

ASME B16.23-2016
(Revision of ASME B16.23-2011)

Cast Copper Alloy Solder Joint Drainage Fittings: DWV

ASMENORMDOC.COM : Click to view the full PDF of ASME B16.23 2016

AN AMERICAN NATIONAL STANDARD



The American Society of
Mechanical Engineers

ASME B16.23-2016
(Revision of ASME B16.23-2011)

Cast Copper Alloy Solder Joint Drainage Fittings: DWV

ASMENORMDOC.COM : Click to view the full PDF of ASME B16.23 2016

AN AMERICAN NATIONAL STANDARD



**The American Society of
Mechanical Engineers**

Two Park Avenue • New York, NY • 10016 USA

Date of Issuance: January 16, 2017

The next edition of this Standard is scheduled for publication in 2021.

ASME issues written replies to inquiries concerning interpretations of technical aspects of this Standard. Periodically certain actions of the ASME B16 Committee may be published as Cases. Cases and interpretations are published on the ASME Web site under the Committee Pages at <http://cstools.asme.org/> as they are issued.

Errata to codes and standards may be posted on the ASME Web site under the Committee Pages to provide corrections to incorrectly published items, or to correct typographical or grammatical errors in codes and standards. Such errata shall be used on the date posted.

The Committee Pages can be found at <http://cstools.asme.org/>. There is an option available to automatically receive an e-mail notification when errata are posted to a particular code or standard. This option can be found on the appropriate Committee Page after selecting "Errata" in the "Publication Information" section.

ASME is the registered trademark of The American Society of Mechanical Engineers.

This code or standard was developed under procedures accredited as meeting the criteria for American National Standards. The Standards Committee that approved the code or standard was balanced to assure that individuals from competent and concerned interests have had an opportunity to participate. The proposed code or standard was made available for public review and comment that provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.

ASME does not "approve," "rate," or "endorse" any item, construction, proprietary device, or activity.

ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable letters patent, nor assumes any such liability. Users of a code or standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this code or standard.

ASME accepts responsibility for only those interpretations of this document issued in accordance with the established ASME procedures and policies, which precludes the issuance of interpretations by individuals.

No part of this document may be reproduced in any form,
in an electronic retrieval system or otherwise,
without the prior written permission of the publisher.

The American Society of Mechanical Engineers
Two Park Avenue, New York, NY 10016-5990

Copyright © 2016 by
THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS
All rights reserved
Printed in U.S.A.

CONTENTS

Foreword	v
Committee Roster	vii
Correspondence With the B16 Committee	viii
Summary of Changes	x
List of Changes in Record Number Order	xi
1 Scope	1
2 General	1
3 Description	1
4 Pitch (Slope)	1
5 Abbreviations	1
6 Size	1
7 Marking	2
8 Material	2
9 Metal Thickness	2
10 Inspection Tolerance	2
11 Threaded Ends	2
12 Configuration of Threaded Ends	3
Figures	
1 Typical Laying Lengths of DWV 90-deg Elbows	4
2 Size Sequence of Fittings	4
Tables	
1 Inspection Tolerance Table	4
2 Dimensions of Solder Joint Ends — DWV	5
3 Dimensions of Threaded Ends — DWV	6
4 Dimensions of DWV Couplings, Reducers, Extended Bushings, and Flush Bushings	7
5 Dimensions of DWV Adapters	8
6 Dimensions of DWV Short Adapters	9
7 Dimensions of DWV Trap Adapters	9
8 Dimensions of C to Soil Pipe Adapter for Joining to Extra Heavy Soil Pipe	10
9 Dimensions of C to Soil Pipe Adapter — Plain End for Joining to Extra Heavy Soil Pipe	11
10 Dimensions of C × No-Hub Soil Pipe Adapter	12
11 Dimensions of C × Hub Soil Pipe Adapter	13
12 Dimensions of DWV 45-deg Y With Cleanout — Soil Pipe (Spigot) × C × Cleanout	13
13 Dimensions of DWV Elbows and Double Elbows — C × C	14
14 Dimensions of Reducing DWV Single and Double Elbows — C × C	15
15 Dimensions of DWV Elbows	16
16 Dimensions of DWV Reducing Elbows	17
17 Dimensions of DWV Elbows	17
18 Dimensions of DWV Tees and Double Tees	18

19	Dimensions of DWV Tees and Double Tees	19
20	Dimensions of DWV Trap Tees	20
21	Dimensions of DWV Double and Quadruple Branch Fittings	20
22	Dimensions of Short Design DWV Tees With Side Inlet(s) (90 deg to Main Inlet), Single and Double	20
23	Dimensions of Short Design DWV Tees With Side Inlet(s) (45 deg to Main Inlet), Single and Double	21
24	Dimensions of Long Design DWV Tees With Side Inlet(s) (90 deg to Main Inlet), Single and Double	21
25	Dimensions of Long Design DWV Tees With Side Inlet(s) (45 deg to Main Inlet), Single and Double	22
26	Dimensions of Single and Double DWV 45-deg Ys	23
27	Dimensions of DWV 45-deg Ys	24
28	Dimensions of DWV Horizontal Twin Branch Tees	24
29	Dimensions of DWV Fitting Tees, Single and Double	24
30	Dimensions of DWV Utility Tees	25
31	Dimensions of DWV Fitting Tees With Side Inlet Maximum Below Centerline	26
32	Dimensions of DWV Long Turn T-Ys, Single and Double	27
33	Dimensions of DWV Double Short T-Y ($C \times C \times F \times F$)	28
34	Dimensions of DWV Double Short T-Y ($C \times C \times C \times C$)	28
35	Dimensions of DWV Elbow With Inlets	28
36	Dimensions of DWV Double Branch Sink Fittings	29
37	Dimensions of DWV Closet Offset Fittings	29
38	Dimensions of DWV 90-deg Closet Elbow	30
39	Dimensions of Floor Flange Vent Support	30
40	Dimensions of DWV Closet Ells With Side Inlet(s) (90 deg and 45 deg) to Main Inlet(s)	31
41	Dimensions of DWV Closet Ells With or Without Side Inlet(s) (90 deg and 45 deg) to Main Inlet(s)	32
42	Dimensions of DWV Closet Flanges	33
43	Dimensions of Vent Tees and Vent Double Tees	34
44	Dimensions of Vent Elbows	34
45	Dimensions of DWV Stack Upturns, Single and Double	34
46	Dimensions of Slip Joint Pieces	35
47	Dimensions of Trap Coupling	35
48	Dimensions of Trap Extended Bushings	35
49	Dimensions of Slip Joint Ends	36
50	Dimensions of DWV Cap	36
51	Dimensions of DWV Plugs	36
52	Dimensions of DWV Drum Traps	37
53	Dimensions of DWV Swivel Drum Traps	38
54	Dimensions of DWV Traps	39
55	Dimensions of DWV Test Tees With Plug	40
56	Dimensions of DWV Plugs	40

Mandatory Appendices

I	U.S. Customary Tables	41
II	References	78

Nonmandatory Appendix

A	Quality System Program	79
---	------------------------------	----

FOREWORD

Standardization work on solder joint fittings began in 1936 in Subcommittee 11 of Sectional Committee A40, Minimum Requirements for Plumbing and Standardization of Plumbing Equipment, organized within the American Standards Association (ASA). It resulted in the publication, in January 1941, of ASA A40.3-1941. That standard covered only supply (pressure) fittings.

In 1949, responsibility for solder joint fittings was transferred to newly formed Subcommittee 9 of Sectional Committee B16 on Standardization of Pipe Flanges and Fittings. The next revision of A40.3 appeared as ASA B16.18-1950, Cast-Brass Solder-Joint Fittings. During its development, however, the need for separate standards for wrought copper and wrought bronze supply fittings and for solder joint drainage fittings was recognized.

Work on the wrought fitting standard was undertaken by a joint committee of the Copper and Brass Research Association and the Manufacturers' Standardization Society of the Valve and Fittings Industry (MSS). That work, properly reviewed and approved, was published as ASA B16.22-1951.

Concurrently, in June 1949, at the request of Subcommittee 9, a task group organized by MSS began work on a standard for cast brass solder joint drainage fittings. Representatives of all U.S. and Canadian manufacturers were invited to participate. The Report of the Coordinating Committee for a National Plumbing Code was taken into account; special research on wall thickness and depth of solder joint was conducted; and coordination with other standards was sought, to avoid inconsistency. After working through nine drafts to reach consensus, the group submitted an April 1952 draft to Subcommittee 9. After committee, sponsor, and ASA approval, the standard was approved as ASA B16.23-1953, Cast Brass Solder Joint Drainage Fittings, on January 30, 1953.

Work soon began on a revision, to include additional sizes, reducing sizes, and additional types of fittings. A March 1955 draft was approved by the B16 Committee, sponsors, and ASA, and published as ASA B16.23-1955. Starting in 1958, responding to requests for further revision and expansion, the MSS task group developed a 1959 draft that was approved by Subcommittee 9, the B16 Committee, sponsors, and ASA, and was published as ASA B16.23-1960.

In 1967 and 1968, a complete revision was undertaken, including engineering studies to verify that a user request for shorter soldering cups was justified. The resulting draft, after approval by Subcommittee 9, USA Standards Committee B16, sponsors, and the (then-called) USA Standards Institute, was published as USAS B16.23-1969. An addenda, dated 1973, lengthened the cups on the three smallest sizes to overcome assembly problems.

The subcommittee, now Subcommittee I, began a new revision in 1974, resulting in the inclusion of the 1973 addenda, addition of metric equivalents, and change of "bronze" to "copper alloy." The draft, finally approved by the (again renamed) American National Standards Institute (ANSI), was published as ANSI B16.23-1976.

In 1982, a new edition updating dimensional tables and metric equivalents was developed. Following approval at all levels, the revision was published as ANSI B16.23-1984.

Also in 1982, American National Standards Committee B16 became the ASME B16 Standards Committee, operating with the same scope, under ASME procedures accredited by ANSI. Subsequently, Subcommittee I merged with Subcommittee J, which had a related scope.

The 1992 edition removed metric units, establishing U.S. Customary units as the standard. Clarifications and updating changes were made to improve the text. The 2002 edition of B16.23 added SI units of measure in the main body of text and moved U.S. Customary units to Mandatory Appendix I. A Nonmandatory Appendix for Quality System Programs was added, plus editorial changes were made to improve text. Following approval by the Standards Committee and ASME, approval as an American National Standard was given on February 6, 2002, with the designation, ASME B16.23-2002.

In the 2011 edition, references to ASME standards were revised to no longer list specific edition years. Following approval by the Standards Committee and the ASME Board on PTCS, the revision to the 2002 edition was approved as an American National Standard by ANSI on September 23, 2011 with the new designation, ASME B16.23-2011.

In this 2016 edition, provisions have been made to update verbiage and readings. Following the approval by the ASME B16 Standards Committee, approval as an American National Standard was given by ANSI on October 21, 2016, with the new designation ASME B16.23-2016.

ASMENORMDOC.COM : Click to view the full PDF of ASME B16.23 2016

ASME B16 COMMITTEE

Standardization of Valves, Flanges, Fittings, and Gaskets

(The following is the roster of the Committee at the time of approval of this Standard.)

STANDARDS COMMITTEE OFFICERS

R. M. Bojarczuk, *Chair*
C. E. Davila, *Vice Chair*
C. Ramcharran, *Secretary*

STANDARDS COMMITTEE PERSONNEL

A. Appleton, Alloy Stainless Products Co., Inc.
J. E. Barker, Dezurik Water Controls
R. W. Barnes, Anric Enterprises, Inc.
K. Barron, Ward Manufacturing
D. C. Bayreuther, Metso Automation, Flow Control Division
W. B. Bedesem, Consultant
R. M. Bojarczuk, ExxonMobil Research and Engineering Co.
A. M. Cheta, Qatar Shell GTL
M. A. Clark, NIBCO, Inc.
G. A. Cuccio, Capitol Manufacturing Co.
J. D'Avanzo, Fluoroseal Valves
C. E. Davila, Crane Energy
D. R. Frikken, Becht Engineering Co.
R. B. Hai, RBH Associates
G. A. Jolly, Consultant

M. Katcher, Haynes International
T. A. McMahon, Emerson Process Management
M. L. Nayyar, NICE
W. H. Patrick, The Dow Chemical Co.
D. Rahoi, Consultant
C. Ramcharran, The American Society of Mechanical Engineers
R. A. Schmidt, Canadoil
J. Tucker, Flowserve
F. R. Volgstadt, Volgstadt & Associates, Inc.
P. Milankov, *Alternate*, Consultant
F. Feng, *Delegate*, China Productivity Center for Machinery
P. V. Craig, *Contributing Member*, Jomar Group
B. F. Fabian, *Contributing Member*, Pennsylvania Machine Works
A. G. Kireta, Jr., *Contributing Member*, Copper Development Association, Inc.
D. F. Reid, *Contributing Member*, VSP Technologies

SUBCOMMITTEE J — COPPER AND COPPER ALLOY FLANGES, FLANGED FITTINGS, AND SOLDER JOINT FITTINGS

A. G. Kireta, Jr., *Chair*, Copper Development Association, Inc.
M. A. Clark, *Vice Chair*, NIBCO, Inc.
E. Lawson, *Secretary*, The American Society of Mechanical Engineers
J. A. Ballanco, JB Engineering and Code Consulting PC
S. L. Cavanaugh, Cavanaugh Consulting
W. E. Chapin, Professional Code Consulting, LLC
D. R. Frikken, Becht Engineering Co.

T. L. Jamison, Jamison Engineering
A. A. Knapp, A. Knapp & Associates
C. A. Mueller, Mueller Industries, Inc.
F. Shingleton, Viega, LLC
G. Morgan, *Alternate*, Viega, LLC
S. Blair, *Contributing Member*, Cerro Flow Products, LLC
M. Gillespie, *Contributing Member*, Viega, LLC

CORRESPONDENCE WITH THE B16 COMMITTEE

General. ASME Standards are developed and maintained with the intent to represent the consensus of concerned interests. As such, users of this Standard may interact with the Committee by requesting interpretations, proposing revisions or a case, and attending Committee meetings. Correspondence should be addressed to:

Secretary, B16 Standards Committee
The American Society of Mechanical Engineers
Two Park Avenue
New York, NY 10016-5990
<http://go.asme.org/Inquiry>

Proposing Revisions. Revisions are made periodically to the Standard to incorporate changes that appear necessary or desirable, as demonstrated by the experience gained from the application of the Standard. Approved revisions will be published periodically.

The Committee welcomes proposals for revisions to this Standard. Such proposals should be as specific as possible, citing the paragraph number(s), the proposed wording, and a detailed description of the reasons for the proposal, including any pertinent documentation.

Proposing a Case. Cases may be issued to provide alternative rules when justified, to permit early implementation of an approved revision when the need is urgent, or to provide rules not covered by existing provisions. Cases are effective immediately upon ASME approval and shall be posted on the ASME Committee Web page.

Requests for Cases shall provide a Statement of Need and Background Information. The request should identify the Standard and the paragraph, figure, or table number(s), and be written as a Question and Reply in the same format as existing Cases. Requests for Cases should also indicate the applicable edition(s) of the Standard to which the proposed Case applies.

Interpretations. Upon request, the B16 Standards Committee will render an interpretation of any requirement of the Standard. Interpretations can only be rendered in response to a written request sent to the Secretary of the B16 Standards Committee.

Requests for interpretation should preferably be submitted through the online Interpretation Submittal Form. The form is accessible at <http://go.asme.org/InterpretationRequest>. Upon submittal of the form, the Inquirer will receive an automatic e-mail confirming receipt.

If the Inquirer is unable to use the online form, he/she may e-mail the request to the Secretary of the B16 Standards Committee at SecretaryB16@asme.org, or mail it to the above address. The request for an interpretation should be clear and unambiguous. It is further recommended that the Inquirer submit his/her request in the following format:

Subject:	Cite the applicable paragraph number(s) and the topic of the inquiry in one or two words.
Edition:	Cite the applicable edition of the Standard for which the interpretation is being requested.
Question:	Phrase the question as a request for an interpretation of a specific requirement suitable for general understanding and use, not as a request for an approval of a proprietary design or situation. Please provide a condensed and precise question, composed in such a way that a "yes" or "no" reply is acceptable.
Proposed Reply(ies):	Provide a proposed reply(ies) in the form of "Yes" or "No," with explanation as needed. If entering replies to more than one question, please number the questions and replies.
Background Information:	Provide the Committee with any background information that will assist the Committee in understanding the inquiry. The Inquirer may also include any plans or drawings that are necessary to explain the question; however, they should not contain proprietary names or information.

Requests that are not in the format described above may be rewritten in the appropriate format by the Committee prior to being answered, which may inadvertently change the intent of the original request.

ASME procedures provide for reconsideration of any interpretation when or if additional information that might affect an interpretation is available. Further, persons aggrieved by an interpretation may appeal to the cognizant ASME Committee or Subcommittee. ASME does not "approve," "certify," "rate," or "endorse" any item, construction, proprietary device, or activity.

Attending Committee Meetings. The B16 Standards Committee regularly holds meetings and/or telephone conferences that are open to the public. Persons wishing to attend any meeting and/or telephone conference should contact the Secretary of the B16 Standards Committee.

ASMENORMDOC.COM : Click to view the full PDF of ASME B16.23 2016

ASME B16.23-2016

SUMMARY OF CHANGES

Following approval by the ASME B16 Committee and ASME, and after public review, ASME B16.23-2016 was approved by the American National Standards Institute on October 21, 2016.

ASME B16.23-2016 includes the following change identified by a margin note, (16). The Record Numbers listed below are explained in more detail in "List of Changes in Record Number Order" following this Summary of Changes.

<i>Page</i>	<i>Location</i>	<i>Change (Record Number)</i>
1	1	In first paragraph, last line revised (12-606)
6	Table 3	Notes (3) and (4) revised (12-606)
43	Table I-3	Notes (3) and (4) revised (12-606)
78	Mandatory Appendix II	Revised (16-1574)

LIST OF CHANGES IN RECORD NUMBER ORDER

Record Number	Change
12-606	Revised Scope, Table footnotes, and Mandatory Appendix II
16-1574	Updated Mandatory Appendix II References

ASMENORMDOC.COM : Click to view the full PDF of ASME B16.23 2016

ASMENORMDOC.COM : Click to view the full PDF of ASME B16.23 2016

INTENTIONALLY LEFT BLANK

CAST COPPER ALLOY SOLDER JOINT DRAINAGE FITTINGS: DWV

(16) 1 SCOPE

This Standard establishes specifications for cast copper alloy solder joint drainage fittings, designed for use in drain, waste, and vent (DWV) systems. These fittings are designed for use with seamless copper tube conforming to ASTM B306, Copper Drainage Tube (DWV), as well as fittings intended to be assembled with soldering materials conforming to ASTM B32, or tapered pipe thread conforming to ASME B1.20.1.

This Standard is allied with ASME B16.29, Wrought Copper and Wrought Copper Alloy Solder Joint Drainage Fittings — DWV.

It provides requirements for fitting ends suitable for soldering. This Standard covers

- (a) description
- (b) pitch (slope)
- (c) abbreviations for end connections
- (d) sizes and methods for designing openings for reducing fittings
- (e) marking
- (f) material
- (g) dimensions and tolerances

2 GENERAL

2.1 Relevant Units

This Standard states values in both SI (Metric) and U.S. Customary units. These systems of units are to be regarded separately as standard. Within the text, the U.S. Customary units are shown in parentheses or in separate tables that appear in Mandatory Appendix I. The values stated in each system are not exact equivalents; therefore, it is required that each system of units be used independently of the other. Combining values from the two systems constitutes nonconformance with the Standard.

2.2 References

Standards and specifications adopted by reference in this Standard are shown in Mandatory Appendix II, which is part of this Standard. It is not considered practical to identify the specific edition of each standard and specification in the individual references. Instead, the specific edition reference is identified in Mandatory Appendix II.

2.3 Quality Systems

Requirements relating to the product manufacturer's quality system programs are described in Nonmandatory Appendix A.

3 DESCRIPTION

(a) These fittings are designed for drainage and vent systems using the solder joint method of connection. The fitting cups (C), are provided with stops so that the ends of the tube, when assembled, meet the stops, thereby forming essentially smooth passageways.

(b) The sketches and designs of fittings are illustrative only. The dimensions specified herein shall govern in all cases.

4 PITCH (SLOPE)

All nominal 90-deg fittings shall be pitched to result in a slope of 21 mm/m (0.25 in./ft) (2.1%) of length of horizontal tube with reference to a horizontal plane (see Fig. 1).

5 ABBREVIATIONS

The following symbols are used to designate the type of fitting end:

- C = solder-joint fitting end made to receive copper tube diameter (female)
- F = internal ANSI Standard taper pipe thread (female) NPT
- FTG = solder-joint fitting end made to copper tube diameter (male)
- M = external ANSI Standard taper pipe thread (male) NPT
- NPSM = standard straight mechanical pipe thread
- SJ = end of fitting made to receive O.D. tube size

6 SIZE

(a) The size of the fittings scheduled in Tables 1 through 56 and Tables I-1 through I-56 corresponds to the drainage tube size shown in ASTM B306. The size of the threaded ends (except slip joints) corresponds to the nominal pipe size.

(b) Fittings are designated by the size of the openings in the sequence illustrated in Fig. 2.

7 MARKING

(a) Each fitting shall be marked permanently and legibly with the manufacturer's name or trademark and with "DWV" (to indicate Drain Waste Vent).

(b) Vent fittings shall be permanently marked "VENT ONLY" (See Tables 43, 44, I-43, and I-44) and show the manufacturer's name or trademark in accordance with MSS SP-25.

8 MATERIAL

Castings shall be copper alloy produced to meet

- (a) the requirements of ASTM B62 Alloy C83600; or
- (b) the chemical and tensile requirements of ASTM B584 Alloy 83800 or 84400, and in all other respects comply with the requirements of ASTM B62.

9 METAL THICKNESS

Dimensional variations will occur in the casting process. Pattern equipment shall be designed to produce the metal thickness given for fittings in Table 2 or Table I-2.

Any final fitting metal wall thickness less than 90% of the thickness given in the table is unacceptable.

10 INSPECTION TOLERANCE

10.1 Convention

For determining conformance with this Standard, the convention for fixing significant digits where limits (maximum and minimum values) are specified shall be as defined in ASTM E29. This requires that an observed or calculated value be rounded off to the nearest unit in the last right-hand digit used for expressing the limit. Decimal values and tolerances do not imply a particular method of measurement.

10.2 Linear Dimensions

DWV fittings covered by this Standard shall conform to the laying lengths specified in Tables 4 through 56 and Tables I-4 through I-56. An inspection tolerance, as shown in Table 1 or Table I-1, shall be allowed on center-to-shoulder, center-to-threaded end, and shoulder-to-threaded end dimensions on all fittings having internal solder (cup) ends; and on center-to-solder end, solder end-to-shoulder, and solder end-to-threaded dimensions on all fittings having external solder (fitting) ends. The largest opening in the fitting governs the tolerance to be applied to all openings.

The inspection tolerance for laying length dimensions A, B, and C (in Table 4 or Table I-4) shall be double those shown above, except the minus tolerance applied to

couplings; dimension A shall not result in a dimension less than 2.3 mm (0.09 in.).

10.3 Ovality

Maximum ovality shall not exceed 1% of the maximum diameters shown in Table 2 or Table I-2. The average of the maximum and minimum diameters shall be within the dimensions shown in the table.

10.4 Alignment

The maximum allowable variations in the regular alignment of all openings shall be 5 mm/m (0.06 in./ft).

10.5 Gaging of Solder Joint Ends

(a) *Standard Gaging Method of Solder Joint Ends.* The standard method of gaging the diameter tolerances for male and female ends shall be by the use of plain plug and ring gages designed to hold the product within the limits established in Table 2 or Table I-2.

(b) *Optional Gaging Method of Solder Joint Ends.* For gaging the diameter tolerance of male and female ends, the manufacturer may use direct reading instruments instead of ring and plug gages as specified in (a). When gaging the diameters of male and female ends, using direct reading instruments, refer to para. 10.3.

11 THREADED ENDS

11.1 General

Threaded ends shall conform to the dimensional requirements contained within Table 3 or Table I-3. Fitting threads shall be right-hand, conforming to ASME B1.20.1. They shall be taper threads (NPT) except for slip joint ends, which shall have straight pipe threads (NPSM).

11.2 Thread Dimensions

All internal threads shall be countersunk a distance not less than one-half the pitch of the thread at an angle of approximately 45 deg with the axis of the thread.

All external threads shall be chamfered at an angle of 30 deg to 45 deg from the axis. This facilitates joint assembly and thread protection. Countersinking and chamfering shall be concentric to the threads. The length of threads specified in all tables shall be measured to include the countersink or chamfer.

11.3 Threading Tolerances

Tapered pipe threads (NPT) shall be checked by use of working plug or ring gages either standard or limit types. Gages shall be threaded hand tight. The reference point for gaging internal taper threads, the plug gage, shall be screwed hand tight into the fitting. Internal product threads depend upon the chamfer diameter. When the internal chamfer diameter exceeds the major diameter of the internal thread, the reference point shall

be the last thread scratch on the chamfer cone. Otherwise, when the internal chamfer diameter does not exceed the major diameter of the internal thread, the reference point shall be the end of the fitting. On the external thread it shall be flush with the end of the fitting.

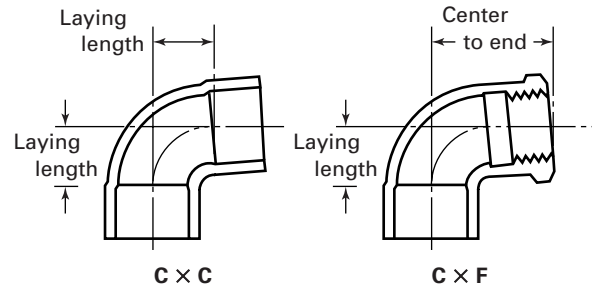
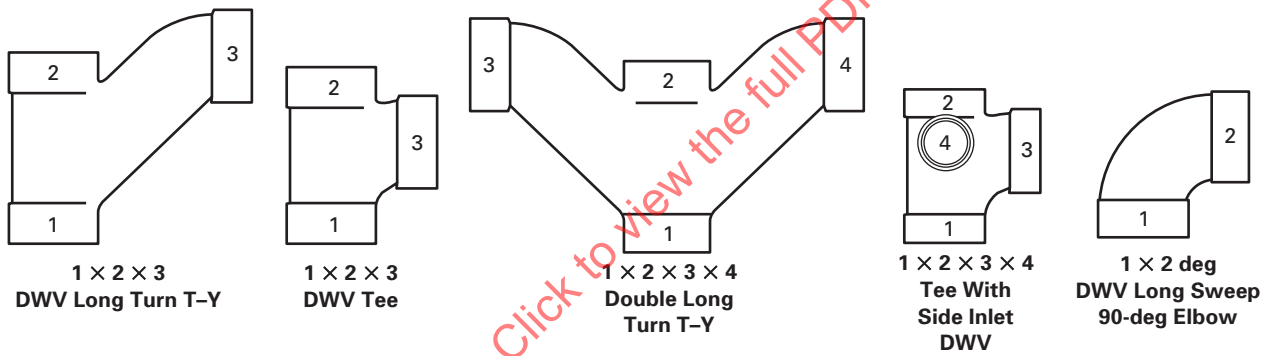
Tolerance for an internal threaded end having an internal shoulder shall be from one turn large to one turn small. Tolerance for an internal threaded end without shoulder and for an external threaded end shall be from one-half turn small to one and one-half turn large.

Straight pipe threads (NPSM) shall be checked by use of the standard GO and NO GO plug and ring gages.

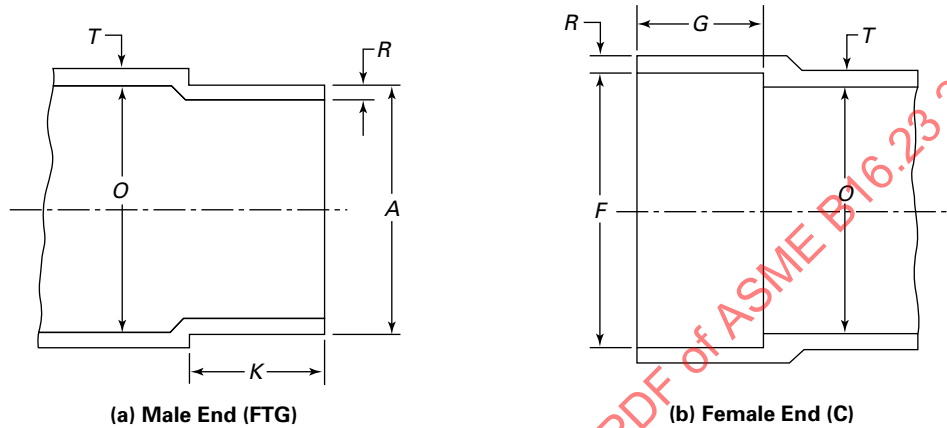
12 CONFIGURATION OF THREADED ENDS

At the manufacturer's option, female ends of fittings may be furnished with a polygon or bead with or without ribs, and male ends of fittings may be furnished with a polygon, ribs, or flats.

ASMENORMDOC.COM : Click to view the full PDF of ASME B16.23 2016

Fig. 1 Typical Laying Lengths of DWV 90-deg Elbows**Fig. 2 Size Sequence of Fittings****Table 1 Inspection Tolerance Table**

Nominal Size	± mm
$1\frac{1}{4}$, $1\frac{1}{2}$, and 2	2.0
3	2.8
4 and 5	3.2
6 and 8	4.0

Table 2 Dimensions of Solder Joint Ends — DWV

Nominal Size [Note (1)]	Male End			Female End			Metal Thickness [Note (4)]		Minimum Inside Diameter of Fitting, <i>O</i>
	Outside Diameter, <i>A</i> [Note (2)]		Minimum Length, <i>K</i> [Note (3)]	Inside Diameter, <i>F</i> [Note (2)]		Minimum Depth, <i>G</i>			
	Min.	Max.		Min.	Max.				
							Body, <i>T</i>	Joint, <i>R</i>	
1¼	34.85	34.98	14.2	35.00	35.10	12.7	2.5	1.8	32.8
1½	41.17	41.33	15.7	41.35	41.48	14.2	2.5	2.0	38.9
2	53.87	54.03	17.5	54.05	54.18	15.7	2.5	2.3	51.1
3	79.27	79.43	20.6	79.45	79.58	19.1	3.0	2.5	75.7
4	104.67	104.83	26.9	104.85	104.98	25.4	3.0	3.0	99.8
5	130.07	130.23	33.3	130.25	130.38	31.8	4.8	4.8	124.7
6	155.47	155.63	41.1	155.65	155.78	38.1	4.8	4.8	149.4
8	206.22	206.43	53.8	206.45	206.58	50.8	5.6	5.6	197.6

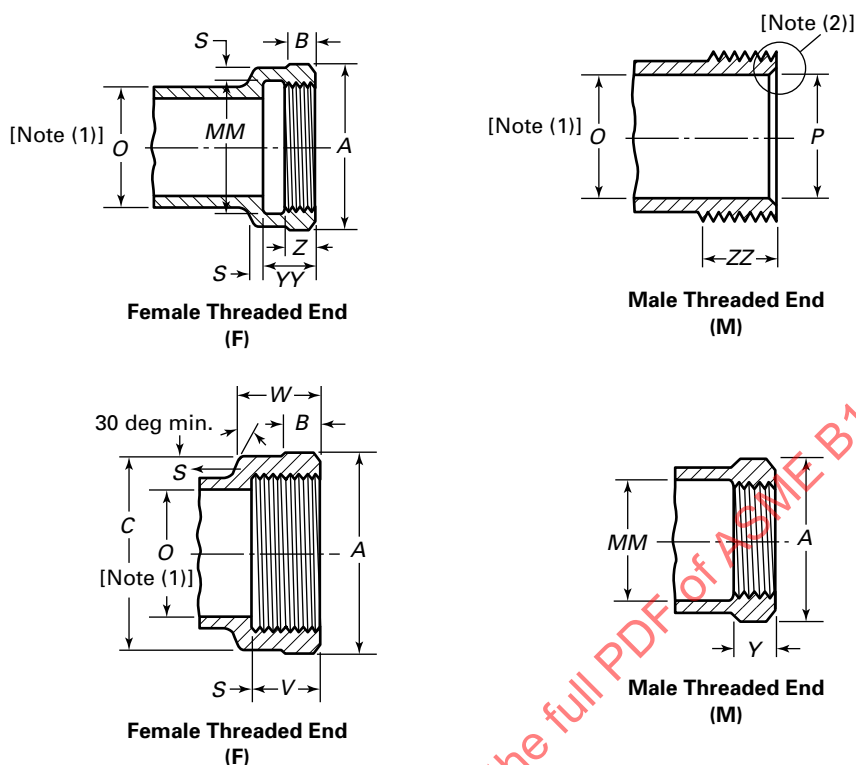
GENERAL NOTES:

- (a) Primary dimensions are in millimeters.
 (b) The sketches and designs of fittings are illustrative only. The dimensions herein shall govern in all cases.

NOTES:

- (1) For size designation of fitting, see section 6.
 (2) For ovality, see para. 10.3.
 (3) *K* dimensions of 11.2 mm, 12.7 mm, and 14.2 mm and *G* dimensions of 9.7 mm, 11.2 mm, and 12.7 mm, respectively, for 1 $\frac{1}{4}$ -in., 1 $\frac{1}{2}$ -in., and 2-in. sizes are sound and acceptable from an engineering standpoint. However, the cup depths specified in Table 2 are to provide greater facility in making installations.
 (4) For metal thickness tolerance, see section 9.

(16)

Table 3 Dimensions of Threaded Ends — DWV

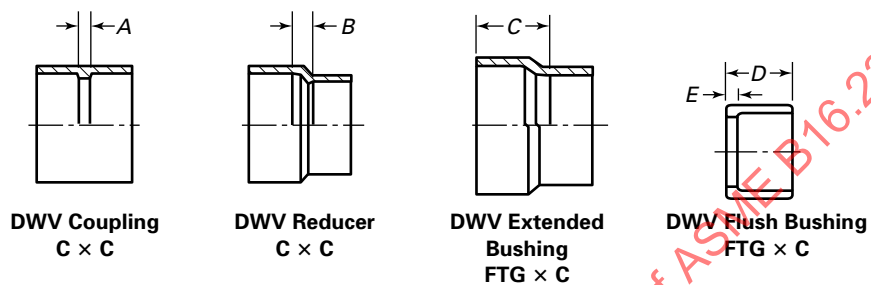
Nominal Thread Size [Note (3)]	Minimum Dia. of Band or Across Flats of Polygon, A	Minimum Band Length, B	Minimum Dia. of Body Over Thread, C	Minimum Dia. of Recess, MM [Note (4)]	Minimum Depth of Full Thread, V	Minimum, W	Minimum Length of Thread, Y	Minimum End To Shoulder, YY ±1.5 [Note (4)]	Minimum Thread End Wall, S [Note (5)]	Maximum Thread End Bore, P [Note (4)]	Minimum Length of Effective Thread, ZZ
1 $\frac{1}{4}$	48.5	7.9	48.3	42.2	18.0	25.4	10.7	17.8	3.05	33.27	18.034
1 $\frac{1}{2}$	55.1	8.6	55.1	48.5	18.3	25.4	10.7	18.3	3.30	39.37	18.3
2	68.3	10.4	68.1	60.5	19.3	26.2	11.2	19.1	3.81	51.56	19.3
3	98.6	14.0	98.6	88.9	30.5	37.1	19.6	30.5	4.83	77.47	30.5
4	125.5	16.8	125.5	114.3	33.0	38.9	21.3	33.0	5.59	102.87	33.0
5	155.4	19.8	155.4	141.2	35.8	42.2	23.9	35.8	7.11	126.49	35.8
6	185.4	22.4	185.4	168.1	38.4	42.7	24.4	38.1	8.64	153.16	38.4
8	238.3	28.4	238.0	218.9	43.4	44.5	26.9	43.2	9.53	201.93	43.4

GENERAL NOTES:

- (a) Dimensions are in millimeters.
 (b) For threads of threaded ends, see section 11.

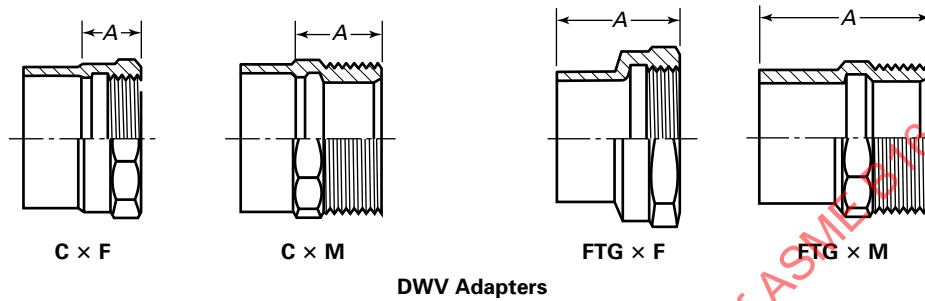
NOTES:

- (1) For inside diameter of fitting, see Table 2.
 (2) 1 $\frac{1}{4}$, 1 $\frac{1}{2}$, and 2 male threaded ends may have inside chamfer for slip nut connections.
 (3) Thread size is American National Standard Pipe Threads, General Purpose (Inch), ASME B1.20.1.
 (4) Dimensions computed using formula $E_1 - h - 2T$.
 E_1 = thread pitch diameter from ASME B1.20.1
 h = height of thread from ASME B1.20.1
 T = metal thickness from Table 2
 (5) For initial thickness tolerance, see section 9.

Table 4 Dimensions of DWV Couplings, Reducers, Extended Bushings, and Flush Bushings


Nominal Size	Coupling, A	Reducer, B	Extended Bushing, C	Flush Bushing	
				D	E
1 ¹ / ₄	3.0	...	...	...	...
1 ¹ / ₂	3.0	...	...	...	...
1 ¹ / ₂ × 1 ¹ / ₄	...	6.4	19.1	15.7	3.0
2	3.0	...	...	...	...
2 × 1 ¹ / ₂	...	9.7	23.1	17.5	3.3
2 × 1 ¹ / ₄	...	11.2	23.9	17.5	4.8
3	4.8	...	...	...	...
3 × 2	...	19.1	35.1	20.6	4.8
3 × 1 ¹ / ₂	...	23.9	33.3	20.6	6.4
3 × 1 ¹ / ₄	...	23.9	33.3	...	...
4	4.8	...	...	...	...
4 × 3	...	8.6	41.1	26.9	7.9
4 × 2	...	12.7	44.5	...	...
4 × 1 ¹ / ₂	...	38.1	...	...	...
5	6.4	...	...	...	...
5 × 4	...	14.2	39.6	...	...
5 × 3	...	22.4	47.8	...	...
6	6.4	...	...	...	...
6 × 5	...	13.5	74.7	...	...
8	9.7	...	...	...	...
8 × 6	...	35.1	...	...	...

GENERAL NOTE: Dimensions are in millimeters.

Table 5 Dimensions of DWV Adapters



Nominal Size	C × F, A	C × M, A	FTG × F, A	FTG × M, A
1 $\frac{1}{4}$	20.6	23.9	37.3	49.3
1 $\frac{1}{4}$ × 2	23.9	33.3	...	...
1 $\frac{1}{4}$ × 1 $\frac{1}{2}$	20.6	28.4	...	...
1 $\frac{1}{2}$	20.6	23.9	38.9	52.3
1 $\frac{1}{2}$ × 2	22.4	31.8	...	...
1 $\frac{1}{2}$ × 1 $\frac{1}{4}$	20.6	26.9	...	...
2	22.4	23.9	41.4	60.5
2 × 3	47.8	...	...	...
2 × 1 $\frac{1}{2}$	22.4	26.9	...	...
2 × 1 $\frac{1}{4}$	22.4	26.9	...	...
3	38.1	39.6	60.5	76.2
3 × 4	57.2	...	...	...
3 × 2	39.6	36.6	...	...
4	42.2	41.1	71.4	91.9
4 × 3	42.9	...	...	...
5	49.3	44.5	...	...
6	55.6	50.8	96.8	...
8	66.5	85.9	111.3	...

GENERAL NOTE: Dimensions are in millimeters.

Table 6 Dimensions of DWV Short Adapters**C × M
DWV Short Adapters**

Nominal Size	C × M	
	A	B
1 $\frac{1}{4}$	25.4	12.7
1 $\frac{1}{2}$	25.4	11.2
1 $\frac{1}{4}$ × 1 $\frac{1}{2}$	25.4	12.7
2	28.4	12.7
1 $\frac{1}{2}$ × 2	30.2	15.7

GENERAL NOTE: Dimensions are in millimeters.

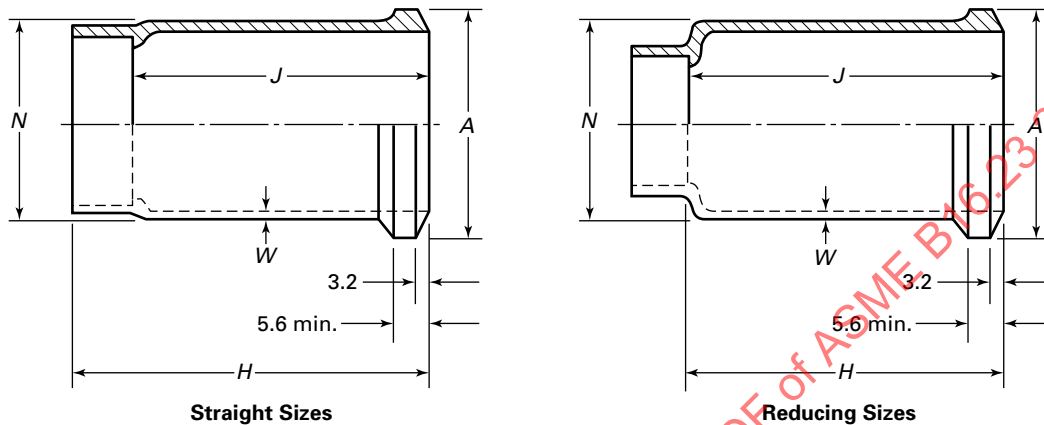
Table 7 Dimensions of DWV Trap Adapters**FTG × SJ****C × SJ****DWV Trap Adapters**

Nominal Size	FTG × SJ, A	C × SJ, A
	A	A
1 $\frac{1}{4}$	30.2	15.7
1 $\frac{1}{2}$	31.8	17.5
1 $\frac{1}{2}$ × 1 $\frac{1}{4}$	...	17.5
2	...	17.5
2 × 1 $\frac{1}{2}$	...	17.5

GENERAL NOTES:

(a) Primary dimensions are in millimeters.

(b) For dimensions of slip joint ends, see Table 49.

Table 8 Dimensions of C to Soil Pipe Adapter for Joining to Extra Heavy Soil Pipe**DWV Soil Pipe Adapter — C x Spigot**

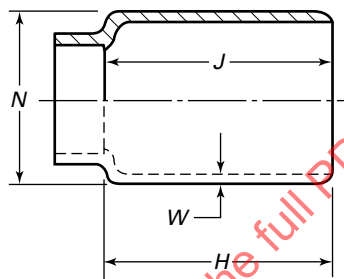
Nominal Size Soil Pipe, C x Spigot [Note (1)]	Diameter of Bead, A		Body Wall, W	Body Outside Diameter [Note (2)], N ± 2.286 mm	Body Length [Note (3)], H ± 1.524 mm	Laying Length, J
	Min.	Max.				
2 x 2	69.9	68.3	2.5	60.5	63.5	63.5
1 x 2	69.9	68.3	2.5	60.5	82.6	58.7
1½ x 2	69.9	68.3	2.5	60.5	82.6	58.7
1¼ x 2	69.9	68.3	2.5	60.5	82.6	84.1
3 x 3	98.6	96.8	3.0	88.9	69.9	69.9
2 x 3	98.6	96.8	3.0	88.9	88.9	90.4
1½ x 3	98.6	96.8	3.0	88.9	88.9	90.4
4 x 4	124.0	122.2	3.0	114.3	76.2	76.2
3 x 4	124.0	122.2	3.0	114.3	95.3	96.8
2 x 4	124.0	122.2	3.0	114.3	95.3	98.6
1½ x 4	124.0	122.2	3.0	114.3	95.3	98.6
5 x 5	149.4	147.6	4.8	139.7	76.2	76.2
6 x 6	174.8	173.0	5.6	165.1	76.2	76.2

GENERAL NOTE: Dimensions are in millimeters.

NOTES:

- (1) Dimensions given are for extra heavy weight soil pipe. Refer to ASTM A74. For service weight, A and N may be reduced as shown in Table 2 of ASTM A74. Service weight adapters should be marked "SW" or "SERVICE WEIGHT."
- (2) N is taken from outside diameter of XH soil pipe.
- (3) H body lengths are based on "telescoping lengths of XH soil pipe hubs."

Table 9 Dimensions of C to Soil Pipe Adapter — Plain End for Joining to Extra Heavy Soil Pipe



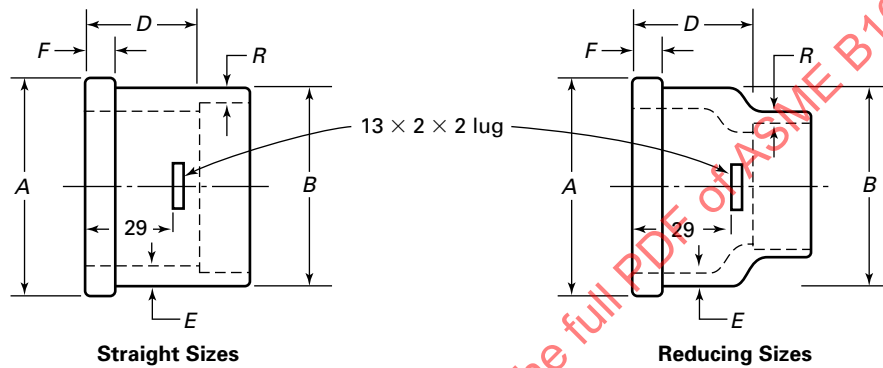
**C × Soil Pipe
DWV Soil Pipe Adapters — Plain End
[Note (1)]**

Nominal Size	Body Length, $H \pm 1.524 \text{ mm}$	Body Outside Diameter, $N \pm 2.286 \text{ mm}$	Body Wall, W	Laying Length, J
2 × 2	63.5	60.5	2.5	63.5
1 $\frac{1}{4}$ × 2	63.5	60.5	2.5	65.0
1 $\frac{1}{2}$ × 2	63.5	60.5	2.5	65.0
3 × 3	69.9	88.9	3.0	69.9
2 × 3	69.9	88.9	3.0	71.4
3 × 4	76.2	114.3	3.0	77.7

GENERAL NOTE: Dimensions are in millimeters.

NOTE:

(1) For use with elastomer gasket.

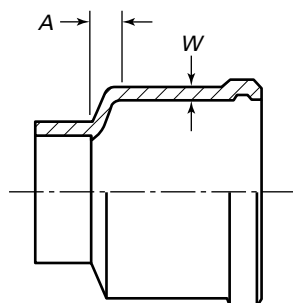
Table 10 Dimensions of C × No-Hub Soil Pipe Adapter**DWV Soil Pipe Adapter — C × No-Hub**
[Note (1)]

Nominal Size C × No-Hub	Diameter of Bead, A ±1.524 mm	Outside Diameter of Body, B ±1.524 mm	Laying Length, D	Metal Thickness [Note (2)]		Minimum Width Bead, F +3.302 mm −0.0 mm
				Body, E	Joint, R	
2	60.5	58.7	31.0	2.54	2.29	6.4
1½ × 2	60.5	58.7	31.8	2.54	1.98	6.4
1¼ × 2	60.5	58.7	32.5	2.54	1.83	6.4
3	86.6	84.8	31.0	3.05	2.62	6.4
2 × 3	86.6	84.8	31.8	3.05	2.29	6.4
1½ × 3	86.6	84.8	32.5	3.05	1.98	6.4
4	112.8	111.3	31.0	3.05	3.05	7.9
3 × 4	112.8	111.3	31.8	3.05	2.62	7.9

GENERAL NOTE: Dimensions are in millimeters.

NOTES:

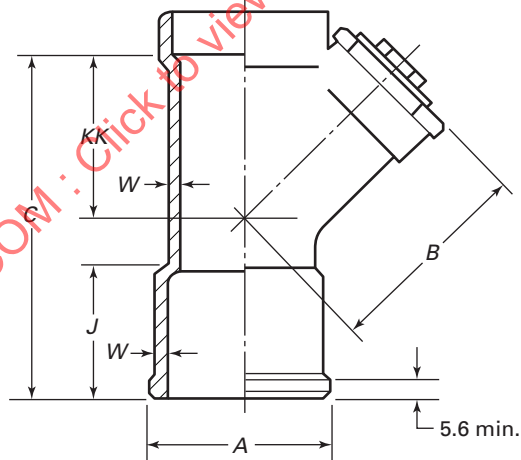
- (1) For use with stainless steel clamp and elastomer gasket.
- (2) For metal thickness tolerance, see section 9.

Table 11 Dimensions of C × Hub Soil Pipe Adapter**DWV Soil Pipe Adapter
C × Hub**

Nominal Size	A	W
3	9.7	3.0
3 × 4	11.2	3.0
4	4.8	3.0

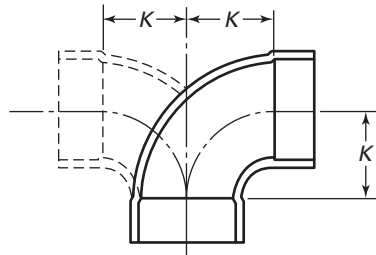




GENERAL NOTES:

- (a) Dimensions are in millimeters.
 (b) For hub dimensions, see ASTM A74.

Table 12 Dimensions of DWV 45-deg Y With Cleanout — Soil Pipe (Spigot) × C × Cleanout**DWV 45-deg Y With Cleanout**

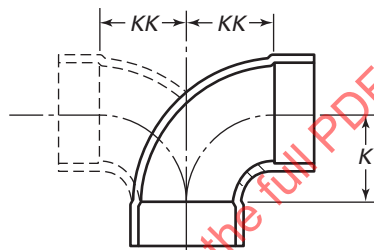
Nominal Size	A		Maximum, B	C	J	KK	W
	Max.	Min.					
4 × 3 × 3	122.7	122.2	130.0	215.9	76.2	104.6	3.0

GENERAL NOTE: Dimensions are in millimeters.

Table 13 Dimensions of DWV Elbows and Double Elbows — C × C**DWV 90-deg Elbow**
C × C and C × C × C**DWV 60-deg Elbow**
C × C**DWV 45-deg Elbow**
C × C**DWV 22½-deg Elbow**
C × C**DWV 11¼-deg Elbow**
C × C

Angle	Dimension	Nominal Size							
		1¼	1½	2	3	4	5	6	8
DWV 90-deg elbow, C × C	K	30.2	36.6	49.3	74.7	98.6	124.0	147.6	198.4
DWV 60-deg elbow, C × C	K	17.5	20.6	28.4	42.9	57.2	73.2	88.9	117.3
DWV 45-deg elbow, C × C	K	12.7	14.2	20.6	30.2	41.1	52.3	63.5	84.1
DWV 22½-deg elbow, C × C	K	4.8	6.4	9.7	14.2	19.1	23.9	28.4	38.1
DWV 11¼-deg elbow, C × C	K	3.0	3.0	4.8	6.4	7.9	10.4	12.7	16.8












GENERAL NOTE: Dimensions are in millimeters.

Table 14 Dimensions of Reducing DWV Single and Double Elbows — C × C

DWV 90-deg Elbow, C × C
DWV Double Elbow, C × C × C

Angle	Dimension	Nominal Size C × C or C × C × C			
		1½ × 1¼	2 × 1½	2 × 1¼	4 × 3
DWV 90-deg reducing elbow, C × C	K	30.2	36.6	30.2	71.4
	KK	33.3	42.9	39.6	76.2

GENERAL NOTE: Dimensions are in millimeters.

Table 15 Dimensions of DWV Elbows**DWV 90-deg Elbow
FTG × C****DWV 90-deg Elbow
C × F****DWV 90-deg Elbow
FTG × F****DWV 90-deg Elbow
C × M****DWV 60-deg Elbow
C × M****DWV 45-deg Elbow
FTG × C****DWV 45-deg Elbow
C × F****DWV 45-deg Elbow
C × M****DWV 45-deg Elbow
FTG × M****DWV 22½-deg Elbow
C × M****DWV 11¼-deg Elbow
C × M**

Angle	Dimensions	Nominal Size				
		1¼	1½	2	3	4
DWV 90-deg elbow, FTG × C	K	30.2	36.6	49.3	74.7	98.6
	G	44.5	53.8	68.3	95.3	124.0
DWV 90-deg elbow, C × F	K	30.2	36.6	49.3	74.7	98.6
	L	47.8	53.8	68.3	100.1	125.5
DWV 90-deg elbow, FTG × F	G	44.5	52.3	68.3	95.3	122.2
	L	47.8	53.8	68.3	100.1	127.0
DWV 90-deg elbow, C × M	K	30.2	36.6	49.3	74.7	98.6
	L	47.8	53.8	71.4	100.1	125.5
DWV 45-deg elbow, FTG × C	K	12.7	14.2	20.6	30.2	41.1
	G	25.9	30.2	38.1	50.8	68.3

GENERAL NOTES:

- (a) Dimensions are in millimeters.
 (b) See Table 16 for reducing sizes.
 (c) See Table 17 for continuation of dimensions.

Table 16 Dimensions of DWV Reducing Elbows

Nominal Size	DWV 90-deg Elbow, C × F		DWV 90-deg Elbow, C × M	
	<i>K</i>	<i>L</i>	<i>K</i>	<i>L</i>
1½ × 1¼	33.3	50.8	33.3	47.8

GENERAL NOTES:

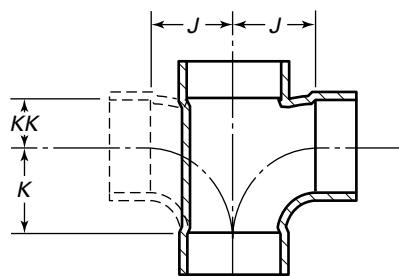
- (a) Dimensions are in millimeters.
(b) Refer to illustrations for Table 15.

Table 17 Dimensions of DWV Elbows

Angle	Dimensions	Nominal Size		
		1¼	1½	2
DWV 60-deg elbow, C × M	<i>K</i>	16.8	20.6	27.7
	<i>L</i>	32.5	38.1	46.7
DWV 45-deg elbow, C × F	<i>K</i>	7.6	9.1	19.1
	<i>L</i>	32.5	35.1	42.2
DWV 45-deg elbow, C × M	<i>K</i>	12.7	14.2	19.1
	<i>L</i>	30.2	33.3	33.8
DWV 45-deg elbow, FTG × M	<i>L</i>	26.9	31.8	33.8
	<i>G</i>	26.2	30.2	33.0
DWV 22½-deg elbow, C × M	<i>K</i>	4.8	6.4	8.6
	<i>L</i>	20.6	23.9	27.7
DWV 11¼-deg elbow, C × M	<i>K</i>	3.0	3.0	4.8
	<i>L</i>	19.1	20.5	23.9

GENERAL NOTES:

- (a) Dimensions are in millimeters.
(b) Refer to illustrations for Table 15.

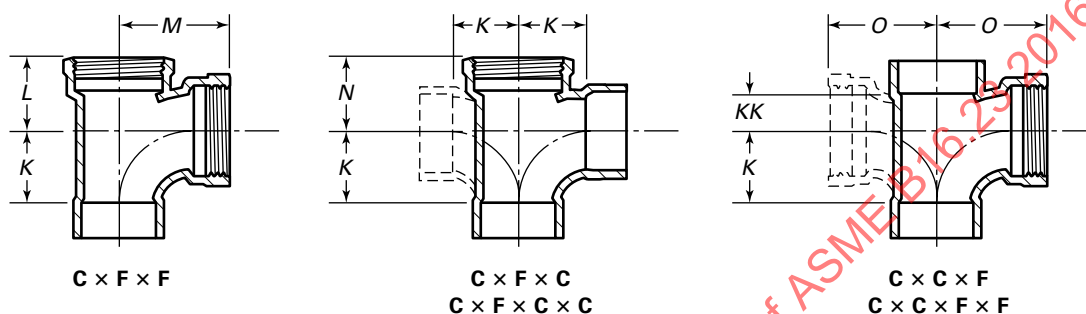
Table 18 Dimensions of DWV Tees and Double Tees

DWV Tees
C × C × C
C × C × C × C

Nominal Size	J	K	KK
1 $\frac{1}{4}$	30.2	30.2	17.5
1 $\frac{1}{2}$	36.6	36.6	20.6
1 $\frac{1}{2}$ × 1 $\frac{1}{2}$ × 1 $\frac{1}{4}$	33.3	30.2	17.5
1 $\frac{1}{2}$ × 1 $\frac{1}{4}$ × 1 $\frac{1}{2}$	36.6	36.6	20.6
1 $\frac{1}{2}$ × 1 $\frac{1}{4}$ × 1 $\frac{1}{4}$	33.3	30.2	19.1
2	49.3	49.3	25.4
2 × 2 × 1 $\frac{1}{2}$	42.9	36.6	20.6
2 × 2 × 1 $\frac{1}{4}$	39.6	30.2	17.5
2 × 1 $\frac{1}{2}$ × 2	49.3	49.3	25.4
2 × 1 $\frac{1}{2}$ × 1 $\frac{1}{2}$	42.9	36.6	20.6
2 × 1 $\frac{1}{2}$ × 1 $\frac{1}{4}$	42.9	36.6	19.1
3	74.7	74.7	38.1
3 × 3 × 2	62.0	49.3	25.4
3 × 3 × 1 $\frac{1}{2}$	55.6	36.6	20.6
3 × 3 × 1 $\frac{1}{4}$	52.3	30.2	17.5
3 × 2 × 3	74.7	74.7	32.5
3 × 2 × 2	62.0	49.3	24.6
3 × 2 × 1 $\frac{1}{2}$	71.4	36.6	21.3
3 × 1 $\frac{1}{2}$ × 3	74.7	74.7	31.8
3 × 1 $\frac{1}{2}$ × 1 $\frac{1}{2}$	55.6	36.6	17.5
4	98.6	98.6	52.3
4 × 4 × 3	87.4	74.7	38.1
4 × 4 × 2	73.2	49.3	25.4
4 × 4 × 1 $\frac{1}{2}$	66.5	36.6	20.6
4 × 4 × 1 $\frac{1}{4}$	63.5	30.2	17.5
4 × 2 × 4	98.6	98.6	31.8
5	124.0	124.0	58.7
5 × 5 × 4	111.3	98.6	49.3
6	147.6	147.6	69.9
6 × 6 × 4	124.0	98.6	49.3
6 × 4 × 4	122.2	98.6	38.1
8	198.4	198.4	87.4
8 × 8 × 6	169.9	147.6	68.3
8 × 6 × 6	171.5	147.6	58.7

GENERAL NOTE: Dimensions are in millimeters.



Table 19 Dimensions of DWV Tees and Double Tees



DWV Tees and Double Tees

Nominal Size	K	L	M	N	O	KK
1 $\frac{1}{4}$	30.2	35.1	47.8	35.1	47.8	17.5
1 $\frac{1}{2}$	36.6	39.6	55.6	38.1	53.8	20.6
1 $\frac{1}{2}$ x 1 $\frac{1}{2}$ x 1 $\frac{1}{4}$	30.2	39.6	55.6	...	50.8	17.5
1 $\frac{1}{2}$ x 1 $\frac{1}{4}$ x 1 $\frac{1}{2}$	36.6	39.6	55.6	...	53.8	20.6
2	49.3	44.5	68.3	44.5	68.3	25.4
2 x 2 x 1 $\frac{1}{2}$	36.6	44.5	60.5	...	60.5	20.6
2 x 2 x 1 $\frac{1}{4}$	30.2	44.5	57.2	...	57.2	17.5
2 x 1 $\frac{1}{2}$ x 1 $\frac{1}{2}$	36.6	39.6	60.5	...	60.5	22.4
2 x 1 $\frac{1}{2}$ x 2	49.3	...	...	44.5	...	...
3	74.7	68.3	100.1	63.5	100.1	38.1
3 x 3 x 2	49.3	...	...	...	81.0	25.4
3 x 3 x 1 $\frac{1}{2}$	36.6	...	...	...	73.2	20.6
3 x 3 x 1 $\frac{1}{4}$	30.2	...	...	...	69.9	17.5
4	98.6	84.1	125.5	84.1	125.5	49.3
4 x 4 x 3	74.7	...	...	...	112.8	38.1
4 x 4 x 2	49.3	...	...	...	91.9	25.4
4 x 4 x 1 $\frac{1}{2}$	36.6	...	...	...	84.1	20.6
4 x 4 x 1 $\frac{1}{4}$	30.2	...	...	...	81.0	17.5

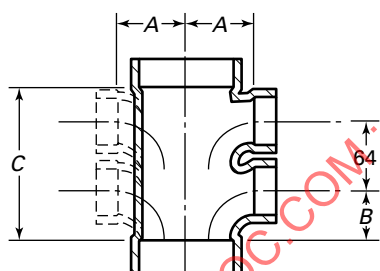
GENERAL NOTE: Dimensions are in millimeters.

Table 20 Dimensions of DWV Trap Tees**DWV Trap Tees**
C × F × SJ**DWV Trap Tees**
C × C × SJ

Nominal Size	K	L	M	KK	LL
1 $\frac{1}{4}$	30.2	35.1	50.8	19.1	49.3
1 $\frac{1}{2}$	36.6	39.6	58.7	20.6	57.2
1 $\frac{1}{2}$ × 1 $\frac{1}{2}$ × 1 $\frac{1}{4}$	30.2	39.6	55.6	19.1	53.8
2	49.3	44.5	70.6	28.4	66.5

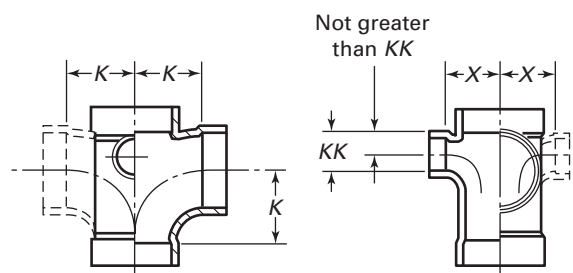
GENERAL NOTES:

- (a) Dimensions are in millimeters.
 (b) For dimensions of slip joint ends, see Table 49.

Table 21 Dimensions of DWV Double and Quadruple Branch Fittings**C × C × C × C**
C × C × C × C × C × C
DWV Branch Fittings

Nominal Size	A	B	C
3 × 3 with 1 $\frac{1}{2}$ -in. inlets	55.6	39.6	125.5
3 × 3 with 1 $\frac{1}{4}$ -in. inlets	52.3	39.6	125.5
4 × 4 with 1 $\frac{1}{2}$ -in. inlets	66.5	36.6	112.8
4 × 4 with 1 $\frac{1}{4}$ -in. inlets	63.5	36.6	112.8

GENERAL NOTE: Dimensions are in millimeters.

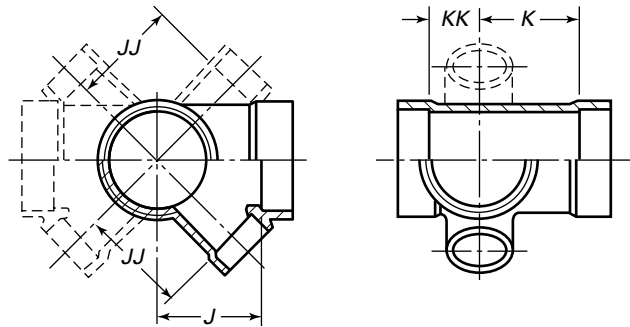
Table 22 Dimensions of Short Design DWV Tees With Side Inlet(s) (90 deg to Main Inlet), Single and Double**C × C × C With One or Two C Side Inlet(s)**
C × C × C × C With One or Two C Side Inlet(s)
DWV Tees — Short Design

Nominal Sizes	K	KK	X
3 × 3 × 3 with 2-in. inlet(s)	74.7	38.1	57.2
3 × 3 × 3 with 1 $\frac{1}{2}$ -in. inlet(s)	74.7	38.1	53.8

GENERAL NOTES:

- (a) Dimensions are in millimeters.
 (b) To determine whether inlets are right-hand or left-hand, place the fitting with large side inlet facing toward you. The side on which the other inlet appears determines its designation.

**Table 23 Dimensions of Short Design DWV Tees With Side Inlet(s)
(45 deg to Main Inlet), Single and Double**



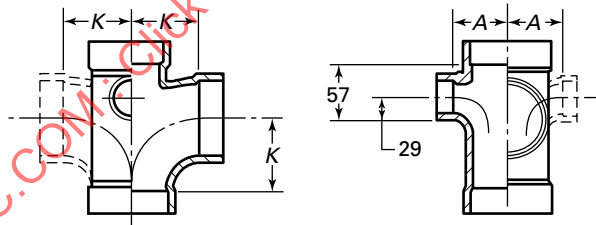
**C × C × C With One or Two C Side Inlet(s)
DWV Tees — Short Design**

Nominal Size	K	KK	J	JJ
3 × 3 × 3 with 2-in. inlet(s)	74.7	39.6	77.7	85.9
3 × 3 × 3 with 1½-in. inlet(s)	74.7	39.6	77.7	79.2

GENERAL NOTES:

- (a) Dimensions are in millimeters.
 (b) To determine whether inlets are right-hand or left-hand, place the fitting with large side inlet facing toward you. The side on which the other inlet appears determines its designation.

**Table 24 Dimensions of Long Design DWV Tees
With Side Inlet(s) (90 deg to Main Inlet),
Single and Double**



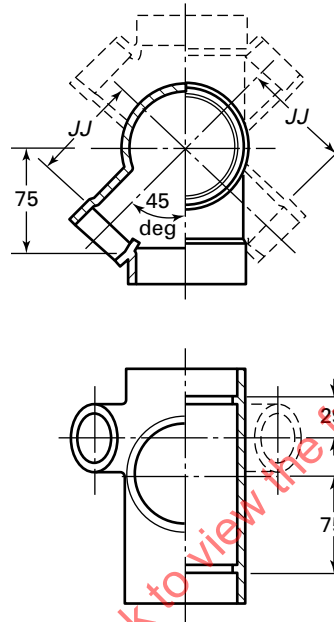
**C × C × C With One or Two C Side Inlet(s)
C × C × C With One or Two C Side Inlet(s)
DWV Tees — Long Design**

Nominal Size	A	K
3 × 3 × 3 with 2-in. inlet(s)	62.0	74.7
3 × 3 × 3 with 1½-in. inlet(s)	55.6	74.7
3 × 3 × 3 with 1¼-in. inlet(s)	52.3	74.7
4 × 4 × 4 with 2-in. inlet(s)	73.2	98.6
4 × 4 × 4 with 1½-in. inlet(s)	66.5	98.6

GENERAL NOTES:

- (a) Dimensions are in millimeters.
 (b) To determine whether inlets are right-hand or left-hand, place the fitting with large side inlet facing toward you. The side on which the other inlet appears determines its designation.

**Table 25 Dimensions of Long Design DWV Tees
With Side Inlet(s) (45 deg to Main Inlet),
Single and Double**



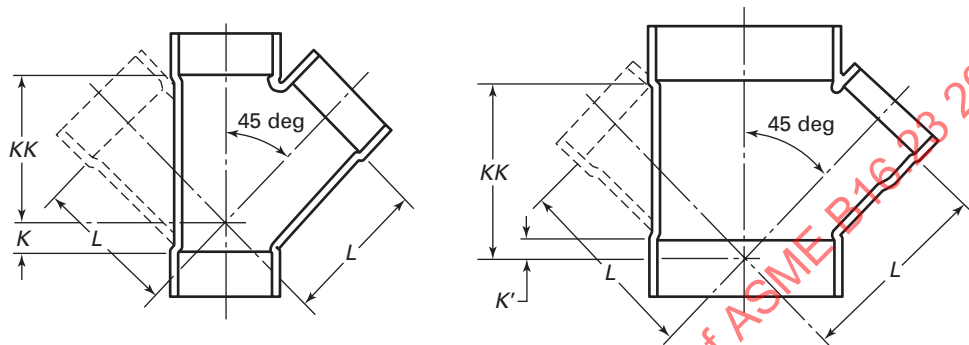
C × C × C With One or Two C Side Inlet(s)
C × C × C × C With One or Two C Side Inlet(s)
DWV Tees — Long Design

Nominal Size	JJ
3 × 3 × 3 with 2-in. inlet(s)	88.9
3 × 3 × 3 with 1½-in. inlet(s)	81.0

GENERAL NOTES:

- (a) Dimensions are in millimeters.
- (b) To determine whether inlets are right-hand or left-hand, place the fitting with large side inlet facing toward you. The side on which the other inlet appears determines its designation.

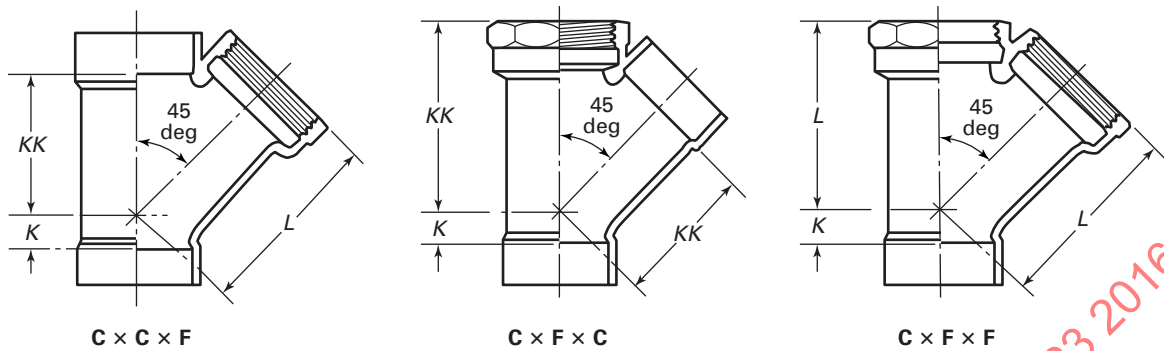
Table 26 Dimensions of Single and Double DWV 45-deg Ys



$C \times C \times C$
 $C \times C \times C \times C$
 DWV 45-deg Ys

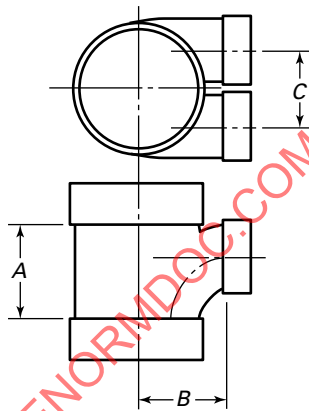
Nominal Size	K	K'	KK	L	Nominal Size	K	K'	KK	L
1 $\frac{1}{4}$	7.9	...	47.8	47.8	4	26.9	...	136.7	136.7
1 $\frac{1}{2}$	9.7	...	55.6	55.6	4 × 4 × 3	8.6	...	117.3	120.7
1 $\frac{1}{2}$ × 1 $\frac{1}{2}$ × 1 $\frac{1}{4}$	6.4	...	50.8	52.3	4 × 4 × 2	...	8.6	98.6	106.4
1 $\frac{1}{2}$ × 1 $\frac{1}{4}$ × 1 $\frac{1}{2}$	11.2	...	53.8	52.3	4 × 4 × 1 $\frac{1}{2}$	...	16.8	90.4	100.1
1 $\frac{1}{2}$ × 1 $\frac{1}{4}$ × 1 $\frac{1}{4}$	6.4	...	49.3	49.3	4 × 4 × 1 $\frac{1}{4}$	...	21.3	85.9	96.8
2	9.1	...	69.9	69.9	5	30.2	...	165.1	165.1
2 × 2 × 1 $\frac{1}{2}$	5.6	...	63.5	65.0	5 × 5 × 4	14.2	...	146.1	152.4
2 × 2 × 1 $\frac{1}{4}$	1.5	...	58.7	62.0	5 × 5 × 3	...	1.5	130.0	140.5
2 × 1 $\frac{1}{2}$ × 2	13.5	...	66.5	64.3	6	38.1	...	195.3	195.3
2 × 1 $\frac{1}{2}$ × 1 $\frac{1}{2}$	7.1	...	55.6	55.6	6 × 6 × 4	1.5	...	158.8	169.9
2 × 1 $\frac{1}{4}$ × 1 $\frac{1}{4}$	1.5	...	59.4	65.0	6 × 6 × 3	...	15.7	142.7	157.2
3	20.6	...	104.6	104.6	6 × 6 × 2	...	31.8	124.0	144.5
3 × 3 × 2	3.0	...	85.9	88.9	6 × 4 × 4	1.5	...	134.9	134.9
3 × 3 × 1 $\frac{1}{2}$	...	4.8	76.2	82.6	6 × 4 × 2	...	31.8	100.1	109.5
3 × 3 × 1 $\frac{1}{4}$	...	9.7	73.2	77.7	8	35.1	...	258.8	258.8
3 × 2 × 3	2.3	...	69.9	69.9	8 × 8 × 6	13.5	...	223.0	234.2
3 × 1 $\frac{1}{2}$ × 3	...	9.7	62.0	64.8	8 × 6 × 6	13.5	...	196.9	196.9
3 × 1 $\frac{1}{2}$ × 1 $\frac{1}{2}$	...	8.6	55.6	55.6					

GENERAL NOTE: Dimensions are in millimeters.

Table 27 Dimensions of DWV 45-deg Ys**DWV 45-deg Ys**

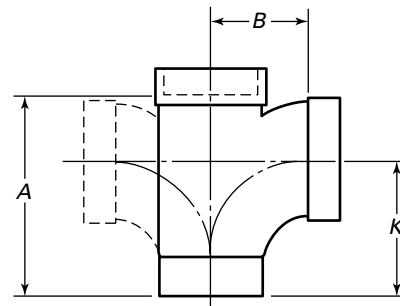
Nominal Size	K	KK	L
1 $\frac{1}{4}$	7.9	47.8	69.9
1 $\frac{1}{2}$	9.7	55.6	79.2
2	14.2	69.9	95.3
2 x 1 $\frac{1}{2}$ x 2	14.2	73.2	95.3
3	20.6	104.6	144.5
4	26.9	136.7	176.3

GENERAL NOTE: Dimensions are in millimeters.

Table 28 Dimensions of DWV Horizontal Twin Branch Tees**DWV Horizontal Twin Branch Tees**
C x C x C x C

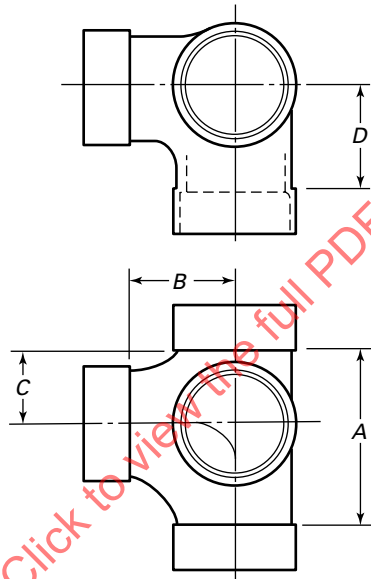
Nominal Size	A	B	Minimum, C
3 x 3 x 1 $\frac{1}{2}$ x 1 $\frac{1}{2}$	62.0	56.4	47.8
3 x 3 x 1 $\frac{1}{4}$ x 1 $\frac{1}{4}$	55.6	55.6	46.5

GENERAL NOTE: Dimensions are in millimeters.

Table 29 Dimensions of DWV Fitting Tees, Single and Double**DWV Fitting Tees — Single and Double**
FTG x C x C
FTG x C x C x C

Nominal Size	A	B	K
1 $\frac{1}{2}$	70.6	35.8	50.0
2	87.6	47.8	63.5
3 x 3 x 2	95.3	60.5	66.5
3 x 3 x 1 $\frac{1}{2}$	81.0	54.9	56.4
3 x 3 x 1 $\frac{1}{4}$	69.1	50.8	47.5
3	133.4	73.2	91.9
3 x 2 x 3	125.5	73.2	91.9

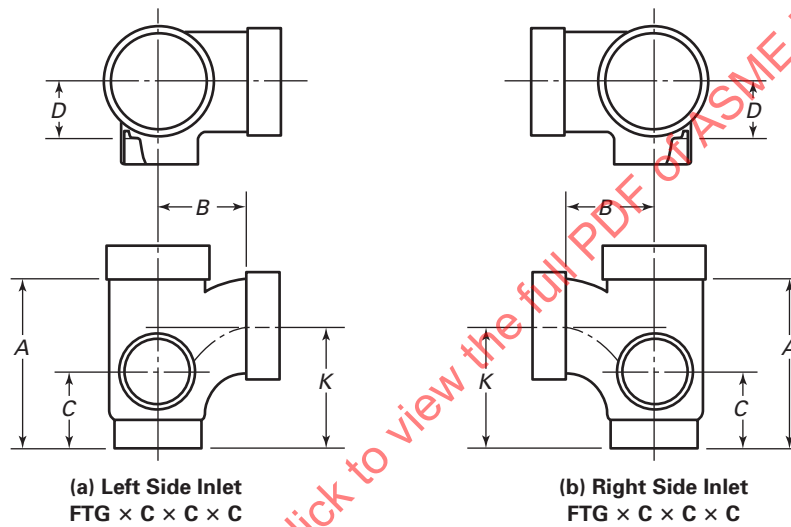
GENERAL NOTE: Dimensions are in millimeters.

Table 30 Dimensions of DWV Utility Tees**DWV Utility Tees**
C × C × C × C

Nominal Size	A	B	C	D
1½	57.2	36.6	20.6	36.6
2	81.0	49.3	31.8	49.3
2 × 2 × 1½ × 1½	58.7	42.2	22.4	42.2

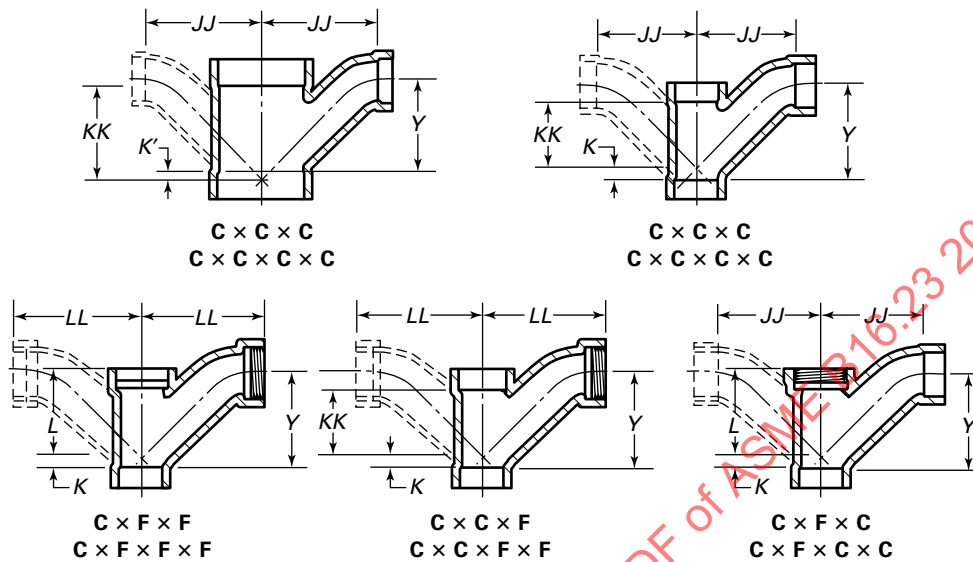
GENERAL NOTE: Dimensions are in millimeters.

**Table 31 Dimensions of DWV Fitting Tees With Side Inlet
Maximum Below Centerline**



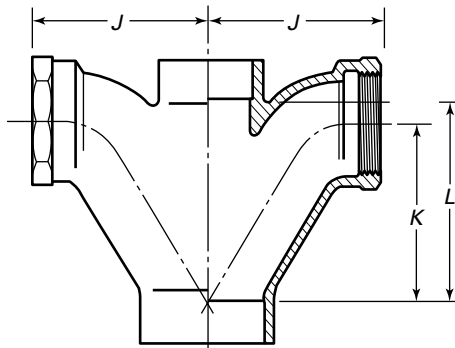
Nominal Size	A	B	C	D	K
3 x 3 x 3 x 1½	133.4	74.7	54.9	44.5	95.3
3 x 3 x 3 x 2	133.4	74.7	61.2	44.5	95.3

GENERAL NOTE: Dimensions are in millimeters.

Table 32 Dimensions of DWV Long Turn T-Ys, Single and Double

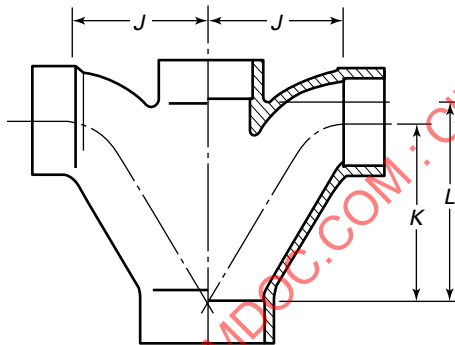
Nominal Size	JJ	K	K'	KK	L	LL	Y
1 $\frac{1}{4}$	63.50	7.87	...	44.45	66.55	100.08	63.50
1 $\frac{1}{2}$	76.20	9.65	...	53.85	79.25	96.77	76.20
1 $\frac{1}{2}$ $\times$ 1 $\frac{1}{2}$ $\times$ 1 $\frac{1}{4}$	71.37	4.83	...	49.28	76.20	96.77	66.55
2	101.60	14.22	...	66.55	91.95	122.17	101.60
2 $\times$ 2 $\times$ 1 $\frac{1}{2}$	87.38	6.35	...	60.45	85.85	112.78	81.03
2 $\times$ 2 $\times$ 1 $\frac{1}{4}$	76.20	1.52	...	53.85	...	...	68.33
2 $\times$ 1 $\frac{1}{2}$ $\times$ 2	101.60	14.22	...	71.37	...	...	101.60
2 $\times$ 1 $\frac{1}{4}$ $\times$ 2	101.60	12.70	...	61.98	...	...	101.60
3	149.35	20.57	...	98.55	138.18	228.60	149.35
3 $\times$ 3 $\times$ 2	119.13	2.29	...	82.55	...	...	104.65
3 $\times$ 3 $\times$ 1 $\frac{1}{2}$	100.08	...	5.59	73.15	...	...	82.55
3 $\times$ 3 $\times$ 1 $\frac{1}{4}$	95.25	...	10.41	70.61	...	...	71.37
3 $\times$ 2 $\times$ 3	149.35	20.57	...	87.38	...	...	149.35
3 $\times$ 2 $\times$ 2	114.30	1.52	...	69.85	...	...	101.60
4	196.85	26.92	...	127.00	169.93	228.60	196.85
4 $\times$ 4 $\times$ 3	142.75	11.18	...	114.30	...	...	130.05
4 $\times$ 4 $\times$ 2	130.05	...	6.35	98.55	...	...	107.95
4 $\times$ 4 $\times$ 1 $\frac{1}{2}$	123.95	...	15.75	88.14	...	...	91.95
5	252.48	31.75	...	165.10	...	...	248.41
5 $\times$ 5 $\times$ 4	218.95	14.99	...	148.34	...	...	202.44
5 $\times$ 5 $\times$ 3	184.15	...	1.52	131.83	...	...	156.46
6	299.97	38.86	...	197.61	...	...	295.15
6 $\times$ 6 $\times$ 5	265.18	22.35	...	180.09	...	...	248.41
6 $\times$ 6 $\times$ 4	230.89	4.83	...	161.04	...	...	200.91
6 $\times$ 6 $\times$ 3	195.33	...	12.70	144.53	...	...	155.45

GENERAL NOTE: Dimensions are in millimeters.

**Table 33 Dimensions of DWV Double Short T-Y
(C × C × F × F)****C × C × F × F
DWV Double Short T-Y**

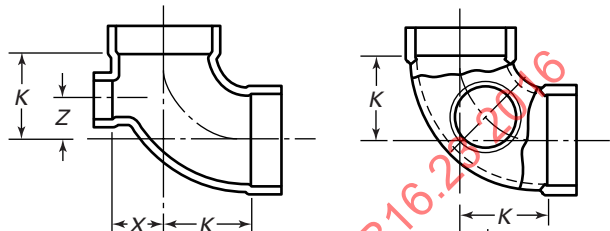
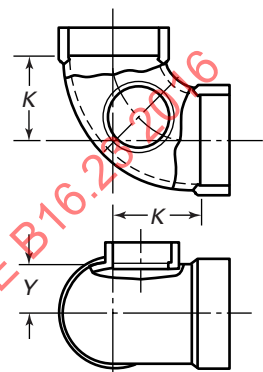

Nominal Size	J	K	L
2 × 1½ × 1½ × 1½	77.7	81.0	82.6
2 × 2 × 1½ × 1½	87.4	91.9	93.0
2 × 1½ × 2 × 2	95.3	106.4	106.4
2 × 1½ × 1¼ × 1¼	77.7	81.0	90.4

GENERAL NOTE: Dimensions are in millimeters.

**Table 34 Dimensions of DWV Double Short T-Y
(C × C × C × C)****C × C × C × C
DWV Double Short T-Y**

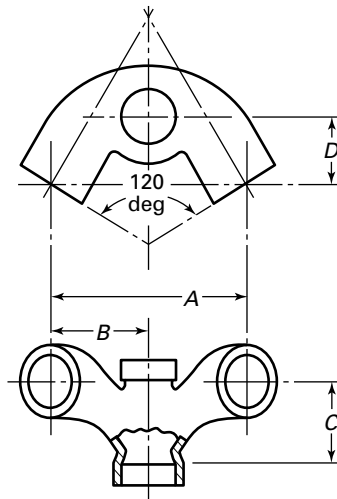
Nominal Size	J	K	L
1½	63.8	82.8	83.6
2	85.9	103.9	101.6
2 × 2 × 1½ × 1½	70.6	91.9	93.5
2 × 1½ × 2 × 2	76.2	106.4	106.4
2 × 1½ × 1½ × 1½	60.5	81.0	82.6
3	112.8	143.8	146.1

GENERAL NOTE: Dimensions are in millimeters.

Table 35 Dimensions of DWV Elbow With Inlets**DWV 90-deg Elbow
With High Heel Inlet
C × C × C****DWV 90-deg Elbow
With Side Inlet
C × C × C****DWV 90-deg Elbow
With Low Heel Inlet
C × C × C**

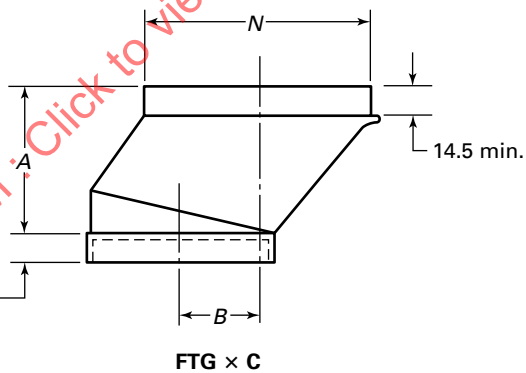
Nominal Size	K	X	Y	Z	L
3 × 3 × 2	74.7	42.9	42.9	38.1	32.5
3 × 3 × 1½	74.7	42.9	42.9	38.1	30.2
3 × 3 × 1¼	74.7	42.9	42.9	38.1	28.4
4 × 4 × 2	98.6	53.8	57.2	50.8	47.8
4 × 4 × 1½	98.6	52.3	57.2	50.8	32.5

GENERAL NOTE: Dimensions are in millimeters.

Table 36 Dimensions of DWV Double Branch Sink Fittings

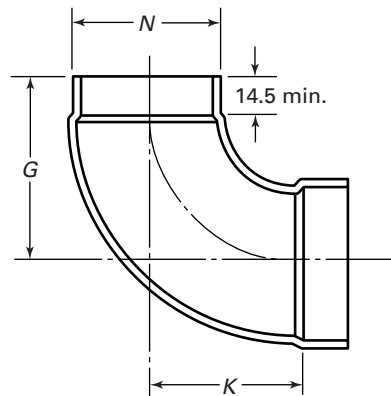
Type	Nominal Size	A	B	C	D
C × C × F × F	2 × 1½ × 1½ × 1½	158.8	79.2	57.2	47.8
C × C × C × C	2 × 1½ × 1½ × 1½	158.8	79.2	57.2	47.8

GENERAL NOTE: Dimensions are in millimeters.

Table 37 Dimensions of DWV Closet Offset Fittings

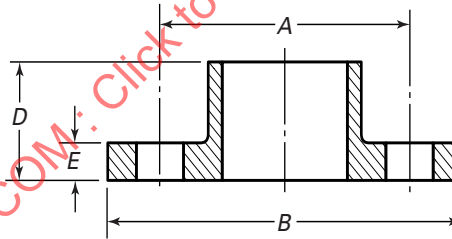
Nominal Size	A	B	N	
			Minimum	Maximum
4	63.5	49.3	104.686	104.826
4 × 3	63.5	36.6	104.686	104.826

GENERAL NOTE: Dimensions are in millimeters.

Table 38 Dimensions of DWV 90-deg Closet Elbow**DWV 90-deg Closet Elbow
FTG $\times$ C**

Nominal Size	K	N		G
		Min.	Max.	
4	98.6	104.686	104.826	112.8
3	74.7	79.286	79.426	88.9
4 $\times$ 3	73.2	104.686	104.826	94.5

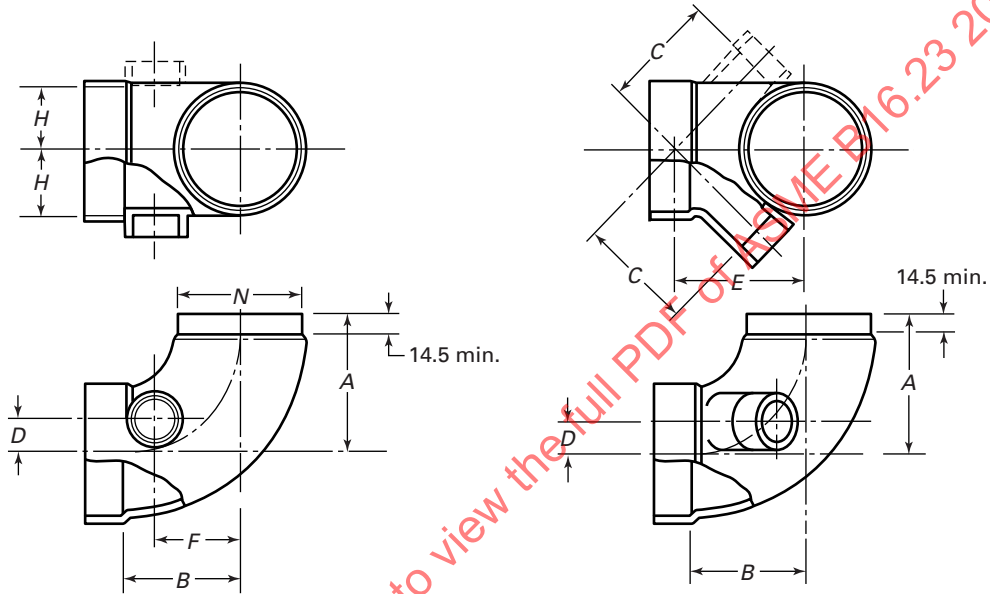
GENERAL NOTE: Dimensions are in millimeters.

Table 39 Dimensions of Floor Flange Vent Support**Floor Flange Vent Support**

Nominal Size	A	B	D	Minimum, E	Bolt Hole Size	Number of Holes
1 $\frac{1}{4}$	66.5	77.7	15.7	4.8	5.6	2
1 $\frac{1}{2}$	66.5	77.5	17.5	4.8	5.6	2
2	85.9	100.1	19.1	4.8	5.6	2
3	114.3	130.0	23.9	4.8	6.4	2
4	139.7	155.4	30.2	4.8	6.4	2
5	176.3	203.2	36.6	9.7	11.2	4
6	200.2	228.6	42.9	12.7	14.2	4
8	254.0	279.4	53.8	15.7	14.2	4

GENERAL NOTES:

- (a) Dimensions are in millimeters.
 (b) May be round or oval design.

Table 40 Dimensions of DWV Closet Ells With Side Inlet(s) (90 deg and 45 deg) to Main Inlet(s)

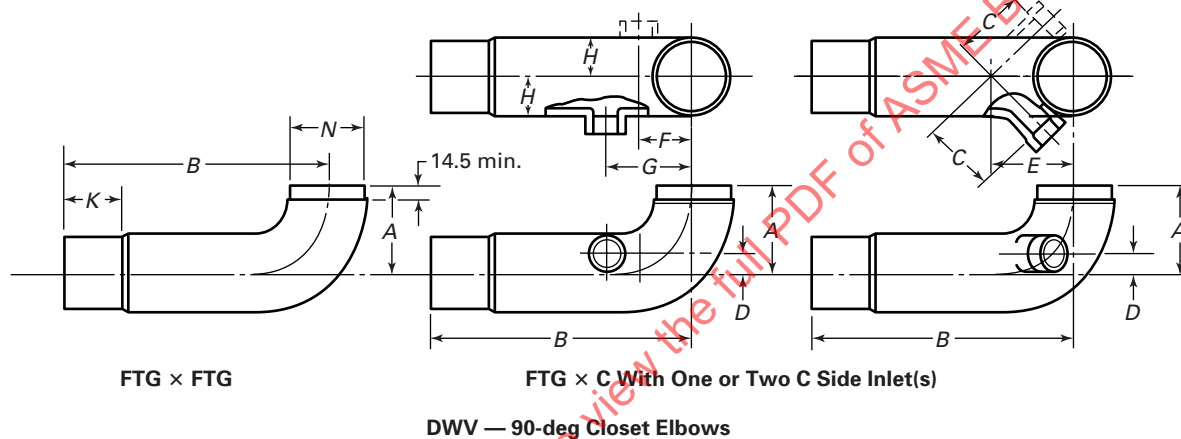
FTG × C With One or Two C Side Inlet(s)
DWV — 90-deg Closet Elbows

Nominal Size	A	B	C	D	E	F	H	N	
								Min.	Max.
4 × 3 with 1½-in. inlet(s)	112.78	98.55	91.95	14.22	102.36	71.37	43.69	104.72	104.83
4 × 4 with 1½-in. inlet(s)	112.78	98.55	96.77	25.40	107.19	53.09	53.09	104.72	104.83

GENERAL NOTES:

- (a) Dimensions are in millimeters.
 (b) To determine whether inlets are right-hand or left-hand, place the fitting with large side inlet facing up and toward you. The side on which the other inlet appears determines its designation.

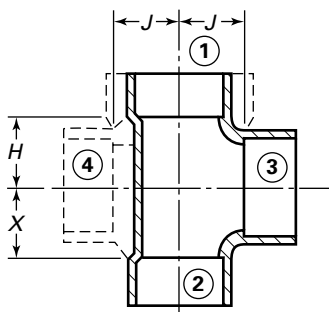
**Table 41 Dimensions of DWV Closet Ells With or Without Side Inlet(s)
(90 deg and 45 deg) to Main Inlet(s)**



Nominal Size	Minimum, A	B	C	D	E	F	G	H	K	N	
										Min.	Max.
4 × 3	112.8	355.6	...	...	...	...	...	...	80.8	104.724	...
4 × 3 with 1½-in. inlet(s)	112.8	355.6	91.9	14.2	102.4	74.7	119.1	43.7	80.8	...	104.826
4 × 4	112.8	355.6	...	...	...	...	...	...	80.8	104.724	...
4 × 4 with 1½-in. inlet(s)	112.8	355.6	96.8	25.4	107.2	71.4	115.8	53.1	80.8	...	104.826

GENERAL NOTES:

- Dimensions are in millimeters.
- To determine whether inlets are right-hand or left-hand, place the fitting with large side inlet facing up and toward you. The side on which the other inlet appears determines its designation.
- Closet flange attaches to 4-in. end.

Table 43 Dimensions of Vent Tees and Vent Double Tees


**Vent Tees and Vent Double Tees
Vent Increases With Side Inlets**

C × C × C and C × C × C × C
 ① ② ③ ① ② ③ ④

Nominal Size	H	J	X
1 ¹ / ₄	22.1	22.1	22.1
1 ¹ / ₂	25.4	25.4	25.4
1 ¹ / ₂ × 1 ¹ / ₂ × 1 ¹ / ₄	22.1	25.4	22.1
2	31.8	31.8	31.8
2 × 2 × 1 ¹ / ₂	25.4	31.8	25.4
2 × 2 × 1 ¹ / ₄	22.1	31.8	22.1
3	44.5	44.5	44.5
3 × 3 × 2	31.8	44.5	31.8
3 × 3 × 1 ¹ / ₂	25.4	44.5	25.4
3 × 3 × 1 ¹ / ₄	22.1	44.5	22.1
3 × 4 × 2	30.2	55.6	30.2
3 × 4 × 1 ¹ / ₂	26.9	53.8	25.4

GENERAL NOTES:

- (a) Dimensions are in millimeters.
 (b) Vent fittings are designed for dry vents only. They are not specified for waste lines. Vent fittings must be marked as follows:
 VENT ONLY.

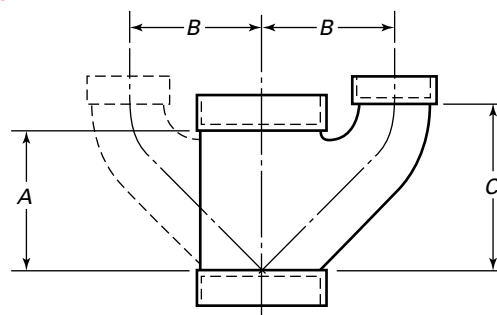
Table 44 Dimensions of Vent Elbows

Vent Elbows
C × C

Nominal Size	K
1 ¹ / ₄	22.1
1 ¹ / ₂	25.4
2	31.8
3	44.5

GENERAL NOTES:


- (a) Dimensions are in millimeters.
 (b) Vent fittings are designed for dry vents only. They are not specified for waste lines. Vent fittings must be marked as follows:
 VENT ONLY.

Table 45 Dimensions of DWV Stack Upturns, Single and Double

DWV Stack Upturns,
Single and Double
C × C × C and C × C × C × C

Nominal Size	A	B	C
2	82.6	88.9	119.9
2 × 2 × 1 ¹ / ₂	65.0	79.2	97.5
2 × 1 ¹ / ₂ × 1 ¹ / ₄	60.5	69.9	88.1
3	129.3	95.3	144.5
3 × 3 × 2	87.4	86.6	106.4
3 × 3 × 1 ¹ / ₂	68.3	80.3	87.4
4 × 4 × 3	127.8	108.0	143.8

GENERAL NOTE: Dimensions are in millimeters.

Table 46 Dimensions of Slip Joint Pieces


DWV Slip Joint Thread Pieces
C × SJ
[Note (1)]

Nominal Size	A
1 $\frac{1}{4}$	9.7
1 $\frac{1}{2}$	9.7
1 $\frac{1}{4}$ × 1 $\frac{1}{2}$	9.7
2	9.7

GENERAL NOTE: Dimensions are in millimeters.

NOTE:


(1) For slip joint threads, see Table 49.

Table 48 Dimensions of Trap Extended Bushings

DWV Trap Extended Bushing
FTG × Outside Diameter of Tube (FTG × O.D. Tube)

Nominal Size	A	B
1 $\frac{1}{2}$ × 1 $\frac{1}{4}$ O.D.	19.1	31.8
1 $\frac{1}{2}$ × 1 $\frac{1}{2}$ O.D.	19.1	38.1

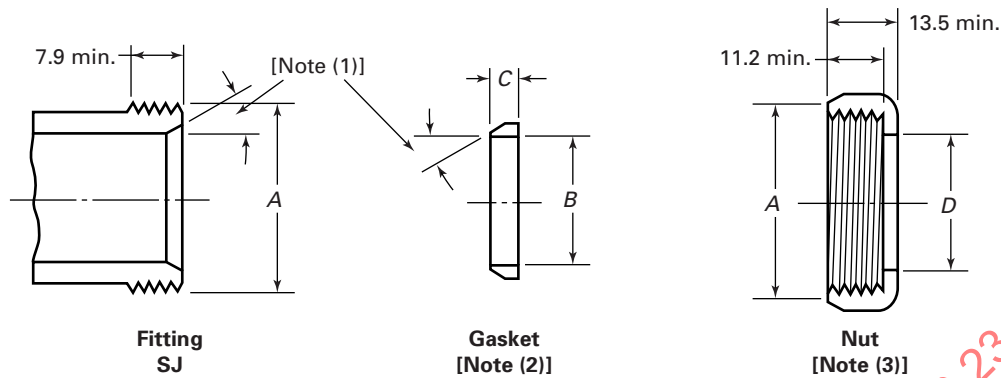
GENERAL NOTE: Dimensions are in millimeters.

Table 47 Dimensions of Trap Coupling

DWV Trap Coupling
C × O.D. Tube

Nominal Size	A	B
1 $\frac{1}{4}$ × 1 $\frac{1}{4}$ O.D.	3.3	31.8
1 $\frac{1}{2}$ × 1 $\frac{1}{2}$ O.D.	5.6	38.1
1 $\frac{1}{2}$ × 1 $\frac{1}{4}$ O.D.	6.4	31.8
2 × 1 $\frac{1}{2}$ O.D.	10.4	38.1

GENERAL NOTE: Dimensions are in millimeters.

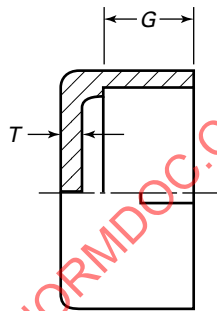
Table 49 Dimensions of Slip Joint Ends**DWV Slip Joint Ends**

Nominal Size	A	B	Minimum, C	D
1 $\frac{1}{4}$	1 $\frac{1}{4}$ NPSM	32.0	11.7	32.5
1 $\frac{1}{2}$	1 $\frac{1}{2}$ NPSM	38.4	4.8	38.9
2	2 NPSM	51.1	4.8	51.6

GENERAL NOTE: Dimensions are in millimeters.

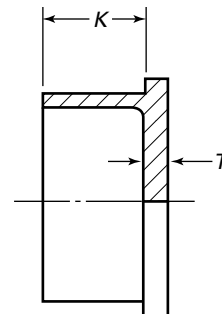
NOTES:

- (1) Angles must be equal.
- (2) Gasket to be pliable material not subject to aging or drying out.
- (3) Nut may be any material specified in section 8, or any other suitable nonferrous alloy.

Table 50 Dimensions of DWV Cap**DWV Cap
C**

Nominal Size	G	T
1 $\frac{1}{4}$	12.7	2.5
1 $\frac{1}{2}$	14.2	2.5
2	15.7	2.5
3	19.1	3.0
4	25.4	3.0

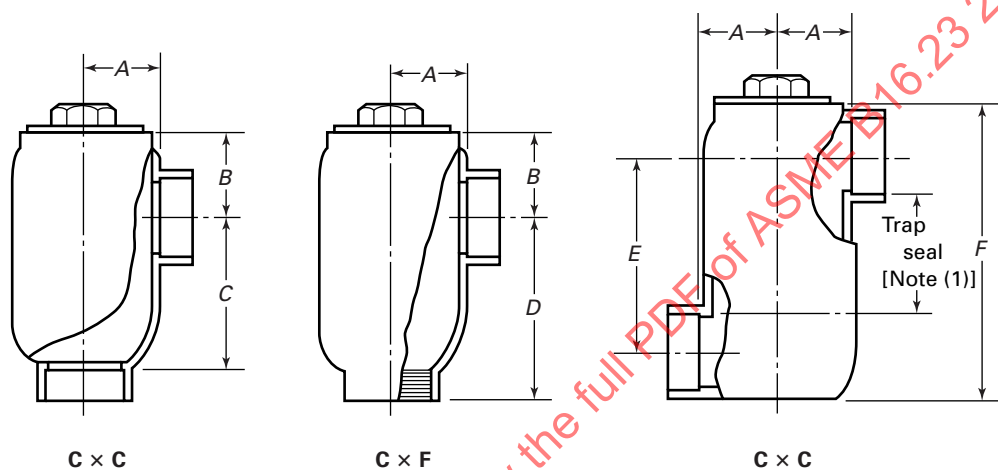
GENERAL NOTE: Dimensions are in millimeters.

Table 51 Dimensions of DWV Plugs**DWV Fitting Plug
FTG**

Nominal Size	K	T
1 $\frac{1}{4}$	14.2	2.5
1 $\frac{1}{2}$	15.7	2.5
2	17.5	2.5
3	20.6	3.0

GENERAL NOTE: Dimensions are in millimeters.

Table 52 Dimensions of DWV Drum Traps



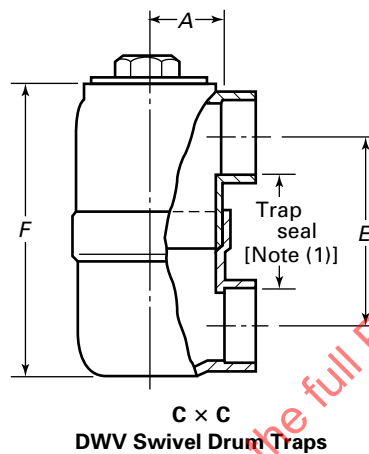
DWV One-Piece Drum Traps

Type	Drum Size	Pipe and Tubing Size	Plug Size	A	B	C	D	E	Maximum, F
C x C	3 x 5	1½	2	38.1	43.7	75.4	...	...	...
C x F	3 x 5	1½	2	38.1	43.7	...	81.8	...	...
C x C	3 x 6	1½	2	38.1	...	...	...	98.6	171.5
C x F	4 x 5	1½	3	50.8	31.0	...	82.6	...	...
C x C	4 x 5	1½	3	50.8	31.0	...	...	...	...
C x C	4 x 8	1½	3	50.8	...	...	...	119.9	203.2
C x F	4 x 5	1¼	3	50.8	31.0	...	82.6	...	...
C x C	4 x 5	1¼	3	50.8	31.0	...	...	...	...

GENERAL NOTE: Dimensions are in millimeters.

NOTE:

(1) Trap seal is 50 mm minimum.

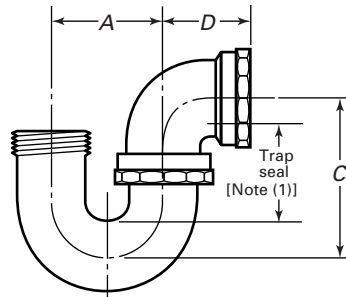
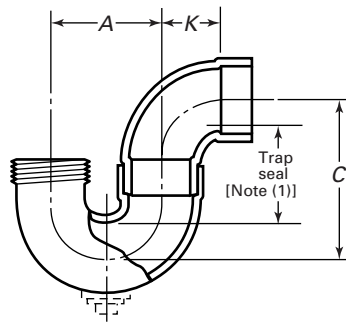
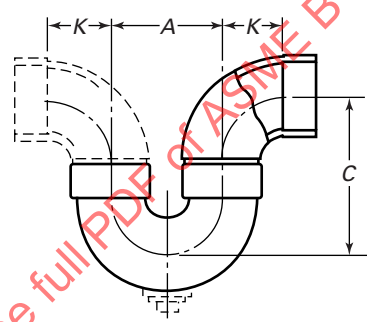



Table 53 Dimensions of DWV Swivel Drum Traps

Type	Drum Size	Tube Size	Plug Size	A	E	Maximum, F
C × C	3 × 6	1½	2	38.1	98.6	171.5
C × C	4 × 8	1½	3	50.8	119.9	203.2
C × C	3 × 6	2	2	38.1	93.0	169.2
C × C	4 × 8	2	3	50.8	110.2	197.6

GENERAL NOTE: Dimensions are in millimeters.

NOTE:

(1) Trap seal is 50 mm minimum.

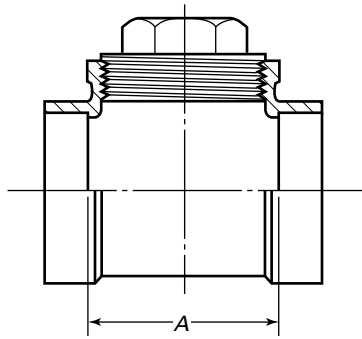
Table 54 Dimensions of DWV Traps**DWV P-Trap With Union Joint
SJ x F****DWV P-Trap With or
Without Cleanout
SJ x C****DWV P-Trap or Running Trap
With or Without Cleanout
C x C****DWV P-Trap With Union Joint
SJ x C****DWV One-Piece P-Trap
SJ x C****DWV One-Piece Line P-Trap
C x C**

Description	Nominal Size	A	K	Minimum, C	D
P-trap SJ x C with or without cleanout	1 $\frac{1}{4}$	55.6	30.2	83.3	...
P-trap C x C with or without cleanout	1 $\frac{1}{2}$	62.0	36.6	89.7	...
Running P-trap C x C with or without cleanout	2	74.7	49.3	108.0	...
P-trap swivel SJ x C	1 $\frac{1}{4}$	60.5	28.4	80.3	49.3
P-trap swivel SJ x F	1 $\frac{1}{2}$	66.5	28.4	87.4	49.3
P-trap one-piece SC	2	79.2	37.3	99.3	71.4
P-trap one-piece CC	1 $\frac{1}{2}$	62.0	36.6	89.7	...

GENERAL NOTE: Dimensions are in millimeters.

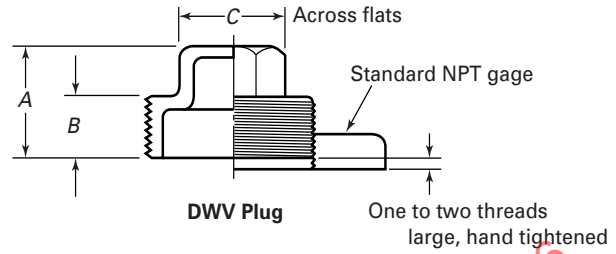
NOTE:

(1) Trap seal is 50 mm minimum (all traps).

Table 55 Dimensions of DWV Test Tees With Plug**DWV Test Tees With Plug**
C × C × F

Nominal Size	A
$1\frac{1}{4} \times 1\frac{1}{4} \times 1\frac{1}{4}$	50.8
$1\frac{1}{2} \times 1\frac{1}{2} \times 1\frac{1}{2}$	57.2
$2 \times 2 \times 2$	69.9
$3 \times 3 \times 3$	98.6
$4 \times 4 \times 4$	139.7

GENERAL NOTE: Dimensions are in millimeters.

Table 56 Dimensions of DWV Plugs

Nominal Size	A	B	C
$1\frac{1}{4}$	22.4	11.2	22.4
$1\frac{1}{2}$	25.4	12.7	25.4
2	27.7	13.5	28.4
3	33.3	15.7	35.1
4	35.1	16.8	35.1
5	36.6	17.5	38.1
6	38.9	18.3	38.1
8	44.5	19.1	44.5

GENERAL NOTE: Dimensions are in millimeters.

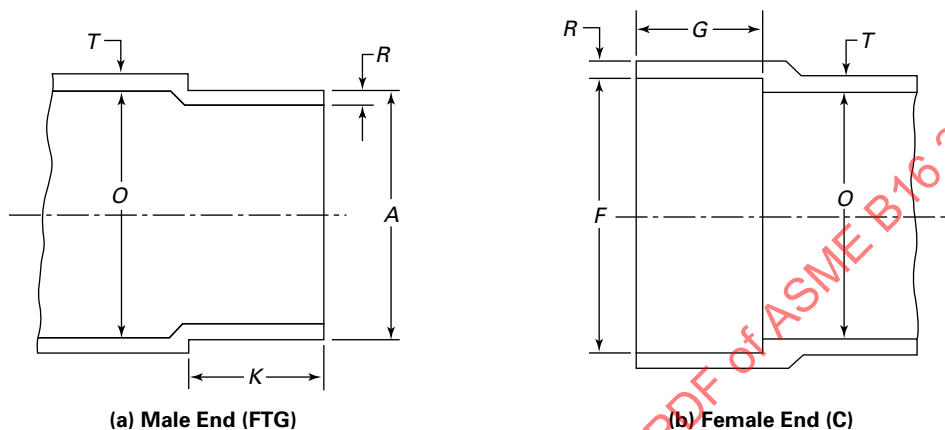
MANDATORY APPENDIX I

U.S. CUSTOMARY TABLES

This Appendix provides tables of the standard inch dimensions for fittings (Tables I-1 through I-56).

Table I-1 Inspection Tolerance Table

Nominal Size	± in.
1¼, 1½, and 2	0.08
3	0.11
4 and 5	0.12
6 and 8	0.16

Table I-2 Dimensions of Solder Joint Ends — DWV

Nominal Size [Note (1)]	Male End		Minimum Length, K [Note (3)]	Female End		Minimum Depth, G	Metal Thickness [Note (4)]		Minimum Inside Diameter of Fitting, O
	Outside Diameter, A [Note (2)]			Inside Diameter, F [Note (2)]			Body, T	Joint, R	
	Min.	Max.		Min.	Max.				
1¼	1.372	1.377	0.56	1.378	1.382	0.50	0.10	0.07	1.29
1½	1.621	1.627	0.62	1.628	1.633	0.56	0.10	0.08	1.53
2	2.121	2.127	0.69	2.128	2.133	0.62	0.10	0.09	2.01
3	3.121	3.127	0.81	3.128	3.133	0.75	0.12	0.10	2.98
4	4.121	4.127	1.06	4.128	4.133	1.00	0.12	0.12	3.93
5	5.121	5.127	1.31	5.128	5.133	1.25	0.19	0.19	4.91
6	6.121	6.127	1.62	6.128	6.133	1.50	0.19	0.19	5.88
8	8.119	8.127	2.12	8.128	8.133	2.00	0.22	0.22	7.78

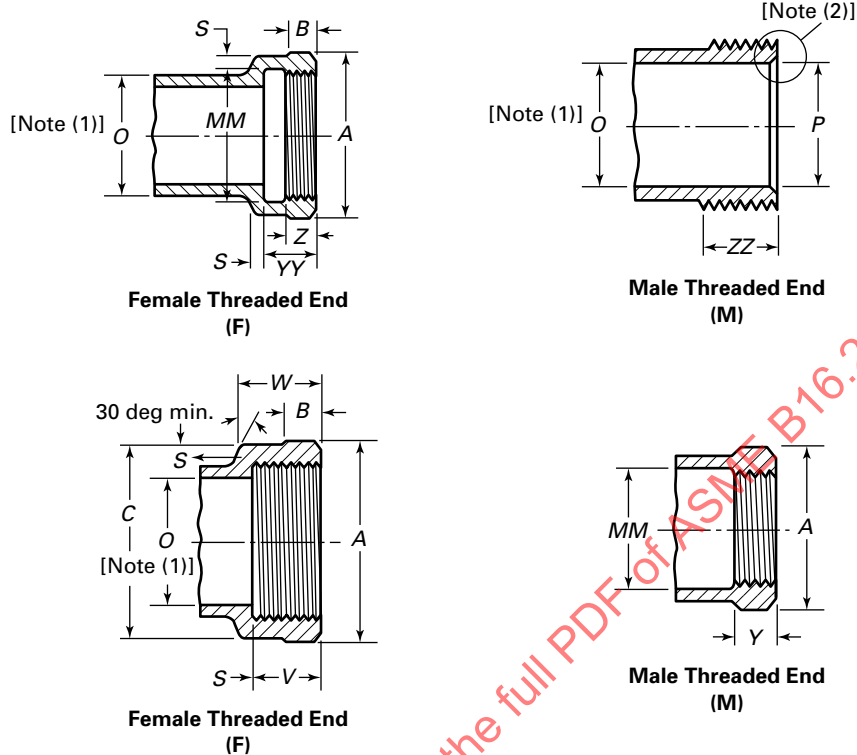
GENERAL NOTES:

- (a) Dimensions are in inches.
 (b) The sketches and designs of fittings are illustrative only. The dimensions herein shall govern in all cases.

NOTES:

- (1) For size designation of fitting, see section 6.
 (2) For ovality, see para. 10.3.
 (3) *K* dimensions of 0.44, 0.50, and 0.56, and *G* dimensions of 0.38, 0.44, and 0.50, respectively, for 1¼-in., 1½-in., and 2-in. sizes are sound and acceptable from an engineering standpoint. However, the cup depths specified in Table I-2 are to provide greater facility in making installations.
 (4) For metal thickness tolerance, see section 9.

Table I-3 Dimensions of Threaded Ends — DWV



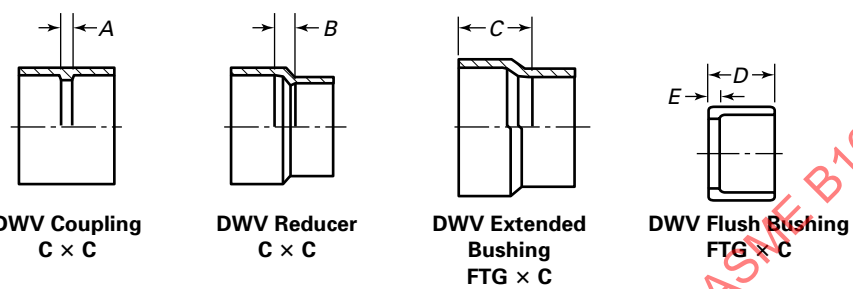
Nominal Thread Size [Note (3)]	Minimum Dia. of Band or Across Flats of Polygon, A	Minimum Band Length, B	Minimum Dia. of Body Over Thread, C	Minimum Dia. of Recess, MM [Note (4)]	Minimum Depth of Full Thread, V	Minimum, W	Minimum Length of Thread, Y	Minimum End To Shoulder, YY ± 0.06 [Note (4)]	Minimum Thread End Wall, S [Note (5)]	Maximum Thread End Bore, P [Note (4)]	Minimum Length of Effective Thread, ZZ
1 $\frac{1}{4}$	1.91	0.31	1.90	1.66	0.71	1.00	0.42	0.70	0.120	1.31	0.71
1 $\frac{1}{2}$	2.17	0.34	2.17	1.91	0.72	1.00	0.42	0.72	0.130	1.55	0.72
2	2.69	0.41	2.68	2.38	0.76	1.03	0.44	0.75	0.150	2.03	0.76
3	3.88	0.55	3.88	3.50	1.20	1.46	0.77	1.20	0.190	3.05	1.20
4	4.94	0.66	4.94	4.50	1.30	1.53	0.84	1.30	0.220	4.05	1.30
5	6.12	0.78	6.12	5.56	1.41	1.65	0.94	1.41	0.280	4.98	1.41
6	7.30	0.88	7.30	6.62	1.51	1.68	0.96	1.50	0.340	6.03	1.51
8	9.38	1.12	9.37	8.62	1.71	1.75	1.06	1.70	0.375	7.95	1.71

GENERAL NOTES:

- (a) Dimensions are in inches.
 (b) For threads of threaded ends, see section 11.

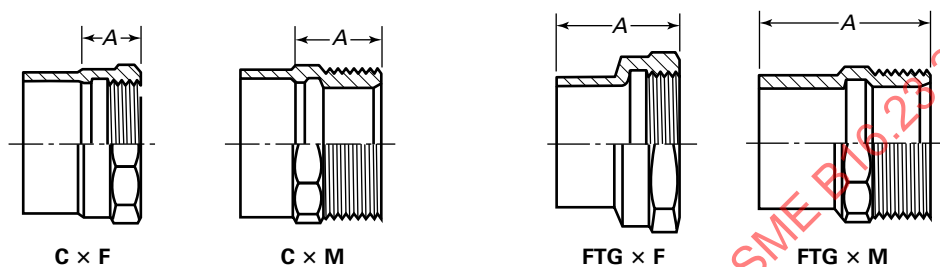
NOTES:

- (1) For inside diameter of fitting, see Table I-2.
 (2) 1 $\frac{1}{4}$, 1 $\frac{1}{2}$, and 2 male threaded ends may have inside chamfer for slip nut connections.
 (3) Thread size is American National Standard Pipe Threads, General Purpose (Inch), ASME B1.20.1.
 (4) Dimensions computed using formula $E_1 - h - 2T$.
 E_1 = thread pitch diameter from ASME B1.20.1
 h = height of thread from ASME B1.20.1
 T = metal thickness from Table I-2
 (5) For initial thickness tolerance, see section 9.

Table I-4 Dimensions of DWV Couplings, Reducers, Extended Bushings, and Flush Bushings


Nominal Size	Coupling, A	Reducer, B	Extended Bushing, C	Flush Bushing	
				D	E
1 $\frac{1}{4}$	0.12	...	...	...	...
1 $\frac{1}{2}$	0.12	...	...	...	...
1 $\frac{1}{2}$ × 1 $\frac{1}{4}$	...	0.25	0.75	0.62	0.12
2	0.12	...	...	...	...
2 × 1 $\frac{1}{2}$	...	0.38	0.91	0.69	0.13
2 × 1 $\frac{1}{4}$	...	0.44	0.94	0.69	0.19
3	0.19	...	...	...	...
3 × 2	...	0.75	1.38	0.81	0.19
3 × 1 $\frac{1}{2}$	...	0.94	1.31	0.81	0.25
3 × 1 $\frac{1}{4}$	...	0.94	1.31	...	...
4	0.19	...	...	...	...
4 × 3	...	0.34	1.62	1.06	0.31
4 × 2	...	0.50	1.75	...	...
4 × 1 $\frac{1}{2}$	...	1.50	...	...	...
5	0.25	...	...	...	...
5 × 4	...	0.56	1.56	...	...
5 × 3	...	0.88	1.88	...	...
6	0.25	...	...	...	...
6 × 5	...	0.53	2.94	...	...
8	0.38	...	...	...	...
8 × 6	...	1.38	...	...	...

GENERAL NOTE: Dimensions are in inches.

Table I-5 Dimensions of DWV Adapters**DWV Adapters**



Nominal Size	C × F, A	C × M, A	FTG × F, A	FTG × M, A
1¼	0.81	0.94	1.47	1.94
1¼ × 2	0.94	1.31	...	...
1¼ × 1½	0.81	1.12	...	...
1½	0.81	0.94	1.53	2.06
1½ × 2	0.88	1.25	...	...
1½ × 1¼	0.81	1.06	...	...
2	0.88	0.94	1.63	2.38
2 × 3	1.88	...	...	...
2 × 1½	0.88	1.06	...	...
2 × 1¼	0.88	1.06	...	...
3	1.50	1.56	2.38	3.00
3 × 4	2.25	...	...	...
3 × 2	1.56	1.44	...	...
4	1.66	1.62	2.81	3.62
4 × 3	1.69	...	...	...
5	1.94	1.75	...	...
6	2.19	2.00	3.81	...
8	2.62	3.38	4.38	...

GENERAL NOTE: Dimensions are in inches.

Table I-6 Dimensions of DWV Short Adapters**C × M
DWV Short Adapters**

Nominal Size	C × M	
	A	B
1 $\frac{1}{4}$	1.00	0.50
1 $\frac{1}{2}$	1.00	0.44
1 $\frac{1}{4}$ × 1 $\frac{1}{2}$	1.00	0.50
2	1.12	0.50
1 $\frac{1}{2}$ × 2	1.19	0.62

GENERAL NOTE: Dimensions are in inches.

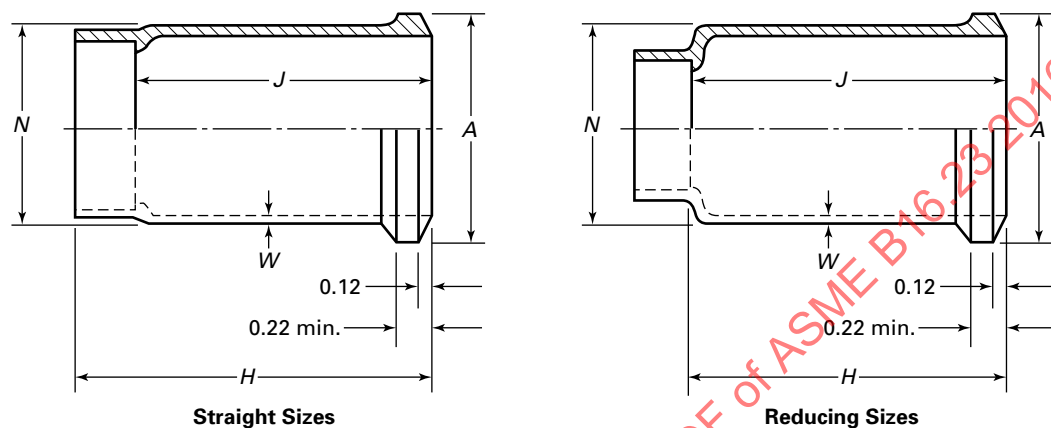
Table I-7 Dimensions of DWV Trap Adapters**FTG × SJ****C × SJ****DWV Trap Adapters**

Nominal Size	FTG × SJ, A	C × SJ, A
1 $\frac{1}{4}$	1.19	0.62
1 $\frac{1}{2}$	1.25	0.69
1 $\frac{1}{2}$ × 1 $\frac{1}{4}$	...	0.69
2	...	0.69
2 × 1 $\frac{1}{2}$	...	0.69

GENERAL NOTES:

(a) Dimensions are in inches.

(b) For dimensions of slip joint ends, see Table I-49.

Table I-8 Dimensions of C to Soil Pipe Adapter for Joining to Extra Heavy Soil Pipe**DWV Soil Pipe Adapter — C x Spigot**

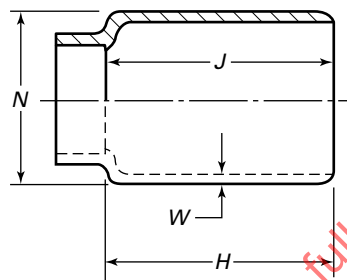
Nominal Size Soil Pipe, C x Spigot [Note (1)]	Diameter of Bead, A		Body Wall, W	Body Outside Diameter [Note (2)], N ±0.09	Body Length [Note (3)], H ±0.06	Laying Length, J
	Max.	Min.				
2 x 2	2.75	2.69	0.10	2.38	2.50	2.50
1½ x 2	2.75	2.69	0.10	2.38	3.25	2.31
1¼ x 2	2.75	2.69	0.10	2.38	3.25	3.31
3 x 3	3.88	3.81	0.12	3.50	2.75	2.75
2 x 3	3.88	3.81	0.12	3.50	3.50	3.56
1½ x 3	3.88	3.81	0.12	3.50	3.50	3.56
4 x 4	4.88	4.81	0.12	4.50	3.00	3.00
3 x 4	4.88	4.81	0.12	4.50	3.75	3.81
2 x 4	4.88	4.81	0.12	4.50	3.75	3.88
1½ x 4	4.88	4.81	0.12	4.50	3.75	3.88
5 x 5	5.88	5.81	0.19	5.50	3.00	3.00
6 x 6	6.88	6.81	0.22	6.50	3.00	3.00

GENERAL NOTE: Dimensions are in inches.

NOTES:

- (1) Dimensions given are for extra heavy weight soil pipe. Refer to ASTM A74. For service weight, A and N may be reduced as shown in Table 2 of ASTM A74. Service weight adapters should be marked "SW" or "SERVICE WEIGHT."
- (2) N is taken from outside diameter of XH soil pipe.
- (3) H body lengths are based on "telescoping lengths of XH soil pipe hubs."

Table I-9 Dimensions of C to Soil Pipe Adapter — Plain End for Joining to Extra Heavy Soil Pipe



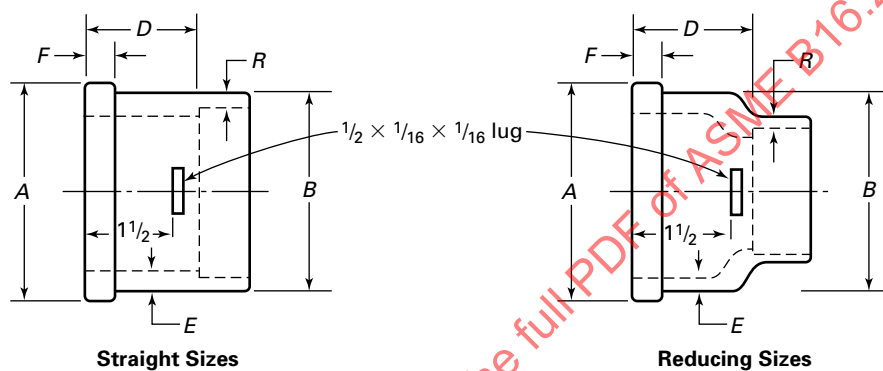
**C × Soil Pipe
DWV Soil Pipe Adapters — Plain End
[Note (1)]**

Nominal Size	Body Length, $H \pm 0.06$	Body Outside Diameter, $N \pm 0.09$	Body Wall, W	Laying Length, J
2 × 2	2.50	2.38	0.10	2.50
1 $\frac{1}{4}$ × 2	2.50	2.38	0.10	2.56
1 $\frac{1}{2}$ × 2	2.50	2.38	0.10	2.56
3 × 3	2.75	3.50	0.12	2.75
2 × 3	2.75	3.50	0.12	2.81
3 × 4	3.00	4.50	0.12	3.06

GENERAL NOTE: Dimensions are in inches.

NOTE:

(1) For use with elastomer gasket.

Table I-10 Dimensions of C × No-Hub Soil Pipe Adapter**DWV Soil Pipe Adapter — C × No-Hub**
[Note (1)]

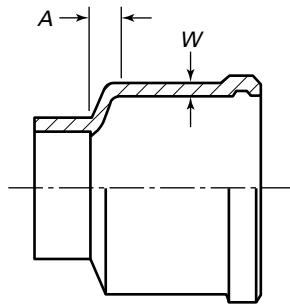
Nominal Size C × No-Hub	Diameter of Bead, A ±0.06	Outside Diameter of Body, B ±0.06	Laying Length, D	Metal Thickness [Note (2)]		Minimum Width Bead, F +0.13 −0.00
				Body, E	Joint, R	
2	2.38	2.31	1.22	0.100	0.090	0.25
1 1/2 × 2	2.38	2.31	1.25	0.100	0.078	0.25
1 1/4 × 2	2.38	2.31	1.28	0.100	0.072	0.25
3	3.41	3.34	1.22	0.120	0.103	0.25
2 × 3	3.41	3.34	1.25	0.120	0.090	0.25
1 1/2 × 3	3.41	3.34	1.28	0.120	0.078	0.25
4	4.44	4.38	1.22	0.120	0.120	0.31
3 × 4	4.44	4.38	1.25	0.120	0.103	0.31

GENERAL NOTE: Dimensions are in inches.

NOTES:

(1) For use with stainless steel clamp and elastomer gasket.

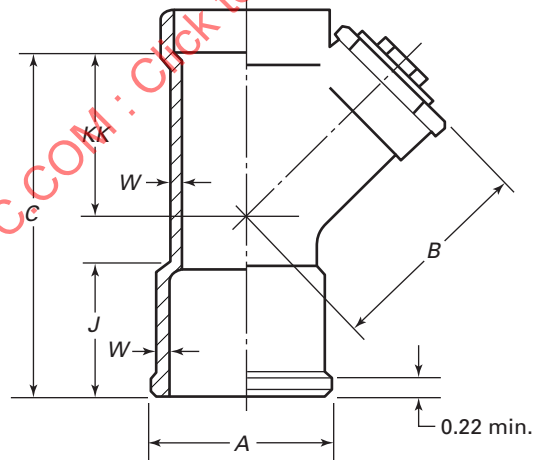
(2) For metal thickness tolerance, see section 9.

Table I-11 Dimensions of C × Hub Soil Pipe Adapter**DWV Soil Pipe Adapter
C × Hub**

Nominal Size	A	W
3	0.38	0.12
3 × 4	0.44	0.12
4	0.19	0.12

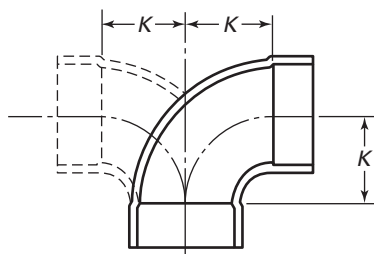




GENERAL NOTES:

- (a) Dimensions are in inches.
 (b) For hub dimensions, see ASTM A74.

Table I-12 Dimensions of DWV 45-deg Y With Cleanout — Soil Pipe (Spigot) × C × Cleanout**DWV 45-deg Y With Cleanout**

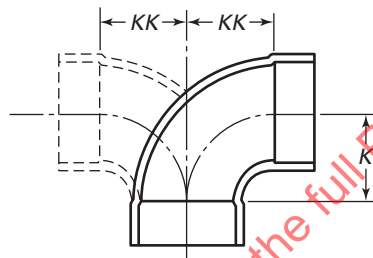
Nominal Size	A		Minimum, B	C	J	KK	W
	Max.	Min.					
4 × 3 × 3	4.83	4.81	5.12	8.50	3.00	4.12	0.12

GENERAL NOTE: Dimensions are in inches.

Table I-13 Dimensions of DWV Elbows and Double Elbows — C × C**DWV 90-deg Elbow
C × C and C × C × C****DWV 60-deg Elbow
C × C****DWV 45-deg Elbow
C × C****DWV 22½-deg Elbow
C × C****DWV 11¼-deg Elbow
C × C**

Angle	Dimension	Nominal Size							
		1¼	1½	2	3	4	5	6	8
DWV 90-deg elbow, C × C	K	1.19	1.44	1.94	2.94	3.88	4.88	5.81	7.81
DWV 60-deg elbow, C × C	K	0.69	0.81	1.12	1.69	2.25	2.88	3.50	4.62
DWV 45-deg elbow, C × C	K	0.50	0.56	0.81	1.19	1.62	2.06	2.50	3.31
DWV 22½-deg elbow, C × C	K	0.19	0.25	0.38	0.56	0.75	0.94	1.12	1.50
DWV 11¼-deg elbow, C × C	K	0.12	0.12	0.19	0.25	0.31	0.41	0.50	0.66

GENERAL NOTE: Dimensions are in inches.

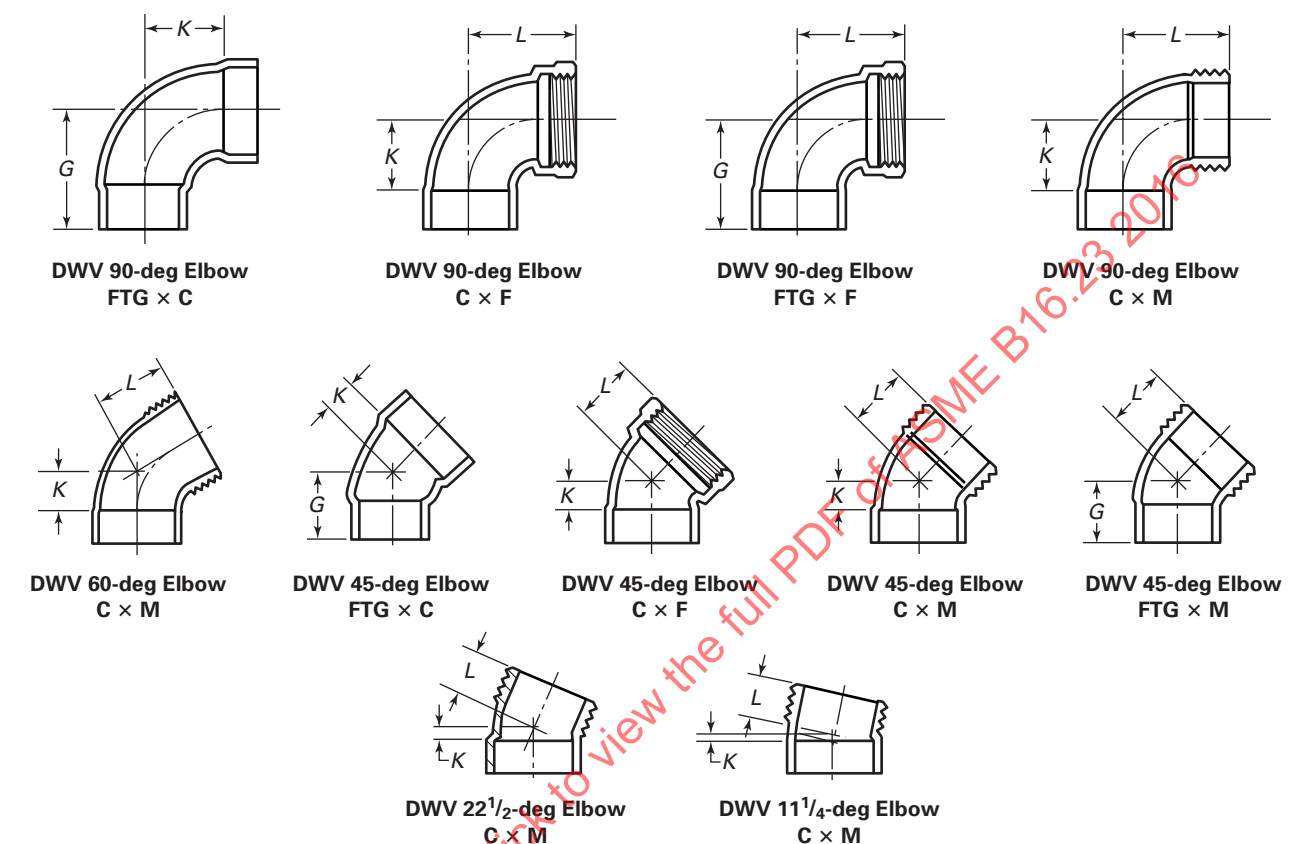
Table I-14 Dimensions of Reducing DWV Single and Double Elbows — C × C

DWV 90-deg Elbow, C × C
DWV Double Elbow, C × C × C

Angle	Dimension	Nominal Size C × C or C × C × C			
		1½ × 1¼	2 × 1½	2 × 1¼	4 × 3
DWV 90-deg reducing elbow, C × C	K	1.19	1.44	1.19	2.81
	KK	1.31	1.69	1.56	3.00

GENERAL NOTE: Dimensions are in inches.

Table I-15 Dimensions of DWV Elbows



Angle	Dimensions	Nominal Size				
		1 $\frac{1}{4}$	1 $\frac{1}{2}$	2	3	4
DWV 90-deg elbow, FTG $\times$ C	K	1.19	1.44	1.94	2.94	3.88
	G	1.75	2.12	2.69	3.75	4.88
DWV 90-deg elbow, C $\times$ F	K	1.19	1.44	1.94	2.94	3.88
	L	1.88	2.12	2.69	3.94	4.94
DWV 90-deg elbow, FTG $\times$ F	G	1.75	2.06	2.69	3.75	4.81
	L	1.88	2.12	2.69	3.94	5.00
DWV 90-deg elbow, C $\times$ M	K	1.19	1.44	1.94	2.94	3.88
	L	1.88	2.12	2.81	3.94	4.94
DWV 45-deg elbow, FTG $\times$ C	K	0.50	0.56	0.81	1.19	1.62
	G	1.06	1.19	1.50	2.00	2.69

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) See Table I-16 for reducing sizes.
- (c) See Table I-17 for continuation of dimensions.

Table I-16 Dimensions of DWV Reducing Elbows

Nominal Size	DWV 90-deg Elbow, C × F		DWV 90-deg Elbow, C × M	
	<i>K</i>	<i>L</i>	<i>K</i>	<i>L</i>
1½ × 1¼	1.31	2.00	1.31	1.88

GENERAL NOTES:

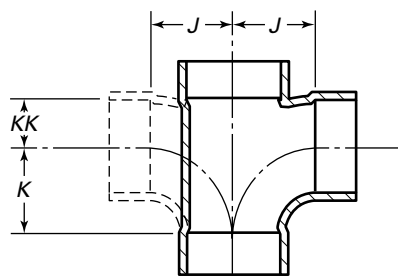
- (a) Dimensions are in inches.
 (b) Refer to illustrations for Table I-15.

Table I-17 Dimensions of DWV Elbows

Angle	Dimensions	Nominal Size		
		1¼	1½	2
DWV 60-deg elbow, C × M	<i>K</i>	0.66	0.81	1.09
	<i>L</i>	1.28	1.50	1.84
DWV 45-deg elbow, C × F	<i>K</i>	0.30	0.36	0.75
	<i>L</i>	1.28	1.38	1.66
DWV 45-deg elbow, C × M	<i>K</i>	0.50	0.56	0.75
	<i>L</i>	1.19	1.31	1.33
DWV 45-deg elbow, FTG × M	<i>L</i>	1.06	1.25	1.33
	<i>G</i>	1.03	1.19	1.30
DWV 22½-deg elbow, C × M	<i>K</i>	0.19	0.25	0.34
	<i>L</i>	0.81	0.94	1.09
DWV 11¼-deg elbow, C × M	<i>K</i>	0.12	0.12	0.19
	<i>L</i>	0.75	0.81	0.94

GENERAL NOTES:

- (a) Dimensions are in inches.
 (b) Refer to illustrations for Table I-15.

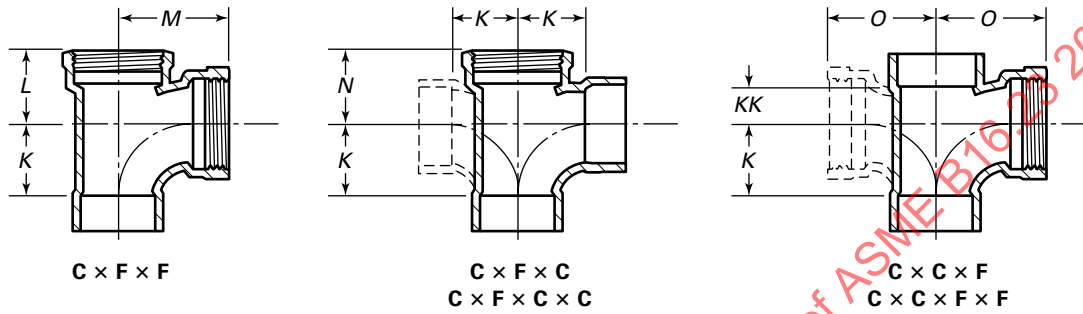
Table I-18 Dimensions of DWV Tees and Double Tees

DWV Tees
C × C × C
C × C × C × C

Nominal Size	J	K	KK
1 ¹ / ₄	1.19	1.19	0.69
1 ¹ / ₂	1.44	1.44	0.81
1 ¹ / ₂ × 1 ¹ / ₂ × 1 ¹ / ₄	1.31	1.19	0.69
1 ¹ / ₂ × 1 ¹ / ₄ × 1 ¹ / ₂	1.44	1.44	0.81
1 ¹ / ₂ × 1 ¹ / ₄ × 1 ¹ / ₄	1.31	1.19	0.75
2	1.94	1.94	1.00
2 × 2 × 1 ¹ / ₂	1.69	1.44	0.81
2 × 2 × 1 ¹ / ₄	1.56	1.19	0.69
2 × 1 ¹ / ₂ × 2	1.94	1.94	1.00
2 × 1 ¹ / ₂ × 1 ¹ / ₂	1.69	1.44	0.81
2 × 1 ¹ / ₂ × 1 ¹ / ₄	1.69	1.44	0.75
3	2.94	2.94	1.50
3 × 3 × 2	2.44	1.94	1.00
3 × 3 × 1 ¹ / ₂	2.19	1.44	0.81
3 × 3 × 1 ¹ / ₄	2.06	1.19	0.69
3 × 2 × 3	2.94	2.94	1.28
3 × 2 × 2	2.44	1.94	0.97
3 × 2 × 1 ¹ / ₂	2.81	1.44	0.84
3 × 1 ¹ / ₂ × 3	2.94	2.94	1.25
3 × 1 ¹ / ₂ × 1 ¹ / ₂	2.19	1.44	0.69
4	3.88	3.88	2.06
4 × 4 × 3	3.44	2.94	1.50
4 × 4 × 2	2.88	1.94	1.00
4 × 4 × 1 ¹ / ₂	2.62	1.44	0.81
4 × 4 × 1 ¹ / ₄	2.150	1.19	0.69
4 × 2 × 4	3.88	3.88	1.25
5	4.88	4.88	2.31
5 × 5 × 4	4.38	3.88	1.94
6	5.81	5.81	2.75
6 × 6 × 4	4.88	3.88	1.94
6 × 4 × 4	4.81	3.88	1.50
8	7.81	7.81	3.44
8 × 8 × 6	6.69	5.81	2.69
8 × 6 × 6	6.75	5.81	2.31

GENERAL NOTE: Dimensions are in inches.

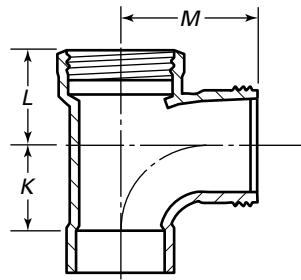

Table I-19 Dimensions of DWV Tees and Double Tees



DWV Tees and Double Tees

Nominal Size	K	L	M	N	O	KK
1 $\frac{1}{4}$	1.19	1.38	1.88	1.38	1.88	0.69
1 $\frac{1}{2}$	1.44	1.56	2.19	1.50	2.12	0.81
1 $\frac{1}{2}$ x 1 $\frac{1}{2}$ x 1 $\frac{1}{4}$	1.19	1.56	2.19	...	2.00	0.69
1 $\frac{1}{2}$ x 1 $\frac{1}{4}$ x 1 $\frac{1}{2}$	1.44	1.56	2.19	...	2.12	0.81
2	1.94	1.75	2.69	1.75	2.69	1.00
2 x 2 x 1 $\frac{1}{2}$	1.44	1.75	2.38	...	2.38	0.81
2 x 2 x 1 $\frac{1}{4}$	1.19	1.75	2.25	...	2.25	0.69
2 x 1 $\frac{1}{2}$ x 1 $\frac{1}{2}$	1.44	1.56	2.38	...	2.38	0.88
2 x 1 $\frac{1}{2}$ x 2	1.94	...	...	1.75	...	...
3	2.94	2.69	3.94	2.50	3.94	1.50
3 x 3 x 2	1.94	...	...	...	3.19	1.00
3 x 3 x 1 $\frac{1}{2}$	1.44	...	...	...	2.88	0.81
3 x 3 x 1 $\frac{1}{4}$	1.19	...	...	...	2.75	0.69
4	3.88	3.31	4.94	3.31	4.94	1.94
4 x 4 x 3	2.94	...	...	...	4.44	1.50
4 x 4 x 2	1.94	...	...	...	3.62	1.00
4 x 4 x 1 $\frac{1}{2}$	1.44	...	...	...	3.31	0.81
4 x 4 x 1 $\frac{1}{4}$	1.19	...	...	...	3.19	0.69

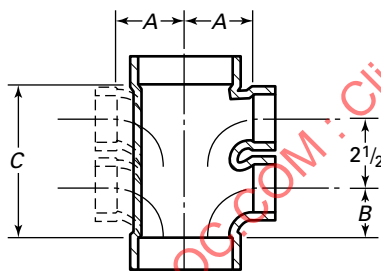
GENERAL NOTE: Dimensions are in inches.

Table I-20 Dimensions of DWV Trap Tees**DWV Trap Tees
C x F x SJ****DWV Trap Tees
C x C x SJ**

Nominal Size	K	L	M	KK	LL
1 $\frac{1}{4}$	1.19	1.38	2.00	0.75	1.94
1 $\frac{1}{2}$	1.44	1.56	2.31	0.81	2.25
1 $\frac{1}{2}$ x 1 $\frac{1}{2}$ x 1 $\frac{1}{4}$	1.19	1.56	2.19	0.75	2.12
2	1.94	1.75	2.78	1.12	2.62

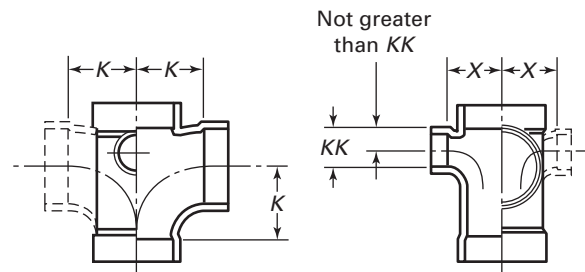
GENERAL NOTES:

- (a) Dimensions are in inches.
 (b) For dimensions of slip joint ends, see Table I-49.

Table I-21 Dimensions of DWV Double and Quadruple Branch Fittings**C x C x C x C
C x C x C x C x C x C
DWV Branch Fittings**

Nominal Size	A	B	C
3 x 3 with 1 $\frac{1}{2}$ -in. inlets	2.19	1.56	4.94
3 x 3 with 1 $\frac{1}{4}$ -in. inlets	2.06	1.56	4.94
4 x 4 with 1 $\frac{1}{2}$ -in. inlets	2.62	1.44	4.44
4 x 4 with 1 $\frac{1}{4}$ -in. inlets	2.50	1.44	4.44

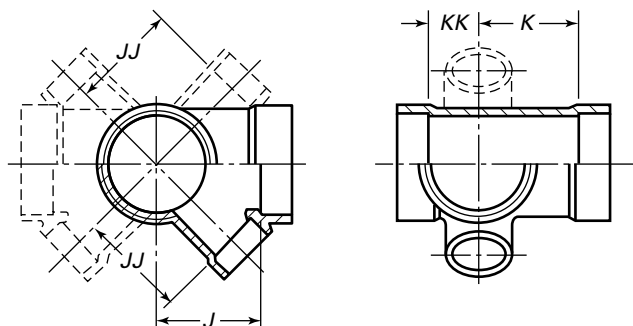
GENERAL NOTE: Dimensions are in inches.

Table I-22 Dimensions of Short Design DWV Tees With Side Inlet(s) (90 deg to Main Inlet), Single and Double**C x C x C With One or Two C Side Inlet(s)
C x C x C x C With One or Two C Side Inlet(s)
DWV Tees — Short Design**

Nominal Sizes	K	KK	X
3 x 3 x 3 with 2-in. inlet(s)	2.94	1.50	2.25
3 x 3 x 3 with 1 $\frac{1}{2}$ -in. inlet(s)	2.94	1.50	2.12

GENERAL NOTES:

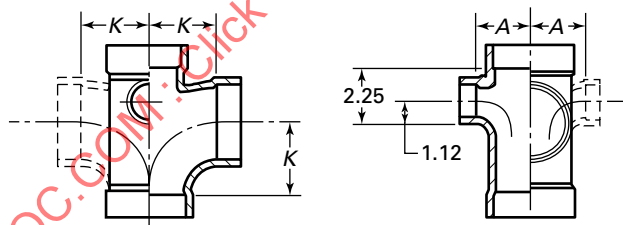
- (a) Dimensions are in inches.
 (b) To determine whether inlets are right-hand or left-hand, place the fitting with large side inlet facing toward you. The side on which the other inlet appears determines its designation.

**Table I-23 Dimensions of Short Design DWV Tees With Side Inlet(s)
(45 deg to Main Inlet), Single and Double****C × C × C With One or Two C Side Inlet(s)
DWV Tees — Short Design**

Nominal Size	K	KK	J	JJ
3 × 3 × 3 with 2-in. inlet(s)	2.94	1.56	3.06	3.38
3 × 3 × 3 with 1½-in. inlet(s)	2.94	1.56	3.06	3.12

GENERAL NOTES:

- (a) Dimensions are in inches.
 (b) To determine whether inlets are right-hand or left-hand, place the fitting with large side inlet facing toward you. The side on which the other inlet appears determines its designation.

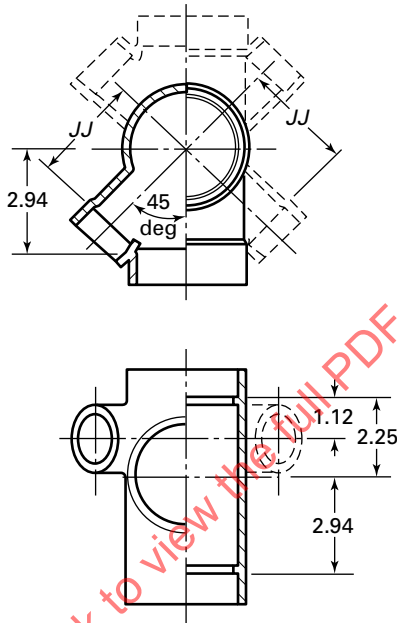
**Table I-24 Dimensions of Long Design DWV Tees
With Side Inlet(s) (90 deg to Main Inlet),
Single and Double****C × C × C With One or Two C Side Inlet(s)
C × C × C × C With One or Two C Side Inlet(s)
DWV Tees — Long Design**

Nominal Size	A	K
3 × 3 × 3 with 2-in. inlet(s)	2.44	2.94
3 × 3 × 3 with 1½-in. inlet(s)	2.19	2.94
3 × 3 × 3 with 1¼-in. inlet(s)	2.06	2.94
4 × 4 × 4 with 2-in. inlet(s)	2.88	3.88
4 × 4 × 4 with 1½-in. inlet(s)	2.62	3.88

GENERAL NOTES:

- (a) Dimensions are in inches.
 (b) To determine whether inlets are right-hand or left-hand, place the fitting with large side inlet facing toward you. The side on which the other inlet appears determines its designation.

Table I-25 Dimensions of Long Design DWV Tees
With Side Inlet(s) (45 deg to Main Inlet),
Single and Double



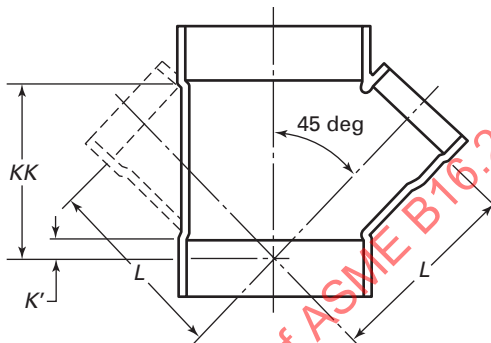
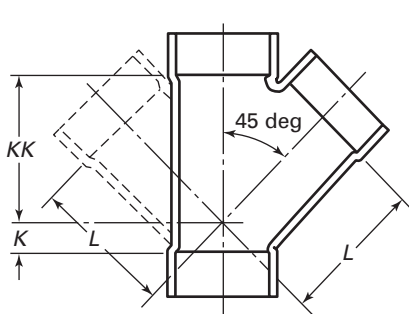
C × C × C With One or Two C Side Inlet(s)
C × C × C × C With One or Two C Side Inlet(s)
DWV Tees — Long Design

Nominal Sizes	//
3 × 3 × 3 with 2-in. inlet(s)	3.50
3 × 3 × 3 with 1½-in. inlet(s)	3.19

GENERAL NOTES:

- (a) Dimensions are in inches.
- (b) To determine whether inlets are right-hand or left-hand, place the fitting with large side inlet facing toward you. The side on which the other inlet appears determines its designation.

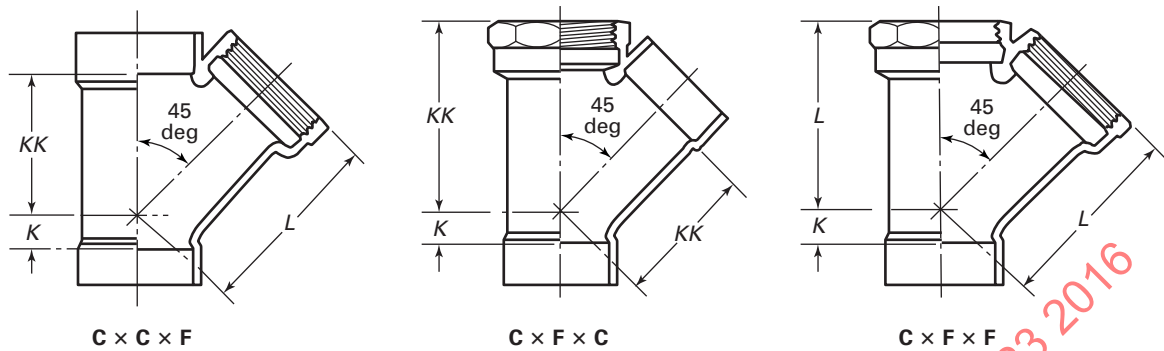
Table I-26 Dimensions of Single and Double DWV 45-deg Ys



$C \times C \times C$
 $C \times C \times C \times C$
 DWV 45-deg Ys

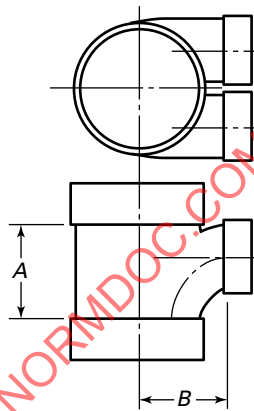
Nominal Size	K	K'	KK	L	Nominal Size	K	K'	KK	L
$1\frac{1}{4}$	0.31	...	1.88	1.88	4	1.06	...	5.38	5.38
$1\frac{1}{2}$	0.38	...	2.19	2.19	$4 \times 4 \times 3$	0.34	...	4.62	4.75
$1\frac{1}{2} \times 1\frac{1}{2} \times 1\frac{1}{4}$	0.25	...	2.00	2.06	$4 \times 4 \times 2$	...	0.34	3.88	4.19
$1\frac{1}{2} \times 1\frac{1}{4} \times 1\frac{1}{2}$	0.44	...	2.12	2.06	$4 \times 4 \times 1\frac{1}{2}$	...	0.66	3.56	3.94
$1\frac{1}{2} \times 1\frac{1}{4} \times 1\frac{1}{4}$	0.25	...	1.94	1.94	$4 \times 4 \times 1\frac{1}{4}$	...	0.84	3.38	3.81
2	0.36	...	2.75	2.75	5	1.19	...	6.50	6.50
$2 \times 2 \times 1\frac{1}{2}$	0.22	...	2.50	2.56	$5 \times 5 \times 4$	0.56	...	5.75	6.00
$2 \times 2 \times 1\frac{1}{4}$	0.06	...	2.31	2.44	$5 \times 5 \times 3$	...	0.06	5.12	5.53
$2 \times 1\frac{1}{2} \times 2$	0.53	...	2.62	2.53	6	1.50	...	7.69	7.69
$2 \times 1\frac{1}{2} \times 1\frac{1}{2}$	0.28	...	2.19	2.19	$6 \times 6 \times 4$	0.06	...	6.25	6.69
$2 \times 1\frac{1}{4} \times 1\frac{1}{4}$	0.06	...	2.34	2.56	$6 \times 6 \times 3$	...	0.62	5.62	6.19
3	0.81	...	4.12	4.12	$6 \times 6 \times 2$	...	1.25	4.88	5.69
$3 \times 3 \times 2$	0.12	...	3.38	3.50	$6 \times 4 \times 4$	0.06	...	5.31	5.31
$3 \times 3 \times 1\frac{1}{2}$	...	0.19	3.00	3.25	$6 \times 4 \times 2$	...	1.25	3.94	4.31
$3 \times 3 \times 1\frac{1}{4}$	...	0.38	2.88	3.06	8	1.38	...	10.19	10.19
$3 \times 2 \times 3$	0.09	...	2.75	2.75	$8 \times 8 \times 6$	0.53	...	8.78	9.22
$3 \times 1\frac{1}{2} \times 3$	...	0.38	2.44	2.55	$8 \times 6 \times 6$	0.53	...	7.75	7.75
$3 \times 1\frac{1}{2} \times 1\frac{1}{2}$	...	0.34	2.19	2.19					

GENERAL NOTE: Dimensions are in inches.

Table I-27 Dimensions of DWV 45-deg Ys

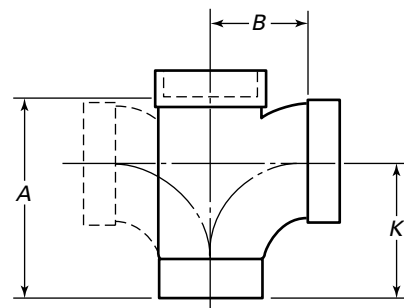
Nominal Size	K	KK	L
1 $\frac{1}{4}$	0.31	1.88	2.75
1 $\frac{1}{2}$	0.38	2.19	3.12
2	0.56	2.75	3.75
2 x 1 $\frac{1}{2}$ x 2	0.56	2.88	3.75
3	0.81	4.12	5.69
4	1.06	5.38	6.94

GENERAL NOTE: Dimensions are in inches.

Table I-28 Dimensions of DWV Horizontal Twin Branch Tees**DWV Horizontal Twin Branch Tees**
C x C x C x C

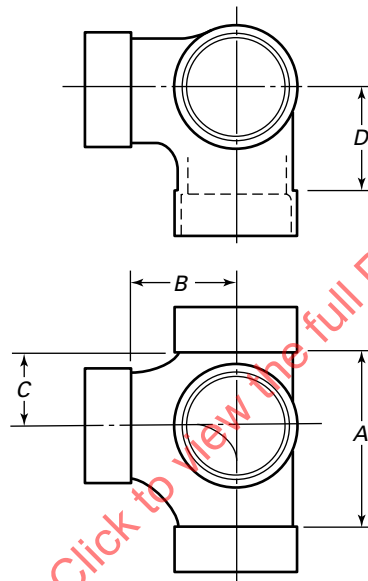
Nominal Size	A	B	Minimum, C
3 x 3 x 1 $\frac{1}{2}$ x 1 $\frac{1}{2}$	2.44	2.22	1.88
3 x 3 x 1 $\frac{1}{4}$ x 1 $\frac{1}{4}$	2.19	2.19	1.83

GENERAL NOTE: Dimensions are in inches.

Table I-29 Dimensions of DWV Fitting Tees, Single and Double**DWV Fitting Tees — Single and Double**
FTG x C x C
FTG x C x C x C

Nominal Size	A	B	K
1 $\frac{1}{2}$	2.78	1.41	1.97
2	3.45	1.88	2.50
3 x 3 x 2	3.75	2.38	2.62
3 x 3 x 1 $\frac{1}{2}$	3.19	2.16	2.22
3 x 3 x 1 $\frac{1}{4}$	2.72	2.00	1.87
3	5.25	2.88	3.62
3 x 2 x 3	4.94	2.88	3.62

GENERAL NOTE: Dimensions are in inches.

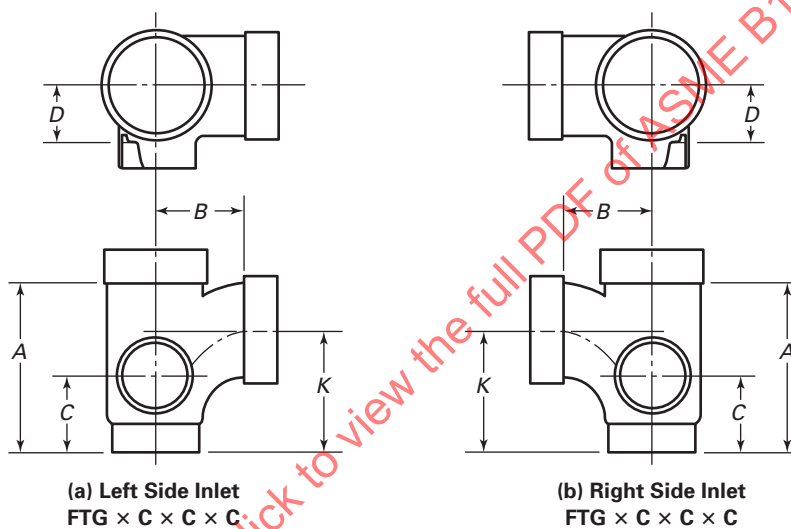
Table I-30 Dimensions of DWV Utility Tees

DWV Utility Tees
C × C × C × C

Nominal Size	A	B	C	D
1½	2.25	1.44	0.81	1.44
2	3.19	1.94	1.25	1.94
2 × 2 × 1½ × 1½	2.31	1.66	0.88	1.66

GENERAL NOTE: Dimensions are in inches.

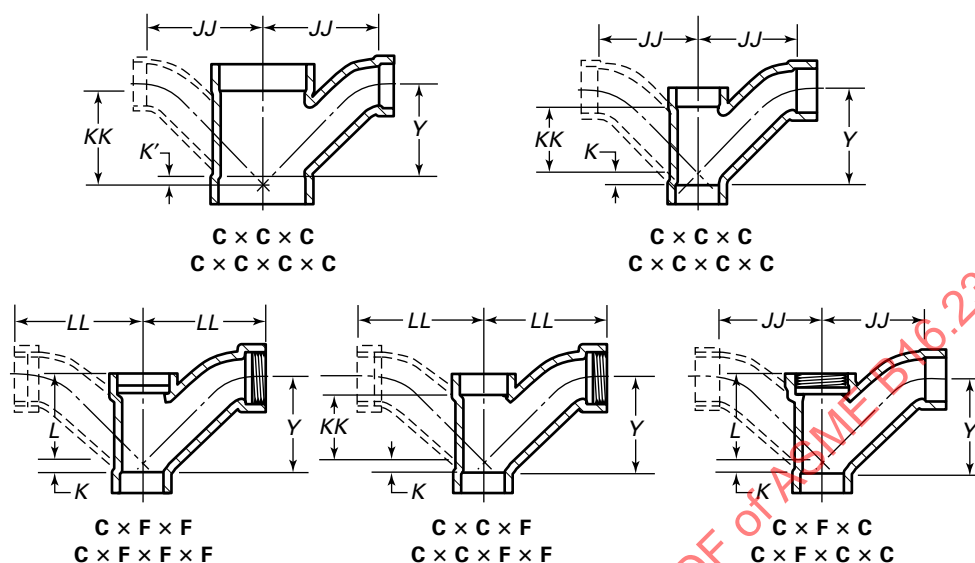
**Table I-31 Dimensions of DWV Fitting Tees With Side Inlet
Maximum Below Centerline**



Nominal Size	A	B	C	D	K
3 $\times$ 3 $\times$ 3 $\times$ 1 $\frac{1}{2}$	5.25	2.94	2.16	1.75	3.75
3 $\times$ 3 $\times$ 3 $\times$ 2	5.25	2.94	2.41	1.75	3.75

GENERAL NOTE: Dimensions are in inches.

Table I-32 Dimensions of DWV Long Turn T-Ys, Single and Double



Nominal Size	JJ	K	K'	KK	L	LL	Y
1 $\frac{1}{4}$	2.50	0.31	...	1.75	2.62	3.94	2.50
1 $\frac{1}{2}$	3.00	0.38	...	2.12	3.12	3.81	3.00
1 $\frac{1}{2}$ x 1 $\frac{1}{2}$ x 1 $\frac{1}{4}$	2.81	0.19	...	1.94	3.00	3.81	2.62
2	4.00	0.56	...	2.62	3.62	4.81	4.00
2 x 2 x 1 $\frac{1}{2}$	3.44	0.25	...	2.38	3.38	4.44	3.19
2 x 2 x 1 $\frac{1}{4}$	3.00	0.06	...	2.12	...	...	2.69
2 x 1 $\frac{1}{2}$ x 2	4.00	0.56	...	2.81	...	...	4.00
2 x 1 $\frac{1}{4}$ x 2	4.00	0.50	...	2.44	...	...	4.00
3	5.88	0.81	...	3.88	5.44	9.00	5.88
3 x 3 x 2	4.69	0.09	...	3.25	...	...	4.12
3 x 3 x 1 $\frac{1}{2}$	3.94	...	0.22	2.88	...	...	3.25
3 x 3 x 1 $\frac{1}{4}$	3.75	...	0.41	2.78	...	...	2.81
3 x 2 x 3	5.88	0.81	...	3.44	...	...	5.88
3 x 2 x 2	4.50	0.06	...	2.75	...	...	4.00
4	7.75	1.06	...	5.00	6.69	9.00	7.75
4 x 4 x 3	5.62	0.44	...	4.50	...	...	5.12
4 x 4 x 2	5.12	...	0.25	3.88	...	...	4.25
4 x 4 x 1 $\frac{1}{2}$	4.88	...	0.62	3.47	...	...	3.62
5	9.94	1.25	...	6.50	...	...	9.78
5 x 5 x 4	8.62	0.59	...	5.84	...	...	7.97
5 x 5 x 3	7.25	...	0.06	5.19	...	...	6.16
6	11.81	1.53	...	7.78	...	...	11.62
6 x 6 x 5	10.44	0.88	...	7.09	...	...	9.78
6 x 6 x 4	9.09	0.19	...	6.34	...	...	7.91
6 x 6 x 3	7.69	...	0.50	5.69	...	...	6.12

GENERAL NOTE: Dimensions are in inches.