




**ASSE 1002-2020/
ASME A112.1002-2020/
CSA B125.12:20**
National Standard of Canada
American National Standard



Anti-siphon fill valves for water closet tanks

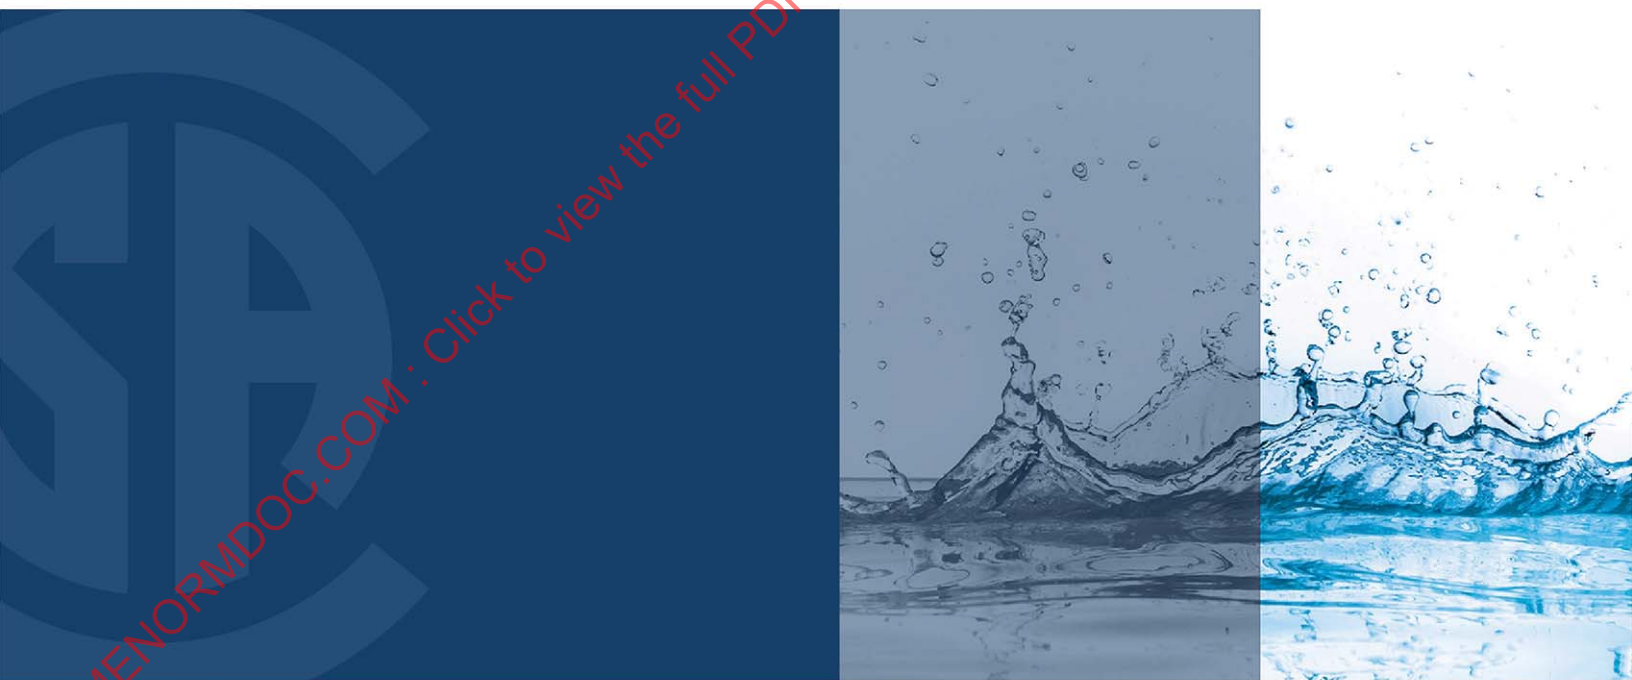

Click to view the full PDF of ASSE 1002 ASME A112.1002 CSA B125.12 2020



Standards Council of Canada
Conseil canadien des normes

Legal Notice for Harmonized Standard

Jointly Developed by ASME, ASSE, and CSA Group

Intellectual property rights and ownership

As between American Society of Mechanical Engineers ("ASME"), ASSE International Chapter of IAPMO, LLC. ("ASSE"), and Canadian Standards Association (Operating as "CSA Group") (collectively "ASME, ASSE, and CSA Group") and the users of this document (whether it be in printed or electronic form), ASME, ASSE, and CSA Group are the joint owners of all works contained herein that are protected by copyright, all trade-marks (except as otherwise noted to the contrary), and all inventions and trade secrets that may be contained in this document, whether or not such inventions and trade secrets are protected by patents and applications for patents. The unauthorized use, modification, copying, or disclosure of this document may violate laws that protect the intellectual property of ASME, ASSE, and CSA Group and may give rise to a right in ASME, ASSE and CSA Group to seek legal redress for such use, modification, copying, or disclosure. ASME, ASSE, and CSA Group reserve all intellectual property rights in this document.

Disclaimer and exclusion of liability

This document is provided without any representations, warranties, or conditions of any kind, express or implied, including, without limitation, implied warranties or conditions concerning this document's fitness for a particular purpose or use, its merchantability, or its non-infringement of any third party's intellectual property rights. ASME, ASSE, and CSA Group do not warrant the accuracy, completeness, or currency of any of the information published in this document. ASME, ASSE, and CSA Group make no representations or warranties regarding this document's compliance with any applicable statute, rule, or regulation.

IN NO EVENT SHALL ASME, ASSE, AND CSA GROUP, THEIR RESPECTIVE VOLUNTEERS, MEMBERS, SUBSIDIARIES, OR AFFILIATED COMPANIES, OR THEIR EMPLOYEES, DIRECTORS, OR OFFICERS, BE LIABLE FOR ANY DIRECT, INDIRECT, OR INCIDENTAL DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES, HOWSOEVER CAUSED, INCLUDING BUT NOT LIMITED TO SPECIAL OR CONSEQUENTIAL DAMAGES, LOST REVENUE, BUSINESS INTERRUPTION, LOST OR DAMAGED DATA, OR ANY OTHER COMMERCIAL OR ECONOMIC LOSS, WHETHER BASED IN CONTRACT, TORT (INCLUDING NEGLIGENCE), OR ANY OTHER THEORY OF LIABILITY, ARISING OUT OF OR RESULTING FROM ACCESS TO OR POSSESSION OR USE OF THIS DOCUMENT, EVEN IF ASME, ASSE, OR CSA GROUP HAVE BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES.

In publishing and making this document available, ASME, ASSE, and CSA Group are not undertaking to render professional or other services for or on behalf of any person or entity or to perform any duty owed by any person or entity to another person or entity. The information in this document is directed to those who have the appropriate degree of experience to use and apply its contents, and ASME, ASSE, and CSA Group accept no responsibility whatsoever arising in any way from any and all use of or reliance on the information contained in this document.

ASME, ASSE, and CSA Group have no power, nor do they undertake, to enforce compliance with the contents of the standards or other documents they jointly publish.

Authorized use of this document

This document is being provided by ASME, ASSE, and CSA Group for informational and non-commercial use only. The user of this document is authorized to do only the following:

If this document is in electronic form:

- load this document onto a computer for the sole purpose of reviewing it;
- search and browse this document; and
- print this document if it is in PDF format.

Limited copies of this document in print or paper form may be distributed only to persons who are authorized by ASME, ASSE, and CSA Group to have such copies, and only if this Legal Notice appears on each such copy.

In addition, users may not and may not permit others to

- alter this document in any way or remove this Legal Notice from the attached standard;
- sell this document without authorization from ASME, ASSE, and CSA Group; or
- make an electronic copy of this document.

If you do not agree with any of the terms and conditions contained in this Legal Notice, you may not load or use this document or make any copies of the contents hereof, and if you do make such copies, you are required to destroy them immediately. Use of this document constitutes your acceptance of the terms and conditions of this Legal Notice.



Standards Update Service

ASSE 1002-2020/ASME A112.1002-2020/ CSA B125.12:20 June 2020

Title: *Anti-siphon fill valves for water closet tanks*

To register for e-mail notification about any updates to this publication

- go to store.csagroup.org
- click on **Product Updates**

The **List ID** that you will need to register for updates to this publication is **2427759**.

If you require assistance, please e-mail techsupport@csagroup.org or call 416-747-2233.

Visit CSA Group's policy on privacy at www.csagroup.org/legal to find out how we protect your personal information.

ASMENORMDOC.COM : Click to view the full PDF of ASSE 1002 ASME A112.1002 CSA B125.12 2020

Canadian Standards Association (operating as “CSA Group”), under whose auspices this National Standard has been produced, was chartered in 1919 and accredited by the Standards Council of Canada to the National Standards system in 1973. It is a not-for-profit, nonstatutory, voluntary membership association engaged in standards development and certification activities.

CSA Group standards reflect a national consensus of producers and users — including manufacturers, consumers, retailers, unions and professional organizations, and governmental agencies. The standards are used widely by industry and commerce and often adopted by municipal, provincial, and federal governments in their regulations, particularly in the fields of health, safety, building and construction, and the environment.

Individuals, companies, and associations across Canada indicate their support for CSA Group’s standards development by volunteering their time and skills to Committee work and supporting CSA Group’s objectives through sustaining memberships. The more than 7000 committee volunteers and the 2000 sustaining memberships together form CSA Group’s total membership from which its Directors are chosen. Sustaining memberships represent a major source of income for CSA Group’s standards development activities.

CSA Group offers certification and testing services in support of and as an extension to its standards development activities. To ensure the integrity of its certification process, CSA Group regularly and continually audits and inspects products that bear the CSA Group Mark.

In addition to its head office and laboratory complex in Toronto, CSA Group has regional branch offices in major centres across Canada and inspection and testing agencies in eight countries. Since 1919, CSA Group has developed the necessary expertise to meet its corporate mission: CSA Group is an independent service organization whose mission is to provide an open and effective forum for activities facilitating the exchange of goods and services through the use of standards, certification and related services to meet national and international needs.

For further information on CSA Group services, write to
CSA Group
178 Rexdale Boulevard
Toronto, Ontario, M9W 1R3
Canada



A National Standard of Canada is a standard developed by a Standards Council of Canada (SCC) accredited Standards Development Organization, in compliance with requirements and guidance set out by SCC. More information on National Standards of Canada can be found at www.scc.ca.

SCC is a Crown corporation within the portfolio of Innovation, Science and Economic Development (ISED) Canada. With the goal of enhancing Canada's economic competitiveness and social well-being, SCC leads and facilitates the development and use of national and international standards. SCC also coordinates Canadian participation in standards development, and identifies strategies to advance Canadian standardization efforts.

Accreditation services are provided by SCC to various customers, including product certifiers, testing laboratories, and standards development organizations. A list of SCC programs and accredited bodies is publicly available at www.scc.ca.

Standards Council of Canada
600-55 Metcalfe Street
Ottawa, Ontario, K1P 6L5
Canada



Standards Council of Canada
Conseil canadien des normes

Cette Norme Nationale du Canada n'est disponible qu'en anglais.

Although the intended primary application of this Standard is stated in its Scope, it is important to note that it remains the responsibility of the users to judge its suitability for their particular purpose.

**A trademark of the Canadian Standards Association, operating as “CSA Group”*

CSA Group

The Canadian Standards Association (operating as "CSA Group"), under whose auspices this National Standard has been produced, was chartered in 1919 and accredited by the Standards Council of Canada to the National Standards system in 1973. It is a not-for-profit, nonstatutory, voluntary membership association engaged in standards development and certification activities.

CSA Group standards reflect a national consensus of producers and users including manufacturers, consumers, retailers, unions and professional organizations, and governmental agencies. The standards are used widely by industry and commerce and often adopted by municipal, provincial, and federal governments in their regulations, particularly in the fields of health, safety, building and construction, and the environment.

Individuals, companies, and associations across Canada indicate their support for CSA Group's standards development by volunteering their time and skills to Committee work and supporting CSA Groups objectives through sustaining memberships. The more than 7000 committee volunteers and the 2000 sustaining memberships together form CSA Group's total membership from which its Directors are chosen. Sustaining memberships represent a major source of income for CSA Groups standards development activities.

CSA Group offers certification and testing services in support of and as an extension to its standards development activities. To ensure the integrity of its certification process, CSA Group regularly and continually audits and inspects products that bear the CSA Group Mark.

In addition to its head office and laboratory complex in Toronto, CSA Group has regional branch offices in major centres across Canada and inspection and testing agencies in eight countries. Since 1919, CSA Group has developed the necessary expertise to meet its corporate mission: CSA Group is an independent service organization whose mission is to provide an open and effective forum for activities facilitating the exchange of goods and services through the use of standards, certification and related services to meet national and international needs.

For further information on CSA Group services, write to
CSA Group
178 Rexdale Boulevard, Toronto, Ontario,
Canada M9W 1R3

American National Standards Institute

The American National Standards Institute (ANSI), Inc. is the nationally recognized coordinator of voluntary standards development in the United States through which voluntary organizations, representing virtually every technical discipline and every facet of trade and commerce, organized labor and consumer interests, establish and improve the some 10,000 national consensus standards currently approved as American National Standards.

ANSI provides that the interests of the public may have appropriate participation and representation in standardization activity, and cooperates with departments and agencies of U.S. Federal, state and local governments in achieving compatibility between government codes and standards and the voluntary standards of industry and commerce.

ANSI represents the interests of the United States in international nontreaty organizations such as the International Organization for Standardization (ISO) and the International Electrotechnical Commission (IEC). The Institute maintains close ties with regional organizations such as the Pacific Area Standards Congress (PASC) and the Pan American Standards Commission (COPANT). As such, ANSI coordinates the activities involved in the U.S. participation in these groups.

ANSI approval of standards is intended to verify that the principles of openness and due process have been followed in the approval procedure and that a consensus of those directly and materially affected by the standards has been achieved. ANSI coordination is intended to assist the voluntary system to ensure that national standards needs are identified and met with a set of standards that are without conflict or unnecessary duplication in their requirements.

Responsibility of approving American standards rests with the
American National Standards Institute, Inc.
25 West 43rd Street, Fourth floor
New York, NY 10036

ASSE/ASME/CSA Standard
ASSE 1002-2020/ASME A112.1002-2020/
CSA B125.12:20
Anti-siphon fill valves for water closet tanks



®A trademark of the Canadian Standards Association and CSA America Inc., operating as "CSA Group"

Published in June 2020 by CSA Group
A not-for-profit private sector organization
178 Rexdale Boulevard, Toronto, Ontario, Canada M9W 1R3
1-800-463-6727 • 416-747-4044

Visit the CSA Group Online Store at store.csagroup.org

The American Society of Mechanical Engineers (ASME)
Two Park Avenue
New York, NY 10016-5990, USA
1-800-843-2763

Visit the ASME Online Store at www.asme.org

ASSE International (ASSE)
18927 Hickory Creek Dr., Suite 220
Mokena, IL 60448, USA
(708) 995-3019

Visit the ASSE International Webstore at www.assewebstore.com

Commitment for Amendments

This Standard is issued jointly by the American Society of Mechanical Engineers (ASME), ASSE International Chapter of IAPMO, LLC. ("ASSE"), and the Canadian Standards Association (Operating as "CSA Group"). Amendments to this Standard will be made only after processing according to the Standards writing procedures of both ASME, ASSE, and CSA Group.

The American Society of Mechanical Engineers (ASME)
Two Park Avenue
New York, NY 10016-5990
USA
1-800-843-2763
Visit the ASME Online Store at
www.asme.org

ISBN 978-0-7918-7378-6
Copyright © 2020 by The American Society of Mechanical Engineers (ASME)

This Standard is available for public review on a continuous basis. This provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public at large.

ASSE International
18927 Hickory Creek Dr., Suite 220
Mokena, IL 60448
Tel: (708) 995-3019
Fax: (708) 479-6139

E-mail: general.info@asse-plumbing.org

www.asse-plumbing.org

© ASSE International — 2020

Published in June 2020 by
CSA Group
A not-for-profit private sector organization
178 Rexdale Boulevard
Toronto, Ontario, Canada
M9W 1R3
1-800-463-6727 or 416-747-4044
Visit the CSA Group Online Store at
store.csagroup.org

ISBN 978-1-4883-2645-5
ICS 23.060.01
© 2020 Canadian Standards Association

All rights reserved. No part of this publication may be reproduced in any form whatsoever without the prior permission of the publisher.

Contents

ASME A112 Standards Committee on Plumbing Materials and Equipment 3

ASSE Product Standards Committee 7

CSA Technical Committee on Plumbing Fittings 9

Preface 15

Section I 18

1 Scope 18

Section II 19

2 Reference publications and definitions 19

2.1 Reference publications 19

2.2 Definitions 19

2.3 Abbreviations 19

Section III 19

3 Design and general requirements 19

3.1 Pressure 19

3.2 Temperature 20

3.3 Bowl refill tube 20

3.3.1 Installed position 20

3.3.2 Retrofit devices only 20

3.4 Backflow prevention 20

3.5 Dimensional criteria for fill valve components — End connections 20

3.6 Seating members 20

3.7 Materials 20

3.8 Servicing 21

3.9 Pressure-relief devices 21

Section IV 21

4 Performance requirements and test methods 21

4.1 General 21

4.2 Preconditioning and test conditions 21

4.2.1 Preconditioning 21

4.2.2 Test conditions 21

4.3 Test specimen installation 21

4.4 Pressure and temperature tests 21

4.4.1 Pressure and temperature cycling test 21

4.4.2 Static and dynamic seals, working pressure test 22

4.5 Life cycle test 22

4.5.1 Purpose 22

4.5.2 Test conditions 23

4.5.3	Procedure	23
4.5.4	Performance criteria	23
4.6	Critical level and backflow prevention tests	23
4.6.1	Purpose	23
4.6.2	Procedure	23
4.6.3	Performance criteria	25
4.7	Flow rate test — Retrofit devices only	25
4.7.1	Purpose	25
4.7.2	Procedure	25
4.7.3	Performance criteria	26
4.8	Refill rate test — Retrofit devices only	26
4.8.1	Purpose	26
4.8.2	Procedure	26
4.8.3	Performance criteria	26
4.9	Thread torque strength test	26
4.9.1	Purpose	26
4.9.2	Procedure	26
4.9.3	Performance criteria	26
4.10	Hydrostatic pressure test	27
4.10.1	Purpose	27
4.10.2	Procedure	27
4.10.3	Performance criteria	27

Section V 27

5 Markings, packaging, and installation instructions and included literature 27

5.1	Markings	27
5.1.1	General	27
5.1.2	Visibility of markings	27
5.2	Installation and maintenance instructions — Retrofit devices only	27
5.2.1	Instructions	27
5.2.2	Packaging	27

ASME A112 Standards Committee on Plumbing Materials and Equipment

W. M. Smith	American Society of Plumbing Engineers, Montgomery, Alabama, USA	<i>Chair</i>
S. M. Rawalpindiwala	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA	<i>Vice-Chair</i>
M. R. Gibeault	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA	<i>Alternate</i>
R. K. Adler	City of San Jose, San Jose, California, USA	
J. A. Ballanco	JB Engineering & Code Consulting PC, Munster, Indiana, USA	
J. E. Bertrand	Fortune Brands — Global Plumbing Group, North Olmsted, Ohio, USA	
T. Burger	NSF International, South Euclid, Ohio, USA	
R. Burnham	Zurn Industries LLC, Erie, Pennsylvania, USA	
M. Campos	ICC Evaluation Service, LLC, Brea, California, USA	
S. L. Cavanaugh	Cavanaugh Consulting, Santa Fe, New Mexico, USA	<i>Contributing Member</i>
W. E. Chapin	Professional Code Consulting, LLC, Cullman, Alabama, USA	
A. Ciechanowski	NSF International, Ann Arbor, Michigan, USA	<i>Alternate</i>
P. V. DeMarco	IAPMO, Dayton, New Jersey, USA	

N. E. Dickey	Hansgrohe, Inc., Alpharetta, Georgia, USA	
G. S. Duren	Code Compliance, Inc., South Pasadena, Florida, USA	
A. R. Emmerson	Consultant, Arlington Heights, Illinois, USA	
K. Ernst	Oakville Stamping & Bending Limited, Oakville, Ontario, Canada	
R. L. George	Plumb-Tech Design and Consulting Services LLC, Newport, Michigan, USA	
D. Gleiberman	Sloan Valve Co., Los Angeles, California, USA	
J. W. Lauer	Sloan Valve Co., Anaheim, California, USA	<i>Alternate</i>
M. Guard	Bradley Corporation, Wauwatosa, Wisconsin, USA	
C. Haldiman	Watts Water Technologies, Springfield, Missouri, USA	
G. W. Harrison	Consultant/Plumbing Instructor, Edmond, Oklahoma, USA	
L. Himmelblau	The Chicago Faucet Company, Des Plaines, Illinois, USA	
J. Kendzel	American Supply Association, Itasca, Illinois, USA	<i>Contributing Member</i>
J. M. Koeller	Koeller and Co., Yorba Linda, California, USA	
N. M. Kummerlen	Consultant, Lorain, Ohio, USA	<i>Contributing Member</i>

C. J. Lagan	American Standard/LIXIL, Piscataway, New Jersey, USA	
M. Malatesta	LIXIL Water Technologies Americas, Piscataway, New Jersey, USA	<i>Alternate</i>
W. LeVan	Cast Iron Soil Pipe Institute, Watersound, Florida, USA	
D. Liang	CSA Group, Toronto, Ontario, Canada	<i>Contributing Member</i>
D. Marbry	Fluidmaster Inc., San Juan Capistrano, California, USA	
R. Mata	American Society of Plumbing Engineers, Mentor, Ohio, USA	
C. W. McDonald	Fortune Brands — Global Plumbing Group, North Olmsted, Ohio, USA	<i>Alternate</i>
L. A. Mercer	IAPMO, Valley City, Ohio, USA	
W. B. Morris	Charlotte Pipe & Foundry, Charlotte, North Carolina, USA	<i>Alternate</i>
A. I. Murra	Abraham Murra Consulting, Oakville, Ontario, Canada	
D. Orton	NSF International, Ann Arbor, Michigan, USA	
R. Pickering	Eastern Research Group, Inc. (ERG), Morrisville, North Carolina, USA	<i>Contributing Member</i>
A. Poon	Delta Faucet Company, Indianapolis, Indiana, USA	
B. Ramkarran	Infinity Drain Ltd., Amityville, New York, USA	<i>Contributing Member</i>

S. A. Remedios	Remedios Consulting, London, Ontario, Canada	
M. Sigler	Plumbing Manufacturers International, Orlando, Florida, USA	
G. L. Simmons	Charlotte Pipe & Foundry, Charlotte, North Carolina, USA	
S. Tanner	U.S. Environmental Protection Agency, Washington, District of Columbia, USA	<i>Contributing Member</i>
K. Thompson	IAPMO, Ontario, California, USA	
J. Watson	Elkay Manufacturing, Oak Brook, Illinois, USA	
M. Weiss	Plumbing & Drainage Institute, Polson, Montana, USA	
W. C. Whitehead	Whitehead Consulting Services, Peabody, Massachusetts, USA	
A. L. Guzman Rodriguez	American Society of Mechanical Engineers, New York, New York, USA	<i>Secretary</i>

ASSE Product Standards Committee

T. Su	Stevens Institute of Technology, Hoboken, New Jersey, USA	<i>Chair</i>
W. Briggs	JB&B, New York, New York, USA	
T. Burger	NSF International, South Euclid, Ohio, USA	
W. Chapin	Professional Code Consulting, LLC, Cullman, Alabama, USA	
M. E. Fish	Zurn Industries, LLC, Cary, North Carolina, USA	
R. L. George	Plumb-Tech Design and Consulting Services LLC, Newport, Michigan, USA	
D. Gleiberman	Sloan Valve Co., Los Angeles, California, USA	
B. Gunnell	Precision Plumbing Products, Portland, Oregon, USA	
C. Haldiman	Watts Water Technologies, Springfield, Missouri, USA	
J. F. Higdon	Supply Source Products, Matthews, North Carolina, USA	
J. Kendzel	American Supply Association, Itasca, Illinois, USA	
R. Mata	American Society of Plumbing Engineers, Mentor, Ohio, USA	
T. Pitcherello	State of New Jersey, Bordentown, New Jersey, USA	

D. Rademacher	Plumbing Code and Design Consulting, Butte, MT, USA
S. M. Rawalpindiwala	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA
B. Smith	ASPE, Montgomery, Alabama, USA
C. Jahrling	ASSE International, Chicago, Illinois, USA

CSA Technical Committee on Plumbing Fittings

K. Ernst	Oakville Stamping & Bending Limited, Oakville, Ontario, Canada <i>Category: Producer Interest</i>	<i>Chair</i>
J. E. Bertrand	Fortune Brands — Global Plumbing Group, North Olmsted, Ohio, USA <i>Category: Producer Interest</i>	<i>Vice-Chair</i>
D. McNamara	Franke Kindred Canada Limited, Midland, Ontario, Canada <i>Category: Producer Interest</i>	<i>Vice-Chair</i>
J. Adili	UL LLC, Northbrook, Illinois, USA	<i>Associate</i>
W. T. Ball	WCM Industries Inc., Colorado Springs, Colorado, USA	<i>Associate</i>
S. Breda	Omni Brass Inc., Vaughan, Ontario, Canada <i>Category: User Interest</i>	
J. Briggs	NSF International, Ann Arbor, Michigan, USA	<i>Associate</i>
T. Burger	NSF International, South Euclid, Ontario, USA	<i>Associate</i>
T. Burke	Victoria + Albert Baths Ltd., Telford, Shropshire, United Kingdom	<i>Associate</i>
R. Burnham	Zurn Industries LLC, Erie, Pennsylvania, USA	<i>Associate</i>
M. Campos	ICC Evaluation Service, LLC, Brea, California, USA	<i>Non-voting</i>
W. E. Chapin	Professional Code Consulting, LLC, Cullman, Alabama, USA	<i>Non-voting</i>

L. Clifton	International Code Council, Brea, California, USA	
A. DeFrancesca	City of Toronto, Toronto, Ontario, Canada	<i>Associate</i>
N. E. Dickey	Hansgrohe, Inc., Alpharetta, Georgia, USA	<i>Associate</i>
Y. Duchesne	Régie du bâtiment du Québec, Québec, Quebec, Canada <i>Category: Regulatory Authority</i>	
A. R. Emmerson	Consultant, Mundelein, Illinois, USA	
W. Falcomer	The Corporation of the City of Ottawa, Ottawa, Ontario, Canada <i>Category: Producer Interest</i>	
F. Fernández	Toto U.S.A. Inc., Ontario, California, USA	<i>Associate</i>
M. E. Fish	Zurn Industries, LLC, Cary, North Carolina, USA	<i>Associate</i>
M. R. Gibeault	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA	<i>Associate</i>
D. Gleiberman	Sloan, Los Angeles, California, USA	<i>Associate</i>
D. Grenier	BainUltra inc., Lévis, Quebec, Canada	<i>Associate</i>
M. Guard	Bradley Corporation, Menomonee Falls, Wisconsin, USA	<i>Associate</i>
R. Guinn	Consultant, Oro-Medonte, Ontario, Canada <i>Category: User Interest</i>	
R. Hernandez	CSA Group, Independence, Ohio, USA	

L. Himmelblau	The Chicago Faucet Company, Des Plaines, Illinois, USA <i>Category: Producer Interest</i>	
E. Ho	IAPMO Group, Markham, Ontario, Canada	<i>Associate</i>
E. Hood	H. H. Angus & Associates Limited Consulting Engineers, Toronto, Ontario, Canada <i>Category: User Interest</i>	
K. S. Hui	Ontario Ministry of Municipal Affairs, Toronto, Ontario, Canada <i>Category: Regulatory Authority</i>	
J. Knapton	Southern Alberta Institute of Technology, Calgary, Alberta, Canada <i>Category: General Interest</i>	
J. M. Koeller	Koeller and Co., Yorba Linda, California, USA <i>Category: General Interest</i>	
A. Lathia	CSA Group, Independence, Ohio, USA <i>Category: Regulatory Authority</i>	
F. Lemieux	Health Canada, Ottawa, Ontario, Canada <i>Category: Regulatory Authority</i>	
D. Liang	CSA Group, Toronto, Ontario, Canada	<i>Associate</i>
R. Liao	Xiamen Lota International Co.Ltd, Xiamen, Fujian, China	<i>Associate</i>
D. Lundy	Watts Water Technologies (Canada) Inc., Burlington, Ontario, Canada	<i>Associate</i>
J. MacDonald	BLANCO Canada Inc., Brampton, Ontario, Canada	<i>Associate</i>

M. Malatesta	American Standard/LIXIL, Piscataway, New Jersey, USA	<i>Associate</i>
D. Marbry	Fluidmaster Inc., San Juan Capistrano, California, USA	<i>Associate</i>
M. Martinez	Delta Faucet Company, Indianapolis, Indiana, USA	
R. Mata	American Society of Plumbing Engineers, Mentor, Ohio, USA	<i>Associate</i>
C. McDonald	Fortune Brands — Global Plumbing Group, North Olmsted, Ohio, USA	<i>Associate</i>
M. Mohammed	Reliance Worldwide Corp. (Canada) Inc., Vaughan, Ontario, Canada	<i>Associate</i>
A. I. Murra	Abraham Murra Consulting, Oakville, Ontario, Canada <i>Category: General Interest</i>	
R. Neff	Delta Faucet Company, Indianapolis, Indiana, USA	<i>Associate</i>
S. R. O'Neill	Mohawk College of Applied Arts and Technology, Stoney Creek, Ontario, Canada	<i>Associate</i>
D. Orton	NSF International, Ann Arbor, Michigan, USA	<i>Associate</i>
P. Paré	Masco Canada Limited, St. Thomas, Ontario, Canada <i>Category: Producer Interest</i>	
M. Pfeiffer	International Code Council (ICC), Country Club Hills, Illinois, USA <i>Category: Producer Interest</i>	
R. Pickering	Eastern Research Group Inc., Morrisville, North Carolina, USA	<i>Associate</i>
A. Poon	Delta Faucet Company, Indianapolis, Indiana, USA	

S. M. Rawalpindiwala	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA <i>Category: Producer Interest</i>	
S. A. Remedios	Remedios Consulting, London, Ontario, Canada <i>Category: User Interest</i>	
S. Rouleau	Intertek, Ste-Marie, Québec, Canada	<i>Associate</i>
P. Saeed	Powers, A Watts Brand, Mt. Prospect, Illinois, USA <i>Category: Producer Interest</i>	
S. Shang	China Building Material Test & Cert. Group (Shaanxi) Co. Ltd., Shaanxi, Shanxi, China	<i>Associate</i>
M. Sigler	Plumbing Manufacturers Int'l, Orlando, Florida, USA	<i>Associate</i>
W. Smith	American Society of Plumbing Engineers (ASPE), Montgomery, Alabama, USA <i>Category: General Interest</i>	
R. Sparling	-30-Forensic Engineering, Toronto, Ontario, Canada <i>Category: General Interest</i>	
S. Tanner	U.S. Environmental Protection Agency, Washington, District of Columbia, USA <i>Category: General Interest</i>	
K. Thompson	IAPMO, Ontario, California, USA	<i>Associate</i>
J. C. Watson	Elkay Manufacturing, Oak Brook, Illinois, USA	<i>Associate</i>
S. Weinman	American Society of Mechanical Engineers (ASME), New York, New York, USA	
S. P. Williams	Sioux Chief Manufacturing Company Inc., Brantford, Ontario, Canada	<i>Associate</i>

E. L. Wirtschoreck	International Code Council (ICC), Country Club Hills, Illinois, USA	<i>Associate</i>
K. Wong	Uponor, Apple Valley, Minnesota, USA	<i>Associate</i>
C. Wright	Ontario Pipe Trades, Dundalk, Ontario, Canada <i>Category: User Interest</i>	
R. Zanola	CSA Group, Lombardia, Milan, Italy	
F. Zhang	China Building Material Test & Cert. Group (Shaanxi) Co. Ltd., Shaanxi, Shanxi, China	<i>Associate</i>
J. Menard	CSA Group, Toronto, Ontario, Canada	<i>Project Manager</i>
L. Pilla	CSA Group, Toronto, Ontario, Canada	<i>Project Manager</i>

Preface

This is the second edition of ASSE 1002/ASME A112.1002/CSA B125.12, *Anti-siphon fill valves for water closet tanks*. It supersedes the previous edition published in 2015.

This Standard is considered suitable for use with conformity assessment within the stated scope of the Standard.

This Standard was prepared by the ASSE/ASME/CSA Harmonization Task Group on Plumbing Fittings, under the jurisdiction of the ASME A112 Standards Committee on Plumbing Materials and Equipment, the ASSE Product Standards Committee, and the CSA Technical Committee on Plumbing Fittings. The CSA Technical Committee operates under the jurisdiction of the CSA Strategic Steering Committee on Construction and Civil Infrastructure.

This Standard has been formally approved by the ASME Standards Committee on Plumbing Materials and Equipment, the ASSE Product Standards Committee, and the CSA Technical Committee on Plumbing Fittings.

This Standard has been developed in compliance with Standards Council of Canada requirements for National Standards of Canada. It has been published as a National Standard of Canada by CSA Group.

This Standard was approved as an American National Standard by the American National Standards Institute on April 14, 2020.

ASME Notes:

- 1) *This standard was developed under procedures accredited as meeting the criteria for American National Standards and it is an American National Standard. The Standards Committee that approved the code or standard was balanced to assure that individuals from competent and concerned interests have had an opportunity to participate. The proposed Standard was made available for public review and comment that provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.*
- 2) *ASME does not “approve,” “rate,” or “endorse” any item, construction, proprietary device, or activity.*
- 3) *ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable letters patent, nor assume any such liability. Users of a standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.*
- 4) *Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this standard.*
- 5) *ASME accepts responsibility for only those interpretations of this document issued in accordance with the established ASME procedures and policies, which precludes the issuance of interpretations by individuals.*
- 6) *ASME issues written replies to inquiries concerning interpretation of technical aspects of this Standard. All inquiries regarding this Standard, including requests for interpretations, should be addressed to:*
Secretary, A112 Standards Committee
The American Society of Mechanical Engineers
Two Park Avenue
New York, NY 10016-5990

A request for interpretation should be clear and unambiguous. The request should

- cite the applicable edition of the Standard for which the interpretation is being requested.
- phrase the question as a request for an interpretation of a specific requirement suitable for general understanding and use, not as a request for an approval of a proprietary design or situation. The inquirer may also include any plans or drawings, which are necessary to explain the question; however, they should not contain proprietary names or information.

ASME procedures provide for reconsideration of any interpretation when or if additional information that might affect an interpretation is available. Further, persons aggrieved by an interpretation may appeal to the cognizant ASME Committee.

Interpretations are published on the ASME Web site under the Committee Pages at <https://cstools.asme.org/> as they are issued.

CSA Notes:

- 1) Use of the singular does not exclude the plural (and vice versa) when the sense allows.
- 2) Although the intended primary application of this Standard is stated in its Scope, it is important to note that it remains the responsibility of the users of the Standard to judge its suitability for their particular purpose.
- 3) This publication was developed by consensus, which is defined by CSA Policy governing standardization — Code of good practice for standardization as “substantial agreement. Consensus implies much more than a simple majority, but not necessarily unanimity”. It is consistent with this definition that a member may be included in the Technical Committee list and yet not be in full agreement with all clauses of this publication.
- 4) This Standard is subject to review within five years from the date of publication. Suggestions for its improvement will be referred to the appropriate committee.
- 5) To submit a request for interpretation of this Standard, please send the following information to inquiries@csagroup.org and include “Request for interpretation” in the subject line:
 - a) define the problem, making reference to the specific clause, and, where appropriate, include an illustrative sketch;
 - b) provide an explanation of circumstances surrounding the actual field condition; and
 - c) where possible, phrase the request in such a way that a specific “yes” or “no” answer will address the issue.

Committee interpretations are processed in accordance with the CSA Directives and guidelines governing standardization and are available on the Current Standards Activities page at standardsactivities.csa.ca.

- 6) Attention is drawn to the possibility that some of the elements of this Standard may be the subject of patent rights. CSA Group is not to be held responsible for identifying any or all such patent rights. Users of this Standard are expressly advised that determination of the validity of any such patent rights is entirely their own responsibility.

ASSE Notes:

Notes:

1) Requests for interpretation

Requests for interpretation may be sent to any of the (3) standards organizations. All interpretations are reviewed and agreed upon by the ASSE International, ASME, and CSA prior to response. Requests for interpretations may be sent to:

Staff Engineering Group
ASSE International
18927 Hickory Creek Drive, Suite 220
Mokena, IL 60448-8399

Requests must include:

- Name and contact information of the individual requesting the interpretation;
- Name of organization the individual represents (if any);
- Appropriate references to the standard's clauses that have a bearing on the issue cited in the request;
- A concise explanation of the issue requiring a technical interpretation;
- Any supporting documentation that will assist in understanding or describing the issue;
- Any recommendations the requestor would like to make concerning a possible technical interpretation, along with appropriate justification or comments.

Forms for requests or general guidance can be obtained by emailing staffengineer@asse-plumbing.org.

2) **Endorsement vs. Listing**

ASSE International does not endorse any product, but rather lists products that have successfully been applied for and meet the given standard. In exchange the manufacturer is allowed to place the ASSE Seal with the given standard number on their product for public recognition.

In order to apply for listing, visit www.asse-plumbing.org/seal/listing_instructions.html.

3) **Patent rights**

ASSE International complies with Section 3.1 of ANSI Essential Requirements — Inclusion of Patents in American National Standards. To understand what is and is not covered, visit www.ansi.org/essentialrequirements.

4) **Committee or Working Group Membership**

Each standard is developed by a working group and then approved by the Product Standards Committee and Board of Directors of ASSE International. In order to apply for membership on a working group or any committee, the applications are available at www.asse-plumbing.org/standards/WorkingGroupApp.pdf.

ASSE 1002-2020/ASME A112.1002-2020/ CSA B125.12:20

Anti-siphon fill valves for water closet tanks

Section I

1 Scope

1.1

This Standard covers anti-siphon fill valves intended to be installed in water closet tanks.

Note: *In this Standard, anti-siphon fill valves are also referred to as “devices”.*

1.2

In this Standard, “shall” is used to express a requirement, i.e., a provision that the user is obliged to satisfy in order to comply with the standard; “should” is used to express a recommendation or that which is advised but not required; and “may” is used to express an option or that which is permissible within the limits of the standard.

Notes accompanying clauses do not include requirements or alternative requirements; the purpose of a note accompanying a clause is to separate from the text explanatory or informative material.

Notes to tables and figures are considered part of the table or figure and may be written as requirements.

Annexes are designated normative (mandatory) or informative (non-mandatory) to define their application.

1.3

SI units are the units of record in Canada. In this Standard the inch/pound units are shown in parentheses.

The values stated in each measurement system are equivalent in application; however, each system is to be used independently. Combining values from the two measurement systems can result in non-conformance with this Standard.

All references to gallons are to U.S. gallons.

Section II

2 Reference publications and definitions

2.1 Reference publications

This Standard refers to the following publications, and where such reference is made, it shall be to the edition listed below, including all amendments published thereto.

ASME (American Society of Mechanical Engineers)/CSA Group

ASME A112.18.1-2018/CSA B125.1-18

Plumbing supply fittings

ASME A112.19.2-2018/CSA B45.1-18

Ceramic plumbing fixtures

ASME (American Society of Mechanical Engineers)

ASME B1.1-2003 (R2018)

Unified Inch Screw Threads, (UN and UNR Thread Form)

ASSE International

ASSE Plumbing Dictionary, Sixth Edition, 2007

2.2 Definitions

In addition to the definitions in ASME A112.18.1/CSA B125.1 and the *ASSE Plumbing Dictionary*, the following definitions shall apply in this Standard:

Anti-siphon fill valve — a valve that is used to supply water for flush tank refill and, where applicable, trap reseal. The device has an air gap, integral mechanical backflow preventer, or vacuum breaker to prevent the backflow of water from the flush tank into the supply system. The device is operated by a float or similar activation method.

Retrofit device — any replacement fill valve not specifically supplied by the original equipment manufacturer of the water closet tank.

2.3 Abbreviations

The following abbreviation shall apply in this Standard:

CL — critical level

Section III

3 Design and general requirements

3.1 Pressure

Devices shall be designed to function at a supply pressure range of 140 to 860 kPa (20 to 125 psi).

3.2 Temperature

Devices shall be designed to function at a temperature range of 5 to 49 °C (40 to 120 °F).

3.3 Bowl refill tube

3.3.1 Installed position

The bowl refill tube, when supplied, shall be sufficiently rigid to maintain its installed position.

3.3.2 Retrofit devices only

The means of securing the bowl refill tube shall not obstruct a cross-sectional area of the tank overflow tube by more than 20 mm² (0.031 in²).

Note: When a water closet tank is equipped with an anti-siphon fill valve as original equipment, the required overflow performance is determined in accordance with ASME A112.19.2/CSA B45.1.

3.4 Backflow prevention

The device shall be equipped with a means to prevent backflow. Air inlet ports shall be protected to reduce the risk of the intake of foreign material into the device.

3.5 Dimensional criteria for fill valve components — End connections

3.5.1

Except when proprietary (i.e., non-standard) shanks or inlets are provided by the manufacturer, the dimensions of standard shanks or inlets designed to mate with standard coupling nuts or locknuts shall be as specified in Figure 1.

3.5.2

Standard shank or inlet thread dimensions shall be 15/16-14 UNS-1A as specified in ASME B1.1.

Standard coupling nut or locknut thread dimensions shall be 15/16-14 UNS-1B as specified in ASME B1.1.

Note: The recommended standard major and pitch thread diameters are the following:

- a) Nominal shank thread —
 - i) major diameter: 23.37 to 23.77 mm (0.9204 to 0.9359 in); and
 - ii) pitch diameter: 22.39 to 22.50 mm (0.8816 to 0.8895 in).
- b) Nominal locknut and coupling nut thread —
 - i) minor diameter: 21.85 to 22.05 mm (0.8602 to 0.8681 in); and
 - ii) pitch diameter: 22.63 to 22.90 mm (0.8911 to 0.9014 in).

3.5.3

Proprietary shanks or inlets shall be designed to mate with common supply connections.

3.6 Seating members

Seat disc arrangements shall be replaceable.

3.7 Materials

Coupling nuts and locknuts shall be made from materials that comply with Clause 4.14 of ASME A112.18.1/CSA B125.1.

3.8 Servicing

The device shall be designed so that replacement of wearing parts can be accomplished

- a) without removing the fitting from the supply system;
- b) without removing the piping from the body;
- c) without disturbing the finished wall; and
- d) using standard tools or manufacturer-provided tools.

3.9 Pressure-relief devices

For pressure-relieving devices, pressure relief shall occur at a pressure of at least 1030 kPa (150 psi) and the relief discharge shall be into the fixture.

Section IV

4 Performance requirements and test methods

4.1 General

Tests shall be conducted in the order in which they are listed in this Standard on one test specimen.

4.2 Preconditioning and test conditions

4.2.1 Preconditioning

Before testing, the device shall be conditioned at ambient laboratory conditions for not less than 12 h.

4.2.2 Test conditions

Unless otherwise specified in this Standard, tests shall be conducted at ambient laboratory conditions.

4.3 Test specimen installation

For test purposes, specimens shall be installed in accordance with the manufacturer's instructions.

4.4 Pressure and temperature tests

4.4.1 Pressure and temperature cycling test

4.4.1.1 Purpose

The purpose of the elevated pressure and temperature cycling test is to

- a) evaluate the performance of the device at elevated temperatures and pressures; and
- b) ensure that the device has a means for securing the refill tube to the overflow tube and that it remains in place during the test.

4.4.1.2 Procedure

The elevated pressure and temperature cycling test shall be conducted as follows:

- a) Install the specimen in a tank in accordance with the manufacturer's instructions.
- b) The water in the tank may be displaced to accelerate the test, provided the flush volume range given by Clause [4.4.1.2 c\)](#) is maintained.

- c) Using water at a temperature of 49 ± 3 °C (120 ± 5 °F) and a static pressure of 860 ± 14 kPa (125 ± 2 psi), flush the water closet tank every $5 \text{ min} \pm 15 \text{ s}$ for a total of 50 cycles using a flush volume between 3.8 and 7.6 L (1.0 and 2.0 gal).
- d) Increase the static pressure to 1035 ± 14 kPa (150 ± 2 psi) and maintain it for $5 \text{ min} \pm 15 \text{ s}$.
- e) Check the specimen for leakage, distortion, or other damage that could affect its performance.

4.4.1.3 Performance criteria

There shall be no leakage, distortion, or other damage that affects the performance of the device. The refill tube shall remain in place throughout the test.

4.4.2 Static and dynamic seals, working pressure test

4.4.2.1 Purpose

The purpose of this test is to determine the static and dynamic seal performance of the device at pressures between 140 and 860 kPa (20 and 125 psi).

4.4.2.2 Procedure with the valve closed

With the valve in the closed position, test the specimen according to Clause [4.4.2.4](#) for $5 \text{ min} \pm 15 \text{ s}$ for each condition.

4.4.2.3 Procedure with the outlet(s) blocked

With the valve in the fully open position, block the outlet(s) and test the specimen according to Clause [4.4.2.4](#) for $5 \text{ min} \pm 15 \text{ s}$ for each condition.

Where the outlet is difficult to block, the pressures listed in Clause [4.4.2.4.2](#) a) and [4.4.2.4.2](#) b) shall be flowing pressures rather than static pressures.

4.4.2.4 Test temperatures and pressures

4.4.2.4.1

The test for static and dynamic seals shall be conducted in an ambient environment. The specimen shall be brought to equilibrium test temperature by running water through it.

4.4.2.4.2

Test temperatures and pressures shall be as follows:

- a) 140 ± 14 kPa and 10 ± 6 °C (20 ± 2 psi and 50 ± 10 °F); and
- b) 860 ± 14 kPa and 10 ± 6 °C (125 ± 2 psi and 50 ± 10 °F).

4.4.2.5 Performance criteria

There shall be no leakage.

4.5 Life cycle test

4.5.1 Purpose

The purpose of this test is to demonstrate the long-term operational performance of the device.

4.5.2 Test conditions

The test shall be conducted with water at a

- a) temperature of 21 ± 5 °C (70 ± 10 °F);
- b) supply pressure of 620 kPa (90 psi) minimum; and
- c) flowing pressure of 480 kPa (70 psi) minimum.

4.5.3 Procedure

The life cycle test shall be conducted as follows:

- a) Install the fill valve in a tank in accordance with the manufacturer's instructions.
- b) The water in the tank may be displaced to accelerate the test.
- c) Operate the fill valve for 150,000 cycles by filling the tank for each cycle. Cycle duration shall not exceed 1 min.
- d) Increase the static pressure to 860 ± 14 kPa (125 ± 2 psi) for $5 \text{ min} \pm 15 \text{ s}$.
- e) Check the fill valve for leakage, distortion, or other damage that could affect its performance.

4.5.4 Performance criteria

There shall be no leakage, distortion, or other damage that affects the fill valve's performance. The refill tube shall remain in place on the fill valve throughout the test.

4.6 Critical level and backflow prevention tests

4.6.1 Purpose

The purpose of this test is to verify the critical level (CL) marking, and ensure that the backflow prevention features function as intended.

4.6.2 Procedure

4.6.2.1 Set-up

4.6.2.1.1 Test water

Manually fill the test tank to the level required with clear or coloured water at 10 ± 6 °C (50 ± 10 °F). When coloured water is used it shall be prepared separately as follows:

- a) Add methylene blue dye powder to water in a concentration of approximately 1.5 g/L (0.013 lb/gal) and mix thoroughly.
- b) Mix the solution in Item a) with water in a ratio of 5 mL/L (0.64 oz/gal).

4.6.2.1.2 Check member fouling

All check members of the specimen shall be fouled using a 0.81 ± 0.10 mm (0.032 ± 0.004 in) diameter fouling wire as follows:

- a) On check members that are hinged, the wire shall be placed in the 90° quadrant opposite to the hinge point or point of suspension.
- b) On check members that move axially, the wire shall be placed at a single point on the seating area. The fouling wire shall follow the cross-sectional contour of the check member.
- c) When devices have other types of moving parts for check members, those parts shall be spaced so as to comply with the intent of this Clause.