



IEC 60079-5

Edition 4.1 2022-05
CONSOLIDATED VERSION

INTERNATIONAL STANDARD



**Explosive atmospheres –
Part 5: Equipment protection by powder filling "q"**

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV





THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2022 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Secretariat
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 300 terminological entries in English and French, with equivalent terms in 19 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IECNORM.COM : Click to view the full PDF of IEC 60719-015+AMD1:2022 CSV



IEC 60079-5

Edition 4.1 2022-05
CONSOLIDATED VERSION

INTERNATIONAL STANDARD



**Explosive atmospheres –
Part 5: Equipment protection by powder filling "q"**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.260.20

ISBN 978-2-8322-0347-7

Warning! Make sure that you obtained this publication from an authorized distributor.

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

REDLINE VERSION



**Explosive atmospheres –
Part 5: Equipment protection by powder filling "q"**

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

CONTENTS

FOREWORD	4
1 Scope	6
2 Normative references	6
3 Terms and definitions	7
4 Constructional requirements	7
4.1 Containers	7
4.1.1 Closing and sealing	7
4.1.2 Pressure test of container	8
4.1.3 Degree of protection of the container	8
4.1.4 Filling procedure	8
4.1.5 Containers that are not external enclosures	8
4.2 Filling material	9
4.2.1 Material specification	9
4.2.2 Documentation	9
4.2.3 Testing	9
4.3 Distances	9
4.3.1 Distances through filling material	9
4.3.2 Distances surrounding free space	11
4.4 Connections	12
4.4.1 Equipment	12
4.4.2 Ex Components	12
4.5 Capacitors	12
4.6 Cells and batteries	12
4.7 Temperature limitations under overload conditions	12
4.8 Temperature limitations under malfunction conditions	12
4.8.1 General	12
4.8.2 Fuse	12
4.8.3 Malfunction exclusions	13
4.8.4 Protective devices for temperature limitation	16
4.8.5 Power supply prospective short-circuit current	16
5 Verifications and tests	16
5.1 Type verifications and tests	16
5.1.1 Pressure type test of container	16
5.1.2 Verification of the degree of protection of the enclosure	17
5.1.3 Dielectric strength Insulation resistance test of the filling material	17
5.1.4 Maximum temperatures	17
5.2 Routine verifications and tests	18
5.2.1 Routine pressure test of container	18
5.2.2 Dielectric strength Insulation resistance test of the filling material	18
6 Marking	19
7 Instructions	20
Bibliography	21
Figure 1 – Distances through filling material	11

IECNORM.COM - Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

Figure 2 – Test arrangement for the dielectric strength insulation resistance test of the filling material	19
Table 1 – Distances through the filling material.....	10
Table 2 – Creepage distances and distances through filling material.....	15

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

INTERNATIONAL ELECTROTECHNICAL COMMISSION

EXPLOSIVE ATMOSPHERES –**Part 5: Equipment protection by powder filling “q”****FOREWORD**

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

This consolidated version of the official IEC Standard and its amendment has been prepared for user convenience.

IEC 60079-5 edition 4.1 contains the fourth edition (2015-02) [documents 31/1156/FDIS and 31/1171/RVD] and its amendment 1 (2022-05) [documents 31/1601/CDV and 31/1171/RVD].

In this Redline version, a vertical line in the margin shows where the technical content is modified by amendment 1. Additions are in green text, deletions are in strikethrough red text. A separate Final version with all changes accepted is available in this publication.

International Standard IEC 60079-5 has been prepared by IEC technical committee 31: Equipment for explosive atmospheres.

This fourth edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

NOTE The technical changes referred to include the significant technical changes in the revised IEC standard, but they do not form an exhaustive list of all modifications from the previous edition. More guidance may be found by referring to the redline version of the IEC standard, if available.

Significant changes	Clause/subclause	Type		
		Minor and editorial changes	Extension	Major technical changes
Specific references to IEC 60079-0 have been reworded so the references to IEC 60079-0 can be non-dated references	4.1.3 4.8 4.8.3	X		
The “housing” surrounding the powder filled equipment or Ex Component has been redefined as a “container” to avoid confusion with the “enclosure” requirements of IEC 60079-0	4.1	X		
A relaxation has been introduced to permit reduced distances through filling material for instances where there is no adjacent gap in the container	4.3.1		X	
A relaxation has been introduced to permit the use of creepage dimensions per IEC 60079-7 where CTI is better than 175	4.8.3		X	
An evaluation of joints employed when the reduced distances according to Table 1 are applied, has been added.	5.1.1		X	
Text for determination of maximum temperature clarified with respect to overloads and malfunctions	5.1.4	X		
A batch routine test has been introduced	5.2.1		X	

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

The list of all parts of IEC 60079 series, under the general title *Explosive atmospheres*, can be found on the IEC website.

The committee has decided that the contents of the base publication and its amendment will remain unchanged until the stability date indicated on the IEC web site under webstore.iec.ch in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

EXPLOSIVE ATMOSPHERES –

Part 5: Equipment protection by powder filling “q”

1 Scope

This part of IEC 60079 contains specific requirements for the construction, testing and marking of electrical equipment, parts of electrical equipment and Ex components in the type of protection powder filling “q”, intended for use in explosive gas atmospheres.

NOTE 1 Electrical equipment and Ex components protected by powder filling “q” can contain electronic circuits, transformers, protection fuses, relays, intrinsically safe electrical apparatus, associated electrical apparatus, switches, etc.

NOTE 2 Type of protection powder filling “q” provides Equipment Protection Level (EPL) Gb or Mb.

This standard supplements and modifies the general requirements of IEC 60079-0. Where a requirement of this standard conflicts with a requirement of IEC 60079-0, the requirement of this standard takes precedence.

This standard applies to electrical equipment, parts of electrical equipment and Ex components with:

- a rated supply current less than or equal to 16 A;
- a rated supply voltage less than or equal to 1 000 V;
- a rated power consumption less than or equal to 1 000 W.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60079-0, *Explosive atmospheres – Part 0: Equipment – General requirements*

IEC 60079-7, *Explosive atmospheres – Part 7: Equipment protection by increased safety “e”*

IEC 60079-11, *Explosive atmospheres – Part 11: Equipment protection by intrinsic safety “i”*

IEC 60127 (all parts), *Miniature fuses*

IEC 60529, *Degrees of protection provided by enclosures (IP Code)*

IEC 61558-1, *Safety of power transformers, power supplies, reactors and similar products – Part 1: General requirements and tests*

IEC 61558-2-6, *Safety of transformers, reactors, power supply units and similar products for supply voltages up to 1 100 V – Part 2-6: Particular requirements and tests for safety isolating transformers and power supply units incorporating safety isolating transformers*

ISO 2859-1, *Sampling procedures for inspection by attributes – Part 1: Sampling schemes indexed by acceptance quality limit (AQL) for lot-by-lot inspection*

ISO 3310-1, *Test sieves – Technical requirements and testing – Part 1: Test sieves of metal wire cloth*

ISO 3310-2, *Test sieves – Technical requirements and testing – Part 2: Test sieves of perforated metal plate*

ISO 2591-1, *Test sieving – Methods using test sieves of woven wire cloth and perforated metal plate*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60079-0 as well as the following apply.

NOTE Additional definitions applicable to explosive atmospheres can be found in IEC 60050-426.

3.1 powder filling “q”

type of protection in which the parts capable of igniting an explosive gas atmosphere are fixed in position and completely surrounded by filling material to prevent the ignition of an external explosive gas atmosphere

Note 1 to entry: The type of protection may not prevent the surrounding explosive gas atmosphere from penetrating into the equipment and components and being ignited by the circuits. However, due to the small free volumes in the filling material and due to the quenching of a flame which may propagate through the paths in the filling material, an external explosion is prevented.

3.2 filling material

solid quartz or solid glass particles

3.3 container (for filling material)

housing immediately surrounding the electrical equipment protected by and containing the filling material

Note 1 to entry: The container may, in some cases, also be the external enclosure.

4 Constructional requirements

4.1 Containers

4.1.1 Closing and sealing

4.1.1.1 General

Containers of electrical equipment, parts of electrical equipment or Ex components protected by powder filling “q” shall be filled and sealed at the time of manufacture. The closing and sealing shall be the methods of 4.1.1.2 or 4.1.1.3.

4.1.1.2 Containers permanently sealed at the time of manufacture

The container shall be permanently sealed at the time of manufacture and shall not be capable of being opened without leaving visible evidence that the container has been opened. The container shall be marked in accordance with Clause 6, item a).

NOTE Suitable techniques that can provide visible evidence of containers being opened are, for example, welding, soldering, cemented joints, rivets, cementing of screws, or lead-seal safety-wiring of screws.

4.1.1.3 Containers intended to be opened for repair

Electrical equipment, parts of electrical equipment, or Ex components that are designed to be repaired shall incorporate sealing methods that are capable of being renewed without damage to the container when the equipment is repaired, re-filled, and re-sealed. The container shall be marked in accordance with Clause 6, item b).

4.1.2 Pressure test of container

The electrical equipment, parts of electrical equipment or Ex components protected by powder filling “q” shall meet the pressure test requirements specified in 5.1.1.

4.1.3 Degree of protection of the container

The container of the electrical equipment, parts of electrical equipment, or Ex components protected by powder filling “q”, in their normal service condition, i.e. with all openings closed as in normal use, shall comply at least with the degree of protection IP54 as defined in IEC 60529. If the degree of protection is IP55 or higher, and the container is not hermetically sealed, the container shall be provided with a breathing device. The container with the breathing device in place shall comply at least with the degree of protection IP54 according to IEC 60529. The test shall be conducted on an empty container without the powder filling installed. At the end of any water ingress tests, no water shall be visible inside the container.

NOTE 1 As the container may need to be destroyed in order to determine the entrance of dust or water, two separate test samples could be required for the two ingress tests.

NOTE 2 When the container is also the external enclosure, the tests of enclosures requirements of IEC 60079-0 apply.

The ingress protection of containers or parts of electrical equipment protected by powder filling “q”, intended for use only in clean, dry rooms, may be reduced to degree of protection IP43. The certificate number of this equipment shall include the “X” suffix in accordance with the marking requirements of IEC 60079-0, and the Specific Conditions of Use listed on the certificate shall detail the restrictions of use.

When Ex components protected by powder filling “q” are intended to be mounted inside another enclosure complying with IEC 60079-0, this outer enclosure shall have a degree of protection of at least IP54. The IP rating of the inner container does not need to be specified provided that the Ex component is mounted in a position where it is unlikely to be contaminated by any small amounts of water that may enter the outer enclosure.

NOTE 3 The impact and drop tests of enclosures from IEC 60079-0 do not generally apply to Ex Components intended to be mounted inside another enclosure complying with IEC 60079-0, as the external enclosure provides the protection against impact and drop.

The maximum gap of a container protected by powder filling “q” shall be at least 0,1 mm smaller than the specified smallest dimension of the filling material.

NOTE 4 The restriction on the size of the gap is intended to reduce the escape of filling material.

4.1.4 Filling procedure

Filling shall be carried out so as not to leave any void within the filling material (for example by shaking down). The free space within electrical equipment, parts of electrical equipment or Ex components protected by powder filling “q” shall be effectively filled with filling material (see also 4.3.2).

4.1.5 Containers that are not external enclosures

The container of type of protection “q” equipment or Ex Component that is installed or intended to be installed internal to another enclosure is considered the same as that of an Ex Component.

4.2 Filling material

4.2.1 Material specification

The material shall be quartz or solid glass particles.

The material specification shall state that, determined in accordance with the ISO 2591-1 procedure for dry materials, the size of particles are within the following sieve sizes:

- 1 mm nominal aperture sieve in accordance with ISO 3310-1 or ISO 3310-2
- 500 µm nominal aperture sieve in accordance with ISO 3310-1.

4.2.2 Documentation

The documents prepared by the manufacturer in accordance with IEC 60079-0 shall include the specification of the particle material, the size range of the particles, as well as the filling process and the measures taken to ensure proper filling.

NOTE It is not a requirement of this standard that conformity to the specification of the particle material and size range of the particles needs to be verified.

4.2.3 Testing

The filling material shall be subjected to the dielectric strength test specified in 5.1.3.

4.3 Distances

4.3.1 Distances through filling material

Except where specified otherwise in this standard, the minimum distance through the filling material between electrically conducting parts of the equipment and the container shall comply with Table 1 and Figure 1. This does not apply to conductors used for field wiring connections which penetrate the wall of the container.

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

Table 1 – Distances through the filling material


Voltage ^a a.c. r.m.s. or d.c. V	Minimum distance mm	Reduced distance ^b mm
$U \leq 80$	5	1,5
$U \leq 100$	5	2
$U \leq 125$	5	2
$U \leq 160$	5	2
$U \leq 200$	5	3
$U \leq 250$	5	3
$U \leq 400$	6,3	3
$U \leq 500$	8	3
$U \leq 800$	10	5
$U \leq 1\ 000$	14	5
$U \leq 1\ 600$	16	10
$U \leq 2\ 500$	25	10
$U \leq 3\ 200$	32	10
$U \leq 4\ 000$	40	14
$U \leq 5\ 000$	50	14
$U \leq 6\ 300$	63	25
$U \leq 8\ 000$	80	25
$U \leq 10\ 000$	100	40

^a When determining the required values for creepage and distance, the working voltage may be higher than the voltage in the table by a factor of 1,1 (see Note).

NOTE The factor of 1,1 recognizes that at many places in a circuit, the working voltage equals the rated voltage and that there are a number of rated voltages in common use that can be accommodated by the 1,1 factor.

^b To ensure that there is a sufficient path length through the filling material to provide quenching of a flame from the inside to the outside of the container, the reduced distances shown are permitted only when there is no adjacent gap in the container that could permit a flame to exit. See Figure 1.

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

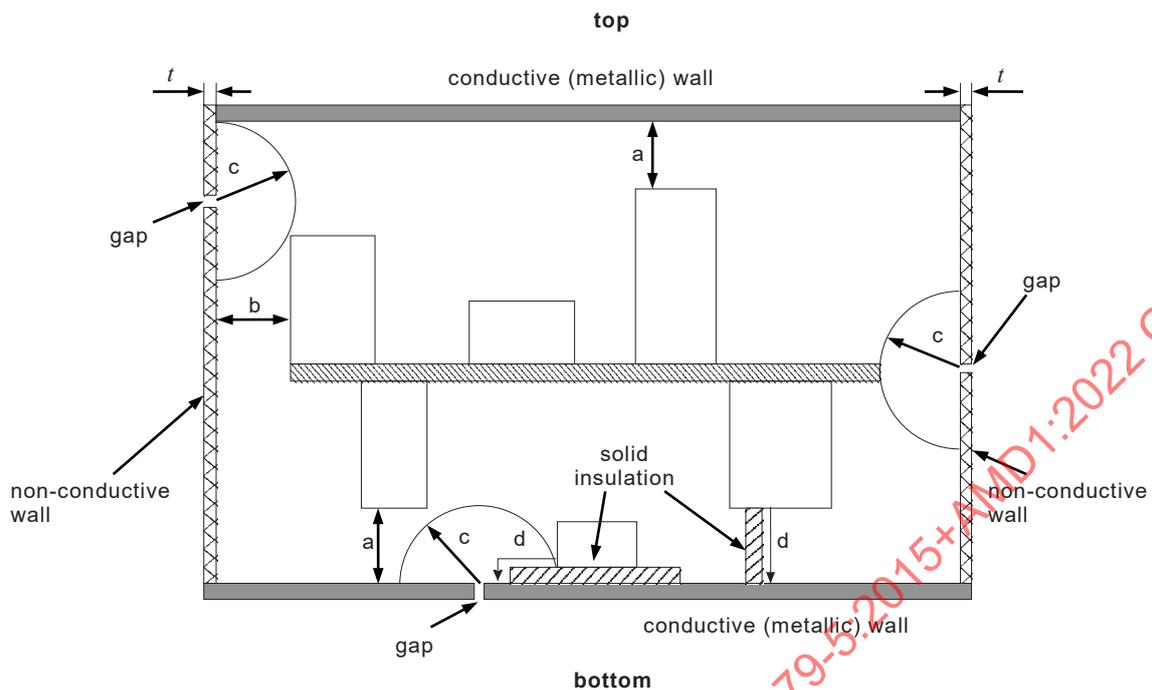

IEC

Key

- a distance to conductive wall according to Table 1, reduced distance
- b distance to non conductive wall with thickness t ; $b \geq (\text{distance according to Table 1}) - t$
- c distance to gap, minimum radius according to Table 1, no reduced distance
- d creepage distance according to Table 2

Figure 1 – Distances through filling material

Malfunction conditions according to 4.8 shall be considered when determining the working voltage.

NOTE While this standard is applicable to equipment with a rated supply voltage not exceeding 1 000 V, Table 1 takes into account working voltages greater than 1 000 V which can be developed or generated within the equipment or Ex Component. A typical example is a fluorescent luminaire ballast with a rated voltage of 240 V, but with an arc initiation voltage of approximately 2 000 V.

4.3.2 Distances surrounding free space

If electrical equipment contains components which have an enclosed free space not filled with the filling material (e.g. a relay), the following requirements apply:

- if the enclosed free space of the component is less than 3 cm³, the minimum distance through the filling material between the component wall and the inner surface of the container shall comply with Table 1. The reduced distances are not permitted;
- if the enclosed free space of the component is between 3 cm³ and 30 cm³, the minimum distance through the filling material between the component wall and the inner surface of the container shall comply with Table 1 but with a minimum of 15 mm;
- the component shall be fixed, so that movement nearer to the wall of the container is not possible;
- the free volume shall not exceed 30 cm³;
- the enclosure of the component shall resist the thermal and mechanical stresses to which it will be subjected even under malfunction conditions according to 4.8. There shall be no damage or distortion which could reduce the protection provided by the filling material.

4.4 Connections

4.4.1 Equipment

Cables used for the entry of electrical conductors into a powder filled “q” container shall be an integral part of the equipment and shall be protected and sealed as specified in 4.1.1. The clamping means shall comply with the cable gland requirements of IEC 60079-0 and shall not be capable of being removed without obvious damage to the powder filled “q” container.

4.4.2 Ex Components

Connection to powder filled “q” Ex Components shall comply with the connection facilities and termination compartments requirements of IEC 60079-0.

4.5 Capacitors

The total stored energy of all capacitors in an enclosure of electrical equipment, part of electrical equipment or Ex component protected by powder filling “q” shall not exceed 20 J in normal operation.

4.6 Cells and batteries

Enclosures for powder filled “q” electrical equipment, parts of electrical equipment or Ex components that contain cells or batteries shall incorporate a breathing device to the surrounding atmosphere (see 4.1.3) unless the batteries or cells:

- a) have a capacity of 1,5 Ah or less, or
- b) do not release gas under normal operating conditions, and comply with the requirements for primary and secondary batteries with a capacity up to 25 Ah, of IEC 60079-7, for level of protection “eb”.

NOTE Sealed gas-tight cells do not release gas under normal operating conditions.

4.7 Temperature limitations under overload conditions

Each electrical equipment, part of electrical equipment or Ex component protected by powder filling “q” shall be protected against overload prescribed in the relevant product standard specified by the manufacturer so that the temperature class is not exceeded inside the filling material at a depth of 5 mm from the wall of the container. If the reduced dimension of Table 1 has been applied and results in a distance less than 5 mm, the reduced distance shall be used in place of the 5 mm shown. The effectiveness of the protection shall be confirmed by the test of 5.1.4.

NOTE It is often difficult to limit the temperatures with only a fuse, and an internal thermal protective device is often necessary to comply with the maximum temperature requirements of 5.1.4.

4.8 Temperature limitations under malfunction conditions

4.8.1 General

The container shall not be damaged and the temperature class shall not be exceeded even in the case of malfunctions as detailed in 4.8. The effectiveness of the temperature protection shall be confirmed by the test in 5.1.4.

4.8.2 Fuse

Unless the equipment supply is protected by a fuse rated at not more than 170 % of the maximum normal current, the equipment shall be subjected to any single internal electrical malfunction which may cause either an overvoltage or overcurrent, for example:

- short-circuit of any component;
- open circuit due to any component failure;

- malfunction in the printed circuitry.

Fuses, if employed, shall have a voltage rating not less than that of the circuit and shall have a breaking capacity not less than the prospective fault current of the circuit.

If a malfunction can lead to one or more subsequent malfunctions, for example overloading of a component, the primary and subsequent malfunctions are considered to be a single malfunction.

Where there is no product standard, the overloads to be considered are those specified by the manufacturer.

The voltage U_n shall be assumed to be applied to the supply terminals when considering malfunction conditions and malfunction exclusions.

When the fuse is not integral to the electrical equipment or parts of electrical equipment, the certificate number shall include the "X" suffix in accordance with the marking requirements of IEC 60079-0 and the Specific Conditions of Use listed on the certificate shall detail the required fuse.

When the fuse is not integral to an Ex component, the certificate number shall include the symbol "U" in accordance with IEC 60079-0 and the schedule of limitations shall detail the required fuse.

4.8.3 Malfunction exclusions

The following malfunctions need not be considered:

- a) Resistance values lower than the rated values for:

- film type resistors,
- wire wound resistors and coils with a single layer in helical form,

when they are used at no more than 2/3 of their rated voltage and rated power at the maximum service temperature as specified by the manufacturer of the respective components.

- b) Short-circuit conditions for:

- plastic foil capacitors,
- ceramic capacitors,
- paper capacitors,

when they are used at no more than 2/3 of their rated voltage as specified by the manufacturer of the respective components.

- c) Insulation failure of:

- galvanically separating components (e.g. optocouplers and relays) designed for segregation of different circuits,

when the sum U of the r.m.s. values of the maximum voltages of the two circuits is not more than 1 000 V and the rated voltage of the component between the two different circuits is at least 1,5 times U .

NOTE Galvanically separating components providing double or reinforced insulation according to a product standard are considered to meet the requirements of IEC 61140, e.g. IEC 60747-5-5 for photo coupler.

- d) Transformers, coils and windings, which:

- comply with Level of Protection "eb" in IEC 60079-7, or
- comply with the requirements for mains transformers, Level of Protection "ia" or "ib", in IEC 60079-11, or
- comply with IEC 61558-2-6, or

- provide a double or reinforced insulation between the circuit per IEC 61558-1.

It is not necessary to consider the possibility of a short circuit if the distances or creepage distances between bare live parts or printed tracks are at least equal to the values of Table 2 (for methods of measuring creepage distances see IEC 60079-7 and IEC 60079-11).

The maximum voltage between the parts shall be used to determine the distances according to Table 2. If the parts are electrically isolated, the sum of the maximum voltages of the two circuits shall be considered as the voltage. The maximum voltage shall be assessed taking into account normal operating conditions (transients being disregarded) and malfunction conditions as specified in this standard.

For distance under a coating according to Table 2, the following conditions apply:

- a conformal coating shall have the effect of sealing the conductors in question against ingress of moisture;
- it shall adhere to the conductive parts and to the insulation material;
- if the conformal coating is applied by spraying, then two separate coats are to be applied;
- other methods of application require only one coat, for example, dip coating, brushing, vacuum impregnating, but the intention is to achieve an effective, lasting, unbroken seal;
- a solder mask is considered as one of the two coatings, provided it is not damaged during soldering.

Conductive parts protruding from the insulation (including soldered component pins) shall not be considered as coated unless special measures have been applied to obtain an effective unbroken seal.

Where bare parts of energized circuits emerge from the coating, the comparative tracking index (CTI) in Table 2 applies to both insulation and conformal coating.

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

Table 2 – Creepage distances and distances through filling material

Voltage ^a a.c. or d.c. $U_{r.m.s.}$ V	Creepage distance ^b mm	Minimum value CTI	Distance under coating mm	Distance through filling material mm
$U \leq 10$	1,6	– ^c	0,6	1,5
$U \leq 12,5$	1,6	100	0,6	1,5
$U \leq 16$	1,6	100	0,6	1,5
$U \leq 20$	1,6	100	0,6	1,5
$U \leq 25$	1,7	100	0,6	1,5
$U \leq 32$	1,8	100	0,7	1,5
$U \leq 40$	3	100	0,7	1,5
$U \leq 50$	3,4	100	0,7	1,5
$U \leq 63$	3,4	100	1	1,5
$U \leq 80$	3,6	100	1	1,5
$U \leq 100$	3,8	100	1,3	2
$U \leq 125$	4	175	1,3	2
$U \leq 160$	5	175	1,3	2
$U \leq 200$	6,3	175	2,6	3
$U \leq 250$	8	175	2,6	3
$U \leq 320$	10	175	2,6	3
$U \leq 400$	12,5	175	3,3	3
$U \leq 500$	16	175	5	3
$U \leq 630$	20	175	6	5
$U \leq 800$	25	175	6	5
$U \leq 1\ 000$	32	175	8,3	5
$U \leq 1\ 250$	32	175	12	10
$U \leq 1\ 600$	32	175	13,3	10
$U \leq 2\ 000$	32	175	13,3	10
$U \leq 2\ 500$	40	175	13,3	10
$U \leq 3\ 200$	50	175	16	14
$U \leq 4\ 000$	63	175	21	14
$U \leq 5\ 000$	80	175	27	14
$U \leq 6\ 300$	100	175	33	25
$U \leq 8\ 000$	125	175	41	25
$U \leq 10\ 000$	160	175	55	40

^a When determining the required values for creepage and distance, the working voltage may be higher than the voltage in the table by a factor of 1,1 (see Note).

NOTE The factor of 1,1 recognizes that at many places in a circuit, the working voltage equals the rated voltage and that there are a number of rated voltages in common use that can be accommodated by the 1,1 factor.

^b If material with higher CTI value is used, the use of the Level of Protection “eb” creepage distances given for that CTI in IEC 60079-7 is permitted.

^c At 10 V and below, the value of CTI is not relevant.

4.8.4 Protective devices for temperature limitation

Temperature limitation may be achieved by an internal or external, electrical or thermal, protective device. The device shall not be self-resetting.

Where integral fuses are used as protective devices, the fusing element shall be of the enclosed type, for example, in glass or ceramic.

Over-current devices shall have a voltage rating not less than that of the circuit and shall have a breaking capacity not less than the prospective fault current of the circuit.

4.8.5 Power supply prospective short-circuit current

Electrical equipment, parts of electrical equipment and Ex components protected by powder filling “q”, with a rated voltage of not greater than 250 V a.c., shall be suitable for operation from a supply system with a prospective short-circuit current of 1 500 A unless the marking includes the value of the permitted prospective short-circuit current. Higher prospective currents than 1 500 A could be present in some installations, for example at higher voltages.

If a current limiting device is necessary to limit the prospective short-circuit current to a value not greater than the rated breaking capacity of the fuse, this device shall be a resistor according to 4.8.3 a) and the rated values shall be:

- current rating $1,5 \times 1,7 \times I_n$ of the fuse;
- externally applied maximum voltage U_m ;
- power rating $1,5 \times (1,7 \times I_n \text{ of the fuse})^2 \times \text{resistance of limiting device}$.

If the manufacturer does not provide a required short-circuit protective device, the certificate number for the electrical equipment or parts of electrical equipment shall include the "X" suffix in accordance with the marking requirements of IEC 60079-0 and the Specific Conditions of Use listed on the certificate shall detail the short-circuit protective devices required.

5 Verifications and tests

5.1 Type verifications and tests

5.1.1 Pressure type test of container

The pressure tests shall be conducted on the samples subjected to the tests of enclosures in IEC 60079-0. Irrespective of its volume, the container samples shall be subjected to a pressure type test with an over-pressure of 50 kPa without the occurrence of permanent deformation exceeding 0,5 mm in any of its dimensions. The pressure shall be applied for at least 10 s.

For containers without breathing or degassing openings, which contain capacitors other than plastic foil, paper or ceramic type and where the volume of the filling material is lower than eight times the volume of the capacitors, the pressure type test with an overpressure of 1,5 MPa shall be applied for at least 10 s.

Where the reduced distances have been applied (4.3.1), the pressure test shall be conducted hydraulically. There shall be no drops of water to blotting paper placed under the sample from any of the joints of the sample not identified as a “gap” for the purposes of employing the reduced distances.

NOTE 1 The test samples used for this test normally have the “gaps” sealed to allow the evaluation of the joints without the drops of water expected to come from the “gaps”.

Tests may be conducted without the filling material present.

NOTE 2 When the container is also the external enclosure, the tests of enclosures requirements of IEC 60079-0 apply.

NOTE 3 The impact and drop tests of enclosures from IEC 60079-0 do not generally apply to Ex Components intended to be mounted inside of another enclosure complying with IEC 60079-0, as the external enclosure provides the protection against impact and drop.

5.1.2 Verification of the degree of protection of the enclosure

The degree of protection of the enclosure shall be verified in accordance with the method specified in IEC 60529. Any breathing devices shall be in place. This test shall be carried out after the pressure type test in 5.1.1 on any one of the samples.

NOTE 1 When the container is also the external enclosure, the tests of enclosures requirements of IEC 60079-0 apply.

NOTE 2 The impact and drop tests of enclosures from IEC 60079-0 do not generally apply to Ex Components intended to be mounted inside of another enclosure complying with IEC 60079-0, as the external enclosure provides the protection against impact and drop.

5.1.3 ~~Dielectric strength~~ Insulation resistance test of the filling material

The insulating properties of the filling material shall be tested prior to the filling process using a sample of the filling material. For this purpose, the electrode arrangement shown in Figure 2 shall be used. The electrodes shall be covered by the filling material in all directions with a thickness of at least 10 mm.

The sample shall be conditioned for at least 24 h at a temperature of $(23 \pm 2) ^\circ\text{C}$ and relative humidity of between 45 % and 55 %. A test voltage of 1 000 V d.c. $^{+5}_0$ % shall then be applied to the electrodes.

The filling material complies with the requirements if the leakage current does not exceed 10^{-6} A. If the material fails to comply, further conditioning and retesting are not permitted.

5.1.4 Maximum temperatures

Where current dependent fuses in accordance with IEC 60127 are used as protective devices for temperature limitation, the maximum temperature under overload conditions shall be measured with a continuous current of at least 1,7 times the fuse rating. If other fuses are employed, the test current shall be based on the non-fusing current rating of the fuse.

Where items other than current dependent fuses are used as protective devices for temperature limitation, the equipment shall be tested to verify that the temperature class is not exceeded when those protective devices operate.

When required by 4.8.3 to consider a malfunction, any malfunction which could increase heat dissipation but not cause a current dependant fuse to disconnect immediately shall be considered. (Malfunctions that will cause immediate rupture of the fuse do not need to be considered.) The malfunction assessed as most likely to affect the temperature class shall be simulated as closely as possible, particularly in respect of the spatial relationship between the container wall and the source of the heat.

NOTE 1 To simulate overload conditions or malfunctions which may cause higher temperatures than in normal operation, it is often convenient to use power components mounted in the equipment and subject to the maximum available power. Such components are normally chosen and located in the equipment so that they are representative of the thermal characteristics of the components they represent.

NOTE 2 The term "overload" also applies to the situation where the Ex "q" equipment (or component – such as a solid state relay or a luminaire ballast) controls rather than consumes power and the temperature rise is, at least partly, related to the external load. In such cases, where the equipment is protected by a fuse rated at not more than 170 % of the maximum normal current, the external load is adjusted to achieve the maximum current through the fused circuit, but no more than 1,7 times the fuse rating. Internal malfunctions are not applied as they are not considered to result in an "overload".

5.2 Routine verifications and tests

5.2.1 Routine pressure test of container

Each container having a volume greater than 100 cm³ shall be subjected to a routine pressure test with an overpressure of 50 kPa or 1,5 MPa, as applicable (See 5.1.1) without the occurrence of permanent deformation exceeding 0,5 mm in any of its dimensions. The pressure shall be applied for at least 10 s.

Tests shall be carried out under normal conditions of the equipment, but may be done without the filling material present.

The routine pressure test may be waived where the container has passed a type test with four times the test pressure (50 kPa or 1,5 MPa) in 5.1.1.

The routine overpressure testing can be replaced by a batch test according to the following criteria based on ISO 2859-1:

- For a production batch up to 100, 8 samples need to be tested at 1,5 times the routine test pressure with no failures.
- For a production batch from 101 to 1 000, 32 samples need to be tested at 1,5 times the routine test pressure with no failures.
- For a production batch from 1 001 up to 10 000, 80 samples need to be tested at 1,5 times the routine test pressure with no failures.

Batches above 10 000 shall be subdivided into smaller batches.

In many cases, the routine pressure test cannot be conducted without modifying the container so significantly that it is no longer representative of the equipment and could no longer be completed as the equipment. In these cases, neither the type test nor the batch routine test provide reasonable alternatives. In some cases, the samples for the batch routine overpressure test also have to be significantly modified to be able to conduct the test. In these cases, the satisfactorily tested samples are discarded and only the remaining untested samples of the batch released.


5.2.2 ~~Dielectric strength~~ Insulation resistance test of the filling material

The insulating properties of each lot of the filling material shall be tested prior to the filling process using a sample of the filling material. For this purpose, the electrode arrangement shown in Figure 2 shall be used. The electrodes shall be covered by the filling material in all directions with a thickness of at least 10 mm. The test voltage shall be 1 000 V d.c. $^{+5}_{0}$ % under the following climatic conditions:

- temperature (23 ± 2) °C;
- relative humidity 45 % to 55 %.

The filling material complies with the requirements if the leakage current does not exceed 10⁻⁶ A.

If the filling material does not initially comply with these requirements, the lot may be dried and retested.

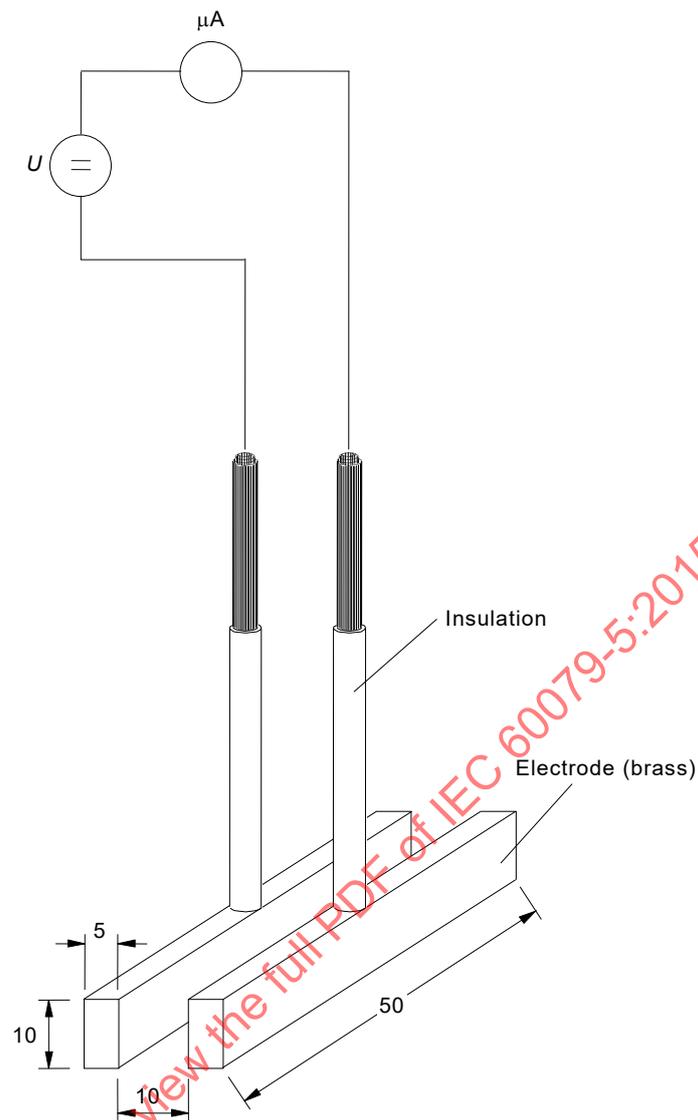

IEC

Dimensions in millimetres with a tolerance of $\pm 1,0$ mm

Figure 2 – Test arrangement for the dielectric strength insulation resistance test of the filling material

6 Marking

Electrical equipment, parts of electrical equipment, and Ex Components of powder filling “q” shall be marked “q” or “qb” in accordance with IEC 60079-0, with the following additional marking, as appropriate:

- “This container has been permanently sealed and cannot be repaired”.
- “This container is factory sealed – consult manufacturer’s instructions for repair”.
- Each connection facility for external connection shall be marked with an identification of rated voltage and rated current (“24 V d.c., 200 mA”, “230 V, 100 mA”).
- External fuse data if the type of protection depends upon such a fuse, “Required external fuse: 315 mA”;
- Permitted prospective short-circuit current of the supply system if the equipment is designed for a short-circuit current less than 1 500 A, according to 4.8.5, for example “Permitted supply short-circuit current: 35 A”.

- f) Optionally, permitted prospective short-circuit current of the supply system if the equipment is designed for a short-circuit current of 1 500 A or more, according to 4.8.5, for example “Permitted supply short-circuit current: 3 500 A”.

Any of these markings may be replaced by technically equivalent information.

7 Instructions

The instructions prepared in accordance with IEC 60079-0, shall also include the following:

- Where permitted by the manufacturer, details on the re-filling, re-sealing, and re-testing requirements for powder filled “q” equipment that has been opened for repair.
- Where the container is permanently sealed and repair is not permitted by the manufacturer, this shall be stated clearly in the instructions.

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

Bibliography

IEC 60050 (all parts), *International Electrotechnical Vocabulary* (available at <http://www.electropedia.org>)

IEC 60050-426, *International Electrotechnical Vocabulary (IEV) – Part 426: Electrical apparatus for explosive atmospheres*

IEC 60664-1:2007, *Insulation coordination for equipment within low-voltage systems – Part 1: Principles, requirements and tests*

IEC 60079 (all parts), *Explosive atmospheres*

IEC 61140, *Protection against electric shock – Common aspects for installation and equipment*

IEC 60747-5-5, *Semiconductor devices – Discrete devices – Part 5-5: Optoelectronic devices – Photocouplers*

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

FINAL VERSION

**Explosive atmospheres –
Part 5: Equipment protection by powder filling "q"**

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

CONTENTS

FOREWORD	4
1 Scope	6
2 Normative references	6
3 Terms and definitions	7
4 Constructional requirements	7
4.1 Containers	7
4.1.1 Closing and sealing	7
4.1.2 Pressure test of container	8
4.1.3 Degree of protection of the container	8
4.1.4 Filling procedure	8
4.1.5 Containers that are not external enclosures	8
4.2 Filling material	9
4.2.1 Material specification	9
4.2.2 Documentation	9
4.2.3 Testing	9
4.3 Distances	9
4.3.1 Distances through filling material	9
4.3.2 Distances surrounding free space	11
4.4 Connections	12
4.4.1 Equipment	12
4.4.2 Ex Components	12
4.5 Capacitors	12
4.6 Cells and batteries	12
4.7 Temperature limitations under overload conditions	12
4.8 Temperature limitations under malfunction conditions	12
4.8.1 General	12
4.8.2 Fuse	12
4.8.3 Malfunction exclusions	13
4.8.4 Protective devices for temperature limitation	16
4.8.5 Power supply prospective short-circuit current	16
5 Verifications and tests	16
5.1 Type verifications and tests	16
5.1.1 Pressure type test of container	16
5.1.2 Verification of the degree of protection of the enclosure	17
5.1.3 Insulation resistance test of the filling material	17
5.1.4 Maximum temperatures	17
5.2 Routine verifications and tests	18
5.2.1 Routine pressure test of container	18
5.2.2 Insulation resistance test of the filling material	18
6 Marking	19
7 Instructions	20
Bibliography	21
Figure 1 – Distances through filling material	11
Figure 2 – Test arrangement for the insulation resistance test of the filling material	19

Table 1 – Distances through the filling material.....	10
Table 2 – Creepage distances and distances through filling material.....	15

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

INTERNATIONAL ELECTROTECHNICAL COMMISSION

EXPLOSIVE ATMOSPHERES –**Part 5: Equipment protection by powder filling “q”**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

This consolidated version of the official IEC Standard and its amendment has been prepared for user convenience.

IEC 60079-5 edition 4.1 contains the fourth edition (2015-02) [documents 31/1156/FDIS and 31/1171/RVD] and its amendment 1 (2022-05) [documents 31/1601/CDV and 31/1171/RVD].

Cette version Finale ne montre pas les modifications apportées au contenu technique par l'amendement 1. Une version Redline montrant toutes les modifications est disponible dans cette publication.

International Standard IEC 60079-5 has been prepared by IEC technical committee 31: Equipment for explosive atmospheres.

This fourth edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

NOTE The technical changes referred to include the significant technical changes in the revised IEC standard, but they do not form an exhaustive list of all modifications from the previous edition. More guidance may be found by referring to the redline version of the IEC standard, if available.

Significant changes	Clause/subclause	Type		
		Minor and editorial changes	Extension	Major technical changes
Specific references to IEC 60079-0 have been reworded so the references to IEC 60079-0 can be non-dated references	4.1.3 4.8 4.8.3	X		
The “housing” surrounding the powder filled equipment or Ex Component has been redefined as a “container” to avoid confusion with the “enclosure” requirements of IEC 60079-0	4.1	X		
A relaxation has been introduced to permit reduced distances through filling material for instances where there is no adjacent gap in the container	4.3.1		X	
A relaxation has been introduced to permit the use of creepage dimensions per IEC 60079-7 where CTI is better than 175	4.8.3		X	
An evaluation of joints employed when the reduced distances according to Table 1 are applied, has been added.	5.1.1		X	
Text for determination of maximum temperature clarified with respect to overloads and malfunctions	5.1.4	X		
A batch routine test has been introduced	5.2.1		X	

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

The list of all parts of IEC 60079 series, under the general title *Explosive atmospheres*, can be found on the IEC website.

The committee has decided that the contents of the base publication and its amendment will remain unchanged until the stability date indicated on the IEC web site under webstore.iec.ch in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

EXPLOSIVE ATMOSPHERES –

Part 5: Equipment protection by powder filling “q”

1 Scope

This part of IEC 60079 contains specific requirements for the construction, testing and marking of electrical equipment, parts of electrical equipment and Ex components in the type of protection powder filling “q”, intended for use in explosive gas atmospheres.

NOTE 1 Electrical equipment and Ex components protected by powder filling “q” can contain electronic circuits, transformers, protection fuses, relays, intrinsically safe electrical apparatus, associated electrical apparatus, switches, etc.

NOTE 2 Type of protection powder filling “q” provides Equipment Protection Level (EPL) Gb or Mb.

This standard supplements and modifies the general requirements of IEC 60079-0. Where a requirement of this standard conflicts with a requirement of IEC 60079-0, the requirement of this standard takes precedence.

This standard applies to electrical equipment, parts of electrical equipment and Ex components with:

- a rated supply current less than or equal to 16 A;
- a rated supply voltage less than or equal to 1 000 V;
- a rated power consumption less than or equal to 1 000 W.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60079-0, *Explosive atmospheres – Part 0: Equipment – General requirements*

IEC 60079-7, *Explosive atmospheres – Part 7: Equipment protection by increased safety “e”*

IEC 60079-11, *Explosive atmospheres – Part 11: Equipment protection by intrinsic safety “i”*

IEC 60127 (all parts), *Miniature fuses*

IEC 60529, *Degrees of protection provided by enclosures (IP Code)*

IEC 61558-1, *Safety of power transformers, power supplies, reactors and similar products – Part 1: General requirements and tests*

IEC 61558-2-6, *Safety of transformers, reactors, power supply units and similar products for supply voltages up to 1 100 V – Part 2-6: Particular requirements and tests for safety isolating transformers and power supply units incorporating safety isolating transformers*

ISO 2859-1, *Sampling procedures for inspection by attributes – Part 1: Sampling schemes indexed by acceptance quality limit (AQL) for lot-by-lot inspection*

ISO 3310-1, *Test sieves – Technical requirements and testing – Part 1: Test sieves of metal wire cloth*

ISO 3310-2, *Test sieves – Technical requirements and testing – Part 2: Test sieves of perforated metal plate*

ISO 2591-1, *Test sieving – Methods using test sieves of woven wire cloth and perforated metal plate*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60079-0 as well as the following apply.

NOTE Additional definitions applicable to explosive atmospheres can be found in IEC 60050-426.

3.1

powder filling “q”

type of protection in which the parts capable of igniting an explosive gas atmosphere are fixed in position and completely surrounded by filling material to prevent the ignition of an external explosive gas atmosphere

Note 1 to entry: The type of protection may not prevent the surrounding explosive gas atmosphere from penetrating into the equipment and components and being ignited by the circuits. However, due to the small free volumes in the filling material and due to the quenching of a flame which may propagate through the paths in the filling material, an external explosion is prevented.

3.2

filling material

solid quartz or solid glass particles

3.3

container (for filling material)

housing immediately surrounding the electrical equipment protected by and containing the filling material

Note 1 to entry: The container may, in some cases, also be the external enclosure.

4 Constructional requirements

4.1 Containers

4.1.1 Closing and sealing

4.1.1.1 General

Containers of electrical equipment, parts of electrical equipment or Ex components protected by powder filling “q” shall be filled and sealed at the time of manufacture. The closing and sealing shall be the methods of 4.1.1.2 or 4.1.1.3.

4.1.1.2 Containers permanently sealed at the time of manufacture

The container shall be permanently sealed at the time of manufacture and shall not be capable of being opened without leaving visible evidence that the container has been opened. The container shall be marked in accordance with Clause 6, item a).

NOTE Suitable techniques that can provide visible evidence of containers being opened are, for example, welding, soldering, cemented joints, rivets, cementing of screws, or lead-seal safety-wiring of screws.

4.1.1.3 Containers intended to be opened for repair

Electrical equipment, parts of electrical equipment, or Ex components that are designed to be repaired shall incorporate sealing methods that are capable of being renewed without damage to the container when the equipment is repaired, re-filled, and re-sealed. The container shall be marked in accordance with Clause 6, item b).

4.1.2 Pressure test of container

The electrical equipment, parts of electrical equipment or Ex components protected by powder filling “q” shall meet the pressure test requirements specified in 5.1.1.

4.1.3 Degree of protection of the container

The container of the electrical equipment, parts of electrical equipment, or Ex components protected by powder filling “q”, in their normal service condition, i.e. with all openings closed as in normal use, shall comply at least with the degree of protection IP54 as defined in IEC 60529. If the degree of protection is IP55 or higher, and the container is not hermetically sealed, the container shall be provided with a breathing device. The container with the breathing device in place shall comply at least with the degree of protection IP54 according to IEC 60529. The test shall be conducted on an empty container without the powder filling installed. At the end of any water ingress tests, no water shall be visible inside the container.

NOTE 1 As the container may need to be destroyed in order to determine the entrance of dust or water, two separate test samples could be required for the two ingress tests.

NOTE 2 When the container is also the external enclosure, the tests of enclosures requirements of IEC 60079-0 apply.

The ingress protection of containers or parts of electrical equipment protected by powder filling “q”, intended for use only in clean, dry rooms, may be reduced to degree of protection IP43. The certificate number of this equipment shall include the “X” suffix in accordance with the marking requirements of IEC 60079-0, and the Specific Conditions of Use listed on the certificate shall detail the restrictions of use.

When Ex components protected by powder filling “q” are intended to be mounted inside another enclosure complying with IEC 60079-0, this outer enclosure shall have a degree of protection of at least IP54. The IP rating of the inner container does not need to be specified provided that the Ex component is mounted in a position where it is unlikely to be contaminated by any small amounts of water that may enter the outer enclosure.

NOTE 3 The impact and drop tests of enclosures from IEC 60079-0 do not generally apply to Ex Components intended to be mounted inside another enclosure complying with IEC 60079-0, as the external enclosure provides the protection against impact and drop.

The maximum gap of a container protected by powder filling “q” shall be at least 0,1 mm smaller than the specified smallest dimension of the filling material.

NOTE 4 The restriction on the size of the gap is intended to reduce the escape of filling material.

4.1.4 Filling procedure

Filling shall be carried out so as not to leave any void within the filling material (for example by shaking down). The free space within electrical equipment, parts of electrical equipment or Ex components protected by powder filling “q” shall be effectively filled with filling material (see also 4.3.2).

4.1.5 Containers that are not external enclosures

The container of type of protection “q” equipment or Ex Component that is installed or intended to be installed internal to another enclosure is considered the same as that of an Ex Component.

4.2 Filling material

4.2.1 Material specification

The material shall be quartz or solid glass particles.

The material specification shall state that, determined in accordance with the ISO 2591-1 procedure for dry materials, the size of particles are within the following sieve sizes:

- 1 mm nominal aperture sieve in accordance with ISO 3310-1 or ISO 3310-2
- 500 µm nominal aperture sieve in accordance with ISO 3310-1.

4.2.2 Documentation

The documents prepared by the manufacturer in accordance with IEC 60079-0 shall include the specification of the particle material, the size range of the particles, as well as the filling process and the measures taken to ensure proper filling.

NOTE It is not a requirement of this standard that conformity to the specification of the particle material and size range of the particles needs to be verified.

4.2.3 Testing

The filling material shall be subjected to the dielectric strength test specified in 5.1.3.

4.3 Distances

4.3.1 Distances through filling material

Except where specified otherwise in this standard, the minimum distance through the filling material between electrically conducting parts of the equipment and the container shall comply with Table 1 and Figure 1. This does not apply to conductors used for field wiring connections which penetrate the wall of the container.

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

Table 1 – Distances through the filling material


Voltage ^a a.c. r.m.s. or d.c. V	Minimum distance mm	Reduced distance ^b mm
$U \leq 80$	5	1,5
$U \leq 100$	5	2
$U \leq 125$	5	2
$U \leq 160$	5	2
$U \leq 200$	5	3
$U \leq 250$	5	3
$U \leq 400$	6,3	3
$U \leq 500$	8	3
$U \leq 800$	10	5
$U \leq 1\ 000$	14	5
$U \leq 1\ 600$	16	10
$U \leq 2\ 500$	25	10
$U \leq 3\ 200$	32	10
$U \leq 4\ 000$	40	14
$U \leq 5\ 000$	50	14
$U \leq 6\ 300$	63	25
$U \leq 8\ 000$	80	25
$U \leq 10\ 000$	100	40

^a When determining the required values for creepage and distance, the working voltage may be higher than the voltage in the table by a factor of 1,1 (see Note).

NOTE The factor of 1,1 recognizes that at many places in a circuit, the working voltage equals the rated voltage and that there are a number of rated voltages in common use that can be accommodated by the 1,1 factor.

^b To ensure that there is a sufficient path length through the filling material to provide quenching of a flame from the inside to the outside of the container, the reduced distances shown are permitted only when there is no adjacent gap in the container that could permit a flame to exit. See Figure 1.

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV

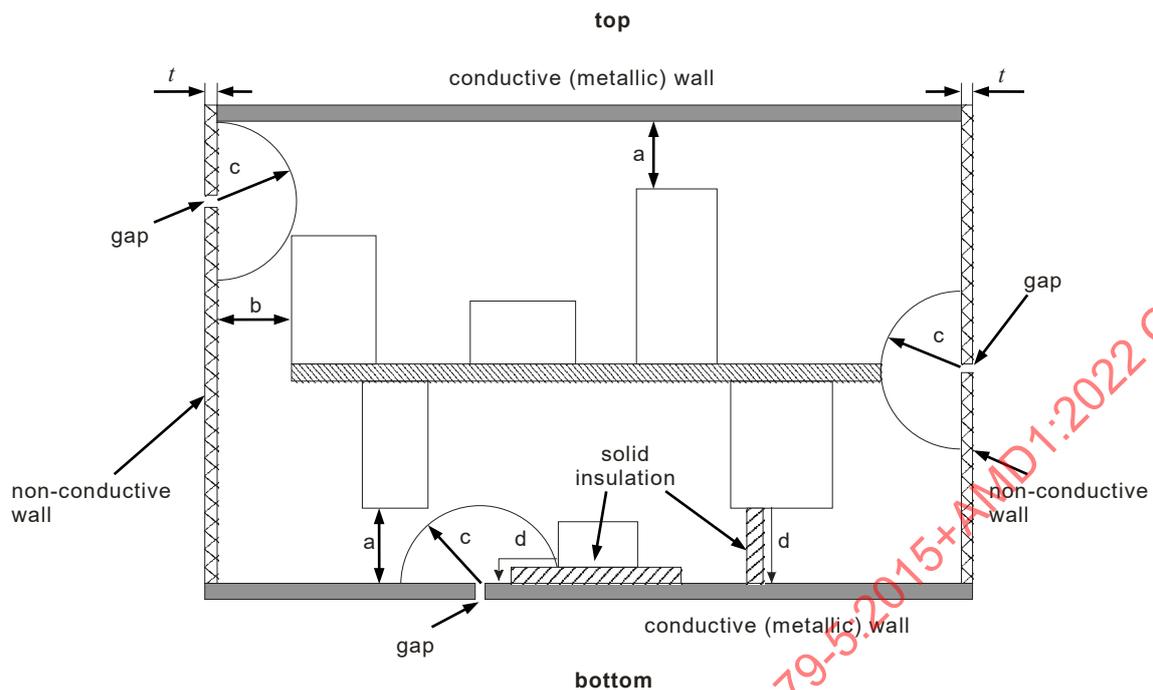

IEC

Key

- a distance to conductive wall according to Table 1, reduced distance
- b distance to non conductive wall with thickness t ; $b \geq (\text{distance according to Table 1}) - t$
- c distance to gap, minimum radius according to Table 1, no reduced distance
- d creepage distance according to Table 2

Figure 1 – Distances through filling material

Malfunction conditions according to 4.8 shall be considered when determining the working voltage.

NOTE While this standard is applicable to equipment with a rated supply voltage not exceeding 1 000 V, Table 1 takes into account working voltages greater than 1 000 V which can be developed or generated within the equipment or Ex Component. A typical example is a fluorescent luminaire ballast with a rated voltage of 240 V, but with an arc initiation voltage of approximately 2 000 V.

4.3.2 Distances surrounding free space

If electrical equipment contains components which have an enclosed free space not filled with the filling material (e.g. a relay), the following requirements apply:

- if the enclosed free space of the component is less than 3 cm³, the minimum distance through the filling material between the component wall and the inner surface of the container shall comply with Table 1. The reduced distances are not permitted;
- if the enclosed free space of the component is between 3 cm³ and 30 cm³, the minimum distance through the filling material between the component wall and the inner surface of the container shall comply with Table 1 but with a minimum of 15 mm;
- the component shall be fixed, so that movement nearer to the wall of the container is not possible;
- the free volume shall not exceed 30 cm³;
- the enclosure of the component shall resist the thermal and mechanical stresses to which it will be subjected even under malfunction conditions according to 4.8. There shall be no damage or distortion which could reduce the protection provided by the filling material.

4.4 Connections

4.4.1 Equipment

Cables used for the entry of electrical conductors into a powder filled “q” container shall be an integral part of the equipment and shall be protected and sealed as specified in 4.1.1. The clamping means shall comply with the cable gland requirements of IEC 60079-0 and shall not be capable of being removed without obvious damage to the powder filled “q” container.

4.4.2 Ex Components

Connection to powder filled “q” Ex Components shall comply with the connection facilities and termination compartments requirements of IEC 60079-0.

4.5 Capacitors

The total stored energy of all capacitors in an enclosure of electrical equipment, part of electrical equipment or Ex component protected by powder filling “q” shall not exceed 20 J in normal operation.

4.6 Cells and batteries

Enclosures for powder filled “q” electrical equipment, parts of electrical equipment or Ex components that contain cells or batteries shall incorporate a breathing device to the surrounding atmosphere (see 4.1.3) unless the batteries or cells:

- a) have a capacity of 1,5 Ah or less, or
- b) do not release gas under normal operating conditions, and comply with the requirements for primary and secondary batteries with a capacity up to 25 Ah, of IEC 60079-7, for level of protection “eb”.

NOTE Sealed gas-tight cells do not release gas under normal operating conditions.

4.7 Temperature limitations under overload conditions

Each electrical equipment, part of electrical equipment or Ex component protected by powder filling “q” shall be protected against overload prescribed in the relevant product standard specified by the manufacturer so that the temperature class is not exceeded inside the filling material at a depth of 5 mm from the wall of the container. If the reduced dimension of Table 1 has been applied and results in a distance less than 5 mm, the reduced distance shall be used in place of the 5 mm shown. The effectiveness of the protection shall be confirmed by the test of 5.1.4.

NOTE It is often difficult to limit the temperatures with only a fuse, and an internal thermal protective device is often necessary to comply with the maximum temperature requirements of 5.1.4.

4.8 Temperature limitations under malfunction conditions

4.8.1 General

The container shall not be damaged and the temperature class shall not be exceeded even in the case of malfunctions as detailed in 4.8. The effectiveness of the temperature protection shall be confirmed by the test in 5.1.4.

4.8.2 Fuse

Unless the equipment supply is protected by a fuse rated at not more than 170 % of the maximum normal current, the equipment shall be subjected to any single internal electrical malfunction which may cause either an overvoltage or overcurrent, for example:

- short-circuit of any component;
- open circuit due to any component failure;

- malfunction in the printed circuitry.

Fuses, if employed, shall have a voltage rating not less than that of the circuit and shall have a breaking capacity not less than the prospective fault current of the circuit.

If a malfunction can lead to one or more subsequent malfunctions, for example overloading of a component, the primary and subsequent malfunctions are considered to be a single malfunction.

Where there is no product standard, the overloads to be considered are those specified by the manufacturer.

The voltage U_n shall be assumed to be applied to the supply terminals when considering malfunction conditions and malfunction exclusions.

When the fuse is not integral to the electrical equipment or parts of electrical equipment, the certificate number shall include the "X" suffix in accordance with the marking requirements of IEC 60079-0 and the Specific Conditions of Use listed on the certificate shall detail the required fuse.

When the fuse is not integral to an Ex component, the certificate number shall include the symbol "U" in accordance with IEC 60079-0 and the schedule of limitations shall detail the required fuse.

4.8.3 Malfunction exclusions

The following malfunctions need not be considered:

- a) Resistance values lower than the rated values for:

- film type resistors,
- wire wound resistors and coils with a single layer in helical form,

when they are used at no more than 2/3 of their rated voltage and rated power at the maximum service temperature as specified by the manufacturer of the respective components.

- b) Short-circuit conditions for:

- plastic foil capacitors,
- ceramic capacitors,
- paper capacitors,

when they are used at no more than 2/3 of their rated voltage as specified by the manufacturer of the respective components.

- c) Insulation failure of:

- galvanically separating components (e.g. optocouplers and relays) designed for segregation of different circuits,

when the sum U of the r.m.s. values of the maximum voltages of the two circuits is not more than 1 000 V and the rated voltage of the component between the two different circuits is at least 1,5 times U .

NOTE Galvanically separating components providing double or reinforced insulation according to a product standard are considered to meet the requirements of IEC 61140, e.g. IEC 60747-5-5 for photo coupler.

- d) Transformers, coils and windings, which:

- comply with Level of Protection "eb" in IEC 60079-7, or
- comply with the requirements for mains transformers, Level of Protection "ia" or "ib", in IEC 60079-11, or
- comply with IEC 61558-2-6, or

- provide a double or reinforced insulation between the circuit per IEC 61558-1.

It is not necessary to consider the possibility of a short circuit if the distances or creepage distances between bare live parts or printed tracks are at least equal to the values of Table 2 (for methods of measuring creepage distances see IEC 60079-7 and IEC 60079-11).

The maximum voltage between the parts shall be used to determine the distances according to Table 2. If the parts are electrically isolated, the sum of the maximum voltages of the two circuits shall be considered as the voltage. The maximum voltage shall be assessed taking into account normal operating conditions (transients being disregarded) and malfunction conditions as specified in this standard.

For distance under a coating according to Table 2, the following conditions apply:

- a conformal coating shall have the effect of sealing the conductors in question against ingress of moisture;
- it shall adhere to the conductive parts and to the insulation material;
- if the conformal coating is applied by spraying, then two separate coats are to be applied;
- other methods of application require only one coat, for example, dip coating, brushing, vacuum impregnating, but the intention is to achieve an effective, lasting, unbroken seal;
- a solder mask is considered as one of the two coatings, provided it is not damaged during soldering.

Conductive parts protruding from the insulation (including soldered component pins) shall not be considered as coated unless special measures have been applied to obtain an effective unbroken seal.

Where bare parts of energized circuits emerge from the coating, the comparative tracking index (CTI) in Table 2 applies to both insulation and conformal coating.

IECNORM.COM : Click to view the full PDF of IEC 60079-5:2015+AMD1:2022 CSV