

INTERNATIONAL STANDARD

IEC 60227-2

Edition 2.1
2003-04

Edition 2:1997 consolidated with amendment 1:2003

Polyvinyl chloride insulated cables of rated voltages up to and including 450/750 V –

Part 2: Test methods

This **English-language** version is derived from the original **bilingual** publication by leaving out all French-language pages. Missing page numbers correspond to the French-language pages.



Reference number
IEC 60227-2:1997+A1:2003(E)

Publication numbering

As from 1 January 1997 all IEC publications are issued with a designation in the 60000 series. For example, IEC 34-1 is now referred to as IEC 60034-1.

Consolidated editions

The IEC is now publishing consolidated versions of its publications. For example, edition numbers 1.0, 1.1 and 1.2 refer, respectively, to the base publication, the base publication incorporating amendment 1 and the base publication incorporating amendments 1 and 2.

Further information on IEC publications

The technical content of IEC publications is kept under constant review by the IEC, thus ensuring that the content reflects current technology. Information relating to this publication, including its validity, is available in the IEC Catalogue of publications (see below) in addition to new editions, amendments and corrigenda. Information on the subjects under consideration and work in progress undertaken by the technical committee which has prepared this publication, as well as the list of publications issued, is also available from the following:

- **IEC Web Site** (www.iec.ch)

- **Catalogue of IEC publications**

The on-line catalogue on the IEC web site (www.iec.ch/searchsub) enables you to search by a variety of criteria including text searches, technical committees and date of publication. On-line information is also available on recently issued publications, withdrawn and replaced publications, as well as corrigenda.

- **IEC Just Published**

This summary of recently issued publications (www.iec.ch/online_news/justpub) is also available by email. Please contact the Customer Service Centre (see below) for further information.

- **Customer Service Centre**

If you have any questions regarding this publication or need further assistance, please contact the Customer Service Centre:

Email: custserv@iec.ch
Tel: +41 22 919 02 11
Fax: +41 22 919 03 00

INTERNATIONAL STANDARD

IEC 60227-2

Edition 2.1
2003-04

Edition 2:1997 consolidated with amendment 1:2003

Polyvinyl chloride insulated cables of rated voltages up to and including 450/750 V –

Part 2: Test methods

© IEC 2003 Copyright - all rights reserved

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Electrotechnical Commission, 3, rue de Varembe, PO Box 131, CH-1211 Geneva 20, Switzerland
Telephone: +41 22 919 02 11 Telefax: +41 22 919 03 00 E-mail: inmail@iec.ch Web: www.iec.ch



Commission Electrotechnique Internationale
International Electrotechnical Commission
Международная Электротехническая Комиссия

CONTENTS

FOREWORD	5
1 General.....	7
1.1 General requirements	7
1.2 Applicable tests	7
1.3 Classification of tests according to the frequency with which they are carried out	7
1.4 Sampling	7
1.5 Pre-conditioning	7
1.6 Test temperature	7
1.7 Test voltage	9
1.8 Checking of the durability of colours and markings	9
1.9 Measurement of insulation thickness	9
1.10 Measurement of sheath thickness	9
1.11 Measurement of overall dimensions and ovality	11
2 Electrical tests	11
2.1 Electrical resistance of conductors	11
2.2 Voltage test carried out on completed cables	11
2.3 Voltage test on cores	13
2.4 Insulation resistance	13
3 Tests of mechanical strength of completed flexible cables	15
3.1 Flexing test	15
3.2 Bending test	19
3.3 Snatch test	21
3.4 Test for separation of cores	21
3.5 Static flexibility test	23
3.6 Tensile strength of the central heart of lift cables	23
Figure 1 – Flexing apparatus	15
Figure 2 – Bending test apparatus	21
Figure 3 – Static flexibility test	25
Table 1 – Mass of weight and diameter of pulleys	17

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**POLYVINYL CHLORIDE INSULATED CABLES
OF RATED VOLTAGES UP TO AND INCLUDING 450/750 V –****Part 2: Test methods**

FOREWORD

- 1) The IEC (International Electrotechnical Commission) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of the IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, the IEC publishes International Standards. Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. The IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of the IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested National Committees.
- 3) The documents produced have the form of recommendations for international use and are published in the form of standards, technical specifications, technical reports or guides and they are accepted by the National Committees in that sense.
- 4) In order to promote international unification, IEC National Committees undertake to apply IEC International Standards transparently to the maximum extent possible in their national and regional standards. Any divergence between the IEC Standard and the corresponding national or regional standard shall be clearly indicated in the latter.
- 5) The IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with one of its standards.
- 6) Attention is drawn to the possibility that some of the elements of this International Standard may be the subject of patent rights. The IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 60227-2 has been prepared by subcommittee 20B: Low-voltage cables, of IEC technical committee 20: Electric cables.

This consolidated version of IEC 60227-2 consists of the second edition (1997) [documents 20B/249/FDIS and 20B/258/RVD], its amendment 1 (2003) [documents 20/560/CDV and 20/606/RVC] and the corrigendum of April 1998.

The technical content is therefore identical to the base edition and its amendment and has been prepared for user convenience.

It bears the edition number 2.1.

A vertical line in the margin shows where the base publication has been modified by amendment 1.

The committee has decided that the contents of the base publication and its amendment 1 will remain unchanged until 2007. At this date, the publication will be

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

POLYVINYL CHLORIDE INSULATED CABLES OF RATED VOLTAGES UP TO AND INCLUDING 450/750 V –

Part 2: Test methods

1 General

1.1 General requirements

The methods of carrying out the tests specified in all parts of IEC 60227 are given in this part and the following publications:

IEC 60227-1:1993, *Polyvinyl chloride insulated cables of rated voltages up to and including 450/750 V – Part 1: General requirements*

IEC 60332-1: *Tests on electric cables under fire conditions – Part 1: Test on a single vertical insulated cable*

IEC 60811-1-1:1993, *Common test methods for insulating and sheathing materials of electrical cables – Part 1: Methods for general application – Section 1: Measurement of thickness and overall dimensions – Test for determining the mechanical properties*

1.2 Applicable tests

The tests applicable to the types of cables are given in the particular specifications (IEC 60227-3, IEC 60227-4, etc.).

1.3 Classification of tests according to the frequency with which they are carried out

The tests specified are type tests (symbol T) and/or sample tests (symbol S) as defined in 2.2 of IEC 60227-1.

The symbols T and S are used in the relevant tables of the particular specifications (IEC 60227-3, IEC 60227-4, etc.).

1.4 Sampling

If a marking is in relief in the insulation or sheath, the samples used for the tests shall be taken so as to include such marking.

For multicore cables, except for the test specified in 1.9, not more than three cores (of different colours, if applicable) shall be tested unless otherwise specified.

1.5 Pre-conditioning

All the tests shall be carried out not less than 16 h after the extrusion of the insulating or sheathing compounds.

1.6 Test temperature

Unless otherwise specified, tests shall be made at ambient temperature.

1.7 Test voltage

Unless otherwise specified, the test voltages shall be a.c. 49 Hz to 61 Hz of approximately sine-wave form, the ratio peak value/r.m.s. value being equal to $\sqrt{2}$ with a tolerance of $\pm 7\%$.

The values quoted are r.m.s. values.

1.8 Checking of the durability of colours and markings

Compliance with this requirement shall be checked by trying to remove the marking of the manufacturer's name or trade mark and the colours of cores or numerals by rubbing lightly ten times with a piece of cotton wool or cloth soaked in water.

1.9 Measurement of insulation thickness

1.9.1 Procedure

The thickness of insulation shall be measured in accordance with 8.1 of IEC 60811-1-1. One sample of cable shall be taken from each of three places, separated by at least 1 m.

Compliance shall be checked on each core of cables having up to five cores, and on any five cores of cables with more than five cores.

If withdrawal of the conductor is difficult, it shall be stretched in a tensile machine or the piece of core shall be loosened by stretching or some other suitable means that does not damage the insulation.

1.9.2 Evaluation of results

The mean of the 18 values (expressed in millimetres) obtained from the three pieces of insulation from each core shall be calculated to two decimal places and rounded off as given below, and this shall be taken as the mean value of the thickness of insulation.

If in the calculation the second decimal figure is 5 or more, the first decimal figure shall be raised to the next number, thus, for example, 1,74 shall be rounded off to 1,7 and 1,75 to 1,8.

The lowest of all values obtained shall be taken as the minimum thickness of insulation at any place.

This test may be combined with any other measurements of thickness, for instance those of 5.2.4 of IEC 60227-1.

1.10 Measurement of sheath thickness

1.10.1 Procedure

The thickness of sheath shall be measured in accordance with 8.2 of IEC 60811-1-1.

One sample of cable shall be taken from each of three places, separated by at least 1 m.

1.10.2 Evaluation of results

The mean of all the values (expressed in millimetres) obtained from the three pieces of sheath shall be calculated to two decimal places and rounded off as given below, and this shall be taken as the mean value of the thickness of sheath.

If in the calculation the second decimal figure is 5 or more, the first decimal figure shall be raised to the next number, thus, for example, 1,74 shall be rounded off to 1,7 and 1,75 to 1,8.

The lowest of all values obtained shall be taken as the minimum thickness of sheath at any place.

This test may be combined with any other measurements of thickness, for instance those of 5.5.4 of IEC 60227-1.

1.11 Measurement of overall dimensions and ovality

The three samples taken in accordance with 1.9 or 1.10 shall be used.

The measurement of the overall diameter of any circular cable and of the overall dimensions of flat cables with a major dimension not exceeding 15 mm shall be carried out in accordance with 8.3 of IEC 60811-1-1.

For the measurement of flat cables with a major dimension exceeding 15 mm, a micrometer, a profile projector or similar appliance shall be used.

The mean of the values obtained shall be taken as the mean overall dimension.

For checking the cable ovality of circular sheathed cables, two measurements shall be made at the same cross-section of the cable.

2 Electrical tests

2.1 Electrical resistance of conductors

In order to check the electrical resistance of conductors, the resistance of each conductor shall be measured from a sample of cable of at least 1 m in length, and the length of each sample shall be measured.

If necessary, a correction to 20 °C and to a length of 1 km shall be obtained by the formula:

$$R_{20} = R_t \frac{254,5}{234,5 + t} \cdot \frac{1\ 000}{L}$$

where

t is the temperature of the sample at the moment of measurement, in degrees Celsius

R_{20} is the resistance at 20 °C, in ohm/kilometre

R_t is the resistance of L metres of cable at t °C in ohms

L is the length of the sample of cable, in metres (length of the complete sample and not of the individual cores or wires)

2.2 Voltage test carried out on completed cables

A sample of cable, as delivered, shall be immersed in water if the cable has no metallic layer. The length of the sample, the temperature of the water and the duration of immersion are given in table 3 of IEC 60227-1.

A voltage shall be applied in turn between each conductor and all the others connected together and to the metallic layer, if any, or to the water, then between all conductors connected together and the metallic layer or water.

The voltage and the duration of its application are given for each case in table 3 of IEC 60227-1.

2.3 Voltage test on cores

The test applies to sheathed cables and to flat non-sheathed cords but not to flat tinsel cords.

The test shall be made on a sample of cable of 5 m length. The sheath and any other covering or filling shall be removed without damaging the cores.

In the case of a flat non-sheathed cord, a short cut shall be made in the insulation between the cores, and the cores shall be separated by hand for a length of 2 m. The voltage and the duration of its application are given for each case in table 3 of IEC 60227-1.

The cores shall be immersed in water as specified in table 3 of IEC 60227-1, and a voltage shall be applied between the conductors and the water.

The voltage and the duration of its application are given for each case in table 3 of IEC 60227-1.

2.4 Insulation resistance

This test applies to all cables. It shall be made on the core samples, 5 m in length, previously submitted to the test described in 2.3 or, if this is not applicable, to the test described in 2.2.

The sample shall be immersed in water previously heated to the specified temperature, a length of about 0,25 m at each end of the sample being kept above the water.

The length of the samples, the temperature of the water and the duration of immersion are given in table 3 of IEC 60227-1.

A d.c. voltage of between 80 V and 500 V shall then be applied between the conductor and the water.

The insulation resistance shall be measured 1 min after application of the voltage and this value shall be related to 1 km.

None of the resulting values shall be below the minimum insulation resistance value prescribed in the particular specifications (IEC 60227-3, IEC 60227-4, etc.).

The values of the insulation resistance specified in the particular specifications (IEC 60227-3, IEC 60227-4, etc.) are based on a volume resistivity of $1 \times 10^8 \Omega \cdot \text{m}$; they have been calculated from the formula:

$$R = 0,0367 \log_{10} \frac{D}{d}$$

where:

R is the insulation resistance, in megohm kilometre

D is the nominal outer diameter of the insulation

d is the diameter of the circumscribed circle of the conductor or, for tinsel cords, the nominal inner diameter of the insulation

3 Tests of mechanical strength of completed flexible cables

3.1 Flexing test

3.1.1 General

The requirements are given in 5.6.3.1 of IEC 60227-1.

This test does not apply to tinsel cords, nor to single-core cables with flexible conductors for fixed wiring, nor to multi-core flexible cables having cores of nominal cross sectional area greater than 2,5 mm².

3.1.2 Apparatus

This test shall be carried out by means of the apparatus shown in figure 1. This apparatus consists of a carrier C, a driving system for the carrier and four pulleys for each sample of cable to be tested. The carrier C supports two pulleys A and B, which are of the same diameter. The two fixed pulleys, at either end of the apparatus, may be of a different diameter from pulleys A and B, but all four pulleys shall be so arranged that the sample is horizontal between them. The carrier makes cycles (forward and backward movements) over a distance of 1 m at an approximately constant speed of 0,33 m/s between each reversal of the direction of movement.

The pulleys shall be made of metal and have a semi-circular shaped groove for circular cables and a flat groove for flat cables. The restraining clamps D shall be fixed so that the pull is always applied by the weight from which the carrier is moving away. The distance from one restraining clamp to its support, while the other clamp is resting on its support, shall be of 5 cm maximum.

The driving system shall be such that the carrier turns smoothly and without jerks when it reverses from one direction to another.

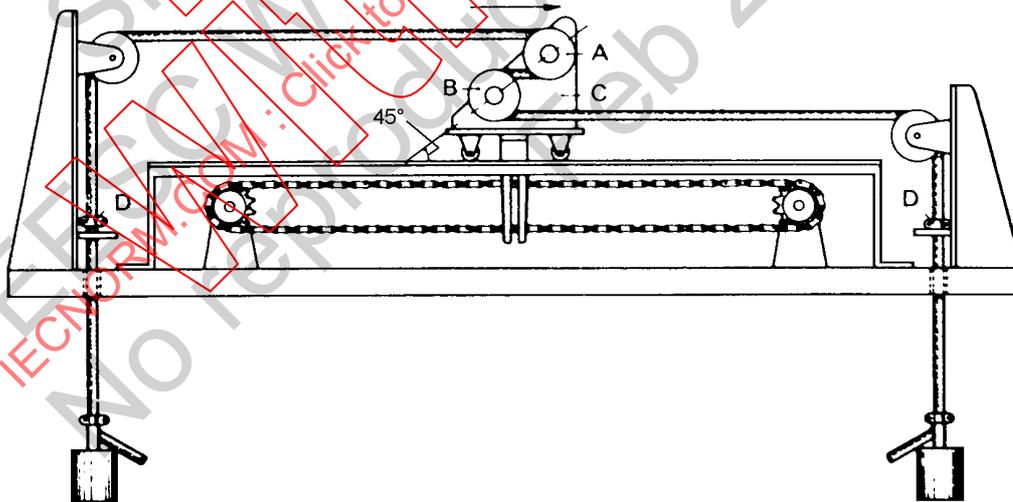


Figure 1 – Flexing apparatus

3.1.3 Sample preparation

A sample of flexible cable about 5 m long shall be stretched over the pulleys, as shown in figure 1, each end being loaded with a weight. The mass of this weight and the diameter of pulleys A and B are given in table 1.

Table 1 – Mass of weight and diameter of pulleys

Types of flexible cables	Number of cores ²⁾	Nominal cross-sectional area mm ²	Mass of weight kg	Diameter of pulleys ¹⁾ mm
Flat non-sheathed cord	2	0,5 0,75	0,5 1,0	60 60
Light polyvinyl chloride sheathed cable	2	0,5	0,5	60
		0,75	1,0	80
		1	1,0	80
		1,5	1,0	80
	2,5	1,5	1,5	120
Ordinary polyvinyl chloride sheathed cable	3	0,5	0,5	80
		0,75	1,0	80
		1	1,0	80
		1,5	1,0	80
		2,5	1,5	120
	4	0,5	0,5	80
		0,75	1,0	80
		1	1,0	80
		1,5	1,5	120
		2,5	1,5	120
Light polyvinyl chloride sheathed cable	5	0,5	1,0	80
Ordinary polyvinyl chloride sheathed cable		0,75	1,0	80
		1	1,0	120
		1,5	1,5	120
		2,5	2,0	120
	6	0,5	1,0	120
		0,75	1,5	120
		1	1,5	120
		1,5	2,0	120
		2,5	3,5	160
Ordinary polyvinyl chloride sheathed cable	7	0,5	1,0	120
		0,75	1,5	120
		1	1,5	120
		1,5	2,0	160
		2,5	3,5	160
	12	0,5	1,5	120
		0,75	2,0	160
		1	3,0	160
		1,5	4,0	160
		2,5	7,0	200
	18	0,5	2,0	160
		0,75	3,0	160
		1	4,0	160
		1,5	6,0	200
		2,5	7,5	200

1) Diameter measured at the lowest point of the groove.

2) Cables with numbers of cores between 7 and 18, but not specified in this table, are non-preferred cable types. They may be tested using the mass of weight and the pulley diameter for the same conductor size at the next higher specified number of cores.

3.1.4 Current loading of cores

For the current loading, either a low voltage or a voltage about 230/400 V may be used.

During the flexing test, the cable sample shall be loaded as follows:

- two and three core cables: all cores to be loaded with $1 \text{ A/mm}^2 \begin{smallmatrix} +10 \\ 0 \end{smallmatrix} \%$;
- four and five core cables: three cores to be loaded with $1 \text{ A/mm}^2 \begin{smallmatrix} +10 \\ 0 \end{smallmatrix} \%$ or all cores to be loaded with $\sqrt{3/n} \text{ A/mm}^2 \begin{smallmatrix} +10 \\ 0 \end{smallmatrix} \%$, where n is the number of cores.

Cables having more than five cores shall not be loaded. On cores which are not loaded, a signal current shall be applied.

3.1.5 Voltage between cores

For two-core cables the voltage between the conductors shall be about 230 V a.c. For all other cables having three or more cores, a three-phase a.c. voltage of about 400 V shall be applied to three conductors, any additional conductors being connected to the neutral. Three adjacent cores shall be tested. In case of a two-layer construction, they shall be taken from the outer layer. This also applies when a low voltage current loading system is used.

3.1.6 Fault detection (construction of the flexing apparatus)

The flexing apparatus shall be constructed so that it will detect and stop if the following occurs during the flexing test:

- interruption of the current;
- short circuit between the conductors;
- short circuit between the test sample and the pulleys (flexing apparatus).

3.2 Bending test

The requirements are given in 5.6.3.2 of IEC 60227-1.

A sample of cord of appropriate length shall be fixed in the apparatus as shown in figure 2, and loaded with a weight having a mass of 0,5 kg. A current of about 0,1 A shall be passed through the conductors.

The sample shall be bent backwards and forwards in a direction perpendicular to the plane of the axes of the conductors, the two extreme positions making an angle of 90° on both sides of the vertical.

A flexing is a movement through 180° . The rate of flexing is 60 per minute.

If the sample does not comply with the test, this shall be repeated with two additional samples, both of which shall then comply with the repeated test.