

INTERNATIONAL STANDARD



Optical fibre cables –

Part 4-20: **Sectional specification** – Aerial optical cables along electrical power lines – Family specification for ADSS (all dielectric self-supported) optical cables

IECNORM.COM : Click to view the full PDF of IEC 60794-4-20:2018 RLV



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2018 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

IEC Catalogue - webstore.iec.ch/catalogue

The stand-alone application for consulting the entire bibliographical information on IEC International Standards, Technical Specifications, Technical Reports and other documents. Available for PC, Mac OS, Android Tablets and iPad.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing 21 000 terms and definitions in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IECNORM.COM : Click to view the full PDF IEC 60954-20:2018 PLV

INTERNATIONAL STANDARD



Optical fibre cables –

Part 4-20: Sectional specification – Aerial optical cables along electrical power lines – Family specification for ADSS (all dielectric self-supported) optical cables

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 33.180.10

ISBN 978-2-8322-6009-8

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD.....	5
1 Scope.....	7
2 Normative references	7
3 Terms, definitions and abbreviated terms	8
4 Optical fibres	10
General.....
Attenuation
Attenuation coefficient.....
Attenuation discontinuities.....
Cut-off wavelength of cabled fibre.....
Fibre colouring.....
Polarisation mode dispersion (PMD).....
5 Cable elements	11
6 Optical fibre cable constructions	11
6.1 General.....	11
Optical unit.....
6.2 Cable protection elements	11
7 Main requirements for installation and operating conditions	12
8 Cable design considerations	12
9 Cable tests	13
9.1 General.....	13
Classification of tests
Type tests.....
Factory acceptance tests
Routine tests
9.2 Tensile performance.....	14
9.2.1 General	14
9.2.2 Family requirement	15
9.2.3 Test conditions	15
9.3 Sheave test.....	15
9.3.1 General	15
9.3.2 Family requirement	16
9.3.3 Test conditions	16
Installation capability.....
9.4 Repeated bending.....	16
9.4.1 General	16
9.4.2 Family requirements.....	16
9.4.3 Test conditions	16
9.5 Impact	17
9.5.1 General	17
9.5.2 Family requirements.....	17
9.5.3 Test conditions	17
9.6 Crush.....	17
9.6.1 General	17
9.6.2 Test requirements.....	17

9.6.3	Test conditions	17
Kink		
9.7	Torsion	18
9.7.1	General	18
9.7.2	Test requirements	18
Vibration testing		
9.8	Aeolian vibration test.....	18
9.8.1	General	18
9.8.2	Family requirements.....	18
9.8.3	Test conditions	18
9.8.4	Parameters to be reported.....	18
9.9	Low frequency vibration test (galloping test)	19
9.9.1	General	19
9.9.2	Family requirements.....	19
9.9.3	Test conditions	19
9.10	Temperature cycling.....	20
9.10.1	General	20
9.10.2	Family requirements.....	20
9.10.3	Test conditions	20
9.11	Water penetration	20
9.12	Weathering resistance Cable UV resistance.....	21
9.13	Tracking and erosion resistance test.....	21
9.14	Creep behaviour	21
9.15	Fitting compatibility	22
Factory acceptance tests		
Routine tests		
10	Quality assurance.....	23
Annex A (informative)	Packaging and marking.....	24
Annex B (informative)	Installation considerations for ADSS cables.....	25
Annex C (informative)	Electrical test (tracking)	27
C.1	General.....	27
C.2	Option C1 C2 – Sheath material qualification	27
C.2.1	Overview	27
C.2.2	Test arrangements	27
C.2.3	Test procedure.....	28
C.2.4	Requirements	28
Option C2 – Example of test for Sahara desert conditions		
C.3	Option C3 – Pollution level and tracking resistance	31
C.3.1	Overview	31
C.3.2	Test setup.....	31
C.3.3	Test method.....	33
C.3.4	Overview of pollution model and electrical test.....	34
Annex D (informative)	All dielectric self-supported (ADSS) cables to be used in overhead power lines (blank detail specification)	36
Bibliography	38

~~Figure – Draft of test equipment~~

~~Figure – Test chamber~~

Figure B.1 – Example of different span lengths allowed for the same cable, depending on sag variation	26
Figure C.1 – Electric scheme for the test	31
Figure C.2 – Foils of the electrodes	32
Figure C.3 – Nozzle	32
Figure C.4 – Details for the spraying	33
Figure C.5 – Pollution model Distributed element model with dry band arc gap.....	34
Figure C.6 – Basic circuit for arcing test Thevenin equivalent circuit	35
Table 1 – Cable design characteristics	13
Table 2 – Optional parameters (if required by customer).....	13
Table C.1 – R_{eq} and C_{eq} values for different pollution index values	33
Table D.1 – Blank detail specification.....	36

IECNORM.COM : Click to view the full PDF of IEC 60794-4-20:2018 RLV

INTERNATIONAL ELECTROTECHNICAL COMMISSION

OPTICAL FIBRE CABLES –

Part 4-20: Sectional specification – Aerial optical cables along electrical power lines – Family specification for ADSS (all dielectric self-supported) optical cables

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

This redline version of the official IEC Standard allows the user to identify the changes made to the previous edition. A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text.

International Standard IEC 60794-4-20 has been prepared by subcommittee 86A: Fibres and cables, of IEC technical committee 86: Fibre optics.

This second edition cancels and replaces the first edition published in 2012 and constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) this document has been streamlined by cross-referencing IEC 60794-1-1, IEC 60794-4 (all parts) and IEC 60794-1-2;
- b) reference to the MICE table has been deleted;
- c) the example of test method for particular environment in Annex C has been deleted;

The text of this International Standard is based on the following documents:

FDIS	Report on voting
86A/1867/FDIS	86A/1876/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all the parts in the IEC 60794 series, published under the general title *Optical fibre cables*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

OPTICAL FIBRE CABLES –

Part 4-20: Sectional specification – Aerial optical cables along electrical power lines – Family specification for ADSS (all dielectric self-supported) optical cables

1 Scope

This part of IEC 60794-4, which is a family specification, covers optical telecommunication cables, commonly with single-mode fibres¹ ~~to be~~ used primarily in overhead power lines applications. The cables ~~may~~ can also be used in other overhead utility networks, such as for telephony or TV services. Requirements of the sectional specification IEC 60794-4 for aerial optical cables along electrical power lines are applicable to cables covered by this document.

This document covers the construction, mechanical, electrical, and optical performance, installation guidelines, acceptance criteria, test requirements, environmental considerations, and accessories compatibility for an all dielectric, self-supporting fibre optic (ADSS) cable. This document provides construction and performance requirements that ensure, within the guidelines of this document, that the ~~required mechanical capabilities~~ integrity of the cable components ~~and maintenance of optical fibre integrity and optical transmissions are proper~~ as well as optical fibre mechanical reliability and transmission parameters are maintained.

The ADSS cable consists of single mode optical fibres contained in one or more protective dielectric fibre optic units surrounded by or attached to suitable dielectric strength members and sheaths. The cable does not contain metallic components. An ADSS cable is designed to meet the optical and mechanical requirements under different ~~types of~~ installation, operating and environmental conditions and loadings, as described in Annex B.

This document excludes any "lashed" or "wrapped" OPAC cables included in IEC 60794-4. Figure 8 aerial cables are also excluded; they are specified in IEC 60794-3-20.

~~Cables intended for installation in conformity with ISO/IEC 24702 and related standards may require the specification of additional tests to ensure their suitability in the applicable environments defined by the mechanical, ingress, climatic and chemical, and electromagnetic (MICE) classification. These tests are outside of the scope of IEC 60794 cable specifications, and MICE criteria are not part of the requirements for IEC 60794 specifications. The MICE tests may be the same as, similar to, or substantially different from, the tests required by IEC 60794 specifications. Cables manufactured per IEC 60794 specifications may or may not meet the MICE criteria. For supplemental discussion, see IEC/TR 62362.~~

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

~~IEC 60304, Standard colours for insulation for low-frequency cables and wires~~

~~IEC 60793-1-40, Optical fibres — Part 1-40: Measurement methods and test procedures — Attenuation~~

¹ In some particular situations in the electrical industry, short overhead links can be also designed with multimode fibres.

~~IEC 60793-1-44, Optical fibres – Part 1-44: Measurement methods and test procedures – Cut-off wavelength~~

~~IEC 60793-1-48, Optical fibres – Part 1-48: Measurement methods and test procedures – Polarization mode dispersion~~

IEC 60793-2, Optical fibres – Part 2: Product specifications – General

IEC 60793-2-50, Optical fibres – Part 2-50: Product specifications – Sectional specification for class B single-mode fibres

IEC 60794-1-1, Optical fibre cables – Part 1: Generic specification – General

~~IEC 60794-1-2, Optical fibre cables – Part 1-2: Generic specification – Basic optical cable test procedures^{2,3}~~

IEC 60794-1-21:2015, Optical fibre cables – Part 1-21: Generic specification – Basic optical cable test procedures – Mechanical test methods

IEC 60794-1-22, Optical fibre cables – Part 1-22: Generic specification – Basic optical cable test procedures – Environmental test methods

~~IEC 60794-1-23, Optical fibre cables – Part 1-23: Generic specification – Basic optical cable test procedures – Cable element test methods~~

IEC 60794-4, Optical fibre cables – Part 4: Sectional Specification – Aerial optical cables along electrical power lines

~~IEC 61395, Overhead electrical conductors – Creep test procedures for stranded conductors~~

ISO 9001, Quality management systems – Requirements

3 Terms, definitions and abbreviated terms

For the purposes of this document, the terms, definitions and abbreviated terms given in IEC 60794-1-1 and IEC 60794-4, ~~as well as the following~~, apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1

~~maximum allowable tension~~

~~MAT~~

~~maximum tensile load that may be applied to the cable without detriment to the performance requirements (optical performance, fibre durability) due to fibre strain~~

² ~~This document has been withdrawn, but can still be purchased, if necessary. Until IEC 60794-1-21 will be available, the tests stated in Clause 9 have to be taken from IEC 60794-1-2.~~

³ ~~This standard will be replaced by IEC 60794-1-21, Optical fibre cables – Part 1-21: Generic specification – Basic optical cable test procedures – Mechanical test methods (see also Bibliography), as soon as it will be available.~~

~~Note 1 to entry: Due to installation codes the MAT value is sometimes restricted to be less than 60 % of the breaking tension of the cable.~~

3.2

maximum operation tension

MOT

~~tensile load that can be applied to the cable either permanently or for a long term without producing any strain to the fibres~~

~~Note 1 to entry: This condition should correspond to the tension with no ice and no gale wind at average mean temperatures throughout the year, assumed to be between 16 °C and 20 °C.~~

3.3

zero strain margin

~~tensile load that the cable can sustain without strain on fibres due to cable elongation~~

3.4

breaking tension

~~tensile load that will produce physical rupture of the cable~~

~~Note 1 to entry: There is no optical consideration related to this parameter.~~

~~Note 2 to entry: The breaking tension should be calculated. The design model shall be validated; the cables do not need to be tested.~~

3.5

maximum installation tension

MIT

~~maximum load that should be applied during the installation procedure~~

~~Note 1 to entry: The maximum installation tension refers mainly to the final adjust of sag (also called sagging load), and the same tension limit can be used for the deployment of the cable (also called stringing load).~~

~~Note 2 to entry: This is a recommended value aimed at avoiding tension values higher than MAT during operational life due to wind, ice or temperature changes.~~

3.6

ADSS

~~all dielectric self supported cable~~

~~dielectric cable that is capable of enduring aerial installation and providing long term service, without any external tensile support~~

3.7

OPAC

~~optical attached cable~~

~~dielectric, not self supported, optical attached cable~~

~~Note 1 to entry: OPACs can be used with one of the following attachment methods:~~

- ~~• wrapped, known as an all dielectric (wrap): using special machinery, a lightweight flexible non-metallic cable is wrapped helically around either the earth wire or the phase conductor;~~
- ~~• lashed: non-metallic cables are installed longitudinally alongside the earth wire, the phase conductor or on a separate support cable (on a pole route) and are held in position with a binder or adhesive cord;~~
- ~~• spiral attached: similar to the lashed cables except that the method of attachment involves the use of special preformed spiral attachment clips.~~

~~Note 2 to entry: OPAC cable designs are not covered by this specification.~~

3.8 cable fittings and dampers

3.8.1 suspension cable fitting

device to hold up the cable in intermediate support points along an aerial line, where the cable is under tension at both sides of the fitting

3.8.2 dead end cable fitting

device designed to terminate an installation run, isolate a splice location or maintenance coil, provide slack span locations, or provide for extreme angle turns, where the cable is under tensional load on one side of the fitting and tension free on the other

3.8.2 damper

device attached to a cable in order to suppress or minimize vibrations due to wind

4 Optical fibres

4.1 General

Single mode optical fibres shall be used that meet the requirements of IEC 60793-2-50. ~~In this clause only the main characteristics are mentioned.~~ Other types of fibre can be agreed upon between the customer and the supplier; such fibre shall conform to IEC 60793-2. The cabled fibre shall conform to IEC 60794-4.

~~Fibres other than those specified above can be used, if mutually agreed between the customer and supplier. In this case, fibre characteristics and attenuation criteria for mechanical tests shall be specified in the detail specification.~~

4.2 Attenuation

4.2.1 Attenuation coefficient

~~The requirements for the uncabled fibres shall be according to IEC 60793-2-50.~~

~~Unless other values are agreed between supplier and customer, the maximum attenuation coefficient of the cabled fibres shall be 0,35 dB/km when measured at 1 310 nm and/or 0,25 dB/km at 1 550 nm.~~

~~Different values from those stated above can be agreed between customer and supplier.~~

~~The attenuation coefficient shall be measured in accordance with IEC 60793-1-40.~~

4.2.2 Attenuation discontinuities

~~The local attenuation shall not have point discontinuities in excess of 0,10 dB.~~

~~The test method used to verify the functional requirements shall be in accordance with IEC 60793-1-40.~~

4.3 Cut-off wavelength of cabled fibre

~~The cabled fibre cut-off wavelength λ_{cc} shall be lower than the operational wavelength when measured in accordance with IEC 60793-1-44.~~

4.4 — Fibre colouring

~~The primary coated fibres shall be coloured for identification. The coloured coating shall be readily identifiable throughout the lifetime of the cable and shall be at a reasonable match to the requirements stated on IEC 60304. If required, the colouring shall permit sufficient light to be transmitted through the primary coating to allow local light injection and detection.~~

4.5 — Polarisation mode dispersion (PMD)

~~PMD shall meet the values indicated in IEC 60793-2-50. The measurement procedure shall be in accordance with IEC 60793-1-48.~~

5 Cable elements

Refer to the relevant parts of the sectional specification IEC 60794-4, ~~the following requirements apply specifically to ADSS cables.~~

~~The material(s) used for a cable element shall be selected to be compatible with the other elements in contact with it.~~

~~Optical elements (cable elements containing optical fibres) and each fibre within a cable element shall be uniquely identified, for example, by colours, by a positional scheme, by markings or as agreed between customer and manufacturer.~~

~~For loose tube construction, one or more primary coated fibres or optical elements are packaged, loosely in a tube construction, with a suitable water blocking system. The plastic tube may be reinforced with a composite wall.~~

~~If required by the customer, the suitability of the tube shall be determined by an evaluation of its kink resistance in accordance with IEC 60794-1-23, Method G7.~~

~~When used, optical fibre ribbons should comply with the requirements stated in IEC 60794-3.~~

6 Optical fibre cable constructions

6.1 General

The construction and characteristics of cable elements shall conform to IEC 60794-4. The cable shall not contain any metallic material.

6.2 — Optical unit

~~Optical unit elements as described in Clause 5 may be laid up as follows:~~

~~Single optical unit in the cable centre, which may contain one or more optical elements:~~

- ~~a) number of loose tubes using helical or SZ stranding configurations around a central element of reinforced plastic, epoxy glass, or other dielectric material. Ribbon elements may be laid up by stacking two or more elements inside the loose tubes;~~
- ~~b) configuration based on a channelled dielectric rod, containing units such as ribbons or plastic tubes, which may contain one or more optical elements.~~

6.2 Cable protection elements

In addition to the optical unit, the cable construction may consist of the following.

- a) The outer sheath shall be a weather-resistant type material. In certain conditions, it shall be necessary to consider the use of a tracking-resistant sheath.

- b) An ADSS cable shall contain self-supported systems that are integral to the cable. The purpose of the support system is to ensure that the cable meets the optical requirements under specified installation conditions, temperatures, and environmental loading for its whole operating design life. ~~This standard excludes any “lashed” or “wrapped” OPAC cables.~~
- c) The basic annular construction may have strength yarns (e.g. aramid yarns) or other dielectric strands or ~~a channelled~~ dielectric rods as a support structure. ~~In addition, other cable elements, such as central members, may be load bearing.~~ A single central dielectric shaft, channelled to accommodate the optical elements, is also accepted.
- d) ~~Fibre strain allowance.~~
- e) The cable shall be designed such that fibre strain does not exceed the limit allowed by the cable manufacturer under design tension limits of the cable (MAT). Maximum allowable fibre strain under MAT condition ~~will generally be a function of the proof test level and strength and fatigue parameters of the optical fibre, 0,33 % is specified for fibre proof tested to 1 % shall be~~ $\leq 0,2 \%$ for 0,69 GPa proof-tested fibres.
- f) ~~A water blocking material shall be used to prevent water penetration to the optical units and to the cable core. The material shall be easily removed without the use of materials considered to be hazardous or dangerous. Water swell able blocking materials can also be used.~~

~~When used in the cable construction, the filling compound shall not flow at temperatures lower than the maximum specified operation temperature of cable.~~

~~NOTE In some countries, a special requirement of shotgun resistance can be specified for aerial cables. ADSS covered by this standard are not designed for this condition.~~

~~Cables with reinforced textile protection, could still meet the dielectric condition, but the increase in diameter and weight would require a significant enhancement of the tensile performance of the cable.~~

NOTE In some countries, a special requirement of shotgun resistance can be specified for aerial cables. ADSS cables covered by this document are not designed for such a condition. Cables with reinforced textile protection could still meet the dielectric condition, but the increase in diameter and weight would make necessary a significant enhancement of the tensile performance of the cable.

7 Main requirements for installation and operating conditions

Operating conditions are particularly important for ADSS cables.

Installation and operating conditions shall be agreed between the customer and the supplier. For the ADSS cable, a detailed study of the field conditions and ~~an important amount~~ a certain level of technical support by the supplier or third-party expert should precede the agreement. Annex B provides a general view of such considerations.

The type of fittings and hardware used to attach the ADSS to the structures shall be approved between the customer and the supplier. Their compatibility ~~has to be checked according to 9.11 and the supplier or the customer fittings' specification~~ shall be verified in accordance with 9.15 and the fittings product specification.

8 Cable design considerations

Table 1 is a summary of cable characteristics which may be of importance as specifications to both the customer and the supplier. Table 2 includes optional engineering parameters relevant for the design and installation of the overhead line with an ADSS cable. Other characteristics may be mutually agreed upon by both the customer and the supplier. A complete blank specification is shown in Annex D.

Table 1 – Cable design characteristics

Ref.	Characteristics	Units
4	Number and type of fibres	NA
-	Modularity of cable core (fibres per tube)	NA
6	Detailed description of cable design construction	NA
-	Overall cable diameter	mm
	Cable weight	kg/km
9.2	MAT (maximum allowable tension)	kN
9-10	Allowable temperature for storage, installation and operation	°C
9.3	Minimum bending diameter during installation	mm
9.4	Minimum bending radius diameter installed	mm

Table 2 – Optional parameters (if required by customer)

Ref.	Characteristics	Units
9.13	MIT, maximum installation (or sagging) load	kN
-	Modulus of elasticity	MPa
-	Coefficient of thermal expansion	$10^{-6}/^{\circ}\text{C}$
9.2	Fibre strain at MAT load	%
Annex B	Zero strain margin	kN
9.9	Creep behaviour	mm
	Maximum Sag at MOT and MAT	m
	Environmental loading conditions – Reference to local or regional installation code	NA
	Recommended span and sag under MAT limit	m/%
C.3	Maximum ADSS cable space potential exposure (generally specified for a low-pollution environment unless specified otherwise by the customer)	kV

9 Cable tests

9.1 General

~~The parameters specified in this standard may be affected by measurement uncertainty arising either from measurement errors or calibration errors due to the lack of suitable standards. Acceptance criteria shall be interpreted with respect to this consideration. For some of the parameters specified in this standard, the objective is no change in attenuation.~~

~~These parameters may be affected by measurement uncertainty arising either from measurement errors or calibration errors due to a lack of suitable standards. Acceptance criteria shall be interpreted with respect to this consideration. The total uncertainty of measurement for this standard shall be $\leq 0,05$ dB for attenuation or $0,05$ dB/km for attenuation coefficient.~~

~~Any measured value within this range, either positive or negative, shall be considered as “no change in attenuation”. By agreement between customer and supplier, minor deviation from this limit may be accepted at some low frequency, e.g. less than 10 % of the fibres. However, for mechanical tests no deviation in excess of $0,15$ dB shall be accepted.~~

In mechanical tests, the general optical criteria is no change in attenuation, as described in IEC 60794-1-1 and IEC 60794-4.

In some environmental and installation tests, some increase is accepted. These are the sheave test, the aeolian vibration test and the galloping test.

The number of fibres tested shall be representative of the cable design according to fibre sampling indicated IEC 60794-1-1. Different sampling can be agreed between the customer and the supplier.

The tests applicable for aerial cables are listed below. The minimum acceptance criteria for the different designs of cables shall be indicated in the product specification.

~~The specimens for the tests shall be taken from the supplier in advance to the tests.~~

9.2 — Classification of tests

9.2.1 — Type tests

~~Tests required to be carried out before supplying a cable covered by this standard on a general commercial basis in order to demonstrate satisfactory performance characteristics to meet the intended application. These tests shall be carried out on a cable length which meets the requirements of the relevant routine tests. These tests are of such a nature that, after they have been made, they need not to be repeated unless significant changes are made in the cable material, design or type of manufacturing process which might change the performance characteristics.~~

~~A full type verification of a cable design includes all tests and characteristics specified in this standard. Tests to be repeated shall be agreed between the customer and the supplier.~~

9.2.2 — Factory acceptance tests

~~Tests made on samples of completed cable, or components taken from a completed cable to verify that the finished product meets the design specifications. Scope and incidence of sample tests, if required, shall be agreed between the customer and the supplier.~~

~~Failure of a test specimen to comply with any one of the requirements of this standard shall constitute grounds for rejection of the lot represented by the specimen. If any lot is so rejected, the supplier shall have the right to test, only once, all individual drums of cables in the lot and submit those which meet the requirements for acceptance.~~

9.2.3 — Routine tests

~~Tests made on all production cable lengths to demonstrate their integrity.~~

~~Failure of a test specimen to comply with any one of the requirements of this standard shall constitute grounds for rejection of the lot represented by the specimen. If any lot is so rejected, the supplier shall have the right to test, only once, all individual drums of cables in the lot and submit those which meet the requirements for acceptance.~~

9.2 Tensile performance

9.2.1 General

~~The tensile performance of the cable is verified with the test methods in 9.2.1 and 9.2.2. The cable manufacturer shall specify the MOT and the MAT for the ADSS design. Both tests shall be evaluated on the same cable sample, subjecting in a first step, the sample to the MOT test, releasing the load to zero tension and then applying the MAT test.~~

~~9.3.2 Maximum allowed tension (MAT)~~

~~The cable shall be terminated with suitable dead end fittings adequate to the type of cable and tested following Methods E1A and E1B, indicated in IEC 60794-1-2.~~

~~A minimum length of 50 m of cable shall be loaded until the specified MAT is applied and sustain this load level for 1 h. Under this load, the strain in the fibre should not be higher than 0,33 % for fibres proof tested at 1 % strain. The attenuation increase shall not exceed 0,15 dB at 1 550 nm.~~

The cable should be tested in accordance with IEC 60794-1-21, method E1. Under this test, the cables shall meet the specified MAT value.

9.2.2 Family requirement

Loaded with MAT, no change in attenuation at 1 550 nm shall be measured, and the strain in the fibre shall be ≤ 0.2 % for 0,69 GPa proof-tested fibres. Other values can be agreed between the customer and the supplier.

NOTE Strain limit values for fibres with different proof test values are under study

9.2.3 Test conditions

- Test set in a straight path in accordance with Figure 1 of IEC 60794-1-21:2015 (no drums or pulleys allowed).
- The cable shall be terminated with adequate dead-end fittings.
- Sample length of 25 m minimum.
- MAT is sustained for 1 h.
- The fibres shall be loop-back spliced so that a minimum of 100 m of fibre are under test.

~~9.4 Installation capability~~

~~9.4.1 General~~

~~Compatibility of ADSS design and hardware with common installation conditions and practices shall be demonstrated by evaluation of the following tests.~~

9.3 Sheave test

9.3.1 General

~~The test shall be performed to verify that the installation of the cables will not damage or degrade their performance. The cable shall be tested in accordance with Method E18, procedure 3 or 4 of IEC 60794-1-2.~~

~~The sheave test shall be performed on a sample cable of a minimum length of 9 m. Dead-end fittings shall be clamped a minimum of 3 m apart. The optical fibres shall be connected to each other by means of fusion or equally reliable splices. The test length of optical fibre shall be a minimum of 100 m long.~~

The cable shall be pulled at one dead end at the maximum stringing tension (MIT) specified by the ADSS cable manufacturer. The method of attachment, although not rigid, shall limit the amount of twist that could occur at the lead end. A dynamometer and a swivel shall be installed between the yoke and the other dead end.

A 2 m minimum length of the ADSS test sample shall be pulled 40 times forward and backward through the sheave (20 times in each direction).

~~The diameter of the sheave for the angle of pull shall be no smaller than the manufacturer's minimum bend diameter for the ADSS cable under test. A minimum diameter of 40 × the outside diameter of the cable is recommended. Before the first pull, the beginning, midpoint, and end of the length shall be marked. After the test is completed, the attenuation shall be measured and the ADSS cable shall be removed in the tested section, and the cable shall be visually examined for any damage. The ADSS cable may be dissected to observe for any signs of damage to the inner structure.~~

The cable shall be tested in accordance with method E18B of IEC 60794-1-21.

9.3.2 Family requirement

Maximum permanent increase in attenuation: 0,10 dB at 1 550 nm.

No physical damage in cable elements.

9.3.3 Test conditions

~~● Procedure 3 or 4 of E18 of IEC 60794-1-2.~~

- Method E18B of IEC 60794-1-21, procedure 1 or 2.
- Tension level applied during test: maximum stringing load (or MIT).
- Length of the cable: 9 m minimum. Length bent under tension: 2 m.
- The cable should be terminated with the recommended dead-end fittings.
- The fibres shall be loop-back spliced so that a minimum of 100 m of fibre are under test.
- Diameter (D) of roller/cylinders $\leq \geq$ manufacturer's minimum bend diameter (approximately $\leq \geq$ 40 times cable outside diameter is recommended).
- Bending angle: $45^\circ \pm 15^\circ$.
- Moving speed: $1 \text{ m/s} \leq \text{speed} \leq 10 \text{ m/s}$.
- Number of complete moving cycles: 20.

9.4 Repeated bending

9.4.1 General

The cable shall be tested in accordance with the method specified in IEC 60794-1-21, Method E6.

9.4.2 Family requirements

Under visual examination without magnification, there shall be no damage to the sheath or cable elements. There shall be no change in attenuation ~~increase greater to 0,05 dB~~ at 1 550 nm after the completion of the test.

9.4.3 Test conditions

- Bending radius: 20 d.
- Number of cycles: 25.
- ~~● Load: Adequate to assure uniform contact with the mandrel~~
- ~~● Duration of cycle: Approximately 2 s~~

Particular conditions may be agreed between ~~manufacturer~~ the customer and the supplier.

9.5 Impact

9.5.1 General

The cable construction shall be tested in accordance with the method specified in IEC 60794-1-21, method E4, ~~without physical damage on the cable elements or attenuation increase greater to 0,05 dB after the completion of the test.~~

9.5.2 Family requirements

Under visual examination without magnification, there shall be no damage to the sheath or to the cable elements. The imprint of the striking surface on the sheath is not considered mechanical damage.

~~The increase in attenuation shall be $\leq 0,05$ dB at 1 550 nm.~~

There shall be no change in attenuation at 1 550 nm.

9.5.3 Test conditions

- Striking surface radius: ~~10 mm or~~ 300 mm.
- Impact energy: 10 J ~~with striking surface radius of 300 mm or 3J with surface radius of 10 mm.~~
- Number of impacts: three, each in a different place spaced not less than 500 mm apart.

NOTE these values are for general purpose use. Particular requirement could be included in product specification.

9.6 Crush

9.6.1 General

The cable shall be tested in accordance with IEC 60794-1-21, method E3, without physical damage or change in attenuation ~~increase greater than 0,05 dB.~~

9.6.2 Test requirements

Under visual examination, there shall be no damage to the sheath or to the cable elements. The imprint of the plate or mandrel on the sheath is not considered mechanical damage.

~~• Family requirements~~

Long term ≥ 10 min. ~~Attenuation increase $\leq 0,05$ dB;~~ No change in attenuation (prior to release of load)

Short term ≥ 1 min. ~~Attenuation increase $\leq 0,05$ dB;~~ No change in attenuation (after test)

9.6.3 Test conditions

- Load (plate/plate): 2,2 kN for short-term load, 1,1 kN for long-term load.
- Duration of load: 1 min of short-term load, followed by 10 min of long-term load.
- Number of tests: 3.
- Spacing between test places: 500 mm.

NOTE These values are for general purpose use. Particular requirements can be included in a product specification.

~~9.4.6 Kink~~

~~The cable shall be tested in accordance with the method specified in IEC 60794-1-2, Method E10, without physical damage on the cable elements.~~

~~The minimum diameter shall be agreed between the customer and the supplier.~~

9.7 Torsion

9.7.1 General

The cable shall be tested in accordance with IEC 60794-1-21, method E7.

~~• Family requirements~~

~~The variation on attenuation after the test shall be no greater than 0,05 dB at 1 550 nm.~~

~~• Test conditions~~

~~— Length under test: 2 m~~

~~— Number of turns: One half turn (through 180°) over the length of 2 m in each direction~~

~~— Number of cycles: 10~~

9.7.2 Test requirements

Under visual examination without magnification, there shall be no damage to the sheath or to the cable elements.

No change on attenuation after the test at 1 550 nm.

~~9.5 Vibration testing~~

9.8 Aeolian vibration test

9.8.1 General

The resistance of the cable to aeolian vibration shall be tested in accordance with method E19 of IEC 60794-1-21.

9.8.2 Family requirements

Under visual examination without magnification, there shall be no damage to the sheath or to the cable elements. The variation on attenuation after the test shall be no greater than 0,10 dB at 1 550 nm.

9.8.3 Test conditions

~~— Number of cycles: 100 000 000~~

~~— Frequency of vibration: 60 Hz ± 10 Hz, or the calculated values for specific operation conditions, requested by the customer~~

~~— Tension applied: 40 % of MAT~~

The cable should be terminated with the recommended dead-end and suspension fittings.

9.8.4 Parameters to be reported

- Length of spans.
- Length of cable and fibres tested.
- Vibration mode/characteristics maintained during the test.
- Characteristics of measuring equipment.
- Ambient temperature and humidity during the test.
- Mass/unit length and diameter of the cable.

9.9 Low frequency vibration test (galloping test)

9.9.1 General

The resistance of the cable to low frequency vibration ~~will~~ shall be tested in accordance with IEC 60794-1-21, method E26 ~~as soon as this test method will be available~~⁴. This test applies for ADSS cables to be installed in areas where ice build-up and/or strong winds are envisaged.

9.9.2 Family requirements

~~The attenuation at 1 550 nm shall be less than or equal to 1,0 dB/km~~

Permanent or temporary increase in attenuation at 1 550 nm shall be $\leq 0,10$ dB.

The sheath shall have no cracks or splits.

9.9.3 Test conditions

- ~~— Number of cycles: 100 000~~
- ~~— Peak to peak antinode amplitude/loop length ratio: 1/25~~
- ~~— Tension: The cable should be tensioned to a level that permits induced galloping in the defined amplitude; 5 % to 10 % of MAT is an adequate tension level.~~
- ~~— The overall span between dead end assemblies should be a minimum of 35 m. The end abutments are used to load and maintain tension in the fibre optic cable. The test section is contained between the two intermediate abutments. End and intermediate abutments need not be separate units if the combined unit affords sufficient space for the apparatus specified below. The fibre optic cable to be tested should be a sufficient length beyond the intermediate abutments to allow removal of the cable outer coverings and to allow access to the optical fibres. The test sample shall be terminated at both ends prior to tensioning in such a way that the optical fibres cannot move relative to the cable. A dynamometer, load cell, calibrated beam, or other device should be used to measure cable tension. Some means should be provided to maintain constant tension to allow for temperature fluctuations during the testing. However, some tension fluctuations are expected from the galloping activity itself.~~
- ~~— A suitable suspension assembly shall be located approximately midway between the two dead end assemblies. It shall be supported at a height such that the static sag angle of the cable to horizontal does not exceed 1°.~~
- ~~— Means shall be provided for measuring and monitoring the mid-loop (antinode), single loop galloping amplitude. A suitable shaker shall be used to excite the cable in the vertical plane. The shaker armature shall be securely fastened to the cable in the vertical plane.~~
- ~~— The test length (i.e., between dead end assemblies) of the optical fibre shall be a minimum of 100 m. To achieve this length several fibres may be spliced together. At least one fibre shall be tested from each buffer tube or fibre bundle. Splices should be made so the optical equipment can be located at the same end. Optical measurements shall be made using a light source with a nominal wavelength of 1 550 nm for single-mode fibres and a nominal wavelength of 1 300 nm for multimode fibres. The source shall be split into two signals. One signal shall be connected to an optical power meter and shall act as a reference. The other signal shall be connected to a free end of the test fibre. The returning signal shall be connected to a second optical power meter. All optical connections and splices shall remain intact through the entire test duration.~~
- ~~— An initial optical measurement shall be taken when the span is pre-tensioned to approximately 5 % of maximum installation tension prior to final tensioning to maximum installation tension. The difference between the two signals for the initial measurement provides a reference level. The change in this difference during the test~~

⁴ ~~Test method E26 is planned to be specified in IEC 60794-1-21 (under consideration).~~

~~shall indicate the change in attenuation of the test fibre. The signals may be output on a strip chart recorder for a continuous hardcopy record.~~

- ~~— The cable shall be subjected to a minimum of 100 000 galloping cycles. The test frequency shall be the single loop resonant frequency. The minimum peak-to-peak antinode amplitude/loop length ratio shall be maintained at a value of 1/25, as measured in the active span.~~
- ~~— Mechanical and optical data shall be read and recorded approximately every 2 000 cycles.~~
- ~~— The optical power meters shall be continuously monitored beginning at least 1 h before the test and ending at least 2 h after the test.~~

The final optical measurement shall be taken at least 2 h after the completion of the vibration test. A section of cable from the location of the hardware support shall be loaded to the ~~MOT~~ MAT, and the attenuation shall comply with ~~4.2.1~~ 9.2.1.

9.10 Temperature cycling

9.10.1 General

The cable shall be tested in accordance with the method specified in IEC 60794-1-22, method F1, one-cycle procedure with the temperature limits, in accordance with operation limits in the product specification, or combined test procedure if different storage limits are specified.

9.10.2 Family requirements

For T_A and T_B (T_{A1} and T_{B1} in combined test), there shall be no change in attenuation (~~$\leq 0,05$ dB/km~~) from the reference room temperature measurement when measured in the 1 550 nm region or at the operational wavelength when specified by the user. T_{A1} and T_{B1} temperature levels are only required during the last cycle.

For T_{A2} and T_{B2} , the change in attenuation coefficient shall be $\leq 0,15$ dB/km during the last cycle from the reference room temperature measurement.

On completion of the test, there shall be no change in attenuation (~~$\leq 0,05$ dB/km~~). The measurement shall be made in the 1 550 nm region.

9.10.3 Test conditions

- Sample length: finished cable length of at least 500 m.
- High temperature, T_B for one-cycle procedure (T_{B1} for combined test): +60 °C.
- High temperature, T_{B2} : +70 °C (only for combined test).
- Low temperature, T_A for one-cycle procedure (T_{A1} for combined test): -20 °C.
- Low temperature, T_{A2} : -40 °C (only for combined test).
- Rate of heating: sufficiently slow so that the effect of changing the temperature does not cause temperature shock or 40 °C/h if not specified.
- t_1 : enough time to get temperature stability in the sample.
- Number of cycles: 2. Additional cycles may be required depending on user requirements.
- Temperature values may vary depending on user requirements.

9.11 Water penetration

The cable shall be tested in accordance with IEC 60794-1-22, method F5B for jelly filled cables or F5C for all-dry cables.

No water shall be detected at the unsealed end of the sample during and at the end of the test.

9.12 ~~Weathering resistance~~ Cable UV resistance

The outer sheath shall be made of UV-stabilized weather-resistant material in accordance with IEC 60794-1-22, method F14. ~~In certain conditions it shall be necessary to consider the use of a tracking-resistant sheath.~~

Further requirements are under consideration.

9.13 Tracking and erosion resistance test

Dielectric cables installed on power lines are exposed to electrical fields. The magnitude of this field space potential **exposure** depends on the line voltage, tower design, conductor configuration, and installation location for the ADSS. Together with specific environmental conditions, especially desert or highly polluted areas close to the sea, this can lead to electrical degradation (e.g. dry-band arcing), which can cause severe damage to the outer cable sheath and finally can cause a total cable failure. The sensitivity to electrical degradation depends on a combination of the space potential, the cable, environment, and sheath material used. In areas with higher space potentials or poor environmental conditions, track resistant sheath materials may be essential to alleviate the risk to product life.

Experience has shown that the formerly used > 12 kV space potential transition point for using track resistant sheath materials may be too high depending on the environmental conditions. Under certain environmental conditions as mentioned above, tracking-resistant sheaths may be needed with space potentials down to 4 kV. Even with tracking-resistant sheath materials, special consideration about the feasibility of ADSS applications is required for levels higher than 20 kV.

Tracking-resistant sheath materials shall be used in the following field conditions:

- a) power lines with an operation voltage of 150 kV or higher;
- b) power lines producing space potential of 4 kV or higher in salty or polluted areas.

If the ADSS cable is to be used in telecommunication poles or low-voltage distribution lines, track-resistant requirements can be waived.

~~Three~~ **Two** current options for evaluating the quality of track-resistant sheath materials are given in Annex C ~~as follows~~:

- 1) salt fog method: evaluates cable in a wet condition (continuous salt water spray);
- ~~2) alternating wet drying cycles in either normal or desert conditions.~~
- 3) alternating wet dry cycles with different current levels to reflect different degrees of resistivity resulting from varying degrees of regional environmental conditions.**

Other test conditions may be needed to evaluate ADSS tracking resistance for specific environments.

9.14 Creep ~~behaviour~~

~~Creep behaviour is engineering information, not a specification. The cable is tested in accordance with IEC 61395, and the applied load should be MOT, the maximal operational tension.~~

There is no pass/fail criterion for creep. This parameter is an engineering guidance to the behaviour of the cable during its working life. The cable creep behaviour should be determined using a test method agreed between the customer and the supplier. Suitable tests are IEC 60794-1-21, method E32 or found in IEC 61395.

9.15 Fitting compatibility

The type of fittings shall be approved between the customer and the supplier, and their compatibility ~~has to~~ shall be verified as follows.

- Dead-end fittings shall be used during the MAT test (9.2), with a maximum of 3 mm of displacement between the fitting and the cable during and after the test. ~~(Under consideration.)~~ There should be no change in attenuation.
- A cable sample with dead-end fittings shall stand 24 h at a temperature of $60\text{ °C} \pm 2\text{ °C}$ and controlled RH of $85\% \pm 5\%$, under ~~MAT~~ MIT load, with a maximum displacement of 3 mm between each fitting and cable. ~~(Under consideration.)~~ There should be no change in attenuation.
- Suspension fitting shall be used during vibration tests (9.8 and 9.9) with no damage to the cable during the test. There should be no change in attenuation. Vibration dampers can also be qualified during this test.
- Following the completed testing, the hardware fittings shall be removed and the cable's outer sheath inspected. There shall be no splits or tears in the ~~other~~ outer sheath.

Sample for verification of the temperature and humidity condition shall be long enough to accept a dead-end fixture and a connection length at both ends; at least 10 m is recommended. The complete setup should be exposed at the indicated temperature and humidity

NOTE The use of vibration dampers is not compulsory but is an installation option.

~~10 Factory acceptance tests~~

~~Sample tests and factory acceptance tests shall be carried out according to the quality plan of the supplier and, if required, in the presence of the customer or their representative.~~

~~Additional tests may be agreed between customer and supplier. The test methods and requirements are given in this standard.~~

~~Typical tests:~~

- ~~— Visual inspection of the cable elements~~
- ~~— Diameter of cable~~
- ~~— Weight of cable~~
- ~~— Optical fibre attenuation coefficient at 1 550 nm or other agreed operational wavelength~~
- ~~— Maximal allowed tension MAT — during product qualification or requalification, or as directed by customers for type test approval~~
- ~~— Maximal operational tension MOT — during product qualification or requalification, or as directed by customers for type test approval.~~

~~11 Routine tests~~

~~Routine tests shall be carried out on all manufactured cables and in accordance with the quality plan of the supplier.~~

~~Additional tests may be agreed between customer and supplier. The test methods and requirements are given by this standard.~~

~~Typical tests are the following:~~

- ~~— inspection of incoming raw materials according to the manufacturer's quality plan;~~
- ~~— optical fibre attenuation coefficient at operational wavelength;~~
- ~~— quality of cable surface;~~
- ~~— diameter of cable.~~

10 Quality assurance

It is the responsibility of the manufacturer to establish quality assurance by quality control procedures which ensure that the product meets the requirements of this document. When the purchaser wishes to specify acceptance tests to other quality procedures, it is essential that an agreement is reached between the customer and the supplier at the time of ordering.

The supplier shall establish, introduce and maintain a quality management system in accordance with ISO 9001 or equivalent.

Annex A provides recommendations for packaging and marking.

IECNORM.COM : Click to view the full PDF of IEC 60794-4-20:2018 RLV

Annex A (informative)

Packaging and marking

The cable should be tightly and uniformly wound onto reel(s) in layers. Reel lengths may be either standard length or specified length. Standard lengths are reel lengths normally provided by a supplier. This length will be defined by the supplier. Specified lengths are reel lengths that are specified by the customer. A tolerance of $\pm 2,0$ % should be maintained for specified lengths and standard lengths.

Reels ~~should~~ may be either wooden non-returnable or steel returnable type. Unless specified otherwise by the customer, the supplier will determine the size and type reel that will withstand normal shipping, handling, storage and stringing operations without damage to the cable.

The reel and inside flanges ~~should~~ shall be manufactured in a manner that damage will not occur to the cable during shipping, handling, storage and stringing.

The cable should be adequately protected against mechanical damage and solar heating.

Reel numbers should be identified in a clear and legible manner on the outside of each flange on two opposite locations.

Each reel should be tagged with a shipping tag. Tags should be weather-resistant. All essential information, such as the supplier's name, cable size and number of fibres, order number, reel number, cable number, cable lengths, and gross, tare, and net weight should appear legibly on the tags. The tags should clearly indicate ~~the type of~~ cable in the description.

The cable ends should be securely fastened to prevent the cable from becoming loose during shipment. The inner end of the cable ~~should~~ shall be accessible for connection to optical measuring equipment. This length of cable ~~should~~ shall be securely fastened and protected during shipment.

A seal should be applied to each end of the cable to prevent the entrance of moisture into the optical fibres or the escape of filling compound during shipment and storage.

Each reel should be marked on the outside flange to indicate the direction the reel should be rolled during shipment in order to prevent loosening of the cable on the reel.

Annex B (informative)

Installation considerations for ADSS cables

In most cases, for underground application cables, the maximum mechanical stress (due to tension, torsion, compression, etc.) occurs during the installation process. During the rest of its operative life, the cable, if properly installed, will suffer stress eventually or just a residual permanent value.

On the contrary, aerial cables will be during the working life permanently under the installation tension and can be periodically subjected to higher tensions due to variable environmental conditions.

In aerial applications, in order to guarantee a long working life for the cable, it is not enough only to perform a careful installation procedure and test the fibres at the end of the job. It is necessary to know the environmental conditions and weather cycles in the location and from that information select or design the cable.

The combination of all these parameters in a field condition define the tensile strength required in the cable, and a detailed engineering study is carried out that takes into consideration several parameters affecting the required strength of the cable, span, sag, temperature, wind speed, ice formation, which are all considered for the design of an aerial power line. Some additional considerations have to be made to ensure the selected cable is adequate.

- 1) In conductor cables, the mechanical strength is proportional to cable size, which is part of the electrical design of the line. Therefore, the physical design of the link necessarily takes into account the cable mechanical resistance. As the ADSS has no electrical function and it is frequently installed in existing power lines, its mechanical analysis is independent and the lack of information could lead to an over-design or under-design of the cable.
- 2) The reference parameter in metallic cables is the breaking load. Under critical conditions, the cable can be under short-term stress close to that limit without intrinsic damage. In a similar situation for an ADSS, the fibres could be broken. Since it is not the integrity of the cable but fibres the first concern in a telecommunication link, breaking strength is not the selected parameter to specify an ADSS cable. In order to protect fibre integrity, the reference should be the ~~maximal allowed load~~ maximum allowed tension (MAT).
- 3) Breaking load is not a parameter in the optical/mechanical performance of an ADSS cable. In some countries, the breaking strength of aerial cables is a regulation as an installation requirement.
- 4) The MAT is the key specification values for cable performance; it ~~shall~~ should be matched with the critical stress situations (wind, heavy ice, temperature) that, although not frequent, are expected to be present in the area.
- 5) The elasticity module and the coefficient of linear expansion ~~and creep behaviour~~ are engineering data. These values should be provided by the manufacturer to be used for tension/sag calculations, if requested by customer, or sag/tension tables should be provided.
- 6) Maximum installation tension (MIT) is a recommended value to be considered in the sagging process in order to avoid exceeding MAT when the expected wind and/or ice arise. It can also serve as limit load while stringing the cable along the power line. To prevent permanent strain in the fibres, it is advisable that MIT is lower to the zero strain margin value.
- 7) Maximum span distance, minimum or maximum sag can be recommended for particular installation cases only after the detailed engineering study (see Figure B.1).

- 8) The placement of the ADSS cable relative to the power conductor and its associated voltage affects the space potential the ADSS cable is exposed to. Compatibility with this space potential ~~shall~~ should be considered.
- 9) When transmission lines are being deployed, it is important that the customer provide details on the ADSS cable and power line conductor configuration along with applicable pollution considerations so the ADSS cables' space potential exposure can be determined.

For information on necessary installation procedures and safety issues for personnel and equipment when installing or maintaining ADSS cables on overhead power lines, see IEC TR 62263.

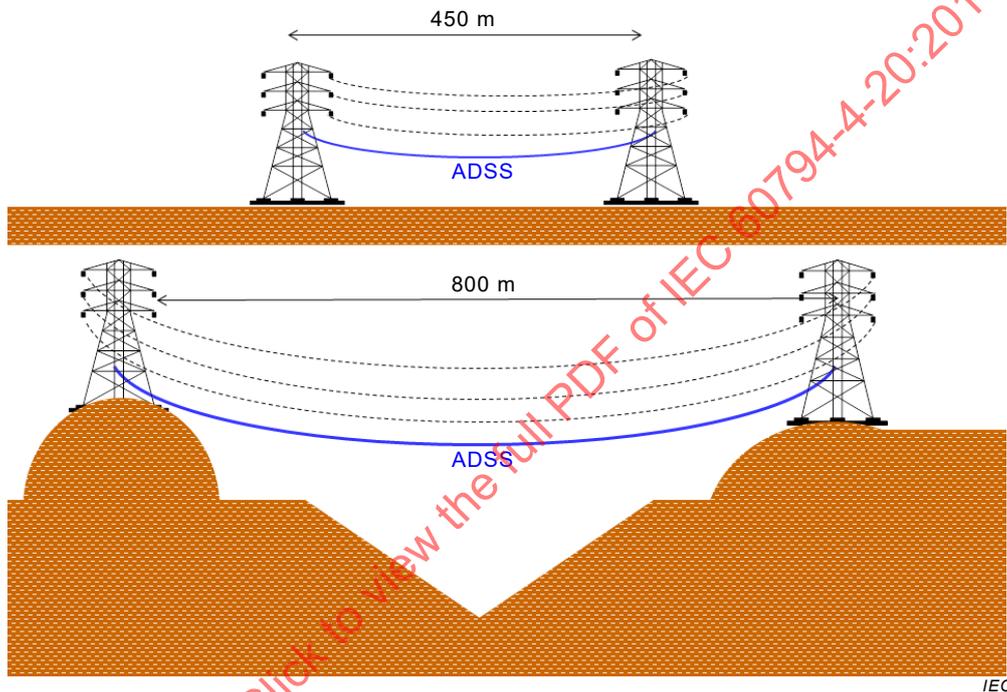


Figure B.1 – Example of different span lengths allowed for the same cable, depending on sag variation

Annex C (informative)

Electrical test (tracking)

C.1 General

~~If the cable sheath is affected by electrical erosion due to various conditions,~~ Electrical erosion arises if cable sheath is affected by several conditions. There is no universal test method for its evaluation. ~~However, 3 possibilities (options)~~ Two options are described in Annex C.

~~Option C1~~ C2 is a well-established way to control a sheath material referred to a specification. It is very useful to the industry for material qualification, although it has no correlation to cable behaviour in the field. The test method of option C3 establishes a means of testing cable to different pollution levels at different space potentials, based on the pollution model described in C.3.4.

~~Option C2 is an example of test method for particular environment.~~

~~Option C3 correlates the result of the test to different pollution conditions.~~

C.2 Option ~~C1~~ C2 – Sheath material qualification

C.2.1 Overview

The objective of this test is to demonstrate the resistance of the cable sheath to erosion and tracking under combined electrical and mechanical stresses, while exposed to humid (salt fog) conditions.

C.2.2 Test arrangements

A length of cable ~~shall~~ should be taken from a production run and sealed at each end against moisture ingress before being supported horizontally inside a salt fog chamber between two anchor points. This will enable it to be tensioned mechanically to a level that represents the value of operation conditions for the cable. The earth termination shall be identical to that proposed by the supplier for use in service adjacent to a support tower and may consist, for example, of spiral-wrap gripping wires together with any suitable mechanical or electrical stress-relieving accessories. This design of the high-voltage termination shall be at the discretion of the supplier.

The gauge length between terminations ~~shall~~ should be great enough to avoid flashovers from taking place during the salt fog test, and a length of 25 mm/kV is usually adequate. The separation between electrode terminations should be 40 mm ~~at least~~ as minimum. The cable should be tensioned with such means so that any creep of the cable material during the test does not result in a major reduction in tension. At suitable intervals during the test, for example every 100 h, the tension should be checked, and if it has changed ~~by~~ more than 10 % of the initial value, it should be adjusted to fall within range again.

A conduction fog shall be produced within the chamber by the use of a suitable number of atomizing nozzles similar to the design shown in Figure 18 of IEC 60060-1:2010 ~~Bi-11~~. A useful guide is to have one nozzle for each 2 m³ of chamber volume. The salt solution to the nozzle shall be prepared dissolving 10,0 kg ± 0,5 kg NaCl in 1 000 l of distilled and de-ionized water. The droplet size should be in the range of 5 µm to 20 µm, and the flow rate of this solution in the chamber should be 0,4 l/h ± 0,1 l/h for each cubic metre of chamber volume. This generally requires an injection of dry air at a pressure of 3,3 bar to the nozzles. The nozzles shall be distributed evenly around the chamber to give a homogeneous fog density,

and no jet should point directly at the cable. An aperture of no more than 80 cm² should be provided on the chamber wall for the natural exhaust of air.

A power frequency test transformer shall be used with a minimum continuous rating of 250 mA RMS and a trip level set at 1 A RMS. There shall be a clearance of at least 300 mm to earth in the vicinity of the cable.

C.2.3 Test procedure

After tensioning the cable to the ~~MOT~~ MIT load, it shall be wiped with a cloth or paper towel soaked in water and then subjected to the salt fog.

After verifying the droplet size, the homogeneity of fog inside of chamber and the homogeneity of electrodes separation a voltage level shall be applied on the evaluation circuit for a period of 1 000 h, ~~note that IEEE 1222 uses 1 000, according to the following classification.~~

For ADSS cables intended to be installed on tracking generator environments, owing to high level induced voltage and/or owing to high concentration of contamination particles, the test voltage should be set at 3,0 kV/cm of separation between electrodes.

The salt water may not be recirculated. Several interruptions of the test for inspection purposes are permissible, each not exceeding 15 min. Interruption periods, which typically occur at 24 h intervals, do not count toward the test duration.

C.2.4 Requirements

After completion of the test, from visual examination, there shall be no signs of internal material exposed to the external environment through the sheath neither on the voltage application area nor on the cable fixation points for mechanical tension application.

The cable sheath shall show tracking erosion no greater than 30 % of the original sheath thickness. A transversal cut should be made on the tested section of cable sheath in order to verify the test compliance by measurement with a calibrated caliper.

~~C.3 Option C2 – Example of test for Sahara desert conditions~~

~~C.3.1 Overview~~

~~The objective of this test method is to demonstrate the resistance of the cable sheath to erosion and tracking under combined electrical and mechanical stresses under two environments; humid climate or dry desert like conditions.~~

~~C.3.2 Test arrangement~~

~~The equipment described in the following (see Figure C.1) was designed to test the cable under most realistic conditions. Therefore, parameters like installation tension, tilt of the cable, capacitive coupling between cable and HV power lines and environmental conditions (pollution, humidity) were taken into account.~~

~~A length of cable (typically between 5 m and 7 m) should be taken from a production run and sealed at each end against moisture ingress before being installed in the test chamber. The cable is installed in the set-up under an angle of 3° from the horizontal plane and under a mechanical tension equivalent to MOT load. Standard spiral-wrap gripping is used to tension the cable.~~

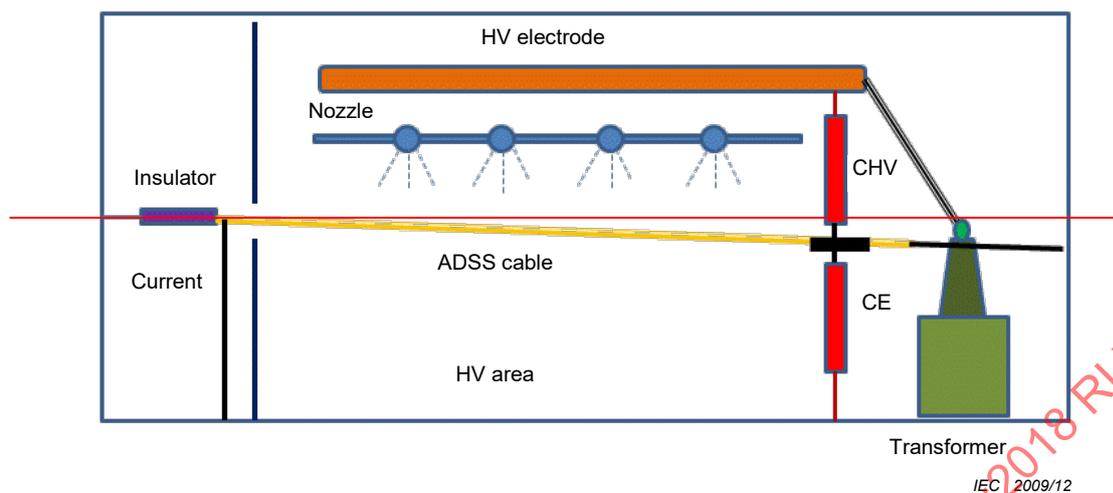


Figure C.1 — Draft of test equipment


The capacitive coupling between the cable and the power line is simulated by an electrode which is attached to a HV transformer (0 to 80) kV. The realistic cable length is taken into account by the two capacitors CHV and CE which are in the order of 200 pF each.

To achieve a slightly conductive cable surface a spraying mechanism was installed. Several spraying nozzles were arranged along the cable in order to achieve homogeneous humidity condition. The flow as well as the spray time should be controlled electronically.

To achieve sufficient conductivity approximately 0,4 g of salt should be dissolved in 1 l of water. To speed up the test and enhance the statistics more than one cable sample should be tested at the same time. Figure C.2 shows a photograph of a test set up.

C.3.3 — Sample preparation

Depending on the environment where the cable is going to be installed the cable sample has to be prepared differently. For simplicity, only two environments were distinguished. The "normal" environment is characterized by a typical mid-European climate with regular rain fall and thus no continuous pollution on the cable surface. The desert like environment leads to a sometimes complete coverage of the cable surface by a dust layer with a thickness in the millimetre range. Together with the daily dew a conductive path can be formed on the cable which finally leads to dry band arcing which can destroy the cable sheath.

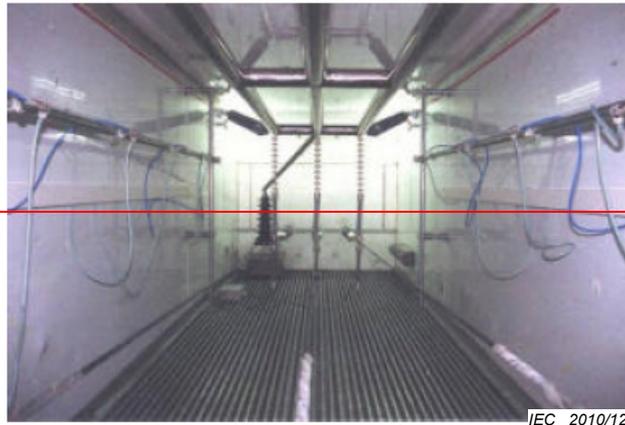

IEC 2010/12

Figure C.2 — Test chamber

C.3.3.1 — “Normal” environment

Cable will be installed in the test chamber without any specific treatment of the outer surface.

C.3.3.2 — Desert-like environment

To simulate the “worst case” installation conditions in a desert like environment the cable has to be specially prepared for testing. The cable sheath has to be covered with an artificial “dust layer” to simulate the conditions in a desert.

A 50 % emulsion of dust, with the same composition (3 % NaCl, 10 % gypsum, 32 % chalk, 50 % clay, 5 % cement) as the Egyptian desert, in water is applied by paint brush. A spatula is used to create a constant emulsion thickness of 0,5 mm on the cable. This corresponds to conditions found in the field. The last part of sample preparation is allowing the water in the deposit to evaporate.

C.3.4 — Test procedure

The measurement phase is divided into cycles. A cycle starts by spraying a salt solution in the atmosphere of the test chamber for 4 min. A salt solution as defined in C.3.2 is used instead of water for two reasons: in case of the “normal environment” the salt provides a certain conductivity of the cable surface and in the case of the “desert-like environment” it prevents salt from being washed out of the deposit layer. Next the chamber is ventilated to remove moisture from the air and to evaporate the water from the field electrodes.

Now the AC high voltage is switched on (typically 10 kV to 50 kV) and the surface current is monitored. Time of test starts counting at this point. The induced current is at least 1,5 mA for a tension of 30 kV. As the cable is drying, the current drops and sparks can appear on the outside of the cable, especially close to the upper end connection. If the current has dropped substantially (below 0,5 mA) no more sparks occur and the high voltage is switched off (after 20 min). The cycle is now complete.

The measuring cycles are repeated continuously and the observed current through the cable is recorded. If the current suddenly increases at least once a day, the cable is inspected visually.

C.3.5 — Requirements

After completion of the number of cycles indicated in the product specification, from visual examination, there shall be no signs of internal material exposed to the external environment


~~through the sheath either on the voltage application area or on the cable fixation points for mechanical tension application.~~

~~The cable sheath should show tracking erosion no greater than 30 % of original sheath thickness. A transversal cut should be made on the tested section of cable sheath in order to verify the test compliance by measurement with calibrated calliper.~~

C.3 Option C3 – Pollution level and tracking resistance

C.3.1 Overview

The objective of this test method is to demonstrate the resistance of the cable sheath to erosion and tracking under different arc voltages and degrees of pollution resistance. This test method uses a Thevenin equivalent circuit shown in Figure C.1 to represent the effect of space potential in the presence of different pollution levels that affect the surface resistance. V_{oc} represents the open circuit voltage across a dry band of wet pollution in the absence of arc current (see C.3.4). Contamination levels are represented by R and C in the circuit. ~~More details of this test method can be found in IEEE paper, TPWRD 00498-2004, (see Bibliography).~~

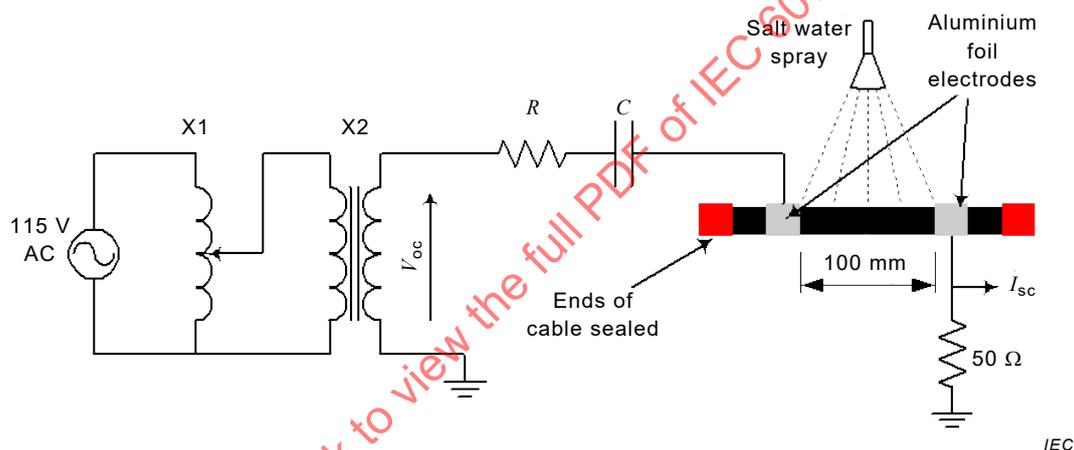


Key

X1	autotransformer
X2	high-voltage transformer
V_{oc}	open circuit voltage
I_{sc}	short circuit current
R, C	limiting impedance

Figure C.1 – Electric scheme for the test

C.3.2 Test setup

A 460-mm (18") long cable sample shall be prepared in accordance with Figure C.2a. The cable ends are to be sealed. The foil shall be cut into 2 trapezoid shapes in accordance with Figure C.2b and wrapped around the cable. The foil shall be separated by 100 mm (4") and shall be placed near the centre of the sample.

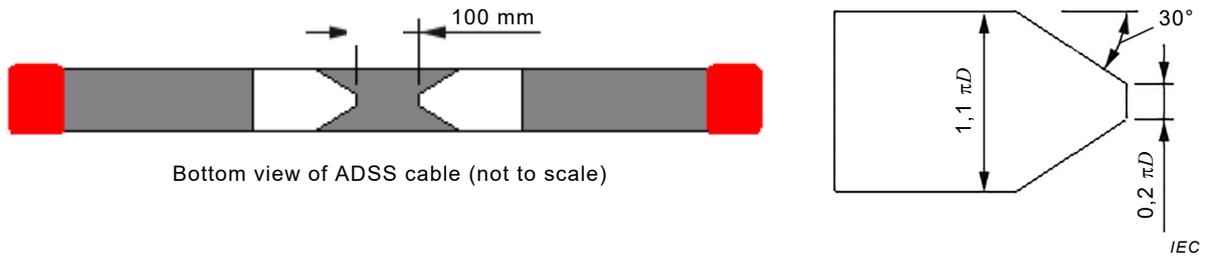

Key

D diameter of the cable

a – Details of the sample

b – Shape of electrodes


Figure C.2 – Foils of the electrodes

An autotransformer X1 controls the primary voltage of the high voltage transformer X2. Other supply designs are permissible provided the output voltage supplied to the limiting impedance is variable up to 40 kV.

The limiting impedance is denoted by resistor *R* in series with capacitor C1. This impedance is defined as the ratio of the open circuit voltage of a dry band arc (i.e. arc current extinguished) to the short circuit current of the arc (current in pollution layer just prior to the arc formation). The 50-Ω resistor serves as an AC milliamperemeter.

Multiple samples are permitted provided each sample has a dedicated RC network connected to V_{oc} .

To produce a uniform conductive layer on the cable surface, a nozzle as shown in Figure C.3 is used. The nozzle consists of a 50 mm × 127 mm stainless steel sheet with 3,6 mm diameter water holes which are arranged in an array to uniformly spray the sample between the electrodes. The cable sample is placed 10 cm below the nozzle.

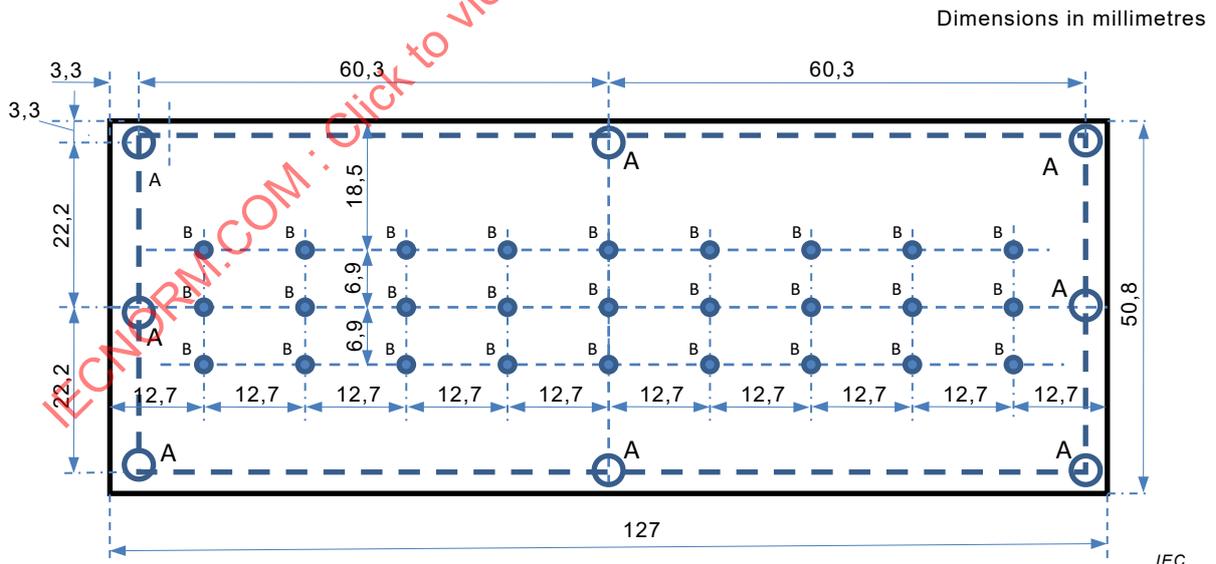

Material: 0,8 mm thick stainless steel sheet.

All holes marked A are 3,6 mm in diameter (8 holes).

The water holes are marked B arranged in a 9 × 3 array.

Water holes marked B are 1,2 mm in diameter.

Figure C.3 – Nozzle

A flow diagram of the pollution delivery system is shown in Figure C.4. Salt water is mixed in a plastic tank or bucket that serves as a storage tank. The pump drives the water through the control valve, filter, flow meter and the rain nozzle. After spraying, it is collected in a stainless steel storage tank and flows back to the reservoir. The flow rate and water salinity are kept constant during the test.

- Salinity: 1 % (wait 12 h after adding salt to allow the salt to completely dissolve). Check the salinity every 24 h to assure a salinity of 1 % or greater.
- Flow rate: 2 l/min to 3 l/min.

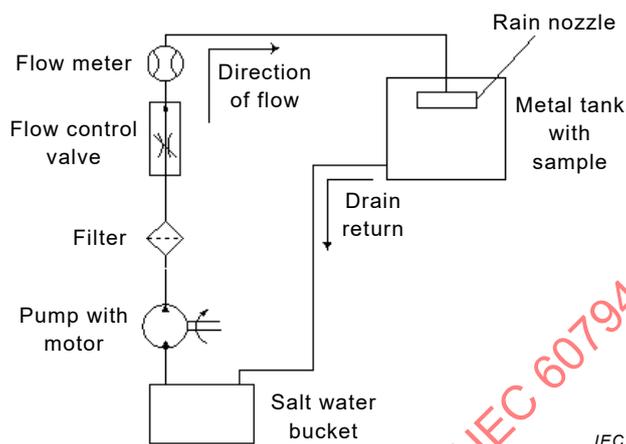


Figure C.4 – Details for the spraying

C.3.3 Test method

The appropriate R_{eq} , C_{eq} , and V_{oc} are chosen. R_{eq} and C_{eq} are chosen to represent the pollution level. V_{oc} is chosen to represent the desired space potential, as shown in Table C.1.

Table C.1 – R_{eq} and C_{eq} values for different pollution index values


Pollution index (PI)	Ohms/meter	Category	R_{eq}	C_{eq}
5	100 000	Heavy	$4,2 \times 10^6 \Omega$	650 pF
5,3	200 000	Heavy	$5,8 \times 10^6 \Omega$	457 pF
5,7	500 000	Heavy	$9,2 \times 10^6 \Omega$	290 pF
6	1 000 000	Medium	$13,1 \times 10^6 \Omega$	200 pF
6,3	2 000 000	Medium	$18,6 \times 10^6 \Omega$	145 pF
6,7	5 000 000	Medium	$30,0 \times 10^6 \Omega$	90 pF
7	10 000 000	Light	$42,0 \times 10^6 \Omega$	65 pF

The ADSS sample is subjected to repeated cycles of salt spray and drying. The samples are wetted for 2 min and allowed to dry for 13 min. During the drying period, arcing will appear on the sample. The test is performed under normal room temperatures and humidity.

Dry band arcing shall not erode through the cable sheath prior to completing 300 cycles for the appropriate pollution index for the region. Unless a pollution index (PI) for the region can be determined, the customer may need to specify a low pollution index. The suppliers cable shall be capable of completing 300 cycles at less than or equal to the customer's specified pollution index (PI).

C.3.4 Overview of pollution model and electrical test

An overview of a pollution model is detailed in Figure C.7. Allowing the first lumped resistor (connecting V_1 to the grounded tower) to be very large (e.g. $10^{14} \Omega$) and repeating the computation provides the value V_{oc} , which is the voltage across a dry band in the wet pollution near the tower. I_0 , from the previous computation, becomes the arc current when the band flashes over.

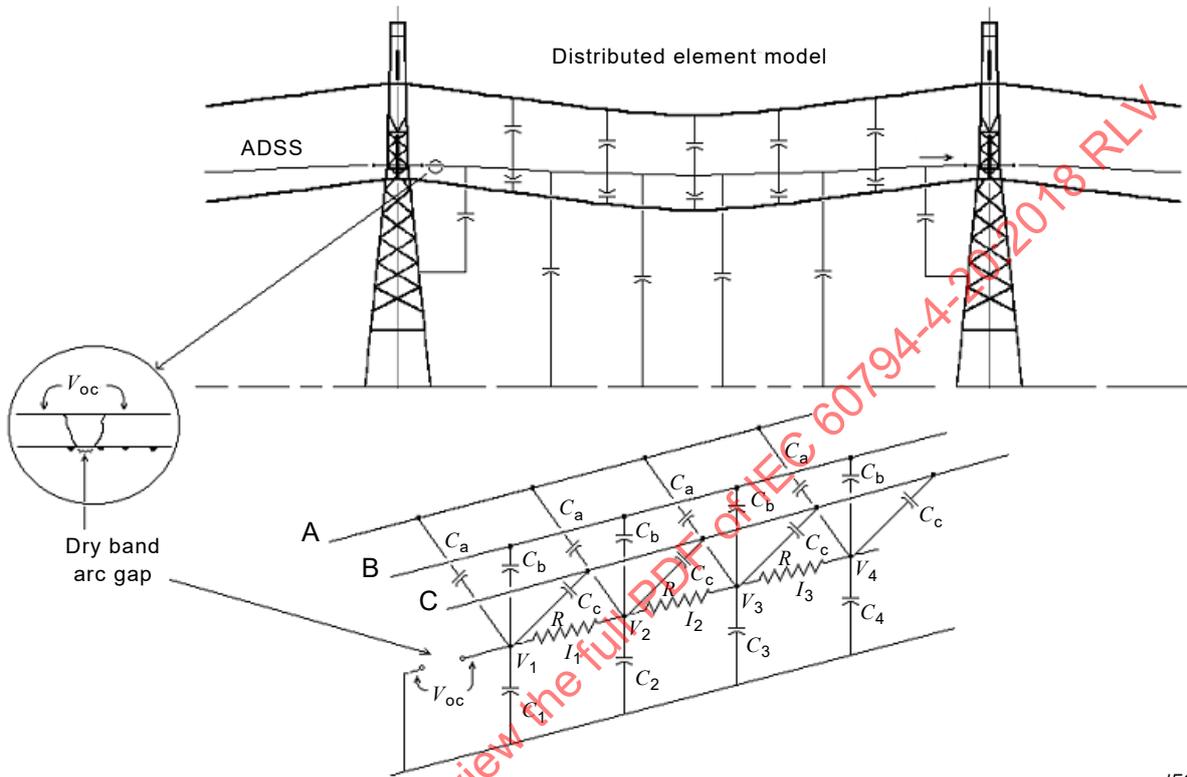


IEC

Key

R pollution resistance in ohms per distance (metres, feet, etc.)

Figure C.5 – Pollution model Distributed element model with dry band arc gap

The entire model, as illustrated in Figure C.5, can be reduced to an electrical equivalent by dividing V_{oc} by I_0 . A and B are the phase angles of each quantity. This is the basic circuit for the arcing test as shown in Figure C.6.

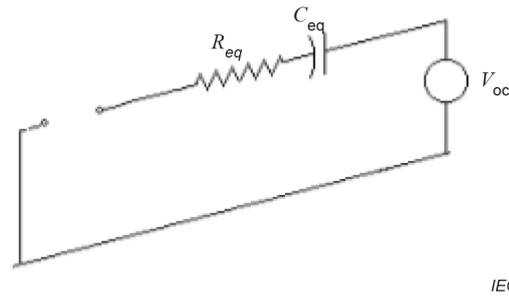

IEC

$$Z_{eq} = \frac{V_{oc}(A)}{I_o(B)} = \frac{V_{oc}(\cos A) + jV_{oc}(\sin A)}{I_o(\cos B) + jI_o(\sin B)} = R_{eq} - jX$$

$$C_{eq} = \frac{1}{\omega X} \quad \omega = 2\pi f \quad f = 60 \text{ Hz}$$

Figure C.6 – ~~Basic circuit for arcing test~~ Thevenin equivalent circuit

IECNORM.COM : Click to view the full PDF of IEC 60794-4-20:2018 RLV

Annex D
(informative)

**All dielectric self-supported (ADSS) cables to be used
in overhead power lines (blank detail specification)**

Table D.1 – Blank detail specification

(1) Prepared by		(2) Document N°: Issue : Date :
(3) Available from:	(4) Generic specification: IEC 60794-4-20 ; IEC 60794-1-2 X series Sectional specification: IEC 60794-4 Family Specification: IEC 60794-4-20	
(5) Additional references:		
(6) Cable description:		
(7) Cable construction:		
<u>Optical fibres</u>		Additional remarks
<u>Range of fibre count</u>		
Modularity		
<u>Construction</u> - Loose tube – filled - Loose tube – unfilled - Slotted core – filled - Slotted core – unfilled - Ribbon in slotted core - Ribbon in loose tube - Central (strength) member – non metallic - Core filling – regular water blocking - Core filling – water swell able materials		
<u>Lay-up</u> - Stranding (helical or SZ) - Single unit		
(7) Cable construction (continued) Inner sheath Peripheral strength member - Non-metallic Moisture barrier Outer sheath Armouring - Non-metallic armouring Outer protection - Polyethylene sheath - Performance of tracking resistant sheath Marking identification - Customer requirement - Identification of manufacturer		Additional remarks

(8) Application information:	
General	
Maximum outer diameter (d)	mm
Installation load (MIT)	N
Allowed short term load (MAT)	N
Zero strain margin	N
Minimum bending radius for no load bending	mm or nxd
Minimum bending radius for rated load bending	mm or nxd
Temperature range:	
- Transport and storage	°C
- Installation	°C
- Operation	°C
Cable weight	kg/km
Manufacturing cable length	
- Typical	m
- Nominal /tolerances	-0 %, +1 %
- Modulus of elasticity	kPa
- Coefficient of linear expansion	$10^{-6}/^{\circ}\text{C}$
- Creep behaviour	mm or %
Particular (cables designed for specific projects)	
- Ice thickness	mm
- Wind speed	km/h
- Maximum span distance while under the maximum weather load	m
- Minimum sag for maximum span (not exceeding MAT under weather load)	m or %

IECNORM.COM : Click to view the full PDF of IEC 60794-4-20:2018 RLV

Bibliography

IEC 60060-1:2010, *High-voltage test techniques – Part 1: General definitions and test requirements*

~~IEC 60794 (all parts), *Optical fibre cables*~~

~~IEC 60794-1-2X (all subparts), *Optical fibre cables – Part 1-2X: Generic specification – Basic optical cable test procedures*~~

IEC 60794-1-2, *Optical fibre cables – Part 1-2: Generic specification – Basic optical cable test procedures – General guidance*

~~IEC 60794-1-21, *Optical fibre cables – Part 1-21: Generic specification – Basic optical cable test procedures – Mechanical test methods*⁵~~

~~IEC 60794-3, *Optical fibre cables – Part 3: Sectional specification – Outdoor cables*~~

IEC 60794-3-20, *Optical fibre cables – Part 3-20: Outdoor cables – Family specification for self-supporting aerial telecommunication cables*

IEC 60794-4 (all parts), *Optical fibre cables – Part 4: Sectional specification – Aerial optical cables along electrical power lines*

IEC 61395, *Overhead electrical conductors – Creep test procedures for stranded conductors*

IEC 61935 (all parts), *Specification for the testing of balanced and coaxial information technology cabling*

IEC TR 62263, *Live working – Guidelines for the installation and maintenance of optical fibre cables on overhead power lines*

IEC TR 62362, *Selection of optical fibre cable specifications relative to mechanical, ingress, climatic or electromagnetic characteristics – Guidance*

~~ISO/IEC 24702, *Information technology – Generic cabling – Industrial premises*~~

~~ISO 9001, *Quality management systems – Requirements*~~

IEEE Std 1222TM-2011, *IEEE standard for testing and performance for all-dielectric self-supporting (ADSS) fiber optic cable for use on electric utility power lines*

~~IEEE TPWRD 00498-2004, *Experimental Verification of the Proposed IEEE Performance and Testing Standard for ADSS Fiber Optic Cable for Use on Electric Utility Power Lines*, Essam Al-Ammar, George G. Karady, Baozhuang Shi and Monty W. Tuominen~~

⁵ ~~Under consideration.~~

INTERNATIONAL STANDARD

NORME INTERNATIONALE



Optical fibre cables –

Part 4-20: Sectional specification – Aerial optical cables along electrical power lines – Family specification for ADSS (all dielectric self-supported) optical cables

Câbles à fibres optiques –

Partie 4-20: Spécification intermédiaire – Câbles optiques aériens le long des lignes électriques de puissance – Spécification de famille pour les câbles optiques autoporteurs entièrement diélectriques (ADSS)

CONTENTS

FOREWORD.....	4
1 Scope.....	6
2 Normative references	6
3 Terms, definitions and abbreviated terms	7
4 Optical fibres	7
5 Cable elements	7
6 Optical fibre cable constructions	7
6.1 General.....	7
6.2 Cable protection elements.....	7
7 Main requirements for installation and operating conditions	8
8 Cable design considerations	8
9 Cable tests	9
9.1 General.....	9
9.2 Tensile performance.....	9
9.2.1 General	9
9.2.2 Family requirement	9
9.2.3 Test conditions	9
9.3 Sheave test.....	9
9.3.1 General	9
9.3.2 Family requirement	9
9.3.3 Test conditions	9
9.4 Repeated bending.....	10
9.4.1 General	10
9.4.2 Family requirements.....	10
9.4.3 Test conditions	10
9.5 Impact	10
9.5.1 General	10
9.5.2 Family requirements.....	10
9.5.3 Test conditions	10
9.6 Crush.....	10
9.6.1 General	10
9.6.2 Test requirements	11
9.6.3 Test conditions	11
9.7 Torsion	11
9.7.1 General	11
9.7.2 Test requirements	11
9.8 Aeolian vibration test.....	11
9.8.1 General	11
9.8.2 Family requirements.....	11
9.8.3 Test conditions	11
9.8.4 Parameters to be reported.....	11
9.9 Low frequency vibration test (galloping test)	12
9.9.1 General	12
9.9.2 Family requirements.....	12
9.9.3 Test conditions	12

9.10	Temperature cycling	12
9.10.1	General	12
9.10.2	Family requirements.....	12
9.10.3	Test conditions	12
9.11	Water penetration	13
9.12	Cable UV resistance.....	13
9.13	Tracking and erosion resistance test.....	13
9.14	Creep	13
9.15	Fitting compatibility	14
10	Quality assurance	14
Annex A (informative) Packaging and marking.....		15
Annex B (informative) Installation considerations for ADSS cables.....		16
Annex C (informative) Electrical test (tracking)		18
C.1	General.....	18
C.2	Option C2 – Sheath material qualification	18
C.2.1	Overview	18
C.2.2	Test arrangements	18
C.2.3	Test procedure.....	19
C.2.4	Requirements	19
C.3	Option C3 – Pollution level and tracking resistance	19
C.3.1	Overview	19
C.3.2	Test setup.....	20
C.3.3	Test method.....	22
C.3.4	Overview of pollution model and electrical test.....	22
Annex D (informative) All dielectric self-supported (ADSS) cables to be used in overhead power lines (blank detail specification)		24
Bibliography		26
Figure B.1 – Example of different span lengths allowed for the same cable, depending on sag variation		17
Figure C.1 – Electric scheme for the test.....		20
Figure C.2 – Foils of the electrodes.....		20
Figure C.3 – Nozzle		21
Figure C.4 – Details for the spraying		21
Figure C.5 – Distributed element model with dry band arc gap.....		23
Figure C.6 – Thevenin equivalent circuit.....		23
Table 1 – Cable design characteristics		8
Table 2 – Optional parameters (if required by customer).....		8
Table C.1 – R_{eq} and C_{eq} values for different pollution index values		22
Table D.1 – Blank detail specification.....		24

INTERNATIONAL ELECTROTECHNICAL COMMISSION

OPTICAL FIBRE CABLES –

Part 4-20: Sectional specification – Aerial optical cables along electrical power lines – Family specification for ADSS (all dielectric self-supported) optical cables

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 60794-4-20 has been prepared by subcommittee 86A: Fibres and cables, of IEC technical committee 86: Fibre optics.

This second edition cancels and replaces the first edition published in 2012 and constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) this document has been streamlined by cross-referencing IEC 60794-1-1, IEC 60794-4 (all parts) and IEC 60794-1-2;
- b) reference to the MICE table has been deleted;
- c) the example of test method for particular environment in Annex C has been deleted;

The text of this International Standard is based on the following documents:

FDIS	Report on voting
86A/1867/FDIS	86A/1876/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all the parts in the IEC 60794 series, published under the general title *Optical fibre cables*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

OPTICAL FIBRE CABLES –

Part 4-20: Sectional specification – Aerial optical cables along electrical power lines – Family specification for ADSS (all dielectric self-supported) optical cables

1 Scope

This part of IEC 60794-4, which is a family specification, covers optical telecommunication cables, commonly with single-mode fibres¹ used primarily in overhead power lines applications. The cables can also be used in other overhead utility networks, such as for telephony or TV services. Requirements of the sectional specification IEC 60794-4 for aerial optical cables along electrical power lines are applicable to cables covered by this document.

This document covers the construction, mechanical, electrical, and optical performance, installation guidelines, acceptance criteria, test requirements, environmental considerations, and accessories compatibility for an all dielectric, self-supporting fibre optic (ADSS) cable. This document provides construction and performance requirements that ensure, within the guidelines of this document, that the required mechanical integrity of the cable components as well as optical fibre mechanical reliability and transmission parameters are maintained.

The ADSS cable consists of single mode optical fibres contained in one or more protective dielectric fibre optic units surrounded by or attached to suitable dielectric strength members and sheaths. The cable does not contain metallic components. An ADSS cable is designed to meet the optical and mechanical requirements under different installation, operating and environmental conditions and loadings, as described in Annex B.

This document excludes any "lashed" or "wrapped" OPAC cables included in IEC 60794-4. Figure 8 aerial cables are also excluded; they are specified in IEC 60794-3-20.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60793-2, *Optical fibres – Part 2: Product specifications – General*

IEC 60793-2-50, *Optical fibres – Part 2-50: Product specifications – Sectional specification for class B single-mode fibres*

IEC 60794-1-1, *Optical fibre cables – Part 1: Generic specification – General*

IEC 60794-1-21:2015, *Optical fibre cables – Part 1-21: Generic specification – Basic optical cable test procedures – Mechanical test methods*

IEC 60794-1-22, *Optical fibre cables – Part 1-22: Generic specification – Basic optical cable test procedures – Environmental test methods*

¹ In some particular situations in the electrical industry, short overhead links can be also designed with multimode fibres.

IEC 60794-4, *Optical fibre cables – Part 4: Sectional specification – Aerial optical cables along electrical power lines*

ISO 9001, *Quality management systems – Requirements*

3 Terms, definitions and abbreviated terms

For the purposes of this document, the terms, definitions and abbreviated terms given in IEC 60794-1-1 and IEC 60794-4 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

4 Optical fibres

Single-mode optical fibres shall be used that meet the requirements of IEC 60793-2-50. Other types of fibre can be agreed upon between the customer and the supplier; such fibre shall conform to IEC 60793-2. The cabled fibre shall conform to IEC 60794-4.

5 Cable elements

Refer to the relevant parts of the sectional specification IEC 60794-4.

6 Optical fibre cable constructions

6.1 General

The construction and characteristics of cable elements shall conform to IEC 60794-4. The cable shall not contain any metallic material.

6.2 Cable protection elements

In addition to the optical unit, the cable construction may consist of the following.

- a) The outer sheath shall be a weather-resistant type material. In certain conditions, it shall be necessary to consider the use of a tracking-resistant sheath.
- b) An ADSS cable shall contain self-supported systems that are integral to the cable. The purpose of the support system is to ensure that the cable meets the optical requirements under specified installation conditions, temperatures, and environmental loading for its whole operating design life.
- c) The basic annular construction may have strength yarns (e.g. aramid yarns) or other dielectric strands or dielectric rods as a support structure. A single central dielectric shaft, channelled to accommodate the optical elements, is also accepted.
- d) The cable shall be designed such that fibre strain does not exceed the limit allowed by the cable manufacturer under design tension limits of the cable (MAT). Maximum allowable fibre strain under MAT condition shall be $\leq 0,2\%$ for 0,69 GPa proof-tested fibres.

NOTE In some countries, a special requirement of shotgun resistance can be specified for aerial cables. ADSS cables covered by this document are not designed for such a condition. Cables with reinforced textile protection could still meet the dielectric condition, but the increase in diameter and weight would make necessary a significant enhancement of the tensile performance of the cable.

7 Main requirements for installation and operating conditions

Operating conditions are particularly important for ADSS cables.

Installation and operating conditions shall be agreed between the customer and the supplier. For the ADSS cable, a detailed study of the field conditions and a certain level of technical support by the supplier or third-party expert should precede the agreement. Annex B provides a general view of such considerations.

The type of fittings and hardware used to attach the ADSS to the structures shall be approved between the customer and the supplier. Their compatibility shall be verified in accordance with 9.15 and the fittings product specification.

8 Cable design considerations

Table 1 is a summary of cable characteristics which may be of importance as specifications to both the customer and the supplier. Table 2 includes optional engineering parameters relevant for the design and installation of the overhead line with an ADSS cable. Other characteristics may be mutually agreed upon by both the customer and the supplier. A complete blank specification is shown in Annex D.

Table 1 – Cable design characteristics

Ref.	Characteristics	Units
4	Number and type of fibres	NA
-	Modularity of cable core	NA
6	Detailed description of cable construction	NA
-	Overall cable diameter	mm
	Cable weight	kg/km
9.2	MAT (maximum allowable tension)	kN
9-10	Allowable temperature for storage, installation and operation	°C
9.3	Minimum bending diameter during installation	mm
9.4	Minimum bending diameter installed	mm

Table 2 – Optional parameters (if required by customer)

Ref.	Characteristics	Units
9.13	MIT, maximum installation (or sagging) load	kN
-	Modulus of elasticity	MPa
-	Coefficient of thermal expansion	10 ⁻⁶ /°C
9.2	Fibre strain at MAT load	%
Annex B	Zero strain margin	kN
	Environmental loading conditions – Reference to local or regional installation code	NA
	Recommended span and sag under MAT limit	m/%
C.3	Maximum ADSS cable space potential exposure (generally specified for a low-pollution environment unless specified otherwise by the customer)	kV

9 Cable tests

9.1 General

In mechanical tests, the general optical criteria is no change in attenuation, as described in IEC 60794-1-1 and IEC 60794-4.

In some environmental and installation tests, some increase is accepted. These are the sheave test, the aeolian vibration test and the galloping test.

The number of fibres tested shall be representative of the cable design according to fibre sampling indicated IEC 60794-1-1. Different sampling can be agreed between the customer and the supplier.

The tests applicable for aerial cables are listed below. The minimum acceptance criteria for the different designs of cables shall be indicated in the product specification.

9.2 Tensile performance

9.2.1 General

The cable should be tested in accordance with IEC 60794-1-21, method E1. Under this test, the cables shall meet the specified MAT value.

9.2.2 Family requirement

Loaded with MAT, no change in attenuation at 1 550 nm shall be measured, and the strain in the fibre shall be ≤ 0.2 % for 0,69 GPa proof-tested fibres. Other values can be agreed between the customer and the supplier.

NOTE Strain limit values for fibres with different proof test values are under study.

9.2.3 Test conditions

- Test set in a straight path in accordance with Figure 1 of IEC 60794-1-21:2015 (no drums or pulleys allowed).
- The cable shall be terminated with adequate dead-end fittings.
- Sample length of 25 m minimum.
- MAT is sustained for 1 h.
- The fibres shall be loop-back spliced so that a minimum of 100 m of fibre are under test.

9.3 Sheave test

9.3.1 General

The cable shall be tested in accordance with method E18B of IEC 60794-1-21.

9.3.2 Family requirement

Maximum permanent increase in attenuation: 0,10 dB at 1 550 nm.

No physical damage in cable elements.

9.3.3 Test conditions

- Method E18B of IEC 60794-1-21, procedure 1 or 2.
- Tension level applied during test: maximum stringing load (or MIT).
- Length of the cable: 9 m minimum. Length bent under tension: 2 m.

- The cable should be terminated with the recommended dead-end fittings.
- The fibres shall be loop-back spliced so that a minimum of 100 m of fibre are under test.
- Diameter (D) of roller/cylinders \geq manufacturer's minimum bend diameter (approximately ≥ 40 times cable outside diameter is recommended).
- Bending angle: $45^\circ \pm 15^\circ$.
- Moving speed: $1 \text{ m/s} \leq \text{speed} \leq 10 \text{ m/s}$.
- Number of complete moving cycles: 20.

9.4 Repeated bending

9.4.1 General

The cable shall be tested in accordance with the method specified in IEC 60794-1-21, method E6.

9.4.2 Family requirements

Under visual examination without magnification, there shall be no damage to the sheath or cable elements. There shall be no change in attenuation at 1 550 nm after the completion of the test.

9.4.3 Test conditions

- Bending radius: 20 d.
- Number of cycles: 25.

Particular conditions may be agreed between the customer and the supplier.

9.5 Impact

9.5.1 General

The cable construction shall be tested in accordance with the method specified in IEC 60794-1-21, method E4.

9.5.2 Family requirements

Under visual examination without magnification, there shall be no damage to the sheath or to the cable elements. The imprint of the striking surface on the sheath is not considered mechanical damage.

There shall be no change in attenuation at 1 550 nm.

9.5.3 Test conditions

- Striking surface radius: 300 mm.
- Impact energy: 10 J.
- Number of impacts: three, each in a different place spaced not less than 500 mm apart.

NOTE these values are for general purpose use. Particular requirement could be included in product specification.

9.6 Crush

9.6.1 General

The cable shall be tested in accordance with IEC 60794-1-21, method E3, without physical damage or change in attenuation.

9.6.2 Test requirements

Under visual examination, there shall be no damage to the sheath or to the cable elements. The imprint of the plate or mandrel on the sheath is not considered mechanical damage.

Long term ≥ 10 min. No change in attenuation (prior to release of load).

Short term ≥ 1 min. No change in attenuation (after test).

9.6.3 Test conditions

- Load (plate/plate): 2,2 kN for short-term load, 1,1 kN for long-term load.
- Duration of load: 1 min of short-term load, followed by 10 min of long-term load.
- Number of tests: 3.
- Spacing between test places: 500 mm.

NOTE These values are for general purpose use. Particular requirements can be included in a product specification.

9.7 Torsion

9.7.1 General

The cable shall be tested in accordance with IEC 60794-1-21, method E7.

9.7.2 Test requirements

Under visual examination without magnification, there shall be no damage to the sheath or to the cable elements.

No change on attenuation after the test at 1 550 nm.

9.8 Aeolian vibration test

9.8.1 General

The resistance of the cable to aeolian vibration shall be tested in accordance with method E19 of IEC 60794-1-21.

9.8.2 Family requirements

Under visual examination without magnification, there shall be no damage to the sheath or to the cable elements. The variation on attenuation after the test shall be no greater than 0,10 dB at 1 550 nm.

9.8.3 Test conditions

The cable should be terminated with the recommended dead-end and suspension fittings.

9.8.4 Parameters to be reported

- Length of spans.
- Length of cable and fibres tested.
- Vibration mode/characteristics maintained during the test.
- Characteristics of measuring equipment.
- Ambient temperature and humidity during the test.
- Mass/unit length and diameter of the cable.

9.9 Low frequency vibration test (galloping test)

9.9.1 General

The resistance of the cable to low frequency vibration shall be tested in accordance with IEC 60794-1-21, method E26. This test applies for ADSS cables to be installed in areas where ice build-up and/or strong winds are envisaged.

9.9.2 Family requirements

Permanent or temporary increase in attenuation at 1 550 nm shall be $\leq 0,10$ dB.

The sheath shall have no cracks or splits.

9.9.3 Test conditions

The final optical measurement shall be taken at least 2 h after the completion of the vibration test. A section of cable from the location of the hardware support shall be loaded to the MAT, and the attenuation shall comply with 9.2.1.

9.10 Temperature cycling

9.10.1 General

The cable shall be tested in accordance with the method specified in IEC 60794-1-22, method F1, one-cycle procedure with the temperature limits, in accordance with operation limits in the product specification, or combined test procedure if different storage limits are specified.

9.10.2 Family requirements

For T_A and T_B (T_{A1} and T_{B1} in combined test), there shall be no change in attenuation from the reference room temperature measurement when measured in the 1 550 nm region or at the operational wavelength when specified by the user. T_{A1} and T_{B1} temperature levels are only required during the last cycle.

For T_{A2} and T_{B2} , the change in attenuation coefficient shall be $\leq 0,15$ dB/km during the last cycle from the reference room temperature measurement.

On completion of the test, there shall be no change in attenuation. The measurement shall be made in the 1 550 nm region.

9.10.3 Test conditions

- Sample length: finished cable length of at least 500 m.
- High temperature, T_B for one-cycle procedure (T_{B1} for combined test): +60 °C.
- High temperature, T_{B2} : +70 °C (only for combined test).
- Low temperature, T_A for one-cycle procedure (T_{A1} for combined test): -20 °C.
- Low temperature, T_{A2} : -40 °C (only for combined test).
- Rate of heating: sufficiently slow so that the effect of changing the temperature does not cause temperature shock or 40 °C/h if not specified.
- t_1 : enough time to get temperature stability in the sample.
- Number of cycles: 2. Additional cycles may be required depending on user requirements.
- Temperature values may vary depending on user requirements.

9.11 Water penetration

The cable shall be tested in accordance with IEC 60794-1-22, method F5B for jelly filled cables or F5C for all-dry cables.

No water shall be detected at the unsealed end of the sample during and at the end of the test.

9.12 Cable UV resistance

The outer sheath shall be made of UV-stabilized weather-resistant material in accordance with IEC 60794-1-22, method F14.

Further requirements are under consideration.

9.13 Tracking and erosion resistance test

Dielectric cables installed on power lines are exposed to electrical fields. The magnitude of this field space potential exposure depends on the line voltage, tower design, conductor configuration, and installation location for the ADSS. Together with specific environmental conditions, especially desert or highly polluted areas close to the sea, this can lead to electrical degradation (e.g. dry-band arcing), which can cause severe damage to the outer cable sheath and finally can cause a total cable failure. The sensitivity to electrical degradation depends on a combination of the space potential, the cable, environment, and sheath material used. In areas with higher space potentials or poor environmental conditions, track resistant sheath materials may be essential to alleviate the risk to product life.

Experience has shown that the formerly used > 12 kV space potential transition point for using track resistant sheath materials may be too high depending on the environmental conditions. Under certain environmental conditions as mentioned above, tracking-resistant sheaths may be needed with space potentials down to 4 kV. Even with tracking-resistant sheath materials, special consideration about the feasibility of ADSS applications is required for levels higher than 20 kV.

Tracking-resistant sheath materials shall be used in the following field conditions:

- a) power lines with an operation voltage of 150 kV or higher;
- b) power lines producing space potential of 4 kV or higher in salty or polluted areas.

If the ADSS cable is to be used in telecommunication poles or low-voltage distribution lines, track-resistant requirements can be waived.

Two current options for evaluating the quality of track-resistant sheath materials are given in Annex C:

- 1) salt fog method: evaluates cable in a wet condition (continuous salt water spray);
- 2) alternating wet dry cycles with different current levels to reflect different degrees of resistivity resulting from varying degrees of regional environmental conditions.

Other test conditions may be needed to evaluate ADSS tracking resistance for specific environments.

9.14 Creep

There is no pass/fail criterion for creep. This parameter is an engineering guidance to the behaviour of the cable during its working life. The cable creep behaviour should be determined using a test method agreed between the customer and the supplier. Suitable tests are IEC 60794-1-21, method E32 or found in IEC 61395.

9.15 Fitting compatibility

The type of fittings shall be approved between the customer and the supplier, and their compatibility shall be verified as follows.

- Dead-end fittings shall be used during the MAT test (9.2), with a maximum of 3 mm of displacement between the fitting and the cable during and after the test. There should be no change in attenuation.
- A cable sample with dead-end fittings shall stand 24 h at a temperature of $60\text{ °C} \pm 2\text{ °C}$ and controlled RH of $85\% \pm 5\%$, under MIT load, with a maximum displacement of 3 mm between each fitting and cable. There should be no change in attenuation.
- Suspension fitting shall be used during vibration tests (9.8 and 9.9) with no damage to the cable during the test. There should be no change in attenuation. Vibration dampers can also be qualified during this test.
- Following the completed testing, the hardware fittings shall be removed and the cable's outer sheath inspected. There shall be no splits or tears in the outer sheath.

Sample for verification of the temperature and humidity condition shall be long enough to accept a dead-end fixture and a connection length at both ends; at least 10 m is recommended. The complete setup should be exposed at the indicated temperature and humidity

NOTE The use of vibration dampers is not compulsory but is an installation option.

10 Quality assurance

It is the responsibility of the manufacturer to establish quality assurance by quality control procedures which ensure that the product meets the requirements of this document. When the purchaser wishes to specify acceptance tests to other quality procedures, it is essential that an agreement is reached between the customer and the supplier at the time of ordering.

The supplier shall establish, introduce and maintain a quality management system in accordance with ISO 9001 or equivalent.

Annex A provides recommendations for packaging and marking.

Annex A (informative)

Packaging and marking

The cable should be tightly and uniformly wound onto reel(s) in layers. Reel lengths may be either standard length or specified length. Standard lengths are reel lengths normally provided by a supplier. This length will be defined by the supplier. Specified lengths are reel lengths that are specified by the customer. A tolerance of $\pm 2,0$ % should be maintained for specified lengths and standard lengths.

Reels may be either wooden non-returnable or steel returnable type. Unless specified otherwise by the customer, the supplier will determine the size and type reel that will withstand normal shipping, handling, storage and stringing operations without damage to the cable.

The reel and inside flanges shall be manufactured in a manner that damage will not occur to the cable during shipping, handling, storage and stringing.

The cable should be adequately protected against mechanical damage and solar heating.

Reel numbers should be identified in a clear and legible manner on the outside of each flange on two opposite locations.

Each reel should be tagged with a shipping tag. Tags should be weather-resistant. All essential information, such as the supplier's name, cable size and number of fibres, order number, reel number, cable number, cable lengths, and gross, tare, and net weight should appear legibly on the tags. The tags should clearly indicate cable in the description.

The cable ends should be securely fastened to prevent the cable from becoming loose during shipment. The inner end of the cable shall be accessible for connection to optical measuring equipment. This length of cable shall be securely fastened and protected during shipment.

A seal should be applied to each end of the cable to prevent the entrance of moisture into the optical fibres or the escape of filling compound during shipment and storage.

Each reel should be marked on the outside flange to indicate the direction the reel should be rolled during shipment in order to prevent loosening of the cable on the reel.

Annex B (informative)

Installation considerations for ADSS cables

In most cases, for underground application cables, the maximum mechanical stress (due to tension, torsion, compression, etc.) occurs during the installation process. During the rest of its operative life, the cable, if properly installed, will suffer stress eventually or just a residual permanent value.

On the contrary, aerial cables will be during the working life permanently under the installation tension and can be periodically subjected to higher tensions due to variable environmental conditions.

In aerial applications, in order to guarantee a long working life for the cable, it is not enough only to perform a careful installation procedure and test the fibres at the end of the job. It is necessary to know the environmental conditions and weather cycles in the location and from that information select or design the cable.

The combination of all these parameters in a field condition define the tensile strength required in the cable, and a detailed engineering study is carried out that takes into consideration several parameters affecting the required strength of the cable, span, sag, temperature, wind speed, ice formation, which are all considered for the design of an aerial power line. Some additional considerations have to be made to ensure the selected cable is adequate.

- 1) In conductor cables, the mechanical strength is proportional to cable size, which is part of the electrical design of the line. Therefore, the physical design of the link necessarily takes into account the cable mechanical resistance. As the ADSS has no electrical function and it is frequently installed in existing power lines, its mechanical analysis is independent and the lack of information could lead to an over-design or under-design of the cable.
- 2) The reference parameter in metallic cables is the breaking load. Under critical conditions, the cable can be under short-term stress close to that limit without intrinsic damage. In a similar situation for an ADSS, the fibres could be broken. Since it is not the integrity of the cable but fibres the first concern in a telecommunication link, breaking strength is not the selected parameter to specify an ADSS cable. In order to protect fibre integrity, the reference should be the maximum allowed tension (MAT).
- 3) Breaking load is not a parameter in the optical/mechanical performance of an ADSS cable. In some countries, the breaking strength of aerial cables is a regulation as an installation requirement.
- 4) The MAT is the key specification values for cable performance; it should be matched with the critical stress situations (wind, heavy ice, temperature) that, although not frequent, are expected to be present in the area.
- 5) The elasticity module and the coefficient of linear expansion are engineering data. These values should be provided by the manufacturer to be used for tension/sag calculations, if requested by customer, or sag/tension tables should be provided.
- 6) Maximum installation tension (MIT) is a recommended value to be considered in the sagging process in order to avoid exceeding MAT when the expected wind and/or ice arise. It can also serve as limit load while stringing the cable along the power line. To prevent permanent strain in the fibres, it is advisable that MIT is lower to the zero strain margin value.
- 7) Maximum span distance, minimum or maximum sag can be recommended for particular installation cases only after the detailed engineering study (see Figure B.1).
- 8) The placement of the ADSS cable relative to the power conductor and its associated voltage affects the space potential the ADSS cable is exposed to. Compatibility with this space potential should be considered.

- 9) When transmission lines are being deployed, it is important that the customer provide details on the ADSS cable and power line conductor configuration along with applicable pollution considerations so the ADSS cables' space potential exposure can be determined.

For information on necessary installation procedures and safety issues for personnel and equipment when installing or maintaining ADSS cables on overhead power lines, see IEC TR 62263.

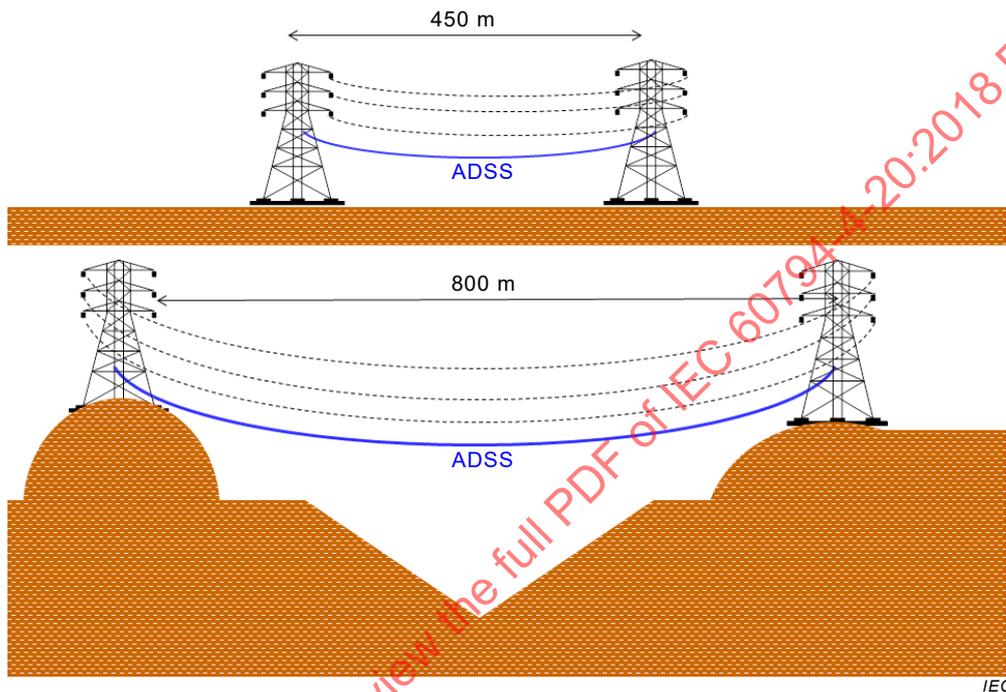


Figure B.1 – Example of different span lengths allowed for the same cable, depending on sag variation

Annex C (informative)

Electrical test (tracking)

C.1 General

Electrical erosion arises if cable sheath is affected by several conditions. There is no universal test method for its evaluation. Two options are described in Annex C.

Option C2 is a well-established way to control a sheath material referred to a specification. It is very useful to the industry for material qualification, although it has no correlation to cable behaviour in the field. The test method of option C3 establishes a means of testing cable to different pollution levels at different space potentials, based on the pollution model described in C.3.4.

C.2 Option C2 – Sheath material qualification

C.2.1 Overview

The objective of this test is to demonstrate the resistance of the cable sheath to erosion and tracking under combined electrical and mechanical stresses, while exposed to humid (salt fog) conditions.

C.2.2 Test arrangements

A length of cable should be taken from a production run and sealed at each end against moisture ingress before being supported horizontally inside a salt fog chamber between two anchor points. This will enable it to be tensioned mechanically to a level that represents the value of operation conditions for the cable. The earth termination shall be identical to that proposed by the supplier for use in service adjacent to a support tower and may consist, for example, of spiral-wrap gripping wires together with any suitable mechanical or electrical stress-relieving accessories. This design of the high-voltage termination shall be at the discretion of the supplier.

The gauge length between terminations should be great enough to avoid flashovers from taking place during the salt fog test, and a length of 25 mm/kV is usually adequate. The separation between electrode terminations should be 40 mm as minimum. The cable should be tensioned with such means so that any creep of the cable material during the test does not result in a major reduction in tension. At suitable intervals during the test, for example every 100 h, the tension should be checked, and if it has changed more than 10 % of the initial value, it should be adjusted to fall within range again.

A conduction fog shall be produced within the chamber by the use of a suitable number of atomizing nozzles similar to the design shown in Figure 18 of IEC 60060-1:2010. A useful guide is to have one nozzle for each 2 m³ of chamber volume. The salt solution to the nozzle shall be prepared dissolving 10,0 kg ± 0,5 kg NaCl in 1 000 l of distilled and de-ionized water. The droplet size should be in the range of 5 µm to 20 µm, and the flow rate of this solution in the chamber should be 0,4 l/h ± 0,1 l/h for each cubic metre of chamber volume. This generally requires an injection of dry air at a pressure of 3,3 bar to the nozzles. The nozzles shall be distributed evenly around the chamber to give a homogeneous fog density, and no jet should point directly at the cable. An aperture of no more than 80 cm² should be provided on the chamber wall for the natural exhaust of air.

A power frequency test transformer shall be used with a minimum continuous rating of 250 mA RMS and a trip level set at 1 A RMS. There shall be a clearance of at least 300 mm to earth in the vicinity of the cable.

C.2.3 Test procedure

After tensioning the cable to the MIT load, it shall be wiped with a cloth or paper towel soaked in water and then subjected to the salt fog.

After verifying the droplet size, the homogeneity of fog inside of chamber and the homogeneity of electrodes separation, a voltage level shall be applied on the evaluation circuit for a period of 1 000 h.

For ADSS cables intended to be installed on tracking generator environments, owing to high level induced voltage and/or owing to high concentration of contamination particles, the test voltage should be set at 3,0 kV/cm of separation between electrodes.

The salt water may not be recirculated. Several interruptions of the test for inspection purposes are permissible, each not exceeding 15 min. Interruption periods, which typically occur at 24 h intervals, do not count toward the test duration.

C.2.4 Requirements


After completion of the test, from visual examination, there shall be no signs of internal material exposed to the external environment through the sheath neither on the voltage application area nor on the cable fixation points for mechanical tension application.

The cable sheath shall show tracking erosion no greater than 30 % of the original sheath thickness. A transversal cut should be made on the tested section of cable sheath in order to verify the test compliance by measurement with a calibrated caliper.

C.3 Option C3 – Pollution level and tracking resistance

C.3.1 Overview

The objective of this test method is to demonstrate the resistance of the cable sheath to erosion and tracking under different arc voltages and degrees of pollution resistance. This test method uses a Thevenin equivalent circuit shown in Figure C.1 to represent the effect of space potential in the presence of different pollution levels that affect the surface resistance. V_{oc} represents the open circuit voltage across a dry band of wet pollution in the absence of arc current (see C.3.4). Contamination levels are represented by R and C in the circuit.

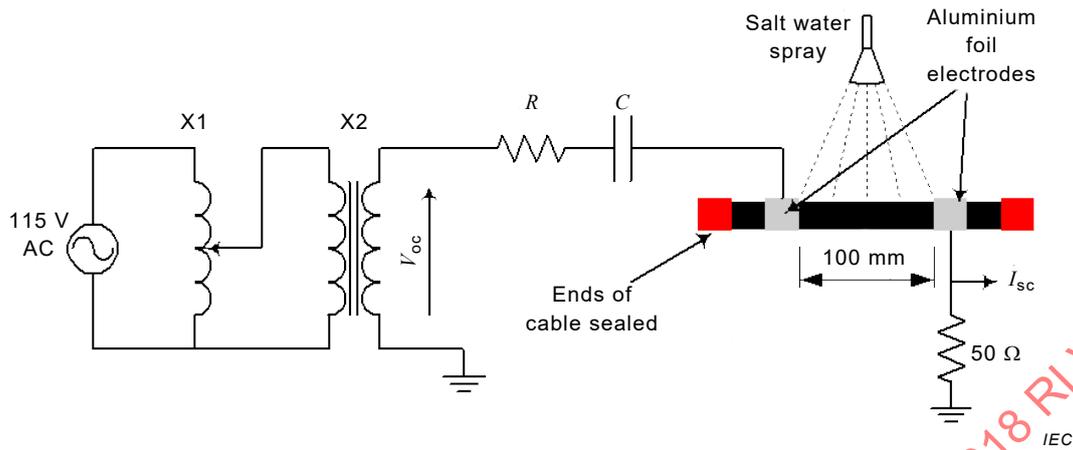


Key

- X1 autotransformer
- X2 high-voltage transformer
- V_{oc} open circuit voltage
- I_{sc} short circuit current
- R, C limiting impedance

Figure C.1 – Electric scheme for the test

C.3.2 Test setup

A 460-mm (18") long cable sample shall be prepared in accordance with Figure C.2a. The cable ends are to be sealed. The foil shall be cut into 2 trapezoid shapes in accordance with Figure C.2b and wrapped around the cable. The foil shall be separated by 100 mm (4") and shall be placed near the centre of the sample.

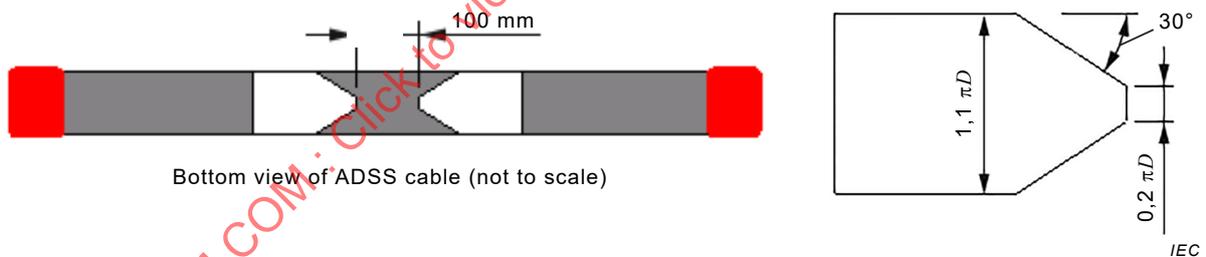

Key

- D diameter of the cable

a – Details of the sample

b – Shape of electrodes


Figure C.2 – Foils of the electrodes

An autotransformer X1 controls the primary voltage of the high voltage transformer X2. Other supply designs are permissible provided the output voltage supplied to the limiting impedance is variable up to 40 kV.

The limiting impedance is denoted by resistor R in series with capacitor C1. This impedance is defined as the ratio of the open circuit voltage of a dry band arc (i.e. arc current extinguished) to the short circuit current of the arc (current in pollution layer just prior to the arc formation). The 50-Ω resistor serves as an AC milliamperemeter.

Multiple samples are permitted provided each sample has a dedicated RC network connected to V_{oc} .

To produce a uniform conductive layer on the cable surface, a nozzle as shown in Figure C.3 is used. The nozzle consists of a 50 mm × 127 mm stainless steel sheet with 3,6 mm diameter water holes which are arranged in an array to uniformly spray the sample between the electrodes. The cable sample is placed 10 cm below the nozzle.

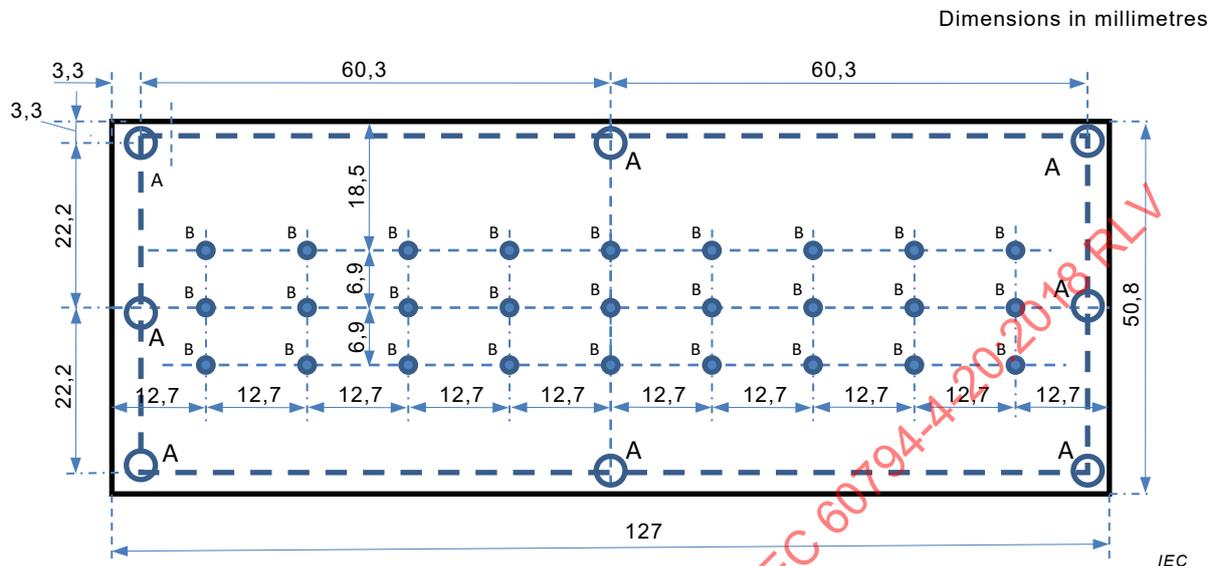

Material: 0,8 mm thick stainless steel sheet.

All holes marked A are 3,6 mm in diameter (8 holes).

The water holes are marked B arranged in a 9 × 3 array.

Water holes marked B are 1,2 mm in diameter.

Figure C.3 – Nozzle

A flow diagram of the pollution delivery system is shown in Figure C.4. Salt water is mixed in a plastic tank or bucket that serves as a storage tank. The pump drives the water through the control valve, filter and the rain nozzle. After spraying, it is collected in a stainless steel storage tank and flows back to the reservoir. The flow rate and water salinity are kept constant during the test.

- Salinity: 1 % (wait 12 h after adding salt to allow the salt to completely dissolve). Check the salinity every 24 h to assure a salinity of 1 % or greater.
- Flow rate: 2 l/min to 3 l/min.

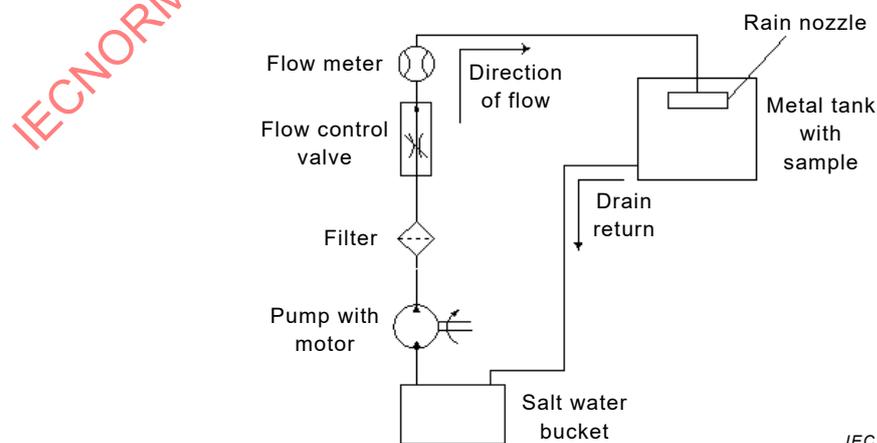


Figure C.4 – Details for the spraying

C.3.3 Test method

The appropriate R_{eq} , C_{eq} , and V_{oc} are chosen. R_{eq} and C_{eq} are chosen to represent the pollution level. V_{oc} is chosen to represent the desired space potential, as shown in Table C.1.

Table C.1 – R_{eq} and C_{eq} values for different pollution index values


Pollution index (PI)	Ohms/meter	Category	R_{eq}	C_{eq}
5	100 000	Heavy	$4,2 \times 10^6 \Omega$	650 pF
5,3	200 000	Heavy	$5,8 \times 10^6 \Omega$	457 pF
5,7	500 000	Heavy	$9,2 \times 10^6 \Omega$	290 pF
6	1 000 000	Medium	$13,1 \times 10^6 \Omega$	200 pF
6,3	2 000 000	Medium	$18,6 \times 10^6 \Omega$	145 pF
6,7	5 000 000	Medium	$30,0 \times 10^6 \Omega$	90 pF
7	10 000 000	Light	$42,0 \times 10^6 \Omega$	65 pF

The ADSS sample is subjected to repeated cycles of salt spray and drying. The samples are wetted for 2 min and allowed to dry for 13 min. During the drying period, arcing will appear on the sample. The test is performed under normal room temperatures and humidity.

Dry band arcing shall not erode through the cable sheath prior to completing 300 cycles for the appropriate pollution index for the region. Unless a pollution index (PI) for the region can be determined, the customer may need to specify a low pollution index. The suppliers cable shall be capable of completing 300 cycles at less than or equal to the customer's specified pollution index (PI).

C.3.4 Overview of pollution model and electrical test

Allowing the first lumped resistor (connecting V_1 to the grounded tower) to be very large (e.g. $10^{14} \Omega$) and repeating the computation provides the value V_{oc} , which is the voltage across a dry band in the wet pollution near the tower. I_0 , from the previous computation, becomes the arc current when the band flashes over.

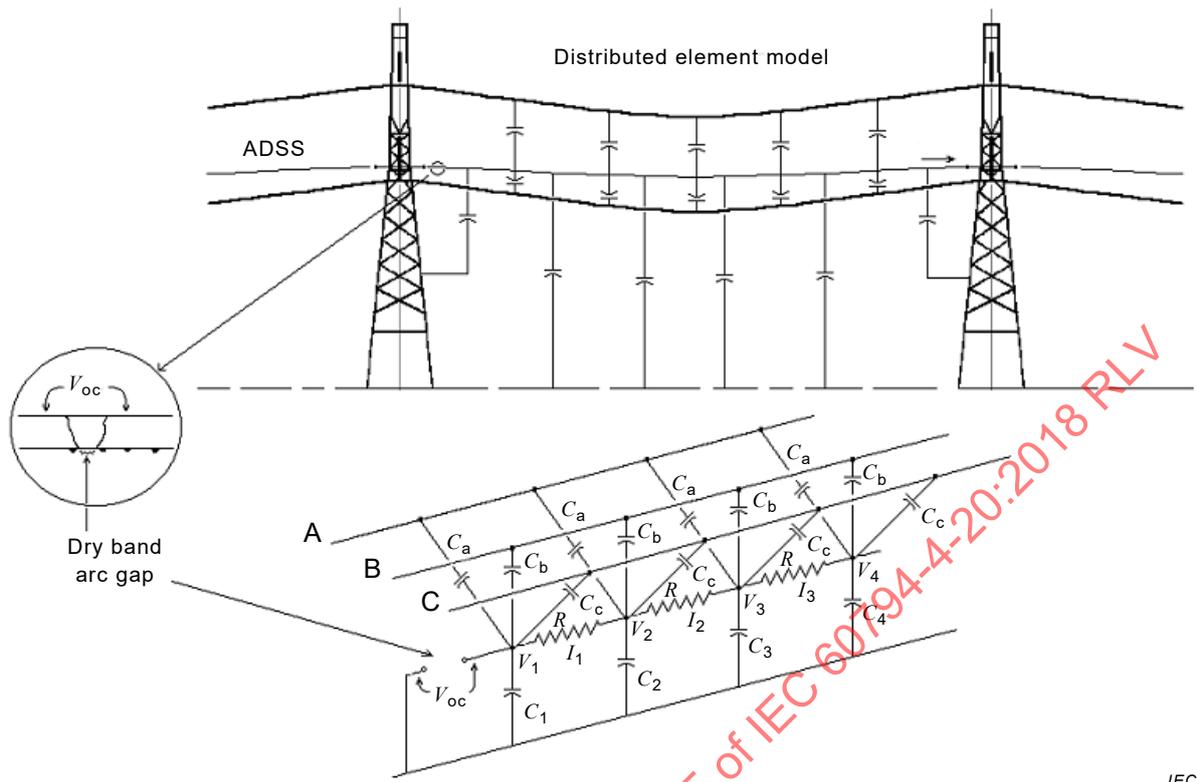


IEC

Key

R pollution resistance in ohms per distance (metres, feet, etc.)

Figure C.5 – Distributed element model with dry band arc gap

The entire model, as illustrated in Figure C.5, can be reduced to an electrical equivalent by dividing V_{oc} by I_0 . A and B are the phase angles of each quantity. This is the basic circuit for the arcing test as shown in Figure C.6.

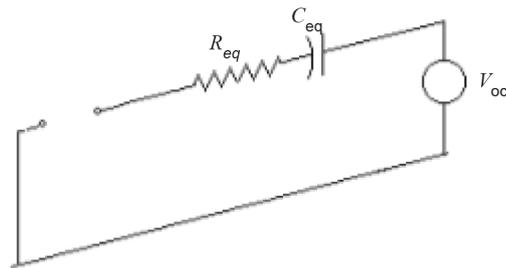

IEC

$$Z_{eq} = \frac{V_{oc}(A)}{I_0(B)} = \frac{V_{oc}(\cos A) + jV_{oc}(\sin A)}{I_0(\cos B) + jI_0(\sin B)} = R_{eq} - jX$$

$$C_{eq} = \frac{1}{\omega X} \quad \omega = 2\pi f \quad f = 60 \text{ Hz}$$

Figure C.6 – Thevenin equivalent circuit

Annex D
(informative)

**All dielectric self-supported (ADSS) cables to be used
in overhead power lines (blank detail specification)**

Table D.1 – Blank detail specification

(1) Prepared by		(2) Document N°: Issue : Date :
(3) Available from:	(4) Generic specification: Sectional specification: Family Specification:	IEC 60794-1-2 IEC 60794-4 IEC 60794-4-20
(5) Additional references:		
(6) Cable description:		
(7) Cable construction:		
<u>Optical fibres</u>		Additional remarks
<u>Range of fibre count</u>		
Modularity		
<u>Construction</u> - Loose tube – filled - Loose tube – unfilled - Slotted core – filled - Slotted core – unfilled - Ribbon in slotted core - Ribbon in loose tube - Central (strength) member – non metallic - Core filling – regular water blocking - Core filling – water swell able materials		
<u>Lay-up</u> - Stranding (helical or SZ) - Single unit		
(7) Cable construction (continued) Inner sheath Peripheral strength member - Non-metallic Moisture barrier Outer sheath Armouring - Non-metallic armouring Outer protection - Polyethylene sheath - Performance of tracking resistant sheath Marking identification - Customer requirement - Identification of manufacturer		Additional remarks

(8) Application information:	
General	
Maximum outer diameter (d)	mm
Installation load (MIT)	N
Allowed short term load (MAT)	N
Zero strain margin	N
Minimum bending radius for no load bending	mm or nxd
Minimum bending radius for rated load bending	mm or nxd
Temperature range:	
- Transport and storage	°C
- Installation	°C
- Operation	°C
Cable weight	kg/km
Manufacturing cable length	
- Typical	m
- Nominal /tolerances	-0 %, +1 %
- Modulus of elasticity	kPa
- Coefficient of linear expansion	10-6/°C
- Creep behaviour	%
Particular (cables designed for specific projects)	
- Ice thickness	mm
- Wind speed	km/h
- Maximum span distance while under the maximum weather load	m
- Minimum sag for maximum span (not exceeding MAT under weather load)	m or %

IECNORM.COM : Click to view the full PDF of IEC 60794-4-20:2018 RLV

Bibliography

IEC 60060-1:2010, *High-voltage test techniques – Part 1: General definitions and test requirements*

IEC 60794-1-2, *Optical fibre cables – Part 1-2: Generic specification – Basic optical cable test procedures – General guidance*

IEC 60794-3-20, *Optical fibre cables – Part 3-20: Outdoor cables – Family specification for self-supporting aerial telecommunication cables*

IEC 60794-4 (all parts), *Optical fibre cables – Part 4: Sectional specification – Aerial optical cables along electrical power lines*

IEC 61395, *Overhead electrical conductors – Creep test procedures for stranded conductors*

IEC 61935 (all parts), *Specification for the testing of balanced and coaxial information technology cabling*

IEC TR 62263, *Live working – Guidelines for the installation and maintenance of optical fibre cables on overhead power lines*

IEC TR 62362, *Selection of optical fibre cable specifications relative to mechanical, ingress, climatic or electromagnetic characteristics – Guidance*

IEEE Std1222TM-2011, *IEEE standard for testing and performance for all-dielectric self-supporting (ADSS) fiber optic cable for use on electric utility power lines*

IECNORM.COM : Click to view the full PDF of IEC 60794-4-20:2018 PLV

IECNORM.COM : Click to view the full PDF of IEC 60794-4-20:2018 RLV

SOMMAIRE

AVANT-PROPOS.....	30
1 Domaine d'application.....	32
2 Références normatives	32
3 Termes, définitions et termes abrégés.....	33
4 Fibres optiques.....	33
5 Eléments de câble	33
6 Constructions de câble à fibres optiques	33
6.1 Généralités	33
6.2 Eléments de protection de câbles	33
7 Exigences principales relatives aux conditions d'installation et de fonctionnement	34
8 Considérations sur la conception des câbles	34
9 Essais du câble	35
9.1 Généralités	35
9.2 Performance en traction	35
9.2.1 Généralités	35
9.2.2 Exigence de famille.....	35
9.2.3 Conditions d'essai.....	35
9.3 Essai de passage sur poulies	36
9.3.1 Généralités	36
9.3.2 Exigence de famille.....	36
9.3.3 Conditions d'essai.....	36
9.4 Courbures répétées.....	36
9.4.1 Généralités	36
9.4.2 Exigences de famille.....	36
9.4.3 Conditions d'essai.....	36
9.5 Impact	37
9.5.1 Généralités	37
9.5.2 Exigences de famille.....	37
9.5.3 Conditions d'essai.....	37
9.6 Ecrasement.....	37
9.6.1 Généralités	37
9.6.2 Exigences relatives aux essais.....	37
9.6.3 Conditions d'essai.....	37
9.7 Torsion	37
9.7.1 Généralités	37
9.7.2 Exigences relatives aux essais.....	38
9.8 Essai de vibration éolienne.....	38
9.8.1 Généralités	38
9.8.2 Exigences de famille.....	38
9.8.3 Conditions d'essai.....	38
9.8.4 Paramètres à consigner	38
9.9 Essai de vibration à basse fréquence (essai de galop).....	38
9.9.1 Généralités	38
9.9.2 Exigences de famille.....	38
9.9.3 Conditions d'essai.....	38

9.10	Cycles de température	39
9.10.1	Généralités	39
9.10.2	Exigences de famille	39
9.10.3	Conditions d'essai	39
9.11	Pénétration d'eau	39
9.12	Résistance du câble aux UV	39
9.13	Essai de résistance au cheminement et à l'érosion	40
9.14	Fluage	40
9.15	Compatibilité des armatures	40
10	Assurance de la qualité.....	41
Annexe A (informative) Emballage et marquage		42
Annexe B (informative) Considérations sur l'installation de câbles ADSS		43
Annexe C (informative) Essai électrique (cheminement)		45
C.1	Généralités	45
C.2	Option C2 – Qualification de matériaux de gaine.....	45
C.2.1	Aperçu	45
C.2.2	Montage d'essai	45
C.2.3	Procédure d'essai	46
C.2.4	Exigences	46
C.3	Option C3 – Niveau de pollution et résistance au cheminement.....	46
C.3.1	Aperçu	46
C.3.2	Montage d'essai	47
C.3.3	Méthode d'essai	49
C.3.4	Présentation du modèle de pollution et de l'essai électrique.....	49
Annexe D (informative) Câbles autoporteurs entièrement diélectriques (ADSS) à utiliser dans des lignes aériennes de puissance (spécification particulière-cadre).....		51
Bibliographie		53
Figure B.1 – Exemple de différentes longueurs de portée autorisées pour le même câble, en fonction de la variation du fléchissement		44
Figure C.1 – Schéma électrique de l'essai		47
Figure C.2 – Feuilles des électrodes		47
Figure C.3 – Buse.....		48
Figure C.4 – Détails de la pulvérisation		49
Figure C.5 – Modèle d'éléments distribués avec espace de formation d'arcs le long de zones sèches		50
Figure C.6 – Circuit équivalent de Thévenin		50
Tableau 1 – Caractéristiques de conception du câble		34
Tableau 2 – Paramètres facultatifs (si exigés par le client).....		35
Tableau C.1 – Valeurs de R_{eq} et C_{eq} pour différentes valeurs d'indice de pollution.....		49
Tableau D.1 – Spécification particulière-cadre.....		51

COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

CÂBLES À FIBRES OPTIQUES –

Partie 4-20: Spécification intermédiaire – Câbles optiques aériens le long des lignes électriques de puissance – Spécification de famille pour les câbles optiques autoporteurs entièrement diélectriques (ADSS)

AVANT-PROPOS

- 1) La Commission Electrotechnique Internationale (IEC) est une organisation mondiale de normalisation composée de l'ensemble des comités électrotechniques nationaux (Comités nationaux de l'IEC). L'IEC a pour objet de favoriser la coopération internationale pour toutes les questions de normalisation dans les domaines de l'électricité et de l'électronique. A cet effet, l'IEC – entre autres activités – publie des Normes internationales, des Spécifications techniques, des Rapports techniques, des Spécifications accessibles au public (PAS) et des Guides (ci-après dénommés "Publication(s) de l'IEC"). Leur élaboration est confiée à des comités d'études, aux travaux desquels tout Comité national intéressé par le sujet traité peut participer. Les organisations internationales, gouvernementales et non gouvernementales, en liaison avec l'IEC, participent également aux travaux. L'IEC collabore étroitement avec l'Organisation Internationale de Normalisation (ISO), selon des conditions fixées par accord entre les deux organisations.
- 2) Les décisions ou accords officiels de l'IEC concernant les questions techniques représentent, dans la mesure du possible, un accord international sur les sujets étudiés, étant donné que les Comités nationaux de l'IEC intéressés sont représentés dans chaque comité d'études.
- 3) Les Publications de l'IEC se présentent sous la forme de recommandations internationales et sont agréées comme telles par les Comités nationaux de l'IEC. Tous les efforts raisonnables sont entrepris afin que l'IEC s'assure de l'exactitude du contenu technique de ses publications; l'IEC ne peut pas être tenue responsable de l'éventuelle mauvaise utilisation ou interprétation qui en est faite par un quelconque utilisateur final.
- 4) Dans le but d'encourager l'uniformité internationale, les Comités nationaux de l'IEC s'engagent, dans toute la mesure possible, à appliquer de façon transparente les Publications de l'IEC dans leurs publications nationales et régionales. Toutes divergences entre toutes Publications de l'IEC et toutes publications nationales ou régionales correspondantes doivent être indiquées en termes clairs dans ces dernières.
- 5) L'IEC elle-même ne fournit aucune attestation de conformité. Des organismes de certification indépendants fournissent des services d'évaluation de conformité et, dans certains secteurs, accèdent aux marques de conformité de l'IEC. L'IEC n'est responsable d'aucun des services effectués par les organismes de certification indépendants.
- 6) Tous les utilisateurs doivent s'assurer qu'ils sont en possession de la dernière édition de cette publication.
- 7) Aucune responsabilité ne doit être imputée à l'IEC, à ses administrateurs, employés, auxiliaires ou mandataires, y compris ses experts particuliers et les membres de ses comités d'études et des Comités nationaux de l'IEC, pour tout préjudice causé en cas de dommages corporels et matériels, ou de tout autre dommage de quelque nature que ce soit, directe ou indirecte, ou pour supporter les coûts (y compris les frais de justice) et les dépenses découlant de la publication ou de l'utilisation de cette Publication de l'IEC ou de toute autre Publication de l'IEC, ou au crédit qui lui est accordé.
- 8) L'attention est attirée sur les références normatives citées dans cette publication. L'utilisation de publications référencées est obligatoire pour une application correcte de la présente publication.
- 9) L'attention est attirée sur le fait que certains des éléments de la présente publication de l'IEC peuvent faire l'objet de droits de brevet. L'IEC ne saurait être tenue pour responsable de ne pas avoir identifié de tels droits de brevets et de ne pas avoir signalé leur existence.

La Norme internationale IEC 60794-4-20 a été établie par le sous-comité 86A: Fibres et câbles, du comité d'études 86 de l'IEC: Fibres optiques.

Cette deuxième édition annule et remplace la première édition parue en 2012 dont elle constitue une révision technique.

La présente édition inclut les modifications techniques majeures suivantes par rapport à l'édition précédente:

- a) le présent document a été simplifié par établissement de correspondances avec les normes IEC 60794-1-1, IEC 60794-4 (toutes les parties) et IEC 60794-1-2;
- b) la référence au tableau MICE a été supprimée;

c) l'exemple de méthode d'essai pour un environnement particulier à l'Annexe C a été supprimé;

Le texte de cette Norme internationale est issu des documents suivants:

FDIS	Rapport de vote
86A/1867/FDIS	86A/1876/RVD

Le rapport de vote indiqué dans le tableau ci-dessus donne toute information sur le vote ayant abouti à l'approbation de cette Norme internationale.

Ce document a été rédigé selon les Directives ISO/IEC, Partie 2.

Une liste de toutes les parties de la série IEC 60794, publiées sous le titre général *Câbles à fibres optiques*, peut être consultée sur le site web de l'IEC.

Le comité a décidé que le contenu de ce document ne sera pas modifié avant la date de stabilité indiquée sur le site web de l'IEC sous "<http://webstore.iec.ch>" dans les données relatives à la publication recherchée. A cette date, le document sera

- reconduit,
- supprimé,
- remplacé par une édition révisée, ou
- amendé.

IMPORTANT – Le logo "colour inside" qui se trouve sur la page de couverture de cette publication indique qu'elle contient des couleurs qui sont considérées comme utiles à une bonne compréhension de son contenu. Les utilisateurs devraient, par conséquent, imprimer cette publication en utilisant une imprimante couleur.

CÂBLES À FIBRES OPTIQUES –

Partie 4-20: Spécification intermédiaire – Câbles optiques aériens le long des lignes électriques de puissance – Spécification de famille pour les câbles optiques autoporteurs entièrement diélectriques (ADSS)

1 Domaine d'application

La présente partie de l'IEC 60794-4, qui est une spécification de famille, couvre les câbles optiques de télécommunication généralement équipés de fibres unimodales¹, utilisés principalement dans des applications le long des lignes aériennes à haute tension. Les câbles peuvent également être utilisés dans d'autres réseaux de services aériens, tels que des services de téléphonie ou de télévision. Les exigences de la spécification intermédiaire IEC 60794-4 pour des câbles optiques aériens le long de lignes électriques de puissance sont applicables aux câbles couverts par le présent document.

Le présent document couvre la construction, les performances mécaniques, électriques et optiques, les lignes directrices relatives à l'installation, les critères d'acceptation, les exigences relatives aux essais, les considérations sur l'environnement et la compatibilité des accessoires pour câble fibronique autoporteur entièrement diélectrique (ADSS: *all dielectric self-supporting*). Le présent document fournit des exigences de performances et de construction qui garantissent, par les lignes directrices du présent document, que sont maintenus l'intégrité mécanique exigée des composants du câble ainsi que les paramètres de transmission et la fiabilité mécanique des fibres optiques.

Le câble ADSS est constitué de fibres optiques unimodales contenues dans une ou plusieurs unités fibroniques diélectriques de protection entourées de, ou fixées à des gaines et des éléments de rigidité diélectrique appropriée. Le câble ne contient pas de composants métalliques. Un câble ADSS est conçu pour satisfaire aux exigences mécaniques et optiques dans différentes conditions d'installations, de fonctionnement et d'environnement et pour différentes charges, comme cela est décrit à l'Annexe B.

Le présent document exclut les câbles OPAC "lacés" ou "enroulés" inclus dans l'IEC 60794-4. Les câbles aériens figure-8 sont également exclus; ils sont spécifiés dans l'IEC 60794-3-20.

2 Références normatives

Les documents suivants cités dans le texte constituent, pour tout ou partie de leur contenu, des exigences du présent document. Pour les références datées, seule l'édition citée s'applique. Pour les références non datées, la dernière édition du document de référence s'applique (y compris les éventuels amendements).

IEC 60793-2, *Fibres optiques – Partie 2: Spécifications de produits – Généralités*

IEC 60793-2-50, *Fibres optiques – Partie 2-50: Spécifications de produits – Spécification intermédiaire pour les fibres unimodales de classe B*

IEC 60794-1-1, *Câbles à fibres optiques – Partie 1: Spécification générique – Généralités*

¹ Dans des situations particulières de l'industrie électrique, de courtes liaisons aériennes peuvent également être conçues avec des fibres multimodales.

IEC 60794-1-21:2015, *Optical fibre cables – Part 1-21: Generic specification – Basic optical cable test procedures – Mechanical test methods* (disponible en anglais seulement)

IEC 60794-1-22, *Optical fibre cables – Part 1-22: Generic specification – Basic optical cable test procedures – Environmental test methods* (disponible en anglais seulement)

IEC 60794-4, *Câbles à fibres optiques – Partie 4: Spécification intermédiaire – Câbles optiques aériens le long des lignes électriques de puissance*

ISO 9001, *Systèmes de management de la qualité – Exigences*

3 Termes, définitions et termes abrégés

Pour les besoins du présent document, les termes, définitions et termes abrégés donnés dans l'IEC 60794-1-1 et dans l'IEC 60794-4 s'appliquent.

L'ISO et l'IEC tiennent à jour des bases de données terminologiques destinées à être utilisées en normalisation, consultables aux adresses suivantes:

- IEC Electropedia: disponible à l'adresse <http://www.electropedia.org/>
- ISO Online browsing platform: disponible à l'adresse <http://www.iso.org/obp>

4 Fibres optiques

Les fibres optiques unimodales utilisées doivent être conformes aux exigences de l'IEC 60793-2-50. D'autres types de fibres peuvent faire l'objet d'un accord entre le client et le fournisseur; de telles fibres doivent être conformes à l'IEC 60793-2. La fibre câblée doit être conforme à l'IEC 60794-4.

5 Éléments de câble

Se reporter aux parties applicables de la spécification intermédiaire IEC 60794-4.

6 Constructions de câble à fibres optiques

6.1 Généralités

La construction et les caractéristiques des éléments de câble doivent être conformes à l'IEC 60794-4. Le câble ne doit pas contenir de matériaux métalliques.

6.2 Éléments de protection de câbles

Outre l'unité optique, la construction d'un câble peut présenter les caractéristiques suivantes.

- a) La gaine extérieure doit être faite d'un matériau de type résistant aux intempéries. Dans certaines conditions, il doit être nécessaire d'envisager l'utilisation d'une gaine résistant aux cheminements.
- b) Un câble ADSS doit contenir des systèmes autoporteurs qui font partie intégrante du câble. Le but du système de soutien est de garantir que le câble satisfait aux exigences optiques à des températures, une charge environnementale et des conditions d'installation spécifiées, pour toute sa durée de vie de fonctionnement.
- c) La construction annulaire de base peut comporter des fils résistants (par exemple des fils en aramide) ou d'autres mèches diélectriques ou tiges diélectriques comme structure de soutien. Un unique axe central diélectrique, cannelé pour accueillir les éléments optiques, est également accepté.

- d) Le câble doit être conçu de telle sorte que la déformation de la fibre ne dépasse pas la limite autorisée par le fabricant de câbles dans les limites de tension de conception du câble (MAT). La déformation maximale admissible de la fibre sous la condition de la MAT doit être $\leq 0,2 \%$ pour des fibres soumises aux essais d'épreuve de 0,69 GPa.

NOTE Dans certains pays, une exigence spéciale sur la résistance aux plombs de chasse peut être spécifiée pour les câbles aériens. Les câbles ADSS couverts par le présent document ne sont pas conçus pour une telle condition. Les câbles avec une protection en textile renforcée pourraient cependant satisfaire à la condition diélectrique, mais une augmentation du diamètre et du poids rendrait nécessaire une amélioration importante des performances en traction du câble.

7 Exigences principales relatives aux conditions d'installation et de fonctionnement

Les conditions de fonctionnement sont particulièrement importantes pour les câbles ADSS.

Les conditions d'installation et de fonctionnement doivent faire l'objet d'un accord entre client et fournisseur. Pour le câble ADSS, il convient qu'une étude détaillée des conditions sur le terrain et un certain niveau de support technique fourni par un expert indépendant ou par le fournisseur précèdent l'accord. L'Annexe B fournit une vue générale de telles considérations.

Les types d'armatures et de matériels utilisés pour fixer le câble ADSS aux structures doivent faire l'objet d'un accord entre le client et le fournisseur. Leur compatibilité doit être vérifiée conformément au 9.15 et aux spécifications de produits des armatures.

8 Considérations sur la conception des câbles

Le Tableau 1 regroupe les caractéristiques d'un câble qui peuvent être des spécifications importantes à la fois pour le client et pour le fournisseur. Le Tableau 2 inclut des paramètres techniques facultatifs importants pour la conception et l'installation de la ligne aérienne avec un câble ADSS. D'autres caractéristiques peuvent faire l'objet d'un accord entre le client et le fournisseur. Une spécification-cadre complète est présentée à l'Annexe D.

Tableau 1 – Caractéristiques de conception du câble

Réf.	Caractéristiques	Unités
4	Nombre et types de fibres	NA
-	Modularité de l'âme de câble	NA
6	Description détaillée de la construction du câble	NA
-	Diamètre extérieur du câble	mm
	Poids du câble	kg/km
9.2	Tension maximale admissible (MAT: <i>maximum allowable tension</i>)	kN
9-10	Température admissible pour le stockage, l'installation et le fonctionnement	°C
9.3	Diamètre de courbure minimal au cours de l'installation	mm
9.4	Diamètre de courbure minimal après installation	mm

Tableau 2 – Paramètres facultatifs (si exigés par le client)

Réf.	Caractéristiques	Unités
9.13	Charge (ou fléchissement) maximal d'installation (MIT: <i>maximum installation tension</i>)	kN
-	Module d'élasticité	MPa
-	Coefficient de dilatation thermique	10 ⁻⁶ /°C
9.2	Déformation de la fibre à la MAT	%
Annexe B	Marge de déformation nulle	kN
	Condition de charge d'environnement – Référence au code d'installation local ou régional	NA
	Portée et fléchissement recommandés dans les limites de la MAT	m/%
C.3	Potentiel d'espace maximal d'exposition du câble ADSS (généralement spécifiée pour un environnement faiblement pollué sauf spécification contraire par le client)	kV

9 Essais du câble

9.1 Généralités

Dans les essais mécaniques, le critère optique général est: pas de variation de l'affaiblissement, comme cela est décrit dans l'IEC 60794-1-1 et l'IEC 60794-4.

Dans certains essais d'environnement et d'installation, une augmentation est acceptée. Il s'agit de l'essai de passage sur poulie, l'essai de vibration éolienne et l'essai de galop.

Le nombre de fibres soumises aux essais doit être représentatif de la conception du câble conformément à l'échantillonnage de fibres indiqué dans l'IEC 60794-1-1. Un échantillonnage différent peut faire l'objet d'un accord entre le client et le fournisseur.

Les essais applicables aux câbles aériens sont énumérés ci-dessous. Les critères minimaux d'acceptation pour les différentes conceptions de câbles doivent être donnés dans les spécifications de produits.

9.2 Performance en traction

9.2.1 Généralités

Il convient de soumettre le câble aux essais conformément à la méthode E.1 de l'IEC 60794-1-21. Dans cet essai, les câbles doivent satisfaire à la valeur de tension maximale admissible (MAT) spécifiée.

9.2.2 Exigence de famille

Lorsque la charge MAT est appliquée, il doit en résulter l'absence de variation de l'affaiblissement mesuré à 1 550 nm, et la déformation de la fibre doit être ≤ 0,2 % pour des fibres soumises à des essais d'épreuve de 0,69 GPa. D'autres valeurs peuvent faire l'objet d'un accord entre le client et le fournisseur.

NOTE Des valeurs limites de déformation pour des fibres avec différentes valeurs d'essai d'épreuve sont à l'étude.

9.2.3 Conditions d'essai

- Montage d'essai sur un chemin droit conforme à la Figure 1 de l'IEC 60794-1-21:2015 (tourements et poulies ne sont pas autorisés).

- Le câble doit être terminé par des armatures d'ancrage appropriées.
- Longueur d'échantillon minimale de 25 m.
- MAT maintenue pendant 1 h.
- Les fibres doivent être bouclées par épissures de telle sorte qu'une fibre d'au moins 100 m soit soumise à essai.

9.3 Essai de passage sur poulies

9.3.1 Généralités

Le câble doit être soumis aux essais selon la méthode E18B de l'IEC 60794-1-21.

9.3.2 Exigence de famille

Augmentation permanente maximale de l'affaiblissement: 0,10 dB à 1 550 nm.

Pas de dommage physique sur les éléments du câble.

9.3.3 Conditions d'essai

- Méthode E18B de l'IEC 60794-1-21, procédure 1 ou 2.
- Niveau de tension appliqué pendant l'essai: charge de déroulage maximale (ou MIT).
- Longueur du câble: 9 m minimum. Longueur courbée en tension: 2 m.
- Il convient que le câble soit terminé par les armatures d'ancrage recommandées.
- Les fibres doivent être bouclées par épissures de telle sorte qu'une fibre d'au moins 100 m soit soumise à essai.
- Diamètre (D) des rouleaux/cylindres: \geq diamètre de courbure minimal du fabricant (environ ≥ 40 fois le diamètre extérieur du câble est recommandé).
- Angle de courbure: $45^\circ \pm 15^\circ$.
- Vitesse de déplacement: $1 \text{ m/s} \leq \text{vitesse} \leq 10 \text{ m/s}$.
- Nombre de cycles de déplacement complets: 20.

9.4 Courbures répétées

9.4.1 Généralités

Le câble doit être soumis aux essais conformément à la méthode E6 spécifiée dans l'IEC 60794-1-21.

9.4.2 Exigences de famille

Pendant l'examen visuel sans grossissement, la gaine ou les éléments du câble ne doivent pas présenter de dommage. Il ne doit pas y avoir de variation de l'affaiblissement à 1 550 nm à la fin de l'essai.

9.4.3 Conditions d'essai

- Rayon de courbure: 20 d.
- Nombre de cycles: 25.

Des conditions particulières peuvent faire l'objet d'un accord entre le client et le fournisseur.