

INTERNATIONAL STANDARD

NORME INTERNATIONALE

**Connectors for electrical and electronic equipment – Product requirements –
Part 8-104: Power connectors – Detail specification for 2-pole circular
connectors with 40 A rated current and push-pull locking IP65/IP67 with metal
housing**

**Connecteurs pour équipements électriques et électroniques – Exigences de
produit –**

**Partie 8-104: Connecteurs d'alimentation – Spécification particulière relative aux
connecteurs circulaires bipolaires avec un courant assigné de 40 A et un
mécanisme de verrouillage de type pousser-tirer IP65/IP67, logés dans un boîtier
métallique**



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2023 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Secretariat
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 300 terminological entries in English and French, with equivalent terms in 19 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Recherche de publications IEC -

webstore.iec.ch/advsearchform

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études, ...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et une fois par mois par email.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch

Découvrez notre puissant moteur de recherche et consultez gratuitement tous les aperçus des publications. Avec un abonnement, vous aurez toujours accès à un contenu à jour adapté à vos besoins.

Electropedia - www.electropedia.org

Le premier dictionnaire d'électrotechnologie en ligne au monde, avec plus de 22 300 articles terminologiques en anglais et en français, ainsi que les termes équivalents dans 19 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

INTERNATIONAL STANDARD

NORME INTERNATIONALE

**Connectors for electrical and electronic equipment – Product requirements –
Part 8-104: Power connectors – Detail specification for 2-pole circular
connectors with 40 A rated current and push-pull locking IP65/IP67 with metal
housing**

**Connecteurs pour équipements électriques et électroniques – Exigences de
produit –
Partie 8-104: Connecteurs d'alimentation – Spécification particulière relative aux
connecteurs circulaires bipolaires avec un courant assigné de 40 A et un
mécanisme de verrouillage de type pousser-tirer IP65/IP67, logés dans un boîtier
métallique**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

ICS 31.220.10

ISBN 978-2-8322-6844-5

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD.....	5
1 Scope.....	8
2 Normative references	8
3 Terms and definitions	11
4 Technical information	11
4.1 Recommended method of termination	11
4.1.1 General	11
4.1.2 Number of contacts and contact cavities	11
4.2 Ratings and characteristics	11
4.3 Systems of levels	12
4.3.1 Performance levels	12
4.3.2 Compatibility levels	12
4.4 Classification into climatic categories	12
4.5 Creepage and clearance distances	12
4.6 Current-carrying capacity	12
4.7 Marking.....	12
5 Dimensional information	12
5.1 General.....	12
5.2 Isometric view and common features	12
5.2.1 General	12
5.2.2 Isometric view of free connector	13
5.2.3 Isometric view of fixed connector	13
5.3 Free connector.....	13
5.3.1 General	13
5.3.2 Dimensions.....	14
5.3.3 Terminations.....	15
5.4 Fixed connector	15
5.4.1 Dimensions (see Figure 4 and Table 2)	15
5.4.2 Terminations.....	16
5.5 Mounting information for connectors	16
5.6 Gauges – Sizing gauges and retention force gauges.....	16
6 Technical characteristics	16
6.1 Classification into climatic categories.....	16
6.2 Electrical characteristics	16
6.2.1 Creepage and clearance distances	16
6.2.2 Voltage proof.....	17
6.2.3 Current-carrying capacity.....	17
6.2.4 Electrical load and temperature	17
6.2.5 Contact resistance	18
6.2.6 Housing electrical continuity	18
6.2.7 Insulation resistance	18
6.3 Mechanical characteristics	18
6.3.1 Mechanical operation.....	18
6.3.2 Effectiveness of connector coupling devices	18
6.3.3 Gauge retention force (resilient contact)	18
6.3.4 Engaging and separating forces.....	19

6.3.5	Contact retention in insert.....	19
6.3.6	Polarizing and keying method.....	19
6.4	Dynamic stress tests.....	19
6.4.1	Vibration (sine).....	19
6.4.2	Shock.....	19
6.4.3	Free fall (repeated).....	20
6.4.4	IP degree of protection.....	20
6.4.5	Glow-wire flammability test method for end-products (GWEPT).....	20
6.5	Climatic tests.....	20
6.5.1	Rapid change of temperature.....	20
6.5.2	Dry heat.....	20
6.5.3	Low temperature.....	20
6.5.4	Low air pressure.....	21
6.5.5	Damp heat, cyclic.....	21
6.5.6	Damp heat, steady state.....	21
6.5.7	Corrosion, salt mist.....	21
6.5.8	Flowing mixed gas corrosion.....	21
6.6	Environmental aspects.....	21
6.6.1	Marking of insulation material (plastic).....	21
6.6.2	Design/use of material.....	21
7	Test schedule.....	22
7.1	General.....	22
7.2	Test schedules.....	22
7.2.1	Basic (minimum) test schedule.....	22
7.2.2	Full test schedule.....	22
7.3	Test procedures and measurement methods.....	33
7.4	Pre-conditioning.....	33
7.5	Wiring and mounting of test specimens.....	33
7.5.1	Wiring.....	33
7.5.2	Mounting.....	33
	Figure 1 – Free connector.....	13
	Figure 2 – Fixed connector.....	13
	Figure 3 – Free connector.....	14
	Figure 4 – Fixed connector.....	15
	Figure 5 – Gauge for contact.....	16
	Figure 6 – Current-temperature derating (6 mm ² wire size).....	17
	Table 1 – Free connector dimensions.....	14
	Table 2 – Fixed connector dimensions.....	15
	Table 3 – Gauge dimensions.....	16
	Table 4 – Climatic category.....	16
	Table 5 – Voltage proof.....	17
	Table 6 – Number of test specimens.....	22
	Table 7 – Test group P.....	23
	Table 8 – Test group AP.....	24

Table 9 – Test group BP	27
Table 10 – Test group CP	29
Table 11 – Test group DP	30
Table 12 – Test group EP	32
Table 13 – Test group GP	32

IECNORM.COM : Click to view the full PDF of IEC 61076-8-104:2023

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**CONNECTORS FOR ELECTRICAL AND ELECTRONIC EQUIPMENT –
PRODUCT REQUIREMENTS –****Part 8-104: Power connectors –****Detail specification for 2-pole circular connectors with 40 A
rated current and push-pull locking IP65/IP67 with metal housing**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

IEC 61076-8-104 has been prepared by subcommittee 48B: Electrical connectors, of IEC technical committee 48: Electrical connectors and mechanical structures for electrical and electronic equipment. It is an International Standard.

The text of this International Standard is based on the following documents:

Draft	Report on voting
48B/2953/CDV	48B/2991/RVC

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this International Standard is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/publications.



A list of all parts of IEC 61076 series, under the general title *Connectors for electrical and electronic equipment – Product requirements*, can be found on the IEC website.

Future standards in this series will carry the new general title as cited above. Titles of existing standards in this series will be updated at the time of the next edition.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IECNORM.COM : Click to view the full PDF of IEC 61076-8-104:2023

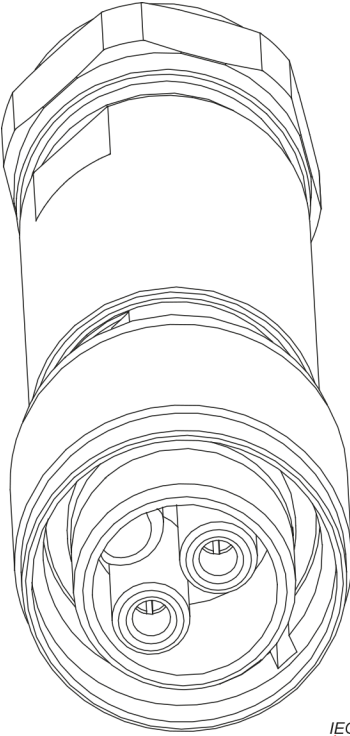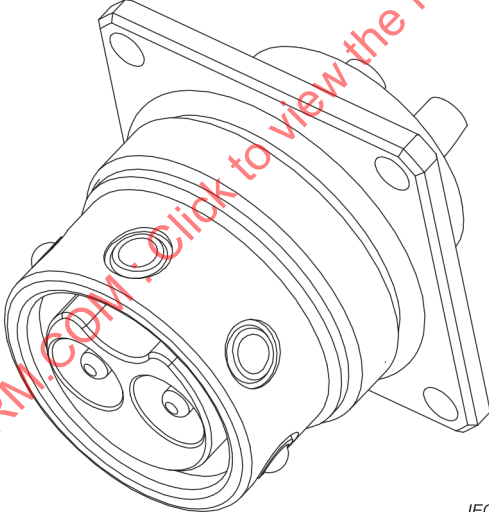The International Electrotechnical Commission IEC SC 48B – Electrical connectors		IEC 61076-8-104
Detail specification in accordance with IEC 61076-8		
Free connector	 IEC	For rated current of 40 A; 2-pole; Female contacts; Push-pull locking; 360° shielding.
Fixed connector	 IEC	For rated current of 40 A; 2-pole; Male contacts; Push-pull locking; 360° shielding.

CONNECTORS FOR ELECTRICAL AND ELECTRONIC EQUIPMENT – PRODUCT REQUIREMENTS –

Part 8-104: Power connectors – Detail specification for 2-pole circular connectors with 40 A rated current and push-pull locking IP65/IP67 with metal housing

1 Scope

This part of IEC 61076-8 describes free and fixed 2-pole circular power connectors with 40 A rated current, rated voltage up to and including 50 V AC/DC, and push-pull locking IP65/IP67 metal housings (hereinafter referred to as connectors) for use in electrical and electronic equipment. It includes overall dimensions, interface dimensions, technical characteristics, performance requirements and test methods.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60050-581, *International Electrotechnical Vocabulary (IEV) – Part 581: Electromechanical components for electronic equipment*

IEC 60068-1, *Environmental testing – Part 1: General and guidance*

IEC 60068-2-60, *Environmental testing – Part 2-60: Tests – Test Ke: Flowing mixed gas corrosion test*

IEC 60228, *Conductors of insulated cables*

IEC 60352-2, *Solderless connections – Part 2: Crimped connections – General requirements, test methods and practical guidance*

IEC 60352-3, *Solderless connections – Part 3: Accessible insulation displacement (ID) connections – General requirements, test methods and practical guidance*

IEC 60352-4, *Solderless connections – Part 4: Non-accessible insulation displacement (ID) connections – General requirements, test methods and practical guidance*

IEC 60352-5, *Solderless connections – Part 5: Press-in connections – General requirements, test methods and practical guidance*

IEC 60352-6, *Solderless connections – Part 6: Insulation piercing connections – General requirements, test methods and practical guidance*

IEC 60352-7, *Solderless connections – Part 7: Spring clamp connections – General requirements, test methods and practical guidance*

IEC 60512-1-1, *Connectors for electronic equipment – Tests and measurements – Part 1-1: General examination-Test 1a: Visual examination*

IEC 60512-1-2, *Connectors for electronic equipment – Tests and measurements – Part 1-2: General examination-Test 1b: Examination of dimension and mass*

IEC 60512-2-1, *Connectors for electronic equipment – Tests and measurements – Part 2-1: Electrical continuity and contact resistance tests – Test 2a: Contact resistance – Millivolt level method*

IEC 60512-2-2, *Connectors for electronic equipment – Tests and measurements – Part 2-2: Electrical continuity and contact resistance tests – Test 2b: Contact resistance – Specified test current method*

IEC 60512-2-5, *Connectors for electronic equipment – Tests and measurements – Part 2-5: Electrical continuity and contact resistance tests – Test 2e: Contact disturbance*

IEC 60512-2-6, *Connectors for electronic equipment – Tests and measurements – Part 2-6: Electrical continuity and contact resistance tests – Test 2f: Housing (shell) electrical continuity*

IEC 60512-3-1, *Connectors for electronic equipment – Tests and measurements – Part 3-1: Insulation tests – Test 3a: Insulation resistance*

IEC 60512-4-1, *Connectors for electronic equipment – Tests and measurements – Part 4-1: Voltage stress tests – Test 4a: Voltage proof*

IEC 60512-5-2, *Connectors for electronic equipment – Tests and measurements – Part 5-2: Current-carrying capacity tests – Test 5b: Current-temperature derating*

IEC 60512-6-3, *Connectors for electronic equipment – Tests and measurements – Part 6-3: Dynamic stress tests – Test 6c: Shock*

IEC 60512-6-4, *Connectors for electronic equipment – Tests and measurements – Part 6-4: Dynamic stress tests – Test 6d: Vibration (sinusoidal)*

IEC 60512-7-1, *Connectors for electronic equipment – Tests and measurements – Part 7-1: Impact tests (free connectors) – Test 7a: Free fall (repeated)*

IEC 60512-9-1, *Connectors for electronic equipment – Tests and measurements – Part 9-1: Endurance tests – Test 9a: Mechanical operation*

IEC 60512-9-2, *Connectors for electronic equipment – Tests and measurements – Part 9-2: Endurance tests – Test 9b: Electrical load and temperature*

IEC 60512-11-1, *Connectors for electrical and electronic equipment – Tests and measurements – Part 11-1: Climatic tests – Test 11a: Climatic sequence*

IEC 60512-11-3, *Connectors for electronic equipment – Tests and measurements – Part 11-3: Climatic tests – Test 11c: Damp heat, steady state*

IEC 60512-11-4, *Connectors for electronic equipment – Tests and measurements – Part 11-4: Climatic tests – Test 11d: Rapid change of temperature*

IEC 60512-11-6, *Connectors for electronic equipment – Tests and measurements – Part 11-6: Climatic tests – Test 11f: Corrosion, salt mist*

IEC 60512-11-7, *Connectors for electronic equipment – Tests and measurements – Part 11-7: Climatic tests – Test 11g: Flowing mixed gas corrosion test*

IEC 60512-11-9, *Connectors for electronic equipment – Tests and measurements – Part 11-9: Climatic tests – Test 11i: Dry heat*

IEC 60512-11-10, *Connectors for electronic equipment – Tests and measurements – Part 11-10: Climatic tests – Test 11j: Cold*

IEC 60512-11-11, *Connectors for electronic equipment – Tests and measurements – Part 11-11: Climatic tests – Test 11k: Low air pressure*

IEC 60512-11-12, *Connectors for electronic equipment – Tests and measurements – Part 11-12: Climatic tests – Test 11m: Damp heat, cyclic*

IEC 60512-13-1, *Connectors for electronic equipment – Tests and measurements – Part 13-1: Mechanical operation tests – Test 13a: Engaging and separating forces*

IEC 60512-13-5, *Connectors for electronic equipment – Tests and measurements – Part 13-5: Mechanical operation tests – Test 13e: Polarizing and keying method*

IEC 60512-15-1, *Connectors for electronic equipment – Tests and measurements – Part 15-1: Connector tests (mechanical) – Test 15a: Contact retention in insert*

IEC 60512-15-6, *Connectors for electronic equipment – Tests and measurements – Part 15-6: Connector tests (mechanical) – Test 15f: Effectiveness of connector coupling devices*

IEC 60512-16-5, *Connectors for electronic equipment – Tests and measurements – Part 16-5: Mechanical tests on contacts and terminations – Test 16e: Gauge retention force (resilient contacts)*

IEC 60512-20-3, *Connectors for electronic equipment – Tests and measurements – Part 20-3: Fire hazard tests – Test 20c: Flammability, glow-wire*

IEC 60529:1989, *Degrees of protection provided by enclosures (IP Code)*

IEC 60529:1989/AMD1:1999

IEC 60529:1989/AMD2:2013

IEC 60664-1:2020, *Insulation coordination for equipment within low-voltage supply systems – Part 1: Principles, requirements and tests*

IEC 60695-2-11:2021, *Fire hazard testing – Part 2-11: Glowing/hot-wire based test methods – Glow-wire flammability test method for end-products (GWEPT)*

IEC 60999-1, *Connecting devices – Electrical copper conductors – Safety requirements for screw-type and screwless-type clamping units – Part 1: General requirements and particular requirements for clamping units for conductors from 0,2 mm² up to 35 mm² (included)*

IEC 61076-1:2006, *Connectors for electronic equipment – Product requirements – Part 1: Generic specification*

IEC 61076-1:2006/AMD1:2019

IEC 61984:2008, *Connectors – Safety requirements and tests*

IEC 62430:2019, *Environmentally conscious design (ECD) – Principles, requirements and guidance*

IEC Guide 109, *Environmental aspects – Inclusion in electrotechnical product standards*

ISO 6508-1, *Metallic materials – Rockwell hardness test – Part 1: Test method*

ISO 11469, *Plastics – Generic identification and marking of plastics products*

ISO 21920-1:2021, *Geometrical product specifications (GPS) – Surface texture: Profile – Part 1: Indication of surface texture*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60050-581 apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

- IEC Electropedia: available at <https://www.electropedia.org/>
- ISO Online browsing platform: available at <https://www.iso.org/obp>

4 Technical information

4.1 Recommended method of termination

4.1.1 General

According to IEC 60352 series or IEC 60999-1.

4.1.2 Number of contacts and contact cavities

Number of contacts: power contacts: 2.

Number of contact cavities (for removable contacts): 2.

Suitable wire: cross-sectional area for power contacts: 4 mm² to 6 mm². The core of each power wire shall be individually shielded, each shielding requiring a dedicated termination.

4.2 Ratings and characteristics

Connectors according to this specification are connectors without breaking capacity (COC) according to IEC 61984, therefore they are not intended to be engaged or disengaged in normal use when live or under load.

Rated voltage: 50 V AC/DC

Rated impulse voltage U_{imp} : 4 kV

Voltage proof: 2 500 V AC

Pollution degree: 2

Rated current (at 85 °C): 40 A. See Figure 6.

Insulation resistance: 5 000 MΩ

Climatic category: 55/125/10

NOTE Whereas the rated impulse voltage U_{imp} corresponding to a rated voltage 50 V AC/DC and overvoltage category III is 0,8 kV (1,5 kV for overvoltage category IV applications) according to IEC 60664-1:2020, Table F.1 (as well as Tables B.1 and B.2), this connector is provided with U_{imp} 4 kV to cover more demanding end-use applications.

4.3 Systems of levels

4.3.1 Performance levels

None specified.

4.3.2 Compatibility levels

The compatibility levels of the products specified by this document shall comply with 2.2.3.3 of IEC 61076-1:2006 (level 2 – intermateable).

4.4 Classification into climatic categories

Classification into climatic category is specified in 6.1.

4.5 Creepage and clearance distances

Creepage and clearance distances shall be as per 6.2.1 of this document (connector without breaking capacity as defined in IEC 61984).

4.6 Current-carrying capacity

Current carrying capacity as specified in 6.2.3.

4.7 Marking

The marking of the connector and the package shall be in accordance with 2.7 of IEC 61076-1:2006.

5 Dimensional information

5.1 General

Dimensions are given in millimetres. Drawings are shown in the first angle projection. The shape of the connectors may deviate from those given in the following drawings as long as the specified dimensions are not influenced.

Missing dimensions shall be chosen according to the common characteristics and intended use.

5.2 Isometric view and common features

5.2.1 General

Figure 1 shows an isometric view of the free connector and Figure 2 shows an isometric view of the fixed connector.

5.2.2 Isometric view of free connector

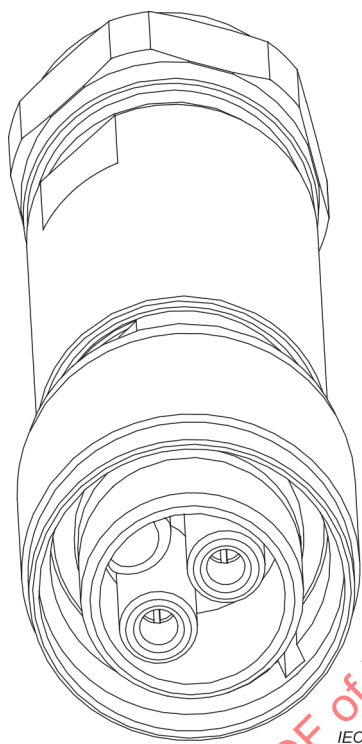


Figure 1 – Free connector

5.2.3 Isometric view of fixed connector

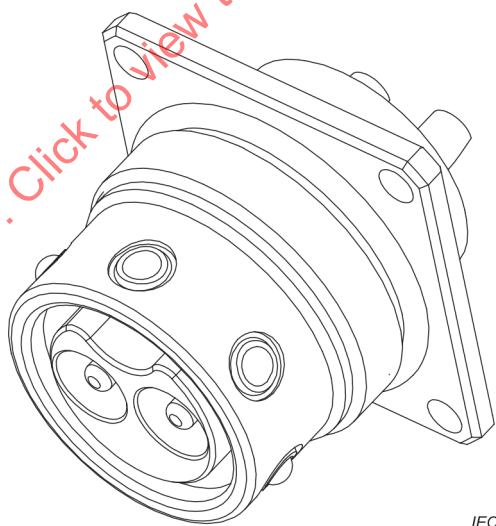


Figure 2 – Fixed connector

5.3 Free connector

5.3.1 General

Figure 3 and Table 1 show drawings and dimensions for the free connector.

5.3.2 Dimensions

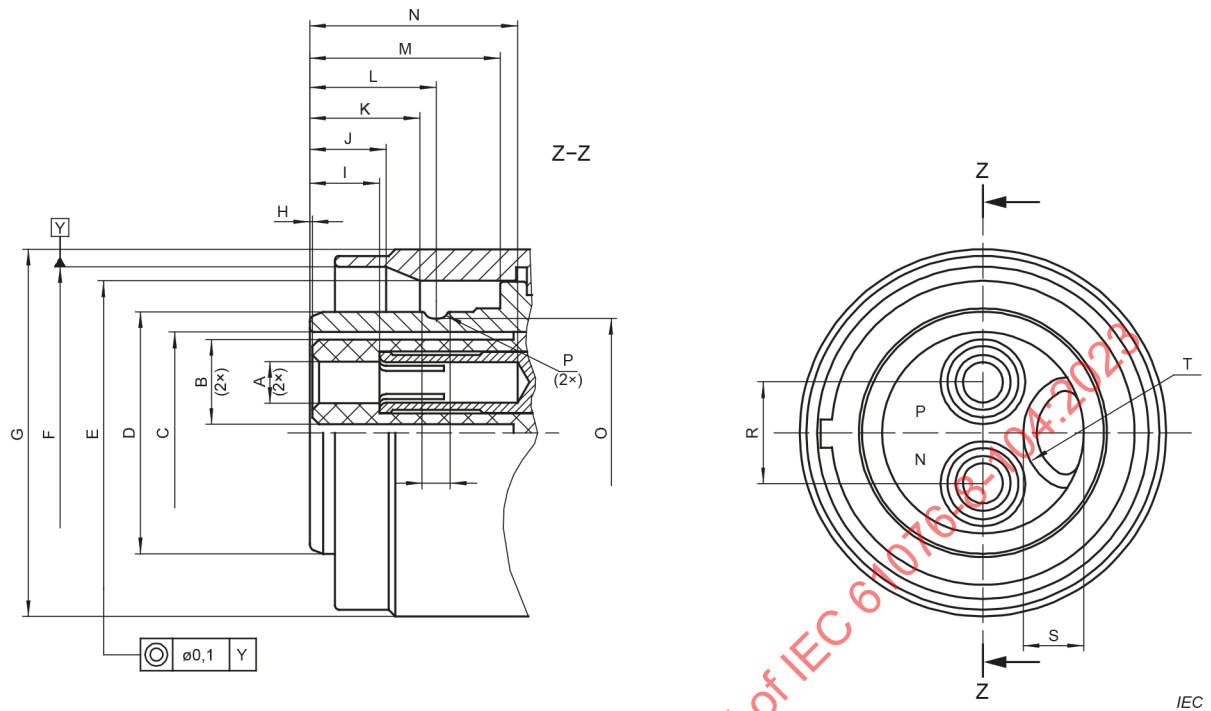


Figure 3 – Free connector

Table 1 – Free connector dimensions

Dimensions in mm			
Letter	Minimum	Nominal	Maximum
A	Φ3,1	Φ3,1	Φ3,2
B	Φ6,2	Φ6,3	Φ6,3
C	Φ15,05	Φ15,10	Φ15,15
D	Φ17,85	Φ17,90	Φ17,90
E	Φ22,6	Φ22,6	Φ22,71
F	Φ24,75	Φ24,80	Φ24,86
G	Φ26,97	Φ27,3	Φ27,3
H	0,2	-	-
I	5,15	5,2	5,25
J	5,65	5,7	5,75
K	8,15	8,2	8,25
L	9,45	9,5	9,55
M	15,2	-	-
N	15,5	-	-
O	Φ16,80	Φ16,85	Φ16,85
P	R0,75	R0,8	R0,85
Q	2,1	2,1	2,2
R	7,475	7,500	7,525
S	4,4	4,5	4,5
T	R4,4	R4,5	R4,5

5.3.3 Terminations

Terminations either according to IEC 60352 series (solderless connections) or according to IEC 60999-1 (screw-type and screwless-type clamping units).

5.4 Fixed connector

5.4.1 Dimensions (see Figure 4 and Table 2)

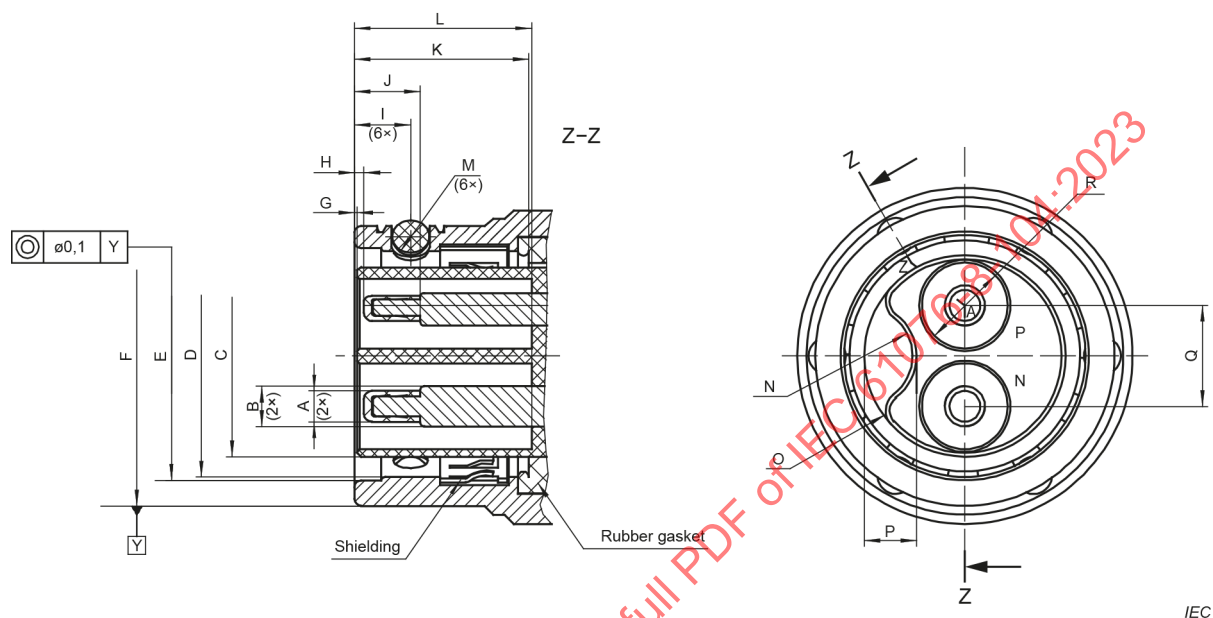


Figure 4 – Fixed connector

Table 2 – Fixed connector dimensions

Dimensions in mm			
Letter	Minimum	Nominal	Maximum
A	Φ2,2	Φ2,3	Φ2,3
B	Φ2,83	Φ2,85	Φ2,87
C	Φ14,9	Φ15	Φ15
D	Φ18,05	Φ18,10	Φ18,16
E	Φ18,53	Φ18,55	Φ18,58
F	Φ22,2	Φ22,3	Φ22,3
G	0,2	-	-
H	0,65	0,7	0,75
I	4,15	4,2	4,25
J	4,85	4,9	4,95
K	12,9	13	13,15
L	13,2	-	-
M	Φ2,777	Φ2,778	Φ2,779
N	R3,6	R3,6	R3,7
O	R1,5	R1,5	R1,6
P	3,6	3,6	3,8
Q	7,475	7,5	7,525
R	Φ6,4	Φ6,4	Φ6,5

5.4.2 Terminations

Terminations either according to IEC 60352 series (solderless connections) or according to IEC 60999-1 (screw-type and screwless-type clamping units).

5.5 Mounting information for connectors

Mounting information could be specified upon agreement between manufacturer and customer.

5.6 Gauges – Sizing gauges and retention force gauges

Figure 5 and Table 3 show the drawing and dimensions for the gauge contacts.

Material: tool steel, with hardness of 60 to 64 HRC according to ISO 6508-1 and surface roughness according to ISO 21920-1:2021: $Ra_{max} = 0,25 \mu m$, $Ra_{min} = 0,15 \mu m$.

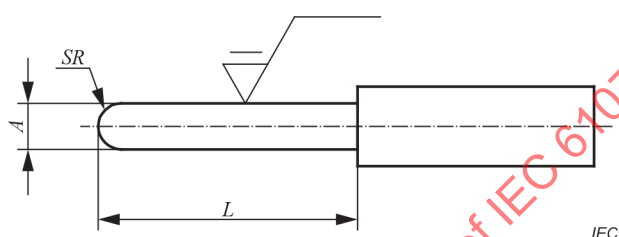


Figure 5 – Gauge for contact

Table 3 – Gauge dimensions

Gauge	Mass g	Application	A mm	L mm
P11	-	Sizing	$\Phi 2,87^{+0,005}_0$	15 min.
P12	200	Retention force	$\Phi 2,83^0_{-0,005}$	15 min.

6 Technical characteristics

6.1 Classification into climatic categories

Conditions: according to IEC 60068-1 and Table 4.

Table 4 – Climatic category

Climatic category	Lower temperature °C	Upper temperature °C	Temperature °C	Relative humidity %	Steady state damp-heat d
55/125/10	-55	+125	40	93	10

6.2 Electrical characteristics

6.2.1 Creepage and clearance distances

For the connector creepage and clearance distances shall be measured only in the mated condition.

Creepage distance 3,9 mm min. Clearance 3,9 mm min.

6.2.2 Voltage proof

Conditions: IEC 60512-4-1, Test 4a, method A.

Standard atmospheric conditions, mated connectors.


Requirements: Test voltage according to Table 5. There shall be no breakdown or flashover.

Table 5 – Voltage proof

NO.	Measuring points	Test voltage V AC RMS	Test time min
1	Between contacts, between contacts and metal housing	2 500	1

6.2.3 Current-carrying capacity

The current-carrying capacity shall be verified according to IEC 60512-5-2, Test 5b, with the maximum accepted cross-sectional area (6 mm²), to demonstrate compliance with the rated current (40 A) and the upper limiting temperature (125 °C). See in Figure 6 the current-temperature derating.

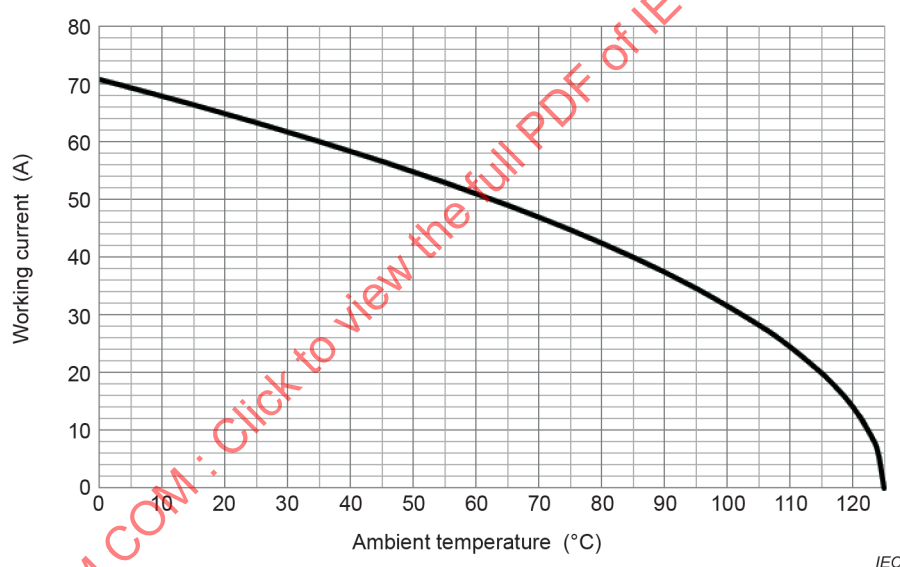

NOTE The diagram is expression of the formula

$$I_{(T)} = 70,72 \times (1 - T/125)^{0,5}$$

Figure 6 – Current-temperature derating (6 mm² wire size)

6.2.4 Electrical load and temperature

Conditions: IEC 60512-9-2, Test 9b.

Standard atmospheric conditions, mated connectors, contacts are connected with IEC 60228 class 5 stranded copper wires, wire cross-sectional area 6 mm².

Test current: 40 A, temperature: 85 °C ± 2 °C, duration: 500 h.

Requirements: the appearance, contact resistance (6.2.5), housing electrical continuity (6.2.6), insulation resistance (6.2.7), voltage proof (6.2.2), engaging and separating forces (6.3.4) and IP degree of protection (6.4.4) shall meet the requirements of this specification after test.

6.2.5 Contact resistance

Conditions: IEC 60512-2-1, Test 2a.

Standard atmospheric conditions.

Requirements: Initial: 1 mΩ max.

Final: 2 mΩ max.

6.2.6 Housing electrical continuity

Conditions: IEC 60512-2-6, Test 2f.

Standard atmospheric conditions, mated connectors.

Resistance shall be measured per Test 2b of IEC 60512-2-2.

Requirements: Initial: 5 mΩ max.

Final: 10 mΩ max.

6.2.7 Insulation resistance

Conditions: IEC 60512-3-1, Test 3a, method A.

Standard atmospheric conditions, mated connectors.

Test voltage: 500 V DC ± 50 V DC.

Requirements: Initial: between contacts, contacts and metal housing: 5 000 MΩ min.

Final: between contacts, contacts and metal housing: 100 MΩ min.

6.3 Mechanical characteristics

6.3.1 Mechanical operation

Conditions: IEC 60512-9-1, Test 9a.

Standard atmospheric conditions, mated connectors.

Rate of insertion and withdrawal operation: 10 mm/s max.

Operating cycles: 500 cycles.

Requirements: the appearance, contact resistance (6.2.5), housing electrical continuity (6.2.6), insulation resistance (6.2.7), voltage proof (6.2.2), polarization and keying method (6.3.6) and IP degree of protection (6.4.4) shall meet the requirements of this specification after test.

6.3.2 Effectiveness of connector coupling devices

Conditions: IEC 60512-15-6, Test 15f.

Standard atmospheric conditions, mated connectors.

Axial force: 500 N.

Requirements: 1 μs max. of duration of disturbance during the test. The connectors shall remain fully engaged; the appearance of the connectors shall meet the requirements of test phase P1.

6.3.3 Gauge retention force (resilient contact)

Condition: IEC 60512-16-5, Test 16e, method A.

Standard atmospheric conditions.

Requirements: The gauges shall be retained.

6.3.4 Engaging and separating forces

Condition: IEC 60512-13-1, Test 13a.

Standard atmospheric conditions.

Rate of engagement and separation: 10 mm/s max.

Requirements: engaging force: 100 N max.

Separating force: 4 N to 80 N.

6.3.5 Contact retention in insert

Conditions: IEC 60512-15-1, Test 15a.

Standard atmospheric conditions, unmated connectors.

Axial force: 150 N.

Requirement: contact displacement shall be less than 0,5 mm when applying axial forces and be less than 0,3 mm after forces are removed. The appearance of connectors shall meet the requirements of this specification after test.

6.3.6 Polarizing and keying method

Conditions: IEC 60512-13-5, Test 13e.

Standard atmospheric conditions, tool and gauges are not required, unintentional engaging forces: 150 N.

Requirements: the appearance of the connectors shall meet the requirements of test phase P1.

6.4 Dynamic stress tests

6.4.1 Vibration (sine)

Conditions: IEC 60512-6-4, Test 6d.

Standard atmospheric conditions, mated connectors.

The fixed and free connectors shall be rigidly installed in a suitable fixture.

Vibration severity: 10 Hz to 500 Hz and 0,75 mm or 10 g.

Sweep cycle: 10 cycles on each of the 3 axes.

Requirements: 1 μ s max. of duration of disturbance during the test. The appearance, contact resistance (6.2.5), housing electrical continuity (6.2.6), engaging and separating forces (6.3.4) and IP degree of protection (6.4.4) shall meet the requirements of this specification after test.

6.4.2 Shock

Conditions: IEC 60512-6-3, Test 6c.

Standard atmospheric conditions, mated connectors.

Acceleration: 500 m/s², duration: 11 ms, half-sine wave, 3 shocks in each axes and direction, 3 axes mutually perpendicular to each other.

Requirements: 1 μ s max. of duration of disturbance during the test. The appearance, contact resistance (6.2.5), housing electrical continuity (6.2.6), engaging and separating forces (6.3.4) and IP degree of protection (6.4.4) shall meet the requirements of this specification after test.

6.4.3 Free fall (repeated)

Conditions: IEC 60512-7-1, Test 7a.

Total number of revolutions: 25.

Requirement: the appearance of the connectors shall meet the requirements of test phase P1.

6.4.4 IP degree of protection

Conditions: according to IEC 60529:1989, mated connectors: IP65/IP67, unmated connectors: IPXXB. Specimens previously subject to the tests foreseen in 6.2.4 (electrical load and temperature), 6.3.1 (mechanical operation), 6.4.1(vibration) and 6.4.2 (shock) according to the relevant test groups (B, D, and A) may be conveniently subject to these IP code tests all together, regardless their belonging to different test groups.

Requirement: IPX5 according to 14.2.5 of IEC 60529:1989; IPX7 according to 14.2.7 of IEC 60529:1989; IP6X according to Table 7 of IEC 60529:1989; IPXXB according to 15.2 of IEC 60529:1989.

6.4.5 Glow-wire flammability test method for end-products (GWEPT)

Conditions: IEC 60512-20-3, Test 20c.

Temperature: 850 °C ± 15 °C.

Requirement: according to clause 10 of IEC 60695-2-11:2021.

6.5 Climatic tests

6.5.1 Rapid change of temperature

Conditions: IEC 60512-11-4, Test 11d.

Temperature: -55 °C to 125 °C, mated connectors.

Requirements: the appearance, insulation resistance (6.2.7), contact resistance (6.2.5), housing electric continuity (6.2.6), voltage proof (6.2.2) shall meet the requirements of this specification after test.

6.5.2 Dry heat

Conditions: IEC 60512-11-9, test 11i.

Temperature: 125 °C ± 2 °C, duration: 96 h, mated connectors.

Requirements: the appearance, contact resistance (6.2.5), engaging and separating forces (6.3.4), contact retention in insert (6.3.5), voltage proof (6.2.2) and IP degree of protection (6.4.4) shall meet the requirements of this specification after test.

6.5.3 Low temperature

Conditions: IEC 60512-11-10, test 11j.

Temperature: -55 °C ± 2 °C, duration: 96 h, mated connectors.

Requirements: the appearance, contact resistance (6.2.5), engaging and separating forces (6.3.4), contact retention in insert (6.3.5), voltage proof (6.2.2) and IP degree of protection (6.4.4) shall meet the requirements of this specification after test.

6.5.4 Low air pressure

Conditions: IEC 60512-11-11, test 11k.

Low air pressure: 54 kPa, mated connectors.

Requirements: the voltage proof (6.2.2) at low air pressure shall meet the requirements of this specification.

6.5.5 Damp heat, cyclic

Conditions: IEC 60512-11-12, test 11m.

Duration: 6 cycles, mated connectors.

Requirements: the appearance, insulation resistance (6.2.7), voltage proof (6.2.2), contact resistance (6.2.5), engaging and separating forces (6.3.4) shall meet the requirements of this specification after test.

6.5.6 Damp heat, steady state

Conditions: IEC 60512-11-3, Test 11c.

Duration: 10 s, mated connectors.

Requirements: the appearance, insulation resistance (6.2.7), voltage proof (6.2.2), contact resistance (6.2.5), engaging and separating force (6.3.4) shall meet the requirements of this specification after test.

6.5.7 Corrosion, salt mist

Conditions: IEC 60512-11-6, Test 11f.

Duration: 7 days, mated connectors.

Requirements: the appearance of the connectors shall meet the requirements of test phase P1.

6.5.8 Flowing mixed gas corrosion

Conditions: IEC 60512-11-7, Test 11g.

Duration: 4 days, test method 4 according to IEC 60068-2-60.

Requirements: the appearance, the contact resistance (6.2.5) and engaging and separating force (6.3.4) shall meet the requirements of this specification after test.

6.6 Environmental aspects

6.6.1 Marking of insulation material (plastic)

If applicable and possible, all plastic material should be marked according to ISO 11469 to ease recycling.

6.6.2 Design/use of material

The design shall take into account the relevant IEC standard for designing products (IEC 62430:2019) and the use of material (IEC Guide 109) with regard to the environment.

7 Test schedule

7.1 General

This test schedule shows the tests subdivided in test groups and within each group the order in which they shall be carried out, as well as the requirements to be met.

The preliminary test group P applies to all specimens, whose number is the sum of the number of specimens specified for each subsequent test group, which may then run independently from each other.

In the following, a mated set of connectors is called a specimen.

The necessary specimens are stated in Table 6.

Table 6 – Number of test specimens

Test group	AP	BP	CP	DP	EP	FP	GP	HP
Test specimens	3	6	3	3	3	Not applicable	3	3

7.2 Test schedules

7.2.1 Basic (minimum) test schedule

Not applicable.

7.2.2 Full test schedule

7.2.2.1 Test group P – Preliminary

All specimens shall be subject to the following tests. See Table 7.

Table 7 – Test group P

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
P1	General examination	1	Unmated connectors	Visual examination	1a	No defect that would impair normal operation
				Examination of dimensions ^a	1b	The dimensions shall comply with those specified in 5.3 and 5.4
P2	Polarizing and keying method	13e	150 N			Shall be as per 6.3.6 No defect that would impair normal operation.
P3				Contact resistance – Millivolt level method	2a	Shall be as per 6.2.5 1 mΩ max.
P4			Mated connectors	Housing electrical continuity	2f	Shall be as per 6.2.7 5 mΩ max.
P5			Method A, test voltage: 500 V DC ± 50 V DC	Insulation resistance	3a	Shall be as per 6.2.7 Between contacts, contacts and metal housing: 5000 MΩ min.
P6			Method A, duration: 1 min Between contacts, contacts and metal housing: 2 500 V AC min.	Voltage proof	4a	Shall be as per 6.2.2 No breakdown or flashover.

^a In case of destructive physical analysis, 1 specimen shall be added.

7.2.2.2 Test group AP – Dynamic/climatic

The number of specimens specified in Table 6 shall be subject to the following tests. See Table 8.

Table 8 – Test group AP

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
AP1	Gauge retention force (resilient contacts)	16e				Shall be as per 6.3.3 The gauges shall be retained.
AP2			Rate of insertion and withdrawal operation: 10 mm/s max.	Engaging and separating forces	13a	Shall be as per 6.3.4 Engaging force: 100 N max.; separating force: 4 N to 80 N
AP3			Method A, duration: 1 min Between contacts, contacts and metal housing: 2 500 V AC min.	Voltage proof	4a	Shall be as per 6.2.2 No breakdown or flashover.
AP4	Contact retention in insert	15a		Visual examination	1a	Shall be as per 6.3.5 No defect that would impair normal operation; contact displacement shall be less than 0,5 mm when applying axial forces and be less than 0,3 mm after forces are removed.
AP5	Vibration	6d	10 Hz to 500 Hz, double amplitude: 0,75 mm or acceleration: 10 g	Contact disturbance	2e	Shall be as per 6.4.1 1 µs max. of duration of disturbance during the test.
AP6				Contact resistance – Millivolt level method	2a	Shall be as per 6.2.5 Contact resistance 2 mΩ max.
AP7				Housing electrical continuity	2f	Shall be as per 6.2.6 10 mΩ max
AP8			Rate of insertion and withdrawal operation: 10 mm/s max.	Engaging and separating forces	13a	Shall be as per 6.3.4 Engaging force: 100 N max.; separating force: 4 N to 80 N
AP9				Visual examination	1a	No defect that would impair normal operation.
AP10	Shock	6c	Acceleration: 500 m/s ² , duration: 11 ms, half-sine wave, 3 shocks in each axes and direction, 3 axes mutually perpendicular to each other.	Contact disturbance	2e	Shall be as per 6.4.1 1 µs max. of duration of disturbance during the test.
AP11				Contact resistance – Millivolt level method	2a	Shall be as per 6.2.5 2 mΩ max.
AP12				Housing electrical continuity	2f	Shall be as per 6.2.6 10 mΩ max.

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
AP13			Rate of insertion and withdrawal operation: 10 mm/s max.	Engaging and separating forces	13a	Shall be as per 6.3.4 Engaging force: 100 N max.; separating force: 4 N to 80 N
AP14				Visual examination	1a	No defect that would impair normal operation.
AP15	Rapid change of temperature	11d	-55 °C to 125 °C Duration: 3 h 5 cycles			
AP16			Test voltage: 500 V DC ± 50 V DC Method A	Insulation resistance	3a	Shall be as per 6.2.7 Between contacts, contacts and metal housing: 100 MΩ min.
AP17			Method A, duration: 1 min Between contacts, contacts and metal housing: 2 500 V AC min.	Voltage proof	4a	Shall be as per 6.2.2 No breakdown or flashover.
AP18				Visual examination	1a	No defect that would impair normal operation.
AP19	Climatic sequence	11a		Visual examination	1a	No defect that would impair normal operation
AP19.1	Dry heat	11i	Temp.: 125 °C Duration: 96 h	Insulation resistance at high temperature	3a	Shall be as per 6.2.7 Between contacts, contacts and metal housing: 100 MΩ min.
AP19.2	Low air pressure	11k	Low air pressure: 54 kPa Duration : 2 h			
			Method A, duration: 1 min Between contacts, contacts and metal housing: 2 500 V AC min.	Voltage proof	4a	Shall be as per 6.2.2 No breakdown or flashover.
AP19.3	Damp heat, Cyclic first cycle	11m	Method Db Recovery time: 2 h			
AP19.4				Visual examination	1a	No defect that would impair normal operation.
AP19.5	Cold	11j	Temp.: -55 °C Duration: 96 h Recovery time: 2 h			
AP19.6				Visual examination	1a	No defect that would impair normal operation.

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
AP19.7	Low air pressure	11k	Low air pressure: 54 kPa Duration : 2 h			
			Method A, duration: 1 min Between contacts, contacts and metal housing: 2 500 V AC min.	Voltage proof	4a	Shall be as per 6.2.2 No breakdown or flashover.
AP19.8	Damp heat, Cyclic, remaining cycles	11m	Method Db 5 cycles Recovery time: 2 h			
AP20				Contact resistance – Millivolt level method	2a	Shall be as per 6.2.5 2 mΩ max.
AP21			Test voltage: 500 V DC ± 50 V DC Method A	Insulation resistance	3a	Shall be as per 6.2.7 Between contacts, contacts and metal housing: 100 MΩ min.
AP22			Method A, duration: 1 min Between contacts, contacts and metal housing: 2 500 V AC min.	Voltage proof	4a	Shall be as per 6.2.2 No breakdown or flashover.
AP23			Rate of insertion and withdrawal operation: 10 mm/s max.	Engaging and separating forces	13a	Shall be as per 6.3.4 Engaging force: 100 N max.; separating force: 4 N to 80 N
AP24			Axial force: 100 N	Contact retention in insert	15a	Shall be as per 6.3.5 Contact displacement shall be less than 0,5 mm when applying axial forces and be less than 0,3 mm after forces are removed.
AP25				Visual examination	1a	No defect that would impair normal operation.
AP26	Second characteristic numeral		Mated connectors reference to 6.4.4 for the IP tests in AP26.1, AP26.2 in which the specimens shall be tested			
AP26.1			IPX5: specimens mated, wired and locked	See 14.2.5 of IEC 60529:1989		See 14.3 of IEC 60529:1989
AP26.2			IPX7: specimens mated, wired and locked	See 14.2.7 of IEC 60529:1989		See 14.3 of IEC 60529:1989
AP27 ^a	First characteristic numeral		IP6X: specimens mated, wired and locked reference to 6.4.4 for the IP tests in AP27 in which the specimens shall be tested	See Table 7 of IEC 60529:1989		See 13.6.2 of IEC 60529:1989

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
AP28	IP code the additional letter		IPXXB: specimens unmated reference to 6.4.4 for the IP tests in AP28 in which the specimens shall be tested	See 15.2 of IEC 60529:1989		See 15.3 of IEC 60529:1989
AP29			Rate of insertion and withdrawal operation: 10 mm/s max.	Engaging and separating forces	13a	Shall be as per 6.3.4 Engaging force: 100 N max.; separating force: 4 N to 80 N
AP30				Visual examination	1a	No defect that would impair normal operation.
^a It is allowed to perform AP27 with an additional specimen, extending the total number of specimens by 1.						

7.2.2.3 Test group BP – Mechanical endurance

The number of specimens specified in Table 6 shall be subject to the following tests. See Table 9.

Table 9 – Test group BP

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
BP1	Engaging and separating forces	13a	Rate of insertion and withdrawal operation: 10 mm/s max.			Shall be as per 6.3.4 Engaging force: 100 N max.; separating force: 4 N to 80 N
BP2	Mechanical operation (half of the specified number of operations)	9a	Speed: 10 mm/s max. Rest time: 30 s (unmated) Cycles: 250			
BP3				Contact resistance – Millivolt level method	2a	Shall be as per 6.2.5 2 mΩ max.
BP4				Visual examination	1a	No defect that would impair normal operation.
BP5.1 ^a	Corrosion, salt mist	11f	7 days			
BP5.2 ^a	flowing mixed gas corrosion	11g	4 d, test method 4 according to IEC 60068-2-60			
BP6				Contact resistance – Millivolt level method	2a	Shall be as per 6.2.5 30 mΩ max.

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
BP7				Visual examination	1a	No defect that would impair normal operation.
BP8	Mechanical operation (remaining half of specified number of operations)	9a	Speed: 10 mm/s max. Rest time: 30 s (unmated) Cycles: 250			
BP9				Contact resistance – Millivolt level method	2a	Shall be as per 6.2.5 2 mΩ max.
BP10				Housing electrical continuity	2f	10 mΩ max.
BP14				Visual examination	1a	No defect that would impair normal operation
BP15	IP code second characteristic numeral		Mated connectors, reference to 6.4.4 for the IP tests in BP15.1, BP15.2, BP15.3, BP15.4 in which the specimens shall be tested			
BP15.1			IPX5: specimens mated, wired and locked	See 14.2.5 of IEC 60529:1989		See 14.3 of IEC 60529:1989
BP15.2			IPX7: specimens mated, wired and locked	See 14.2.7 of IEC 60529:1989		See 14.3 of IEC 60529:1989
BP15.3	IP code first characteristic numeral		IP6X: specimens mated, wired and locked	See Table 7 of IEC 60529:1989		See 13.6.2 of IEC 60529:1989
BP15.4	IP code the additional letter		IPXXB: specimens unmated	See 15.2 of IEC 60529:1989		See 15.3 of IEC 60529:1989
BP16			Rate of insertion and withdrawal operation: 10 mm/s max.	Engaging and separating forces	13a	Shall be as per 6.3.4 Engaging force: 100 N max.; separating force: 4 N to 80 N

^a Half of the specimens are for the test of corrosion, salt mist, half are for the test of flowing mixed gas corrosion.

7.2.2.4 Test group CP – Moisture

The number of specimens specified in Table 6 shall be subject to the following tests. See Table 10.

Table 10 – Test group CP

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
CP1	Damp heat, steady state	11c	Duration: 10 days Mated connectors			
CP2				Contact resistance – Millivolt level method	2a	Shall be as per 6.2.5 2 mΩ max.
CP3			Test voltage: 500 V DC ± 50 V DC Method A	Insulation resistance	3a	Shall be as per 6.2.7 Between contacts, contacts and metal housing: 100 MΩ min.
CP4			Method A, duration: 1 min Between contacts, contacts and metal housing: 2 500 V AC min.	Voltage proof	4a	Shall be as per 6.2.2 No breakdown or flashover.
CP5			Rate of insertion and withdrawal operation: 10 mm/s max.	Engaging and separating forces	13a	Shall be as per 6.3.4 Engaging force: 100 N max.; separating force: 4 N to 80 N
CP6				Visual examination	1a	No defect that would impair normal operation.

7.2.2.5 Test group DP – Heat and electrical load

The number of specimens specified in Table 6 shall be subject to the following tests. See Table 11.

Table 11 – Test group DP

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
DP1	Rapid change of temperature	11d	-55 °C to 125 °C Recovery time: 1h 5 cycles			
DP2			Test voltage: 500 V DC $\pm$ 50 V DC Method A	Insulation resistance	3a	Shall be as per 6.2.7 Between contacts, contacts and metal housing: 100 M Ω min.
DP3			Method A, duration: 1 min Between contacts, contacts and metal housing: 2 500 V AC min.	Voltage proof	4a	Shall be as per 6.2.2 No breakdown or flashover.
DP4				Visual examination	1a	No defect that would impair normal operation.
DP5	Mechanical operation	9a	Speed: 10 mm/s max. Rest time: 30 s (unmated) Cycles: 500			
DP6				Contact resistance – Millivolt level method	2a	Shall be as per 6.2.5 2 m Ω max.
DP7				Housing electrical continuity	2f	Shall be as per 6.2.6 10 m Ω max.
DP8			Test voltage: 500 V DC $\pm$ 50 V DC Method A	Insulation resistance	3a	Shall be as per 6.2.7 Between contacts, contacts and metal housing: 100 M Ω min.
DP9			Method A, duration: 1 min Between contacts, contacts and metal housing: 2 500 V AC min.	Voltage proof	4a	Shall be as per 6.2.2 No breakdown or flashover.
DP10			150 N	Polarizing and keying method	13e	Shall be as per 6.3.6 No defect that would impair normal operation.
DP11				Visual examination	1a	No defect that would impair normal operation.
DP12	Current-carrying capacity	5b				
DP13				Visual examination	1a	No defect that would impair normal operation.

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
DP14	Electrical load and temperature	9b				
DP15				Contact resistance – Millivolt level method	2a	Shall be as per 6.2.5 2 mΩ max.
DP16			Test voltage: 500 V DC ± 50 V DC Method A	Insulation resistance	3a	Shall be as per 6.2.7 Between contacts, contacts and metal housing: 100 MΩ min.
DP17				Housing electrical continuity	2f	Shall be as per 6.2.6 10 mΩ max.
DP18			Method A, duration: 1 min Between contacts, contacts and metal housing: 2 500 V AC min.	Voltage proof	4a	Shall be as per 6.2.2 No breakdown or flashover.
DP19			Rate of insertion and withdrawal operation: 10 mm/s max.	Engaging and separating forces	13a	Shall be as per 6.3.4 Engaging force: 100 N max.; separating force: 4 N to 80 N
DP20				Visual examination	1a	No defect that would impair normal operation.
DP21	IP code second characteristic numeral		Mated connectors reference to 6.4.4 for the IP tests in DP21.1, DP21.2 in which the specimens shall be tested			
DP21.1			IPX5: specimens mated, wired and locked	See 14.2.5 of IEC 60529:1989		See 14.3 of IEC 60529:1989
DP21.2			IPX7: specimens mated, wired and locked	See 14.2.7 of IEC 60529:1989		See 14.3 of IEC 60529:1989
DP22	IP code first characteristic numeral		IP6X: specimens mated, wired and locked reference to 6.4.4 for the IP tests in DP22 in which the specimens shall be tested	See Table 7 of IEC 60529:1989		See 13.6.2 of IEC 60529:1989
DP23	IP code the additional letter		IPXXB: specimens unmated reference to 6.4.4 for the IP tests in DP23 in which the specimens shall be tested	See 15.2 of IEC 60529:1989		See 15.3 of IEC 60529:1989
DP24	Effectiveness of connector coupling devices	15f	Axial force: 500 N	Contact disturbance	2e	Shall be as per 6.3.2 1 μs max. of duration of disturbance during the test.
DP25			Rate of insertion and withdrawal operation: 10 mm/s max.	Engaging and separating forces	13a	Shall be as per 6.3.4 Engaging force: 100 N max.; separating force: 4 N to 80 N

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
DP26				Visual examination	1a	No defect that would impair normal operation.
DP27	Free fall (repeated)	7a	Revolution times: 25			
DP28				Visual examination	1a	No defect that would impair normal operation.

7.2.2.6 Test group EP – Fire

The number of specimens specified in Table 6 shall be subject to the following tests. See Table 12.

Table 12 – Test group EP

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test	Title	IEC 60512 Test NO.	
EP1	Glow-wire flammability test	20c	Temp.: 850 °C ± 15 °C			
EP2				Visual examination	1a	No defect that would impair normal operation.

7.2.2.7 Test group FP – Fluids

Not applicable.

7.2.2.8 Test group GP- Connection method tests

The number of specimens specified in Table 6 shall be subject to the following tests. See Table 13.

Table 13 – Test group GP

Test phase	Test			Measurement to be performed		Requirements
	Title	IEC 60512 Test NO.	Severity or condition of test Requirements	Title	IEC 60512 Test NO.	
JP1	Applicable tests of connection methods according to IEC 60352 series and IEC 60512 series.					
- JPX	Depending upon the type of solderless termination/connection method, if applicable, a test sequence from the relevant part of IEC 60352 series shall be selected.					

Where test evidence can be provided, confirming that the connection methods used by the connectors have been previously tested in accordance with either the specified tests of IEC 60352 series (solderless connections) or of IEC 60999-1 (screw-type or screwless-type clamping units), and have satisfactorily passed them, test phases JP1 to JPX shall be omitted.

If a screw-type or a screwless-type clamping unit is used, its conformance to the requirements to IEC 60999-1 shall be proven.

7.3 Test procedures and measurement methods

The test methods specified and given in the relevant standards are the preferred methods but not necessarily the only ones which can be used. In case of dispute, however, the specified method shall be used.

Unless otherwise specified, all tests shall be carried out under standard atmospheric conditions for testing as specified in IEC 60068-1.

7.4 Pre-conditioning

Before the tests are performed, the connectors shall be preconditioned under conditions specified in IEC 60068-1 for a period of 24 h, unless otherwise specified by the detail product specification.

7.5 Wiring and mounting of test specimens

7.5.1 Wiring

The specimens are to be wired according to 6.6 of IEC 61984:2008.

7.5.2 Mounting

When mounting is required in a test, the connectors shall be rigidly mounted on a metal plate, a printed board or to specified accessories, whichever is applicable, using the normal mounting method, fixing devices and panel cut-out as laid down in the detail product specification.

SOMMAIRE

AVANT-PROPOS	37
1 Domaine d'application	40
2 Références normatives	40
3 Termes et définitions	43
4 Informations techniques	43
4.1 Méthode de sortie recommandée	43
4.1.1 Généralités	43
4.1.2 Nombre de contacts et de cavités de contact	43
4.2 Valeurs assignées et caractéristiques	43
4.3 Systèmes de niveaux	44
4.3.1 Niveaux de performances	44
4.3.2 Niveaux de compatibilité	44
4.4 Classification en catégories climatiques	44
4.5 Ligne de fuite et distance d'isolement	44
4.6 Courant admissible	44
4.7 Marquage	44
5 Informations relatives aux dimensions	44
5.1 Généralités	44
5.2 Vue isométrique et caractéristiques communes	45
5.2.1 Généralités	45
5.2.2 Vue isométrique d'une fiche	45
5.2.3 Vue isométrique d'une embase	45
5.3 Fiche	46
5.3.1 Généralités	46
5.3.2 Dimensions	46
5.3.3 Sorties	47
5.4 Embase	47
5.4.1 Dimensions (voir la Figure 4 et le Tableau 2)	47
5.4.2 Sorties	48
5.5 Informations de montage pour connecteurs	48
5.6 Calibres – Calibres de dimensionnement et calibres de force de rétention	48
6 Caractéristiques techniques	48
6.1 Classification en catégories climatiques	48
6.2 Caractéristiques électriques	48
6.2.1 Ligne de fuite et distance d'isolement	48
6.2.2 Tension de tenue	49
6.2.3 Courant admissible	49
6.2.4 Charge électrique et température	49
6.2.5 Résistance de contact	50
6.2.6 Continuité électrique du boîtier	50
6.2.7 Résistance d'isolement	50
6.3 Caractéristiques mécaniques	50
6.3.1 Fonctionnement mécanique	50
6.3.2 Efficacité des dispositifs d'accouplement des connecteurs	50
6.3.3 Force de rétention du calibre (contact élastique)	51
6.3.4 Forces d'accouplement et de désaccouplement	51

6.3.5	Rétention des contacts dans l'isolant	51
6.3.6	Méthode de détrompage et de codage	51
6.4	Essais de contraintes dynamiques	51
6.4.1	Vibrations (sinusoïdales)	51
6.4.2	Chocs	52
6.4.3	Chute libre (essai répété)	52
6.4.4	Degré de protection IP	52
6.4.5	Méthode d'essai d'inflammabilité pour produits finis (GWEPT)	52
6.5	Essais climatiques	52
6.5.1	Variations rapides de température	52
6.5.2	Chaleur sèche	52
6.5.3	Température la plus basse:	53
6.5.4	Basse pression atmosphérique	53
6.5.5	Essai cyclique de chaleur humide	53
6.5.6	Chaleur humide, essai continu	53
6.5.7	Corrosion, brouillard salin	53
6.5.8	Essai de corrosion dans un flux de mélange de gaz	53
6.6	Aspects environnementaux	54
6.6.1	Marquage des matériaux isolants (plastiques)	54
6.6.2	Conception/utilisation des matériaux	54
7	Programme d'essais	54
7.1	Généralités	54
7.2	Programmes d'essai	54
7.2.1	Programme d'essai de base (minimal)	54
7.2.2	Programme d'essai complet	54
7.3	Procédures d'essai et méthodes de mesure	66
7.4	Préconditionnement	66
7.5	Câblage et montage des spécimens	67
7.5.1	Câblage	67
7.5.2	Montage	67
	Figure 1 – Fiche	45
	Figure 2 – Embase	45
	Figure 3 – Fiche	46
	Figure 4 – Embase	47
	Figure 5 – Calibre pour contact	48
	Figure 6 – Taux de réduction de l'intensité en fonction de la température (section de fil de 6 mm ²)	49
	Tableau 1 – Dimensions d'une fiche	46
	Tableau 2 – Dimensions de l'embase	47
	Tableau 3 – Dimensions des calibres	48
	Tableau 4 – Catégorie climatique	48
	Tableau 5 – Tension de tenue	49
	Tableau 6 – Nombre de spécimens	54
	Tableau 7 – Groupe d'essais P	55
	Tableau 8 – Groupe d'essais AP	56

Tableau 9 – Groupe d’essais BP	60
Tableau 10 – Groupe d’essais CP	62
Tableau 11 – Groupe d’essais DP	63
Tableau 12 – Groupe d’essais EP	66
Tableau 13 – Groupe d’essais GP	66

IECNORM.COM : Click to view the full PDF of IEC 61076-8-104:2023

COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

**CONNECTEURS POUR ÉQUIPEMENTS
ÉLECTRIQUES ET ÉLECTRONIQUES –
EXIGENCES DE PRODUIT –****Partie 8-104: Connecteurs d'alimentation –
Spécification particulière relative aux connecteurs circulaires bipolaires
avec un courant assigné de 40 A et un mécanisme de verrouillage de type
pousser-tirer IP65/IP67, logés dans un boîtier métallique**

AVANT-PROPOS

- 1) La Commission Electrotechnique Internationale (IEC) est une organisation mondiale de normalisation composée de l'ensemble des comités électrotechniques nationaux (Comités nationaux de l'IEC). L'IEC a pour objet de favoriser la coopération internationale pour toutes les questions de normalisation dans les domaines de l'électricité et de l'électronique. A cet effet, l'IEC – entre autres activités – publie des Normes internationales, des Spécifications techniques, des Rapports techniques, des Spécifications accessibles au public (PAS) et des Guides (ci-après dénommés "Publication(s) de l'IEC"). Leur élaboration est confiée à des comités d'études, aux travaux desquels tout Comité national intéressé par le sujet traité peut participer. Les organisations internationales, gouvernementales et non gouvernementales, en liaison avec l'IEC, participent également aux travaux. L'IEC collabore étroitement avec l'Organisation Internationale de Normalisation (ISO), selon des conditions fixées par accord entre les deux organisations.
- 2) Les décisions ou accords officiels de l'IEC concernant les questions techniques représentent, dans la mesure du possible, un accord international sur les sujets étudiés, étant donné que les Comités nationaux de l'IEC intéressés sont représentés dans chaque comité d'études.
- 3) Les Publications de l'IEC se présentent sous la forme de recommandations internationales et sont agréées comme telles par les Comités nationaux de l'IEC. Tous les efforts raisonnables sont entrepris afin que l'IEC s'assure de l'exactitude du contenu technique de ses Publications; l'IEC ne peut pas être tenue responsable de l'éventuelle mauvaise utilisation ou interprétation qui en est faite par un quelconque utilisateur final.
- 4) Dans le but d'encourager l'uniformité internationale, les Comités nationaux de l'IEC s'engagent, dans toute la mesure possible, à appliquer de façon transparente les Publications de l'IEC dans leurs publications nationales et régionales. Toutes divergences entre toutes Publications de l'IEC et toutes publications nationales ou régionales correspondantes doivent être indiquées en termes clairs dans ces dernières.
- 5) L'IEC elle-même ne fournit aucune attestation de conformité. Des organismes de certification indépendants fournissent des services d'évaluation de conformité et, dans certains secteurs, accèdent aux marques de conformité de l'IEC. L'IEC n'est responsable d'aucun des services effectués par les organismes de certification indépendants.
- 6) Tous les utilisateurs doivent s'assurer qu'ils sont en possession de la dernière édition de cette publication.
- 7) Aucune responsabilité ne doit être imputée à l'IEC, à ses administrateurs, employés, auxiliaires ou mandataires, y compris ses experts particuliers et les membres de ses comités d'études et des Comités nationaux de l'IEC, pour tout préjudice causé en cas de dommages corporels et matériels, ou de tout autre dommage de quelque nature que ce soit, directe ou indirecte, ou pour supporter les coûts (y compris les frais de justice) et les dépenses découlant de la publication ou de l'utilisation de cette Publication de l'IEC ou de toute autre Publication de l'IEC, ou au crédit qui lui est accordé.
- 8) L'attention est attirée sur les références normatives citées dans cette publication. L'utilisation de publications référencées est obligatoire pour une application correcte de la présente publication.
- 9) L'attention est attirée sur le fait que certains des éléments de la présente Publication de l'IEC peuvent faire l'objet de droits de brevet. L'IEC ne saurait être tenue pour responsable de ne pas avoir identifié de tels droits de propriété et averti de leur existence.

L'IEC 61076-8-104 a été établie par le sous-comité 48B: Connecteurs électriques, du comité d'études 48 de l'IEC: Connecteurs électriques et structures mécaniques pour les équipements électriques et électroniques. Il s'agit d'une Norme internationale.

Le texte de cette Norme internationale est issu des documents suivants:

Projet	Rapport de vote
48B/2953/CDV	48B/2991/RVC

Le rapport de vote indiqué dans le tableau ci-dessus donne toute information sur le vote ayant abouti à son approbation.

La langue employée pour l'élaboration de cette Norme internationale est l'anglais.



Ce document a été rédigé selon les Directives ISO/IEC, Partie 2, il a été développé selon les Directives ISO/IEC, Partie 1 et les Directives ISO/IEC, Supplément IEC, disponibles sous www.iec.ch/members_experts/refdocs. Les principaux types de documents développés par l'IEC sont décrits plus en détail sous www.iec.ch/publications.

Une liste de toutes les parties de la série IEC 61076, publiées sous le titre général *Connecteurs pour équipements électriques et électroniques – Exigences de produit*, se trouve sur le site web de l'IEC.

Les futures normes de cette série porteront le nouveau titre général cité ci-dessus. Le titre des normes qui existent déjà dans cette série sera mis à jour lors de leur prochaine édition.

Le comité a décidé que le contenu de ce document ne sera pas modifié avant la date de stabilité indiquée sur le site web de l'IEC sous webstore.iec.ch dans les données relatives au document recherché. A cette date, le document sera:

- Reconduit;
- Supprimé;
- remplacé par une édition révisée; ou
- amendé.

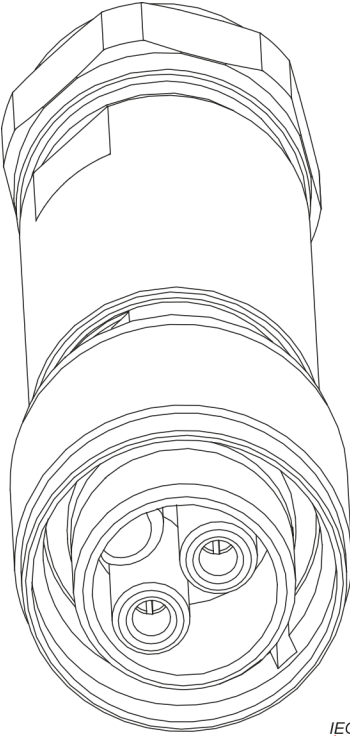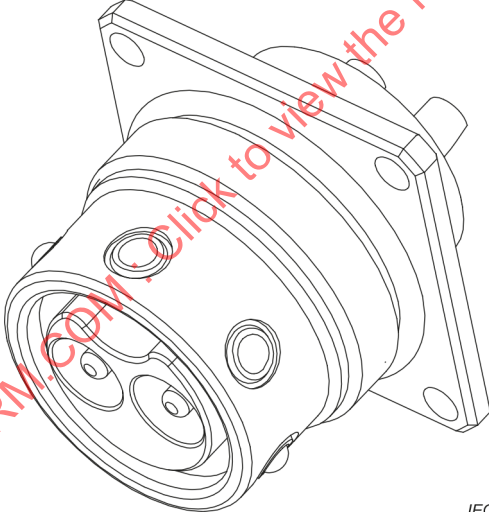La Commission Electrotechnique Internationale IEC SC 48B – Connecteurs électriques		IEC 61076-8-104
Spécification particulière conformément à l'IEC 61076-8		
Fiche	 IEC	Pour courant assigné de 40 A; 2 pôles; Contacts femelles; Mécanisme de verrouillage de type pousser-tirer; Blindage 360°.
Embase	 IEC	Pour courant assigné de 40 A; 2 pôles; Contacts mâles; Mécanisme de verrouillage de type pousser-tirer; Blindage 360°.

CONNECTEURS POUR ÉQUIPEMENTS ÉLECTRIQUES ET ÉLECTRONIQUES – EXIGENCES DE PRODUIT –

Partie 8-104: Connecteurs d'alimentation – Spécification particulière relative aux connecteurs circulaires bipolaires avec un courant assigné de 40 A et un mécanisme de verrouillage de type pousser-tirer IP65/IP67, logés dans un boîtier métallique

1 Domaine d'application

La présente partie de l'IEC 61076-8 décrit des embases et fiches circulaires bipolaires avec un courant assigné de 40 A, une tension assignée jusqu'à 50 V (en courant alternatif/en courant continu) inclus et des boîtiers métalliques IP65/IP67 avec verrouillage par pousser-tirer (ci-après désignés connecteurs) destinés à être utilisés dans des équipements électriques et électroniques. Elle inclut les dimensions hors tout, les dimensions d'interface, les caractéristiques techniques, les exigences de performance et les méthodes d'essai.

2 Références normatives

Les documents suivants sont cités dans le texte de sorte qu'ils constituent, pour tout ou partie de leur contenu, des exigences du présent document. Pour les références datées, seule l'édition citée s'applique. Pour les références non datées, la dernière édition du document de référence s'applique (y compris les éventuels amendements).

IEC 60050-581, *Vocabulaire Electrotechnique International (IEV) – Partie 581: Composants électromécaniques pour équipements électroniques*

IEC 60068-1, *Essais d'environnement – Partie 1: Généralités et lignes directrices*

IEC 60068-2-60, *Essais d'environnement – Partie 2-60: Essais – Essai Ke: Essai de corrosion dans un flux de mélange de gaz*

IEC 60228, *Ames des câbles isolés*

IEC 60352-2, *Connexions sans soudure – Partie 2: Connexions serties – Exigences générales, méthodes d'essai et guide pratique*

IEC 60352-3, *Connexions sans soudure – Partie 3: Connexions autodénudantes accessibles – Règles générales, méthodes d'essai et guide pratique*

IEC 60352-4, *Connexions sans soudure – Partie 4: Connexions autodénudantes (CAD) non accessibles – Règles générales, méthodes d'essai et guide pratique*

IEC 60352-5, *Connexions sans soudure – Partie 5: Connexions insérées à force – Exigences générales, méthodes d'essai et guide pratique*

IEC 60352-6, *Connexions sans soudure – Partie 6: Connexions à percement d'isolant – Exigences générales, méthodes d'essai et guide pratique*

IEC 60352-7, *Connexions sans soudure – Partie 7: Connexions à ressort – Règles générales, méthodes d'essai et guide pratique*

IEC 60512-1-1, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 1-1: Examen général – Essai 1a: Examen visuel*

IEC 60512-1-2, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 1-2: Examen général – Essai 1b: Examen de dimension et masse*

IEC 60512-2-1, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 2-1: Essais de continuité électrique et de résistance de contact – Essai 2a: Résistance de contact – Méthode du niveau des millivolts*

IEC 60512-2-2, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 2-2: Essais de continuité électrique et de résistance de contact – Essai 2b: Résistance de contact – Méthode du courant d'essai spécifié*

IEC 60512-2-5, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 2-5: Essais de continuité électrique et de résistance de contact – Essai 2e: Perturbation de contact*

IEC 60512-2-6, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 2-6: Essais de continuité électrique et de résistance de contact – Essai 2f: Continuité électrique du boîtier (coquille)*

IEC 60512-3-1, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 3-1: Essais d'isolement – Essai 3a: Résistance d'isolement*

IEC 60512-4-1, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 4-1: Essais de contrainte diélectrique – Essai 4a: Tension de tenue*

IEC 60512-5-2, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 5-2: Essais de courant limite – Essai 5b: Taux de réduction de l'intensité en fonction de la température*

IEC 60512-6-3, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 6-3: Essais de contraintes dynamiques – Essai 6c: Chocs*

IEC 60512-6-4, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 6-4: Essais de contraintes dynamiques – Essai 6d: Vibrations (sinusoïdales)*

IEC 60512-7-1, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 7-1: Essais d'impact (fiches) – Essai 7a: Chute libre (essai répété)*

IEC 60512-9-1, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 9-1: Essais d'endurance – Essai 9a: Fonctionnement mécanique*

IEC 60512-9-2, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 9-2: Essais d'endurance – Essai 9b: Charge électrique et température*

IEC 60512-11-1, *Connecteurs pour équipements électriques et électroniques – Essais et mesures – Partie 11-1: Essais climatiques – Essai 11a: Séquence climatique*

IEC 60512-11-3, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 11-3: Essais climatiques – Essai 11c: Essai continu de chaleur humide*

IEC 60512-11-4, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 11-4: Essais climatiques – Essai 11d: Variations rapides de température*

IEC 60512-11-6, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 11-6: Essais climatiques – Essai 11f: Corrosion, brouillard salin*

IEC 60512-11-7, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 11-7: Essais climatiques – Essai 11g: Essai de corrosion dans un flux de mélange de gaz*

IEC 60512-11-9, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 11-9: Essais climatiques – Essai 11i: Chaleur sèche*

IEC 60512-11-10, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 11-10: Essais climatiques – Essai 11j: Froid*

IEC 60512-11-11, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 11-11: Essais climatiques – Essai 11k: Basse pression atmosphérique*

IEC 60512-11-12, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 11-12: Essais climatiques – Essai 11m: Essai cyclique de chaleur humide*

IEC 60512-13-1, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 13-1: Essais de fonctionnement mécanique – Essai 13a: Forces d'accouplement et de désaccouplement*

IEC 60512-13-5, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 13-5: Essais de fonctionnement mécanique – Essai 13e: Méthode de polarisation et de codage*

IEC 60512-15-1, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 15-1: Essais (mécaniques) des connecteurs – Essai 15a: Rétention des contacts dans l'isolant*

IEC 60512-15-6, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 15-6: Essais (mécaniques) des connecteurs – Essai 15f: Efficacité des dispositifs d'accouplement des connecteurs*

IEC 60512-16-5, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 16-5: Essais mécaniques des contacts et des sorties – Essai 16e: Force de rétention du calibre (contacts élastiques)*

IEC 60512-20-3, *Connecteurs pour équipements électroniques – Essais et mesures – Partie 20-3: Essais relatifs aux risques du feu – Essai 20c: Inflammabilité, fil incandescent*

IEC 60529:1989, *Degrés de protection procurés par les enveloppes (Code IP)*

IEC 60529:1989/AMD1:1999

IEC 60529:1989/AMD2:2013

IEC 60664-1:2020, *Coordination de l'isolement des matériels dans les réseaux d'énergie électrique à basse tension – Partie 1: Principes, exigences et essais*

IEC 60695-2-11:2021, *Essais relatifs aux risques du feu – Partie 2-11: Essais au fil incandescent/chauffant – Méthode d'essai d'inflammabilité pour produits finis (GWEPT)*

IEC 60999-1, *Dispositifs de connexion – Conducteurs électriques en cuivre – Prescriptions de sécurité pour organes de serrage à vis et sans vis – Partie 1: Prescriptions générales et particulières pour les organes de serrage pour les conducteurs de 0,2 mm² à 35 mm² (inclus)*

IEC 61076-1:2006, *Connecteurs pour équipements électroniques – Exigences de produit – Partie 1: Spécification générique*
IEC 61076-1:2006/AMD1:2019

IEC 61984:2008, *Connecteurs – Exigences de sécurité et essais*

IEC 62430:2019, *Écoconception (ECD) – Principes, exigences et recommandations*

IEC Guide 109, *Aspects liés à l'environnement – Prise en compte dans les normes électrotechniques de produits*

ISO 6508-1:2005, *Matériaux métalliques – Essai de dureté Rockwell – Partie 1: Méthode d'essai*

ISO 11469, *Plastiques – Identification générique et marquage des produits en matière plastique*

ISO 21920-1:2021, *Spécification géométrique des produits (GPS) – Etat de surface: Méthode du profil – Partie 1: Indication des états de surface*

3 Termes et définitions

Pour les besoins du présent document, les termes et définitions de l'IEC 60050-581 s'appliquent.

L'ISO et l'IEC tiennent à jour des bases de données terminologiques destinées à être utilisées en normalisation, consultables aux adresses suivantes:

- IEC Electropedia: disponible à l'adresse <https://www.electropedia.org/>;
- ISO Online browsing platform: disponible à l'adresse <https://www.iso.org/obp>.

4 Informations techniques

4.1 Méthode de sortie recommandée

4.1.1 Généralités

Conformément à la série IEC 60352 ou à l'IEC 60999-1.

4.1.2 Nombre de contacts et de cavités de contact

Nombre de contacts: contacts d'alimentation: 2.

Nombre de cavités de contact (pour les contacts amovibles): 2.

Fil adapté: section des contacts d'alimentation: de 4 mm² jusqu'à 6 mm² Le cœur de chaque câble d'alimentation doit être protégé individuellement, chaque blindage exigeant une sortie dédiée.

4.2 Valeurs assignées et caractéristiques

Les connecteurs qui relèvent de la présente spécification n'ont pas de pouvoir de coupure au sens de l'IEC 61984 et ne sont donc pas prévus pour être accouplés ou désaccouplés en utilisation normale lorsqu'ils sont sous tension ou sous charge.

Tension assignée: 50 V CA/CC

Tension assignée de tenue aux chocs U_{imp} : 4 kV

Tension de tenue: 2 500 V en courant alternatif

Degré de pollution: 2

Courant assigné (à 85 °C): 40 A. Voir la Figure 6.

Résistance d'isolement: 5 000 MΩ

Catégorie climatique: 55/125/10

NOTE Alors que la tension assignée de tenue aux chocs U_{imp} correspondant à une tension assignée de 50 V en courant alternatif/continu et de catégorie de surtension III est de 0,8 kV (1,5 kV pour les applications de catégorie de surtension IV) conformément au Tableau F.1 de l'IEC 60664-1:2020 (ainsi que les Tableaux B.1 et B.2), le connecteur présente une U_{imp} de 4 kV pour couvrir des applications d'utilisation finale plus exigeantes.

4.3 Systèmes de niveaux

4.3.1 Niveaux de performances

Non spécifiés.

4.3.2 Niveaux de compatibilité

Les niveaux de compatibilité des produits spécifiés par le présent document doivent être conformes à 2.2.3.3 de l'IEC 61076-1:2006 (niveau 2 – accouplable).

4.4 Classification en catégories climatiques

La classification en catégories climatiques est spécifiée en 6.1.

4.5 Ligne de fuite et distance d'isolement

Les lignes de fuite et les distances d'isolement doivent être conformes à 6.2.1 du présent document (connecteur sans pouvoir de coupure tel que défini dans l'IEC 61984).

4.6 Courant admissible

Courant admissible spécifié en 6.2.3.

4.7 Marquage

Le marquage du connecteur et le marquage de son emballage doivent être conformes à 2.7 de l'IEC 61076-1:2006.

5 Informations relatives aux dimensions

5.1 Généralités

Les dimensions sont données en millimètres. Les schémas sont représentés en utilisant la projection de premier dièdre. La forme des connecteurs peut varier de celle donnée sur les schémas suivants tant que ceci n'a pas d'influence sur les dimensions spécifiées.

Les dimensions manquantes doivent être choisies en fonction des caractéristiques communes et de l'utilisation prévue.

5.2 Vue isométrique et caractéristiques communes

5.2.1 Généralités

La Figure 1 présente une vue isométrique de la fiche tandis que la Figure 2 présente une vue isométrique de l'embase.

5.2.2 Vue isométrique d'une fiche

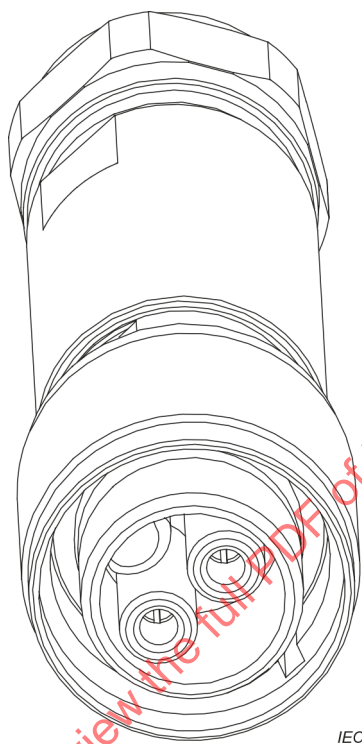


Figure 1 – Fiche

5.2.3 Vue isométrique d'une embase

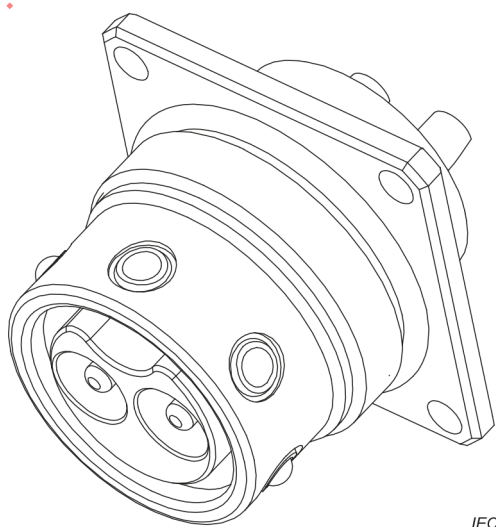


Figure 2 – Embase

5.3 Fiche

5.3.1 Généralités

La Figure 3 et le Tableau 1 présentent des schémas ainsi que les dimensions de la fiche.

5.3.2 Dimensions

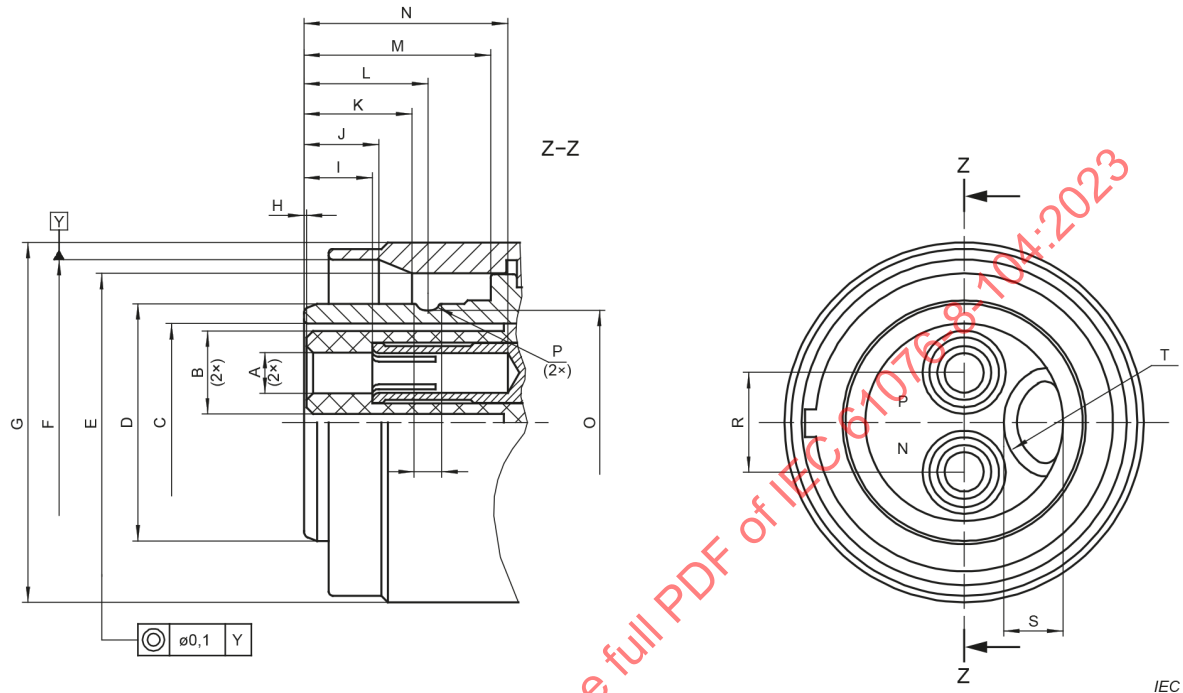


Figure 3 – Fiche

Tableau 1 – Dimensions d'une fiche

Dimensions exprimées en mm

Cote	Valeur minimale	Nominale	Maximale
A	Φ3,1	Φ3,1	Φ3,2
B	Φ6,2	Φ6,3	Φ6,3
C	Φ15,05	Φ15,10	Φ15,15
D	Φ17,85	Φ17,90	Φ17,90
E	Φ22,6	Φ22,6	Φ22,71
F	Φ24,75	Φ24,80	Φ24,86
G	Φ26,97	Φ27,3	Φ27,3
H	0,2	-	-
I	5,15	5,2	5,25
J	5,65	5,7	5,75
K	8,15	8,2	8,25
L	9,45	9,5	9,55
M	15,2	-	-
N	15,5	-	-
O	Φ16,80	Φ16,85	Φ16,85
P	R0,75	R0,8	R0,85
Q	2,1	2,1	2,2
R	7 475	7 500	7 525
S	4,4	4,5	4,5
T	R4,4	R4,5	R4,5

5.3.3 Sorties

Sorties conformément soit à la série IEC 60352 (connexions sans soudure) soit à l'IEC 60999-1 (organes de serrage à vis et sans vis).

5.4 Embase

5.4.1 Dimensions (voir la Figure 4 et le Tableau 2)

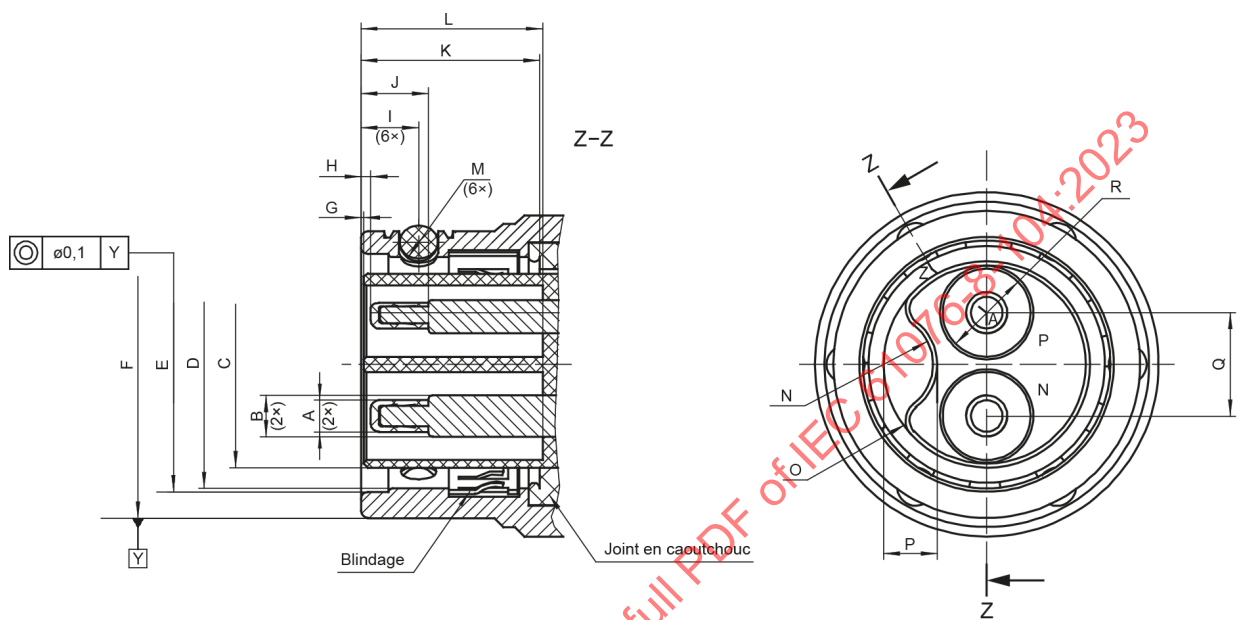


Figure 4 – Embase

Tableau 2 – Dimensions de l'embase

Dimensions exprimées en mm

Cote	Valeur minimale	Nominale	Maximale
A	Φ2,2	Φ2,3	Φ2,3
B	Φ2,83	Φ2,85	Φ2,87
C	Φ14,9	Φ15	Φ15
D	Φ18,05	Φ18,10	Φ18,16
E	Φ18,53	Φ18,55	Φ18,58
F	Φ22,2	Φ22,3	Φ22,3
G	0,2	-	-
H	0,65	0,7	0,75
I	4,15	4,2	4,25
J	4,85	4,9	4,95
K	12,9	13	13,15
L	13,2	-	-
M	Φ2,777	Φ2,778	Φ2,779
N	R3,6	R3,6	R3,7
O	R1,5	R1,5	R1,6
P	3,6	3,6	3,8
Q	7 475	7,5	7 525
R	Φ6,4	Φ6,4	Φ6,5

5.4.2 Sorties

Sorties conformément soit à la série IEC 60352 (connexions sans soudure) soit à l'IEC 60999-1 (organes de serrage à vis et sans vis).

5.5 Informations de montage pour connecteurs

Les informations de montage peuvent être spécifiées par accord entre le fabricant et le client.

5.6 Calibres – Calibres de dimensionnement et calibres de force de rétention

La Figure 5 et le Tableau 3 présentent le schéma et les dimensions des contacts de calibre.

Matériel: outil en acier de dureté 60 à 64 HRC conformément à l'ISO 6508-1 et d'une rugosité de surface conformément à l'ISO 21920-1:2021: $Ra_{\max} = 0,25 \mu\text{m}$, $Ra_{\min} = 0,15 \mu\text{m}$.

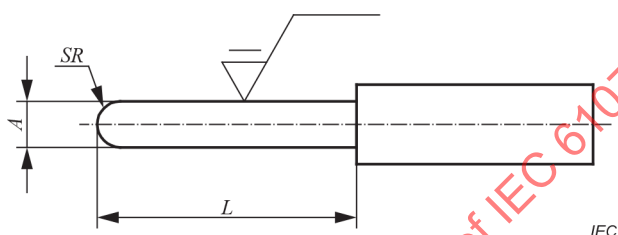


Figure 5 – Calibre pour contact

Tableau 3 – Dimensions des calibres

Calibre	Masse g	Application	A mm	L mm
P11	-	Dimensionnement	$\Phi 2,87^{+0,005}_0$	15 min.
P12	200	Force de rétention	$\Phi 2,83^{0}_{-0,005}$	15 min.

6 Caractéristiques techniques

6.1 Classification en catégories climatiques

Conditions: conformément à l'IEC 60068-1 et au Tableau 4.

Tableau 4 – Catégorie climatique

Catégorie climatique	Température inférieure °C	Température supérieure °C	Température °C	Humidité relative %	Chaleur humide, essai continu Jours
55/125/10	-55	+125	40	93	10

6.2 Caractéristiques électriques

6.2.1 Ligne de fuite et distance d'isolement

Pour ce connecteur, les distances d'isolement et les lignes de fuite doivent être uniquement mesurées en état accouplé.

Ligne de fuite de 3,9 mm au minimum. Distance d'isolement de 3,9 mm au minimum.

6.2.2 Tension de tenue

Conditions: IEC 60512-4-1, Essai 4a, méthode A.

Conditions atmosphériques normales, connecteurs accouplés.


Exigences: tension d'essai conformément au Tableau 5. Il ne doit y avoir aucun claquage ni contournement.

Tableau 5 – Tension de tenue

N°	Points de mesure	Tension d'essai V CA eff.	Durée d'essai min
1	Entre contacts, et entre contacts et boîtier métallique	2 500	1

6.2.3 Courant admissible

Le courant admissible doit être vérifié conformément à l'IEC 60512-5-2, Essai 5b, avec la section maximale acceptée (6 mm²), pour démontrer la conformité au courant assigné (40 A) et à la température limite supérieure (125 °C). Voir la Figure 6 pour le taux de réduction de l'intensité en fonction de la température.

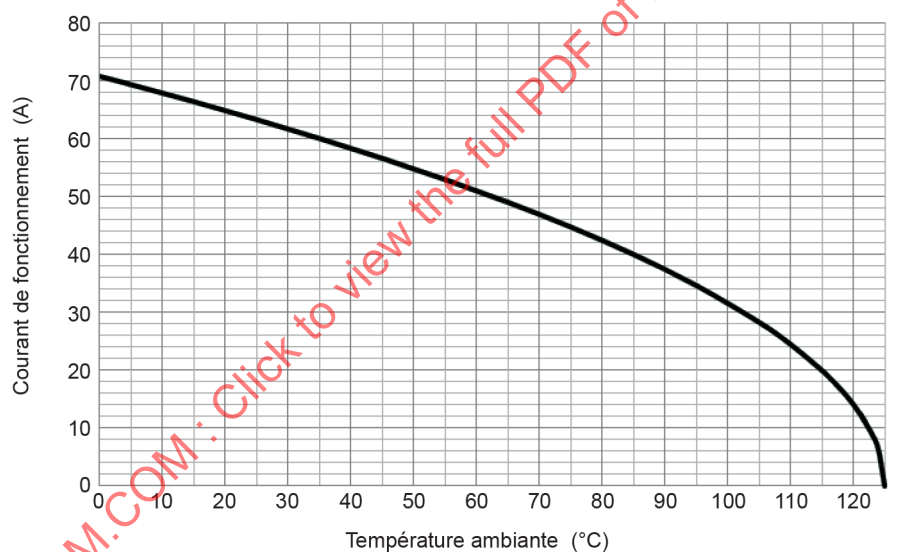

NOTE La courbe est l'expression de la formule

$$I_{(T)} = 70,72 \times (1 - T/125)^{0,5}$$

Figure 6 – Taux de réduction de l'intensité en fonction de la température (section de fil de 6 mm²)

6.2.4 Charge électrique et température

Conditions: IEC 60512-9-2, Essai 9b.

Conditions atmosphériques normales, connecteurs accouplés, contacts connectés à l'aide de fils de cuivre torsadés de classe 5 selon l'IEC 60228, section des fils de 6 mm².

Courant d'essai: 40 A, température: 85 °C ± 2 °C, durée: 500 h.

Exigences: l'aspect, la résistance de contact (6.2.5), la continuité électrique du boîtier (6.2.6), la résistance d'isolement (6.2.7), la tension de tenue (6.2.2), les forces d'accouplement et de

désaccouplement (6.3.4) ainsi que le degré de protection IP (6.4.4) doivent satisfaire aux exigences de la présente spécification après essai.

6.2.5 Résistance de contact

Conditions: IEC 60512-2-1, Essai 2a.

Conditions atmosphériques normales.

Exigences: Résistance initiale: 1 mΩ max.

Final: 2 mΩ max.

6.2.6 Continuité électrique du boîtier

Conditions: IEC 60512-2-6, Essai 2f.

Conditions atmosphériques normales, connecteurs accouplés.

La résistance doit être mesurée selon l'essai 2b de l'IEC 60512-2-2.

Exigences: Résistance initiale: 5 mΩ max.

Final: 10 mΩ max.

6.2.7 Résistance d'isolement

Conditions: IEC 60512-3-1, Essai 3a, méthode A.

Conditions atmosphériques normales, connecteurs accouplés.

Tension d'essai: 500 V CC ± 50 V CC.

Exigences: Initiale: entre contacts, et entre contacts et boîtier métallique: 5 000 MΩ min.

Finale: entre contacts, et entre contacts et boîtier métallique: 100 MΩ min.

6.3 Caractéristiques mécaniques

6.3.1 Fonctionnement mécanique

Conditions: IEC 60512-9-1, Essai 9a.

Conditions atmosphériques normales, connecteurs accouplés.

Taux de l'opération d'insertion et d'extraction: 10 mm/s max.

Nombre de cycles de manœuvre: 500 cycles.

Exigences: l'aspect, la résistance de contact (6.2.5), la continuité électrique du boîtier (6.2.6), la résistance d'isolement (6.2.7), la tension de tenue (6.2.2), la méthode de détrompage et de codage (6.3.6) ainsi que le degré de protection IP (6.4.4) doivent satisfaire aux exigences de la présente spécification après essai.

6.3.2 Efficacité des dispositifs d'accouplement des connecteurs

Conditions: IEC 60512-15-6, Essai 15f.

Conditions atmosphériques normales, connecteurs accouplés.

Force axiale: 500 N.

Exigences: Durée de perturbation max. de 1 μs pendant l'essai. Les connecteurs doivent rester pleinement accouplés. L'aspect des connecteurs doit satisfaire aux exigences de la phase d'essai P1.

6.3.3 Force de rétention du calibre (contact élastique)

Condition: IEC 60512-16-5, Essai 16e, méthode A.

Conditions atmosphériques normales.

Exigences: Les calibres doivent être retenus.

6.3.4 Forces d'accouplement et de désaccouplement

Condition: IEC 60512-13-1, Essai 13a.

Conditions atmosphériques normales.

Taux d'accouplement et de désaccouplement: 10 mm/s max.

Exigences: force d'accouplement: 100 N max.

Force de désaccouplement: 4 N à 80 N.

6.3.5 Rétention des contacts dans l'isolant

Conditions: IEC 60512-15-1, Essai 15a.

Conditions atmosphériques normales, connecteurs désaccouplés.

Force axiale: 150 N.

Exigences: le déplacement du contact sous l'effet des forces axiales doit être inférieur à 0,5 mm et inférieur à 0,3 mm après la suppression de ces forces. L'aspect des connecteurs doit satisfaire aux exigences de la présente spécification après essai.

6.3.6 Méthode de détrompage et de codage

Conditions: IEC 60512-13-5, Essai 13e.

Conditions atmosphériques normales, aucun outil ni calibre exigés, forces d'accouplement involontaires: 150 N.

Exigence: l'aspect des connecteurs doit satisfaire aux exigences de la phase d'essai P1.

6.4 Essais de contraintes dynamiques

6.4.1 Vibrations (sinusoïdales)

Conditions: IEC 60512-6-4, Essai 6d.

Conditions atmosphériques normales, connecteurs accouplés.

L'embase et la fiche doivent être fixées de manière rigide dans un système de fixation approprié.

Sévérité des vibrations: 10 Hz à 500 Hz et 0,75 mm ou 10 g.

Cycle de balayage: 10 cycles selon chacun des 3 axes.

Exigences: Durée de perturbation max. de 1 µs pendant l'essai. L'aspect, la résistance de contact (6.2.5), la continuité électrique du boîtier (6.2.6), les forces d'accouplement et de désaccouplement (6.3.4) ainsi que le degré de protection IP (6.4.4) doivent satisfaire aux exigences de la présente spécification après essai.

6.4.2 Chocs

Conditions: IEC 60512-6-3, Essai 6c.

Conditions atmosphériques normales, connecteurs accouplés.

Accélération: 500 m/s², durée: 11 ms, onde semi-sinusoïdale, 3 chocs selon chaque axe et dans chaque direction, 3 axes perpendiculaires les uns aux autres.

Exigences: Durée de perturbation max. de 1 µs pendant l'essai. L'aspect, la résistance de contact (6.2.5), la continuité électrique du boîtier (6.2.6), les forces d'accouplement et de désaccouplement (6.3.4) ainsi que le degré de protection IP (6.4.4) doivent satisfaire aux exigences de la présente spécification après essai.

6.4.3 Chute libre (essai répété)

Conditions: IEC 60512-7-1, Essai 7a.

Nombre total de tours: 25.

Exigence: l'aspect des connecteurs doit satisfaire aux exigences de la phase d'essai P1.

6.4.4 Degré de protection IP

Conditions: conformément à l'IEC 60529:1989, connecteurs accouplés: IP65/IP67, connecteurs désaccouplés: IPXXB. Les spécimens précédemment soumis aux essais prévus en 6.2.4 (charge électrique et température), 6.3.1 (fonctionnement mécanique), 6.4.1 (vibration) et 6.4.2 (choc) selon les groupes d'essais correspondants (B, D et A) peuvent être facilement soumis à ces essais de code IP, indépendamment de leur appartenance à différents groupes d'essais.

Exigence: IPX5 conformément à 14.2.5 de l'IEC 60529:1989; IPX7 conformément à 14.2.7 de l'IEC 60529:1989; IP6X conformément au Tableau 7 de l'IEC 60529:1989; IPXXB conformément à 15.2 de l'IEC 60529:1989.

6.4.5 Méthode d'essai d'inflammabilité pour produits finis (GWEPT)

Conditions: IEC 60512-20-3, Essai 20c.

Température: 850 °C ± 15 °C.

Exigence: conformément à l'Article 10 de l'IEC 60695-2-11:2021.

6.5 Essais climatiques

6.5.1 Variations rapides de température

Conditions: IEC 60512-11-4, Essai 11d.

Température: entre -55 °C et 125 °C, connecteurs accouplés.

Exigences: l'aspect, la résistance d'isolement (6.2.7), la résistance de contact (6.2.5), la continuité électrique du boîtier (6.2.6) et la tension de tenue (6.2.2) doivent satisfaire aux exigences de la présente spécification après essai.

6.5.2 Chaleur sèche

Conditions: IEC 60512-11-9, Essai 11i.

Température: 125 °C ± 2 °C, durée: 96 h, connecteurs accouplés.

Exigences: l'aspect et la résistance de contact (6.2.5), les forces d'accouplement et de désaccouplement (6.3.4), la rétention des contacts dans l'isolant (6.3.5), la tension de tenue (6.2.2) ainsi que le degré de protection IP (6.4.4) doivent satisfaire aux exigences de la présente spécification après essai.

6.5.3 Température la plus basse:

Conditions: IEC 60512-11-10, Essai 11j.

Température: $-55\text{ °C} \pm 2\text{ °C}$, durée: 96 h, connecteurs accouplés.

Exigences: l'aspect et la résistance de contact (6.2.5), les forces d'accouplement et de désaccouplement (6.3.4), la rétention des contacts dans l'isolant (6.3.5), la tension de tenue (6.2.2) ainsi que le degré de protection IP (6.4.4) doivent satisfaire aux exigences de la présente spécification après essai.

6.5.4 Basse pression atmosphérique

Conditions: IEC 60512-11-11, Essai 11k.

Basse pression atmosphérique: 54 kPa, connecteurs accouplés.

Exigences: la tension de tenue (6.2.2) à basse pression atmosphérique doit satisfaire aux exigences de la présente spécification.

6.5.5 Essai cyclique de chaleur humide

Conditions: IEC 60512-11-12, Essai 11m.

Durée: 6 h, connecteurs accouplés.

Exigences: l'aspect, la résistance d'isolement (6.2.7), la tension de tenue (6.2.2), la résistance de contact (6.2.5) ainsi que les forces d'accouplement et de désaccouplement (6.3.4) doivent satisfaire aux exigences de la présente spécification après essai.

6.5.6 Chaleur humide, essai continu

Conditions: IEC 60512-11-3, Essai 11c.

Durée: 10 s, connecteurs accouplés.

Exigences: l'aspect, la résistance d'isolement (6.2.7), la tension de tenue (6.2.2), la résistance de contact (6.2.5) ainsi que les forces d'accouplement et de désaccouplement (6.3.4) doivent satisfaire aux exigences de la présente spécification après essai.

6.5.7 Corrosion, brouillard salin

Conditions: IEC 60512-11-6, Essai 11f.

Durée: 7 jours, connecteurs accouplés.

Exigence: l'aspect des connecteurs doit satisfaire aux exigences de la phase d'essai P1.

6.5.8 Essai de corrosion dans un flux de mélange de gaz

Conditions: IEC 60512-11-7, Essai 11g.

Durée: 4 jours, méthode d'essai 4 selon l'IEC 60068-2-60.

Exigences: l'aspect, la résistance de contact (6.2.5) et les forces d'accouplement et de désaccouplement (6.3.4) doivent satisfaire aux exigences de la présente spécification après essai.

6.6 Aspects environnementaux

6.6.1 Marquage des matériaux isolants (plastiques)

Le cas échéant et si possible, il convient de marquer tous les matériaux en plastique conformément à l'ISO 11469 pour en faciliter le recyclage.

6.6.2 Conception/utilisation des matériaux

La conception doit tenir compte de l'IEC applicable pour la conception de produits (IEC 62430:2019) et l'utilisation de matériaux (IEC Guide 109) en ce qui concerne l'environnement.

7 Programme d'essais

7.1 Généralités

Le programme d'essais indique les essais subdivisés en groupes d'essais et au sein de chaque groupe l'ordre dans lequel ils doivent être réalisés, ainsi que les exigences à satisfaire.

Le groupe d'essais préliminaires P s'applique à tous les spécimens, dont le nombre est égal à la somme du nombre de spécimens spécifiés pour chaque groupe d'essais ultérieurs, qui peuvent alors fonctionner indépendamment les uns des autres.

Par la suite, une paire de connecteurs accouplés est appelée "spécimen".

Le nombre de spécimens nécessaires est défini dans le Tableau 6.

Tableau 6 – Nombre de spécimens

Groupe d'essais	AP	BP	CP	DP	EP	FP	GP	HP
Spécimens d'essai	3	6	3	3	3	Non applicable	3	3

7.2 Programmes d'essai

7.2.1 Programme d'essai de base (minimal)

Non applicable.

7.2.2 Programme d'essai complet

7.2.2.1 Groupe d'essais P – Essais préliminaires

Tous les spécimens doivent être soumis aux essais suivants. Voir le Tableau 7.

Tableau 7 – Groupe d'essais P

Phase d'essai	Essai			Mesure à effectuer		Exigences
	Titre	N° d'essai dans la série IEC 60512	Sévérité ou condition de l'essai	Titre	N° d'essai dans la série IEC 60512	
P1	Examen général	1	Connecteurs désaccouplés	Examen visuel	1a	Aucun défaut susceptible de nuire au fonctionnement normal
				Examen des dimensions ^a	1b	Les dimensions doivent satisfaire à celles spécifiées en 5.3 et 5.4
P2	Méthode de polarisation et de codage	13e	150 N			Doit être comme indiqué en 6.3.6 Aucun défaut susceptible de nuire au fonctionnement normal
P3				Résistance de contact – Méthode du niveau des millivolts	2a	Doit être comme indiqué en 6.2.5 1 mΩ max.
P4			Connecteurs accouplés	Continuité électrique du boîtier	2f	Doit être comme indiqué en 6.2.7 5 mΩ max.
P5			Méthode A, tension d'essai: 500 V c.c. ± 50 V c.c.	Résistance d'isolement	3a	Doit être comme indiqué en 6.2.7 Entre contacts, et entre contacts et boîtier métallique: 5 000 MΩ min.
P6			Méthode A, durée: 1 min Entre contacts, et entre contacts et boîtier métallique: 2 500 V en courant alternatif min.	Tension de tenue	4a	Doit être comme indiqué en 6.2.2 Ni claquage ni contournement.

^a En cas d'analyse physique destructive, 1 spécimen doit être ajouté.

7.2.2.2 Groupe d'essais AP – Essais dynamiques/climatiques

Le nombre de spécimens spécifiés dans le Tableau 6 doit être soumis aux essais suivants. Voir le Tableau 8.