

# INTERNATIONAL STANDARD

Industrial communication networks – Fieldbus specifications –  
Part 3-3: Data-link layer service definition – Type 3 elements

IECNORM.COM: Click to view the full PDF of IEC 61158-3-3:2007



## THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2007 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland  
Email: [inmail@iec.ch](mailto:inmail@iec.ch)  
Web: [www.iec.ch](http://www.iec.ch)

### About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

### About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: [www.iec.ch/searchpub](http://www.iec.ch/searchpub)

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: [www.iec.ch/online\\_news/justpub](http://www.iec.ch/online_news/justpub)

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: [www.electropedia.org](http://www.electropedia.org)

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.

- Customer Service Centre: [www.iec.ch/webstore/custserv](http://www.iec.ch/webstore/custserv)

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: [csc@iec.ch](mailto:csc@iec.ch)  
Tel.: +41 22 919 02 11  
Fax: +41 22 919 03 00

IECNORM.COM: Click to view the full PDF of IEC 607158-03B:2007

# INTERNATIONAL STANDARD

---

**Industrial communication networks – Fieldbus specifications –  
Part 3-3: Data-link layer service definition – Type 3 elements**

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

PRICE CODE

**XB**

## CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
1 Scope.....	8
1.1 Overview.....	8
1.2 Specifications.....	8
1.3 Conformance.....	8
2 Normative references.....	9
3 Terms, definitions, symbols, abbreviations and conventions.....	9
3.1 Reference model terms and definitions.....	9
3.2 Service convention terms and definitions.....	10
3.3 Common data-link service terms and definitions.....	11
3.4 Additional Type 3 data-link specific definitions.....	13
3.5 Common symbols and abbreviations.....	15
3.6 Additional Type 3 symbols and abbreviations.....	16
3.7 Common conventions.....	18
3.8 Additional Type 3 conventions.....	19
4 Connectionless-mode data-link service.....	19
4.1 General.....	19
4.2 Model of the connectionless-mode data-link service.....	20
4.3 Sequence of primitives.....	21
4.4 Detailed description of DL services.....	25
5 DL-management Service.....	44
5.1 General.....	44
5.2 Facilities of the DLMS.....	44
5.3 Services of the DL-management.....	44
5.4 Overview of interactions.....	46
5.5 Detailed specification of services and interactions.....	47
Bibliography.....	68
Figure 1 – Relationships of DLSAPs, DLSAP-addresses and group DL-addresses.....	12
Figure 2 – SDA service.....	22
Figure 3 – SDN service.....	23
Figure 4 – SRD service.....	23
Figure 5 – MSRD service.....	24
Figure 6 – CS service.....	24
Figure 7 – Reset, Set value, Get value, Ident (local), DLSAP status, DLSAP activate, DLSAP activate responder, DLSAP activate subscriber and DLSAP deactivate services.....	47
Figure 8 – Event service.....	47
Figure 9 – Ident (remote) service.....	47
Table 1 – Summary of DL services and primitives.....	22
Table 2 – SDA data ack primitives and parameters.....	26
Table 3 – Values of DL_status for the SDA data ack service.....	28
Table 4 – SDN data primitives and parameters.....	29

Table 5 – Values of DL_status for the SDN data service .....	30
Table 6 – SRD data reply primitives and parameters.....	32
Table 7 – Values of Update_status for the SRD data reply service .....	33
Table 8 – Additional values of DL_status for the SRD data reply service .....	34
Table 9 – SRD reply-update primitives and parameters.....	34
Table 10 – Values of DL_status for the SRD reply-update service .....	35
Table 11 – MSRD MCT data reply primitives and parameters.....	37
Table 12 – MSRD DXM data reply primitive and parameters .....	39
Table 13 – CS time event primitives and parameters .....	40
Table 14 – Values of DL_status for the CS time event service .....	42
Table 15 – CS clock value primitives and parameters .....	42
Table 16 – Values of CS_status for the CS clock value service.....	43
Table 17 – Values of DL_status for the CS clock value service .....	44
Table 18 – Summary of DL-management services and primitives.....	46
Table 19 – Reset primitives and parameters .....	47
Table 20 – Values of DLM_status for the reset service.....	48
Table 21 – Set value primitives and parameters.....	48
Table 22 – Mandatory DLE-variables .....	49
Table 23 – Optional DLE-variables .....	49
Table 24 – Permissible values of mandatory DLE-variables .....	50
Table 25 – Permissible values of optional DLE-variables.....	50
Table 26 – Meaning of the values for the parameter isochronous_mode.....	51
Table 27 – Default reaction times and operating parameters for a master station for asynchronous transmission.....	51
Table 28 – Default reaction times and operating parameters for a slave station with asynchronous transmission.....	51
Table 29 – Default reaction times and operating parameters for master stations for coupling of synchronous and asynchronous transmission segments .....	52
Table 30 – Default reaction times and operating parameter for slave stations for coupling of synchronous and asynchronous transmission segments .....	52
Table 31 – Values of DLM_status for the set value service .....	52
Table 32 – Get value primitives and parameters .....	53
Table 33 – Additional mandatory DLE-variables in master stations.....	53
Table 34 – Permissible values of the additional DLE-variables in master stations.....	54
Table 35 – Values of DLM_status for the get value service .....	54
Table 36 – Event primitive and parameters.....	55
Table 37 – Mandatory DLL events and fault types .....	55
Table 38 – Permissible values of T <sub>SH</sub> .....	55
Table 39 – Ident primitives and parameters .....	56
Table 40 – Ident_list for the ident service .....	57
Table 41 – Values of DLM_status for the ident service (local) .....	57
Table 42 – Values of DLM_status for the ident service (remote).....	57
Table 43 – DLSAP status primitives and parameters.....	58
Table 44 – Values of DLM_status for the DLSAP status service .....	59

Table 45 – DLSAP activate primitives and parameters .....	59
Table 46 – DLSAP activate service_list.....	60
Table 47 – DLSAP activate DLSDU_length_list (SDA, SDN, SRD, MSRD and CS) .....	61
Table 48 – DLSDU lengths of SDA and SDN as used in the DLSAP activate service .....	61
Table 49 – DLSDU lengths of SRD and MSRD as used in the (master station) DLSAP activate service .....	61
Table 50 – DLSDU lengths of CS as used in the DLSAP activate service .....	62
Table 51 – Values of DLM_status for the DLSAP activate service .....	62
Table 52 – DLSAP activate responder primitives and parameters.....	62
Table 53 – DLSDU_length_list for the DLSAP activate responder service.....	63
Table 54 – DLSDU length of SRD and MSRD as used in the DLSAP activate responder service .....	63
Table 55 – Values of DLM_status for the DLSAP activate responder service .....	64
Table 56 – DLSAP activate subscriber primitives and parameters .....	65
Table 57 – DLSDU_length_list for the DLSAP activate subscriber service .....	65
Table 58 – DLSDU lengths of MSRD as used in the DLSAP activate subscriber service (master and slave stations).....	65
Table 59 – Values of DLM_status for the DLSAP activate subscriber service .....	66
Table 60 – DLSAP deactivate primitives and parameters .....	66
Table 61 – Values of DLM_status for the DLSAP deactivate service.....	67

IECNORM.COM: Click to view the full PDF of IEC 61158-3-3:2007

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**INDUSTRIAL COMMUNICATION NETWORKS –  
FIELDBUS SPECIFICATIONS –****Part 3-3: Data-link layer service definition – Type 3 elements**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

NOTE Use of some of the associated protocol types is restricted by their intellectual-property-right holders. In all cases, the commitment to limited release of intellectual-property-rights made by the holders of those rights permits a particular data-link layer protocol type to be used with physical layer and application layer protocols in type combinations as specified explicitly in the IEC 61784 series. Use of the various protocol types in other combinations may require permission of their respective intellectual-property-right holders.

International Standard IEC 61158-3-3 has been prepared by subcommittee 65C: Industrial networks, of IEC technical committee 65: Industrial-process measurement, control and automation.

This first edition and its companion parts of the IEC 61158-3 subseries cancel and replace IEC 61158-3:2003. This edition of this part constitutes an editorial revision.

This edition includes the following significant changes with respect to the previous edition:

- a) deletion of the former Type 6 fieldbus, and the placeholder for a Type 5 fieldbus data-link layer, for lack of market relevance;
- b) addition of new types of fieldbuses;
- c) division of this part into multiple parts numbered 3-1, 3-2, ..., 3-19.

The text of this standard is based on the following documents:

FDIS	Report on voting
65C/473/FDIS	65C/484/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with ISO/IEC Directives, Part 2.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under <http://webstore.iec.ch> in the data related to the specific publication. At this date, the publication will be:

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

NOTE The revision of this standard will be synchronized with the other parts of the IEC 61158 series.

The list of all the parts of the IEC 61158 series, under the general title *Industrial communication networks – Fieldbus specifications*, can be found on the IEC web site.

IECNORM.COM: Click to view the full PDF of IEC 61158-3-3:2007  
Withdrawn

## INTRODUCTION

This part of IEC 61158 is one of a series produced to facilitate the interconnection of automation system components. It is related to other standards in the set as defined by the “three-layer” fieldbus reference model described in IEC/TR 61158-1.

Throughout the set of fieldbus standards, the term “service” refers to the abstract capability provided by one layer of the OSI Basic Reference Model to the layer immediately above. Thus, the data-link layer service defined in this standard is a conceptual architectural service, independent of administrative and implementation divisions.

IECNORM.COM: Click to view the full PDF of IEC 61158-3-3:2007  
Withdrawn

# INDUSTRIAL COMMUNICATION NETWORKS – FIELD BUS SPECIFICATIONS –

## Part 3-3: Data-link layer service definition – Type 3 elements

### 1 Scope

#### 1.1 Overview

This part of IEC 61158 provides common elements for basic time-critical messaging communications between devices in an automation environment. The term “time-critical” is used to represent the presence of a time-window, within which one or more specified actions are required to be completed with some defined level of certainty. Failure to complete specified actions within the time window risks failure of the applications requesting the actions, with attendant risk to equipment, plant and possibly human life.

This standard defines in an abstract way the externally visible service provided by the Type 3 fieldbus data-link layer in terms of

- a) the primitive actions and events of the service;
- b) the parameters associated with each primitive action and event, and the form which they take; and
- c) the interrelationship between these actions and events, and their valid sequences.

The purpose of this standard is to define the services provided to

- the Type 3 fieldbus application layer at the boundary between the application and data-link layers of the fieldbus reference model, and
- systems management at the boundary between the data-link layer and systems management of the fieldbus reference model.

#### 1.2 Specifications

The principal objective of this standard is to specify the characteristics of conceptual data-link layer services suitable for time-critical communications, and thus supplement the OSI Basic Reference Model in guiding the development of data-link protocols for time-critical communications. A secondary objective is to provide migration paths from previously existing industrial communications protocols.

This specification may be used as the basis for formal DL-Programming-Interfaces. Nevertheless, it is not a formal programming interface, and any such interface will need to address implementation issues not covered by this specification, including

- a) the sizes and octet ordering of various multi-octet service parameters, and
- b) the correlation of paired request and confirm, or indication and response, primitives.

#### 1.3 Conformance

This standard does not specify individual implementations or products, nor do they constrain the implementations of data-link entities within industrial automation systems.

There is no conformance of equipment to this data-link layer service definition standard. Instead, conformance is achieved through implementation of the corresponding data-link protocol that fulfills the Type 1 data-link layer services defined in this standard.

## 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO/IEC 7498-1, *Information technology – Open Systems Interconnection – Basic Reference Model — Basic Reference Model: The Basic Model*

ISO/IEC 7498-3, *Information technology – Open Systems Interconnection – Basic Reference Model: Naming and addressing*

ISO/IEC 10731, *Information technology – Open Systems Interconnection – Basic Reference Model – Conventions for the definition of OSI services*

## 3 Terms, definitions, symbols, abbreviations and conventions

For the purposes of this document, the following terms, definitions, symbols, abbreviations and conventions apply.

### 3.1 Reference model terms and definitions

This standard is based in part on the concepts developed in ISO/IEC 7498-1 and ISO/IEC 7498-3, and makes use of the following terms defined therein.

<b>3.1.1 DL-address</b>	[7498-3]
<b>3.1.2 DL-address-mapping</b>	[7498-1]
<b>3.1.3 called-DL-address</b>	[7498-3]
<b>3.1.4 calling-DL-address</b>	[7498-3]
<b>3.1.5 centralized multi-end-point-connection</b>	[7498-1]
<b>3.1.6 DL-connection</b>	[7498-1]
<b>3.1.7 DL-connection-end-point</b>	[7498-1]
<b>3.1.8 DL-connection-end-point-identifier</b>	[7498-1]
<b>3.1.9 DL-connection-mode transmission</b>	[7498-1]
<b>3.1.10 DL-connectionless-mode transmission</b>	[7498-1]
<b>3.1.11 correspondent (N)-entities</b>	[7498-1]
<b>correspondent DL-entities (N=2)</b>	
<b>correspondent Ph-entities (N=1)</b>	
<b>3.1.12 DL-duplex-transmission</b>	[7498-1]
<b>3.1.13 (N)-entity</b>	[7498-1]
<b>DL-entity (N=2)</b>	
<b>Ph-entity (N=1)</b>	
<b>3.1.14 DL-facility</b>	[7498-1]
<b>3.1.15 flow control</b>	[7498-1]

<b>3.1.16 (N)-layer</b>	[7498-1]
DL-layer (N=2)	
Ph-layer (N=1)	
<b>3.1.17 layer-management</b>	[7498-1]
<b>3.1.18 DL-local-view</b>	[7498-3]
<b>3.1.19 DL-name</b>	[7498-3]
<b>3.1.20 naming-(addressing)-domain</b>	[7498-3]
<b>3.1.21 peer-entities</b>	[7498-1]
<b>3.1.22 primitive name</b>	[7498-3]
<b>3.1.23 DL-protocol</b>	[7498-1]
<b>3.1.24 DL-protocol-connection-identifier</b>	[7498-1]
<b>3.1.25 DL-protocol-data-unit</b>	[7498-1]
<b>3.1.26 DL-relay</b>	[7498-1]
<b>3.1.27 reset</b>	[7498-1]
<b>3.1.28 responding-DL-address</b>	[7498-3]
<b>3.1.29 routing</b>	[7498-1]
<b>3.1.30 segmenting</b>	[7498-1]
<b>3.1.31 (N)-service</b>	[7498-1]
DL-service (N=2)	
Ph-service (N=1)	
<b>3.1.32 (N)-service-access-point</b>	[7498-1]
DL-service-access-point (N=2)	
Ph-service-access-point (N=1)	
<b>3.1.33 DL-service-access-point-address</b>	[7498-3]
<b>3.1.34 DL-service-connection-identifier</b>	[7498-1]
<b>3.1.35 DL-service-data-unit</b>	[7498-1]
<b>3.1.36 DL-simplex-transmission</b>	[7498-1]
<b>3.1.37 DL-subsystem</b>	[7498-1]
<b>3.1.38 systems-management</b>	[7498-1]
<b>3.1.39 DLS-user-data</b>	[7498-1]

## **3.2 Service convention terms and definitions**

This standard also makes use of the following terms defined in ISO/IEC 10731 as they apply to the data-link layer:

### **3.2.1 acceptor**

### **3.2.2 asymmetrical service**

**3.2.3 confirm (primitive);  
requestor.deliver (primitive)**

**3.2.4 deliver (primitive)**

**3.2.5 DL-confirmed-facility**

**3.2.6 DL-facility**

**3.2.7 DL-local-view**

**3.2.8 DL-mandatory-facility**

**3.2.9 DL-non-confirmed-facility**

**3.2.10 DL-provider-initiated-facility**

**3.2.11 DL-provider-optional-facility**

**3.2.12 DL-service-primitive;  
primitive**

**3.2.13 DL-service-provider**

**3.2.14 DL-service-user**

**3.2.15 DLS-user-optional-facility**

**3.2.16 indication (primitive);  
acceptor.deliver (primitive)**

**3.2.17 multi-peer**

**3.2.18 request (primitive);  
requestor.submit (primitive)**

**3.2.19 requestor**

**3.2.20 response (primitive);  
acceptor.submit (primitive)**

**3.2.21 submit (primitive)**

**3.2.22 symmetrical service**

### **3.3 Common data-link service terms and definitions**

NOTE Many definitions are common to more than one protocol Type; they are not necessarily used by all protocol Types.

#### **3.3.1**

##### **DL-segment, link, local link**


single DL-subnetwork in which any of the connected DLEs may communicate directly, without any intervening DL-relaying, whenever all of those DLEs that are participating in an instance of communication are simultaneously attentive to the DL-subnetwork during the period(s) of attempted communication

#### **3.3.2**

##### **DLSAP**

distinctive point at which DL-services are provided by a single DL-entity to a single higher-layer entity

NOTE This definition, derived from ISO/IEC 7498-1, is repeated here to facilitate understanding of the critical distinction between DLSAPs and their DL-addresses.

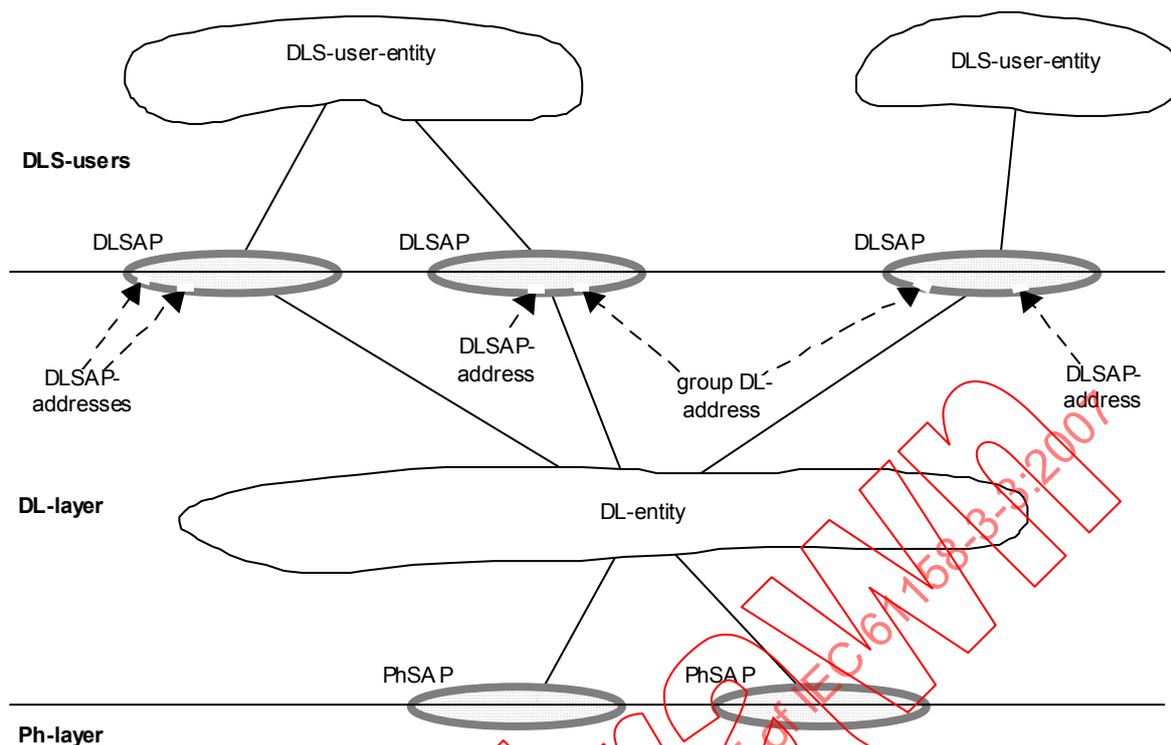

- NOTE 1 DLSAPs and PhSAPs are depicted as ovals spanning the boundary between two adjacent layers.
- NOTE 2 DL-addresses are depicted as designating small gaps (points of access) in the DLL portion of a DLSAP.
- NOTE 3 A single DL-entity may have multiple DLSAP-addresses and group DL-addresses associated with a single DLSAP.

**Figure 1 – Relationships of DLSAPs, DLSAP-addresses and group DL-addresses**

**3.3.3**

**DL(SAP)-address**

either an individual DLSAP address, designating a single DLSAP of a single DLS-user, or a group DL-address potentially designating multiple DLSAPs, each of a single DLS-user

NOTE This terminology is chosen because ISO/IEC 7498-3 does not permit the use of the term DLSAP-address to designate more than a single DLSAP at a single DLS-user.

**3.3.4**

**(individual) DLSAP-address**

DL-address that designates only one DLSAP within the extended link

NOTE A single DL-entity may have multiple DLSAP-addresses associated with a single DLSAP.

**3.3.5**

**extended link**

DL-subnetwork, consisting of the maximal set of links interconnected by DL-relays, sharing a single DL-name (DL-address) space, in which any of the connected DL-entities may communicate, one with another, either directly or with the assistance of one or more of those intervening DL-relay entities

NOTE An extended link may be composed of just a single link.

**3.3.6**

**frame**

denigrated synonym for DLPDU

**3.3.7****group DL-address**

DL-address that potentially designates more than one DLSAP within the extended link. A single DL-entity can have multiple group DL-addresses associated with a single DLSAP. A single DL-entity also can have a single group DL-address associated with more than one DLSAP

**3.3.8****node**

single DL-entity as it appears on one local link

**3.3.9****receiving DLS-user**

DL-service user that acts as a recipient of DLS-user-data

NOTE A DL-service user can be concurrently both a sending and receiving DLS-user.

**3.3.10****sending DLS-user**

DL-service user that acts as a source of DLS-user-data

**3.4 Additional Type 3 data-link specific definitions****3.4.1****acknowledgement DLPDU**

reply DLPDU that contains no DLSDU

**3.4.2****bit time**

time to transmit one bit

**3.4.3****clock synchronization**

represents a sequence of interactions to synchronize the clocks of all time receivers by a time master

**3.4.4****controller\_type**

hardware class of the communications entity

**3.4.5****data DLPDU**

DLPDU that carries a DLSDU from a local DLS-user to a remote DLS-user

**3.4.6****DL\_status, DLM\_status**

status that specifies the result of the execution of the associated request

**3.4.7****GAP**

range of station (DLE) DL-addresses from this station (TS) to its successor (NS) in the logical token ring, excluding stations above HSA

**3.4.8****isochronous mode**

special operational mode that implies both a constant (isochronous) cycle with a fixed schedule of high and low priority messages, and the synchronization of the DLS-users with this constant (isochronous) cycle

**3.4.9**

**local DLE**

DLE in a current master station that initiates the current transaction

**3.4.10**

**local DLS-user**

DLS-user that initiates the current service

**3.4.11**

**publisher**

transmitter of messages for consumption by subscribers

**3.4.12**

**region/segment address**

address extension that identifies a particular fieldbus subnetwork

NOTE This supports DL-routing between fieldbuses.

**3.4.13**

**remote DLE**

addressed DLE of a service request (that is, the intended receiving DLE of any resulting request DLPDU)

**3.4.14**

**remote DLS-user**

addressed DLS-user of a service request (that is, the intended receiver of any resulting indication primitive)

**3.4.15**

**reply DLPDU**

DLPDU transmitted from a remote DLE to the initiating (local) DLE, and possibly other DLEs

NOTE When the remote DLE is a Publisher, the reply DLPDU also can be sent to several remote DLEs.

**3.4.16**

**request DLPDU**

DLPDU that carries either a request for data or a DLSDU or both from a local DLS-user to a remote DLS-user

**3.4.17**

**response DLPDU**

reply DLPDU that carries a DLSDU from a remote DLS-user to local DLS-user

**3.4.18**

**station**

master or slave device containing a DLE

**3.4.19**

**subscriber**

receiver of messages produced by a publisher

**3.4.20**

**time event**

message that represents a trigger for a moment of time

**3.4.21**

**time master**

device which is able to send clock synchronization messages

NOTE Link devices have time master functionality.

### 3.4.22

#### **time receiver**

fieldbus device able to be time synchronized by a time master

### 3.4.23

#### **token passing**

medium access method, in which the right to transmit is passed from master station to master station in a logical ring

## 3.5 Common symbols and abbreviations

NOTE Many symbols and abbreviations are common to more than one protocol Type; they are not necessarily used by all protocol Types.

<b>3.5.1 DL-</b>	data-link layer (as a prefix)
<b>3.5.2 DLC</b>	DL-connection
<b>3.5.3 DLCEP</b>	DL-connection-end-point
<b>3.5.4 DLE</b>	DL-entity (the local active instance of the data-link layer)
<b>3.5.5 DLL</b>	DL-layer
<b>3.5.6 DLPCI</b>	DL-protocol-control-information
<b>3.5.7 DLPCDU</b>	DL-protocol-data-unit
<b>3.5.8 DLM</b>	DL-management
<b>3.5.9 DLME</b>	DL-management Entity (the local active instance of DL-management)
<b>3.5.10 DLMS</b>	DL-management Service
<b>3.5.11 DLS</b>	DL-service
<b>3.5.12 DLSAP</b>	DL-service access-point
<b>3.5.13 DLSDU</b>	DL-service-data-unit
<b>3.5.14 FIFO</b>	first-in first-out (queuing method)
<b>3.5.15 OSI</b>	open systems interconnection
<b>3.5.16 Ph-</b>	physical layer (as a prefix)
<b>3.5.17 PhE</b>	Ph-entity (the local active instance of the physical layer)
<b>3.5.18 PhL</b>	Ph-layer
<b>3.5.19 QoS</b>	quality of service

### 3.6 Additional Type 3 symbols and abbreviations

<b>3.6.1 ACK</b>	acknowledge(ment) DLPDU
<b>3.6.2 cnf</b>	confirm primitive
<b>3.6.3 CS</b>	clock synchronization
<b>3.6.4 DA</b>	destination address of a DLPDU
<b>3.6.5 DAE</b>	destination address extension(s) of a DLPDU which conveys D_SAP_index or destination region/segment address or both
<b>3.6.6 DS</b>	DL/DLM_status: Disconnected station, local DL-entity not in logical token ring or disconnected from line
<b>3.6.7 D_SAP</b>	destination service access point, the DLSAP which identifies the remote DLS-user.
<b>3.6.8 D_SAP_index</b>	destination service access point index, that component of a DLSAP-address which designates a DLSAP and remote DLS-user within the remote DLE
<b>3.6.9 DXM</b>	data exchange multicast
<b>3.6.10 EXT</b>	address extension bit of a DLPDU
<b>3.6.11 FC</b>	frame control (DLPDU type) field of a DLPDU
<b>3.6.12 G</b>	GAP update factor, the number of token cycles between GAP maintenance (update) cycles
<b>3.6.13 HSA</b>	highest station address installed (configured) on this fieldbus
<b>3.6.14 ind</b>	indication primitive
<b>3.6.15 IsoM</b>	isochronous mode
<b>3.6.16 LMS</b>	list of master stations
<b>3.6.17 LR</b>	DL/DLM_status: Local resource not available or not sufficient
<b>3.6.18 LS</b>	DL/DLM_status: Local service not activated at DLSAP or local DLSAP not activated
<b>3.6.19 MSRD</b>	send and request data with multicast reply (DL-service)
<b>3.6.20 NA</b>	DL/DLM_status: No acknowledgement/response
<b>3.6.21 NIL</b>	locally existing value, but not fixed
<b>3.6.22 NO</b>	DL/DLM_status: Not ok
<b>3.6.23 NR</b>	DL/DLM_status: No response, DL/DLM-data acknowledgement negative and send data ok
<b>3.6.24 NS</b>	Next station, the station to which this Master will pass the token
<b>3.6.25 OK</b>	DL/DLM_status: Service finished according to the rules
<b>3.6.26 RDH</b>	DL/DLM_status: Response DL-data high and no resource for send data

<b>3.6.27 RDL</b>	DL/DLM_status: Response DL/DLM-data low and no resource for send data
<b>3.6.28 req</b>	request primitive
<b>3.6.29 RR</b>	DL/DLM_status: No resource for send data and no response DL-data available (acknowledgement negative)
<b>3.6.30 RS</b>	DL/DLM_status: No service or no remote address activated at remote-service-access-point (acknowledgement negative)
<b>3.6.31 SA</b>	source address of a DLPDU
<b>3.6.32 SAE</b>	source address extension(s) of a DLPDU, which conveys S_SAP_index or source region/segment address or both
<b>3.6.33 SC</b>	single character acknowledge DLPDU
<b>3.6.34 SDA</b>	send data with acknowledge (DL-service)
<b>3.6.35 SDN</b>	send data with no acknowledge (DL-service)
<b>3.6.36 SRD</b>	send and request data with reply (DL-service)
<b>3.6.37 S_SAP</b>	source service access point, the DLSAP associated with the initiates local DLS-user
<b>3.6.38 S_SAP_index</b>	source service access point index, a component of a DLSAP-address which designates that DLSAP within the DLE at which the transaction is being initiated
<b>3.6.39 SYN</b>	synchronizing bits of a DLPDU (period of IDLE), which guarantees the specified DLPDU integrity and facilitates receiver synchronization
<b>3.6.40 SYNCHT</b>	synchronization telegram, indicates the start of a new cycle in IsoM
<b>3.6.41 tBIT</b>	bit time, DL-symbol period, the time to transmit one bit on the fieldbus: $1/(\text{data signaling rate in bit/s})$
<b>3.6.42 TCSI</b>	clock synchronization interval time
<b>3.6.43 TCT</b>	Isochronous cycle time, the requested duration for one cycle in IsoM
<b>3.6.44 TQUI</b>	quiet time, transmitter fall time (line state uncertain time) or repeater switch time or both. The time a transmitting station needs to wait after the end of a DLPDU before enabling its receiver.
<b>3.6.45 TRDY</b>	ready time, the time after which the transmitting master will expect a reply DLPDU
<b>3.6.46 TRR</b>	real rotation time, the time between the last successive receptions of the token by the observing master station
<b>3.6.47 TS</b>	This Station
<b>3.6.48 TSDI</b>	station delay of initiator, the time a master station will wait before sending successive DLPDUs
<b>3.6.49 TSDR</b>	station delay of responder, the actual time a responder needs to generate a reply DLPDU
<b>3.6.50 TSET</b>	setup time, the time between an event (e.g. interrupt SYN timer expired) and the necessary reaction (e.g. enabling a receiver)

<b>3.6.51 TSH</b>	time shift, the time a real isochronous cycle deviates from the requested duration for one cycle in IsoM
<b>3.6.52 TSL</b>	slot time, the maximum time a master station waits for a reply DLPDU
<b>3.6.53 TSYN</b>	synchronization time, the period of IDLE before the beginning of a DLPDU after which a station enables its receiver; the required minimum inter-DLPDU idle period to guarantee DLPDU integrity and a valid DLPDU
<b>3.6.54 TSYNI</b>	synchronization interval time, the maximum time that a receiving station waits for the required inter-DLPDU idle period, of duration TSYN, to occur before it detects a bus fault
<b>3.6.55 TTR</b>	Target rotation time, the anticipated time for one token cycle, including allowances for high and low priority transactions, errors and GAP maintenance
<b>3.6.56 UE</b>	DL/DLM_status: Negative acknowledgement, remote user interface error

### 3.7 Common conventions

This standard uses the descriptive conventions given in ISO/IEC 10731.

The service model, service primitives, and time-sequence diagrams used are entirely abstract descriptions; they do not represent a specification for implementation.

Service primitives, used to represent service user/service provider interactions (see ISO/IEC 10731), convey parameters that indicate information available in the user/provider interaction.

This standard uses a tabular format to describe the component parameters of the DLS primitives. The parameters that apply to each group of DLS primitives are set out in tables throughout the remainder of this standard. Each table consists of up to six columns, containing the name of the service parameter, and a column each for those primitives and parameter-transfer directions used by the DLS:

- the request primitive's input parameters;
- the request primitive's output parameters;
- the indication primitive's output parameters;
- the response primitive's input parameters; and
- the confirm primitive's output parameters.

NOTE The request, indication, response and confirm primitives are also known as requestor.submit, acceptor.deliver, acceptor.submit, and requestor.deliver primitives, respectively (see ISO/IEC 10731).

One parameter (or part of it) is listed in each row of each table. Under the appropriate service primitive columns, a code is used to specify the type of usage of the parameter on the primitive and parameter direction specified in the column:

- M** — parameter is mandatory for the primitive.
- U** — parameter is a User option, and may or may not be provided depending on the dynamic usage of the DLS-user. When not provided, a default value for the parameter is assumed.
- C** — parameter is conditional upon other parameters or upon the environment of the DLS-user.
- (blank)** — parameter is never present.

Some entries are further qualified by items in brackets. These may be

a) a parameter-specific constraint

(=) indicates that the parameter is semantically equivalent to the parameter in the service primitive to its immediate left in the table.

b) an indication that some note applies to the entry

(n) indicates that the following note n contains additional information pertaining to the parameter and its use.

In any particular interface, not all parameters need be explicitly stated. Some may be implicitly associated with the DLSAP at which the primitive is issued.

In the diagrams which illustrate these interfaces, dashed lines indicate cause-and-effect or time-sequence relationships, and wavy lines indicate that events are roughly contemporaneous.

### 3.8 Additional Type 3 conventions

In the diagrams which illustrate the DLS and DLM interfaces, dashed lines indicate cause-and-effect or time-sequence relationships between actions at different stations, while solid lines with arrows indicate cause-and-effect time-sequence relationships which occur within the DLE-provider at a single station.

The following notation, a shortened form of the primitive classes defined in 3.7, is used in the figures.

## 4 Connectionless-mode data-link service

### 4.1 General

This clause describes the interface between a DLE and a data-link service user (DLS-user). The services of this interface are typical of those needed in application fields such as process control, factory automation, power distribution, building automation and other primary process industries:

- general purpose data transfer service;
- time transfer service.

<b>req</b>	request primitive
<b>ind</b>	indication primitive
<b>cnf</b>	confirm primitive (confirmation)

## 4.2 Model of the connectionless-mode data-link service

### 4.2.1 Overview

This subclause describes the abstract model for data and time transfer services. The model defines interactions between the DLS-user and the DLL that take place at the DLSAPs. Information is passed between the DLS-user and the local DLE by DLS primitives and their associated parameters.

The DLS-user is provided with the following data and time transfer services:

- Acknowledged connectionless data transfer:  
Send Data with Acknowledge (SDA)
- Unacknowledged connectionless data transfer:  
Send Data with No Acknowledge (SDN)
- Two-way connectionless data exchange:  
Send and Request Data with Reply (SRD)
- M-way connectionless data exchange:  
Send and Request Data with Multicast Reply (MSRD)
- Unacknowledged connectionless time event and clock transfer:  
Clock Synchronization (CS).

These services permit a DLS-user in a master station, called the local DLS-user, to send DLS-user data or time information (a DLSDU) to a DLS-user, called the remote DLS-user, at either a single remote station (SDN, SDA, SRD, MSRD) or at all remote stations (SDN, CS).

Two of these services (SRD and MSRD) permit a DLSDU to be returned by that single remote station (in an immediate reply) as part of a single transaction. These same two services can be used to retrieve a DLSDU from that remote station without first sending a DLSDU. Additionally, the MSRD service permits a DLSDU to be returned by the remote station as a multicast message.

NOTE All of these services are considered optional.

### 4.2.2 Acknowledged connectionless data transfer: Send data with acknowledge (SDA)

This service permits the local DLS-user to send a DLSDU to a single remote station. At the remote station the DLSDU, if the respective DLPDU is transferred error-free, is delivered by the remote DLE to its local DLS-user. The originating local DLS-user receives a confirmation concerning the receipt or non-receipt of the DLSDU by the remote DLS-user. If an error occurred during the transfer, the originating DLE repeats the data transfer up to a configured maximum number of times.

### 4.2.3 Unacknowledged connectionless data transfer: Send data with no acknowledge (SDN)

This service permits a local DLS-user to transfer a DLSDU to a single remote station (unicast), or to all other remote stations (Broadcast) at the same time. The local DLS-user receives a confirmation acknowledging the completion of the transfer, but not whether the DLPDU was duly received. At each addressed remote station this DLSDU, if the respective DLPDU is received error-free, is delivered to a single local DLS-user (Unicast), to the appropriate set of local DLS-users (Multicast), or to all local DLS-users (Broadcast). There is no confirmation to the sending DLS-user that such an intended delivery has taken place.

### 4.2.4 Two-way connectionless data exchange: Send and request data with reply (SRD)

This service variant permits a local DLS-user to transfer a DLSDU to a DLS-user at a single remote station and as part of the same transaction, to transfer to the requesting DLS-user either a DLSDU that was previously made available by the remote DLS-user, or a status that a DLSDU is not available or that an error has been detected. At the remote station the received

DLSDU, if the respective DLPDU is error-free, is delivered to the remote DLS-user. The service permits the local DLS-user to specify a null DLSDU, thereby requesting a DLSDU from the remote DLS-user without concurrently transferring a DLSDU to the remote DLS-user.

The local DLS-user receives either the requested DLSDU, or a notification that no DLSDU was available, or a notification of the type of error that was detected. The first two alternatives also confirm the receipt by the remote DLS-user of the DLSDU sent by the initiating local DLS-user.

If an error occurs during the transmission, the local DLE repeats (as part of the same transaction) the transmission of the initiator's DLSDU, if any, including the request for a returned DLSDU, up to a configured maximum number of times.

#### **4.2.5 M-way connectionless data exchange: Send and request data with multicast-reply (MSRD)**

This service permits a local DLS-user to transfer a DLSDU to a DLS-user at a single remote station and as part of the same transaction, to transfer to the requesting DLS-user and to the appropriate set of remote DLS-users (Multicast-Reply) a DLSDU that was previously made available by the remote DLS-user. If a DLPDU is not available by the remote DLS-user, or an error has been detected the requesting DLS-user receives a status. At the addressed remote station the received DLSDU, if the respective DLPDU is error-free, is delivered to the remote DLS-user. The service permits the local DLS-user to specify a null DLSDU, thereby requesting a DLSDU from the remote DLS-user without concurrently transferring a DLSDU to the remote DLS-user.

The local DLS-user and the appropriate set of remote DLS-users receive the data requested by the local DLS-user, or the local DLS-user only receives either a notification that no data was available or a notification of the type of error that was detected. The first two alternatives also confirm the receipt by the remote DLS-user of the DLSDU sent by the initiating local DLS-user. There is no guarantee of correct receipt of the requested DLPDU (multicast-reply) at all other remote DLS-users; acknowledgement does not occur.

If an error occurs during the transmission, the local DLE repeats (as part of the same transaction) both the transmission of the initiator's DLSDU, if any, and the request for a returned DLSDU, up to a configured maximum number of times.

#### **4.2.6 Unacknowledged connectionless time event and clock transfer: Clock synchronization (CS)**

This service sequence permits the local DLS-user of the time master to distribute a DLSDU to all remote time receivers.

As part of the service sequence the time master transmit a time event message at first. Upon reception of a CS time event request the local DLE of the time master measures the send delay time between reception of the request and transmitting of the appropriate DLPDU while the remote DLEs start the measurement of the receiving delay after reception of this DLPDU.

Upon reception of a positive CS time event confirmation together with the send delay time the DLS-user passes a CS clock value request to the local DLE as second part of the service sequence to distribute the DLSDU to all remote time receivers. If the respective DLPDU is transferred error-free the remote time receivers stop the receive delay measurement and deliver the DLSDU together with the receive delay time to their local DLS-user.

### **4.3 Sequence of primitives**

#### **4.3.1 Constraints on services and primitives**

These fieldbus services are realized through a number of DLS primitives. A request primitive is used by a DLS-user to request a service. A confirm primitive is returned to the DLS-user upon completion of the service.

An indication primitive is used to report a non-requested event to an appropriate DLS-user. Non-requested events include reception of DLS-user data from a local DLS-user addressed to the remote DLS-user.


The DLS and their primitives are summarized in Table 1.

**Table 1 – Summary of DL services and primitives**

Service	Primitive	Possible for the following stations
Acknowledged connectionless data transfer: Send Data with Acknowledge (SDA)	DL-DATA-ACK request	Master
	DL-DATA-ACK confirm	
	DL-DATA-ACK indication	Master and slave
Unacknowledged connectionless data transfer: Send Data with No Acknowledge (SDN)	DL-DATA request	Master
	DL-DATA confirm	
	DL-DATA indication	Master and slave
Two-way connectionless data exchange: Send and Request Data with Reply (SRD)	DL-DATA-REPLY request	Master
	DL-DATA-REPLY confirm	
	DL-DATA-REPLY indication	Master and slave
	DL-REPLY-UPDATE request	Master and slave
M-way connectionless data exchange: Send and Request Data with Multicast Reply (MSRD)	DL-MCT-DATA-REPLY request	Master
	DL-MCT-DATA-REPLY confirm	
	DL-MCT-DATA-REPLY indication	Master and slave
	DL-DXM-DATA-REPLY indication	Master and slave
	DL-REPLY-UPDATE request	Master and slave
Unacknowledged connectionless time event and clock transfer: Clock Synchronization (CS)	DL-CS-TIME-EVENT request	Master
	DL-CS-TIME-EVENT confirm	
	DL-CS-CLOCK-VALUE request	Master
	DL-CS-CLOCK-VALUE confirm	
	DL-CS-CLOCK-VALUE indication	Master and slave

**4.3.2 Relation of primitives at the end-points of connectionless services**

The major temporal relationships of service primitives are shown in Figure 2 to Figure 6.

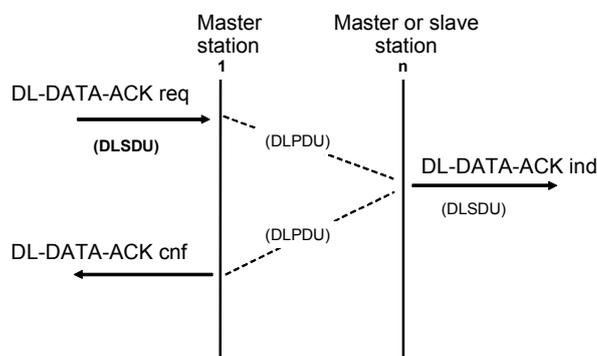

**Figure 2 – SDA service**

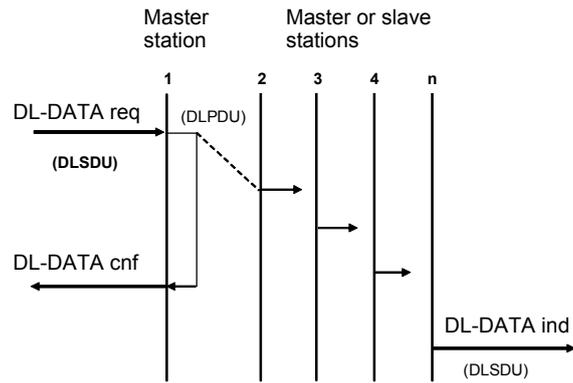


Figure 3 – SDN service

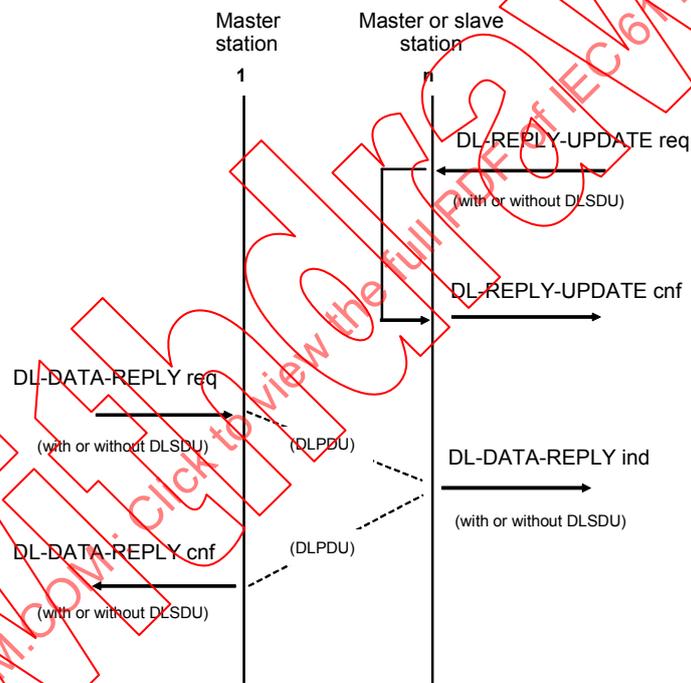


Figure 4 – SRD service

IECNORM.COM: Click to view the full PDF of IEC 61158-3-3:2007

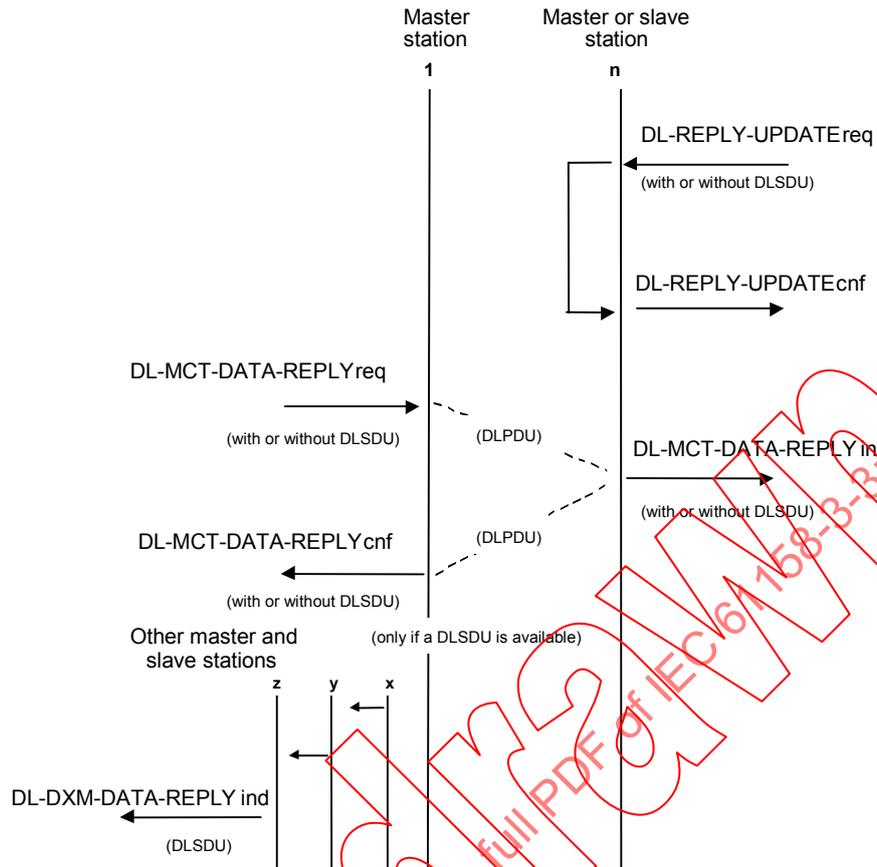


Figure 5 – MSDR service

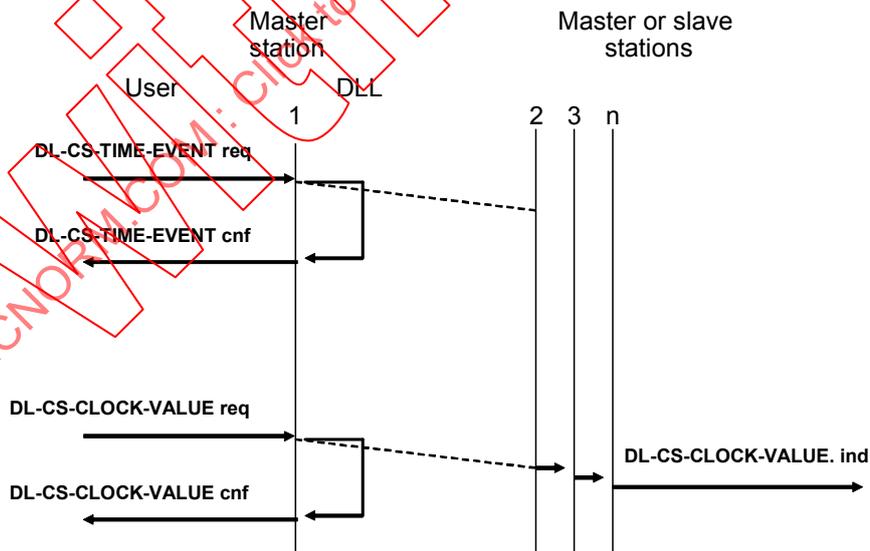


Figure 6 – CS service

### 4.3.3 Addressing

#### 4.3.3.1 Address (individual)

Each DL-entity on the link is designated by a DL-address. The range of individual DL-addresses is limited, from 0 to a maximum of 126. An extended link is designated by an

address extension (a region/segment address). The DL-address 127 is used for broadcast and multicast messages.

#### 4.3.3.2 DLSAP-index

The DLSAP-index designates the DLSAP, the point of communication with the DLS-user. The range of usable DLSAP-indexes is limited, from 0 to 63, CS and NIL. The DLSAP-index 63 is used for broadcast messages. The DLSAP-index NIL means that the default DLSAP is addressed. The DLSAP-index CS is reserved for clock synchronization only. If the DLSAP-indexes CS or NIL are used in a DL service request, then the corresponding DLPDU contains no DLSAP-index (DAE or SAE) for efficiency reasons.

The DLSAP-index serves both as

- a) address of a DLSAP within the DL-entity, and
- b) the DLSAP-identifier for the DLS-user.

#### 4.3.3.3 Global address

The global address is used to designate more than one DLS-user. A group of DLS users is addressed by the global address (127) in conjunction with a DLSAP-index with a value different from 63 whose interpretation throughout the link is that of a multicast address. All DLS users are addressed by the global address (127) in conjunction with the DLSAP-index 63 (see 4.4.2.3.2.3).

### 4.4 Detailed description of DL services

#### 4.4.1 Send data with acknowledge (SDA)

##### 4.4.1.1 Function

The local DLS-user prepares a DLSDU for the remote DLS-user and passes it to the local DLE (DL-entity) as the DLSDU parameter of a DL-DATA-ACK request primitive. The local DLE accepts the service request, forms an appropriate DLPDU containing the DLSDU, and tries to send the DLPDU to the remote DLE.

Upon receiving the data DLPDU error-free, the remote DLE immediately starts transmitting the requested acknowledgement DLPDU to the initiating DLE.

The local DLE waits for an acknowledgement DLPDU from the remote DLE. If this acknowledgement DLPDU is not received within the slot time  $T_{SL}$  or a erroneous DLPDU is received, the local DLE again transmits the data DLPDU to the remote DLE. If no error free acknowledgement DLPDU is received after a number of retransmissions equal to  $max\_retry\_limit$ , the local DLE reports the negative status in a confirm primitive which it issues to the local DLS-user.

When an error free acknowledgement DLPDU is received, the local DLE passes a completion status to the local DLS-user by means of a DL-DATA-ACK confirm primitive, conveying either successful completion of the requested service or the type of error detected.

During the transfer of the data and the receipt of the associated acknowledgement, no other traffic takes place on the fieldbus. If the data DLPDU was received error-free, the remote DLE passes the DLSDU and address information conveyed by the DLPDU to the remote DLS-user by means of a DL-DATA-ACK indication primitive. Retransmission does not result in duplicate DL-DATA-ACK indication primitives.

##### 4.4.1.2 Types of primitives and parameters

Table 2 indicates the primitives and parameters of the SDA service.

**Table 2 – SDA data ack primitives and parameters**

DL-DATA-ACK Parameter name	Request	Indication	Confirm
	input	output	output
Service_class	M	M (=)	(see Note)
D_addr	M	M (=)	(see Note)
D_SAP_index	M	M (=)	(see Note)
S_addr		M	
S_SAP_index	M	M (=)	(see Note)
DLSDU	M	M (=)	
DL_status			M

NOTE The method by which a confirm primitive is correlated with its corresponding preceding request primitive is a local matter. The descriptions in IEC 61158-4-3 and IEC 61158-5-3 assume that the indicated input parameter values of the request primitive are returned as output parameter values of the corresponding confirm primitive.

### 4.4.1.3 SDA request primitive

#### 4.4.1.3.1 Use of the primitive

This primitive is passed from the local DLS-user to the local DLE to send DLS-user data to a remote DLS-user using the SDA service. Receipt of the primitive results in the transmittal of the DLSDU by the local DLE employing the procedure appropriate for the SDA service. While processing a SDA request (that is, while waiting for the acknowledgement) the DLE does not attempt to transmit any unrelated DLPDUs.

#### 4.4.1.3.2 Parameters of the primitive

##### 4.4.1.3.2.1 Service\_class

This parameter specifies the priority for the data transfer. There are two priorities:

**High Priority (high):** Time-critical messages, such as alarms, synchronization and coordination data.

**Low Priority (low):** Less urgent messages, such as process, diagnostic and program data.

##### 4.4.1.3.2.2 D\_addr

The D\_addr (destination-address) parameter specifies the DL-address of the remote DLE. The value 127, designating the global address used for broadcast or multicast messages, is not permitted.

NOTE The Type 3 protocol defined in IEC 61158-4-3 further describes and restricts DL-addresses.

##### 4.4.1.3.2.3 D\_SAP\_index

The D\_SAP\_index (destination-service-access-point index) parameter specifies the destination service-access-point of the remote DLS-user within the remote DLE designated by the D\_addr parameter. The D\_SAP\_index values 63, which specifies BROADCAST, and CS are not permitted.

NOTE It is possible for efficiency reasons to omit DLSAP indexes from DLPDUs. In that case the D\_SAP\_index parameter is set to NIL, which means that the default DLSAP in the receiving DLE is addressed.

#### 4.4.1.3.2.4 S\_SAP\_index

The S\_SAP\_index (source-service-access-point index) parameter specifies the source service-access-point of the local DLS-user. The S\_SAP\_index values 63, which specifies BROADCAST, and CS are not permitted.

NOTE It is possible for efficiency reasons to omit DLSAP indexes from DLPDUs. In that case the S\_SAP\_index parameter is set to NIL, which means that on reception the DLSDU is inferred to have been sent from the default DLSAP of the sending DLE.

#### 4.4.1.3.2.5 DLSDU

This parameter specifies the DLS-user data that is to be transferred by the DLE. The minimum size of the DLSDU is one octet. The maximum size is between 242 and 246 octets, depending on whether region/segment addresses and an explicit D\_SAP\_index and S\_SAP\_index are also provided.

#### 4.4.1.4 SDA indication primitive

##### 4.4.1.4.1 Use of the primitive

This primitive is passed from the addressed remote DLE to the addressed remote DLS-user upon successful receipt of a SDA data DLPDU and transmission of an acknowledgement DLPDU. Receipt of a duplicate SDA data DLPDU (with no other intervening DLPDUs) does not cause the indication primitive to be repeated.

##### 4.4.1.4.2 Parameters of the primitive

###### 4.4.1.4.2.1 Service\_class

This parameter specifies the priority of the received SDA request DLPDU.

###### 4.4.1.4.2.2 D\_addr

This parameter specifies the destination DL-address of the received SDA data DLPDU. The global address (127) for broadcast or multicast messages is not permitted.

NOTE The Type 3 protocol defined in IEC 61158-4-3 further describes destination DL-addresses.

###### 4.4.1.4.2.3 S\_addr

This parameter specifies the DL-address of the initiating DLE. S\_addr specifies the source DL-address of the received SDA request DLPDU. S\_addr is an individual address; the global address (127) for broadcast or multicast messages is not permitted.

NOTE The Type 3 protocol defined in IEC 61158-4-3 further describes source DL-addresses.

###### 4.4.1.4.2.4 D\_SAP\_index, S\_SAP\_index,

These parameters specify the source and destination service-access-points of the received SDA data DLPDU within their respective DLEs.

###### 4.4.1.4.2.5 DLSDU

This parameter specifies the DLS-user data sent by the remote DLS-user which initiated the service.

#### 4.4.1.5 SDA confirm primitive

##### 4.4.1.5.1 Use of the primitive

This primitive is passed from the local DLE to the local DLS-user upon completion of the corresponding service request.

NOTE 1 When DL\_status indicates a temporary error, the local DLS-user may assume that a subsequent repetition may be successful. When DL\_status indicates a permanent error, the local DLS-user may assume that a subsequent repetition may not be successful. Other method should be used to deal this type of error.

NOTE 2 For the local errors LS, LR, DS and IV no attempt has been made to transmit the DLS-user data.

#### 4.4.1.5.2 Parameters of the primitive

##### 4.4.1.5.2.1 DL\_status

This parameter indicates the success or failure of the corresponding SDA request and whether a temporary or a permanent error exists. Permitted values for this parameter are specified in Table 3.

**Table 3 – Values of DL\_status for the SDA data ack service**

Short name	Status	Definition	Temporary (t) or permanent (p)
OK	success	Service completed without error	—
RR	failure	Resources of the remote DLE not available or not sufficient	t
UE	failure	Remote DLS interface error	p
RS	failure	Service at remote DLSAP not activated, or D_addr not contained in the access parameter at the remote DLSAP	p
LS	failure	Service at local DLSAP not activated	p
LR	failure	Resources of the local DLE not available or not sufficient	t
NA	failure	No reaction, or no plausible reaction (ACK or RES), from remote DLE	t
DS	failure	Local DL-entity not in logical token ring or disconnected from line	p
IV	failure	Invalid parameters in request	—

#### 4.4.2 Send data with no acknowledge (SDN)

##### 4.4.2.1 Function

The local DLS-user prepares a DLSDU for a single remote DLS-user, for a group of remote DLS-users, or for all remote DLS-users. The DLSDU is passed to the local DLE via the DLS interface by means of a DL-DATA request primitive. The DLE accepts the service request and tries to send the data to the remote DLE or to all remote DLEs.

The sending DLE returns a local confirmation of transmittal to the local DLS-user by means of a DL-DATA confirm primitive. The receiving DLE(s) attempt to deliver the received DLSDU to the specified DLS-user(s).

There is no confirmation of correct receipt at the remote DLEs or of delivery to the intended DLS-user(s); acknowledgements do not occur. When the DLSDU is transmitted, it reaches all remote DLEs approximately concurrently (ignoring signal propagation delays). Each addressed remote DLE that has received the data DLPDU error-free passes the DLSDU and associated addressing information to the local DLS-user by means of a DL-DATA indication primitive.

##### 4.4.2.2 Types of primitives and parameters

Table 4 indicates the primitives and parameters of the SDN service.

**Table 4 – SDN data primitives and parameters**

Parameter name	DL-DATA	Request	Indication	Confirm
		input	output	output
Service_class		M	M (=)	(see Note)
D_addr		M	M (=)	(see Note)
D_SAP_index		M	M (=)	(see Note)
S_addr			M	
S_SAP_index		M	M (=)	(see Note)
DLSDU		M	M (=)	
DL_status				M

NOTE The method by which a confirm primitive is correlated with its corresponding preceding request primitive is a local matter. The descriptions in IEC 61158-4-3 and IEC 61158-5-3 assume that the indicated input parameter values of the request primitive are returned as output parameter values of the corresponding confirm primitive.

### 4.4.2.3 SDN request primitive

#### 4.4.2.3.1 Use of the primitive

This primitive is passed from the local DLS-user to the local DLE to send DLS-user data to a single, a group of, or all remote DLS-users using the SDN service. Receipt of the primitive results in the transmittal of the DLSDU by the local DLE employing the procedure appropriate for the SDN service.

#### 4.4.2.3.2 Parameters of the primitive

##### 4.4.2.3.2.1 Service\_class, S\_SAP\_index, DLSDU

These parameters have the same meaning as described in 4.4.1.3.2.

##### 4.4.2.3.2.2 D\_addr

This parameter specifies the destination DL-address of the SDN data DLPDU. The global address (127) for broadcast or multicast messages is permitted; it designates the set of all receiving DLEs.

NOTE See Note in 4.4.1.4.2.2.

##### 4.4.2.3.2.3 D\_SAP\_index

The parameter has a meaning similar to that described in 4.4.1.3.2.3. A value of 63 specifies BROADCAST; each receiving DLE delivers the received DLSDU to all local DLS-users if the BROADCAST DLSAP has been activated. The D\_SAP\_index value CS is not permitted.

A distinct dedicated D\_SAP\_index is required for each multicast group; each receiving DLE delivers the received DLSDU to the appropriate local DLS-user if that dedicated DLSAP has been activated.

### 4.4.2.4 SDN indication primitive

#### 4.4.2.4.1 Use of the primitive

This primitive is passed from the remote DLE to the remote DLS-user upon receipt of a SDN data DLPDU.

#### 4.4.2.4.2 Parameters of the primitive

##### 4.4.2.4.2.1 Service\_class, S\_addr, S\_SAP\_index, DLSDU

These parameters have the same meaning as described in 4.4.1.4.2.

##### 4.4.2.4.2.2 D\_addr

This parameter specifies the destination DL-address of the received SDN data DLPDU. The global address (127) for broadcast or multicast messages is permitted.

NOTE See Note in 4.4.1.4.2.2.

##### 4.4.2.4.2.3 D\_SAP\_index

This parameter specifies the destination service-access-point of the received SDN data DLPDU. A value of 63 specifies BROADCAST; each receiving DLE delivers the received DLSDU to all local DLS-users if the BROADCAST DLSAP has been activated. The D\_SAP\_index value CS is not permitted.

A distinct dedicated D\_SAP\_index is required for each multicast group; each receiving DLE delivers the received DLSDU to the appropriate local DLS-user if that dedicated DLSAP has been activated.

#### 4.4.2.5 SDN confirm primitive

##### 4.4.2.5.1 Use of the primitive

This primitive is passed from the local DLE to the local DLS-user upon completion of the corresponding service request.

NOTE 1 When DL\_status indicates a temporary error, the local DLS-user may assume that a subsequent repetition may be successful. When DL\_status indicates a permanent error, the local DLS-user may assume that a subsequent repetition may not be successful. Other method should be used to deal this type of error.

NOTE 2 For the local errors LS, LR, DS and IV no attempt has been made to transmit the DLS-user data.

##### 4.4.2.5.2 Parameters of the primitive

###### 4.4.2.5.2.1 DL\_status

This parameter indicates the local success or failure of the associated SDN request. The possible values of this parameter are specified in Table 5.

**Table 5 – Values of DL\_status for the SDN data service**

Short name	Status	Definition	Temporary (t) or permanent (p)
OK	success	Transmission of data completed by local DL-entity	—
LS	failure	Service at local DLSAP or local DLSAP not activated	p
LR	failure	Resources of the local DLE not available or not sufficient	t
DS	failure	Local DL-entity not in logical token ring or disconnected from line	p
IV	failure	Invalid parameters in request	—

#### 4.4.3 Send and request data with reply (SRD)

##### 4.4.3.1 Function

The local DLS-user prepares a DLSDU for the remote DLS-user and passes it to the local DLE as the DLSDU parameter of a DL-DATA-REPLY request primitive, requesting data from the remote DLS-user at the same time. The local DLE accepts the service request, forms an

appropriate DLPDU containing the DLSDU, and tries to send the DLPDU to the remote DLE, requesting that a DLSDU previously prepared by the remote DLS-user be sent in reply.

Alternatively, if the local DLS-user has no DLSDU to send, it passes the DL-DATA-REPLY request primitive to the DLE without a DLSDU parameter. In this case the local DLE accepts the service request, forms an appropriate DLPDU not containing a DLSDU, and tries to send the DLPDU to the remote DLE, requesting that a DLSDU previously prepared by the remote DLS-user be sent in reply.

Upon receiving the request DLPDU, the remote DLE immediately starts transmitting a reply DLPDU to the initiating DLE, if the remote DLS-user had previously prepared a DLSDU for this reply (by means of a DL-REPLY-UPDATE request primitive). If no DLSDU is available for transmission, or if an error occurred, then an acknowledgement DLPDU with appropriate status information is returned instead addressed to the initiating DLE only.

The receiving DLE passes the DLSDU, if any, received from the initiating DLE, together with status concerning the transmitted reply, to its local DLS-user with a DL-DATA-REPLY indication primitive.

The local DLE waits for a reply DLPDU from the remote DLE. If this reply DLPDU is not received error-free within the slot time  $T_{SL}$ , the local DLE again transmits the request DLPDU to the remote DLE. If no reply DLPDU is received error-free after a number of retransmissions equal to `max_retry_limit`, the local DLE reports the negative status in a confirm primitive which it issues to the local DLS-user.

When a reply DLPDU is received, the local DLE passes the conveyed DLSDU, if any, together with a completion status to the local DLS-user by means of a DL-DATA-REPLY confirm primitive; this status conveys either successful completion of the requested service or the type of error detected.

The remote DLS-user is responsible for having prepared a valid DLSDU, ready for transmission by the remote DLE. The remote DLS-user passes a DL-REPLY-UPDATE request primitive to the remote DLE to convey the DLSDU to that DLE, where it awaits a remotely-initiated SRD transfer request. The DLE informs the DLS-user of the completion of this request by means of a DL-REPLY-UPDATE confirm primitive.

#### **4.4.3.2 Types of primitives and parameters of SRD data-reply**

Table 6 indicates the primitives and parameters of the SRD data reply service.

**Table 6 – SRD data reply primitives and parameters**

DL-DATA-REPLY Parameter name	Request	Indication	Confirm
	input	output	output
Service_class	M	M	(see Note)
D_addr	M	M (=)	(see Note)
D_SAP_index	M	M (=)	(see Note)
S_addr		M	
S_SAP_index	M	M (=)	(see Note)
DLSDU	U	U (=)	U
Reference		U	
Update_status		M	
DL_status			M

NOTE The method by which a confirm primitive is correlated with its corresponding preceding request primitive is a local matter. The descriptions in IEC 61158-4-3 and IEC 61158-5-3 assume that the indicated input parameter values of the request primitive are returned as output parameter values of the corresponding confirm primitive.

### 4.4.3.3 SRD data-reply request primitive

#### 4.4.3.3.1 Use of the primitive

This primitive is passed from the local DLS-user to the local DLE

- a) optionally, to send DLS-user data to a remote DLS-user; and
  - b) simultaneously to request previously-prepared DLS-user data from that DLS-user
- both through use of the SRD service.

Receipt of this primitive results in the transmittal of the DLSDU by the local DLE employing the procedure appropriate for the SRD service. While processing a SRD request (that is, while waiting for the reply and during any retry attempts) the DLE does not attempt to transmit any unrelated DLPDUs.

#### 4.4.3.3.2 Parameters of the primitive

##### 4.4.3.3.2.1 Service\_class

This parameter has the same meaning as described in 4.4.1.3.2.1.

##### 4.4.3.3.2.2 D\_addr, S\_SAP\_index, DLSDU

The D\_addr, S\_SAP\_index and DLSDU parameters have the same meaning as described in 4.4.1.3.2.

##### 4.4.3.3.2.3 D\_SAP\_index

This parameter specifies the destination service-access-point of the remote DLS-user within the remote DLE designated by the D\_addr parameter. The specified remote DLSAP can also have an associated DLSDU which has been prepared by that DLSAPs DLS-user. The D\_SAP\_index values 63, which specifies BROADCAST, and CS are not permitted.

NOTE It is possible for efficiency reasons to omit DLSAP indexes from DLPDUs. In that case the D\_SAP\_index parameter is set to NIL, which means that the default DLSAP in the receiving DLE is addressed.

#### 4.4.3.4 SRD data-reply indication primitive

##### 4.4.3.4.1 Use of the primitive

This primitive is passed from the addressed remote DLE to the remote DLS-user upon receipt of a SRD request DLPDU and transmission of a reply DLPDU. Receipt of a duplicate SRD request DLPDU (with no other intervening DLPDUs) does not cause the indication primitive to be repeated.

However, no indication primitive occurs when

- a) both the received SRD request DLPDU and the reply DLPDU contain null (zero length) DLSDUs, and
- b) the addressed remote DLS-user has configured the D\_SAP to not signal such events.

NOTE 1 This behavior is configured through the Indication\_mode parameter of the DL-management DLSAP Activate Responder primitive (see 5.5.8).

NOTE 2 This non-reporting does not affect the storage resources of the responding DLE.

##### 4.4.3.4.2 Parameters of the primitive

###### 4.4.3.4.2.1 Service\_class, D\_addr, D\_SAP\_index, S\_addr, S\_SAP\_index, DLSDU

These parameters have the same meaning as described in 4.4.1.4.2.

###### 4.4.3.4.2.2 Reference

This optional parameter is used to identify the DLSDU that was passed upon receipt of a SRD request DLPDU.

###### 4.4.3.4.2.3 Update\_status

This parameter indicates whether or not the response data (DLSDU) has been passed to the initiating local DLE. Permitted values for this parameter are specified in Table 7.

**Table 7 – Values of Update\_status for the SRD data reply service**

Short name	Status	Definition	Temporary (t) or permanent (p)
NO	failure	No reply data (DLSDU) transmitted	t
LO	success	Low priority reply data transmitted	—
HI	success	High priority reply data transmitted	—

#### 4.4.3.5 SRD data-reply confirm primitive

##### 4.4.3.5.1 Use of the primitive

This primitive is passed from the local DLE to the local DLS-user upon completion of the corresponding service request. DL\_status indicates the completion status of the request and, when successful, the presence or absence of a returned DLSDU.

NOTE When DL\_status indicates a temporary error, the local DLS-user may assume that a subsequent repetition may be successful. When DL\_status indicates a permanent error, the local DLS-user may assume that a subsequent repetition may not be successful. Other method should be used to deal this type of error.

##### 4.4.3.5.2 Parameters of the primitive

###### 4.4.3.5.2.1 DLSDU

This optional parameter returns the DLS-user data sent by the remote DLE, if any. This parameter will not appear, if the DL\_status is different from DL, DH, RDL and RDH.

#### 4.4.3.5.2.2 DL\_status

This parameter indicates the success or failure of the corresponding SRD request. The values UE, RS, LS, LR, NA, DS and IV as specified for SDA (see Table 3) are possible. Additional possible values are specified in Table 8.

**Table 8 – Additional values of DL\_status for the SRD data reply service**

Short name	Status	Definition	Temporary (t) or permanent (p)
DL	success	Positive acknowledgement for sent data, reply data (DLSDU) with low priority available	—
DH	success	Positive acknowledgement for sent data, reply data with high priority available	t
NR	success	Positive acknowledgement for sent data, negative acknowledgement for reply data, as not available in the remote DLE	t
RDL	failure	Negative acknowledgement for sent data, resources of the remote DLE not available or not sufficient, reply data with low priority available	t
RDH	failure	Negative acknowledgement for sent data, resources of the remote DLE not available or not sufficient, reply data with high priority available	t
RR	failure	Negative acknowledgement for sent data, resources of the remote DLE not available or not sufficient, reply data not available	t

#### 4.4.3.6 Types of primitives and parameters of SRD reply-update

Table 9 indicates the primitives and parameters of the SRD reply-update service.

**Table 9 – SRD reply-update primitives and parameters**

DL-REPLY-UPDATE Parameter name	Request	Confirm
	input	output
Service_class	M	(see Note)
S_SAP_index	M	(see Note)
DLSDU	U	—
Transmit_strategy	M	—
Reference	U	—
DL_status	—	M

NOTE The method by which a confirm primitive is correlated with its corresponding preceding request primitive is a local matter. The descriptions in IEC 61158-4-3 and IEC 61158-5-3 assume that the indicated input parameter values of the request primitive are returned as output parameter values of the corresponding confirm primitive.

#### 4.4.3.7 SRD reply-update request primitive

##### 4.4.3.7.1 Use of the primitive

This primitive is passed from the local DLS-user to the local DLE to convey a DLSDU which can be retrieved by a remotely-initiated invocation of the SRD service. The local DLE associates the DLSDU with the specified S\_SAP\_index in a way which avoids update concurrent with any ongoing SRD transaction at that S\_SAP\_index. This primitive is only useful in conjunction with remote invocation of the SRD service; of itself it does not cause any transmission of the conveyed DLSDU.

#### 4.4.3.7.2 Parameters of the primitive

##### 4.4.3.7.2.1 Service\_class

This parameter has the same meaning as described in 4.4.3.3.2.1.

##### 4.4.3.7.2.2 S\_SAP\_index

This parameter specifies the service access point of the local DLS-user which makes the request. The S\_SAP\_index values 63, which specifies BROADCAST, and CS are not permitted.

##### 4.4.3.7.2.3 DLSDU

This optional parameter specifies the DLS-user data which is to be used to update the data associated with the specified S\_SAP\_index.

##### 4.4.3.7.2.4 Transmit\_strategy

This parameter specifies whether the update is transmitted only once (SINGLE) or many times (MULTIPLE). In the case of "MULTIPLE" any DLSDU associated with the S\_SAP\_index is transferred with each subsequent SRD.

In the case of "SINGLE" the association of the DLSDU with the S\_SAP\_index is terminated after the first apparently-successful SRD exchange (and any immediately-following retries). This causes subsequent SRD exchanges do not return a DLSDU until the DLS-user associates a new DLSDU with the S\_SAP\_index.

##### 4.4.3.7.2.5 Reference

This optional parameter is used to identify the DLSDU that was passed by a DL-REPLY-UPDATE request primitive.

#### 4.4.3.8 SRD reply-update confirm primitive

##### 4.4.3.8.1 Use of the primitive

This primitive is passed from the local DLE to the local DLS-user upon completion of the corresponding service request.

NOTE When DL\_status indicates a temporary error, the local DLS-user may assume that a subsequent repetition may be successful. When DL\_status indicates a permanent error, the local DLS-user may assume that a subsequent repetition may not be successful. Other method should be used to deal this type of error.

##### 4.4.3.8.2 Parameters of the primitive

##### 4.4.3.8.2.1 DL\_status

This parameter indicates the result of the corresponding DL-REPLY-UPDATE REQUEST primitive. The possible values are specified in Table 10.

**Table 10 – Values of DL\_status for the SRD reply-update service**

Short name	Status	Definition	Temporary (t) or permanent (p)
OK	success	Update data (DLSDU) loaded	—
LS	failure	Service at local DLSAP or local DLSAP not activated	p
LR	failure	Resources of the local DLE not available or not sufficient	t
IV	failure	Invalid parameters in request	—

#### 4.4.4 Send and request data with multicast reply (MSRD)

##### 4.4.4.1 Function

The local DLS-user prepares a DLSDU for the remote DLS-user and passes it to the local DLE as the DLSDU parameter of a DL-MCT-DATA-REPLY request primitive, requesting data from the remote DLS-user (Publisher) at the same time. The local DLE accepts the service request, forms an appropriate DLPDU containing the DLSDU, and tries to send the DLPDU to the remote DLE (Publisher), requesting that a DLSDU previously prepared by the remote DLS-user be multicast in reply to the appropriate set of DLEs (Subscribers) which have configured their corresponding DLSAP in the intention to subscribe to this particular publisher (DLSAP activate subscriber service).

Alternatively, if the local DLS-user has no DLSDU to send, it passes the DL-MCT-DATA-REPLY request primitive to the DLE without a DLSDU parameter. In this case the local DLE accepts the service request, forms an appropriate DLPDU not containing a DLSDU, and tries to send the DLPDU to the remote DLE (Publisher), requesting that a DLSDU previously prepared by the remote DLS-user be multicast in reply.

Upon receiving the request DLPDU error-free, the remote DLE (Publisher) immediately starts transmitting a reply DLPDU to the initiating DLE and the appropriate set of remote DLEs (Subscribers) by sending the response using the destination address DA = 127 (Broadcast) and a specified D\_SAP\_index if the remote DLS-user had previously prepared a DLSDU for this reply (by means of a DL-REPLY-UPDATE request primitive). If no DLSDU is available for transmission, or if an error occurred, then an acknowledgement DLPDU with appropriate status information is returned instead addressed to the initiating DLE only.

The receiving DLE (Publisher) passes the DLSDU, if any, received from the initiating DLE, together with status concerning the transmitted reply, to its local DLS-user with a DL-DATA-REPLY indication primitive.

The local DLE waits for a reply DLPDU from the remote DLE (Publisher). If this reply DLPDU is not received error-free within the slot time  $T_{SL}$ , the local DLE again transmits the request DLPDU to the remote DLE (Publisher). If no reply DLPDU is received error-free after a number of retransmissions equal to `max_retry_limit`, the local DLE reports the negative status in a confirm primitive which it issues to the local DLS-user.

When a reply DLPDU is received, the local DLE passes the conveyed DLSDU, if any, together with a completion status to the local DLS-user by means of a DL-MCT-DATA-REPLY confirm primitive; this status conveys either successful completion of the requested service or the type of error detected.

The DLEs (Subscribers) which receive the reply DLPDU addressed to the destination address DA = 127 (Broadcast) and the specified D\_SAP\_index indicate this to their DLS-user with a DL-DXM-REPLY indication primitive. The completion status of a DL-DXM-REPLY indication is always set to successful completion.

The remote DLS-user is responsible for having prepared a valid DLSDU, ready for transmission by the remote DLE (Publisher). The remote DLS-user passes a DL-REPLY-UPDATE request primitive to its local DLE to convey the DLSDU to that DLE, where it awaits a remotely-initiated MSRD transfer request. The DLE informs the DLS-user of the completion of this request by means of a DL-REPLY-UPDATE confirm primitive.

##### 4.4.4.2 Types of primitives and parameters of MSRD MCT-data-reply

Table 11 indicates the primitives and parameters of the MSRD MCT data reply service.

**Table 11 – MSRD MCT data reply primitives and parameters**

DL-MCT-DATA-REPLY Parameter name	Request	Indication	Confirm
	input	output	output
Service_class	M	M	(see Note)
D_addr	M	M (=)	(see Note)
D_SAP_index	M	M (=)	(see Note)
S_addr	—	M	—
S_SAP_index	M	M (=)	(see Note)
DLSDU	U	U (=)	U
Update_status	—	M	—
Reference	—	U	—
DL_status	—	—	M

NOTE The method by which a confirm primitive is correlated with its corresponding preceding request primitive is a local matter. The descriptions in IEC 61158-4-3 and IEC 61158-5-3 assume that the indicated input parameter values of the request primitive are returned as output parameter values of the corresponding confirm primitive.

#### 4.4.4.3 MSRD MCT-DATA-REPLY request primitive

##### 4.4.4.3.1 Use of the primitive

This primitive is passed from the local DLS-user to the local DLE

- optionally, to send DLS-user data to a remote DLS-user, and
- simultaneously to request previously-prepared DLS-user data to be published from that DLS-user

both through use of the MSRD service.

Receipt of this primitive results in the transmittal of the DLSDU by the local DLE employing the procedure appropriate for the MSRD service. While processing a MSRD request (that is, while waiting for the reply and during any retry attempts) the DLE does not attempt to transmit any unrelated DLDPUs.

##### 4.4.4.3.2 Parameters of the primitive

###### 4.4.4.3.2.1 Service\_class

This parameter has the same meaning as described in 4.4.1.3.2.1.

###### 4.4.4.3.2.2 D\_addr, S\_SAP\_index, DLSDU

The D\_addr, S\_SAP\_index and DLSDU parameters have the same meaning as described in 4.4.1.3.2.

###### 4.4.4.3.2.3 D\_SAP\_index

This parameter specifies the DLSAP of the remote DLS-user within the remote DLE (Publisher) designated by the D\_addr parameter. The specified remote DLSAP can also have an associated DLSDU which has been prepared by that DLSAPs DLS-user. The D\_SAP\_index values 63, which specifies Broadcast, and CS are not permitted.

#### 4.4.4.4 MSRDC MCT-data-reply indication primitive

##### 4.4.4.4.1 Use of the primitive

This primitive is passed from the addressed remote DLE (Publisher) to the remote DLS-user upon receipt of a MSRDC request DLPDU and transmission of a reply DLPDU. Receipt of a duplicate MSRDC request DLPDU (with no other intervening DLPDUs) does not cause the indication primitive to be repeated.

However, no indication primitive occurs when

- a) both the received MSRDC request DLPDU and the reply DLPDU contain null (zero length) DLSDUs, and
- b) the addressed remote DLS-user has configured the D\_SAP to not signal such events.

NOTE 1 This behavior is configured through the Indication\_mode parameter of the DL-management DLSAP Activate Responder primitive (see 5.5.8).

NOTE 2 This non-reporting does not affect the storage resources of the responding DLE.

##### 4.4.4.4.2 Parameters of the primitive

###### 4.4.4.4.2.1 Service\_class, D\_addr, D\_SAP\_index, S\_addr, S\_SAP\_index, DLSDU

These parameters have the same meaning as described in 4.4.3.4.2.

###### 4.4.4.4.2.2 Reference

This parameter has the same meaning as described in 4.4.3.4.2.2.

###### 4.4.4.4.2.3 Update\_status

This parameter indicates whether or not the response data (DLSDU) has been passed to the initiating local DLE and to all other remote DLEs (Subscribers). Permitted values for this parameter are specified in Table 7 (see 4.4.3.4.2.3).

#### 4.4.4.5 MSRDC MCT-data-reply confirm primitive

##### 4.4.4.5.1 Use of the primitive

This primitive is passed from the local DLE to the local DLS-user upon completion of the corresponding service request. DL\_status indicates the completion status of the request and, when successful, the presence or absence of a returned DLSDU.

NOTE When DL\_status indicates a temporary error, the local DLS-user may assume that a subsequent repetition may be successful. When DL\_status indicates a permanent error, the local DLS-user may assume that a subsequent repetition may not be successful. Other method should be used to deal this type of error.

##### 4.4.4.5.2 Parameters of the primitive

###### 4.4.4.5.2.1 DLSDU

This optional parameter returns the DLS-user data sent by the remote DLE, if any. This parameter will not appear, if the DL\_status is different from DL, DH, RDL and RDH.

###### 4.4.4.5.2.2 DL\_status

This parameter has the same meaning as described in 4.4.3.5.2.2.

#### 4.4.4.6 Type of primitive and parameters of MSRDC DXM data reply

Table 12 indicates the primitives and parameters of the MSRDC DXM data reply service.

**Table 12 – MSRD DXM data reply primitive and parameters**

DL-DXM-DATA-REPLY Parameter name	Indication
	output
Service_class	M
D_addr	M
D_SAP_index	M
S_addr	M
S_SAP_index	M
DLSDU	M

#### 4.4.4.7 MSRD DXM data reply indication primitive

##### 4.4.4.7.1 Use of the primitive

This primitive is passed from the remote DLE (Subscriber) to the remote DLS-user upon receipt of a reply DLPDU addressed to the DLE with the destination address DA = 127 (Broadcast) and the specified D\_SAP\_index to convey a DLSDU which has been retrieved by a remotely-initiated invocation of the MSRD service. This primitive is only possible in conjunction with remote invocation of the MSRD service.

##### 4.4.4.7.2 Parameters of the primitive

###### 4.4.4.7.2.1 Service\_class

This parameter has the same meaning as described in 4.4.1.3.2.1.

###### 4.4.4.7.2.2 S\_addr, S\_SAP\_index

These parameters have the same meaning as described in 4.4.3.4.2.

###### 4.4.4.7.2.3 DLSDU

This parameter returns the DLS-user data sent by the remote DLE (Publisher).

###### 4.4.4.7.2.4 D\_addr

This parameter specifies the destination DL-address of the received reply DLPDU. The global address (127) is the only allowed value.

NOTE See Note of 4.4.1.4.2.2.

###### 4.4.4.7.2.5 D\_SAP\_index

This parameter specifies the destination service-access-point of the received reply DLPDU. The D\_SAP\_index value 63, which specifies Broadcast, and CS are not permitted. Each receiving remote DLE (Subscriber) delivers the received DLSDU to its DLS-user.

NOTE See Note of 4.4.1.3.2.3

#### 4.4.4.8 SRD reply-update request primitive

For a description of this primitive and its parameters, see 4.4.3.7.

#### 4.4.4.9 SRD reply-update confirm primitive

For a description of this primitive and its parameters, see 4.4.3.8.

### 4.4.5 Clock Synchronization (CS)

#### 4.4.5.1 Function

The local DLS-user passes a DL-CS-TIME-EVENT request primitive to the local DLE to start the clock synchronization sequence. The local DLE accepts the service request, forms an appropriate DLPDU to transmit a Time Event indicating the start of clock synchronization to all remote DLEs (time receivers) which support clock synchronization.

Upon reception of a DL-CS-TIME-EVENT request primitive the local DLE starts a send-delay-timer to measure the delay between the reception of the primitive and sending of the appropriate DLPDU. The remote DLEs (time receivers) start the receive-delay-timer after reception of such a DLPDU.

The local DLE passes a DL-CS-TIME-EVENT confirm primitive together with the send delay time and the status of transmission to the local DLS-user.

Upon a positive confirmation the local DLS-user passes a DL-CS-CLOCK-VALUE request primitive with a DLSDU which contains clock information to the local DLE. The local DLE accepts the service request, forms an appropriate DLPDU containing the DLSDU, and tries to send the DLPDU to all remote DLEs (time receivers) which support clock synchronization. When the DLPDU is sent, the local DLE passes a DL-CS-CLOCK-VALUE confirm primitive together with a completion status to the local DLS-user. The remote DLEs (time receivers) that receive the DLPDU error-free stop their receive-delay-timer. The receiving DLEs (time receivers) pass the DLSDU received from the initiating DLE (time master) together with the receive delay time and the status concerning the transmission to its local DLS-user by means of a DL-CS-CLOCK-VALUE indication primitive.

#### 4.4.5.2 Types of primitives and parameters of the CS time event

Table 13 indicates the primitives and parameters of the CS time event service.

**Table 13 – CS time event primitives and parameters**

DL-CS-TIME-EVENT Parameter name	Request	Confirm
	input	output
D_addr	M	(see Note)
D_SAP_index	M	(see Note)
S_SAP_index	M	(see Note)
Send_delay_time	—	C
DL_status	—	M

NOTE The method by which a confirm primitive is correlated with its corresponding preceding request primitive is a local matter. The descriptions in IEC 61158-4-3 and IEC 61158-5-3 assume that the indicated input parameter values of the request primitive are returned as output parameter values of the corresponding confirm primitive.

#### 4.4.5.3 CS time event request primitive

##### 4.4.5.3.1 Use of the primitive

This primitive is passed to the local DLE (time master) to send an appropriate DLPDU to a group of remote DLEs (time receivers) which have activated the CS DLSAP. Upon reception of this primitive the local DLE (time master) starts its send-delay-timer to measure the internal delay between receiving the primitive and transmitting the appropriate DLPDU.

#### 4.4.5.3.2 Parameters of the primitive

##### 4.4.5.3.2.1 D\_addr

The D\_addr (destination-address) parameter specifies the DL-address of the remote DLE. The global address (127) is permitted; it designates the set of all receiving DLEs.

NOTE See Note in 4.4.1.4.2.2.

##### 4.4.5.3.2.2 D\_SAP\_index

The D\_SAP\_index parameter specifies the DLSAP of the remote DLS-user within the remote DLE designated by the D\_addr parameter. The D\_SAP\_index value CS is the only allowed one.

##### 4.4.5.3.2.3 S\_SAP\_index

The S\_SAP\_index parameter specifies a DLSAP of the local DLS-user. The S\_SAP\_index value CS is the only allowed value.

#### 4.4.5.4 CS time event confirm primitive

##### 4.4.5.4.1 Use of the primitive

After successful transmission of the DLPDU initiated by the appropriate request primitive the local DLE stops its send-delay-timer and returns a local confirmation of transmittal together with the send delay time to the local DLS-user by means of a DL-CS-TIME-EVENT confirm primitive.

##### 4.4.5.4.2 Parameters of the primitive

###### 4.4.5.4.2.1 Send\_delay\_time

This conditional parameter specifies the delay time which elapse between the CS time event request and the transmitting of the appropriate DLPDU. This parameter is not present when the resulting DL\_status is different from OK and SV.

###### 4.4.5.4.2.2 DL\_status

This parameter indicates the success or failure of the associated request and whether a temporary or a permanent error exists. Table 14 specifies the permitted values.

**Table 14 – Values of DL\_status for the CS time event service**

Short name	Status	Definition	Temporary (t) or permanent (p)
OK	success	The parameter Send_delay_time is available	—
LS	failure	Service at local DLSAP or local DLSAP not activated (send-delay-timer has not been started)	p
LR	failure	Resources local not available or not sufficient (send-delay-timer has not been started)	p
DS	failure	Local DL/Ph Entity not in logical token ring or disconnected from line (send-delay-timer has not been started)	t
SV	failure	Sequence violation (subsequent CS time event services without CS clock value service in between)	p
IV	failure	Invalid parameters in request	—

#### 4.4.5.5 Types of primitives and parameters of the CS clock value

Table 15 indicates the primitives and parameters of the CS clock value service.

**Table 15 – CS clock value primitives and parameters**

DL-CS-CLOCK-VALUE Parameter name	Request	Indication	Confirm
	input	output	output
D_addr	M	M(=)	(see Note)
D_SAP_index	M	M(=)	(see Note)
S_addr	—	M	
S_SAP_index	M	M(=)	(see Note)
DLSDU	M	M(=)	—
Receive_delay_time	—	M	—
CS_status	—	M	v
DL_status	—	—	M

NOTE The method by which a confirm primitive is correlated with its corresponding preceding request primitive is a local matter. The descriptions in IEC 61158-4-3 and IEC 61158-5-3 assume that the indicated input parameter values of the request primitive are returned as output parameter values of the corresponding confirm primitive.

#### 4.4.5.6 CS clock value request primitive

##### 4.4.5.6.1 Use of the primitive

The DLS-user passes a DLSDU by meaning of a CS clock value request primitive. The local DLE prepares an appropriate DLPDU and tries to transmit this DLPDU.

##### 4.4.5.6.2 Parameters of the primitive

###### 4.4.5.6.2.1 D\_addr, D\_SAP\_index, S\_SAP\_index

These parameters have the same meaning as described in 4.4.5.3.2.

#### 4.4.5.6.2.2 DLSDU

This parameter specifies the DLS-user data that is to be transferred by the local DLE (time master). The size of this DLSDU is fixed to 18 octets.

#### 4.4.5.7 CS clock value indication primitive

##### 4.4.5.7.1 Use of the primitive

This primitive is passed from the remote DLE (time receiver) to the addressed DLS-user upon reception of a Clock Value DLPDU. If the Clock Value DLPDU was received error-free the local DLE stops their receive-delay-timer and calculate the receive delay time.

##### 4.4.5.7.2 Parameters of the primitive

###### 4.4.5.7.2.1 D\_addr

This parameter specifies the destination DL-address of the received Clock Value DLPDU. The global address (127) is permitted; it designates the set of all receiving DLEs.

NOTE See Note in 4.4.1.4.2.2.

###### 4.4.5.7.2.2 S\_addr

This parameter specifies the DL-address of the initiating DLE. The S\_addr is an individual address; the global address (127) for broadcast or multicast messages is not permitted.

NOTE See Note in 4.4.1.4.2.3.

###### 4.4.5.7.2.3 D\_SAP\_index, S\_SAP\_index

These parameters specify the source and destination DLSAPs of the received Clock Value DLPDU within their respective DLEs.

###### 4.4.5.7.2.4 DLSDU

This parameter has the same meaning as described in 4.4.5.6.2.2.

###### 4.4.5.7.2.5 Receive\_delay\_time

This parameter specifies the receive delay time between the reception of a Time Event DLPDU and the end of the Clock Value DLPDU reception. In case of a sequence violation the value of this parameter is zero.

###### 4.4.5.7.2.6 CS\_status

This parameter indicates the success or failure of the Clock Synchronization sequence. Table 16 specifies the parameter values.

**Table 16 – Values of CS\_status for the CS clock value service**

Short name	Status	Definition	Temporary (t) or permanent (p)
OK	success	clock synchronization sequence orderly executed	—
SV	failure	clock synchronization sequence not orderly executed	t/p

#### 4.4.5.8 CS clock value confirm primitive

##### 4.4.5.8.1 Use of the primitive

The local DLE (time master) returns a local confirmation of transmittal to the local DLS-user by means of this primitive including a status information about the success or failure of the transmittal and the validity of the clock synchronization sequence.

##### 4.4.5.8.2 Parameters of the primitive

###### 4.4.5.8.2.1 DL\_status

This parameter indicates success or failure of the associated request and whether a temporary or a permanent error exists. Table 17 specifies the parameter values.

**Table 17 – Values of DL\_status for the CS clock value service**

Short name	Status	Definition	Temporary (t) or permanent (p)
OK	success	Transmission of CS clock value completed by local DL-entity	—
LS	failure	Service at local DLSAP or local DLSAP not activated	p
LR	failure	Resources local not available or not sufficient	p
DS	failure	Local FDL/Ph Entity not in logical token ring or disconnected from line	t
SV	failure	Sequence violation	p
IV	failure	Invalid parameters in request	—

## 5 DL-management Service

### 5.1 General

This clause describes the interface between a DLE and a DL-management user (DLMS-user). The services of this interface are needed for the protocol which implements the DLS specified in Clause 4.

### 5.2 Facilities of the DLMS

DL-management organizes the initialization, configuration, event and error handling between the DLMS-user and the logical functions in the DLE. The following functions are provided to the DLMS-user.

- a) Reset of the local DLE
- b) Request for and modification of the actual operating parameters and of the counters of the local DLE
- c) Notification of unexpected events, errors, and status changes, both local and remote
- d) Request for identification and for the DLSAP configuration of the local DLE
- e) Activation and deactivation of local DLSAPs

### 5.3 Services of the DL-management

#### 5.3.1 Overview of services

DL-management provides the following services to the DLMS-user:

- a) Reset
- b) Set Value
- c) Get Value
- d) Event
- e) Ident
- f) DLSAP Status
- g) DLSAP Activate
- h) DLSAP Activate Responder
- i) DLSAP Activate Subscriber
- j) DLSAP Deactivate

The services Reset, Set Value, Event and DLSAP Activate are considered mandatory. The services Get Value, Ident, DLSAP Status, DLSAP Activate Subscriber and DLSAP Deactivate are considered optional. The service DLSAP Activate Responder is considered mandatory for slaves and optional for masters.

### 5.3.2 Reset

The DLMS-user employs this service to cause DL-management to reset the DLE. A reset is equivalent to power on. The DLMS-user receives a confirmation thereof.

### 5.3.3 Set value

The DLMS-user employs this service to assign new values to the variables of the DLE. The DLMS-user receives a confirmation whether the specified variables have been set to the new values.

### 5.3.4 Get value

This service enables DL-management to read variables of the DLE. The response of the DL-management returns the actual value of the specified variables.

### 5.3.5 Event

DL-management employs this service to inform the DLMS-user about certain events or errors in the DLL.

### 5.3.6 Ident

When requesting the identification service, a distinction is made between master and slave stations. By employing this service the DLMS-user of a slave station determines the version data of the local DLEs hardware and software. When employing this service in the case of a master station, the DLMS-user can additionally request the same type of information from a remote station.

### 5.3.7 DLSAP status

The DLMS-user employs this service to inform itself about the configuration of DLSAPs of the local DLE.

### 5.3.8 DLSAP activate

This service enables the DLMS-user to activate and to configure a local DLSAP for the reply services (SRD and MSRD). Excluded from this is the responder function for the reply services. The DLMS-user receives a confirmation on the execution of the service from DL-management.

### 5.3.9 DLSAP activate responder

The DLMS-user employs this service to activate a local DLSAP for the responder function for the reply services (SRD and MSRD). The DLMS-user receives a confirmation of execution of the service from DL-management.

### 5.3.10 DLSAP activate subscriber

The DLMS-user employs this service to activate a local DLSAP for the subscriber function of the MSRD service. The DLMS-user receives a confirmation of execution of the service from DL-management.

### 5.3.11 DLSAP deactivate

The DLMS-user employs this service to cause DL-management to deactivate a local DLSAP. DL-management returns a confirmation thereof.


## 5.4 Overview of interactions

DL-management services and their primitives are summarized in Table 18.


**Table 18 – Summary of DL-management services and primitives**

Service	Primitive	Possible for the following stations
Reset	DLM-RESET request DLM-RESET confirm	local: master and slave
Set Value	DLM-SET-VALUE request DLM-SET-VALUE confirm	local: master and slave
Get Value	DLM-GET-VALUE request DLM-GET-VALUE confirm	local: master and slave
Event	DLM-EVENT indication	local: master and slave
Ident	DLM-IDENT request DLM-IDENT confirm	local: master and slave remote: master
DLSAP Status	DLM-DLSAP-STATUS request DLM-DLSAP-STATUS confirm	local: master and slave
DLSAP Activate	DLM-DLSAP-ACTIVATE request DLM-DLSAP-ACTIVATE confirm	local: master and slave
DLSAP Activate Responder	DLM-DLSAP-ACTIVATE-RESPONDER request DLM-DLSAP-ACTIVATE-RESPONDER confirm	local: master and slave
DLSAP Activate Subscriber	DLM-DLSAP-ACTIVATE-SUBSCRIBER request DLM-DLSAP-ACTIVATE-SUBSCRIBER confirm	local: master and slave
DLSAP Deactivate	DLM-DLSAP-DEACTIVATE request DLM-DLSAP-DEACTIVATE confirm	local: master and slave


The temporal relationships of the DL-management primitives are shown in Figure 7 through Figure 9.

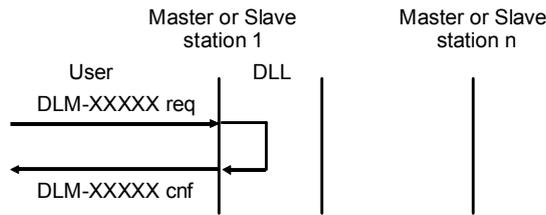

**Figure 7 – Reset, Set value, Get value, Ident (local), DLSAP status, DLSAP activate, DLSAP activate responder, DLSAP activate subscriber and DLSAP deactivate services**

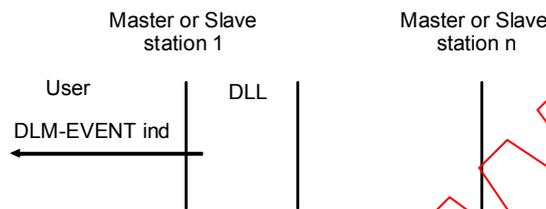

**Figure 8 – Event service**

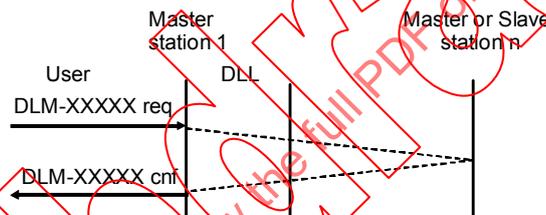

**Figure 9 – Ident (remote) service**

**5.5 Detailed specification of services and interactions**

**5.5.1 Reset**

**5.5.1.1 Function**

The DLMS-user passes a DLM-RESET request primitive to DL-management causing it to reset the DLE. This is carried out in the same manner as at a Power On. The DLE assumes the "Offline"-status and all DLE variables (operational parameters/counters) are cleared. As a result DL-management passes a DLM-RESET confirm primitive to the DLMS-user to indicate the success or failure of the corresponding service request.

**5.5.1.2 Types of primitives and parameters**

Table 19 indicates the primitives and parameters of the Reset service.

**Table 19 – Reset primitives and parameters**

DLM-RESET Parameter name	Request	Confirm
	input	output
DLM_status		M
NOTE The method by which a confirm primitive is correlated with its corresponding preceding request primitive is a local matter.		

### 5.5.1.3 Parameters of the primitive

#### 5.5.1.3.1 DLM\_status

This parameter indicates the success or failure of the associated reset service request. Permitted values for this parameter are specified in Table 20.

**Table 20 – Values of DLM\_status for the reset service**

Short name	Status	Definition	Temporary (t) or permanent (p)
OK	success	The Reset function was carried out successfully	—
NO	failure	The Reset function was not carried out successfully	t/p
IV	failure	Invalid parameters in request	—

### 5.5.2 Set Value

#### 5.5.2.1 Function

The DLMS-user passes a DLM-SET-VALUE request primitive to DL-management to assign a desired value to one or more specified variables of the DLE. After receiving this primitive DL-management tries to select these variables and to set the new values. If the requested service was executed DL-management passes a DLM-SET-VALUE confirm primitive to the DLMS-user to indicate the success or failure of the corresponding service request.

#### 5.5.2.2 Types of primitives and parameters

Table 21 indicates the primitives and parameters of the Set Value service.

**Table 21 – Set value primitives and parameters**

DLM-SET-VALUE Parameter name	Request	Confirm
	input	output
Variable_name (1 to n)	M	
Index (1 to k)	C	
Desired_value (1 to n)	M	
DLM_status (1 to n)		M
NOTE The method by which a confirm primitive is correlated with its corresponding preceding request primitive is a local matter.		

#### 5.5.2.3 Parameters of the primitives

##### 5.5.2.3.1 Variable\_name

This array parameter specifies one or more variables (1 to n) which are to be assigned values from the corresponding elements of the Desired\_value parameter. The selectable variables are operating parameters and counters; they are specified in Table 22 and Table 23.

**Table 22 – Mandatory DLE-variables**

Operating parameters	
Name	Definition
TS	DL-address of this station
Data_rate	Data signaling rate of this fieldbus
Medium_redundancy	Availability of redundant media
HW-Release	Hardware release number
SW-Release	Software release number
T <sub>SL</sub>	Slot time
min T <sub>SDR</sub>	Smallest station delay time
max T <sub>SDR</sub> (see Note 1)	Largest station delay time
T <sub>QUI</sub> (see Note 1)	Transmitter fall time (line state uncertain time) or repeater switch time
T <sub>SET</sub> (see Note 1)	Setup time
T <sub>TR</sub> (see Note 1)	Target rotation time
G (see Note 1)	GAP update factor
in_ring_desired (see Note 1)	Request entry into or exit out of the logical token ring
HSA (see Note 1)	Highest station address of a master station on this fieldbus
max_retry_limit (see Note 1)	Maximum number of retries
T <sub>CSI</sub> (see Note 2)	Clock synchronization interval
Isochronous_mode	Selects the operation of the isochronous mode
SYNCHT (see Note 3)	Contents of the SYNCH DLPDU
T <sub>CT</sub> (see Note 3)	Isochronous cycle time
maxT <sub>SH</sub> (see Note 3)	Allowed maximal time shift
NOTE 1 This applies only to master stations.	
NOTE 2 This applies only to stations able to support clock synchronization.	
NOTE 3 This applies only to master stations able to work in isochronous mode.	

**Table 23 – Optional DLE-variables**

Counters	
Name	Definition
DLPDU_sent_count (see Notes 1, 2)	Number of DLPDUs sent
Retry_count (see Notes 1, 2)	Number of DLPDU repeats
DLPDU_sent_count_sr (see Notes 1, 2)	List of numbers of DLPDUs sent per station
Error_count (see Notes 1, 2)	List of numbers of no or erroneous responses per station
SD_count (see Note 2)	Number of correct start delimiters (from PhE)
SD_error_count (see Note 2)	Number of defective start delimiters (from PhE)
NOTE 1 This applies only to master stations.	
NOTE 2 If a counter reaches its maximum value, then both this counter and its comparison counter are stopped. If a counter is reset to zero the related co-operative counter is also reset to zero, then these counters are free to count again.	

### 5.5.2.3.2 Index

This conditional parameter is a selector for one or more entries (1 to k), used when a variable contains an array or list of values. Possible values for each entry of the list are 0 to 126.

NOTE The parameter is only used for the counters DLPDU\_sent\_count\_sr and Error\_count.

### 5.5.2.3.3 Desired\_value

This array parameter specifies the actual value to be written to the variables (1 to n) that are specified by the Variable\_name parameter. This parameter specifies a list of one or more (1 to n) new values for the specified DLE-variables. The permissible value or range of values for each of these variables is specified in Table 24 and Table 25.

**Table 24 – Permissible values of mandatory DLE-variables**

Operating parameters	
Variable	Range of values
TS	one octet address field, DL-address value 0 to 126
Data_rate	9,6; 19,2; 31,25; 45,45; 93,75; 187,5; 500; 1 500; 3 000; 6 000; 12 000 kbit/s and others
Medium_redundancy	single; redundant
HW-Release	LE_HR; Visible String [length 0 to 32]
SW-Release	LE_SR; Visible String [length 0 to 32]
TSL	52 to $2^{16}-1$ (bit times)
min TSDR	$2^0$ to $2^{16}-1$ (bit times)
max TSDR	$2^0$ to $2^{16}-1$ (bit times)
TQUI	0 to $2^8-1$ (bit times)
TSET	$2^0$ to $2^8-1$ (bit times)
TTR	$2^0$ to $2^{24}-1$ (bit times)
G	1 to 100
in_ring_desired	TRUE; FALSE
HSA (see Note 1)	2 to 126
max_retry_limit	0 to 8 (preferably 1)
TCSI	$2^0$ to $2^{32}-1$ (bit times)
Isochronous_mode	0 to 3 (see Table 26)
SYNCHT (see Note 2)	2 (octets)
TCT	$2^0$ to $2^{24}-1$ (bit times), not exceeding 32 ms
maxTSH	1 to 256 (bit times)
NOTE 1 Additionally the value 0 is possible for isochronous mode operation.	
NOTE 2 For further explanation, refer to IEC 61158-5-3.	

**Table 25 – Permissible values of optional DLE-variables**

Counters	
Variable	Value
DLPDU_sent_count	0
Retry_count	0
DLPDU_sent_count_sr[Index]	0
Error_count[Index]	0
SD_count	0
SD_error_count	0

**Table 26 – Meaning of the values for the parameter isochronous\_mode**

Value	Meaning
0	No isochronous operation
1	Station works as isochronous master
2	Station works as isochronous master; delayed isochronous cycles are skipped
3	Station works as additional master in a fieldbus system working in isochronous mode

Table 27 and Table 28 give an overview of the most important operating parameters and their default values in the fieldbus system.

**Table 27 – Default reaction times and operating parameters for a master station for asynchronous transmission**

Operating parameters	Data rate (kbit/s)					
	≤ 187,5	500	1 500	3 000	6 000	12 000
$T_{RDY}$ (t <sub>BIT</sub> )	< 11	< 11	< 11	< 11	< 11	< 11
$T_{SDI}$ (t <sub>BIT</sub> )	≤ 70	≤ 150	≤ 200	≤ 250	≤ 450	≤ 800
default values						
$T_{SL}$ (t <sub>BIT</sub> )	100	200	300	400	600	1 000
min $T_{SDR}$ (t <sub>BIT</sub> )	11	11	11	11	11	11
max $T_{SDR}$ (t <sub>BIT</sub> )	60	100	150	250	450	800
$T_{SET}$ (t <sub>BIT</sub> )	1	1	1	4	8	16
$T_{QUI}$ (t <sub>BIT</sub> )	0	0	0	3	6	9
$T_{S}$	10	10	10	10	10	10
HSA	126	126	126	126	126	126
max_retry_limit	1	1	1	2	3	4

NOTE In a multi-master environment some operating parameters may have to be set to higher values. Especially the  $T_{SL}$  may be extended because of token passing. Each master should have the possibility to receive the token and if necessary react (send a request DLPDU or token) properly.

**Table 28 – Default reaction times and operating parameters for a slave station with asynchronous transmission**

Operating parameters	Data rate (kbit/s)					
	≤ 187,5	500	1 500	3 000	6 000	12 000
max $T_{SDR}$ (t <sub>Bit</sub> )	≤ 60	≤ 100	≤ 150	≤ 250	≤ 450	≤ 800
default values						
min $T_{SDR}$ (t <sub>Bit</sub> )	11	11	11	11	11	11

In process application areas, coupling between the synchronous transmission and the asynchronous transmission (according to IEC 61158-2, Type 3) is done by Ph-couplers. In the case of the synchronous data rate 31,25 kbit/s, the correlated data rate on the asynchronous side should be 45,45 kbit/s or 93,75 kbit/s. Table 29 and Table 30 indicate the required range of parameters.

**Table 29 – Default reaction times and operating parameters for master stations for coupling of synchronous and asynchronous transmission segments**

Operating parameters	Data rate (kbit/s)		
	Synchronous	Asynchronous	
	31,25	45,45	93,75
T <sub>RDY</sub> (t <sub>BIT</sub> )	< 11	< 11	< 11
T <sub>SDI</sub> (t <sub>BIT</sub> )	≤ 70	≤ 70	≤ 70
default values			
Preamble_Extension (bit)	1		
T <sub>PTG</sub> (t <sub>BIT</sub> )	0		
T <sub>SL</sub> (t <sub>BIT</sub> )	150	640	2 500 (7 200) (see Note)
min T <sub>SDR</sub> (t <sub>BIT</sub> )	11	11	11
max T <sub>SDR</sub> (t <sub>BIT</sub> )	100	400	1 000 (3 800) (see Note)
T <sub>SET</sub> (t <sub>BIT</sub> )	30	95	95
T <sub>QUI</sub> (t <sub>BIT</sub> )	0	0	0
G	10	10	10
HSA	126	126	126
max_retry_limit	1	1	1

NOTE The value within parentheses is for a maximum DLSDU length between 65 octets and 244 octets in request and acknowledge/response DLPDUs. The value before the parentheses is for a maximum DLSDU length of 64 octets or less in request and acknowledge/response DLPDUs.

**Table 30 – Default reaction times and operating parameter for slave stations for coupling of synchronous and asynchronous transmission segments**

Operating parameters	Data rate (kbit/s)		
	Synchronous	Asynchronous	
	31,25	45,45	93,75
max T <sub>SDR</sub> (t <sub>BIT</sub> )	≤ 100	≤ 250	≤ 250
default values			
Preamble_Extension (bit)	1		
T <sub>PTG</sub> (t <sub>BIT</sub> )	0		
min T <sub>SDR</sub> (t <sub>BIT</sub> )	11	11	11

The values for asynchronous transmission (45,45 kbit/s and 93,75 kbit/s) are valid only for slaves operating directly on an asynchronous transmission segment.

**5.5.2.3.4 DLM\_status**

This array parameter indicates for each variable in the corresponding request, the success or failure of that component of the associated Set Value service request. Permitted values for the individual components of this array parameter are specified in Table 31.

**Table 31 – Values of DLM\_status for the set value service**

Short name	Status	Definition	Temporary (t) or permanent (p)t
OK	success	The variable has been set to the new value	—
NO	failure	The variable does not exist or could not be set to the new value	t/p
IV	failure	Invalid parameters in request	—

### 5.5.3 Get Value

#### 5.5.3.1 Function

The DLMS-user passes a DLM-GET-VALUE request primitive to DL-management to read the current value(s) of one or more variables of the DLE. After receipt of this primitive DL-management tries to select the specified variables and to deliver their current values and passes a DLM-GET-VALUE confirm primitive to the DLMS-user to indicate the success or failure of the corresponding service request. This primitive returns as a parameter one or more of the requested variable values.

#### 5.5.3.2 Types of primitives and parameters

Table 32 indicates the primitives and parameters of the Get Value service.

**Table 32 – Get value primitives and parameters**

DLM-GET-VALUE Parameter name	Request	Confirm
	input	output
Variable_name (1 to n)	M	
Index (1 to k)	C	
Current_value (1 to n)		M
DLM_status (1 to n)		M
NOTE The method by which a confirm primitive is correlated with its corresponding preceding request primitive is a local matter.		

#### 5.5.3.3 Parameters of the primitives

##### 5.5.3.3.1 Variable\_name

This array parameter specifies one or more variables (1 to n) whose values are to be read. The selectable variables are specified in Table 22 and Table 23. In master stations the additional variables specified in Table 33 also can be selected.

**Table 33 – Additional mandatory DLE-variables in master stations**

Operating parameters (mandatory)	
Name	Definition
TRR	Real rotation time
LMS	List of master stations in the logical ring
GAPL	List all of stations in the own GAP

##### 5.5.3.3.2 Index

This conditional parameter is a selector for one or more entries (1 to k), used when a variable contains an array or list of values. Possible values for each entry of the list are 0 to 126.

NOTE The parameter is only used in case of the variables "DLPDU\_sent\_count\_sr" and "Error\_count".

##### 5.5.3.3.3 Current\_value

This array parameter specifies the actual value of the (1 to n) variables that were specified by the Variable\_name parameter of the corresponding request. The permissible value or range of values for each of these variables is specified in Table 24, Table 25, and Table 34.

**Table 34 – Permissible values of the additional DLE-variables in master stations**

Operating parameters	
Variable	Range of values
T <sub>RR</sub>	2 <sup>0</sup> to 2 <sup>24</sup> -1 (bit times)
LMS	preferably maximum 32 DL-addresses (0 to 126), optionally up to 127 DL-addresses
GAPL	max. 126 DL-addresses (0 to 126) inclusive DLE status
Counters	
Variable	Range of values
DLPDU_sent_count	0 to 2 <sup>32</sup> -1
Retry_count	0 to 2 <sup>16</sup> -1
SD_count	0 to 2 <sup>32</sup> -1
SD_error_count	0 to 2 <sup>16</sup> -1
DLPDU_sent_count_sr	max. 126 entries of 0 to 2 <sup>32</sup> -1
Error_count	max. 126 entries of 0 to 2 <sup>16</sup> -1

The value of the parameter Current\_value is not defined if the value of the parameter DLM\_status is different from OK.

#### 5.5.3.3.4 DLM\_status

This array parameter indicates for each variable in the associated Get Value service request the success or failure of the execution of the service. Permitted values for this parameter are specified in Table 35.

**Table 35 – Values of DLM\_status for the get value service**

Short name	Status	Definition	Temporary (t) or permanent (p)
OK	success	The variable could be read	—
NO	failure	The variable does not exist or could not be read	t/p
IV	failure	Invalid parameters in request	—

#### 5.5.4 Event

##### 5.5.4.1 Function

The DLE informs DL-management that it has detected a faulty condition or an event. After that DL-management passes a DLM-EVENT indication primitive to the DLMS-user to inform it about important error conditions or events in the DLL.

##### 5.5.4.2 Types of primitives and parameters

Table 36 indicates the primitive and parameters of the Event service.

**Table 36 – Event primitive and parameters**

DLM-EVENT Parameter name	Indication
	output
Event/Fault	M
TSH	C

### 5.5.4.3 Parameters of the primitives

#### 5.5.4.3.1 Event/Fault

This parameter specifies the event that took place or the fault type. The various events and faults are shown in Table 37.

**Table 37 – Mandatory DLL events and fault types**

Name	Definition
Time_out	No bus activity
Not_synchronized	Synchronization not detected within interval T <sub>SYN</sub>
In_ring (see Note 1)	This master stations has been taken into the logical token ring
Out_of_ring (see Note 1)	This master station has been taken out of the logical token ring not on its own initiative
GAP_event (see Note 1)	A change in the GAPL has occurred
Duplicate_address (see Note 1)	A duplication of this station's DL-address exists in the logical token ring
Faulty_transceiver (see Note 1)	The transmitter or receiver of this station is malfunctioning
Double_token (see Note 1)	While waiting for a response the master station receives a request DLPDU or token DLPDU
HSA_error (see Note 1)	master station receives a token DLPDU with DA or SA higher than local HSA
State_conflict (see Note 1)	MAC of master station has detected an internal state conflict
Synch (see Note 2)	Marks the beginning of an isochronous cycle
Synch_Delay (see Note 2)	Synch delay has occurred
NOTE 1 This event applies only to master stations.	
NOTE 2 This event applies only to master stations in isochronous mode.	

#### 5.5.4.3.2 TSH

This conditional parameter is only present, if the parameter Event/Fault has the value "Synch\_Delay". It contains the time shift which marks the time difference between the end of an isochronous cycle and sending of a synch message. The permissible values are shown in Table 38.

**Table 38 – Permissible values of TSH**

Operating parameters	
Variable	Range of values
TSH	0 to 2 <sup>16</sup> -1