

INTERNATIONAL STANDARD

NORME INTERNATIONALE

**Industrial communication networks – Fieldbus specifications –
Part 6-15: Application layer protocol specification – Type 15 element**

**Réseaux de communication industriels – Spécifications des bus de terrain –
Partie 6-15: Spécification des protocoles des couches d'application –
Éléments de Type 15**



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2007 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

IEC Catalogue - webstore.iec.ch/catalogue

The stand-alone application for consulting the entire bibliographical information on IEC International Standards, Technical Specifications, Technical Reports and other documents. Available for PC, Mac OS, Android Tablets and iPad.

IEC publications search - www.iec.ch/searchpub

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 30 000 terms and definitions in English and French, with equivalent terms in 14 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

More than 55 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: csc@iec.ch.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Catalogue IEC - webstore.iec.ch/catalogue

Application autonome pour consulter tous les renseignements bibliographiques sur les Normes internationales, Spécifications techniques, Rapports techniques et autres documents de l'IEC. Disponible pour PC, Mac OS, tablettes Android et iPad.

Recherche de publications IEC - www.iec.ch/searchpub

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études,...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et aussi une fois par mois par email.

Electropedia - www.electropedia.org

Le premier dictionnaire en ligne de termes électroniques et électriques. Il contient plus de 30 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans 14 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

Glossaire IEC - std.iec.ch/glossary

Plus de 55 000 entrées terminologiques électrotechniques, en anglais et en français, extraites des articles Termes et Définitions des publications IEC parues depuis 2002. Plus certaines entrées antérieures extraites des publications des CE 37, 77, 86 et CISPR de l'IEC.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: csc@iec.ch.

INTERNATIONAL STANDARD

NORME INTERNATIONALE

**Industrial communication networks – Fieldbus specifications –
Part 6-15: Application layer protocol specification – Type 15 elements**

**Réseaux de communication industriels – Spécifications des bus de terrain –
Partie 6-15: Spécification des protocoles des couches d'application –
Éléments de Type 15**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

PRICE CODE
CODE PRIX

XD

ICS 25.040.40; 35.100.70

ISBN 978-2-8322-1983-6

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD.....	6
INTRODUCTION.....	8
1 Scope.....	9
1.1 General.....	9
1.2 Specifications.....	9
1.3 Conformance.....	9
2 Normative references	10
3 Terms and definitions, abbreviations, symbols and conventions	10
3.1 Terms and definitions.....	10
3.2 Abbreviations and symbols.....	17
3.3 Conventions	18
3.4 Conventions used in state machines	20
4 Abstract syntax for client/server	22
5 Transfer syntax for client/server	22
5.1 General.....	22
5.2 Common APDU structure	22
5.3 Service-specific APDU structures.....	26
5.4 Data representation 'on the wire'.....	50
6 Abstract syntax for publish/subscribe.....	50
7 Transfer syntax for publish/subscribe	51
7.1 General.....	51
7.2 APDU structure	51
7.3 Sub-message structure	52
7.4 APDU interpretation.....	54
7.5 Service specific APDU structures	56
7.6 Common data representation for publish/subscribe	77
8 Structure of FAL protocol state machines	82
9 AP-context state machines for client/server	84
10 FAL service protocol machine (FSPM) for client/server.....	84
10.1 General.....	84
10.2 FSPM state tables.....	84
10.3 Functions used by FSPM.....	90
10.4 Parameters of FSPM/ARPM primitives	90
10.5 Client/server server transactions	90
11 Application relationship protocol machines (ARPMs) for client/server	91
11.1 Application relationship protocol machines (ARPMs)	91
11.2 AREP state machine primitive definitions	93
11.3 AREP state machine functions	94
12 DLL mapping protocol machine (DMPM) for client/server.....	94
12.1 AREP mapping to data link layer	94
12.2 DMPM states.....	95
12.3 DMPM states.....	95
12.4 Primitives exchanged between data link layer and DMPM	95
12.5 Client/server on TCP/IP.....	96
13 AP-Context state machines for publish/subscribe	97

14 Protocol machines for publish/subscribe	97
14.1 General	97
14.2 Publish/subscribe on UDP	99
Bibliography	100
Figure 1 – APDU Format	22
Figure 2 – Client to server confirmed service request	24
Figure 3 – Normal response from server to client	24
Figure 4 – Exception response from server to client	24
Figure 5 – Client to server unconfirmed service request	25
Figure 6 – Publish/subscribe APDU	51
Figure 7 – Relationships among protocol machines and adjacent layers	83
Figure 8 – State transition diagram of FSPM	84
Figure 9 – Client/server server transactions	91
Figure 10 – State transition diagram of the client ARPM	92
Figure 11 – State transition diagram of the server ARPM	92
Figure 12 – State transition diagram of DMPM	95
Figure 13 – APDU format	96
Figure 14 – TCP/IP PDU format	97
Figure 15 – Publish/subscribe receiver	98
Table 1 – Conventions used for state machines	21
Table 2 – Exception code	25
Table 3 – Read discretes request	26
Table 4 – Read discretes response	26
Table 5 – Read coils request	27
Table 6 – Read coils response	27
Table 7 – Write single coil request	28
Table 8 – Write single coil response	28
Table 9 – Write multiple coils request	29
Table 10 – Write multiple coils response	29
Table 11 – Broadcast write single coil request	30
Table 12 – Broadcast write multiple coils request	31
Table 13 – Read input registers request	31
Table 14 – Read input registers response	32
Table 15 – Read holding registers request	32
Table 16 – Read holding registers response	33
Table 17 – Write single holding register request	33
Table 18 – Write single holding register response	34
Table 19 – Write multiple holding registers request	34
Table 20 – Write multiple holding registers response	35
Table 21 – Mask write holding register request	36
Table 22 – Mask write holding register request	36

Table 23 – Read/Write multiple holding registers request.....	37
Table 24 – Read/Write multiple holding registers response	37
Table 25 – Read FIFO request.....	38
Table 26 – Read FIFO response	38
Table 27 – Broadcast write single holding register request.....	39
Table 28 – Broadcast write multiple holding registers request	40
Table 29 – Read file record request	41
Table 30 – Read file record response	42
Table 31 – Write file record request	43
Table 32 – Write file record response	45
Table 33 – Read device identification request.....	46
Table 34 – Device identification categories	47
Table 35 – Read device ID code	47
Table 36 – Read device identification response	48
Table 37 – Conformity level	49
Table 38 – Requested vs. returned known objects	50
Table 39 – APDU structure	52
Table 40 – Sub-message structure	53
Table 41 – Publish/subscribe service identifier encoding	53
Table 42 – Attributes changed modally and affecting APDUs interpretations	55
Table 43 – Issue request	56
Table 44 – Flags of issue request	57
Table 45 – Meaning of issue request flags.....	57
Table 46 – Interpretation of issue.....	58
Table 47 – Heartbeat request	59
Table 48 – Flags of heartbeat request.....	59
Table 49 – Meaning of heartbeat request flags	60
Table 50 – Interpretation of heartbeat.....	61
Table 51 – VAR request.....	62
Table 52 – Flags of VAR request	63
Table 53 – Meaning of VAR request flags	63
Table 54 – Interpretation of VAR.....	64
Table 55 – GAP request.....	65
Table 56 – Flags of GAP request	65
Table 57 – Meaning of GAP request flags	66
Table 58 – Interpretation of GAP.....	66
Table 59 – ACK request.....	67
Table 60 – Flags of ACK request	67
Table 61 – Meaning of ACK request flags	68
Table 62 – Interpretation of ACK.....	68
Table 63 – Header request	69
Table 64 – Change in state of the receiver.....	70
Table 65 – INFO_DST request.....	70

Table 66 – Flags of INFO_DST request	71
Table 67 – Meaning of INFO_DST request flags	71
Table 68 – INFO_REPLY request	72
Table 69 – Flags of INFO_REPLY request	72
Table 70 – Meaning of INFO_REPLY request flags	73
Table 71 – INFO_SRC request	74
Table 72 – Flags of INFO_SRC request	74
Table 73 – Meaning of INFO_SRC request flags	74
Table 74 – INFO_TS request	75
Table 75 – Flags of INFO_TS request	76
Table 76 – Meaning of INFO_TS request flags	76
Table 77 – PAD request	77
Table 78 – Flags of PAD request	77
Table 79 – Meaning of PAD request flags	77
Table 80 – Semantics	78
Table 81 – FSPM state table – client transactions	85
Table 82 – FSPM state table – server transactions	90
Table 83 – Function MatchInvokeID()	90
Table 84 – Function HighBit()	90
Table 85 – Parameters used with primitives exchanged between FSPM and ARPM	90
Table 86 – Client ARPM states	92
Table 87 – Client ARPM state table	92
Table 88 – Server ARPM states	92
Table 89 – Server ARPM state table	93
Table 90 – Primitives issued from ARPM to DMPM	93
Table 91 – Primitives issued by DMPM to ARPM	93
Table 92 – Parameters used with primitives exchanged between ARPM and DMPM	93
Table 93 – DMPM state descriptions	95
Table 94 – DMPM state table – client transactions	95
Table 95 – DMPM state table – server transactions	95
Table 96 – Primitives exchanged between data-link layer and DMPM	96
Table 97 – Encapsulation parameters for client/server on TCP/IP	96

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**INDUSTRIAL COMMUNICATION NETWORKS –
FIELDBUS SPECIFICATIONS –****Part 6-15: Application layer protocol specification – Type 15 elements**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

NOTE Use of some of the associated protocol types is restricted by their intellectual-property-right holders. In all cases, the commitment to limited release of intellectual-property-rights made by the holders of those rights permits a particular data-link layer protocol type to be used with physical layer and application layer protocols in Type combinations as specified explicitly in the IEC 61784 series. Use of the various protocol types in other combinations may require permission from their respective intellectual-property-right holders.

International Standard IEC 61158-6-15 has been prepared by subcommittee 65C: Industrial networks, of IEC technical committee 65: Industrial-process measurement, control and automation.

This first edition and its companion parts of the IEC 61158-6 subseries cancel and replace IEC 61158-6:2003. This edition of this part constitutes a technical addition. This part and its Type 15 companion parts also cancel and replace IEC/PAS 62030, published in 2005.

This edition of IEC 61158-6 includes the following significant changes from the previous edition:

- a) deletion of the former Type 6 fieldbus for lack of market relevance;
- b) addition of new types of fieldbuses;
- c) partition of part 6 of the third edition into multiple parts numbered -6-2, -6-3, ...

This bilingual version (2014-12) corresponds to the monolingual English version, published in 2007-12.

The text of this standard is based on the following documents:

FDIS	Report on voting
65C/476/FDIS	65C/487/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

The French version of this standard has not been voted upon.

This publication has been drafted in accordance with ISO/IEC Directives, Part 2.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under <http://webstore.iec.ch> in the data related to the specific publication. At this date, the publication will be:

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

NOTE The revision of this standard will be synchronized with the other parts of the IEC 61158 series.

The list of all the parts of the IEC 61158 series, under the general title *Industrial communication networks – Fieldbus specifications*, can be found on the IEC web site.

INTRODUCTION

This part of IEC 61158 is one of a series produced to facilitate the interconnection of automation system components. It is related to other standards in the set as defined by the “three-layer” fieldbus reference model described in IEC/TR 61158-1.

The application protocol provides the application service by making use of the services available from the data-link or other immediately lower layer. The primary aim of this standard is to provide a set of rules for communication expressed in terms of the procedures to be carried out by peer application entities (AEs) at the time of communication. These rules for communication are intended to provide a sound basis for development in order to serve a variety of purposes:

- as a guide for implementors and designers;
- for use in the testing and procurement of equipment;
- as part of an agreement for the admittance of systems into the open systems environment;
- as a refinement to the understanding of time-critical communications within OSI.

This standard is concerned, in particular, with the communication and interworking of sensors, effectors and other automation devices. By using this standard together with other standards positioned within the OSI or fieldbus reference models, otherwise incompatible systems may work together in any combination.

INDUSTRIAL COMMUNICATION NETWORKS – FIELDBUS SPECIFICATIONS –

Part 6-15: Application layer protocol specification – Type 15 elements

1 Scope

1.1 General

The fieldbus Application Layer (FAL) provides user programs with a means to access the fieldbus communication environment. In this respect, the FAL can be viewed as a “window between corresponding application programs.”

This standard provides common elements for basic time-critical and non-time-critical messaging communications between application programs in an automation environment and material specific to Type 15 fieldbus. The term “time-critical” is used to represent the presence of a time-window, within which one or more specified actions are required to be completed with some defined level of certainty. Failure to complete specified actions within the time window risks failure of the applications requesting the actions, with attendant risk to equipment, plant and possibly human life.

This standard defines in an abstract way the externally visible behavior provided by the Type 15 fieldbus Application Layer in terms of

- a) the abstract syntax defining the application layer protocol data units conveyed between communicating application entities,
- b) the transfer syntax defining the application layer protocol data units conveyed between communicating application entities,
- c) the application context state machine defining the application service behavior visible between communicating application entities; and
- d) the application relationship state machines defining the communication behavior visible between communicating application entities; and.

The purpose of this standard is to define the protocol provided to

- 1) define the wire representation of the service primitives defined in IEC 61158-5-15, and
- 2) define the externally visible behavior associated with their transfer.

This standard specifies the protocol of the Type 15 IEC fieldbus Application Layer, in conformance with the OSI Basic Reference Model (ISO/IEC 7498) and the OSI Application Layer Structure (ISO/IEC 9545).

1.2 Specifications

The principal objective of this standard is to specify the syntax and behavior of the application layer protocol that conveys the application layer services defined in IEC 61158-5-15.

A secondary objective is to provide migration paths from previously-existing industrial communications protocols. It is this latter objective which gives rise to the diversity of protocols standardized in IEC 61158-6.

1.3 Conformance

This standard does not specify individual implementations or products, nor does it constrain the implementations of application layer entities within industrial automation systems.

Conformance is achieved through implementation of this application layer protocol specification.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61158-5-15, *Industrial communication networks – Fieldbus specifications – Part 5-15: Application layer service definition – Type 15 elements*

ISO/IEC 7498-1, *Information technology – Open Systems Interconnection – Basic Reference Model – Part 1: The Basic Model*

ISO/IEC 9545, *Information technology – Open Systems Interconnection – Application Layer structure*

ISO/IEC 8822, *Information technology – Open Systems Interconnection – Presentation service definition*

ISO/IEC 8824, *Information technology – Open Systems Interconnection – Specification of Abstract Syntax Notation One (ASN.1)*

3 Terms and definitions, abbreviations, symbols and conventions

3.1 Terms and definitions

For the purposes of this document, the following terms as defined in these publications apply:

3.1.1 ISO/IEC 7498-1 terms

- a) application entity
- b) application process
- c) application protocol data unit
- d) application service element
- e) application entity invocation
- f) application process invocation
- g) application transaction
- h) real open system
- i) transfer syntax

3.1.2 ISO/IEC 8822 terms

- a) abstract syntax
- b) presentation context

3.1.3 ISO/IEC 9545 terms

- a) application-association
- b) application-context
- c) application context name
- d) application-entity-invocation
- e) application-entity-type

- f) application-process-invocation
- g) application-process-type
- h) application-service-element
- i) application control service element

3.1.4 ISO/IEC 8824 terms

- a) object identifier
- b) type

3.1.5 IEC/TR 61158-1 terms

The following IEC/TR 61158-1 terms apply.

3.1.5.1 application

function or data structure for which data is consumed or produced

3.1.5.2 application layer interoperability

capability of application entities to perform coordinated and cooperative operations using the services of the FAL

3.1.5.3 application object

object class that manages and provides the run time exchange of messages across the network and within the network device

NOTE Multiple types of application object classes may be defined.

3.1.5.4 application process

part of a distributed application on a network, which is located on one device and unambiguously addressed

3.1.5.5 application process identifier

distinguishes multiple application processes used in a device

3.1.5.6 application process object

component of an application process that is identifiable and accessible through an FAL application relationship

NOTE Application process object definitions are composed of a set of values for the attributes of their class.

3.1.5.7 application process object class

class of application process objects defined in terms of the set of their network-accessible attributes and services

3.1.5.8 application relationship

cooperative association between two or more application-entity-invocations for the purpose of exchange of information and coordination of their joint operation

NOTE This relationship is activated either by the exchange of application-protocol-data-units or as a result of preconfiguration activities.

3.1.5.9 application relationship endpoint

context and behavior of an application relationship as seen and maintained by one of the application processes involved in the application relationship

NOTE Each application process involved in the application relationship maintains its own application relationship endpoint.

3.1.5.10 application service element

application-service-element that provides the exclusive means for establishing and terminating all application relationships

3.1.5.11 attribute

description of an externally visible characteristic or feature of an object

NOTE The attributes of an object contain information about variable portions of an object. Typically, they provide status information or govern the operation of an object. Attributes may also affect the behaviour of an object. Attributes are divided into class attributes and instance attributes.

3.1.5.12 behaviour

indication of how the object responds to particular events

NOTE Its description includes the relationship between attribute values and services.

3.1.5.13 class

set of objects, all of which represent the same kind of system component

NOTE A class is a generalisation of the object; a template for defining variables and methods. All objects in a class are identical in form and behaviour, but usually contain different data in their attributes.

3.1.5.14 class attributes

attribute that is shared by all objects within the same class

3.1.5.15 class code

unique identifier assigned to each object class

3.1.5.16 class specific service

service defined by a particular object class to perform a required function which is not performed by a common service

NOTE A class specific object is unique to the object class which defines it.

3.1.5.17 Client

a) object which uses the services of another (server) object to perform a task

b) initiator of a message to which a server reacts, such as the role of an AR endpoint in which it issues confirmed service request APDUs to a single AR endpoint acting as a server

3.1.5.18 conveyance path

unidirectional flow of APDUs across an application relationship

3.1.5.19 cyclic

term used to describe events which repeat in a regular and repetitive manner

3.1.5.20 dedicated AR

AR used directly by the FAL user

NOTE On Dedicated ARs, only the FAL Header and the user data are transferred.

3.1.5.21 device

physical hardware connection to the link

NOTE A device may contain more than one node.

3.1.5.22 device profile

collection of device dependent information and functionality providing consistency between similar devices of the same device type

3.1.5.23 dynamic AR

AR that requires the use of the AR establishment procedures to place it into an established state

3.1.5.24 endpoint

one of the communicating entities involved in a connection

3.1.5.25 error

discrepancy between a computed, observed or measured value or condition and the specified or theoretically correct value or condition

3.1.5.26 error class

general grouping for error definitions

NOTE Error codes for specific errors are defined within an error class.

3.1.5.27 error code

identification of a specific type of error within an error class

3.1.5.28 FAL subnet

networks composed of one or more data link segments

NOTE Subnets are permitted to contain bridges, but not routers. FAL subnets are identified by a subset of the network address.

3.1.5.29 logical device

FAL class that abstracts a software component or a firmware component as an autonomous self-contained facility of an automation device

3.1.5.30 management information

network-accessible information that supports managing the operation of the fieldbus system, including the application layer

NOTE Managing includes functions such as controlling, monitoring, and diagnosing.

3.1.5.31 network

series of nodes connected by some type of communication medium

NOTE The connection paths between any pair of nodes can include repeaters, routers and gateways.

3.1.5.32 peer

role of an AR endpoint in which it is capable of acting as both client and server

3.1.5.33 pre-defined AR endpoint

AR endpoint that is defined locally within a device without use of the create service

NOTE Pre-defined ARs that are not pre-established are established before being used.

3.1.5.34 pre-established AR endpoint

AR endpoint that is placed in an established state during configuration of the AEs that control its endpoints

3.1.5.35 publisher

role of an AR endpoint in which it transmits APDUs onto the fieldbus for consumption by one or more subscribers

NOTE The publisher may not be aware of the identity or the number of subscribers and it may publish its APDUs using a dedicated AR. Two types of publishers are defined by this standard, Pull Publishers and Push Publishers, each of which is defined separately.

3.1.5.36 server

- a) role of an AREP in which it returns a confirmed service response APDU to the client that initiated the request
- b) object which provides services to another (client) object

3.1.5.37 service

operation or function than an object and/or object class performs upon request from another object and/or object class

NOTE A set of common services is defined and provisions for the definition of object-specific services are provided. Object-specific services are those which are defined by a particular object class to perform a required function which is not performed by a common service.

3.1.5.38 subscriber

role of an AREP in which it receives APDUs produced by a publisher

NOTE Two types of subscribers are defined by this standard, pull subscribers and push subscribers, each of which is defined separately.

3.1.6 Specific definitions for client/server

3.1.6.1

coils, discrete outputs

application process object, a set of coils, characterized by the address of a coil and a quantity of coils

3.1.6.2

discrete, discrete input

application process object, addressed by an unsigned number and having a width of one bit, representing a 1-bit encoded status value, read-only, with the value '1' encoding the status ON and the value '0' encoding the status OFF

3.1.6.3**discrete inputs, discretes**

application process object, a set of discretes, characterized by the address of a discrete and a quantity of discretes

3.1.6.4**coil, discrete output**

application process object, addressed by an unsigned number and having a width of one bit, representing a 1-bit encoded status value, read-write, with the value '1' encoding the status ON and the value '0' encoding the status OFF

3.1.6.5**encapsulated interface**

mechanism encapsulating a service for an interface, which is an application process object characterized by an MEI type

3.1.6.6**exception**

encoding used to signal a service request failure

3.1.6.7**exception code**

encoding associated with an exception, detailing the reason of a service request failure

3.1.6.8**file**

application process object, an organization of records, characterized by an unsigned number

3.1.6.9**function code**

encoding of a service requested to a server

3.1.6.10**holding register, output register**

application process object, addressed by an unsigned number and representing values with 16 bits, read-write

3.1.6.11**holding registers, output registers**

application process object, a set of holding registers, characterized by the address of a holding register and a quantity of holding registers

3.1.6.12**input register**

application process object, addressed by an unsigned number and representing values with 16 bits, read-only

3.1.6.13**input registers**

application process object, a set of input registers, characterized by the address of an input register and a quantity of input registers

3.1.6.14**record**

application process object, a set of contiguous registers of a specified type, characterized by the address of the first register and by the quantity of registers; in the context of this definition, the registers involved have also been called references

3.1.6.15

reference

denigrated term for register

3.1.6.16

reference type

denigrated term for register type

3.1.6.17

sub-code

specialization of a function code

3.1.6.18

unit ID

logical device identifier

3.1.6.19

MEI type

type specified as an octet value, used to dispatch a service to the appropriate interface in the context of the encapsulated interface mechanism

3.1.7 Specific definitions for publish/subscribe

3.1.7.1

network object

Publish/subscribe application, reader, or writer

3.1.7.2

GUID

globally unique network object identifier

3.1.7.3

composite state

attributes of a set of network objects

3.1.7.4

reader

subscriber or a CSTReader

3.1.7.5

writer

Publisher or a CSTWriter

3.1.7.6

CSTReader

meta-information-specialized subscriber

3.1.7.7

CSTWriter

meta-information-specialized publisher

3.1.7.8

communication actor

reader or writer

3.1.7.9

domain participant

application that contains publish/subscribe elements, also called publish/subscribe application

NOTE (Informative) This terminology is adopted to avoid the overuse of the term “application”. At the same time, the term “domain” has a place within publish/subscribe. The Type extensibility allows for the concept of “domains”, or independent communication planes, effectively permitting isolation of application exchanges within domains. While OMG DDS as in “Data Distribution Service for Real-Time Systems Specification, Version 1.1, December 2005” uses this extension, the feature will not be examined further in this specification, which will consider a single domain.

3.1.7.10

manager

specialized publish/subscribe application, containing specialized publishers and subscribers, and involved in the described discovery and maintenance mechanism; not to be confused with any publishing manager

3.1.7.11

managed participant

a publish/subscribe application; the qualifier refers to its role in relation to a manager when involved in the described discovery and maintenance mechanism; not to be confused with any publishing manager subordinate

3.1.7.12

sequence number

number used to uniquely identify elementary publish/subscribe messages in an ordered manner

3.2 Abbreviations and symbols

3.2.1 Common abbreviations and symbols

AE	Application Entity
AL	Application Layer
ALME	Application Layer Management Entity
ALP	Application Layer Protocol
APO	Application Object
AP	Application Process
APDU	Application Protocol Data Unit
API	Application Process Identifier
AR	Application Relationship
AREP	Application Relationship End Point
ASCII	American Standard Code for Information Interchange
ASE	Application Service Element
Cnf	Confirmation
DL-	(as a prefix) data-link-
DLC	data-link Connection
DLCEP	data-link Connection End Point
DLL	data-link Layer
DLM	data-link-management
DLSAP	data-link Service Access Point
DLSDU	DL-service-data-unit
FAL	Fieldbus Application Layer
ID	Identifier
IEC	International Electrotechnical Commission
Ind	Indication

LME	Layer Management Entity
LSB	Least Significant Bit
MSB	Most Significant Bit
OSI	Open Systems Interconnect
QoS	Quality of Service
Req	Request
Rsp	Response
SAP	Service Access Point
SDU	Service Data Unit
SMIB	System Management Information Base
SMK	System Management Kernel

3.2.2 Abbreviations and symbols for client/server

C/S	Client/Server
FC	Function Code
CAN	Controller Area Network
CiA	CAN in Automation
MEI	Encapsulated Interface type
URL	Uniform Resource Locator

3.2.3 Abbreviations and symbols for publish/subscribe

CS	Composite State
DCPS	Data-Centric Publish-Subscribe
DDS	Data Distribution Service
DLRL	Data Local Reconstruction Layer
OMG	Object Management Group
P/S	Publish/Subscribe

3.3 Conventions

3.3.1 Overview

The FAL is defined as a set of object-oriented ASEs. Each ASE is specified in a separate subclause. Each ASE specification is composed of two parts, its class specification, and its service specification.

The class specification defines the attributes of the class. The attributes are accessible from instances of the class using the Object Management ASE services specified in Clause 5 of this standard. The service specification defines the services that are provided by the ASE.

3.3.2 General conventions

This standard uses the descriptive conventions given in ISO/IEC 10731

3.3.3 Conventions for class definitions

Class definitions are described using templates. Each template consists of a list of attributes for the class. The general form of the template is shown below:

FAL ASE: ASE Name**CLASS:Class Name****CLASS ID: #****PARENT CLASS: Parent Class Name****ATTRIBUTES:**

1	(o)	Key Attribute:	numeric identifier
2	(o)	Key Attribute:	name
3	(m)	Attribute:	attribute name(values)
4	(m)	Attribute:	attribute name(values)
4.1	(s)	Attribute:	attribute name(values)
4.2	(s)	Attribute:	attribute name(values)
4.3	(s)	Attribute:	attribute name(values)
5	(c)	Constraint:	constraint expression
5.1	(m)	Attribute:	attribute name(values)
5.2	(o)	Attribute:	attribute name(values)
6	(m)	Attribute:	attribute name(values)
6.1	(s)	Attribute:	attribute name(values)
6.2	(s)	Attribute:	attribute name(values)

SERVICES:

1	(o)	OpService:	service name
2	(c)	Constraint:	constraint expression
2.1	(o)	OpService:	service name
3	(m)	MgtService:	service name

- (1) The "FAL ASE:" entry is the name of the FAL ASE that provides the services for the class being specified.
- (2) The "CLASS:" entry is the name of the class being specified. All objects defined using this template will be an instance of this class. The class may be specified by this standard, or by a user of this standard.
- (3) The "CLASS ID:" entry is a number that identifies the class being specified. This number is unique within the FAL ASE that will provide the services for this class. When qualified by the identity of its FAL ASE, it unambiguously identifies the class within the scope of the FAL. The value "NULL" indicates that the class cannot be instantiated. Class IDs between 1 and 255 are reserved by this standard to identify standardized classes. They have been assigned to maintain compatibility with existing national standards. CLASS IDs between 256 and 2048 are allocated for identifying user defined classes.
- (4) The "PARENT CLASS:" entry is the name of the parent class for the class being specified. All attributes defined for the parent class and inherited by it are inherited for the class being defined, and therefore do not have to be redefined in the template for this class.

NOTE The parent class "TOP" indicates that the class being defined is an initial class definition. The parent class TOP is used as a starting point from which all other classes are defined. The use of TOP is reserved for classes defined by this standard.

- (5) The "ATTRIBUTES" label indicate that the following entries are attributes defined for the class.
 - a) Each of the attribute entries contains a line number in column 1, a mandatory (m) / optional (o) / conditional (c) / selector (s) indicator in column 2, an attribute type label in column 3, a name or a conditional expression in column 4, and optionally a list of enumerated values in column 5. In the column following the list of values, the default value for the attribute may be specified.
 - b) Objects are normally identified by a numeric identifier or by an object name, or by both. In the class templates, these key attributes are defined under the key attribute.
 - c) The line number defines the sequence and the level of nesting of the line. Each nesting level is identified by period. Nesting is used to specify

- i) fields of a structured attribute (4.1, 4.2, 4.3),
 - ii) attributes conditional on a constraint statement (5). Attributes may be mandatory (5.1) or optional (5.2) if the constraint is true. Not all optional attributes require constraint statements as does the attribute defined in (5.2).
 - iii) the selection fields of a choice type attribute (6.1 and 6.2).
- (6) The "SERVICES" label indicates that the following entries are services defined for the class.
- a) An (m) in column 2 indicates that the service is mandatory for the class, while an (o) indicates that it is optional. A (c) in this column indicates that the service is conditional. When all services defined for a class are defined as optional, at least one has to be selected when an instance of the class is defined.
 - b) The label "OpsService" designates an operational service (1).
 - c) The label "MgtService" designates an management service (2).
 - d) The line number defines the sequence and the level of nesting of the line. Each nesting level is identified by period. Nesting within the list of services is used to specify services conditional on a constraint statement.

3.3.4 Conventions for service definitions

3.3.4.1 General

The FAL is defined as a set of object-oriented ASEs. Each ASE is specified in a separate subclause. Each ASE specification is composed of three parts: its class definitions, its services, and its protocol specification. The first two are contained in IEC 61158-5. The protocol specification for each of the ASEs is defined in this standard.

The class definitions define the attributes of the classes supported by each ASE. The attributes are accessible from instances of the class using the Management ASE services specified in IEC 61158-5 subseries. The service specification defines the services that are provided by the ASE.

This standard uses the descriptive conventions given in ISO/IEC 10731.

3.3.5 Conventions for class definitions

The data-link layer mapping definitions are described using templates. Each template consists of a list of attributes for the class. The general form of the template is defined in IEC/TR 61158-1.

3.3.6 Abstract syntax conventions

When the "optionalParametersMap" parameter is used, a bit number which corresponds to each OPTIONAL or DEFAULT production is given as a comment.

3.4 Conventions used in state machines

The state machines are described in Table 1.

Table 1 – Conventions used for state machines

#	Current state	Event / condition => action	Next state
Name of this transition.	The current state to which this state transition applies.	Events or conditions that trigger this state transaction. => The actions that are taken when the above events or conditions are met. The actions are always indented below events or conditions.	The next state after the actions in this transition is taken.

The conventions used in the state machines are as follows:

:= Value of an item on the left is replaced by value of an item on the right. If an item on the right is a parameter, it comes from the primitive shown as an input event.

xxx A parameter name.

Example:

Identifier := reason

means value of a 'reason' parameter is assigned to a parameter called 'Identifier.'

"xxx" Indicates fixed value.

Example:

Identifier := "abc"

means value "abc" is assigned to a parameter named 'Identifier.'

= A logical condition to indicate an item on the left is equal to an item on the right.

< A logical condition to indicate an item on the left is less than the item on the right.

> A logical condition to indicate an item on the left is greater than the item on the right.

<> A logical condition to indicate an item on the left is not equal to an item on the right.

&& Logical "AND"

|| Logical "OR"

This construct allows the execution of a sequence of actions in a loop within one transition. The loop is executed for all values from start_value to end_value.

Example:

for (Identifier := start_value to end_value)

actions

endfor

This construct allows the execution of alternative actions depending on some condition (which might be the value of some identifier or the outcome of a previous action) within one transition.

Example:

If (condition)

actions

else

actions

endif

Readers are strongly recommended to refer to the subclauses for the AREP attribute definitions, the local functions, and the FAL-PDU definitions to understand protocol machines. It is assumed that readers have sufficient knowledge of these definitions, and they are used without further explanations.

4 Abstract syntax for client/server

The abstract syntax of APDUs is combined with their transfer syntax and is specified in Clause 5.

5 Transfer syntax for client/server

5.1 General

The sending Application Layer prepares an APDU to transfer to the receiving Application Layer. It uses the parameters from the service primitives to do so. There are several formats of the APDU:

- request APDU from Client to Server device or devices, or
- normal response and positive confirmation from Server to Client device, or
- response and negative confirmation from Server to Client device.

The format and coding rules for all APDUs are specified in this clause.

5.2 Common APDU structure

All APDUs have a common structure as shown in Figure 1.




Figure 1 – APDU Format

5.2.1 Unit ID

Client/server devices in the role of servers are addressed using a Unit ID. The Unit ID needs to be unique across all the servers addressable by a client. The set of addressable servers is determined by the underlying layer. This set is sometimes called connection.

The Unit ID assignment is outside of the scope of this specification.

The Unit ID identifies logical devices. There may be more than one logical device per physical device.

Some values of Unit ID are reserved and have particular meanings. The value 0 is reserved for broadcast.

Field Type: Unsigned8

Allowed values: 1 to 247, and 0 for broadcast where supported.

NOTE In general the Unit ID is only required for logical devices having the role of servers. Often logical devices can have either role or multiple roles, via configuration, and their Unit ID is not used when they only perform in the client role. Depending on the underlying layers some devices can have concurrently a client and a server role on the same access point, this is the case for client/server on Token Bus/HDLC, outside the scope of this specification.

5.2.2 Code

5.2.2.1 General

This field represents

- a requested service, confirmed or unconfirmed, via an identifier called function code, or
- the normal response and positive confirmation of a requested service, represented by echoing the requested service identifier, or
- the exception response and negative confirmation of a requested service, represented by echoing the requested service identifier with its high bit turned on. The latter representation is also called exception.

Field Type: Unsigned8

5.2.2.2 Service identifiers and function codes

Client/server service identifiers are commonly called function codes.

Function codes are encodings of services requested to a server. Some function codes are further specialized by means of a sub-code, specified as part of the data field. These encodings are partitioned in three categories, and since the subdivision may propagate to the sub-codes, for sake of completeness, despite being part of the data field they will also be mentioned here:

Publicly assigned function codes

These function codes are either assigned to a standard service or reserved for future assignment. The standard services and their identifiers will be detailed in this specification.

User definable function codes

These function codes can be used for experimentation in a controlled laboratory environment. They must not be used in an open environment.

Ranges: There are two ranges, FC 65 (0x41) to 72 (0x48) included, and 100 (0x64) to 110 (0x6E) included.

Reserved function codes

These function codes are currently used by some companies for legacy products and are not available for public use.

NOTE 1 Function code assignments are managed by the Modbus-IDA industrial consortium.

NOTE 2 The following function codes, while publicly assigned, are not covered by this specification: FC 7 (0x07, Read Exception Status), FC 8 (0x08, Diagnostics), FC 11 (0x0B, Get Com Event Counter), FC 12 (0x0C, Get Com Event Log), FC 17 (0x11, Report Slave ID).

NOTE 3 The following function codes and function code/sub-codes are reserved: FC 8/19 (0x08/0x13), FC 8/21-255 (0x08/0x15-0xFFFF), FC 9 (0x09), FC 10 (0x0A), FC 13 (0x0D), FC 14 (0x0E), FC 41 (0x29), FC 42 (0x2A), FC 43/0-12 (0x2B/0x00-0x0C), FC 43/15-255 (0x2B/0x0F-0xFF), FC 90 (0x5A), FC 91 (0x5B), FC 125 (0x7D), FC 126 (0x7E), FC 127 (0x7F).

5.2.3 Data

For normal requests and responses this is the user data which is transferred between the application layer and its user. The application layer assembles it from the parameters of a service primitive or parses it into parameters of a service primitive. Its structure depends upon the type of APDU. For exception responses it represents the reason for the exception via an exception code.

Field Type: from 1 to 252 octets; the Type is APDU specific.

5.2.4 Client to server confirmed service request

The format is as in Figure 2.

Unit ID	Function code	Request Data
---------	---------------	--------------

Figure 2 – Client to server confirmed service request

5.2.5 Normal response from server to client

The format for the normal response to a confirmed service is as in Figure 3. The Unit ID and the function code fields are the same as the corresponding fields in the request.

Unit ID	Function code	Response Data
---------	---------------	---------------

Figure 3 – Normal response from server to client

5.2.6 Exception response from server to client

The format for the exception response is as in Figure 4. The Unit ID is the same as the corresponding field in the request. The exception is produced adding 0x80 to the function code of the corresponding request.

Unit ID	Exception	Exception code
---------	-----------	----------------

Figure 4 – Exception response from server to client

The exception codes, giving information on the service failure, are shown in Table 2.

Table 2 – Exception code

Encoding	Name	Description
0x01	Illegal function	The function code received in the query is not an allowable action for the server. This may be because the function code is only applicable to newer devices, and was not implemented in the unit selected. It could also indicate that the server is in the wrong state to process a request of this type, for example because it is not configured and it is being asked to return register values.
0x02	Illegal data address	The data address received in the query is not an allowable address for the server. More specifically, the combination of reference number and transfer length is invalid. Example (informative): For a controller with 100 registers, a request with offset (data address) 96 and length 4 would succeed, a request with offset 96 and length 5 would generate exception code 0x02.
0x03	Illegal data value	A value contained in the query data field is not an allowable value for server. This indicates a fault in the structure of the remainder of a complex request, such as that the implied length is incorrect. It specifically does NOT mean for example that a data item submitted for storage in a register has a value outside the expectation of the application program, since the client/server protocol is unaware of the significance of any particular value for any particular register.
0x04	Server device failure	An unrecoverable error occurred while the server was attempting to perform the requested action.
0x05	Acknowledge	The server accepted the service invocation but the service requires a relatively long time to execute. The server therefore returns only an acknowledgement of the service invocation receipt. This response is returned to prevent a timeout error from occurring in the client.
0x06	Server busy	The server was unable to accept the request. The client application has the responsibility of deciding if and when to re-send the request.
0x08	Memory parity error	For specialized use in conjunction with function codes 20 (0x14) and 21 (0x15), to indicate that the extended file area failed to pass a consistency check. For example, the server attempted to read record file, but detected a memory parity error. The client can retry the request, but service may be required on the server device.
0x0A	Gateway path unavailable	For specialized use in conjunction with gateways, hubs, switches and similar network devices, to indicate that the gateway was unable to allocate an internal communication path from the input port to the output port for processing the request. This usually means that the gateway is misconfigured or overloaded.
0x0B	Gateway target device failed to respond	For specialized use in conjunction with gateways, hubs, switches and similar network devices, to indicate that no response was obtained from the target device. This usually means that the device is not present on the network.

5.2.7 Client to server unconfirmed service request

The format is as in Figure 5. These services are used for broadcast. Only a small number of function codes allow broadcast.

Unit ID = 0	Function code	Request Data
-------------	---------------	--------------

Figure 5 – Client to server unconfirmed service request

5.3 Service-specific APDU structures

5.3.1 Read Discretes FAL PDU

5.3.1.1 Request primitive

Service identifier, function code = 2 (0x02).

This function code is used to read the status of 1 to 2000 discrete inputs in a remote device. The request PDU specifies the starting address, i.e. the address of the first input specified, and the number of inputs. In the PDU Discrete Inputs are addressed starting at zero. Therefore discrete inputs numbered 1-16 are addressed as 0-15. The starting address can be from 0x0000 to 0xFFFF.

The format is given in Table 3.

Table 3 – Read discretes request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 2 (0x02).
Address of first discrete	Unsigned16	Address of the first discrete input. Allowed values: 0x0000 to 0xFFFF
Quantity of discretes	Unsigned16	Quantity of discretes. Allowed values: 1 to 2000 (0x7D0)

5.3.1.2 Response primitive

The format is given in Table 4.

Table 4 – Read discretes response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 2 (0x02). Echo of requested.
Data octets count	Unsigned16	Number of octets read.
Data	Status bit sequence	Status values of the discretes read.

The field data contains n octets where n is the number in the field data octets count.

The discrete inputs in the response message are packed as one input per bit of the data field. Status is indicated as 1= ON; 0= OFF. The LSB (least significant bit) of the first data octet contains the input addressed in the query. The other inputs follow toward the high order end of this octet, and from low order to high order in subsequent octets.

If the returned input quantity is not a multiple of eight, the remaining bits in the final data octet shall be padded with zeros (toward the high order end of the octet). The data octets count field specifies the quantity of octets of returned inputs data, n (including the padded octet, if any).

5.3.2 Read Coils FAL PDU

5.3.2.1 Request primitive

Service identifier, function code = 1 (0x01).

This function code is used to read from 1 to 2000 coils in a remote device. The request PDU specifies the starting address, i.e. the address of the first coil specified, and the number of coils. In the PDU, coils are addressed starting at zero. Therefore coils numbered 1-16 are addressed as 0-15. The starting address can be from 0x0000 to 0xFFFF.

The format is given in Table 5.

Table 5 – Read coils request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 1 (0x01).
Address of first coil	Unsigned16	Address of the first coil. Allowed values: 0x0000 to 0xFFFF
Quantity of coils	Unsigned16	Quantity of coils. Allowed values: 1 to 2000 (0x7D0)

5.3.2.2 Response primitive

The format is given in Table 6.

Table 6 – Read coils response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 1 (0x01). Echo of requested.
Data octets count	Unsigned16	Number of octets read.
Data	Status bit sequence	Status values of the discretes read.

The field data contains n octets where n is the number in the field data octets count.

The coils in the response message are packed as one input per bit of the data field. Status is indicated as 1= ON; 0= OFF. The LSB (least significant bit) of the first data octet contains the input addressed in the query. The other coils follow toward the high order end of this octet, and from low order to high order in subsequent octets.

If the returned input quantity is not a multiple of eight, the remaining bits in the final data octet shall be padded with zeros (toward the high order end of the octet). The data octets count field specifies the quantity of octets of returned inputs data, n (including the padded octet, if any).

5.3.3 Write Single Coil FAL PDU

5.3.3.1 Request primitive

Service identifier, function code = 5 (0x05).

This function code is used to write a single coil to either ON or OFF in a remote device.

The requested ON/OFF status is specified by a constant in the request data field. A value of 0xFF00 requests the output to be ON. A value of 0x0000 requests it to be OFF. All other values are illegal and do not affect the output.

The Request PDU specifies the address of the coil to be forced. Coils are addressed starting at zero. Therefore coil numbered 1 is addressed as 0.

The format is given in Table 7.

Table 7 – Write single coil request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 5 (0x05).
Address of coil	Unsigned16	Address of the coil. Allowed values: 0x0000 to 0xFFFF
Data single coil	Status flag	Single coil status value that has to be written. Allowed values: 0xFF00 or 0x0000

5.3.3.2 Response primitive

The format is given in Table 8.

Table 8 – Write single coil response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 5 (0x05). Echo of requested.
Address of coil	Unsigned16	Address of the coil. Echo of requested.
Data single coil	Status flag	Single coil status value that had to be written. Echo of requested.

The normal response is an echo of the request, returned after the coil state has been written.

5.3.4 Write Multiple Coils FAL PDU

5.3.4.1 Request primitive

Service identifier, function code = 15 (0x0F).

This function code is used to force each coil in a sequence of coils to either ON or OFF in a remote device.

The Request PDU specifies the coil references to be forced. Coils are addressed starting at zero. Therefore coil numbered 1 is addressed as 0.

The requested ON/OFF coils status is specified by the contents of the request data field. A logical '1' in a bit position of the field requests the corresponding output to be ON. A logical '0' requests it to be OFF.

The coils in the request message are packed as one input per bit of the data field. If the specified quantity of coils is not a multiple of eight, the remaining bits in the final data octet of data shall be padded with zeros (toward the high order end of the octet). The octet count field specifies the quantity of octets of data, n (including the padded octet, if any). The field data contains the n data octets, where n is the number in the field octet count.

The format is given in Table 9.

Table 9 – Write multiple coils request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 15 (0x0F).
Address of first coil	Unsigned16	Address of the first coil. Allowed values: 0x0000 to 0xFFFF
Quantity of coils	Unsigned16	Quantity of coils to be written. Allowed values: 1 to 1968 (0x7B0), must be consistent with the Data octets count and the Data parameters.
Data octets count	Unsigned16	Number of octets carrying the coil status values to be written. Allowed values: 1 to 246, must be consistent with the Quantity of coils and the Data parameters.
Data	Status bit sequence	This parameter shall be used to specify the coil status values that have to be written. Allowed values: Must be consistent with the Quantity of coils and the Data octets count parameters.

5.3.4.2 Response primitive

The format is given in Table 10.

Table 10 – Write multiple coils response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 15 (0x0F).
Address of first coil	Unsigned16	Address of the first coil. Echo of requested.
Quantity of coils	Unsigned16	Quantity of coils. Echo of requested.

The normal response is an echo of the requested parameters Unit ID, function code, address of first coil, and quantity of coils.

5.3.5 Broadcast Write Single Coil FAL PDU

5.3.5.1 Request primitive

Service identifier, function code = 5 (0x05); Unit ID = 0.

This function code is used to write a single coil to either ON or OFF in all the Unit ID addressable servers, by specifying Unit ID = 0.

This is an unconfirmed service.

The requested ON/OFF status is specified by a constant in the request data field. A value of 0xFF00 requests the output to be ON. A value of 0x0000 requests it to be OFF. All other values are illegal and do not affect the output.

The Request PDU specifies the address of the coil to be forced. Coils are addressed starting at zero. Therefore coil numbered 1 is addressed as 0.

The format is given in Table 11.

Table 11 – Broadcast write single coil request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 0
Function code	Unsigned8	Service identifier, function code = 5 (0x05).
Address of coil	Unsigned16	Address of the coil. Allowed values: 0x0000 to 0xFFFF
Data single coil	Status flag	Single coil status value that has to be written. Allowed values: 0xFF00 or 0x0000

5.3.6 Broadcast Write Multiple Coils FAL PDU

5.3.6.1 Request primitive

Service identifier, function code = 15 (0x0F); Unit ID = 0.

This function code is used to force each coil in a sequence of coils to either ON or OFF in all the Unit ID addressable servers, by specifying Unit ID = 0.

This is an unconfirmed service.

The Request PDU specifies the coil references to be forced. Coils are addressed starting at zero. Therefore coil numbered 1 is addressed as 0.

The requested ON/OFF coils status is specified by the contents of the request data field. A logical '1' in a bit position of the field requests the corresponding output to be ON. A logical '0' requests it to be OFF.

The coils in the request message are packed as one input per bit of the data field. If the specified quantity of coils is not a multiple of eight, the remaining bits in the final data octet of data shall be padded with zeros (toward the high order end of the octet). The octet count field specifies the quantity of octets of data, n (including the padded octet, if any). The field data contains the n data octets, where n is the number in the field octet count.

The format is given in Table 12.

Table 12 – Broadcast write multiple coils request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 0
Function code	Unsigned8	Service identifier, function code = 15 (0x0F).
Address of first coil	Unsigned16	Address of the first coil. Allowed values: 0x0000 to 0xFFFF
Quantity of coils	Unsigned16	Quantity of coils to be written. Allowed values: 1 to 1968 (0x7B0), must be consistent with the Data octets count and the Data parameters.
Data octets count	Unsigned16	Number of octets carrying the coil status values to be written. Allowed values: 1 to 246, must be consistent with the Quantity of coils and the Data parameters.
Data	Status bit sequence	This parameter shall be used to specify the coil status values that have to be written. Allowed values: Must be consistent with the Quantity of coils and the Data octets count parameters.

5.3.7 Read Input Registers FAL PDU

5.3.7.1 Request primitive

Service identifier, function code = 4 (0x04).

This function code is used to read from 1 to 125 input registers in a remote device. The Request PDU specifies the starting register address and the number of registers. In the PDU Registers are addressed starting at zero. Therefore input registers numbered 1-16 are addressed as 0-15.

The format is given in Table 13.

Table 13 – Read input registers request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 4 (0x04).
Address of input register to read	Unsigned16	Address of input register to read. Allowed values: 0x0000 to 0xFFFF
Quantity of input registers	Unsigned16	Quantity of input registers to read. Allowed values: 1 to 125 (0x7D)

5.3.7.2 Response primitive

The format is given in Table 14.

Table 14 – Read input registers response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 4 (0x04). Echo of requested.
Data octets count	Unsigned16	Number of octets read.
Data	Array of Unsigned16	Input registers values read.

The response parameter data contains n octets, where n is the number in the response parameter data octet count, equal to twice the requested quantity of input registers.

The register data in the response parameter data elements is packed as two octets per register value. For each register, the first octet contains the high order register value bits and the second octet contains the low order register value bits (big-endian convention).

5.3.8 Read Holding Registers FAL PDU

5.3.8.1 Request primitive

Service identifier, function code = 3 (0x03).

This function code is used to read from 1 to 125 holding registers in a remote device. The Request PDU specifies the starting register address and the number of registers. In the PDU Registers are addressed starting at zero. Therefore input registers numbered 1-16 are addressed as 0-15.

The format is given in Table 15.

Table 15 – Read holding registers request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 3 (0x03).
Address of first holding register to read	Unsigned16	Address of the first holding register to read. Allowed values: 0x0000 to 0xFFFF
Quantity of holding registers to read	Unsigned16	Quantity of holding registers to read. Allowed values: 1 to 125 (0x7D)

5.3.8.2 Response primitive

The format is given in Table 16.

Table 16 – Read holding registers response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 3 (0x03). Echo of requested.
Data octets count	Unsigned16	Number of octets read.
Data	Array of Unsigned16	Holding registers values read.

The response parameter data contains n octets, where n is the number in the response parameter data octet count, equal to twice the requested quantity of holding registers.

The register data in the response parameter data elements is packed as two octets per register value. For each register, the first octet contains the high order register value bits and the second octet contains the low order register value bits (big-endian convention).

5.3.9 Write Single Holding Register FAL PDU

5.3.9.1 Request primitive

Service identifier, function code = 6 (0x06).

This function code is used to write a single holding register in a remote device.

The Request PDU specifies the address of the register to be written. Registers are addressed starting at zero. Therefore register numbered 1 is addressed as 0.

The register data in the request parameter data is packed as two octets per register. For each register, the first octet contains the high order register bits and the second octet contains the low order register bits (big-endian convention).

The format is given in Table 17.

Table 17 – Write single holding register request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 6 (0x06).
Address of holding register to write	Unsigned16	Address of the holding register to write. Allowed values: 0x0000 to 0xFFFF
Data	Unsigned16	Holding register value to be written. Allowed values: 0x0000 to 0xFFFF

5.3.9.2 Response primitive

The format is given in Table 18.

Table 18 – Write single holding register response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 6 (0x06). Echo of requested.
Address holding register to write	Unsigned16	Address of the holding register to write. Echo of requested.
Data	Unsigned16	Holding register value to be written. Echo of requested.

The normal response is an echo of the request, returned after the register contents have been written.

5.3.10 Write Multiple Holding Registers FAL PDU

5.3.10.1 Request primitive

Service identifier, function code = 16 (0x10).

This function code is used to write from 1 to 123 holding registers in a remote device.

The Request PDU specifies the starting register address and the number of registers. In the PDU Registers are addressed starting at zero. Therefore registers numbered 1-16 are addressed as 0-15.

The values to be written are specified in the request data parameter. The register data in the request parameter data elements is packed as two octets per register value. For each register, the first octet contains the high order register bits and the second octet contains the low order register bits (big-endian convention).

The format is given in Table 19.

Table 19 – Write multiple holding registers request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 16 (0x10).
Address of first holding register to write	Unsigned16	Address of the first holding register to write. Allowed values: 0x0000 to 0xFFFF
Quantity of holding registers to write	Unsigned16	Quantity of holding registers to write. Allowed values: 1 to 123 (0x7B), must be consistent with the Data octets count and the Data parameters.
Data octets count	Unsigned16	Number of octets to write. Allowed values: 1 to 246, must be consistent with the Quantity of holding registers to write and the Data parameters.
Data	Array of Unsigned16	Holding registers values to write. Allowed values: 1 to 123 elements, must be consistent with the Quantity of holding registers to write and the Data octets count parameters. Element values can be from 0x0000 to 0xFFFF.

5.3.10.2 Response primitive

The format is given in Table 20.

Table 20 – Write multiple holding registers response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 16 (0x10). Echo of requested.
Address of first holding register to write	Unsigned16	Address of the first holding register to write. Echo of requested.
Quantity of holding registers to write	Unsigned16	Quantity of holding registers to write. Echo of requested.

The normal response returns the requested parameters Unit ID, function code, address of first holding register to write, and quantity of registers to write.

5.3.11 Mask Write Holding Register FAL PDU

5.3.11.1 Request primitive

Service identifier, function code = 22 (0x16)

This function code is used to modify the contents of a specified holding register using a combination of an AND mask, an OR mask, and the register's current contents. The function can be used to set or clear individual bits in the register. This is done according to Equation (1).

$$new_content = (old_content \wedge AND_Mask) \vee (OR_Mask \wedge \neg AND_Mask) \quad (1)$$

The request specifies the holding register to be written, the data to be used as the AND mask, and the data to be used as the OR mask. Registers are addressed starting at zero. Therefore registers 1-16 are addressed as 0-15.

The format is given in Table 21.

Table 21 – Mask write holding register request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 22 (0x16).
Address of holding register to change	Unsigned16	Address of the holding register to change. Allowed values: 0x0000 to 0xFFFF
AND Mask	Unsigned16	Binary mask AND_Mask that contributes to the new content of the holding register to change according to equation (1). Allowed values: 0x0000 to 0xFFFF
OR Mask	Unsigned16	Binary mask OR_Mask that contributes to the new content of the holding register to change according to equation (1). Allowed values: 0x0000 to 0xFFFF

5.3.11.2 Response primitive

The format is given in Table 22.

Table 22 – Mask write holding register request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 22 (0x16). Echo of requested.
Address of holding register to change	Unsigned16	Address of the holding register to change. Echo of requested.
AND Mask	Unsigned16	Binary mask AND_Mask that contributes to the new content of the holding register to change according to equation (1). Echo of requested.
OR Mask	Unsigned16	Binary mask OR_Mask that contributes to the new content of the holding register to change according to equation (1). Echo of requested.

The normal response is an echo of the request, returned after the register contents have been written.

5.3.12 Read/Write Holding Registers FAL PDU

5.3.12.1 Request primitive

Service identifier, function code = 23 (0x17).

This function code performs a combination of one read operation and one write operation on holding registers in a single service.

The write operation is performed before the read operation.

Holding registers are addressed starting at zero. Therefore holding registers 1-16 are addressed in the PDU as 0-15.

The request specifies the starting address and number of holding registers to be read as well as the starting address, number of holding registers, and the data to be written. The octet count specifies the number of octets to follow in the write data field.

The parameter data contains n octets, where n is the number in the parameter data octets count, equal to twice the requested quantity of holding registers to write parameter.

The values to be written are specified in the request data parameter. The register data in the request parameter data elements is packed as two octets per register value. For each register, the first octet contains the high order register bits and the second octet contains the low order register bits (big-endian convention).

The format is given in Table 23.

Table 23 – Read/Write multiple holding registers request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 23 (0x17).
Address of first holding register to read	Unsigned16	Address of the first holding register to read. Allowed values: 0x0000 to 0xFFFF
Quantity of holding registers to read	Unsigned16	Quantity of holding registers to read. Allowed values: 1 to 125 (0x7D).
Address of first holding register to write	Unsigned16	Address of the first holding register to write. Allowed values: 0x0000 to 0xFFFF
Quantity of holding registers to write	Unsigned16	Quantity of holding registers to write. Allowed values: 1 to 121 (0x79), must be consistent with the Data octets count and the Data parameters.
Data octets count	Unsigned16	Number of octets to write. Allowed values: 1 to 242, must be consistent with the Quantity of holding registers to write and the Data parameters.
Data	Array of Unsigned16	Holding registers values to write. Allowed values: 1 to 123 elements, must be consistent with the Quantity of holding registers to write and the Data octets count parameters. Element values can be from 0x0000 to 0xFFFF.

5.3.12.2 Response primitive

The format is given in Table 24.

Table 24 – Read/Write multiple holding registers response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 23 (0x17). Echo of requested.
Data octets count	Unsigned16	Number of octets read.
Data	Array of Unsigned16	Holding registers values read.

The response parameter data contains n octets, where n is the number in the response parameter data octet count, equal to twice the requested quantity of holding registers.

The register data in the response parameter data elements is packed as two octets per register value. For each register, the first octet contains the high order register value bits and the second octet contains the low order register value bits (big-endian convention).

5.3.13 Read FIFO FAL PDU

5.3.13.1 Request primitive

Service identifier, function code = 24 (0x18).

This function code is used to read a bounded number of holding registers, organized to facilitate a FIFO policy. The bounded number is a-priori unknown, and it is part of the response. The bound is 32 registers: the register containing the above number plus up to 31 following registers.

The format is given in Table 25.

Table 25 – Read FIFO request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 24 (0x18).
Address of FIFO queue	Unsigned16	Address of the holding register that contains the count of the FIFO queue data holding registers to follow. Allowed values: 0x0000 to 0xFFFF

5.3.13.2 Response primitive

The format is given in Table 26.

Table 26 – Read FIFO response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 3 (0x03). Echo of requested.
Data octets count	Unsigned16	Number of octets read, including the octets of the FIFO queue count.
FIFO queue count	Unsigned16	Number of data holding registers of the FIFO queue, read in the Data parameter. The FIFO queue count holding register itself is not included.
Data	Array of Unsigned16	Holding registers values read.

In a normal response, the data octet count shows the quantity of octets to follow, including the FIFO queue count octets and the data octets.

The FIFO queue count is the quantity of data registers in the queue (not including the FIFO queue count register itself).

The register data in the response parameter data elements is packed as two octets per register value. For each register, the first octet contains the high order register value bits and the second octet contains the low order register value bits (big-endian convention).

5.3.14 Broadcast Write Single Holding Register FAL PDU

5.3.14.1 Request primitive

Service identifier, function code = 6 (0x06); Unit ID = 0.

This function code is used to write a single holding register in all the Unit ID addressable servers, by specifying Unit ID = 0.

This is an unconfirmed service.

The Request PDU specifies the address of the register to be written. Registers are addressed starting at zero. Therefore register numbered 1 is addressed as 0.

The register data in the request parameter data is packed as two octets per register. For each register, the first octet contains the high order register bits and the second octet contains the low order register bits (big-endian convention).

The format is given in Table 27.

Table 27 – Broadcast write single holding register request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 0
Function code	Unsigned8	Service identifier, function code = 6 (0x06).
Address of holding register to write	Unsigned16	Address of the holding register to write. Allowed values: 0x0000 to 0xFFFF
Data	Unsigned16	Holding register value to be written. Allowed values: 0x0000 to 0xFFFF

5.3.15 Broadcast Write Multiple Holding Registers FAL PDU

5.3.15.1 Request primitive

Service identifier, function code = 16 (0x10); Unit ID = 0.

This function code is used to write from 1 to 123 holding registers in all the Unit ID addressable servers, by specifying Unit ID = 0.

This is an unconfirmed service.

The Request PDU specifies the starting register address and the number of registers. In the PDU Registers are addressed starting at zero. Therefore registers numbered 1-16 are addressed as 0-15.

The values to be written are specified in the request data parameter. The register data in the request parameter data elements is packed as two octets per register value. For each register, the first octet contains the high order register bits and the second octet contains the low order register bits (big-endian convention).

The format is given in Table 28.

Table 28 – Broadcast write multiple holding registers request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 0
Function code	Unsigned8	Service identifier, function code = 16 (0x10).
Address of first holding register to write	Unsigned16	Address of the first holding register to write. Allowed values: 0x0000 to 0xFFFF
Quantity of holding registers to write	Unsigned16	Quantity of holding registers to write. Allowed values: 1 to 123 (0x7B), must be consistent with the Data octets count and the Data parameters.
Data octets count	Unsigned16	Number of octets to write. Allowed values: 1 to 246, must be consistent with the Quantity of holding registers to write and the Data parameters.
Data	Array of Unsigned16	Holding registers values to write. Allowed values: 1 to 123 elements, must be consistent with the Quantity of holding registers to write and the Data octets count parameters. Element values can be from 0x0000 to 0xFFFF.

5.3.16 Read File Record FAL PDU

5.3.16.1 Request primitive

Service identifier, function code = 20 (0x14).

This function code is used to read multiple records from one or more files.

The format is given in Table 29.

Table 29 – Read file record request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 20 (0x14).
Sub-requests all-elements octets count	Unsigned8	Total count of octets (excluding itself) of all the following sub-requests. Allowed values: 7 (0x07) to 245 (0xF5). The minimum is obtained when there is only one Sub-request element, and the maximum is obtained when there are 35 Sub-request elements. The upper bound is dictated by the maximum size of the APDU for client/server (Unit ID + Function Code + Data = 254 octets). A correct Read File Record request will also have to ensure that the total size of the requested response, including all requested records, does not exceed this upper bound.
Sub-request 1 reference type	Unsigned8	Part of a sub-request element used to specify the reference type. Allowed values: In the context of this service the only allowed value is 6.
Sub-request 1 file number	Unsigned16	Part of a sub-request element used to specify the file number. Allowed values: The lowest file number is 1. The highest file number should be 10 (0x0A). NOTE While it is allowed for the file number to be in the range 1 to 0xFFFF, it should be noted that interoperability with legacy equipment may be compromised if the file number is greater than 10 (0x0A).
Sub-request 1 record number	Unsigned16	Part of a Sub-request element used to specify the record number, that contributes to the qualification of the record. Records are identified using the address of their first register and their length, the latter is specified in number of registers; this parameter represents the address of the first register of the record. Allowed values: Each file but the last should contain 10.000 registers, with the last file allowed to have less. This provides for records addressed from 0x0000 to 0x270F (0000 to 9999 decimal), at most. As a consequence, the Record Number should be in the range 0x0000 to 0x270F. NOTE 1 While it is allowed for any file to have more or less than 10.000 registers, with a maximum of 65.536 (0x10000), and consequently to have records addressed from 0x0000 to 0xFFFF, it should be noted that interoperability with legacy equipment may be compromised if each file but the last does not have 10.000 registers, with the last file allowed to have less. NOTE 2 Differently from other APOs, like discretes, coils, input registers and holding registers, where the lowest addressable instance is known to an application as 1-based and it is addressed in the protocol as 0-based, the lowest addressable record is record 0, known to an application as 0-based, and it is addressed in the protocol using a 0-based register address.
Sub-request 1 record length	Unsigned16	Part of a sub-request element used to specify the record length, that contributes to the qualification of the record. Records are identified using the address of their first register and their length, the latter is specified in number of registers; this parameter represents the length of the record in number of registers. Allowed values: For a given record number, the record length, in number of registers, must result in a record contained in the file. Moreover, such record length, in combination with all the other parts of the request, shall not produce a response that exceeds the maximum size of the APDU for client/server (Unit ID + Function Code + Data = 254 octets).
Sub-request 2		
Sub-request n		

5.3.16.2 Response primitive

The format is given in Table 30.

Table 30 – Read file record response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 20 (0x14). Echo of requested.
Sub-requests all-elements octets count	Unsigned8	Total count of octets (excluding itself) of all the following sub-responses. Expected values: The successful value depends on the request. For any successful request the value will be in the range 4 (0x04) to 250 (0xFA). The minimum is obtained when there is only one sub-response element and that is the smaller sub-response, with a record of length 1 register. The maximum can be reached in several ways, with different combinations of number of sub-responses and record lengths, for example with 34 sub-responses each with a record of length 1 register (136 octets so far), and one additional sub-response with a record of length of 56 registers ($2 + (56 * 2) = 114$ octets). The upper bound is dictated by the maximum size of the APDU for client/server (Unit ID + Function Code + Data = 254 octets). A correct read file record request will have ensured that the total size of the requested response, including all requested records, does not exceed this upper bound.
Sub-response 1 octets count	Unsigned8	Part of a sub-response element used to specify the total count of octets (excluding itself) for the sub-response. The count includes the reference type octet and the octets contained in the record data array, all together $1 + \text{twice the record length specified in the corresponding sub-request}$, which is expressed in number of registers. Expected values: The successful value depends on the request. For any successful request the value will be a minimum of 3 (0x03) and a maximum of 249 (0xF9). The minimum is obtained when the requested record has the length of 1 register. The maximum is reached when the requested record has the length of 124 registers, and in this case this is the only sub-response.
Sub-response 1 reference type	Unsigned8	Part of a sub-response element used to specify the reference type. Echo of the requested.
Sub-response 1 record data array	Unsigned16	1-st register of the record data array of a sub-response element.
	Unsigned16	2-nd register of the record data array of a sub-response element.
	Unsigned16	n-th register of the record data array of a sub-response element.
Sub-response 2		
Sub-response n		

5.3.17 Write File Record FAL PDU

5.3.17.1 Request primitive

Service identifier, function code = 21 (0x15).

This function code is used to write multiple records into one or more files.

The format is given in Table 31.

Table 31 – Write file record request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 21 (0x15).
Sub-requests all-elements octets count	Unsigned8	Total count of octets (excluding itself) of all the following sub-requests. Allowed values: 9 (0x09) to 251 (0xFB). The minimum is obtained when there is only one Sub-request element, and that is the smaller sub-request, with a record of length 1 register. The maximum can be reached in several ways, with different combinations of number of sub-requests and record lengths, for example with 3 sub-requests, one with a record of length 1 register (9 octets so far), one with a record of length 113 registers (130 octets so far) and finally another one with a record length of 113 registers (for a total of 251 octets). The upper bound is dictated by the maximum size of the APDU for client/server (Unit ID + Function Code + Data = 254 octets). A correct write file record request will have a normal response that does not exceed the upper bound, since in this case, as described below, a successful write file record response is an exact copy of the write file record request.
Sub-request 1 reference type	Unsigned8	Part of a sub-request element used to specify the reference type. Allowed values: In the context of this service the only allowed value is 6.
Sub-request 1 file number	Unsigned16	Part of a sub-request element used to specify the file number. Allowed values: The lowest file number is 1. The highest file number should be 10 (0x0A). NOTE While it is allowed for the file number to be in the range 1 to 0xFFFF, it should be noted that interoperability with legacy equipment may be compromised if the file number is greater than 10 (0x0A).
Sub-request 1 record number	Unsigned16	Part of a Sub-request element used to specify the record number, that contributes to the qualification of the record. Records are identified using the address of their first register and their length, the latter is specified in number of registers; this parameter represents the address of the first register of the record. Allowed values: Each file but the last should contain 10.000 registers, with the last file allowed to have less. This provides for records addressed from 0x0000 to 0x270F (0000 to 9999 decimal), at most. As a consequence, the Record Number should be in the range 0x0000 to 0x270F. NOTE 1 While it is allowed for any file to have more or less than 10.000 registers, with a maximum of 65.536 (0x10000), and consequently to have records addressed from 0x0000 to 0xFFFF, it should be noted that interoperability with legacy equipment may be compromised if each file but the last does not have 10.000 registers, with the last file allowed to have less. NOTE 2 Differently from other APOs, like discretes, coils, input registers and holding registers, where the lowest addressable instance is known to an application as 1-based and it is addressed in the protocol as 0-based, the lowest addressable record is record 0, known to an application as 0-based, and it is addressed in the protocol using a 0-based register address.

Parameter name / field	Type	Description
Sub-request 1 record length	Unsigned16	Part of a sub-request element used to specify the record length, that contributes to the qualification of the record. Records are identified using the address of their first register and their length, the latter is specified in number of registers; this parameter represents the length of the record in number of registers. Allowed values: For a given record number, the record length, in number of registers, must result in a record contained in the file. Moreover, such record length, in combination with all the other parts of the request, shall not produce a response that exceeds the maximum size of the APDU for client/server (Unit ID + Function Code + Data = 254 octets).
Sub-request 1 record data array	Unsigned16	1-st register of the record data array of a sub-request element.
	Unsigned16	2-nd register of the record data array of a sub-request element.
	Unsigned16	3-rd register of the record data array of a sub-request element.
Sub-request 2		
Sub-request n		

5.3.17.2 Response primitive

The normal response is an echo of the request. The format is given in Table 32.

Table 32 – Write file record response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 21 (0x15). Echo of requested.
Sub-requests all-elements octets count	Unsigned8	Total count of octets (excluding itself) of all the following sub-requests. Echo of requested.
Sub-request 1 reference type	Unsigned8	Part of a sub-request element used to specify the reference type. Echo of requested.
Sub-request 1 file number	Unsigned16	Part of a sub-request element used to specify the file number. Echo of requested.
Sub-request 1 record number	Unsigned16	Part of a Sub-request element used to specify the record number, that contributes to the qualification of the record. Records are identified using the address of their first register and their length, the latter is specified in number of registers; this parameter represents the address of the first register of the record. Echo of requested.
Sub-request 1 record length	Unsigned16	Part of a sub-request element used to specify the record length, that contributes to the qualification of the record. Records are identified using the address of their first register and their length, the latter is specified in number of registers; this parameter represents the length of the record in number of registers. Echo of requested.
Sub-request 1 record data array	Unsigned16	1-st register of the record data array of a sub-request element. Echo of requested.
	Unsigned16	2-nd register of the record data array of a sub-request element. Echo of requested.
	Unsigned16	3-rd register of the record data array of a sub-request element. Echo of requested.
Sub-request 2		Echo of requested.
Sub-request n		Echo of requested.

5.3.18 Read Device Identification FAL PDU

5.3.18.1 Request primitive

Service identifier, function code/MEI Type = 43 (0x2B)/14 (0x0E).

This function code/MEI Type is used to retrieve the device identification objects.

The format is given in Table 33.

Table 33 – Read device identification request

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Allowed values: 1 to 247
Function code	Unsigned8	Service identifier, function code = 43 (0x2B).
MEI	Unsigned8	Encapsulated Interface type. Allowed values: 14 (0x0E).
Read device ID code	Unsigned8	Requested device access type, that qualifies the requested information based on device categories described in Table 34 and, when supported, individually addressed object retrieval. This is illustrated in Table 35. Allowed values: As illustrated in Table 35.
Requested object ID	Unsigned8	First requested object, or the single requested object, according to the Read Device ID code. A response cannot exceed the maximum size of the APDU for client/server (Unit ID + Function Code + Data = 254 octets). An individual object size is guaranteed to fit in the maximum size by definition. If the set of returned objects requires more octets than the maximum size, then several transactions (request/response) are needed. This is an application client responsibility. When many objects are requested, the ID of the first requested object of the first transaction must be set to 0x00. If the initial object ID is not 0x00, then in general the returned Device Identification will be incomplete. Subsequent requests within the same set of objects must set the Requested-object ID to the Next-object ID returned by the server in the previous response. If a different Requested-object ID is provided, then in general the returned Device Identification will be incomplete. When many objects are requested, if the Requested-object ID does not match any known object, the server will respond as if the object with ID 0x00 was requested, effectively restarting from the beginning if this happens in the middle of the retrieval. When the server supports the retrieval of a single object, and this is performed with a Requested-object ID that does not match any known object, the server will return an error response. Allowed values: 0x00 to 0xFF.

Table 34 – Device identification categories

Object IDs	Object name / description	Type	Presence	Category
0x00	Vendor Name	ASCII string	Mandatory	Basic
0x01	Product Code	ASCII string	Mandatory	
0x02	Major Minor Revision	ASCII string	Mandatory	
0x03	Vendor URL	ASCII string	Optional	Regular
0x04	Product Name	ASCII string		
0x05	Model Name	ASCII string		
0x06	User Application Name	ASCII string		
0x07	<i>Reserved</i>			
... 0x7F				
0x80	<i>Private application-defined objects. The object ID range [0x80 – 0xFF] can be used by an application to define its own objects.</i>	Device dependent	Optional	Extended
...				
0xFF				

Table 35 – Read device ID code

Value	Read device ID code
0x01	Request to retrieve the objects in the Basic Device Identification category. A stream of objects is expected.
0x02	Request to retrieve the objects in the Regular Device Identification category, if any, and this implies a request for the Basic Device Identification category as well. A stream of objects is expected, with the Basic Device Identification category returned first, and the Regular Device Identification category afterward, if any.
0x03	Request to retrieve the objects in the Extended Device Identification category, if any, and this implies a request for the Regular Device Identification category, if any, and for the Basic Device Identification category as well. A stream of objects is expected, with the Basic Device Identification category returned first, the Regular Device Identification category after that, if any, and finally the Extended Device Identification category, if any.
0x04	Request to retrieve a specific object. If this feature is supported, a single object is expected, otherwise an error response is returned.

NOTE While the returned categories are ordered as from Table 35, no assumption should be made about the order of returned objects within any category, even across service invocations. This is to avoid any extra processing load on servers that may reside in very simple devices, and to permit the best object packing when the retrieval of multiple objects requires multiple request/response transactions.

5.3.18.2 Response primitive

The format is given in Table 36.

Table 36 – Read device identification response

Parameter name / field	Type	Description
Unit ID	Unsigned8	Address of the server. Echo of requested.
Function code	Unsigned8	Service identifier, function code = 43 (0x2B). Echo of requested.
MEI	Unsigned8	Encapsulated Interface type. Echo of requested.
Read device ID code	Unsigned8	Requested device access type, that qualifies the requested information based on device categories described in Table 34 and, when supported, individually addressed object retrieval. This is illustrated in Table 35. Echo of requested.
Conformity level	Unsigned8	Actual object categories and object retrieval access type made available by the server. Its value is provided by the server in all the responses, irrespective of the requested Read Device ID code. Values are illustrated in Table 37. In the Read Device ID parameter description it was explained what is returned when dealing with objects unknown to the server. For known objects, if a Read Device ID code requests a category or a type of access that is not available on the server, then the returned objects are as from Table 38.
More-available flag	Unsigned8	Information about having or not more objects to retrieve after a request/response. It is meaningful when the Read Device ID code is one of 0x01, 0x02, or 0x03, and the response exceed the maximum size of the APDU for client/server (Unit ID + Function Code + Data = 254 octets). A value of 0x00 means that there are no more objects available, while a value of 0xFF means that more requests have to be issued to retrieve the remaining objects. The meaning of this parameter is related to the one of the Next-object ID parameter.
Next-object ID	Unsigned8	The ID of the object that has to be requested in a subsequent request when the More-available flag is 0xFF. This is a client's responsibility, and if the Next-object ID requested in the subsequent request does not match any known object, the server will respond as if the object with ID 0x00 was requested, effectively restarting from the beginning.
Number of objects	Unsigned8	Part of the Read Device Identification array parameter. Each element carries one object. Each element uniquely identifies and represents an object within the device identification address space using the Returned-object ID, the Object length and the Object value. All is described below.
Object 1 returned-object ID	Unsigned8	Part of the Objects array element, and it uniquely identifies the object. Its description is the same as for the Requested-object ID, and it is part of the stream that initiated with the Requested-object ID.
Object 1 Object length	Unsigned8	Part of the Objects array element. It describes the length of the object value, in octets.
Object 1 Object value	As from Table 34	Part of the Objects array element and contributes to the device identification.
Object 2		
...		
Object n		

Table 37 – Conformity level

Value	Read device ID code
0x01	The device supports only the Basic Device Identification category, and only stream access.
0x02	In addition to the Basic Device Identification category, the device supports also the Regular Device Identification category, and only stream access.
0x03	In addition to the Basic Device Identification category and to the Regular Device Identification category, the device supports also the Extended Device Identification category, and only stream access.
0x81	The device supports only the Basic Device Identification category, and both stream access and individual access.
0x82	In addition to the Basic Device Identification category, the device supports also the Regular Device Identification category, and both stream access and individual access.
0x83	In addition to the Basic Device Identification category and to the Regular Device Identification category, the device supports also the Extended Device Identification category, and both stream access and individual access.

Table 38 – Requested vs. returned known objects

Read device ID	Conformity level	Returned objects
0x01 or 0x02 or 0x03	0x01	The server returns the objects in the Basic Device Identification category. Objects are returned as a stream.
0x01	0x02	The server returns the objects in the Basic Device Identification category. Objects are returned as a stream.
0x02 or 0x03	0x02	In addition to objects in the Basic Device Identification category, the server returns afterward also the objects in the Regular Device Identification category. Objects are returned as a stream.
0x01	0x03	The server returns the objects in the Basic Device Identification category. Objects are returned as a stream.
0x02	0x03	In addition to objects in the Basic Device Identification category, the server returns afterward also the objects in the Regular Device Identification category. Objects are returned as a stream.
0x03	0x03	In addition to objects in the Basic Device Identification category and after that objects in the Regular Device Identification category, the server returns afterward also the objects in the Extended Device Identification category. Objects are returned as a stream.
0x04	0x01 or 0x02 or 0x03	The server returns an illegal function error response.
0x01 or 0x02 or 0x03	0x81	The server returns the objects in the Basic Device Identification category. Objects are returned as a stream.
0x01	0x82	The server returns the objects in the Basic Device Identification category. Objects are returned as a stream.
0x02 or 0x03	0x82	In addition to objects in the Basic Device Identification category, the server returns afterward also the objects in the Regular Device Identification category. Objects are returned as a stream.
0x01	0x83	The server returns the objects in the Basic Device Identification category. Objects are returned as a stream.
0x02	0x83	In addition to objects in the Basic Device Identification category, the server returns afterward also the objects in the Regular Device Identification category. Objects are returned as a stream.
0x03	0x83	In addition to objects in the Basic Device Identification category and after that objects in the Regular Device Identification category, the server returns afterward also the objects in the Extended Device Identification category. Objects are returned as a stream.
0x04	0x81 or 0x82 or 0x83	The server returns the individually requested object.

5.4 Data representation 'on the wire'

Client/server uses a big-endian representation for addresses and data items. This means that when a numerical quantity larger than a single octet is transmitted, the most significant octet is sent first.

Example (Informative): A register is of type Unsigned16, a multiple octet quantity. If its value is 0x1234, then the first octet sent is 0x12, and the second octet sent is 0x34.

6 Abstract syntax for publish/subscribe

The abstract syntax of APDUs is combined with their transfer syntax and is specified in Clause 7.

7 Transfer syntax for publish/subscribe

7.1 General

The sending Application Layer prepares an APDU to transfer to the receiving Application Layer. It uses the parameters from the service primitives to do so. There is only one APDU format, it is the packed format produced with the help of the messenger services, which thread together APDUs from the other services. This permits flexibility and expansion, with differences encoded as content in the APDU itself.

In the context of publish/subscribe the packed APDU is also called message, and the constituent sub-APDUs are also called sub-messages. The APDU composition is illustrated using UML notation in Figure 6.

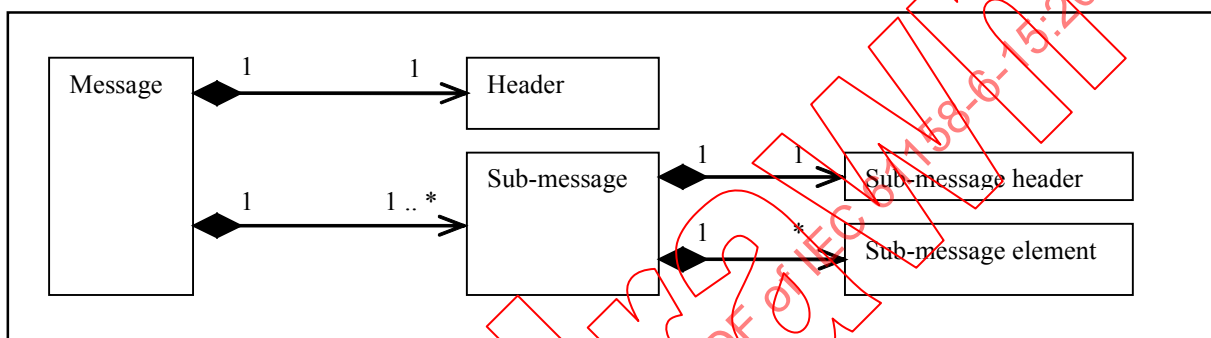


Figure 6 – Publish/subscribe APDU

7.2 APDU structure

The generic APDU is made of a leading header followed by a variable number of sub-messages. Each sub-message starts aligned on a 32-bit boundary with respect to the start of the message. The APDU details are illustrated in Table 39.

The APDU has a well-known length. This length is not sent explicitly by the publish/subscribe protocol but is part of the underlying transport with which APDUs are sent. In the case of UDP/IP, the length of the APDU is the length of the UDP payload.

Table 39 – APDU structure

	32 bits
header fixed length 16 octets	
sub-message 1 32 bits aligned variable length	
...	
sub-message n 32 bits aligned variable length	

It is convenient to see the message header as a sub-APDU itself, despite it being a header. In IEC 61158-5-15 it has been abstracted as one of the services of the messenger ASE because it has many similarities with other services there, which modify defaults set by the header. It is also different, its sub-APDU has the fixed length of 16 octets, it is a singleton and it is identified by its location instead of having a service identifier. The message header will be described as part of the service specific APDU structures, after the discussion of the sub-message structure.

The header is one of the set of logistic sub-messages: header, INFO_DST, INFO_REPLY, INFO_SRC, INFO_TS, and PAD. The publish/subscribe is a wire protocol, and these messages are all responsibility of the user application.

NOTE OMG DDS as in "Data Distribution Service for Real-Time Systems Specification, Version 1.1, December 2005" defines services that are here presented as responsibility of the publish/subscribe AL user instead. publish/subscribe is a wire protocol, and as such some functionality is deferred to the user application. This can be appreciated by the flexibility offered for implementations where foot-print is at a premium, and contributes to the pervasiveness of the approach.

Types are defined in IEC 61158-5-15. The octets for every sub-message are in the order specified up to the flags octet; after that, multi-octet types are placed 'on the wire' according to the endianness flag, that may modify the ordering on a per sub-message basis.

7.3 Sub-message structure

7.3.1 General

The general structure of each sub-message in a message is as illustrated in Table 40.

Table 40 – Sub-message structure

Parameter name / Field	Type	Description
Sub-message ID	Unsigned8	This is the service identifier encoding.
Flags	OctetString, 1 octet	Flags encode some of the parameters.
OctetsToNextHeader	Unsigned16	Parameter that allows the variable length sub-messages composition.
Sub-message specific content	OctetString, variable length	Described with the service specific APDU structures.

7.3.2 Service identifiers

The sub-message ID octet carries the service identifier encoding. IDs 0x00 to 0x7F (inclusive) are protocol-specific. They are defined as part of the publish/subscribe protocol. The major version 1 of publish/subscribe defines the sub-message IDs as reported in Table 41.

Table 41 – Publish/subscribe service identifier encoding

Encoding	Service
0x01	PAD
0x02	VAR
0x03	Issue
0x04 – 0x05	<i>Reserved</i>
0x06	ACK
0x07	Heartbeat
0x08	GAP
0x09	INFO_TS
0x0A – 0x0B	<i>Reserved</i>
0x0C	INFO_SRC
0x0D	INFO_REPLY
0x0E	INFO_DST
0x0F – 0x7F	<i>Reserved</i>
0x80 – 0xFF	<i>available to be used for vendor specific extensions; their interpretation is dependent on the vendorID encoded in the message header</i>

The meaning of the sub-message IDs cannot be modified in this major version (1). Additional sub-messages can be added in higher minor versions. Sub-messages with ID's 0x80 to 0xFF (inclusive) are vendor-specific; they will not be defined by the protocol. Their interpretation is dependent on the *vendorID* that is current when the sub-message is encountered. The description of the header will specify how the current *vendorID* is determined.

7.3.3 Flags

The least-significant bit (LSB) of the flags is always present in all sub-messages and represents the endianness used to encode the information in the sub-message. E=0 means big-endian, E=1 means little-endian. This is on a per sub-message basis.

This is the only flag that has a dedicated position, the LSB position, in the flags octet.

Other bits in the flags octet have interpretations that depend on the type of sub-message.

In the following descriptions of the sub-messages, the character 'X' is used to indicate a flag that is unused in version 1.0 of the protocol. publish/subscribe implementations of version 1.0 should set these to zero when sending and ignore these when receiving. Higher minor versions of the protocol can use these flags.

7.3.4 OctetsToNextHeader

The final two octets of the sub-message header contain the number of octets from the first octet of the contents of the sub-message until the first octet of the header of the next sub-message. The representation of this field is a Common Data Representation (CDR) unsigned short (ushort). CDR is documented in “Common Object Request Broker Architecture: Core Specification”, and in this specification in 7.6 for the part regarding publish/subscribe.

If the sub-message is the last one in the message, the *octetsToNextHeader* field contains either the number of octets remaining in the message or the sentinel 0. The meaning of the sentinel is that the length of the content of the last message has to be derived by other means (computed from the lengths of all previous sub-messages and the length of the all message). This allows for a last sub-message larger than what can be specified in the encoding Unsigned16. In general, due to alignment requirements, the *octetsToNextHeader* field may be larger than the length of the current sub-message data.

7.4 APDU interpretation

7.4.1 General

The interpretation and meaning of a sub-message/sub-APDU within a message/APDU may depend on the previous sub-messages within that same message. Therefore the receiver of a message must maintain state from previously deserialized sub-messages in the same message.

Table 42 lists attributes that will be encountered examining the service specific APDU structures; these attributes may be modally changed by the parameters of some service specific APDUs and affect the interpretation of the following ones. Types are defined in IEC 61158-5-15.

Table 42 – Attributes changed modally and affecting APDUs interpretations

Attribute name	Type	Description
sourceVersion	ProtocolVersion	The major and minor version with which the following sub-messages need to be interpreted.
sourceVendorID	VendorID	The vendor identification with which the following vendor-specific extensions need to be interpreted.
sourceHostID, sourceAppID	HostID, AppID	The originator's host and application identifiers. The following sub-messages need to be identified as if they are coming from this host and application.
destHostID, destAppID	HostID, AppID	The destination's host and application identifiers. The following sub-messages need to be identified as if they are meant for this host and application.
unicastReplyIPAddress, unicastReplyPort	IPAddress, Port	An explicit IP address and port that provides an additional direct way for the receiver to reply directly to the originator over unicast.
multicastReplyIPAddress, multicastReplyPort	IPAddress, Port	An explicit IP address and port that provides an additional direct way for the receiver to reach the originator (and potentially many others) over multicast.
haveTimestamp, timestamp	Boolean, NtpTime	The timestamp applying to all the following sub-messages.

7.4.2 Rules

The following algorithm outlines the rules that a receiver of any message must follow:

- 1) if a 4-octets sub-message header cannot be read, the rest of the message is considered invalid;
- 2) the last two octets of a sub-message header, the *octetsToNextHeader* field, contains the number of octets to the next sub-message. If this field is invalid, the rest of the message is invalid;
- 3) the first octet of a sub-message header is the *sub-messageID*. A sub-message with an unknown ID must be ignored and parsing must continue with the next sub-message. Concretely: an implementation of publish/subscribe 1.0 must ignore any sub-messages with IDs that are outside of the sub-messageID list used by version 1.0. IDs in the vendor-specific range coming from a *vendorID* that is unknown must be ignored and parsing must continue with the next sub-message;
- 4) the second octet of a sub-message header contains flags; unknown flags should be skipped. An implementation of publish/subscribe 1.0 should skip all flags that are marked as 'X' (unused) in the protocol;
- 5) a valid *octetsToNextHeader* field must *always* be used to find the next sub-message, even for sub-messages with unknown IDs;
- 6) a known but invalid sub-message invalidates the rest of the message. 7.5.1 through 7.5.10.1 each describe a known sub-message and when it should be considered invalid.

The reception of a valid message header and/or sub-message has two effects:

- it can change the state of the receiver; this state influences how the following sub-messages in the message are interpreted. 7.5.1 through 7.5.10.1 show how the state changes for each sub-message. In this version of the protocol, only the Header and the sub-messages INFO_SRC, INFO_REPLY and INFO_TS change the state of the receiver;
- the sub-message, interpreted within the message, has a logical interpretation: it encodes one of the five basic publish/subscribe services: ACK, GAP, HEARTBEAT, ISSUE or VAR, beside the logistic services.

7.5 Service specific APDU structures

7.5.1 Issue FAL PDU

7.5.1.1 Request primitive

Service identifier, sub-message ID = 3 (0x03).


This sub-message is used by a publisher to publish user data for one or more subscribers.

This is an unconfirmed service.

The format is given in Table 43, Table 44 and Table 45.

Table 43 – Issue request

Parameter name / Field	Type	Description
Sub-message ID	Unsigned8	Service identifier, sub-message ID = 3 (0x03).
Flags	Octet string, 1 octet, see Table 44 and Table 45	Octet encoding boolean flags, described separately.
OctetsToNextHeader	Unsigned16	Number of octets from the first octet of the contents of this sub-message until the first octet of the header of the next sub-message, for all sub-messages but the last. See 7.3.4. Allowed values: 0x0000 to 0xFFFF
readerObjectID	ObjectID	Used to specify the subscription GUID <destHostID, destAppID, Issue.readerObjectID> for which the Issue service is meant. The Issue.readerObjectID can be OBJECTID_UNKNOWN, in which case the Issue service applies to all Subscriptions within the application <destHostID, destAppID>.
writerObjectID	ObjectID	Used to specify the Publication GUID <sourceHostID, sourceAppID, Issue.writerObjectID> that originated the Issue.
issueSeqNumber	SequenceNumber	Used to specify the sequence number identifying the Issue.
parameterSequence	ParameterSequence	Conditional to the value of the hasParameterSequence flag; it shall be used to provide a variable list of operational Issue parameters, and allows for publish/subscribe extensions.
issueData	Type is communicated by configuration or by convention on the topic specification or by the discovery mechanism	Used to specify the actual AI user data in this Issue.

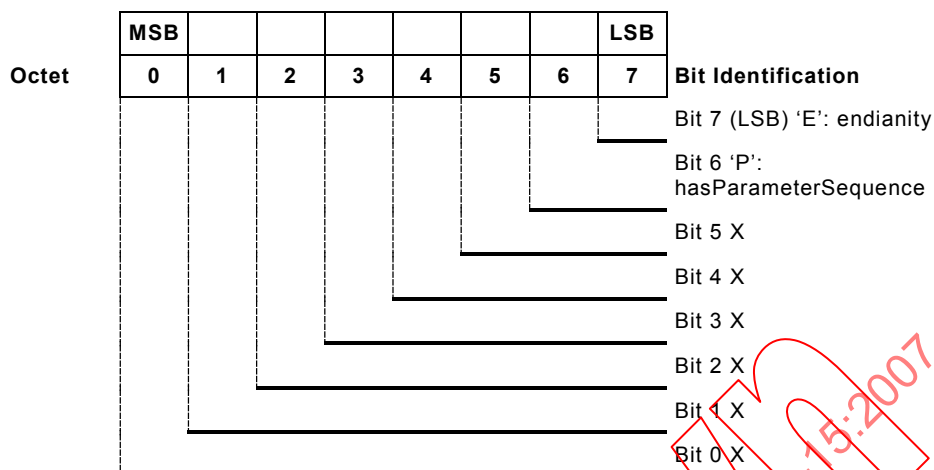Table 44 – Flags of issue request**Table 45 – Meaning of issue request flags**

Boolean flag	Description
endianness	Specifies the endianness of this service request and indication. Values: {big-endian, 0}, {little-endian, 1}
hasParameterSequence	Specifies if there is or not a parameterSequence parameter. Values: {NO, 0}, {YES, 1}

7.5.1.2 Validity

This sub-message is *invalid* when any of the following are true:

- *octetsToNextHeader* is too small given other sub-messages and message information;
- *issueSeqNumber* is either not strictly positive (1,2,...) or is not SEQUENCE_NUMBER_UNKNOWN;
- the parameter sequence is invalid.

7.5.1.3 Change in state of the receiver

None.

7.5.1.4 Logical interpretation

Table 46 – Interpretation of issue

Attribute	Value	Description
subscriptionGUID	<destHostId, destAppld, ISSUE.readerObjectId>	The Subscription for which the ISSUE is meant. The ISSUE.readerObjectId can be OBJECTID_UNKNOWN, in which case the ISSUE applies to all Subscriptions within the Application <destHostId, destAppld>.
publicationGUID	<sourceHostId, sourceAppld, ISSUE.writerObjectId>	The Publication object that originated this issue.
issueSeqNumber	ISSUE.issueSeqNumber	The sequence number of this issue, this should either be a strictly positive number (1,2,3,...) or the special sequence-number SEQUENCENUMBER_UNKNOWN. The latter may be used by a simple publication that does not number consecutive issues.
(parameters)	ISSUE.parameters (iff ISSUE.P==1)	(optional) This is present iff P == 1. These parameters will allow future extensions of the protocol.
ACKIPAddressPortList	{ unicastReplyIPAddress:unicastReplyPort }	The destinations to which the Publication can send an ACK message in response to this ISSUE.
(timestamp)	timestamp (present iff haveTimestamp == true)	(optional) Timestamp of this issue.
issueData	ISSUE.issueData	The actual user data in this issue.

7.5.2 Heartbeat FAL PDU

7.5.2.1 Request primitive

Service identifier, sub-message ID = 7 (0x07).

This sub-message is used to probe a reader's presence, and to inform one or more readers about a writer's available information via sequence numbers.

This is an unconfirmed service.

The format is given in Table 47, Table 48 and Table 49.

Table 47 – Heartbeat request

Parameter name / Field	Type	Description
Sub-message ID	Unsigned8	Service identifier, sub-message ID = 7 (0x07).
Flags	Octet string, 1 octet, see Table 48 and Table 49	Octet encoding boolean flags, described separately.
OctetsToNextHeader	Unsigned16	Number of octets from the first octet of the contents of this sub-message until the first octet of the header of the next sub-message, for all sub-messages but the last. See 7.3.4.
readerObjectID	ObjectID	Allowed values: 0x0000 to 0xFFFF Used to specify the reader GUID <destHostID, destAppID, Heartbeat.readerObjectID> for which the Heartbeat service is meant. The Heartbeat.readerObjectID can be OBJECTID_UNKNOWN, in which case the Heartbeat service applies to all readers within the application <destHostID, destAppID>
writerObjectID	ObjectID	Used to specify the writer GUID <sourceHostID, sourceAppID, Heartbeat.writerObjectID> that originated the Heartbeat.
firstSeqNumber	SequenceNumber	Used to specify the first sequence number that is still available and meaningful in the writer with writerObjectID. This field must be greater than or equal to zero. If it is equal to SEQUENCE_NUMBER_NONE, the writer has no data available.
lastSeqNumber	SequenceNumber	Used to specify the last sequence number that is available and in the writer with writerObjectID. This field must be greater than or equal to firstSeqNumber. If firstSeqNumber is equal to SEQUENCE_NUMBER_NONE, then lastSeqNumber must also be SEQUENCE_NUMBER_NONE.

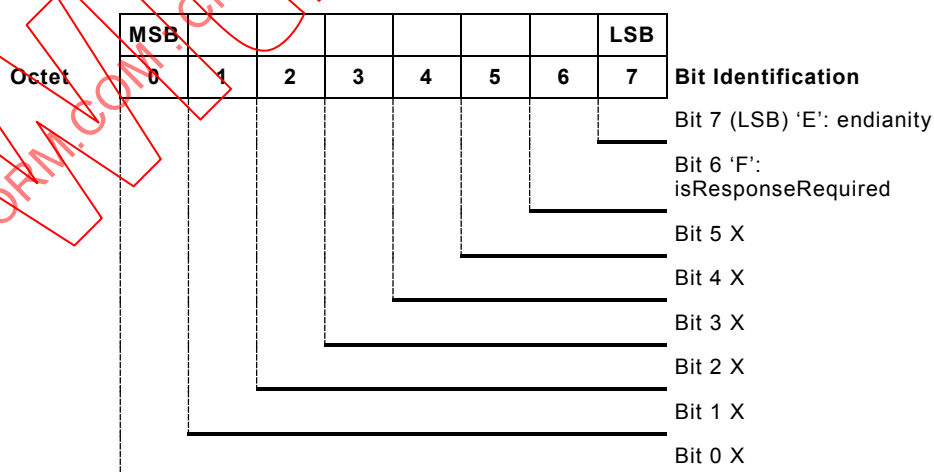
Table 48 – Flags of heartbeat request

Table 49 – Meaning of heartbeat request flags

Boolean flag	Description
endianity	Specifies the endianity of this service request and indication. Values: {big-endian, 0}, {little-endian, 1}
responselsNotRequired	Specifies if the application sending the Heartbeat requires or not a response. Known with 'F', that stands for 'Final'. Values: {FALSE, it IS required, 0}, {TRUE, it IS NOT required, 1}

7.5.2.2 Validity

This sub-message is *invalid* when any of the following are true:

- *octetsToNextHeader* is too small given other sub-messages and message information;
- *firstSeqNumber* is less than 0;
- *lastSeqNumber* is less than 0;
- *lastSeqNumber* is strictly less than *firstSeqNumber*.

7.5.2.3 Change in state of the receiver

None.

7.5.2.4 Logical interpretation

Table 50 – Interpretation of heartbeat

Attribute	Value	Description
FINAL-bit	HEARTBEAT.F	When the F-bit is set, the application sending the HEARTBEAT does not require a response.
readerGUID	<destHostId, destAppld, HEARTBEAT.readerObjectId>	The Reader to which the heartbeat applies. The HEARTBEAT.readerObjectId can be OBJECTID_UNKNOWN, in which case the HEARTBEAT applies to all Readers of that <i>writerGUID</i> within the Application <destHostId, destAppld>
writerGUID	<sourceHostId, sourceAppld, HEARTBEAT.writerObjectId>	The Writer to which the HEARTBEAT applies.
ACKIPAddressPortList	{ unicastReplyIPAddress:unicastReplyPort }	An additional list of destinations where responses (ACKs) to this sub-message can be sent.
firstSeqNumber	HEARTBEAT.firstSeqNumber	The first sequence number, <i>firstSeqNumber</i> , that is still available and meaningful in the <i>writerObject</i> . This field must be greater than or equal to zero. If it is equal to SEQUENCE_NUMBER_NONE, the Writer has no data available.
lastSeqNumber	HEARTBEAT.lastSeqNumber	The last sequence number, <i>lastSeqNumber</i> , that is available in the Writer. This field must be greater than or equal to <i>firstSeqNumber</i> . If <i>firstSeqNumber</i> is SEQUENCE_NUMBER_NONE, <i>lastSeqNumber</i> must also be SEQUENCE_NUMBER_NONE.

7.5.3 VAR FAL PDU

7.5.3.1 Request primitive

Service identifier, sub-message ID = 2 (0x02).


This sub-message is used by CSTWriters to publish metadata for CSTReaders, in this case information about the attributes of a network object. This information is part of a composite state.

This is an unconfirmed service.

The format is given in Table 51, Table 52 and Table 53.

Table 51 – VAR request

Parameter name / field	Type	Description
Sub-message ID	Unsigned8	Service identifier, sub-message ID = 2 (0x02).
Flags	Octet string, 1 octet, see Table 52 and Table 53	Octet encoding boolean flags, described separately.
OctetsToNextHeader	Unsigned16	Number of octets from the first octet of the contents of this sub-message until the first octet of the header of the next sub-message, for all sub-messages but the last. See 7.3.4.
readerObjectID	ObjectID	Allowed values: 0x0000 to 0xFFFF Used to specify the reader GUID <destHostID, destAppID, VAR.readerObjectID> for which the VAR service is meant. The VAR.readerObjectID can be OBJECTID_UNKNOWN, in which case the VAR service applies to all readers of the writerObjectID within the application <destHostID, destAppID>.
writerObjectID	ObjectID	Used to specify the CSTWriter GUID <sourceHostID, sourceAppID, VAR.writerObjectID> that originated the VAR.
hostID	HostID	Conditional to the value of the hasHostIDandAppID flag; when present, combined with the appID and objectID parameters, shall be used to specify the GUID of the object the information carried by this VAR is about.
appID	AppID	Conditional to the value of the hasHostIDandAppID flag; when present, combined with the hostID and objectID parameters, shall be used to specify the GUID of the object the information carried by this VAR is about.
objectID	ObjectID	Used to specify the GUID of the object the information carried by this VAR is about; if the parameters hostID and appID are present then the GUID is <VAR.hostID, VAR.appID, VAR.objectID> otherwise, combined with the modal/state values provided by the Messenger service, the GUID is <sourceHostID, sourceAppID>.
writerSeqNumber	SequenceNumber	Used to tag changes in the composite state provided by the CSTWriter; it is incremented each time a change in such composite state occurs; this should be a strictly positive number (1, 2, ...), or the special sequence number, SEQUENCE_NUMBER_UNKNOWN, may be sent to indicate that the sender does not keep track of the sequence number.
parameterSequence	ParameterSequence	Conditional to the value of the hasParameterSequence flag; it shall be used to provide a variable list of operational Issue parameters, and allows for publish/subscribe extensions.

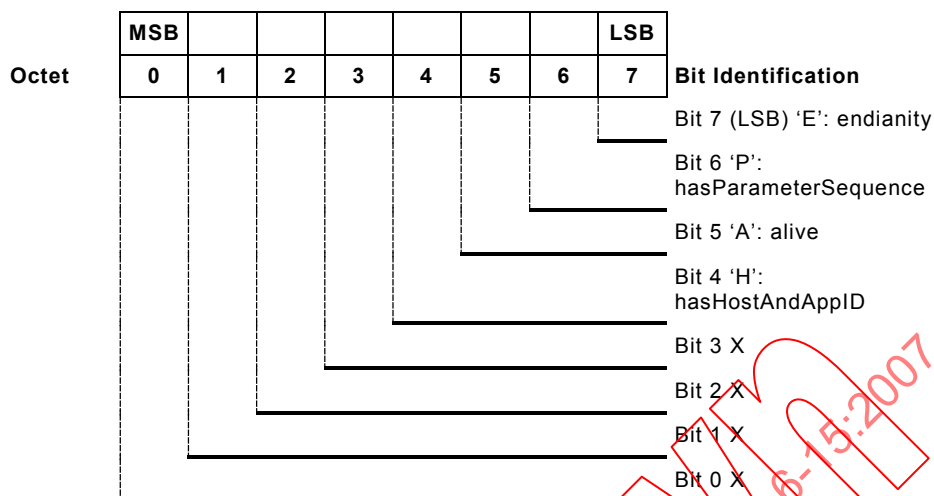Table 52 – Flags of VAR request**Table 53 – Meaning of VAR request flags**

Boolean flag	Description
endianness	Specifies the endianness of this service request and indication. Values: {big-endian, 0}, {little-endian, 1}
hasParameterSequence	Specifies if there is or not a parameterSequence parameter. Values: {NO, 0}, {YES, 1}
alive	Indicates to the reader whether the data-object is alive or else is not-alive (disposed). Values: {NO, 0}, {YES, 1}
hasHostAndAppID	Specifies if there are or not the hostID and the appID parameters. Values: {NO, 0}, {YES, 1}

7.5.3.2 Validity

This sub-message is *invalid* when any of the following are true:

- *octetsToNextHeader* is too small given other sub-messages and message information;
- *writerSeqNumber* is not strictly positive (1,2,...) or is SEQUENCE_NUMBER_UNKNOWN;
- the parameter sequence is invalid.

7.5.3.3 Change in state of the receiver

None.

7.5.3.4 Logical interpretation

Table 54 – Interpretation of VAR

Attribute	Value	Description
readerGUID	<destHostId, destAppld, VAR.readerObjectId>	The Reader to which the VAR applies. The VAR.readerObjectId can be OBJECTID_UNKNOWN, in which case the VAR applies to all Readers of that <i>writerGUID</i> within the Application <destHostId, destAppld>.
writerGUID	<sourceHostId, sourceAppld, VAR.writerObjectId>	The CSTWriter that sent the information.
objectGUID	<VAR.hostId, VAR.appld, VAR.objectId> (iff H == 1) <sourceHostId, sourceAppld, VAR.objectId> (iff H == 0)	The object this information (contained in the parameters) is about.
writerSeqNumber	VAR.writerSeqNumber	Incremented each time a change in the Composite State provided by the CSTWriter occurs. This should be a strictly positive number (1, 2, ...). Or, the special sequence number, SEQUENCE_NUMBER_UNKNOWN, may be sent to indicate that the sender does not keep track of the sequence number.
(timestamp)	current.timestamp if current.haveTimestamp == true	(optional) This is present iff current.haveTimestamp == true. Timestamp of the new parameters sent with this sub-message.
(parameters)	VAR.parameters (iff VAR.P == 1)	(optional) This is present iff VAR.P == 1. Contains information about the object.
ALIVE-bit	VAR.A	Indicates to the reader whether the data-object is alive or else is not-alive (disposed).
ACKIPAddressPortList	{ unicastReplyIPAddress:unicastReplyIPPort, writer>IPAddressPortList() }	Where to sent ACKs in reply to this sub-message.

7.5.4 GAP FAL PDU

7.5.4.1 Request primitive

Service identifier, sub-message ID = 8 (0x08).

This sub-message is sent from a CSTWriter to a CSTReader to indicate that a range of sequence numbers is no longer relevant. The set may be a contiguous range of sequence numbers or a specific set of sequence numbers.

This is an unconfirmed service.

The format is given in Table 55, Table 56 and Table 57.

Table 55 – GAP request

Parameter name / Field	Type	Description
Sub-message ID	Unsigned8	Service identifier, sub-message ID = 3 (0x03).
Flags	Octet string, 1 octet, see Table 56 and Table 57	Octet encoding boolean flags, described separately.
OctetsToNextHeader	Unsigned16	Number of octets from the first octet of the contents of this sub-message until the first octet of the header of the next sub-message, for all sub-messages but the last. See 7.3.4. Allowed values: 0x0000 to 0xFFFF
readerObjectID	ObjectID	Used to specify the reader GUID <destHostID, destAppID, GAP.readerObjectID> for which the GAP service is meant. The GAP.readerObjectID can be OBJECTID_UNKNOWN, in which case the GAP service applies to all readers within the application <destHostID, destAppID>.
writerObjectID	ObjectID	Used to specify the CSTWriter GUID <sourceHostID, sourceAppID, GAP.writerObjectID> that is the subject of the GAP sequence numbers of this GAP service invocation.
firstSeqNumber	SequenceNumber	Used with the <i>bitmap</i> parameter to specify the sequence numbers that are no longer available in the writerObjectID network object; the list of the no longer available sequence numbers is the union of: all the sequence numbers in the range from GAP.firstSeqNumber up to GAP.bitmap.bitmapBase – 1; this list is empty if the firstSeqNumber is greater than or equal to the bitmapBase of the <i>bitmap</i> ; GAP.firstSeqNumber should always be greater than or equal to 1; <i>and</i> the sequence numbers that have the corresponding bit in the <i>bitmap</i> set to 1.
bitmap	Bitmap	Used with the <i>firstSeqNumber</i> parameter to specify the sequence numbers that are no longer available in the writerObjectID network object, as detailed in the <i>firstSeqNumber</i> parameter description above.

Table 56 – Flags of GAP request

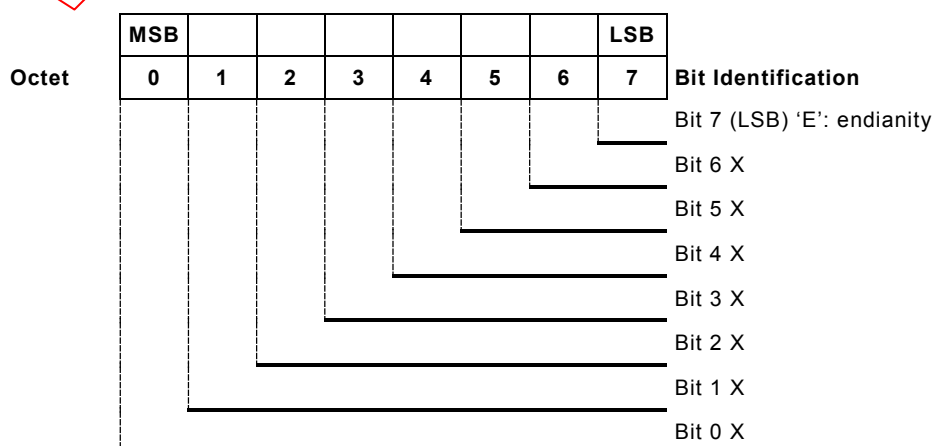


Table 57 – Meaning of GAP request flags

Boolean flag	Description
endianity	Specifies the endianity of this service request and indication. Values: {big-endian, 0}, {little-endian, 1}

7.5.4.2 Validity

This sub-message is *invalid* when any of the following are true:

- *octetsToNextHeader* is too small given other sub-messages and message information;
- *bitmap* is invalid;
- *firstSeqNumber* is 0 or negative.

7.5.4.3 Change in state of the receiver

None.

7.5.4.4 Logical interpretation

Table 58 – Interpretation of GAP

Attribute	Value	Description
readerGUID	<destHostId, destAppId, GAP.readerObjectId>	The GUID of the CSTReader for which the <i>gapList</i> is meant. The GAP <i>readerObjectId</i> can be OBJECTID_UNKNOWN, in which case the GAP applies to all Readers within the Application <destHostId, destAppId>.
writerGUID	<sourceHostId, sourceAppId, GAP.writerObjectId>	The GUID of the CSTWriter to which the <i>gapList</i> applies.
ACKIPAddressPortList	{ unicastReplyIPAddress:uni castReplyPort }	If the CSTReader that receives this sub-message needs to reply with an ACK sub-message, then this ACK can be sent to one of the explicit destinations in this list.
gapList	{ GAP.firstSeqNumber, GAP.firstSeqNumber+1,..., GAP.bitmap.bitmapBase-1 } <i>and</i> all sequence numbers that have a corresponding bit set to 1 in the <i>bitmap</i>	The list of sequence numbers that are no longer available in the <i>writerObject</i> . This list is the union of: All the sequence numbers in the range from <i>GAP.firstSeqNumber</i> up to <i>GAP.bitmap.bitmapBase - 1</i> . This list is empty if the <i>firstSeqNumber</i> is greater than or equal to the <i>bitmapBase</i> of the <i>bitmap</i> . <i>GAP.firstSeqNumber</i> should always be greater than or equal to 1; <i>and</i> The sequence numbers that have the corresponding bit in the <i>bitmap</i> set to 1.

7.5.5 ACK FAL PDU

7.5.5.1 Request primitive

Service identifier, sub-message ID = 6 (0x06).

This sub-message is used to communicate the state of a Reader to a Writer.

This is an unconfirmed service.

The format is given in Table 59, Table 60 and Table 61.

Table 59 – ACK request

Parameter name / Field	Type	Description
Sub-message ID	Unsigned8	Service identifier, sub-message ID = 3 (0x03).
Flags	Octet string, 1 octet, see Table 60 and Table 61	Octet encoding boolean flags, described separately.
OctetsToNextHeader	Unsigned16	Number of octets from the first octet of the contents of this sub-message until the first octet of the header of the next sub-message, for all sub-messages but the last. See 7.3.4. Allowed values: 0x0000 to 0xFFFF
readerObjectID	ObjectID	Used to specify the GUID <sourceHostID, sourceAppID, ACK readerObjectID> of the reader acknowledges receipt of certain sequence numbers and/or requests to receive certain sequence numbers.
writerObjectID	ObjectID	Used to specify the GUID <destHostID, deatAppID, ACK writerObjectID> of the writer that the reader has received these sequence numbers from and/or wants to receive these sequence numbers from.
bitmap	Bitmap	Used to specify the ACK botmap: a “0” in this bitmap means that the corresponding sequence-number is missing; a “1” in the bitmap conveys no information, that is, the corresponding sequence number may or may not be missing; by sending an ACK, the readerGUID object acknowledges receipt of all messages up to and including the sequence number (bitmap.bitmapBase -1).

Table 60 – Flags of ACK request

[illegible]

Table 61 – Meaning of ACK request flags

Boolean flag	Description
endianity	Specifies the endianity of this service request and indication. Values: {big-endian, 0}, {little-endian, 1}
responselsNotRequired	Specifies if the application sending the Heartbeat requires or not a response. Known with 'F', that stands for 'Final'. Values: {FALSE, it IS required, 0}, {TRUE, it IS NOT required, 1}

7.5.5.2 Validity

This sub-message is *invalid* when any of the following are true:

- *octetsToNextHeader* is too small given other sub-messages and message information;
- bitmap is invalid.

7.5.5.3 Change in state of the receiver

None.

7.5.5.4 Logical interpretation

Table 62 – Interpretation of ACK

Attribute	Value	Description
FINAL-bit	ACK.F	When the F-bit is set, the application sending the ACK does not expect a response to the ACK.
readerGUID	<sourceHostId, sourceAppld, ACK.readerObjectId>	The GUID of the Reader that acknowledges receipt of certain sequence numbers and/or requests to receive certain sequence numbers.
writerGUID	<destHostId, destAppld, ACK.writerObjectId>	The GUID of the Writer that the reader has received these sequence numbers from and/or wants to receive these sequence numbers from.
replyIPAddressPortList	{ unicastReplyIPAddress:uni castReplyPort, multicastReplyIPAddress: multicastReplyPort }	This is an additional list of addresses that the receiving application can use to respond to this ACK.
bitmap	ACK.bitmap	A "0" in this bitmap means that the corresponding sequence-number is missing. A "1" in the bitmap conveys no information, that is, the corresponding sequence number may or may not be missing. By sending an ACK, the readerGUID object acknowledges receipt of all messages up to and including the sequence number (bitmap.bitmapBase -1).

7.5.6 Header FAL PDU

7.5.6.1 General

It is convenient to see the message header as a sub-APDU itself, despite it being a header. In IEC 61158-5-15, it has been abstracted as one of the services of the messenger ASE because it has many similarities with other services there, which modify defaults set by the

header. It is also different, its sub-APDU has the fixed length of 16 octets, it is a singleton and it is identified by its location instead of having a service identifier.

The header is one of the set of logistic sub-messages: header, INFO_DST, INFO_REPLY, INFO_SRC, INFO_TS, and PAD.

7.5.6.2 Request primitive

Service identifier: positional, it is at the beginning of every message.

The format is given in Table 63.

Table 63 – Header request

Parameter name / field	Type	Description
1 st header marker	Octet string, 1 octet	Ascii character 'R'.
2 nd header marker	Octet string, 1 octet	Ascii character 'T'.
3 rd header marker	Octet string, 1 octet	Ascii character 'P'.
4 th header marker	Octet string, 1 octet	Ascii character 'S'.
version	ProtocolVersion	The type is defined in IEC 61158-5-15. This specification refers to {major = 0x1, minor = 0x0}.
vendorID	VendorID	Used to specify the vendor of the middleware implementing the publish/subscribe protocol and allows this vendor to add specific extensions to the protocol. The vendorID does not refer to the vendor of the device or product that contains publish/subscribe middleware. The type is defined in IEC 61158-5-15.
hostID	HostID	Used to specify sourceHostID for the receiver and for the reader and writer services that use sourceHostID; the value setting is modal, as specified until changed.
applID	AppID	Used to specify sourceAppID for the receiver and for the reader and writer services that use sourceAppID; the value setting is modal, as specified until changed.

7.5.6.3 Validity

A header is *invalid* when any of the following are true:

- The full APDU has less than the required number of octets to contain a full header (16 octets);
- its first 4 octets are not 'R' 'T' 'P' 'S';
- the major protocol version is larger than the major protocol version supported by the implementation.

7.5.6.4 Change in state of the receiver

Table 64 – Change in state of the receiver

attribute	value
sourceHostID	Header.hostID
sourceAppID	Header.appID
sourceVersion	Header.version
sourceVendorID	Header.vendorID
haveTimestamp	false

7.5.6.5 Logical interpretation

None.

7.5.7 INFO_DST FAL PDU

7.5.7.1 Request primitive

Service identifier, sub-message ID = 14 (0x0E).


This sub-message modifies the logical destination for the service requests that follow it.

This is an unconfirmed service.

The format is given in Table 65, Table 66 and Table 67.

Table 65 – INFO_DST request

Parameter name / field	Type	Description
Sub-message ID	Unsigned8	Service identifier, sub-message ID = 14 (0x0E).
Flags	Octet string, 1 octet, see Table 66 and Table 67	Octet encoding boolean flags, described separately.
OctetsToNextHeader	Unsigned16	Number of octets from the first octet of the contents of this sub-message until the first octet of the header of the next sub-message, for all sub-messages but the last. See 7.3.4. Allowed values: 0x0000 to 0xFFFF
hostID	HostID	Used to specify destHostID for the reader and writer services that use destHostID; the value setting is modal, as specified until changed.
appID	AppID	Used to specify destAppID for the reader and writer services that use destAppID; the value setting is modal, as specified until changed.

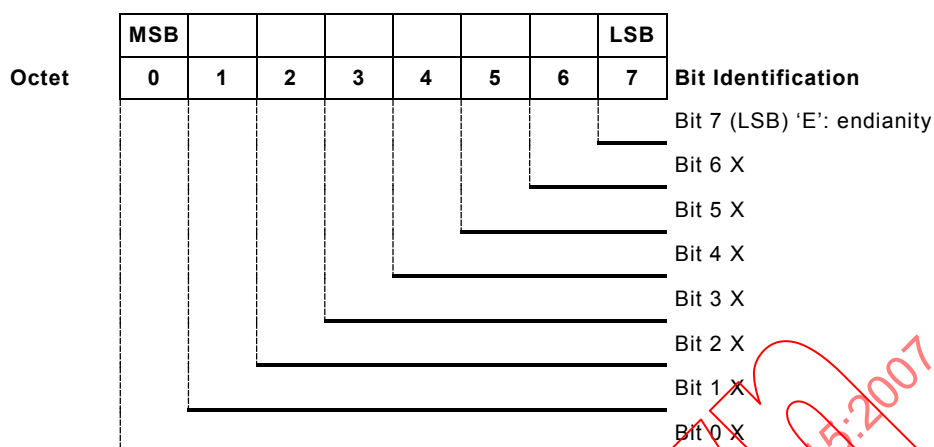Table 66 – Flags of INFO_DST request**Table 67 – Meaning of INFO_DST request flags**

Boolean flag	Description
endianness	Specifies the endianness of this service request and indication. Values: {big-endian, 0}, {little-endian, 1}

7.5.7.2 Validity

This sub-message is *invalid* when any of the following are true:

- *octetsToNextHeader* is too small given other sub-messages and message information.

7.5.7.3 Change in state of the receiver

```

if(INFO_DST.hostId != HOSTID_UNKNOWN) {
    destHostId = INFO_DST.hostId
} else {
    destHostId = hostId of application receiving the message
}

if(INFO_DST.appId != APPID_UNKNOWN) {
    destAppId = INFO_DST.appId
} else {
    destAppId = appId of application receiving the message
}

```

In other words, an INFO_DST with a HOSTID_UNKNOWN means that any host may interpret the following submessages as if they were meant for it. Similarly, an INFO_DST with a APPID_UNKNOWN means that any application may interpret the following submessages as if they were meant for it.

7.5.7.4 Logical interpretation

None; this only affects the interpretation of the submessages that follow it.

7.5.8 INFO_REPLY FAL PDU**7.5.8.1 Request primitive**

Service identifier, sub-message ID = 13 (0x0D).

This sub-message specifies explicit information on where to send a reply to the requests that follow it within the same message.

The format is given in Table 68, Table 69 and Table 70.

Table 68 – INFO_REPLY request

Parameter name / field	Type	Description
Sub-message ID	Unsigned8	Service identifier, sub-message ID = 13 (0x0D).
Flags	Octet string, 1 octet, see Table 69 and Table 70	Octet encoding boolean flags, described separately.
OctetsToNextHeader	Unsigned16	Number of octets from the first octet of the contents of this sub-message until the first octet of the header of the next sub-message, for all sub-messages but the last. See 7.3.4. Allowed values: 0x0000 to 0xFFFF
unicastReplyIPAddress	IPAddress	Used to specify the IP address of where to send a reply to the requests that follow within the same message; the value setting is modal, as specified until changed.
unicastReplyPort	Port	Used to specify the port of where to send a reply to the requests that follow within the same message; the value setting is modal, as specified until changed.
multicastReplyIPAddress	IPAddress	Conditional to the value of the hasMulticast parameter. It shall be used to specify the IP address of where to send a reply to the requests that follow within the same message; the value setting is modal, as specified until changed.
multicastReplyPort	Port	Conditional to the value of the hasMulticast parameter. It shall be used to specify the port of where to send a reply to the requests that follow within the same message; the value setting is modal, as specified until changed.

Table 69 – Flags of INFO_REPLY request

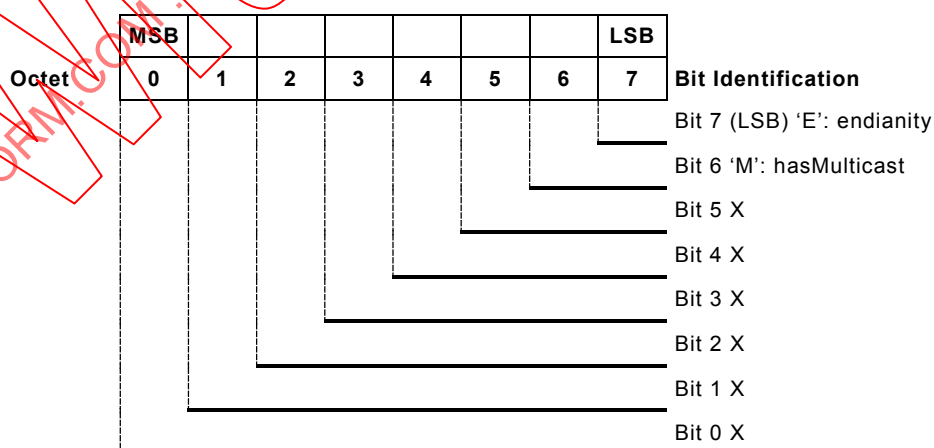


Table 70 – Meaning of INFO_REPLY request flags

Boolean flag	Description
endianity	Specifies the endianity of this service request and indication. Values: {big-endian, 0}, {little-endian, 1}
hasMulticast	Specifies if there is multicast information. Values: {NO, 0}, {YES, 1}

7.5.8.2 Validity

This sub-message is *invalid* when any of the following are true:

- *octetsToNextHeader* is too small given other sub-messages and message information.

7.5.8.3 Change in state of the receiver

```

if ( INFO_REPLY.unicastReplyIPAddress != IPADDRESS_INVALID )
    unicastReplyIPAddress = INFO_REPLY.unicastReplyIPAddress;
}
unicastReplyPort = INFO_REPLY.replyPort
if ( M==1 ) {
    multicastReplyIPAddress = INFO_REPLY.multicastReplyIPAddress
    multicastReplyPort      = INFO_REPLY.multicastReplyPort
} else {
    multicastReplyIPAddress = IPADDRESS_INVALID
    multicastReplyPort      = PORT_INVALID
}

```

7.5.8.4 Logical interpretation

None; this only affects the interpretation of the submessages that follow it.

7.5.9 INFO_SRC FAL PDU**7.5.9.1 Request primitive**

Service identifier, sub-message ID = 12 (0x0C).

This sub-message modifies the logical source for the service requests that follow it.

This is an unconfirmed service.

The format is given in Table 71, Table 72 and Table 73.

Table 71 – INFO_SRC request

Parameter name / field	Type	Description
Sub-message ID	Unsigned8	Service identifier, sub-message ID = 12 (0x0C).
Flags	Octet string, 1 octet, see Table 72 and Table 73	Octet encoding boolean flags, described separately.
OctetsToNextHeader	Unsigned16	Number of octets from the first octet of the contents of this sub-message until the first octet of the header of the next sub-message, for all sub-messages but the last. See 7.3.4.
appIPAddress	IPAddress	Allowed values: 0x0000 to 0xFFFF Used to specify the IP address of where to send a reply to the requests that follow within the same message; the value setting is modal, as specified until changed.
version	ProtocolVersion	The type is defined in IEC 61158-5-15. This specification refers to {major = 0x1, minor = 0x0}
vendorID	VendorID	Used to specify the vendor of the middleware implementing the publish/subscribe protocol and allows this vendor to add specific extensions to the protocol. The vendorID does not refer to the vendor of the device or product that contains publish/subscribe middleware. The type is defined in IEC 61158-5-15.
hostID	HostID	Used to specify sourceHostID for the receiver and for the reader and writer services that use sourceHostID; the value setting is modal, as specified until changed.
appID	AppID	Used to specify sourceAppID for the receiver and for the reader and writer services that use sourceAppID; the value setting is modal, as specified until changed.

Table 72 – Flags of INFO_SRC request

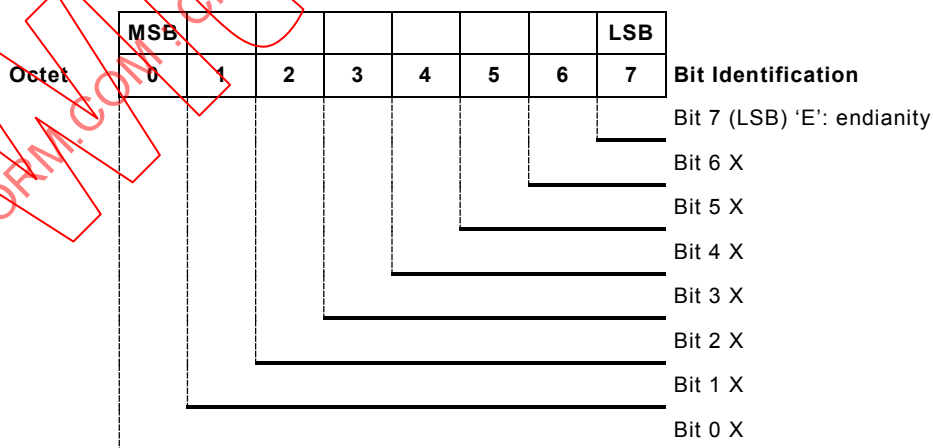


Table 73 – Meaning of INFO_SRC request flags

Boolean flag	Description
endianness	Specifies the endianness of this service request and indication. Values: {big-endian, 0}, {little-endian, 1}

7.5.9.2 Validity

This sub-message is *invalid* when any of the following are true:

- *octetsToNextHeader* is too small given other sub-messages and message information.

7.5.9.3 Change in state of the receiver

```

sourceHostId      = INFO_SRC.hostId
sourceAppId       = INFO_SRC.appId
sourceVersion     = INFO_SRC.version
sourceVendorId    = INFO_SRC.vendorId
unicastReplyIPAddress = INFO_SRC.appIPAddress
unicastReplyPort  = PORT_INVALID
multicastReplyIPAddress = IPADDRESS_INVALID
multicastReplyPort = PORT_INVALID
haveTimestamp     = false

```

7.5.9.4 Logical interpretation

None; this only affects the interpretation of the submessages that follow it.

7.5.10 INFO_TS FAL PDU

7.5.10.1 Request primitive

Service identifier, sub-message ID = 9 (0x09).

This sub-message is used to send a timestamp which applies to the service requests that follow it.

This is an unconfirmed service.

The format is given in Table 74, Table 75 and Table 76.

Table 74 – INFO_TS request

Parameter name / field	Type	Description
Sub-message ID	Unsigned8	Service identifier, sub-message ID = 9 (0x09).
Flags	Octet string, 1 octet, see Table 75 and Table 76	Octet encoding boolean flags, described separately.
OctetsToNextHeader	Unsigned16	Number of octets from the first octet of the contents of this sub-message until the first octet of the header of the next sub-message, for all sub-messages but the last. See 7.3.4.
ntpTimestamp	NtpTime	Allowed values: 0x0000 to 0xFFFF Conditional to the value of the noTimestamp flag. It shall be used to specify the timestamp for the requests that follow within the same message; the value setting is modal, as specified until changed.

Table 75 – Flags of INFO_TS request

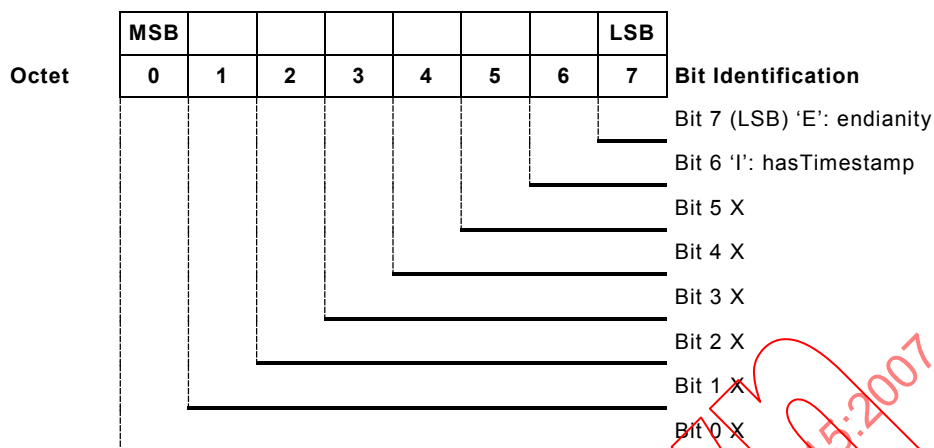


Table 76 – Meaning of INFO_TS request flags

Boolean flag	Description
endianness	Specifies the endianness of this service request and indication. Values: {big-endian, 0}, {little-endian, 1}
hasTimestamp	Specifies if there is (0) or not (1) a timestamp. Values: {hasTimestamp, 0}, {thereIsNOTimestamp, 1}

7.5.10.2 Validity

This sub-message is *invalid* when any of the following are true:

- *octetsToNextHeader* is too small given other sub-messages and message information.

7.5.10.3 Change in state of the receiver

```

if (INFO_TS.I==0) {
    haveTimestamp = true
    timestamp = INFO_TS.ntpTimestamp
} else {
    haveTimestamp = false
}

```

7.5.10.4 Logical interpretation

None; this only affects the interpretation of the submessages that follow it.

7.5.11 PAD FAL PDU

7.5.11.1 Request primitive

Service identifier, sub-message ID = 1 (0x01).

This sub-message is used for alignment purposes within the message, whereas the receiver will skip the PAD service request length and will get to the next request. The length is specified as part of the request format. The service has no other meaning.

This is an unconfirmed service.

The format is given in Table 77, Table 78 and Table 79.

Table 77 – PAD request

Parameter name / field	Type	Description
Sub-message ID	Unsigned8	Service identifier, sub-message ID = 1 (0x01).
Flags	Octet string, 1 octet, see Table 78 and Table 79	Octet encoding boolean flags, described separately.
OctetsToNextHeader	Unsigned16	Number of octets from the first octet of the contents of this sub-message until the first octet of the header of the next sub-message, for all sub-messages but the last. See 7.3.4. Allowed values: 0x0000 to 0xFFFF

Table 78 – Flags of PAD request

	MSB						LSB	
Octet	0	1	2	3	4	5	6	7
								Bit Identification
								Bit 7 (LSB) 'E': endianness
								Bit 6 X
								Bit 5 X
								Bit 4 X
								Bit 3 X
								Bit 2 X
								Bit 1 X
								Bit 0 X

Table 79 – Meaning of PAD request flags

Boolean flag	Description
endianness	Specifies the endianness of this service request and indication. Values: {big-endian, 0}, {little-endian, 1}

7.5.11.2 Validity

This sub-message is *invalid* when any of the following are true:

- *octetsToNextHeader* is too small given other sub-messages and message information.

7.5.11.3 Change in state of the receiver

None.

7.5.11.4 Logical interpretation

Logistic only, the receiver skips the PAD using *octetsToNextHeader*.

7.6 Common data representation for publish/subscribe**7.6.1 General**

The following is a summary of the CDR (defined within the OMG CORBA protocol) data format and the OMG IDL syntax to the extent that they are used by the publish/subscribe protocol and its description in this standard.

NOTE The authoritative source of the CDR specification and OMG IDL is the CORBA protocol (available through the Object Management Group <<http://www.omg.org>>). In the CORBA V2.3.1 specification, the relevant sections are 15.3 (General Inter-ORB Protocol—CDR Transfer Syntax) and 3.10 (OMG IDL Syntax and Semantics— Type Declaration). Unless mentioned explicitly, CDR for publish/subscribe follows the CDR standard for GIOP version 1.1.

publish/subscribe makes some additional restrictions on CDR and makes concrete choices where CDR for GIOP 1.1 is not fully defined. Notable are the implementation of the wide characters and strings (wchar and wstring) and the definition of the publish/subscribe Identifier, which only allows certain characters.

7.6.2 Primitive Types

7.6.2.1 Semantics

Table 80 – Semantics

OMG IDL-name	Size	Meaning
octet	1	8 uninterpreted bits
boolean	1	TRUE or FALSE
unsigned short	2	integer N, $0 \leq N < 2^{16}$
short	2	integer N, $-2^{15} \leq N < 2^{15}$
unsigned long	4	integer N, $0 \leq N < 2^{32}$
long	4	integer N, $-2^{31} \leq N < 2^{31}$
unsigned long long	8	integer N, $0 \leq N < 2^{64}$
long long	8	integer N, $-2^{63} \leq N < 2^{63}$
float	4	IEEE single-precision fp number
double	8	IEEE double-precision fp number
char	1	a character following ISO 8859-1
wchar	2	a wide-character following UNICODE

Remarks:

- CDR defines some additional primitive types, such as "long double"; these are currently disallowed by publish/subscribe;
- CDR leaves the width of the wchar open; publish/subscribe gives it a fixed length of two octets.

7.6.2.2 Encoding

CDR has both a big-endian ("BE") and a little-endian ("LE") encoding. The sender is allowed to choose the encoding. The receiver needs to know which encoding has been used by the sender to unpack the data correctly. This endianness-bit is transmitted as part of the publish/subscribe protocol.

7.6.2.3 octet

```

BE/LE
0...2.....7
+-+-+-+
|7|6|5|4|3|2|1|0|
+-+-+-+

```

7.6.2.4 boolean

```

TRUE BE/LE
0...2.....7
+-+-+-+
|0|0|0|0|0|0|0|1|
+-+-+-+

```

```

FALSE BE/LE
0...2.....7
+-+-+-+
|0|0|0|0|0|0|0|0|
+-+-+-+

```

7.6.2.5 unsigned short

```

BE
0...2.....7.....15
+-+-+-+
|MSB|LSB|
+-+-+-+
LE
0...2.....7.....15
+-+-+-+
|LSB|MSB|
+-+-+-+

```

7.6.2.6 short

A short has the same encoding as an unsigned short, but uses 2's complement representation.

7.6.2.7 unsigned long

```


BE
0...2.....7.....15.....23.....31
+-+-+-+
|MSB|X|Y|LSB|
+-+-+-+
LE
0...2.....7.....15.....23.....31
+-+-+-+
|LSB|Y|X|MSB|
+-+-+-+

```

7.6.2.8 long

A long has the same encoding as an unsigned long, but uses 2's complement representation.


7.6.2.9 unsigned long long

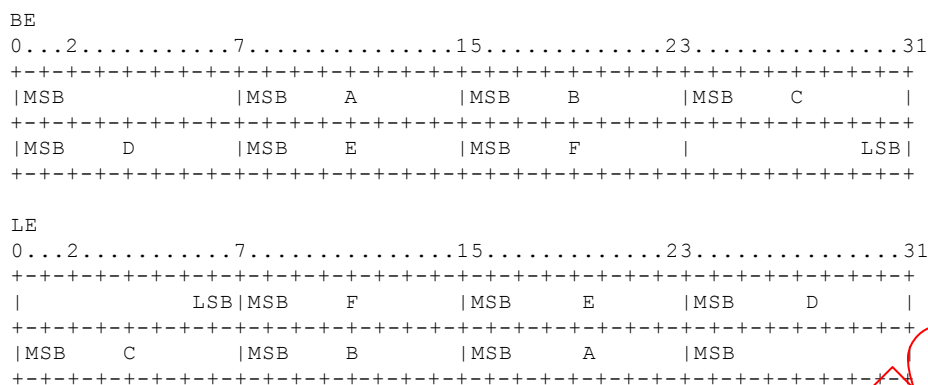


7.6.2.10 long long

A long long has the same encoding as an unsigned long long, but uses 2's complement representation.

7.6.2.11 float

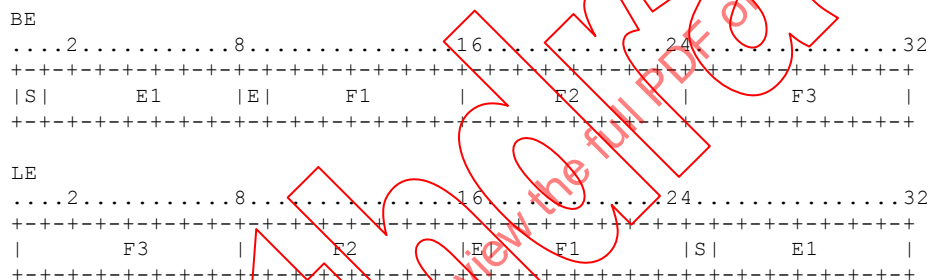

7.6.2.12 double

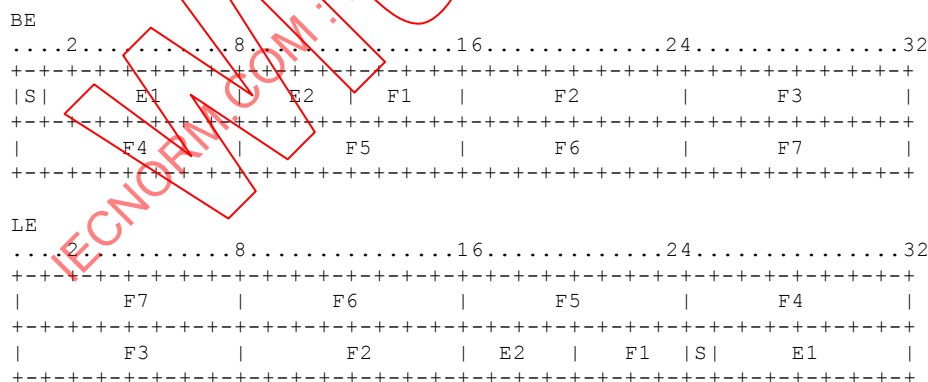

7.6.2.13 char

A character has the same encoding as an octet.

7.6.2.14 wchar

A wide-character occupies two octets and follows UNICODE encoding.

7.6.3 Constructed types

7.6.3.1 Alignment

In CDR, only the primitive types listed in 7.6.2 have alignment constraints. The primitive types need to be aligned on their length. For example (Informative), a long must start on a 4-octets boundary. The boundaries are counted from the start of the CDR stream.

7.6.3.2 Identifiers

An identifier is a sequence of ASCII alphabetic and numeric characters, plus the underscore character. The first character must be an ASCII alphabetic character.

7.6.3.3 List of constructed types

publish/subscribe supports the following subset of CDR constructed types:

struct	structure
array	fixed size array (the length is part of the type)
sequence	variable size array (the maximum length is part of the type)
string	string of 1-byte characters
wstring	string of wide character

NOTE There are some additional constructed types in CDR, such as unions and fixed-point decimal types; these are currently not supported in publish/subscribe.

7.6.3.4 Struct

A structure has a name (an identifier) and an ordered sequence of elements. Each element has a name (an identifier) and a type. In OMG IDL, a structure is defined by the keyword "struct", followed by an identifier and a sequence of the elements of the structure. An example (Informative) of the definition of a structure named "myStructure" in OMG IDL is:

```
struct myStructure {  
    long long l;  
    unsigned short s;  
    myType t;  
}
```

In CDR, the components of such a structure are encoded in the order of their declaration in the structure. The only alignment requirements are at the level of the primitive types.

7.6.3.5 Enumeration

An enumeration has a name (an identifier) and an ordered set of case-keywords which also are identifiers. In OMG IDL, an enumeration is defined by the keyword "enum", followed by an identifier and a list of identifiers in the enumeration. For example (Informative):

```
enum myEnumeration { case1, case2, case3 }
```

In CDR, enumerations are encoded as unsigned longs, where the identifiers in the enumeration are numbered from left to right, starting with 0.

7.6.3.6 Sequence

A sequence is a variable number of elements of the same type. Optionally, the type can specify the maximum number of elements in the sequence. OMG IDL uses the keyword "sequence". The syntax for an unbounded sequence of floats is:

```
sequence<float>
```


The syntax for a sequence of unsigned long longs with a maximum length is

```
sequence<unsigned long long, MAX_NUMBER_OF_ELEMENTS>
```

In CDR, sequences are encoded as the number of elements (as an unsigned long) followed by each of the elements in the sequence.

7.6.3.7 Array

Arrays have a fixed and well-known number of elements of the same type. In OMG IDL, an array is defined using the symbols "[" and "]", following the C/C++ style. An example (Informative) is

```
float[17]
```

In CDR, arrays are encoded by encoding each of its elements from low to high index. In multi-dimensional arrays, the index of the last dimension varies most quickly.

7.6.3.8 String

A string is an optionally bounded sequence of characters. In OMG IDL, a string of unbounded length is identified by the keyword "string"; a bounded string is specified as follows:

```
string<MAX_LENGTH>
```

On the wire, strings are encoded as an unsigned long (indicating the number of octets that follow to encode the string), followed by each of the characters in the string and a terminating zero. For example (Informative), the string "Hello" is encoded as the unsigned long 6 followed by the octets 'H', 'e', 'l', 'l', 'o', 0.

7.6.3.9 Wstring

A wide-string is a string of wide-characters. In OMG IDL, unbounded and bounded strings are specified, respectively, as follows:

```
wstring  
wstring<MAX_LENGTH>
```

In CDR (GIOP 1.1), a wide-string is encoded as an unsigned long indicating the length of the string on octets or unsigned integers (determined by the transfer syntax for wchar), followed by the individual wide characters. Both the string length and contents include a terminating NULL.

8 Structure of FAL protocol state machines

Interface to FAL services and protocol machines are specified in this subclause.

NOTE The state machines specified in this subclause and ARPMs defined in the following sections only define the valid events for each. It is a local matter to handle the invalid events.

The behavior of the FAL is described by three integrated protocol machines. Specific sets of these protocol machines are defined for different AREP types. The three protocol machines are: FAL Service Protocol Machine (FSPM), the Application Relationship Protocol Machine (ARPM), and the data-link layer Mapping Protocol Machine (DMPM). The relationship among these protocol machines as well as primitives exchanged among them are depicted in Figure 7.

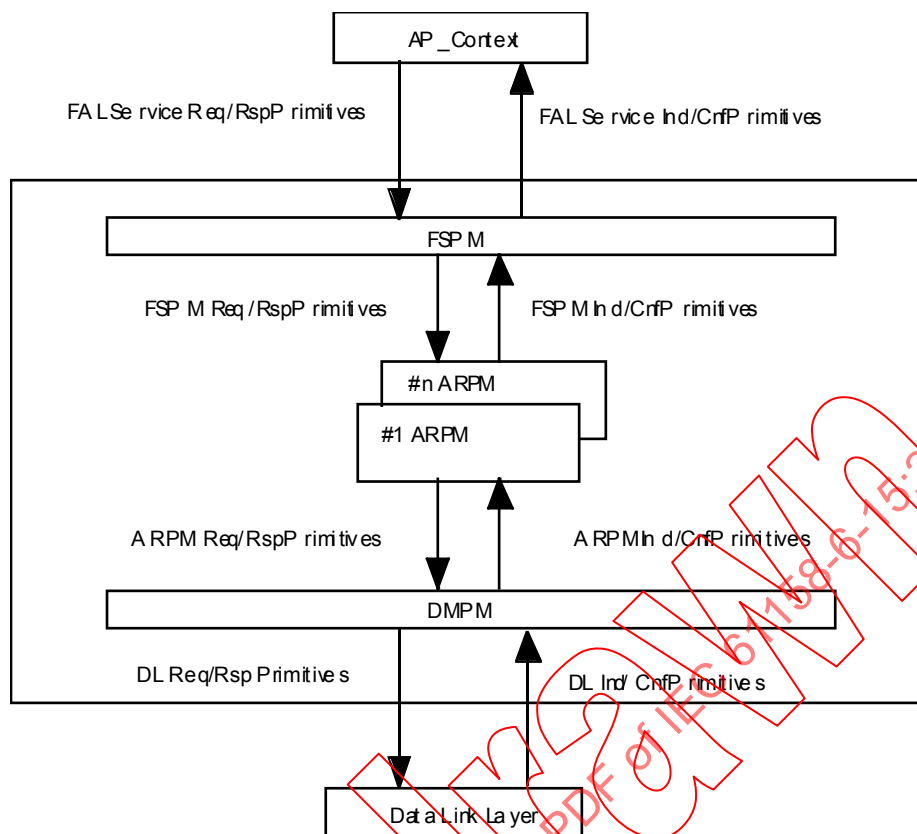


Figure 7 – Relationships among protocol machines and adjacent layers

The FSPM describes the service interface between the AP-Context and a particular AREP. The FSPM is common to all the AREP classes and does not have any state changes. The FSPM is responsible for the following activities:

- to accept service primitives from the FAL service user and convert them into FAL internal primitives;
- to select an appropriate ARPM state machine based on the AREP Identifier parameter supplied by the AP-Context and send FAL internal primitives to the selected ARPM;
- to accept FAL internal primitives from the ARPM and convert them into service primitives for the AP-Context;
- to deliver the FAL service primitives to the AP-Context based on the AREP Identifier parameter associated with the primitives.

The ARPM describes the establishment and release of an AR and exchange of FAL-PDUs with a remote ARPM(s). The ARPM is responsible for the following activities:

- to accept FAL internal primitives from the FSPM and create and send other FAL internal primitives to either the FSPM or the DMPM, based on the AREP and primitive types;
- to accept FAL internal primitives from the DMPM and send them to the FSPM as a form of FAL internal primitives;
- if the primitives are for the Establish or Abort service, it shall try to establish or release the specified AR.

The DMPM describes the mapping between the FAL and the DLL. It is common to all the AREP types and does not have any state changes. The DMPM is responsible for the following activities:

- h) to accept FAL internal primitives from the ARPM, prepare DLL service primitives, and send them to the DLL;
- i) to receive DLL indication or confirmation primitives from the DLL and send them to the ARPM in a form of FAL internal primitives.

9 AP-context state machines for client/server

There is no AP-Context State Machine in this Type of FAL.

10 FAL service protocol machine (FSPM) for client/server

10.1 General

FAS Service Protocol Machine is common to all the AREP types. Only applicable primitives are different among different AREP types. It has one state called "ACTIVE" as shown in Figure 8.

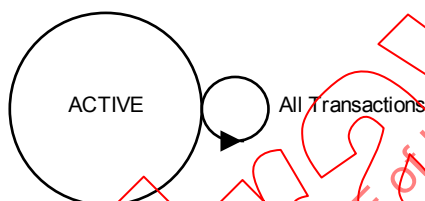


Figure 8 – State transition diagram of FSPM

10.2 FSPM state tables

Table 81 and Table 82 specify the FSPM protocol machine.

The invoke_ID is the transaction identifier object and it must be unique across all the transaction identifiers still pending on the connection involved.

The transaction object is instantiated for the duration of the service invocation, and in general it is used to couple requests and confirmations for confirmed services, and destroyed afterward. It also acts as a moderator. If a client can only instantiate one transaction object at a time then, when invoking a service, it is not necessary to dynamically create a transaction object and exchange it with lower layers, since the reason of existence of a transaction object is to properly couple requests with confirmations, which is automatic for these clients. In these situations a single static transaction object effectively acts like a client token, which is either taken or available, and only of interest to the client. For these clients there will be only one pending request at a time, and the invoke_ID as used in the state tables may be considered empty in the request and always matching in the confirmation.

For unconfirmed services, transaction objects are disposed-of after an amount of time that is device and connection specific.

Table 81 – FSPM state table – client transactions

#	Current state	Event or condition => action	Next state
S1	ACTIVE	ReadDiscretes.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S2	ACTIVE	ReadCoils.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S3	ACTIVE	WriteSingleCoil.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S4	ACTIVE	WriteMultipleCoils.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S5	ACTIVE	BroadcastWriteSingleCoil.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S6	ACTIVE	BroadcastWriteMultipleCoils.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S7	ACTIVE	ReadInputRegisters.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S8	ACTIVE	ReadHoldingRegisters.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S9	ACTIVE	WriteSingleHoldingRegister.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S10	ACTIVE	WriteMultipleHoldingRegisters.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE

#	Current state	Event or condition => action	Next state
S11	ACTIVE	MaskWriteHoldingRegister.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S12	ACTIVE	Read/WriteHoldingRegisters.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S13	ACTIVE	ReadFIFO.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S14	ACTIVE	BroadcastWriteSingleHoldingRegister.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S15	ACTIVE	BroadcastWriteMultipleHoldingRegisters.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S16	ACTIVE	ReadFileRecord.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S17	ACTIVE	WriteFileRecord.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S18	ACTIVE	ReadDeviceIdentification.req => Transaction.req { remote_address := AREP_ID, invoke_ID := unique_per_connection_ID, user_data := alpdu }	ACTIVE
S19	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => ReadDiscretes.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S20	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => ReadCoils.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE

#	Current state	Event or condition => action	Next state
S21	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => WriteSingleCoil.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S22	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => WriteMultipleCoils.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S23	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => ReadInputRegisters.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S24	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => ReadHoldingRegisters.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S25	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => WriteSingleHoldingRegister.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S26	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => WriteMultipleHoldingRegister.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S27	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => MaskWriteHoldingRegister.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S28	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => Read/WriteHoldingRegisters.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S29	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => ReadFIFO.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE

#	Current state	Event or condition => action	Next state
S30	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => ReadFileRecord.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S31	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => WriteFileRecord.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S32	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "True" => ReadDeviceIdentification.cnf(-) { AreplD := remote_address, ExceptionCode := data }	ACTIVE
S33	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => ReadDiscretes.cnf(+) { AreplD := remote_address, ResponseData := data }	ACTIVE
S34	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => ReadCoils.cnf(+) { AreplD := remote_address, ResponseData := data }	ACTIVE
S35	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => WriteSingleCoil.cnf(+) { AreplD := remote_address, ResponseData := data }	ACTIVE
S36	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => WriteMultipleCoils.cnf(+) { AreplD := remote_address, ResponseData := data }	ACTIVE
S37	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => ReadInputRegisters.cnf(+) { AreplD := remote_address, ResponseData := data }	ACTIVE
S38	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => ReadHoldingRegisters.cnf(+) { AreplD := remote_address, ResponseData := data }	ACTIVE

#	Current state	Event or condition => action	Next state
S39	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => WriteSingleHoldingRegister.cnf(+) { AreplD := remote_address, ResponseData := data } }	ACTIVE
S40	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => WriteMultipleHoldingRegister.cnf(+) { AreplD := remote_address, ResponseData := data } }	ACTIVE
S41	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => MaskWriteHoldingRegister.cnf(+) { AreplD := remote_address, ResponseData := data } }	ACTIVE
S42	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => Read/WriteHoldingRegisters.cnf(+) { AreplD := remote_address, ResponseData := data } }	ACTIVE
S43	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => ReadFIFO.cnf(+) { AreplD := remote_address, ResponseData := data } }	ACTIVE
S44	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => ReadFileRecord.cnf(+) { AreplD := remote_address, ResponseData := data } }	ACTIVE
S45	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => WriteFileRecord.cnf(+) { AreplD := remote_address, ResponseData := data } }	ACTIVE
S46	ACTIVE	Transaction.cnf && MatchInvokeID(Invoke_ID) && HighBit(code) == "False" => ReadDeviceIdentification.cnf(+) { AreplD := remote_address, ResponseData := data } }	ACTIVE

Table 82 – FSPM state table – server transactions

#	Current state	Event or condition => action	Next state
R1	ACTIVE	Transaction.ind => al_service.ind { Invoke_Id := invoke_id, Arep_Id := arep_id, alpdu := user_data }	ACTIVE
R2	ACTIVE	Transaction.rsp => al_service.rsp { Invoke_Id := invoke_id, Arep_Id := arep_id, alpdu := user_data }	ACTIVE
NOTE al_service includes all AL services. The appropriate indication or response primitive is used depending upon the type of service.			

10.3 Functions used by FSPM

Table 83 and Table 84 define the functions used by the FSPM

Table 83 – Function MatchInvokeID()

Name	MatchInvokeID	Used in	FSPM
Input		Output	
Invoke_ID		True False	
Function	Matches requests with responses, and upon successful match disposed of the transaction object.		

Table 84 – Function HighBit()

Name	HighBit	Used in	FSPM
Input		Output	
Code		True False	
Function	Checks the code field to see if it is an exception (MSB of the octet is high).		

10.4 Parameters of FSPM/ARPM primitives

The parameters used with the primitives exchanged between the FSPM and the ARPM are described in Table 85.

Table 85 – Parameters used with primitives exchanged between FSPM and ARPM

Parameter name	Description
arep_id	This parameter is used to unanimously identify an instance of the AREP that has issued a primitive. A means for such identification is not specified by this specification.
user_data	This parameter conveys FAS-User data.
invoke_ID	This parameter conveys the value used to match requests and responses.
code	code field of the APDU.

10.5 Client/server server transactions

10.5.1 General

The server transactions are detailed in Figure 9.

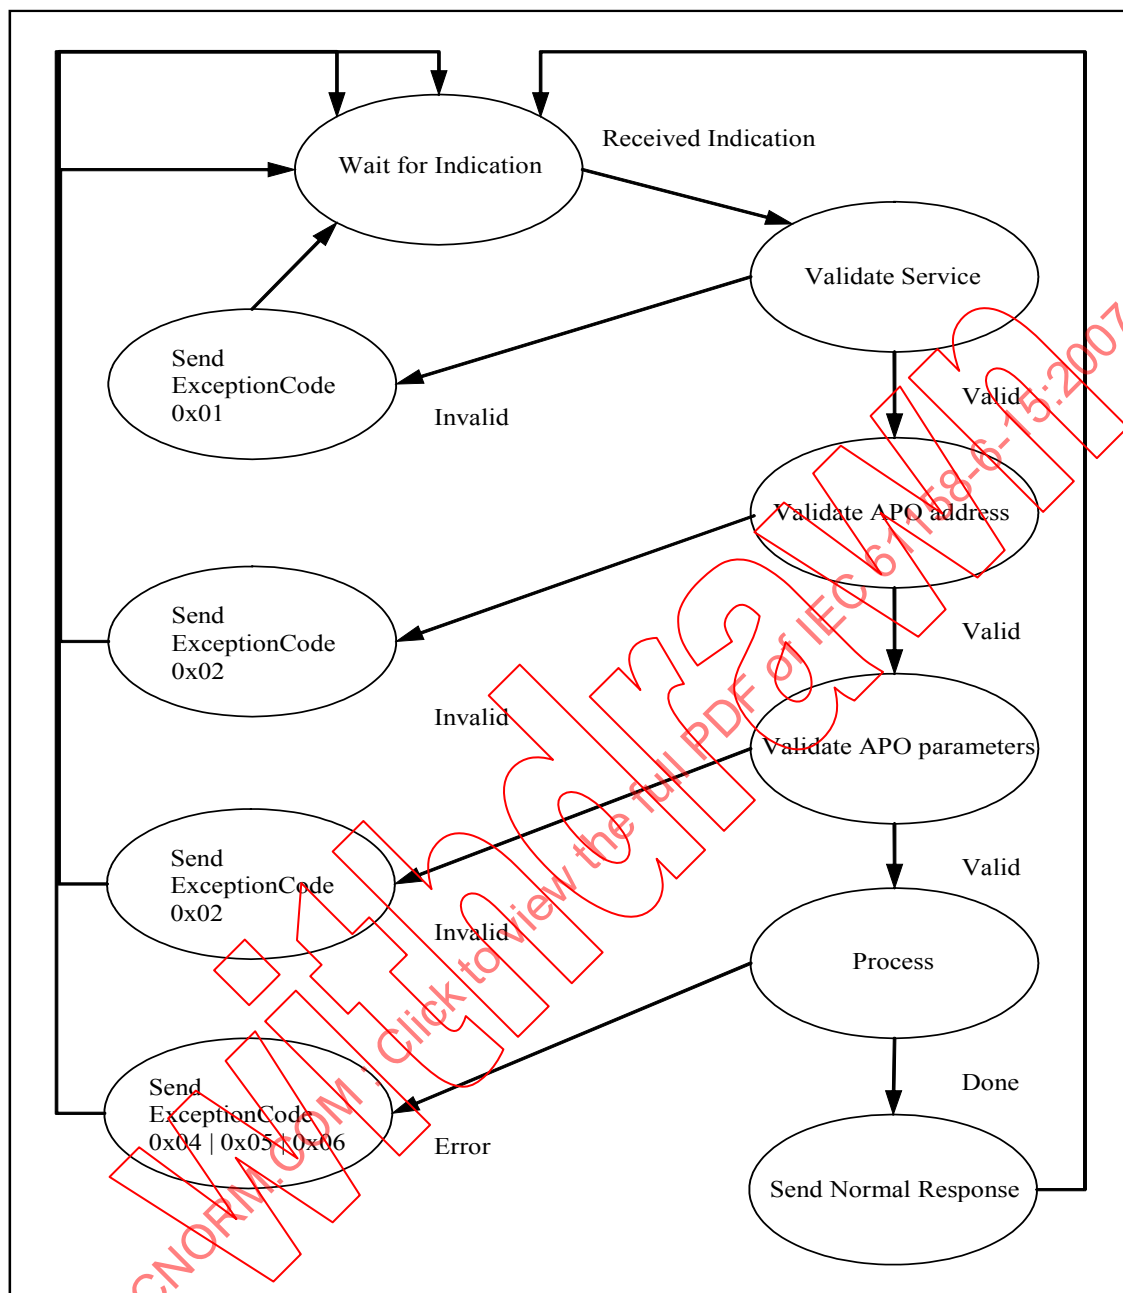


Figure 9 – Client/server server transactions

11 Application relationship protocol machines (ARPMs) for client/server

11.1 Application relationship protocol machines (ARPMs)

11.1.1 AR protocol machine (ARPM) for client AREP

11.1.1.1 Client ARPM states

The states of the Client ARPM and their descriptions are shown in Table 86 and Figure 10.

Table 86 – Client ARPM states

IDLE	The AREP is not active.
WAIT for CONFIRM	The AREP has sent a request PDU to a Server and is waiting for a confirmation from the Server.

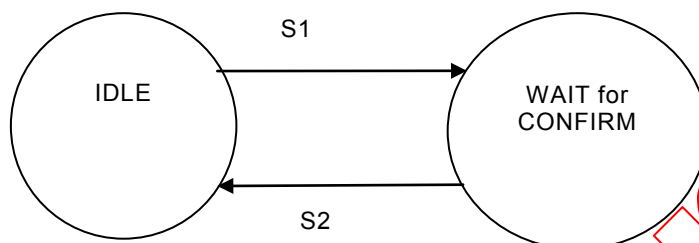


Figure 10 – State transition diagram of the client ARPM

11.1.1.2 Client ARPM state table

Table 87 specifies the Client ARPM state machine.

Table 87 – Client ARPM state table

#	Current state	Event or condition => action	Next state
S1	IDLE	Transaction.req => DTC_req { called_address := remote_address, dlsdu := user_data }	WAIT for CONFIRM
S2	WAIT for CONFIRM	DTC_cnf => Transaction.cnf { remote_address := responding_address, user_data := dlsdu }	IDLE

NOTE DTC is Data Transmission Confirmed.

11.1.2 AR protocol machine (ARPM) for server AREP

11.1.2.1 Server ARPM states

The states of the Server ARPM and their descriptions are shown in Table 88 and Figure 11.

Table 88 – Server ARPM states

IDLE	The AREP is not active.
WAIT for RESPONSE	The AREP has received a PDU from DLL, has sent the corresponding indication to the AL user and is waiting for a response from the AL user.

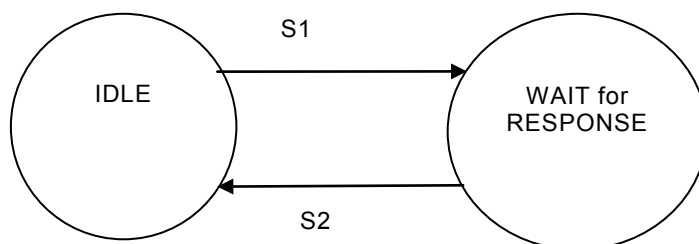


Figure 11 – State transition diagram of the server ARPM

11.1.2.2 Server ARPM state table

Table 89 specifies the Server ARPM state machine.

Table 89 – Server ARPM state table

#	Current state	Event or condition => action	Next state
S1	IDLE	DTC_ind => Transaction.ind { user_data := dlsdu }	WAIT for RESPONSE
S2	WAIT for RESPONSE	Transaction.rsp => DTC_rsp { dlsdu := user_data }	IDLE

11.2 AREP state machine primitive definitions

11.2.1 Primitives exchanged between DMPM and ARPM

The primitives exchanged between the DMPM and the ARPM are specified in Table 90 and Table 91.

Table 90 – Primitives issued from ARPM to DMPM

Primitive names	Source	Associated parameters	Functions
DTC_req	ARPM	called_address, dlsdu	This primitive is used to request the DMPM to transfer an ALPDU to a Slave deice.
DTC_rsp	ARPM	dlsdu	This primitive is used to request the DMPM to transfer an ALPDU to a Master deice.

Table 91 – Primitives issued by DMPM to ARPM

Primitive names	Source	Associated parameters	Functions
DTC_ind	DMPM	dlsdu	This primitive is used to pass an ALPDU received as a Data Like Layer service data unit to the Server ARPM.
DTC_cnf	DMPM	responding_address, dlsdu	This primitive is used to convey an ALPDU received from the Slave device.

11.2.2 Parameters of ARPM/DMPM primitives

The parameters used with the primitives exchanged between the ARPM and the DMPM are described in Table 92.

Table 92 – Parameters used with primitives exchanged between ARPM and DMPM

Parameter name	Description
called_address	This parameter conveys the value of the address parameter supplied with the Data Like Layer primitive.
responding_address	This parameter conveys the value of the address parameter of the received primitive.
dlsdu	This parameter conveys the value of the data to be conveyed or received by data-link layer.

11.3 AREP state machine functions

ARPM does not use any functions.

12 DLL mapping protocol machine (DMPM) for client/server

12.1 AREP mapping to data link layer

12.1.1 General

This subclause describes the mapping of the AL to the Fieldbus data-link layer. It does not redefine the DLSAP attributes or DLME attributes that are defined in the data-link layer specification; rather, it defines how they are used by each of the AR classes. A means to configure and monitor the values of these attributes is provided by Network Management. The following class definitions describe the DLSAP attributes and the DLME attributes required to support each of the AREP classes.

NOTE Undefined attributes use the same definitions as those previously defined.

12.1.2 DLL mapping of client AREP class

12.1.2.1 Client AREP class formal model

The DLL Mapping attributes and their permitted values and the DLL services used with the Client AREP class are defined in this subclause.

CLASS: Client

PARENT CLASS: Top

ATTRIBUTES:

1. (m) Attribute: RemoteAddress

DLL SERVICES:

1. (m) OpsService: Transmit_request
2. (m) OpsService: Transmit_confirm

12.1.2.2 Attributes

RemoteAddress

This attribute specifies the remote address to which request APDUs are sent, or from which confirm APDUs are received.

12.1.2.2.1 Transmit_request

This service is used in the Client device to transfer an APDU to the remote Server DLL user.

12.1.2.2.2 Receive_confirm

The DLL uses this service to receive the response APDU from a remote Server DLL user.

12.1.3 DLL mapping of server AREP class

12.1.3.1 Server AREP class formal model

The DLL Mapping attributes and their permitted values and the DLL services used with the Server AREP class are defined in this subclause.

CLASS: Server

PARENT CLASS: Top

ATTRIBUTES:

1. (m) Attribute: Address

DLL SERVICES:

1. (m) OpsService: Transmit_indication
2. (m) OpsService: Transmit_response

12.1.3.2 Attributes

Address

This attribute specifies the address that the Slave device uses to receive and send DLPDU.

12.1.3.3 DLL services

12.1.3.3.1 Receive_indication

The DLL uses this service to transfer the indication APDU from a remote Client DLL user.

12.1.3.3.2 Transmit_response

This service is used in the Server device to transfer an APDU to the remote Client DLL user.

12.2 DMPM states

The defined states and their descriptions of the DMPM are shown in Table 93 and Figure 12.

Table 93 – DMPM state descriptions

State Name	Description
ACTIVE	The DMPM in the ACTIVE state is ready to transmit or receive primitives to or from the Data Like Layer and the ARPM.

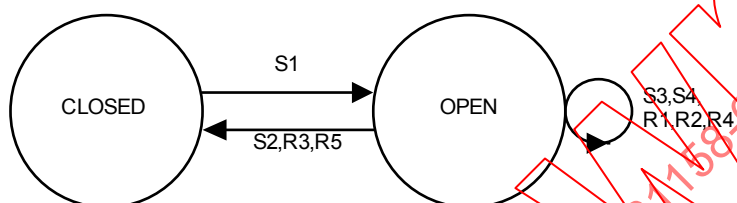


Figure 12 – State transition diagram of DMPM

12.3 DMPM states

Table 94 and Table 95 specify the DMPM state machine.

Table 94 – DMPM state table – client transactions

#	Current state	Event or condition => action	Next state
S1	ACTIVE	DTC_req => Transmit.request { address := called_address, dl_dis_user_data := dl_sdu }	ACTIVE
S1	ACTIVE	Transmit.confirm => DTC_conf { responding_address := address, dl_sdu := dl_dis_user_data }	ACTIVE

Table 95 – DMPM state table – server transactions

#	Current state	Event or condition => action	Next state
S1	ACTIVE	DTC_rsp => Transmit.response { dl_dis_user_data := dl_sdu }	ACTIVE
S1	ACTIVE	Transmit.indication => DTC_ind { dl_sdu := dl_dis_user_data }	ACTIVE

12.4 Primitives exchanged between data link layer and DMPM

The primitives exchanged between the data-link layer and the DMPM are specified in Table 96.

Table 96 – Primitives exchanged between data-link layer and DMPM

Primitive names	Source	Associated parameters
Transmit. indication	data-link layer	dl_dls_user_data
Transmit. confirm	data-link layer	address, dl_dls_user_data
Transmit.request	DMPM	address, dl_dls_user_data
Transmit. response	DMPM	dl_dls_user_data

12.4.1 Functions used by DMPM

DMPM does not use any functions.

12.5 Client/server on TCP/IP

12.5.1 General

This subclause describes the client/server encapsulation when the DLL is TCP/IP.

12.5.2 TCP/IP encapsulation

The APDU for client/server is as described in this standard in 5.2, and illustrated in Figure 13.




Figure 13 – APDU format

TCP/IP encapsulation is obtained by adding a header to the APDU. The parameters of the header are described in Table 97.

Table 97 – Encapsulation parameters for client/server on TCP/IP

Parameter	Length	Description
Transaction Identifier	2 octets	Invoke_ID, allows pairing of request/response
Protocol Identifier	2 octets	0 for client/server
Length	2 octets	number of octets in APDU

The PDU carried as payload by TCP/IP becomes the one described in Figure 14.

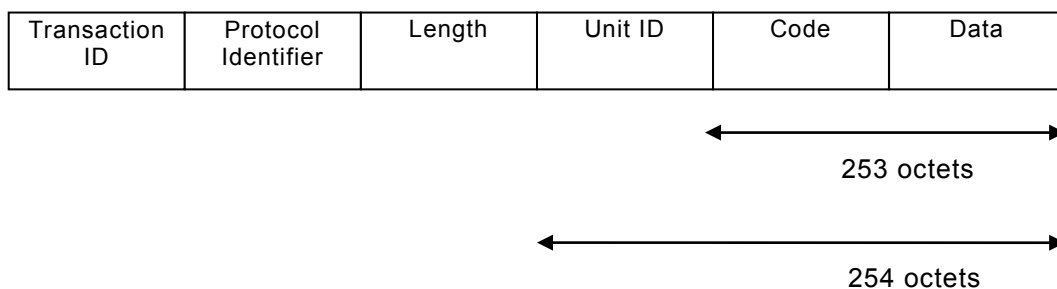


Figure 14 – TCP/IP PDU format

The transaction identifier is the same as the Invoke ID, and it must be unique across all the identifiers still pending on the connection involved.

12.5.3 Assigned port

client/server communicates using port 502, assigned by IANA.

13 AP-Context state machines for publish/subscribe

There is no AP-Context State Machine in this Type of FAL.

14 Protocol machines for publish/subscribe

14.1 General

publish/subscribe communicates using the following characteristics:

- the transport has a generalized notion of a unicast address (shall fit within 16 octets);
- the transport has a generalized notion of a port (shall fit within 4 octets), e.g. could be a UDP port, an offset in a shared memory segment, etc.;
- the transport can send a datagram (uninterpreted sequence of octets) to a specific address/port;
- the transport can receive a datagram at a specific address/port;
- the transport will drop messages if incomplete or corrupted during transfer (i.e. publish/subscribe assumes messages are complete and not corrupted);
- the transport provides a means to deduce the size of the received message.

Publish/subscribe exchanges messages composed of service requests as detailed in 7.2.

The Figure 15 illustrates the receiver state machine, according to the APDU interpretation described in 7.4.

There is only one APDU, composed of all the requests, and it is sent as an unconfirmed service.

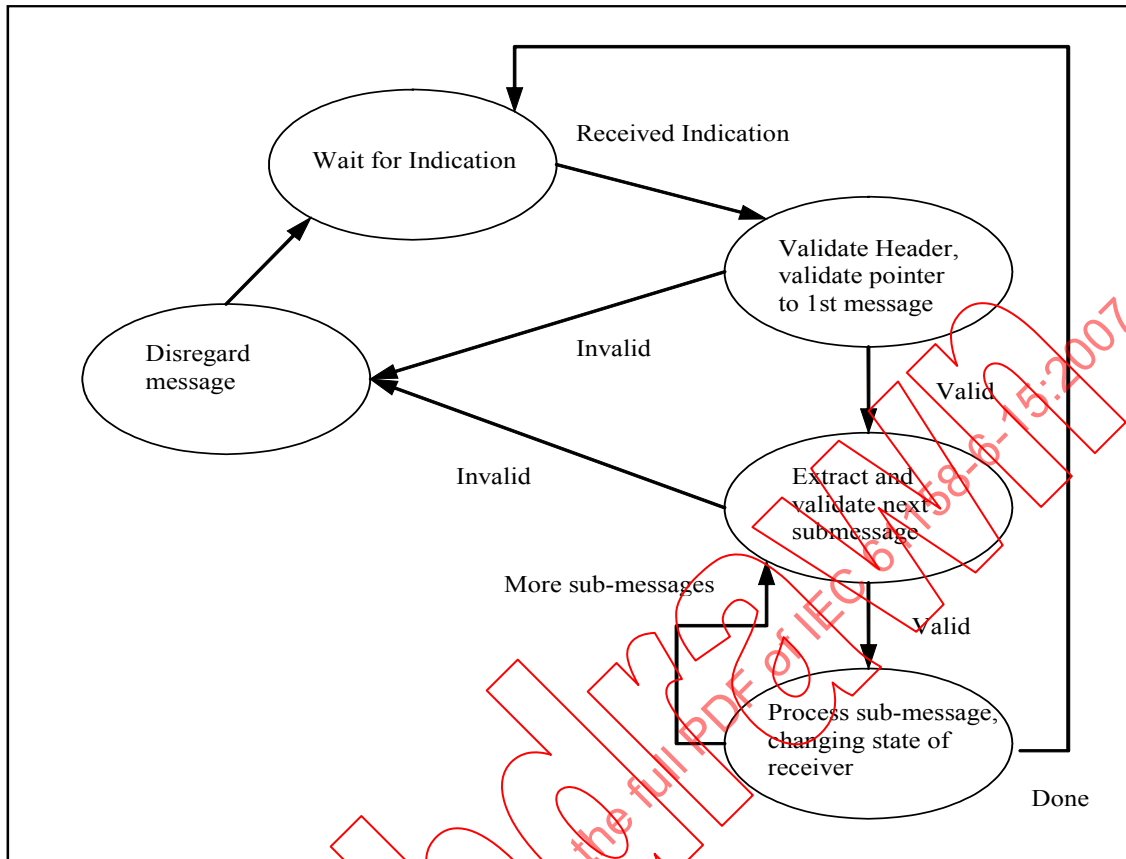


Figure 15 – Publish/subscribe receiver

The general extraction and validation process for a sub-message is according to 7.4.2 and it is repeated here for convenience:

- 1) the last two octets of a sub-message header, the *octetsToNextHeader* field, contains the number of octets to the next sub-message. If this field is invalid, the rest of the message is invalid;
- 2) the first octet of a sub-message header is the *sub-messageID*. A sub-message with an unknown ID must be ignored and parsing must continue with the next sub-message. Concretely: an implementation of publish/subscribe 1.0 must ignore any sub-messages with IDs that are outside of the sub-messageID list used by version 1.0. IDs in the vendor-specific range coming from a *vendorID* that is unknown must be ignored and parsing must continue with the next sub-message;
- 3) the second octet of a sub-message header contains flags; unknown flags should be skipped. An implementation of publish/subscribe 1.0 should skip all flags that are marked as 'X' (unused) in the protocol;
- 4) a valid *octetsToNextHeader* field must *always* be used to find the next sub-message, even for sub-messages with unknown IDs.

In addition to the general rules, there are sub-message specific rules. A known but invalid sub-message invalidates the rest of the message. 7.5.1 through 7.5.10.1 each describe a known sub-message and when it should be considered invalid.

The processing of a sub-message has the following effects:

- it can change the state of the receiver; this state influences how the following sub-messages in the message are interpreted. 7.5.1 through 7.5.10.1 show how the state changes for each sub-message. In this version of the protocol, only the Header and the sub-messages INFO_SRC, INFO_REPLY and INFO_TS change the state of the receiver;
- the sub-message, interpreted within the message, has a logical interpretation: it encodes one of the five basic publish/subscribe services: ACK, GAP, HEARTBEAT, ISSUE or VAR, beside the logistic services. The logical interpretation is also described in 7.5.1 through 7.5.10.1.

14.2 Publish/subscribe on UDP

14.2.1 General

14.2.1.1 publish/subscribe and the UDP payload

When publish/subscribe is used over UDP/IP, a message is the contents (payload) of exactly one UDP/IP Datagram.

14.2.1.2 UDP/IP Destinations

A UDP/IP destination consists of an IPAddress and a Port. This document uses notation such as "12.44.123.92:1024" or "225.0.1.2:6701" to refer to such a destination. The IP address can be a unicast or multicast address.

14.2.1.3 Note on relative addresses

The publish/subscribe protocol often sends IP addresses to a sender of messages, so that the sender knows where to send future messages. These destinations are always interpreted locally by the sender of UDP datagrams. Certain IP addresses, such as "127.0.0.1" have only relative meaning (i.e. they do not refer to a unique host).

14.2.2 Well known ports

At the network level, publish/subscribe uses the following three well-known ports:

$\text{wellknownManagerPort} = \text{portBaseNumber} + 10 * \text{portGroupNumber}$

$\text{wellknownUsertrafficMulticastPort} = 1 + \text{portBaseNumber} + 10 * \text{portGroupNumber}$

$\text{wellknownMetattrafficMulticastPort} = 2 + \text{portBaseNumber} + 10 * \text{portGroupNumber}$

Within a network, all applications need to use the same *portBaseNumber*. Applications that want to communicate with each other use the same *portGroupNumber*; applications that need to be isolated from each other use a different *portGroupNumber*.

Each application needs to be configured with the correct *portBaseNumber* and *portGroupNumber*.

Except for the rules stated above, publish/subscribe does not define which *portBaseNumber* and *portGroupNumber* are used nor how the applications participating in a network obtain this information, but the base number 7400 should be the one used, since the ports 7400, 7401 and 7402 are the one assigned by IANA for publish/subscribe usage.

Bibliography

IEC 60559, *Binary floating-point arithmetic for microprocessor systems*

IEC/TR 61158-1 (Ed.2.0), *Industrial communication networks – Fieldbus specifications – Part 1: Overview and guidance for the IEC 61158 and IEC 61784 series*

IEC 61158-3-15, *Industrial communication networks – Fieldbus specifications – Part 3-15: Data-link layer service definition – Type 15 elements*

IEC 61158-4-15, *Industrial communication networks – Fieldbus specifications – Part 4-15: Data-link layer protocol specification – Type 15 elements*

IEC 61784-1 (Ed.2.0), *Industrial communication networks – Profiles – Part 1: Fieldbus profiles*

IEC 61784-2, *Industrial communication networks – Profiles – Part 2: Additional fieldbus profiles for real-time networks based on ISO/IEC 8802-3*

ISO/IEC 7498-3, *Information technology – Open Systems Interconnection – Basic Reference Model – Part 3: Naming and addressing*

ISO/IEC 8825, *Information technology – Open Systems Interconnection – Specification of Basic Encoding Rules for Abstract Syntax Notation One (ASN.1)*

IECNORM.COM : Click to view the full PDF of IEC 61158-6-15:2007

IECNORM.COM : Click to view the full PDF of IEC 61158-6-15:2007

SOMMAIRE

AVANT-PROPOS	106
INTRODUCTION.....	108
1 Domaine d'application	109
1.1 Généralités.....	109
1.2 Spécifications.....	109
1.3 Conformité	110
2 Références normatives.....	110
3 Termes et définitions, abréviations, symboles et conventions	110
3.1 Termes et définitions.....	110
3.2 Abréviations et symboles.....	117
3.3 Conventions	118
3.4 Conventions utilisées dans les diagrammes d'états	121
4 Syntaxe abstraite pour le client/serveur	122
5 Syntaxe de transfert pour le client/serveur.....	122
5.1 Généralités.....	122
5.2 Structure commune des APDU	122
5.3 Structures d'APDU spécifiques aux services	127
5.4 Représentation des données "sur le fil"	154
6 Syntaxe abstraite du mode fournisseur/abonné.....	154
7 Syntaxe de transfert du mode fournisseur/abonné	155
7.1 Généralités.....	155
7.2 Structure d'APDU	155
7.3 Structure des sous-messages.....	156
7.4 Interprétation des APDU	158
7.5 Structures d'APDU spécifiques aux services	160
7.6 Représentation commune des données pour le fournisseur/abonné.....	184
8 Structure des diagrammes d'états de protocole FAL	189
9 Diagrammes d'états d'AP-context pour le client/serveur	191
10 Machine de protocole de service FAL (FSPM) pour le client/serveur.....	191
10.1 Généralités.....	191
10.2 Tableaux d'état de la FSPM	192
10.3 Fonctions utilisées par la FSPM	198
10.4 Paramètres des primitives FSPM/ARPM	198
10.5 Transactions du serveur client/serveur	199
11 Machines de protocole de relation d'application (ARPM) pour le client/serveur	200
11.1 Machines de protocole de relation d'application (ARPM)	200
11.2 Définitions des primitives du diagramme d'états d'AREP	202
11.3 Fonctions du diagramme d'états d'AREP	203
12 Machine de protocole de mise en correspondance DLL (DMPM) pour le client/serveur.....	203
12.1 Mise en correspondance de l'AREP avec la couche liaison de données	203
12.2 États de la DMPM	204
12.3 États DMPM	204
12.4 Primitives échangées entre la couche liaison de données et la DMPM	205
12.5 Client/serveur sur TCP/IP	205

13 Diagrammes d'états d'AP-context pour le mode fournisseur/abonné	207
14 Machines de protocole du mode fournisseur/abonné	207
14.1 Généralités.....	207
14.2 Fournisseur/abonné sur UDP	209
Bibliographie.....	211
 Figure 1 – Format d'APDU	122
Figure 2 – Demande de service confirmé du client au serveur	124
Figure 3 – Réponse normale du serveur au client	124
Figure 4 – Réponse d'exception du serveur au client	125
Figure 5 – Demande de service non confirmé du client au serveur.....	127
Figure 6 – APDU du modèle fournisseur/abonné.....	155
Figure 7 – Relations entre les machines de protocole et les couches adjacentes	190
Figure 8 – Schéma de transition d'état de la FSPM.....	191
Figure 9 – Transactions du serveur client/serveur.....	200
Figure 10 – Schéma de transition d'état de l'ARPM cliente	200
Figure 11 – Schéma de transition d'état de l'ARPM serveur.....	201
Figure 12 – Schéma de transition d'état de la DMPM.....	204
Figure 13 – Format d'APDU	206
Figure 14 – Format de PDU TCP/IP	206
Figure 15 – Destinataire fournisseur/abonné.....	208
 Tableau 1 – Conventions utilisées pour les diagrammes d'états	121
Tableau 2 – Code d'exception.....	126
Tableau 3 – Demande Lire discrets.....	127
Tableau 4 – Réponse à Lire discrets.....	127
Tableau 5 – Demande Lire bobines.....	128
Tableau 6 – Réponse à Lire bobines.....	128
Tableau 7 – Demande Écrire bobine individuelle.....	129
Tableau 8 – Réponse à Écrire bobine individuelle.....	130
Tableau 9 – Demande Écrire plusieurs bobines	131
Tableau 10 – Réponse à Écrire plusieurs bobines.....	131
Tableau 11 – Demande Écrire en diffusion bobine individuelle.....	132
Tableau 12 – Demande Écrire en diffusion plusieurs bobines	133
Tableau 13 – Demande Lire registres d'entrée.....	133
Tableau 14 – Réponse à Lire registres d'entrée.....	134
Tableau 15 – Demande Lire registres de maintien	134
Tableau 16 – Réponse à Lire registres de maintien.....	135
Tableau 17 – Demande Écrire registre de maintien individuel	135
Tableau 18 – Réponse à Écrire registre de maintien individuel	136
Tableau 19 – Demande Écrire plusieurs registres de maintien	137
Tableau 20 – Réponse à Écrire plusieurs registres de maintien	137
Tableau 21 – Demande Écrire avec masque registre de maintien	138

Tableau 22 – Demande Écrire avec masque registre de maintien	138
Tableau 23 – Demande Lire/écrire plusieurs registres de maintien.....	140
Tableau 24 – Réponse à Lire/écrire plusieurs registres de maintien.....	140
Tableau 25 – Demande Lire FIFO	141
Tableau 26 – Réponse à Lire FIFO	141
Tableau 27 – Demande Écrire en diffusion registre de maintien individuel	142
Tableau 28 – Demande Écrire en diffusion plusieurs registres de maintien	143
Tableau 29 – Demande Lire enregistrement de fichier	144
Tableau 30 – Réponse à Lire enregistrement de fichier	146
Tableau 31 – Demande Écrire enregistrement de fichier	147
Tableau 32 – Réponse à Écrire enregistrement de fichier	149
Tableau 33 – Demande Lire identification de dispositif.....	150
Tableau 34 – Catégories d'identification de dispositif.....	151
Tableau 35 – Code d'ID de lecture de dispositif	151
Tableau 36 – Réponse à Lire identification de dispositif.....	152
Tableau 37 – Niveau de conformité.....	153
Tableau 38 – Objets connus demandés et renvoyés	154
Tableau 39 – Structure de l'APDU	156
Tableau 40 – Structure des sous-messages.....	157
Tableau 41 – Codage des identificateurs de service fournisseur/abonné.....	157
Tableau 42 – Attributs modifiés de façon modale et affectant les interprétations des APDU	159
Tableau 43 – Demande Question.....	161
Tableau 44 – Indicateurs de la demande question	162
Tableau 45 – Signification des indicateurs de la demande question	162
Tableau 46 – Interprétation de la question	163
Tableau 47 – Demande Pulsation.....	164
Tableau 48 – Indicateurs de la demande pulsation.....	164
Tableau 49 – Signification des indicateurs de la demande pulsation	165
Tableau 50 – Interprétation de la pulsation	166
Tableau 51 – Demande VAR.....	167
Tableau 52 – Indicateurs de la demande VAR.....	168
Tableau 53 – Signification des indicateurs de la demande VAR	168
Tableau 54 – Interprétation du VAR	169
Tableau 55 – Demande GAP.....	170
Tableau 56 – Indicateurs de la demande GAP	170
Tableau 57 – Signification des indicateurs de la demande GAP	171
Tableau 58 – Interprétation du GAP.....	171
Tableau 59 – Demande ACK.....	172
Tableau 60 – Indicateurs de la demande ACK.....	173
Tableau 61 – Signification des indicateurs de la demande ACK	173
Tableau 62 – Interprétation de l'ACK	174
Tableau 63 – Demande En-tête	175

Tableau 64 – Changement dans l'état du destinataire	175
Tableau 65 – Demande INFO_DST	176
Tableau 66 – Indicateurs de la demande INFO_DST	177
Tableau 67 – Signification des indicateurs de la demande INFO_DST	177
Tableau 68 – Demande INFO_REPLY	178
Tableau 69 – Indicateurs de la demande INFO_REPLY	179
Tableau 70 – Signification des indicateurs de la demande INFO_REPLY	179
Tableau 71 – Demande INFO_SRC	180
Tableau 72 – Indicateurs de la demande INFO_SRC	181
Tableau 73 – Signification des indicateurs de la demande INFO_SRC	181
Tableau 74 – Demande INFO_TS	182
Tableau 75 – Indicateurs de la demande INFO_TS	182
Tableau 76 – Signification des indicateurs de la demande INFO_TS	182
Tableau 77 – Demande PAD	183
Tableau 78 – Indicateurs de la demande PAD	183
Tableau 79 – Signification des indicateurs de la demande PAD	184
Tableau 80 – Sémantique	185
Tableau 81 – Tableau d'états FSPM – transactions clientes	193
Tableau 82 – Tableau d'états FSPM – transactions serveur	198
Tableau 83 – Fonction MatchInvokeID()	198
Tableau 84 – Fonction HighBit()	198
Tableau 85 – Paramètres utilisés dans les primitives échangées entre la FSPM et l'ARPM	198
Tableau 86 – États de l'ARPM cliente	200
Tableau 87 – Tableau d'états de l'ARPM cliente	201
Tableau 88 – États de l'ARPM serveur	201
Tableau 89 – Tableau d'états de l'ARPM serveur	202
Tableau 90 – Primitives émises entre l'ARPM et la DMPM	202
Tableau 91 – Primitives émises par la DMPM à l'ARPM	202
Tableau 92 – Paramètres utilisés dans les primitives échangées entre l'ARPM et la DMPM	202
Tableau 93 – Description d'état de la DMPM	204
Tableau 94 – Tableau d'états DMPM – transactions clientes	205
Tableau 95 – Tableau d'états DMPM – transactions serveur	205
Tableau 96 – Primitives échangées entre la couche liaison de données et la DMPM	205
Tableau 97 – Paramètres d'encapsulation du client/serveur sur TCP/IP	206

COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

**RÉSEAUX DE COMMUNICATION INDUSTRIELS –
SPÉCIFICATIONS DES BUS DE TERRAIN –****Partie 6-15: Spécification des protocoles des couches d'application –
Éléments de Type 15**

AVANT-PROPOS

- 1) La Commission Électrotechnique Internationale (CEI) est une organisation mondiale de normalisation composée de l'ensemble des comités électrotechniques nationaux (Comités nationaux de la CEI). La CEI a pour objet de favoriser la coopération internationale pour toutes les questions de normalisation dans les domaines de l'électricité et de l'électronique. A cet effet, la CEI – entre autres activités – publie des Normes internationales, des Spécifications techniques, des Rapports techniques, des Spécifications accessibles au public (PAS) et des Guides (ci-après dénommés "Publication(s) de la CEI"). Leur élaboration est confiée à des comités d'études, aux travaux desquels tout Comité national intéressé par le sujet traité peut participer. Les organisations internationales, gouvernementales et non gouvernementales, en liaison avec la CEI, participent également aux travaux. La CEI collabore étroitement avec l'Organisation Internationale de Normalisation (ISO), selon des conditions fixées par accord entre les deux organisations.
- 2) Les décisions ou accords officiels de la CEI concernant les questions techniques représentent, dans la mesure du possible, un accord international sur les sujets étudiés, étant donné que les Comités nationaux de la CEI intéressés sont représentés dans chaque comité d'études.
- 3) Les Publications de la CEI se présentent sous la forme de recommandations internationales et sont agréées comme telles par les Comités nationaux de la CEI. Tous les efforts raisonnables sont entrepris afin que la CEI s'assure de l'exactitude du contenu technique de ses publications; la CEI ne peut pas être tenue responsable de l'éventuelle mauvaise utilisation ou interprétation qui en est faite par un quelconque utilisateur final.
- 4) Dans le but d'encourager l'uniformité internationale, les Comités nationaux de la CEI s'engagent, dans toute la mesure possible, à appliquer de façon transparente les Publications de la CEI dans leurs publications nationales et régionales. Toutes divergences entre toutes Publications de la CEI et toutes publications nationales ou régionales correspondantes doivent être indiquées en termes clairs dans ces dernières.
- 5) La CEI n'a prévu aucune procédure de marquage valant indication d'approbation et n'engage pas sa responsabilité pour les équipements déclarés conformes à une de ses Publications.
- 6) Il convient que tous les utilisateurs s'assurent d'être en possession de la dernière édition de cette publication.
- 7) Aucune responsabilité ne doit être imputée à la CEI, à ses administrateurs, employés, auxiliaires ou mandataires, y compris ses experts particuliers et les membres de ses comités d'études et des Comités nationaux de la CEI, pour tout préjudice causé en cas de dommages corporels et matériels, ou de tout autre dommage de quelque nature que ce soit, directe ou indirecte, ou pour supporter les coûts (y compris les frais de justice) et les dépenses découlant de la publication ou de l'utilisation de cette Publication de la CEI ou de toute autre Publication de la CEI, ou au crédit qui lui est accordé.
- 8) L'attention est attirée sur les références normatives citées dans cette publication. L'utilisation de publications référencées est obligatoire pour une application correcte de la présente publication.
- 9) L'attention est attirée sur le fait que certains des éléments de la présente Publication de la CEI peuvent faire l'objet de droits de propriété intellectuelle ou de droits analogues. La CEI ne saurait être tenue pour responsable de ne pas avoir identifié de tels droits de propriété et de ne pas avoir signalé leur existence.

NOTE L'utilisation de certains des types de protocoles associés est limitée par leurs détenteurs de droits de propriété intellectuelle. Dans tous les cas, l'engagement à limiter l'attribution des droits de propriété intellectuelle effectuée par les détenteurs de ces droits permet l'utilisation d'un type de protocole de couche liaison de données particulier avec des protocoles de couche physique et de couche application en combinaisons de types, comme spécifié explicitement dans la série CEI 61784. L'utilisation des différents types de protocoles dans d'autres combinaisons peut nécessiter la permission de la part de leurs détenteurs de droits de propriété intellectuelle respectifs.

La Norme Internationale CEI 61158-6-15 a été établie par le sous-comité 65C: Réseaux industriels, du comité d'études 65 de la CEI: Mesure, commande et automation dans les processus industriels.

Cette première édition et ses parties d'accompagnement de la sous-série CEI 61158-6 annulent et remplacent la CEI 61158-6:2003. La présente édition de cette partie constitue une addition technique. Cette partie et ses parties d'accompagnement pour le Type 15 annulent et remplacent également la CEI/PAS 62030, publiée en 2005.

Cette édition de la CEI 61158-6 inclut les modifications majeures suivantes par rapport à l'édition précédente:

- a) suppression du précédent bus de terrain de Type 6 en raison du manque d'adéquation au marché;
- b) ajout de nouveaux types de bus de terrain;
- c) division de la partie 6 de la troisième édition en parties multiples numérotées -6-2,-6-3, ...

La présente version bilingue (2014-12) correspond à la version anglaise monolingue publiée en 2007-12.

Le texte anglais de cette norme est issu des documents 65C/476/FDIS et 65C/487/RVD.

Le rapport de vote 65C/487/RVD donne toute information sur le vote ayant abouti à l'approbation de cette norme.

La version française de cette norme n'a pas été soumise au vote.

Cette publication a été rédigée selon les Directives ISO/CEI, Partie 2.

Le comité a décidé que le contenu de cette publication ne sera pas modifié avant la date de résultat de maintenance indiquée sur le site web de la CEI sous "<http://webstore.iec.ch>" dans les données relatives à la publication recherchée. A cette date, la publication sera

- reconduite;
- supprimée;
- remplacée par une édition révisée, ou
- amendée.

NOTE La révision de la présente norme sera synchronisée avec les autres parties de la série CEI 61158.

La liste de toutes les parties de la série CEI 61158, publiées sous le titre général *Réseaux de communication industriels – Spécifications des bus de terrain*, peut être consultée sur le site web de la CEI.

INTRODUCTION

La présente partie de la CEI 61158 constitue l'un des éléments d'une série rédigée pour faciliter l'interconnexion des composants des systèmes d'automatisation. Elle est liée à d'autres normes de l'ensemble défini par le modèle de référence de bus de terrain dit "à trois couches", décrit dans la CEI/TR 61158-1.

Le protocole d'application fournit le service d'application en utilisant les services disponibles dans la couche liaison de données ou toute autre couche immédiatement inférieure. Le principal objet de la présente norme est de fournir un ensemble de règles relatives à la communication, exprimées de façon à indiquer les procédures que doivent exécuter les entités d'application (AE) des pairs au moment de la communication. Ces règles relatives à la communication, conçues pour offrir une base utile au développement, jouent également différents rôles; elles peuvent:

- servir de guide aux concepteurs et aux personnes chargées de la mise en œuvre;
- être utilisées pour les essais et les approvisionnements en équipements;
- faire partie des contrats relatifs au droit d'admission des systèmes dans l'environnement des systèmes ouverts;
- apporter une meilleure compréhension des communications prioritaires dans l'OSI.

La présente norme concerne en particulier la communication et l'interfonctionnement des capteurs, des effecteurs et d'autres dispositifs d'automatisation. Lorsqu'ils utilisent la présente norme parallèlement à d'autres normes positionnées dans les modèles de référence de l'OSI ou des bus de terrain, des systèmes normalement incompatibles peuvent fonctionner ensemble quelle que soit la façon dont on les combine.

RÉSEAUX DE COMMUNICATION INDUSTRIELS – SPÉCIFICATIONS DES BUS DE TERRAIN –

Partie 6-15: Spécification des protocoles des couches d'application – Éléments de Type 15

1 Domaine d'application

1.1 Généralités

La couche application de bus de terrain (FAL - fieldbus application layer) donne aux programmes d'utilisateur le moyen d'accéder à l'environnement de communication des bus de terrain. À cet égard, la FAL peut être considérée comme une "fenêtre entre programmes d'application correspondants".

La présente norme fournit des éléments communs pour les communications de messagerie prioritaires et non prioritaires élémentaires entre les programmes d'application des environnements d'automatisation et le matériel spécifique au bus de terrain de type 15. On utilise le terme "prioritaire" pour traduire la présence d'une fenêtre temporelle, à l'intérieur de laquelle une ou plusieurs actions spécifiées doivent être terminées avec un niveau de certitude défini. Si les actions spécifiées ne sont pas terminées à l'intérieur de cette fenêtre temporelle, les applications qui ont demandé l'exécution de ces actions risquent de présenter des dysfonctionnements, accompagnés de risques pour les équipements, l'usine, voire les vies humaines.

La présente norme définit d'une manière abstraite le comportement visible de manière externe fourni par la couche application du bus de terrain de type 15 en termes

- a) de syntaxe abstraite définissant les unités de données de protocole de couche application transmises entre les entités d'application communicantes,
- b) de syntaxe de transfert définissant les unités de données de protocole de couche application transmises entre les entités d'application communicantes,
- c) de diagramme d'états de contexte d'application définissant le comportement de service d'application visible entre les entités d'application communicantes; et
- d) de diagramme d'états de relation d'application définissant le comportement de communication visible entre les entités d'application communicantes.

La présente norme a pour objet de définir le protocole servant à

- 1) définir la représentation point à point des primitives de service définies dans la CEI 61158-5-15, et
- 2) définir le comportement visible de manière externe associé à leur transfert.

La présente norme spécifie le protocole de la couche application de bus de terrain CEI type 15, en conformité au modèle de référence de base OSI (ISO/CEI 7498) et à la structure de couche application OSI (ISO/CEI 9545).

1.2 Spécifications

Le principal objectif de la présente norme est de spécifier la syntaxe et le comportement du protocole de couche application qui transmet les services de couche application définis dans la CEI 61158-5-15.

Un objectif secondaire est de fournir des chemins de migration aux protocoles de communication industriels existants. C'est ce dernier objectif qui est à l'origine de la diversité de protocoles normalisés dans la CEI 61158-6.

1.3 Conformité

La présente Norme ne spécifie pas de mises en œuvre individuelles ou de produits; elle n'impose pas non plus la mise en œuvre d'entités de couche application dans les systèmes d'automatisation industriels. La conformité s'obtient par la mise en œuvre de la présente spécification de protocole de couche application.

2 Références normatives

Les documents de référence suivants sont indispensables pour l'application du présent document. Pour les références datées, seule l'édition citée s'applique. Pour les références non datées, la dernière édition du document de référence s'applique (y compris les éventuels amendements).

CEI 61158-5-15, *Réseaux de communication industriels – Spécifications des bus de terrain – Partie 5-15: Définition des services de la couche application – Eléments de type 15*

ISO/CEI 7498-1, *Technologies de l'information – Interconnexion de systèmes ouverts (OSI) – Modèle de référence de base – Partie 1: Le modèle de base*

ISO/CEI 9545, *Technologies de l'information – Interconnexion de systèmes ouverts (OSI) – Structure de la couche application*

ISO/CEI 8822, *Systèmes de traitement de l'information – Interconnexion de systèmes ouverts – Définition du service de présentation en mode connexion*

ISO/CEI 8824, *Technologies de l'information – Interconnexion de systèmes ouverts – Spécification de la notation de syntaxe abstraite numéro un (ASN.1)*

3 Termes et définitions, abréviations, symboles et conventions

3.1 Termes et définitions

Pour les besoins du présent document, les termes suivants, tels qu'ils sont définis dans les publications indiquées, s'appliquent:

3.1.1 Termes de l'ISO/CEI 7498-1

- a) entité d'application
- b) processus d'application
- c) unité de données de protocole d'application
- d) élément de service d'application
- e) appel d'entité d'application
- f) appel de processus d'application
- g) transaction d'application
- h) système ouvert réel
- i) syntaxe de transfert

3.1.2 Termes de l'ISO/CEI 8822

- a) syntaxe abstraite

b) contexte de présentation

3.1.3 Termes de l'ISO/CEI 9545

- a) association d'application
- b) contexte d'application
- c) nom de contexte d'application
- d) appel d'entité d'application
- e) type d'entité d'application
- f) appel de processus d'application
- g) type de processus d'application
- h) élément de service d'application
- i) élément de service de commande d'application

3.1.4 Termes de l'ISO/CEI 8824

- a) identificateur d'objet
- b) type

3.1.5 Termes de la CEI/TR 61158-1

Les termes suivants de la CEI/TR 61158-1 s'appliquent.

3.1.5.1 application

fonction ou structure de données pour laquelle des données sont consommées ou produites

3.1.5.2 interopérabilité de couche application

capacité qu'ont les entités d'application à effectuer des opérations coordonnées et coopératives en utilisant les services de la FAL

3.1.5.3 objet d'application

classe d'objet qui gère et fournit l'échange de messages en mode opératoire à travers le réseau et à l'intérieur du dispositif réseau

NOTE Plusieurs types de classes d'objet d'application peuvent être définis.

3.1.5.4 processus d'application

partie d'une application distribuée sur un réseau, qui est située sur un dispositif et qui est adressée sans ambiguïté

3.1.5.5 identificateur de processus d'application

identificateur permettant de distinguer plusieurs processus d'application utilisés dans un dispositif

3.1.5.6 objet de processus d'application

composant d'un processus d'application qui est identifiable et accessible par la relation d'application de la FAL

NOTE Les définitions des objets de processus d'application sont composées d'un ensemble de valeurs données aux attributs de leur classe.

3.1.5.7 classe d'objet de processus d'application

classe d'objets de processus d'application définis par rapport à l'ensemble des attributs et services accessibles en réseau qu'ils possèdent

3.1.5.8 relation d'application

association coopérative entre deux appels d'entité d'application ou plus, destinée à l'échange d'informations et à la coordination de leur association fonctionnelle

NOTE Cette relation est activée par l'échange d'unités de données de protocole d'application ou à la suite d'activités de préconfiguration.

3.1.5.9 point final de relation d'application

contexte et comportement d'une relation d'application, vus et maintenus par l'un des processus d'application impliqués dans la relation d'application

NOTE Chaque processus d'application impliqué dans la relation d'application maintient son propre point final de relation d'application.

3.1.5.10 élément de service d'application

élément de service d'application qui fournit le moyen exclusif d'établir et de terminer toutes les relations d'application

3.1.5.11 attribut

description d'une caractéristique ou d'une particularité, visible de l'extérieur, d'un objet

NOTE Les attributs d'un objet contiennent des informations au sujet des parties variables d'un objet. Ils servent habituellement à fournir des informations de statut ou à régir le fonctionnement d'un objet. Les attributs peuvent également avoir un effet sur le fonctionnement d'un objet. Les attributs se répartissent en attributs de classe et en attributs d'instance.

3.1.5.12 comportement

indication de la façon dont l'objectif répond à des événements particuliers

NOTE Sa description comprend la relation entre les valeurs d'attribut et les services.

3.1.5.13 classe

ensemble d'objets, chacun d'eux représentant la même sorte de composant de système

NOTE Une classe constitue la généralisation de l'objet; un modèle pour définir les variables et les méthodes. Tous les objets d'une classe sont identiques en forme et en comportement, mais ils contiennent habituellement des données différentes dans leurs attributs.

3.1.5.14 attribut de classe

attribut qui est partagé par tous les objets de la même classe

3.1.5.15 code de classe

identificateur unique affecté à chaque classe d'objet

3.1.5.16 service spécifique à une classe

service défini par une classe d'objets particulière pour l'exécution d'une fonction requise qui n'est pas exécutée par un service commun

NOTE Un objet spécifique à une classe est unique pour la classe d'objets qui le définit.

3.1.5.17 client

a) objet qui utilise les services d'un autre objet (serveur) pour exécuter une tâche

b) initiateur d'un message auquel un serveur réagit, comme par exemple le rôle d'un point final d'AR consistant à envoyer des APDU de demande de service confirmé à un point final d'AR individuel agissant en tant que serveur

3.1.5.18 chemin de transmission

flux unidirectionnel d'APDU sur l'ensemble d'une relation d'application

3.1.5.19 cyclique

terme utilisé pour décrire des événements qui se reproduisent de manière régulière et répétitive

3.1.5.20 AR dédiée

AR utilisée directement par l'utilisateur de la FAL

NOTE Sur les AR dédiées, seuls l'en-tête de la FAL et les données de l'utilisateur sont transférés.

3.1.5.21 dispositif

connexion matérielle physique à la liaison

NOTE Un dispositif peut contenir plus d'un nœud.

3.1.5.22 profil de dispositif

collection d'informations et de fonctionnalités dépendantes du dispositif, fournissant une harmonisation entre dispositifs similaires de même type

3.1.5.23 AR dynamique

AR qui exige l'utilisation de procédures d'établissement d'AR pour pouvoir être placée dans un état établi

3.1.5.24 point final

l'une des entités communicantes impliquées dans une connexion

3.1.5.25 erreur

divergence entre une valeur ou une condition calculée, observée ou mesurée et la valeur ou la condition spécifiée ou théoriquement correcte

3.1.5.26 classe d'erreur

groupement général pour les définitions d'erreur

NOTE Les codes d'erreur correspondant à des erreurs spécifiques sont définis dans une classe d'erreur.

3.1.5.27 code d'erreur

identification d'un type d'erreur spécifique dans une classe d'erreur

3.1.5.28 sous-réseau FAL

réseaux composés d'un ou de plusieurs segments de liaison de données

NOTE Les sous-réseaux peuvent contenir des ponts, mais pas les routeurs. Les sous-réseaux FAL sont identifiés par un sous-ensemble de l'adresse réseau.

3.1.5.29 dispositif logique

Classe FAL qui extrait un composant logiciel ou un composant de micrologiciel sous forme de ressource autonome indépendante d'un dispositif d'automatisation

3.1.5.30 information de gestion

information accessible en réseau utilisée pour gérer le fonctionnement du système de bus de terrain, y compris la couche application

NOTE Cette gestion comprend des fonctions telles que le contrôle, la surveillance et l'établissement de diagnostics.

3.1.5.31 réseau

série de nœuds connectés par un certain type de support de communication

NOTE Les chemins de connexion reliant n'importe quelle paire de nœuds peuvent comporter des répéteurs, des routeurs et des passerelles.

3.1.5.32 pair

rôle d'un point final d'AR consistant à être capable d'agir à la fois comme client et comme serveur

3.1.5.33 point final d'AR prédéfini

point final d'AR qui est défini localement dans un dispositif sans passer par le service de création

NOTE Les AR prédéfinis qui ne sont pas pré-établis sont établis avant d'être utilisés.

3.1.5.34 point final d'AR pré-établi

point final d'AR qui est placé dans un état établi lors de la configuration des AE qui servent à commander ses points finaux

3.1.5.35 fournisseur

rôle d'un point final d'AR consistant à émettre des APDU sur le bus de terrain en vue de leur consommation par un ou plusieurs abonnés

NOTE Le fournisseur peut ne pas avoir connaissance de l'identité des abonnés ou de leur nombre, et il peut fournir ses APDU au moyen d'une AR dédiée. Deux types de fournisseurs sont définis dans la présente norme: les fournisseurs tireurs et les fournisseurs pousseurs, chacun étant défini individuellement.

3.1.5.36 serveur

- a) rôle joué par un AREP consistant à renvoyer une APDU de réponse de service confirmé au client qui a initié la demande
- b) objet qui fournit des services à un autre objet (client)

3.1.5.37 service

opération ou fonction qu'un objet et/ou une classe d'objets exécute sur demande provenant d'un autre objet et/ou classe d'objets

NOTE Un ensemble de services communs est défini, et des dispositions en vue de la définition des services spécifiques aux objets sont fournies. Les services spécifiques aux objets sont les services qui sont définis par une classe d'objets particulière pour l'exécution d'une fonction requise qui n'est pas exécutée par un service commun.

3.1.5.38 abonné

rôle joué par un AREP consistant à recevoir des APDU produites par un fournisseur

NOTE Deux types d'abonnés sont définis dans la présente norme: les fournisseurs tireurs et les fournisseurs pousseurs, chacun étant défini individuellement.

3.1.6 Définitions spécifiques au client/serveur

3.1.6.1

bobines, sorties discrètes

objet de processus d'application, un ensemble de bobines, caractérisé par l'adresse d'une bobine et une quantité de bobines

3.1.6.2

discret, entrée discrète

objet de processus d'application, adressé par un nombre non signé et ayant une largeur d'un bit, représentant une valeur de statut codée sur 1 bit, en lecture seule, la valeur '1' correspondant au statut actif et la valeur '0' au statut inactif

3.1.6.3**entrées discrètes, discrets**

objet de processus d'application, un ensemble de discrets, caractérisé par l'adresse d'un discret et une quantité de discrets

3.1.6.4**bobine, sortie discrète**

objet de processus d'application, adressé par un nombre non signé et ayant une largeur d'un bit, représentant une valeur de statut codée sur 1 bit, en lecture seule, la valeur '1' correspondant au statut actif et la valeur '0' au statut inactif

3.1.6.5**interface encapsulée**

mécanisme servant à encapsuler un service pour une interface, ce mécanisme constituant un objet de processus d'application caractérisé par un type MEI

3.1.6.6**exception**

codage utilisé pour signaler l'échec d'une demande de service

3.1.6.7**code d'exception**

codage associé à une exception, détaillant les raisons pour lesquelles une demande de service a échoué

3.1.6.8**fichier**

objet de processus d'application, une organisation d'enregistrements, caractérisé par un nombre non signé

3.1.6.9**code de fonction**

codage d'un service demandé à un serveur

3.1.6.10**registre de maintien, registre de sortie**

objet de processus d'application, adressé par un nombre non signé et représentant des valeurs de 16 bits, en lecture et écriture, également appelé registre de sortie

3.1.6.11**registres de maintien, registres de sortie**

objet de processus d'application, un ensemble de registres de maintien, caractérisé par l'adresse d'un registre de maintien et une quantité de registres de maintien

3.1.6.12**registre d'entrée**

objet de processus d'application, adressé par un nombre non signé et représentant des valeurs de 16 bits, en lecture seule

3.1.6.13**registres d'entrée**

objet de processus d'application, un ensemble de registres d'entrée, caractérisé par l'adresse d'un registre d'entrée et une quantité de registres d'entrée

3.1.6.14

enregistrement

objet de processus d'application, un ensemble de registres contigus d'un type spécifié, caractérisé par l'adresse du premier registre et par la quantité de registres; dans le contexte de cette définition, les registres concernés sont également appelés des références

3.1.6.15

référence

terme critiqué pour désigner un registre

3.1.6.16

type de référence

terme critiqué pour désigner un type de registre

3.1.6.17

sous-code

spécialisation d'un code de fonction

3.1.6.18

ID d'unité

identificateur de dispositif logique

3.1.6.19

type MEI

type spécifié sous forme de valeur d'octet, utilisé pour expédier un service à l'interface appropriée dans le contexte du mécanisme de l'interface encapsulée

3.1.7 Définitions spécifiques au fournisseur/abonné

3.1.7.1

objet de réseau

application fournisseur/abonné, lecteur, ou auteur

3.1.7.2

GUID

identificateur d'objet de réseau globalement unique

3.1.7.3

état composite

attributs d'un ensemble d'objets de réseau

3.1.7.4

lecteur

un abonné ou un CSTReader

3.1.7.5

auteur

un fournisseur ou un CSTWriter

3.1.7.6

CSTReader

abonné spécialisé en méta-informations

3.1.7.7

CSTWriter

fournisseur spécialisé en méta-informations

3.1.7.8**acteur de communication**

lecteur ou auteur

3.1.7.9**participant de domaine**

application qui contient des éléments fournisseur/abonné, également appelée application fournisseur/abonné

NOTE (Informative) On a adopté cette terminologie dans le but d'éviter l'usage excessif du terme "application". Parallèlement, le terme "domaine" a une place dans le mode fournisseur/abonné. L'extensibilité de type autorise le concept de "domaines", ou de plans de communication indépendants, qui permet d'isoler efficacement les échanges d'application à l'intérieur des domaines. Le DDS de l'OMG, comme dans "Data Distribution Service for Real-Time Systems Specification, Version 1.1, December 2005", utilise cette extension, mais la fonction n'est pas examinée de façon plus approfondie dans la présente spécification, laquelle ne considère qu'un domaine individuel.

3.1.7.10**gestionnaire**

application fournisseur/abonné spécialisée contenant des fournisseurs et abonnés spécialisés et impliquée dans le mécanisme de découverte et maintenance décrit; à ne pas confondre avec un gestionnaire de fourniture

3.1.7.11**participant géré**

application fournisseur/abonné; l'adjectif désigne son rôle par rapport à un gestionnaire lorsqu'il est impliqué dans le mécanisme de découverte et maintenance décrit; à ne pas confondre avec un gestionnaire de fourniture

3.1.7.12**numéro de séquence**

numéro utilisé pour identifier de manière unique des messages fournisseur/abonné élémentaires d'une manière ordonnée

3.2 Abréviations et symboles**3.2.1 Abréviations et symboles courants**

AE	Application Entity (Entité d'application)
AL	Application Layer (Couche application)
ALME	Application Layer Management Entity (Entité de gestion de couche application)
ALP	Application Layer Protocol (Protocole de couche application)
APO	Application Object (Objet d'application)
AP	Application Process (Processus d'application)
APDU	Application Protocol Data Unit (Unité de données de protocole d'application)
API	Application Process Identifier (Identificateur de processus d'application)
AR	Application Relationship (Relation d'application)
AREP	Application Relationship End Point (Point final de relation d'application)
ASCII	American Standard Code for Information Interchange (Code normalisé américain pour l'échange d'informations)
ASE	Application Service Element (Élément de service d'application)
Conf.	Confirmation
DL-	(préfixe) data-link- (liaison de données)
DLC	data-link Connection (Connexion de liaison de données)
DLCEP	data-link Connection End Point (Point final de connexion de liaison de données)

DLL	data-link Layer (Couche liaison de données)
DLM	data-link-management (Gestion de liaison de données)
DLSAP	data-link Service Access Point (Point d'accès au service de liaison de données)
DLSDU	DL-service-data-unit (Unité de données de service de liaison de données)
FAL	Fieldbus Application Layer (Couche application de bus de terrain)
ID	Identificateur
CEI	Commission Électrotechnique Internationale
Ind.	Indication
LME	Layer Management Entity (Entité de gestion de couche)
LSB	Least Significant Bit (Bit de poids faible)
MSB	Most Significant Bit (Bit de poids fort)
OSI	Open Systems Interconnect (Interconnexion de systèmes ouverts)
QoS	Quality of Service (Qualité de service)
Dem.	Demande
Rép.	Réponse
SAP	Service Access Point (Point d'accès au service)
SDU	Service Data Unit (Unité de données de service)
SMIB	System Management Information Base (Base d'information de gestion de système)
SMK	System Management Kernel (Noyau de gestion de système)

3.2.2 Abréviations et symboles pour le mode client/serveur

C/S	Client/serveur
FC	Function Code (Code de fonction)
CAN	Controller Area Network (Réseau local de contrôleurs)
CiA	CAN en automatisation
MEI	Type interface encapsulée
URL	Uniform Resource Locator (adresse)

3.2.3 Abréviations et symboles pour le mode fournisseur/abonné

CS	Composite State (État composite)
DCPS	Data-Centric Publish-Subscribe (Fournisseur/abonné centré sur les données)
DDS	Data Distribution Service (Service de distribution de données)
DLRL	Data Local Reconstruction Layer (Couche de reconstruction locale de données)
OMG	Object Management Group (Groupe de gestion d'objets)
P/S	Publish/Subscribe (Fournisseur/abonné)

3.3 Conventions

3.3.1 Vue d'ensemble

La FAL est définie comme étant un ensemble d'ASE orientés objet. Chaque ASE est spécifié dans un paragraphe qui lui est propre. Chaque spécification d'ASE comprend deux parties: la spécification de classe et la spécification de service.

La spécification de classe définit les attributs de la classe. Les attributs sont accessibles dans les instances de la classe au moyen des services ASE de gestion d'objets spécifiés à l'Article 5 de la présente norme. La spécification de service définit les services qui sont fournis par l'ASE.

3.3.2 Conventions générales

La présente norme utilise les conventions descriptives données dans l'ISO/CEI 10731.

3.3.3 Conventions pour les définitions de classe

Les définitions de classe sont décrites au moyen de modèles. Chaque modèle consiste en une liste d'attributs destinés à la classe. La forme générale du modèle est représentée ci-dessous:

ASE de FAL: Nom de l'ASE

CLASSE: Nom de la classe

ID CLASSE: #

CLASSE PARENTE: Nom de la classe parente

ATTRIBUTS:

1	(o)	Attribut clé:	identificateur numérique
2	(o)	Attribut clé:	nom
3	(m)	Attribut:	nom de l'attribut(valeurs)
4	(m)	Attribut:	nom de l'attribut(valeurs)
4.1	(s)	Attribut:	nom de l'attribut(valeurs)
4.2	(s)	Attribut:	nom de l'attribut(valeurs)
4.3	(s)	Attribut:	nom de l'attribut(valeurs)
5.	(c)	Contrainte:	expression de la contrainte
5.1	(m)	Attribut:	nom de l'attribut(valeurs)
5.2	(o)	Attribut:	nom de l'attribut(valeurs)
6	(m)	Attribut:	nom de l'attribut(valeurs)
6.1	(s)	Attribut:	nom de l'attribut(valeurs)
6.2	(s)	Attribut:	nom de l'attribut(valeurs)

SERVICES:

1	(o)	OpService:	nom du service:
2.	(c)	Contrainte:	expression de la contrainte
2.1	(o)	OpService:	nom du service:
3	(m)	MgtService:	nom du service:

- (1) L'entrée "ASE de FAL:" est le nom de l'ASE de FAL qui fournit les services correspondant à la classe qui est en train d'être spécifiée.
- (2) L'entrée "CLASSE:" est le nom de la classe qui est en train d'être spécifiée. Tout objet défini au moyen de ce modèle constitue une instance de cette classe. La classe peut être spécifiée au moyen de la présente norme ou par un utilisateur de la présente norme.
- (3) L'entrée "ID CLASSE:" est le numéro qui identifie la classe qui est en train d'être spécifiée. Ce numéro est unique au sein de l'ASE de FAL qui fournit les services correspondant à cette classe. Lorsqu'on lui adjoint l'identité de son ASE de FAL, il identifie sans ambiguïté la classe dans le domaine d'application de la FAL. La valeur "NULL" indique que la classe ne peut pas être instanciée. Les ID de classe compris entre 1 et 255 sont réservés par la présente norme pour l'identification des classes normalisées. Ils ont été définis ainsi pour maintenir la compatibilité avec les normes nationales existantes. Les ID de classe compris entre 256 et 2048 sont alloués pour l'identification des classes définies par les utilisateurs.
- (4) L'entrée "CLASSE PARENTE:" est le nom de la classe parente de la classe qui est en train d'être spécifiée. La classe en train d'être définie hérite de tous les attributs définis pour la classe parente et dont celle-ci a hérité, aussi ces attributs ne doivent pas être redéfinis dans le modèle correspondant à cette classe.

NOTE La classe parente "TOP" indique que la classe en train d'être définie est une définition de classe initiale. La classe parente TOP est utilisée comme point de départ à partir duquel toutes les autres classes sont définies. L'utilisation de TOP est réservée aux classes définies par la présente norme.

(5) L'étiquette "ATTRIBUTS" indique que les entrées suivantes sont des attributs définis pour la classe.

- a) Chacune des entrées d'attribut est composée d'un numéro de ligne dans la colonne 1, d'un indicateur obligatoire (mandatory) (m) / optionnel (o) / conditionnel (c) / sélecteur (s) dans la colonne 2, d'une étiquette de type d'attribut dans la colonne 3, d'un nom ou d'une expression conditionnelle dans la colonne 4 et, en option, d'une liste de valeurs énumérées dans la colonne 5. Dans la colonne qui suit la liste de valeurs, on peut spécifier la valeur par défaut de l'attribut.
- b) Les objets sont normalement identifiés par un identificateur numérique ou par un nom d'objet, ou les deux. Dans les modèles de classe, ces attributs clés sont définis sous l'attribut clé.
- c) Le numéro de ligne identifie la séquence et le niveau d'emboîtement de la ligne. Chaque niveau d'emboîtement est identifié par période. L'emboîtement permet de spécifier:
 - i) les champs d'un attribut structuré (4.1, 4.2, 4.3),
 - ii) les attributs dépendant d'une déclaration de contrainte (5). Les attributs peuvent être obligatoires (5.1) ou optionnels (5.2) si la contrainte est vraie. Contrairement à l'attribut défini en (5.2), les attributs optionnels ne nécessitent pas systématiquement de déclaration de contrainte.
 - iii) les champs de sélection d'un attribut de type de choix (6.1 et 6.2).

(6) L'étiquette "SERVICES" indique que les entrées suivantes sont des services définis pour la classe.

- a) Un (m) dans la colonne 2 indique le service est obligatoire (*mandatory*) pour la classe, le (o) indiquant qu'il est optionnel. Un (c) dans cette colonne indique que le service est conditionnel. Lorsque tous les services définis pour une classe sont définis comme étant optionnels, au moins un doit être sélectionné lorsque l'on définit une instance de la classe.
- b) L'étiquette "OpsService" désigne un service opérationnel (1).
- c) L'étiquette "MgtService" désigne un service de gestion (2).
- d) Le numéro de ligne identifie la séquence et le niveau d'emboîtement de la ligne. Chaque niveau d'emboîtement est identifié par période. L'emboîtement dans la liste de services permet de spécifier les services qui dépendent d'une déclaration de contrainte.

3.3.4 Conventions pour les définitions de service

3.3.4.1 Généralités

La FAL est définie comme étant un ensemble d'ASE orientés objet. Chaque ASE est spécifié dans un paragraphe qui lui est propre. Chaque spécification d'ASE comprend trois parties: ses définitions de classe, ses services et sa spécification de protocole. Les deux premières sont contenues dans la CEI 61158-5. La spécification de protocole de chacun des ASE est définie dans la présente norme.

Les définitions de classe définissent les attributs des classes supportées par chacun des ASE. Les attributs sont accessibles dans des instances de la classe au moyen des services ASE de gestion spécifiés dans la sous-série CEI 61158-5. La spécification de service définit les services qui sont fournis par l'ASE.

La présente norme utilise les conventions descriptives données dans l'ISO/CEI 10731.

3.3.5 Conventions pour les définitions de classe

Les définitions de mise en correspondance pour la couche liaison de données sont décrites au moyen de modèles. Chaque modèle consiste en une liste d'attributs destinés à la classe. La forme générale du modèle est définie dans la CEI/TR 61158-1.

3.3.6 Conventions pour la syntaxe abstraite

Lorsque le paramètre "optionalParametersMap" est utilisé, un numéro de bit qui correspond à chaque production OPTIONAL ou DEFAULT est donné en commentaire.

3.4 Conventions utilisées dans les diagrammes d'états

Les diagrammes d'états sont décrits dans le Tableau 1.

Tableau 1 – Conventions utilisées pour les diagrammes d'états

#	État courant	Événement / condition => action	État suivant
Nom de cette transition.	L'état courant auquel cette transition d'état s'applique.	Événements ou conditions qui déclenchent cette transition d'état. => Les actions qui sont entreprises lorsque les événements ou conditions ci-dessus se produisent. Les actions sont toujours indentées au-dessous des événements et des conditions.	L'état qui suit les actions de cette transition est pris.

Les conventions utilisées dans les diagrammes d'états sont les suivantes:

:= La valeur de l'élément de gauche est remplacée par la valeur de l'élément de droite. Si l'élément de droite est un paramètre, il provient de la primitive représentée comme événement d'entrée.

xxx Nom de paramètre.

Exemple:

Identificateur:= raison
signifie que la valeur du paramètre "raison" est affectée à un paramètre appelé "Identificateur".

"xxx" Indique une valeur fixe.

Exemple:

Identificateur:="abc"
signifie que la valeur "abc" est affectée à un paramètre appelé "Identificateur".

= Condition logique indiquant que l'élément de gauche est égal à l'élément de droite.

< Condition logique indiquant que l'élément de gauche est inférieur à l'élément de droite.

> Condition logique indiquant que l'élément de gauche est supérieur à l'élément de droite.

<> Condition logique indiquant que l'élément de gauche est différent de l'élément de droite.

&& "ET" logique

|| "OU" logique

Cette structure permet d'exécuter une séquence d'actions dans une boucle en une seule transition. La boucle est exécutée pour toutes les valeurs allant de valeur_départ à valeur_fin.

Exemple:
 for (Identificateur:= valeur_départ to valeur_fin)
 actions
endfor

Cette structure permet d'exécuter des actions alternatives qui dépendent d'une certaine condition (par exemple la valeur d'un certain identificateur ou le résultat d'une action précédente) en une seule transition.

Exemple:
 If (condition)
 actions
else
 actions
endif

Il est vivement recommandé aux lecteurs désireux de mieux comprendre les machines de protocole de se reporter aux paragraphes concernant les définitions des attributs d'AREP, les fonctions locales et les définitions des FAL-PDU. Le lecteur est censé avoir une connaissance suffisante de ces définitions, lesquelles sont utilisées sans être accompagnées d'explications supplémentaires.

4 Syntaxe abstraite pour le client/serveur

La syntaxe abstraite des APDU est combinée à leur syntaxe de transfert et est spécifiée à l'Article 5.

5 Syntaxe de transfert pour le client/serveur

5.1 Généralités

La couche application émettrice prépare une APDU à transférer vers la couche application réceptrice. Elle utilise à cet effet les paramètres donnés par les primitives de service. Il existe plusieurs formats d'APDU:

- APDU de demande allant du client au dispositif serveur ou aux dispositifs serveurs, ou
- réponse normale et confirmation positive du serveur au dispositif client, ou
- réponse et confirmation négative du serveur au dispositif client.

Le format et les règles de codage applicables aux APDU sont spécifiés dans le présent Article.

5.2 Structure commune des APDU

Toutes les APDU ont la structure commune représentée sur la Figure 1.

Unit ID	Code	Data
---------	------	------

Légende

Anglais	Français
Unit ID	ID d'unité
Code	Code
Data	Données

Figure 1 – Format d'APDU

5.2.1 ID d'unité

Les dispositifs client/serveur jouant le rôle de serveurs sont adressés au moyen d'un ID d'unité. L'ID d'unité doit être unique parmi tous les serveurs adressables par un client. L'ensemble des serveurs adressables est déterminé par la couche sous-jacente. On appelle parfois cet ensemble une connexion.

L'affectation des ID d'unité ne fait pas partie du domaine d'application de la présente spécification.

L'ID d'unité identifie les dispositifs logiques. Il peut exister plus d'un dispositif logique par dispositif physique.

Certaines valeurs d'ID d'unité sont réservées et ont des significations particulières. La valeur 0 est réservée pour la diffusion.

Type de champ: Unsigned8

Valeurs autorisées: 1 à 247, et 0 pour la diffusion si elle est supportée.

NOTE En général, l'ID d'unité n'est obligatoire que pour les dispositifs logiques jouant le rôle de serveurs. Les dispositifs logiques peuvent souvent avoir l'un des deux rôles ou plusieurs rôles, définis par une configuration, leur ID d'unité n'étant pas utilisé s'ils jouent uniquement le rôle de client. Selon les couches sous-jacentes, certains dispositifs peuvent avoir simultanément un rôle de client et un rôle de serveur sur le même point d'accès; c'est le cas du client/serveur sur bus à jetons/HDLC, qui ne fait pas partie du domaine d'application de la présente spécification.

5.2.2 Code

5.2.2.1 Généralités

Ce champ représente

- un service demandé, confirmé ou non confirmé, par l'intermédiaire d'un identificateur appelé code de fonction, ou
- la réponse normale et la confirmation positive d'un service demandé, représentés par renvoi en écho de l'identificateur du service demandé, ou
- la réponse d'exception et la confirmation négative d'un service demandé, représentés par renvoi en écho de l'identificateur du service demandé avec son bit de poids fort activé. Cette dernière représentation est également appelée exception.

Type de champ: Unsigned8

5.2.2.2 Identificateurs de service et codes de fonction

Les identificateurs de service client/serveur sont communément appelés codes de fonction.

Les codes de fonction sont des codages de services demandés à un serveur. Certains codes de fonction sont de plus spécialisés au moyen d'un sous-code, spécifié en tant que partie du champ de données. Ces codages sont cloisonnés en trois catégories, et du fait que la subdivision peut propager les sous-codes, afin que la description donnée ici soit complète, ils sont également mentionnés bien qu'ils fassent partie du champ de données:

Codes de fonction attribués publiquement

Ces codes de fonction sont soit affectés à un service normalisé, soit réservés à une affectation future. Les services normalisés et leurs identificateurs sont détaillés dans la présente spécification.

Codes de fonction définis par l'utilisateur

Ces codes de fonction peuvent être utilisés à des fins d'expérimentation dans un environnement de laboratoire contrôlé. Ils ne doivent pas être utilisés dans un environnement ouvert.

Plages: Il existe deux plages, FC 65 (0x41) à 72 (0x48) inclus, et 100 (0x64) à 110 (0x6E) inclus.

Codes de fonction réservés

Ces codes de fonction sont actuellement utilisés par certaines entreprises pour les produits patrimoniaux; ils ne sont pas disponibles pour une utilisation publique.

NOTE 1 Les affectations de code de fonction sont gérées par le consortium industriel Modbus-IDA.

NOTE 2 Les codes de fonction suivants, bien qu'affectés publiquement, ne sont pas couverts par la présente spécification: FC 7 (0x07, Read Exception Status – lire statut d'exception), FC 8 (0x08, Diagnostics), FC 11 (0x0B, Get Com Event Counter – obtenir compteur d'événements de communication), FC 12 (0x0C, Get Com Event Log – obtenir journal d'événements de communication), FC 17 (0x11, Report Slave ID – rapporter ID esclave).

NOTE 3 Les codes de fonction et les codes/sous-codes de fonction suivants sont réservés: FC 8/19 (0x08/0x13), FC 8/21-255 (0x08/0x15-0xFFFF), FC 9 (0x09), FC 10 (0x0A), FC 13 (0x0D), FC 14 (0x0E), FC 41 (0x29), FC 42 (0x2A), FC 43/0-12 (0x2B/0x00-0x0C), FC 43/15-255 (0x2B/0x0F-0xFF), FC 90 (0x5A), FC 91 (0x5B), FC 125 (0x7D), FC 126 (0x7E), FC 127 (0x7F).

5.2.3 Données

Pour les demandes normales et les réponses, il s'agit des données d'utilisateur qui sont transférées entre la couche application et son utilisateur. La couche application les assemble à partir des paramètres d'une primitive de service ou les interprète en paramètres d'une primitive de service. Leur structure dépend du type d'APDU. Pour les réponses d'exception, elles représentent la raison de l'exception au moyen d'un code d'exception.

Type de champ: de 1 à 252 octets; le type est spécifique à l'APDU.

5.2.4 Demande de service confirmé du client au serveur

Le format correspond aux indications de la Figure 2.

Unit ID	Function code	Request Data
---------	---------------	--------------

Légende

Anglais	Français
Unit ID	ID d'unité
Function code	Code de fonction
Request data	Données de demande

Figure 2 – Demande de service confirmé du client au serveur

5.2.5 Réponse normale du serveur au client

Le format utilisé pour la réponse normale à un service confirmé correspond aux indications de la Figure 3. L'ID d'unité et les champs du code de fonction sont les mêmes que les champs correspondants de la demande.

Unit ID	Function code	Response Data
---------	---------------	---------------

Légende

Anglais	Français
Unit ID	ID d'unité
Function code	Code de fonction
Response data	Données de réponse

Figure 3 – Réponse normale du serveur au client

5.2.6 Réponse d'exception du serveur au client

Le format utilisé pour la réponse d'exception correspond aux indications de la Figure 4. L'ID d'unité est le même que le champ correspondant de la demande. On produit l'exception en ajoutant 0x80 au code de fonction de la demande correspondante.

Unit ID	Exception	Exception code
---------	-----------	----------------

Légende

Anglais	Français
Unit ID	ID d'unité
Exception	Exception
Exception code	Code d'exception

Figure 4 – Réponse d'exception du serveur au client

Les codes d'exception, qui donnent des informations sur la défaillance du service, sont indiqués dans le Tableau 2.

Tableau 2 – Code d'exception

Codage	Nom	Description
0x01	Fonction non autorisée	Le code de fonction reçu dans la demande n'est pas une action autorisée pour le serveur. Cela peut s'expliquer par le fait que le code de fonction n'est applicable qu'aux dispositifs plus récents et n'a pas été mis en œuvre dans l'unité sélectionnée. Cela pourrait également indiquer que le serveur n'est pas dans un état qui lui permet de traiter les demandes de ce type, par exemple parce qu'il n'est pas configuré et qu'on lui demande de renvoyer des valeurs de registre.
0x02	Adresse de données non autorisée	L'adresse de données reçue dans la demande n'est pas une adresse autorisée pour le serveur. Plus précisément, la combinaison du numéro de référence et de la longueur de transfert est invalide. Exemple (informatif) : Pour un contrôleur comportant 100 registres, une demande avec un décalage (adresse de données) de 96 et une longueur de 4 réussirait, tandis qu'une demande avec un décalage de 96 et une longueur de 5 générerait le code d'exception 0x02.
0x03	Valeur de données non autorisée	Une valeur contenue dans le champ de données de la demande n'est pas une valeur autorisée pour le serveur. Cela indique une erreur dans la structure du reste d'une demande complexe, par exemple une longueur impliquée incorrecte. Cependant, cela ne signifie PAS, par exemple, que la valeur d'un élément de données envoyé pour stockage dans un registre est située en dehors des valeurs attendues par le programme d'application, car le protocole client/serveur ne connaît pas la signification d'une valeur particulière pour un registre particulier.
0x04	Défaillance du dispositif serveur	Une erreur irréversible s'est produite alors que le serveur tentait d'effectuer l'action demandée.
0x05	Accusé de réception	Le serveur a appelé l'appel de service mais le service nécessite une durée assez longue pour s'exécuter. Le serveur ne renvoie donc qu'un accusé de réception de l'appel de service. Cette réponse est renvoyée afin d'éviter de provoquer une erreur de temporisation écoulee chez le client.
0x06	Serveur occupé	Le serveur n'a pas pu accepter la demande. L'application cliente a la responsabilité de déterminer si la demande doit être rémise et quand elle doit l'être.
0x08	Erreur de parité de mémoire	Pour une utilisation spécialisée en combinaison avec les codes de fonction 20 (0x14) et 21 (0x15), afin d'indiquer que la zone de fichier étendue n'a pas réussi la vérification de cohérence. Par exemple, le serveur a essayé de lire un fichier d'enregistrement mais a détecté une erreur de parité de mémoire. Le client peut tenter de rémettre la demande, mais le dispositif serveur peut nécessiter une intervention de service.
0x0A	Chemin de passerelle indisponible	Pour une utilisation spécialisée en combinaison avec les passerelles, concentrateurs, commutateurs et dispositifs réseau similaires, afin d'indiquer que la passerelle n'a pas pu allouer un chemin de communication interne entre le port d'entrée et le port de sortie pour traiter la demande. Cela signifie habituellement que la passerelle est mal configurée ou est surchargée.
0x0B	Le dispositif cible de passerelle n'a pas répondu	Pour une utilisation spécialisée en combinaison avec les passerelles, concentrateurs, commutateurs et dispositifs réseau similaires, afin d'indiquer qu'aucune réponse n'a été obtenue du dispositif cible. Cela signifie habituellement que le dispositif n'est pas présent sur la réseau.

5.2.7 Demande de service non confirmé du client au serveur

Le format correspond aux indications de la Figure 5. Ces services sont utilisés pour la diffusion. Seul un petit nombre de codes de fonction autorise la diffusion.

Unit ID = 0	Function code	Request Data
-------------	---------------	--------------

Légende

Anglais	Français
Unit ID = 0	ID d'unité = 0.
Function code	Code de fonction
Request Data	Données de demande

Figure 5 – Demande de service non confirmé du client au serveur**5.3 Structures d'APDU spécifiques aux services****5.3.1 FAL PDU Lire discrets****5.3.1.1 Primitive de demande**

Identificateur de service, code de fonction = 2 (0x02).

Ce code de fonction permet de lire le statut de 1 à 2000 entrées discrètes dans un dispositif distant. La PDU de demande spécifie l'adresse de départ, c'est-à-dire l'adresse de la première entrée spécifiée, et le nombre d'entrées. Dans la PDU, les adresses des entrées discrètes commencent à zéro. Les entrées discrètes numérotées 1-16 ont donc pour adresses 0-15. L'adresse de départ peut aller de 0x0000 à 0xFFFF.

Le format est donné dans le Tableau 3.

Tableau 3 – Demande Lire discrets

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 2 (0x02).
Adresse du premier discret	Unsigned16	Adresse de la première entrée discrète Valeurs autorisées: 0x0000 à 0xFFFF
Quantité de discrets	Unsigned16	Quantité de discrets. Valeurs autorisées: 1 à 2000 (0x7D0)

5.3.1.2 Primitive de réponse

Le format est donné dans le Tableau 4.

Tableau 4 – Réponse à Lire discrets

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 2 (0x02). Écho de ce qui est demandé
Nombre d'octets de données	Unsigned16	Nombre d'octets lus
Données	Séquence de bits de statut	Valeurs de statut des discrets lus

Les données du champ contiennent n octets, n étant le nombre d'octets de données du champ.

Les entrées discrètes du message de réponse sont empaquetées à raison d'une entrée par bit du champ de données. Le statut est indiqué par 1= ON; 0= OFF. Le LSB (bit de poids faible) du premier octet de données contient l'entrée adressée dans la demande. Les autres entrées suivent en direction de l'extrémité de poids fort de cet octet, puis du poids faible au poids fort des octets suivants.

Si la quantité d'entrées renvoyées n'est pas un multiple de huit, les bits restants de l'octet de données final doivent être complétés par des zéros (vers l'extrémité de poids fort de l'octet). Le champ de nombre d'octets de données spécifie la quantité d'octets de données d'entrée renvoyées, n (y compris l'octet complété, s'il y a lieu).

5.3.2 FAL PDU Lire bobines

5.3.2.1 Primitive de demande

Identificateur de service, code de fonction = 1 (0x01).

Ce code de fonction permet de lire l'état de 1 à 2000 bobines dans un dispositif distant. La PDU de demande spécifie l'adresse de départ, c'est-à-dire l'adresse de la première bobine spécifiée, et le nombre de bobines. Dans la PDU, les adresses des bobines commencent à zéro. Les bobines numérotées 1-16 ont donc pour adresses 0-15. L'adresse de départ peut aller de 0x0000 à 0xFFFF.

Le format est donné dans le Tableau 5

Tableau 5 – Demande Lire bobines

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 1 (0x01).
Adresse de la première bobine	Unsigned16	Adresse de la première bobine. Valeurs autorisées: 0x0000 à 0xFFFF
Quantité de bobines	Unsigned16	Quantité de bobines. Valeurs autorisées: 1 à 2000 (0x7D0)

5.3.2.2 Primitive de réponse

Le format est donné dans le Tableau 6.

Tableau 6 – Réponse à Lire bobines

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 1 (0x01). Écho de ce qui est demandé
Nombre d'octets de données	Unsigned16	Nombre d'octets lus
Données	Séquence de bits de statut	Valeurs de statut des discrets lus

Les données du champ contiennent n octets, n étant le nombre d'octets de données du champ.

Les bobines du message de réponse sont empaquetées à raison d'une entrée par bit du champ de données. Le statut est indiqué par 1= ON; 0= OFF. Le LSB (bit de poids faible) du premier octet de données contient l'entrée adressée dans la demande. Les autres bobines suivent en direction de l'extrémité de poids fort de cet octet, puis du poids faible au poids fort des octets suivants.

Si la quantité d'entrées renvoyées n'est pas un multiple de huit, les bits restants de l'octet de données final doivent être complétés par des zéros (vers l'extrémité de poids fort de l'octet). Le champ de nombre d'octets de données spécifie la quantité d'octets de données d'entrée renvoyées, n (y compris l'octet complété, s'il y a lieu).

5.3.3 FAL PDU Écrire bobine individuelle

5.3.3.1 Primitive de demande

Identificateur de service, code de fonction = 5 (0x05).

Ce code de fonction permet d'écrire une bobine individuelle à ON ou OFF dans un dispositif distant.

Le statut ON/OFF demandé est spécifié par une constante dans le champ de données de la demande. La valeur 0xFF00 demande que la sortie soit égale à ON. La valeur 0x0000 demande qu'elle soit égale à OFF. Les autres valeurs sont interdites et n'ont aucune influence sur la sortie.

La PDU de demande spécifie l'adresse de la bobine à forcer. Les adresses des bobines commencent à zéro. La bobine ayant le numéro 1 a donc l'adresse 0.

Le format est donné dans le Tableau 7.

Tableau 7 – Demande Écrire bobine individuelle

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 5 (0x05).
Adresse de la bobine	Unsigned16	Adresse de la bobine. Valeurs autorisées: 0x0000 à 0xFFFF
Bobine individuelle de données	Indicateur de statut	La valeur de statut de bobine individuelle qui doit être écrite. Valeurs autorisées: 0xFF00 ou 0x0000

5.3.3.2 Primitive de réponse

Le format est donné dans le Tableau 8.

Tableau 8 – Réponse à Écrire bobine individuelle

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé.
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 5 (0x05). Écho de ce qui est demandé.
Adresse de la bobine	Unsigned16	Adresse de la bobine. Écho de ce qui est demandé.
Bobine individuelle de données	Indicateur de statut	La valeur de statut de bobine individuelle qui doit être écrite. Écho de ce qui est demandé.

La réponse normale est un écho de la demande, renvoyé après que l'état de la bobine a été écrit.

5.3.4 FAL PDU Écrire plusieurs bobines

5.3.4.1 PrIMITIVE de demande

Identificateur de service, code de fonction = 15 (0x0F).

Ce code de fonction permet de forcer chaque bobine d'une séquence de bobines à ON ou OFF dans un dispositif distant.

La PDU de demande spécifie les références des bobines à forcer. Les adresses des bobines commencent à zéro. La bobine ayant le numéro 1 a donc l'adresse 0.

Le statut ON/OFF demandé pour les bobines est spécifié par le contenu du champ de données de la demande. Un '1' logique dans une position de bit du champ a pour effet de demander que la sortie correspondante soit à ON. Un '0' logique demande qu'elle soit égale à OFF.

Les bobines du message de demande sont empaquetées à raison d'une entrée par bit du champ de données. Si la quantité de bobines spécifiée n'est pas un multiple de huit, les bits restants de l'octet de données final doivent être complétés par des zéros (vers l'extrémité de poids fort de l'octet). Le champ de nombre d'octets spécifie la quantité d'octets de données, n (y compris l'octet complété, s'il y a lieu). Les données du champ contiennent les n octets de données, n étant le nombre d'octets du champ.

Le format est donné dans le Tableau 9.

Tableau 9 – Demande Écrire plusieurs bobines

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 15 (0x0F).
Adresse de la première bobine	Unsigned16	Adresse de la première bobine. Valeurs autorisées: 0x0000 à 0xFFFF
Quantité de bobines	Unsigned16	Quantité de bobines à écrire. Valeurs autorisées: 1 à 1968 (0x7B0); la valeur doit être compatible avec les paramètres Nombre d'octets de données et Données.
Nombre d'octets de données	Unsigned16	Nombre d'octets transportant les valeurs de statut de bobine à écrire. Valeurs autorisées: 1 à 246; la valeur doit être compatible avec les paramètres Quantité de bobines et Données.
Données	Séquence de bits de statut	Ce paramètre doit être utilisé pour spécifier les valeurs de statut de bobine qui doivent être écrites. Valeurs autorisées: les valeurs doivent être compatibles avec les paramètres Quantité de bobines et Nombre d'octets de données.

5.3.4.2 PrIMITIVE de réponse

Le format est donné dans le Tableau 10.

Tableau 10 – Réponse à Écrire plusieurs bobines

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé.
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 15 (0x0F).
Adresse de la première bobine	Unsigned16	Adresse de la première bobine. Écho de ce qui est demandé.
Quantité de bobines	Unsigned16	Quantité de bobines. Écho de ce qui est demandé.

La réponse normale est un écho des paramètres demandés ID d'unité, code de fonction, adresse de la première bobine et quantité de bobines.

5.3.5 FAL PDU Écrire en diffusion bobine individuelle**5.3.5.1 PrIMITIVE de demande**

Identificateur de service, code de fonction = 5 (0x05); ID d'unité = 0.

Ce code de fonction permet d'écrire une bobine individuelle à ON ou OFF dans tous les serveurs adressables par l'ID d'unité, en spécifiant ID d'unité = 0.

Il s'agit d'un service non confirmé.

Le statut ON/OFF demandé est spécifié par une constante dans le champ de données de la demande. La valeur 0xFF00 demande que la sortie soit égale à ON. La valeur 0x0000 demande qu'elle soit égale à OFF. Les autres valeurs sont interdites et n'ont aucune influence sur la sortie.

La PDU de demande spécifie l'adresse de la bobine à forcer. Les adresses des bobines commencent à zéro. La bobine ayant le numéro 1 a donc l'adresse 0.

Le format est donné dans le Tableau 11.

Tableau 11 – Demande Écrire en diffusion bobine individuelle

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 0
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 5 (0x05)
Adresse de la bobine	Unsigned16	Adresse de la bobine. Valeurs autorisées: 0x0000 à 0xFFFF
Bobine individuelle de données	Indicateur de statut	La valeur de statut de bobine individuelle qui doit être écrite. Valeurs autorisées: 0xFF00 ou 0x0000

5.3.6 FAL PDU Écrire en diffusion plusieurs bobines

5.3.6.1 Primitive de demande

Identificateur de service, code de fonction = 15 (0x0F); ID d'unité = 0.

Ce code de fonction permet de forcer chaque bobine d'une séquence de bobines à ON ou OFF dans tous les serveurs adressables par l'ID d'unité, en spécifiant ID d'unité = 0.

Il s'agit d'un service non confirmé.

La PDU de demande spécifie les références des bobines à forcer. Les adresses des bobines commencent à zéro. La bobine ayant le numéro 1 a donc l'adresse 0.

Le statut ON/OFF demandé pour les bobines est spécifié par le contenu du champ de données de la demande. Un '1' logique dans une position de bit du champ a pour effet de demander que la sortie correspondante soit à ON. Un '0' logique demande qu'elle soit égale à OFF.

Les bobines du message de demande sont empaquetées à raison d'une entrée par bit du champ de données. Si la quantité de bobines spécifiée n'est pas un multiple de huit, les bits restants de l'octet de données final doivent être complétés par des zéros (vers l'extrémité de poids fort de l'octet). Le champ de nombre d'octets spécifie la quantité d'octets de données, n (y compris l'octet complété, s'il y a lieu). Les données du champ contiennent les n octets de données, n étant le nombre d'octets du champ.

Le format est donné dans le Tableau 12.

Tableau 12 – Demande Écrire en diffusion plusieurs bobines

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 0
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 15 (0x0F)
Adresse de la première bobine	Unsigned16	Adresse de la première bobine. Valeurs autorisées: 0x0000 à 0xFFFF
Quantité de bobines	Unsigned16	Quantité de bobines à écrire. Valeurs autorisées: 1 à 1968 (0x7B0); la valeur doit être compatible avec les paramètres Nombre d'octets de données et Données
Nombre d'octets de données	Unsigned16	Nombre d'octets transportant les valeurs de statut de bobine à écrire. Valeurs autorisées: 1 à 246; la valeur doit être compatible avec les paramètres Quantité de bobines et Données
Données	Séquence de bits de statut	Ce paramètre doit être utilisé pour spécifier les valeurs de statut de bobine qui doivent être écrites. Valeurs autorisées: les valeurs doivent être compatibles avec les paramètres Quantité de bobines et Nombre d'octets de données.

5.3.7 FAL PDU Lire registres d'entrée

5.3.7.1 PrIMITIVE DE DEMANDE

Identificateur de service, code de fonction = 4 (0x04).

Ce code de fonction permet de lire l'état de 1 à 125 registres d'entrée dans un dispositif distant. La PDU de demande spécifie l'adresse du registre de départ et le nombre de registres. Dans la PDU, les adresses des registres commencent à zéro. Les registres d'entrée numérotés 1-16 ont donc pour adresses 0-15.

Le format est donné dans le Tableau 13.

Tableau 13 – Demande Lire registres d'entrée

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 4 (0x04)
Adresse du registre d'entrée à lire	Unsigned16	Adresse du registre d'entrée à lire. Valeurs autorisées: 0x0000 à 0xFFFF
Quantité de registres d'entrée	Unsigned16	Quantité de registres d'entrée à lire. Valeurs autorisées: 1 à 125 (0x7D)

5.3.7.2 PrIMITIVE DE RÉPONSE

Le format est donné dans le Tableau 14.

Tableau 14 – Réponse à Lire registres d'entrée

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé.
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 4 (0x04). Écho de ce qui est demandé.
Nombre d'octets de données	Unsigned16	Nombre d'octets lus.
Données	Matrice de Unsigned16	Valeurs des registres d'entrée lues.

Les données du paramètre de réponse contiennent n octets de données, n étant le nombre d'octets de données du paramètre de réponse, égal à deux fois la quantité de registres d'entrée requise.

Les données de registre des éléments de données du paramètre de réponse sont empaquetées à raison de deux octets par valeur de registre. Pour chaque registre, le premier octet contient les bits de valeur de registre de poids fort et le deuxième octet contient les bits de valeur de registre de poids faible (convention big-endian).

5.3.8 FAL PDU Lire registres de maintien

5.3.8.1 Primitive de demande

Identificateur de service, code de fonction = 3 (0x03).

Ce code de fonction permet de lire l'état de 1 à 125 registres de maintien dans un dispositif distant. La PDU de demande spécifie l'adresse du registre de départ et le nombre de registres. Dans la PDU, les adresses des registres commencent à zéro. Les registres d'entrée numérotés 1-16 ont donc pour adresses 0-15.

Le format est donné dans le Tableau 15.

Tableau 15 – Demande Lire registres de maintien

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 3 (0x03)
Adresse du premier registre de maintien à lire	Unsigned16	Adresse du premier registre de maintien à lire. Valeurs autorisées: 0x0000 à 0xFFFF
Quantité de registres de maintien à lire	Unsigned16	Quantité de registres de maintien à lire. Valeurs autorisées: 1 à 125 (0x7D)

5.3.8.2 Primitive de réponse

Le format est donné dans le Tableau 16.

Tableau 16 – Réponse à Lire registres de maintien

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé.
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 3 (0x03). Écho de ce qui est demandé.
Nombre d'octets de données	Unsigned16	Nombre d'octets lus.
Données	Matrice de Unsigned16	Valeurs des registres de maintien lues.

Les données du paramètre de réponse contiennent n octets de données, n étant le nombre d'octets de données du paramètre de réponse, égal à deux fois la quantité de registres de maintien requise.

Les données de registre des éléments de données du paramètre de réponse sont empaquetées à raison de deux octets par valeur de registre. Pour chaque registre, le premier octet contient les bits de valeur de registre de poids fort et le deuxième octet contient les bits de valeur de registre de poids faible (convention big-endian).

5.3.9 FAL PDU Écrire registre de maintien individuel

5.3.9.1 PrIMITIVE de demande

Identificateur de service, code de fonction = 6 (0x06).

Ce code de fonction permet d'écrire un registre de maintien individuel dans un dispositif distant.

La PDU de demande spécifie l'adresse du registre à écrire. Les adresses des registres commencent à zéro. Le registre ayant le numéro 1 a donc l'adresse 0.

Les données de registre des données du paramètre de demande sont empaquetées à raison de deux octets par registre. Pour chaque registre, le premier octet contient les bits de registre de poids fort et le deuxième octet contient les bits de registre de poids faible (convention big-endian).

Le format est donné dans le Tableau 17.

Tableau 17 – Demande Écrire registre de maintien individuel

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 6 (0x06)
Adresse du registre de maintien à écrire	Unsigned16	Adresse du registre de maintien à écrire. Valeurs autorisées: 0x0000 à 0xFFFF
Données	Unsigned16	Valeur de registre de maintien à écrire. Valeurs autorisées: 0x0000 à 0xFFFF

5.3.9.2 PrIMITIVE de réponse

Le format est donné dans le Tableau 18.

Tableau 18 – Réponse à Écrire registre de maintien individuel

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé.
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 6 (0x06). Écho de ce qui est demandé.
Adresse du registre de maintien à écrire	Unsigned16	Adresse du registre de maintien à écrire. Écho de ce qui est demandé.
Données	Unsigned16	Valeur de registre de maintien à écrire. Écho de ce qui est demandé.

La réponse normale est un écho de la demande, renvoyé après que le contenu du registre a été écrit.

5.3.10 FAL PDU Écrire plusieurs registres de maintien

5.3.10.1 PrIMITIVE de demande

Identificateur de service, code de fonction = 16 (0x10).

Ce code de fonction permet d'écrire de 1 à 123 registres de maintien dans un dispositif distant.

La PDU de demande spécifie l'adresse du registre de départ et le nombre de registres. Dans la PDU, les adresses des registres commencent à zéro. Les registres numérotés 1-16 ont donc pour adresses 0-15.

Les valeurs à écrire sont spécifiées dans le paramètre de données de la demande. Les données de registre des éléments de données du paramètre de demande sont empaquetées à raison de deux octets par valeur de registre. Pour chaque registre, le premier octet contient les bits de registre de poids fort et le deuxième octet contient les bits de registre de poids faible (convention big-endian).

Le format est donné dans le Tableau 19.

Tableau 19 – Demande Écrire plusieurs registres de maintien

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 16 (0x10)
Adresse du premier registre de maintien à écrire	Unsigned16	Adresse du premier registre de maintien à écrire. Valeurs autorisées: 0x0000 à 0xFFFF
Quantité de registres de maintien à écrire	Unsigned16	Quantité de registres de maintien à écrire. Valeurs autorisées: 1 à 123 (0x7B); la valeur doit être compatible avec les paramètres Nombre d'octets de données et Données.
Nombre d'octets de données	Unsigned16	Nombre d'octets à écrire. Valeurs autorisées: 1 à 246; la valeur doit être compatible avec les paramètres Quantité de registres de maintien à écrire et Données.
Données	Matrice de Unsigned16	Valeurs des registres de maintien à écrire. Valeurs autorisées: 1 à 123 éléments; la valeur doit être compatible avec les paramètres Quantité de registres de maintien à écrire et Nombre d'octets de données. Les valeurs d'éléments peuvent être comprises entre 0x0000 et 0xFFFF.

5.3.10.2 PrIMITIVE de réponse

Le format est donné dans le Tableau 20.

Tableau 20 – Réponse à Écrire plusieurs registres de maintien

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé.
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 16 (0x10). Écho de ce qui est demandé.
Adresse du premier registre de maintien à écrire	Unsigned16	Adresse du premier registre de maintien à écrire. Écho de ce qui est demandé.
Quantité de registres de maintien à écrire	Unsigned16	Quantité de registres de maintien à écrire. Écho de ce qui est demandé.

La réponse normale renvoie les paramètres demandés ID d'unité, code de fonction, adresse du premier registre de maintien à écrire et quantité de registres à écrire.

5.3.11 FAL PDU Écrire avec masque registre de maintien**5.3.11.1 PrIMITIVE de demande**

Identificateur de service, code de fonction = 22 (0x16).

Ce code de fonction permet de modifier le contenu d'un registre de maintien spécifié au moyen d'une combinaison d'un masque ET, d'un masque OU et du contenu courant du registre. La fonction peut être utilisée pour positionner ou remettre à zéro des bits individuels du registre. Cela s'effectue selon l'équation ((1)).

$$new_content = (old_content \wedge AND_Mask) \vee (OR_Mask \wedge \neg AND_Mask) \quad (1)$$

La demande spécifie le registre de maintien à écrire, les données à utiliser pour le masque ET et les données à utiliser pour le masque OU. Les adresses des registres commencent à zéro. Les registres 1-16 ont donc pour adresses 0-15.

Le format est donné dans le Tableau 21.

Tableau 21 – Demande Écrire avec masque registre de maintien

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 22 (0x16)
Adresse du registre de maintien à modifier	Unsigned16	Adresse du registre de maintien à modifier. Valeurs autorisées: 0x0000 à 0xFFFF
Masque ET	Unsigned16	Masque binaire AND_Mask qui produit le nouveau contenu du registre de maintien à modifier selon l'équation ((1)). Valeurs autorisées: 0x0000 à 0xFFFF
Masque OU	Unsigned16	Masque binaire OR_Mask qui produit le nouveau contenu du registre de maintien à modifier selon l'équation ((1)). Valeurs autorisées: 0x0000 à 0xFFFF

5.3.11.2 Primitive de réponse

Le format est donné dans le Tableau 22.

Tableau 22 – Demande Écrire avec masque registre de maintien

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé.
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 22 (0x16). Écho de ce qui est demandé.
Adresse du registre de maintien à modifier	Unsigned16	Adresse du registre de maintien à modifier. Écho de ce qui est demandé.
Masque ET	Unsigned16	Masque binaire AND_Mask qui produit le nouveau contenu du registre de maintien à modifier selon l'équation ((1)). Écho de ce qui est demandé.
Masque OU	Unsigned16	Masque binaire OR_Mask qui produit le nouveau contenu du registre de maintien à modifier selon l'équation ((1)). Écho de ce qui est demandé.

La réponse normale est un écho de la demande, renvoyé après que le contenu du registre a été écrit.

5.3.12 FAL PDU Lire/écrire registres de maintien

5.3.12.1 PrIMITIVE de demande

Identificateur de service, code de fonction = 23 (0x17).

Ce code de fonction effectue une combinaison d'une opération de lecture et d'une opération d'écriture sur les registres de maintien en un seul service.

L'opération d'écriture est effectuée avant l'opération de lecture.

Les adresses des registres de maintien commencent à zéro. Les registres de maintien 1-6 ont donc pour adresses 0-15 dans la PDU.

La demande spécifie l'adresse de départ et le nombre des registres de maintien à lire ainsi que l'adresse de départ, le nombre et les données des registres de maintien à écrire. Le nombre d'octets spécifie le nombre d'octets qui suivent dans le champ de données à écrire.

Les données du paramètre contiennent n octets de données, n étant le nombre d'octets de données du paramètre, égal à deux fois le paramètre de quantité de registres de maintien à écrire requise.

Les valeurs à écrire sont spécifiées dans le paramètre de données de la demande. Les données de registre des éléments de données du paramètre de demande sont empaquetées à raison de deux octets par valeur de registre. Pour chaque registre, le premier octet contient les bits de registre de poids fort et le deuxième octet contient les bits de registre de poids faible (convention big-endian).

Le format est donné dans le Tableau 23.

Tableau 23 – Demande Lire/écrire plusieurs registres de maintien

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 23 (0x17).
Adresse du premier registre de maintien à lire	Unsigned16	Adresse du premier registre de maintien à lire. Valeurs autorisées: 0x0000 à 0xFFFF
Quantité de registres de maintien à lire	Unsigned16	Quantité de registres de maintien à lire. Valeurs autorisées: 1 à 125 (0x7D).
Adresse du premier registre de maintien à écrire	Unsigned16	Adresse du premier registre de maintien à écrire. Valeurs autorisées: 0x0000 à 0xFFFF
Quantité de registres de maintien à écrire	Unsigned16	Quantité de registres de maintien à écrire. Valeurs autorisées: 1 à 121 (0x79), la valeur doit être compatible avec les paramètres Nombre d'octets de données et Données
Nombre d'octets de données	Unsigned16	Nombre d'octets à écrire. Valeurs autorisées: 1 à 242; la valeur doit être compatible avec les paramètres Quantité de registres de maintien à écrire et Données.
Données	Matrice de Unsigned16	Valeurs des registres de maintien à écrire. Valeurs autorisées: 1 à 123 éléments; la valeur doit être compatible avec les paramètres Quantité de registres de maintien à écrire et Nombre d'octets de données. Les valeurs d'élément peuvent être comprises entre 0x0000 et 0xFFFF.

5.3.12.2 Primitive de réponse

Le format est donné dans le Tableau 24.

Tableau 24 – Réponse à Lire/écrire plusieurs registres de maintien

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 23 (0x17). Écho de ce qui est demandé
Nombre d'octets de données	Unsigned16	Nombre d'octets lus
Données	Matrice de Unsigned16	Valeurs des registres de maintien lues

Les données du paramètre de réponse contiennent n octets de données, n étant le nombre d'octets de données du paramètre de réponse, égal à deux fois la quantité de registres de maintien requise.

Les données de registre des éléments de données du paramètre de réponse sont empaquetées à raison de deux octets par valeur de registre. Pour chaque registre, le premier octet contient les bits de valeur de registre de poids fort et le deuxième octet contient les bits de valeur de registre de poids faible (convention big-endian).

5.3.13 FAL PDU Lire FIFO

5.3.13.1 PrIMITIVE de demande

Identificateur de service, code de fonction = 24 (0x18).

Ce code de fonction permet de lire un nombre borné de registres de maintien, organisés pour faciliter une politique FIFO. Le nombre borné est a priori inconnu et fait partie de la réponse. La borne est de 32 registres: le registre contenant le nombre ci-dessus, plus jusqu'à 31 registres qui suivent.

Le format est donné dans le Tableau 25.

Tableau 25 – Demande Lire FIFO

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 24 (0x18)
Adresse de file d'attente FIFO	Unsigned16	Adresse du registre de maintien qui contient le nombre de registres de maintien de données de file d'attente FIFO qui suivent. Valeurs autorisées: 0x0000 à 0xFFFF

5.3.13.2 PrIMITIVE de réponse

Le format est donné dans le Tableau 26.

Tableau 26 – Réponse à Lire FIFO

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé.
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 3 (0x03). Écho de ce qui est demandé.
Nombre d'octets de données	Unsigned16	Nombre d'octets lus, y compris les octets du comptage de file d'attente FIFO.
Comptage file d'attente FIFO	Unsigned16	Nombre de registres de maintien de données de la file d'attente FIFO, lus dans le paramètre de données. Le registre de maintien du comptage de file d'attente FIFO n'en fait pas partie.
Données	Matrice de Unsigned16	Valeurs des registres de maintien lues.

Dans une réponse normale, le nombre d'octets de données indique la quantité d'octets qui suivent, qui se compose des octets du comptage de file d'attente FIFO et des octets de données.

Le comptage de file d'attente FIFO est la quantité de registres de données dans la file d'attente (non compris le registre de comptage de file d'attente FIFO lui-même).

Les données de registre des éléments de données du paramètre de réponse sont empaquetées à raison de deux octets par valeur de registre. Pour chaque registre, le premier octet contient les bits de valeur de registre de poids fort et le deuxième octet contient les bits de valeur de registre de poids faible (convention big-endian).

5.3.14 FAL PDU Écrire en diffusion registre de maintien individuel

5.3.14.1 PrIMITIVE DE DEMANDE

Identificateur de service, code de fonction = 6 (0x06); ID d'unité = 0.

Ce code de fonction permet d'écrire un registre de maintien individuel dans tous les serveurs adressables par l'ID d'unité, en spécifiant ID d'unité = 0.

Il s'agit d'un service non confirmé.

La PDU de demande spécifie l'adresse du registre à écrire. Les adresses des registres commencent à zéro. Le registre ayant le numéro 1 a donc l'adresse 0.

Les données de registre des données du paramètre de demande sont empaquetées à raison de deux octets par registre. Pour chaque registre, le premier octet contient les bits de registre de poids fort et le deuxième octet contient les bits de registre de poids faible (convention big-endian).

Le format est donné dans le Tableau 27.

Tableau 27 – Demande Écrire en diffusion registre de maintien individuel

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 0
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 6 (0x06).
Adresse du registre de maintien à écrire	Unsigned16	Adresse du registre de maintien à écrire. Valeurs autorisées: 0x0000 à 0xFFFF
Données	Unsigned16	Valeur de registre de maintien à écrire. Valeurs autorisées: 0x0000 à 0xFFFF

5.3.15 FAL PDU Écrire en diffusion plusieurs registres de maintien

5.3.15.1 PrIMITIVE DE DEMANDE

Identificateur de service, code de fonction = 16 (0x10); ID d'unité = 0.

Ce code de fonction permet d'écrire de 1 à 123 registres de maintien dans tous les serveurs adressables par l'ID d'unité, en spécifiant ID d'unité = 0.

Il s'agit d'un service non confirmé.

La PDU de demande spécifie l'adresse du registre de départ et le nombre de registres. Dans la PDU, les adresses des registres commencent à zéro. Les registres numérotés de 1 à 16 ont donc pour adresses 0-15.

Les valeurs à écrire sont spécifiées dans le paramètre de données de la demande. Les données de registre des éléments de données du paramètre de demande sont empaquetées à raison de deux octets par valeur de registre. Pour chaque registre, le premier octet contient les bits de registre de poids fort et le deuxième octet contient les bits de registre de poids faible (convention big-endian).

Le format est donné dans le Tableau 28.

Tableau 28 – Demande Écrire en diffusion plusieurs registres de maintien

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 0
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 16 (0x10).
Adresse du premier registre de maintien à écrire	Unsigned16	Adresse du premier registre de maintien à écrire. Valeurs autorisées: 0x0000 à 0xFFFF
Quantité de registres de maintien à écrire	Unsigned16	Quantité de registres de maintien à écrire. Valeurs autorisées: 1 à 123 (0x7B); la valeur doit être compatible avec les paramètres Nombre d'octets de données et Données.
Nombre d'octets de données	Unsigned16	Nombre d'octets à écrire. Valeurs autorisées: 1 à 246; la valeur doit être compatible avec les paramètres Quantité de registres de maintien à écrire et Données.
Données	Matrice de Unsigned16	Valeurs des registres de maintien à écrire. Valeurs autorisées: 1 à 123 éléments; la valeur doit être compatible avec les paramètres Quantité de registres de maintien à écrire et Nombre d'octets de données. Les valeurs d'élément peuvent être comprises entre 0x0000 et 0xFFFF.

5.3.16 FAL PDU Lire enregistrement de fichier**5.3.16.1 PrIMITIVE de demande**

Identificateur de service, code de fonction = 20 (0x14).

Ce code de fonction permet de lire plusieurs enregistrements dans un ou plusieurs fichiers.

Le format est donné dans le Tableau 29.

Tableau 29 – Demande Lire enregistrement de fichier

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 20 (0x14).
Nombre d'octets de tous les éléments des sous-demandes	Unsigned8	Nombre total d'octets (à l'exclusion de celui-ci) de toutes les sous-demandes suivantes. Valeurs autorisées: 7 (0x07) à 245 (0xF5). On obtient le minimum lorsqu'il n'y a qu'un élément de sous-demande; on obtient le maximum lorsqu'il y a 35 éléments de sous-demande. La borne supérieure est définie par la taille maximum de l'APDU du client/serveur (ID d'unité + Code de fonction + Données = 254 octets). Pour que la demande Lire enregistrement de fichier soit correcte, on devra aussi s'assurer que la taille totale de la réponse demandée, contenant tous les enregistrements demandés, ne dépasse pas cette limite supérieure.
Type de référence de sous-demande 1	Unsigned8	Partie d'un élément de sous-demande servant à spécifier le type de référence. Valeurs autorisées: Dans le contexte de ce service, la seule valeur autorisée est 6.
Numéro de fichier de sous-demande 1	Unsigned16	Partie d'un élément de sous-demande servant à spécifier le numéro de fichier. Valeurs autorisées: Le plus petit numéro de fichier est 1. Il convient que le numéro de fichier le plus grand soit de 10 (0x0A). NOTE Le numéro de fichier peut se trouver dans la plage 1 à 0xFFFF, mais il convient de noter que l'interopérabilité avec les équipements patrimoniaux peut se dégrader si le numéro de fichier est supérieur à 10 (0x0A).
Numéro d'enregistrement de sous-demande 1	Unsigned16	Partie d'un élément de sous-demande servant à spécifier le numéro d'enregistrement, qui contribue à la qualification de l'enregistrement. Les enregistrements sont identifiés au moyen de l'adresse de leur premier registre et de leur longueur, cette dernière étant spécifiée en nombre de registres; ce paramètre représente l'adresse du premier registre de l'enregistrement. Valeurs autorisées: Il convient que chaque fichier, à l'exception du dernier, contienne 10.000 registres, le dernier fichier pouvant en posséder moins. Cela donne des enregistrements adressés de 0x0000 à 0x270F (de 0000 à 9999 en valeurs décimales) au maximum. En conséquence, il convient que le numéro d'enregistrement se trouve dans la plage allant de 0x0000 à 0x270F. NOTE 1 Tout fichier peut posséder plus de 10.000 registres, ou moins, avec un maximum de 65.536 (0x10000), et par conséquent à avoir des enregistrements adressés de 0x0000 à 0xFFFF, mais il convient de noter que l'interopérabilité avec les équipements patrimoniaux peut se dégrader si aucun des fichiers à l'exception du dernier ne possède 10.000 registres, le dernier fichier pouvant en posséder moins. NOTE 2 Contrairement aux autres APO tels que les discrets, les bobines, les registres d'entrée et les registres de maintien, dans lesquels l'instance adressable inférieure est connue d'une application comme étant de base 1 et est adressée dans le protocole avec la base 0, l'enregistrement adressable inférieur est l'enregistrement 0, connu d'une application comme étant de base 0 et adressé dans le protocole avec une adresse de registre de base 0.

Nom de paramètre / champ	Type	Description
Longueur d'enregistrement de sous-demande 1	Unsigned16	Partie d'un élément de sous-demande servant à spécifier la longueur d'enregistrement, qui contribue à la qualification de l'enregistrement. Les enregistrements sont identifiés au moyen de l'adresse de leur premier registre et de leur longueur, cette dernière étant spécifiée en nombre de registres; ce paramètre représente la longueur de l'enregistrement en nombre de registres. Valeurs autorisées: Pour un numéro d'enregistrement donné, la longueur d'enregistrement, en nombre de registres, doit avoir pour résultat un enregistrement contenu dans le fichier. En outre, cette longueur d'enregistrement, combinée à toutes les autres parties de la demande, ne doit pas produire de réponse qui dépasse la taille maximum de l'APDU du client/serveur (ID d'unité + Code de fonction + Données = 254 octets).
Sous-demande 2		
Sous-demande n		

5.3.16.2 Primitive de réponse

Le format est donné dans le Tableau 30.

Tableau 30 – Réponse à Lire enregistrement de fichier

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé.
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 20 (0x14). Écho de ce qui est demandé.
Nombre d'octets de tous les éléments des sous-demandes	Unsigned8	Nombre total d'octets (à l'exclusion de celui-ci) de toutes les sous-réponses suivantes. Valeurs attendues: la valeur correspondant à la réussite dépend de la demande. Pour toute demande réussie, la valeur sera dans la plage allant de 4 (0x04) à 250 (0xFA). On obtient le minimum lorsqu'il n'y a qu'un élément de sous-réponse: il s'agit là de la plus petite sous-réponse, avec un enregistrement de longueur 1 registre. Le maximum peut être atteint de plusieurs façons, avec différentes combinaisons de nombre de sous-réponses et de longueurs d'enregistrement, par exemple avec 34 sous-réponses ayant chacune un enregistrement de longueur 1 registre (136 octets jusqu'ici), et une sous-réponse supplémentaire avec un enregistrement d'une longueur de 56 registres ($2 + (56 \times 2) = 114$ octets). La borne supérieure est définie par la taille maximum de l'APDU du client/serveur (ID d'unité + Code de fonction + Données = 254 octets). Pour que la demande Lire enregistrement de fichier soit correcte, on devra s'assurer que la taille totale de la réponse demandée, contenant tous les enregistrements demandés, ne dépasse pas cette borne supérieure.
Nombre d'octets de sous-réponse 1	Unsigned8	Partie d'un élément de sous-réponse servant à spécifier le nombre total d'octets (à l'exclusion de lui-même) de la sous-réponse. Le nombre comprend l'octet de type de référence et les octets contenus dans la matrice de données d'enregistrement, soit au total 1 + deux fois la longueur d'enregistrement spécifiée dans la sous-demande correspondante, qui est exprimée en nombre de registres. Valeurs attendues: la valeur correspondant à la réussite dépend de la demande. Pour toute demande réussie, la valeur sera au minimum de 3 (0x03) et au maximum de 249 (0xF9). Le minimum s'obtient lorsque l'enregistrement demandé a une longueur de 1 registre. On atteint le maximum lorsque l'enregistrement demandé a une longueur de 124 registres, et dans ce cas il s'agit de la seule sous-réponse.
Type de référence de sous-réponse 1	Unsigned8	Partie d'un élément de sous-réponse servant à spécifier le type de référence. Écho de ce qui est demandé.
Matrice de données d'enregistrement de sous-réponse 1	Unsigned16	1er registre de la matrice de données d'enregistrement d'un élément de sous-réponse.
	Unsigned16	2ème registre de la matrice de données d'enregistrement d'un élément de sous-réponse.
	Unsigned16	n-ième registre de la matrice de données d'enregistrement d'un élément de sous-réponse.
Sous-réponse 2		
Sous-réponse n		

5.3.17 FAL PDU Écrire enregistrement de fichier

5.3.17.1 Primitive de demande

Identificateur de service, code de fonction = 21 (0x15).

Ce code de fonction permet d'écrire plusieurs enregistrements dans un ou plusieurs fichiers.

Le format est donné dans le Tableau 31.

Tableau 31 – Demande Écrire enregistrement de fichier

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 21 (0x15).
Nombre d'octets de tous les éléments des sous-demandes	Unsigned8	Nombre total d'octets (à l'exclusion de celui-ci) de toutes les sous-demandes suivantes. Valeurs autorisées: 9 (0x09) à 251 (0xFB). On obtient le minimum lorsqu'il n'y a qu'un élément de sous-demande: il s'agit là de la plus petite sous-demande, avec un enregistrement de longueur 1 registre. Le maximum peut être atteint de plusieurs façons, avec différentes combinaisons de nombre de sous-demandes et de longueurs d'enregistrement, par exemple avec 3 sous-demandes, une ayant un enregistrement de longueur 1 registre (9 octets jusqu'ici), une ayant un enregistrement d'une longueur de 113 registres (130 octets jusqu'ici) et enfin une dernière ayant un enregistrement d'une longueur de 113 registres (au total, 251 octets). La borne supérieure est définie par la taille maximum de l'APDU du client/serveur (ID d'unité + Code de fonction + Données = 254 octets). Pour être correcte, la demande Écrire enregistrement de fichier doit avoir une réponse normale qui ne dépasse pas la limite supérieure, car dans ce cas, comme décrit ci-dessous, la réponse de réussite de Écrire enregistrement de fichier est une copie exacte de la demande Écrire enregistrement de fichier.
Type de référence de sous-demande 1	Unsigned8	Partie d'un élément de sous-demande servant à spécifier le type de référence. Valeurs autorisées: Dans le contexte de ce service, la seule valeur autorisée est 6.
Numéro de fichier de sous-demande 1	Unsigned16	Partie d'un élément de sous-demande servant à spécifier le numéro de fichier. Valeurs autorisées: Le plus petit numéro de fichier est 1. Il convient que le numéro de fichier le plus grand soit de 10 (0x0A). NOTE Le numéro de fichier peut se trouver dans la plage 1 à 0xFFFF, mais il convient de noter que l'interopérabilité avec les équipements patrimoniaux peut se dégrader si le numéro de fichier est supérieur à 10 (0x0A).

Nom de paramètre / champ	Type	Description
Numéro d'enregistrement de sous-demande 1	Unsigned16	Partie d'un élément de sous-demande servant à spécifier le numéro d'enregistrement, qui contribue à la qualification de l'enregistrement. Les enregistrements sont identifiés au moyen de l'adresse de leur premier registre et de leur longueur, cette dernière étant spécifiée en nombre de registres; ce paramètre représente l'adresse du premier registre de l'enregistrement. Valeurs autorisées: Il convient que chaque fichier, à l'exception du dernier, contienne 10.000 registres, le dernier fichier pouvant en posséder moins. Cela donne des enregistrements adressés de 0x0000 à 0x270F (de 0000 à 9999 en valeurs décimales) au maximum. En conséquence, il convient que le numéro d'enregistrement se trouve dans la plage allant de 0x0000 à 0x270F. NOTE 1 Tout fichier peut posséder plus de 10.000 registres, ou moins, avec un maximum de 65.536 (0x10000), et par conséquent avoir des enregistrements adressés de 0x0000 à 0xFFFF, mais il convient de noter que l'interopérabilité avec les équipements patrimoniaux peut se dégrader si aucun des fichiers à l'exception du dernier ne possède 10.000 registres, le dernier fichier pouvant en posséder moins. NOTE 2 Contrairement aux autres APO tels que les discrets, les bobines, les registres d'entrée et les registres de maintien, dans lesquels l'instance adressable inférieure est connue d'une application comme étant de base 1, et est adressée dans le protocole avec la base 0, l'enregistrement adressable inférieur est l'enregistrement 0, connu d'une application comme étant de base 0 et adressé dans le protocole avec une adresse de registre de base 0.
Longueur d'enregistrement de sous-demande 1	Unsigned16	Partie d'un élément de sous-demande servant à spécifier la longueur d'enregistrement, qui contribue à la qualification de l'enregistrement. Les enregistrements sont identifiés au moyen de l'adresse de leur premier registre et de leur longueur, cette dernière étant spécifiée en nombre de registres; ce paramètre représente la longueur de l'enregistrement en nombre de registres. Valeurs autorisées: Pour un numéro d'enregistrement donné, la longueur d'enregistrement, en nombre de registres, doit avoir pour résultat un enregistrement contenu dans le fichier. En outre, cette longueur d'enregistrement, combinée à toutes les autres parties de la demande, ne doit pas produire de réponse qui dépasse la taille maximum de l'APDU du client/serveur (ID d'unité + Code de fonction + Données = 254 octets).
Matrice de données d'enregistrement de sous-demande 1	Unsigned16	1er registre de la matrice de données d'enregistrement d'un élément de sous-demande.
	Unsigned16	2ème registre de la matrice de données d'enregistrement d'un élément de sous-demande.
	Unsigned16	3ème registre de la matrice de données d'enregistrement d'un élément de sous-demande.
Sous-demande 2		
Sous-demande n		

5.3.17.2 Primitive de réponse

La réponse normale est un écho de la demande. Le format est donné dans le Tableau 32.

Tableau 32 – Réponse à Écrire enregistrement de fichier

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé.
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 21 (0x15). Écho de ce qui est demandé.
Nombre d'octets de tous les éléments des sous-demandes	Unsigned8	Nombre total d'octets (à l'exclusion de celui-ci) de toutes les sous-demandes suivantes. Écho de ce qui est demandé.
Type de référence de sous-demande 1	Unsigned8	Partie d'un élément de sous-demande servant à spécifier le type de référence. Écho de ce qui est demandé.
Numéro de fichier de sous-demande 1	Unsigned16	Partie d'un élément de sous-demande servant à spécifier le numéro de fichier. Écho de ce qui est demandé.
Numéro d'enregistrement de sous-demande 1	Unsigned16	Partie d'un élément de sous-demande servant à spécifier le numéro d'enregistrement, qui contribue à la qualification de l'enregistrement. Les enregistrements sont identifiés au moyen de l'adresse de leur premier registre et de leur longueur, cette dernière étant spécifiée en nombre de registres; ce paramètre représente l'adresse du premier registre de l'enregistrement. Écho de ce qui est demandé.
Longueur d'enregistrement de sous-demande 1	Unsigned16	Partie d'un élément de sous-demande servant à spécifier la longueur d'enregistrement, qui contribue à la qualification de l'enregistrement. Les enregistrements sont identifiés au moyen de l'adresse de leur premier registre et de leur longueur, cette dernière étant spécifiée en nombre de registres; ce paramètre représente la longueur de l'enregistrement en nombre de registres. Écho de ce qui est demandé.
Matrice de données d'enregistrement de sous-demande 1	Unsigned16	1er registre de la matrice de données d'enregistrement d'un élément de sous-demande. Écho de ce qui est demandé.
	Unsigned16	2ème registre de la matrice de données d'enregistrement d'un élément de sous-demande. Écho de ce qui est demandé.
	Unsigned16	3ème registre de la matrice de données d'enregistrement d'un élément de sous-demande. Écho de ce qui est demandé.
Sous-demande 2		Écho de ce qui est demandé.
Sous-demande n		Écho de ce qui est demandé.

5.3.18 FAL PDU Lire identification de dispositif

5.3.18.1 Primitive de demande

Identificateur de service, code de fonction/type MEI = 43 (0x2B)/14 (0x0E).

Ce code de fonction/type MEI permet de récupérer les objets d'identification de dispositif.

Le format est donné dans le Tableau 33.

Tableau 33 – Demande Lire identification de dispositif

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Valeurs autorisées: 1 à 247
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 43 (0x2B).
MEI	Unsigned8	Type interface encapsulée. Valeurs autorisées: 14 (0x0E).
Code d'ID de lecture de dispositif	Unsigned8	Type d'accès au dispositif demandé, qui qualifie les informations demandées d'après les catégories de dispositif décrites dans le Tableau 34 et, si elle est supportée, la récupération d'objets adressés individuellement. Ceci est illustré dans le Tableau 35. Valeurs autorisées: comme indiqué dans le Tableau 35.
ID d'objet demandé	Unsigned8	Le premier objet demandé ou l'objet individuel demandé, selon le code d'ID de lecture de dispositif. La réponse ne peut pas dépasser la taille maximum de l'APDU du client/serveur (ID d'unité + Code de fonction + Données = 254 octets). Par définition, la taille d'un objet individuel est nécessairement inférieure à la taille maximum. Si l'ensemble d'objets renvoyés nécessite un nombre d'octets supérieur à la taille maximum, plusieurs transactions (demande/réponse) sont nécessaires. Ceci est à la charge du client d'application. Si les objets demandés sont nombreux, l'ID du premier objet demandé dans la première transaction doit être fixé à 0x00. Si l'ID de l'objet initial n'est pas 0x00, l'identification de dispositif renvoyée est en général incomplète. Les demandes qui suivent portant sur le même ensemble d'objets doivent positionner l'ID d'objet demandé sur l'ID d'objet suivant renvoyé par le serveur dans la réponse précédente. Si l'on fournit un ID d'objet demandé différent, l'identification de dispositif renvoyée est en général incomplète. Si, lorsque les objets demandés sont nombreux, l'ID de l'objet demandé ne correspond à aucun objet connu, le serveur répond comme si l'objet demandé était l'objet d'ID 0x00, ce qui produit un recommencement à partir du début si cela arrive lorsque la récupération est en cours. Si le serveur supporte la récupération d'un objet individuel, et que la demande est effectuée avec un ID d'objet demandé qui ne correspond à aucun objet connu, le serveur renvoie comme réponse un message d'erreur. Valeurs autorisées: 0x00 à 0xFF.

Tableau 34 – Catégories d'identification de dispositif

ID d'objet	Nom d'objet / Description	Type	Présence	Catégorie
0x00	Nom du vendeur	Chaîne ASCII	Obligatoire	Base
0x01	Code du produit	Chaîne ASCII	Obligatoire	
0x02	Révision mineure/majeure	Chaîne ASCII	Obligatoire	
0x03	URL du vendeur	Chaîne ASCII	Optionnel	Normale
0x04	Désignation du produit	Chaîne ASCII		
0x05	Nom de modèle	Chaîne ASCII		
0x06	Nom de l'application utilisateur	Chaîne ASCII		
0x07	<i>Réservé</i>			
... 0x7F				
0x80	<i>Objets définis par une application privée. Une application peut utiliser la plage d'ID d'objet [0x80 – 0xFF] pour définir ses propres objets.</i>	Dépend du dispositif	Optionnel	Étendue
... 0xFF				

Tableau 35 – Code d'ID de lecture de dispositif

Valeur	Code d'ID de lecture de dispositif
0x01	Demande de récupération d'objets dans la catégorie Identification de dispositif de base. Le retour attendu est un flux d'objets.
0x02	Demande de récupération d'objets dans la catégorie Identification de dispositif normale, si elle existe, ceci entraînant également une demande destinée à la catégorie Identification de dispositif de base. Le retour attendu est un flux d'objets, la catégorie Identification de dispositif de base étant renvoyée en premier, suivie de la catégorie Identification de dispositif normale, si elle existe.
0x03	Demande de récupération d'objets dans la catégorie Identification de dispositif étendue, si elle existe, ceci entraînant également une demande destinée à la catégorie Identification de dispositif normale, si elle existe, et à la catégorie Identification de dispositif de base. Le retour attendu est un flux d'objets, la catégorie Identification de dispositif de base étant renvoyée en premier, suivie de la catégorie Identification de dispositif normale, si elle existe, puis de la catégorie Identification de dispositif étendue, si elle existe.
0x04	Demande de récupération d'un objet spécifique. Si cette fonction est supportée, le retour attendu est un objet individuel, sinon la réponse renvoyée est un message d'erreur.

NOTE Les catégories renvoyées sont ordonnées comme indiqué dans le Tableau 35, mais il convient de ne tirer aucune conclusion quant à l'ordre des objets renvoyés dans une catégorie quelconque, même entre les différents appels de service. Cela a pour but d'éviter d'imposer des charges de traitement supplémentaires aux serveurs, ceux-ci pouvant résider dans des dispositifs très élémentaires, et de permettre le meilleur regroupement possible des objets lorsque la récupération d'objets multiples nécessite des transactions demande/réponse multiples.

5.3.18.2 Primitive de réponse

Le format est donné dans le Tableau 36.

Tableau 36 – Réponse à Lire identification de dispositif

Nom de paramètre / champ	Type	Description
ID d'unité	Unsigned8	Adresse du serveur. Écho de ce qui est demandé.
Code de fonction	Unsigned8	Identificateur de service, code de fonction = 43 (0x2B). Écho de ce qui est demandé.
MEI	Unsigned8	Type interface encapsulée. Écho de ce qui est demandé.
Code d'ID de lecture de dispositif	Unsigned8	Type d'accès au dispositif demandé, qui qualifie les informations demandées d'après les catégories de dispositif décrites dans le Tableau 34 et, si elle est supportée, la récupération d'objets adressés individuellement. Ceci est illustré dans le Tableau 35. Écho de ce qui est demandé.
Niveau de conformité	Unsigned8	Catégories d'objet réelles et type d'accès de récupération d'objet mis à disposition par le serveur. Sa valeur est fournie par le serveur dans toutes les réponses, quel que soit le code d'ID de lecture de dispositif demandé. Les valeurs sont illustrées dans le Tableau 37. La description du paramètre de lecture d'ID de dispositif expliquait ce qui est renvoyé lorsque l'on envoie des objets inconnus du serveur. Pour les objets connus, si un code d'ID de lecture de dispositif demande une catégorie ou un type d'accès qui n'est pas disponible sur le serveur, les objets renvoyés correspondent à ce qui est décrit dans le Tableau 38
Indicateur Davantage disponibles	Unsigned8	Informations indiquant s'il existe ou non davantage d'objets à récupérer après une demande/réponse. Il est significatif si le code d'ID de lecture de dispositif prend l'une des valeurs 0x01, 0x02 ou 0x03 et si la réponse dépasse la taille maximum de l'APDU du client/serveur (ID d'unité + Code de fonction + Données = 254 octets). La valeur 0x00 signifie qu'il n'y a pas d'autre objet disponible, tandis que la valeur 0xFF signifie que d'autres demandes doivent être émises pour récupérer les objets restants. La signification de ce paramètre est liée à celle du paramètre ID d'objet suivant.
ID d'objet suivant	Unsigned8	ID de l'objet qui doit être demandé dans la demande suivante lorsque l'indicateur Davantage disponibles est à 0xFF. Ceci est à la charge du client et, si l'ID d'objet suivant de la demande qui suit ne correspond à aucun objet connu, le serveur répond comme si l'objet demandé était l'objet d'ID 0x00, ce qui produit un recommencement à partir du début.
Nombre d'objets	Unsigned8	Partie du paramètre de la matrice de Lire identification de dispositif. Chaque élément porte un objet. Chaque élément identifie et représente de manière unique un objet de l'espace d'adresses d'identification de dispositif au moyen de l'ID d'objet renvoyé, de la longueur d'objet et de la valeur d'objet. Tous ces paramètres sont décrits ci-dessous.
Objet 1 ID d'objet renvoyé	Unsigned8	Partie de l'élément de matrice d'objets, qui identifie l'objet de manière unique. Sa description est identique à celle de l'ID d'objet demandé; il fait partie du flux qui a été initié par l'ID d'objet demandé.
Objet 1 Longueur d'objet	Unsigned8	Partie de l'élément de matrice d'objets. Il spécifie la longueur de la valeur d'objet, en octets.
Objet 1 Valeur d'objet	Comme indiqué dans le Tableau 34	Partie de l'élément de matrice d'objets, qui contribue à l'identification des dispositifs.
Objet 2		
...		
Objet n		

Tableau 37 – Niveau de conformité

Valeur	Code d'ID de lecture de dispositif
0x01	Le dispositif supporte uniquement la catégorie Identification de dispositif de base, et uniquement l'accès sous forme de flux.
0x02	Outre la catégorie Identification de dispositif de base, le dispositif supporte également la catégorie Identification de dispositif normale, et uniquement l'accès sous forme de flux.
0x03	Outre la catégorie Identification de dispositif de base et la catégorie Identification de dispositif normale, le dispositif supporte également la catégorie Identification de dispositif étendue, et uniquement l'accès sous forme de flux.
0x81	Le dispositif supporte uniquement la catégorie Identification de dispositif de base, et à la fois l'accès sous forme de flux et l'accès individuel.
0x82	Outre la catégorie Identification de dispositif de base, le dispositif supporte également la catégorie Identification de dispositif normale, et à la fois l'accès sous forme de flux et l'accès individuel.
0x83	Outre la catégorie Identification de dispositif de base et la catégorie Identification de dispositif normale, le dispositif supporte également la catégorie Identification de dispositif étendue, et à la fois l'accès sous forme de flux et l'accès individuel.

Tableau 38 – Objets connus demandés et renvoyés

ID de lecture de dispositif	Niveau de conformité	Objets renvoyés
0x01 ou 0x02 ou 0x03	0x01	Le serveur renvoie les objets de la catégorie Identification de dispositif de base. Les objets sont renvoyés sous forme de flux.
0x01	0x02	Le serveur renvoie les objets de la catégorie Identification de dispositif de base. Les objets sont renvoyés sous forme de flux.
0x02 ou 0x03	0x02	Outre les objets de la catégorie Identification de dispositif de base, le serveur renvoie ensuite les objets de la catégorie Identification de dispositif normale. Les objets sont renvoyés sous forme de flux.
0x01	0x03	Le serveur renvoie les objets de la catégorie Identification de dispositif de base. Les objets sont renvoyés sous forme de flux.
0x02	0x03	Outre les objets de la catégorie Identification de dispositif de base, le serveur renvoie ensuite les objets de la catégorie Identification de dispositif normale. Les objets sont renvoyés sous forme de flux.
0x03	0x03	Outre les objets de la catégorie Identification de dispositif de base, suivis des objets de la catégorie Identification de dispositif normale, le serveur renvoie ensuite les objets de la catégorie Identification de dispositif étendue. Les objets sont renvoyés sous forme de flux.
0x04	0x01 ou 0x02 ou 0x03	Le serveur renvoie une réponse sous forme de message d'erreur signalant une fonction illégale.
0x01 ou 0x02 ou 0x03	0x81	Le serveur renvoie les objets de la catégorie Identification de dispositif de base. Les objets sont renvoyés sous forme de flux.
0x01	0x82	Le serveur renvoie les objets de la catégorie Identification de dispositif de base. Les objets sont renvoyés sous forme de flux.
0x02 ou 0x03	0x82	Outre les objets de la catégorie Identification de dispositif de base, le serveur renvoie ensuite les objets de la catégorie Identification de dispositif normale. Les objets sont renvoyés sous forme de flux.
0x01	0x83	Le serveur renvoie les objets de la catégorie Identification de dispositif de base. Les objets sont renvoyés sous forme de flux.
0x02	0x83	Outre les objets de la catégorie Identification de dispositif de base, le serveur renvoie ensuite les objets de la catégorie Identification de dispositif normale. Les objets sont renvoyés sous forme de flux.
0x03	0x83	Outre les objets de la catégorie Identification de dispositif de base, suivis des objets de la catégorie Identification de dispositif normale, le serveur renvoie ensuite les objets de la catégorie Identification de dispositif étendue. Les objets sont renvoyés sous forme de flux.
0x04	0x81 ou 0x82 ou 0x83	Le serveur renvoie l'objet demandé individuellement.

5.4 Représentation des données "sur le fil"

Le mode client/serveur utilise une représentation big-endian pour les adresses et les éléments de données. Cela signifie que lorsqu'une quantité numérique supérieure à un octet individuel est transmise, l'octet de poids fort est envoyé en premier.

Exemple (Informatif): Un registre est du type Unsigned16, quantité contenant plusieurs octets. Si sa valeur est 0x1234, le premier octet envoyé est 0x12 et le deuxième octet envoyé est 0x34.

6 Syntaxe abstraite du mode fournisseur/abonné


La syntaxe abstraite des APDU est combinée à leur syntaxe de transfert et est spécifiée à l'Article 7.

7 Syntaxe de transfert du mode fournisseur/abonné

7.1 Généralités

La couche application émettrice prépare une APDU à transférer vers la couche application réceptrice. Elle utilise à cet effet les paramètres donnés par les primitives de service. Il n'existe qu'un format d'APDU, à savoir le format empaqueté produit à l'aide des services de messenger, qui associe les APDU provenant des autres services. Cela offre de la flexibilité et des possibilités d'extension, les différences étant codées en tant que contenu dans l'APDU elle-même.

Dans le contexte du mode fournisseur/abonné, l'APDU empaquetée est également appelée message, les sous-APDU constituant également appelées des sous-messages. La composition de l'APDU est illustrée au moyen de la notation UML sur la Figure 6.

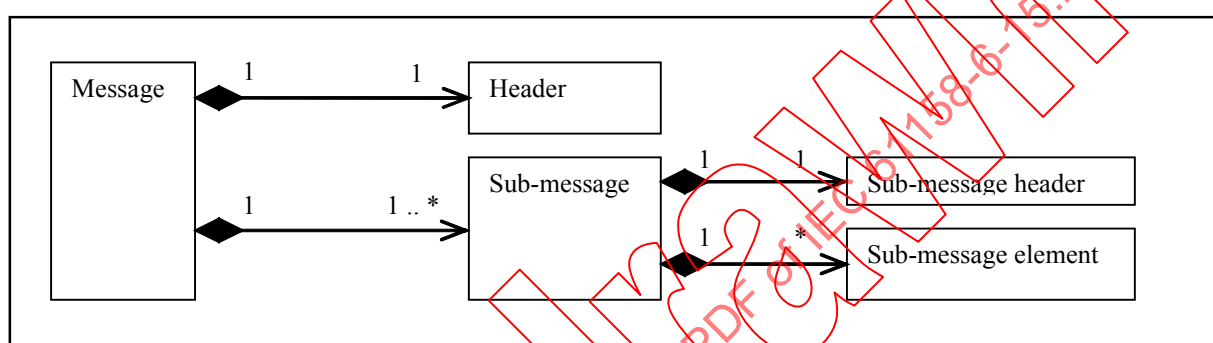

Légende

Anglais	Français
Message	Message
Header	En-tête
Sub-message	Sous-message
Sub-message header	En-tête de sous-message
Sub-message element	Élément de sous-message

Figure 6 – APDU du modèle fournisseur/abonné

7.2 Structure d'APDU

L'APDU générique est constituée d'un en-tête de départ suivi d'un nombre variable de sous-messages. Chaque sous-message commence en étant aligné sur une frontière de 32 bits avec le début du message. Les détails de l'APDU sont présentés dans le Tableau 39.

L'APDU a une longueur bien connue. Cette longueur n'est pas envoyée explicitement par le protocole fournisseur/abonné mais fait partie du transport sous-jacent servant à envoyer les APDU. Dans le cas de l'UDP/IP, la longueur de l'APDU est la longueur de la charge utile UDP.

Tableau 39 – Structure de l'APDU

	32 bits
en-tête longueur fixe de 16 octets	
sous-message 1 32 bits alignés longueur variable	
...	...
sous-message n 32 bits alignés longueur variable	

Il est commode de considérer l'en-tête de message comme une sous-APDU en elle-même, en dépit du fait qu'il s'agit d'un en-tête. Dans la CEI 61158-5-15, il a été extrait comme un des services de l'ASE de messenger parce qu'il présente de nombreuses similarités avec d'autres services de cet ASE, qui modifient les valeurs par défaut définies par l'en-tête. Il est également différent; sa sous-APDU a une longueur fixe de 16 octets, c'est un singleton et il est identifié par son emplacement plutôt que par un identificateur de service. L'en-tête de message est décrit en tant que partie des structures d'APDU spécifiques aux services, après la discussion de la structure des sous-messages.

L'en-tête fait partie de l'ensemble des sous-messages logistiques: en-tête, INFO_DST, INFO_REPLY, INFO_SRC, INFO_TS et PAD. Le fournisseur/abonné est un protocole point à point; ces messages sont entièrement à la charge de l'application utilisateur.

NOTE Le DDS de l'OMG, comme dans "Data Distribution Service for Real-Time Systems Specification, Version 1.1, décembre 2005", définit des services qui sont présentés ici comme relevant plutôt de la responsabilité de l'utilisateur de l'AL fournisseur/abonné. Le fournisseur/abonné est un protocole point à point, et en tant que tel une partie des fonctionnalités est remise à l'application de l'utilisateur. On peut le constater à la flexibilité apportée aux mises en œuvre dans lesquelles l'encombrement est une préoccupation majeure, qui contribue à l'omniprésence de cette approche.

Les types sont définis dans la CEI 61158-5-15. Les octets de chaque sous-message sont dans l'ordre spécifié jusqu'à l'octet des *indicateurs*; après cela, des types multi-octets sont placés "sur le fil" selon l'indicateur d'endianity, et cela peut modifier l'ordonnancement sur la base des sous-messages.

7.3 Structure des sous-messages

7.3.1 Généralités

La structure générale de chaque sous-message d'un message est illustrée dans le Tableau 40.

Tableau 40 – Structure des sous-messages

Nom de paramètre / champ	Type	Description
ID de sous-message	Unsigned8	Il s'agit du codage de l'identificateur de service.
Indicateurs	OctetString, 1 octet	Les indicateurs codent certains des paramètres.
OctetsToNextHeader	Unsigned16	Paramètre qui permet de composer des sous-messages de longueur variable.
Contenu spécifique au sous-message	OctetString, longueur variable	Décrit avec les structures d'APDU spécifiques aux services.

7.3.2 Identificateurs de service

Cet octet d'ID de sous-message transporte le codage des identificateurs de service. Les ID 0x00 à 0x7F (inclus) sont spécifiques au protocole. Ils sont définis en tant que partie du protocole fournisseur/abonné. La version majeure 1 du mode fournisseur/abonné définit les ID de sous-message comme indiqué dans le Tableau 41.

Tableau 41 – Codage des identificateurs de service fournisseur/abonné

Codage	Service
0x01	PAD
0x02	VAR
0x03	Question
0x04 à 0x05	Réservé
0x06	ACK
0x07	Pulsation
0x08	GAP
0x09	INFO_TS
0x0A à 0x0B	Réservé
0x0C	INFO_SRC
0x0D	INFO_REPLY
0x0E	INFO_DST
0x0F à 0x7F	Réservé
0x80 à 0xFF	disponibles pour utilisation pour des extensions spécifiques aux vendeurs; leur interprétation dépend du vendorID codé dans l'en-tête de message

La signification des ID de sous-message ne peut pas être modifiée dans cette version majeure (1). On peut ajouter d'autres sous-messages dans les versions mineures supérieures. Les sous-messages ayant pour ID 0x80 à 0xFF (inclus) sont spécifiques aux vendeurs; ils ne sont pas définis par le protocole. Leur interprétation dépend du *vendorID* courant au moment où le sous-message est rencontré. La description de l'en-tête spécifie de quelle façon le *vendorID* courant est déterminé.

7.3.3 Indicateurs

Le bit de poids faible (LSB) des indicateurs est toujours présent dans tous les sous-messages; il représente l'endianness utilisé pour coder l'information dans le sous-message. E=0 signifie big-endian, E=1 signifie little-endian. Ceci se définit sous-message par sous-message.

C'est le seul indicateur ayant une position dédiée, la position du LSB, dans l'octet des indicateurs.

Les autres bits de l'octet des indicateurs ont des interprétations qui dépendent du type de sous-message.

Dans les descriptions suivantes des sous-messages, le caractère "X" sert à indiquer un indicateur inutilisé dans la version 1.0 du protocole. Il convient que les mises en œuvre fournisseur/abonné de la version 1.0 positionnent ces indicateurs à zéro lors de l'envoi et qu'elles n'en tiennent pas compte lors de la réception. Les versions mineures supérieures du protocole peuvent utiliser ces indicateurs.

7.3.4 OctetsToNextHeader

Les deux derniers octets de l'en-tête de sous-message contiennent le nombre d'octets allant du premier octet du contenu du sous-message au premier octet de l'en-tête du sous-message suivant. La représentation de ce champ est une valeur courte non signée (ushort) de la Common Data Representation (CDR). La CDR est documentée dans "Common Object Request Broker Architecture: Core Specification", ainsi qu'en 0 de la présente spécification pour la partie concernant le fournisseur/abonné.

Si le sous-message est le dernier du message, le champ *octetsToNextHeader* contient soit le nombre d'octets restant dans le message, soit la sentinelle 0. La sentinelle signifie que la longueur du contenu du dernier message doit être déduite par d'autres moyens (calculée d'après la longueur de chacun des sous-messages précédents et la longueur de l'ensemble du message). Cela permet d'avoir un dernier sous-message plus grand que ce qui peut être spécifié par le codage Unsigned16. En général, étant donné les exigences d'alignements, le champ *octetsToNextHeader* peut être plus grand que la longueur des données de sous-message courantes.

7.4 Interprétation des APDU

7.4.1 Généralités

L'interprétation et la signification d'un sous-message, d'une sous-APDU dans un message ou d'une APDU peuvent dépendre des sous-messages précédents contenus dans ce même message. Par conséquent, le destinataire d'un message doit maintenir l'état des sous-messages précédemment désérialisés dans le même message.

Le Tableau 42 énumère les attributs que l'on rencontre en examinant les structures d'APDU spécifiques aux services; ces attributs peuvent être modifiés de façon modale par les paramètres de certaines APDU spécifiques aux services et affectent l'interprétation des attributs suivants. Les types sont définis dans la CEI 61158-5-15.

Tableau 42 – Attributs modifiés de façon modale et affectant les interprétations des APDU

Nom d'attribut	Type	Description
sourceVersion	ProtocolVersion	Les versions majeure et mineure avec lesquelles les sous-messages qui suivent doivent être interprétés.
sourceVendorID	VendorID	L'identification du vendeur avec lequel les extensions spécifiques vendeur suivantes doivent être interprétées.
sourceHostID, sourceAppID	HostID, AppID	L'hôte de l'émetteur et les identificateurs de l'application. Les sous-messages qui suivent doivent être identifiés s'ils viennent de cet hôte et de cette application.
destHostID, destAppID	HostID, AppID	L'hôte de la destination et les identificateurs de l'application. Les sous-messages qui suivent doivent être identifiés s'ils sont destinés à cet hôte et à cette application.
unicastReplyIPAddress, unicastReplyPort	IPAddress, Port	Une adresse IP explicite et un port qui donnent au destinataire un moyen direct supplémentaire pour répondre directement à l'émetteur par diffusion individuelle.
multicastReplyIPAddress, multicastReplyPort	IPAddress, Port	Une adresse IP explicite et un port qui donnent au destinataire un moyen direct supplémentaire pour atteindre l'émetteur (et potentiellement bien d'autres) par multidiffusion.
haveTimestamp, timestamp	Boolean, NtpTime	L'horodatage qui s'applique à tous les sous-messages qui suivent.

7.4.2 Règles

L'algorithme suivant souligne les règles que le destinataire d'un message doit suivre:

- 1) si l'on ne peut lire un en-tête de sous-message de 4 octets, le reste du message est considéré invalide;
- 2) les deux derniers octets d'un en-tête de sous-message, le champ *octetsToNextHeader*, contiennent le nombre d'octets du sous-message suivant. Si ce champ est invalide, le reste du message est invalide.
- 3) le premier octet d'un en-tête de sous-message est le *sub-messageID*. Un sous-message dont l'ID est inconnu doit être ignoré, et l'analyse doit se poursuivre sur le sous-message suivant. Concrètement: une mise en œuvre de fournisseur/abonné 1.0 doit ignorer tout sous-message dont l'ID n'appartient pas à la liste des *sub-messageID* utilisée par la version 1.0. Les ID se trouvant dans la plage spécifique au vendeur mais provenant d'un *vendorID* qui est inconnu doivent être ignorés, et l'analyse doit se poursuivre avec le sous-message suivant;
- 4) le deuxième octet d'un en-tête de sous-message contient des indicateurs; il convient que les indicateurs inconnus soient ignorés. Il convient que les mises en œuvre de fournisseur/abonné 1.0 ignorent tous les indicateurs marqués d'un "X" (inutilisé) dans le protocole;
- 5) on doit *toujours* utiliser un champ *octetsToNextHeader* valide pour trouver le sous-message suivant, même pour les sous-messages ayant des ID inconnus;

- 6) si un sous-message est connu mais invalide, le reste du message est invalidé. Les 7.5.1 à 7.5.10.1 décrivent chacune les sous-messages connus et indiquent à quel moment il convient de les considérer invalides.

La réception d'un en-tête de message valide et/ou d'un sous-message valide a deux effets:

- elle peut changer l'état du destinataire; cet état influence la façon dont les sous-messages suivants du message sont interprétés. Les 7.5.1 à 7.5.10.1 indiquent la façon dont l'état change pour chaque sous-message. Dans cette version du protocole, seuls l'En-tête et les sous-messages INFO_SRC, INFO_REPLY et INFO_TS changent l'état du destinataire;
- le sous-message, interprété à l'intérieur du message, a une interprétation logique: il code l'un des cinq services fournisseur/abonné de base: ACK, GAP, PULSATION, QUESTION ou VAR, en dehors des services logistiques.

7.5 Structures d'APDU spécifiques aux services

7.5.1 FAL PDU Question

7.5.1.1 Primitive de demande

Identificateur de service, ID de sous-message = 3 (0x03).

Ce sous-message est utilisé par un fournisseur pour fournir des données d'utilisateur à un ou plusieurs abonnés.

Il s'agit d'un service non confirmé.

Le format est donné dans le Tableau 43, le Tableau 44 et le Tableau 45.

Tableau 43 – Demande Question

Nom de paramètre / champ	Type	Description
ID de sous-message	Unsigned8	Identificateur de service, ID de sous-message = 3 (0x03).
Indicateurs	Chaîne d'octet, 1 octet, voir Tableau 44 et Tableau 45	Indicateurs booléens codés en octets, décrits séparément.
OctetsToNextHeader	Unsigned16	Nombre d'octets depuis le premier octet du contenu de ce sous-message jusqu'au premier octet de l'en-tête du sous-message suivant, pour tous les sous-messages sauf le dernier. Voir en 7.3.4.
readerObjectID	ObjectID	Valeurs autorisées: 0x0000 à 0xFFFF Permet de spécifier le GUID d'abonnement <destHostID, destAppID, Issue.readerObjectID> auquel le service Question est destiné. L'identificateur Issue.readerObjectID peut être OBJECTID_UNKNOWN, auquel cas le service Question s'applique à tous les abonnements situés dans l'application <destHostID, destAppID>.
writerObjectID	ObjectID	Permet de spécifier le GUID de publication <sourceHostID, sourceAppID, Issue.writerObjectID> qui a émis la Question.
issueSeqNumber	SequenceNumber	Permet de spécifier le numéro de séquence qui identifie la Question.
parameterSequence	ParameterSequence	Dépend de la valeur de l'indicateur hasParameterSequence; il doit être utilisé pour fournir une liste variable de paramètres de Question opérationnels et permet de réaliser des extensions fournisseur/abonné.
issueData	Le type est communiqué par configuration ou par convention dans la spécification de sujet ou par le mécanisme de découverte	Ce paramètre spécifie les données d'utilisateur d'AL réelles de cette Question.

Tableau 44 – Indicateurs de la demande question

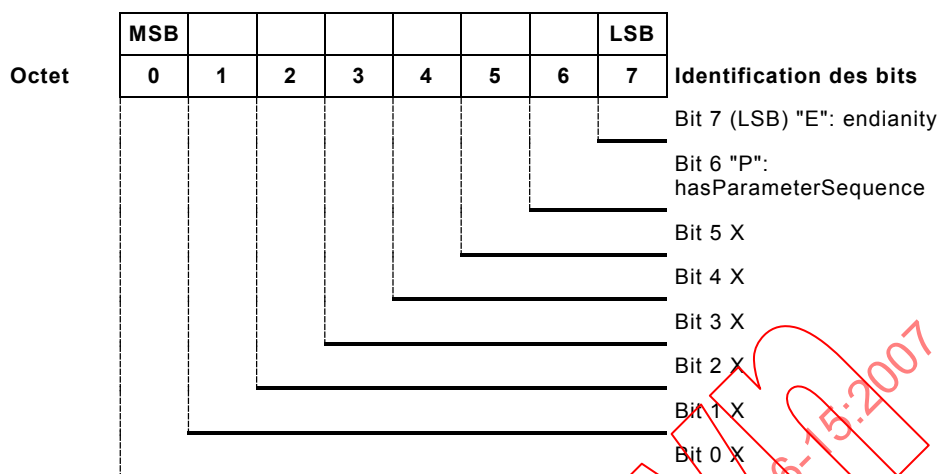


Tableau 45 – Signification des indicateurs de la demande question

Indicateur booléen	Description
endianness	Spécifie l'endianness de cette demande et indication de service. Valeurs: {big-endian, 0}, {little-endian, 1}
hasParameterSequence	Spécifie la présence ou l'absence d'un paramètre parameterSequence. Valeurs: {NO, 0}, {YES, 1}

7.5.1.2 Validité

Ce sous-message est *invalide* si l'une quelconque des situations suivantes se produit:

- *octetsToNextHeader* est trop petit au regard des autres sous-messages et des informations du message;
- *issueSeqNumber* est soit non strictement positif (1,2,...), soit non égal à SEQUENCE_NUMBER_UNKNOWN;
- la séquence de paramètres est invalide.

7.5.1.3 Changement dans l'état du destinataire

Aucun.

7.5.1.4 Interprétation logique

Tableau 46 – Interprétation de la question

Attribut	Valeur	Description
subscriptionGUID	<destHostId, destApplId, ISSUE.readerObjectId>	L'abonnement auquel la QUESTION est destinée. L'identificateur ISSUE.readerObjectId peut être OBJECTID_UNKNOWN, auquel cas la QUESTION s'applique à tous les abonnements situés dans l'application <destHostId, destApplId>.
publicationGUID	<sourceHostId, sourceApplId, ISSUE.writerObjectId>	L'objet Publication qui a émis cette question.
issueSeqNumber	ISSUE.issueSeqNumber	Le numéro de séquence de cette question; il convient que ce numéro soit, soit un nombre strictement positif (1,2,3,...), soit le numéro de séquence spécial SEQUENCENUMBER_UNKNOWN. Ce dernier peut être utilisé par une publication simple qui ne numérote pas les questions consécutives.
(paramètres)	ISSUE.paramètres (iff ISSUE.P==1)	(option) Présent iff P == 1. Ces paramètres autorisent des extensions futures du protocole.
ACKIPAddressPortList	{ unicastReplyIPAddress:unicastReplyPort }	Les destinations auxquelles la Publication peut envoyer un message ACK en réponse à cette QUESTION.
(horodatage)	timestamp (présent iff haveTimestamp == true)	(option) horodatage de cette question
issueData	ISSUE.issueData	Les données d'utilisateur réelles de cette question

7.5.2 FAL PDU Pulsation

7.5.2.1 PrIMITIVE de demande

Identificateur de service, ID de sous-message = 7 (0x07).

Ce sous-message sert à détecter la présence d'un lecteur et à informer un ou plusieurs lecteurs de la disponibilité d'informations chez un auteur au moyen de numéros de séquence.

Il s'agit d'un service non confirmé.

Le format est donné dans le Tableau 47, le Tableau 48 et le Tableau 49.

Tableau 47 – Demande Pulsation

Nom de paramètre / champ	Type	Description
ID de sous-message	Unsigned8	Identificateur de service, ID de sous-message = 7 (0x07).
Indicateurs	Chaîne d'octet, 1 octet, voir Tableau 48 et Tableau 49	Indicateurs booléens codés en octets, décrits séparément.
OctetsToNextHeader	Unsigned16	Nombre d'octets depuis le premier octet du contenu de ce sous-message jusqu'au premier octet de l'en-tête du sous-message suivant, pour tous les sous-messages sauf le dernier. Voir en 7.3.4.
readerObjectID	ObjectID	Valeurs autorisées: 0x0000 à 0xFFFF Permet de spécifier le GUID de lecteur <destHostID, destAppID, Heartbeat.readerObjectID> auquel le service Pulsation est destiné. Le Heartbeat.readerObjectID peut être OBJECTID_UNKNOWN, auquel cas le service Pulsation s'applique à tous les lecteurs situés dans l'application <destHostId, destAppId>.
writerObjectID	ObjectID	Permet de spécifier le GUID d'auteur <sourceHostID, sourceAppID, Heartbeat.writerObjectID> qui a émis la Pulsation.
firstSeqNumber	SequenceNumber	Permet de spécifier le premier numéro de séquence qui est encore disponible et significatif dans l'auteur identifié par writerObjectID. Ce champ doit être supérieur ou égal à zéro. S'il est égal à SEQUENCE_NUMBER_NONE, il n'y a pas de données disponibles chez l'auteur.
lastSeqNumber	SequenceNumber	Ce paramètre spécifie le dernier numéro de séquence qui est disponible dans l'auteur identifié par writerObjectID. Ce champ doit être supérieur ou égal à firstSeqNumber. Si firstSeqNumber est égal à SEQUENCE_NUMBER_NONE, lastSeqNumber doit lui aussi être égal à SEQUENCE_NUMBER_NONE.

Tableau 48 – Indicateurs de la demande pulsation

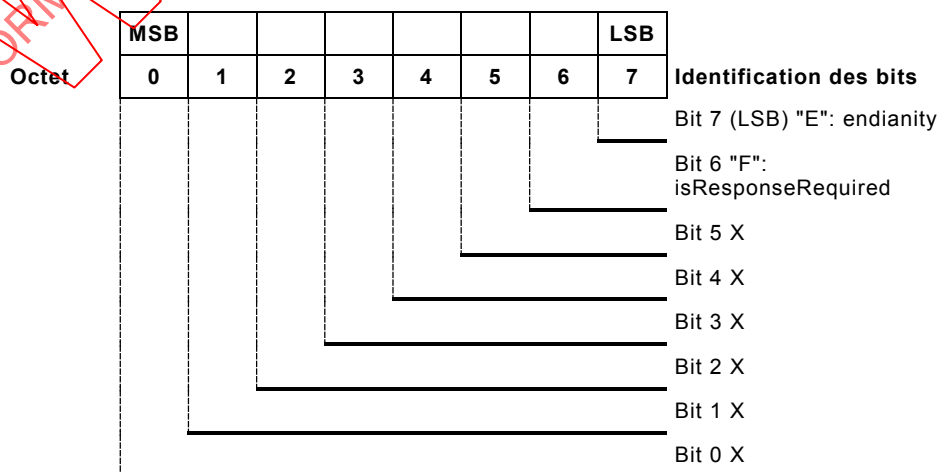


Tableau 49 – Signification des indicateurs de la demande pulsation

Indicateur booléen	Description
endianity	Spécifie l'endianity de cette demande et indication de service. Valeurs: {big-endian, 0}, {little-endian, 1}
responselsNotRequired	Spécifie si l'application qui envoie la Pulsation exige ou non une réponse. Connu avec "F", qui signifie "Final". Valeurs: {FALSE, it IS required, 0}, {TRUE, it IS NOT required, 1}

7.5.2.2 Validité

Ce sous-message est *invalide* si l'une quelconque des situations suivantes se produit:

- *octetsToNextHeader* est trop petit au regard des autres sous-messages et des informations du message;
- *firstSeqNumber* est inférieur à 0;
- *lastSeqNumber* est inférieur à 0;
- *lastSeqNumber* est strictement inférieur à *firstSeqNumber*.

7.5.2.3 Changement dans l'état du destinataire

Aucun.

7.5.2.4 Interprétation logique

Tableau 50 – Interprétation de la pulsation

Attribut	Valeur	Description
FINAL-bit	HEARTBEAT.F	Lorsque le F-bit est positionné, l'application qui envoie la PULSATION n'exige pas de réponse.
readerGUID	<destHostId, destAppld, HEARTBEAT.readerObjectId>	Le lecteur auquel la pulsation s'applique. Le HEARTBEAT.readerObjectId peut être OBJECTID_UNKNOWN, auquel cas la PULSATION s'applique à tous les lecteurs de ce writerGUID dans l'application <destHostId, destAppld>.
writerGUID	<sourceHostId, sourceAppld, HEARTBEAT.writerObjectId>	L'auteur auquel la PULSATION s'applique.
ACKIPAddressPortList	{ unicastReplyIPAddress:unicastReplyPort }	Liste supplémentaire de destinations auxquelles les réponses (ACK) à ce sous-message peuvent être envoyées.
firstSeqNumber	HEARTBEAT.firstSeqNumber	Le premier numéro de séquence, <i>firstSeqNumber</i> , qui est encore disponible et significatif dans le <i>writerObject</i> . Ce champ doit être supérieur ou égal à zéro. S'il est égal à SEQUENCE_NUMBER_NONE, il n'y a pas de données disponibles chez l'auteur.
lastSeqNumber	HEARTBEAT.lastSeqNumber	Le dernier numéro de séquence, <i>lastSeqNumber</i> , qui est disponible et significatif dans l'auteur. Ce champ doit être supérieur ou égal à <i>firstSeqNumber</i> . Si <i>firstSeqNumber</i> est SEQUENCE_NUMBER_NONE, <i>lastSeqNumber</i> doit être lui aussi SEQUENCE_NUMBER_NONE.

7.5.3 FAL PDU VAR

7.5.3.1 Primitive de demande

Identificateur de service, ID de sous-message = 2 (0x02).

Ce sous-message est utilisé par les CSTWriters pour publier des métadonnées pour les CSTReaders, c'est-à-dire dans le cas présent des informations au sujet des attributs d'un objet de réseau. Ces informations font partie d'un état composite.

Il s'agit d'un service non confirmé.

Le format est donné dans le Tableau 51, le Tableau 52 et le Tableau 53.

Tableau 51 – Demande VAR

Nom de paramètre / champ	Type	Description
ID de sous-message	Unsigned8	Identificateur de service, ID de sous-message = 2 (0x02).
Indicateurs	Chaîne d'octet, 1 octet, voir Tableau 52 et Tableau 53	Indicateurs booléens codés en octets, décrits séparément
OctetsToNextHeader	Unsigned16	Nombre d'octets depuis le premier octet du contenu de ce sous-message jusqu'au premier octet de l'en-tête du sous-message suivant, pour tous les sous-messages sauf le dernier. Voir en 7.3.4.
readerObjectID	ObjectID	Valeurs autorisées: 0x0000 à 0xFFFF Permet de spécifier le GUID de lecteur <destHostID, destAppID, VAR.readerObjectID> auquel le service VAR est destiné. Le VAR.readerObjectID peut être OBJECTID_UNKNOWN, auquel cas le service VAR s'applique à tous les lecteurs du writerObjectID situé dans l'application <destHostID, destAppID>.
writerObjectID	ObjectID	Permet de spécifier le GUID de CSTWriter <sourceHostID, sourceAppID, VAR.writerObjectID> qui a émis le VAR.
hostID	HostID	Dépend de la valeur de l'indicateur hasHostIDandAppID; s'il est présent, combiné aux paramètres appID et objectID, il doit être utilisé pour spécifier le GUID de l'objet que concernent les informations transportées par ce VAR.
appID	AppID	Dépend de la valeur de l'indicateur hasHostIDandAppID; s'il est présent, combiné aux paramètres hostID et objectID, il doit être utilisé pour spécifier le GUID de l'objet que concernent les informations transportées par ce VAR.
objectID	ObjectID	Permet de spécifier le GUID de l'objet que concernent les informations transportées par ce VAR. Si les paramètres hostID et appID sont présents, le GUID est <VAR.hostID, VAR.appID, VAR.objectID>; sinon, combiné aux valeurs modal/état fournies par le service Messenger, le GUID est <sourceHostID, sourceAppID>
writerSeqNumber	SequenceNumber	Permet d'étiqueter les changements d'état composite fournis par le CSTWriter; il est incrémenté chaque fois qu'un changement de cet état composite a lieu; il convient de lui faire prendre comme valeur un nombre strictement positif (1, 2, ...); on peut également envoyer le numéro de séquence spécial, SEQUENCE_NUMBER_UNKNOWN, pour indiquer que l'expéditeur ne garde pas la trace des numéros de séquence.
parameterSequence	ParameterSequence	Dépend de la valeur de l'indicateur hasParameterSequence; il doit être utilisé pour fournir une liste variable de paramètres de Question opérationnels et permet de réaliser des extensions fournisseur/abonné.

Tableau 52 – Indicateurs de la demande VAR

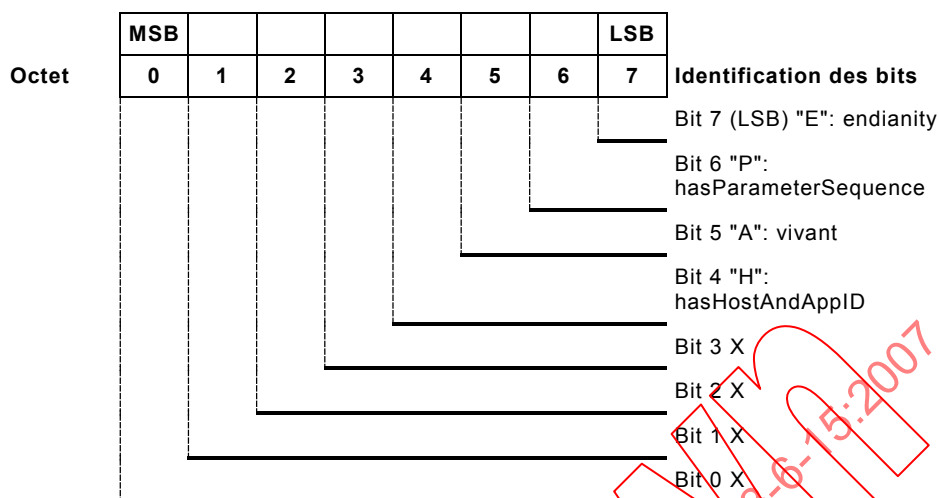


Tableau 53 – Signification des indicateurs de la demande VAR

Indicateur booléen	Description
endianity	Spécifie l'endianity de cette demande et indication de service. Valeurs: {big-endian, 0}, {little-endian, 1}
hasParameterSequence	Spécifie la présence ou l'absence d'un paramètre parameterSequence. Valeurs: {NO, 0}, {YES, 1}
vivant	Indique au lecteur si l'objet de données est vivant ou s'il est non vivant (éliminé). Valeurs: {NO, 0}, {YES, 1}
hasHostAndAppID	Spécifie la présence ou l'absence des paramètres hostID et appID. Valeurs: {NO, 0}, {YES, 1}

7.5.3.2 Validité

Ce sous-message est *invalide* si l'une quelconque des situations suivantes se produit:

- *octetsToNextHeader* est trop petit au regard des autres sous-messages et des informations du message;
- *writerSeqNumber* est non strictement positif (1,2,...) ou est égal à SEQUENCE_NUMBER_UNKNOWN;
- la séquence de paramètres est invalide.

7.5.3.3 Changement dans l'état du destinataire

Aucun.

7.5.3.4 Interprétation logique

Tableau 54 – Interprétation du VAR

Attribut	Valeur	Description
readerGUID	<destHostId, destAppld, VAR.readerObjectId>	Le lecteur auquel le VAR s'applique. Le VAR.readerObjectId peut être OBJECTID_UNKNOWN, auquel cas le VAR s'applique à tous les lecteurs de ce writerGUID dans l'application <destHostId, destAppld>.
writerGUID	<sourceHostId, sourceAppld, VAR.writerObjectId>	Le CSTWriter qui a envoyé l'information.
objectGUID	<VAR.hostId, VAR.appld, VAR.objectId> (iff H == 1) <sourceHostId, sourceAppld, VAR.objectId> (iff H == 0)	L'objet de cette information (contenue dans les paramètres).
writerSeqNumber	VAR.writerSeqNumber	Incrémenté chaque fois qu'un changement se produit dans l'état composite fourni par le CSTWriter. Il convient que ce soit un nombre strictement positif (1, 2, ...). On peut également envoyer le numéro de séquence spécial SEQUENCE_NUMBER_UNKNOWN, pour indiquer que l'expéditeur ne garde pas la trace du numéro de séquence.
(horodatage)	current.timestamp if current.haveTimestamp == true	(option) Présent iff current.haveTimestamp == true. Horodatage des nouveaux paramètres envoyé avec ce sous-message.
(paramètres)	VAR.parameters (iff VAR.P==1)	(option) Présent iff VAR.P == 1. Contient des informations à propos de l'objet.
ALIVE-bit	VAR.A	Indique au lecteur si l'objet de données est vivant ou s'il est non vivant (éliminé).
ACKIPAddressPortList	{ unicastReplyIPAddress:unicastReplyIPPort, writer>IPAddressPortList() }	Où les ACK doivent être envoyés en réponse à ce sous-message.

7.5.4 FAL PDU GAP

7.5.4.1 Primitive de demande

Identificateur de service, ID de sous-message = 8 (0x08).

Ce sous-message est envoyé par un CSTWriter à un CSTReader pour indiquer qu'une plage de numéros de séquence n'est plus pertinente. Cet ensemble peut être une plage contiguë de numéros de séquence ou un ensemble spécifique de numéros de séquence.

Il s'agit d'un service non confirmé.

Le format est donné dans le Tableau 55, le Tableau 56 et le Tableau 57.

Tableau 55 – Demande GAP

Nom de paramètre / champ	Type	Description
ID de sous-message	Unsigned8	Identificateur de service, ID de sous-message = 3 (0x03).
Indicateurs	Chaîne d'octet, 1 octet, voir Tableau 56 et Tableau 57	Indicateurs booléens codés en octets, décrits séparément.
OctetsToNextHeader	Unsigned16	Nombre d'octets depuis le premier octet du contenu de ce sous-message jusqu'au premier octet de l'en-tête du sous-message suivant, pour tous les sous-messages sauf le dernier. Voir en 7.3.4.
readerObjectID	ObjectID	Valeurs autorisées: 0x0000 à 0xFFFF Permet de spécifier le GUID de lecteur <destHostID, destAppID, GAP.readerObjectID> auquel le service GAP est destiné. Le GAP.readerObjectID peut être OBJECTID_UNKNOWN, auquel cas le service GAP s'applique à tous les lecteurs situés dans l'application <destHostID, destAppID>.
writerObjectID	ObjectID	Spécifie le GUID de CSTWriter <sourceHostID, sourceAppID, GAP.writerObjectID> qui est le sujet des numéros de séquence GAP de cet appel de service GAP.
firstSeqNumber	SequenceNumber	Utilisé avec le paramètre <i>bitmap</i> pour spécifier les numéros de séquence qui ne sont plus disponibles dans l'objet de réseau writerObjectID: la liste des numéros de séquence qui ne sont plus disponibles est la réunion de: tous les numéros de séquence de la plage allant de <i>GAP.firstSeqNumber</i> à <i>GAP.bitmap.bitmapBase</i> – 1; cette liste est vide si <i>firstSeqNumber</i> est supérieur ou égal à la <i>bitmapBase</i> du <i>bitmap</i> ; il convient que <i>GAP.firstSeqNumber</i> soit toujours supérieur ou égal à 1;
bitmap	Bitmap	<i>et</i> des numéros de séquence dont le bit correspondant dans le <i>bitmap</i> est positionné à 1. Ce paramètre est utilisé avec le paramètre <i>firstSeqNumber</i> pour spécifier les numéros de séquence qui ne sont plus disponibles dans l'objet de réseau writerObjectID, comme détaillé dans la description ci-dessus de <i>firstSeqNumber</i> .

Tableau 56 – Indicateurs de la demande GAP

