

INTERNATIONAL STANDARD



Overhead lines – Requirements and tests for spacers

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2020 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IECNORM.COM : Click to view the IEC Standard IEC 60384-2:2020 REV1



IEC 61854

Edition 2.0 2020-02
REDLINE VERSION

INTERNATIONAL STANDARD



Overhead lines – Requirements and tests for spacers

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.240.20

ISBN 978-2-8322-7900-7

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD	4
1 Scope	6
2 Normative references	6
3 Terms and definitions	8
4 General requirements	8
4.1 Design	8
4.2 Materials	9
4.2.1 General	9
4.2.2 Non-metallic materials	9
4.3 Mass, dimensions and tolerances	9
4.4 Protection against corrosion	9
4.5 Manufacturing appearance and finish	9
4.6 Marking	10
4.7 Installation instructions	10
4.8 Specimen	10
5 Quality assurance	10
6 Classification of tests	10
6.1 Type tests	10
6.1.1 General	10
6.1.2 Application	10
6.2 Sample tests	11
6.2.1 General	11
6.2.2 Application	11
6.2.3 Sampling and acceptance criteria	11
6.3 Routine tests	11
6.3.1 General	11
6.3.2 Application and acceptance criteria	11
6.4 Table of tests to be applied	11
7 Test methods	14
7.1 Visual examination	14
7.2 Verification of dimensions, materials and mass	14
7.3 Corrosion protection test	14
7.3.1 Hot dip galvanized components (other than stranded galvanized steel wires)	14
7.3.2 Ferrous components protected from corrosion by methods other than hot dip galvanizing	15
7.3.3 Stranded galvanized steel wires	15
7.3.4 Corrosion caused by non-metallic components	15
7.4 Non-destructive tests	15
7.5 Mechanical tests	15
7.5.1 Clamp slip tests	15
7.5.2 Tests on bolt sets	23
7.5.3 Simulated short-circuit current test and compression and tension tests	26
7.5.4 Characterisation of the elastic and damping properties	33
7.5.5 Flexibility tests	37
7.5.6 Fatigue tests	40

7.6	Tests to characterise elastomers	45
7.6.1	General	45
7.6.2	Tests	45
7.6.3	Ozone resistance test	45
7.7	Electrical tests	47
7.7.1	Corona and radio interference voltage (RIV) tests.....	47
7.7.2	Electrical resistance test.....	48
7.8	Verification of vibration behaviour of the bundle/spacer system	49
Annex A (normative) Minimum technical details to be agreed between purchaser and supplier.....		50
Annex B (informative) Compressive forces in the simulated short-circuit current test		51
Annex C (informative) Characterisation of the elastic and damping properties Stiffness-Damping Method		52
Annex D (informative) Verification of vibration behaviour of the bundle/spacer system.....		54
D.1	General.....	54
D.2	Aeolian vibration	54
D.3	Subspan oscillation.....	55
Annex E (informative) Description of HT conductors as given in CIGRE TB 695-2017 [7]		56
Bibliography.....		57
Figure 1 – Test arrangements for longitudinal slip tests		18
Figure 2 – Test arrangement for torsional slip tests.....		22
Figure 3 – Test arrangement for the spring force test at room temperature		24
Figure 4 – Test arrangement for permanent load test on conical washers		25
Figure 5 – Test arrangements for simulated short-circuit current tests		30
Figure 6 – Test arrangements for compression and tension test.....		32
Figure 7 – Typical logarithmic decrement graph.....		36
Figure 8 – Sketch of longitudinal displacement test.....		38
Figure 9 – Sketch of vertical displacement test		39
Figure 10 – Sketch of conical displacement test.....		39
Figure 11 – Sketch of transverse horizontal displacement test		40
Figure 12 – Test arrangements for subspan oscillation tests		43
Figure 13 – Test arrangement for aeolian vibration test		45
Figure C.1 – Rotation of spacer arm around the centre of the hinge.....		52
Figure C.2 – Vector representation of formula C.2		53
Table 1 – Tests on spacers.....		13
Table 2 – Tests on elastomers		47

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**OVERHEAD LINES –
REQUIREMENTS AND TESTS FOR SPACERS****FOREWORD**

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

This redline version of the official IEC Standard allows the user to identify the changes made to the previous edition. A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text.

International Standard IEC 61854 has been prepared by IEC technical committee 11: Overhead lines.

This second edition cancels and replaces the first edition published in 1998. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) Consider the application of spacers on high temperature conductors specifying additional high temperature tests in clamp slip tests and for the characterization of elastic and damping properties;
- b) Specify as far as possible test parameters and acceptance values;
- c) Avoid as far as possible the alternative procedures for the same test;
- d) Introduce a simpler test device for the simulated short circuit current test;
- e) Introduce test at low temperature on fastener components such as break away bolts and conical spring washers;
- f) Prescribe a different procedure for subspan oscillation tests on spacers equipped with clamps having rod attachments;
- g) Modify the test procedure for the aeolian vibration tests;
- h) Prescribe a different procedure for aeolian vibration tests on spacers equipped with clamps having rod attachments;
- i) Re-edit all the figures in order to make them more clear and homogeneous;
- j) Introduce an additional test device for the simulated short circuit current test.

The text of this standard is based on the following documents:

FDIS	Report on voting
11/265/FDIS	11/272/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

OVERHEAD LINES – REQUIREMENTS AND TESTS FOR SPACERS

1 Scope

This document applies to spacers for conductor bundles of overhead lines. It covers rigid spacers, flexible spacers and spacer dampers.

It does not apply to interphase spacers, hoop spacers and bonding spacers.

NOTE This document is written to cover the line design practices and spacers most commonly used at the time of writing. There may be other spacers available for which the specific tests reported in this document may not be applicable.

In ~~many~~ some cases, test procedures and test values are left to agreement between purchaser and supplier and are stated in the procurement contract. The purchaser is best able to evaluate the intended service conditions, which should be the basis for establishing the test severity.

In Annex A, the minimum technical details to be agreed between purchaser and supplier are listed.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60050(466):1990, *International Electrotechnical vocabulary (IEV) – Chapter 466: Overhead lines*

IEC 60888:1987, *Zinc-coated steel wires for stranded conductors*

IEC 61284:1997, *Overhead lines – Requirements and tests for fittings*

ISO 34-1:1994/2015, *Rubber, vulcanized or thermoplastic – Determination of tear strength – Part 1: Trouser, angle and crescent test pieces*

ISO 34-2:1996/2015, *Rubber, vulcanized or thermoplastic – Determination of tear strength – Part 2: Small (Delft) test pieces*

ISO 37:1994/2017, *Rubber, vulcanized or thermoplastic – Determination of tensile stress-strain properties*

ISO 188:1982/2011, *Rubber, vulcanized or thermoplastic – Accelerated ageing or heat resistance tests*

ISO 812:1991/2017, *Rubber, vulcanized or thermoplastic – Determination of low-temperature brittleness*

~~ISO 815:1991, Rubber, vulcanized or thermoplastic – Determination of compression set at ambient, elevated or low temperatures~~

ISO 815-1:2014, *Rubber, vulcanized or thermoplastic – Determination of compression set – Part 1: At ambient or elevated temperatures*

ISO 815-2:2014, *Rubber, vulcanized or thermoplastic – Determination of compression set – Part 2: At low temperatures*

ISO 868:~~1985~~2003, *Plastics and ebonite – Determination of indentation hardness by means of a durometer (Shore hardness)*

~~ISO 1183:1987, *Plastics – Methods for determining the density and relative density of non-cellular plastics*~~

ISO 1183-1:2019, *Plastics — Methods for determining the density of non-cellular plastics — Part 1: Immersion method, liquid pycnometer method and titration method*

ISO 1431-1:~~1989~~2012, *Rubber, vulcanized or thermoplastic – Resistance to ozone cracking – Part 1: Static and dynamic strain testing*

ISO 1461:2009, *Hot dip galvanized coatings on fabricated ~~ferrous products~~ iron and steel articles – Specifications and test methods¹⁾*

ISO 1817:~~1985~~2015, *Rubber, vulcanized or thermoplastic – Determination of the effect of liquids*

ISO 2781:~~1988~~2018, *Rubber, vulcanized or thermoplastic – Determination of density*

ISO 2859-1:~~1989~~1999/AMD1:2011, *Sampling procedures for inspection by attributes – Part 1: Sampling ~~plans~~ schemes indexed by acceptable quality ~~level~~ limit (AQL) for lot-by-lot inspection*

ISO 2859-2:1985, *Sampling procedures for inspection by attributes – Part 2: Sampling plans indexed by limiting quality level (LQ) for isolated lot inspection*

ISO 2921:~~1982~~2011, *Rubber, vulcanized – Determination of low-temperature ~~characteristics~~ retraction (TR test) – ~~Temperature retraction procedure (TR test)~~*

~~ISO 3417:1991, *Rubber – Measurement of vulcanization characteristics with the oscillating disc curemeter*~~

~~ISO 3951:1989, *Sampling procedures and charts for inspection by variables for percent nonconforming*~~

ISO 3951-1:2013, *Sampling procedures for inspection by variables -- Part 1: Specification for single sampling plans indexed by acceptance quality limit (AQL) for lot-by-lot inspection for a single quality characteristic and a single AQL*

ISO 3951-2:2013, *Sampling procedures for inspection by variables -- Part 2: General specification for single sampling plans indexed by acceptance quality limit (AQL) for lot-by-lot inspection of independent quality characteristics*

ISO 4649:~~1985~~2017, *Rubber, vulcanized or thermoplastic – Determination of abrasion resistance using a rotating cylindrical drum device*

¹⁾ ~~To be published.~~

ISO 4662:1986/2017, *Rubber, vulcanized or thermoplastic – Determination of rebound resilience of vulcanizates*

ISO 6502-2:2018, *Rubber – Measurement of vulcanization characteristics using curemeters – Part 2: Oscillating disc curemeter*

ISO 9001:2015, *Quality management systems – Requirements*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60050-466 apply as well as the following.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1

rigid spacer

spacer allowing no relative movement between the subconductors at the spacer location

3.2

flexible spacer

spacer allowing relative movements between the subconductors at the spacer location

3.3

spacer system

complex of spacers and the relevant in-span distribution

3.4

high temperature conductors

HTC

conductors which are designed to have a maximum continuous operating temperature over 95 °C

Note 1 to entry: HTC_a: conductors using annealed wires; HTC_{na}: conductors using non-annealed wires.

3.5

maximum continuous operating temperature

conductor temperature specified by the manufacturer and measured at the outer wire layers

4 General requirements

4.1 Design

The spacer shall be designed as to:

- maintain subconductor spacing (at spacer locations), within any prescribed limits, under all conditions of service excluding short-circuit currents;
- prevent, in subspans between spacers, physical contact between subconductors, except during the passage of short circuit currents when the possibility of contact is accepted provided that the specified spacing is restored immediately following fault clearance;
- withstand mechanical loads imposed on the spacer during installation, maintenance and service (including short circuit conditions) without any component failure or unacceptable permanent deformation;

- avoid damage to the subconductor under specified service conditions;
- be free from unacceptable levels of corona and radio interference under specified service conditions;
- be suitable for safe and easy installation. For the bolted and latching clamp the design shall retain all parts when opened for attachment to the conductor;
- ensure that individual components will not become loose in service;
- be capable of being removed and re-installed on the subconductors without damage to the spacer or subconductors;
- maintain its function over the entire service temperature range;
- avoid audible noise.

NOTE Other desirable characteristics, which are not essential to the basic functions of the spacer but which may be advantageous to the purchaser, include:

- verification of proper installation from the ground,
- ease of installation and removal from energized lines

Detailed information on design, best practice and experience of spacers and spacer dampers is given in [6]².

4.2 Materials

4.2.1 General

Spacers shall be made of any materials suitable for their purpose. Unless additional requirements are stated, the material shall conform to the requirements of IEC 61284.

4.2.2 Non-metallic materials

In addition to the requirements of IEC 61284, the conductivity of the various non-metallic components shall be such that when properly installed

- potential differences between metallic components do not cause damage due to discharge;
- ~~any current flow between subconductors does not degrade spacer materials.~~
- line current including short circuit current and any current flow through the spacer do not degrade spacer components.

4.3 Mass, dimensions and tolerances

Spacer mass and significant dimensions, including appropriate tolerances, shall be shown on contract drawings.

NOTE Tolerances applied to the mass and to the dimensions should ensure that the spacers meet their specified mechanical and electrical requirements.

4.4 Protection against corrosion

In addition to the applicable requirements of IEC 61284, stranded steel wires, if used, shall be protected against corrosion in accordance with IEC 60888.

4.5 Manufacturing appearance and finish

The spacers shall be free of defects and irregularities; all outside surfaces shall be smooth and all edges and corners well-rounded.

² Numbers in square brackets refer to the Bibliography.

4.6 Marking

The fitting marking requirements of IEC 61284 shall be applied to all clamp assemblies including those using breakaway bolts.

Correct position of the top of the spacer (for example arrows pointing upward), if necessary, shall also be provided.

4.7 Installation instructions

The supplier shall provide a clear and complete description of the installation procedure and, if required, the in-span location of the spacers.

The supplier shall make available any special installation tool that is required.

4.8 Specimen

All tests described in this document are based on bolted clamps and clamps with helical fixation. If other types of clamps are tested, the clamps should be installed according to the suppliers installation instruction.

5 Quality assurance

A quality assurance programme taking into account the requirements of this document can be used by agreement between the purchaser and the supplier to verify the quality of the spacers during the manufacturing process.

Detailed information on the use of quality assurance is given in ~~the following ISO standards ISO 9000-1 [1]; ISO 9001 [2]; ISO 9002 [3]; ISO 9003 [4] and ISO 9004-1 [5]*~~ a system as per ISO 9001 or similar.

It is recommended that test and measuring equipment used to verify compliance to this document is routinely maintained and calibrated in accordance with a relevant quality standard.

6 Classification of tests

6.1 Type tests

6.1.1 General

Type tests are intended to establish design characteristics. They are normally made once and repeated only when the design or the material of the spacer is changed. The results of type tests are recorded as evidence of compliance with design requirements.

6.1.2 Application

Spacers shall be subjected to type tests as per Table 1. Each type test shall be performed on three samples which are identical, in all essential respects, with the spacers to be supplied under contract to the purchaser. All units shall pass the tests.

The spacers used for tests during which no damage occurs to the units or their components may be used in subsequent tests.

* ~~Figures in square brackets refer to the bibliography.~~

NOTE The unit subjected to type tests can be either a complete spacer or a component of the spacer as appropriate to the test.

6.2 Sample tests

6.2.1 General

Sample tests are required to verify that the spacers meet the performance specifications of the type test samples. In addition, they are intended to verify the quality of materials and workmanship.

6.2.2 Application

Spacers shall be subjected to sample tests as per Table 1. The samples to be tested shall be selected at random from the lot offered for acceptance. The purchaser has the right to make the selection.

The spacers used for tests during which no damage occurs to the units or their components may be used in subsequent tests.

NOTE The unit subjected to sample tests can be either a complete spacer or a component of the spacer as appropriate to the test.

6.2.3 Sampling and acceptance criteria

The sampling plan procedures according to ISO 2859-1 and ISO 2859-2 (inspection by attributes) and ISO 3951 (inspection by variables) and the detailed procedures (inspection level, AQL, single, double or multiple sampling, etc.) shall be agreed between purchaser and supplier for each different attribute or variable.

NOTE Sampling inspection by variables is an acceptance sampling procedure to be used in place of inspection by attributes when it is more appropriate to measure on some continuous scale the characteristic(s) under consideration. In the case of failure load tests and similar expensive tests, better discrimination between acceptable quality and objective quality is available with acceptance sampling by variables than by attributes for the same sample size.

The purpose of the sampling process may also be important in the choice between a variables or attributes plan. For example, a customer may choose to use an attributes acceptance sampling plan to assure that parts in a shipment lot are within a required dimensional tolerance; the manufacturer may make measurements under a variables sampling plan of the same dimensions because of concern with gradual trends or changes which may affect the ability to provide shipment lots which meet the AQL.

6.3 Routine tests

6.3.1 General

Routine tests are intended to prove conformance of spacers to specific requirements and are made on every spacer. The tests shall not damage the spacers.

6.3.2 Application and acceptance criteria

Whole lots of spacers may be subjected to routine tests. Any spacer which does not conform to the requirements shall be discarded.

6.4 Table of tests to be applied

Table 1 indicates the tests which shall be performed. These are marked with an "X" in the table.

However, the purchaser may specify additional tests which are included in the table and marked with an "O".

Units or components damaged during the tests shall be excluded from the delivery to the customer.

[IECNORM.COM](https://www.iecnorm.com) : Click to view the full PDF of IEC 61854:2020 RLV

Table 1 – Tests on spacers

Clause	Test	Spacer damper			Flexible spacer			Rigid spacer		
		Type test	Sample test	Routine test	Type test	Sample test	Routine test	Type test	Sample test	Routine test
7.1	Visual examination	X	X	O	X	X	O	X	X	O
7.2	Verifications of dimensions, material and mass	X	X	O	X	X	O	X	X	O
7.3	Corrosion protection tests	X ¹⁾	X ¹⁾		X ¹⁾	X ¹⁾		X ¹⁾	X ¹⁾	
7.4	Non-destructive tests	O	O	O	O	O	O	O	O	O
7.5	Mechanical tests	X	O		X	O		X	O	
7.5.1	– clamp slip tests	X	O		X	O		X	O	
7.5.2	– breakaway-bolt test	X	X		X	X		X	X	
7.5.3	– tests on bolt sets	X	X		X	X		X	X	
7.5.4	– clamp-bolt-tightening test	X	X		X	X		X	X	
7.5.5	– simulated short circuit current test and compression and tension tests	X	O		X	O		X	O	
7.5.6	– characterisation of the elastic and damping properties	X	O		X	O		X	O	
7.5.7	– flexibility tests	X	O		X	O		X	O	
7.5.8	– fatigue tests	X	O		X	O		X	O	
7.6	Tests to characterise elastomers	X	O		X ¹⁾	O ¹⁾		X ¹⁾	O ¹⁾	
7.7	Electrical tests	X			X			X		
7.7.1	– corona and radio interference voltage (RIV) tests	X			X			X		
7.7.2	– electrical resistance test	X	O		X ¹⁾	O ¹⁾		X ¹⁾	O ¹⁾	
7.8	Verification of vibration behaviour of the bundle/spacer system	O			O ²⁾			O		
D.2	– aeolian vibration	O			O			O		
D.3	– subspan oscillation	O			O			O		

1) If applicable.

2) When used in conjunction with vibration dampers.

NOTE: The supplier should state in the tender quality plan, or other tender documentation, which testing is already complete (i.e: which type test) and which tests (sample or routine) are included in the tender, subject to the approval or change required by the purchaser.

7 Test methods

7.1 Visual examination

Type tests shall include visual examination to ascertain conformity of the spacers, in all essential respects, with the manufacturing or contract drawings. Deviations from the drawings shall be subject to the approval of the purchaser and shall be appropriately documented as an agreed concession.

Sample tests and, if required, routine tests shall include visual examination to ensure conformity of manufacturing process, shape, coating and surface finish of the spacer with the contract drawings. Particular attention shall be given to the markings required and to the finish of surfaces which come into contact with the conductor.

The sample test procedures and acceptance criteria shall be agreed between purchaser and supplier.

For spacers subject to corona type tests, the sample test shall include a comparison of shape and surface finish with one of the corona type test samples when specified or agreed by the purchaser.

7.2 Verification of dimensions, materials and mass

Type, sample and, if required, routine tests shall include verification of dimensions to ensure that spacers are within the dimensional tolerances stated on contract drawings. The purchaser may choose to witness the measurement of selected dimensions or may inspect the supplier's documentation when this is available.

Type, sample and, if required, routine tests shall also include verification of materials to ensure that they are in accordance with contract drawings and documents. This verification shall normally be carried out by the purchaser inspecting the supplier's documentation relating to material specifications, certificates of conformity or other quality documentation.

The total mass of the spacer complete with all its components shall comply with the mass shown on the contract drawing (within given tolerances).

7.3 Corrosion protection test

7.3.1 Hot dip galvanized components (other than stranded galvanized steel wires)

Hot dip galvanized components other than stranded galvanized steel wires shall be tested in accordance with the requirements specified in: ISO 1461.

The coating thicknesses shall conform to Tables 23 and 34 unless otherwise agreed between purchaser and supplier. However, for the purpose of this document, Tables 23 and 34 of ISO 1461:2009 shall apply to the following categories of items (and not to the categories specified in ISO 1461).

Table 23 of ISO 1461:2009: coating thickness on all samples except:

- washers;
- threaded components;
- small parts which are centrifuged (significant surface area < 1 000 mm²).

Table 34 of ISO 1461:2009 coating thickness on

- washers;
- threaded components;
- small parts which are centrifuged (significant surface area < 1 000 mm²).

7.3.2 Ferrous components protected from corrosion by methods other than hot dip galvanizing

Ferrous components protected from corrosion by methods other than hot dip galvanizing shall be tested in accordance with the requirement of the relevant IEC/ISO standards, as agreed between purchaser and supplier.

7.3.3 Stranded galvanized steel wires

Stranded galvanized steel wires shall be tested in accordance with the requirements specified in IEC 60888.

7.3.4 Corrosion caused by non-metallic components

By agreement between purchaser and supplier, evidence of non-corrosion compatibility between the elastomer and the conductor or spacer components, as appropriate, shall be demonstrated by a corrosion test or by suitable service experience. Alternatively, and where appropriate, the purchaser may specify for each subassembly containing an elastomer, a range of electrical resistance which provides adequate conductivity for electrical charging but minimizes galvanic action.

NOTE Non-metallic components, especially elastomeric elements lining a spacer clamp or providing the flexibility and damping in a spacer damper, are commonly made electrically conducting to avoid any problems that might otherwise arise from the capacitive charging of the arms or body of the spacer. Carbon is frequently used in elastomer formulations, both to achieve the desired stiffness and damping, and to provide electrical conductivity. ~~However, carbon in contact with aluminium may lead to severe galvanic corrosion of the latter in a polluted environment. Other constituents of non-metallic components, such as chlorides, free sulphur, etc. may also have corrosive effects.~~ Some constituents of the non-metallic components, such as chlorides, free sulphur, etc., may have corrosion effects.

The combination of the nature of the rubber, the pollution and the electrolyte are responsible for a corrosion process.

7.4 Non-destructive tests

The purchaser shall specify or agree to relevant test methods (ISO or other) and acceptance criteria. Examples of non-destructive tests are as follows:

- magnetic test;
- eddy current test;
- radiographic test;
- ultrasonic test;
- proof load test;
- dye penetrant test;
- hardness test.

7.5 Mechanical tests

7.5.1 Clamp slip tests

7.5.1.1 General

The tests shall be performed using the conductor for which the clamps are intended. The conductor shall be "as new", i.e. free of any deterioration or damage. The minimum length of the test conductor between its terminating fittings shall be, ~~with the exception of the test in~~

~~clause 7.5.1.2 B)~~, 4 m. The conductor shall be tensioned to 20 % of its rated tensile strength before the installation of the clamps to be tested.

Clamps shall be installed on an unused portion of conductor for each test.

Precautions shall be taken to avoid birdcaging of the conductor.

The clamps shall be tested individually. ~~The clamp shall be installed in accordance with the supplier's instructions. In the case of breakaway bolts, the installation torque shall be the design value minus the tolerance agreed between purchaser and supplier (see 7.5.3).~~ The clamp shall be installed in accordance with the supplier's instructions. In the case of breakaway bolts or break away caps, the breakaway portion shall be removed and the torque has to be applied to the lower head with a calibrated torque wrench.

The installation torque shall be the nominal break away torque minus the tolerance as specified by the supplier.

NOTE The use of other conductor, conductor lengths and tensions can be agreed between purchaser and supplier.

7.5.1.2 Longitudinal slip test

~~A) By means of a suitable device (see figure 1a), a load coaxial to the conductor shall be applied to the clamp.~~

~~The load shall be gradually increased (not faster than 100 N/s) until it reaches the specified minimum slip load value. This load shall be kept constant for 60 s. Then the load shall be gradually increased until slippage of the clamp occurs. The slip load value shall be recorded.~~

~~For metal surface clamps, slip shall be considered as having occurred when a movement of the clamp on the conductor of 1,0 mm is measured.~~

~~NOTE—The following values for rubber lined clamps and clamps using helical rods are given for reference:~~

- ~~— rubber lined clamp: ——— 2,5 mm;~~
- ~~— clamp using helical rods: — 12,0 mm.~~

~~● Acceptance criteria~~

~~No slippage shall occur at or below the minimum specified value. If both minimum and maximum slip requirements are stated, the slip shall occur between those values. Surface flattening of the outer strands of the conductor is acceptable.~~

~~B) An alternative test arrangement which evaluates the performance of the whole spacer assembly under simulated broken conductor conditions, as well as clamp slip, is shown in figure 1b.~~

~~NOTE—The effects imposed by the two test methods A) and B) are not equivalent.~~

~~For a bundle of N subconductors, N-1 subconductors shall be tensioned. A spacer shall be mounted on the subconductors and a longitudinal force shall be applied to the untensioned subconductor.~~

~~The load shall be gradually increased (not faster than 100 N/s) until it reaches the specified minimum slip load value. This load shall be kept constant for 60 s. Then the load shall be gradually increased until slippage of the clamp occurs. The slip load value shall be recorded.~~

~~For metal surface clamps, slip shall be considered as having occurred when a movement of the clamp on the conductor of 1,0 mm is measured.~~

~~NOTE—The following values for rubber lined clamps and clamps using helical rods are given for reference:~~

- ~~— rubber lined clamp: ——— 2,5 mm;~~

~~— clamp using helical rods: — 12,0 mm.~~

~~• Acceptance criteria~~

~~The slip force of the clamp on the subconductor or the failure load of the spacer shall not be less than the minimum specified value. In addition, if required by the purchaser, the longitudinal movement of the initially untensioned subconductor with respect to its initial position shall be higher than the minimum specified value at the moment of the slippage.~~

By means of a suitable device (i.e. Figure 1), a load coaxial to the conductor shall be applied to the clamp.

The load shall be gradually increased (not faster than 100 N/s) until it reaches the following values, unless otherwise agreed between purchaser and supplier.

- 4,0 kN for metal to metal clamps (except helical fixation);
- 1,5 kN for rubber/elastomer-lined clamps;
- 1,5 kN for clamps with helical fixation.

This load shall be kept constant for 60 s

To detect slippage colour marks shall be fixed at the interface of the clamp and conductor respectively and at the end of helical rods, if used. Other methods are also permitted if agreed between purchaser and supplier.

Then the load shall be gradually increased until slippage of the clamp occurs.

Slippage shall be considered as having occurred when the pulling force cannot be increased or the movement of the clamp on the conductor is

- 2 mm for metal to metal clamp;
- 5 mm for rubber lined clamp;
- 15 mm for clamps with helical fixation.

For type test only, an additional slip test taking into account the creeping behaviour of the conductor shall be performed.

A new clamp shall be fixed (according to 7.5.1.1) on the conductor which is tensioned to 20 % of RTS. Then the tension shall be gradually increased (not more than 100 N/s) to 40 % of conductor RTS and kept for 2 h at this tension load.

It is permitted to fix several clamps on the same setup to reduce expenditure of time. The distance between the clamps shall be at least 300 mm.

Afterwards the tension shall be gradually decreased to 20 % of conductor RTS and the slip test shall be repeated.

• Acceptance criteria

No slippage shall occur at or below 4 kN for metal/metal clamps and 1,5 kN for rubber lined clamp and clamps with helical fixation. If both minimum and maximum slip requirements are stated, the slip shall occur between those values. Very small surface flattening of the outer strands of the conductor is acceptable.

If armor rods are used under the clamps, slippage of the armor rods relative to the conductor is considered as clamp slippage.

For clamps with helical fixation, relative displacement up to 15 mm in the interface of clamp and helical rods, when the load is reached, is acceptable. The relative displacement shall not

increase during the 60 s at constant load. There shall not be any relative movement at the end of helical rods.

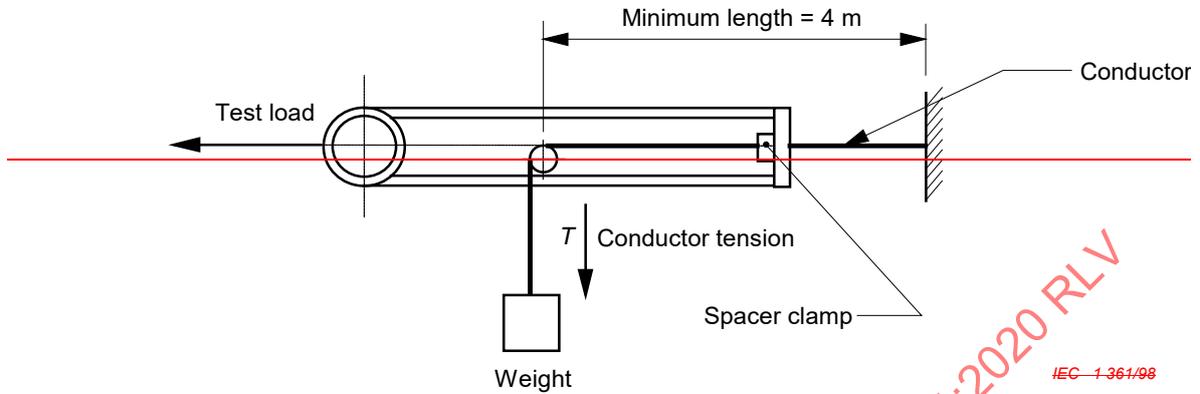


Figure 1a – Method A

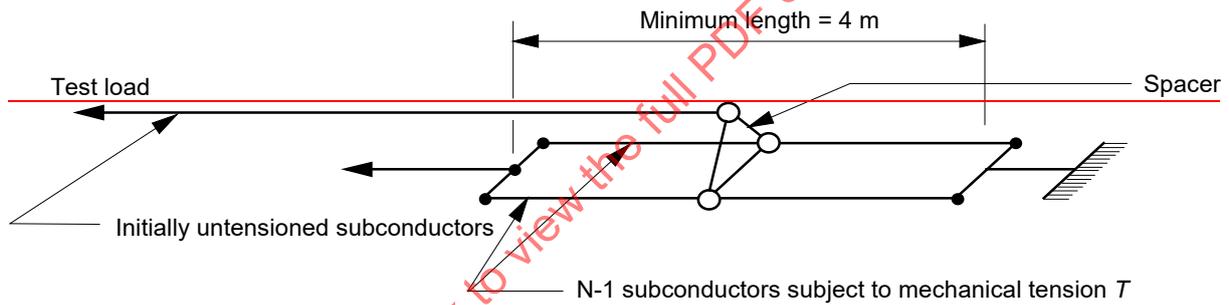


Figure 1b – Method B

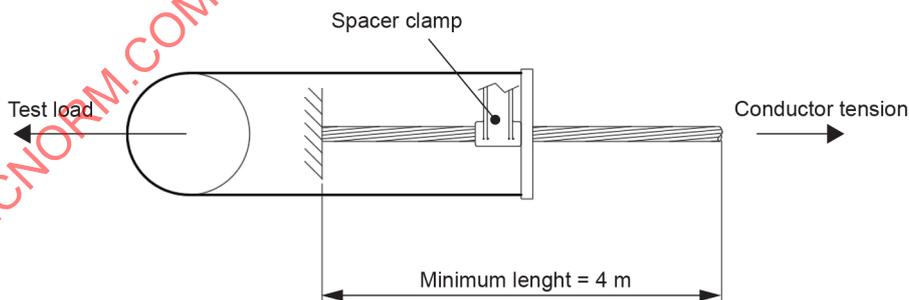


Figure 1 – Test arrangements for longitudinal slip tests

a) Longitudinal slip test for high temperature conductors (HTC)

Use the same set-up parameters as for standard conductors (7.5.1.1).

After installing the clamp at ambient temperature, the conductor shall be electrically heated up to the maximum continuous operating temperature as specified by the conductor manufacturer and kept constant at this temperature for 0,5 h.

The tension load shall be kept constant at 20 % of RTS of the used conductor.

Then the slip test shall be performed as for standard conductors, at the maximum continuous operating temperature.

For the type test, an additional thermal process of the conductor shall be performed.

A new clamp shall be fixed (according to 7.5.1.1) at ambient temperature on the conductor which is tensioned to 20 % of RTS. It is permitted to fix several clamps on the same setup to reduce expenditure of time. The distance between the clamps shall be at least 300 mm.

Then the conductor shall be electrically heated up to the maximum continuous operating temperature as specified by the conductor manufacturer and kept constant at this temperature for 1 h.

Afterwards, the temperature shall decrease to at least ambient temperature plus 5 °C. These cycles shall be carried out four times. At the end of the fourth cycle, after decreasing the temperature to ambient values the longitudinal slip test shall be performed. For the complete test run the tension shall be kept constant at 20 % of rated tensile strength.

- Acceptance criteria for not annealed conductor wires:

No slippage shall occur at or below 2,5 kN for metal/metal clamps and 1 kN for rubber lined clamps and clamps with helical fixation. If minimum and maximum slip values are specified, the slip shall occur between those values. Very small surface flattening on the outer strands of the conductor is acceptable.

- Acceptance criteria for annealed conductor wires:

No slippage shall occur at or below 1,5 kN for metal/metal clamps and 0,5 kN for rubber lined clamps and clamps with helical fixation. If minimum and maximum slip values are specified, the slip shall occur between those values. Very small surface flattening on the outer strands of the conductor is acceptable.

7.5.1.3 Torsional slip test

~~A) A torque (see figure 2a) shall be applied to the clamps in order to rotate it around the axis of the conductor.~~

~~The torque shall be gradually increased until it reaches the specified minimum slip torque. This torque shall be kept constant for 60 s. Then the torque shall be gradually increased until slippage of the clamp by torsion occurs. The slip torque value shall be recorded.~~

~~The test shall be carried out applying the torque in the direction of lay of the outer conductor strands. The test shall be repeated by applying the torque in the opposite direction.~~

~~Clamp slip shall be considered as having occurred when a slip value greater than one strand diameter is measured after the release of load.~~

- ~~• Acceptance criteria~~

~~No slippage shall occur at or below the minimum specified value.~~

~~B) An alternative test arrangement is shown in figure 2b.~~

~~A conductor of length L equal to the average sub-span associated with the tested spacer, shall be tensioned to 20 % of its rated tensile strength. The spacer shall be mounted at the centre of the test conductor ($l_1 = l_2 = L/2$). Then the tension on the test conductor shall be increased to 40 % of its rated tensile strength. The spacer shall be rotated to an angle γ , specified or agreed by the purchaser, around the axis of the conductor.~~

~~The test shall be carried out applying the torque in the direction of lay of the outer conductor strands. The test shall be repeated by applying the torque in the opposite direction.~~

~~NOTE—The test may be performed with unequal lengths l_1 and l_2 . In this case, the recommended angle of rotation is~~

$$\gamma = \frac{4\gamma_l}{L} \left(\frac{l_1 \times l_2}{l_1 + l_2} \right) \text{ (degrees)}$$

~~Clamp slip shall be considered as having occurred when a slip value greater than one strand diameter is measured after release of load.~~

~~• Acceptance criteria~~

~~No slippage shall occur at or below γ_l .~~

This test is applicable for metal to metal clamps, rubber lined clamps and helical fixation.

The spacer clamp shall be installed in accordance with the supplier's instruction.

To limit the torsion flexibility of the conductor, rigid clamps have to be installed at both sides of the tested spacer clamp (Figure 2). The free length of conductor between specimen and fixing clamps should be at least 1x spacer clamp width.

A torque (see Figure 2) shall be applied to the clamps in order to rotate it around the axis of the conductor. The torque shall be gradually increased until it reaches the specified minimum slip torque.

The minimum slip torque should correlate with the minimum longitudinal slip load according 7.5.1.1 (4kN for metal/metal clamps, 1.5 kN for rubber/elastomer lined clamps).

The adequate torsion slip torque can be calculated as follows:

$$M = \frac{d}{2} F_{slip}$$

where

M is the calculated torque (Nm);

F_{slip} is the specified longitudinal slip load according to 7.5.1.1 (N);

d is the conductor diameter (m).

This torque shall be kept constant for 60 s. Then the torque shall be gradually increased until slippage of the clamp by torsion occurs. The slip torque value shall be recorded.

Clamp slip shall be considered as having occurred when a permanent slip value greater than one strand diameter is measured.

• Acceptance criteria

No slippage shall occur at or below the calculated torsion slip torque M .

Very small surface flattening on the outer strands of the conductor is acceptable.

For type test only, an additional slip test taking into account the creeping behaviour of the conductor shall be performed.

A new clamp shall be fixed (according to 7.5.1) on the conductor which is tensioned to 20 % of RTS. Then the tension shall be gradually increased (not more than 100 N/s) to 40 % of conductor RTS and kept for 2 h.

It is permitted to fix several clamps on the same setup to reduce expenditure of time. The distance between the clamps shall be at least 300 mm.

Afterwards the tension shall be gradually decreased to 20 % of conductor RTS and the torsion slip test shall be repeated.

- Acceptance criteria:

No slippage shall occur at or below the minimum specified value.

Very small surface flattening on the outer strands of the conductor is acceptable.

a) High Temperature Conductor (HTC)

Use the same set-up parameters as for standard conductors (7.5.1).

After installing the clamp at ambient temperature, the conductor shall be electrically heated up to the maximum continuous operating temperature as specified by the conductor manufacturer and kept constant at this temperature for 0,5 h.

Then the torsion slip test shall be carried out in the same way than for standard conductors, at the maximum continuous operating temperature.

- Acceptance criteria:

No slippage shall occur at or below the minimum specified value.

Very small surface flattening on the outer strands of the conductor is acceptable.

For clamps with helical fixation, a slight relative displacement in the interface of clamp and helical rods, when the load is reached, is acceptable. The relative displacement shall not increase during the 60 s at constant load. There shall not be any relative movement at the end of helical rods

For the type test an additional thermal process of the conductor shall be performed.

A new clamp shall be fixed (according to 7.5.1) at ambient temperature on the conductor which is tensioned to 20 % of RTS. It is permitted to fix several clamps on the same setup to reduce expenditure of time. The distance between the clamps shall be at least 300 mm.

Then the conductor shall be electrically heated up to the maximum continuous operating temperature as specified by the conductor manufacturer and kept constant at this temperature for 1 h.

Afterwards the temperature shall decrease to at least ambient temperature plus 5 °C. These cycles shall be carried out four times. After decreasing the temperature to ambient value, the torsional slip test shall be performed in the same way than for standard conductors. For the complete test run the tension shall be kept constant at 20 % of rated tensile strength.

- Acceptance criteria:

No slippage shall occur at or below the minimum specified value.

Very small surface flattening on the outer strands of the conductor is acceptable.

For clamps with helical fixation, a slight relative displacement in the interface of clamp and helical rods, when the load is reached, is acceptable. The relative displacement shall not

increase during the 60 s at constant load. There shall not be any relative movement at the end of helical rods.

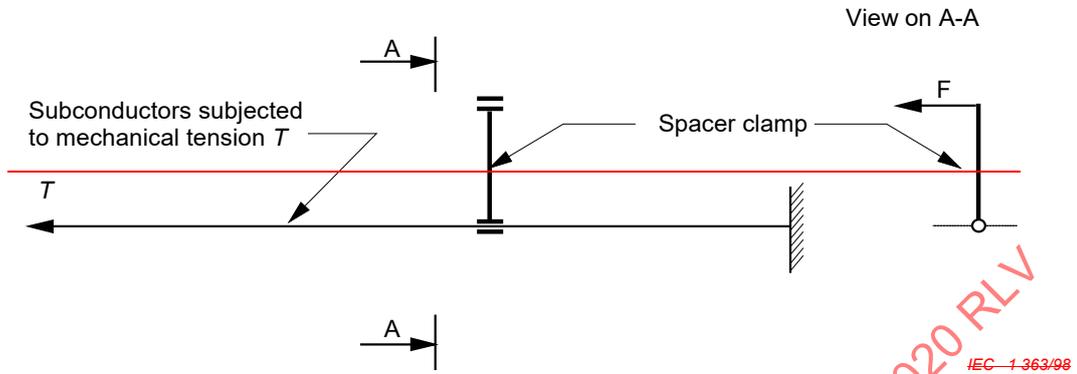


Figure 2a – Method A


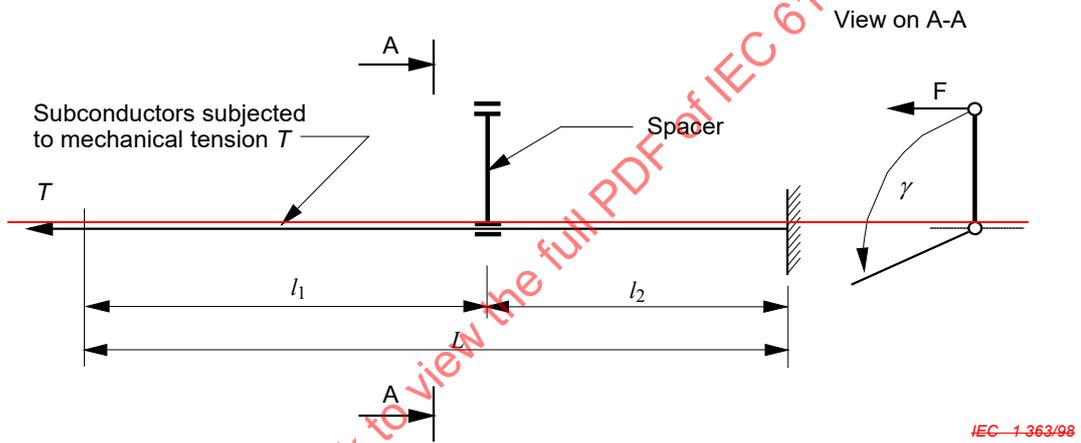


Figure 2b – Method B

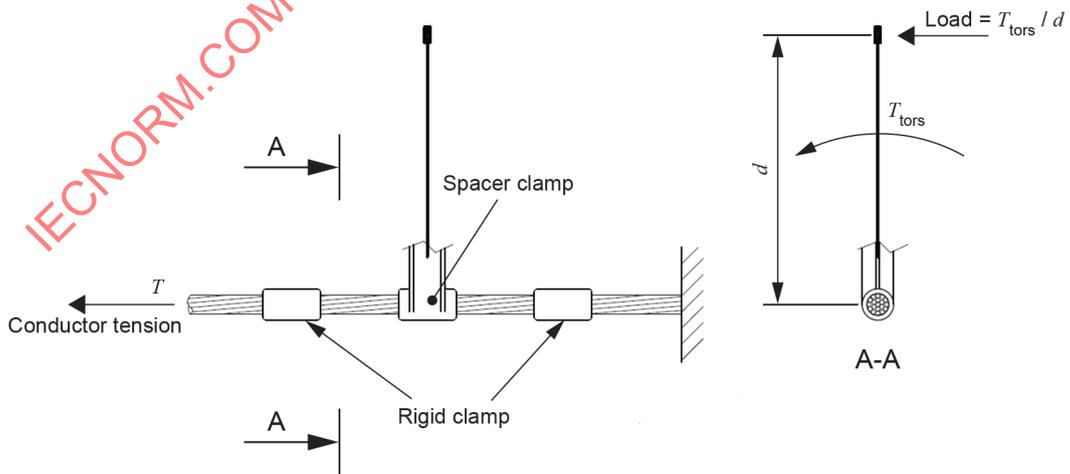

IEC

Figure 2 – Test arrangement for torsional slip tests

7.5.2 Tests on bolt sets

7.5.2.1 General

These tests are performed to ensure the proper function of all individual items used in bolted clamps.

7.5.2.2 Breakaway bolt test

~~The breakaway bolt, if used, shall be tested by applying increasing torque to the breakaway portion of the bolt until it breaks away. The breakaway torque shall be recorded. The breakaway torque shall be within the tolerance agreed between purchaser and supplier.~~

The breakaway bolts or breakaway caps, if used, shall be tested by applying increasing torque to the breakaway portion of the bolt or breakaway cap until it breaks away. The test shall be carried out at ambient temperature.

Precaution shall be taken on a constant continuous circular motion and a perpendicular angle between torque wrench and bolt head.

The breakaway torque shall be recorded.

- Acceptance criteria:

The breakaway torque shall be within the tolerance agreed between the purchaser and the supplier.

If no tolerance is specified, the range shall be nominal installation torque plus/minus 10 %.

For countries where ambient temperature below 0 °C can be expected, it is recommended to repeat the tests on breakaway bolts and breakaway caps at the temperature corresponding to the average temperature of the coldest month.

The specimens shall be kept for at least 1 h in an appropriate cooling device prior the test.

During the break away test the temperature of the specimens should be measured and recorded. The temperature during the test shall not increase more than 10 °C from initial cooling temperature.

7.5.2.3 Embrittlement tests on conical washers

First, a spring force test shall be carried out at room temperature on 3 specimens to assess the resilience of the washers. The washers shall be installed individually in a bolt used in the spacer damper under test and tightened 10 % above the specified installation torque, as shown in Figure 3. The assembly shall be placed in an appropriate test device and the reaction force and the deflection of the washers shall be recorded.

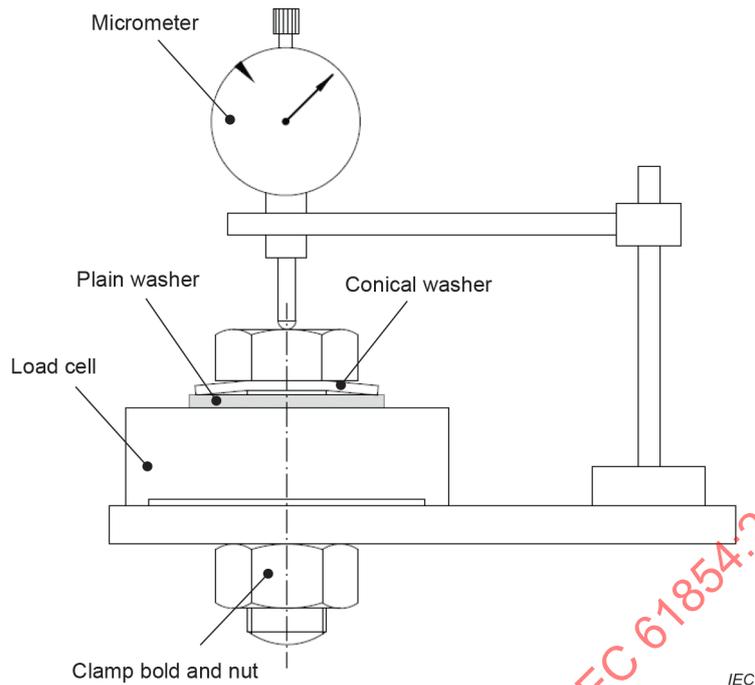


Figure 3 – Test arrangement for the spring force test at room temperature

Second, a permanent load test shall be performed.

At least 10 unused conical spring washers shall be installed with alternating orientation on a bolt used in the spacer damper under test or if necessary on a longer bolt of the same type. The bolt shall be tightened 10 % above the specified installation torque of the spacer.

The conical spring washers shall be separated from one another by a plain washer with a hardness of at least 300 HV, as shown in Figure 4.

The test arrangement shall then be stored at a constant temperature of at least -20 °C (±2 °C) for 24 h.

After the test assembly has warmed up to ambient temperature and visually inspected, it will be dismantled.

The spring force test at room temperature shall be repeated after the storage at low temperature on 3 conical spring washers and the results compared with the initial recorded reaction force of the washers.

- Acceptance criteria:

No cracks shall occur during the low temperature test period.

The reaction force of the washers, after storage at low temperature, shall be at least 90 % of the reaction force initially recorded at the same deflection.

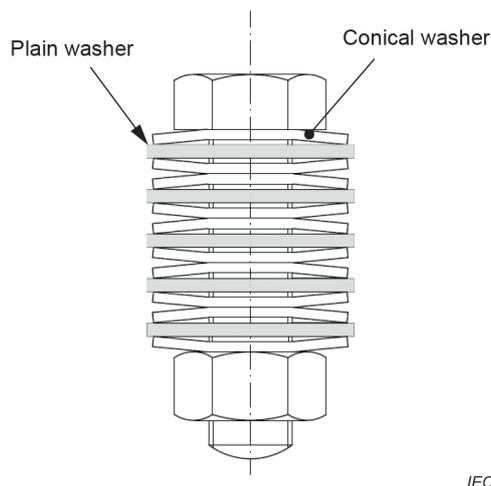


Figure 4 – Test arrangement for permanent load test on conical washers

7.5.2.4 Clamp bolt tightening test

~~The test shall be performed by installing the clamp on a conductor with a diameter equal to that for which the clamp is intended to be used. The bolt(s) or nut(s) shall be tightened to a torque 10 % above the specified installation torque. Clamps with breakaway bolts shall have the breakaway portion of the head removed prior to the test and shall be tightened with the specified torque value plus the agreed tolerance. The threaded connection shall remain serviceable for any number of subsequent installations and removals and all components of the clamp shall be undamaged. No unacceptable damage shall occur on the conductor inside the clamp. Unacceptable damage shall be agreed between purchaser and supplier.~~

~~Lastly, the torque shall be increased either to twice the specified installation torque or the maximum torque value recommended by the bolt supplier, whichever is lower. This increase shall not result in any breakage of threaded parts or other components.~~

The test shall be performed by installing the clamp on a piece of the actual conductor. In case not available, an equivalent conductor or a tube of same diameter can be used. The bolts or nuts shall be tightened to a torque 10 % above the specified installation torque with a calibrated torque wrench. Clamps with breakaway bolts or breakaway caps shall have the breakaway portion of the head removed prior to the test and shall be tightened 10 % above the specified installation torque.

- Acceptance criteria

The threaded connection shall remain serviceable (by hand) for 3 subsequent installations and removals and all components of the clamp shall be without any mechanical deformation or cracks. No plastic deformation shall occur to the conductor inside the clamp.

Lastly, the torque shall be increased to either twice the specified installation value or the maximum torque value recommended by the bolt supplier, whichever is lower. This increase shall not result in any breakage of threaded parts or other components of the clamp or any cracks. The bolt(s) shall be able to be removed from the spacer without any failure.

Plastic deformation is permitted.

7.5.3 Simulated short-circuit current test and compression and tension tests

7.5.3.1 General

The purpose of these tests is to ensure that the spacers will be able to withstand, without failure or permanent deformation, the compressive and tensile load which may occur in service.

The purchaser shall specify or agree to one of the following tests, or any combination of tests.

NOTE The effects imposed by the loads in the different tests, or combination of tests, are not necessarily equivalent.

7.5.3.2 Simulated short-circuit current test

Suitable devices (see Figure 5) which are able to apply compressive forces (directed toward the centre of the conductor bundle) and tensile forces (directed away from the centre of the conductor bundle) to all spacer clamps simultaneously shall be used.

Variant A: Test device using mechanical means other than a simulated conductor. Possible methods include the use of pulleys, pneumatic cylinders, or hydraulic cylinders. See Figure 5a for a possible example setup.

Variant B: Setup with conductors or wires to simulate span conditions in the field using a tensile testing machine. The yoke plates shall be shaped in relation to the type of spacer under test.

The line angles α (alpha) are typically between 77° to 80° (Figure 5b and Figure 5c).

The tensile load F can be calculated as follows:

Compression test:
$$F = \frac{n}{2} F_{compr} \tan \alpha_c$$

Tension test:
$$F = \frac{n}{2} F_{tens} \tan \alpha_t$$

where

F is the tensile load (N);

n is the number of sub conductors;

α_c is the line angle measured between conductor and spacer during compression (°);

α_t is the line angle measured between conductor and spacer during tension (°);

F_{compr} is the calculated compression load according to Annex B (N);

$$F_{tens} = \frac{1}{2} F_{compr}$$

Compression:

Metal to metal clamps and rubber lined clamps shall be fixed according to suppliers' instruction. The compressive forces shall be gradually increased until they reach it reaches the specified test value which is calculated using the formula given in Annex B. At this value the forces shall be held constant for 60s and then removed.

The test shall be executed twice; the first one with the spacer in its normal position ~~and~~, the second one ~~with one~~, applicable to flexible spacer and spacer damper only, with a clamp displaced 25 mm longitudinally ~~of an agreed amount~~, with reference to the other clamp(s).

~~The value of the compressive force specified above can be calculated using the formula given in annex B unless a different value is agreed between purchaser and supplier.~~

Tension:

Following the compressive forces, the tensile forces shall be applied. ~~These forces shall be gradually increased until they reach the specified value at which they shall be maintained for 60 s. The value of the tensile forces shall be taken as 50 % of the corresponding compressive forces, unless a different value is agreed between purchaser and supplier.~~ This value shall be gradually increased until it reaches 50 % of the compressive force.


This force shall be kept constant for 60 s and then removed.

- Acceptance criteria

After the test,

- it shall be possible to return the spacer clamps to their design position using only slight hand pressure;
- the spacer shall be examined ~~by disassembly~~; if necessary, the spacer shall be disassembled. There shall be no deformation or damage which would impair the efficiency of the spacer or affect its function of maintaining the normal bundle spacing.

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

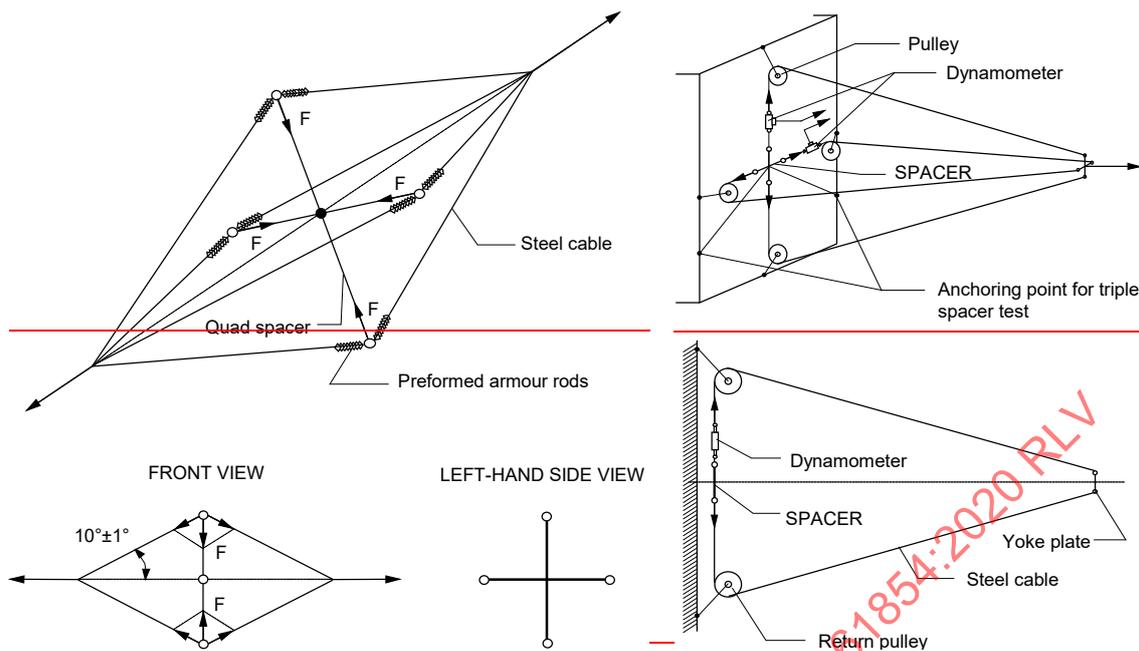


Compression

Tension

IEC-1365/08

NOTE— The subconductors may be replaced by steel cables of smaller diameter fitted with preformed armour rods in order to match the conductor diameter. These cables shall be so deformed that the angle between a subconductor and the axis of the bundle is equal to $(10 \pm 1)^\circ$.

Figure 3a – Variant A

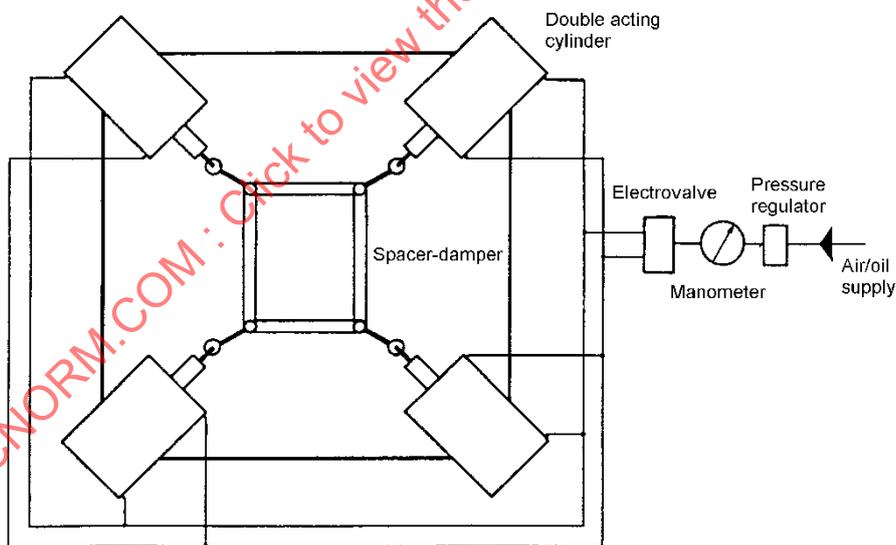

IEC-1366/08

Figure 3b – Variant B

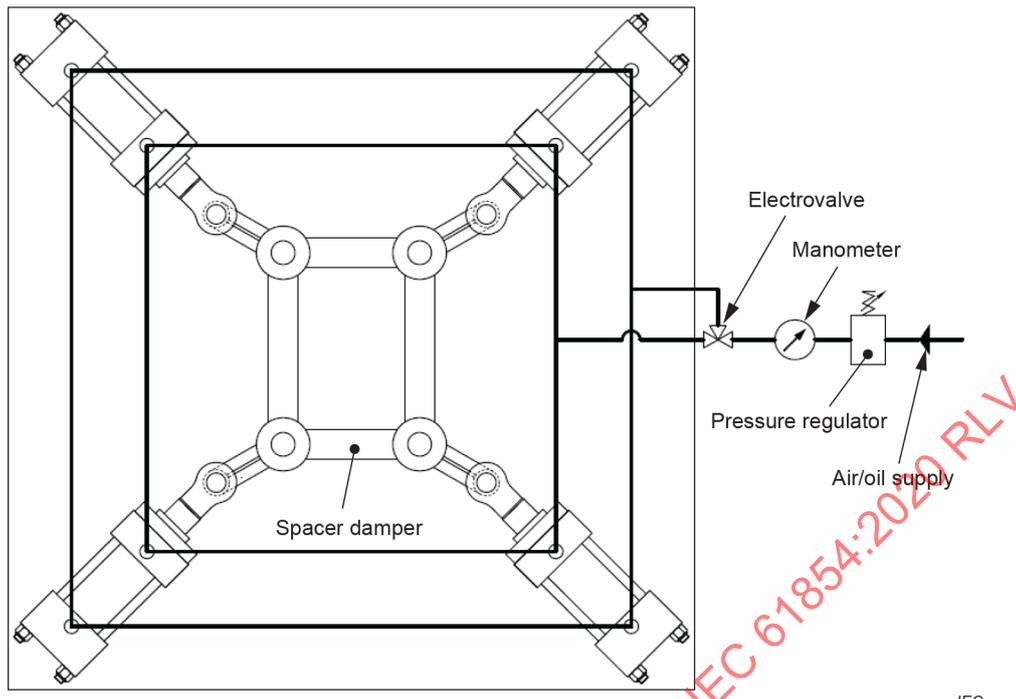


Figure 5a – Example of test device used in Variant A

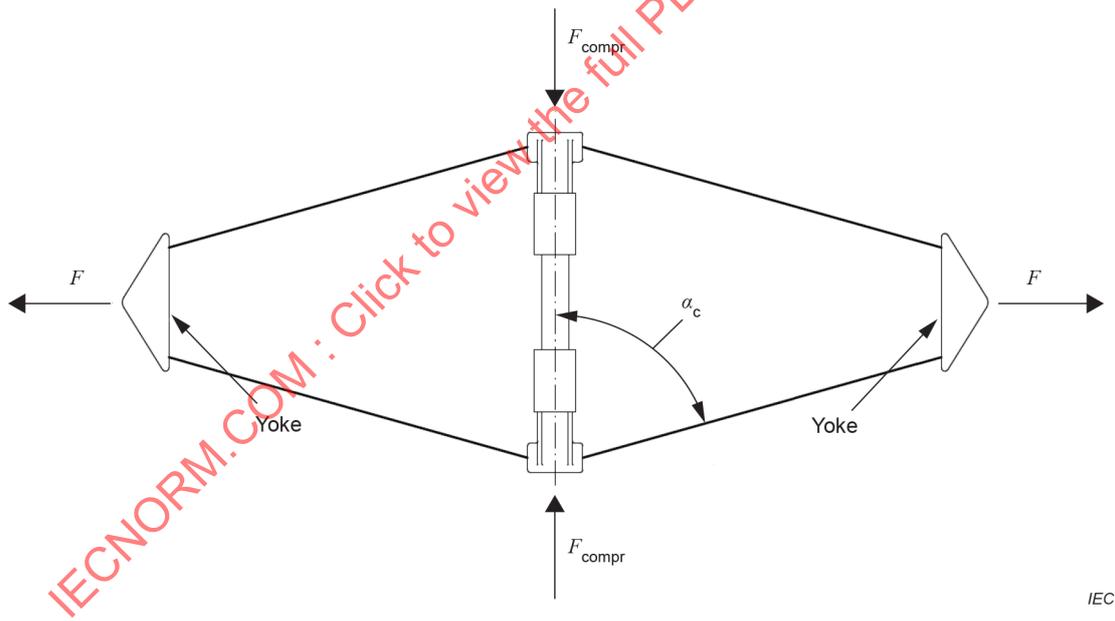


Figure 5b – Variant B (compression)

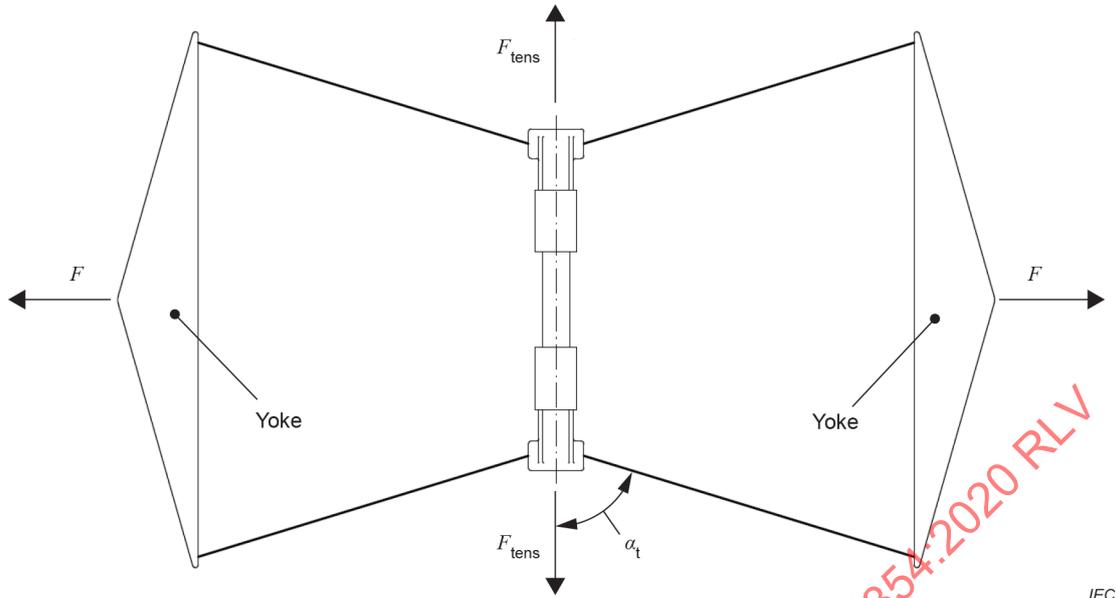


Figure 5c – Variant B (tension)

Figure 5 – Test arrangements for simulated short circuit current tests

7.5.3.3 Compression and tension test

For twin spacers this test is covered by the simulated short circuit test (7.5.3.1).

The spacer assembly shall be installed on a suitable device (see Figure 6a) able to apply compression and tension forces between each pair of adjacent clamps.

The clamp bolts, when used, shall be tightened ~~to the specified installation torque~~ according to supplier's instruction.

Helical, used for fixation, should be replaced by an appropriate mechanical fixation.

For each pair of adjacent clamps, the compressive force shall first be applied. The force shall be gradually increased until it reaches the ~~specified value~~ calculated compression force which shall be maintained for 60 s. Then the compressive force shall be removed and the tensile force, corresponding to 50 % of the compressive force, shall be applied to the same pair of clamps and held for 60 s ~~at the specified value~~.

~~The value of the compressive and tensile forces to be applied shall be agreed between purchaser and supplier.~~

The centripetal compressive force for triple, quad and hexagonal bundle configurations shall be calculated using the formula given in Annex B.

Only the components of the calculated centripetal short circuit forces are applied between two adjacent clamps (Figure 6b).

Helical fixation clamps:

To prove the mechanical strength of the system clamp helical/rod of helical fixation clamps a separate tension test (see Figure 6c) shall be performed.

The conductor shall be simulated by a piece of tube having the same diameter than the conductor. The distance "L" between the two attachment points beside the spacer clamp (see Figure 6c) should be at least 500 mm.

The tensile force, correlating to 50 % of the compressive force, shall be applied to a pair of clamps and held for 60 s.

Then the load shall be released.

- Acceptance criteria

After the test,

- it shall be possible to return the spacer clamps to their design position using only slight hand pressure;
- the spacer shall be examined ~~by disassembly~~; if necessary, the spacer shall be disassembled. There shall be no deformation or damage which would impair the efficiency of the spacer or affect its function of maintaining the normal bundle spacing.

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

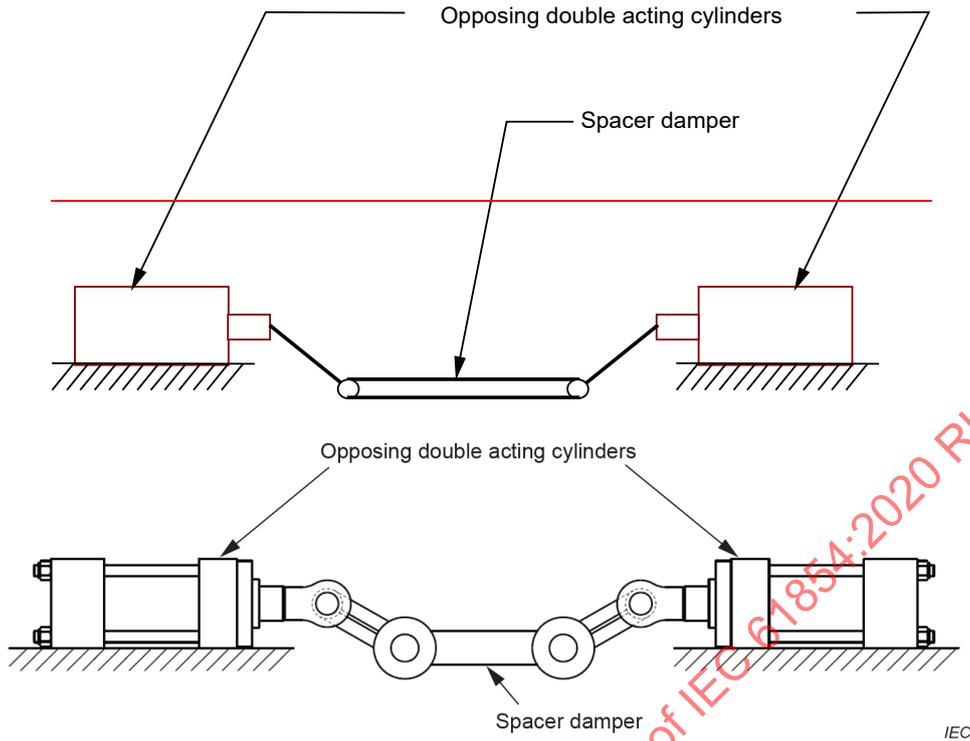


Figure 6a – Example of device for compression and tension test

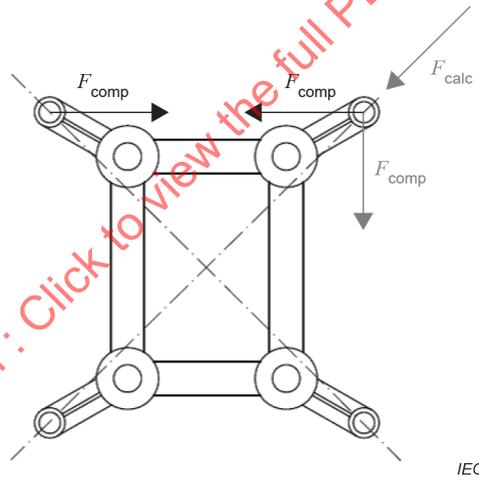


Figure 6b – Application of centripetal force component

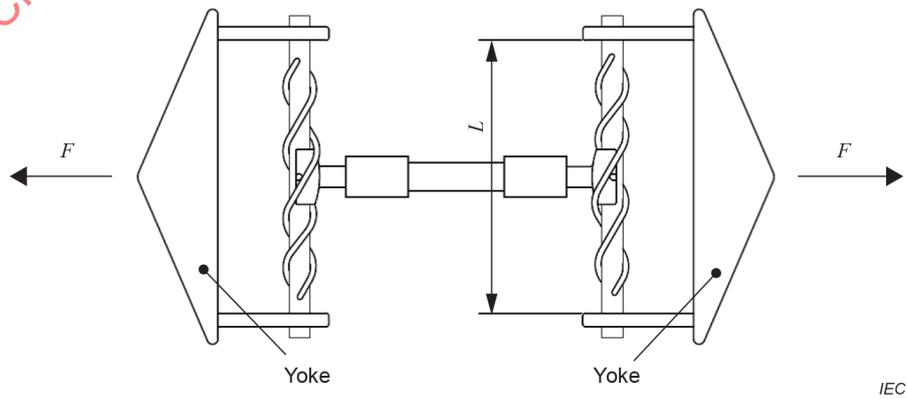


Figure 6c – Example of device for tension test of helical fixation clamps

Figure 6 – Test arrangements for compression and tension test

7.5.4 Characterisation of the elastic and damping properties

Tests to determine the elastic and damping properties of spacer dampers shall be performed in accordance with one or more of the following methods as specified or agreed by the purchaser.

NOTE 1 The stiffness and damping values do not provide direct confirmation of the performance of spacer dampers installed on conductor bundles, but they ~~may~~ can be used in analytical models used to provide indication of performance, particularly with regard to aeolian vibration.

NOTE 2 The stiffness and damping values determined in type tests can be used to establish acceptance criteria for sample tests as specified or agreed by the purchaser.

NOTE 3 The elastic and damping characteristics determined in the following different tests are not equivalent.

a) Stiffness-damping method

The test shall be carried out at room temperature (20 ± 5 °C), the temperature shall be reported. The specimens shall be kept in room temperature prior the test for at least 3 h.

The frame of the spacer shall be fixed securely and a rigid tube or rod shall be securely held in one of the spacer clamps. The tube/rod shall be oscillated (see Annex C) such that the angle of deflection of the spacer arm from its unloaded position follows a sinusoid, i.e.

$$\varphi = \Phi \sin \omega t$$

where

φ is the angle of deflection;

Φ is the peak value of deflection selected for the measurement.

The peak force F required to oscillate the spacer arm through the angle measurement $\pm \Phi$ shall be determined (measured at approximately 90° to the arm axis in the plane of the spacer and passing through the centre of the clamp).

The phase angle, α , between the force and arm deflection angle shall also be determined.

If necessary the arm oscillation shall be maintained for a period long enough to stabilize the temperature of the damping element(s) before measuring F and α .

The angle α may be measured directly by comparing the force and arm angle wave forms. It may also be determined indirectly by measuring the area of the hysteresis loop formed by displaying the force and arm angle deflection in X-Y form. In this case α can be calculated as follows:

$$\alpha = \arcsin \frac{E}{F l \pi \Phi}$$

where

α is the phase angle between arm deflection and force (rad);

E is the area of the moment/angular deflection loop (J);

F is the peak force (N);

l is the arm length measured between clamp centre and effective frame/arm pivot point (m);

Φ is the peak arm deflection (rad).

The test shall be carried out at a frequency between 1 Hz and 2 Hz with a peak-to-peak displacement equivalent to the diameter of the conductor for which the clamp is intended to be used.

NOTE 2 Tests at a variety of frequencies and/or displacements can be used to characterize spacer dampers for computer programs.

From the measurements of F and α , the torsional stiffness K_t and the damping constant H_t shall be calculated as follows:

$$K_t = \frac{F l \cos \alpha}{\Phi} \quad (\text{Nm/rad})$$

$$H_t = K_t \tan \alpha \quad (\text{Nm/rad})$$

1) High Temperature Conductor (HTC)

Use the same set-up parameters as for standard conductors.

One spacer damper clamp shall be installed on a length of High Temperature Conductor which will heat up to its maximum continuous operating temperature. This temperature shall be kept constant (± 5 °C) for 2 h.

Shortly before the end of the heating cycle the temperature of the damping elements shall be measured and recorded.

The stiffness damping method shall be performed with the elastomer damping element kept at the previously measured temperature (± 10 °C).

- Acceptance criteria

- The torsional stiffness K_t shall not differ by more than ± 20 % from the values declared by the supplier for the ambient temperature and ~~stated on contract drawings~~ for the maximum operating temperature respectively.
- The ratio H_t/K_t shall not be lower than 20 % of the values declared by the supplier for the ambient temperature and ~~stated on contract drawings~~ for the maximum operating temperature respectively.

b) Stiffness method

~~After being held at a test reference temperature of (20 ± 5) °C for at least 3 h, the horizontal stiffness of a spacer shall be determined in the following manner:~~

The test shall be carried out at room temperature (20 ± 5 °C), the temperature shall be reported. The specimens shall be kept in room temperature prior the test for at least 3 h.

- the spacer shall be held (preferably in its working orientation) by two adjacent clamps installed on horizontal rods which are free to rotate;
- one rod shall be held in position and a force shall be applied to the other rod just sufficient to move the clamp arms to their stops in tension, i.e. the spacing shall have been increased from X_{nom} to X_{max} which shall be recorded;
- the above shall be repeated for the arms in compression for X_{min} to be recorded;
- spacings X_t and X_c shall then be determined, where

$$X_t = X_{\text{nom}} + 0,9(X_{\text{max}} - X_{\text{nom}})$$

$$X_c = X_{\text{nom}} - 0,9(X_{\text{nom}} - X_{\text{min}})$$

- The spacer arms shall then be moved in the following cycle:
 - starting at X_{nom} the spacing shall be increased to X_t at a uniform rate between 50 mm/min and 100 mm/min;
 - the spacing shall be held at X_t and after 60 s the force F_t required to hold this spacing shall be recorded;
 - the spacing shall then be decreased at a uniform rate between 20 mm/min and 50 mm/min until the spacing is again equal to X_{nom} ;
 - after holding the spacing at X_{nom} between 0 s and 20 s, the spacing shall be decreased to X_c at a uniform rate between 50 mm/min and 100 mm/min;
 - the spacing shall be held at X_c and after 60 s the force F_c required to hold this spacing shall be recorded;
 - the stiffness shall then be determined as $\frac{F_t + F_c}{X_t - X_c}$.

NOTE To illustrate the above, assume that the test is carried out on a 400 mm twin spacer which has stops at spacings of 420 mm and 370 mm. It will then be necessary to record the tensile force F_t (N) required to maintain a spacing of 418 mm and the compression force F_c (N) required to maintain a spacing of 373 mm. The stiffness will then be $(F_t + F_c)/45$ (N/mm).

1) High Temperature Conductor (HTC)

Use the same set-up parameters as for standard conductors.

One spacer damper clamp shall be installed on a length of High Temperature Conductor which will heat up to its maximum continuous operating temperature. This temperature shall be kept constant (± 5 °C) for 2 h.

Shortly before the end of the heating cycle the temperature of the damping elements shall be measured and recorded.

The stiffness method shall be performed with the elastomer damping element kept at the previously measured temperature (± 10 °C)

- Acceptance criteria

The stiffness shall not differ by more than ± 20 % from the values declared by the supplier for the ambient temperature and ~~stated on contract drawings~~ for the maximum operating temperature respectively.

c) Damping method


The test shall be carried out at room temperature (20 ± 5 °C), the temperature shall be reported. The specimens shall be kept in room temperature prior the test for at least 3 h.

The damping characteristic shall be determined as follows.

The body of the spacer shall be fixed rigidly, and a mass shall be added to one arm such that the natural frequency of oscillation is between 1 Hz and 2 Hz. The arm shall then be moved to one of the end stops and, after 1 min, suddenly released. The movement of the arm shall be recorded for at least two complete cycles. If the initial swing (from starting position to

maximum deflection in the opposite direction) is Y_1 (see Figure 7) and subsequent swings (peak to peak) are Y_2, Y_3, Y_4 , the log decrement shall be taken to be equal to

$$\ln \left[\frac{1}{2} \left(\frac{Y_1}{Y_3} + \frac{Y_2}{Y_4} \right) \right]$$

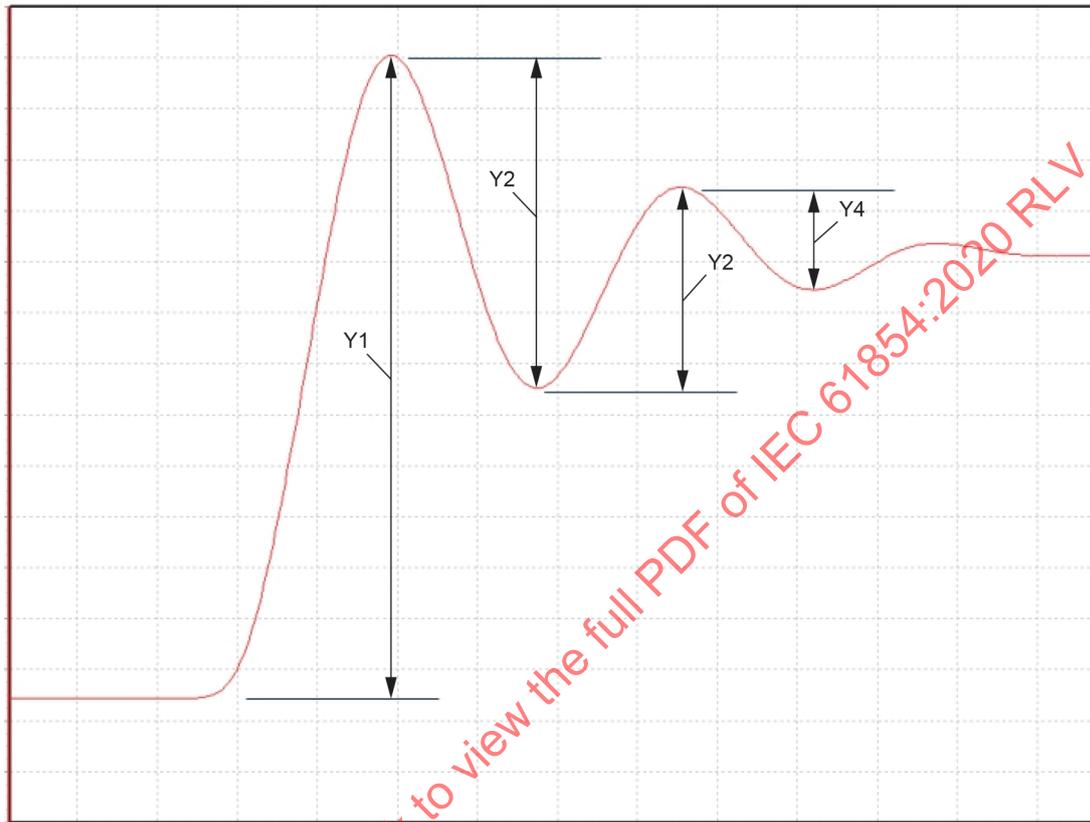

IEC

Figure 7 – Typical logarithmic decrement graph

NOTE This definition is different to the conventional one $\frac{1}{n} \ln \frac{A_0}{A_n}$ but is less sensitive to measurement error and does not require the zero deflection position to be determined.

The length and mass of the pendulum shall be recorded.

1) High Temperature Conductor (HTC)

Use the same set-up parameters as for standard conductors.

One spacer damper clamp shall be installed on a length of High Temperature Conductor which will heat up to its max continuous operating temperature. This temperature shall be kept constant (± 5 °C) for 2 h.

Shortly before the end of the heating cycle the temperature of the damping elements shall be measured and recorded.

The damping method shall be performed with the elastomer damping element kept at the previously measured temperature (± 10 °C)

- Acceptance criteria

The log decrement shall not differ by more than ± 20 % from the values declared by the supplier for the ambient temperature and ~~stated on contract drawings~~ for the maximum operating temperature respectively.

Characterization of the elastomer damping elements of spacer dampers designed for HTC (Type test only)

The characteristic of the elastomer damping element shall be verified with one of the 3 mentioned methods, heating the elastomer up to the maximum working temperature (± 5 °C) which it is designed for.

The complete spacer has to be heated in an appropriate test device (i.e. oven, climate chamber) for at least 2 h.

The temperature shall be taken at the spacer arm, close to the elastomer element.

The test shall be repeated at a temperature corresponding to 75 % and 50 % of the maximum working temperature of the damping element.

7.5.5 Flexibility tests

The purpose of these tests is to ensure and prove that the spacer damper or flexible spacer will accommodate any expected relative movement or displacement of the subconductors, during the normal working life of the line, without damage to conductors or the spacer.

~~The values of the displacements to be used for the tests shall be agreed between purchaser and supplier.~~

The spacer shall be installed on a length of ~~the specified subconductor~~ an appropriate bundle tensioned at 20 % of its rated tensile strength, tightening the clamp bolts to the specified installation torque. As an alternative, the spacer may be installed on rods or tubes of the correct size.

The following displacements shall be applied gradually:

- a) longitudinal displacement (see Figure 8): horizontal, longitudinal, parallel movement of one subconductor relative to the other(s) as measured by the deflection of the vertical long axis of the spacer from its position normal to the conductor;
- b) vertical displacement (see Figure 9): vertical movement of one subconductor relative to the other(s) as measured by the vertical deflection of the horizontal axis of the spacer from its position normal to the conductor;
- c) conical displacement (see Figure 10): conical or angular movement of the spacer clamp on one sub-conductor as measured conically about the ~~normal~~ subconductor axis;
- d) transversal displacement (see Figure 11): relative movement of two spacer clamps horizontally aligned perpendicular to the subconductor axes, as measured by the increase and decrease of conductor separation.

The values of the displacements to be used for the tests shall be in accordance with supplier's specified values on drawing, but should be at least:

- Longitudinal displacement: 25 mm (p-p)
- Vertical displacement: 50 mm (p-p)
- Conical displacement: 10° (cone vertex angle)
- Transversal displacement: 25 mm (p-p)

- Acceptance criteria

The above movements or displacements shall be executed without slip or damage to the subconductors (if used) and spacer, as detected by visual examination after removal of the spacer.

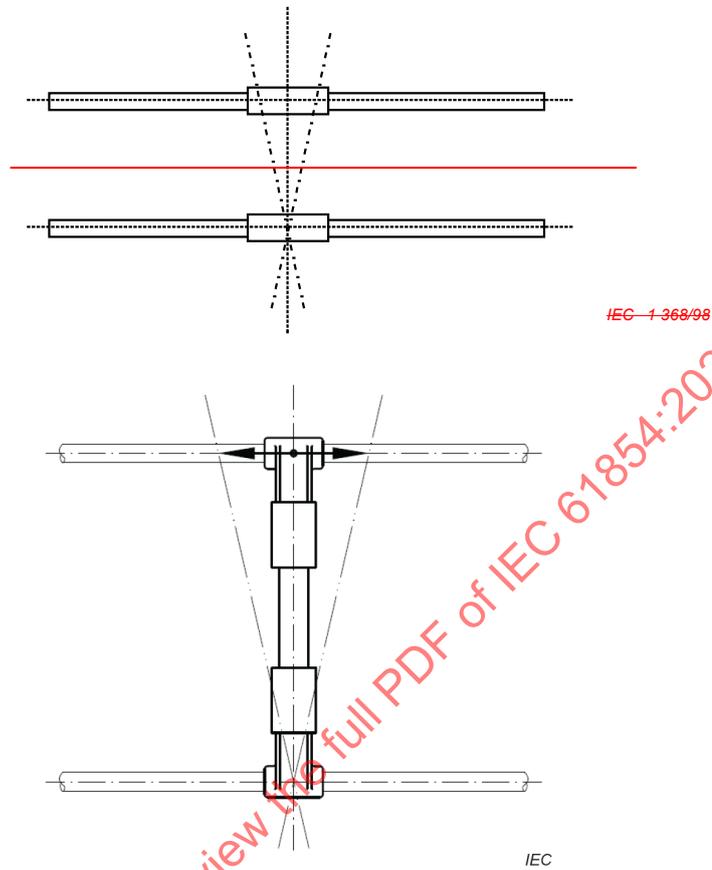


Figure 8 – Sketch of longitudinal displacement test

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

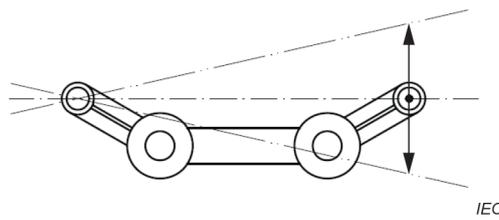
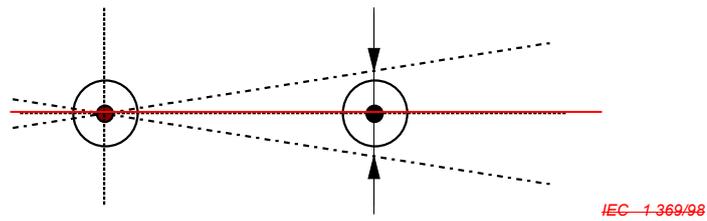


Figure 9 – Sketch of vertical displacement test

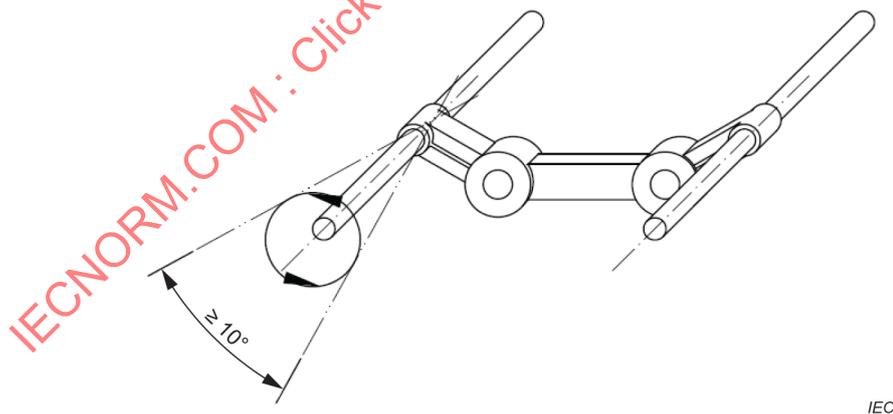
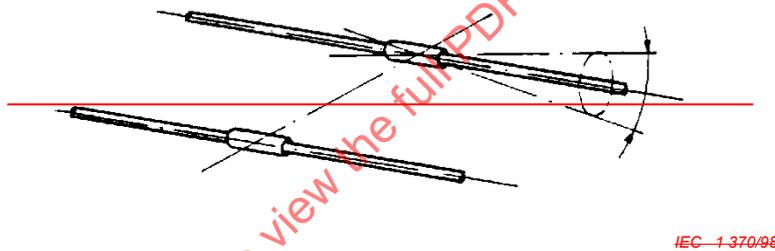


Figure 10 – Sketch of conical displacement test

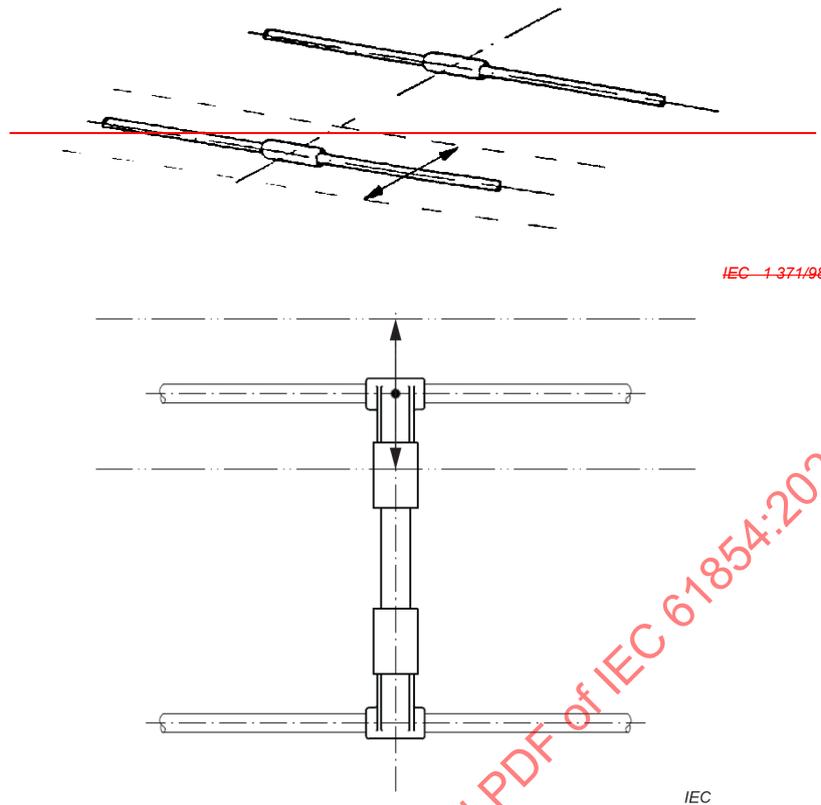


Figure 11 – Sketch of transverse horizontal displacement test

7.5.6 Fatigue tests

7.5.6.1 General

Tests shall be performed to verify the fatigue behaviour of spacers subjected to alternating motions or simulating vibrations (aeolian vibration and subspan oscillation) occurring in service.

Unless otherwise agreed between purchaser and supplier, two spacers shall be tested: one for subspan oscillation and one for aeolian vibration.

NOTE In the following test additional requirements may be agreed between purchaser and supplier to match very severe service conditions.

7.5.6.2 Subspan oscillation

The spacer shall be installed in a test rig designed to subject the spacer to oscillatory compressive/tensile forces directed between two horizontally opposite clamps (see Figure 12a).

The central frame of the spacer shall be unrestrained.

Alternatively, the frame of the spacer shall be held in a fixed position and oscillatory forces shall be applied to one clamp, approximately 90° to the arm axis (see Figure 12b).

~~Each clamp under test shall be installed on a rigid tube or rod having the same diameter as the conductor for which the spacer is intended to be used. The clamp fasteners, if threaded, shall be tightened to the specified installation torque.~~

Each clamp under test shall be installed in the middle of a length of the conductor for which the clamp is intended or alternatively on rigid tubes or rods of the same diameter. The clamp fasteners, if threaded, shall be tightened to the specified installation torque.

In case of breakaway bolts or breakaway caps the breakaway portion shall be removed and the torque has to be applied to the lower head with a calibrated torque wrench.

The installation torque shall be the nominal break away torque minus the tolerance as specified by the supplier.

The above tube(s) or rod(s) shall be connected to the drive mechanism.

Clamps with rod attachment shall be installed on a rigid tube or rod having the same diameter as the conductor for which the clamp is intended to be used.

The test shall be performed in one of the following two ways:

- either with a displacement ~~(peak-to-peak)~~ resulting from the application of a sinusoidal initial force having a peak-to-peak value of 600 N. The displacement shall be determined at the beginning of the test and shall be kept constant during ~~all the~~ duration of the test.
- or with a clamp displacement or an arm rotation equal to 90 % of the maximum allowed by the spacer ~~construction~~.

The test shall be carried out at a frequency between 1 Hz and 2 Hz for ~~a number of~~ 10 million (10^7) cycles, ~~agreed between purchaser and supplier~~.

~~NOTE—Tests in which actual conductors are involved are under consideration.~~


- Acceptance criteria

At the end of the test, the phase angle α (as determined in 7.5.4 a) and the force required to maintain the horizontal displacement shall not be less than 70 % of their initial value. There shall be no deterioration in the metal components of the spacer, and the residual tightening torque of the clamp fastener (if threaded) shall not be less than 50 % of the original value (i.e. half the specified installation torque).

~~NOTE~~ The residual tightening torque (RTT) is measured by means of a torque wrench which is applied to the bolt and operated in the tightening sense. The RTT value is read on the torque ~~meter~~ wrench when the bolt begins to move.


After the test, the spacer shall be dismantled and the damping elements shall be visually investigated. There shall be no cracks visible.

In case of helical fixation there should be no abrasion of the clamp or the rods and no looseness between the clamp body and the rods.

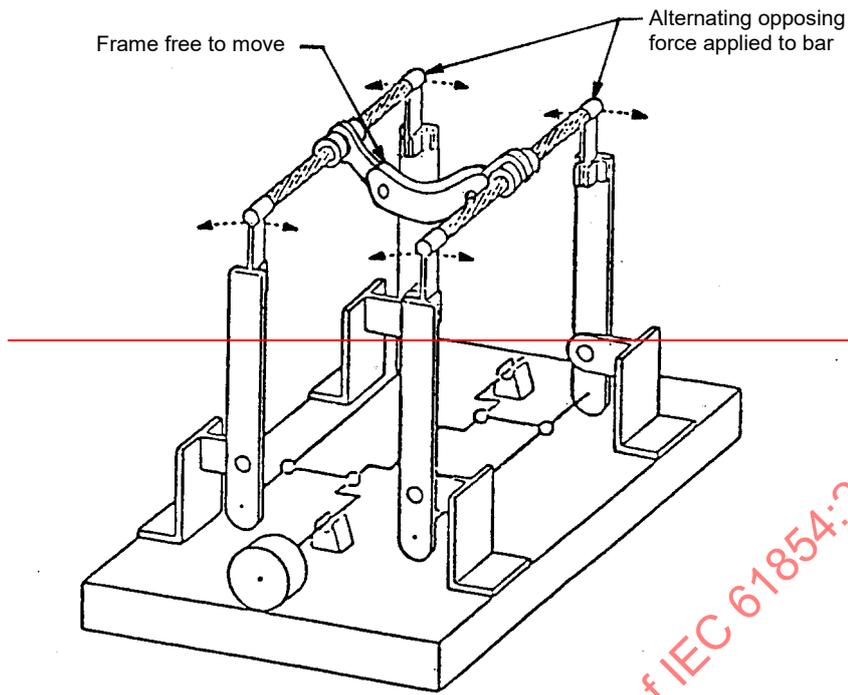

IEC-1.372/98

Figure 9a – Spacer frame free to move

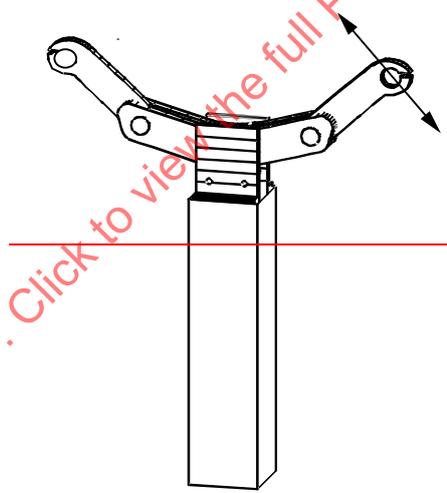

IEC-1.373/98

Figure 9b – Spacer frame fixed

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

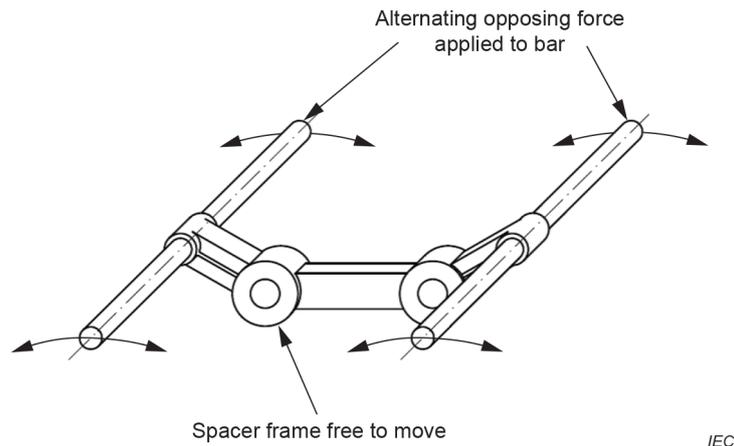


Figure 12a – Spacer frame free to move

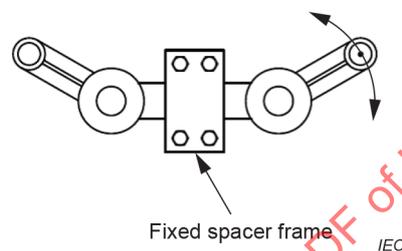


Figure 12b – Spacer frame fixed

Figure 12 – Test arrangements for subspan oscillation tests

7.5.6.3 Aeolian vibration

~~The following test simulates the behaviour of a spacer positioned at a node.~~

~~The frame of the spacer shall be fixed in a position as in service and a spacer clamp shall be installed on a rigid tube or rod having the same diameter as the conductor for which the spacer is designed (see figure 10). The clamp fastener (if threaded) shall be tightened to the specified installation torque.~~

~~The tube or rod shall be connected to the driving mechanism and shall be subjected to a vibration of a total angle equal to $0,2^\circ$ peak-to-peak, in a vertical plane parallel to the conductor, at a fixed frequency of 20 Hz, for 100 million cycles.~~

The frame of the spacer shall be fixed in a position as in service and a spacer clamp shall be connected by a hinge to the drive mechanism of a shaker (see Figure 13a). The clamp fasteners (if threaded) shall be tightened to the specified installation torque.

In case of breakaway bolts or breakaway caps these items shall be removed and the bolt shall be tightened with a calibrated torque wrench. The installation torque shall be the nominal break away torque minus the tolerance range, as specified by the supplier.

Clamps for helical fixation shall be fixed by the use of the helical rods over a tube or rod, having the same diameter of the conductor for which the spacer is designed; if possible, the length of the rods can be shortened. The distance between the two attachment points beside the spacer clamp (see Figure 13b) should be at least 500 mm.

The tube or rod shall be connected to the driving mechanism of a shaker. A frequency range of 20 Hz to 40 Hz shall be covered. Any automatic sweep rate not exceeding 0,2 decade/min in the case of logarithmic sweep, and 0,5 Hz/s in the case of linear sweep, can be used. The


shaker velocity shall be held constant at 0,1 m/s (0-p). The spacer shall be vibrated for 100 million (10^8) cycles.

- Acceptance criteria

At the end of the test the ~~torque~~ shaker force required to maintain the ~~agreed angle~~ shaker velocity of 0,1 m/s (0-p) at 20 and 40 Hz, shall be not less than 70 % of the initial value, there shall be no deterioration in the metal component of the spacer, and the residual tightening torque of the clamp fastener (if threaded) shall be not less than 50 % of the original value (i.e. half the specified installation torque).

At the end the spacer shall be dismantled and the damping elements shall be visually investigated. There shall be no cracks visible.

In case of helical fixation there should be no abrasion of the clamp or the rods and the integral strength of the connection system shall be ensured.

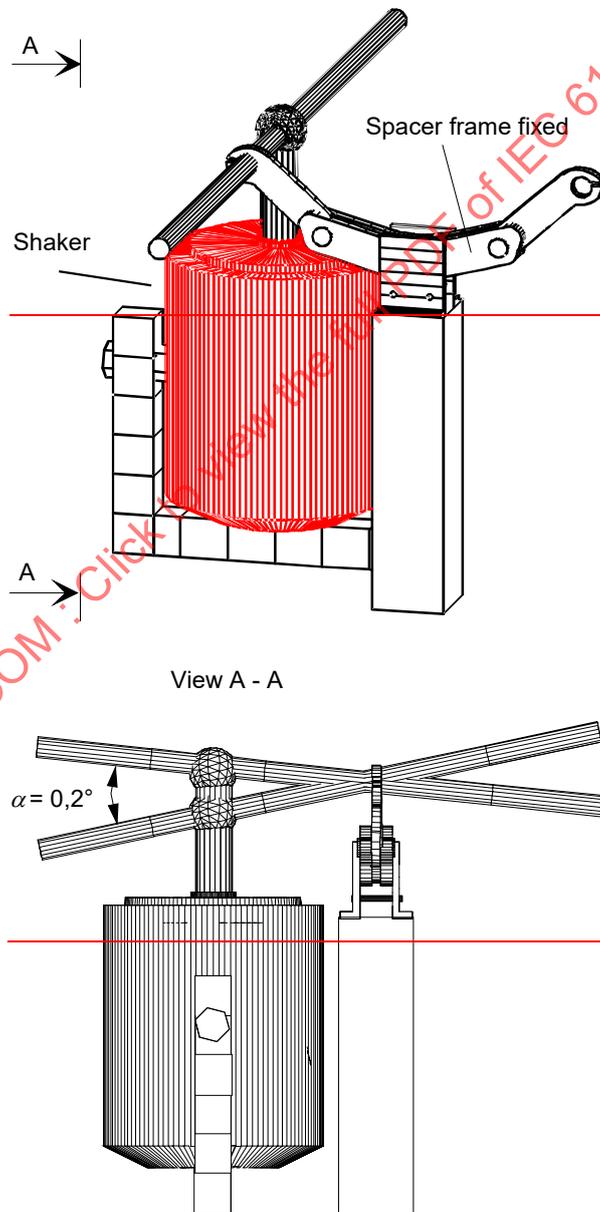

IEC-1374/08

Figure 10 — Example of aeolian vibration test at a node

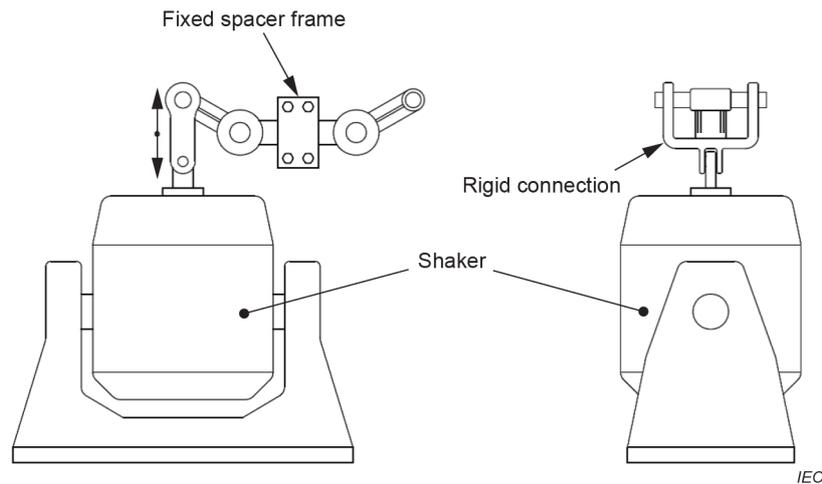


Figure 13a – Spacer clamp with fastener

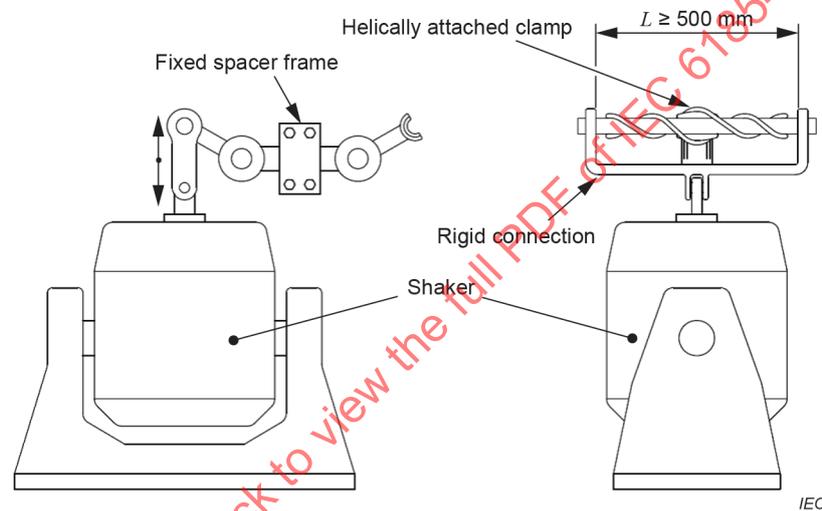


Figure 13b – Spacer clamp with helical fixation

Figure 13 – Test arrangement for aeolian vibration test

7.6 Tests to characterise elastomers

7.6.1 General

These tests shall be performed on samples taken from elastomeric components or test slabs and buttons as appropriate. These test data, along with supplier's guaranteed values, shall form the basis for acceptance of sample tests during production.

7.6.2 Tests

The tests reported in Table 2 shall be performed. The test values shall fall within the values guaranteed by the supplier.

7.6.3 Ozone resistance test

- Scope

The purpose of this test is to verify the resistance of the elastomer to the attack of ozone, universally present in the atmosphere and generated by the electrical discharges around high-voltage cables (corona).

- Test procedures

There are several test procedures covered by international standards. The test method to be used shall be agreed between purchaser and supplier. The recommended method is described in ISO 1431-1, procedure A, and the following parameters are recommended.

Ozone chamber temperature	(40 ± 2) °C
Ozone concentration	(50 ± 5) pp hm (parts per hundred million of air by volume)
Exposure time	72 h

As far as specimens are concerned, ISO 1431-1 (procedure A) prescribes thin rectangular test strips clamped at an elongation of 20 %. Alternatively, the test may be performed on finished elastomer components. The elastomer components shall be tested in their metal housing and at least one of them shall be subjected to the maximum tensile deformation allowed by the spacer design. In both cases, the elastomer under test shall be conditioned for 48 h in the dark at room temperature before being placed in the ozone chamber.

- Acceptance criteria

Ozone attack is usually evidenced by the formation of a few deep cracks or a myriad of small parallel cracks. They occur at right angles to the direction of applied stress. No cracks shall be observed at ×7 magnification on the surface of the specimens elongated or deformed as above.

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

Table 2 – Tests on elastomers

Recommended tests	Required value	Test methods
Room temperature tests		
– Specific gravity and density	Supplier specified range	ISO 1183-1 – ISO 2781
– Vulcanization characteristics	Supplier specified range	ISO 3417 6502-2
– Hardness shore A	Supplier specified range	ISO 868
– Tensile properties		ISO 37
Tensile strength	Supplier specified min. value	ISO 37
Ultimate elongation	Supplier specified min. value	ISO 37
Modulus at 100 % elongation	Supplier specified min. value	ISO 37
Modulus at 300 % elongation	Supplier specified min. value	ISO 37
– Compression set 70 h, 20 °C	Supplier specified max. value	ISO 815-1
– Rebound resilience at 20 °C	Supplier specified range	ISO 4662
– Ozone resistance	To meet 7.6.3	ISO 1431-1
– Abrasion resistance	Supplier specified min. value	ISO 4649
– Tear resistance	Supplier specified min max. value	ISO 34-1/34-2
– Electrical resistance	Supplier specified range	As per 7.7.2
High temperature tests		
– Compression set, 70 h, 100 °C	Supplier specified max. value	ISO 815-1
– Rebound resilience at 100 °C	Supplier specified range	ISO 4662
– Water immersion		ISO 1817
Volume change	Supplier specified max. value	ISO 1817
Weight change	Supplier specified max. value	ISO 1817
– Oil* conditioning 72 h, 70 °C		ISO 1817
Volume change	Supplier specified range	ISO 1817
Weight change	Supplier specified range	ISO 1817
Hardness change	Supplier specified range	ISO 1817
Tensile strength change	Supplier specified range	ISO 1817
Ultimate elongation change	Supplier specified range	ISO 1817
– Air-oven ageing, 72 h, 70 °C		ISO 188
Volume change	Supplier specified max. value	ISO 188
Weight change	Supplier specified max. value	ISO 188
Hardness change	Supplier specified max. value	ISO 188
Tensile strength change	Supplier specified max. value	ISO 188
Ultimate elongation change	Supplier specified max. value	ISO 188
Low temperature tests		
– Brittleness	Supplier specified min. value	ISO 812
– Compression set, 70 h, at minimum user service temperature	Supplier specified max. value	ISO 815-2
– Rebound resilience at minimum user service temperature	Supplier specified range	ISO 4662
– TR10 Modulus temperature	Supplier specified range	ISO 2921
* The test oil shall be agreed between specified by the purchaser and supplier.		

7.7 Electrical tests

7.7.1 Corona and radio interference voltage (RIV) tests

The tests shall be carried out according to Clause 14 of IEC 61284:1997.

7.7.2 Electrical resistance test

The purpose of the test is to verify that the conductivity of the various components is such that potential differences and current flows do not result in deterioration of spacer components or conductors.

~~The electrical resistance shall be measured between each pair of subconductors.~~

In case of rubber lined clamp all individual clamps shall be installed according to supplier's instruction on an appropriate length of conductor.

Metal to metal clamps (including helically fixed types without liners) do not need to be fixed on a conductor.

For spacers having elastomeric elements with high electrical resistance, ($> 1000 \Omega$) the electrical resistance of the elastomeric elements between each spacer arm and the spacer frame shall be determined by the application of 100 Vrms ($\pm 10\%$) at 50 Hz/60 Hz AC and the resistance determined from Vrms/Irms.

For spacers with elastomeric clamp liners the resistance between the conductor and the spacer arm shall also be determined by the same method. The elastomeric element and clamp liners shall be free from moisture or any liquid used during the assembly when testing is performed.

For spacers having an elastomeric element with low electrical resistance, ($< 1000 \Omega$), the electrical resistance of the spacer between each spacer arm and the spacer frame shall be determined by the application of a suitable voltage depending on the design of the spacer and agreed between purchaser and supplier.

The test shall be carried out at room temperature ($20 \pm 5 \text{ }^\circ\text{C}$); the temperature shall be reported. The specimens shall be kept at room temperature prior the test for at least 3 h.

The arms should not be moved during conditioning and testing to avoid any stress on to the damping elements.

When conductive current paths are used and, due to special design considerations, conductive current paths do not exist between all pairs of subconductors, the resistance shall be measured between the two most remote spacer components which are supposed to be connected via a conductive path.

~~An appropriate method shall be applied for measuring the resistance.~~

The test parameter and the test results shall be recorded.

- Acceptance criteria:

~~All the electrical resistance measurements obtained shall be in the range agreed between purchaser and supplier.~~

The resistance between the spacer arm and the central frame and between the conductor and the spacer arm in case of rubber lined clamps shall be within the range agreed between purchaser and supplier.

a) High Temperature Conductor (HTC)

Use the same set-up parameters as for standard conductors.

The electrical resistance test shall be performed with the elastomer damping element kept at the previously (7.5.4) measured temperature (± 10 °C).

- Acceptance criteria:

The resistance between the spacer arm and the central frame and between the conductor and the spacer arm shall be within the range agreed between the purchaser and the supplier.

7.8 Verification of vibration behaviour of the bundle/spacer system

Criteria and tests to verify the vibration behaviour of the bundle/spacer system can be agreed between purchaser and supplier following the suggestions reported in Annex D.

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

Annex A
(normative)

Minimum technical details to be agreed between purchaser and supplier

Reference subclause	Test option	Details to be agreed
6.2.3 Sampling and acceptance criteria	Inspection by variables	Inspection level, AQL, sampling instruction
	Inspection by attributes	Inspection level, AQL, sampling instruction
7.5.1 Clamp slip test		Tolerance if breakaway bolts are used
7.5.1.1 Longitudinal slip test	Variant A	Specified values
	Variant B	Specified values
7.5.1.2 Torsional slip test	Variant A	Specified load
	Variant B	Rotation angle γ_t
7.5.2 Breakaway bolt test		Tolerance
7.5.3 Clamp bolt tightening test		Tolerance if breakaway bolts are used
7.5.3 Simulated short-circuit test	Simulated short circuit current	Compressive force
	Compression and tension	Compressive and tensile force
7.5.4 Characterisation of the elastic and damping properties	Stiffness-damping-method	
	Stiffness method	
	Damping method	
7.5.6 Flexibility tests		Values of the displacements: – longitudinal – vertical – conical – transversal
7.5.7.2 Fatigue tests – subspan oscillation		Number of cycles
7.7.1 Corona and radio interference voltage (RIV) tests	Voltage method	Specified corona extinction voltage
	Voltage gradient method	Specified corona extinction test voltage gradient
7.7.2 Electrical resistance test		Range of the electrical resistance

Annex B (informative)

Compressive forces in the simulated short-circuit current test

To calculate the value of the compressive force, the following formula [4] may be applied, unless a different value is agreed between purchaser and supplier:

$$F_{\max} = K I_{\text{cc}} \sqrt{T \lg \frac{S}{D}}$$

where

F_{\max} is the maximum compressive force (N);

I_{cc} is the specified short-circuit current in the bundle (I_{rms} value) (kA);

T is the subconductor tensile load (N);

S is the bundle diameter (diameter of the circumscribing circle) (m);

D is the subconductor diameter (m);

K is the factor depending on the number of subconductors in the bundle [$\text{N}^{0,5} \text{A}^{-1}$]:

Number of subconductors	K factor
2	1,585
3	1,450
4	1,260
6	1,014

Example 1

Bundle type:	quad
Spacing:	450×10^{-3} m
Bundle diameter S :	636×10^{-3} m
Subconductor type:	ACSR Curlew
Overall diameter D :	$31,68 \times 10^{-3}$ m
Tensile load T :	32 000 N
Short-circuit current I_{cc} :	50 kA

$$F_{\max} = 1,26 \times 50 \sqrt{32000 \times \lg \frac{636}{31,68}} = 12863 \text{ N}$$

Example 2

Bundle type:	twin
Spacing:	400×10^{-3} m
Bundle diameter S :	400×10^{-3} m
Subconductor type:	AAAC Flint
Overall diameter D :	$25,16 \times 10^{-3}$ m
Tensile load T :	21 700 N
Short-circuit current I_{cc} :	20 kA

$$F_{\max} = 1,585 \times 20 \sqrt{21700 \times \lg \frac{400}{25,16}} = 5188 \text{ N}$$

Annex C
(informative)

Characterisation of the elastic and damping properties
Stiffness-Damping Method

With reference to Figure C.1, by assuming $\frac{H_t}{\omega}$ as the equivalent viscous damping of the hinge and the force f always perpendicular to the arm, the rotation of the spacer arm around the centre of the hinge is described by the formula:

$$J \varphi'' + \frac{H_t}{\omega} \varphi' + K_t \varphi = f l \tag{C.1}$$

where

- J is the moment of the inertia of the arm in respect of the centre of rotation;
- $\varphi, \varphi', \varphi''$ are respectively the instantaneous values of the angle of rotation of the arm and the associated first and second derivative;
- ω is the circular frequency;
- H_t is the damping constant;
- K_t is the torsional stiffness;
- f is the instantaneous value of the applied force;
- l is the arm length.

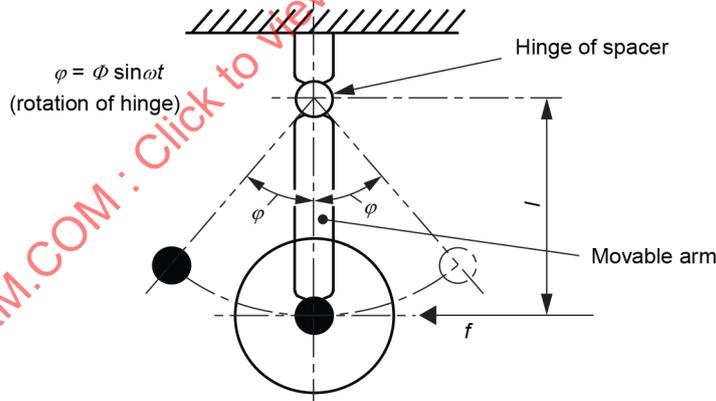


Figure C.1 – Rotation of spacer arm around the centre of the hinge

By assuming a sinusoidal force

$$f = F e^{j\omega t} \quad (F = \text{peak value, complex representation})$$

the angle of rotation will be sinusoidal

$$\phi = \Phi e^{j\omega t} e^{-j\alpha} \quad (\Phi = \text{peak value})$$

and will satisfy formula (C.1).

$$-\omega^2 J \Phi e^{j\omega t} e^{-j\alpha} + H_t j \Phi e^{j\omega t} e^{-j\alpha} + K_t \Phi e^{j\omega t} e^{-j\alpha} = F l e^{j\omega t} \quad (\text{C.2})$$

The relevant vector representation is illustrated in Figure C.2.

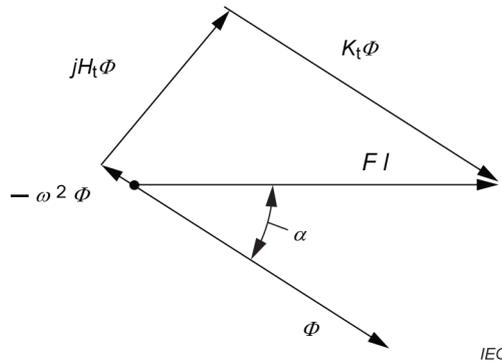


Figure C.2 – Vector representation of formula C.2

For very low frequency ν ($\omega = 2 \pi \nu$) and for a typical spacer damper, it is possible to neglect $\omega^2 \cdot J \cdot \Phi$ with respect to $K_t \cdot \Phi$, therefore:

$$\tan \alpha = \frac{H_t}{K_t}$$

$$\text{and, } K_t = \frac{F l \cos \alpha}{\Phi}$$

The energy dissipated by the hinge in one period is equal to:

$$E = \int f l d\varphi = \int f l \frac{d\varphi}{dt} dt$$

where

$$f = F \sin \omega t$$

$$\varphi = \Phi \sin(\omega t - \alpha)$$

$$E = F l \Phi \omega \int_0^{\frac{2\pi}{\omega}} \sin \omega t \cos(\omega t - \alpha) dt = \pi F l \Phi \sin \alpha$$

Annex D (informative)

Verification of vibration behaviour of the bundle/spacer system

D.1 General

Bundled conductors of overhead lines are subject to aeolian vibration and subconductor oscillation which, under severe conditions, may lead to fatigue failure of conductor strands or fittings. Spacer dampers are frequently used to reduce the amplitudes of these wind-induced vibrations and hence avoid the associated fatigue problems.

NOTE Sometimes the damping system for bundle conductors comprises either flexible spacers or spacer dampers together with vibration dampers.

The performance of a given spacer system in respect of vibratory behaviour is strictly correlated to the characteristics of the bundle (type of conductors, spacing, tensile load, etc.); as a consequence, the bundle plus spacer system shall be considered as a "whole" in evaluating the vibratory behaviour.

The performance verification of the bundle/spacer system, if agreed between purchaser and supplier, should consider aeolian vibration since this is the most common vibration phenomenon. Performance verification for subspan oscillation may also be agreed.

The performance verification should be made in one of the following two ways:

- analytically, determining the vibratory behaviour through the use of specific computer programs based on mathematical models of the system. The analytical performance verification should be carried out by the supplier;
- experimentally, carrying out field tests on overhead lines or experimental spans exposed to natural wind.

NOTE If agreed between purchaser and supplier, test evidence regarding previous experimental verification of the proposed damping systems can be accepted to evaluate the performance without any other additional field tests.

D.2 Aeolian vibration

The analytical verifications of aeolian vibration behaviour should be carried out for at least two spans of different length.

The purchaser should provide the following additional information, where available:

- the length of the two spans;
- the characteristics of the conductor (type, stranding, mass per length, RTS);
- the tensile load of the conductors (to be based on the yearly distribution of the minimum daily temperature);
- the conductor self-damping, or alternatively a section of conductor to be used by the supplier for evaluating, experimentally, the conductor self-damping; experimental data available for similar conductors can also be used for determining theoretically the self-damping coefficient;
- the type of suspension clamp (conventional, AGS, etc);
- the characteristics of armor rods, if applied;
- the characteristics of devices, other than damping elements, attached to the conductor and their in-span distribution;

- the conditions of the terrain surrounding the line (flat, hilly, woody, etc.);
- the yearly distribution of the average wind velocity (10 min mean) at the site relevant to the overhead line.

The experimental verification of aeolian vibration behaviour should be carried out for at least two spans of different length. The purchaser and supplier shall agree upon the period of time for the field tests, the measurements to be made (bending amplitude or strain at the suspension clamp, at the spacer-clamps, wind speed and direction, turbulence, etc.), the instrumentation and transducers to be used and the procedures for processing and presenting the experimental data.

NOTE The specified period of time for the field tests should be extended if during the same period the frequency of occurrence of wind perpendicular to the test spans with speeds in the range 0,5 m/s to 10 m/s, is deemed to be insufficient.

- Suggested acceptance criteria

The acceptance criteria should take into consideration the strains on the conductor at the suspension clamps, at the spacer-clamps and at the damper clamps, if dampers are used.

The acceptance criteria should be agreed between purchaser and supplier making reference to IEEE WPM 31 TP 65-156 [1], CIGRE SC22-WG04 [2], CIGRE SC22 WG11-TF2 [3] and IEEE Std 1368 [5] or to other equivalent publications.

D.3 Subspan oscillation

The analytical verification of subspan oscillation behaviour should be carried out for at least two spans of different length.

The purchaser should provide:

- the length of the two spans;
- the tensile load of the conductors;
- the characteristics of the conductor (type, stranding, mass per length, RTS);
- the conditions of the terrain surrounding the line (flat, hilly, woody, etc);
- the characteristics of devices, other than damping elements, attached to the conductor and their in-span distribution;
- the yearly distribution of the average wind velocity (10 min mean) at the site relevant to the overhead line, if available.

The experimental verification of subspan oscillation behaviour should be carried out for at least two adjacent spans of different length. The purchaser and supplier should agree upon the period of time for the field tests, the measurements to be made (amplitude of oscillation at mid-subspan and/or at a quarter-subspan, bending amplitude or strain at the spacer clamps, direction, speed and turbulence of the wind, etc.), the instrumentation and transducers to be used, and the procedures for processing and presenting the experimental data.

- Suggested acceptance criteria

The acceptance criteria should take into consideration the amplitude of oscillation at mid-subspan and at a quarter-subspan.

Propagation to adjacent subspans the subspan oscillations, strains at the spacer clamps or at the suspension clamps can also be considered.

The acceptance criteria should be agreed between purchaser and supplier.

Annex E (informative)

Description of HT conductors as given in CIGRE TB 695-2017 [7]

Type 0

Conductors designed for a maximum continuous operating temperature of 95 °C.

Type 1

Conductors consisting of a strength member made of steel, coated steel, or steel alloy, and an envelope for which the high temperature effects are mitigated by means of thermal-resistant aluminium alloys.

Type 2

Conductors consisting of a strength member made of steel, coated steel, or steel alloy, and an envelope for which the high temperature effects are mitigated by means of annealed aluminium.

Type 3

Conductors consisting of a metal-matrix composite (MMC) strength member, and an envelope for which the high temperature effects are mitigated by means of thermal-resistant aluminium alloys.

Type 4

Conductors consisting of a polymer-matrix composite (PMC) strength member, and an envelope for which the high temperature effects are mitigated by means of annealed aluminium or thermal-resistant aluminium alloys for HTLS applications.

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

Bibliography

- ~~[1] ISO 9000-1:1994, Quality management and quality assurance standards — Part 1: Guidelines for selection and use~~
- ~~[2] ISO 9001:1994, Quality systems — Model for quality assurance in design, development, production, installation and servicing~~
- ~~[3] ISO 9002:1994, Quality systems — Model for quality assurance in production, installation and servicing~~
- ~~[4] ISO 9003:1994, Quality systems — Model for quality assurance in final inspection and test~~
- ~~[5] ISO 9004-1:1994, Quality management and quality system elements — Part 1: Guidelines~~
- [1] IEEE Committee report, *Standardization of conductor vibration measurements*; IEEE WPM 1965; 31TP 65-156
- [2] CIGRE SC22 WG04, *Recommendations for the evaluation of the lifetime of transmission line conductors*; Electra 63, March 1979
- [3] CIGRE SC22 WG11-TF2, *Guide to vibration measurements on overhead lines* – Electra 163, Dec 1995
- [4] Manuzio C. An investigation on the forces on bundle conductor spacers under fault conditions – *IEEE T & D*, June-July 1965, Paper 31TP 65-707
- [5] IEEE Std 1368:2007, *IEEE Guide for Aeolian Vibration Field Measurements of Overhead Conductors*
- [6] CIGRE SCB2 WG11-TF05, *State of the art survey on spacers and spacer dampers* – Technical Brochure 277, August 2005
- [7] CIGRE SCB2 WG 48, *Experience with the mechanical performance of non-conventional conductors* – Technical Brochure 695, August 2017
-

[IECNORM.COM](https://www.iecnorm.com) : Click to view the full PDF of IEC 61854:2020 RLV

INTERNATIONAL STANDARD

NORME INTERNATIONALE



Overhead lines – Requirements and tests for spacers

Lignes aériennes – Exigences et essais applicables aux entretoises

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

CONTENTS

FOREWORD	4
1 Scope	6
2 Normative references	6
3 Terms and definitions	7
4 General requirements	8
4.1 Design	8
4.2 Materials	9
4.2.1 General	9
4.2.2 Non-metallic materials	9
4.3 Mass, dimensions and tolerances	9
4.4 Protection against corrosion	9
4.5 Manufacturing appearance and finish	9
4.6 Marking	9
4.7 Installation instructions	9
4.8 Specimen	9
5 Quality assurance	10
6 Classification of tests	10
6.1 Type tests	10
6.1.1 General	10
6.1.2 Application	10
6.2 Sample tests	10
6.2.1 General	10
6.2.2 Application	10
6.2.3 Sampling and acceptance criteria	11
6.3 Routine tests	11
6.3.1 General	11
6.3.2 Application and acceptance criteria	11
6.4 Table of tests to be applied	11
7 Test methods	13
7.1 Visual examination	13
7.2 Verification of dimensions, materials and mass	13
7.3 Corrosion protection test	13
7.3.1 Hot dip galvanized components (other than stranded galvanized steel wires)	13
7.3.2 Ferrous components protected from corrosion by methods other than hot dip galvanizing	14
7.3.3 Stranded galvanized steel wires	14
7.3.4 Corrosion caused by non-metallic components	14
7.4 Non-destructive tests	14
7.5 Mechanical tests	14
7.5.1 Clamp slip tests	14
7.5.2 Tests on bolt sets	19
7.5.3 Simulated short-circuit current test and compression and tension tests	21
7.5.4 Characterisation of the elastic and damping properties	27
7.5.5 Flexibility tests	31
7.5.6 Fatigue tests	33

7.6	Tests to characterise elastomers	36
7.6.1	General	36
7.6.2	Tests	36
7.6.3	Ozone resistance test	36
7.7	Electrical tests	38
7.7.1	Corona and radio interference voltage (RIV) tests.....	38
7.7.2	Electrical resistance test.....	38
7.8	Verification of vibration behaviour of the bundle/spacer system	39
Annex A (normative) Minimum technical details to be agreed between purchaser and supplier.....		40
Annex B (informative) Compressive forces in the simulated short-circuit current test		41
Annex C (informative) Characterisation of the elastic and damping properties Stiffness-Damping Method		42
Annex D (informative) Verification of vibration behaviour of the bundle/spacer system.....		44
D.1	General.....	44
D.2	Aeolian vibration	44
D.3	Subspan oscillation.....	45
Annex E (informative) Description of HT conductors as given in CIGRE TB 695-2017 [7]		46
Bibliography.....		47
Figure 1 – Test arrangements for longitudinal slip tests		16
Figure 2 – Test arrangement for torsional slip tests		19
Figure 3 – Test arrangement for the spring force test at room temperature		20
Figure 4 – Test arrangement for permanent load test on conical washers		21
Figure 5 – Test arrangements for simulated short-circuit current tests		25
Figure 6 – Test arrangements for compression and tension test.....		26
Figure 7 – Typical logarithmic decrement graph.....		30
Figure 8 – Sketch of longitudinal displacement test.....		32
Figure 9 – Sketch of vertical displacement test		32
Figure 10 – Sketch of conical displacement test.....		32
Figure 11 – Sketch of transverse horizontal displacement test		33
Figure 12 – Test arrangements for subspan oscillation tests		34
Figure 13 – Test arrangement for aeolian vibration test		36
Figure C.1 – Rotation of spacer arm around the centre of the hinge.....		42
Figure C.2 – Vector representation of formula C.2		43
Table 1 – Tests on spacers.....		12
Table 2 – Tests on elastomers		37

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**OVERHEAD LINES –
REQUIREMENTS AND TESTS FOR SPACERS****FOREWORD**

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61854 has been prepared by IEC technical committee 11: Overhead lines.

This second edition cancels and replaces the first edition published in 1998. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) Consider the application of spacers on high temperature conductors specifying additional high temperature tests in clamp slip tests and for the characterization of elastic and damping properties;
- b) Specify as far as possible test parameters and acceptance values;
- c) Avoid as far as possible the alternative procedures for the same test;
- d) Introduce a simpler test device for the simulated short circuit current test;
- e) Introduce test at low temperature on fastener components such as break away bolts and conical spring washers;

- f) Prescribe a different procedure for subspan oscillation tests on spacers equipped with clamps having rod attachments;
- g) Modify the test procedure for the aeolian vibration tests;
- h) Prescribe a different procedure for aeolian vibration tests on spacers equipped with clamps having rod attachments;
- i) Re-edit all the figures in order to make them more clear and homogeneous;
- j) Introduce an additional test device for the simulated short circuit current test.

The text of this standard is based on the following documents:

FDIS	Report on voting
11/265/FDIS	11/272/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

OVERHEAD LINES – REQUIREMENTS AND TESTS FOR SPACERS

1 Scope

This document applies to spacers for conductor bundles of overhead lines. It covers rigid spacers, flexible spacers and spacer dampers.

It does not apply to interphase spacers, hoop spacers and bonding spacers.

NOTE This document is written to cover the line design practices and spacers most commonly used at the time of writing. There may be other spacers available for which the specific tests reported in this document may not be applicable.

In some cases, test procedures and test values are left to agreement between purchaser and supplier and are stated in the procurement contract. The purchaser is best able to evaluate the intended service conditions, which should be the basis for establishing the test severity.

In Annex A, the minimum technical details to be agreed between purchaser and supplier are listed.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60050(466):1990, *International Electrotechnical vocabulary (IEV) – Chapter 466: Overhead lines*

IEC 60888:1987, *Zinc-coated steel wires for stranded conductors*

IEC 61284:1997, *Overhead lines – Requirements and tests for fittings*

ISO 34-1:2015, *Rubber, vulcanized or thermoplastic – Determination of tear strength – Part 1: Trouser, angle and crescent test pieces*

ISO 34-2:2015, *Rubber, vulcanized or thermoplastic – Determination of tear strength – Part 2: Small (Delft) test pieces*

ISO 37:2017, *Rubber, vulcanized or thermoplastic – Determination of tensile stress-strain properties*

ISO 188:2011, *Rubber, vulcanized or thermoplastic – Accelerated ageing or heat resistance tests*

ISO 812:2017, *Rubber, vulcanized or thermoplastic – Determination of low-temperature brittleness*

ISO 815-1:2014, *Rubber, vulcanized or thermoplastic – Determination of compression set – Part 1: At ambient or elevated temperatures*

ISO 815-2:2014, *Rubber, vulcanized or thermoplastic – Determination of compression set – Part 2: At low temperatures*

ISO 868:2003, *Plastics and ebonite – Determination of indentation hardness by means of a durometer (Shore hardness)*

ISO 1183-1: 2019, *Plastics — Methods for determining the density of non-cellular plastics — Part 1: Immersion method, liquid pycnometer method and titration method*

ISO 1431-1:2012, *Rubber, vulcanized or thermoplastic – Resistance to ozone cracking – Part 1: Static and dynamic strain testing*

ISO 1461:2009, *Hot dip galvanized coatings on fabricated iron and steel articles – Specifications and test methods*

ISO 1817:2015, *Rubber, vulcanized or thermoplastic – Determination of the effect of liquids*

ISO 2781:2018, *Rubber, vulcanized or thermoplastic – Determination of density*

ISO 2859-1:1999/AMD1: 2011, *Sampling procedures for inspection by attributes – Part 1: Sampling schemes indexed by acceptable quality limit (AQL) for lot-by-lot inspection*

ISO 2859-2:1985, *Sampling procedures for inspection by attributes – Part 2: Sampling plans indexed by limiting quality level (LQ) for isolated lot inspection*

ISO 2921:2011, *Rubber, vulcanized – Determination of low-temperature retraction (TR test)*

ISO 3951-1:2013, *Sampling procedures for inspection by variables -- Part 1: Specification for single sampling plans indexed by acceptance quality limit (AQL) for lot-by-lot inspection for a single quality characteristic and a single AQL*

ISO 3951-2:2013, *Sampling procedures for inspection by variables -- Part 2: General specification for single sampling plans indexed by acceptance quality limit (AQL) for lot-by-lot inspection of independent quality characteristics*

ISO 4649:2017, *Rubber, vulcanized or thermoplastic – Determination of abrasion resistance using a rotating cylindrical drum device*

ISO 4662:2017, *Rubber, vulcanized or thermoplastic – Determination of rebound resilience*

ISO 6502-2:2018, *Rubber – Measurement of vulcanization characteristics using curemeters – Part 2: Oscillating disc curemeter*

ISO 9001:2015, *Quality management systems – Requirements*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 60050-466 apply as well as the following.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1**rigid spacer**

spacer allowing no relative movement between the subconductors at the spacer location

3.2**flexible spacer**

spacer allowing relative movements between the subconductors at the spacer location

3.3**spacer system**

complex of spacers and the relevant in-span distribution

3.4**high temperature conductors****HTC**

conductors which are designed to have a maximum continuous operating temperature over 95 °C

Note 1 to entry: HTCa: conductors using annealed wires; HTCna: conductors using non-annealed wires.

3.5**maximum continuous operating temperature**

conductor temperature specified by the manufacturer and measured at the outer wire layers

4 General requirements**4.1 Design**

The spacer shall be designed as to:

- maintain subconductor spacing (at spacer locations), within any prescribed limits, under all conditions of service excluding short-circuit currents;
- prevent, in subspans between spacers, physical contact between subconductors, except during the passage of short circuit currents when the possibility of contact is accepted provided that the specified spacing is restored immediately following fault clearance;
- withstand mechanical loads imposed on the spacer during installation, maintenance and service (including short circuit conditions) without any component failure or unacceptable permanent deformation;
- avoid damage to the subconductor under specified service conditions;
- be free from unacceptable levels of corona and radio interference under specified service conditions;
- be suitable for safe and easy installation. For the bolted and latching clamp the design shall retain all parts when opened for attachment to the conductor;
- ensure that individual components will not become loose in service;
- be capable of being removed and re-installed on the subconductors without damage to the spacer or subconductors;
- maintain its function over the entire service temperature range;
- avoid audible noise.

Other desirable characteristics, which are not essential to the basic functions of the spacer but which may be advantageous to the purchaser, include:

- verification of proper installation from the ground,
- ease of installation and removal from energized lines

Detailed information on design, best practice and experience of spacers and spacer dampers is given in [6]¹.

4.2 Materials

4.2.1 General

Spacers shall be made of any materials suitable for their purpose. Unless additional requirements are stated, the material shall conform to the requirements of IEC 61284.

4.2.2 Non-metallic materials

In addition to the requirements of IEC 61284, the conductivity of the various non-metallic components shall be such that when properly installed

- potential differences between metallic components do not cause damage due to discharge;
- line current including short circuit current and any current flow through the spacer do not degrade spacer components

4.3 Mass, dimensions and tolerances

Spacer mass and significant dimensions, including appropriate tolerances, shall be shown on contract drawings.

Tolerances applied to the mass and to the dimensions should ensure that the spacers meet their specified mechanical and electrical requirements.

4.4 Protection against corrosion

In addition to the applicable requirements of IEC 61284, stranded steel wires, if used, shall be protected against corrosion in accordance with IEC 60888.

4.5 Manufacturing appearance and finish

The spacers shall be free of defects and irregularities; all outside surfaces shall be smooth and all edges and corners well-rounded.

4.6 Marking

The fitting marking requirements of IEC 61284 shall be applied to all clamp assemblies including those using breakaway bolts.

Correct position of the top of the spacer (for example arrows pointing upward), if necessary, shall also be provided.

4.7 Installation instructions

The supplier shall provide a clear and complete description of the installation procedure and, if required, the in-span location of the spacers.

The supplier shall make available any special installation tool that is required.

4.8 Specimen

All tests described in this document are based on bolted clamps and clamps with helical fixation. If other types of clamps are tested, the clamps should be installed according the suppliers installation instruction.

¹ Numbers in square brackets refer to the Bibliography.

5 Quality assurance

A quality assurance programme taking into account the requirements of this document can be used by agreement between the purchaser and the supplier to verify the quality of the spacers during the manufacturing process.

Detailed information on the use of quality assurance is given in a system as per ISO 9001 or similar.

It is recommended that test and measuring equipment used to verify compliance to this document is routinely maintained and calibrated in accordance with a relevant quality standard.

6 Classification of tests

6.1 Type tests

6.1.1 General

Type tests are intended to establish design characteristics. They are normally made once and repeated only when the design or the material of the spacer is changed. The results of type tests are recorded as evidence of compliance with design requirements.

6.1.2 Application

Spacers shall be subjected to type tests as per Table 1. Each type test shall be performed on three samples which are identical, in all essential respects, with the spacers to be supplied under contract to the purchaser. All units shall pass the tests.

The spacers used for tests during which no damage occurs to the units or their components may be used in subsequent tests.

NOTE The unit subjected to type tests can be either a complete spacer or a component of the spacer as appropriate to the test.

6.2 Sample tests

6.2.1 General

Sample tests are required to verify that the spacers meet the performance specifications of the type test samples. In addition, they are intended to verify the quality of materials and workmanship.

6.2.2 Application

Spacers shall be subjected to sample tests as per Table 1. The samples to be tested shall be selected at random from the lot offered for acceptance. The purchaser has the right to make the selection.

The spacers used for tests during which no damage occurs to the units or their components may be used in subsequent tests.

The unit subjected to sample tests can be either a complete spacer or a component of the spacer as appropriate to the test.

6.2.3 Sampling and acceptance criteria

The sampling plan procedures according to ISO 2859-1 and ISO 2859-2 (inspection by attributes) and ISO 3951 (inspection by variables) and the detailed procedures (inspection level, AQL, single, double or multiple sampling, etc.) shall be agreed between purchaser and supplier for each different attribute or variable.

Sampling inspection by variables is an acceptance sampling procedure to be used in place of inspection by attributes when it is more appropriate to measure on some continuous scale the characteristic(s) under consideration. In the case of failure load tests and similar expensive tests, better discrimination between acceptable quality and objective quality is available with acceptance sampling by variables than by attributes for the same sample size.

The purpose of the sampling process may also be important in the choice between a variables or attributes plan. For example, a customer may choose to use an attributes acceptance sampling plan to assure that parts in a shipment lot are within a required dimensional tolerance; the manufacturer may make measurements under a variables sampling plan of the same dimensions because of concern with gradual trends or changes which may affect the ability to provide shipment lots which meet the AQL.

6.3 Routine tests

6.3.1 General

Routine tests are intended to prove conformance of spacers to specific requirements and are made on every spacer. The tests shall not damage the spacers.

6.3.2 Application and acceptance criteria

Whole lots of spacers may be subjected to routine tests. Any spacer which does not conform to the requirements shall be discarded.

6.4 Table of tests to be applied

Table 1 indicates the tests which shall be performed. These are marked with an "X" in the table.

However, the purchaser may specify additional tests which are included in the table and marked with an "O".

Units or components damaged during the tests shall be excluded from the delivery to the customer.

Table 1 – Tests on spacers

Clause	Test	Spacer damper			Flexible spacer			Rigid spacer		
		Type test	Sample test	Routine test	Type test	Sample test	Routine test	Type test	Sample test	Routine test
7.1	Visual examination	X	X	O	X	X	O	X	X	O
7.2	Verification of dimensions, material and mass	X	X	O	X	X	O	X	X	O
7.3	Corrosion protection tests	X ¹⁾	X ¹⁾		X ¹⁾	X ¹⁾		X ¹⁾	X ¹⁾	
7.4	Non-destructive tests	O	O	O	O	O	O	O	O	O
7.5	Mechanical tests									
7.5.1	- clamp slip tests	X	O		X	O		X	O	
7.5.2	- tests on bolt sets	X	X		X	X		X	X	
7.5.3	- simulated short-circuit current test and compression and tension tests	X	O		X	O		X	O	
7.5.4	- characterisation of the elastic and damping properties	X	O		O	O		O	O	
7.5.5	- flexibility tests	X	O		X	O		X	O	
7.5.6	- fatigue tests	X			O			O		
7.6	Tests to characterise elastomers	X	O		X ¹⁾	O ¹⁾		X ¹⁾	O ¹⁾	
7.7	Electrical tests									
7.7.1	- corona and radio interference voltage (RIV) tests	X			X			X		
7.7.2	- electrical resistance test	X	O		X ¹⁾	O ¹⁾		X ¹⁾	O ¹⁾	
7.8	Verification of vibration behaviour of the bundle/spacer system									
D.2	- aeolian vibration	O			O ²⁾			O ²⁾		
D.3	- subspan oscillation	O			O			O		

1) If applicable.

2) When used in conjunction with vibration dampers.

The supplier should state in the tender quality plan, or other tender documentation, which testing is already complete (i.e: which type test) and which tests (sample or routine) are included in the tender, subject to the approval or change required by the purchaser.

7 Test methods

7.1 Visual examination

Type tests shall include visual examination to ascertain conformity of the spacers, in all essential respects, with the manufacturing or contract drawings. Deviations from the drawings shall be subject to the approval of the purchaser and shall be appropriately documented as an agreed concession.

Sample tests and, if required, routine tests shall include visual examination to ensure conformity of manufacturing process, shape, coating and surface finish of the spacer with the contract drawings. Particular attention shall be given to the markings required and to the finish of surfaces which come into contact with the conductor.

The sample test procedures and acceptance criteria shall be agreed between purchaser and supplier.

For spacers subject to corona type tests, the sample test shall include a comparison of shape and surface finish with one of the corona type test samples when specified or agreed by the purchaser.

7.2 Verification of dimensions, materials and mass

Type, sample and, if required, routine tests shall include verification of dimensions to ensure that spacers are within the dimensional tolerances stated on contract drawings. The purchaser may choose to witness the measurement of selected dimensions or may inspect the supplier's documentation when this is available.

Type, sample and, if required, routine tests shall also include verification of materials to ensure that they are in accordance with contract drawings and documents. This verification shall normally be carried out by the purchaser inspecting the supplier's documentation relating to material specifications, certificates of conformity or other quality documentation.

The total mass of the spacer complete with all its components shall comply with the mass shown on the contract drawing (within given tolerances).

7.3 Corrosion protection test

7.3.1 Hot dip galvanized components (other than stranded galvanized steel wires)

Hot dip galvanized components other than stranded galvanized steel wires shall be tested in accordance with the requirements specified in: ISO 1461.

The coating thicknesses shall conform to Tables 3 and 4 unless otherwise agreed between purchaser and supplier. However, for the purpose of this document, Tables 3 and 4 of ISO 1461:2009 shall apply to the following categories of items (and not to the categories specified in ISO 1461).

Table 3 of ISO 1461:2009: coating thickness on all samples except:

- washers;
- threaded components;
- small parts which are centrifuged (significant surface area < 1 000 mm²).

Table 4 of ISO 1461:2009 coating thickness on

- washers;
- threaded components;
- small parts which are centrifuged (significant surface area < 1 000 mm²).

7.3.2 Ferrous components protected from corrosion by methods other than hot dip galvanizing

Ferrous components protected from corrosion by methods other than hot dip galvanizing shall be tested in accordance with the requirement of the relevant IEC/ISO standards, as agreed between purchaser and supplier.

7.3.3 Stranded galvanized steel wires

Stranded galvanized steel wires shall be tested in accordance with the requirements specified in IEC 60888.

7.3.4 Corrosion caused by non-metallic components

By agreement between purchaser and supplier, evidence of non-corrosion compatibility between the elastomer and the conductor or spacer components, as appropriate, shall be demonstrated by a corrosion test or by suitable service experience. Alternatively, and where appropriate, the purchaser may specify for each subassembly containing an elastomer, a range of electrical resistance which provides adequate conductivity for electrical charging but minimizes galvanic action.

NOTE Non-metallic components, especially elastomeric elements lining a spacer clamp or providing the flexibility and damping in a spacer damper, are commonly made electrically conducting to avoid any problems that might otherwise arise from the capacitive charging of the arms or body of the spacer. Carbon is frequently used in elastomer formulations, both to achieve the desired stiffness and damping, and to provide electrical conductivity. Some constituents of the non-metallic components, such as chlorides, free sulphur, etc., may have corrosion effects.

The combination of the nature of the rubber, the pollution and the electrolyte are responsible for a corrosion process.

7.4 Non-destructive tests

The purchaser shall specify or agree to relevant test methods (ISO or other) and acceptance criteria. Examples of non-destructive tests are as follows:

- magnetic test;
- eddy current test;
- radiographic test;
- ultrasonic test;
- proof load test;
- dye penetrant test;
- hardness test.

7.5 Mechanical tests

7.5.1 Clamp slip tests

7.5.1.1 General

The tests shall be performed using the conductor for which the clamps are intended. The conductor shall be "as new", i.e. free of any deterioration or damage. The minimum length of the test conductor between its terminating fittings shall be 4 m. The conductor shall be tensioned to 20 % of its rated tensile strength before the installation of the clamps to be tested.

Clamps shall be installed on an unused portion of conductor for each test.

Precautions shall be taken to avoid birdcaging of the conductor.

The clamps shall be tested individually. The clamp shall be installed in accordance with the supplier's instructions. In the case of breakaway bolts or break away caps, the breakaway portion shall be removed and the torque has to be applied to the lower head with a calibrated torque wrench.

The installation torque shall be the nominal break away torque minus the tolerance as specified by the supplier.

The use of other conductor, conductor lengths and tensions can be agreed between purchaser and supplier.

7.5.1.2 Longitudinal slip test

By means of a suitable device (i.e. Figure 1), a load coaxial to the conductor shall be applied to the clamp.

The load shall be gradually increased (not faster than 100 N/s) until it reaches the following values, unless otherwise agreed between purchaser and supplier.

- 4,0 kN for metal to metal clamps (except helical fixation);
- 1,5 kN for rubber/elastomer-lined clamps;
- 1,5 kN for clamps with helical fixation.

This load shall be kept constant for 60 s

To detect slippage colour marks shall be fixed at the interface of the clamp and conductor respectively and at the end of helical rods, if used. Other methods are also permitted if agreed between purchaser and supplier.

Then the load shall be gradually increased until slippage of the clamp occurs.

Slippage shall be considered as having occurred when the pulling force cannot be increased or the movement of the clamp on the conductor is

- 2 mm for metal to metal clamp;
- 5 mm for rubber lined clamp;
- 15 mm for clamps with helical fixation.

For type test only, an additional slip test taking into account the creeping behaviour of the conductor shall be performed.

A new clamp shall be fixed (according to 7.5.1.1) on the conductor which is tensioned to 20 % of RTS. Then the tension shall be gradually increased (not more than 100 N/s) to 40 % of conductor RTS and kept for 2 h at this tension load.

It is permitted to fix several clamps on the same setup to reduce expenditure of time. The distance between the clamps shall be at least 300 mm.

Afterwards the tension shall be gradually decreased to 20 % of conductor RTS and the slip test shall be repeated.

- Acceptance criteria

No slippage shall occur at or below 4 kN for metal/metal clamps and 1,5 kN for rubber lined clamp and clamps with helical fixation. If both minimum and maximum slip requirements are stated, the slip shall occur between those values. Very small surface flattening of the outer strands of the conductor is acceptable.

If armor rods are used under the clamps, slippage of the armor rods relative to the conductor is considered as clamp slippage.

For clamps with helical fixation, relative displacement up to 15 mm in the interface of clamp and helical rods, when the load is reached, is acceptable. The relative displacement shall not increase during the 60 s at constant load. There shall not be any relative movement at the end of helical rods.

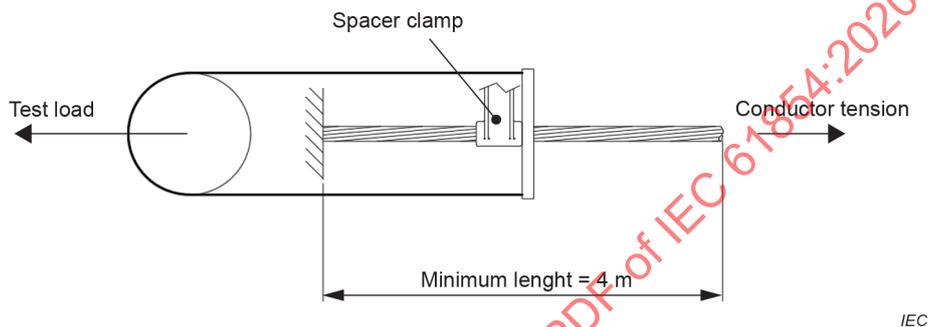


Figure 1 – Test arrangements for longitudinal slip tests

a) Longitudinal slip test for high temperature conductors (HTC)

Use the same set-up parameters as for standard conductors (7.5.1.1).

After installing the clamp at ambient temperature, the conductor shall be electrically heated up to the maximum continuous operating temperature as specified by the conductor manufacturer and kept constant at this temperature for 0,5 h.

The tension load shall be kept constant at 20 % of RTS of the used conductor.

Then the slip test shall be performed as for standard conductors, at the maximum continuous operating temperature.

For the type test, an additional thermal process of the conductor shall be performed.

A new clamp shall be fixed (according to 7.5.1.1) at ambient temperature on the conductor which is tensioned to 20 % of RTS. It is permitted to fix several clamps on the same setup to reduce expenditure of time. The distance between the clamps shall be at least 300 mm.

Then the conductor shall be electrically heated up to the maximum continuous operating temperature as specified by the conductor manufacturer and kept constant at this temperature for 1 h.

Afterwards, the temperature shall decrease to at least ambient temperature plus 5 °C. These cycles shall be carried out four times. At the end of the fourth cycle, after decreasing the temperature to ambient values the longitudinal slip test shall be performed. For the complete test run the tension shall be kept constant at 20 % of rated tensile strength.

- Acceptance criteria for not annealed conductor wires:

No slippage shall occur at or below 2,5 kN for metal/metal clamps and 1 kN for rubber lined clamps and clamps with helical fixation. If minimum and maximum slip values are specified, the slip shall occur between those values. Very small surface flattening on the outer strands of the conductor is acceptable.

- Acceptance criteria for annealed conductor wires:

No slippage shall occur at or below 1,5 kN for metal/metal clamps and 0,5 kN for rubber lined clamps and clamps with helical fixation. If minimum and maximum slip values are specified, the slip shall occur between those values. Very small surface flattening on the outer strands of the conductor is acceptable.

7.5.1.3 Torsional slip test

This test is applicable for metal to metal clamps, rubber lined clamps and helical fixation.

The spacer clamp shall be installed in accordance with the supplier's instruction.

To limit the torsion flexibility of the conductor, rigid clamps have to be installed at both sides of the tested spacer clamp (Figure 2). The free length of conductor between specimen and fixing clamps should be at least 1x spacer clamp width.

A torque (see Figure 2) shall be applied to the clamps in order to rotate it around the axis of the conductor. The torque shall be gradually increased until it reaches the specified minimum slip torque.

The minimum slip torque should correlate with the minimum longitudinal slip load according 7.5.1.1 (4kN for metal/metal clamps, 1.5 kN for rubber/elastomer lined clamps).

The adequate torsion slip torque can be calculated as follows:

$$M = \frac{d}{2} F_{slip}$$

where

- M is the calculated torque (Nm);
- F_{slip} is the specified longitudinal slip load according to 7.5.1.1 (N);
- d is the conductor diameter (m).

This torque shall be kept constant for 60 s. Then the torque shall be gradually increased until slippage of the clamp by torsion occurs. The slip torque value shall be recorded.

Clamp slip shall be considered as having occurred when a permanent slip value greater than one strand diameter is measured.

- Acceptance criteria

No slippage shall occur at or below the calculated torsion slip torque M .

Very small surface flattening on the outer strands of the conductor is acceptable.

For type test only, an additional slip test taking into account the creeping behaviour of the conductor shall be performed.

A new clamp shall be fixed (according to 7.5.1) on the conductor which is tensioned to 20 % of RTS. Then the tension shall be gradually increased (not more than 100 N/s) to 40 % of conductor RTS and kept for 2 h.

It is permitted to fix several clamps on the same setup to reduce expenditure of time. The distance between the clamps shall be at least 300 mm.

Afterwards the tension shall be gradually decreased to 20 % of conductor RTS and the torsion slip test shall be repeated.

- Acceptance criteria:

No slippage shall occur at or below the minimum specified value.

Very small surface flattening on the outer strands of the conductor is acceptable.

a) High Temperature Conductor (HTC)

Use the same set-up parameters as for standard conductors (7.5.1).

After installing the clamp at ambient temperature, the conductor shall be electrically heated up to the maximum continuous operating temperature as specified by the conductor manufacturer and kept constant at this temperature for 0,5 h.

Then the torsion slip test shall be carried out in the same way than for standard conductors, at the maximum continuous operating temperature.

- Acceptance criteria:

No slippage shall occur at or below the minimum specified value.

Very small surface flattening on the outer strands of the conductor is acceptable.

For clamps with helical fixation, a slight relative displacement in the interface of clamp and helical rods, when the load is reached, is acceptable. The relative displacement shall not increase during the 60 s at constant load. There shall not be any relative movement at the end of helical rods

For the type test an additional thermal process of the conductor shall be performed.

A new clamp shall be fixed (according to 7.5.1) at ambient temperature on the conductor which is tensioned to 20 % of RTS. It is permitted to fix several clamps on the same setup to reduce expenditure of time. The distance between the clamps shall be at least 300 mm.

Then the conductor shall be electrically heated up to the maximum continuous operating temperature as specified by the conductor manufacturer and kept constant at this temperature for 1 h.


Afterwards the temperature shall decrease to at least ambient temperature plus 5 °C. These cycles shall be carried out four times. After decreasing the temperature to ambient value, the torsional slip test shall be performed in the same way than for standard conductors. For the complete test run the tension shall be kept constant at 20 % of rated tensile strength.

- Acceptance criteria:

No slippage shall occur at or below the minimum specified value.

Very small surface flattening on the outer strands of the conductor is acceptable.

For clamps with helical fixation, a slight relative displacement in the interface of clamp and helical rods, when the load is reached, is acceptable. The relative displacement shall not increase during the 60 s at constant load. There shall not be any relative movement at the end of helical rods.

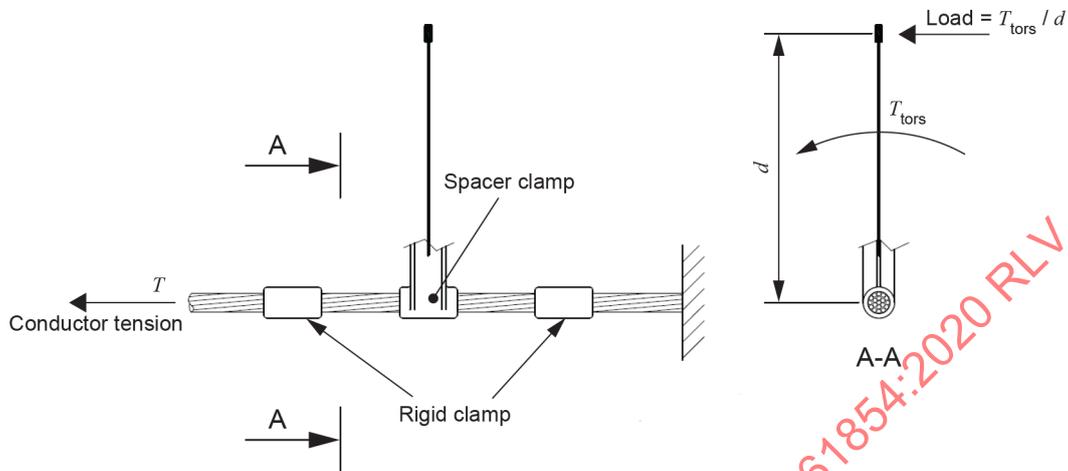

IEC

Figure 2 – Test arrangement for torsional slip tests

7.5.2 Tests on bolt sets

7.5.2.1 General

These tests are performed to ensure the proper function of all individual items used in bolted clamps.

7.5.2.2 Breakaway bolt test

The breakaway bolts or breakaway caps, if used, shall be tested by applying increasing torque to the breakaway portion of the bolt or breakaway cap until it breaks away. The test shall be carried out at ambient temperature.

Precaution shall be taken on a constant continuous circular motion and a perpendicular angle between torque wrench and bolt head.

The breakaway torque shall be recorded.

- Acceptance criteria:

The breakaway torque shall be within the tolerance agreed between the purchaser and the supplier.

If no tolerance is specified, the range shall be nominal installation torque plus/minus 10 %.

For countries where ambient temperature below 0 °C can be expected, it is recommended to repeat the tests on breakaway bolts and breakaway caps at the temperature corresponding to the average temperature of the coldest month.

The specimens shall be kept for at least 1 h in an appropriate cooling device prior the test.

During the break away test the temperature of the specimens should be measured and recorded. The temperature during the test shall not increase more than 10 °C from initial cooling temperature.

7.5.2.3 Embrittlement tests on conical washers

First, a spring force test shall be carried out at room temperature on 3 specimens to assess the resilience of the washers. The washers shall be installed individually in a bolt used in the spacer damper under test and tightened 10 % above the specified installation torque, as shown in Figure 3. The assembly shall be placed in an appropriate test device and the reaction force and the deflection of the washers shall be recorded.

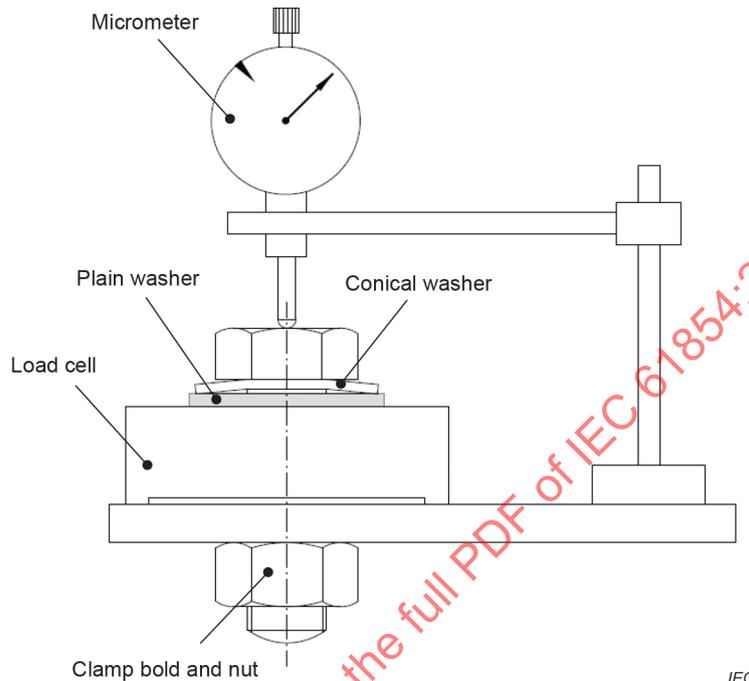


Figure 3 – Test arrangement for the spring force test at room temperature

Second, a permanent load test shall be performed.

At least 10 unused conical spring washers shall be installed with alternating orientation on a bolt used in the spacer damper under test or if necessary on a longer bolt of the same type. The bolt shall be tightened 10 % above the specified installation torque of the spacer.

The conical spring washers shall be separated from one another by a plain washer with a hardness of at least 300 HV, as shown in Figure 4.

The test arrangement shall then be stored at a constant temperature of at least -20 °C (±2 °C) for 24 h.

After the test assembly has warmed up to ambient temperature and visually inspected, it will be dismantled.

The spring force test at room temperature shall be repeated after the storage at low temperature on 3 conical spring washers and the results compared with the initial recorded reaction force of the washers.

- Acceptance criteria:

No cracks shall occur during the low temperature test period.

The reaction force of the washers, after storage at low temperature, shall be at least 90 % of the reaction force initially recorded at the same deflection.

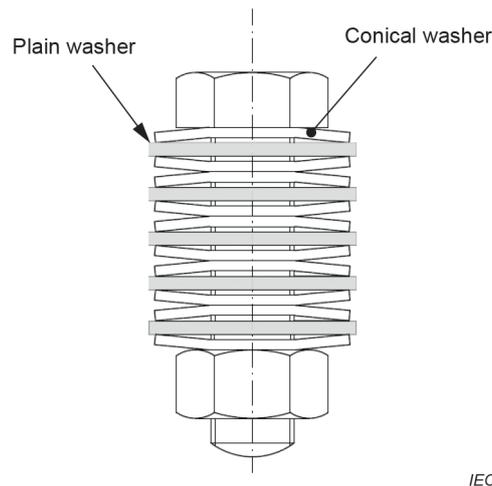


Figure 4 – Test arrangement for permanent load test on conical washers

7.5.2.4 Clamp bolt tightening test

The test shall be performed by installing the clamp on a piece of the actual conductor. In case not available, an equivalent conductor or a tube of same diameter can be used. The bolts or nuts shall be tightened to a torque 10 % above the specified installation torque with a calibrated torque wrench. Clamps with breakaway bolts or breakaway caps shall have the breakaway portion of the head removed prior to the test and shall be tightened 10 % above the specified installation torque.

- Acceptance criteria

The threaded connection shall remain serviceable (by hand) for 3 subsequent installations and removals and all components of the clamp shall be without any mechanical deformation or cracks. No plastic deformation shall occur to the conductor inside the clamp.

Lastly, the torque shall be increased to either twice the specified installation value or the maximum torque value recommended by the bolt supplier, whichever is lower. This increase shall not result in any breakage of threaded parts or other components of the clamp or any cracks. The bolt(s) shall be able to be removed from the spacer without any failure.

Plastic deformation is permitted.

7.5.3 Simulated short-circuit current test and compression and tension tests

7.5.3.1 General

The purpose of these tests is to ensure that the spacers will be able to withstand, without failure or permanent deformation, the compressive and tensile load which may occur in service.

The purchaser shall specify or agree to one of the following tests, or any combination of tests.

NOTE The effects imposed by the loads in the different tests, or combination of tests, are not necessarily equivalent.

7.5.3.2 Simulated short-circuit current test

Suitable devices (see Figure 5) which are able to apply compressive forces (directed toward the centre of the conductor bundle) and tensile forces (directed away from the centre of the conductor bundle) to all spacer clamps simultaneously shall be used.

Variant A: Test device using mechanical means other than a simulated conductor. Possible methods include the use of pulleys, pneumatic cylinders, or hydraulic cylinders. See Figure 5a for a possible example setup.

Variant B: Setup with conductors or wires to simulate span conditions in the field using a tensile testing machine. The yoke plates shall be shaped in relation to the type of spacer under test.

The line angles α (alpha) are typically between 77° to 80° (Figure 5b and Figure 5c).

The tensile load F can be calculated as follows:

Compression test:
$$F = \frac{n}{2} F_{compr} \tan \alpha_c$$

Tension test:
$$F = \frac{n}{2} F_{tens} \tan \alpha_t$$

where

F is the tensile load (N);

n is the number of sub conductors;

α_c is the line angle measured between conductor and spacer during compression ($^\circ$);

α_t is the line angle measured between conductor and spacer during tension ($^\circ$);

F_{compr} is the calculated compression load according to Annex B (N);

$$F_{tens} = \frac{1}{2} F_{compr}$$

Compression:

Metal to metal clamps and rubber lined clamps shall be fixed according to suppliers' instruction. The compressive force shall be gradually increased until it reaches the test value which is calculated using the formula given in Annex B. At this value the forces shall be held constant for 60s and then removed.

The test shall be executed twice; the first one with the spacer in its normal position, the second one, applicable to flexible spacer and spacer damper only, with a clamp displaced 25 mm longitudinally, with reference to the other clamp(s).

Tension:

Following the compressive force, the tensile force shall be applied. This value shall be gradually increased until it reaches 50 % of the compressive force.

This force shall be kept constant for 60 s and then removed.

- Acceptance criteria

After the test,

- it shall be possible to return the spacer clamps to their design position using only slight hand pressure;
- the spacer shall be examined; if necessary, the spacer shall be disassembled. There shall be no deformation or damage which would impair the efficiency of the spacer or affect its function of maintaining the normal bundle spacing.

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

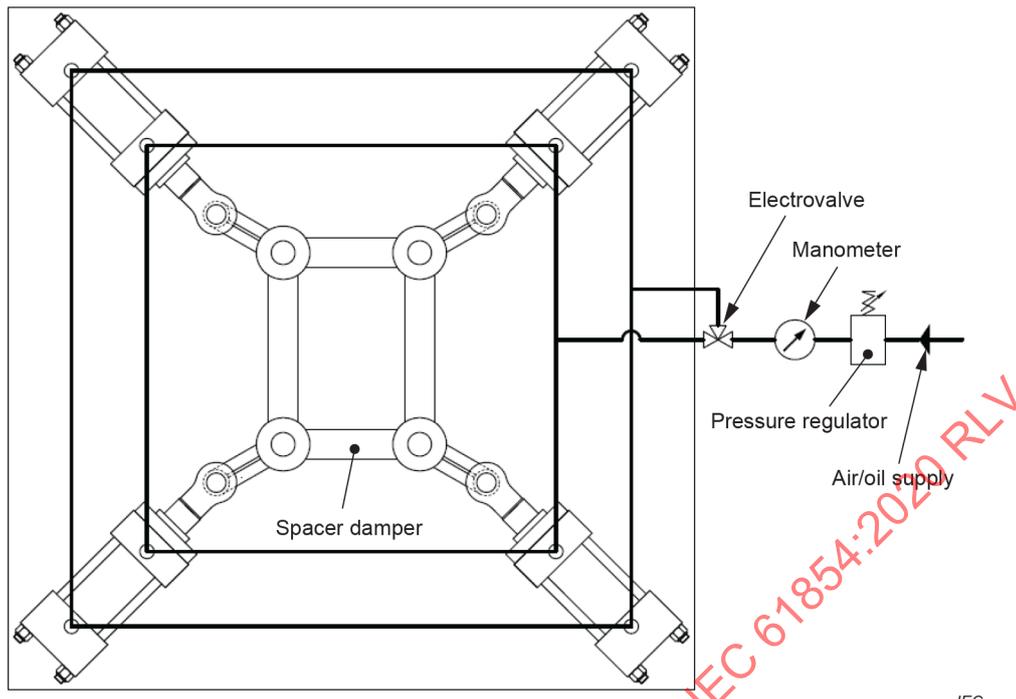


Figure 5a – Example of test device used in Variant A

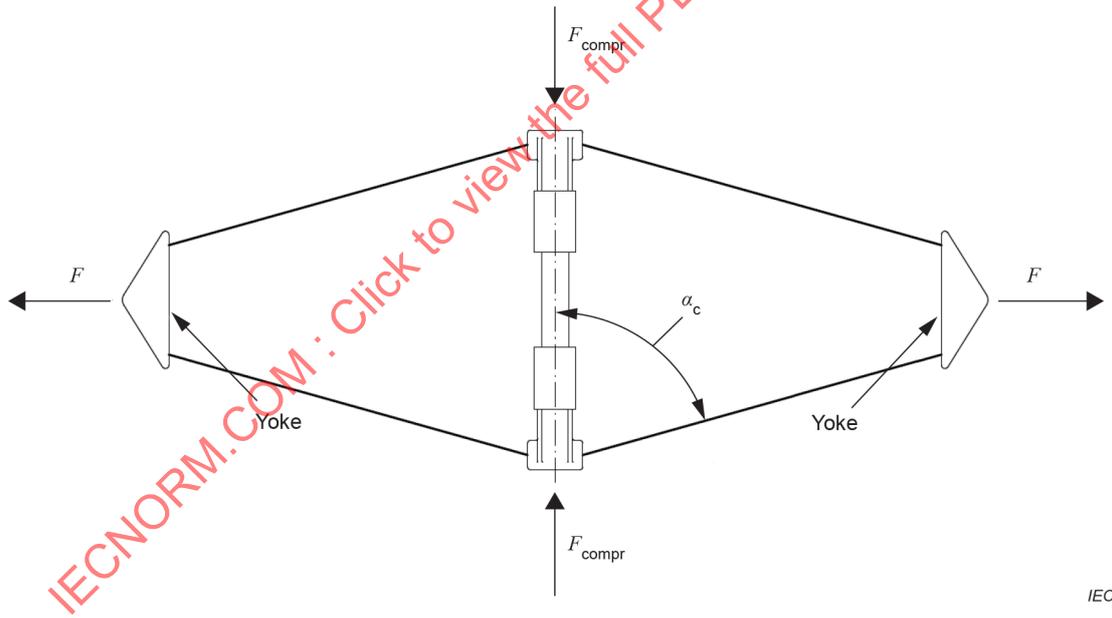


Figure 5b – Variant B (compression)

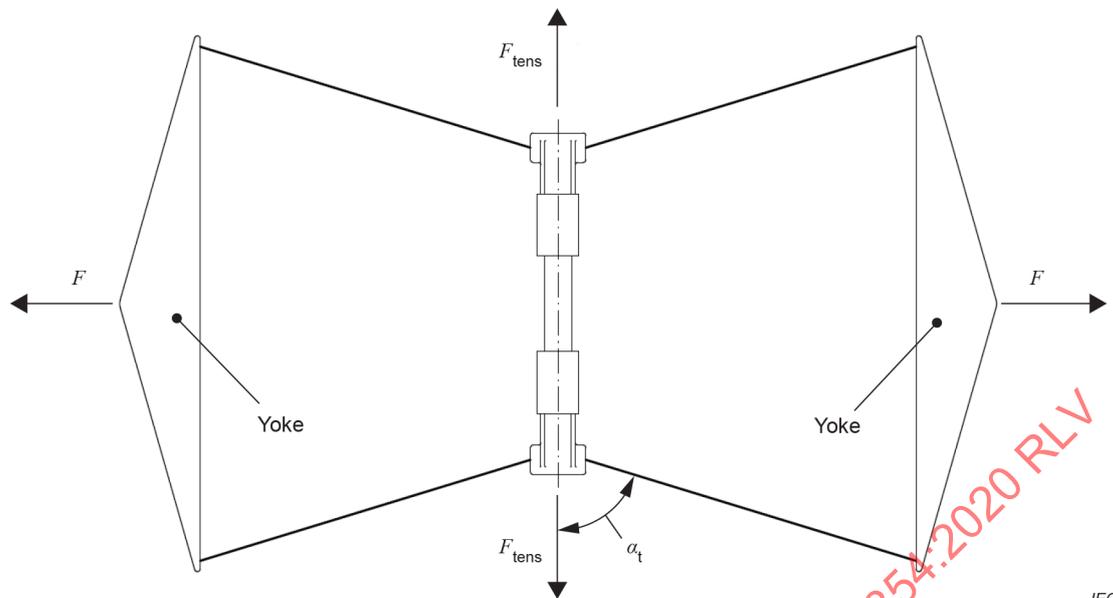


Figure 5c – Variant B (tension)

Figure 5 – Test arrangements for simulated short-circuit current tests

7.5.3.3 Compression and tension test

For twin spacers this test is covered by the simulated short circuit test (7.5.3.1).

The spacer assembly shall be installed on a suitable device (see Figure 6a) able to apply compression and tension forces between each pair of adjacent clamps.

The clamp bolts, when used, shall be tightened according to supplier's instruction.

Helical, used for fixation, should be replaced by an appropriate mechanical fixation.

For each pair of adjacent clamps, the compressive force shall first be applied. The force shall be gradually increased until it reaches the calculated compression force which shall be maintained for 60 s. Then the compressive force shall be removed and the tensile force, corresponding to 50 % of the compressive force, shall be applied to the same pair of clamps and held for 60 s.

The centripetal compressive force for triple, quad and hexagonal bundle configurations shall be calculated using the formula given in Annex B.

Only the components of the calculated centripetal short circuit forces are applied between two adjacent clamps (Figure 6b).

Helical fixation clamps:

To prove the mechanical strength of the system clamp helical/rod of helical fixation clamps a separate tension test (see Figure 6c) shall be performed.

The conductor shall be simulated by a piece of tube having the same diameter than the conductor. The distance "L" between the two attachment points beside the spacer clamp (see Figure 6c) should be at least 500 mm.

The tensile force, correlating to 50 % of the compressive force, shall be applied to a pair of clamps and held for 60 s.

Then the load shall be released.

- Acceptance criteria

After the test,

- it shall be possible to return the spacer clamps to their design position using only slight hand pressure;
- the spacer shall be examined; if necessary, the spacer shall be disassembled. There shall be no deformation or damage which would impair the efficiency of the spacer or affect its function of maintaining the normal bundle spacing.

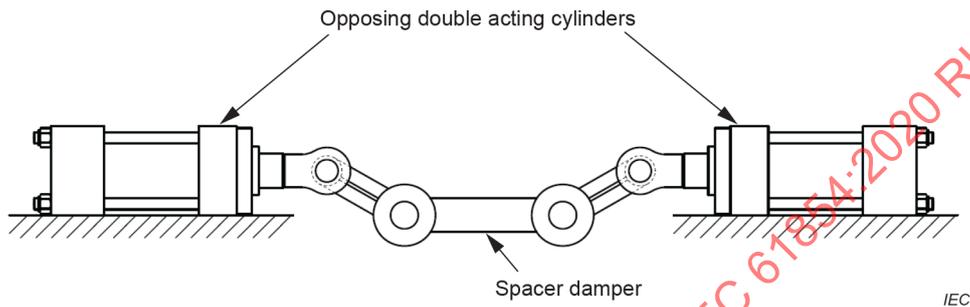


Figure 6a – Example of device for compression and tension test

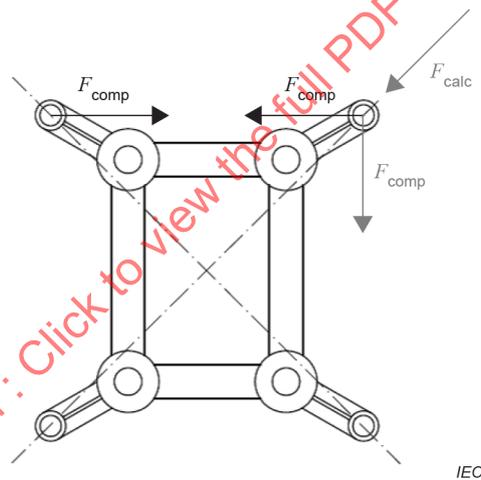


Figure 6b – Application of centripetal force component

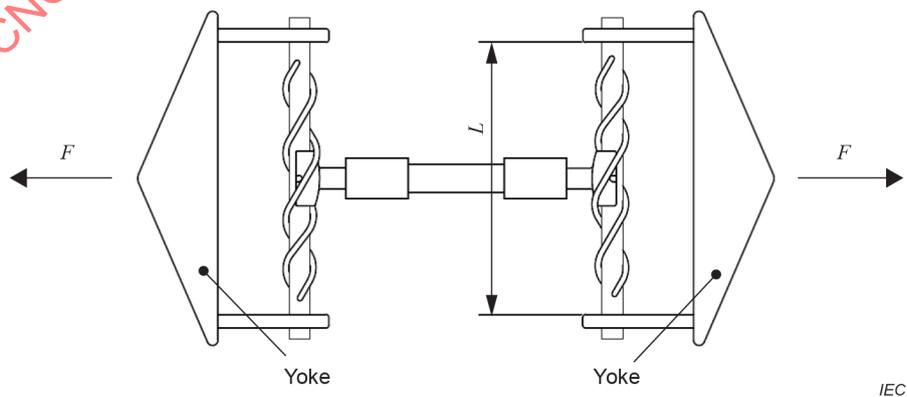


Figure 6c – Example of device for tension test of helical fixation clamps

Figure 6 – Test arrangements for compression and tension test

7.5.4 Characterisation of the elastic and damping properties

Tests to determine the elastic and damping properties of spacer dampers shall be performed in accordance with one or more of the following methods as specified or agreed by the purchaser.

NOTE 1 The stiffness and damping values do not provide direct confirmation of the performance of spacer dampers installed on conductor bundles, but they can be used in analytical models used to provide indication of performance, particularly with regard to aeolian vibration.

The stiffness and damping values determined in type tests can be used to establish acceptance criteria for sample tests as specified or agreed by the purchaser.

The elastic and damping characteristics determined in the following different tests are not equivalent.

a) Stiffness-damping method

The test shall be carried out at room temperature (20 ± 5 °C), the temperature shall be reported. The specimens shall be kept in room temperature prior the test for at least 3 h.

The frame of the spacer shall be fixed securely and a rigid tube or rod shall be securely held in one of the spacer clamps. The tube/rod shall be oscillated (see Annex C) such that the angle of deflection of the spacer arm from its unloaded position follows a sinusoid, i.e.

$$\varphi = \Phi \sin \omega t$$

where

φ is the angle of deflection;

Φ is the peak value of deflection selected for the measurement.

The peak force F required to oscillate the spacer arm through the angle measurement $\pm \Phi$ shall be determined (measured at approximately 90° to the arm axis in the plane of the spacer and passing through the centre of the clamp).

The phase angle, α , between the force and arm deflection angle shall also be determined.

If necessary the arm oscillation shall be maintained for a period long enough to stabilize the temperature of the damping element(s) before measuring F and α .

The angle α may be measured directly by comparing the force and arm angle wave forms. It may also be determined indirectly by measuring the area of the hysteresis loop formed by displaying the force and arm angle deflection in X-Y form. In this case α can be calculated as follows:

$$\alpha = \arcsin \frac{E}{F l \pi \Phi}$$

where

α is the phase angle between arm deflection and force (rad);

E is the area of the moment/angular deflection loop (J);

F is the peak force (N);

l is the arm length measured between clamp centre and effective frame/arm pivot point (m);
 Φ is the peak arm deflection (rad).

The test shall be carried out at a frequency between 1 Hz and 2 Hz with a peak-to-peak displacement equivalent to the diameter of the conductor for which the clamp is intended to be used.

NOTE 2 Tests at a variety of frequencies and/or displacements can be used to characterize spacer dampers for computer programs.

From the measurements of F and α , the torsional stiffness K_t and the damping constant H_t shall be calculated as follows:

$$K_t = \frac{F l \cos \alpha}{\Phi} \quad (\text{Nm/rad})$$

$$H_t = K_t \tan \alpha \quad (\text{Nm/rad})$$

1) High Temperature Conductor (HTC)

Use the same set-up parameters as for standard conductors.

One spacer damper clamp shall be installed on a length of High Temperature Conductor which will heat up to its maximum continuous operating temperature. This temperature shall be kept constant (± 5 °C) for 2 h.

Shortly before the end of the heating cycle the temperature of the damping elements shall be measured and recorded.

The stiffness damping method shall be performed with the elastomer damping element kept at the previously measured temperature (± 10 °C).

- Acceptance criteria

- The torsional stiffness K_t shall not differ by more than ± 20 % from the values declared by the supplier for the ambient temperature and for the maximum operating temperature respectively.
- The ratio H_t/K_t shall not be lower than 20 % of the values declared by the supplier for the ambient temperature and for the maximum operating temperature respectively.

b) Stiffness method

The test shall be carried out at room temperature (20 ± 5 °C), the temperature shall be reported. The specimens shall be kept in room temperature prior the test for at least 3 h.

- the spacer shall be held (preferably in its working orientation) by two adjacent clamps installed on horizontal rods which are free to rotate;
- one rod shall be held in position and a force shall be applied to the other rod just sufficient to move the clamp arms to their stops in tension, i.e. the spacing shall have been increased from X_{nom} to X_{max} which shall be recorded;
- the above shall be repeated for the arms in compression for X_{min} to be recorded;
- spacings X_t and X_c shall then be determined, where

$$X_t = X_{nom} + 0,9(X_{max} - X_{nom})$$

$$X_c = X_{nom} - 0,9(X_{nom} - X_{min})$$

- The spacer arms shall then be moved in the following cycle:
 - starting at X_{nom} the spacing shall be increased to X_t at a uniform rate between 50 mm/min and 100 mm/min;
 - the spacing shall be held at X_t and after 60 s the force F_t required to hold this spacing shall be recorded;
 - the spacing shall then be decreased at a uniform rate between 20 mm/min and 50 mm/min until the spacing is again equal to X_{nom} ;
 - after holding the spacing at X_{nom} between 0 s and 20 s, the spacing shall be decreased to X_c at a uniform rate between 50 mm/min and 100 mm/min;
 - the spacing shall be held at X_c and after 60 s the force F_c required to hold this spacing shall be recorded;
 - the stiffness shall then be determined as $\frac{F_t + F_c}{X_t - X_c}$.

To illustrate the above, assume that the test is carried out on a 400 mm twin spacer which has stops at spacings of 420 mm and 370 mm. It will then be necessary to record the tensile force F_t (N) required to maintain a spacing of 418 mm and the compression force F_c (N) required to maintain a spacing of 373 mm. The stiffness will then be $(F_t + F_c)/45$ (N/mm).

1) High Temperature Conductor (HTC)

Use the same set-up parameters as for standard conductors.

One spacer damper clamp shall be installed on a length of High Temperature Conductor which will heat up to its maximum continuous operating temperature. This temperature shall be kept constant (± 5 °C) for 2 h.

Shortly before the end of the heating cycle the temperature of the damping elements shall be measured and recorded.

The stiffness method shall be performed with the elastomer damping element kept at the previously measured temperature (± 10 °C)

- Acceptance criteria

The stiffness shall not differ by more than ± 20 % from the values declared by the supplier for the ambient temperature and for the maximum operating temperature respectively.


c) Damping method

The test shall be carried out at room temperature (20 ± 5 °C), the temperature shall be reported. The specimens shall be kept in room temperature prior the test for at least 3 h.

The damping characteristic shall be determined as follows.

The body of the spacer shall be fixed rigidly, and a mass shall be added to one arm such that the natural frequency of oscillation is between 1 Hz and 2 Hz. The arm shall then be moved to one of the end stops and, after 1 min, suddenly released. The movement of the arm shall be recorded for at least two complete cycles. If the initial swing (from starting position to maximum deflection in the opposite direction) is Y_1 (see Figure 7) and subsequent swings (peak to peak) are Y_2, Y_3, Y_4 , the log decrement shall be taken to be equal to

$$\ln \left[\frac{1}{2} \left(\frac{Y_1}{Y_3} + \frac{Y_2}{Y_4} \right) \right]$$

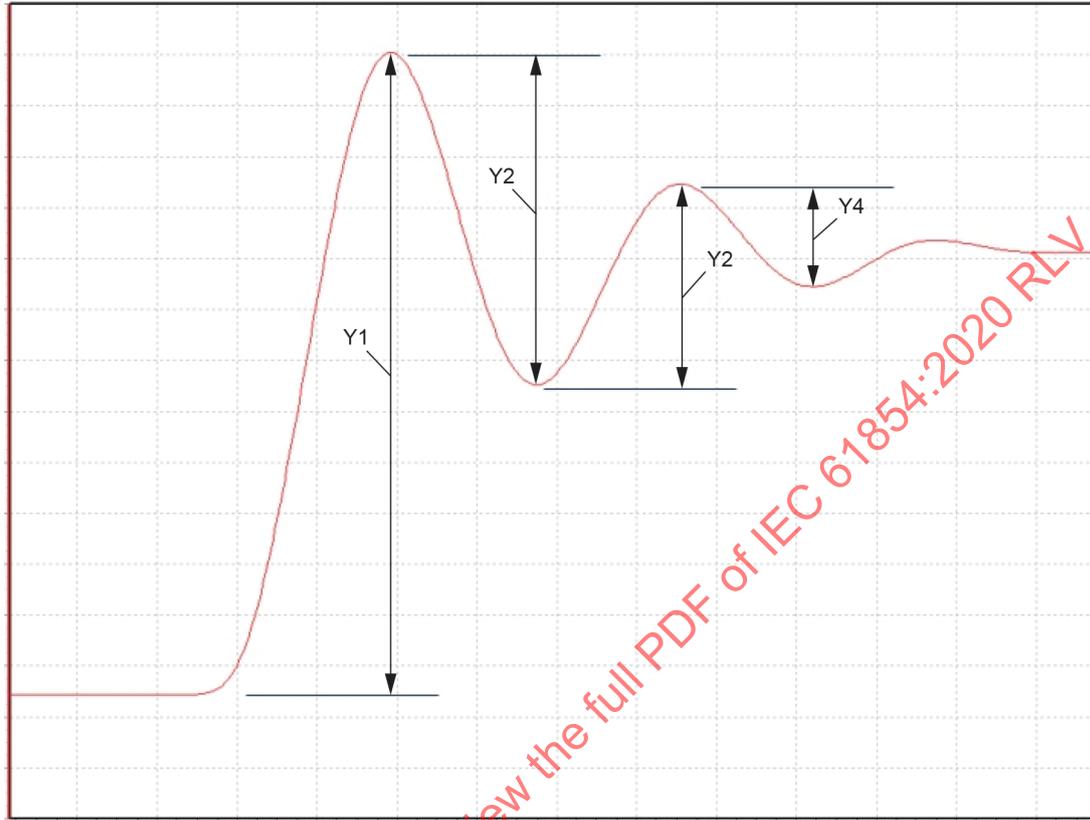

IEC

Figure 7. – Typical logarithmic decrement graph

This definition is different to the conventional one $\frac{1}{n} \ln \frac{A_0}{A_n}$ but is less sensitive to measurement error and does not require the zero deflection position to be determined.

The length and mass of the pendulum shall be recorded.

1) High Temperature Conductor (HTC)

Use the same set-up parameters as for standard conductors.

One spacer damper clamp shall be installed on a length of High Temperature Conductor which will heat up to its max continuous operating temperature. This temperature shall be kept constant (± 5 °C) for 2 h.

Shortly before the end of the heating cycle the temperature of the damping elements shall be measured and recorded.

The damping method shall be performed with the elastomer damping element kept at the previously measured temperature (± 10 °C)

- Acceptance criteria

The log decrement shall not differ by more than ± 20 % from the values declared by the supplier for the ambient temperature and for the maximum operating temperature respectively.

Characterization of the elastomer damping elements of spacer dampers designed for HTC (Type test only)

The characteristic of the elastomer damping element shall be verified with one of the 3 mentioned methods, heating the elastomer up to the maximum working temperature (± 5 °C) which it is designed for.

The complete spacer has to be heated in an appropriate test device (i.e. oven, climate chamber) for at least 2 h.

The temperature shall be taken at the spacer arm, close to the elastomer element.

The test shall be repeated at a temperature corresponding to 75 % and 50 % of the maximum working temperature of the damping element.

7.5.5 Flexibility tests

The purpose of these tests is to ensure and prove that the spacer damper or flexible spacer will accommodate any expected relative movement or displacement of the subconductors, during the normal working life of the line, without damage to conductors or the spacer.

The spacer shall be installed on a length of an appropriate bundle tensioned at 20 % of its rated tensile strength, tightening the clamp bolts to the specified installation torque. As an alternative, the spacer may be installed on rods or tubes of the correct size.

The following displacements shall be applied gradually:

- a) longitudinal displacement (see Figure 8): horizontal, longitudinal, parallel movement of one subconductor relative to the other(s) as measured by the deflection of the vertical long axis of the spacer from its position normal to the conductor;
- b) vertical displacement (see Figure 9): vertical movement of one subconductor relative to the other(s) as measured by the vertical deflection of the horizontal axis of the spacer from its position normal to the conductor;
- c) conical displacement (see Figure 10): conical or angular movement of the spacer clamp on one sub-conductor as measured conically about the subconductor axis;
- d) transversal displacement (see Figure 11): relative movement of two spacer clamps horizontally aligned perpendicular to the subconductor axes, as measured by the increase and decrease of conductor separation.

The values of the displacements to be used for the tests shall be in accordance with supplier's specified values on drawing, but should be at least:

- Longitudinal displacement: 25 mm (p-p)
- Vertical displacement: 50 mm (p-p)
- Conical displacement: 10° (cone vertex angle)
- Transversal displacement: 25 mm (p-p)

- Acceptance criteria

The above movements or displacements shall be executed without slip or damage to the subconductors (if used) and spacer, as detected by visual examination after removal of the spacer.

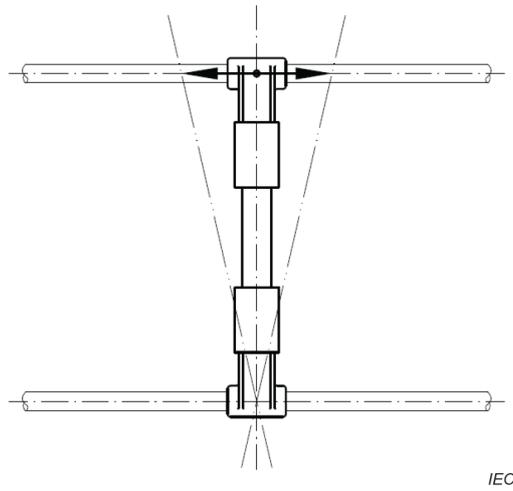


Figure 8 – Sketch of longitudinal displacement test

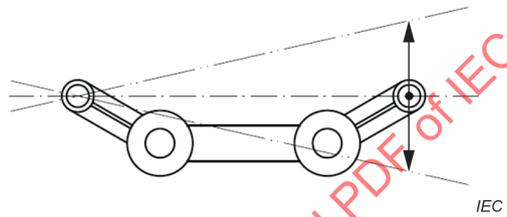


Figure 9 – Sketch of vertical displacement test

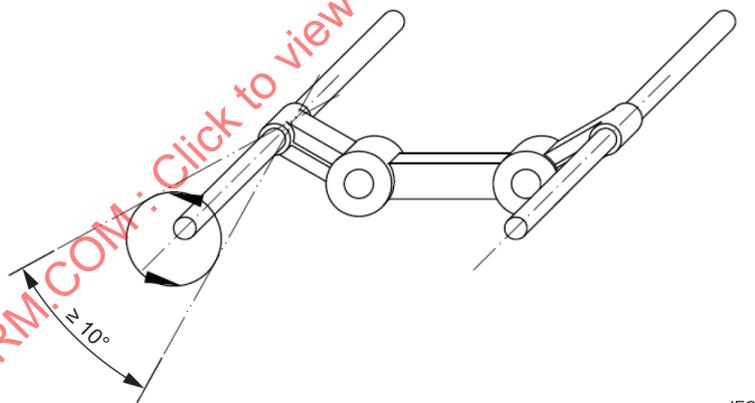


Figure 10 – Sketch of conical displacement test

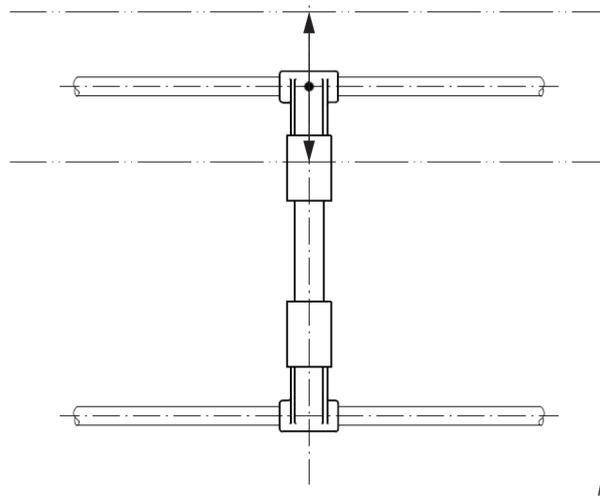


Figure 11 – Sketch of transverse horizontal displacement test

7.5.6 Fatigue tests

7.5.6.1 General

Tests shall be performed to verify the fatigue behaviour of spacers subjected to alternating motions or simulating vibrations (aeolian vibration and subspan oscillation) occurring in service.

Unless otherwise agreed between purchaser and supplier, two spacers shall be tested: one for subspan oscillation and one for aeolian vibration.

In the following test additional requirements may be agreed between purchaser and supplier to match very severe service conditions.

7.5.6.2 Subspan oscillation

The spacer shall be installed in a test rig designed to subject the spacer to oscillatory compressive/tensile forces directed between two horizontally opposite clamps (see Figure 12a).

The central frame of the spacer shall be unrestrained.

Alternatively, the frame of the spacer shall be held in a fixed position and oscillatory forces shall be applied to one clamp, approximately 90° to the arm axis (see Figure 12b).

Each clamp under test shall be installed in the middle of a length of the conductor for which the clamp is intended or alternatively on rigid tubes or rods of the same diameter. The clamp fasteners, if threaded, shall be tightened to the specified installation torque.

In case of breakaway bolts or breakaway caps the breakaway portion shall be removed and the torque has to be applied to the lower head with a calibrated torque wrench.

The installation torque shall be the nominal break away torque minus the tolerance as specified by the supplier.

The above tube(s) or rod(s) shall be connected to the drive mechanism.

Clamps with rod attachment shall be installed on a rigid tube or rod having the same diameter as the conductor for which the clamp is intended to be used.

The test shall be performed in one of the following two ways:

- either with a displacement resulting from the application of a sinusoidal initial force having a peak-to-peak value of 600 N. The displacement shall be determined at the beginning of the test and shall be kept constant during the duration of the test.
- or with a clamp displacement or an arm rotation equal to 90 % of the maximum allowed by the spacer construction.

The test shall be carried out at a frequency between 1 Hz and 2 Hz for 10 million (10^7) cycles.

- Acceptance criteria

At the end of the test, the phase angle α (as determined in 7.5.4 a) and the force required to maintain the horizontal displacement shall not be less than 70 % of their initial value. There shall be no deterioration in the metal components of the spacer, and the residual tightening torque of the clamp fastener (if threaded) shall not be less than 50 % of the original value (i.e. half the specified installation torque).

The residual tightening torque (RTT) is measured by means of a torque wrench which is applied to the bolt and operated in the tightening sense. The RTT value is read on the torque wrench when the bolt begins to move.

After the test, the spacer shall be dismantled and the damping elements shall be visually investigated. There shall be no cracks visible.

In case of helical fixation there should be no abrasion of the clamp or the rods and no looseness between the clamp body and the rods.

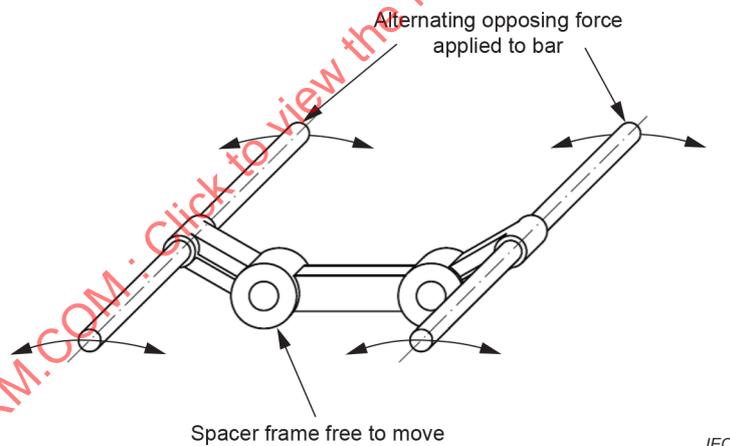


Figure 12a – Spacer frame free to move

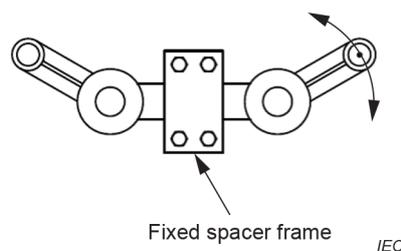


Figure 12b – Spacer frame fixed

Figure 12 – Test arrangements for subspan oscillation tests

7.5.6.3 Aeolian vibration

The frame of the spacer shall be fixed in a position as in service and a spacer clamp shall be connected by a hinge to the drive mechanism of a shaker (see Figure 13a). The clamp fasteners (if threaded) shall be tightened to the specified installation torque.

In case of breakaway bolts or breakaway caps these items shall be removed and the bolt shall be tightened with a calibrated torque wrench. The installation torque shall be the nominal break away torque minus the tolerance range, as specified by the supplier.

Clamps for helical fixation shall be fixed by the use of the helical rods over a tube or rod, having the same diameter of the conductor for which the spacer is designed; if possible, the length of the rods can be shortened. The distance between the two attachment points beside the spacer clamp (see Figure 13b) should be at least 500 mm.

The tube or rod shall be connected to the driving mechanism of a shaker. A frequency range of 20 Hz to 40 Hz shall be covered. Any automatic sweep rate not exceeding 0,2 decade/min in the case of logarithmic sweep, and 0,5 Hz/s in the case of linear sweep, can be used. The shaker velocity shall be held constant at 0,1 m/s (0-p). The spacer shall be vibrated for 100 million (10^8) cycles.

- Acceptance criteria

At the end of the test the shaker force required to maintain the shaker velocity of 0,1 m/s (0-p) at 20 and 40 Hz, shall be not less than 70 % of the initial value, there shall be no deterioration in the metal component of the spacer, and the residual tightening torque of the clamp fastener (if threaded) shall be not less than 50 % of the original value (i.e. half the specified installation torque).

At the end the spacer shall be dismantled and the damping elements shall be visually investigated. There shall be no cracks visible.

In case of helical fixation there should be no abrasion of the clamp or the rods and the integral strength of the connection system shall be ensured.

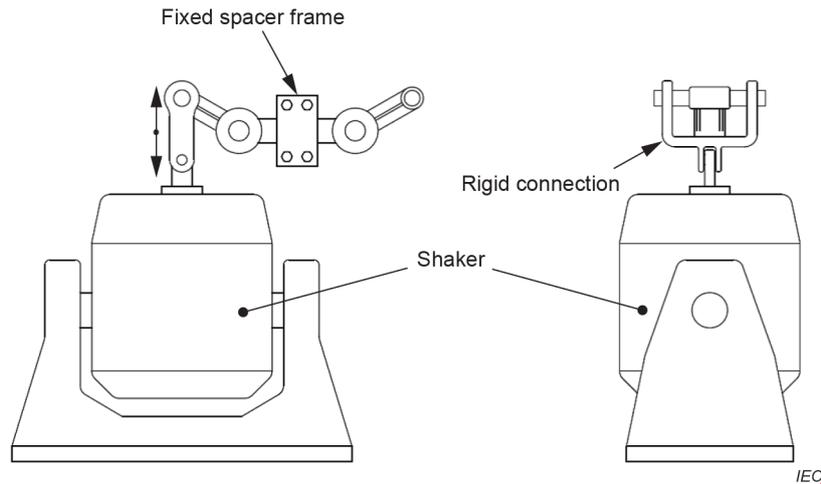


Figure 13a – Spacer clamp with fastener

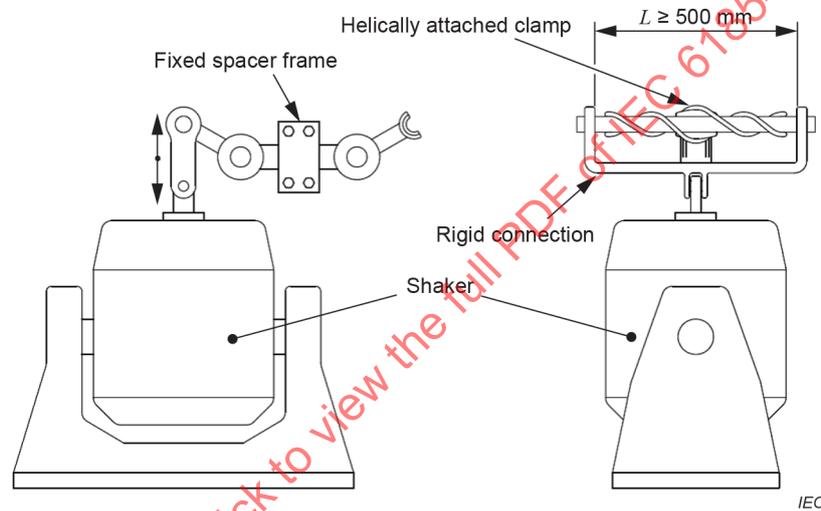


Figure 13b – Spacer clamp with helical fixation

Figure 13 – Test arrangement for aeolian vibration test

7.6 Tests to characterise elastomers

7.6.1 General

These tests shall be performed on samples taken from elastomeric components or test slabs and buttons as appropriate. These test data, along with supplier's guaranteed values, shall form the basis for acceptance of sample tests during production.

7.6.2 Tests

The tests reported in Table 2 shall be performed. The test values shall fall within the values guaranteed by the supplier.

7.6.3 Ozone resistance test

- Scope

The purpose of this test is to verify the resistance of the elastomer to the attack of ozone, universally present in the atmosphere and generated by the electrical discharges around high-voltage cables (corona).

- Test procedures

There are several test procedures covered by international standards. The test method to be used shall be agreed between purchaser and supplier. The recommended method is described in ISO 1431-1, procedure A, and the following parameters are recommended.

Ozone chamber temperature	(40 ± 2) °C
Ozone concentration	(50 ± 5) pp hm (parts per hundred million of air by volume)
Exposure time	72 h

As far as specimens are concerned, ISO 1431-1 (procedure A) prescribes thin rectangular test strips clamped at an elongation of 20 %. Alternatively, the test may be performed on finished elastomer components. The elastomer components shall be tested in their metal housing and at least one of them shall be subjected to the maximum tensile deformation allowed by the spacer design. In both cases, the elastomer under test shall be conditioned for 48 h in the dark at room temperature before being placed in the ozone chamber.

- Acceptance criteria

Ozone attack is usually evidenced by the formation of a few deep cracks or a myriad of small parallel cracks. They occur at right angles to the direction of applied stress. No cracks shall be observed at ×7 magnification on the surface of the specimens elongated or deformed as above.

Table 2 – Tests on elastomers

Recommended tests	Required value	Test methods
Room temperature tests		
– Specific gravity and density	Supplier specified range	ISO 1183-1 – ISO 2781
– Vulcanization characteristics	Supplier specified range	ISO 6502-2
– Hardness shore A	Supplier specified range	ISO 868
– Tensile properties		ISO 37
Tensile strength	Supplier specified min. value	ISO 37
Ultimate elongation	Supplier specified min. value	ISO 37
Modulus at 100 % elongation	Supplier specified min. value	ISO 37
Modulus at 300 % elongation	Supplier specified min. value	ISO 37
– Compression set 70 h, 20 °C	Supplier specified max. value	ISO 815-1
– Rebound resilience at 20 °C	Supplier specified range	ISO 4662
– Ozone resistance	To meet 7.6.3	ISO 1431-1
– Abrasion resistance	Supplier specified min. value	ISO 4649
– Tear resistance	Supplier specified max. value	ISO 34-1/34-2
– Electrical resistance	Supplier specified range	As per 7.7.2

Recommended tests	Required value	Test methods
High temperature tests		
– Compression set, 70 h, 100 °C	Supplier specified max. value	ISO 815-1
– Rebound resilience at 100 °C	Supplier specified range	ISO 4662
– Water immersion		ISO 1817
Volume change	Supplier specified max. value	ISO 1817
Weight change	Supplier specified max. value	ISO 1817
– Oil* conditioning 72 h, 70 °C		ISO 1817
Volume change	Supplier specified range	ISO 1817
Weight change	Supplier specified range	ISO 1817
Hardness change	Supplier specified range	ISO 1817
Tensile strength change	Supplier specified range	ISO 1817
Ultimate elongation change	Supplier specified range	ISO 1817
– Air-oven ageing, 72 h, 70 °C		ISO 188
Volume change	Supplier specified max. value	ISO 188
Weight change	Supplier specified max. value	ISO 188
Hardness change	Supplier specified max. value	ISO 188
Tensile strength change	Supplier specified max. value	ISO 188
Ultimate elongation change	Supplier specified max. value	ISO 188
Low temperature tests		
– Brittleness	Supplier specified min. value	ISO 812
– Compression set, 70 h, at minimum user service temperature	Supplier specified max. value	ISO 815-2
– Rebound resilience at minimum user service temperature	Supplier specified range	ISO 4662
– TR10 Modulus temperature	Supplier specified range	ISO 2921
* The test oil shall be specified by the purchaser.		

7.7 Electrical tests

7.7.1 Corona and radio interference voltage (RIV) tests

The tests shall be carried out according to Clause 14 of IEC 61284:1997.

7.7.2 Electrical resistance test

The purpose of the test is to verify that the conductivity of the various components is such that potential differences and current flows do not result in deterioration of spacer components or conductors.

In case of rubber lined clamp all individual clamps shall be installed according to supplier's instruction on an appropriate length of conductor.

Metal to metal clamps (including helically fixed types without liners) do not need to be fixed on a conductor.

For spacers having elastomeric elements with high electrical resistance, (> 1000 Ω) the electrical resistance of the elastomeric elements between each spacer arm and the spacer frame shall be determined by the application of 100 Vrms (±10 %) at 50 Hz/60 Hz AC and the resistance determined from Vrms/Irms.

For spacers with elastomeric clamp liners the resistance between the conductor and the spacer arm shall also be determined by the same method. The elastomeric element and clamp liners shall be free from moisture or any liquid used during the assembly when testing is performed.

For spacers having an elastomeric element with low electrical resistance, ($<1\ 000\ \Omega$), the electrical resistance of the spacer between each spacer arm and the spacer frame shall be determined by the application of a suitable voltage depending on the design of the spacer and agreed between purchaser and supplier.

The test shall be carried out at room temperature ($20 \pm 5\ ^\circ\text{C}$); the temperature shall be reported. The specimens shall be kept at room temperature prior the test for at least 3 h.

The arms should not be moved during conditioning and testing to avoid any stress on to the damping elements.

When conductive current paths are used and, due to special design considerations, conductive current paths do not exist between all pairs of subconductors, the resistance shall be measured between the two most remote spacer components which are supposed to be connected via a conductive path.

The test parameter and the test results shall be recorded.

- Acceptance criteria:

The resistance between the spacer arm and the central frame and between the conductor and the spacer arm in case of rubber lined clamps shall be within the range agreed between purchaser and supplier.

a) High Temperature Conductor (HTC)

Use the same set-up parameters as for standard conductors.

The electrical resistance test shall be performed with the elastomer damping element kept at the previously (7.5.4) measured temperature ($\pm 10\ ^\circ\text{C}$).

- Acceptance criteria:

The resistance between the spacer arm and the central frame and between the conductor and the spacer arm shall be within the range agreed between the purchaser and the supplier.

7.8 Verification of vibration behaviour of the bundle/spacer system

Criteria and tests to verify the vibration behaviour of the bundle/spacer system can be agreed between purchaser and supplier following the suggestions reported in Annex D.

Annex A
(normative)

Minimum technical details to be agreed between purchaser and supplier

Reference subclause	Test option	Details to be agreed
6.2.3 Sampling and acceptance criteria	Inspection by variables	Inspection level, AQL, sampling instruction
	Inspection by attributes	Inspection level, AQL, sampling instruction
7.5.3 Simulated short-circuit test	Simulated short circuit current	Compressive force
	Compression and tension	Compressive and tensile force
7.5.4 Characterisation of the elastic and damping properties	Stiffness-damping-method	
	Stiffness method	
	Damping method	
7.7.1 Corona and radio interference voltage (RIV) tests	Voltage method	Specified corona extinction voltage
	Voltage gradient method	Specified corona extinction test voltage gradient
7.7.2 Electrical resistance test		Range of the electrical resistance

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

Annex B (informative)

Compressive forces in the simulated short-circuit current test

To calculate the value of the compressive force, the following formula [4] may be applied, unless a different value is agreed between purchaser and supplier:

$$F_{\max} = K I_{\text{cc}} \sqrt{T \lg \frac{S}{D}}$$

where

- F_{\max} is the maximum compressive force (N);
 I_{cc} is the specified short-circuit current in the bundle (I_{rms} value) (kA);
 T is the subconductor tensile load (N);
 S is the bundle diameter (diameter of the circumscribing circle) (m);
 D is the subconductor diameter (m);
 K is the factor depending on the number of subconductors in the bundle [$N^{0,5} \text{ A}^{-1}$]:

Number of subconductors	K factor
2	1,585
3	1,450
4	1,260
6	1,014

Example 1

Bundle type:	quad
Spacing:	$450 \times 10^{-3} \text{ m}$
Bundle diameter S :	$636 \times 10^{-3} \text{ m}$
Subconductor type:	ACSR Curlew
Overall diameter D :	$31,68 \times 10^{-3} \text{ m}$
Tensile load T :	32 000 N
Short-circuit current I_{cc} :	50 kA

$$F_{\max} = 1,26 \times 50 \sqrt{32000 \times \lg \frac{636}{31,68}} = 12863 \text{ N}$$

Example 2

Bundle type:	twin
Spacing:	$400 \times 10^{-3} \text{ m}$
Bundle diameter S :	$400 \times 10^{-3} \text{ m}$
Subconductor type:	AAAC Flint
Overall diameter D :	$25,16 \times 10^{-3} \text{ m}$
Tensile load T :	21 700 N
Short-circuit current I_{cc} :	20 kA

$$F_{\max} = 1,585 \times 20 \sqrt{21700 \times \lg \frac{400}{25,16}} = 5188 \text{ N}$$

Annex C
(informative)

Characterisation of the elastic and damping properties
Stiffness-Damping Method

With reference to Figure C.1, by assuming $\frac{H_t}{\omega}$ as the equivalent viscous damping of the hinge and the force f always perpendicular to the arm, the rotation of the spacer arm around the centre of the hinge is described by the formula:

$$J \varphi'' + \frac{H_t}{\omega} \varphi' + K_t \varphi = f l \tag{C.1}$$

where

- J is the moment of the inertia of the arm in respect of the centre of rotation;
- $\varphi, \varphi', \varphi''$ are respectively the instantaneous values of the angle of rotation of the arm and the associated first and second derivative;
- ω is the circular frequency;
- H_t is the damping constant;
- K_t is the torsional stiffness;
- f is the instantaneous value of the applied force;
- l is the arm length.

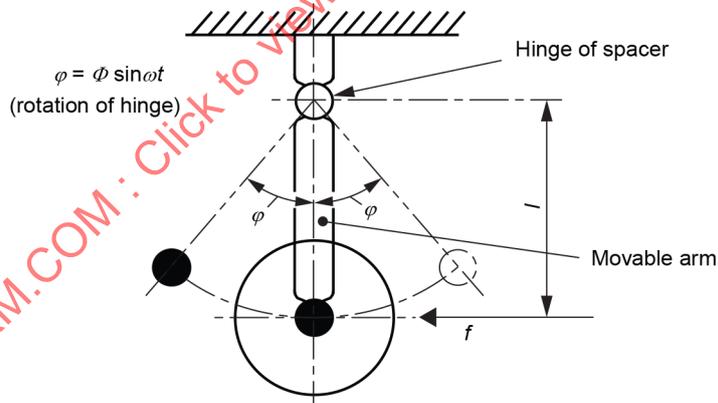


Figure C.1 – Rotation of spacer arm around the centre of the hinge

By assuming a sinusoidal force

$$f = F e^{j\omega t} \quad (F = \text{peak value, complex representation})$$

the angle of rotation will be sinusoidal

$$\phi = \Phi e^{j\omega t} e^{-j\alpha} \quad (\Phi = \text{peak value})$$

and will satisfy formula (C.1).

$$-\omega^2 J \Phi e^{j\omega t} e^{-j\alpha} + H_t j \Phi e^{j\omega t} e^{-j\alpha} + K_t \Phi e^{j\omega t} e^{-j\alpha} = F l e^{j\omega t} \quad (\text{C.2})$$

The relevant vector representation is illustrated in Figure C.2.

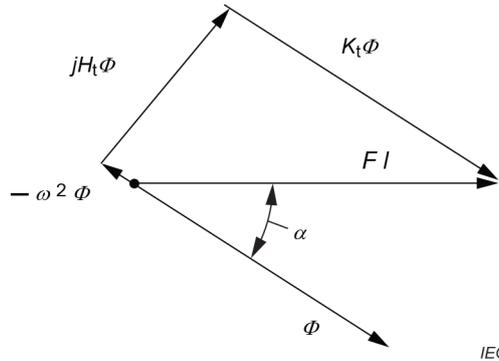


Figure C.2 – Vector representation of formula C.2

For very low frequency ν ($\omega = 2 \pi \nu$) and for a typical spacer damper, it is possible to neglect $\omega^2 \cdot J \cdot \Phi$ with respect to $K_t \cdot \Phi$, therefore:

$$\tan \alpha = \frac{H_t}{K_t}$$

$$\text{and, } K_t = \frac{F l \cos \alpha}{\Phi}$$

The energy dissipated by the hinge in one period is equal to:

$$E = \int f l d\varphi = \int f l \frac{d\varphi}{dt} dt$$

where

$$f = F \sin \omega t$$

$$\varphi = \Phi \sin(\omega t - \alpha)$$

$$E = F l \Phi \omega \int_0^{2\pi} \sin \omega t \cos(\omega t - \alpha) dt = \pi F l \Phi \sin \alpha$$

Annex D (informative)

Verification of vibration behaviour of the bundle/spacer system

D.1 General

Bundled conductors of overhead lines are subject to aeolian vibration and subconductor oscillation which, under severe conditions, may lead to fatigue failure of conductor strands or fittings. Spacer dampers are frequently used to reduce the amplitudes of these wind-induced vibrations and hence avoid the associated fatigue problems.

NOTE Sometimes the damping system for bundle conductors comprises either flexible spacers or spacer dampers together with vibration dampers.

The performance of a given spacer system in respect of vibratory behaviour is strictly correlated to the characteristics of the bundle (type of conductors, spacing, tensile load, etc.); as a consequence, the bundle plus spacer system shall be considered as a "whole" in evaluating the vibratory behaviour.

The performance verification of the bundle/spacer system, if agreed between purchaser and supplier, should consider aeolian vibration since this is the most common vibration phenomenon. Performance verification for subspan oscillation may also be agreed.

The performance verification should be made in one of the following two ways:

- analytically, determining the vibratory behaviour through the use of specific computer programs based on mathematical models of the system. The analytical performance verification should be carried out by the supplier;
- experimentally, carrying out field tests on overhead lines or experimental spans exposed to natural wind.

If agreed between purchaser and supplier, test evidence regarding previous experimental verification of the proposed damping systems can be accepted to evaluate the performance without any other additional field tests.

D.2 Aeolian vibration

The analytical verifications of aeolian vibration behaviour should be carried out for at least two spans of different length.

The purchaser should provide the following additional information, where available:

- the length of the two spans;
- the characteristics of the conductor (type, stranding, mass per length, RTS);
- the tensile load of the conductors (to be based on the yearly distribution of the minimum daily temperature);
- the conductor self-damping, or alternatively a section of conductor to be used by the supplier for evaluating, experimentally, the conductor self-damping; experimental data available for similar conductors can also be used for determining theoretically the self-damping coefficient;
- the type of suspension clamp (conventional, AGS, etc);
- the characteristics of armor rods, if applied;
- the characteristics of devices, other than damping elements, attached to the conductor and their in-span distribution;

- the conditions of the terrain surrounding the line (flat, hilly, woody, etc.);
- the yearly distribution of the average wind velocity (10 min mean) at the site relevant to the overhead line.

The experimental verification of aeolian vibration behaviour should be carried out for at least two spans of different length. The purchaser and supplier shall agree upon the period of time for the field tests, the measurements to be made (bending amplitude or strain at the suspension clamp, at the spacer-clamps, wind speed and direction, turbulence, etc.), the instrumentation and transducers to be used and the procedures for processing and presenting the experimental data.

The specified period of time for the field tests should be extended if during the same period the frequency of occurrence of wind perpendicular to the test spans with speeds in the range 0,5 m/s to 10 m/s, is deemed to be insufficient.

- Suggested acceptance criteria

The acceptance criteria should take into consideration the strains on the conductor at the suspension clamps, at the spacer-clamps and at the damper clamps, if dampers are used.

The acceptance criteria should be agreed between purchaser and supplier making reference to IEEE WPM 31 TP 65-156 [1], CIGRE SC22-WG04 [2], CIGRE SC22 WG11-TF2 [3] and IEEE Std 1368 [5] or to other equivalent publications.

D.3 Subspan oscillation

The analytical verification of subspan oscillation behaviour should be carried out for at least two spans of different length.

The purchaser should provide:

- the length of the two spans;
- the tensile load of the conductors;
- the characteristics of the conductor (type, stranding, mass per length, RTS);
- the conditions of the terrain surrounding the line (flat, hilly, woody, etc);
- the characteristics of devices, other than damping elements, attached to the conductor and their in-span distribution;
- the yearly distribution of the average wind velocity (10 min mean) at the site relevant to the overhead line, if available.

The experimental verification of subspan oscillation behaviour should be carried out for at least two adjacent spans of different length. The purchaser and supplier should agree upon the period of time for the field tests, the measurements to be made (amplitude of oscillation at mid-subspan and/or at a quarter-subspan, bending amplitude or strain at the spacer clamps, direction, speed and turbulence of the wind, etc.), the instrumentation and transducers to be used, and the procedures for processing and presenting the experimental data.

- Suggested acceptance criteria

The acceptance criteria should take into consideration the amplitude of oscillation at mid-subspan and at a quarter-subspan.

Propagation to adjacent subspans the subspan oscillations, strains at the spacer clamps or at the suspension clamps can also be considered.

The acceptance criteria should be agreed between purchaser and supplier.

Annex E (informative)

Description of HT conductors as given in CIGRE TB 695-2017 [7]

Type 0

Conductors designed for a maximum continuous operating temperature of 95 °C.

Type 1

Conductors consisting of a strength member made of steel, coated steel, or steel alloy, and an envelope for which the high temperature effects are mitigated by means of thermal-resistant aluminium alloys.

Type 2

Conductors consisting of a strength member made of steel, coated steel, or steel alloy, and an envelope for which the high temperature effects are mitigated by means of annealed aluminium.

Type 3

Conductors consisting of a metal-matrix composite (MMC) strength member, and an envelope for which the high temperature effects are mitigated by means of thermal-resistant aluminium alloys.

Type 4

Conductors consisting of a polymer-matrix composite (PMC) strength member, and an envelope for which the high temperature effects are mitigated by means of annealed aluminium or thermal-resistant aluminium alloys for HTLS applications.

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 Full

Bibliography

- [1] IEEE Committee report, *Standardization of conductor vibration measurements*; IEEE WPM 1965; 31TP 65-156
- [2] CIGRE SC22 WG04, *Recommendations for the evaluation of the lifetime of transmission line conductors*; Electra 63, March 1979
- [3] CIGRE SC22 WG11-TF2, *Guide to vibration measurements on overhead lines* – Electra 163, Dec 1995
- [4] Manuzio C. An investigation on the forces on bundle conductor spacers under fault conditions – *IEEE T & D*, June-July 1965, Paper 31TP 65-707
- [5] IEEE Std 1368:2007, *IEEE Guide for Aeolian Vibration Field Measurements of Overhead Conductors*
- [6] CIGRE SCB2 WG11-TF05, *State of the art survey on spacers and spacer dampers* – Technical Brochure 277, August 2005
- [7] CIGRE SCB2 WG 48, *Experience with the mechanical performance of non-conventional conductors* – Technical Brochure 695, August 2017

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

SOMMAIRE

AVANT-PROPOS	50
1 Domaine d'application	52
2 Références normatives	52
3 Termes et définitions	54
4 Exigences générales	54
4.1 Conception	54
4.2 Matériaux.....	55
4.2.1 Généralités.....	55
4.2.2 Matériaux non métalliques	55
4.3 Masse, dimensions et tolérances	55
4.4 Protection contre la corrosion	55
4.5 Aspect et finition de fabrication	56
4.6 Marquage	56
4.7 Instructions d'installation.....	56
4.8 Eprouvettes	56
5 Assurance qualité	56
6 Classification des essais	56
6.1 Essais de type	56
6.1.1 Généralités.....	56
6.1.2 Application.....	56
6.2 Essais sur échantillon	57
6.2.1 Généralités.....	57
6.2.2 Application.....	57
6.2.3 Echantillonnage et critères de réception	57
6.3 Essais individuels de série.....	57
6.3.1 Généralités.....	57
6.3.2 Application et critères de réception	57
6.4 Tableau des essais à effectuer	58
7 Méthodes d'essai.....	60
7.1 Examen visuel	60
7.2 Vérification des dimensions, des matériaux et de la masse	60
7.3 Essai de protection contre la corrosion	60
7.3.1 Composants revêtus par galvanisation à chaud (autres que les fils en acier galvanisé câblés)	60
7.3.2 Produits ferreux protégés contre la corrosion par des méthodes autres que la galvanisation à chaud	61
7.3.3 Fils en acier galvanisé câblés	61
7.3.4 Corrosion causée par des composants non métalliques	61
7.4 Essais non destructifs	61
7.5 Essais mécaniques	62
7.5.1 Essais de glissement des pinces	62
7.5.2 Essais sur ensembles de boulons	67
7.5.3 Essais de courant de court-circuit simulé et essais de compression et de traction	69
7.5.4 Caractérisation des propriétés élastiques et d'amortissement	75
7.5.5 Essais de flexibilité	80

7.5.6	Essais de fatigue	82
7.6	Essais de caractérisation des élastomères.....	86
7.6.1	Généralités	86
7.6.2	Essais	86
7.6.3	Essai de résistance à l'ozone.....	86
7.7	Essais électriques.....	88
7.7.1	Essais d'effet couronne et de tension perturbatrice radioélectrique (RIV).....	88
7.7.2	Essai de résistance électrique	88
7.8	Vérification du comportement vibratoire du système faisceau/entretoise	89
Annexe A (normative) Informations techniques minimales à convenir entre l'acheteur et le fournisseur.....		90
Annexe B (informative) Forces de compression dans l'essai de courant de court-circuit simulé.....		91
Annexe C (informative) Caractérisation des propriétés élastiques et d'amortissement Méthode de détermination de la rigidité et de l'amortissement		92
Annexe D (informative) Vérification du comportement vibratoire du système faisceau/entretoise		94
D.1	Généralités	94
D.2	Vibrations éoliennes	94
D.3	Oscillation de sous-portée	95
Annexe E (informative) Description des conducteurs HT donnée dans la brochure technique CIGRE 695-2017 [7]		97
Bibliographie.....		98
Figure 1 – Montages d'essai pour les essais de glissement longitudinal.....		63
Figure 2 – Montage d'essai pour les essais de glissement en torsion.....		67
Figure 3 – Montage d'essai pour l'essai de force du ressort à température ambiante		68
Figure 4 – Montage d'essai pour l'essai de charge permanente sur rondelles coniques		69
Figure 5 – Montages d'essai pour les essais de courant de court-circuit simulé		73
Figure 6 – Montages d'essai pour l'essai de compression et de traction.....		75
Figure 7 – Courbe de décrémentation logarithmique type		79
Figure 8 – Exemple d'essai de déplacement longitudinal.....		81
Figure 9 – Exemple d'essai de déplacement vertical		81
Figure 10 – Exemple d'essai de déplacement conique		81
Figure 11 – Exemple d'essai de déplacement horizontal transversal		82
Figure 12 – Montages d'essai pour les essais d'oscillation de sous-portée.....		84
Figure 13 – Montage d'essai pour l'essai de vibrations éoliennes.....		85
Figure C.1 – Rotation du bras de l'entretoise autour du centre de l'articulation		92
Figure C.2 – Représentation vectorielle de la formule C.2.....		93
Tableau 1 – Essais sur les entretoises.....		59
Tableau 2 – Essais sur les élastomères		87

COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

LIGNES AÉRIENNES – EXIGENCES ET ESSAIS APPLICABLES AUX ENTRETOISES

AVANT-PROPOS

- 1) La Commission Electrotechnique Internationale (IEC) est une organisation mondiale de normalisation composée de l'ensemble des comités électrotechniques nationaux (Comités nationaux de l'IEC). L'IEC a pour objet de favoriser la coopération internationale pour toutes les questions de normalisation dans les domaines de l'électricité et de l'électronique. A cet effet, l'IEC – entre autres activités – publie des Normes internationales, des Spécifications techniques, des Rapports techniques, des Spécifications accessibles au public (PAS) et des Guides (ci-après dénommés "Publication(s) de l'IEC"). Leur élaboration est confiée à des comités d'études, aux travaux desquels tout Comité national intéressé par le sujet traité peut participer. Les organisations internationales, gouvernementales et non gouvernementales, en liaison avec l'IEC, participent également aux travaux. L'IEC collabore étroitement avec l'Organisation Internationale de Normalisation (ISO), selon des conditions fixées par accord entre les deux organisations.
- 2) Les décisions ou accords officiels de l'IEC concernant les questions techniques représentent, dans la mesure du possible, un accord international sur les sujets étudiés, étant donné que les Comités nationaux de l'IEC intéressés sont représentés dans chaque comité d'études.
- 3) Les Publications de l'IEC se présentent sous la forme de recommandations internationales et sont agréées comme telles par les Comités nationaux de l'IEC.
- 4) Dans le but d'encourager l'uniformité internationale, les Comités nationaux de l'IEC s'engagent, dans toute la mesure possible, à appliquer de façon transparente les Publications de l'IEC dans leurs publications nationales et régionales. Toutes divergences entre toutes Publications de l'IEC et toutes publications nationales ou régionales correspondantes doivent être indiquées en termes clairs dans ces dernières.
- 5) L'IEC elle-même ne fournit aucune attestation de conformité. Des organismes de certification indépendants fournissent des services d'évaluation de conformité et, dans certains secteurs, accèdent aux marques de conformité de l'IEC. L'IEC n'est responsable d'aucun des services effectués par les organismes de certification indépendants.
- 6) Tous les utilisateurs doivent s'assurer qu'ils sont en possession de la dernière édition de cette publication.
- 7) Aucune responsabilité ne doit être imputée à l'IEC, à ses administrateurs, employés, auxiliaires ou mandataires, y compris ses experts particuliers et les membres de ses comités d'études et des Comités nationaux de l'IEC, pour tout préjudice causé en cas de dommages corporels et matériels, ou de tout autre dommage de quelque nature que ce soit, directe ou indirecte, ou pour supporter les coûts (y compris les frais de justice) et les dépenses découlant de la publication ou de l'utilisation de cette Publication de l'IEC ou de toute autre Publication de l'IEC, ou au crédit qui lui est accordé.
- 8) L'attention est attirée sur les références normatives citées dans cette publication. L'utilisation de publications référencées est obligatoire pour une application correcte de la présente publication.
- 9) L'attention est attirée sur le fait que certains des éléments de la présente Publication de l'IEC peuvent faire l'objet de droits de brevet. L'IEC ne saurait être tenue pour responsable de ne pas avoir identifié de tels droits de brevets et de ne pas avoir signalé leur existence.

La Norme internationale IEC 61854 a été établie par le comité d'études 11 de l'IEC: Lignes aériennes.

Cette deuxième édition annule et remplace la première édition parue en 1998. Cette édition constitue une révision technique.

Cette édition inclut les modifications techniques majeures suivantes par rapport à l'édition précédente:

- a) prise en compte de l'application des entretoises sur des conducteurs haute température, avec la spécification d'essais à haute température supplémentaires dans le cadre des essais de glissement des pinces et la caractérisation des propriétés élastiques et d'amortissement;
- b) spécification la plus large possible des paramètres d'essai et des valeurs de réception associées;
- c) affranchissement, dans la mesure du possible, par rapport aux procédures alternatives pour le même essai;

- d) introduction d'un dispositif d'essai plus simple pour l'essai de courant de court-circuit simulé;
- e) introduction d'un essai à basse température sur les composants de fixation tels que les boulons fusibles et les rondelles élastiques coniques;
- f) prescription d'une procédure différente pour les essais d'oscillation de sous-portée sur les entretoises équipées de pinces avec garnitures;
- g) modification de la procédure d'essai pour les essais de vibrations éoliennes;
- h) prescription d'une procédure différente pour les essais de vibrations éoliennes sur les entretoises équipées de pinces avec garnitures;
- i) reprise de l'ensemble des figures afin de les rendre plus claires et homogènes;
- j) introduction d'un dispositif d'essai supplémentaire pour l'essai de courant de court-circuit simulé.

Le texte de cette norme est issu des documents suivants:

FDIS	Rapport de vote
11/265/FDIS	11/272/RVD

Le rapport de vote indiqué dans le tableau ci-dessus donne toute information sur le vote ayant abouti à l'approbation de cette norme.

Ce document a été rédigé selon les Directives ISO/IEC, Partie 2.

Le comité a décidé que le contenu de ce document ne sera pas modifié avant la date de stabilité indiquée sur le site web de l'IEC sous "<http://webstore.iec.ch>" dans les données relatives au document recherché. A cette date, le document sera

- reconduit,
- supprimé,
- remplacé par une édition révisée, ou
- amendé.

IMPORTANT – Le logo "colour inside" qui se trouve sur la page de couverture de cette publication indique qu'elle contient des couleurs qui sont considérées comme utiles à une bonne compréhension de son contenu. Les utilisateurs devraient, par conséquent, imprimer cette publication en utilisant une imprimante couleur.

LIGNES AÉRIENNES – EXIGENCES ET ESSAIS APPLICABLES AUX ENTRETOISES

1 Domaine d'application

Le présent document s'applique aux entretoises destinées aux faisceaux de conducteurs de lignes aériennes. Il couvre les entretoises rigides, les entretoises souples et les entretoises amortisseuses.

Il ne s'applique pas aux espaceurs, aux écarteurs à anneaux et aux entretoises de mise à la terre.

NOTE Le présent document a été élaboré pour couvrir les pratiques de conception de lignes, ainsi que les entretoises les plus couramment utilisées au moment de sa rédaction. Il peut exister d'autres entretoises pour lesquelles les essais spécifiques décrits dans le présent document peuvent ne pas s'appliquer.

Dans certains cas, les procédures d'essai et les valeurs d'essai sont convenues entre l'acheteur et le fournisseur et sont indiquées dans le contrat d'approvisionnement. L'acheteur est le mieux à même d'évaluer les conditions de service prévues, qu'il convient d'utiliser comme base pour la définition de la sévérité des essais.

L'Annexe A répertorie les informations techniques minimales à convenir entre l'acheteur et le fournisseur.

2 Références normatives

Les documents suivants cités dans le texte constituent, pour tout ou partie de leur contenu, des exigences du présent document. Pour les références datées, seule l'édition citée s'applique. Pour les références non datées, la dernière édition du document de référence s'applique (y compris les éventuels amendements).

IEC 60050(466):1990, *Vocabulaire Electrotechnique International (IEV) – Chapitre 466: Lignes électriques*

IEC 60888:1987, *Fils en acier zingué pour conducteurs câblés*

IEC 61284:1997, *Lignes aériennes – Exigences et essais pour le matériel d'équipement*

ISO 34-1:2015, *Caoutchouc vulcanisé ou thermoplastique – Détermination de la résistance au déchirement – Partie 1: Eprouvettes pantalon, angulaire et croissant*

ISO 34-2:2015, *Caoutchouc vulcanisé ou thermoplastique – Détermination de la résistance au déchirement – Partie 2: Petites éprouvettes (épreuves de Delft)*

ISO 37:2017, *Caoutchouc vulcanisé ou thermoplastique – Détermination des caractéristiques de contrainte-déformation en traction*

ISO 188:2011, *Caoutchouc vulcanisé ou thermoplastique – Essais de résistance au vieillissement accéléré et à la chaleur*

ISO 812:2017, *Caoutchouc vulcanisé ou thermoplastique – Détermination de la fragilité à basse température*

ISO 815-1:2014, *Caoutchouc vulcanisé ou thermoplastique – Détermination de la déformation rémanente après compression – Partie 1: A températures ambiantes ou élevées*

ISO 815-2:2014, *Caoutchouc vulcanisé ou thermoplastique – Détermination de la déformation rémanente après compression – Partie 2: A basses températures*

ISO 868:2003, *Plastiques et ébonite – Détermination de la dureté par pénétration au moyen d'un duromètre (dureté Shore)*

ISO 1183-1: 2019, *Plastics — Methods for determining the density of non-cellular plastics — Part 1: Immersion method, liquid pycnometer method and titration method* (disponible en anglais uniquement)

ISO 1183-1:2012, *Plastiques – Méthodes de détermination de la masse volumique des plastiques non alvéolaires*

ISO 1431-1:2012, *Caoutchouc vulcanisé ou thermoplastique – Résistance au craquelage par l'ozone – Partie 1: Essais sous allongement statique et dynamique*

ISO 1461:2009, *Revêtements par galvanisation à chaud sur produits finis en fonte et en acier – Spécifications et méthodes d'essai*

ISO 1817:2015, *Caoutchouc vulcanisé ou thermoplastique – Détermination de l'action des liquides*

ISO 2781:2018, *Caoutchouc vulcanisé ou thermoplastique – Détermination de la masse volumique*

ISO 2859-1:1999/AMD1: 2011, *Règles d'échantillonnage pour les contrôles par attributs – Partie 1: Procédures d'échantillonnage pour les contrôles lot par lot, indexés d'après le niveau de qualité acceptable (NQA)*

ISO 2859-2:1985, *Règles d'échantillonnage pour les contrôles par attributs – Partie 2: Plans d'échantillonnage pour les contrôles de lots isolés, indexés d'après la qualité limite (QL)*

ISO 2921:2011, *Caoutchouc vulcanisé – Détermination du retrait à basse température (essai TR)*

ISO 3951-1:2013, *Règles d'échantillonnage pour les contrôles par mesures – Partie 1: Spécification pour les plans d'échantillonnage simples indexés d'après une limite de qualité acceptable (LQA) pour un contrôle lot par lot pour une caractéristique qualité unique et une LQA unique*

ISO 3951-2:2013, *Règles d'échantillonnage pour les contrôles par mesures – Partie 2: Spécification générale pour les plans d'échantillonnage simples indexés d'après une limite de qualité acceptable (LQA) pour le contrôle lot par lot de caractéristiques qualité indépendantes*

ISO 4649:2017, *Caoutchouc vulcanisé ou thermoplastique – Détermination de la résistance à l'abrasion à l'aide d'un dispositif à tambour tournant*

ISO 4662:2017, *Caoutchouc vulcanisé ou thermoplastique – Détermination de la résilience de rebondissement*

ISO 6502-2:2018, *Caoutchouc – Mesure des caractéristiques de vulcanisation à l'aide de rhéomètres – Partie 2: Rhéomètre à disque oscillant*

ISO 9001:2015, *Systèmes de management de la qualité – Exigences*

3 Termes et définitions

Pour les besoins du présent document, les termes et définitions donnés dans l'IEC 60050-466 ainsi que les suivants s'appliquent.

L'ISO et l'IEC tiennent à jour des bases de données terminologiques destinées à être utilisées en normalisation, consultables aux adresses suivantes:

- IEC Electropedia: disponible à l'adresse <http://www.electropedia.org/>
- ISO Online browsing platform: disponible à l'adresse <http://www.iso.org/obp>

3.1

entretoise rigide

entretoise ne permettant aucun mouvement relatif des sous-conducteurs à l'emplacement de l'entretoise

3.2

entretoise souple

entretoise permettant des mouvements relatifs des sous-conducteurs à l'emplacement de l'entretoise

3.3

système d'entretoises

complexe d'entretoises et distribution correspondante dans la portée

3.4

conducteurs haute température

HTC

conducteurs conçus pour avoir une température maximale en service continu supérieure à 95 °C

Note 1 à l'article: HTCa: conducteurs utilisant des fils recuits; HTCna: conducteurs utilisant des fils non recuits.

Note 2 à l'article: L'abréviation "HTC" est dérivée du terme anglais développé correspondant "high temperature conductors".

3.5

température maximale en service continu

température du conducteur spécifiée par le fabricant et mesurée au niveau des couches de fils extérieures

4 Exigences générales

4.1 Conception

L'entretoise doit être conçue de manière à:

- maintenir l'espacement entre sous-conducteurs (à l'emplacement des entretoises) dans les limites prescrites, dans l'ensemble des conditions de service, à l'exclusion des courants de court-circuit;
- empêcher, dans les sous-portées entre entretoises, le contact physique entre sous-conducteurs, sauf lors du passage de courants de court-circuit où la possibilité d'un contact est acceptée sous réserve que l'espacement spécifié soit rétabli immédiatement après l'élimination du défaut;

- supporter les charges mécaniques exercées sur l'entretoise pendant l'installation, la maintenance et le service (y compris les conditions de court-circuit) sans provoquer une rupture des composants ni de déformation permanente inacceptable;
- éviter la détérioration du sous-conducteur dans les conditions de service spécifiées;
- ne présenter aucun niveau inacceptable d'effets couronne et de perturbations radioélectriques dans les conditions de service spécifiées;
- être adapté à une installation simple et sécurisée. En ce qui concerne les pinces boulonnées et à verrouillage, la conception de la pince doit maintenir l'ensemble des pièces en place lorsque la pince est ouverte pour fixation au conducteur;
- assurer que les différents composants ne se desserrent pas en service;
- pouvoir être déposée et réinstallée sur les sous-conducteurs sans endommagement de l'entretoise ni des sous-conducteurs;
- assurer sa fonction sur l'ensemble de la plage de températures de service;
- prévenir tout bruit audible.

La liste suivante répertorie d'autres caractéristiques souhaitables, qui ne sont pas indispensables aux fonctions élémentaires de l'entretoise, mais qui peuvent être intéressantes pour l'acheteur:

- vérification de l'installation correcte depuis le sol;
- facilité d'installation et de dépose sur les lignes sous tension.

Des informations précises sur la conception, les meilleures pratiques et l'expérience des entretoises et des entretoises amortisseuses sont fournies en [6]¹.

4.2 Matériaux

4.2.1 Généralités

Les entretoises doivent être réalisées dans des matériaux adaptés à leur usage. Sauf exigence contraire, le matériau doit être conforme aux exigences de l'IEC 61284.

4.2.2 Matériaux non métalliques

Outre les exigences de l'IEC 61284, la conductivité des différents composants non métalliques doit être telle que, lorsqu'ils sont correctement installés:

- les différences de potentiel entre composants métalliques n'entraînent pas de dommages dus aux décharges;
- le courant de ligne, y compris le courant de court-circuit ainsi que tout passage de courant à travers l'entretoise, ne dégrade pas les composants de l'entretoise.

4.3 Masse, dimensions et tolérances

La masse et les dimensions importantes de l'entretoise, y compris les tolérances appropriées, doivent apparaître sur les plans contractuels.

Il convient que les tolérances appliquées sur la masse et les dimensions permettent aux entretoises de satisfaire aux exigences mécaniques et électriques correspondantes spécifiées.

4.4 Protection contre la corrosion

Outre les exigences applicables de l'IEC 61284, les fils en acier câblés, le cas échéant, doivent être protégés contre la corrosion conformément à l'IEC 60888.

¹ Les chiffres entre crochets se réfèrent à la Bibliographie.

4.5 Aspect et finition de fabrication

Les entretoises ne doivent présenter aucun défaut ni irrégularité; toutes les surfaces extérieures doivent être lisses, et les arêtes et coins doivent être arrondis.

4.6 Marquage

Les exigences de l'IEC 61284 concernant le marquage des raccords doivent être appliquées à l'ensemble des pinces équipées, y compris celles qui utilisent des boulons fusibles.

Si nécessaire, la position correcte du haut de l'entretoise (par exemple, flèche pointant vers le haut) doit également être indiquée.

4.7 Instructions d'installation

Le fournisseur doit fournir une description claire et complète de la procédure d'installation et indiquer, si nécessaire, la répartition des entretoises dans la portée.

Le fournisseur doit mettre à disposition tout outil d'installation spécial nécessaire.

4.8 Epreuves

Tous les essais décrits dans le présent document sont effectués sur des pinces boulonnées et des pinces avec fixation en hélice. Si d'autres types de pinces sont soumis à l'essai, il convient d'installer les pinces conformément aux instructions d'installation du fournisseur.

5 Assurance qualité

Un programme d'assurance qualité prenant en compte les exigences du présent document peut être utilisé par accord entre l'acheteur et le fournisseur afin de vérifier la qualité des entretoises pendant le processus de fabrication.

Les informations précises concernant l'usage de l'assurance qualité sont fournies dans un système conforme à l'ISO 9001 ou à une norme analogue.

Il est recommandé d'assurer la maintenance et l'étalonnage des appareils d'essai et de mesure utilisés pour vérifier la conformité au présent document en se référant à une norme qualité pertinente.

6 Classification des essais

6.1 Essais de type

6.1.1 Généralités

L'objet des essais de type est d'établir les caractéristiques de conception. Ils sont en général effectués une fois et répétés uniquement en cas de changement de matériau ou de modification de la conception de l'entretoise. Les résultats des essais de type sont consignés afin de démontrer la conformité aux exigences de conception.

6.1.2 Application

Les entretoises doivent être soumises aux essais de type indiqués dans le Tableau 1. Chaque essai de type doit être effectué sur trois échantillons identiques, en ce qui concerne toutes les caractéristiques importantes, aux entretoises qui doivent être fournies à l'acheteur au titre du contrat. Toutes les unités doivent satisfaire aux essais.

Les entretoises utilisées lors d'essais, où aucune détérioration des unités ou de leurs composants n'a été constatée, peuvent être réutilisées pour les essais ultérieurs.

NOTE L'unité soumise aux essais de type peut être soit une entretoise complète soit un composant de l'entretoise, selon ce qui est approprié pour l'essai.

6.2 Essais sur échantillon

6.2.1 Généralités

Les essais sur échantillon sont exigés pour vérifier que les entretoises satisfont aux spécifications de performances des échantillons d'essai de type. En outre, ils ont pour objet de vérifier la qualité des matériaux et de l'exécution.

6.2.2 Application

Les entretoises doivent être soumises aux essais sur échantillon indiqués dans le Tableau 1. Les échantillons à soumettre aux essais doivent être choisis au hasard parmi le lot présenté pour réception. L'acheteur est habilité à procéder lui-même à ce choix.

Les entretoises utilisées lors d'essais, où aucune détérioration des unités ou de leurs composants n'a été constatée, peuvent être réutilisées pour les essais ultérieurs.

L'unité soumise aux essais sur échantillon peut être soit une entretoise complète soit un composant de l'entretoise, selon ce qui est approprié pour l'essai.

6.2.3 Echantillonnage et critères de réception

Les procédures du plan d'échantillonnage selon l'ISO 2859-1 et l'ISO 2859-2 (contrôles par attributs) et l'ISO 3951 (contrôles par variables) ainsi que les procédures précises (niveau de contrôle, NQA, échantillonnage simple, double ou multiple, etc.) doivent faire l'objet d'un accord entre l'acheteur et le fournisseur pour chacun des attributs ou variables.

Le contrôle d'échantillonnage par variables est une procédure d'échantillonnage de réception à utiliser en lieu et place du contrôle par attributs lorsqu'il est plus approprié de mesurer la ou les caractéristiques concernées sur une échelle continue. Dans le cas des essais de charge de rupture et autres essais coûteux analogues, l'échantillonnage de réception par variables permet de mieux distinguer la qualité acceptable de la qualité objective que l'échantillonnage de réception par attributs, pour la même taille d'échantillon.

L'objet du processus d'échantillonnage peut également être important pour le choix entre un plan par variables et par attributs. Par exemple, un client peut décider d'utiliser un plan d'échantillonnage de réception par attributs afin de vérifier que les pièces d'un lot d'expédition respectent les tolérances dimensionnelles exigées; le fabricant peut mesurer les mêmes dimensions selon un plan d'échantillonnage par variables s'il craint que des tendances ou changements progressifs puissent affecter sa capacité à livrer des lots conformes au NQA.

6.3 Essais individuels de série

6.3.1 Généralités

L'objet des essais individuels de série est de démontrer la conformité des entretoises aux exigences spécifiques; ils sont effectués sur chaque entretoise. Les essais ne doivent pas détériorer les entretoises.

6.3.2 Application et critères de réception

Des lots complets d'entretoises peuvent être soumis aux essais individuels de série. Toute entretoise non conforme aux exigences doit être mise au rebut.

6.4 Tableau des essais à effectuer

Le Tableau 1 répertorie les essais qui doivent être effectués. Les essais marqués d'un "X" sont obligatoires.

Toutefois, l'acheteur peut spécifier des essais supplémentaires (marqués d'un "O").

Les équipements ou composants détériorés au cours des essais doivent être retirés de la livraison au client.

IECNORM.COM : Click to view the full PDF of IEC 61854:2020 RLV

Tableau 1 – Essais sur les entretoises

Article/ Paragraphe	Essai	Entretoise amortisseuse			Entretoise souple			Entretoise rigide		
		Essai de type	Essai sur échantillon	Essai individuel de série	Essai de type	Essai sur échantillon	Essai individuel de série	Essai de type	Essai sur échantillon	Essai individuel de série
7.1	Examen visuel	X	X	O	X	X	O	X	X	O
7.2	Vérification des dimensions, des matériaux et de la masse	X	X	O	X	X	O	X	X	O
7.3	Essais de protection contre la corrosion	X ¹⁾	X ¹⁾		X ¹⁾	X ¹⁾		X ¹⁾	X ¹⁾	
7.4	Essais non destructifs	O	O	O	O	O	O	O	O	O
7.5	Essais mécaniques									
7.5.1	– essais de glissement des pinces	X	O		X	O		X	O	
7.5.2	– essais sur ensemble de boulons	X	X		X	X		X	X	
7.5.3	– essais de courant de court-circuit simulé et essais de compression et de traction	X	O		X	O		X	O	
7.5.4	– caractérisation des propriétés élastiques et d'amortissement	X	O		O	O		O		
7.5.5	– essais de flexibilité	X	O		X	O		X	O	
7.5.6	– essais de fatigue	X	O		O	O		O		
7.6	Essais de caractérisation des élastomères	X	O		X ¹⁾	O ¹⁾		X ¹⁾	O ¹⁾	
7.7	Essais électriques									
7.7.1	– essais d'effet couronne et de tension perturbatrice radioélectrique (RIV)	X			X			X		
7.7.2	– essai de résistance électrique	X	O		X ¹⁾	O ¹⁾		X ¹⁾	O ¹⁾	
7.8	Vérification du comportement vibratoire du système faisceau/entretoise									
D.2	– vibrations éoliennes	O			O ²⁾			O ²⁾		
D.3	– oscillations de sous-portée	O			O			O		

1) Si applicable.

2) Lorsque des entretoises sont utilisées en association avec des amortisseurs de vibrations.

Il convient que le fournisseur précise dans le plan qualité de son offre, ou dans la documentation d'offre, les essais qui sont déjà terminés (essais de type) ainsi que les essais (essais sur échantillon ou essais individuels de série) qui sont compris dans l'offre sous réserve de l'accord ou d'une demande de modification de la part de l'acheteur.

7 Méthodes d'essai

7.1 Examen visuel

Les essais de type doivent comprendre un examen visuel afin de vérifier la conformité des entretoises, en ce qui concerne toutes les caractéristiques importantes, aux plans de fabrication ou contractuels. Les écarts par rapport aux plans doivent être soumis à l'accord de l'acheteur et doivent être documentés de manière adéquate sur la base d'une dérogation mutuelle.

Les essais sur échantillon et, si exigés, les essais individuels de série doivent comprendre un examen visuel afin de vérifier la conformité du processus de fabrication, de la forme, du revêtement et de l'état de surface de l'entretoise aux plans contractuels. Une attention particulière doit être accordée aux marquages exigés et à l'état des surfaces qui entrent en contact avec le conducteur.

Les procédures d'essai sur échantillon et les critères de réception doivent faire l'objet d'un accord entre l'acheteur et le fournisseur.

Pour les entretoises soumises aux essais de type de détection de l'effet couronne, l'essai sur échantillon doit comprendre une comparaison de la forme et de l'état de surface avec l'un des échantillons d'essai de type de détection de l'effet couronne, lorsque cela est spécifié ou autorisé par l'acheteur.

7.2 Vérification des dimensions, des matériaux et de la masse

Les essais de type, les essais sur échantillon et, si exigés, les essais individuels de série doivent comprendre un contrôle des dimensions afin de vérifier que les entretoises respectent les tolérances dimensionnelles indiquées sur les plans contractuels. L'acheteur peut décider d'assister au mesurage des dimensions choisies ou peut contrôler la documentation du fournisseur dès que celle-ci est disponible.

Les essais de type, les essais sur échantillon et, si exigés, les essais individuels de série doivent également comprendre un contrôle des matériaux afin de vérifier qu'ils sont conformes aux plans et documents contractuels. Cette vérification doit normalement être effectuée par l'acheteur qui contrôle la documentation du fournisseur relative aux spécifications des matériaux, les certificats de conformité ou toute autre documentation qualité.

La masse totale de l'entretoise avec l'ensemble de ses composants doit être conforme à la masse indiquée sur le plan contractuel (dans les tolérances indiquées).

7.3 Essai de protection contre la corrosion

7.3.1 Composants revêtus par galvanisation à chaud (autres que les fils en acier galvanisé câblés)

Les composants revêtus par galvanisation à chaud autres que les fils en acier galvanisé câblés doivent être soumis à l'essai conformément aux exigences spécifiées dans: l'ISO 1461.

L'épaisseur du revêtement doit être conforme aux Tableaux 3 et 4, sauf accord contraire entre l'acheteur et le fournisseur. Toutefois, pour les besoins du présent document, les Tableaux 3 et 4 de l'ISO 1461:2009 doivent s'appliquer aux catégories d'articles suivantes (et non aux catégories spécifiées dans l'ISO 1461).

Tableau 3 de l'ISO 1461:2009: épaisseur du revêtement sur l'ensemble des échantillons sauf sur les:

- rondelles;
- composants filetés;
- petites pièces centrifugées (surface utile < 1 000 mm²).

Tableau 4 de l'ISO 1461:2009: épaisseur du revêtement sur les:

- rondelles;
- composants filetés;
- petites pièces centrifugées (surface utile < 1 000 mm²).

7.3.2 Produits ferreux protégés contre la corrosion par des méthodes autres que la galvanisation à chaud

Les produits en fer protégés contre la corrosion par des méthodes autres que la galvanisation à chaud doivent être soumis à l'essai conformément aux exigences des normes IEC/ISO pertinentes, convenues entre l'acheteur et le fournisseur.

7.3.3 Fils en acier galvanisé câblés

Les fils en acier galvanisé câblés doivent être soumis à l'essai conformément aux exigences spécifiées par l'IEC 60888.

7.3.4 Corrosion causée par des composants non métalliques

Sous réserve d'un accord entre l'acheteur et le fournisseur, l'absence de conditions favorables à la corrosion entre l'élastomère et le conducteur ou l'entretoise, selon le cas, doit être démontrée par un essai de corrosion ou par une expérience en conditions de service adéquate. En variante, si approprié, l'acheteur peut également spécifier pour chaque sous-ensemble contenant un élastomère une plage de résistances électriques assurant une conductivité électrique adéquate pour la charge électrique, tout en réduisant le plus possible l'action galvanique.

NOTE Les composants non métalliques, en particulier les éléments élastomères constituant le revêtement d'une pince d'entretoise ou assurant la flexibilité et l'amortissement dans une entretoise amortisseuse, sont couramment rendus électriquement conducteurs afin d'éviter les problèmes pouvant résulter de la mise en charge capacitive des bras ou du corps de l'entretoise. Le carbone est fréquemment utilisé dans les formulations d'élastomères afin d'obtenir la rigidité et l'amortissement souhaités et d'assurer la conductivité électrique. Certains constituants des composants non métalliques tels que les chlorures, le soufre libre, etc., peuvent avoir des effets corrosifs.

La combinaison de la nature du caoutchouc, de la pollution et de l'électrolyte est responsable d'un processus de corrosion.

7.4 Essais non destructifs

L'acheteur doit spécifier et autoriser les méthodes d'essai pertinentes (ISO ou autres) et les critères de réception associés. Exemples d'essais non destructifs:

- essai magnétique;
- essai par courants de Foucault;
- essai radiographique;
- essai par ultrasons;
- essai de charge d'essai;
- essai de ressuage;
- essai de dureté.

7.5 Essais mécaniques

7.5.1 Essais de glissement des pinces

7.5.1.1 Généralités

Les essais doivent être effectués sur le conducteur auquel les pinces sont destinées. Le conducteur doit être à l'état neuf, c'est-à-dire exempt de toute détérioration ou de tout dommage. La longueur minimale du conducteur à l'essai entre ses raccords de connexion doit être de 4 m. Le conducteur doit être tendu à 20 % de sa résistance assignée à la traction avant l'installation des pinces à soumettre à l'essai.

Les pinces doivent être installées sur une partie inutilisée du conducteur pour chaque essai.

Des précautions doivent être prises afin d'éviter la formation de cages d'oiseau sur le conducteur.

Les pinces doivent être soumises à l'essai individuellement. Les pinces doivent être installées conformément aux instructions du fournisseur. Dans le cas de boulons fusibles ou de capsules à bague de rupture, la partie fusible doit être retirée et la partie de tête inférieure doit être serrée au couple spécifié à l'aide d'une clé dynamométrique étalonnée.

Le couple d'installation doit correspondre au couple de rupture nominal moins la tolérance spécifiée par le fournisseur.

L'acheteur et le fournisseur peuvent convenir de l'utilisation d'autres conducteurs, longueurs de conducteurs et tensions de conducteurs.

7.5.1.2 Essai de glissement longitudinal

Une charge coaxiale au conducteur doit être appliquée à la pince au moyen d'un dispositif adéquat (voir Figure 1).

La charge doit être augmentée progressivement (à une vitesse n'excédant pas 100 N/s) jusqu'à ce qu'elle atteigne les valeurs suivantes, sauf accord contraire entre l'acheteur et le fournisseur:

- 4,0 kN pour des pinces métal sur métal (hors fixation en hélice);
- 1,5 kN pour des pinces revêtues de caoutchouc/élastomère;
- 1,5 kN pour des pinces avec fixation en hélice.

Cette charge doit être maintenue constante pendant 60 s.

Pour détecter un glissement, des marquages de couleur doivent être appliqués respectivement au niveau de l'interface de la pince et du conducteur, ainsi qu'à l'extrémité des garnitures en hélice, si de telles garnitures sont utilisées. D'autres méthodes sont également admises à condition qu'elles aient été convenues entre l'acheteur et le fournisseur.

La charge doit ensuite être augmentée progressivement jusqu'à ce que le glissement de la pince se produise.

Le glissement doit être estimé comme s'étant produit lorsque la force de traction ne peut pas être augmentée ou lorsque le mouvement de la pince sur le conducteur est de:

- 2 mm pour une pince métal sur métal;
- 5 mm pour une pince revêtue de caoutchouc;
- 15 mm pour des pinces avec fixation en hélice.

Pour l'essai de type uniquement, un essai de glissement supplémentaire doit être effectué pour évaluer le comportement de glissement du conducteur.

Une nouvelle pince doit être fixée (conformément au 7.5.1.1) sur le conducteur qui est mis en tension à 20 % de la résistance assignée à la traction. L'effort de traction doit alors être augmenté progressivement (à une vitesse n'excédant pas 100 N/s) à 40 % de la résistance assignée à la traction du conducteur et maintenu pendant 2 h.

Il est admis de fixer plusieurs pinces sur le même montage afin de réduire la durée des essais. La distance entre les pinces doit être d'au moins 300 mm.

Ensuite, la traction doit être réduite progressivement jusqu'à 20 % de la résistance assignée à la traction du conducteur et l'essai de glissement doit être répété.

- Critères de réception

Aucun glissement ne doit se produire à 4 kN ou moins pour les pinces métal sur métal et à 1,5 kN ou moins pour les pinces revêtues de caoutchouc et les pinces avec fixation en hélice. Si des exigences de glissement minimales et maximales sont spécifiées, le glissement doit se produire entre ces valeurs. Un aplatissement très faible de la surface des brins extérieurs du conducteur est acceptable.

Si des garnitures en hélice sont utilisées sous les pinces, le glissement des garnitures en hélice par rapport au conducteur est vu comme étant un glissement de la pince.

Pour les pinces avec fixation en hélice, un déplacement relatif jusqu'à 15 mm dans l'interface entre la pince et les garnitures en hélice, lorsque la charge est atteinte, est acceptable. Le déplacement relatif ne doit pas augmenter pendant 60 s à charge constante. Il ne doit y avoir aucun mouvement relatif à l'extrémité des garnitures en hélice.

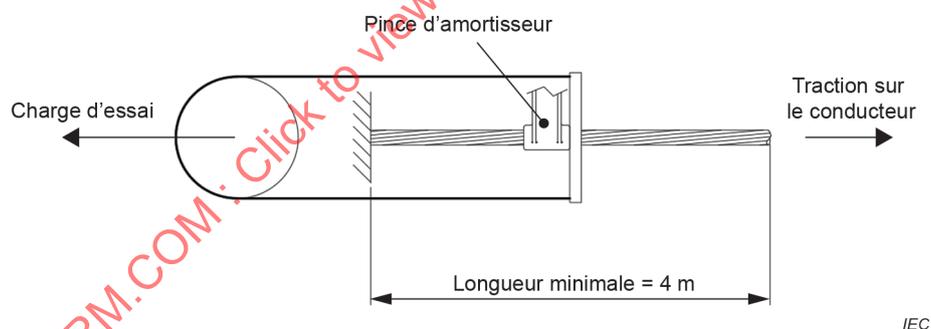


Figure 1 – Montages d'essai pour les essais de glissement longitudinal

a) Essai de glissement longitudinal pour les conducteurs haute température (HTC)

Utiliser les mêmes paramètres de montage que ceux utilisés pour les conducteurs normalisés (voir 7.5.1.1).

Après installation de la pince à température ambiante, le conducteur doit être électriquement chauffé jusqu'à la température maximale en service continu spécifiée par le fabricant du conducteur et maintenu à cette température pendant 0,5 h.

L'effort de traction doit être maintenu constant à 20 % de la résistance assignée à la traction du conducteur utilisé.

L'essai de glissement doit alors être effectué de la même manière que pour les conducteurs normalisés, à la température maximale en service continu.

Pour l'essai de type, le conducteur doit être soumis à un autre processus thermique.

Une nouvelle pince doit être fixée (conformément au 7.5.1.1) à température ambiante sur le conducteur qui est mis en tension à 20 % de la résistance assignée à la traction. Il est admis de fixer plusieurs pinces sur le même montage afin de réduire la durée des essais. La distance entre les pinces doit être d'au moins 300 mm.

Le conducteur doit alors être électriquement chauffé jusqu'à la température maximale en service continu spécifiée par le fabricant du conducteur et maintenu à cette température pendant 1 h.

La température doit ensuite diminuer jusqu'à au moins la température ambiante plus 5 °C. Ce cycle doit être répété quatre fois. A la fin du quatrième cycle, après retour de la température à des valeurs ambiantes, l'essai de glissement longitudinal doit être effectué. Pour l'ensemble de la session d'essai, la traction doit être maintenue constante à 20 % de la résistance assignée à la traction.

- Critères de réception des fils conducteurs non recuits:

Aucun glissement ne doit se produire à 2,5 kN ou moins pour les pinces métal sur métal et à 1 kN ou moins pour les pinces revêtues de caoutchouc et les pinces avec fixation en hélice. Si des valeurs de glissement minimales et maximales sont spécifiées, le glissement doit se produire entre ces valeurs. Un aplatissement très faible de la surface des brins extérieurs du conducteur est acceptable.

- Critères de réception des fils conducteurs recuits:

Aucun glissement ne doit se produire à 1,5 kN ou moins pour les pinces métal sur métal et à 0,5 kN ou moins pour les pinces revêtues de caoutchouc et les pinces avec fixation en hélice. Si des valeurs de glissement minimales et maximales sont spécifiées, le glissement doit se produire entre ces valeurs. Un aplatissement très faible de la surface des brins extérieurs du conducteur est acceptable.

7.5.1.3 Essai de glissement en torsion

Cet essai est applicable aux pinces métal sur métal, aux pinces revêtues de caoutchouc et aux pinces avec fixation en hélice.

Les pinces d'entretoises doivent être installées conformément aux instructions du fournisseur.

Afin de limiter la flexibilité en torsion du conducteur, des pinces rigides doivent être installées de chaque côté de la pince d'entretoise soumise à l'essai (voir Figure 2). Il convient que la longueur libre du conducteur entre l'éprouvette et les pinces de fixation soit d'au moins 1 x la largeur de la pince d'entretoise.

Un couple (voir Figure 2) doit être appliqué aux pinces afin de les faire tourner autour de l'axe du conducteur. Le couple doit être augmenté progressivement jusqu'à ce qu'il atteigne le couple de glissement minimal spécifié.

Il convient que le couple de glissement minimal corresponde à la charge de glissement longitudinal minimale selon le 7.5.1.1 (4 kN pour les pinces métal sur métal, 1,5 kN pour les pinces revêtues de caoutchouc/élastomère).

Le couple de glissement en torsion adéquat peut être calculé comme suit:

$$M = \frac{d}{2} F_{slip}$$

où

M est le couple calculé, en Nm;

F_{slip} est la charge de glissement longitudinal spécifiée selon le 7.5.1.1, en N;

d est le diamètre du conducteur, en m.

Ce couple doit être maintenu constant pendant 60 s. Le couple doit ensuite être augmenté progressivement jusqu'à ce que le glissement de la pince par torsion se produise. La valeur du couple de glissement doit être consignée.

Le glissement de la pince doit être estimé comme s'étant produit lorsqu'une valeur de glissement permanent supérieure à un diamètre de brin est mesurée.

- Critères de réception:

Aucun glissement ne doit se produire au couple de glissement en torsion M calculé ou au-dessous de celui-ci.

Un aplanissement très faible de la surface des brins extérieurs du conducteur est acceptable.

Pour l'essai de type uniquement, un essai de glissement supplémentaire doit être effectué pour évaluer le comportement de glissement du conducteur.

Une nouvelle pince doit être fixée (conformément au 7.5.1) sur le conducteur qui est mis en tension à 20 % de la résistance assignée à la traction. La traction doit alors être augmentée progressivement (à une vitesse n'excédant pas 100 N/s) à 40 % de la résistance assignée à la traction du conducteur et maintenue pendant 2 h.

Il est admis de fixer plusieurs pinces sur le même montage afin de réduire la durée des essais. La distance entre les pinces doit être d'au moins 300 mm.

Ensuite, la traction doit être réduite progressivement jusqu'à 20 % de la résistance assignée à la traction du conducteur et l'essai de glissement en torsion doit être répété.

- Critères de réception:

Aucun glissement ne doit se produire à la valeur minimale spécifiée ou au-dessous de celle-ci.

Un aplanissement très faible de la surface des brins extérieurs du conducteur est acceptable.

a) Conducteur haute température (HTC)

Utiliser les mêmes paramètres de montage que ceux utilisés pour les conducteurs normalisés (voir 7.5.1).

Après installation de la pince à température ambiante, le conducteur doit être électriquement chauffé jusqu'à la température maximale en service continu spécifiée par le fabricant du conducteur et maintenu à cette température pendant 0,5 h.

L'essai de glissement en torsion doit être effectué de la même manière que pour les conducteurs normalisés, à la température maximale en service continu.

- Critères de réception:

Aucun glissement ne doit se produire à la valeur minimale spécifiée ou au-dessous de celle-ci.

Un aplanissement très faible de la surface des brins extérieurs du conducteur est acceptable.

Pour les pinces avec fixation en hélice, un léger déplacement relatif dans l'interface entre la pince et les garnitures en hélice, lorsque la charge est atteinte, est acceptable. Le déplacement relatif ne doit pas augmenter pendant 60 s à charge constante. Il ne doit y avoir aucun mouvement relatif à l'extrémité des garnitures en hélice.

Pour l'essai de type, le conducteur doit être soumis à un autre processus thermique.

Une nouvelle pince doit être fixée (conformément au 7.5.1) à température ambiante sur le conducteur qui est mis en tension à 20 % de la résistance assignée à la traction. Il est admis de fixer plusieurs pinces sur le même montage afin de réduire la durée des essais. La distance entre les pinces doit être d'au moins 300 mm.

Le conducteur doit alors être électriquement chauffé jusqu'à la température maximale en service continu spécifiée par le fabricant du conducteur et maintenu à cette température pendant 1 h.

La température doit ensuite diminuer jusqu'à au moins la température ambiante plus 5 °C. Ce cycle doit être répété quatre fois. Après la diminution de la température à la valeur ambiante, l'essai de glissement en torsion doit être effectué de la même manière que pour les conducteurs normalisés. Pour l'ensemble de la session d'essai, la traction doit être maintenue constante à 20 % de la résistance assignée à la traction.

- Critères de réception:

Aucun glissement ne doit se produire à la valeur minimale spécifiée ou au-dessous de celle-ci.

Un aplanissement très faible de la surface des brins extérieurs du conducteur est acceptable.

Pour les pinces avec fixation en hélice, un léger déplacement relatif dans l'interface entre la pince et les garnitures en hélice, lorsque la charge est atteinte, est acceptable. Le déplacement relatif ne doit pas augmenter pendant 60 s à charge constante. Il ne doit y avoir aucun mouvement relatif à l'extrémité des garnitures en hélice.

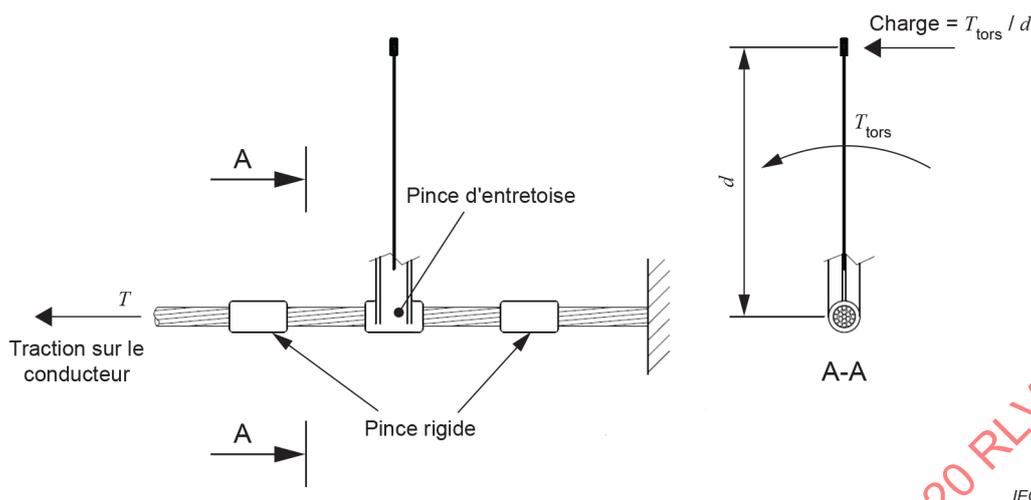


Figure 2 – Montage d'essai pour les essais de glissement en torsion

7.5.2 Essais sur ensembles de boulons

7.5.2.1 Généralités

Ces essais sont effectués afin de vérifier le bon fonctionnement de chaque élément individuel utilisé dans des pincés boulonnés.

7.5.2.2 Essai des boulons fusibles

Les boulons fusibles ou les capsules à bague de rupture, le cas échéant, doivent être soumis à l'essai en appliquant un couple croissant sur la partie fusible du boulon ou de la bague jusqu'à ce qu'elle casse. L'essai doit être réalisé à température ambiante.

Des précautions particulières doivent être prises sur un mouvement circulaire permanent et constant et sur un angle perpendiculaire entre la clé dynamométrique et la tête de boulon.

Le couple de rupture doit être consigné.

- Critères de réception.

Le couple de rupture doit être dans les tolérances convenues entre l'acheteur et le fournisseur.

Si aucune tolérance n'est spécifiée, la plage doit correspondre au couple d'installation nominal plus/moins 10 %.

Dans les pays où la température ambiante peut être inférieure à 0 °C, il est recommandé de répéter les essais sur les boulons fusibles et les capsules à bague de rupture à la température correspondant à la température moyenne du mois le plus froid.

Les éprouvettes doivent être conservées pendant au moins 1 h dans un dispositif de refroidissement adéquat avant l'essai.

Il convient de mesurer et de consigner la température des éprouvettes pendant l'essai de rupture. La température pendant l'essai ne doit pas augmenter de plus de 10 °C par rapport à la température de refroidissement initiale.

7.5.2.3 Essais de fragilisation sur rondelles coniques

Dans un premier temps, un essai de force du ressort doit être effectué à température ambiante sur 3 éprouvettes afin d'évaluer la résilience des rondelles. Les rondelles doivent être installées individuellement sur un boulon utilisé dans l'entretoise amortisseuse soumise à l'essai et serrées 10 % au-dessus du couple d'installation spécifié (voir Figure 3). L'assemblage doit être placé dans un dispositif d'essai approprié, puis la force de réaction et la déformation des rondelles doivent être consignées.

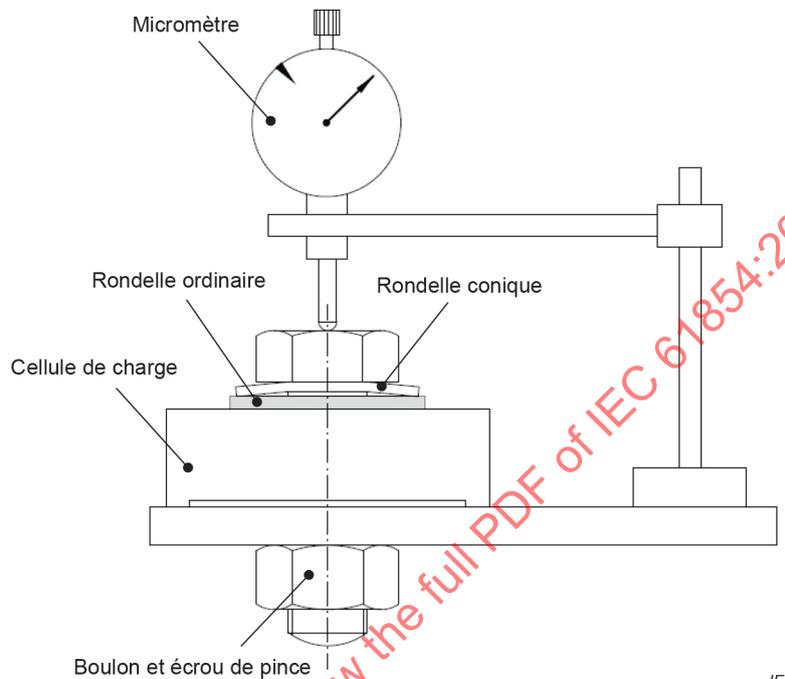


Figure 3 – Montage d'essai pour l'essai de force du ressort à température ambiante

Ensuite, un essai de charge permanente doit être effectué.

Au moins 10 rondelles élastiques coniques neuves doivent être installées en alternant leur orientation sur un boulon utilisé dans l'entretoise amortisseuse soumise à l'essai ou, si nécessaire, sur un boulon de même type, mais de longueur supérieure. Le boulon doit être serré à un couple supérieur de 10 % au couple d'installation spécifié pour l'entretoise.

Les rondelles élastiques coniques doivent être séparées les unes des autres par des rondelles ordinaires d'une dureté d'au moins 300 HV (voir Figure 4).

Le montage d'essai doit ensuite être stocké à une température constante d'au moins -20 °C (± 2 °C) pendant 24 h.

Lorsque le montage d'essai a atteint la température ambiante et après un examen visuel, le montage est démonté.

L'essai de force du ressort à température ambiante doit être répété après le stockage à basse température sur 3 rondelles élastiques coniques; les résultats doivent ensuite être comparés à la force de réaction consignée initiale des rondelles.

- Critères de réception:

Aucune fissure ne doit se produire pendant l'essai à basse température.