

INTERNATIONAL ELECTROTECHNICAL COMMISSION  
COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

---

**IEC 62271-211**  
Edition 1.0 2014-04

**IEC 62271-211**  
Édition 1.0 2014-04

**HIGH-VOLTAGE SWITCHGEAR AND  
CONTROLGEAR –**

**Part 211: Direct connection between power  
transformers and gas-insulated metal-enclosed  
switchgear for rated voltages above 52 kV**

**APPAREILLAGE À HAUTE TENSION –**

**Partie 211: Raccordements directs entre  
transformateurs de puissance et appareillage  
sous enveloppe métallique à isolation gazeuse  
de tensions assignées supérieures à 52 kV**

**CORRIGENDUM 1**

Corrections to the French version appear after the English text.

Les corrections à la version française sont données après le texte anglais.

IECNORM.COM : Click to view the full PDF of IEC 62271-211:2014/COR1:2015

Figure 1 – Typical direct connection between power transformer and gas-insulated metal-enclosed switchgear

Replace the existing Figure 1 with the following new figure:

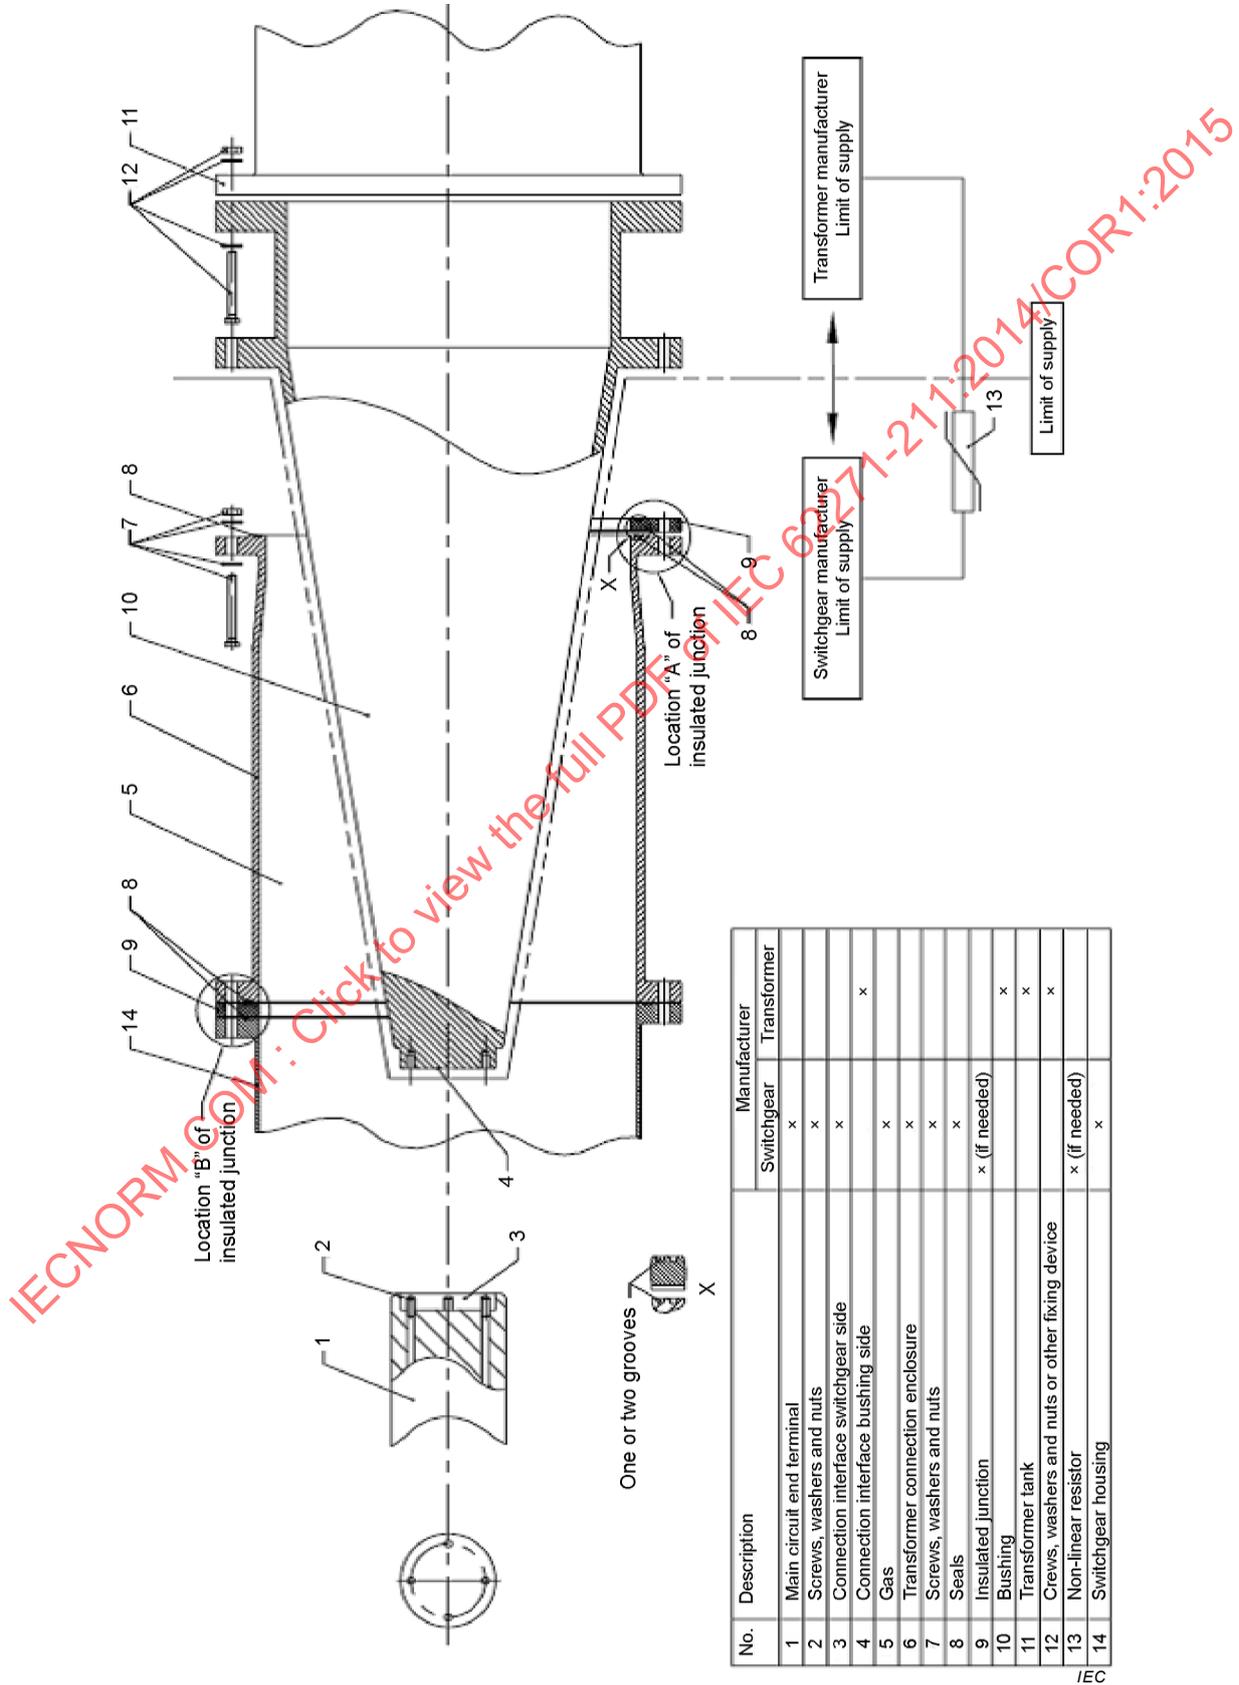
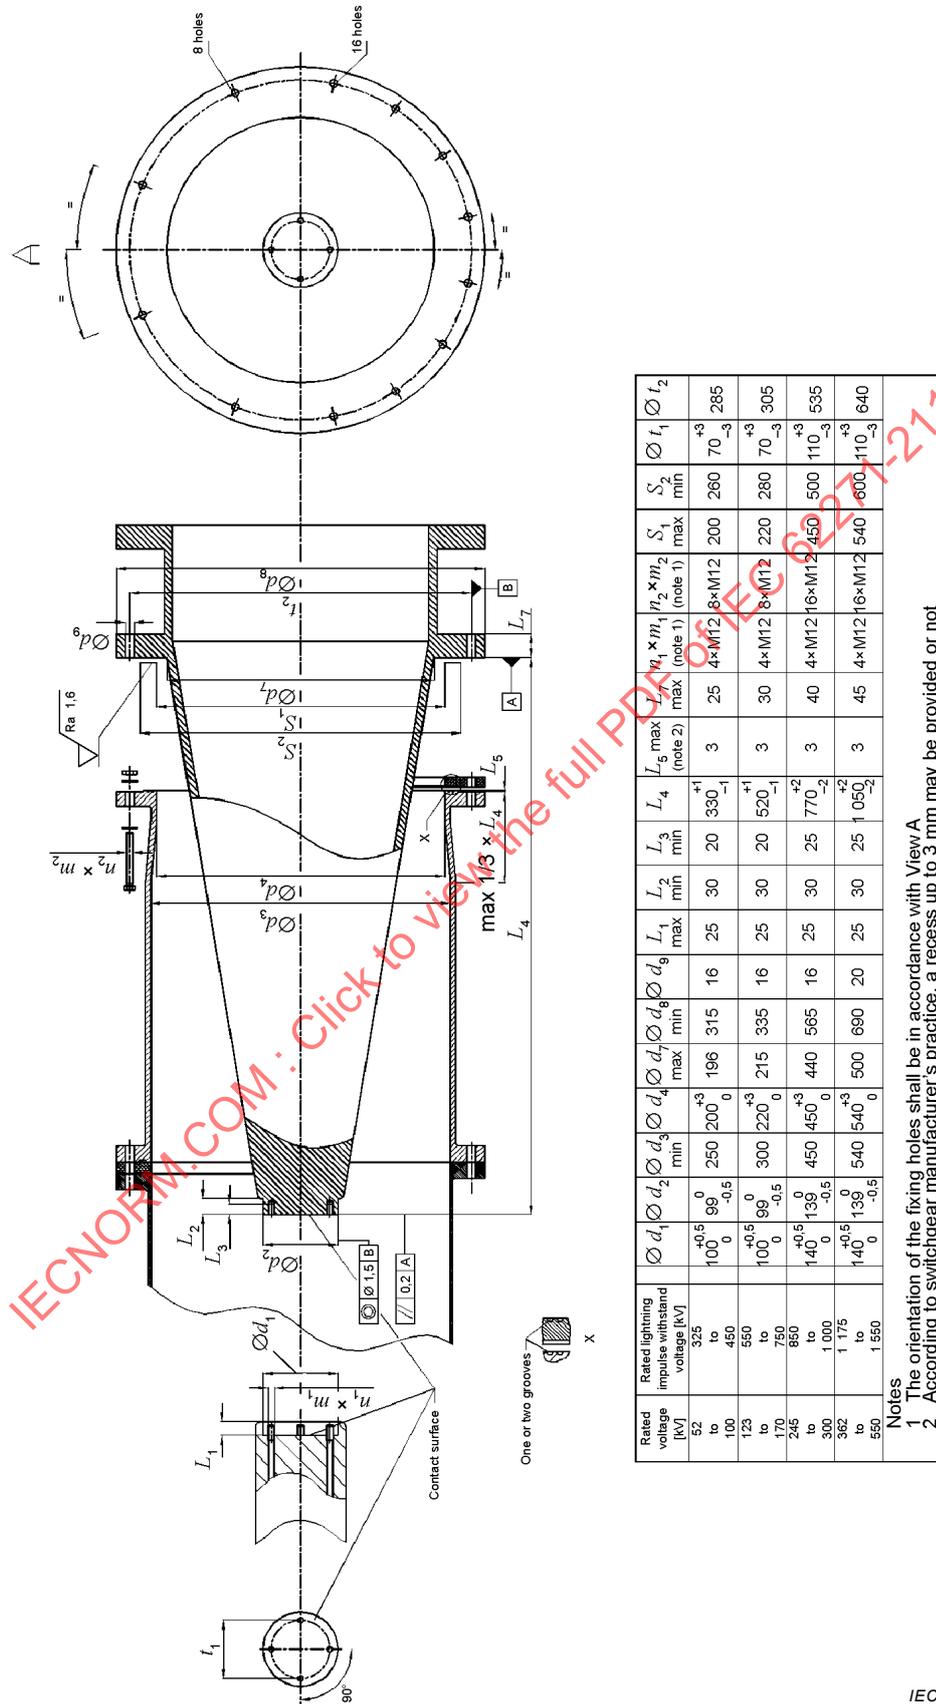


Figure 2 – Standard dimensions for typical direct connection between power transformer and gas-insulated metal-enclosed switchgear

Replace the existing Figure 2 with the following new figure:



**Figure 1 – Raccordement direct type entre le transformateur de puissance et l'appareillage sous enveloppe métallique à isolation gazeuse**

Remplacer la Figure 1 existante par la nouvelle figure suivante:

