

INTERNATIONAL STANDARD

NORME INTERNATIONALE

Double-capped LED lamps designed to retrofit linear fluorescent lamps – Safety specifications

Lampes à LED à deux culots conçues pour remplacer des lampes à fluorescence linéaires – Spécifications de sécurité



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2014 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

IEC Catalogue - webstore.iec.ch/catalogue

The stand-alone application for consulting the entire bibliographical information on IEC International Standards, Technical Specifications, Technical Reports and other documents. Available for PC, Mac OS, Android Tablets and iPad.

IEC publications search - www.iec.ch/searchpub

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 30 000 terms and definitions in English and French, with equivalent terms in 14 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

More than 55 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: csc@iec.ch.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Catalogue IEC - webstore.iec.ch/catalogue

Application autonome pour consulter tous les renseignements bibliographiques sur les Normes internationales, Spécifications techniques, Rapports techniques et autres documents de l'IEC. Disponible pour PC, Mac OS, tablettes Android et iPad.

Recherche de publications IEC - www.iec.ch/searchpub

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études,...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et aussi une fois par mois par email.

Electropedia - www.electropedia.org

Le premier dictionnaire en ligne de termes électroniques et électriques. Il contient plus de 30 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans 14 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

Glossaire IEC - std.iec.ch/glossary

Plus de 55 000 entrées terminologiques électrotechniques, en anglais et en français, extraites des articles Termes et Définitions des publications IEC parues depuis 2002. Plus certaines entrées antérieures extraites des publications des CE 37, 77, 86 et CISPR de l'IEC.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: csc@iec.ch.

INTERNATIONAL STANDARD

NORME INTERNATIONALE

Double-capped LED lamps designed to retrofit linear fluorescent lamps – Safety specifications

Lampes à LED à deux culots conçues pour remplacer des lampes à fluorescence linéaires – Spécifications de sécurité

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

PRICE CODE
CODE PRIX

U

ICS 29.140.99

ISBN 978-2-8322-1939-3

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

INTERNATIONAL ELECTROTECHNICAL COMMISSION

IEC 62776
Edition 1.0 2014-12

**DOUBLE-CAPPED LED LAMPS DESIGNED
TO RETROFIT LINEAR FLUORESCENT LAMPS –
SAFETY SPECIFICATIONS**

INTERPRETATION SHEET 1

This interpretation sheet has been prepared by subcommittee 34A: Lamps, of IEC technical committee 34: Lamps and related equipment.

The text of this interpretation sheet is based on the following documents:

FDIS	Report on voting
34A/2081/FDIS	34A/2090/RVD

Full information on the voting for the approval of this interpretation sheet can be found in the report on voting indicated in the above table.

Interpretation of Clause 7 of IEC 62776:2014

The statement in the first paragraph of Clause 7 that “there shall not be any electrical continuity between the two ends of the lamp during the insertion” is in contradiction with the compliance requirements that follow. In the physical world, establishing the complete lack of any electrical continuity between the two ends is not possible since all materials may be characterized by their inherent conductivity however small it may be.

The compliance requirements described in the fourth paragraph of Clause 7 shall take precedence.

CONTENTS

FOREWORD.....	4
INTRODUCTION.....	6
1 Scope.....	7
2 Normative references	7
3 Terms and definitions	8
4 General requirements and general test requirements.....	9
5 Marking	10
5.1 Marking on the lamp	10
5.2 Marking on the lamp, on the immediate lamp wrapping (or container) or in the instructions	12
5.3 Instruction manual	12
5.3.1 General	12
5.3.2 Declaration of the product.....	12
5.3.3 Graphical instruction.....	13
5.3.4 Mounting	13
5.4 Compliance.....	13
6 Interchangeability	14
6.1 Interchangeability of the cap	14
6.2 Mass.....	14
6.3 Dimensions	14
6.3.1 Requirements	14
6.3.2 Dimensions at 25 °C (non-operating).....	14
6.3.3 Variation of dimension A due to self-heating at 25 °C	15
6.3.4 Dimension B at minimum ambient temperature	15
6.3.5 Dimension A at maximum ambient temperature	15
6.3.6 Compliance	15
6.4 Temperature	15
6.4.1 Temperature requirement	15
6.4.2 Power requirement	16
6.4.3 Compliance	16
6.5 Safety of the lamp in case a wrong starter-lamp combination is used	16
7 Pin-safety during insertion	16
8 Protection against accidental contact with live parts	17
8.1 General.....	17
8.2 Test to establish whether a conductive part may cause an electric shock during operation.....	17
8.3 Insulation resistance	19
8.4 Electric strength.....	19
9 Mechanical requirements for caps	19
9.1 Construction and assembly.....	19
9.2 Torque test on unused lamps	19
9.3 Torque test after heat treatment.....	20
9.4 Repetition of 8.2	20
10 Cap temperature rise.....	20
11 Resistance to heat.....	21

12	Resistance to flame and ignition	22
13	Fault conditions	22
13.1	General.....	22
13.2	Testing under extreme electrical conditions	22
13.3	Short-circuit across capacitors	23
13.4	Fault conditions across electronic components	23
13.5	Compliance.....	23
13.6	Further requirements	24
13.7	Safety of the lamp with different types of controlgear	24
13.8	Compliance for test with different types of controlgear	25
13.9	Safety of the lamp in case the luminaire controlgear short circuits	25
14	Creepage distances and clearances	25
15	Lamp with protection against dust and moisture	25
15.1	Aim of the test	25
15.2	Thermal endurance	26
15.3	IP testing	26
16	Photobiological hazard	26
16.1	UV radiation.....	26
16.2	Blue light hazard.....	26
16.3	Infrared radiation	26
Annex A	(informative) Conformity testing during manufacture	27
A.1	Background and recommended procedure	27
A.2	Testing	27
	Bibliography.....	28
	Figure 1 – Lamp suitable for high frequency operation	10
	Figure 2 – Lamp suitable for 50 Hz or 60 Hz operation.....	11
	Figure 3 – Lamp not suitable for emergency operation.....	11
	Figure 4 – LED replacement starter	11
	Figure 5 – Lamp to be used in dry conditions or in a luminaire that provides protection	12
	Figure 6 – Dimming not allowed.....	12
	Figure 7 – Schematic steps of removing a fluorescent lamp and inserting a double-capped LED lamp designed to retrofit linear fluorescent lamp	13
	Figure 8 – Test configuration for touch current measurement.....	17
	Figure 9 – Standard test finger (according to IEC 60529).....	18
	Figure 10 – Ball-pressure test apparatus.....	21
	Table 1 – Interchangeability gauges and lamp cap dimensions	14
	Table 2 – Torque values for unused lamps.....	20
	Table 3 – Torque values after heating treatment	20
	Table 4 – Minimum LED lamp impedances.....	24
	Table A.1 – Minimum values for electrical tests.....	27

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**DOUBLE-CAPPED LED LAMPS DESIGNED
TO RETROFIT LINEAR FLUORESCENT LAMPS –
SAFETY SPECIFICATIONS**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 62776 has been prepared by subcommittee 34A: Lamps, of IEC of IEC technical committee 34: Lamps and related equipment.

The text of this standard is based on the following documents:

FDIS	Report on voting
34A/1795/FDIS	34A/1816/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

In this standard, the following print types are used:

- requirements proper: in roman type.
- *test specifications: in italic type.*
- Notes: in small roman type.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

The contents of the corrigendum of March 2015 and Interpretation Sheet 1 of June 2018 have been included in this copy.

Single user licence
EEESC TC2WG5 on Lighting
IECNORM.COM : Click to view the full PDF of IEC 62776 WG2014
No reproduction or circulation
October 2022

INTRODUCTION

Double-capped fluorescent lamps are installed in big volume in office lighting, street lighting, industrial lighting and much more. Double-capped LED lamps are intended as a possible replacement for G5- or G13-capped fluorescent lamps. This standard safeguards that the change from fluorescent lamp to LED lamp and the backward change from LED lamp to fluorescent lamp is carried out with safe LED lamps and under specified exchange conditions.

The establishing of a safety standard for double-capped LED lamps does not exclude future relocation as a part of IEC 60968, self-ballasted lamps (if re-edited as an umbrella standard), and further inclusion of requirements for conversion type double-capped LED lamps.

This proposal covers double-capped LED lamps with cap G5 and G13 only, where the fluorescent tube is replaced by a tubular LED lamp, without modifications to the luminaire. Only in case of electromagnetic controlgear, the starter is replaced by a LED starter.

Single user licence
EEESC TC2WG5 on Lighting
IECNORM.COM : Click to view the full PDF of IEC 62776 W0204
No reproduction or circulation
October 2022

DOUBLE-CAPPED LED LAMPS DESIGNED TO RETROFIT LINEAR FLUORESCENT LAMPS – SAFETY SPECIFICATIONS

1 Scope

This International Standard specifies the safety and interchangeability requirements, and the exchange operation together with the test methods and conditions required to show compliance of double-capped LED lamps with G5 and G13 caps, intended for replacing fluorescent lamps with the same caps, having:

- a rated power up to 125 W;
- a rated voltage of up to 250 V.

Such LED lamps are designed for replacement without requiring any internal modification of the luminaire.

The existing luminaires, into which the double-capped LED lamps are fitted, can be operated with electromagnetic or electronic controlgear.

The requirements of this standard relate only to type testing.

Recommendations for whole product testing or batch testing are given in Annex A.

NOTE 1 Where in this standard the term “lamp(s)” is used, it is understood to stand for “double-capped retrofit LED lamp(s)”, except where it is obviously assigned to other types of lamps.

This standard does not cover double-capped conversion LED lamps where modification in the luminaire is required. The requirements in this standard are given for general lighting service (excluding for example explosive atmospheres). For lamps for other applications additional requirements may apply.

NOTE 2 This standard includes photobiological safety.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60061-1, *Lamp caps and holders together with gauges for the control of interchangeability and safety – Part 1: Lamp caps*

IEC 60061-3, *Lamp caps and holders together with gauges for the control of interchangeability and safety – Part 3: Gauges*

IEC 60061-4, *Lamp caps and holders together with gauges for the control of interchangeability and safety – Part 4: Guidelines and general information*

IEC 60081, *Double-capped fluorescent lamps – Performance specifications*

IEC 60155, *Glow-starters for fluorescent lamps*

IEC 60360, *Standard method of measurement of lamp cap temperature rise*

IEC 60417, *Graphical symbols for use on equipment* (available at <http://www.graphical-symbols.info/equipment>)

IEC 60598-1, *Luminaires – Part 1: General requirements and tests*

IEC 60695-2-10:2013, *Fire hazard testing – Part 2-10: Glowing/hot-wire based test methods; Glow-wire apparatus and common test procedure*

IEC 60695-2-11:2000¹, *Fire hazard testing – Part 2-11: Glowing/hot-wire based test methods – Glow-wire flammability test method for end products*

IEC 60921, *Ballasts for tubular fluorescent lamps – Performance requirements*

IEC 61195, *Double-capped fluorescent lamps – Safety specifications*

IEC 61347-1:— 2, *Lamp controlgear – Part 1: General and safety requirements*

IEC 61347-2-8, *Lamp controlgear – Part 2-8: Particular requirements for ballasts for fluorescent lamps*

IEC 62031, *LED modules for general lighting – Safety specifications*

IEC 62504, *General lighting - Light emitting diode (LED) products and related equipment - Terms and definitions*

IEC TR 62778, *Application of IEC 62471 for the assessment of blue light hazard to light sources and luminaires*

ISO 4046-4:2002, *Paper, board, pulps and related terms – Vocabulary – Part 4: Paper and board grades and converted products*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 62504, IEC 62031 as well as the following apply.

3.1

double-capped retrofit LED lamp

tubular LED lamp which can be used as a replacement for double-capped fluorescent lamps without requiring any internal modification in the luminaire and which, after installation, maintains the same level of safety of the replaced lamp in the luminaire

Note 1 to entry: The replacement of a glow starter according to IEC 60155 with LED replacement starter having the same dimensions and fit, for the correct functioning of the double-capped LED lamp is not considered as a modification to the luminaire.

¹ First edition. This edition has been replaced in 2014 by IEC 60695-2-11:2014, *Fire hazard testing - Part 2-11: Glowing/hot-wire based test methods - Glow-wire flammability test method for end-products (GWEPT)*

² To be published.

3.2**double-capped conversion LED lamp**

double-capped LED lamp which can be used as a replacement for another type of lamp with modification to the luminaire

3.3**rated voltage**

voltage value for a characteristic of a lamp for specified operating conditions

Note 1 to entry: The value and the conditions are specified in this standard, or assigned by the manufacturer or responsible vendor.

3.4**rated power**

power marked on the lamp

3.5**rated frequency**

frequency marked on the lamp

3.6**cap temperature rise**

Δt_s

surface temperature rise (above ambient) of the lamp cap

3.7**live part**

conductive part which may cause an electric shock in normal use

3.8**type**

double-capped LED lamp, representative of the production

3.9**type test**

conformity test on one or more double-capped LED lamps with similar cap, representative of the production

3.10**type test sample**

one or more double-capped LED lamps with similar cap, submitted by the manufacturer or responsible vendor for the purpose of the type test

3.11**ultraviolet hazard efficacy of luminous radiation**

$K_{S,v}$

quotient of an ultraviolet hazard quantity to the corresponding photometric quantity

Note 1 to entry: Ultraviolet hazard efficacy of luminous radiation is expressed in mW/klm

Note 2 to entry: The ultraviolet hazard efficacy of luminous radiation is obtained by weighting the spectral power distribution of the lamp with the UV hazard function $S_{UV}(\lambda)$. Information about the relevant UV hazard function is given in IEC 62471. It only relates to possible hazards regarding UV exposure of human beings. It does not deal with the possible influence of optical radiation on materials, such as mechanical damage or discoloration.

4 General requirements and general test requirements

4.1 The lamps shall be so designed and constructed that in normal use they function safely causing no danger to the user or surroundings.

In general, compliance is checked by carrying out all the tests specified.

4.2 Double-capped LED lamps shall normally not be opened for tests. In the case of doubt based on the inspection of the lamp and the examination of the lamp circuit diagram, and in agreement with the manufacturer or responsible vendor, lamps shall be specially prepared so that a fault condition can be simulated and shall be submitted for testing (see Clause 13). Opened lamps or inspection of internal component parts of the lamp may be required to verify conformity with Clauses 11, 12 and 14 of this standard.

4.3 In general, all tests are carried out on each type of lamp or, where a range of similar lamps is involved, for each power in the range or on a representative selection from the range, as agreed with the manufacturer.

4.4 When the lamp fails safely during one of the tests, it is replaced, provided that no fire, smoke or flammable gas is produced. Further requirements on failing safe are given in Clause 13.

4.5 Internal wiring shall be carried out as in Clause 5.3 of IEC 60598-1.

4.6 For construction of the electrical circuit, 15.1 and 15.2 of IEC 61347-1:— shall be regarded and for the other parts, Clauses 4.11, 4.12 and 4.25 of IEC 60598-1 shall be regarded.

5 Marking

5.1 Marking on the lamp

Lamps shall be clearly and durably marked with the following markings, the size of which shall be minimum 2 mm for letters/numbers and 5 mm for symbols.

- a) Mark of origin (this may take the form of a trademark, the manufacturer's name or the name of the responsible vendor).
- b) Rated voltage or voltage range (marked "V" or "volts").

NOTE 1 The rated voltage or voltage range of the lamp can differ from the open circuit voltage.

- c) Rated power (marked "W" or "watts").
- d) Rated frequency or frequency range (marked in "Hz" or "kHz").
- e) Double-capped LED lamps suitable to be used in combination with some type of ballast only (e.g. with magnetic ballast) shall be marked with the symbol as in Figure 1 and/or Figure 2.



[SOURCE: 60417-6095 (2011-11)]

Figure 1 – Lamp suitable for high frequency operation




[SOURCE: 60417-6094 (2011-11)]

Figure 2 – Lamp suitable for 50 Hz or 60 Hz operation

- f) Double-capped LED lamps shall be marked according to Figure 3 and with the following information: “This lamp is not suitable to be used in emergency luminaires designed for double-capped fluorescent lamp(s)”.

NOTE 2 For the future, additional requirements to support use for emergency lighting can be developed



IEC

Figure 3 – Lamp not suitable for emergency operation

- g) If double-capped LED lamps need to be used with components which replace the starter, they shall be marked with the type reference of the LED replacement starter. The LED replacement starter shall be marked as in Figure 4.



NOTE: The symbol is under development as IEC 60417-Pr14-181.

Figure 4 – LED replacement starter

- h) Provide information on the ingress of dust and water.

For lamps that should be used in dry conditions or in a luminaire that provides protection, see Figure 5.



[SOURCE: IEC 60417-6179-1 (2014-10)]

Figure 5 – Lamp to be used in dry conditions or in a luminaire that provides protection

- i) Rated ambient temperature range of the lamp.

5.2 Marking on the lamp, on the immediate lamp wrapping (or container) or in the instructions

In addition, the following information shall be given by the lamp manufacturer on the lamp or immediate lamp wrapping or container or in the instruction manual. Explanation of Figures 1 and 2 shall be given in the instruction manual.

- a) Rated current (marked “A” or “ampere”).
- b) Special conditions or restrictions which shall be observed for lamp operation, for example operation in dimming circuits. Where lamps are not suitable for dimming, the lamps may be marked according to Figure 6.



NOTE: The symbol is under development as IEC 60417-Pr14-205.

Figure 6 – Dimming not allowed

5.3 Instruction manual

5.3.1 General

In addition to the information listed in 5.2, double-capped LED lamps shall be accompanied by instructions, describing all necessary steps for the replacement of the fluorescent lamp with a LED lamp, such as replacement of the starter.

All required instructions detailed by this safety standard shall be given either on the lamp, on the product packaging or in the manufacturer’s instructions provided with the lamp. The meaning of the symbols shown in 5.1 and 5.2 should be clearly explained (using words) in the instruction manual.

The content of the instructions shall include the following.

5.3.2 Declaration of the product

The provisions requested under the following items 1) to 5) shall be supplied.

- 1) A list of all parts supplied shall be provided.

- 2) The type of the fluorescent lamp that the LED lamp is designed to replace shall be declared.
- 3) Provide a warning that no modifications of the luminaire which the LED lamp is to be used with are to be made.
- 4) The ambient temperature range for which the lamp is rated shall be declared. Where the minimum ambient temperature of the range is higher than $-20\text{ }^{\circ}\text{C}$ or the maximum ambient temperature of the range lower than $+60\text{ }^{\circ}\text{C}$ the instruction manual for the lamp shall contain the following information.

“This lamp may not be suitable for use in all applications where a traditional fluorescent lamp has been used. The temperature range of this lamp is more restricted. In cases of doubt regarding the suitability of the application the manufacturer of this lamp should be consulted.”

NOTE This standard is based on the assumption that the normal expected ambient temperature range of the fluorescent lamps that may be replaced by these retro-fit products is $-20\text{ }^{\circ}\text{C}$ to $+60\text{ }^{\circ}\text{C}$.

- 5) Declare: “This lamp is designed for general lighting service (excluding for example explosive atmospheres).”

5.3.3 Graphical instruction

This clause can be used instead of 5.3.4. The steps for applying the product to an existing luminaire shall be as given in Figure 7. If no starter replacement is needed, steps 4 and 5 in Figure 7 and in 5.3.4 are omitted.



IEC

Figure 7 – Schematic steps of removing a fluorescent lamp and inserting a double-capped LED lamp designed to retrofit linear fluorescent lamp

5.3.4 Mounting

This clause can be used instead of 5.3.3. Describe the steps needed in line with the graphical instruction in Figure 7.

Example for a retrofit version.

- (1) Switch off electricity.
- (2) and (3) Remove the conventional lamp.
- (4) Remove the starter.
- (5) Click the LED replacement starter into the starter holder.
- (6) Insert the LED lamp into the lampholder.
- (7) Secure the position by turning the lamp by 90° .
- (8) Switch on electricity and check for lamp starting.

5.4 Compliance

Compliance with 5.1 to 5.3 is checked by the following:

Presence and legibility of the marking by visual inspection.

The durability of the marking – as far as applied on the lamp – is checked by trying to remove it by rubbing lightly for 15 s with a piece of cloth soaked with water and, after drying, for a further 15 s with a piece of cloth soaked with hexane. The marking shall be legible after the test.

Availability of information required in 5.2 and 5.3 – by visual inspection.

6 Interchangeability

6.1 Interchangeability of the cap

Interchangeability shall be assured by the use of caps in accordance with IEC 60061-1 and gauges in accordance with IEC 60061-3; see Table 1.

Compliance is checked by using the relevant gauges.

Table 1 – Interchangeability gauges and lamp cap dimensions

Lamp cap	Cap sheet in IEC 60061-1	Cap dimensions to be checked by the gauge	Gauge sheet in IEC 60061-3
G5	7004-52	All dimensions to be checked	7006-46 and 7006-46A
G13	7004-51	All dimensions to be checked	7006-44 and 7006-45

If double-capped LED lamps need to operate in combination with a LED replacement starter which replaces the glow starter, this LED replacement starter shall be supplied together with the lamp. This device shall comply with dimensions, electrical, mechanical and thermal tests required in Section 1 of IEC 60155.

6.2 Mass

The entire mass of a lamp shall not exceed 200 g for a G5-capped lamp and 500 g for a G13-capped lamp.

Compliance is checked by weighing the lamp.

6.3 Dimensions

6.3.1 Requirements

The length of the lamp shall not change significantly within the specified ambient temperature range of the lamp.

Compliance is checked by the tests in 6.3.2 to 6.3.6.

NOTE For the purpose of this standard, the minimum and maximum temperature range for fluorescent lamps has been assumed to be $-20\text{ }^{\circ}\text{C}$ to $+60\text{ }^{\circ}\text{C}$. Lamp lengths critical for stress at the holders at elevated temperatures and critical for contact making at lowered temperatures are considered.

6.3.2 Dimensions at $25\text{ }^{\circ}\text{C}$ (non-operating)

Double-capped LED lamps for use in fluorescent luminaires shall comply with the dimensions and tolerances of the corresponding lamps as defined in IEC 60081 at $25\text{ }^{\circ}\text{C}$. The lamp dimension as specified in corresponding IEC 60081 datasheet shall be measured. Resulting dimensions shall be noted as $A_{25^{\circ}\text{C}}$, $B_{25^{\circ}\text{C}}$, $C_{25^{\circ}\text{C}}$, and $D_{25^{\circ}\text{C}}$.

Compliance is checked by inspection.

NOTE Designation A, B, C and D refer to the sheet 60081-IEC-01 of IEC 60081.

6.3.3 Variation of dimension A due to self-heating at 25 °C

The lamp is placed in a draught free environment and operated at its rated supply voltage. Dimension A is measured after the lamp is stabilised and noted as $A_{\text{operating}}$. The difference in length is calculated from the value measured in this operating state:

$$\Delta A = A_{\text{operating}} - A_{25^{\circ}\text{C}}$$

When stable conditions have been reached, the surface temperature on the lamp shall not exceed the value in 6.4.1.

6.3.4 Dimension B at minimum ambient temperature

The lamp is placed in a climate chamber at the minimum ambient temperature, i.e. -20°C , or at the minimum specified ambient temperature (t_{min}). After having attained the temperature (t_{min}) for 1 h (u.c), the lamp is taken off the climate chamber and the length of the lamp is measured immediately. Care has to be taken that during measurement no significant change of temperature of the lamp occurs. The temperature of the lamp is recorded during the length measurement of dimension B. The value at minimum of the rated temperature range shall be considered for compliance and noted as $B_{t_{\text{min}}}$.

6.3.5 Dimension A at maximum ambient temperature

The lamp is placed in the climate chamber at the maximum ambient temperature, i.e. $+60^{\circ}\text{C}$ or at the maximum specified ambient temperature, t_{max} . After having attained the temperature t_{max} for 1 h (u.c.), the lamp is taken off the climate chamber and the length of the lamp is measured immediately. Care has to be taken that during measurement no significant change of temperature of the lamp occurs. The temperature of the lamp is recorded during the length measurement, after having taken it off from the climate chamber. The length A at the maximum of the rated ambient temperature range shall be noted as $A_{t_{\text{max}}}$.

6.3.6 Compliance

The following formulae apply:

$$A1 = A_{t_{\text{max}}} + \Delta A - A_{25^{\circ}\text{C}} (t_{\text{max}} - 25^{\circ}\text{C}) \cdot 11,7 \cdot 10^{-6}$$

$$B1 = B_{t_{\text{min}}} - A_{25^{\circ}\text{C}} (t_{\text{min}} - 25^{\circ}\text{C}) \cdot 11,7 \cdot 10^{-6}$$

Compliance is checked as follows:

- Dimension A1 shall be within the limits of the corresponding dimensions according to the relevant lamp data sheet from IEC 60081.
- Dimension B1 shall be within the limits of the corresponding dimensions according to the relevant lamp data sheet from IEC 60081.

NOTE Acceptable length variation of the LED lamp is based on thermal expansion of a general luminaire construction assuming a steel tray construction for mounting the lampholders and having a thermal expansion coefficient of $11,7 \cdot 10^{-6}/^{\circ}\text{C}$.

6.4 Temperature

6.4.1 Temperature requirement

Except the lamp caps, the LED lamp temperature shall not be higher than 75°C measured on any location of the lamp. The requirement applies for lamp surfaces which can be touched with a test finger.

6.4.2 Power requirement

The power consumed by the LED lamp shall not be higher than that of the fluorescent lamp that it replaces as described in IEC 60081.

6.4.3 Compliance

The lamp is measured positioned horizontally at 25 °C ambient temperature in free air. For details of this test set-up, see Annex B, IEC 61195. The lamp under test shall consist of a complete unit, operated at its rated supply voltage. When stable conditions have been reached, the maximum surface temperature on the lamp and the power consumed shall be measured. These shall not exceed the values in 6.4.1 and 6.4.2.

6.5 Safety of the lamp in case a wrong starter-lamp combination is used

The following combinations shall be tested:

- fluorescent starter with LED lamp;
- LED replacement starter with fluorescent lamp;
- one fluorescent lamp replaced by a LED lamp in case of two fluorescent lamps connected in series with the same controlgear (e.g. 2 x 18 W) and equipped with starter and LED replacement starter replacing the starter shall show compliance for all possible combinations. For LED replacement starter which replace starter with a short circuit (e.g. a fuse) or open circuit, the test of the combination with “LED replacement starter with fluorescent lamp”, is not required.

If lamps are marked with a voltage range, rated voltage is taken as the maximum of the voltage range marked unless the manufacturer declares another voltage as the most critical one.

Compliance:

Same as 13.6, repeated below:

During the tests 13.2 to 13.5, the lamp shall not catch fire, or produce flammable gases or smoke and live parts shall not become accessible.

To check if gases liberated from component parts are flammable or not, a test with a high-frequency spark generator is made.

To check if accessible parts have become live, a test in accordance with 8.2 is made.

After testing according to 13.2 to 13.5, the lamp shall meet the insulation resistance requirements of 8.3.

7 Pin-safety during insertion

G5 and G13 lamp caps do not assure the insertion of both ends of the lamp simultaneously, for this reason there shall not be any electrical continuity between the two ends of the lamp during the insertion.


With the lamp pins inserted into only one lampholder the voltage present at the un-inserted pins shall not be capable of causing an electric shock. Following IEC 60598-1, Section 8, basic insulation during lamp insertion is sufficient.

An accessible protection measure that may accidentally be deactivated and hereby deactivate the protection against electric shock is not permissible.

NOTE An accessible protective measure could be a button that closes a switch, when the lamp is fully mounted.

Compliance is checked by the following tests:

- 1) *Electric strength test: based on possibility of 250 V on the lampholder during insertion, the electric strength test shall be conducted with 1 500 V (2 U + 1 000 V) between both ends of the lamp. Initially, no more than half the voltage is applied between the pins or contacts of one cap and the pins or contacts of the other cap. It is then gradually raised to the full value. No flashover or breakdown shall occur during the test.*
- 2) *Insulation resistance: measured with about 500 V d.c. the minimum resistance shall be 2 MΩ*
- 3) *Creepage distances and clearance: regarding clearance, Table 9 of IEC 61347-1:— shall be applied based on 250 V working voltage including mains supply transients.
Creepage distances shall not be less than the required minimum clearance.*
- 4) *Touch current: applying a test voltage of 500 V r.m.s. (50 Hz or 60 Hz), the touch current shall not exceed 0,7 mA peak when measured in accordance with Figure 8.*

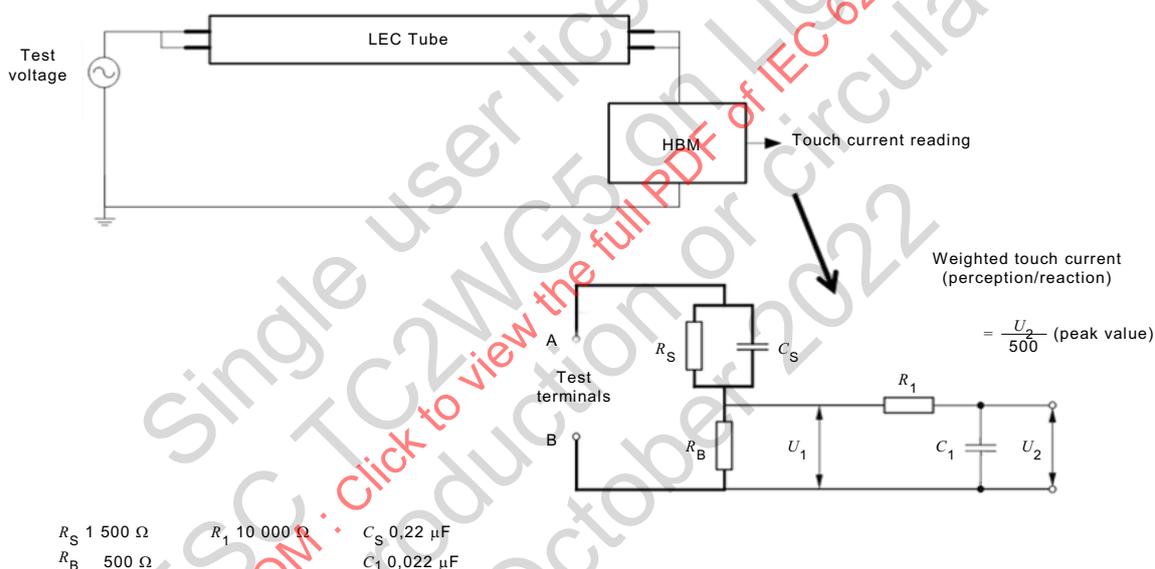

IEC

Key

HBM = Human Body Model, for explanation see IEC 60598-1, Annex G.

Figure 8 – Test configuration for touch current measurement

8 Protection against accidental contact with live parts

8.1 General


Insulation resistance and electric strength shall be adequate between live parts of the lamp and accessible parts of the lamp. Concerning caps, the requirements of 2.4 and 2.5 of IEC 61195 apply. For the other parts of the lamp, the following requirements apply.

8.2 Test to establish whether a conductive part may cause an electric shock during operation

The lamps shall be so constructed that, without any additional enclosure in the form of a luminaire, the following parts are not accessible when the lamp is installed in a lampholder according to the relevant IEC lampholder data sheet:

- internal metal parts,
- basic insulated external metal parts other than caps,
- live metal parts of the lamp cap,
- live metal parts of the lamp itself.

The accessibility is checked with a test finger specified in Figure 9, with a force of 10 N.

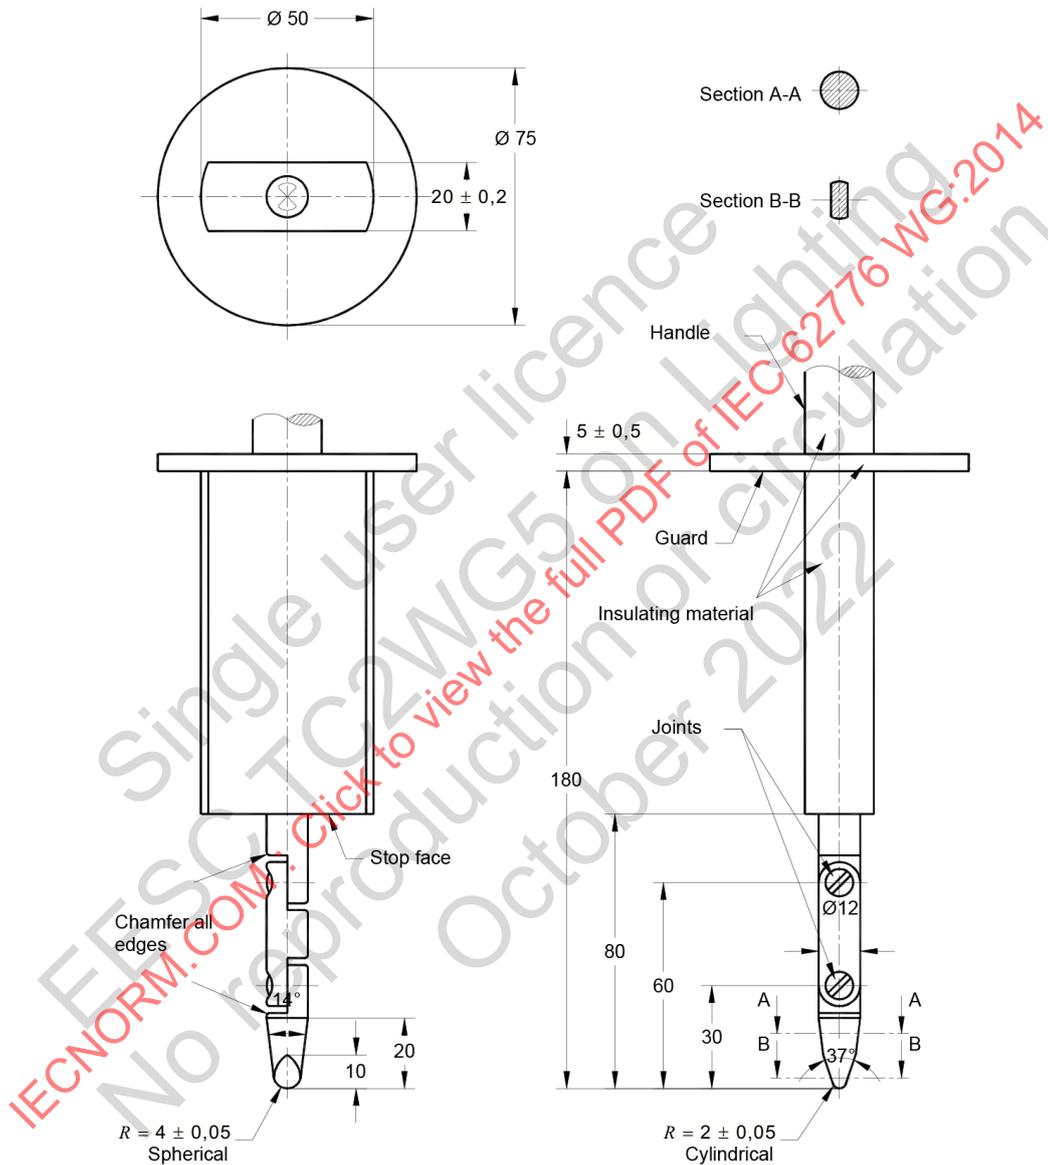

IEC

Material: metal, except where otherwise specified

Tolerances on dimensions without specific tolerance:

on angles:

on linear dimensions:

+0°
-10'

• up to 25 mm: +0 mm
-0,05 mm

• over 25 mm: ± 0,2 mm

Both joints shall permit movement in the same plane and the same direction through an angle of 90° with a 0° to +10° tolerance.

Figure 9 – Standard test finger (according to IEC 60529)

External metal parts other than current-carrying metal parts of the cap shall not be or become live. For testing, any movable conductive material shall be placed in the most onerous position without using a tool.

Compliance: To check whether accessible parts have become live, a test in accordance with IEC 61347-1:—, Annex A is made. The lamp is operated on a reference circuit as described in IEC 60081, B.1.2, B.1.3 and B.1.4.

8.3 Insulation resistance

The lamp shall be conditioned for 48 h in a cabinet containing air with a relative humidity between 91 % and 95 %. The temperature of the air is maintained within 1 °C of any convenient value between 20 °C and 30 °C.

Insulation resistance shall be measured in the humidity cabinet with a d.c. voltage of approximately 500 V, 1 min after application of the voltage.

The insulation resistance between live parts of the cap and accessible parts of the lamp (accessible parts of insulating material are covered with metal foil) shall be not less than 4 MΩ.

8.4 Electric strength

Immediately after the insulation resistance test, the same parts as specified above shall withstand a voltage test for 1 min with an a.c. voltage or a d.c. voltage equal to the peak voltage of the prescribed a.c. voltage as follows.

The use of a.c. or d.c. voltage is to be advised by the manufacturer.

NOTE The electric strength test with an equivalent d.c. voltage is under consideration.

During the test, the supply contacts of the cap are short-circuited. Accessible parts of insulating material of the lamp are covered with metal foil. Initially, no more than half the voltage prescribed in IEC 60598-1, Table 10.2, and reference d) for double or reinforced insulation is applied between the contacts and the metal foil or accessible conductive parts. It is then gradually raised to the full value. Care shall be taken that the metal foil is so placed that no flashover occurs at the edges of the insulation.

No flashover or breakdown shall occur during the test. Measurements shall be carried out in the humidity cabinet.

9 Mechanical requirements for caps

9.1 Construction and assembly

Caps shall be so constructed and assembled to the tubes that they remain attached during and after operation.

Compliance is checked by the following tests.

9.2 Torque test on unused lamps

For unused lamps, compliance is checked by applying a torque test to the pins, as follows.

The lamp cap shall remain firmly attached to the tube and there shall be no rotational movement between component parts of the cap exceeding an angular displacement of 6° when subjected to the torque levels listed in Table 2.

Table 2 – Torque values for unused lamps

Cap type	Torque value
	Nm
G5	0,5
G13	1,0

The torque shall not be applied suddenly, but shall be increased progressively from zero to the value specified in Table 2.

The test holder for the application of the torque is shown in Annex A of IEC 61195.

In case of lamps with adjustable caps, before applying the torque test, the lamp cap shall be rotated to its extreme positions. Both extreme positions shall be tested.

9.3 Torque test after heat treatment

LED lamps having a crimp, screw or similar mechanical connection used for fixing the cap to the tube, are exempt from this clause.

Following a heating treatment for a period of $2\,000\text{ h} \pm 50\text{ h}$ at a temperature of $80\text{ °C} \pm 5\text{ °C}$, the cap shall remain firmly attached to the tube and there shall be no rotational movement between the component parts of the cap exceeding an angular displacement of 6° when subjected to the torque levels specified in Table 3. In case of other kind of fixation of the cap of the tube than that used for fluorescent lamps, a shorter heating period down to 100 h, is allowed. The effect of adhesive materials connecting cap and tube shall be as rigid as the adhesive material used for fluorescent lamps.

NOTE The heating time, the properties of other kind of fixation of the cap, e.g. with adhesives and its application procedure are under consideration

In case of lamps with adjustable caps, before applying the torque test, the lamp cap shall be rotated to its extreme positions. Both extreme positions shall be tested.

Table 3 – Torque values after heating treatment

Cap type	Torque value ^a
	Nm
G5	0,3
G13	0,6
^a Under consideration.	

9.4 Repetition of 8.2

After the mechanical strength test, the sample shall comply with the requirements of accessibility (see 8.2).

10 Cap temperature rise

Lamp cap temperature rise is checked by the test set-up specified in Annex B of IEC 61195.


Compliance:

The lamp cap temperature rise above ambient temperature shall not exceed 95 K.

11 Resistance to heat

The lamp shall be sufficiently resistant to heat. External parts of insulating material providing protection against electric shock, and parts of insulating material retaining live parts in position shall be sufficiently resistant to heat.

Compliance is checked by subjecting the parts to a ball-pressure test by means of the apparatus shown in Figure 10.

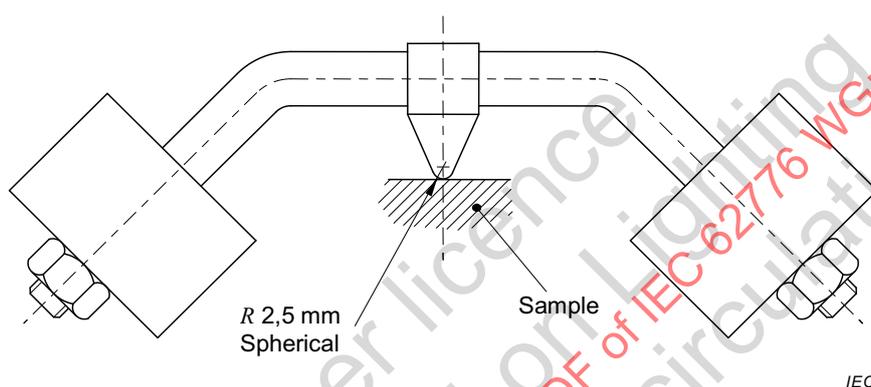

[Source IEC 60598-1, Figure 10]

Figure 10 – Ball-pressure test apparatus

The test is made in a heating cabinet at a temperature of $(25 \pm 5)^\circ\text{C}$ in excess of the operating temperature of the relevant part according to Clause 10, with a minimum of 125°C for parts retaining live parts in position and 75°C for other parts. The surface of the part to be tested is placed in the horizontal position and a steel ball of 5 mm diameter pressed against this surface with a force of 20 N.

The test load and the supporting means are placed within the heating cabinet for a sufficient time to ensure that they have attained the stabilized testing temperature before the test commences.

The part to be tested is placed in the heating cabinet, for a period of 10 min, before the test load is applied.

The surface where the ball presses should not bend, if necessary the surface shall be supported. For this purpose, if the test cannot be made on the complete specimen, a suitable part may be cut from it.

The specimen shall be at least 2,5 mm thick, but if such a thickness is not available on the specimen, then two or more pieces are placed together.

After 1 h, the ball is removed from the specimen, which is then immersed for 10 s in cold water for cooling down to approximately room temperature. The diameter of the impression is measured, and shall not exceed 2 mm.

In the event of curved surfaces, the shorter axis is measured if the indent is elliptical.

In case of doubt, the depth of the impression is measured and the diameter calculated using the formula

$$\Phi = 2\sqrt{p(5 - p)}$$

where p is the depth of impression.

The test is not made on parts of ceramic material.

12 Resistance to flame and ignition

Parts of insulating material retaining live parts in position and external parts of insulating material providing protection against electric shock are subjected to the glow-wire test in accordance with IEC 60695-2-10 and IEC 60695-2-11, subject to the following details.

- The test specimen is a complete lamp. It may be necessary to take away parts of the lamp to perform the test, but care is taken to ensure that the test conditions are not significantly different from those occurring in normal use.
- The test specimen is mounted on the carriage and pressed against the glow-wire tip with a force of 1 N, preferably 15 mm, or more, from the upper edge, into the centre of the surface to be tested. The penetration of the glow-wire into the specimen is mechanically limited to 7 mm.

If it is not possible to make the test on a specimen as described above because the specimen is too small, the above test is made on a separate specimen of the same material, 30 mm² and with a thickness equal to the smallest thickness of the specimen.

- The temperature of the tip of the glow-wire is 650 °C. After 30 s, the specimen is withdrawn from contact with the glow-wire tip.

The glow-wire temperature and heating current are constant for 1 min prior to commencing the test. Care is taken to ensure that heat radiation does not influence the specimen during this period. The glow-wire tip temperature is measured by means of a sheathed fine-wire thermocouple constructed and calibrated as described in IEC 60695-2-10.

- Any flame or glowing of the specimen shall extinguish within 30 s of withdrawing the glow-wire, and any flaming drop shall not ignite a piece of the tissue paper, spread out horizontally 200 ± 5 mm below the specimen. The tissue paper is specified in 4.187 of ISO 4046-4:2002.

The test is not made on parts of ceramic material.

13 Fault conditions

13.1 General

Lamps – dimmable and non-dimmable – shall not impair safety when operated under fault conditions which may occur during the intended use. Each of the following fault conditions is applied in turn, as well as any other associated fault condition that may arise from them as logical consequence.

13.2 Testing under extreme electrical conditions

If lamps are marked with a voltage range, the voltage at which they are tested is taken as the maximum of the voltage range marked unless the manufacturer declares another voltage as the most critical one. The lamp is switched on at ambient temperature (definition as in IEC 62504 and conditions as in Clause H.1 of IEC 61347-1:—) and adjusted to the most critical electrical conditions as indicated by the manufacturer or the power is increased until 150 % of the rated power is reached. The test is continued until the lamp is thermally stabilised. A stable condition is reached, if the lamp cap temperature does not change by