

INTERNATIONAL STANDARD

IEC
88528-11

First edition
2004-03

Reciprocating internal combustion engine driven alternating current generating sets –

Part 11: Rotary uninterruptible power systems – Performance requirements and test methods

IECNORM.COM : Click to view the full PDF of IEC 88528-11:2004



Reference number
IEC 88528-11:2004(E)

Publication numbering

As from 1 January 1997 all IEC publications are issued with a designation in the 60000 series. For example, IEC 34-1 is now referred to as IEC 60034-1.

Consolidated editions

The IEC is now publishing consolidated versions of its publications. For example, edition numbers 1.0, 1.1 and 1.2 refer, respectively, to the base publication, the base publication incorporating amendment 1 and the base publication incorporating amendments 1 and 2.

Further information on IEC publications

The technical content of IEC publications is kept under constant review by the IEC, thus ensuring that the content reflects current technology. Information relating to this publication, including its validity, is available in the IEC Catalogue of publications (see below) in addition to new editions, amendments and corrigenda. Information on the subjects under consideration and work in progress undertaken by the technical committee which has prepared this publication, as well as the list of publications issued, is also available from the following:

- **IEC Web Site** (www.iec.ch)

- **Catalogue of IEC publications**

The on-line catalogue on the IEC web site (http://www.iec.ch/searchpub/cur_fut.htm) enables you to search by a variety of criteria including text searches, technical committees and date of publication. On-line information is also available on recently issued publications, withdrawn and replaced publications, as well as corrigenda.

- **IEC Just Published**

This summary of recently issued publications (http://www.iec.ch/online_news/justpub/jp_entry.htm) is also available by email. Please contact the Customer Service Centre (see below) for further information.

- **Customer Service Centre**

If you have any questions regarding this publication or need further assistance, please contact the Customer Service Centre:

Email: custserv@iec.ch
Tel: +41 22 919 02 11
Fax: +41 22 919 03 00

INTERNATIONAL STANDARD

IEC
88528-11

First edition
2004-03

Reciprocating internal combustion engine driven alternating current generating sets –

Part 11: Rotary uninterruptible power systems – Performance requirements and test methods

IECNORM.COM : Click to view the full PDF of IEC 88528-11:2004

© IEC 2004

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

ISO/IEC Copyright Office • Case postale 56 • CH-1211 Genève 20 • Switzerland



PRICE CODE

U

For price, see current catalogue

CONTENTS

FOREWORD.....	5
1 Scope.....	7
2 Normative references.....	7
3 Terms and definitions.....	8
3.1 General.....	8
3.2 Performance of systems and components.....	9
3.3 Specified values.....	10
3.4 Input values.....	11
3.5 Output values.....	12
4 Symbols and abbreviations.....	12
5 Selection criteria.....	12
6 General description.....	13
6.1 Rotary UPS.....	13
6.2 Types of rotary UPS.....	13
6.2.1 Series connected rotary UPS.....	13
6.2.2 Line interactive rotary UPS.....	14
6.3 Parallel operation of a rotary UPS installation.....	15
6.3.1 General.....	15
6.3.2 Parallel operation.....	15
6.3.3 Redundant operation.....	15
6.4 Power system changeover with rotary UPS installations (bypass).....	16
6.5 Enclosure protection.....	16
7 Modes of operation.....	16
7.1 Power conditioning mode.....	17
7.2 Independent mode.....	17
7.3 Bypass mode.....	18
7.4 Off mode.....	18
7.5 Transitions.....	18
7.5.1 Transition 1, starting the system with mains voltage present.....	18
7.5.2 Transition 2, start-up without mains voltage (black start).....	18
7.5.3 Transition 3, disconnect from grid.....	19
7.5.4 Transition 4, connect to grid.....	19
7.5.5 Transition 6, transfer.....	19
7.5.6 Transition 7, 8, retransfer.....	19
8 Service conditions.....	19
8.1 Normal service conditions.....	19
8.2 Operation at extended ambient.....	19
8.2.1 Ambient service temperature.....	19
8.2.2 Ambient storage and transportation conditions.....	19
8.3 Engines.....	20
8.4 Rotating electrical machines.....	20
8.5 Control logic.....	20

9	Electrical service conditions and performance	20
9.1	General – all rotary UPS.....	20
9.2	Performance.....	21
10	Manufacturer technical declarations	22
10.1	General	22
10.2	Purchaser specification guidelines.....	22
10.2.1	Type of rotary UPS, additional features, and system requirements	23
10.2.2	Rotary UPS input.....	23
10.2.3	Load to be supplied from a rotary UPS	23
10.2.4	Rotary UPS output.....	24
10.2.5	Battery (where applicable).....	24
10.2.6	General application requirements and special service conditions	25
10.2.7	Multi-module system configurations	25
10.2.8	Electromagnetic compatibility	26
11	Testing	27
11.1	Static output voltage and frequency deviations.....	27
11.2	Dynamic output voltage and frequency deviations	28
11.3	Input current characteristics	28
11.4	Measurement of filter properties	28
11.4.1	From mains to output.....	28
11.4.2	From output to mains.....	30
11.5	System performance	30
11.5.1	Efficiency.....	30
11.5.2	Stored energy times	30
11.5.3	Multi-module rotary UPS performance	30
11.6	Black start test	31
11.7	Environmental tests.....	31
11.8	Audible noise	31
11.9	Testing.....	31
12	Maintenance and product marking	33
12.1	Nameplate markings.....	33
12.2	Label requirements.....	34
12.3	Name plate marker.....	34
12.4	Decals – labelling	35
12.4.1	Safety instructions and documentation	35
12.5	Maintenance.....	35
	Annex A (informative) Typical energy storage devices	36
	Annex B (normative) Reference non-linear load – Single-phase.....	40
	Annex C (normative) Reference non-linear load – Three-phase	42
	Annex D (normative) Input mains failure – Test method	43
	Annex E (informative) Types of uninterruptible power systems (UPS) configurations	44
	Figure 1 – Types of UPS systems	13
	Figure 2 – Typical example series connected rotary UPS.....	13
	Figure 3 – Typical example of a line interactive rotary UPS.....	14
	Figure 4 – Parallel operation of a rotary UPS	15

Figure 5 – Bypass operation	16
Figure 6 – Illustration of rotary UPS operation	17
Figure 7 – Operating modes.....	18
Figure 8 – Surge test	29
Figure 9 – Warning label.....	34
Figure A.1 – Dual conversion – direct-coupled flywheel	37
Figure A.2 – Line interactive – direct-coupled flywheel.....	37
Figure A.3 – Dual conversion – indirect coupled flywheel.....	37
Figure A.4 – Line interactive – indirect coupled flywheel.....	38
Figure A.5 – Double fed a.c. machine	38
Figure A.6 – Dual conversion with battery.....	38
Figure A.7 – Line interactive with battery	39
Figure B.1 – Single-phase non-linear load	40
Figure C.1 – Three-phase non-linear load.....	42
Figure D.1 – Input mains failure test method.....	43
Figure E.1 – Series connected type 1	44
Figure E.2 – Series connected type 2	45
Figure E.3 – Line interactive	45
Figure E.4 – Typical UPS.....	46
Figure E.5 – Typical switchless dual feed UPS	47
Table 1 – Compatibility levels for individual harmonic voltages in mains power	21
Table 2 – Operating steady-state limit values for performance classes	21
Table 3 – Operating dynamic limit values for performance classes (note 1).....	22
Table 4 – Technical data sheets – Manufacturers declaration	26
Table 5 – Test methods for rotary UPS performance characteristics	32

IECNORM.COM : Click to view the full PDF of IEC 88528-11:2004

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**RECIPROCATING INTERNAL COMBUSTION ENGINE DRIVEN
ALTERNATING CURRENT GENERATING SETS –**
**Part 11: Rotary uninterruptible power systems –
Performance requirements and test methods**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 88528-11 has been prepared jointly by IEC technical committee 2: Rotating machinery, and ISO technical committee 70: Internal combustion engines.

The text of this standard is based on the following documents:

FDIS	Report on voting
2/1275/FDIS	2/1280/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

The committee has decided that the contents of this publication will remain unchanged until 2007. At this date, the publication will be

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

IEC 88528-11 is integrated into the ISO 8528 series listed below, under the general title *Reciprocating internal combustion engine driven alternating current generating sets*:

- Part 1: Application, ratings and performance
- Part 2: Engines
- Part 3: Alternating current generators for generating sets
- Part 4: Controlgear and switchgear
- Part 5: Generating sets
- Part 6: Test methods
- Part 7: Technical declarations for specification and design
- Part 8: Requirements and tests for low-power generating sets (available in English only)
- Part 9: Measurement and evaluation of mechanical vibrations (available in English only)
- Part 10: Measurement of airborne noise by the enveloping surface method
- Part 12: Emergency power supply to safety services

IECNORM.COM : Click to view the full PDF of IEC 88528-11:2004

RECIPROCATING INTERNAL COMBUSTION ENGINE DRIVEN ALTERNATING CURRENT GENERATING SETS –

Part 11: Rotary uninterruptible power systems – Performance requirements and test methods

1 Scope

This International Standard, which forms part of the ISO 8528 series, specifies criteria, including performance and test methods, for rotary uninterruptible power systems (UPS) arising out of a combination of mechanical and electrical rotating machines. This standard applies to power supplies primarily designed for supplying uninterrupted a.c. power to the consumer. When operated without input mains feed, the power is provided by stored energy and/or reciprocating internal combustion (RIC) engine and the output power is provided by one or more rotating electrical machines.

This part 11 applies to a.c. power supplies primarily designed for supplying uninterruptible electrical power for stationary land and marine use, excluding supplies for aircraft, land vehicles or locomotives. It also excludes power supplies where the output power is generated by static converters. (See IEC 62040-3.)

The use of a rotary UPS installation to improve the quality of a.c. power supply, to provide voltage and/or frequency conversion, and to provide peak shaving is also described.

For some specific applications (for example, essential hospital supplies, offshore, non-stationary applications, high rise buildings, nuclear, etc.) supplementary requirements may be necessary. The provisions of this part of ISO 8528 should be used as a basis.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60034-1:2003, *Rotating Electrical Machines – Part 1: Rating and performance*

IEC 60034-22:1996, *Rotating Electrical Machines – Part 22: AC generators for reciprocating internal combustion (RIC) engine driven generating sets*

IEC 60417 (all parts), *Graphical symbols for use on equipment. Index, survey and compilation of the single sheets*

IEC 60529:1989, *Degrees of protection provided by enclosures (IP Code)*

IEC 61000, *Electromagnetic compatibility (EMC)*

ISO 3046-1:2003, *Reciprocating internal combustion engines*

ISO 7000, *Graphical symbols for use on equipment*

ISO 8178-1, *Reciprocating internal combustion engines – Exhaust emission measurement – Part 1: Test-bed measurement of gaseous and particulate exhaust emissions*

ISO 8528-1, *Reciprocating internal combustion engine driven alternating current generating sets – Part 1: Application, ratings and performance*

ISO 8528-6, *Reciprocating internal combustion engine driven alternating current generating sets – Part 6: Test methods*

ISO 8528-9, *Reciprocating internal combustion engine driven alternating current generating sets – Part 9: Measurement and evaluation of mechanical vibrations*

ISO 8528-10, *Reciprocating internal combustion engine driven alternating current generating sets – Part 10: Measurement of airborne noise by the enveloping surface method*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1 General

3.1.1

generating set

one or more RIC engines to produce mechanical energy and one or more generators to convert the mechanical energy into electrical energy together with components for transmitting the mechanical energy (for example, couplings, gearbox) and where applicable bearing and mounting components

3.1.2

uninterruptible power system (UPS)

power system for maintaining continuity of load power in the event of failure of the mains power

3.1.3

rotary UPS

UPS where one or more electrical rotating machines provide the output voltage

3.1.4

converter

set of equipment, static or rotating, to convert one type of electric current to another type, different in nature, voltage and/or frequency

3.1.5

power system reactor

regulated or non-regulated inductance in series with the input of some types of UPS

3.1.6

machine set

any combination of one or more electrical rotating machines

3.1.7

energy storage device

device to provide stored energy on failure of the normal power supply system. This energy shall be available either during the total failure time or until the take over of a power supply by the RIC engine

3.1.8

continuity of load power

availability of the power supplied to the load with voltage and frequency within steady-state and transient tolerance bands and with distortion and power interruptions within the limits specified for the load

3.2 Performance of systems and components

3.2.1

mains power

power normally continuously available which is supplied from the electrical power system or by independent electrical power generation

3.2.2

backfeed

condition where a portion of the voltage or energy available within the UPS is fed back to any of the input terminals, either directly or by a leakage path

3.2.3

linear load

load where the parameter Z (load impedance) is a constant when a variable sinusoidal voltage is applied to it and that a sinusoidal voltage causes a sinusoidal current

3.2.4

non-linear load

load where the parameter Z (load impedance) is no longer a constant but is a variable dependent on other parameters, such as voltage or time

3.2.5

power failure

any variation in the input voltage or frequency of the mains power not within acceptable limits

3.2.6

redundant operation

any operation with the addition of parallel functional units or groups of functional units in a system to enhance the availability of load power

3.2.7

power conditioning mode

stable mode of operation that the UPS finally attains when operating under the following conditions:

- normal power is present and within its given tolerance;
- full (100 %) stored energy available within its given restored energy time;
- the operation is or may be continuous;
- the load is within its given range;
- the output voltage is within its given tolerance.

Where a bypass is used:

- the input voltage is available and within specified tolerances;
- the phase lock is active, if present.

3.2.8

independent mode

operation of the UPS when operating under the following conditions:

- normal power is disconnected or is out of given tolerance;
- energy is from storage device or RIC engine;
- load is within the given range;
- output voltage and frequency are within given tolerances.

3.2.9

bypass mode

state the UPS attains when operating and the load is supplied via the bypass

3.2.10

off mode

state that the rotary UPS attains when de-energized and at rest

3.2.11

synchronization

adjustment of an a.c. power source to match another a.c. source in frequency and phase angle

3.2.12

load power

power which is supplied to the load from the UPS

3.2.13

asynchronous transfer

switching of load power between two sources that are not synchronized. This transfer must happen with an interruption

3.3 Specified values

3.3.1

rated value

value of a quantity used for specification purposes, established for a specified set of operating conditions of a component, device, equipment, or system

[IEV 151-16-08]

3.3.2

tolerance band

range of values of a quantity within specified limits

3.3.3

deviation

difference between the desired value and the actual value of a variable at a given instant

NOTE This definition applies whether the desired value is constant or varies in time.

[IEV 351-12-15]

3.3.4

rated voltage

input or output supply voltage for which equipment is designed or specified

3.3.5

rated frequency

input or output frequency as declared by the manufacturer

3.3.6

phase angle

angle (usually expressed in electrical degrees) between reference points on one or more a.c. waveforms

3.3.7

crest factor

ratio of the peak value of a periodic waveform to its r.m.s. value

3.3.8**power**

time rate of transferring or transforming energy or of doing work. (also called active power)

[IEV 111-13-30]

3.3.9**apparent power**

product of the r.m.s. voltage U between the terminals of a two-terminal element or two-terminal circuit and the r.m.s. electric current I in the element or circuit:

$$S=UI$$

[IEV 131-11-41]

3.3.10**ambient temperature**

temperature of the air or other medium where the equipment is to be used

[IEV 826-01-04]

3.3.11**total harmonic distortion**

ratio of the r.m.s. value of the harmonic content as a percentage of the r.m.s. value of the fundamental component of the periodic function

3.3.12**recovery time**

time interval between the moment a stabilized voltage or frequency leaves the steady-state tolerance band until the instant when this quantity returns to and stays within the steady-state tolerance band

3.3.13**stored energy time**

minimum time during which the UPS will ensure conditions when the normal power fails starting with the energy storage means being charged

3.4 Input values

NOTE These definitions are only valid in the power conditioning mode (normal mode).

3.4.1**input voltage tolerance**

maximum continuous input voltage variation in normal operation

3.4.2**input power factor**

ratio of the input active power to the input apparent power with the UPS operating at rated input voltages at rated output power, and fully charged storage

3.4.3**high impedance mains failure**

mains failure where the mains impedance as presented to the UPS input terminals is infinite

3.4.4**low impedance mains failure**

mains failure where the mains impedance as presented to the UPS input terminals is negligible

3.5 Output values

3.5.1

output voltage

r.m.s. value (unless otherwise specified for a particular load) of the voltage between the output terminals

3.5.2

output current

r.m.s. value of the current (unless otherwise specified for a particular load) from the output terminals

3.5.3

rated load

load for which the system is defined

4 Symbols and abbreviations

$\cos \phi$	Fundamental portion of power factor
f	Rotary UPS output frequency in Hz
P	Active power
S	Apparent power
U_r	Rated output voltage of a rotary UPS
U_c	Rectified voltage
U_{ac}	Rotary UPS output voltage (r.m.s. line-line)
Z	Load impedance

5 Selection criteria

Complete application criteria should include the following features and shall be made available by the system supplier:

- rotary UPS load requirements;
- operating time required;
- starting capability of large electric motors in the load;
- fault clearing capability;
- input power quality;
- ambient temperature;
- reliability;
- maintainability;
- required floor space;
- parallel operation requirement;
- operating efficiency;
- reduction and/or isolation of voltage harmonics and other deviations from input to output;
- reduction and/or isolation of current harmonics and other deviations from output to input;
- environmental requirements (noise, vibration, dust, electromagnetic compatibility, etc.);
- degree of separation from the mains in power conditioning mode (harmonics, full galvanic isolation, etc.).

An input switching device shall be provided to isolate the rotary UPS from the incoming mains.

Means shall be provided to prevent reverse power flow, if required.

6 General description

Types of uninterruptible power systems are shown in Figure 1.

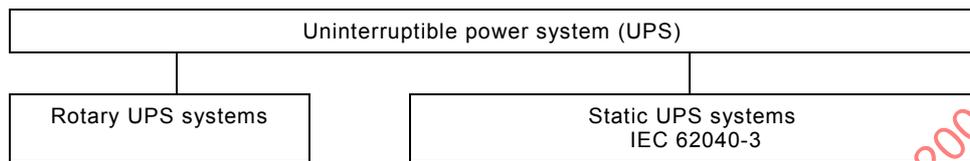


Figure 1 – Types of UPS systems

IEC 033/04

6.1 Rotary UPS

Rotary uninterruptible power supply as defined in this standard is achieved by a combination of electrical and when required RIC engines and generating sets.


In order to achieve an uninterrupted supply of power during a short interruption period, a pneumatic, kinetic, electrochemical, or other such energy storage device is used. For extended periods of operation an RIC engine or generating set may be utilized to provide the energy supply. (See ISO 8528-1, subclause 6.5.)

6.2 Types of rotary UPS

Various configurations of rotary UPS systems are possible depending upon the application and performance requirements. It is important that the configuration shall be taken into account by the customer when agreeing upon the requirements with the manufacturer.

6.2.1 Series connected rotary UPS

Figure 2 illustrates a series connected rotary UPS.

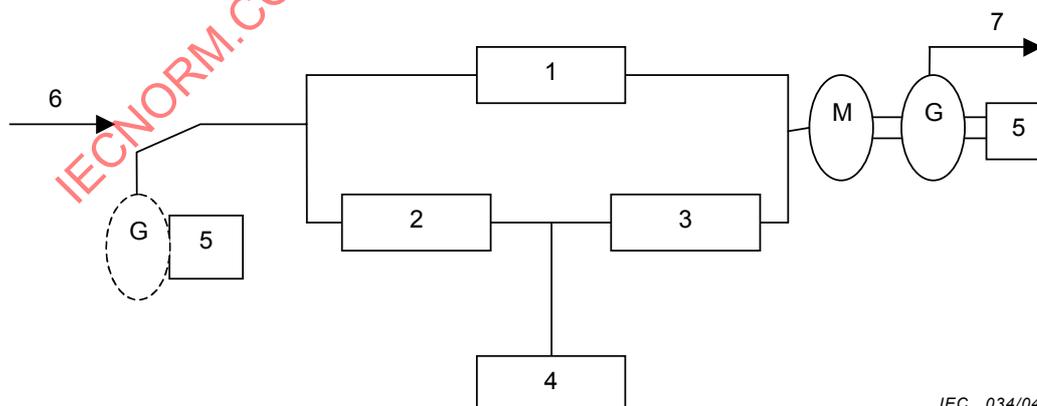

Key

1 primary path	3 inverter	5 RIC engine	7 AC output	G generator
2 rectifier	4 energy storage	6 AC input	M motor	

IEC 034/04


Figure 2 – Typical example series connected rotary UPS

In most series connected cases, two independent electrical machines (motor and generator) or a combination of both is used as the final output of the rotary UPS. In most cases the final output machine pair or combination machine is direct connected to the mains source with an alternate path to the mains through power converters allowing connection to a stored energy source. Direct connection provides higher efficiency and reduced input harmonics. Some series connected cases rely on the alternate path.

- Rotary UPS power supply to the electrical consumer is taken from the rotary UPS system, independent of whether the external power supply system is intact or has failed. In the event of a mains failure or if the power is outside the permissible tolerance limits of the input of the rotary UPS system, energy is provided from a short term stored energy source until a RIC engine can be started, if the installation is so equipped. When the installation is equipped with an engine, the required energy for continuity of the power supply to the electrical consumer is taken for a practically unlimited time from the engine (sufficient fuel supply assumed) (see also Clause 5). After restoration of the mains, supply power for the rotary UPS system is again taken from the mains system.
- The engine may be equipped with its own generator and transfer switch configured to supply power to the input of the series connected rotary UPS. The engine can also be directly connected by a clutch to the MG set of the series connected rotary UPS.
- Back feed to the mains during a short circuit of the mains or during rotary UPS transition modes must be prevented to maintain rotary UPS output power and prevent internal damage of the rotary UPS. In the series connected case with a single power path (i.e. rectifier to inverter to MG set) back feed prevention is provided by phase control of the rectifier. In series connected rotary UPS cases with a dual power path (i.e. static switch to MG set and rectifier to inverter to MG set) back feed is prevented by phase control of the sub-cycle static switch and the rectifier.
- In the series connected rotary UPS isolation protection of the consumer's load is provided by the electrical to mechanical and back to electrical power conversions of the final output MG set. The level of isolation protection depends on the MG set, insulation, air gaps, etc. The generator provides reactive power compensation and supplies the harmonics and unbalance as required by the load.
- In the event of mains failure or when exceeding the permissible tolerance limits of the electrical consumer, the power supply, practically without any interruption, will change over to short term stored energy and then to an engine when so equipped.
- Upon restoration of the stabilized mains, supply is effected synchronously and without interruption.

6.2.2 Line interactive rotary UPS

Figure 3 illustrates a line interactive rotary UPS.

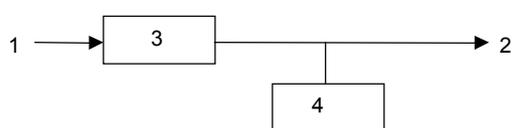

IEC 035/04

Key

- | | |
|-------------|------------------------|
| 1 AC input | 3 power system reactor |
| 2 AC output | 4 machine set |

Figure 3 – Typical example of a line interactive rotary UPS

A machine set including a generator, energy storage means and an RIC engine if so equipped, is operated in parallel with the mains system.

The energy storage and RIC engine may all be coupled on the same shaft, or realized as separate units with an indirect coupling (electrical, hydraulic, mechanical, etc.).

- Power is taken from the mains system, provided the voltage and frequency lie within the tolerance range specified for the mains system or electrical consumers.
- The rotary UPS system is also supplied with energy from the mains system. A certain degree of isolation between the mains system and the electrical consumer is achieved by means of an impedance (reactor). This is installed in the incoming feeder so that voltage deviations can be compensated to suit system requirements by the synchronous machine (s) that are connected in parallel.
- The power system reactor limits back feed in case of low impedance mains failure and allows independent control of output voltage. The generator provides reactive power compensation and supplies the harmonics and unbalance as required by the load.
- In the event of mains system failure or when exceeding the permissible tolerance limits of the electrical consumer, the power supply will change over to the synchronous converter machine or to the synchronous generator of the twin machine set.

The energy required for driving the rotary UPS is taken for either a limited time from the energy storage device or a practically unlimited time from an RIC engine (sufficient fuel supply assumed) (see also Clause 5).

Continuation of energy supply from the restored and stabilized mains is effected synchronously and without interruption.


6.3 Parallel operation of a rotary UPS installation

6.3.1 General

Rotary UPS systems may be operated in parallel to increase power output, to increase availability, or to provide redundancy.

6.3.2 Parallel operation

Parallel operation of a rotary UPS system is illustrated in Figure 4. An arrangement of rotary UPS systems of identical rating is usual.

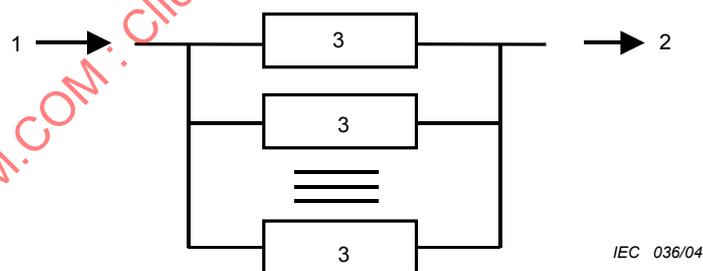

Key

1 AC input 2 AC output 3 UPS


Figure 4 – Parallel operation of a rotary UPS

6.3.3 Redundant operation

Increasing the number of active rotary UPS units by at least one active unit to ensure full supply of electrical consumers in cases of maintenance or failure of a single rotary UPS unit ($1 + n$ active redundancy).

6.4 Power system changeover with rotary UPS installations (bypass)

Bypass can be provided, to electrically isolate the rotary UPS, in case the nominal input and output frequencies are the same and where the average mains power availability is acceptable for the load. Bypass can be manual, automatic, or a combination of both. Bypass circuits may be individual or common in the case of parallel rotary UPS systems. See Figure 5.

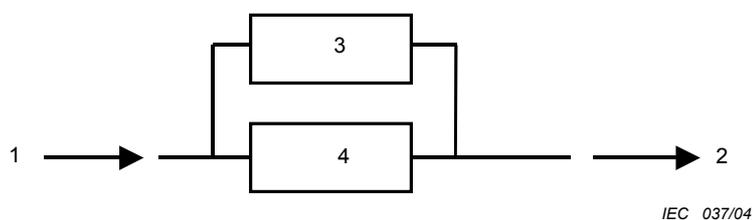

Key

- 1 AC input
- 2 AC output
- 3 rotary UPS
- 4 bypass

Figure 5 – Bypass operation

Automatic transfer of electrical consumers supply to the mains system may be provided if a fault occurs in the rotary UPS system (passive redundancy).

Transfer is effected either with or without interruption depending on the rotary UPS system design. Mainly, however, transfer is effected without interruption.


A transfer can be without interruption if a rotary UPS system and utility were synchronized, or with a short interruption if they are not synchronized. This transfer may be (temporarily) inhibited when the utility is not available or out of tolerance.

6.5 Enclosure protection

The equipment shall be provided with a surrounding case or enclosure constructed to provide a minimum degree of protection IP2X, (IEC 60529) to personnel against accidental contact with energized, hot or moving parts.

7 Modes of operation

Typical operation of a rotary UPS is shown in Figure 6.

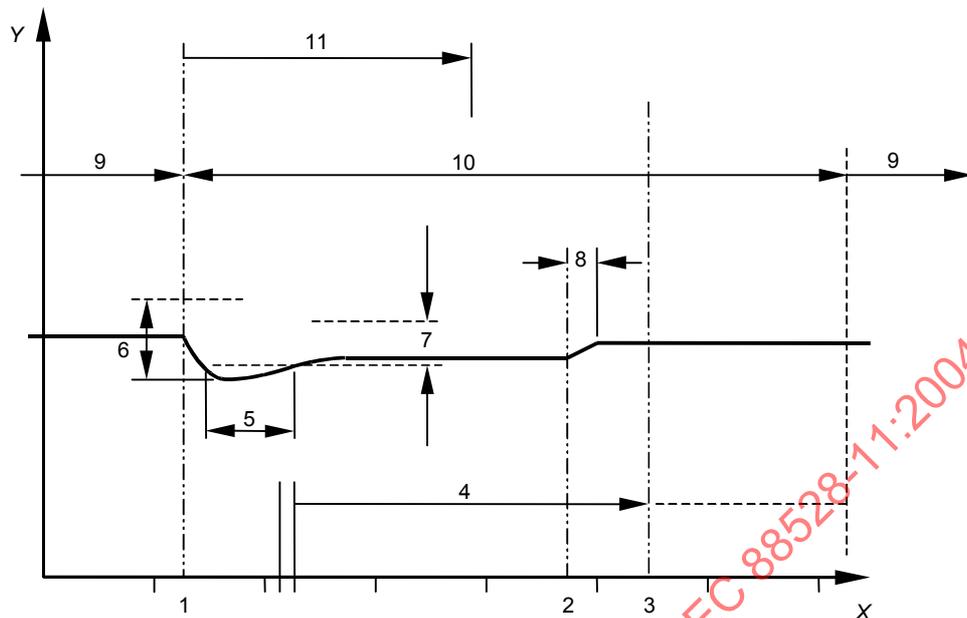

IEC 038/04

Key

1	time of power failure	6	dynamic limit values (Table 3)	11	stored energy time
2	time of power return	7	steady-state limit values (Table 2)	X	axis time t in seconds
3	time of synchronization	8	synchronization	Y	axis output voltage frequency
4	RIC engine if used	9	power conditioning mode		
5	recovery time	10	independent mode		

Figure 6 – Illustration of rotary UPS operation**7.1 Power conditioning mode**

A stable mode of operation that a rotary UPS finally attains when operating under the following conditions:

- normal power is present and within specified tolerances;
- energy storage means are being charged or fully charged;
- the operation is or may be continuous;
- the load is within its given range;
- the output voltage is within its given tolerance;
- RIC engine if provided ready to start.

7.2 Independent mode

The operation of the rotary UPS when operating under the following conditions:

- normal power is disconnected or is out of given tolerances;
- the energy is from storage device or RIC engine, if provided;
- load is within the given range;
- output voltage is within given tolerances.

7.3 Bypass mode


The state that the rotary UPS attains when operating the load supplied via the bypass supply.

7.4 Off mode

The state that the rotary UPS attains when de-energized and at rest.

7.5 Transitions

The 4 main operating modes and the 12 possible transitions are shown in Figure 7.

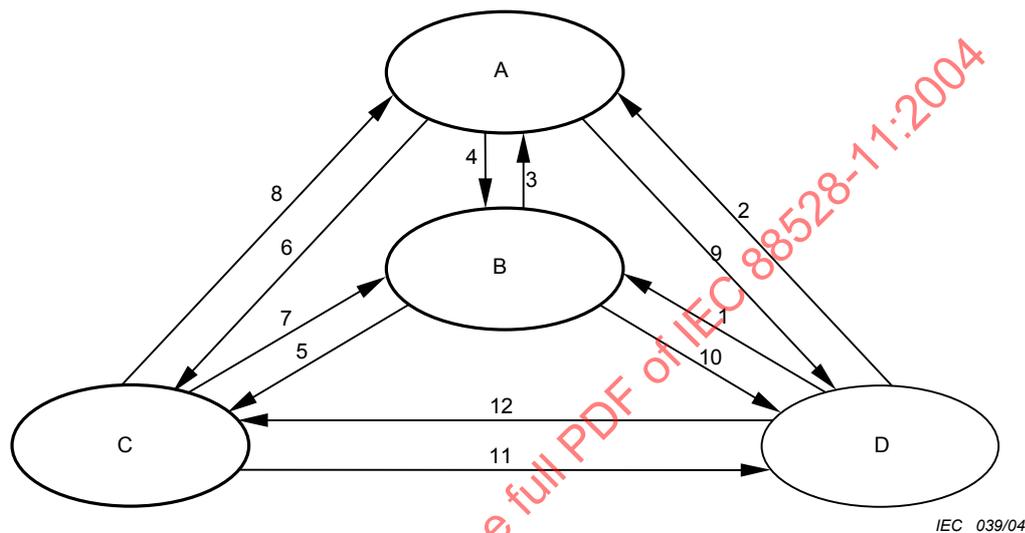

IEC 039/04

Key

- | | |
|---------------------------|---------------|
| A independent mode | C bypass mode |
| B power conditioning mode | D off mode |

Figure 7 – Operating modes

7.5.1 Transition 1, starting the system with mains voltage present

Start-up may require the RIC engine or a pony motor to bring the rotating parts to speed before energy can be taken from the grid. With mains voltage and frequency within tolerance, the system enters the power conditioning mode.

The units of a multi-module system can be started sequentially, even when the total load is more than the first unit can supply when the excess load is supplied via the bypass from the mains.

NOTE Start-up (transitions 1, 2, or 12) is at least inhibited when an emergency OFF button is active.

7.5.2 Transition 2, start-up without mains voltage (black start)

This start-up method is only useful for systems with a permanent energy source, i.e. an RIC engine. Otherwise, the independent mode could only be maintained for a limited time. Black start is the ability to start using only internal energy sources like charged batteries and fuel. Internal energy sources that cannot be maintained during at least one day in "Off" mode are assumed as discharged at the beginning of the black start. The units of a multi-module system can be started (and mutually paralleled) sequentially, but loading shall be done in steps or after a sufficient number of modules is running.

7.5.3 Transition 3, disconnect from grid

At a mains failure, the system continues supply to the critical loads in independent mode. Detection of a mains failure might be different for a low impedance mains failure (based on under voltage for instance) or for a high impedance mains failure, where voltage and frequency on the rotary UPS input terminals initially might seem OK on some systems. High impedance mains failure detection can be based on frequency change, impedance measurement or phase change. The rotary UPS might open a switch to disconnect the system from the (failed) mains.

7.5.4 Transition 4, connect to grid

After a mains return, the system is synchronized to the utility voltage and connected to it.

7.5.5 Transition 6, transfer

Load is transferred from the rotary UPS to bypass in case of overload or internal failure.

7.5.6 Transition 7, 8, retransfer

Retransfer from bypass to (normal) power conditioning mode may be automatic, for instance after maintenance or initial start. Retransfer of load from bypass to generator is generally without interruption. Retransfer requires manual intervention when the transfer to bypass was due to internal errors.

The remaining transitions are numbered in the diagram but no further explanation is given. Their implementation depends on the type of rotary UPS, and not all may be possible.

8 Service conditions

8.1 Normal service conditions

Equipment that complies with this standard shall be capable of operating up to and from 0 to 1 000 metres altitude; from 0 °C to +35 °C; and in ambient relative humidity from 20 % to 80 % (non-condensing).

8.2 Operation at extended ambient

8.2.1 Ambient service temperature

A rotary UPS according to this standard shall operate under rated conditions in a minimum temperature range from 0 °C to +35 °C. Above this range, a de-rating in rated power of 1 % per °C up to 55 °C is used.

8.2.2 Ambient storage and transportation conditions

Rotary UPS equipment according to this standard can be stored non-operating under the conditions defined in 8.2.2.1 and 8.2.2.2, if no other conditions are given by the manufacturer's instructions.

NOTE Storage duration may be limited due to recharging requirements of an included lead acid battery. The manufacturer should state these requirements on request.

8.2.2.1 Transportation/storage temperature

Rotary UPS equipment according to this standard shall be transportable in its normal shipping container, for example by aircraft or by truck, in an ambient temperature range from –25 °C to +55 °C. For stationary storage within a building, the ambient temperature range shall be from –25 °C to +55 °C. The battery manufacturer's transportation and storage instructions shall be observed.

NOTE When a battery is included which contains an electrolyte, the duration of high or low ambient temperature may be limited due to a reduction of the battery life endurance.

8.2.2.2 Relative humidity

During transports and storage of a rotary UPS in its normal shipping container, the relative humidity can range between 20 % up to 95 %, non-condensing. The shipping container must be designed adequately, unless dry ambient conditions are guaranteed. Containers not designed for wet ambient conditions shall be marked by adequate warning labels.

8.2.2.3 Special transport conditions

These conditions are to be rated by manufacturer. Conditions may include liquids draining procedures, rotor locking, risk of freezing, shock, maintenance of (e.g. vertical) position, battery handling, etc.

8.3 Engines

Engines shall be rated according to ISO 3046 and ISO 8528-1 standard power. Engines employed for rotary UPS systems are designed to extend the bridging time in conjunction with stored energy devices as described in Annex A.

The practically unlimited bridging time is dependent on

- fuel supply;
- lubrication oil supply;
- maintenance interval.

8.4 Rotating electrical machines

Rotating electrical machines shall comply with IEC 60034-1 and IEC 60034-22.

8.5 Control logic

The rotary UPS system shall include necessary control devices to operate in all functional modes and transitions between these modes, within the specified tolerances of Tables 2 and 3.

9 Electrical service conditions and performance

9.1 General – all rotary UPS

Rotary based UPS offer the potential to provide additional fault clearing current capacity. To capitalize on this feature, the user should consider the sub-transient reactance of the output of the rotary UPS and the ability of the particular design to sustain this fault clearing capability for coordination with the particular load circuit protective devices used.

The output voltage waveform shall comply with the minimum requirements given in Clause 4 of IEC 61000-2-2 or Table 1 of IEC 61000-2-12 for linear load and up to a specified amount of non-linear load as defined in Annexes B and C. See Table 1.

Table 1 – Compatibility levels for individual harmonic voltages in mains power

Odd harmonics non-multiple of 3		Odd harmonics multiple of 3		Even harmonics	
Harmonic order <i>n</i>	Harmonic voltage %	Harmonic order <i>n</i>	Harmonic voltage %	Harmonic order <i>n</i>	Harmonic voltage %
5	6	3	5	2	2
7	5	9	1,5	4	1
11	3,5	15	0,3	6	0,5
13	3	21	0,2	8	0,5
17	2	>21	0,2	10	0,5
19	1,5			12	0,2
23	1,5			>12	0,2
25	1,5				
>25	$0,2 + 0,5 \times 25/n$				

Rotary UPS complying with this standard shall be marked and supplied with instructions for the installation and operation of the rotary UPS controls and indications.

9.2 Performance

The electrical performance of a rotary UPS shall comply with Table 2 and Table 3.

Rotary UPS systems depend upon the application. This subclause defines four performance classes and operating limit values for them, see ISO 8528-1.

Class G1 – basic lighting and controls;

Class G2 – similar to utility with small excursions, pumps, fans, hoists;

Class G3 – computers, telecommunication, and other sensitive loads;

Class G4 – special application.

The following limit values apply for any combination of

- temperature within normal operating limits;
- mains within steady-state operating limits;
- no load to rated load at rated power factor;
- single or multi-module systems.

Table 2 – Operating steady-state limit values for performance classes

Class		Frequency ^{a)}	Voltage ^{b)}
G1	Basic lighting and controls	±4 %	±8 %
G2	Similar utility lighting, pumps, fans, hoists	±2 %	±4 %
G3	Computers, telecommunication	±1 %	±2 %
G4	Special applications	AMC	AMC

AMC: Agreement between manufacturer and customer.

a) Not including current compensation.

b) Ten seconds running average of the 3 line r.m.s. values.

Table 3 – Operating dynamic limit values for performance classes (note 1)

Class		Sudden phase shift	Frequency (note 3)	Voltage (note 2)	Recovery time
G1	Basic lighting and controls	No limit	±5 Hz	±30 %	5 s
G2	Similar utility lighting, pumps, fans, hoists	No limit	±3 Hz	±22 %	1 s
G3	Computers, telecommunication	2 %	±1 Hz	±15 %	0,7 s
G4	Special applications		AMC	AMC	AMC

NOTE 1 Transient values after

- change of load from 5 % to 100 % and vice versa in power conditioning mode;
- change of load from 5 % to 100 % and vice versa in independent mode;
- at mains failure and return;
- at transfer to, and retransfer from bypass, provided the bypass supply is at its nominal values;
- and during the addition/removal of one unit in case of redundant multi-rotary UPS system.

NOTE 2 Transient voltage lower limit applies from 10 ms after creation of a fused load fault when applicable.

NOTE 3 Frequency slewing rate outside the steady-state tolerance band should not be more than twice the transient frequency deviation limit per second in either direction (10 cycle average). Additionally, the duration of successive cycles should not differ by more than 2 % for class 3 in power conditioning and independent modes of operation.

AMC: Agreement between manufacturer and customer.

The output voltage distortion for all classes shall be less than the values stated in Table 3 for linear load, and up to a specified amount of reference for non-linear load.

Class G4 special application

Performance of class 4 applications is subject to agreement between manufacturer and customer. The agreement can include other tolerance limits or other conditions under which they apply.

10 Manufacturer technical declarations

10.1 General

The manufacturer shall declare the following list:

- net electrical output;
- output quality level (see G1, G2, G3, G4 of 9.2);
- net efficiency in power condition mode and stored energy mode at rated load, see 8.2.2;
- essential auxiliaries;
- battery recharge interval (if included) or restored energy time.

10.2 Purchaser specification guidelines

A variety of rotary UPS are available to meet the users requirements for continuity and quality of power to different types of loads over a wide range of power from less than one hundred watts to several megawatts.

This has been compiled to assist purchasers identify criteria important to his application or information that may be requested by the manufacturer/supplier in order to advise the appropriate type of rotary UPS for a given application.

Additionally, it identifies the performance characteristics to be supplied by the manufacturer/supplier for a rotary UPS in conformance with the requirements of this standard, together with any performance or operational limitations.

The items listed below are intended as a checklist to assist a purchaser to choose the type of rotary UPS which best meets his needs, and to specify it adequately in conjunction with the manufacturer/supplier.

10.2.1 Type of rotary UPS, additional features, and system requirements

- a) Single
- b) Multi-module (see 10.2.7 for additional information)
- c) Bypass to prime or stand-by power system
- d) AC generator stand-by power system (if applicable)
- e) Required bypass transfer time (if applicable)
- f) Galvanic separation required between input and/or d.c. link and/or output
- g) Earthing of input and/or d.c. link and/or output
- h) Maintenance bypass circuits and other installation requirements, such as rotary UPS system isolators and tie switches
- i) Compatibility with intended power system (i.e. earthed neutral, floating neutral)
- j) Remote emergency power off (EPO) or emergency stop requirements

10.2.2 Rotary UPS input

For prime power system and (if any) stand-by power system:

- a) nominal input voltage and voltage tolerance band desired;
- b) number of phases and requirements for neutral lines;
- c) nominal input frequency and tolerance band desired;
- d) special conditions regarding, for example, super imposed harmonics, transient voltages, supply impedance, etc.;
- e) limitations regarding, for example, inrush currents, harmonic currents, etc.;
- f) stand-by power system rating;
- g) supply protection requirements (short-circuit overload, earth faults).

10.2.3 Load to be supplied from a rotary UPS

- a) Type – examples:
 - computers;
 - motors;
 - saturating transformer power supplies;
 - diode rectifiers;
 - thyristor rectifiers;
 - switched type power loads and other types of loads
- b) Continuous apparent power and power factor requirements
- c) Single and/or three-phase loads
- d) Inrush currents
- e) Start-up procedure

- f) Special features of loads, such as operating duty, unbalance between phases and non-linearity (generation of harmonic currents)
- g) Branch-circuit fuse and breaker ratings
- h) Maximum step load and load profile
- i) Required method of connection of loads to the rotary UPS output

Information Notes – Rotary UPS output loading

The diversity of types of load equipment and their relevant characteristics are always changing with technology. For this reason, the rotary UPS output is characterized by loading with passive reference loads to simulate, as far as is practical, the expected load types, but it cannot be taken that these are totally representative of the actual load equipment in a given application.

The rotary UPS industry has generally specified rotary UPS output characteristics under conditions of linear loading, i.e. resistive or resistive/ inductive. Under present technology, many loads have a non-linear characteristic due to power supplies of the rectifier capacitor type either single or three-phase (see annex C).

The effect on the output of the rotary UPS by non-linear loads in both steady-state and rotary is, in many cases, to cause deviation from the output characteristic specified by the manufacturer/supplier where these are quoted under linear load conditions due to

- a) the higher peak to r.m.s. steady-state current values, the output voltage total harmonic distortion may be increased beyond the stated limit. Compatibility with the load for higher levels of THD is a matter of agreement between manufacturer/supplier and purchaser.
- b) application of non-linear load steps may result in a deviation from the linear dynamic voltage characteristics due to high transient inrush currents relative to steady-state, especially where the rotary UPS employs electronic current limiting in normal mode of operation. This effect also applies to switching of transformers and other magnetic devices due to magnetic remanence.

These effects of high transient inrush currents on the load voltage may be tolerable where the load is sequence switched and are the first applied or may have no deteriorative effect on the loads already running.

Some rotary UPS topologies use the a.c. input supply/bypass for this purpose to permit economic sizing of the rotary UPS system. Equally, while single units may not tolerate these load steps within the specification, in multi-module or redundant systems, the total system response is acceptable.

Load voltage and frequency sensitivity, where the load is sensitive to frequency variation beyond normal mains limits or is sensitive to voltage variation or distortion of the supply waveform, the choice of the best rotary UPS topology for these applications should be investigated.

The advice of the manufacturer/supplier should be sought in respect of these matters.

10.2.4 Rotary UPS output

- a) Rated output power and power factor
- b) Number of phases
- c) Rated output voltage, steady-state and transient tolerance bands
- d) Nominal output frequency and tolerance band
- e) Special requirements regarding, for example, synchronization, relative harmonic content and modulation
- f) Voltage adjustment range
- g) Phase angle tolerance allowed (for three-phase or for single-phase centre tapped and single-phase rotary UPS supplied from two of a three-phase system)
- h) Unbalanced load capability required (for three-phase or for single-phase centre tapped and single-phase rotary UPS supplied from two of a three-phase system)
- i) Coordination between rotary UPS and load protective devices
- j) Supply protection requirements (short circuit, overload, earth faults)

10.2.5 Battery (where applicable)

- a) Type of battery/batteries and construction
- b) Nominal voltage, number of cells, ampere hour capacity (if supplied by purchaser)
- c) Rated stored energy time
- d) Rated restored energy time

- e) Battery service life required
- f) Presence of other loads on battery and their voltage tolerances
- g) Availability of separate battery rooms
- h) Battery protection and isolation devices
- i) Special requirements regarding, for example, ripple current
- j) Temperature of battery room installation (recommended 20 °C to 22 °C)
- k) Battery cut-off voltage
- l) Temperature compensated charging voltage

10.2.6 General application requirements and special service conditions

- a) Efficiency at rated load conditions:

the efficiency is the ratio of the net useful output power of the rotary UPS system to the total input power. To allow comparison, it is measured and specified in a steady-state under average climatic conditions. Efficiency is an economic or thermal parameter, and only of interest in those operating modes that can exist for more than 15 min with fully charged energy storage devices. The power consumption of all auxiliary systems needed to perform the normal task of the rotary UPS system is part of the losses. Eventual heating or air conditioning systems needed for wider climatic conditions are excluded. If energy is recovered, i.e. from exhaust gas or cooling water, it is a part of the net output power of the system

- b) Ambient temperature range of operation
- c) Cooling system (rotary UPS and battery installation)
- d) Instrumentation (local/remote)
- e) Remote control and monitoring system
- f) Special environmental conditions: equipment exposed to fumes, moisture, dust, salt, air, heat, etc.
- g) Special mechanical conditions: exposure to vibration, shocks or tilting, special transportation or storage conditions, limitations to space or weight
- h) Performance limitations regarding, for example, electrical and audible noise
- i) Future extensions of the rotary UPS system
- j) Crest factor

NOTE When applied to the load current of a UPS, one could say that the crest factor is solely a property to the load. In practice, this load crest factor is a result of both the load and the internal impedance of the source that supplies it. For instance, the same non-linear load can have a crest factor as high as 4 when supplied by a pure sinusoidal voltage from a stiff grid via the bypass, or only 2 when supplied by a rotary UPS. The (non-linear) load current shows short peaks centred at or around the peaks of the a.c. voltage at which time the d.c. side capacitors are charged. When supplied by a UPS, the output impedance of the UPS prevents such narrow peaks, and broader and lower current peaks will result having a lower crest factor.

10.2.7 Multi-module system configurations

- a) Redundant rotary UPS
- b) Non-redundant rotary UPS
- c) Common system battery
- d) Separate module batteries
- e) Type of rotary UPS switches
- f) Configuration of rotary UPS switches

10.2.8 Electromagnetic compatibility

- a) Required emission standard and level category to which equipment shall comply
- b) Applicable immunity standards and test level of which the equipment shall comply

Table 4 – Technical data sheets – Manufacturers declaration

Characteristic of equipment	Manufacturers declared values
Electrical output characteristics – steady-state characteristics – power conditioning mode and stored energy mode	
Rated output voltage V r.m.s.
Voltage adjustment class V
Output frequency (nominal) Hz
Rated output apparent power kVA
Rated output active power across linear load kW
Rated output active power sinusoidal kW
Short circuit capability % of full load running	See separate declaration
Overload capability	See separate declaration
Rated load power factor permitted – linear load PF
Number of output phases
Number of output leads
Maximum phase angle variation (multi-phase only) Degrees
Continuous unbalanced load capability%
Output volts – DC component, linear load V
Electrical output characteristics – dynamic characteristics – power conditioning mode and stored energy mode (required class G4 only)	
Output voltage dynamic variation during transfer power conditioning/stored energy mode of operation and vice versa	See separate declaration
Output voltage dynamic variation due to load changes	See separate declaration
Slew rate Hz/s
Inrush current A
Electrical output characteristics – dynamic characteristics – stored energy mode	
Efficiency input/output%
Synchronization (if applicable)	
Mains matching synchronizer	Yes..... No
Stored energy mode of operation	
Duration of maximum permitted stored energy time at rated load seconds/minutes/hours
Stored energy time (for integral batteries) minutes at rated load
Restored energy time to 90 % charge (for integral battery) hours
Battery rating and quantity (for integral battery) x cells
Battery recharge profile	See separate declaration
Battery cut-off voltage V

Table 4 (continued)

Characteristic of equipment	Manufacturers declared values
Control and monitoring signals	
See separate declaration for complete list of indications and remote alarm/monitoring or interface devices	
Bypass characteristics	
Type of bypass	Manual <input type="checkbox"/> Automatic <input type="checkbox"/>
Mechanical/static	Mechanical <input type="checkbox"/> Static <input type="checkbox"/>
No break transfer/break transfer	No Break <input type="checkbox"/> Break <input type="checkbox"/>
Break time/make timemsms
Maintenance bypass	Yes <input type="checkbox"/> No <input type="checkbox"/>
Bypass protection fuse/circuit breakerRating
Galvanic isolation fitted	Yes <input type="checkbox"/> No <input type="checkbox"/>
Electromagnetic compatibility	
Immunity	State relevant National/International Standard and test levels
Emission	State relevant National/International Standard and class
Conducted a.c. mains	See separate declaration
Conducted a.c. outputdB
Radiated – Electric field	
Radiated – Magnetic field	
Input harmonic currents	
Attenuation of mains borne radio frequency – input to output	

11 Testing

The following test methods are proposed for all performance tests.

Tests to demonstrate compatibility with safety and EMC standards are subject to local regulations and are not included within this list. (See ISO 8528-6.)

Type test or routine test is under consideration.

Unless otherwise stated, rated load is linear and symmetric, at rated power factor. Testing shall be done at ambient conditions between 15 °C to 25 °C. If the rated power factor is not declared, then power factor 0,8 shall be used. Unless otherwise stated, all tests apply for single units.

11.1 Static output voltage and frequency deviations

All 3 output line r.m.s. voltages and the output frequency shall be measured in the following situations, and compared to the steady-state values of the table:

- a) resulting from steady-state voltage or frequency deviations from the mains;
- b) resulting from variations of load:
 - symmetric linear load 0 %, 25 %, 50 %, 75 % and 100% rated load at rated power factor;

NOTE If not stated, then power factor 0,8 should be assumed.

- unbalanced load;

disconnect one of the three line connections from a rated, symmetric, resistive load, and measure the resulting output voltage unbalance.

NOTE The remaining load is connected line-line for a rotary UPS system without neutral, or two times line-neutral for a system with a neutral connection. Note that the line currents in both cases are less than their rated values, and have different power factors.

- non-linear load;
 - overload.
- c) efficiency;
- d) output waveform distortion;
- e) steady-state non-linear load.

Measure the steady-state harmonic components of the rotary UPS output voltage at 50 % and 100 % linear load, both line-line and line-neutral (low voltage if applicable).

11.2 Dynamic output voltage and frequency deviations

Output voltage and frequency shall be observed during the following tests. For three-phase systems without neutral, the line voltages shall be recorded for three-wire + neutral systems at recording divided by $\sqrt{2}$, or the real r.m.s. value per half cycle shall be used as the r.m.s. value. The frequency measurement shall use a frequency-to-voltage converter capable of measuring the frequency of each individual cycle, or at least the running average frequency over the last 5 cycles.

11.3 Input current characteristics

In power conditioning mode, at nominal mains voltage, at rated load, and with fully charged energy storage device.

- Input current harmonics

If the system has more than one power path, the input current harmonics shall be measured in all power path modes that can occur for more than 5 s.

- Input power factor
- Back feed

The voltage on the input terminals of the rotary UPS shall be recorded after a high impedance mains failure.

- Inrush current

11.4 Measurement of filter properties

11.4.1 From mains to output

The rotary UPS is in power conditioning mode without load or with light resistive load.

11.4.1.1 Voltage harmonics

Step 1: measure the input and output voltage harmonics. Measure at least the fifth and seventh harmonic in the line-line voltages, and if the rotary UPS has a neutral, also the third harmonic in the line-neutral voltages;

Step 2: connect enough rectifier load, as in Annex C, in parallel with the input terminals of the rotary UPS to at least double the level of input voltage harmonics to the rotary UPS. Then measure the same harmonics as in step 1;

Step 3: calculate the increase in magnitude per harmonic on the input side;

Step 4: calculate the increase in magnitude per harmonic on the output side. The filtering is the result of step 4 as a percentage of the result of step 3.

Example: step 1 shows a 5th harmonic voltage component of 5 V r.m.s. in the input, and 2 V on the output. In step 2, the input 5th harmonic was 10 V, and the output is now 2,2 V r.m.s. The attenuation is $((2,2 - 2,0)/(10 - 5)) \times 100 \% = 4 \%$.

11.4.1.2 Surges and transients


In order to isolate the applied surges to the input of the rotary UPS from the mains, a series impedance is required. The voltage drop over a suitable sized series inductor is approximately 5 % at the rated rotary UPS input current. For large systems, this impedance might be present in the feeder system.

Surges can be applied:

- between lines;
- from one line to neutral;
- or between ground and all input lines, including the neutral.

The test surge can be made in the following ways:

- first, the test surge can be made by creating a short circuit on the input side of the rotary UPS. The trapped energy in the upstream inductor produces a voltage surge when the fuse is blown. The typical surge has a rise time of approximately 0,3 ms and a peak value of 500 V;
- the test surge can also be made with a capacitive coupled standard surge generator. A typical pulse has a rise time of 1,2 μ s to a peak value of 2,5 kV, and a decay of 50 μ s. The coupling capacitor shall be large enough to conduct the pulse, yet small enough to limit line frequency infeed to the pulse generator.

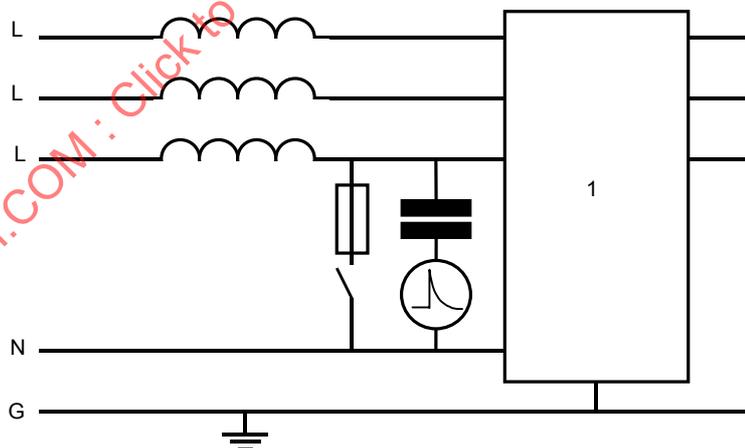

IEC 040/04

Key

L line	G ground
N neutral	1 UPS under test

Figure 8 – Surge test

The waveform on the input and on the corresponding output lines shall be recorded, and the maximum deviation from the (normal) sine wave is noted. The attenuation of the rotary UPS is the ratio of these maximum deviations on the input to output side of the rotary UPS.

11.4.2 From output to mains

The rotary UPS system in power conditioning mode reduces or eliminates the back feed of harmonic current components into the mains that originate from non-linear loads on the output of the rotary UPS. The rotary UPS is in power conditioning mode with non-linear load. The active power P taken by this load shall be at least 30 % of the rotary UPS rated active power. The measurement procedure for the input current harmonics is line current harmonics.

11.4.2.1 Line current harmonics

- Step 1: measure the input current harmonics and output current harmonics with the non-linear load. (see above);
- Step 2: measure the input current harmonics with a linear load of equal active power P ;
- Step 3: calculate the difference in input current harmonics between steps 1 and 2. The attenuation is this difference divided by the output current harmonics of step 1.

11.4.2.2 Neutral line current harmonics

Same for neutral line. Use 3 single-phase non-linear loads from Annex C.

11.5 System performance

11.5.1 Efficiency

Measure at load steps 0 %, 25 %, 50 %, 75 % and 100 % with stored energy fully charged, 25 % and 75 % are type tests. Efficiency shall be stated:

- Power conditioning mode efficiency

Measure with a linear symmetric load and at nominal mains voltage.

- Stored energy mode efficiency (fuel consumption)

11.5.2 Stored energy times

- Stored energy discharge time
- Stored energy recharge time

11.5.3 Multi-module rotary UPS performance

Such performance is applicable for parallel operating multi-module rotary UPS systems. The test is performed with at least two units in parallel operation with a linear symmetric load of at least 1,5 times the rated load of a single unit. All tests shall be done in power conditioning and in independent mode:

- Variation of voltage and frequency with load

Measure by switching on/off the load.

- Active load sharing

Record the lowest and highest active load per unit.

- Reactive load sharing

Record the lowest and highest reactive load per unit.

- Single unit failure test (if the system has a parallel redundancy)

Load short-circuit test. This is basically the same test as for a single unit. However, recovery is more critical as generators may lose mutual synchronism during the load fault.

11.6 Black start test

The ability of the rotary UPS system to start with no other power sources than the fuel and the starter battery (and an electronics battery if applicable). Black start is tested without load.

11.7 Environmental tests

- RIC engine start test at low temperature (see ISO 8528-1, subclause 14.1)
- RIC engine rated power test at the upper limit of ambient temperature that the RIC engine will operate
- RIC engine exhaust emission measurement according to ISO 8178-1
- Measurement and evaluation of mechanical vibrations of the RIC engine and any rotating electrical machine according to ISO 8528-9.

11.8 Audible noise

Measurement of airborne noise according to ISO 8528-10 at 0 % and 100 % load

- In power conditioning mode
- In independent mode

11.9 Testing

See Table 5 for a summary of testing.

IECNORM.COM : Click to view the full PDF of IEC 88528-11:2004

Table 5 – Test methods for rotary UPS performance characteristics

Measured rotary UPS characteristic	Routine	Type test	Request only	Clause
Static output voltage and frequency deviations				
Resulting from steady-state V or f deviations of the mains			×	11.1
Resulting from variations of the load		×		11.1
Symmetric, linear load	×			11.1
Unbalanced load		×		11.1
Non-linear load		×		11.1
Overload	×			11.1
Efficiency	×			11.1
Output waveform distortion	×			11.1
Steady-state non-linear load		×		11.1
Dynamic output voltage and frequency deviations				
Resulting from variations of the load	×			11.2
Resulting from changes in operational mode		×		11.2
Change from power conditioning to stored energy mode	×			11.2
With a high impedance mains failure	×			11.2
With a low impedance mains failure		×		11.2
Change from stored energy to power conditioning mode	×			11.2
Change from power conditioning to bypass mode	×			11.2
Change from bypass to power conditioning or stored energy mode	×			11.2
Resulting from load side faults		×		11.2
Single phase fault		×		11.2
Three-phase fault		×		11.2
Input current characteristics				
Input current harmonics		×		11.3
Input power factor		×		11.3
Back feed		×		11.3
Inrush current (magnet and stators)			×	11.3
Measurement of filtering properties				
From mains to output			×	11.4.1
Voltage harmonics			×	11.4.1.1
Surges and transients			×	11.4.1.2
From output to mains			×	11.4.2
Line current harmonics		×		11.4.2.1
Neutral line current harmonics		×		11.4.2.2
System performance				
Efficiency at rated load	×			11.5.1
Power conditioning mode efficiency	×			11.5.1
Stored energy mode efficiency (fuel consumption)			×	11.5.1

Measured rotary UPS characteristic	Routine	Type test	Request only	Clause
Stored energy times				
Stored energy charge time	×			11.5.2
Stored energy recharge time	×			11.5.2
Stored energy discharge time	×			11.5.2
Multi UPS performance				
Active load sharing	×			11.5.3
Reactive load sharing	×			11.5.3
Single unit failure test	×			11.5.3
Redundancy test	×			11.5.3
Black start test (if applicable)	×			11.6
Environmental tests				
RIC engine start test at low temperature			×	11.7
RIC engine rated power test at the upper limit of ambient air temperature			×	11.7
Measurement of mechanical vibrations		×		11.7
Measurement of RIC engine exhaust emissions			×	11.7
Audible noise				
Measurement of airborne noise in power conditioning mode		×		11.8
Measurement of airborne noise in stored energy mode		×		11.8

12 Maintenance and product marking

12.1 Nameplate markings

The manufacturer shall provide nameplate markings to include the following minimum information in accordance with IEC 60034-1:


- a) supplier's name;
- b) model and/or part number designation or both;
- c) serial number and or control number;
- d) rated input voltage (input voltage tolerance);
- e) rated input current;
- f) rated input frequency;
- g) rated output voltage;
- h) rated output frequency;
- i) rated output current;
- j) rated output power and output kVA;
- k) rated d.c. input voltage (required for rotary UPS with external battery);
- l) rated d.c. input current (required for rotary UPS with external battery);
- m) rated d.c. input voltage (optional for rotary UPS with internal battery);
- n) rated d.c. input current (optional for rotary UPS with internal battery);
- o) weight (optional);
- p) performance class.

12.2 Label requirements

Warnings and instructions shall NOT be mixed. The warning label shall:

- a) state the hazard;
- b) be conspicuous, clear, and concise;
- c) describe the severity of the potential harm;
- d) instruct the user how to avoid the hazard;
- e) be permanently affixed to the product.

As a minimum, the electric shock can kill information shown in Figure 9, or its equivalent shall be placed on the rotary UPS.

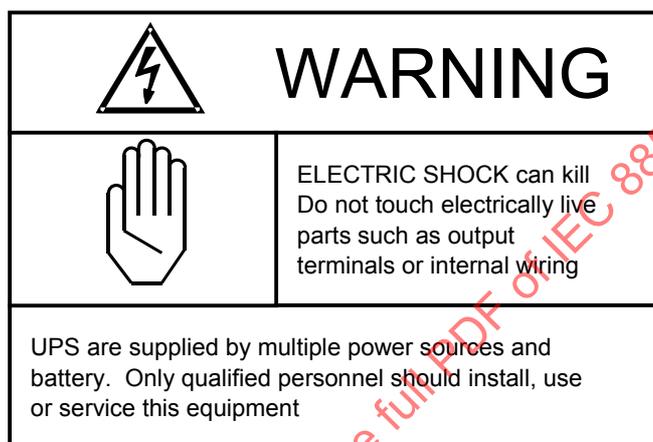

IEC 041/04

Figure 9 – Warning label

12.3 Name plate marker

Equipment shall be provided with markings in order to specify:

- a) input supply requirements;
- b) output supply ratings.

For equipment intended to be installed by anyone other than service personnel, the markings shall be readily visible either in an operator access area or shall be located on an outside surface of the equipment. If located on an outside surface of fixed equipment, the marking shall be discernible after the equipment has been installed as in normal use.

Markings that are not visible from the outside of the equipment are considered to be in compliance if they are directly visible when opening a door or cover. If the area behind a door or cover is not an operator access area, a readily visible marker should be attached to the equipment to clearly indicate the location of the marking where the equipment is operator installable. It is permitted to use a temporary marker.

The markings of input and output shall include the following:

- c) rated voltage(s) or rated voltage range(s), in V for line/line and/or line/neutral values;

The voltage range shall have a hyphen (-) between the minimum and maximum rated voltages. When multiple rated voltages or voltage ranges are given, they shall be separated by a "/".

NOTE Some examples of rated voltage markings are: rated voltage range: 220 V-240 V. This means that the equipment is designed to connect to any supply having a nominal voltage between 220 V and 240 V.

Multiple rating voltage: 120/220/240 V. This means that the equipment is designed to connect to a supply having a nominal voltage of 120, 220, or 240 V, usually after internal adjustment.

- d) rated frequency or rated frequency range, in Hz.
- e) rated current, in A.

For equipment with multiple rated voltages, the corresponding rated currents shall be marked so that the different current ratings are separated by a solidus (/) and the relation between rated voltage and associated rated current appears distinctly.

Equipment with a rated voltage range shall be marked with either the maximum rated current, or with the current range:

- number of phases (1 ϕ – 3 ϕ) with or without neutral;
- output rated active power, in W or kW;
- output rated apparent power, in VA or kVA;
- maximum ambient operating temperature range (optional);
- stored energy time, in minutes or hours at an ambient temperature of 25 °C and rated active power (only for built-in batteries) (optional);
- manufacturer's name, trade mark or identification mark;
- reference to this standard;
- manufacturer's model or type reference.

Where symbols are used, they shall conform to ISO 7000 and IEC 60417, where appropriate symbols exist.

12.4 Decals – labelling

The following instruction shall appear near to the point of connection:

'SEE INSTALLATION INSTRUCTIONS BEFORE CONNECTING TO THE SUPPLY.'

12.4.1 Safety instructions and documentation

If it is necessary to take special precautions to avoid the introduction of hazards when operating, installing, maintaining, transporting or storing rotary UPS, the manufacturer shall make available the necessary instructions.

The operating instructions shall be made available to the user.

NOTE 1 Such special precautions may be necessary, for example, d.c. connection of the equipment to the battery and the interconnection of separate units, if any.

NOTE 2 Where appropriate, installation instructions should include reference that national wiring rules may override these instructions.

NOTE 3 Maintenance information is normally made available only to service personnel.

12.5 Maintenance

Means shall be provided to isolate the rotary UPS from input, output, and bypass. Means shall also be provided to electrically isolate batteries, if provided. Means shall be provided to verify that the machine is at rest for service purposes.

Annex A (informative)

Typical energy storage devices

A.1 Energy storage devices

The machine set is the central component of dynamic UPS installations. Depending on its rotating parts, it stores energy, which can be delivered in the form of power within milliseconds. The duration of power output can be extended by a limited amount by adding energy storage devices like a flywheel or batteries. Power output capability can be extended for almost unlimited time by combination with an RIC engine.

Items to be taken into account when designing the energy storage devices for UPS installations are:

- power increase/power change (where applicable: in steps);
- allowed frequency deviation;
- allowed recovery time;
- installed inertia of electrical machines, clutches, and RIC engine if applicable;
- required back-up time.

A.2 Kinetic energy storage devices

Kinetic energy is stored in a flywheel. High-speed flywheels (10 000 to 50 000) rpm provide low torque during a relatively long time, whereas low speed flywheels (1 000 to 5 000) rpm can provide high torque during a short time, in the order of a few seconds and therefore are better matched to the use in rotary UPS systems.

Kinetic energy storage devices can be used in dual conversion UPS (where the energy flow in normal mode is converted twice into and from an intermediate form of energy), and in line interactive UPS, where the main energy flow is normally not converted. Where applicable, both solutions are shown in the following figures.

All systems can be combined with an RIC engine, either directly coupled to the generator, or as a separate diesel-generator set replacing the mains on the a.c. input side. Flywheel systems may include a pony motor to bring the speed of the shaft(s) near synchronous speed, or to charge the flywheel, or both.

Diesel engine, pony motor(s) and bypass circuits are not shown in the figures below.

A.2.1 Hard coupled flywheel storage

Rotary UPS systems with hard coupled flywheel are the simplest ones. The output frequency is proportional with the flywheel speed in stored energy mode when a normal generator is used. The allowed frequency deviation limits the speed variation of the flywheel so that only a small fraction of its stored energy can be used. During a power failure, the a.c. input must be disconnected from the grid to prevent back feed.

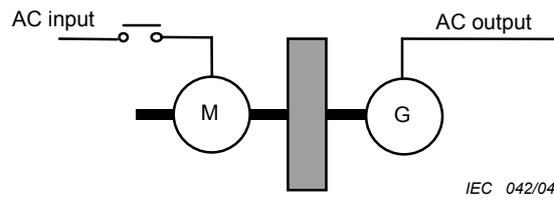


Figure A.1 – Dual conversion – direct-coupled flywheel

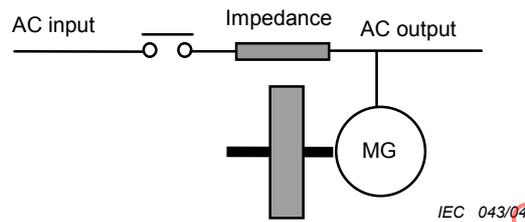


Figure A.2 – Line interactive – direct-coupled flywheel

A.2.2 Indirect coupled flywheel storage

When the flywheel is coupled to the motor/generator by a controlled ratio transmission, then much more of the flywheel energy can be used, even with negligible frequency variation on the output of the UPS.

Examples for a variable ratio transmission are:

- a coupling with electromagnetic controlled-slip between flywheel and generator shaft;
- synchronous motors coupled by a static frequency converter;
- hydraulic motors coupled by a high pressure hydraulic link;
- a continuous variable transmission (CVT).

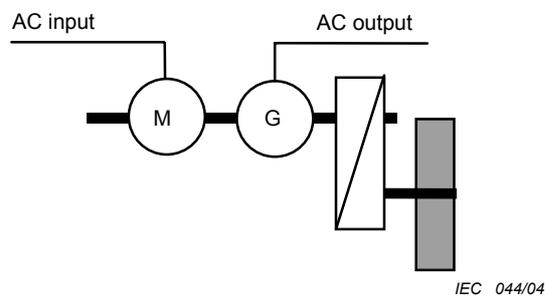


Figure A.3 – Dual conversion – indirect coupled flywheel

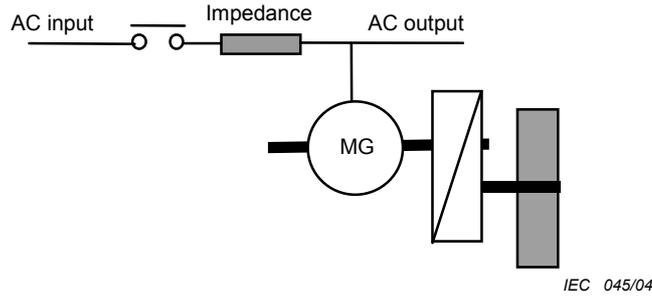


Figure A.4 – Line interactive – indirect coupled flywheel

Few variable ratio transmissions can transmit the full power in both directions. For economic reasons, the power in one direction is much lower, resulting in a time to charge the flywheel that is 10 to 1000 times longer than the typical discharge time.

A.2.3 Variable speed/ constant frequency generator

Constant output frequency with a decelerating direct-coupled flywheel is possible with a controlled-frequency supply of the rotor windings. (double fed a.c. machine). The excitation is provided by a frequency converter, feeding the rotor over slip rings. If the converter can convert energy in both directions, then the shaft speed can be from above to below the synchronous (d.c. excited) speed of the alternator.

An example is shown in Figure A.5 in the line-interactive form.

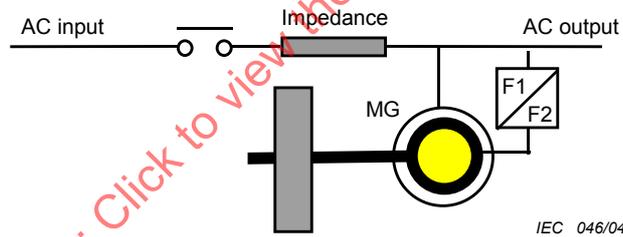


Figure A.5 – Double fed a.c. machine

A.3 Electrochemical energy storage devices

Another very common method to store energy is in batteries. Again, this can be done with dual conversion or line interactive designs, using a d.c. motor directly coupled to the battery, or with a synchronous a.c. machine, coupled to the battery over an inverter.

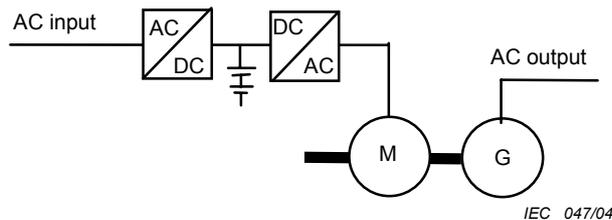


Figure A.6 – Dual conversion with battery

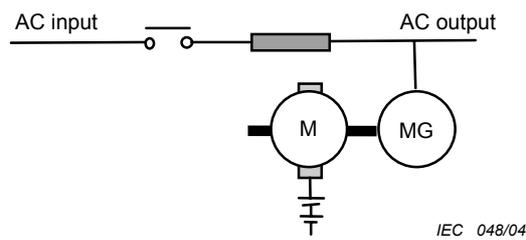


Figure A.7 – Line interactive with battery

The motor in Figure A.6 is an a.c. machine, so it can be fed directly from the a.c. input as long as the mains voltage and frequency are within suitable limits.

If this is not required, then the motor in Figure A.7 can be a d.c. type, directly fed from the battery.

The stored energy time for batteries is in the order of several minutes.

A.4 Further possibilities for energy storage

While the energy storage devices mentioned previously are widely used in practice, there are a number of other possibilities, for example, utilization of super conducting magnet energy storage (SMES), super capacitors, or compressed air.


IECNORM.COM : Click to view the full PDF of IEC 88528-11:2004

Annex B
(normative)

Reference non-linear load – Single-phase

To simulate a single-phase steady-state rectifier/capacitor load, the UPS is loaded with a diode rectifier bridge that has a capacitor and a resistor in parallel on its output. The total single phase load may be formed by a single load as per Figure B1, or formed by multiple equivalent loads in parallel.

Calculation and test method

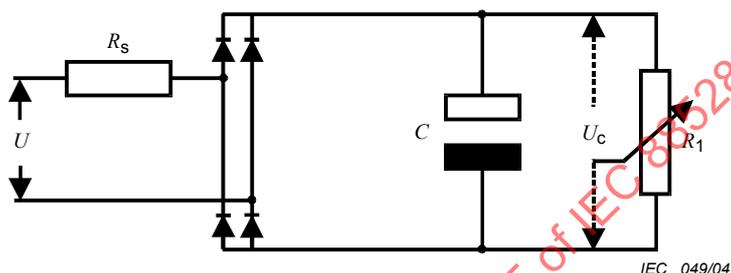

U is the rated output voltage of UPS;

f is the UPS output frequency in Hz;

U_c is the rectified voltage;

S is the apparent power across a non-linear load – Power factor 0,7, that is, 70 % of the apparent power S will be dissipated as active power in the two resistors R_1 and R_s ;

R_1 is the load resistor, set to dissipate 66 % of active power of the total apparent power S ;

R_s is the series line resistor, set to dissipate 4 % of active power of the total apparent power S (the 4 % is according to IEC TC 64 proposal for voltage drop in power lines).

Figure B.1 – Single-phase non-linear load

NOTE Resistor R_s can be placed either in the a.c. or d.c. side of the rectifier bridge.

A ripple voltage <5 % peak-to-peak of the capacitor voltage U_c corresponds to a time constant of:

$$R_1 \times C = 7,5/f.$$

Observing peak voltage, distortion of line voltage, voltage drop in line cables, and ripple voltage of rectified voltage the average of the rectified voltage U_c will be:

$$U_c = \sqrt{2} \times 0,92 \times 0,96 \times 0,975 \times U = 1,22 \times U \text{ [V]}$$

And the values of resistors R_s , R_1 , and capacitor C will be calculated by the following:

$$R_s = 0,04 \times U^2/S$$

$$R_1 = U_c^2/(0,66 \times S)$$

$$C = 7,5/(f \times R_1) \text{ [F]}$$

For dual frequency 50/60 Hz, 50 Hz shall be used in the calculation.

The capacitance value used shall be not less than the calculated value.

NOTE The voltage drop in the diode bridge is neglected.

Test method

- a) The non-linear test load circuit shall initially be connected to an a.c. input supply at the rated output voltage specified for the UPS unit under test.
- b) The a.c. input supply impedance shall not cause a distortion of the a.c. input waveform greater than 8 % when supplying this test load (requirement of IEC 61000-2-2)
- c) The resistor R_1 shall be adjusted to obtain the rated output apparent power (S) and rated output active power specified for the UPS under test.
- d) After adjustment of resistor R_1 , the non-linear test load shall be applied to the output of the UPS under test without further adjustment.
- e) The test load shall be used, without further adjustment, while performing all tests to obtain parameters required under non-linear loading, as defined in the various clauses.

Connection for non-linear loads to UPS

- a) For single-phase UPS, the non-linear load is used with apparent power S equal to the UPS rated apparent power up to 33 kVA.
- b) For single-phase UPS rated above 33 kVA, the non-linear load is used with apparent power S of 33 kVA, plus linear load up to the apparent and active power rating of the UPS.
- c) For three-phase UPS designed for single-phase loads connected line-neutral, three equal single-phase loads, connected line-neutral, shall be used up to 100 kVA UPS apparent and active power rating.
- d) For three-phase UPS rated above 100 kVA, the loads according to Clause 3 shall be used, plus load according to Annex C.

IECNORM.COM : Click to view the full PDF of IEC 88528-11:2004