

SYSTEMS REFERENCE DELIVERABLE



**Generic smart grid requirements –
Part 1: Specific application of the use case methodology for defining generic
smart grid requirements according to the IEC systems approach**

IECNORM.COM : Click to view the full PDF of IEC SRD 62913-1:2022



THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2022 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Secretariat
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 300 terminological entries in English and French, with equivalent terms in 19 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IECNORM.COM : Click to view the full PDF IEC 60293-1:2022

SYSTEMS REFERENCE DELIVERABLE



**Generic smart grid requirements –
Part 1: Specific application of the use case methodology for defining generic
smart grid requirements according to the IEC systems approach**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.020; 29.240

ISBN 978-2-8322-4434-0

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
1 Scope.....	8
2 Normative references	8
3 Terms, definitions and abbreviated terms	8
3.1 Terms and definitions.....	8
3.2 Abbreviated terms.....	12
4 Systems approach.....	13
4.1 A systems perspective	13
4.2 Applying the IEC systems approach to smart energy.....	13
4.3 Main areas of work.....	15
4.4 Breaking down the scope	16
4.5 Link with some existing conceptual models	16
5 Specific application of use case methodology for defining generic smart grid requirements	17
5.1 General.....	17
5.2 Why the use case methodology is particularly adapted to smart grid	17
5.2.1 General	17
5.2.2 Linking the use case methodology with existing frameworks	18
5.2.3 Notion of role.....	21
5.3 Applying the use case methodology to define generic smart grid requirements.....	22
5.3.1 A customer-centric and business-processes-driven approach	22
5.3.2 Generic smart grid requirements.....	26
5.4 Approach used to elaborate a consolidated smart grid role model.....	30
6 UML profile for modelling smart grid use cases.....	31
6.1 A formal approach of use cases modelling	31
6.1.1 General	31
6.1.2 Key principles.....	31
6.2 UML-driven top-down approach methodology.....	32
6.2.1 Formalism and objectives	32
6.2.2 Modelling language.....	32
6.2.3 Scope and information type classification: diagrams and main elements.....	33
6.2.4 Key benefits	34
6.2.5 Types of diagrams and views.....	36
6.3 IEC use cases UML profile concepts	38
7 UML modelling diagrams	40
Annex A (informative) Existing Actors Lists.....	44
Annex B (informative) Content of the use case mapped on IEC 62559-2 template	45
B.1 Description of the use case.....	45
B.1.1 Name of use case.....	45
B.1.2 Version management.....	45
B.1.3 Scope and objectives of use case.....	45
B.1.4 Narrative of use case.....	45
B.1.5 Key performance indicators (KPI)	46
B.1.6 Use case conditions.....	46

B.1.7	Further information to the use case for classification / mapping	46
B.1.8	General remarks	46
B.2	Diagrams of use case	46
B.3	Technical details	47
B.3.1	Actors	47
B.3.2	References	47
B.4	Step by step analysis of use case	47
B.4.1	Overview of scenarios	47
B.4.2	Steps of scenarios	48
B.5	Information exchanged	48
B.6	Requirements (optional)	48
B.7	Common terms and definitions	48
B.8	Custom information (optional)	49
B.9	IEC 62559-2 UML Modelling	49
Annex C (informative)	Example of telecommunications related non-functional requirements	51
Annex D (informative)	Existing Smart Grid Conceptual Models	52
Bibliography	54
Figure 1	– The GridWise Architecture Council's model (NIST, 2012)	18
Figure 2	– Simplification of the GWAC model (CEN-CENELEC-ETSI, 2014)	19
Figure 3	– Smart grid plane domains and hierarchical zones	19
Figure 4	– The Smart Grid Architecture Model (CEN-CENELEC-ETSI, 2014)	20
Figure 5	– Interactions between the use case methodology and the Smart Grid Architecture Model (based on CEN-CENELEC-ETSI, 2014)	21
Figure 6	– Defining smart grid requirements methodology	23
Figure 7	– Point of view of a domain role	24
Figure 8	– The first two levels of detail used to capture generic smart grid requirements	25
Figure 9	– The three levels of detail used to capture generic smart grid requirements	26
Figure 10	– Generic smart grid functional requirements and non-functional requirements captured in use cases	28
Figure 11	– Example of representation of a domain's role model	30
Figure 12	– Example of representation of relations between roles	31
Figure 13	– Four-layer model architecture	33
Figure 14	– UML use case profile for the IEC SRD 62913 series aligned with the IEC 62559 series	36
Figure 15	– Use case overview diagram	37
Figure 16	– Domain overview diagram	37
Figure 17	– BUC-SUC relations diagram	38
Figure 18	– Mapping between use case concepts and architecture concepts	40
Figure 19	– Domain overview concepts UML model	41
Figure 20	– Use case overview concepts UML model	41
Figure 21	– Scenario overview concepts UML model	42
Figure 22	– Activity overview concepts UML model	43
Figure 23	– Requirement overview concepts UML model	43

Figure C.1 – Use case mapping to IEC 62559-2..... 49

Figure C.2 – Use case mapping to IEC 62559-2 – Scenario and activities..... 50

Figure D.1 – NIST/SGIP Smart Grid Conceptual Model..... 52

Figure D.2 – M490 domains 53

Table 1 – Differences between business use cases and system use cases 12

Table 2 – Links between SGAM and IEC SRD 62913 series domains..... 17

Table 3 – Use cases concepts 39

Table C.1 – Example of telecommunications related non-functional requirements 51

Table D.1 – NIST/SGIP domains..... 52

Table D.2 – SGAM domains 53

IECNORM.COM : Click to view the full PDF of IEC SRD 62913-1:2022

INTERNATIONAL ELECTROTECHNICAL COMMISSION

GENERIC SMART GRID REQUIREMENTS –**Part 1: Specific application of the use case methodology for defining generic smart grid requirements according to the IEC systems approach**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

IEC SRD 62913-1, which is a Systems Reference Deliverable, has been prepared by IEC systems committee Smart Energy.

This second edition cancels and replaces the first edition published in 2019. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- it consolidates requirements identification and management and their associated naming rules;
- it leverages IEC SRD 63200:2021, *Definition of extended SGAM Smart Energy Grid Reference Architecture Model*;
- it highlights links between use case methodology and other tools and methodologies (i.e. TOGAF/ArchiMate as used in IEC 61968-1:2020).

The text of this Systems Reference Deliverable is based on the following documents:

Draft	Report on voting
SyCSmartEnergy /169/DTS	SyCSmartEnergy /204/RVDTS

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this Systems Reference Deliverable is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/standardsdev/publications.

A list of all parts in the IEC SRD 62913 series, published under the general title *Generic smart grid requirements*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

IEC SRD 62913 generic smart grid requirements are needed to fulfil the SG3 decision 2 made by the SMB at its February 2010 meeting (SMB/4204/DL, Decision 137/10) requesting the need to describe all the functional and system requirements for all smart grid applications.

The IEC Smart Grid Standardization Roadmap states that "the standardization process should offer a formal path between the application as 'requested' by smart grid (stakeholders) and the standards themselves, i.e. a 'top-down' process", whilst at the same time recognizing that for various reasons in many cases this path has not been the one implemented. This has in turn led to inconsistencies in standards.

The purpose of the IEC systems approach is to ensure and improve the interoperability between smart energy systems and components. This approach is based on the business needs expressed by the market. The main purpose of capturing and sharing generic smart grid requirements is the constitution of a basis for coming standardization work, with standards ensuring and facilitating the deployment of smart grid applications.

A working group has been set up within IEC SyC Smart Energy in order to capture the smart grid requirements derived from the market needs, using a standardized approach based on use cases as described in the IEC 62559 series. This work is building on existing use cases, namely within the IEC when they exist, and is carried out collaboratively with the experts of the relevant technical committees.

The IEC SRD 62913 series will deliver an applicable methodology to draft use cases (IEC SRD 62913-1), clarifying 'who does what' with regards to smart energy use cases, and it will also initiate the process of listing, organizing and making available the use cases which carry the smart energy requirements which should be addressed by the IEC core technical standards (IEC SRD 62913-2 series). The IEC systems approach will require adapted tools and processes to facilitate its implementation, and until they are available to the IEC National Committees and experts, the IEC SRD 62913-2 series should be understood as the first stepping stone towards this systems approach implementation. IEC SRD 62913-3 will be a roles database, based on a harmonized naming methodology, to ensure consistency when drafting smart energy use cases. This will provide a consistent and ready-to-use framework for all standardization stakeholders.

Use cases in the top-down approach of IEC SyC Smart Energy (C/1845/RV) are tools to identify smart grid requirements used to assess situations in standards (gaps or overlaps) and in that way contribute to interoperability. These requirements can also be used further as input for interoperability profiles for the testing phase.

These requirements should then feed into the work carried out by IEC SyC Smart Energy with other technical committees in order to ensure the technical standards are developed taking into account the needs and priorities of the smart grid market.

This document corresponds to the specific application of the use case methodology for defining generic smart grid requirements according to the IEC systems approach.

GENERIC SMART GRID REQUIREMENTS –

Part 1: Specific application of the use case methodology for defining generic smart grid requirements according to the IEC systems approach

1 Scope

This part of IEC SRD 62913 describes a common approach for IEC technical committees to define generic smart grid requirements for further standardization work. It uses as input the use case methodology defined as part of the IEC 62559 series, and provides a more detailed methodology for describing use cases and extracting requirements from these use cases. This will achieve a consistent and homogeneous description of generic requirements for the different areas which make up the smart grid environment.

2 Normative references

There are no normative references in this document.

3 Terms, definitions and abbreviated terms

3.1 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1.1

activity

part of a scenario that can be executed by one or more roles

Note 1 to entry: The details of an activity are described through actions. However, if it is necessary, intermediate levels can be created where activities describe an activity.

3.1.2

actor

entity that communicates and interacts

Note 1 to entry: These actors can include people, software applications, systems, databases, and even the power system itself.

Note 2 to entry: In IEC SRD 62913 this term includes the concepts of business role and system role involved in use cases.

[SOURCE: IEC 62559-2:2015, 3.2]

3.1.3

business case

explanation or set of reasons describing how a business decision will improve a business, product, etc. and how it will affect costs and profits and attract investments

Note 1 to entry: Equivalent to strategic goals and principles which drive business processes.

3.1.4

business process

chain of logical connected, repetitive activities that utilizes the enterprise's resources to refine an object (physical or mental) for the purpose of achieving specified and measurable results/products for internal or external customers

Note 1 to entry: In the context of IEC SRD 62913, the business processes describe the sequenced interactions between several roles of a system.

Note 2 to entry: Business processes can be described or modelled as business use cases.

[SOURCE: Ericsson Quality Institute (1993): Business Process Management, Gothenburg, Sweden]

3.1.5

business role

role describing a finite set of responsibilities that is assumed by a party

Note 1 to entry: Organizations, organizational entities and physical persons are examples of business roles.

3.1.6

cluster

group of items organized by criteria

3.1.7

consumer

end user of electricity

Note 1 to entry: Consumers never generate or store the use of electricity.

3.1.8

demand response

DR

action resulting from management of the electricity demand in response to supply conditions

[SOURCE: IEC 60050-617:2018, 617-04-16]

3.1.9

domain

group of related subjects of standardization

[SOURCE: IEC 60050-901:2013, 901-01-03, modified – The term "field of standardization" has been replaced by "domain".]

3.1.10

functional requirement

requirement that describes what the system must do

Note 1 to entry: They are actions in response to events, or actions performed autonomously. They represent operations and features provided.

[SOURCE: IEC 62559-2:2015, 7.2.6.2]

3.1.11

level of maturity

one of a set of structured levels that describe how well a process, or use case, is implemented through an organization and relates to its degree of formality, optimization and reliability

Note 1 to entry: Proposed levels of maturity:

- Level "Already implemented": the process is implemented in and between several organizations, it is well defined, reliable, sustainable and few uncertainties remain in its framework (regulatory, business or technological).
- Level "Adjustments in progress": the process is implemented in a few organizations, it is well defined but subject to remaining major uncertainties in its framework (regulatory, business or technological).
- Level "Explorative": the process is tested in very few organizations, it is not completely defined and subject to numerous major uncertainties in its framework (regulatory, business or technological).

3.1.12

non-functional requirement

NFR

requirement that describes what qualities the system must contain from an execution and performance perspective

Note 1 to entry: These are also known as "constraints", "behaviour", "criteria", "performance targets", etc. They set limits or controls on how well the system performs the functional requirements.

Note 2 to entry: Non-functional requirements include: reliability, security, usability, upgradeability, expandability, scalability, compatibility, safety, performance, and conformance.

[SOURCE: IEC 62559-2:2015, 7.2.6.2]

3.1.13

prosumer

end user of electricity who may also generate, store and manage the use of electricity

Note 1 to entry: Traditionally, three prosumer types are discussed: residential, industrial and commercial.

3.1.14

requirement

provision that conveys criteria to be fulfilled

[SOURCE: IEC 60050-901:2013, 901-05-05]

3.1.15

role

type of actor which has responsibilities and represents the external intended behaviour of a party

EXAMPLE A legally defined market participant (e.g. grid operator, customer), a generic role which represents a bundle of possible roles (e.g. flexibility operator) or an artificially defined body needed for generic process and use case descriptions.

Note 1 to entry: The IEC SRD 62913 series uses two kinds of role: business roles and system roles.

Note 2 to entry: Legally or generically defined external actors can be named and identified by their roles.

[SOURCE: SG-CG/M490/C:2012-12]

3.1.16

scenario

possible sequence of interactions

[SOURCE: SG-CG/M490/E:2012-12; definition 3.10]

3.1.17

service

specific transaction satisfied by a business process involving two or more roles

3.1.18 smart grid

electric power system that utilizes information exchange and control technologies, distributed computing and associated sensors and actuators

Note 1 to entry: Purposes of smart grids are, for example,

- to integrate the behaviour and actions of the network users and other stakeholders,
- to efficiently deliver sustainable, economic and secure electricity supplies.

[SOURCE: IEC 60050-617:2018, 617-04-13, modified – The second part of the definition has been moved to a Note to entry.]

3.1.19 smart grid function

transformation of a number of input data, collected with the use of information and communication technologies, into a number of technical results to enable one or several business processes of the electric power system

Note 1 to entry: The implementation of smart grid functions requires the coordinated use of a series of equipment and software (generally called smart grid systems, such as AMI or DER Management system).

Note 2 to entry: Smart grid functions and the associated interactions between systems, devices and operators can be described or modelled as system use cases.

3.1.20 system

set of interrelated elements considered in a defined context as a whole and separated from their environment

Note 1 to entry: System is defined in the systems activities Administrative Circular AC/33/2013 as: "a group of interacting, interrelated, or independent elements forming a purposeful whole of a complexity that requires specific structures and work methods in order to support applications and services relevant to IEC stakeholders."

[SOURCE: IEC 62559-2:2015, 3.7]

3.1.21 system role

role describing a finite set of functionalities that is assumed by an entity

Note 1 to entry: device, information system and equipment are examples of system roles.

3.1.22 transmission of electricity

transfer in bulk of electricity, from generating stations to areas of consumption

[SOURCE: IEC 60050-601:1985, 601-01-09]

3.1.23 use case

specification of a set of actions performed by a system, which yields an observable result that is, typically, of value for one or more actors or other stakeholders of the system

Note 1 to entry: There are two types of use case:

- Business use cases describe how business roles interact to execute a business process. These processes are derived from services, i.e. business transactions, which have previously been identified.
- System use cases describe how system and/or business roles of a given system interact to perform a smart grid function required to enable or facilitate the business processes described in business use cases. Their purpose is to detail the execution of those processes from an information system perspective.

Note 2 to entry: Since a smart grid function can be used to enable or facilitate more than one business process, a system use case can be linked to more than one business use case.

Table 1 highlights the differences between these two types of use case.

[SOURCE: SG-CG/M490/E:2012-12]

Table 1 – Differences between business use cases and system use cases

Type of use case	Description	Roles involved
Business use case (BUC)	Depicts a business process – Expected to be system agnostic	Business roles (organizations, organizational entities or physical persons)
System use case (SUC)	Depicts a function or sub-function supporting one or several business processes	Business roles and system roles (devices, Information system)

3.2 Abbreviated terms

- AMI: advanced metering infrastructures
- BPMN: business process model and notation
- BUC-SUC: business use case-system use case
- CEN: European Committee for Standardization
- CENELEC: European Committee for Electrotechnical Standardization
- CIM: common information model
- DER: distributed energy resources
- DSO: distribution system operator
- ebIX: European forum for energy business information exchange
- EFET: European federation of energy traders
- ENTSO-E: European network of transmission system operators for electricity
- ETSI: European Telecommunications Standards Institute
- EURELECTRIC: Union of the Electricity industry
- GWAC: GridWise®¹ Architecture Council
- MDA: model-driven architecture
- NFR: non-functional requirement
- NIST: National Institute of Standards and Technology
- SDO: standards development organization
- SGAM: smart grid architecture model
- SMB: IEC Standardization Management Board
- TSO: transmission system operator
- UML: unified modelling language
- XML: extensible markup language

¹ This information is given for the convenience of users of this document and does not constitute an endorsement by IEC.

4 Systems approach

4.1 A systems perspective

As stated in the Administrative Circular AC/33/2013: As part of the systems approach implemented by the IEC, systems committees have been defined to work "at the systems instead of the product level to define reference architectures, use cases and appropriate standards and guidance on the interfaces, functionality and interaction of a system ...".

The multiplicity of technologies and their convergence in many new and emerging markets, however – particularly those involving large-scale infrastructure – now demand a top-down approach to standardization, starting at the system or system-architecture rather than at the product level. System standards are also increasingly required in sectors such as environment, safety and health.

Although the introduction of such processes in the IEC began some years ago, a major effort is now required to improve understanding of them and to widen their application. It will be necessary to take account of the implied need for increased co-operation with many other standards development organizations, as well as with relevant non-standards bodies in the international arena. There will also be implications for the IEC's conformity assessment systems and processes.

Use cases are used to facilitate co-operation at a system level with other standards development organizations, non-traditional players of electrotechnology, regional organizations and users of smart energy systems closing the many open loops. Inside IEC they provide a convergence platform with overall system level value for support and guidance of the technical committees and other standards development groups, both inside and outside the IEC.

In order to achieve interoperability, use cases are used, in a top-down approach of IEC SyC Smart Energy, to derive generic smart grid requirements further used to assess situations in standards (gaps and overlaps) and so contribute to interoperability through better standardization. Note that use cases also provide a solid platform to define the testing cases to specify interfaces.

As defined in IEC 60050-617:2011, 617-04-13, a smart grid is an "electric power system that utilizes information exchange and control technologies, distributed computing and associated sensors and actuators, for purposes such as:

- to integrate the behaviour and actions of the network users and other stakeholders,
- to efficiently deliver sustainable, economic and secure electricity supplies."

Smart energy in addition to smart grid includes heat and gas in its scope as interactions. IEC SyC Smart Energy explores needs to optimize the energy use between electricity, heat and gas and seek value through a larger range of flexibility possibilities (technologies, cost).

The use of the term 'generic' in this document needs to be clarified. IEC standards need to address the maximum number of requirements needed by its stakeholders, namely those that bring value to several actors and that are not project specific. Use cases are a tool to capture requirements, and the importance or the relevance of a requirement is not just determined by the number of use cases that capture it (although it can be a valid indication). A regulatory requirement, for example, will be considered a priority in one geography and perhaps not in another. The fact that there is only one use case that captures that regulatory requirement does not diminish the importance of the requirement, nor the fact that it needs to be addressed.

4.2 Applying the IEC systems approach to smart energy

"Systems committees (SyC) aim to extend the use of strategic or other horizontal groups to bridge areas covered by more than one or two TCs or SCs."

Although definitions like the one above (from the IEC website) help understand the IEC systems approach, certain clarifications are useful to help understand the scope of the IEC SRD 62913 series.

- a) SyC Smart Energy is tasked with consolidating and ensuring the consistency of the generic smart grid requirements, as well as terminology, for the smart energy domain.
 - This work is carried out according to the use case methodology in standardization as described in the IEC 62559 series, which includes a use case template (IEC 62559-2).
 - Use cases are the basis to identify the smart grid standardization requirements as well as components of the working architectures.
 - The specific application of the use case methodology for defining generic smart grid requirements according to the IEC systems approach is the purpose of this document.
- b) SyC Smart Energy will achieve its task by supporting TCs to draft use cases.
 - This document provides methodology and drafting guidelines to draft use cases, differentiating between business use cases and system use cases.
 - Use cases are a common language to identify and describes requirements inside a TC and between TCs.
 - TCs continue to provide in-depth technical knowledge of a considered domain.
 - SyC Smart Energy needs to ensure that market drivers are captured in the business use cases ("WHY") and can contribute on drafting system use cases when relevant. This is important because it is via the aggregation of system use cases and system actors that a global architecture will emerge, and that is needed to determine whether there are any gaps in the existing standards (thus completing the IEC's Smart Grid Standards Map).
 - The purpose of the IEC SRD 62913-2 series is to initiate the process of listing, organizing, making available the use cases which carry the smart energy requirements which will be addressed by the IEC core technical standards. The IEC systems approach will require adapted tools and processes to facilitate its implementation, and until they are available to IEC National Committees and experts, the IEC SRD 62913-2 series can be seen as the first stepping stone towards this systems approach implementation.
 - The current content of the IEC SRD 62913-2 series is not exhaustive, but the current content represents the priorities for the smart energy domain at the time of publication. It is important that the content in terms of use cases and requirements continues to grow to encompass the requirements of the broad smart energy stakeholders (both within the IEC community as well as more generally the other market stakeholders).
 - The purpose of the work carried out in SyC Smart Energy is to ensure consistency in the way requirements are gathered, shared and addressed by the IEC, and to improve the efficiency of the production of technical standards by reducing the time it takes to identify gaps or overlaps in the existing technical standards and address these situations. The fact that SyCs are organized to interact regularly with the market stakeholders (inside as well as outside the IEC) will ensure that standardization work is aligned on the market priorities at any given time, and so ultimately help improve the delivery acceptance of the IEC core standards.
 - Note that system use cases can describe different and conflicting approaches to address the same requirement. However, system use cases can be used to build requirement repositories, so that these requirements be processed, in order to check inconsistencies inside one system use case or between two system use cases.
 - For the avoidance of doubt, SyC Smart Energy and all its working groups are not and never had the intention of being a 'control mechanism' on the publications of technical standards.
- c) SyC Smart Energy works on what is needed for "further" standardization work in the smart energy domain.
 - The standardization process taking into account the systems approach focuses on the priorities today which need further standardization as it will be an impossible task to include all existing use cases and requirements according to the IEC SRD 62913 methodology.

- The scope covers "what changes or what is new" – although potentially this can cover more. Ultimately, any use case which brings value to several actors of the electric power system is of interest to the IEC.
- The basis of work is the on-going standardization work in the TCs and potentially also new market needs – which determines the priorities for the SyC Smart Energy working groups.

In addition to a shared and applicable methodology as described in this document, consistency will be achieved if there is a collaborative work environment between TCs and SyC Smart Energy.

4.3 Main areas of work

The IEC Smart Grid Standardization Roadmap states:

"Care must be taken to concentrate standardization efforts on providing additional value to the smart grid implementation. This will be especially true for all interoperability standards, which will help to reach the goal of increased observability and controllability of the power system. In this respect the IEC offers the absolute precondition for a further promotion of smart grid. On the other hand, the IEC refrains from standardization of solutions or specific implementations itself. This would actually block innovation and the further development of smart grid."

These key points will be taken into account when describing generic smart grid requirements. They translate as simple yet fundamental guidelines for describing generic smart grid requirements.

- a) Describe what changes, what is improved, needs to be improved, what is new

The focus is on defining what is new, what is improved, or what changes in the electric power system with the emergence of smart grid functions. The purpose of the IEC SRD 62913 series is not to define all electric power system requirements, nor does it seek to standardize solutions-specific or architecture-specific requirements.

- b) Keep an electric power system perspective

Emerging smart grid functions, on the back of new and more reliable information and communication technologies, offer new opportunities which are gradually changing the way in which the electric power system operates. One major changing trend is the need to integrate and manage the increasing number of distributed and/or intermittent energy resources onto the transmission and distribution networks. Another example of these changes is the growing role of the market within the electric power system, and the possibilities being offered to these markets to operate increasingly closer to real-time.

At the heart of these changing trends, the electric power system still needs to meet the objectives listed above (ensuring security and quality of supply, ensuring security of people and assets and optimizing costs for all stakeholders). The development of smart grid functions does not alter these objectives, only the more efficient way they can be met.

- c) Describe the relevant functional and non-functional requirements for all smart grid applications

Defining generic requirements addressing mainly interfaces supporting smart grid applications needs to ultimately facilitate the development and deployment of smart grid applications, and to do this means providing the sufficient level of detail which enables this.

- d) Take into account the fundamental rules that govern the electric power system

Another important parameter to bear in mind is that the actors of the electric power system all need to respect certain fundamental rules and take them into account in the way they operate, i.e. in their business processes. These rules include Grid and Market rules, essentially derived from electricity network codes and guidelines.

Regulatory bodies at regional and state levels define and contribute to enforce both Grid and Market rules – they can delegate to state agencies or to some actors of the electric power system the elaboration of those rules, which they will ultimately validate. In turn, both

the grid codes and the Market models impose requirements to the different Users or Resources which connect to the Grid.

It is the mission of standards to support/enable the implementations of these requirements.

4.4 Breaking down the scope

The IEC SRD 62913 series has been broken down into domains to provide a neutral term for document management purposes. The IEC SRD 62913 series consists of the following parts:

- Part 1: Specific application of the use case methodology for defining generic smart grid requirements according to the IEC systems approach.
- Part 2, composed of four subparts which refer to the clusters which regroup several domains:
 - Part 2-1: Grid related domains – these include Transmission Grid Management, Distribution Grid Management, Microgrids and Smart Substation Automation;
 - Part 2-2: Market related domain (including commercial activities for supply of electricity);
 - Part 2-3: Resources connected to the grid domains – these include Bulk Generation, Distributed Energy Resources, Smart Home / Commercial / Industrial / DR-Customer Energy Management, and Energy Storage;
 - Part 2-4: Electric transportation related domain;

IEC SRD 62913 refers to 'clusters' of domains for its different parts so as to provide a neutral term for document management purposes simply because it is necessary to split in several documents the broad scope of smart grids.

4.5 Link with some existing conceptual models

This necessary split has been inspired by existing conceptual models which have been drafted previously, such as the NIST Smart Grid Conceptual Model, the SGAM or the conceptual model developed as part of the European mandate M/490 Smart Grid Coordination Group. These existing conceptual models are listed in Annex D.

A conceptual model can be defined as the grouping of roles and actors (systems, components, operators, ...) within coherent domains related to a general system (the electric power system here). It provides a high-level reference architecture model and proposes a decomposition of a system in domains. This facilitates the description of smart grid systems and interoperability analysis. The roles and systems of each domain interact with each other, as well as with the roles and systems of other domains.

Based on the commonly accepted breakdown and other existing conceptual models (NIST SGIP conceptual model, EU M/490 smart grid conceptual model SGAM), in order to apprehend its complexity and to help maintain a global vision of the smart grid market needs, the IEC SRD 62913 series has been organized around the smart grid domains identified in Table 2.

Table 2 – Links between SGAM and IEC SRD 62913 series domains

SGAM domains	IEC SRD 62913 series domains	
Bulk generation	Bulk Generation	
Transmission	Transmission Grid Management	Smart Substation Automation
Distribution	Distribution Grid Management	
	Microgrids ^a	
DER	Distributed Energy Resources	
	Energy Storage	
Customer premises	Smart Home / Commercial / Industrial / DR-Customer Energy Management	
	Electric Transportation	
	Metering Management	
	Asset Management	
	Market	
^a Actually microgrids are small versions of smart grids and can encompass a large variety of domains including distribution, DER and customer premises.		

The distribution domain, as described in the SGAM, has been broken into three domains – Distribution Grid Management, Microgrids and Smart Substation Automation – to facilitate capturing and sharing generic smart grid requirements on what is new or what changes in the electric power system with the emergence of smart grid functions. Following the same approach, DER has been split in two domains: Distributed Energy Resources for 'generation' DER and Energy Storage domain for 'storage' DER (note that DER could be further refined to also include controllable load). Customer premises has been split in Smart Home / Commercial / Industrial / DR-Customer Energy Management and Electric Transportation.

In addition, we define a Market domain as the one defined in the NIST/SGIP Smart Grid Conceptual Model and two cross-domains Metering Management and Asset Management.

The business analyses which underlie the definition of generic smart grid requirements are carried out per domain initially, and then consolidated to take into account dependencies and interactions between the domains.

5 Specific application of use case methodology for defining generic smart grid requirements

5.1 General

The purpose of Clause 5 is to describe the methodology which can be shared and easily applied to carry out a comprehensive and consistent description of generic smart grid requirements based on a business analysis of the identified smart grid domains and to detail the context in which smart grid functions are or can be used.

5.2 Why the use case methodology is particularly adapted to smart grid

5.2.1 General

It provides a robust, tried and tested common methodology to describe complex systems. The methodology strikes the correct balance between a necessary structure and form and enough flexibility to leave room to take into account emerging requirements or regulatory uncertainty. The use case methodology is widely used within IEC as well as other SDOs and the industry, which will facilitate re-use and making sure existing work is taken into account from the outset.

It is based on a collective approach which requires putting all the stakeholders around the table to ensure all requirements have been taken into account. It helps highlight the inevitable 'grey' areas which will need to be clarified. Note that smart grid requirements can evolve rapidly.


It uses a comprehensible and flexible format with a wide range of representations at different levels based on user needs, which makes it understandable by users, business analysts, IT experts all the way through to senior executives.

The use case methodology can be used at all levels of a company: to translate a company's strategy per domain, to highlight how existing business processes will be impacted, or to design new information systems or modify existing ones.

5.2.2 Linking the use case methodology with existing frameworks

Different frameworks have been elaborated by SDOs to grasp the complexity of smart grid, present and validate use cases in relation to existing standards, and ultimately ensure interoperability of systems and components. A common denominator of the various works is the identification of different interoperability layers, inherent to the complexity of smart grid.


The model proposed by the US Department of Energy's Grid Wise Architecture Council (GWAC) and adapted by NIST, referred to as "GWAC stack", has identified eight layers of interoperability based on different drivers (organizational, technical, or informational); see Figure 1. It provides a "context for determining Smart Grid interoperability requirements and defining exchanges of information" (NIST, 2012).

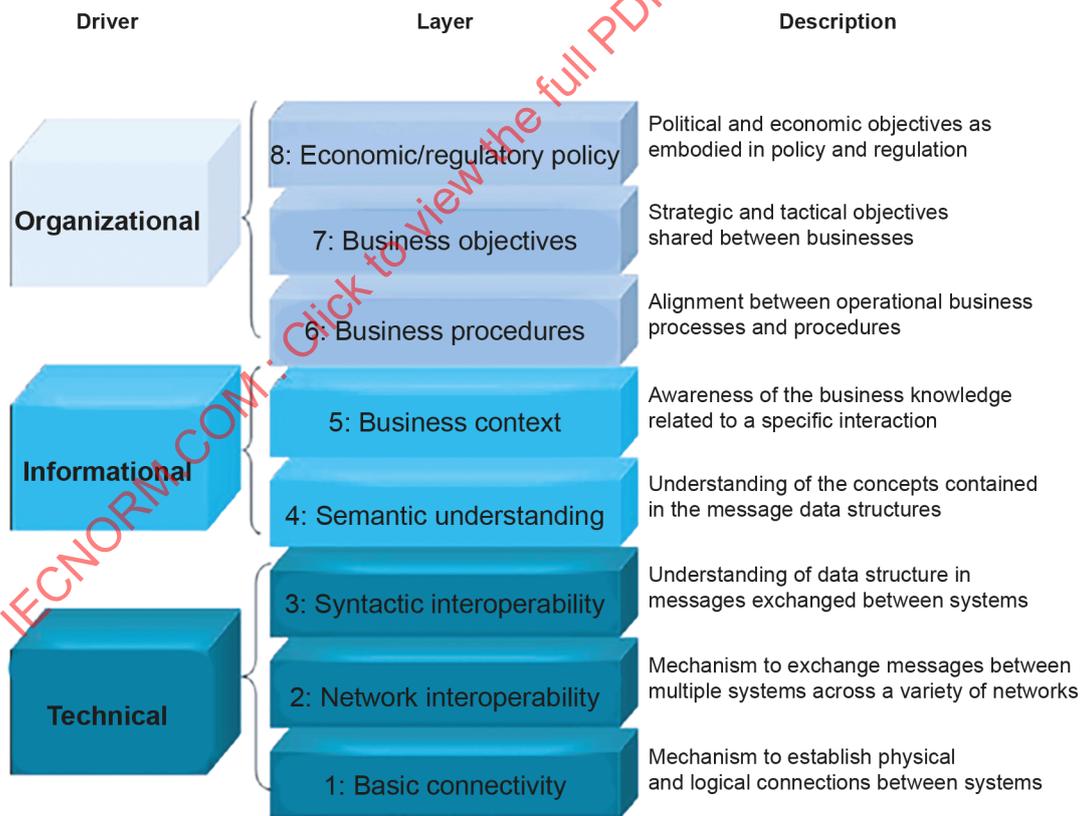

IEC

Figure 1 – The GridWise Architecture Council's model (NIST, 2012)

The Smart Grid-Coordination Group, established by CEN-CENELEC-ETSI to fulfil the tasks laid down by the M/490 European Commission Mandate, has simplified this model by grouping different layers with the Smart Grid Architecture Model (SGAM), see Figure 2. This framework aims at decomposing the electric power system by interoperability layers, domains, and zones.

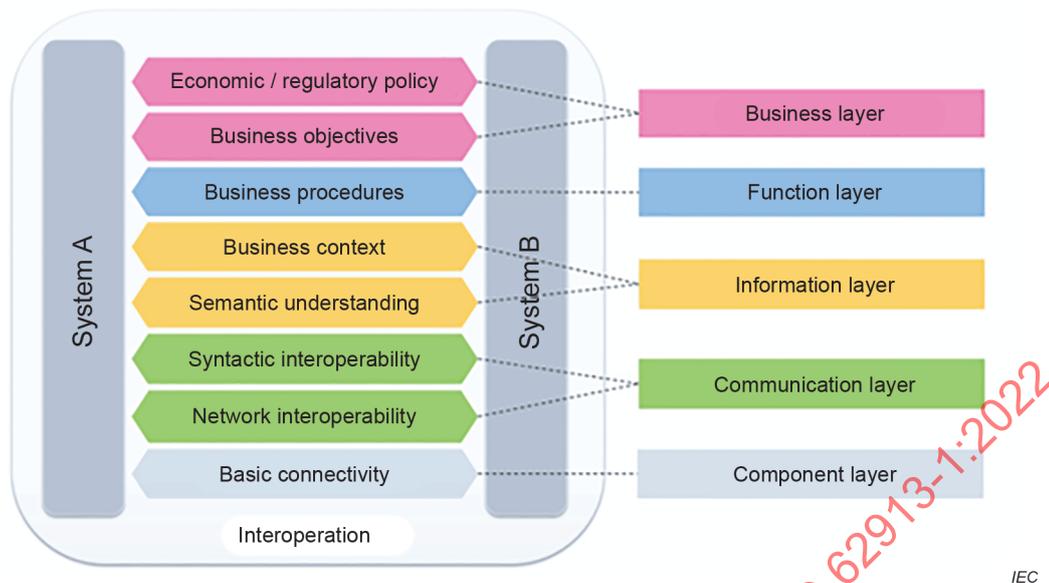


IEC

Figure 2 – Simplification of the GWAC model (CEN-CENELEC-ETSI, 2014)

The SGAM framework enables the design of new smart grid architecture components to be organized on a three-axis basis (see Figure 3 and Figure 4).

- Domains: the physical partitions of the energy chain from the generation down to the customer premises as described in 4.4; see Figure 3.
- Zones: the partitions for the management of the electrical processes (See Figure 3).
- Interoperability layers: a set of abstract points of view enabling a simple handling of architecture model. It allows representing smart grid systems in five layers – business objectives and processes, functions, information exchange and models, communication protocols, and components – as well as the interactions between them.

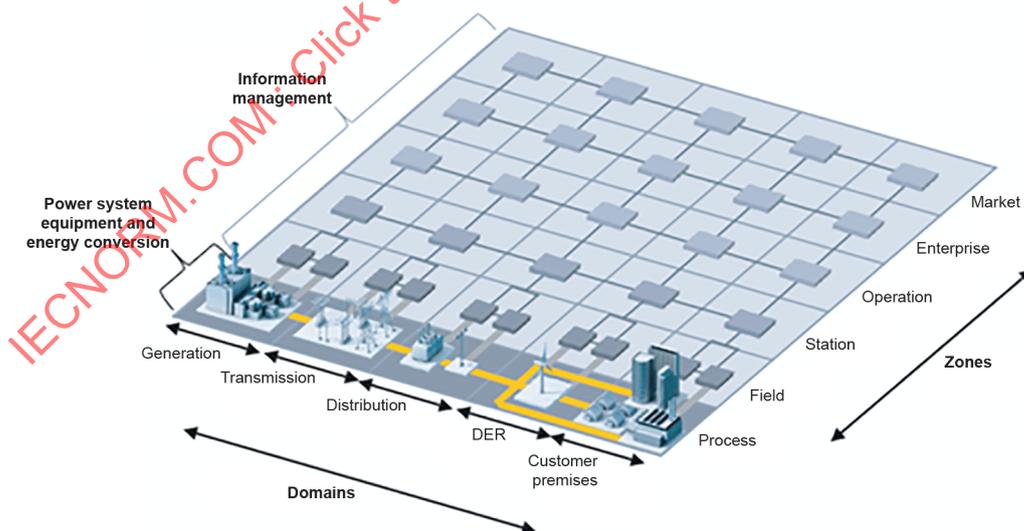

IEC

Figure 3 – Smart grid plane domains and hierarchical zones

Every smart grid component to be deployed on the field needs to be first specified through different layers of abstraction from the business, down to the component implementation. In order to facilitate the high-level specifications, IEC decided to leverage an approach based on the design of use cases capturing the smart grid requirements.

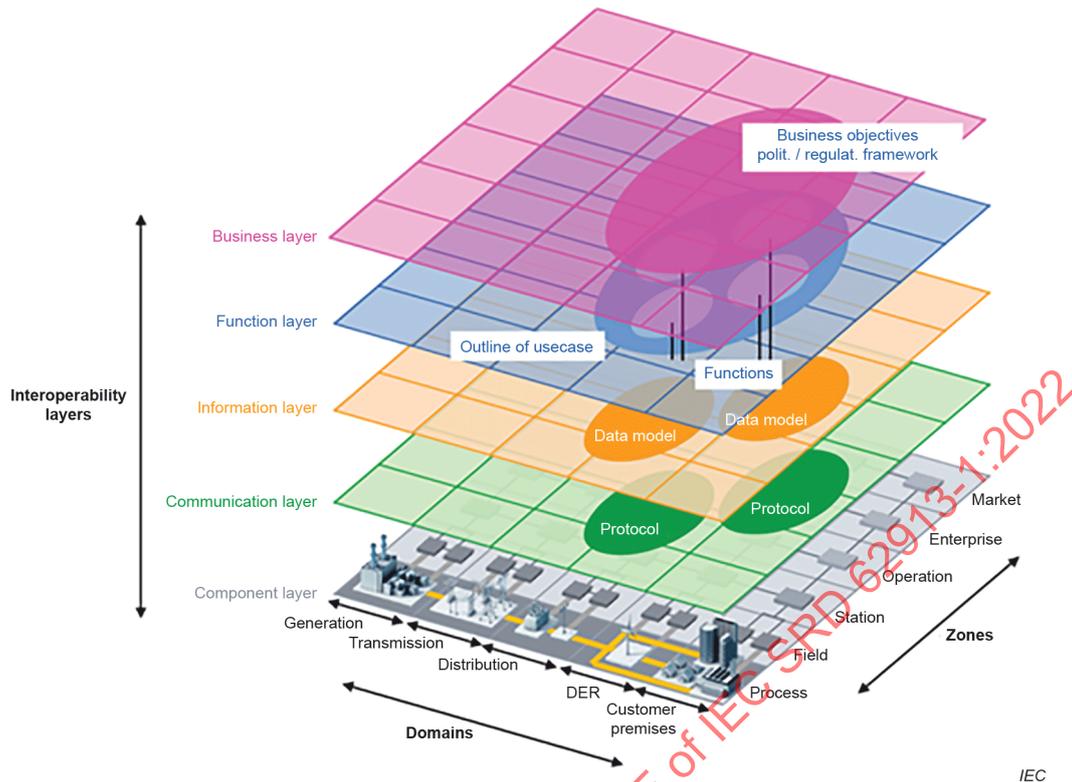


Figure 4 – The Smart Grid Architecture Model (CEN-CENELEC-ETSI, 2014)

These different frameworks have helped structure the work for the IEC SRD 62913 series. They have contributed to ensure the methodological approach to capture generic smart grid requirements is business-driven, not solutions-driven.

IEC established a link between the SGAM framework and the use case methodology through key concepts: roles, business processes, activities, systems and functions.

Figure 5 highlights the link between the five layers of the SGAM model described above, and the interactions with the key concepts of the use case methodology. More precisely, it shows how a given role within the electric power system provides a service to another role, through the execution of a business process composed of different activities. Moreover, a business process needs to be implemented in various systems. These systems also have different processes (named functions) that can be described through activities.

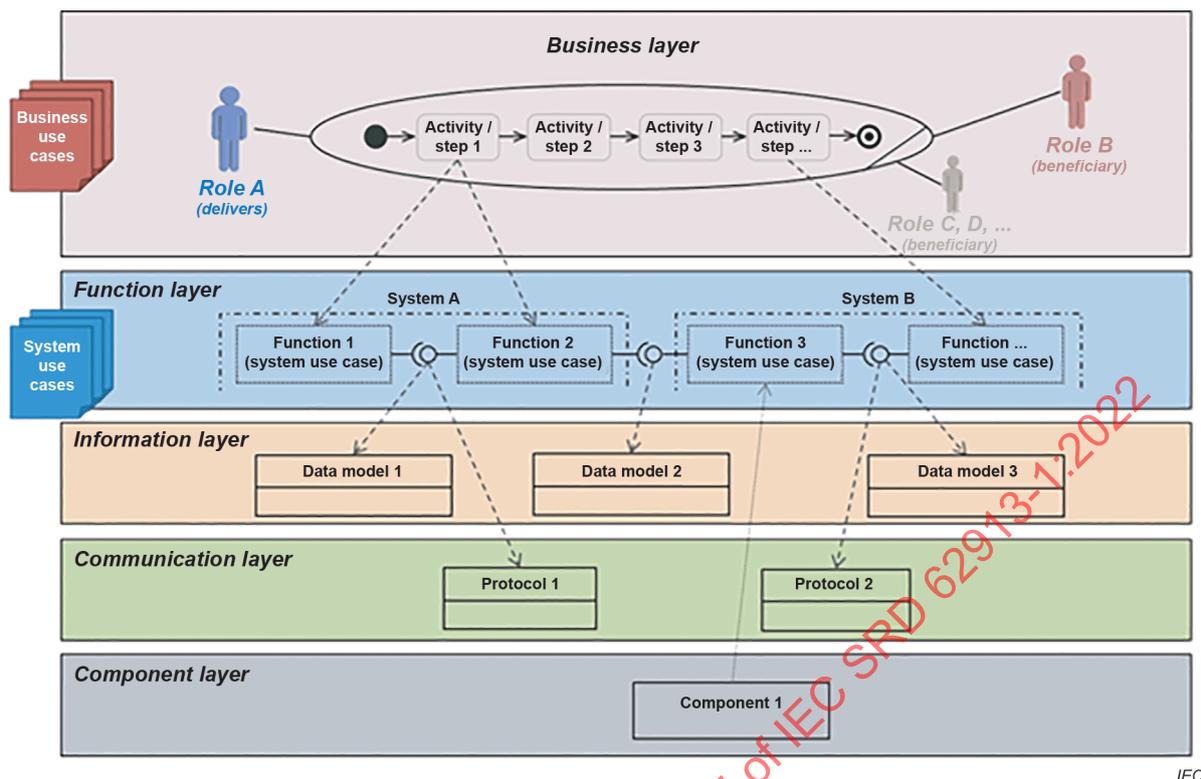


Figure 5 – Interactions between the use case methodology and the Smart Grid Architecture Model (based on CEN-CENELEC-ETSI, 2014)

These links support IEC 63200 which defines the framework elements, associated ontology and modelling methodology for designing the smart energy Grid Reference Architecture using the Smart Grid Architecture Model (SGAM), with potential expansion to describe the interaction between the grid and the heat system, the gas system or both, and including easily understandable examples.

5.2.3 Notion of role

The notion of 'role' is fundamental in the use case methodology. A role can be defined as "an intended behaviour of a business party"². It is associated with responsibilities. A business party, when carrying out a business transaction, takes on a certain role. According to the harmonized electricity market role model (ENTSO-E, EFET and eBIX, 2020), "the objective of decomposing the electricity system into a set of autonomous roles and domains is to enable the construction of business processes where the relevant role participates to satisfy a specific transaction (service). Business processes should be designed to satisfy the requirements of the roles and not of the parties."

Although the notions of roles and actors are often interchanged, it is important not to confuse the two. Actors are entities that communicate or interact with a given system. A role on the other hand is a type of actor which has responsibilities, for a business role, or functionalities, for a system role (information systems, or devices) within a given system. A role can be played by different parties (legal or physical entity) – depending on geographies for example.

"A role must be able to stand alone within the model. In other words it must represent a relatively autonomous function. A good guide to determining the validity for the insertion of a role is to determine whether it provides:

² SG-CG/M490/C:2012-12.

- All the information relevant to interoperability. It must be able to participate in the development of a business process by being a key factor in the construction of the allowable sequences of information exchanges and satisfy the conditions in which it is allowed to send information. In this respect it has to be autonomous [...].
- The process constraints to be satisfied in which the role participates. Such constraints impose restrictions on how roles may or must react. These constraints will be defined within the business process specification." ³

A role can be a specialisation of a more general role, which means it shares its characteristics. For instance, a transmission system operator and a distribution system operator are kinds of system operators.

In the use case methodology, roles interact with each other within a role model, which represents all of the interactions between the different roles and domains of a given system. The purpose of a role model is to share a common understanding and ultimately to facilitate communication and the development of information exchanges. See Annex A for examples of existing actor lists.

5.3 Applying the use case methodology to define generic smart grid requirements

5.3.1 A customer-centric and business-processes-driven approach

5.3.1.1 General


As stated in IEC TR 62746-2, a process aiming at defining requirements for messages and related information to be exchanged starts with the collection of user stories. User stories describe the behaviour from the customers' or users' point of view. User stories are produced from the consumer or grid side perspective and describe typical scenarios.

EXAMPLE "The customer wants to get the dishes ready at 8 a.m. tomorrow."

At this level, the roles are not yet defined. Then, use cases aim at accomplishing user stories and compile information in a standardized format. They describe what is the business process to be put in place and which smart grid function supporting a business process should be implemented.

The methodology described in this document to capture the generic requirements for all smart grid applications illustrated in Figure 6 is structured on an approach based on business processes. This business-driven approach is particularly relevant to define generic smart grid requirements so ensuring that fundamental requirements of the electric power system (including network rules or market rules) as well as strategic goals are taken into account at all times.

³ ENTSO-E, EFET & EBIX, The harmonised electricity market role model, 2020-01.

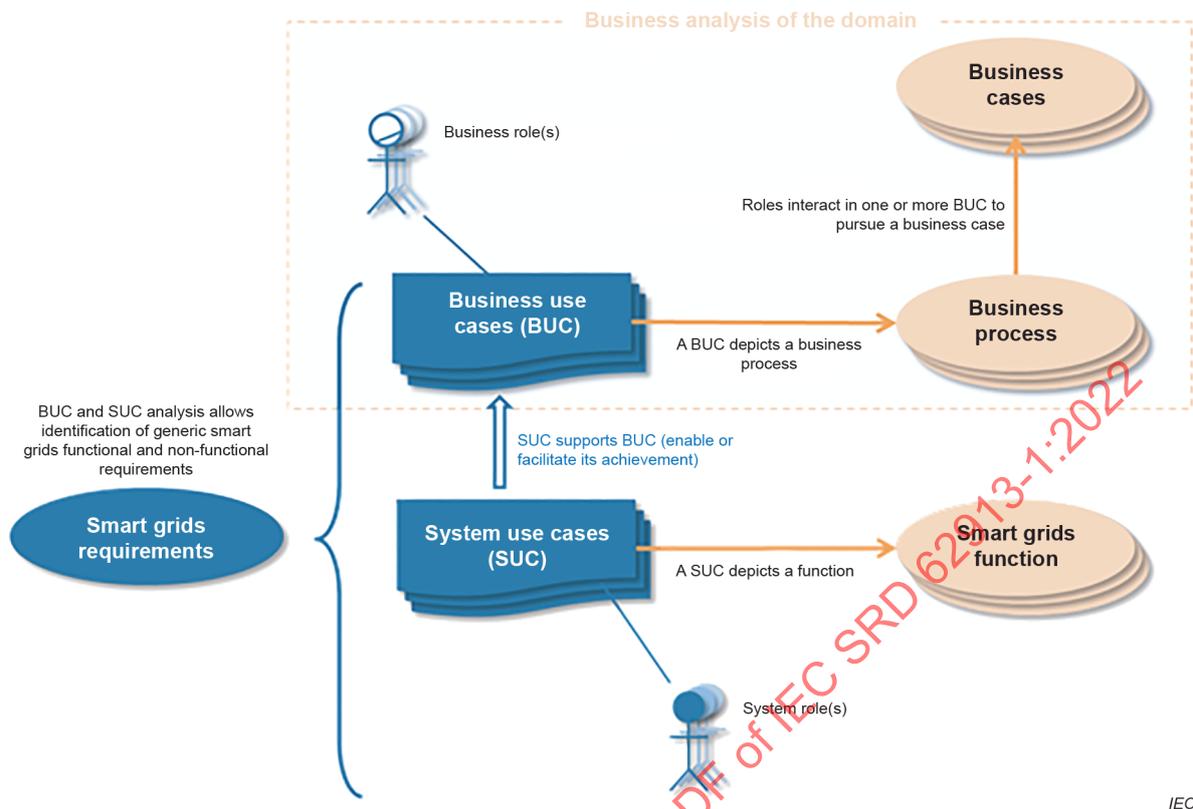

IEC

Figure 6 – Defining smart grid requirements methodology

The business analysis which needs to be carried out covers the activities and operations within the electric power system.

The business analysis will focus on the adapted existing business processes or new business processes impacted by new trends and market needs. This is formalized through business use cases which are just a pragmatic and structured method to describe business processes, functions, and ultimately their associated requirements.

In order to capture generic smart grid requirements with a business-driven and top-down approach, it is necessary to first identify business cases (domain strategic goals and principles). To do so, the roles interacting with the domain need to be considered, as described in 5.2.3.

Figure 7 provides a simplified overview of the point of view of the 'business role' of a domain.

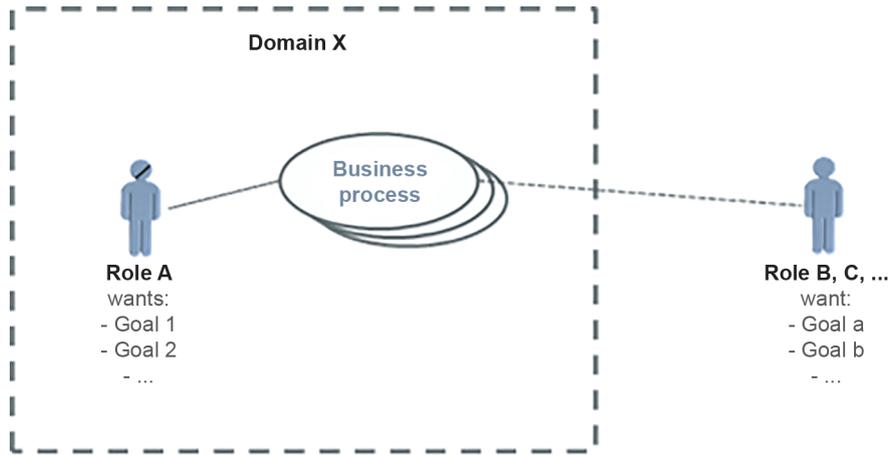


Figure 7 – Point of view of a domain role

Figure 7 also highlights the fact that the business analysis carried out per domain will need to take into account interactions with other roles or stakeholders. Indeed, the latter (Role B, C, ...) can contribute to achieve the goals of Role A, or they can have different goals – which are not necessarily convergent with those of Role A. These situations need to be identified as part of the business analysis per domain and shall be addressed as part of the consolidation phase.

One of the main challenges in drafting use cases is to converge on the level of detail. It is suggested to proceed in three levels, the first two levels being the following.

- 1) Defining the main business cases of the domains, which are strategic goals and principles, constitutes the first level of detail. They involve multiple business processes (see below);
Key questions: Why are we doing this? Is it consistent with our mission statement? What is in it for the stakeholders?
- 2) Defining business processes of the domains, which are the set of activities that the business roles of the domains shall achieve, constitutes the second level of detail. Note that a business process can be related to several business cases.
Key questions: What activities do we need to carry out to achieve this operational goal (from the trigger to a visible/valued end result)?

As an example, optimizing the planning of the network represents a business case for both Transmission Grid Management and Distribution Grid Management domains.

Business processes and the associated interaction between business roles (inside and outside a given domain) can be described as business use cases and will be referred to as business use cases (BUC) in the IEC SRD 62913 series.

Figure 8, consistent with SGAM business layer, shows the first two levels of detail (business cases and business use cases).

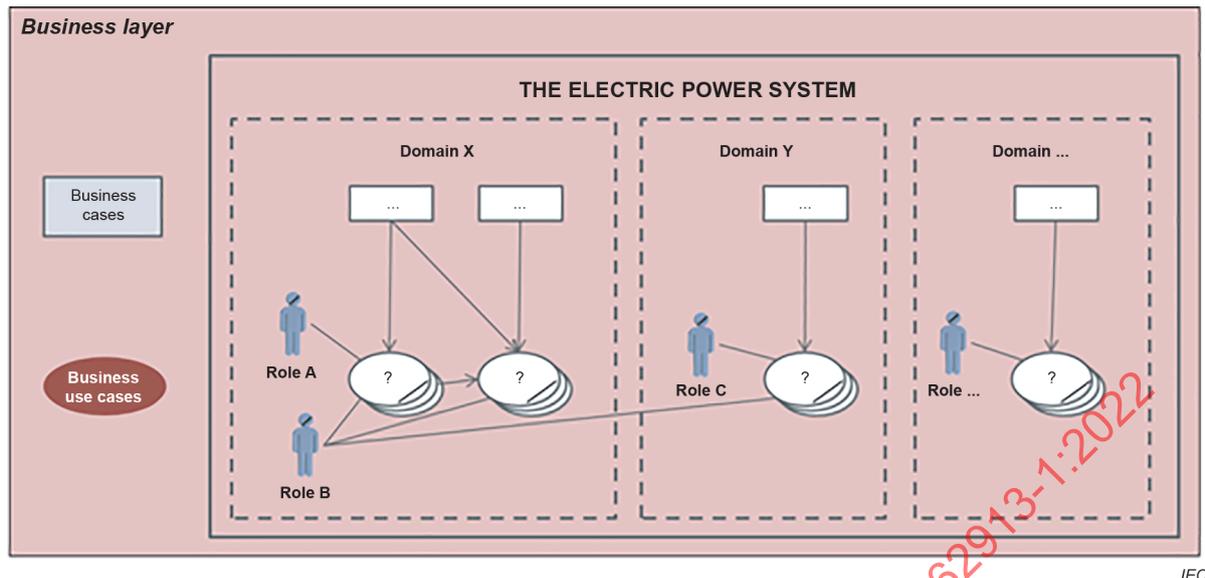


Figure 8 – The first two levels of detail used to capture generic smart grid requirements

Note that:

- A business use case can require the execution of another business use case within the same domain.
- A business use case can be related to several business cases.
- Business use cases should be system agnostic: Business use cases should be depicted in such a way that they do not presume the solutions and means which will be used to run the targeted business process, i.e. do not imply system roles.
- Roles of a given domain can interact with business use cases of another domain.

These interactions increase the complexity of the electric power system, but need to be described as they will ultimately materialize as additional requirements.

When describing the business use cases of the domain some smart grid functions required to enable or facilitate those business use cases need be identified and defined.

- 3) Defining the smart grid functions constitutes the third level of detail. They are means or tools to support business use cases, they can be solution-specific. One smart grid function can be used in several business use cases. There will be several system use cases – and potentially associated functions – as there are different solutions or ways to support the business cases.

For instance, a load-flow calculation is a function that can be used to prevent faults, optimize the grid and operate it.

Smart grid functions and the associated interactions between roles (business and/or system roles) can be described in system use cases and will be referred to as system use cases (SUC) in the IEC SRD 62913 series.

Note that as smart grid functions can be made up of sub-smart grid functions, system use cases can be made up of other system use cases, smart grids are often systems of systems, see Figure 9.

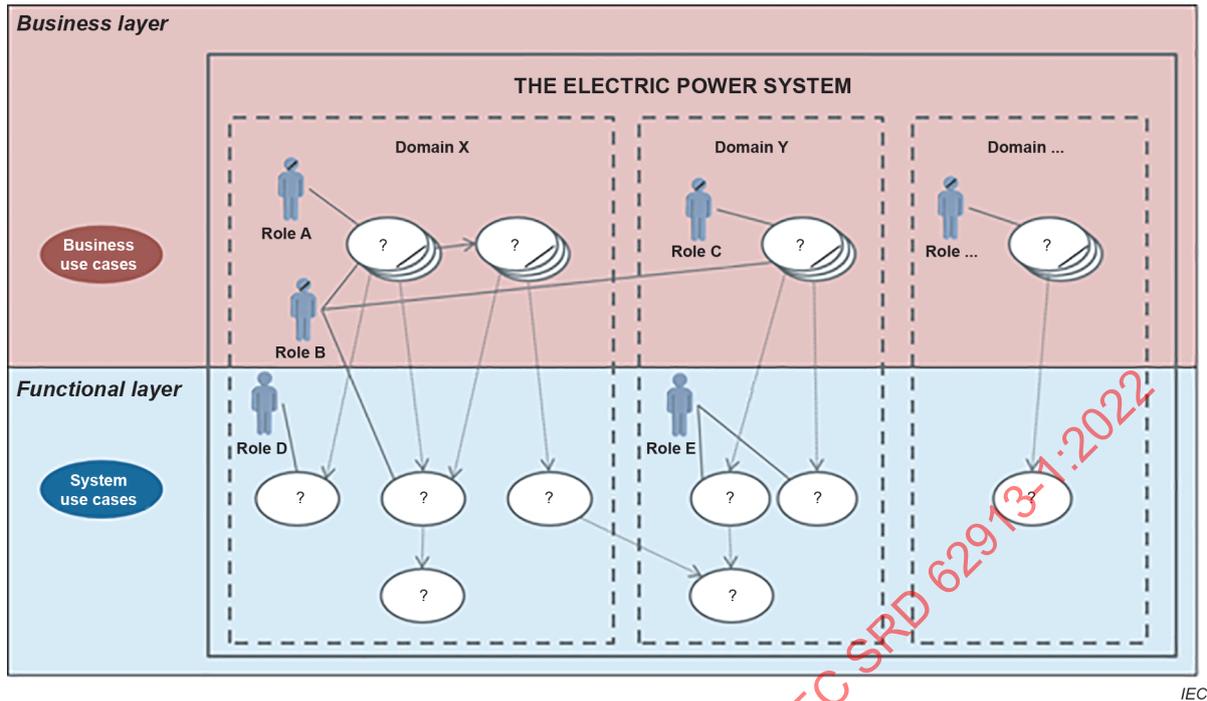


Figure 9 – The three levels of detail used to capture generic smart grid requirements

In other words and as illustrated in Figure 6, generic smart grid requirements are captured by means of business use cases and system use cases. While writing these use cases, functional and non-functional requirements are identified.

Note that the number of business use cases and system use cases which are represented in Figure 9, as well as the number and the nature of the links between these different elements, are indicative.

5.3.1.2 Proposed step-by-step approach

On the basis of what has been described above, the different steps to carry out a business analysis and from there define the generic smart grid requirements could be summarized as follows.

- Share new smart grid ideas, identify and gather existing use cases.
- Identify and describe use cases that are in conformity with IEC 62559-2 and this document:
 - identify and describe business roles of the domain;
 - identify and describe the strategic goals of the domain (the business cases);
 - describe the business use cases, including the set of activities enabling them to achieve their business cases;
 - identify and describe the system roles of the domain;
 - describe the system use cases required to execute or enable the business use cases, and the working architectures associated in order to map data flows.
- Derive generic smart grid requirements from use cases.

5.3.2 Generic smart grid requirements

5.3.2.1 Functional and non-functional requirements

The key point behind using the proposed application of the use case methodology is to ensure the business viewpoint is borne in mind at all times during the analysis work, thereby ensuring each domain addresses the business-related, or functional requirements associated with the

different use cases. Those functional requirements mainly concern interfaces supporting all smart grid applications.

Requirements mainly focus on capabilities of the interfaces of the different roles/functions which appear to be needed through the use case descriptions, and then on capabilities that existing standards are supporting or coming standards should support.

Because requirements mostly focus on interaction, their expression can be simplified and shall conform to ISO/IEC directives:

- Use the present tense, use forms such as: shall, is to, is required to, it is required that, has to, only ... is permitted, it is necessary ... and their negative form.
- Indicate which are the roles interacting (one to one, one to many).
- Indicate the element to be exchanged (might not be exclusively of information type) in a non-ambiguous manner.
- Indicate the constraint identified to this interaction – the non-functional requirements (NFRs). These NFRs cover topics as broad as response time performance, scalability, cybersecurity, criticality, availability, resilience or interoperability.

Functional requirements are derived from information exchange with a methodology inspired by:

- ISO/IEC directives;
- IEC 61850-5:2013: see PICOM (Piece of Information for Communication);
- IEC 61968-1, IEC 61968-100: see message types;
- IEC TR 62746-2.

Requirements are the subject of dedicated standards, such as ISO/IEC 25030:2019.

It is essential to split complex requirements until it can be considered as a discrete test case. requirements should be eventually testable, according to the SMART paradigm (Specific, Measurable, Achievable, Realistic and Time-bound).

In order to facilitate extraction of generic smart grid requirements, use cases should be written following those rules, referring to IEC 62559-2 use case template sections:

- scope and objectives of use case (1.3);
- narrative of the use case (1.4);
- use case conditions (1.6);
- step by step analysis of use case (4);
- information exchanged (5);
- requirements (6).

Requirements format adopted for the IEC SRD 62913 series:

Requirement ID (unique)	Requirement description	Link to use cases
Part number followed by a unique requirement number Example: 62913-2-3-087	<i>Functional or non-functional nature can be specified</i>	Annex subclause number followed by the part of the use case concerned Example: Annex B.3.2.1 Scenario 1 – step 1.5

Other testable and usable (one can demonstrate that a standard supports or not the achievement of it) requirements can be extracted, even if they cannot be directly linked to an interface supporting a smart grid application.

It should also be noted that not all of the non-functional requirements will need to be captured in the use cases. Complex algorithms and formulae and graphical user interface requirements will not need to be detailed in the use cases for example – they are clearly linked to a specific solution or implementation approach and thus out of scope of the IEC SRD 62913 series, as explained in Figure 10.

There are a few cases when a sequence of interactions is absolutely needed to perform a specific function, and guarantee interoperability (for example "select-before-execute"), and such a sequence can appear as a Requirement to be supported by the standard as a standard "state machine".

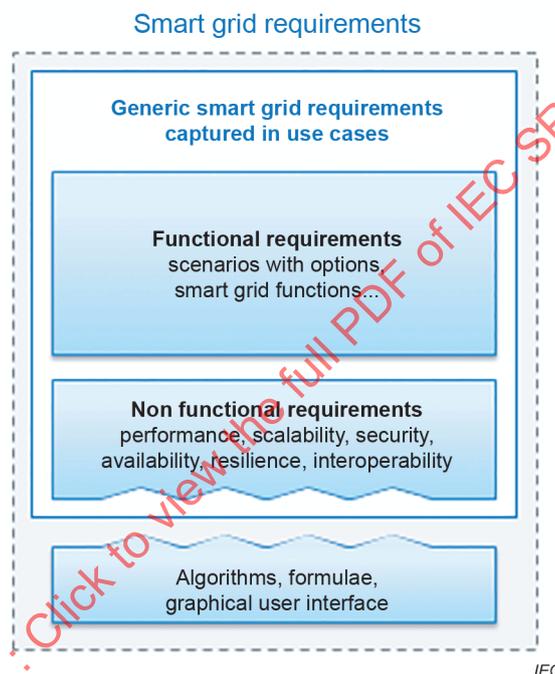


Figure 10 – Generic smart grid functional requirements and non-functional requirements captured in use cases

Functional requirements are intended to specify business expectations in business use cases (e.g. "In XYZ condition, the operator shall ask for confirmation, etc.") or technical expectations in system use cases from a functional perspective (e.g. "In XYZ condition, the user shall select, etc." or "In XYZ condition, the system shall register, etc.").

The use case template as defined in IEC 62559-2 includes placeholders designed to detail non-functional requirements.

Non-functional requirements are intended to specify technical expectations in system use cases from an execution and performance perspective (e.g. "In XYZ condition, the system shall register in less than one second, etc.").

Non-functional requirements emphasize links between system use cases and protocols to be used for data exchanges (e.g. REST, XMPP, MQTT) and represented in SGAM Communication layer.

As an example of NFRs, Annex D provides an example of telecommunications related non-functional requirements which can be used when describing a use case.

5.3.2.2 Extracting generic smart grid requirements from use cases

A use case-driven approach is necessary for a top-down development of standards. From a use case perspective actors and deliverables are identified and requirements are derived. This is the base for future standardization.

The generic smart grid requirements will be extracted from business use cases and their associated system use cases and included in the IEC SRD 62913-2 series as proposed. The use cases themselves will be published as an informative annex in parts of the IEC SRD 62913-2 series.

In order to provide some insight into the complexity of the smart grid systems and help the reader make a link between the listed generic smart grid requirements and the context provided as part of the use cases, a note will be added with reference to the relevant use cases where this Requirement occurred.

5.3.2.3 Other kinds of requirements

Several smart grid topics are recurring: flexibility management, personal data management compliant with local regulations, cybersecurity, real time performance, big data issues implying suitable design patterns, etc. All these topics are characterized by functional and non-functional requirements.

Upstream user stories mentioned in 5.3.1.1 are also kinds of functional and non-functional requirements.

Functional and non-functional requirements emerging with business use cases and system use cases are often of a high level. When systems are developed or integrated, these high-level requirements need to be refined, in particular to reflect design choices or to drive the software development processes.

Agile software development processes often rely on user stories which should be considered as requirements as well. These user stories are also kinds of functional or non-functional requirements, with a higher level of detail. Examples of functional or non-functional requirements are given in 5.3.2.2. User stories of a high level of detail can be integrated back into use case repositories and linked with high-level requirements, so new versions of the use cases are produced along with the user stories.

As a result and due to the large number of requirements to manage, categories of requirement are intended to structure and classify requirements. Requirements can then be classified according to business, functional, information and communication criteria, in order to facilitate links with SGAM layers, and these criteria are examples of categories of requirements. More precisely, the name of a category should explicitly refer to one or several SGAM layers, domains and zones or to a higher level of detail of them.

The list of categories needs to be extendable, so that requirements can be classified according to the most relevant smart grid topic (e.g. flexibility management, personal data management, cybersecurity). A category can be split into several sub-categories, in order to adjust the level of requirements' classification.

Besides, a requirement can refer to other requirements and be linked to them, so that top-level requirements can be characterized by finer grained requirements and requirements can be recursively selected by the requirements they depend on. Lists of requirements and depending requirements can be drawn up by means of UML exports.

Any kind of requirement is related to an object: a use case, a scenario, an activity or a business object. The requirement description should be written in a natural language and should express an observable property (see examples of functional and non-functional requirements in 5.3.2.2).

5.4 Approach used to elaborate a consolidated smart grid role model


The business analysis carried out per domain will identify the business roles and the use cases they are contributing to achieve. These business roles and use cases will be consolidated to elaborate a smart grid role model. Navigation into the complexity of this role model will be facilitated by UML models.

The purpose of this role model is to give an overall view of the interactions between domains, roles, and the business use cases which are being created or modified with smart grid. More precisely, the role model outlines the nature and the importance of these interactions. This role model will figure in all subparts of IEC SRD 62913-2 (see Figure 11).

Several types of relations can be highlighted, such as:

- relations between domains, which can be deduced from relations between business use cases from different domains or between business use cases and roles from different domains;
- relations between roles, deduced from 'inherited' relationships;
- relations between a role and several use cases;
- relations between business objects and reference schemas used to exchange them (e.g. XSD, JSON schema);
- relations between use cases and non-functional requirements, in order to describe supported communication protocols.

Note that the importance of the relations between domains or roles is represented on the diagrams by the thickness of the line between them (illustrated in Figure 12).

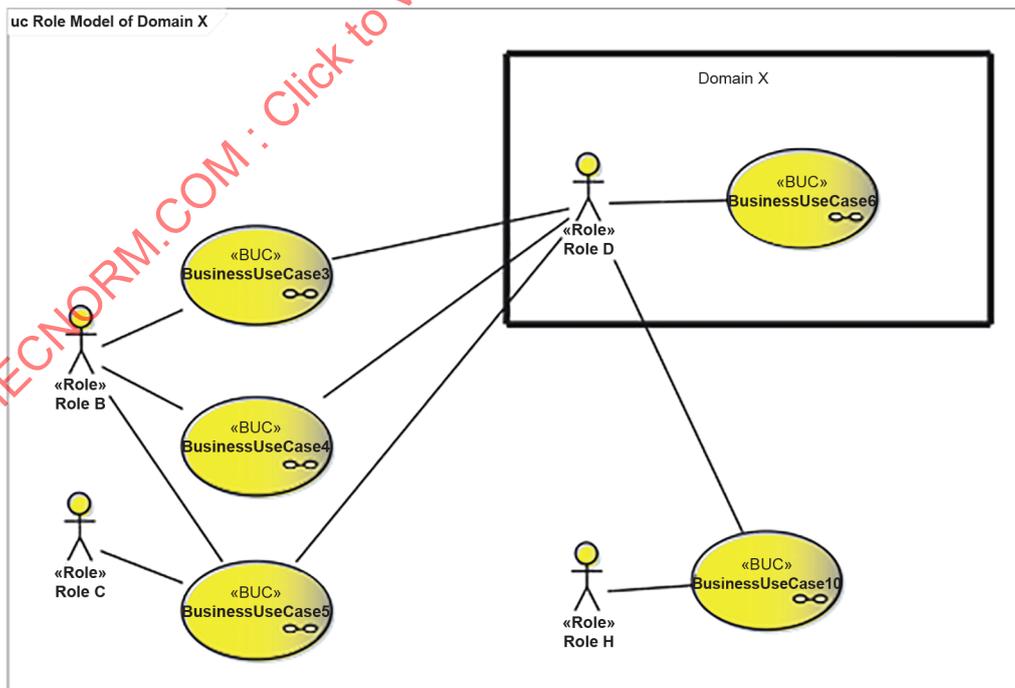

IEC

Figure 11 – Example of representation of a domain's role model

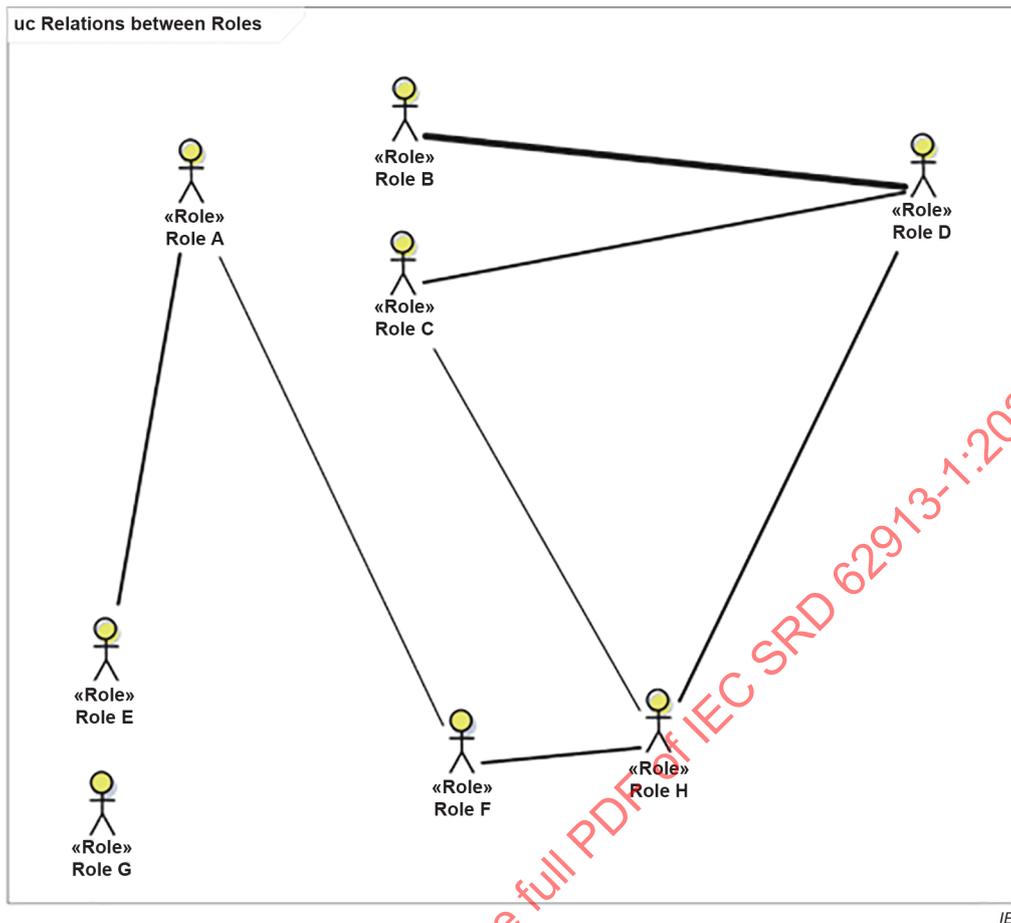


Figure 12 – Example of representation of relations between roles

6 UML profile for modelling smart grid use cases

6.1 A formal approach of use cases modelling

6.1.1 General

Subclause 6.1 presents the benefits of a formal use case model within a model-driven engineering context and proposes a UML profile to model a use case. This UML profile for describing IEC SRD 62913 series use cases is aligned with the IEC 62559 series which enables direct mapping with serialized IEC 62559-3 exchange format and automation such as import and export capability between IT environments, coherency analysis, validation, and other engineering automations (documentation generation, code generation).

Based on this profile, other work extensions can be provided; for example, it will be now possible to align this work with enterprise architecture meta-models.

6.1.2 Key principles

To ensure consistency in the UML use case approach and to tailor the IEC 62559 use case methodology to the need of deriving generic smart grid requirements, this document sets up key principles for use cases modelling.

a) Organize information

During the modelling phase of the system with this approach, information will quickly grow. However, having more data is only helpful when it is possible to manage it in order to retrieve the desired bits of information. Therefore, to preserve its usefulness an organization system

needs to be set up. In particular, this system needs to be able to facilitate the exploration of the data and minimize the redundancy.

b) Remove ambiguity

Project teams using this UML use case approach will generally comprise people with various backgrounds. Therefore, people can be novices in the modelling domain. To soften the learning curve and to foster communication, a first step is to remove ambiguity: assign one clear purpose to each UML notion (e.g. diagram).

c) Prefer practicality

Use cases are written in the context of the general specification of a system. All information in use cases helps to write this specification. Therefore, use case delivers value only if its data are relevant and understandable to members of the system domain. For example, an action on comprehension can be: other things being equal, use case needs to respect standards of the domain (e.g. vocabulary). The potentially already existing use cases should be used as archives.

6.2 UML-driven top-down approach methodology

6.2.1 Formalism and objectives

Use case methodologies possess a low-level of formalism using semi-structured data. The constraint to conform to an IEC standard favours a higher level of formalism to enable automated processes (transformation, analyses). A formal model also facilitates the creation, selection and management of information described by use cases.

To model a use case, different elements need to be considered.

- A first level of description outlines information specific to the use case under study, such as its roles or its activities. This information can be modelled using UML diagrams.
- A second level of description covers information specific to the system under design, which is shared between all use cases. This includes any information required to position a use case within the system, such as its relations with other domains or with other use cases.

Moreover, information can be structural or behavioural. Structural information describes static properties of an entity, such as the roles that interact with a use case. Behavioural information represents dynamic properties. For example, the execution of an activity in a flowchart depends on previous executed activities.

To benefit from a high level of formalism with limited disadvantages, this methodology creates two kinds of artefact: diagram and view. A diagram describes visually a system in a use case context. It needs to strictly conform to a meta-model and therefore possesses a high level of formalism. Diagrams contain reference data and need to minimize information redundancy. Therefore, diagrams are used to input information during the creation phase. Views do not conform to a meta-model and therefore allow for more freedom and creativity. Views are used to communicate on use cases but do not contain reference data.

6.2.2 Modelling language

Criteria to select a modelling language were a widespread dissemination to reduce the learning curve, a strong ecosystem to provide mature tools and technologies, a visual representation to facilitate manipulation and comprehension and a customization capability. UML (Unified Modeling Language) maintained by the OMG (Object Management Group) is widely used and possesses high expressivity power to describe workflows.

The methodology retains UML for three reasons. Firstly, it can be used not only to model processes but also data for example. Secondly, it has strong customization capability (profile). Thirdly, the initial community using the methodology was more familiar with UML and UML is mentioned as the preferred choice in IEC 62559-2 for diagramming use cases. In a technical context, this methodology respects the standard model-driven architecture (MDA) approach and

its formalism is defined through a UML profile. Figure 13 describes the position of this methodology within the four-layer architecture from the OMG.

Specific notions like business use cases or system use cases are defined through a dedicated UML profile in the M1 layer. Then a model using these elements applies the UML profile to represent structured information in coherence with the IEC SRD 62913 series and the IEC 62559 series. Therefore, a specification written with this methodology is an instantiation of the model presented in the M1 layer.

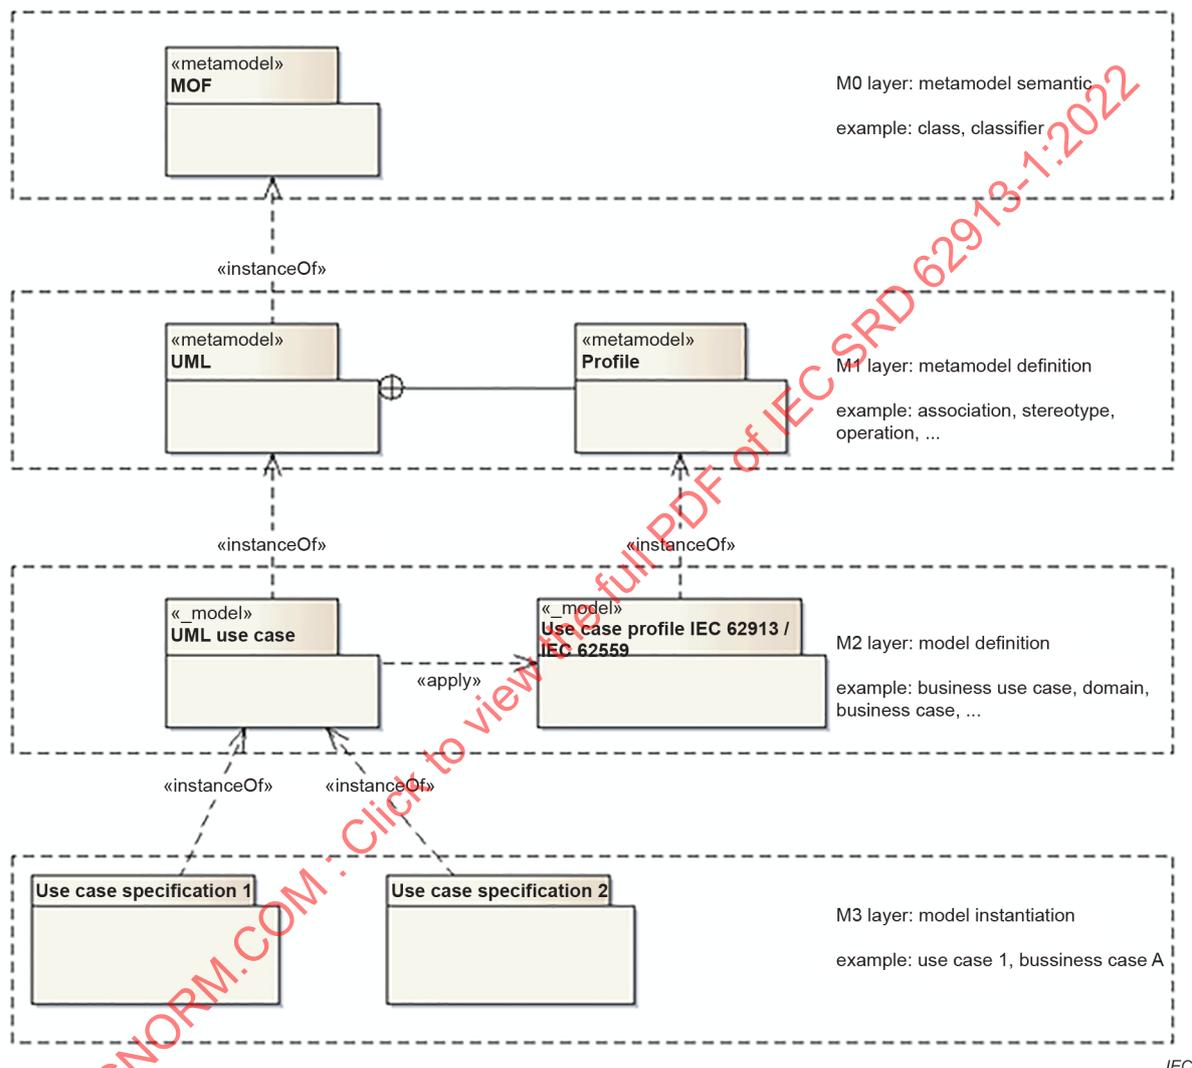


Figure 13 – Four-layer model architecture

UML models can be mapped over ArchiMate models, such as the IRM (Interface Reference Model). For this purpose, correspondences can be made between UML and ArchiMate notions (e.g. classes, relations), so that a UML model can be converted into an ArchiMate model (and vice versa), thanks to model-driven engineering techniques.

Similarly, business use cases describing business processes can be mapped over BPMN models.

6.2.3 Scope and information type classification: diagrams and main elements

To organize information, an organization plan is built around two axes: scope and information type.

The first axis, scope, allows the description of the system to be refined through a list of successive scopes. Each successive scope increases the level of detail at the cost of a reduced perimeter. Therefore, each scope is built around a different set of main elements. The following scopes exist.

- The first scope has the specificity to position the system through its use case in its environment. The main elements are the domains and business cases. A business case explains why a course of action is aligned with enterprise goals. The obligation to associate business use cases to business cases ensures that use cases deliver value and support the enterprise strategy.
- The second scope is built around the use case element. A use case is a specification of a set of actions performed by a system which yields an observable result that is of value for one or more actors or other stakeholders of the system (definition from IEC 62559-2). Moreover, a use case in the IEC SRD 62913 series is specialized into a business use case (BUC) or a system use case (SUC) to describe the business and system points of view, respectively. A use case represents an information unit of the system that can be disputed and understood on its own.
- The third scope details a part of a use case through a scenario. A scenario describes a workflow that achieves some goals of the use case. To facilitate the combination of scenarios to model the use case workflow, a scenario is not considered like a simple alternative to a normal or best path.
- The fourth scope uses the main element activity to add finer grained details. An activity represents a step of process that can be accomplished by one or more roles. In the case of a complex system, an activity can be subdivided into a set of internal activities. This scope is also used to describe information exchanges.

The second axis, information type, is used to classify information in two categories: structural, and behavioural.

- Structural information belongs to the overview diagrams. These diagrams present static data about a main element. For example, a use case overview diagram shows objectives of a use case. This information is independent of the current execution state of the use case.
- Behavioural information belongs to the flowchart diagrams. These diagrams describe a process through a graphical representation of a workflow. For example, the execution of a scenario can be described with a succession of activities.

6.2.4 Key benefits

6.2.4.1 From a formal meta-model

A meta-model is a model of a model (i.e. an abstraction of an abstraction). A meta-model can be seen as the grammar of the model. To remove ambiguity and to allow a program to reason on the model, we choose a formal meta-model. In our proposed UML approach, we can gain two major benefits from our meta-model: model verification and transformation.

The verification can check if the model respects formally the semantics and the syntax defined in the meta-model. However, the same mechanism can be used to improve the quality of model by detecting suspicious choices and proposing to refactor these parts.

Model transformation is at the heart of the model-driven architecture (MDA). A meta-model allows defining transformation between semantic concepts. These transformations are then instantiated and applied on models. Model transformation can generate views, exchange files, listing reports, etc. from information found in diagrams in the model.

Moreover, the content coherence can be analysed by business experts thanks to the use of generated views simplifying and aggregating details of a set of use cases for the specific different purposes depending on the responsibility of each expert.

6.2.4.2 From free views

The use case methodology, described in IEC 62559, considers strongly its environment. Use cases are useful to establish a general specification of a system. However, this specification needs input data (business case, strategic vision, enterprise goal, etc.) and will be refined through detailed specifications. During these phases, various points of view will be taken on the system. To maximize the usefulness of use case, it is required to analyse its data and present it in various views.

In our approach, we fulfil this requirement by introducing the notion of view, a non-formalized diagram. Views are used to communicate, show a subset of inputted or deduced data from the use cases.

6.2.4.3 From conformity with standard

This UML use case approach has been developed first and foremost to support the IEC 62559 series and the IEC SRD 62913 series. Conformity with standards ensures an alignment of the approach with internationally approved practices that have been refined through various field experiments. For example, the core concept of categorization of use case in business and system use case derives straight from IEC 62559-2. Sharing concepts at an international level allows creating a common use case set that will be the foundation of a common comprehension of a domain (like smart grid). IEC 62559 also defines interoperable exchange file formats to facilitate the creation of this use case set (see Figure 14).

The choice of a modelling language, a UML profile, which respects a well-established specification by the Object Management Group, allows compatibility with a large set of modelling tools. It also reduces significantly the learning curve by leveraging an adopted core semantic. UML can be mapped over other modelling language standards, such as ArchiMate or BPMN.

Use cases are useful as input to other models or processes and therefore need to be analysed, transformed, converted. To do so use cases need to be formal, a possible approach to fulfil this prerequisite. The UML profile introduced in this document for describing IEC SRD 62913 series use cases is aligned with the IEC 62559 series which enables direct mapping with serialized IEC 62559 exchange format and automation such as import and export capability between IT environments, coherence analysis, validation, and other engineering automations (documentation generation, code generation, etc.).

- IEC TR 62559-1 defines the use case methodology and core concepts.
- IEC 62559-2 defines the structure of a use case template, template lists for actors and requirements, as well as their relation to each other.
- IEC 62559-3 defines an XML based format for exchanging use case descriptions between IT environments (IEC repository, UML modelling tools, other modelling tools, private enterprise repository, etc.).
- IEC SRD 62559-4 gives best practices in use case development for IEC standardization processes and some examples for application outside standardization.

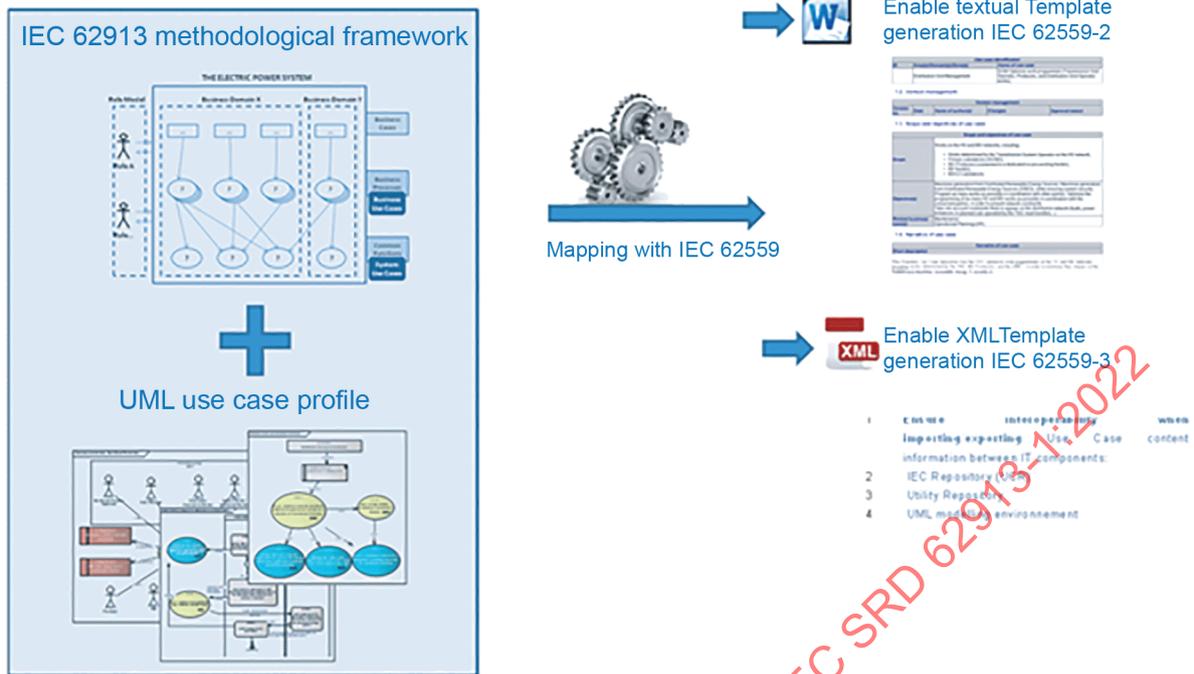


Figure 14 – UML use case profile for the IEC SRD 62913 series aligned with the IEC 62559 series

6.2.4.4 From requirement engineering

Requirements of different kinds help to precisely characterize business use cases, system use cases and systems and facilitate tests. They can be identified in business use cases, then be reused and refined in system use cases.

Requirements are used along whole software development processes: waterfall processes (i.e. sequences of specification, design, development and test phases) and agile processes.

Requirements facilitate stronger alignments with SGAM, in particular thanks to non-functional requirements related to SGAM communication layer.

Requirements can change. Thus, requirements' updates or removals (when requirements are no longer needed or are deprecated) should be tracked, in order to facilitate impact analysis and non-regression tests.

6.2.5 Types of diagrams and views

Four types of diagrams (with several views) are recommended to be used:

- use case overview diagram;
- domain overview diagram;
- BUC-SUC relations diagram;
- use case "flowchart" (activity and/or sequence).

The first type of diagram is the use case overview diagram (see Figure 15). This diagram contains structural information. It presents the main properties of a use case such as objectives or scenarios, and the major associated entities. It can be considered as an alteration of the standard UML use case diagram with additional information.

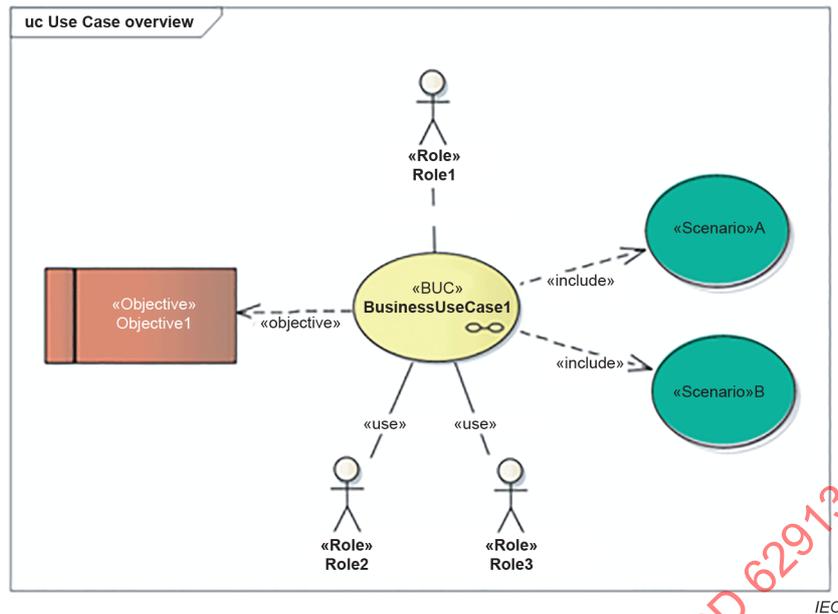


Figure 15 – Use case overview diagram

The second type of diagram is the domain overview diagram (Figure 16). This diagram describes the system under design and contains structural information. It details the business context of the business use case under study by highlighting relations with other business use cases, strategic goals (business cases), and domains. Note that a business use case can be linked to business use cases from other domains.

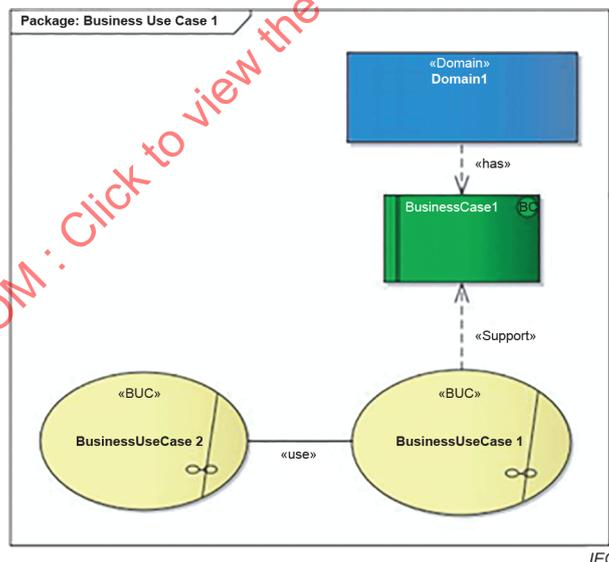


Figure 16 – Domain overview diagram

The third type of diagram is the BUC-SUC relations diagram (see Figure 17). This diagram highlights the relations between a business use case and its supporting system use cases. The latter describe the functions required to execute the business use case under study. These functions can be grouped within functional system groupings, i.e. information systems.

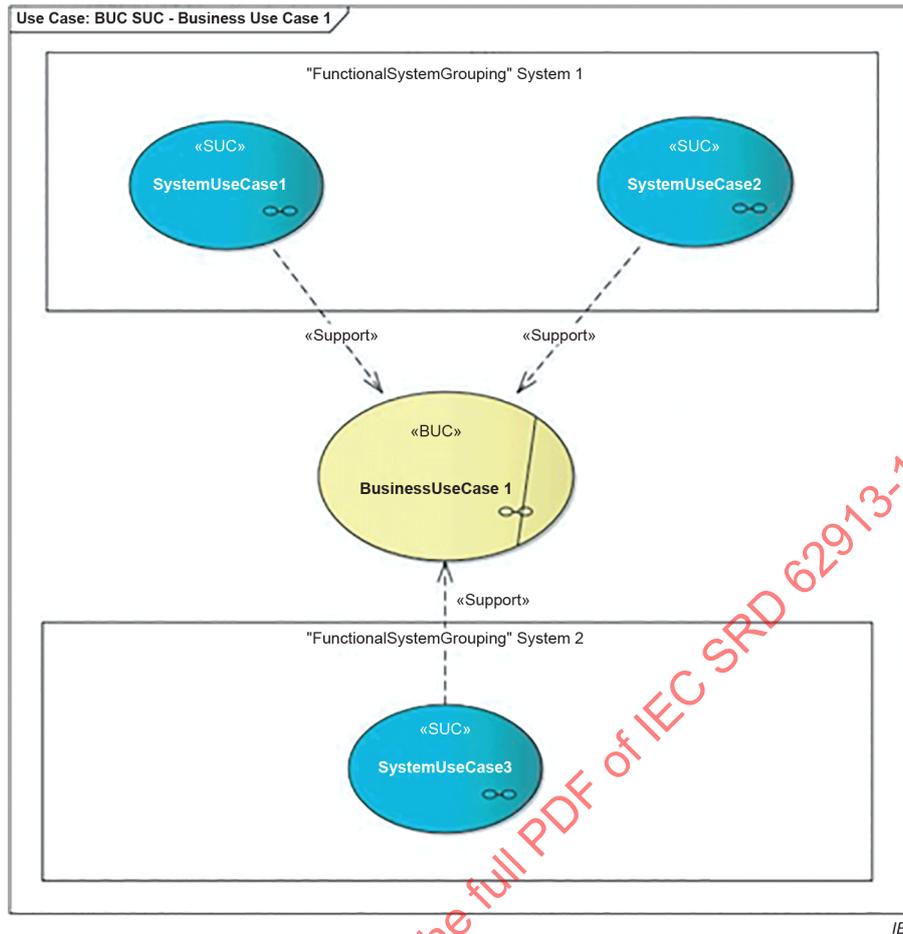


Figure 17 – BUC-SUC relations diagram

The fourth type of diagram is the **flowchart**. This diagram contains behavioural information. It describes the internal process of the use case during its execution, through scenarios and activities. It is possible to represent the system use cases called by the steps of the business use case under study. Modelling approaches used are UML activity diagram.

6.3 IEC use cases UML profile concepts

Use case concepts are listed in Table 3 and illustrated in Figure 18. The first column gives the name of the stereotype possibly followed by its attributes, the second column indicates which metaclass is extended and the third column provides short texts of description.

In this list, some stereotypes seem to be already present in basic UML like "activity". There are three reasons for this overlap. The first one is to allow greater flexibility when adapting the visual representation. The second one is to facilitate model manipulation by identifying clearly elements relevant to use cases. The third and last one is to anticipate future needs. Base metaclass defines what kind of association can be used between stereotyped elements.

Table 3 – Use cases concepts

Stereotype	Metaclass	Description of the use cases concept
Activity	Activity	An activity describes a part of a scenario that can be executed by one or more roles. The details of an activity are described through actions. However, if it is necessary, intermediate levels can be created where activities describe an activity.
Activity set	Activity region	An activity set groups activities executed by the same business roles and/or system roles.
Actor	Class	Entity that communicates and interacts.
Area	Class	Major usage area for use cases which supports grouping, filtering and administration of use cases within a common use cases database.
Assumption	Class	Is a constraint that shall be verified in order to have a valid use case.
Business case	Class	An explanation or set of reasons describing how a business decision will improve a business, product, etc. and how it will affect costs, profits and attract investments, equivalent to strategic goals and principles of a domain.
Business object	Class	Describes information exchanged. It defines the nature of the information.
Business role	Class	A business role describes a finite set of responsibilities that is assumed by a party (organizations, organizational entities or physical persons).
Business use case	UseCase	Describe how business roles of a given system interact to execute a business process. These processes are derived from services, i.e. business transactions, which have previously been identified.
Contain	Dependency	Indicates an inclusion relationship between two elements.
Domain	Class	Area of knowledge or activity characterized by a set of concepts and terminology understood by the practitioners in that area [OMG UML]. A domain offers several business cases.
Has	Dependency	Denotes that an entity can only carry a comprehensible, useful meaning in relation with another entity. It is a directional relation. Moreover, if the source entity becomes irrelevant, the target entity also becomes irrelevant.
Key performance indicator	Class	Assesses the level of success of an objective.
Is mapped over	Dependency	Allows to establish a mapping between entities belonging to different semantic area.
Objective	Class	Refers to the goal of a use case. The success of an objective can be gradual and is assessed with key performance indicators.
Postcondition	Class	A condition that shall hold true when the associated execution (scenario, macro-activity, action) is finished.
Precondition	Class	A condition that shall hold true when the associated execution (use case, scenario, macro-activity, action) is beginning.
Requirement	Class	A requirement linked to any object shall always be verified if the model is valid. A requirement can be seen as an invariant. A requirement can be functional or not (indicated by its category).
Scenario	Activity	Is a possible sequence of interactions [SG-CG/M490/E:2012-12 def 3.10].
Support	Dependency	An entity supports another one if it contributes to its process/goal.
System role	Class	A system role describes a finite set of functionalities that is assumed by an entity (devices, information system, equipment).
System use case	UseCase	Describes how system and/or business roles of a given system interact to perform a smart grid function required to enable or facilitate the business processes described in business use cases. Their purpose is to detail the execution of those processes from an information system perspective.
Use	Dependency	Describes a bidirectional association. Each of the linked entities can be understood without the other. Moreover, each entity can be employed in a very large panel of situations.

Stereotype	Metaclass	Description of the use cases concept
Use case Classification Complete description Remark Scope Keyword LevelOfDepth Nature Prioritization	UseCase	Is a specification of a set of actions performed by a system which yields an observable result that is of value for one or more actors or other stakeholders of the system (IEC 62559-2). Information is structured through classification, complete description, remark and scope properties. Meta-information is written in keywords (tags), level of depth (granularity), nature (black-white box) and prioritization (international, national, regional, etc.) properties.
Zone	Class	Automation levels, classified in combination with a reference architecture

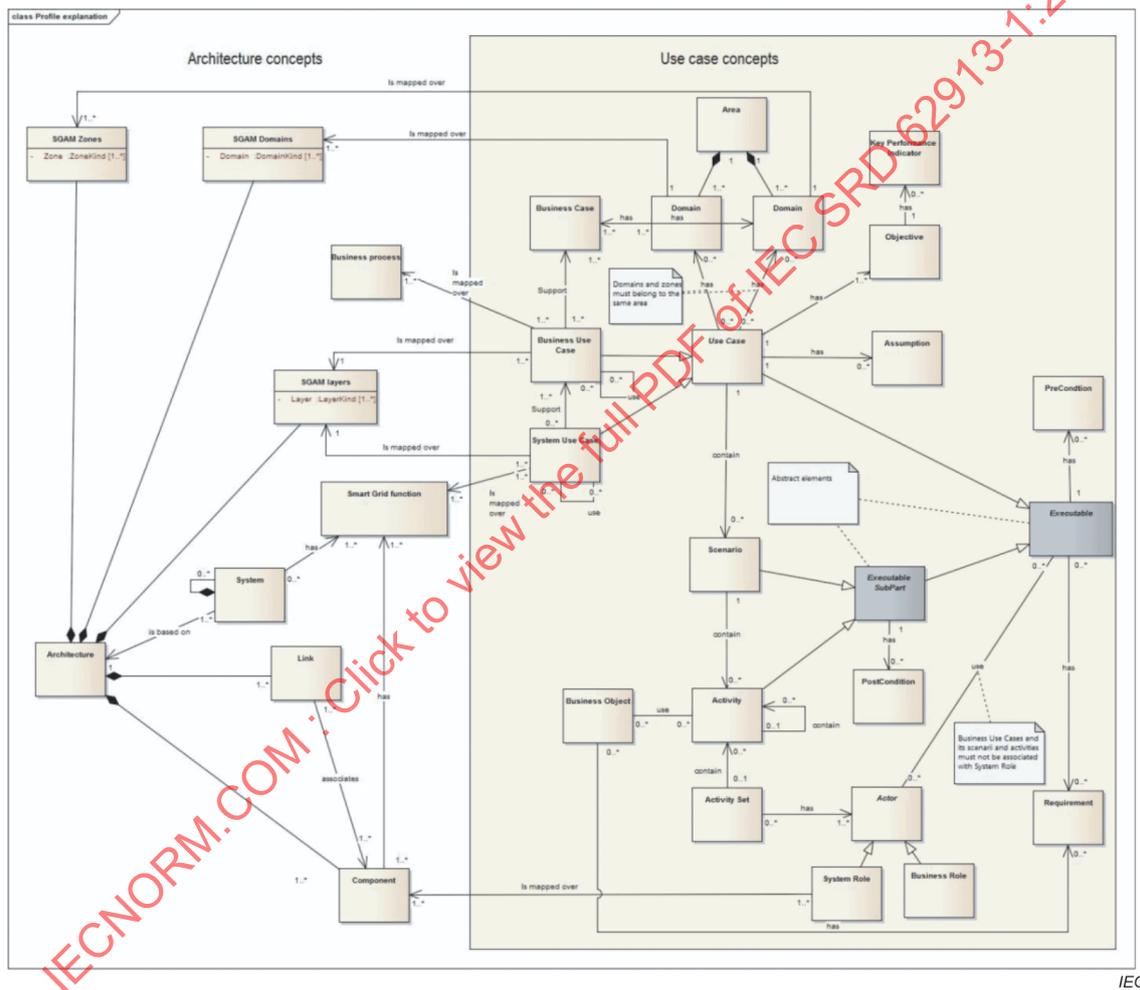



Figure 18 – Mapping between use case concepts and architecture concepts

7 UML modelling diagrams

Figure 19 to Figure 23 show the diagrams subsets. To complete these subsets, purely graphical elements like note or boundary are allowed.


Flowchart diagrams are based on UML activity diagram and describe steps of a process that can be a use case, a scenario or an activity. To organize information, in a flowchart diagram, all steps are described by a same type of element: scenario or activity. Moreover, exchanges of information occur only at the activity scope and these exchanges instantiate business object.

To specify roles interacting during an exchange, activities are located inside activity sets. The activity sets are then linked to roles.

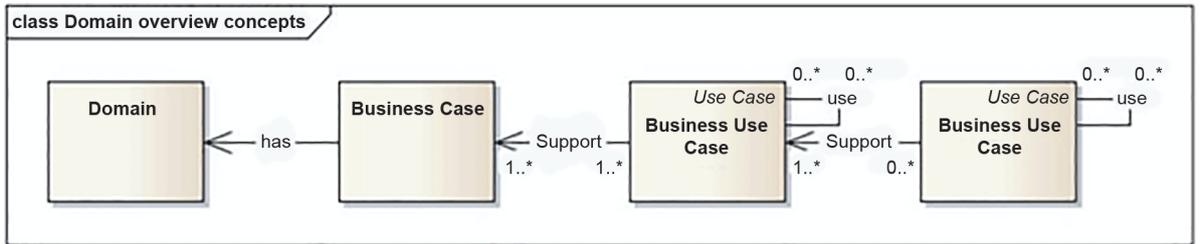

IEC

Figure 19 – Domain overview concepts UML model

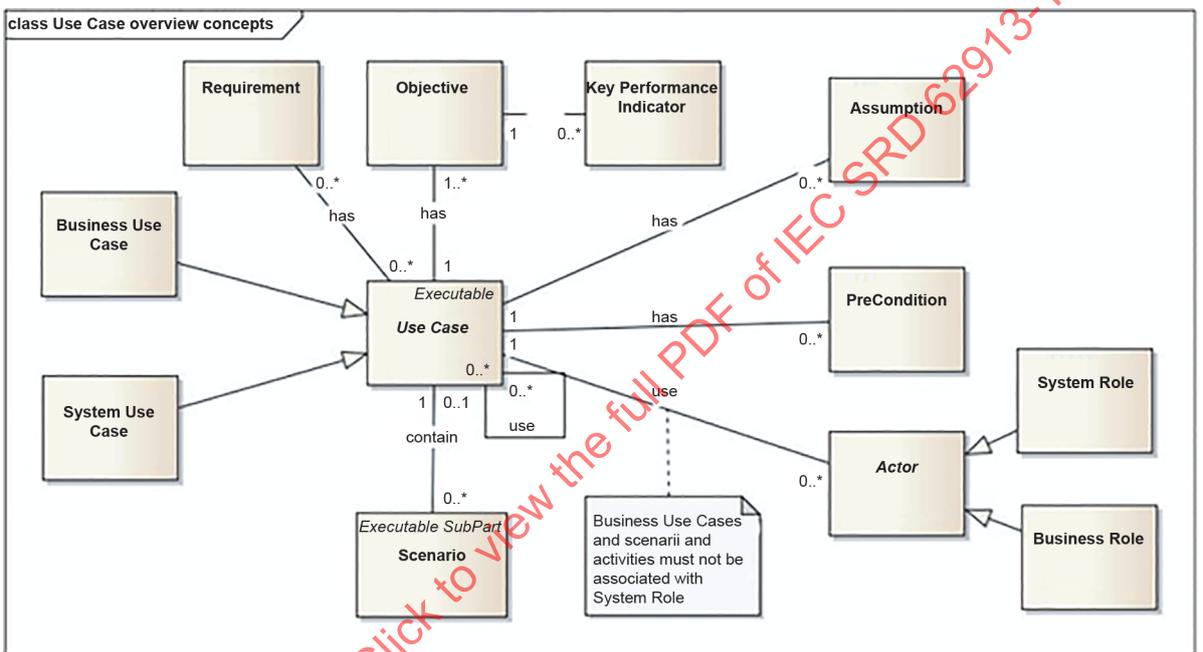

IEC

Figure 20 – Use case overview concepts UML model

IECNORM.COM : Click to view the full PDF of IEC SRD 62913-1:2022


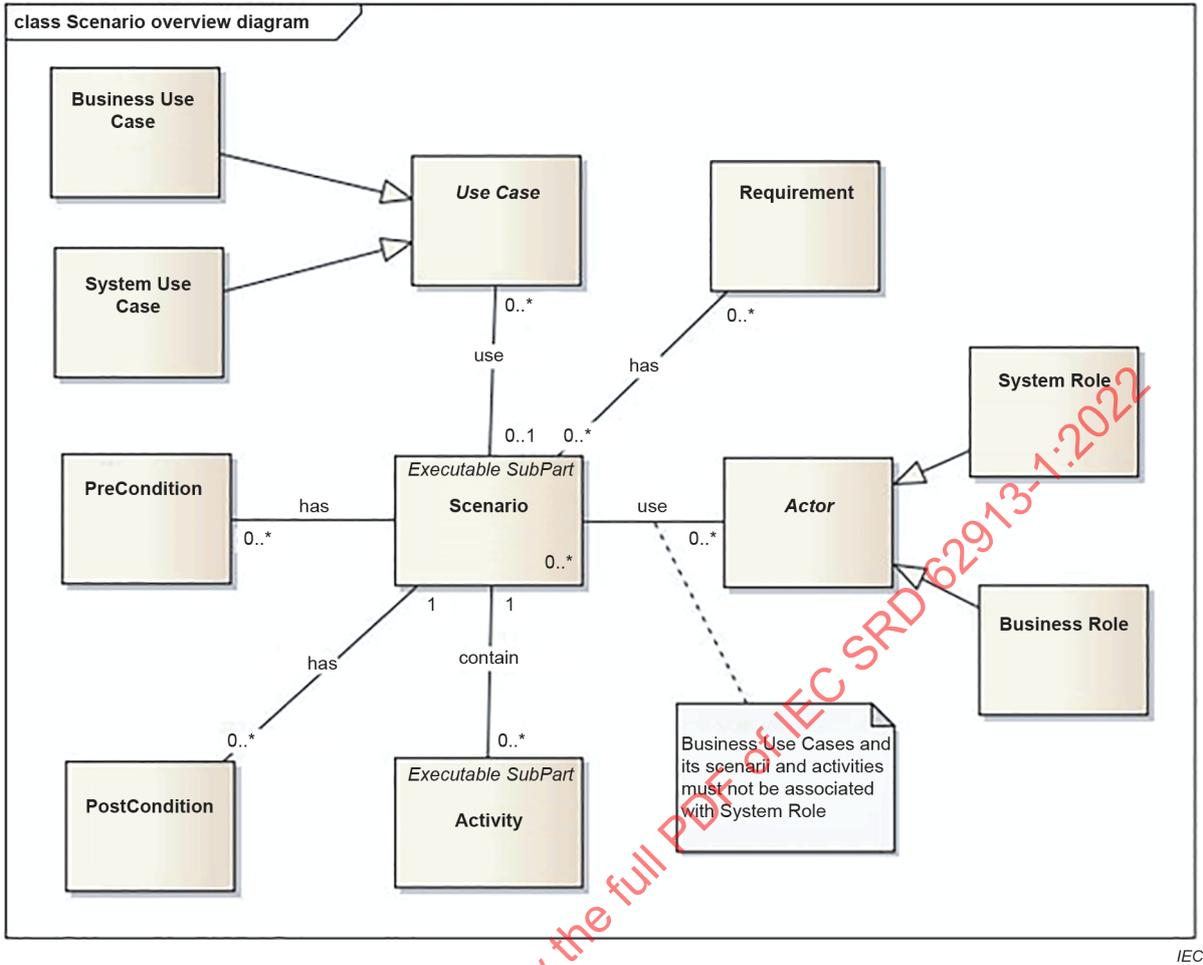



Figure 21 – Scenario overview concepts UML model

IECNORM.COM : Click to view the full PDF of IEC SRD 62913-1:2022

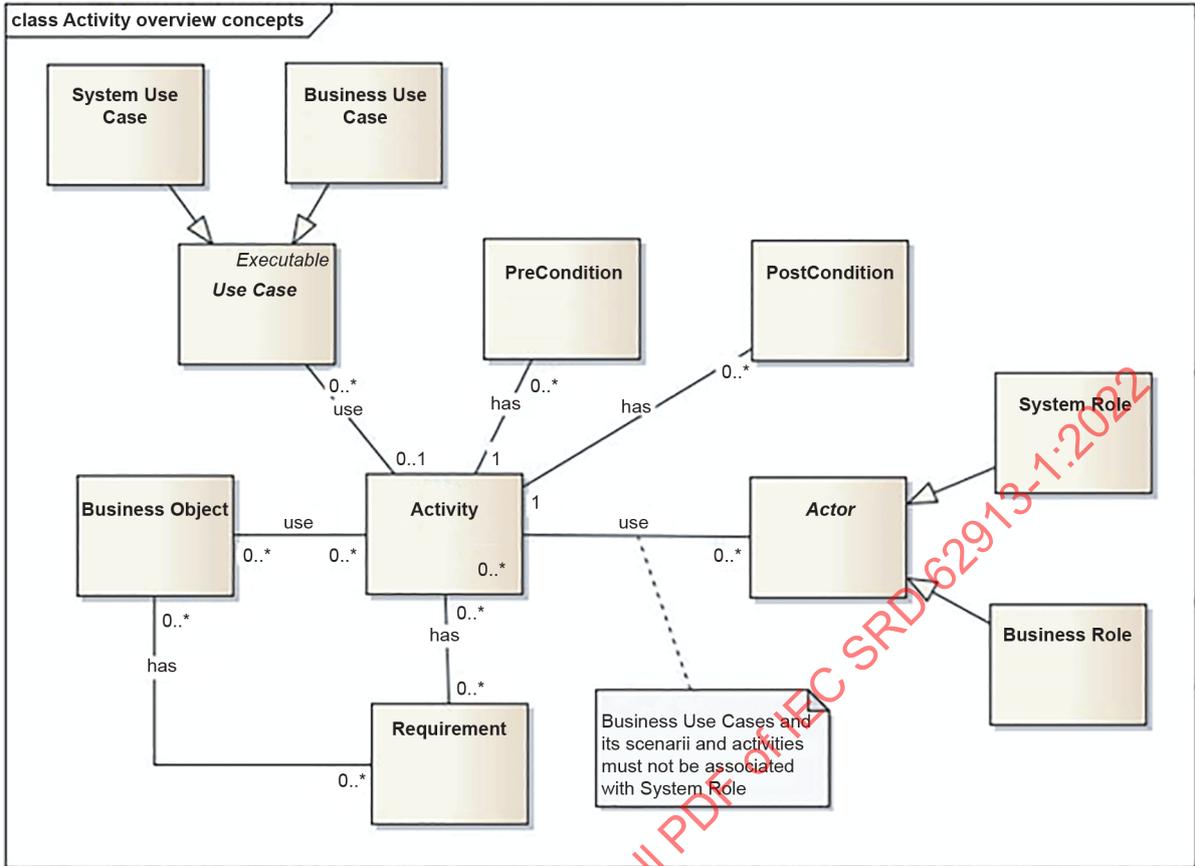

IEC

Figure 22 – Activity overview concepts UML model

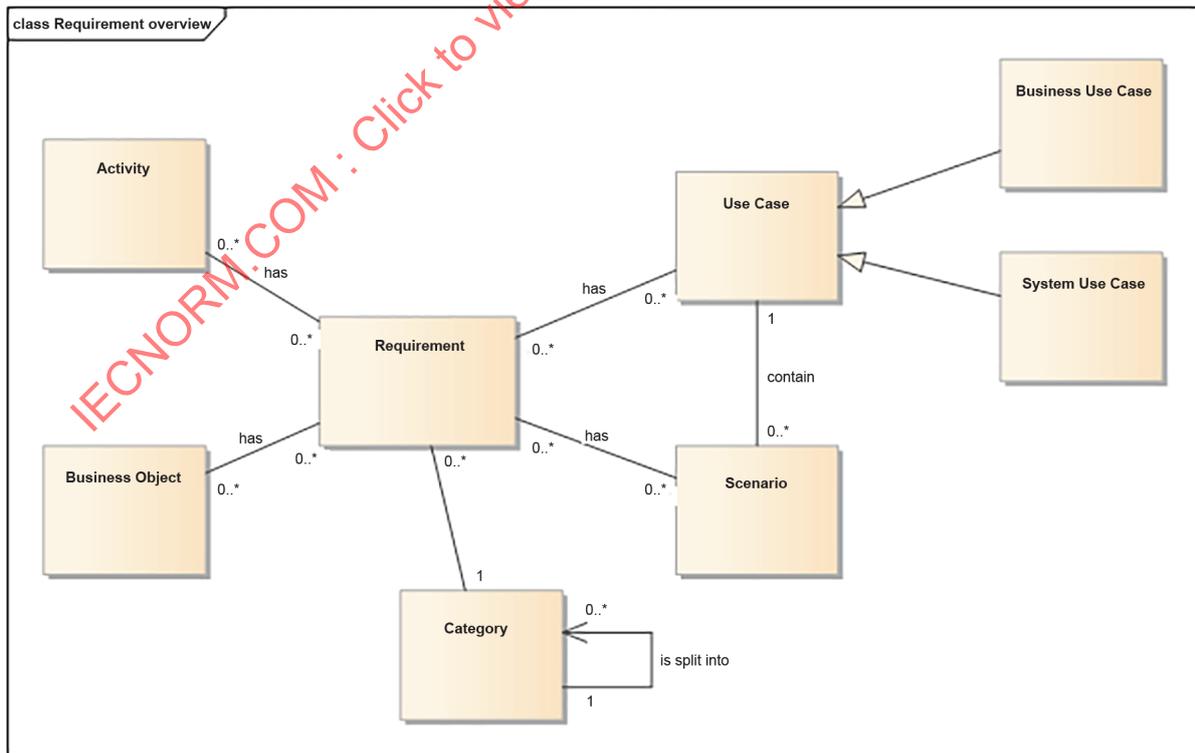

IEC

Figure 23 – Requirement overview concepts UML model

Annex A (informative)

Existing Actors Lists

- CEN/CENELEC/ETSI Actors List from CEN-CENELEC-ETSI Smart Grid Coordination Group – Sustainable Processes (2012), based on:
 - IEC 61968 Interface Reference Model (which is described in IEC 61968-1);
 - harmonized electricity market role model;
 - SMCG: Smart Meter Coordination Group associated with M441 mandate.
- NIST IKB Actor List (draft in progress, v1.1.3 last updated on 8 August 2013), document consolidating and harmonizing Actors from:
 - Energy Information Standards (EIS) Alliance Customer Domain use cases Version 3.01 (21th May 2010);
 - NIST's Framework and Roadmap Version 1.0: Conceptual Model (10 August 2009);
 - NIST's Framework and Roadmap Version 1.0 – Chapter 4 + two new areas AMI (10 August 2009);
 - NAESB;
 - NIST's CSWG NISTIR (July 2009);
 - IEEE P2030 Draft3.0, Chapter 6 Power system Actors (July 2009);
 - SGAC Conceptual Architecture – Interaction Diagrams (1 March 2012).
- IREB (International Requirements Engineering Board) NIST IKB Actor List (draft in progress, v1.1.3 last updated on 8 August 2013), document consolidating and harmonizing Actors from:
 - a non-profit organization founded in 2006. Consists of leading requirements engineering representatives, who come from science, research, industry and consulting;
 - provider of the CPRE (Certified Professional for Requirements Engineering) certification scheme.

IECNORM.COM : Click to view the full PDF of IEC SRD 62913-1:2022

Annex B (informative)

Content of the use case mapped on IEC 62559-2 template

B.1 Description of the use case

B.1.1 Name of use case

Use case identification		
ID	Area / Domain(s)/ Zone(s)	Name of use case
Use case overview / BUC or SUC / tagged value(identifier)	Domain overview / each domain associated through business cases / name	Use case overview / BUC or SUC / name

B.1.2 Version management

Version management				
Version No.	Date	Name of author(s)	Changes	Approval status
Documentation / Versions / name of the attribute	Documentation / Versions / tagged value(date)	Documentation / Versions / tagged value(authors)	Documentation / Versions / note of the attribute	Documentation / Versions / tagged value(status)

B.1.3 Scope and objectives of use case

Scope and objectives of use case	
Scope	Documentation / Narrative / note of attribute scope
Objective(s)	Use case overview / each objective / name: note (one line per objective)
Related business case(s)	Domain overview / each associated business case / name: note (one line per business case)

B.1.4 Narrative of use case

Narrative of use case
Short description
Use case overview / BUC or SUC / note
Complete description
Documentation / Narrative / note of attribute completeDescription
<u>Summary of use case</u>
<ul style="list-style-type: none"> Each scenarios flowchart / each scenario / name
<u>Description:</u> note
<ul style="list-style-type: none"> Each activities flowchart / each activity / name
<u>Description:</u> note
<ul style="list-style-type: none"> Each activities flowchart / each activity / name ...

B.1.5 Key performance indicators (KPI)

Key performance indicators			
ID	Name	Description	Reference to mentioned use case objectives
Use case overview / each objective linked to the use case / each KPI linked to the objective / sequential number	Use case overview / each objective linked to the use case / each KPI linked to the objective / name of the KPI	Use case overview / each objective linked to the use case / each KPI linked to the objective / note of the KPI	Use case overview / each objective linked to the use case / each KPI linked to the objective / name of the objective

B.1.6 Use case conditions

Use case conditions	
Assumptions	
Use case overview / each strategic assumption / sequential number	Use case overview / each strategic assumption / name: note
Prerequisites	
Use case overview / each precondition assumption / sequential number	Use case overview / each precondition / name: note

B.1.7 Further information to the use case for classification / mapping

Classification information
Relation to other use cases
Each associated BUC or SUC / <<stereotype>>[tagged value(identifier)]name
Level of depth
Documentation / Classification information / note of attribute <i>levelOfDepth</i>
Prioritisation
Documentation / Classification information / note of attribute <i>prioritisation</i>
Generic, regional or national relation
Documentation / Classification information / note of attribute <i>classification</i>
Nature of the use case
Use case overview / BUC or SUC / stereotype
Further keywords for classification
Documentation / Classification information / note of attribute <i>keywords</i>

B.1.8 General remarks

General remarks
Documentation / each general remarks / name: note

B.2 Diagrams of use case

Diagram(s) of use case
Documentation / Images / copy of the image linked to in the note of each attribute + Copy of all the diagrams directly under the use case