

TECHNICAL REPORT

IEC
TR 61000-5-6

First edition
2002-06

PUBLICATION FONDAMENTALE EN CEM
BASIC EMC PUBLICATION

Electromagnetic compatibility (EMC) –

Part 5-6: Installation and mitigation guidelines – Mitigation of external EM influences

Compatibilité électromagnétique (CEM) –

*Partie 5-6:
Guides d'installation et d'atténuation –
Atténuation des influences électromagnétiques externes*



Reference number
IEC/TR 61000-5-6:2002(E)

Publication numbering

As from 1 January 1997 all IEC publications are issued with a designation in the 60000 series. For example, IEC 34-1 is now referred to as IEC 60034-1.

Consolidated editions

The IEC is now publishing consolidated versions of its publications. For example, edition numbers 1.0, 1.1 and 1.2 refer, respectively, to the base publication, the base publication incorporating amendment 1 and the base publication incorporating amendments 1 and 2.

Further information on IEC publications

The technical content of IEC publications is kept under constant review by the IEC, thus ensuring that the content reflects current technology. Information relating to this publication, including its validity, is available in the IEC Catalogue of publications (see below) in addition to new editions, amendments and corrigenda. Information on the subjects under consideration and work in progress undertaken by the technical committee which has prepared this publication, as well as the list of publications issued, is also available from the following:

- **IEC Web Site** (www.iec.ch)

- **Catalogue of IEC publications**

The on-line catalogue on the IEC web site (www.iec.ch/catlg-e.htm) enables you to search by a variety of criteria including text searches, technical committees and date of publication. On-line information is also available on recently issued publications, withdrawn and replaced publications, as well as corrigenda.

- **IEC Just Published**

This summary of recently issued publications (www.iec.ch/JP.htm) is also available by email. Please contact the Customer Service Centre (see below) for further information.

- **Customer Service Centre**

If you have any questions regarding this publication or need further assistance, please contact the Customer Service Centre:

Email: custserv@iec.ch
Tel: +41 22 919 02 11
Fax: +41 22 919 03 00

TECHNICAL REPORT

IEC TR 61000-5-6

First edition
2002-06

PUBLICATION FONDAMENTALE EN CEM
BASIC EMC PUBLICATION

Electromagnetic compatibility (EMC) –

Part 5-6: Installation and mitigation guidelines – Mitigation of external EM influences

Compatibilité électromagnétique (CEM) –

*Partie 5-6:
Guides d'installation et d'atténuation –
Atténuation des influences électromagnétiques externes*

© IEC 2002 — Copyright - all rights reserved

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Electrotechnical Commission, 3, rue de Varembé, PO Box 131, CH-1211 Geneva 20, Switzerland
Telephone: +41 22 919 02 11 Telefax: +41 22 919 03 00 E-mail: inmail@iec.ch Web: www.iec.ch



Commission Electrotechnique Internationale
International Electrotechnical Commission
Международная Электротехническая Комиссия

PRICE CODE

X

For price, see current catalogue

CONTENTS

FOREWORD.....	3
INTRODUCTION.....	5
1 Scope and general considerations.....	6
1.1 Scope.....	6
1.2 General considerations.....	6
2 Reference documents.....	8
3 Terms, definitions and acronyms.....	10
4 Mitigation of radiated and conducted disturbances.....	13
4.1 Topological concepts.....	13
4.2 Mitigation needs.....	14
4.3 The general concept of enclosure.....	15
4.4 Interactions at the enclosure boundary.....	16
5 Shielding.....	16
5.1 General.....	16
5.2 Classification of protection zones.....	18
5.3 Design principles for screening.....	19
5.4 Implementation of screening.....	21
6 Filters.....	26
6.1 General.....	26
6.2 Fundamental filter characteristics.....	27
6.3 Functional tasks.....	29
6.4 Additional filtering concerns.....	30
6.5 Selection criteria.....	30
6.6 Filter installation.....	33
6.7 Filter testing.....	36
7 Decoupling devices.....	37
7.1 Isolation transformers.....	37
7.2 Motor-generator sets.....	39
7.3 Engine generators.....	40
7.4 Uninterruptible power supplies (UPS).....	40
7.5 Optical links.....	41
8 Surge-protective devices.....	41
8.1 General.....	41
8.2 Direct equipment protection.....	42
8.3 Installation of multiple SPDs.....	43
8.4 Side-effects of uncoordinated cascades.....	44
8.5 Typical protective devices.....	44
Bibliography.....	45

INTERNATIONAL ELECTROTECHNICAL COMMISSION

ELECTROMAGNETIC COMPATIBILITY (EMC) –**Part 5-6: Installation and mitigation guidelines –
Mitigation of external EM influences**

FOREWORD

- 1) The IEC (International Electrotechnical Commission) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of the IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, the IEC publishes International Standards. Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. The IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of the IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested National Committees.
- 3) The documents produced have the form of recommendations for international use and are published in the form of standards, technical specifications, technical reports or guides and they are accepted by the National Committees in that sense.
- 4) In order to promote international unification, IEC National Committees undertake to apply IEC International Standards transparently to the maximum extent possible in their national and regional standards. Any divergence between the IEC Standard and the corresponding national or regional standard shall be clearly indicated in the latter.
- 5) The IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with one of its standards.
- 6) Attention is drawn to the possibility that some of the elements of this technical report may be the subject of patent rights. The IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. However, a technical committee may propose the publication of a technical report when it has collected data of a different kind from that which is normally published as an International Standard, for example "state of the art".

Technical reports do not necessarily have to be reviewed until the data they provide are considered to be no longer valid or useful by the maintenance team.

IEC 61000-5-6, which is a technical report, has been prepared by subcommittee 77C: High power transient phenomena, of IEC technical committee 77: Electromagnetic compatibility. It has the status of a basic EMC publication in accordance with IEC Guide 107.

The text of this technical report is based on the following documents:

Enquiry draft	Report on voting
77C/110/CDV	77C/122/RVC

Full information on the voting for the approval of this technical report can be found in the report on voting indicated in the above table.

This document, which is purely informative, is not to be regarded as an International Standard.

The committee has decided that the contents of this publication will remain unchanged until 2007. At this date, the publication will be

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

A bilingual version of this technical report may be issued at a later date.

IECNORM.COM : Click to view the full PDF of IEC TR 61000-5-6:2002

INTRODUCTION

IEC 61000 is published in separate parts according to the following structure:

Part 1: General

General considerations (introduction, fundamental principles)

Definitions, terminology

Part 2: Environment

Description of the environment

Classification of the environment

Compatibility levels

Part 3: Limits

Emission limits

Immunity limits (in so far as they do not fall under the responsibility of product committees)

Part 4: Testing and measurement techniques

Measurement techniques

Testing techniques

Part 5: Installation and mitigation guidelines

Installation guidelines

Mitigation methods and devices

Part 6: Generic standards

Part 9: Miscellaneous

Each part is further subdivided into several parts published either as International Standards or as technical specifications or technical reports, some of which have already been published as sections. Others will be published with the part number followed by a dash and a second number identifying the subdivision (example: IEC 61000-6-1).

This part of IEC 61000 gives guidelines for the mitigation of external electromagnetic influences.

ELECTROMAGNETIC COMPATIBILITY (EMC) –

Part 5-6: Installation and mitigation guidelines – Mitigation of external EM influences

1 Scope and general considerations

1.1 Scope

This part of IEC 61000 covers guidelines for the mitigation of external electromagnetic influences impinging upon a facility, aimed at ensuring electromagnetic compatibility (EMC) among electrical and electronic apparatus or systems. These influences include lightning, RF transmitters, power-line and telecom transients, high-altitude electromagnetic pulse (HEMP) and other high-power electromagnetic transients. More particularly, this technical report is concerned with the arrangement of shielding and screening against radiated disturbances, and with mitigation of conducted disturbances. These arrangements include appropriate electromagnetic barriers for industrial, commercial, and residential installations.

The concept of barriers installed for mitigating potentially penetrating and unwanted electromagnetic noise is applicable even when there is no designed-in electromagnetic shield. The enclosure through which power and signal (communications, control, etc.) cables must enter or exit may be considered as a potential electromagnetic barrier that will provide some level of protection. The concept of enclosure can be understood as the perimeter walls of a building, the walls of a single room, or the housing of an apparatus, with protection installed at all points of electromagnetic penetration into the enclosure.

This technical report is intended for use by installers, manufacturers and users of sensitive electrical or electronic installations or systems, and of equipment with emission levels that could degrade the overall electromagnetic (EM) environment. It applies primarily to new installations but, where economically feasible, it may be applied to extensions or modifications to existing facilities. While the technical principles are applicable to individual equipment or apparatus, such application is not included in the scope of this technical report.

1.2 General considerations

1.2.1 Elementary interference control

In its simplest form, the interference problem consists of a source of disturbance, a victim and the medium between the two. Interference control consists of suppressing the disturbance source, strengthening the victim, or impeding the source-victim interaction through the medium. When the source is not controllable (for example, lightning, portable transmitters, HEMP, etc.), and the inherent strength of the victim is dictated by other considerations (for example, circuit density and operating power), interference control is relegated to the intervening medium. Furthermore, for interference control oriented toward victim protection, control measures tend to be applied fairly close to the susceptible circuits (at the system or subsystem levels).

Increasing the separation between them, enclosing one or the other in a shield or orthogonalizing them (for example, rejecting common-mode interference on differential-mode signalling lines) can reduce the interaction between source and victim. All three techniques can be combined to form a closed electromagnetic barrier between the source and the victim. For sources outside the system, the barrier may be applied at the system level. For sources inside the system, electromagnetic compatibility requires two barriers: one at the source to control emissions, and one at the victim to control susceptibility. This concept is illustrated in figure 1. In this technical report, we will concentrate on sources outside the system.

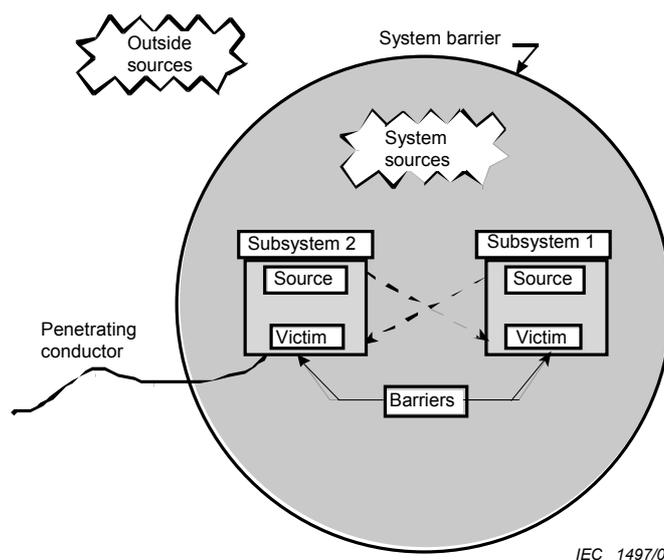


Figure 1 – System barrier topology

1.2.2 Shields and interfaces

Shields are used for attenuating the direct coupling of radiated electromagnetic disturbances from the external environment onto the internal electronics circuits and, conversely, to limit the radiation of disturbances from the internal circuits to the exterior, thus contributing to the electromagnetic compatibility (EMC) of the installation. The shields considered in this document are electromagnetically closed structures. Any form of electromagnetically open structure is not recommended for achieving a fully compliant installation. Some examples of structure shielding applications include

- telecom facilities, such as relay stations, multipurpose radio installations;
- TV and broadcasting studios;
- test rooms and laboratories (telecom, metrology, high-voltage engineering);
- metrology facilities in educational institutions;
- diagnostic and therapy rooms in medical facilities;
- computer rooms for business and industry.

Interface protection devices are used for mitigating the propagation of conducted electromagnetic disturbances from the environment into the internal electronics and may, conversely, limit the emission of disturbances from the internal electronics into the environment. This assumes that bi-directional protection devices are applied. Thus, when installed in conjunction with a shield, these devices contribute to achieving electromagnetic compatibility for the installation. Protection devices that will be discussed in this technical report include filters, decoupling devices and surge-protective devices (SPDs).

The filters considered in this document are limited to low-voltage passive circuits for high-frequency disturbances that are part of an installation. Filters and other interface devices incorporated in individual apparatus are not included within the scope of this document. Low-frequency filters, such as those used to mitigate power-line harmonics, are also not included in the scope of this document.

A complete installation can include the interconnection of several properly shielded cabinets with screened cables. However, the selection of such cables and proper bonding of the cable screens is not within the scope of this publication, but is addressed in IEC 61000-5-2.

The installation of filters and other mitigation means, including shields, is predicated on the existence of a properly designed earthing system, as described in IEC 61000-5-2.

The recommendations presented in this technical report address the EMC concerns of the installation. The safety aspects of any installation are of prime importance but while not ignored, are not within the scope of this technical report. Reference to safety issues may be found in IEC 60364-1, IEC 60364-5-54, and IEC 60364-5-548. The efficient transportation of power within the installation is a prime function of any facility, but is also excluded from the scope of this technical report. Nevertheless, these two issues are taken into consideration in the recommendations concerning EMC. These two issues can be implemented concurrently for enhanced EMC of the installed sensitive apparatus or systems without conflict by applying the recommended practices presented in this technical report and the relevant safety requirements such as those of IEC 60364. As each installation is unique, it is the responsibility of the designer and the installer to select and abide by the relevant recommendations most appropriate to a particular installation. It is important to note that the recommendations presented in this technical report do not seek to preclude existing installation practices, when they have been shown to perform satisfactorily. Special mitigation methods might not be necessary when the installed equipment satisfy applicable emission and immunity standards.

1.2.3 Summary

Clauses 1-3 provide general information concerning the scope, references and definitions applicable to this publication.

Clause 4 provides an overview and introduction of the general approach to applying EMC concepts in the design of installations through the use of appropriate interface protection devices.

Clause 5 provides information on the application of shields to mitigate the coupling of radiated disturbances and to create a boundary between different zones of disturbance levels.

Clause 6 provides information on the application of filters as interface protection devices that can be inserted in power and signal cables entering the shield or enclosure.

Clause 7 provides information on the application of decoupling devices as interface protection devices that can be inserted in power cables or applied to signal cables entering the shield or enclosure.

Clause 8 provides information on the application of SPDs as interface protection devices that can be inserted in power or signal cables entering the shield or enclosure.

It is emphasized that this technical report does not discuss in detail the internal design of these mitigation means. However, some knowledge of their fundamental characteristics, as well as some information on the EM disturbance environment, is necessary to make an appropriate selection of measures and to install them in a way that will not make them ineffective.

2 Reference documents

IEC 60050(161), *International Electrotechnical Vocabulary (IEV) – Chapter 161: Electromagnetic compatibility*

IEC 60050(195), *International Electrotechnical Vocabulary (IEV) – Chapter 195: Earthing and protection against electric shock*

IEC 60050(300), Part 312, *International Electrotechnical Vocabulary (IEV) – Electrical and electronic measurements and measuring instruments – Part 312: General terms relating to electrical measurements*

IEC 60335-1, *Household and similar electrical appliances – Safety – Part 1: General requirements*

IEC 60364-1, *Electrical installations of buildings – Part 1: Fundamental principles, assessment of general characteristics, definitions*

IEC 60364-5-54, *Electrical installations of buildings – Part 5: Selection and erection of electrical equipment – Chapter 54: Earthing arrangements and protective conductors*

IEC 60364-5-548, *Electrical installations of buildings – Part 5: Selection and erection of electrical equipment – Section 548: Earthing arrangements and equipotential bonding for information technology installations*

IEC 60939-1, *Complete filter units for radio frequency suppression – Part 1: Generic specification*

IEC 60939-2, *Complete filter units for radio frequency suppression – Part 2: Sectional specification. Selection of methods for test and general requirements*

IEC/TR2 61000-2-5, *Electromagnetic compatibility – Part 2: Environment – Section 5: Classification of electromagnetic environments*. Basic EMC publication

IEC 61000-2-11, *Electromagnetic compatibility – Part 2-11: Environment – Classification of HEMP environments*

IEC 61000-4-4, *Electromagnetic compatibility (EMC) – Part 4: Testing and measurement techniques – Section 4: Electrical fast transient/burst immunity test*. Basic EMC publication

IEC 61000-4-5, *Electromagnetic compatibility (EMC) – Part 4-5: Testing and measurement techniques – Surge immunity test*

IEC 61000-4-12, *Electromagnetic compatibility (EMC) – Part 4-12: Testing and measurement techniques – Oscillatory waves immunity test*

IEC/TR 61000-5-1, *Electromagnetic compatibility (EMC) – Part 5: Installation and mitigation guidelines – Section 1: General considerations*. Basic EMC publication

IEC/TR 61000-5-2, *Electromagnetic compatibility (EMC) – Part 5: Installation and mitigation guidelines – Section 2: Earthing and cabling*

IEC/TR 61000-5-3, *Electromagnetic compatibility (EMC) – Part 5-3: Installation and mitigation guidelines – HEMP protection concepts*

IEC/TR2 61000-5-4, *Electromagnetic compatibility (EMC) – Part 5: Installation and mitigation guidelines – Section 4: Immunity to HEMP – Specifications for protective devices against HEMP radiated disturbance*. Basic EMC publication

IEC 61000-5-5, *Electromagnetic compatibility (EMC) – Part 5: Installation and mitigation guidelines – Section 5: Specification of protective devices for HEMP conducted disturbance*. Basic EMC publication

IEC 61000-5-7, *Electromagnetic compatibility (EMC) – Part 5-7: Installation and mitigation guidelines – Degrees of protection provided by enclosures against electromagnetic disturbances (EM code)*

IEC 61024-1, *Protection of structures against lightning – Part 1: General principles*

IEC 61312-1, *Protection against lightning electromagnetic impulse (LEMP) – Part 1 – General principles*

IEC/TS 61312-2, *Protection against lightning electromagnetic impulse (LEMP) – Part 2: Shielding of structures, bonding inside structures and earthing*

IEC/TS 61312-3, *Protection against lightning electromagnetic impulse (LEMP) – Part 3: Requirements of surge protective devices (SPDs)*

IEC 61312-4, *Protection against lightning electromagnetic impulse (LEMP) – Part 4: Protection of equipment in existing structures*

IEC/TR 62066, *General basic information regarding surge overvoltages and surge protection in low-voltage a.c. power systems*¹

CISPR 17, *Methods of measurement of the suppression characteristics of passive radio interference filters and suppression components*

3 Terms, definitions and acronyms

For the purposes of this technical report, the definitions of IEC 60050(161) together with the following definitions apply.

3.1 apparatus

finished combination of devices (or equipment) with an intrinsic function intended for the final user and intended to be placed on the market as a single commercial unit

3.2 attenuation

ratio of the input to the output values of quantities of the same kind in a device or system

NOTE When this ratio is less than unity it is usually replaced by its reciprocal, the gain.

[IEV 312-06-06]

3.3 device

combination of components having a given function, forming part of a piece of equipment, apparatus, or system

NOTE For example, thermostat, relay, push buttons, switch or contactor.

3.4 (local) earth

(local) ground (US)

part of the earth which is in electric contact with an earth electrode and the electric potential of which is not necessarily equal to zero

3.5

earth (verb)

ground (verb) (US)

make an electric connection between a given point in a system or in an installation or in equipment and a local earth

NOTE The connection to local earth may be

– intentional, or

¹ To be published

– unintentional or accidental
and may be permanent or temporary.
[IEV 195-01-08]

3.6

earth electrode

ground electrode (US)

conductive part, which may be embedded in a specific conductive medium, e.g. concrete or coke, in electric contact with the Earth

[IEV 195-02-01]

3.7

earthing arrangement

grounding arrangement (US)

earthing system (deprecated)

all the electric connections and devices involved in the earthing of a system, an installation and equipment; the electrical circuit, or a part of it, including the earth electrode, which performs the earthing of a system, an installation and equipment

[IEV 195-02-20, modified]

3.8

electromagnetic compatibility

EMC (abbreviation)

ability of an equipment or system to function satisfactorily in its *electromagnetic environment* without introducing *electromagnetic disturbances* to anything in that environment

[IEV 161-01-07]

3.9

electromagnetic disturbance

any electromagnetic phenomenon which may degrade the performance of a device, equipment or system, or adversely affect living or inert matter

NOTE An electromagnetic disturbance may be an *electromagnetic noise*, an *unwanted signal*, or a change in the propagation medium itself.

[IEV 161-01-05]

3.10

electromagnetic interference

EMI (abbreviation)

degradation of the performance of an equipment, transmission channel, or system caused by an electromagnetic disturbance

[IEV 161-01-06]

3.11

equipment

general term for apparatus, appliance, system, etc.

NOTE For the purposes of the present document, to make a distinction between the collective (plural) nature of the term "equipment" and an individual "piece of equipment", the term "apparatus" will be used when the meaning is a single piece.

3.12

equipotential bonding

provision of electric connections between conductive parts, intended to achieve equipotentiality

[IEV 195-01-10]

**3.13
facility**

entity (such as a hospital, a factory, machinery, etc.) that is built, constructed, installed or established to perform some particular function or to serve or facilitate some particular end

**3.14
filter**

two-port network that transmits signals with low attenuation at all frequencies within one or more frequency bands and with high attenuation at all other frequencies

**3.15
HEMP**

high altitude electromagnetic pulse

**3.16
installation**

several combined items of apparatus or systems put together at a given place to fulfil a specific objective but not intended to be placed into service as a single functional unit

**3.17
maximum continuous operating voltage**

maximum voltage which may be continuously applied to the SPDs mode of protection (equal to the rated voltage)

**3.18
residual voltage (current)**

peak value of voltage (current) that appears at the output terminals of an SPD or filter during application of a standard stress at the input terminals

**3.19
screen
shield**

device intended to reduce the penetration of an electric, magnetic or electromagnetic field into a given region, or to separate electric circuits. A shield is used when a mechanical barrier is intended

**3.20
screening
shielding**

act of reducing the magnitude of an electric or magnetic field provided by a good electrical conductor

**3.21
shielded enclosure, screened room**

mesh or sheet metallic housing designed expressly for the purpose of separating electromagnetically the internal and the external environment

[IEV 161-04-37]

**3.22
shielding effectiveness, EMC**

for a given external source, the ratio of electric or magnetic field strength at a point before and after the placement of the shield in question

3.23**surge-protective device****SPD**

device that is intended to limit transient overvoltages and divert surge currents. It contains at least one non-linear component that is intended to limit surge voltages and divert surge currents

3.24**system**

several items of apparatus combined to fulfil a specific objective

Acronyms

EM	electromagnetic
EMC	electromagnetic compatibility
EMI	electromagnetic interference
HEMP	high-altitude electromagnetic pulse
RF	radio frequency
SE	shielding effectiveness
SPD	surge-protective device
UPS	uninterruptible power supply

4 Mitigation of radiated and conducted disturbances**4.1 Topological concepts**

As a practical matter, the system to be protected is required to communicate with the outside world via conductive and non-conductive (radiating) paths that penetrate the enclosure electromagnetic shield and thus introduce imperfections (openings) in the shield. In addition, other penetrations may be introduced for entry and egress as well as for providing internally a controlled environment for system operators as well as for the internal equipment, such as electronics, water, air, sewers, etc. Therefore, a conceptually simple problem may become quite complex electromagnetically. The concept of topological control has been introduced to account for a system's inherent electromagnetic complexity. Such a concept may be applied to simplify both the system electromagnetic coupling problem and to develop and implement electromagnetic interference control.

In figure 2 we show a generalized, but simple, system topology enclosed in a volume surrounded by the outer surface. The outer surface may be fabricated from common materials (concrete, brick, steel reinforcing bars, metal, etc.) and is penetrated by conductive and non-conductive penetrations such as doors, windows, seams, electrical lines, plumbing, etc. The electronic equipment may be located in different compartments or rooms. This equipment is usually interconnected by wiring harnesses or cables. Environmental control equipment and ducts may also interconnect the equipment rooms. These conductors provide paths for electromagnetic energy to either exit or enter the enclosure.

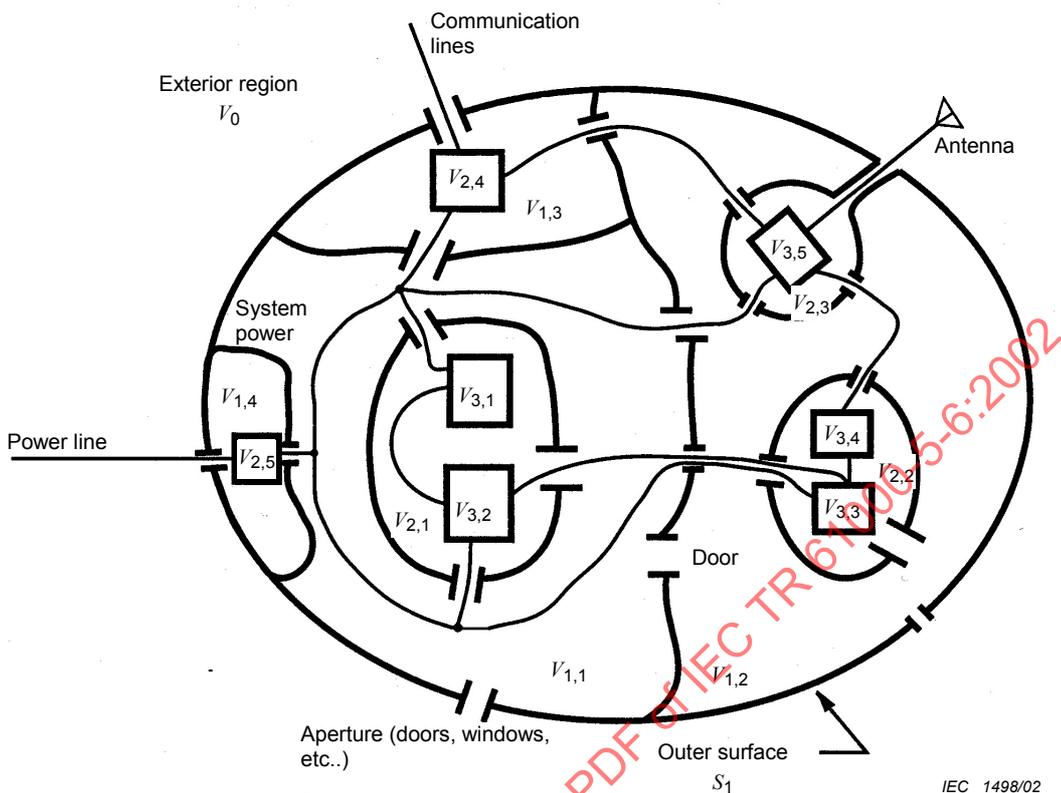


Figure 2 – Generalized system topology

All electrical devices, systems and installations produce or utilize at various frequencies energy which propagates through conductors connected to the apparatus. This energy can interfere with other equipment. Screening may be necessary either to protect a facility from an external electromagnetic environment, or to prevent the radiation of electromagnetic disturbances created by the internal equipment operation.

A formal topological approach may be used 1) to describe the system, and 2) to design a consistent approach to protect the equipment. A formal approach for decomposing a system into its smaller, more tractable, parts is possible. Following the notation provided in figure 2 the generalized system is subdivided into the volumes and surfaces. The exterior region or volume is identified as V_0 ; interior volumes or layers are identified as $V_{j,k}$, where the first subscript indicates the surface traversed (outside to inside) and the second subscript indicates the volume within that (jth) surface. The topological approach aids in identifying the various surfaces and volumes in a particular system and is very useful in describing and accounting for system electromagnetic shields. The notation may be used for further analysis as may be warranted. For example, in figure 2, the surface of volume 2 could have different characteristics in the boundaries to volume 1 and volume 3. This approach also aids in accounting for the assessment of every penetration in all surfaces.

4.2 Mitigation needs

Mitigation is required if EMC between an apparatus and its environment is not achieved. However, if EMC has been achieved then no further mitigation is required. Mitigation can be achieved by using a barrier between the source and the victim. For conducted disturbances this barrier is typically a combination of SPDs and filters or other decoupling devices, and for radiated disturbances it can be a screen and perhaps a filter as needed, the attenuation of which is compatible with that of the screen in the frequency range considered.

The attenuation provided by a barrier has to be compatible with the need, that is, be at least equal to the difference between the disturbance level and the immunity level of the apparatus to that disturbance. For verification purposes, in most of the cases, disturbances are simulated and the immunity of an apparatus is compared against a standard. Thus, the attenuation provided corresponds to the difference between the disturbance level (expected or measured) and the immunity level determined in a laboratory test or by reference to an established immunity level.

According to uncertainties on disturbance level(s) and immunity level(s), a margin should be considered as well, and added to the basic attenuation needed. This margin generally depends on the criticality of the equipment. For most low-risk domestic or industrial applications of equipment satisfying applicable EMC requirements, there is no need for additional mitigation.

4.3 The general concept of enclosure

As discussed in IEC 61000-5-1, it is useful to extend the concept of enclosure as being the boundary of a facility. An enclosure may be envisaged as a complete building, a room, a rack, a single cabinet and even, by extension of the concept, as an individual apparatus or a circuit board within an apparatus. This facility interfaces with its environment by "ports" as shown in figure 3. IEC 61000-5-1 provides further discussion of the concept of ports.

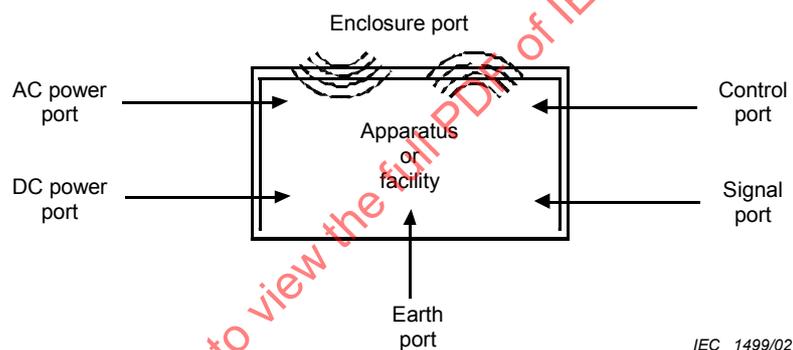


Figure 3 – Ports of an apparatus or facility

The scope of this technical report is restricted to the practices involved in the implementation of the electrical installation in a facility. These activities involve the selection of functional elements of the system and the relevant interconnections. This should also include the interconnection to external sensors, actuators, telecommunication networks and the power supply.

4.4 Interactions at the enclosure boundary

Interactions at the enclosure boundary involve two directions of propagation:


- disturbances originating in the environment that can enter the enclosure;
- disturbances generated within the enclosure that can exit the enclosure;
- a shield provided mainly to protect a circuit against radiated disturbances that will also restrict the emission of radiated disturbances from the circuit;
- likewise, a filter installed to mitigate the entry of a certain type of conducted disturbances will also restrict the emission of the same type of disturbances, although the effect might not be bi-directional.

This technical report presents the fundamental concepts for installation practices that limit radiated disturbances by screening and limiting the propagation of conducted disturbances across the enclosure boundaries through the use of filters, decoupling devices, and overvoltage protective devices.

5 Shielding

5.1 General

Electromagnetic shielding of buildings, rooms, compartments, cabinets, rack chassis and equipment makes it possible to ensure compliance with the EMC for equipment exposed to radiated disturbances. IEC 61000-2-5 may be used as a guide for EMC limits within each zone, and IEC 61000-2-11 and IEC 61000-5-3 together may be used as a guide to develop HEMP limits within each zone. Conversely, radiated disturbances emitted by equipment can be prevented from “polluting” the environment by enclosing it in an appropriate shielded enclosure (figure 4). Low-frequency electric fields are relatively easy to mitigate. Low-frequency magnetic fields are more difficult to screen and will involve a shield with a large wall thickness and/or a high permeability. IEC 61000-5-7 may be used to qualify the protection levels for equipment enclosures once the level of desired protection is identified.

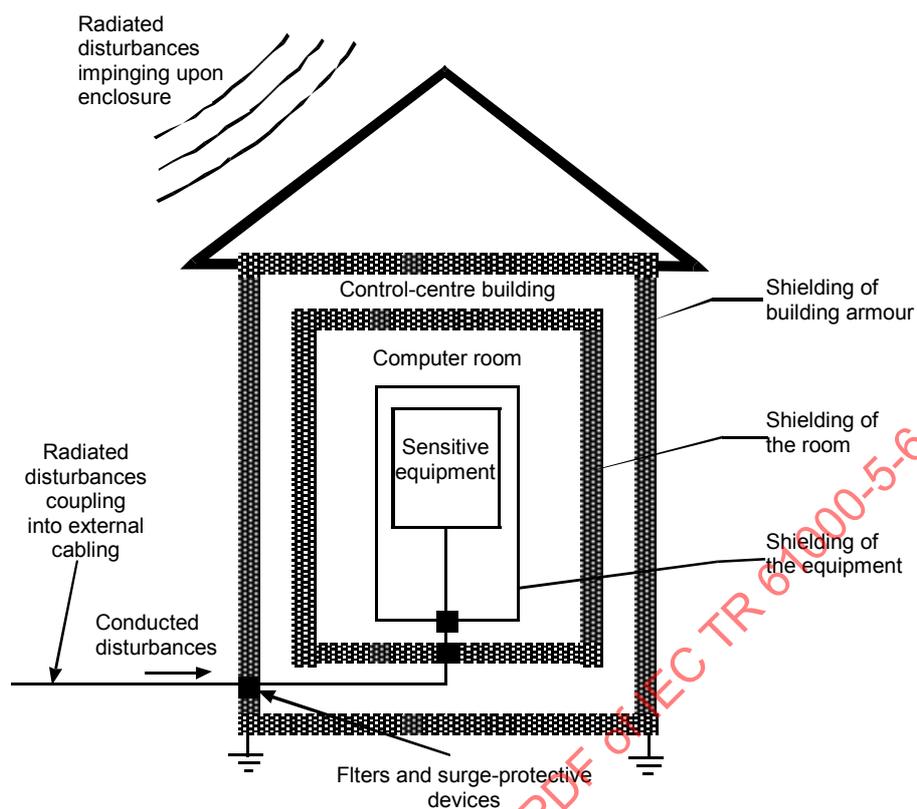

IEC 1500/02

Figure 4 – Topological concept of shields with interfaces at penetration points

Screening of rooms and cabinets with appropriate penetration protection is only one of several actions that may be used to limit the effect of radiated electromagnetic disturbances. For instance, maintaining appropriate distances between emitters and victims is a relatively effective means of mitigation for radiated disturbances. Obtaining a satisfactory result may involve other actions such as

- a) selecting correct cabling and wiring (adding a screen jacket over cables or wires);
- b) applying good cable layout and management;
- c) implementing good earthing and bonding practices;
- d) using devices limiting the emissions or increasing the immunity.

Refer to IEC 61000-5-1 and IEC 61000-5-2) and to other clauses of this technical report for guidelines concerning these actions:

- clause 6 ;
- clause 7 ;
- clause 8 .

The objective of this clause is to present the main arrangements used in mitigation methods involving screening of installations, that is:

- introduction of the concept of mitigation zones and review of the corresponding types of shielded enclosures;
- guidance on preservation of shielding effectiveness for housings with apertures based on a set of generic EMC rules;

- generic information on the implementation of screening, progressing from the sensitive apparatus to the complete building, as well as on the means of dealing with the unavoidable apertures/penetrations.

5.2 Classification of protection zones

For the purpose of designing and applying appropriate mitigation measures, it is useful to consider a hierarchy of zones of protection, from the unprotected environment to the strong protection of especially sensitive equipment. For the purposes of this technical report, the particular zones are defined as follows:

zone 0 – no protection

zone 1 – buildings protected by reinforced concrete outdoor walls

zone 2 – rooms shielded by special materials

zone 3 – internal equipment shielded by metallic materials or metallized enclosures

zone 4 – sensitive apparatus enclosed within a special shielded rack

Figure 5 shows a schematic representation of the hierarchy of the classification for protection of zones 0 through 4. Note that not all barriers may be present in a given installation. Zones may be selected in a more arbitrary manner.

5.2.1 Zone 1 – Building shield

Zone 1 applies to buildings containing welded iron reinforcing bars for concrete outdoor walls. The reinforcement bars should be interconnected preferentially by as many welds as feasible. Thus the reinforcement forms a good earthing structure. Note that steel reinforcing bars may not always be interconnected so that a good electrical bond is made. In such situations the steel reinforcing bars may not represent an adequate shield. An important first measure is a well-designed and implemented lightning conductor with conductive connections to the earth. Conductive penetrations should be protected with appropriate limiting (surge-protective device) and filtering.

5.2.2 Zone 2 – Room shield

Zone 2 applies to indoor facilities with protection measures. In this case the shield is effective when it consists of continuously connected (welded) sheet-metal walls or walls with a metal surface. Bolted or otherwise interconnected walls will result in some degradation of the shielding effectiveness. All the screens of leads entering this zone must have a short connection to the metal walls. The penetrating leads should also be protected against overvoltages with appropriate limiting (surge-protective device) and filtering.

5.2.3 Zone 3 – Equipment shield

Zone 3 applies where individual apparatus is protected by metal cabinets or metallized enclosures. The earth connection should be a short lead to the earthing arrangement. Conductive penetrations should be protected with appropriate limiting (surge-protective device) and filtering.

5.2.4 Zone 4 – Apparatus shield

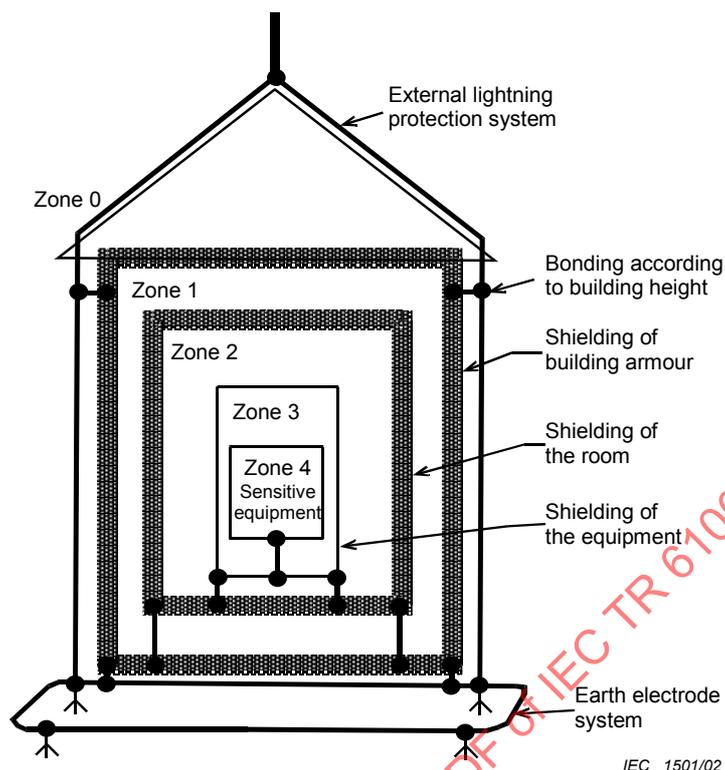


Figure 5 – Zones of protection of shielding and earthing systems

Zone 4 applies at the individual apparatus level; it is not within the scope of this technical report, but is the responsibility of the apparatus manufacturer. This zone may also include highly sensitive equipment that may require additional protection.

5.3 Design principles for screening

5.3.1 General

The design principles presented in this clause are not intended to serve as a comprehensive guide for the detailed design of a specific installation; rather, they are offered as an overview of design considerations that can serve as useful checks for a proposed installation. Providing effective screening techniques require a design by specialists, taking into consideration the specifics of the installation. By application of different materials it is possible to obtain a good shielding effectiveness over the whole disturbance spectrum of electromagnetic fields. Screening can be provided by the following materials and constructions:

- metallic enclosure or cabinets;
- rooms with continuous metallic walls;
- clamped or welded iron mats, grids and sheets inside of walls;
- metallic meshed wire or meshed screen;
- metallic or metalized fabric;
- metallic foil;
- metal sheets (copper or aluminium or other good conductive metals);
- metallized plastics with undamaged surfaces and a good contact across all seams;
- window glass with wire mesh fused in the glass or metallized glass, both continuously bonded to the wall shield.

Note that for screening against low-frequency electric fields, metallized plastic might be adequate. However, screening against low-frequency magnetic fields requires metal walls of sufficient thickness, conductivity and permeability. The electrical continuity of the walls must be ensured, especially in the case of the lower frequency magnetic fields.

5.3.2 Shielding effectiveness

The effectiveness of a shielded enclosure depends on many parameters. In theory, a shielded enclosure may be designed to produce attenuation ranging from a few dB to over 100 dB in a frequency range up to 10 GHz and beyond. However, in practice, the effectiveness of an enclosure with penetrations of all types will be reduced and limited by these penetrations. For practical purposes, the shielding effectiveness of a solid metallic cabinet or enclosure is mainly determined by the following factors:

- the disturbance currents, which should be run over the outer surface of the cabinets or in closed loops over the surfaces via connections to the earth/ground;
- the installation of penetrating cables: for good performance all signal cables penetrating the cabinet should either be filtered/limited and/or their screens should be earthed directly to the cabinet (see IEC 61000-5-2);
- the electrical length of seams of all parts of the enclosure should be as small as possible, preferably smaller than one-tenth of the wavelength of the impinging disturbance (this conditional limit is not applicable to low-frequency magnetic fields);
- the size of holes should be as small as possible relative to the incident wavelength or should be fitted with pipes (waveguide beyond cutoff); this topic is discussed further in 5.4.6.

5.3.3 Maintaining shielding effectiveness

The following is a set of simple rules that can help when checking whether a shielded enclosure is correctly installed.

- a) Ensure a correct path for all common-mode currents that could flow in cables entering the enclosure.

This rule implies that screens of all cables should be connected over 360° to the wall of the shielded enclosure. It applies to all types of cables such as coaxial cables, screened multi-lead signal cables, power cables, etc. Screens may continue through the wall into the inside of the enclosure, as is for instance necessary for the correct signal transport by coaxial cables.

If the 360° circumferential contact cannot be maintained for some reason, the shortest possible connection between the cable screen and the wall, on the outside – not inside – of the enclosure, is advised. This type of connection, however, will impair the quality of the shielded enclosure, particularly at higher frequencies.

- b) Ensure a correct path for all disturbance currents that could flow through any metallic object towards the shielded enclosure.

This rule applies for instance to metallic tubing for water or cooling liquid for air conditioners. Again, a 360° circumferential contact between the tubing and the wall is necessary.

- c) If possible, all conductors mentioned under rules a) and b) above should enter through a single metal panel, far from large openings in the enclosure.

The metal wall of a shielded enclosure provides a short path for all common-mode currents and diverts those currents around the shielded enclosure; it thereby acts as a barrier for disturbances. Openings should normally be closed, such as doors equipped with contact strips. In some cases a double shield door may be warranted. Rule c) will still provide some protection if the doors are occasionally open. The EMC cabinet discussed in IEC 61000-5-2 is an example of this topology

- d) Limit the bandwidth of the signals or power entering the shielded enclosure to the bare minimum needed for the particular signal. Employ filters and mount them correctly against the wall.

In particular, the way filters are mounted has the largest influence on their correct operation. A simple filter which is correctly mounted is preferable to an expensive filter which is incorrectly installed (refer to clause 6).

In addition, in large shielded rooms the power-input cable needs attention. A three-phase power cable, equipped with a neutral conductor and a protective earth inside an earthed screen is correctly installed if the earthed screen is circumferentially connected to the metal wall, as stipulated by rule a). The protective earth and the neutral conductors may also be connected there to the metal wall.²

- e) If any overvoltage protection is applied at a cable to limit the differential-mode voltage, the filters mentioned in rule d) above should be mounted between the SPDs and the shielded enclosure.

Note that SPDs of the voltage-switching type (see 8.5.2) might generate new fast disturbances when they operate. The filters, mounted downstream from the SPDs, should reduce these SPD-related disturbances before they enter the shielded enclosure. Furthermore, the SPDs will serve to limit the external overvoltages impinging on the filters, allowing a more cost-effective selection of filters.

- f) Ensure that all walls of the shielded enclosure form a single metallic, well-conducting surface.

Different parts of the shielded enclosure should be interconnected over their full perimeter, preferentially by welding the seams. Other good ways of ensuring conducting seams, such as many bolts or screws are allowed as well, but at a reduced shielding effectiveness. Painted surfaces divert the currents that provide the screening effect where these currents would cross the seams. Conductivity must be maintained by removing the paint and applying corrosion protection. Alternate fastener methods may also be used, such as self-tapping screws, "pop-nails", etc.

- g) All openings in the wall of a shielded enclosure should be carefully considered.

The following types of openings (apertures) might be encountered:

- a long slit, such as an open seam;
- a large circular hole;
- many small holes with the same open area as the large hole;
- holes protected by a mesh;
- holes protected by tubes or honeycomb arrays of tubes.

See 5.4.6 for further details on how to deal with these various types of apertures.

The specific implementation of a protection scheme will require a risk assessment of the overall protection so that the installation benefit/cost may be determined.

5.4 Implementation of screening

In preceding clauses, the need for screening has been described from the point of view of external influences impinging upon the facility, with a sequence of zones starting from the outside and progressing toward the equipment – the most significant part of the installation. When a facility is being designed for general EMC purposes, it is reasonable to begin the protection design from the outside and progress inward, taking advantage of an overall protection scheme, as described in IEC 61000-5-1. For HEMP environments the situation is

² Note that in some countries, national codes prohibit multiple connections of the neutral to the earthing system. In that case, a filter is also required for the neutral conductor.

the same, and IEC 61000-5-4 provides information on how to specify the screening levels once they are determined. When sensitive equipment is being installed in an existing building, it is more likely that any screening that would turn out to be necessary would start at the apparatus level and progress outward. Adding screening to an existing building is expensive, and its implementation will depend on the value of the equipment to be protected.

5.4.1 Sensitive apparatus

Apparatus containing sensitive components can be shielded if necessary by metallic cage(s) or by metallized plastic box(es), depending on the needs. According to the definition of apparatus, that is, “placed on the market as a single commercial unit”, the apparatus screening should be the responsibility of the apparatus manufacturer rather than the responsibility of the installer. However, if a mass-produced consumer-type apparatus designed for moderate environments is going to be installed in a harsh environment, the necessary adaptation becomes a concern for the installer.

5.4.2 Shielding of racks and chassis (zones 4/3 barrier)

Metallic racks and chassis are furnished by various suppliers who control the shielding design. Typical shielding practices involve the assembly of many individual electrical and electronic building blocks to result in a single housing. In this case a metallic enclosure increases the shielding effectiveness.

5.4.3 Shielding of cabinets (zones 3/2 barrier)

The use of shielded cabinets is necessary in the case of high electromagnetic fields, such as those greater than 30 V/m. These cabinets also provide protection against outgoing radiated disturbances.

Protection of cable penetrations can be obtained by use of special filters that are installed on the incoming cables (power and control/signal ports). These filters must have a good bonding connection to the cabinet wall. All metal parts should be bonded together with high quality, permanent connections via the shortest path to the earth/ground system. Most important is the treatment of the frame and the racks.

5.4.4 Shielding of rooms (zones 2/1 barrier)

Good-quality shielded rooms, or shielded enclosures have been in use for many years for performing electronic measurements where a low electromagnetic ambient level is necessary, or where potentially damaging emission must be contained. Refer to IEC 61000-2-5 for acceptable ambient levels. The use of shielded rooms has been extended to non-measurement applications, such as protection of personnel working near high-power radar sites or industrial RF emission sources, and protection of sensitive equipment such as medical devices, biomedical instruments and computers.

The room shield may consist of meshed conductors inside of the walls such as steel reinforcing bars, grids or metal sheets installed on the surface of walls. Figure 6 represents the shielding effectiveness of a continuous solid metallic shield with penetration protection. Shielding provided by discontinuous conductors, such as steel reinforcing bars, will be much less than shown in figure 6 (see table 1). All doors and other openings (ventilation openings, windows, etc.) must be constructed with screening material, and they must have a short bonding strap to the other screening materials.

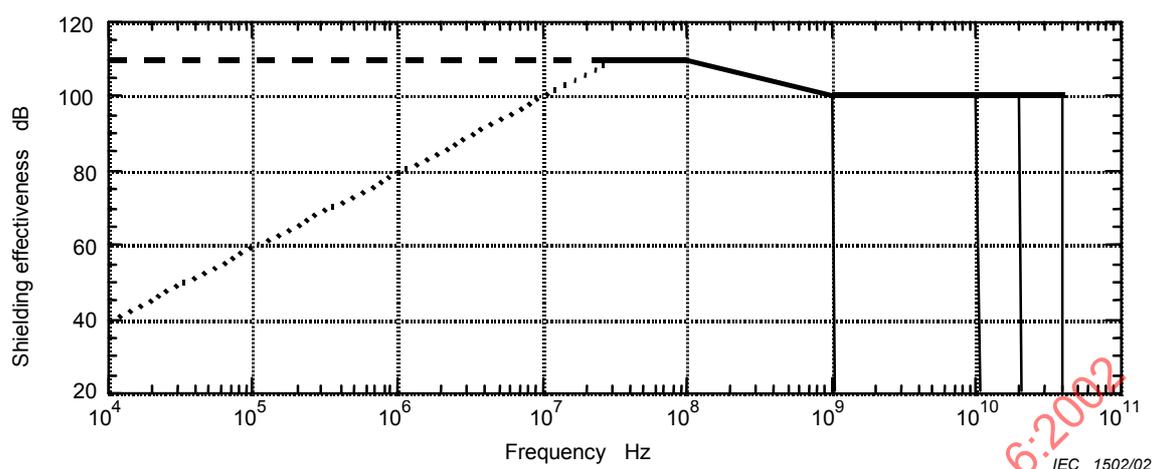


Figure 6 – Example of performance of high-efficiency shielded enclosure

5.4.5 Shielding of buildings (zones 1/0 barrier)

The reinforcement bars of a concrete building can provide a limited screening effect up to 20 dB when implemented with a view toward EMC benefits, as illustrated by the experimental measurement results of table 1. When a building consists of steel panels on a steel frame, appropriate EMC measures (bonding) applied at the time of construction can produce cost-effective benefits.

Table 1 – Measured shielding effectiveness of a 2 × 2 m cage made of concrete building armour, against a 20-ns rise-time pulse (equivalent frequency less than 20 MHz)

Type of armour			Attenuation dB	
Diameter mm	Spacing mm	Bonding of bars	Electric field	Magnetic field
14	200	Binding	6	4
14	100	Binding	No data	10
8	100	Binding	9	9
8	100	Welding	19	11

The shielding effectiveness of the armour can be improved by welding the connections of the reinforcement bars and adding armour grids of small diameter and small mesh. The metal frames of all openings should be bonded to the armour at multiple points.

All incoming and outgoing leads (power network or data network) should be protected against direct as well as indirect lightning discharges (see IEC 61024-1 and IEC 61312-1,-2,-3,-4,-5). These lines should have an outer metallic sheathing that is bonded to the earthing system. If an outer sheathing is not present, protection by means of a filter and/or an SPD may be necessary. Both the filter and the SPD must be connected to the nearest earthing arrangement at the point where the cables enter the building. If this is not practical, another suitable point of entry should be selected. For instance, with an antenna on the roof, the screen of the antenna cable should be connected to the local earthing arrangement of the roof. Often the screen of the cable connector can be used for this connection, providing a circumferential connection to a metallic wall. This measure is a very economical protection and far superior to a pigtail connection (a wire connecting the connector to the metallic wall).

5.4.6 Dealing with apertures

Apertures in a shield are generally unavoidable (cable entries, ventilation, windows). These openings may be designed as waveguides beyond cutoff. If they are constructed correctly, they can maintain the shielding effectiveness for a broad range of frequencies. Deliberate or unintended apertures and the uncontrolled entrance of cable jackets into enclosures create most of the weak points. Doors should have metal surfaces and contact fingers over the full circumference. Ventilation openings should be protected as indicated below. The effect of a window can be reduced by installing wire meshes, with dimensions depending on the frequency of the disturbing radiation. Window protection is available for indoor installation, and thermally insulated outer wall windows with metallic meshes sandwiched between glass plates may also be used. The achievable screening value depends on the number of mesh layers. The window mesh should be peripherally bonded to the facility shield.

Honeycombs

In a honeycomb array, the tube diameter and length should be selected for the maximum frequency at which the shielded enclosure must operate (figures 7 and 8) and should be selected so that the array tubes operate as waveguides beyond cutoff at the high frequency of interest. All tubes should form well-conducting contacts over the lines where they touch each other. Mesh or honeycomb arrays should contact the wall in which they are mounted over their full perimeter.

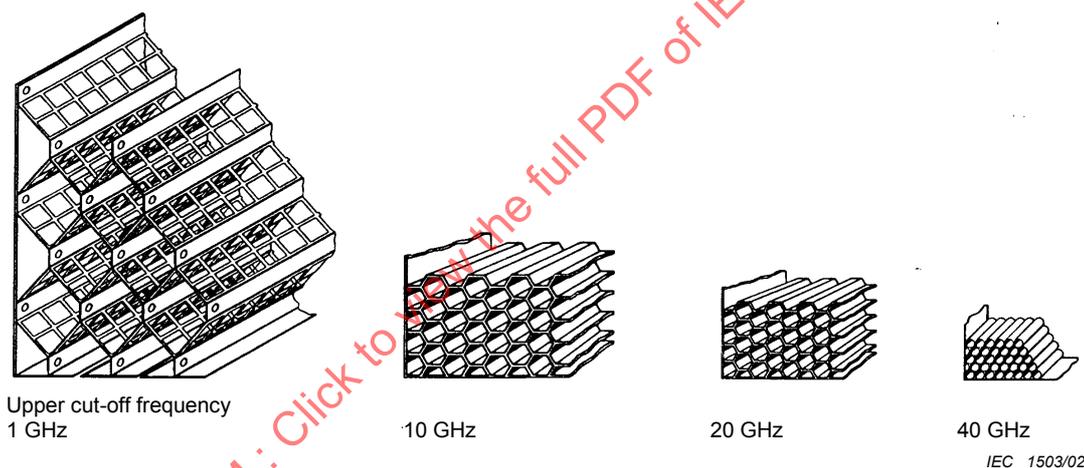


Figure 7 – Honeycomb inserts for different cut-off frequencies

Non-conductive tubing, such as water drains, should be fitted inside a metal pipe. The dimensions of the pipes should be chosen similar to the honeycomb. The pipe should contact the wall over its full perimeter. Fibre optic cables should penetrate a wall through a metallic pipe. No metal cladding or metal leads should pass through the wall with the fibre cable without proper care for the disturbance currents.

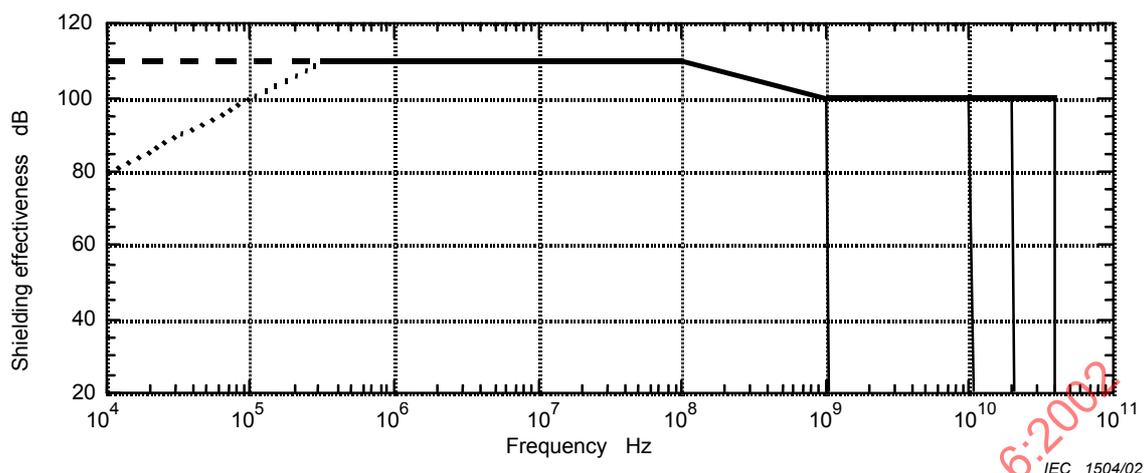


Figure 8 – Typical screening attenuation of honeycomb inserts

Conductive gaskets

Conductive gaskets are applied to reduce the effect of apertures and to maintain bonding of components of an enclosure. Such gaskets are employed for either temporary or semi-permanent sealing applications between joints or structures. The gasket is compressed between the mating surfaces to be bonded, thus providing the conductive path across the joint between them; screen currents can then flow without abrupt changes in current density across the joint, thus maintaining the ideal screen performance. Gaskets should be used to make firm, continuous and uniform contact with seam surfaces, to avoid joining only at irregular spots between the surfaces. There are three types of gaskets classified by usage:

- permanently mounted cover plates or assemblies: gaskets for these applications include knitted wire mesh gaskets pressed into the desired gasket shape, or soft metals such as indium;
- access cover plates with high joint unevenness, frequently opened but always closed on the same portions of the gaskets: elastomeric gaskets are used for this application;
- removable cover plates with symmetrical mounting patterns which are replaceable but not necessarily in the original orientation: the preferred gaskets are sponge elastomers with oriented wires which exhibit low closure force and low compression set, and are removable and reusable.

Gasket types and other materials

There are many types, shapes, binders, and materials for gaskets that are designed for EMC applications, as illustrated by the following paragraphs. Their effectiveness is dependent upon the conductivity of the surfaces that require maintenance.

- Knitted wire mesh gaskets. These are made from resilient, conductive knitted wire and they somewhat resemble the outer jacket of a coaxial cable.
- Oriented-immersed wire gaskets. These are made with many fine parallel, transverse conductive wires providing very low parallel impedance across the gasket interface.
- Conductive plastics and elastomer gaskets. These are made with many tiny silver balls immersed in a silicone rubber or vinyl elastomer binder and a carrier.
- Spring-finger stock. Spring-finger contact strips now use conducting self-adhesive backing to eliminate older mechanical fastening methods. Manufacturers usually apply those strips because they facilitate a large area connection of doors to the shielded enclosure.

Gasket mounting

Several methods are available to mount the gasket onto a metal mating surface

- hold-in slot;
- pressure-sensitive adhesive;
- bond non-functional portion of gasket;
- conductive adhesive;
- bolt-through boltholes.

EMC sealants

Many types of sealants are available, such as epoxies, caulking as rubber and elastics, and grease.

- a) Conductive epoxies. Conductive epoxies are used to join, bond, and seal two or more metallic mating surfaces.
- b) Conductive caulking. Conductive caulking is used to screen and seal two or more metallic mating members mechanically held by other means.
- c) Conductive grease. Conductive grease is a low-resistance, silver-silicone grease which contains no carbon or graphite fillers. Its principal use is for power substation switches and on suspension insulators to reduce EM disturbances.

6 Filters

6.1 General

Filters are used in power systems and in telecommunication and control system signal cables when disturbance levels do not correspond with the immunity level of the installed equipment. The general function of a filter is to limit the bandwidth; this function can be aimed at several goals, in order of decreasing importance:

- protect electronic equipment against unwanted disturbances, outside the frequency band of the intended signals;
- separate common-mode disturbances from differential-mode signals;
- limit differential-mode bandwidth to the minimum necessary operational width.

Filters can have a two-fold effect by protecting the environment from conducted disturbances generated within equipment and also by protecting the equipment against disturbances generated external to the equipment concerned. This dual role assumes that the filter and other associated mitigating devices such as SPDs are bi-directional. A common application in installations is the limiting of high-frequency disturbances through the application of low-pass filters for power lines or voice-band telephone lines.

Two kinds of filters exist: passive filters and active filters. Active filters are generally incorporated into an apparatus for the purpose of signal processing rather than protection. This type of filter is not usually bi-directional. Active filters are excluded from the scope of this technical report. Passive filters, shunt or series, are designed with a combination of passive circuit components (resistors, inductors and capacitors). These filters pass signals within the pass-band and attenuate signals at other frequencies. Filters aimed at the mitigation of low-frequency disturbances are not included in the scope of this technical report.

When the designer of an installation considers the application of filters for the purpose of preventing interference from external sources, three questions should be resolved, depending on the function of the filter:

- Reflections: Is the filter designed to properly match the source and load impedances?
- Insertion loss: Does the filter introduce excessive losses or distortion to the normal operating signal?
- Non-linear performance: Are the expected disturbance levels within the operating limits of the filter? Will new disturbances be generated if limits are exceeded?

6.2 Fundamental filter characteristics

Fundamental filter characteristics include the following:

- attenuation and insertion loss;
- frequency response;
- filter characteristic impedance.

These characteristics are discussed in the following paragraphs.

6.2.1 Attenuation and insertion loss

Filters considered here are linear, passive and time-invariant two-port devices. Attenuation and insertion losses are determined by the values of the components of the filter circuit. Figure 9a and 9b shows the circuit voltages (U^* , U) and currents (I^* , I) before and after inserting the filter, respectively.

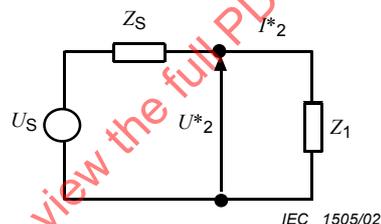


Figure 9a

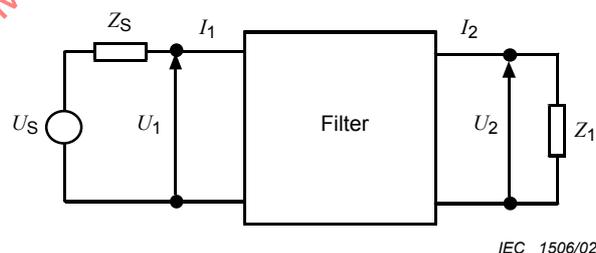


Figure 9b

Figure 9 – Parameters for attenuation and insertion loss

Attenuation and insertion loss are dependent on both the source impedance Z_S and the load impedance Z_L . The insertion loss (I) is referred to a specified test condition as shown in figure 9 and is defined as the ratio of the load voltage before and after the insertion of the filter:

$$I = U^*_2 / U_2 \quad \text{or} \quad I = 20 \log (U^*_2 / U_2) \quad \text{in dB};$$

CISPR 17 recommends the choice of Z_S and $Z_L = 50 \Omega$.

The attenuation can refer to different quantities, such as voltage attenuation U_S/U_2 , absorption attenuation or total attenuation, depending on the characteristics of the source and load impedances.

It is common to characterize a filter with either its insertion loss or its total attenuation. Quite often, filters are chosen according to their insertion loss in a 50 Ω system where $Z_l = Z_s = 50 \Omega$. In this special case, the insertion loss is equal to the total attenuation. However, insertion loss and total attenuation are dependant on both the source impedance Z_s and the load impedance Z_l .

Note that it is not valid to compare or select filters for their 50 Ω system insertion loss if they are not to be used with those load and source impedances. This is especially true when either the source or the load is reactive.

Important: The (assumed linear) impedance of the signal source, of the filter and of the receiver protected by the filter must be known over a large frequency range, adapted to all possible disturbances, rather than to the frequency band for the signals only.

The impedance of a low-voltage power-line network assumes a large range of values, especially in the frequency range of 9 kHz to several tens of MHz. These impedances also change with time. Insertion loss or attenuation as defined above is therefore of little help in characterizing a power-line filter. In fact, a conservative design should only retain the worst possible behaviour of a power-line filter, when the network impedance assumes any random value. Such a value is called a worst-case value. Refer to 6.4 for more discussion on the worst-case parameters.

Interference suppression filters reach their highest in-band attenuation when they are mismatched with the impedance of the disturbance source, victim apparatus or the line. The simplest “low-pass filter” is a shunt-connected capacitor. In the case of a low-impedance source, the simplest low-pass filter is a series-connected suppression inductance.

6.2.2 Basic types of filters

Depending on the application, filters may be designed with RL, RC and RLC circuits in various combinations. Basic types of filters are briefly described below. In the most elementary form, filtering may be obtained by a series-connected inductance (as a ferrite bead or core threaded on a cable – saturation effects must be taken into account) or a shunt-connected capacitor. Selection of a specific filter type will depend on the application, cost and required performance.

Passive filters utilize the resonance characteristics of series and parallel combinations of inductance and capacitance. The resulting reactance reduces disturbances by introducing a high impedance in series with the disturbance currents and/or by shunting these currents to earth through a low impedance. Several types of filters can be identified.

- Low-pass filter: allows the passage of low frequencies; attenuates high frequencies.
- High-pass filter: allows the passage of high frequencies; attenuates low frequencies.
- Bandpass filter: passes a specific range of pass-band frequencies; attenuates signals with frequencies outside the pass-band.
- Stop-band filter: attenuates a specific range of frequencies within the stop-band; passes frequencies outside the stop-band.

All information concerning two-port filters can be adapted for multiport filters. In addition to the elementary filter types above, double-tuned filters are often used. These filters have one frequency at which parallel resonance occurs and another at which series resonance occurs. The former resonant frequency determines the rejected frequency, the latter the accepted frequency. The low-pass filter is the type most frequently used in EMC applications.

6.3 Functional tasks


Functional tasks of filters include

- preventing interference on an installed apparatus by limiting incoming disturbances in power, control and communication circuits (figure 10);
- reducing the outgoing electromagnetic noise in power networks and in the environment by limiting conducted disturbance emission of cables or radiation from the apparatus (figure 11);
- preventing electromagnetic interference between pieces of equipment or within the equipment itself;
- providing a preferred path for the common-mode current (not only at frequencies inside the band-pass of the filter).

With reference to a specific functional requirement, a detailed analysis is necessary, concerning


- characteristics of disturbance sources (continuous or transient type, frequency range, etc.);
- type of disturbances (common mode, differential mode, mixed type);
- necessary attenuation (value related to the frequency range);
- application conditions (characteristics and topology of the circuit to be filtered, environmental conditions, etc.);
- last but not least, the safety aspects of the installation.

Figures 10 and 11 show the functional tasks of filters with reference to disturbances appearing in common mode and in differential mode. Generally, these two types of disturbances are present at the same time, and the same filtering device could limit both of them.

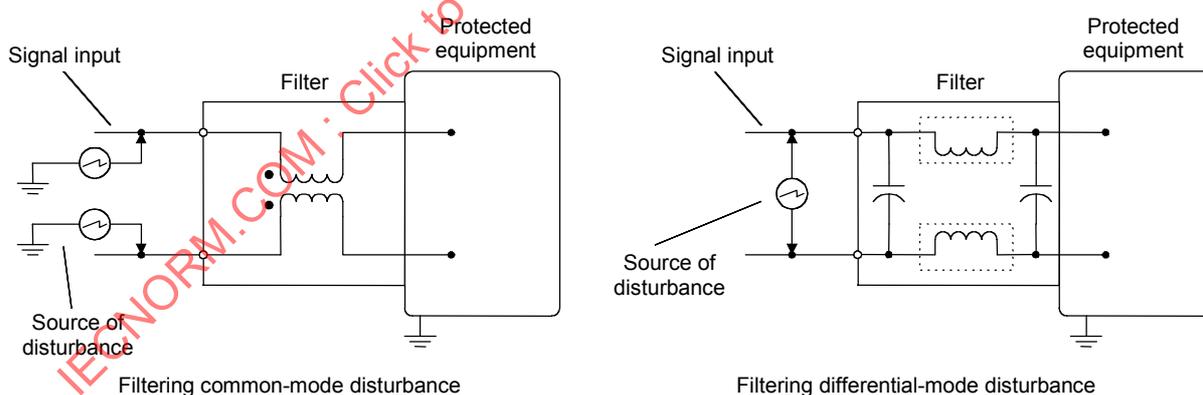

IEC 1507/02

Figure 10 – Prevention of interference on installed equipment

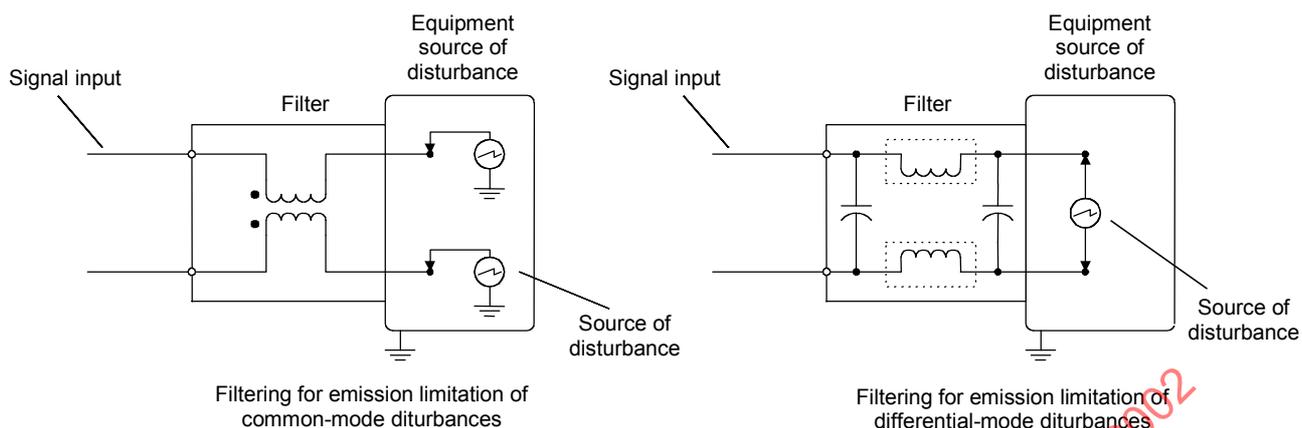

IEC 1508/02

Figure 11 – Reduction of electromagnetic disturbances in the power network and the environment

6.4 Additional filtering concerns

6.4.1 Technical aspects

EMC filters are often subjected to much higher power than conventional filters. Since, for instance, power-line filters have to accommodate the normal power levels, they often will be larger in size and the high power levels could cause a non-linear response as a result of saturation.

Often the energy spectrum of the disturbance is much broader than the energy spectrum of the power, control or signal. In some cases, filtering can be performed in several stages, each one adapted to a different band.

The design of communications filters is premised on impedance matching. In power lines in particular, this is not possible, since power lines are designed to be efficient solely at the power frequency. Thus mismatch often plays a very detrimental role, namely, a drastic reduction of the claimed or expected filtering and, quite often, the occurrence of pronounced ringing.

High-peaked impulse noise combines the high energy of the noise with a very broad frequency spectrum. The presence of saturable materials in the filter inductive components should be taken into consideration.

Cascaded filters must be designed carefully so as to avoid any detrimental interactions.

6.4.2 Economic aspects

There are many alternatives to elimination or mitigation of disturbances. The decision of the most reasonable means must be based on the maximum benefit-to-cost ratio, with the benefit possibly being not much more than what is necessary. No specific single rule can be given for the decision involved, since it depends on the circumstances of the particular system under consideration and its noise environment. Rather, familiarity with all aspects of disturbance elimination and suppression is important. Filtering is quite often the most economical remedy. Filters are usually the preferred means to eliminate differential mode disturbances. The introduction of a filter close to the source can save on costly separation of wiring or on screening if the only concern is conducted disturbances.

6.5 Selection criteria

Filters should be selected and used judiciously. As in all cases of an installation including potentially sensitive equipment, it is desirable that the equipment be intrinsically immune to

disturbances and thus perform satisfactorily without the use of external filters or other extensive and perhaps expensive mitigation means. However, when an external filtering action becomes necessary, filters should be applied according to the principles and guidance provided in this technical report, in order to assure proper disturbance mitigation. The first step in the process is to determine the nature of the disturbances against which the protection is necessary:

- frequency range;
- amplitude over the frequency range;
- intentional signal characteristics.

It is then possible to refer to the manufacturer's documentation. This effective application can then be achieved by referring to the filter manufacturer's documentation and tests, in order to determine whether or not the product meets the particular needs of the application. Preferably, the completed filter installation should be checked by performing final tests with the filter installed and operating as intended. If this is not possible, verification may be performed on a partial system where these operating conditions could be emulated.

Filters available on the market should be expected to meet the particular needs of the application with a reasonable EMC margin. A reasonable but misguided quest for economy could result in low-cost but less effective filters; nevertheless, one which will provide a sufficient margin should be selected. The following circuit and filter characteristics, common to all applications, should be carefully considered in the filter selection.

6.5.1 Voltage rating

Filters for the different rated voltage of the power supply are available on the market, such as 125 V, 250 V, 380 V or 440 V (see IEC 60939-2). Some manufacturers specify permissible overvoltage conditions related to a limited period of time.

Telecommunication/control line filters with proper rated voltage are available on the market for telephone circuits, digital and analogue circuits, control lines, coaxial lines, etc.

6.5.2 Current rating

Power-line filters with a wide range of rated current values are available for different applications: filtering of equipment, filtering for shielded rooms and cabinets, protection of the power network in the installation, etc. Values of rated current frequently used are 1 A, 2 A, 4 A, 6 A, 10 A, 30 A, 100 A; many other values are also available.

Filters for applications on telecommunication/control lines are generally designed for current in the range of hundreds of mA.

6.5.3 Duty-cycle and overload operating conditions

These characteristics are mainly applicable to power filters and concern intermittent operation, overloading and possible fault conditions in the power system. Overload conditions may be defined by some manufacturers as over-current related to a specified duration, such as 10 times the rated current for 1 s, 5 times the rated current for 5 s, and so on.

6.5.4 Operating frequency and range of frequencies to be filtered

Filters for d.c. or a.c. power lines are available as well as filters for the typical communications and signal lines frequencies. Low-pass filters are generally used, so any frequency higher than the operating frequency is filtered. Specific band-pass filters may also be used for telecommunication lines.

6.5.5 Voltage drop and signal loss

Power-line filters are characterized by a voltage drop depending on the load condition; at rated current this voltage drop is generally in the order of 1% of the rated voltage or less. The voltage drop of the filter is referred to the rated current and power frequency, and includes the drop across both lines of the power supply circuit.

Filters for telecommunication and control lines can produce signal loss. Values less than 1 dB, required for a proper line impedance termination condition, are generally specified by the manufacturers in the bandwidth of the signal.

6.5.6 Ambient temperature range

Several climatic categories are defined in IEC 60939-2. A temperature range frequently specified by manufacturers is $-25\text{ }^{\circ}\text{C}$ to $+85\text{ }^{\circ}\text{C}$. Due to their power dissipation, power-line filters can exhibit some casing temperature rise, for instance up to $10\text{ }^{\circ}\text{C}$. In an assembly design, this parameter should be considered for a possible influence on adjacent components.

6.5.7 Insertion loss and attenuation

The insertion loss and the attenuation of common-mode disturbances (line-to-earth) and differential-mode disturbances (line-to-line) are dependent on the frequency and on the operating conditions.

Filters in a wide range of performances are available on the market for the different applications. Limited performances are provided by general application filters, such as in the order of 20 dB to 50 dB for common-mode and differential-mode disturbances in the frequency range 0,1 MHz to 100 MHz. With stringent mounting rules (see 6.6), higher levels of insertion loss are provided by filters for shielded rooms and cabinets; a performance of 80 dB to 120 dB is typical in the frequency range from some tens or hundreds of kHz to 1 GHz or more (figure 12).

The insertion loss of filters is typically designed and measured with the input and output terminated in an impedance of 50 ohms. In this case, the filter insertion loss may be anywhere from 80 dB to 120 dB. However, in the actual installation the line impedance may deviate from 50 ohms with an accompanying degradation in the specified insertion loss.

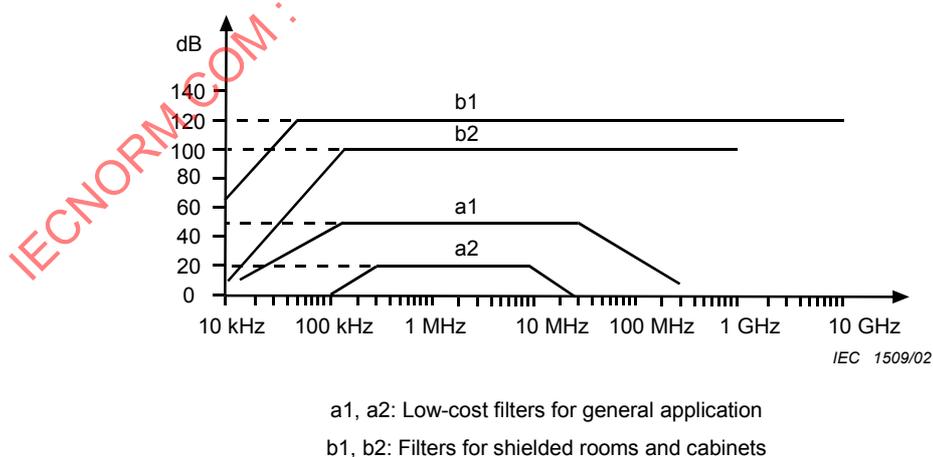


Figure 12 – Examples of insertion loss characteristics of a.c./d.c. power port filters

6.5.8 Withstand voltage

Filters should be selected with proper withstand voltage corresponding to the line characteristics. Power-line filters are generally characterized by different values of line-to-line and line-to-earth, d.c. or a.c. withstand voltage; values starting from 1 000 V d.c. are

generally specified by the manufacturer. Test voltages of power-line filters for HF disturbances are specified in IEC 60939-2. For instance, insulation to earth of 2 000 V or greater is recommended for power-line filters with a rated voltage of 125 V or more. Telecommunication or control-line filters generally present lower withstand voltages.

When filtering power or signal lines affected by transient overvoltages, attention must be paid to the surge withstand capabilities, in common mode and differential mode; the adoption of SPDs may be necessary to protect the filter and the line.

6.5.9 Attenuation of HF transient disturbances

The attenuation of transient disturbances (surges, damped oscillatory, fast transients, etc.) depends on their frequency content, the equivalent impedance of the line at the frequency of interest and the impedance of the load.

The attenuation of high-energy surges, including unidirectional surges, is generally low or insignificant; the attenuation of fast transients or oscillations in the range of MHz is better, generally of the order of a few tens of dB. These attenuation levels are generally not specified by the manufacturers of filters. For filtering power or signal lines subjected to high-energy surges, specific filters with built-in transient suppression devices are available on the market; standard filters complemented by suitable overvoltage protection can also be used.

6.5.10 Leakage current to protective earthing conductor

The shunt capacitors of the power-line filters cause a steady-state leakage current into the protective-earthing conductor. This current, combined with the contribution of the protected apparatus itself, cannot exceed the safety limits set for the different applications. For instance IEC 60335-1 specifies current limits for domestic household appliances in the range 0,5 mA to 5 mA. In order to allow the application of safety rules for equipment and installations, the leakage current of the different filters should be taken into consideration in accordance with applicable electrical installation requirements.

Filters for permanently wired shielded enclosures possess values of leakage current of the order of a small percentage of the rated current; these values imply a dedicated low-impedance connection to earth, to avoid unsafe voltages.

6.5.11 Permissible reactive current

The reactive current of power-line filters for shielded enclosures, cabinets, networks, etc., can be a significant portion of the rated current. This consideration applies especially to filters incorporating high values of capacitance, as in the case of filters for shielded rooms and cabinets, for which the reactive current and possible imbalance should be taken into consideration.

The reactive current is related to the line voltage and is not dependent on the load condition; it must be considered in the design of the power supply network, with particular care for special cases, such as the use of uninterruptible power supply systems.

6.6 Filter installation

When using filters, proper installation is essential to achieve good results; mounting techniques become critical at high frequencies. A wide range of practical solutions is available for power-line filters, for instance:

- built-in connector, also with fuse holders and main switch;
- sealed in a plastic or metal case, for printed-circuit-board mounting;
- metal case with earth terminal, connections by fast-on or screws, etc.

Typical filters for installation on shielded rooms (both power supply and telecommunication or control lines) present a feed-through construction for mounting on a metal plate; care is

advised in the preparation the surfaces before the installation of filters for good electrical bonding and to avoid corrosion.

As a general rule, particularly for high-frequency disturbances, filters should be located as near as possible to the apparatus which is the source or victim, to minimize the impedance of the connection. Filters may be enclosed in the apparatus cubicle or mounted in a dedicated unit installed in its proximity. Filter installation must be consistent with the overall shield topology.

6.6.1 Installation and mounting techniques


If filter circuits consist of individual components, such as capacitors, chokes and resistors, the following should be considered:

- components should be arranged along the line to avoid capacitive and inductive coupling between components and between filter inputs and outputs;
- filters should be well screened to prevent coupling between filter inputs and outputs;
- an important safety consideration is related to the selection of the capacitors providing decoupling to earth. These capacitors should not become short circuits when damaged;
- since attenuation of a filter circuit in the MHz range is primarily determined by the capacitors connected to earth, the connecting leads of the capacitors should be as short as possible;
- filter circuits that are to be installed in devices with limited available space should be screened consistent with the shield topology;
- the metallic filter cases should have a non-corroding surface in order to ensure a low contact resistance of the case to the interface with the victim apparatus throughout an extensive period of time;
- some filter circuits that have been combined to form a filter could be subjected to different disturbance levels, or may be intended for apparatus with different immunity levels. They are therefore also designed for different degrees of attenuation. These filter circuits should be decoupled from each other by screening.

6.6.2 Wiring


Physical separation of input and output lines is facilitated by the feed-through mounting technique of the filters. Inputs and outputs of filters should be arranged as far apart as possible; leads from the input and output side should never be in the same bundle.

If screened conductors are to be connected to the filter case, coaxial screw-type connections should be used. The mounting of a filter is often more important than type of filter. Poor mounting of an otherwise good filter will produce poor filtering. The filter earth connection impedance should be as low as possible to avoid the generation of disturbances that would otherwise be applied in common mode to the apparatus to be protected. See figures 13 and 14 for examples.

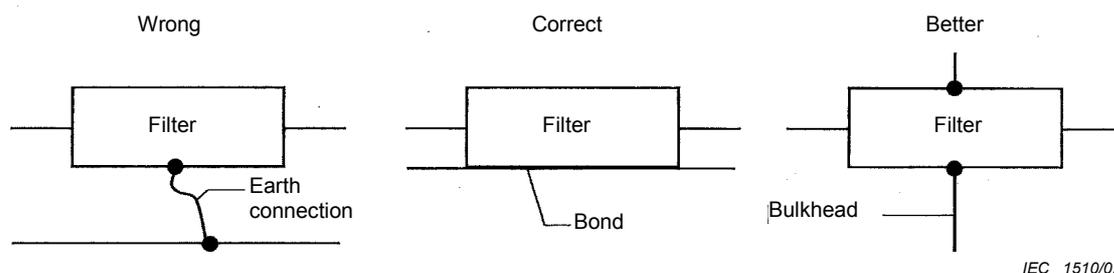

IEC 1510/02

Figure 13 – Mounting of filters

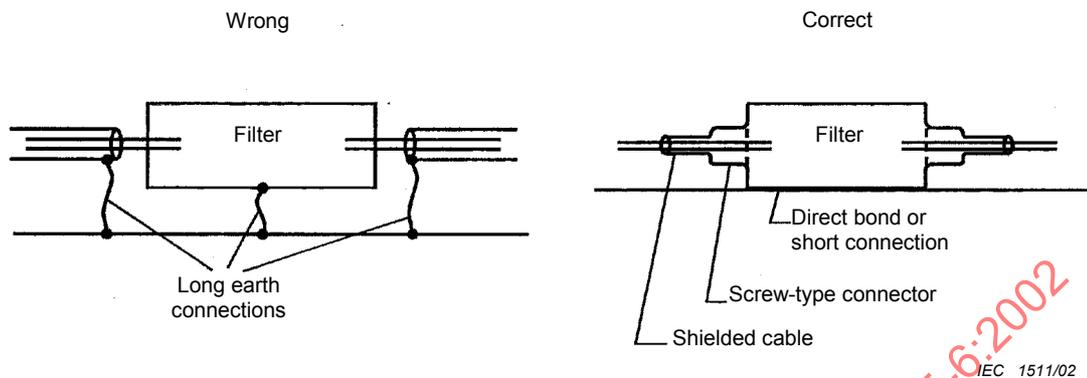


IEC 1511/02

Figure 14 – Connection of screened cables

6.6.3 Installation of cabinet filters

When an installation includes the provision of cabinets or cubicles, in which several individual apparatuses will be operating, these cabinets become the responsibility of the installer, in contrast with the situation where a complete cabinet is supplied by a manufacturer.

There can be situations where the installer will be expected to provide filters where the installation wiring interfaces with this cabinet or cubicle. Figure 15 illustrates the integration of filters within a cubicle, and figure 16 illustrates an arrangement with a separate, dedicated filter unit installed adjacent to an equipment cabinet.

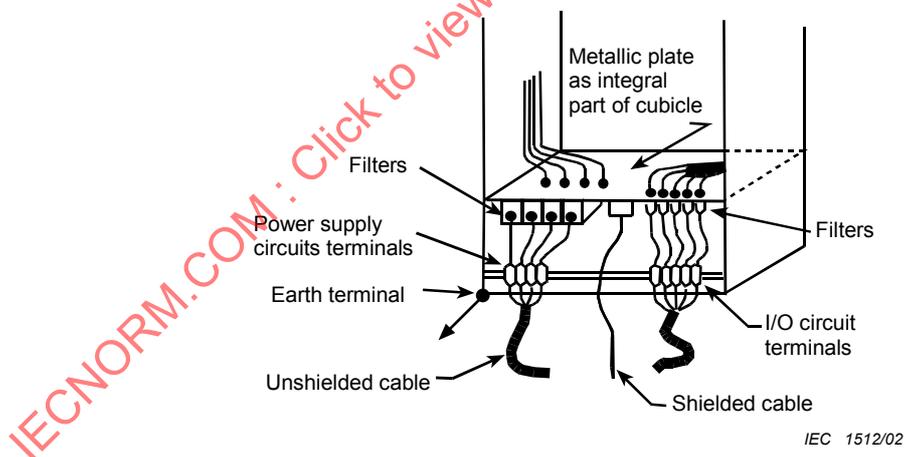

IEC 1512/02

Figure 15 – Example of integration of filters inside an equipment cubicle

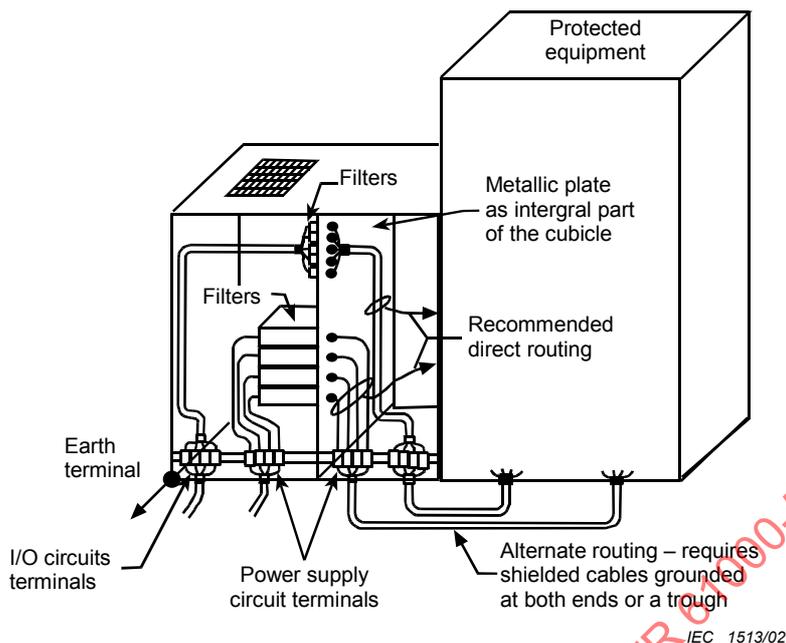


Figure 16 – Example of filter mounting in a dedicated unit

6.7 Filter testing

6.7.1 General considerations

This clause addresses testing procedures for installations that include filters, not test procedures associated with incoming reception or performance verification of filters as loose components. Consequently, the test procedures for the following parameters – essential as prerequisites for a successful system design – will not be discussed here as they are considered to be routine tests on components, not installations:

- voltage and current rating;
- duty cycle and overload conditions;
- voltage drop (power-line filters) and signal loss (telecommunications and control filters);
- climatic conditions.

Performance of filters should be verified after they are installed in the equipment or environment for which they are intended. The effectiveness of the earth connection should be assessed by measuring it by a HF conducted test. Correct installation and connections should be checked with the filters in operation, for the absence of any oscillation. The attenuation tests for transient disturbances should be made on installed filters, as described under 6.7.4.

6.7.2 Insulation to earth and withstand voltage of installed filters

Should an insulation test be advisable (in the case of tight clearances, for instance), the test procedure specified in IEC 60939-1 for testing insulation resistance and dielectric strength applies to both power port filters and telecommunication and control port filters.

Concerning the 1,2/50 μ s surge test: the test generator and test procedure specified in IEC 61000-4-5 are applicable as follows. The combination wave test generator (1,2/50 to 8/20) defined in the standard should be used, with the appropriate internal impedances.

The insulation test should be carried out on the filter under no-load condition, and not connected to power supply or signal sources. The test generator may therefore be directly connected to the filter under test without using any coupling/decoupling network. The output terminals of the filter under test should be maintained opened and isolated from earth.