

# TECHNICAL REPORT

**IEC**  
**TR 62102**

Second edition  
2005-05

---

---

**Electrical safety –  
Classification of interfaces for equipment  
to be connected to information and  
communications technology networks**

IECNORM.COM : Click to view the full PDF of IEC TR 62102:2005



Reference number  
IEC/TR 62102:2005(E)

## Publication numbering

As from 1 January 1997 all IEC publications are issued with a designation in the 60000 series. For example, IEC 34-1 is now referred to as IEC 60034-1.

## Consolidated editions

The IEC is now publishing consolidated versions of its publications. For example, edition numbers 1.0, 1.1 and 1.2 refer, respectively, to the base publication, the base publication incorporating amendment 1 and the base publication incorporating amendments 1 and 2.

## Further information on IEC publications

The technical content of IEC publications is kept under constant review by the IEC, thus ensuring that the content reflects current technology. Information relating to this publication, including its validity, is available in the IEC Catalogue of publications (see below) in addition to new editions, amendments and corrigenda. Information on the subjects under consideration and work in progress undertaken by the technical committee which has prepared this publication, as well as the list of publications issued, is also available from the following:

- **IEC Web Site** ([www.iec.ch](http://www.iec.ch))

- **Catalogue of IEC publications**

The on-line catalogue on the IEC web site ([www.iec.ch/searchpub](http://www.iec.ch/searchpub)) enables you to search by a variety of criteria including text searches, technical committees and date of publication. On-line information is also available on recently issued publications, withdrawn and replaced publications, as well as corrigenda.

- **IEC Just Published**

This summary of recently issued publications ([www.iec.ch/online\\_news/justpub](http://www.iec.ch/online_news/justpub)) is also available by email. Please contact the Customer Service Centre (see below) for further information.

- **Customer Service Centre**

If you have any questions regarding this publication or need further assistance, please contact the Customer Service Centre:

Email: [custserv@iec.ch](mailto:custserv@iec.ch)  
Tel: +41 22 919 02 11  
Fax: +41 22 919 03 00

IECNORM.COM Click to view the full PDF of IEC TR 62192:2005

# TECHNICAL REPORT

# IEC TR 62102

Second edition  
2005-05

---

---

## Electrical safety – Classification of interfaces for equipment to be connected to information and communications technology networks

IECNORM.COM : Click to view the full PDF of IEC TR 62102:2005

© IEC 2005 — Copyright - all rights reserved

No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Electrotechnical Commission, 3, rue de Varembé, PO Box 131, CH-1211 Geneva 20, Switzerland  
Telephone: +41 22 919 02 11 Telefax: +41 22 919 03 00 E-mail: [inmail@iec.ch](mailto:inmail@iec.ch) Web: [www.iec.ch](http://www.iec.ch)



Commission Electrotechnique Internationale  
International Electrotechnical Commission  
Международная Электротехническая Комиссия

PRICE CODE

T

*For price, see current catalogue*

## CONTENTS

FOREWORD.....	3
INTRODUCTION.....	5
1 Scope.....	6
2 Normative references.....	6
3 Terms and definitions .....	7
3.1 Definitions from IEC 60950-1 .....	7
3.2 Definitions from IEC 60950-21 .....	9
3.3 Additional definitions for this document .....	9
3.4 Abbreviations.....	10
4 Reference configuration.....	10
5 Safety categories of interfaces provided for connection to an information and communications technology network .....	13
5.1 SELV circuits.....	13
5.2 TNV circuits.....	13
5.3 User information .....	13
5.4 RFT circuits.....	13
6 Phenomena affecting the safety of interface ports .....	13
6.1 Network Environment 0.....	14
6.2 Network Environment 1.....	14
7 Determination of circuit type.....	15
Annex A (informative) Consideration of interface phenomenon .....	16
Annex B (informative) Worked examples of certain network interfaces.....	19
Annex C (informative) Conditions for Network Environment 0.....	22
Annex D (informative) Voltage ranges of SELV circuits and TNV circuits.....	23
Bibliography.....	24

IECNORM.COM - Click to view the full PDF of IEC TR 62102:2005

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

---

**ELECTRICAL SAFETY –  
CLASSIFICATION OF INTERFACES FOR EQUIPMENT  
TO BE CONNECTED TO INFORMATION AND  
COMMUNICATIONS TECHNOLOGY NETWORKS**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. However, a technical committee may propose the publication of a technical report when it has collected data of a different kind from that which is normally published as an International Standard, for example "state of the art".

IEC 62102, which is a technical report, was prepared by IEC technical committee 108: Safety of electronic equipment within the field of audio/video, information technology and communication technology, previously organized as IEC technical committee 74: Safety and energy efficiency of IT equipment.

This second edition cancels and replaces the first edition published in 2001. This edition constitutes a technical revision. The principal changes in this edition as compared with the first edition of IEC 62102 are as follows (small changes are not listed):

- this 2nd edition was updated to accord with IEC 60950-1:2001;
- RFT (remote feeding telecommunication) circuits from IEC 60950-21 have been added;

- in Annex B more interfaces have been added;
- in Annex B the category of xDSL interfaces have replaced ADSL interfaces.

The text of this technical report is based on the following documents:

Enquiry draft	Report on voting
108/128/DTR	108/130/RVC

Full information on the voting for the approval of this technical report can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

Terms printed in **bold** in the text are defined in Clause 3.

The committee has decided that the contents of this publication will remain unchanged until the maintenance result date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

A bilingual version of this document may be published at a later date.

IECNORM.COM : Click to view the full PDF of IEC TR 62102:2005

## INTRODUCTION

This technical report is a guide to the determination of the interface requirements for equipment in terms of safety. It lists a number of interfaces and indicates the safety category of each listed interface. This technical report does not contain sufficient detail for conformance testing purposes, except when used in conjunction with product standards such as IEC 60950-1 and IEC 60950-21.

The equipment safety standards IEC 60950-1 and IEC 60950-21 specify the requirements for categories of circuits as **SELV circuits**, **TNV circuits**, **RFT circuits** and **hazardous voltage circuits** (among others). For stand-alone equipment it is a relatively simple matter to determine the different categories of circuits. However, an equipment which has data port interfaces is intended to be connected to other equipment, either locally or via a network. In this case, the safety categories of the interfaces which will be connected together have to be compatible with each other. Furthermore, the category of the interface of the remote equipment may be unknown. This is the case in systems where telecommunication equipment and data processing equipment are connected together via different types of interfaces and networks.

To overcome this situation it is necessary to classify the interfaces of equipment in such configurations according to the application and to select the safety category for the interfaces of the equipment and for the type of the network. Similarly, the interfaces have to be classified for protection against damage of the equipment and of the network. Aspects of protection are dealt with in the ITU-T K series of recommendations.

IECNORM.COM : Click to view the full PDF of IEC TR 62102:2005

# ELECTRICAL SAFETY – CLASSIFICATION OF INTERFACES FOR EQUIPMENT TO BE CONNECTED TO INFORMATION AND COMMUNICATIONS TECHNOLOGY NETWORKS

## 1 Scope

This technical report applies to equipment interfaces. These interfaces within the equipment may be connected to **telecommunication networks**, may form part of the **telecommunication network** infrastructure or may provide localized transfer of data. This technical report provides guidance on the classification of interfaces in accordance with the circuit types defined in IEC 60950-1 and IEC 60950-21 following an analysis of the **telecommunication network** characteristics.

This technical report only covers equipment appropriately interconnected. Furthermore, it does not address damage caused by one equipment to another equipment to which it is connected. Exceptionally, interfaces may be designed for higher or lower levels for special applications. In such cases it should be ensured that only interfaces having the same safety category and protection level are connected together. This is based on the available specifications of the equipment manufacturers and network providers, and on information regarding the installation category of the mains interface.

This technical report is intended to be used by equipment designers, network operators, network regulators/authorities, standards writers and network installers. It is applicable to various interfaces of equipment. Network presentations are not equipment and so are not covered by IEC 60950-1 and IEC 60950-21, hence they are also not covered by this technical report. However, it is necessary to consider the characteristics, installation and presentation of **telecommunication networks** when determining what equipment interface requirements apply (for example, **SELV circuit**, **TNV-1 circuit**, **TNV-2 circuit**, **TNV-3 circuit** etc.).

If a standard other than IEC 60950-1 or IEC 60950-21 is used for designing the equipment and its interface (for example, IEC 62151 in conjunction with other product safety standards), then the corresponding requirements of these other standards are to be preferred.

If there is a conflict between this technical report and a more detailed specification, the latter prevails.

This technical report applies regardless of ownership or responsibility for installation and maintenance of the equipment or network.

NOTE Terminal equipment is often connected to customer premises cabling when used in a business environment, and there are standards covering such cabling.

## 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60950-1:2001, *Information technology equipment – Safety – Part 1: General requirements*

IEC 60950-21:2002, *Information technology equipment – Safety – Part 21: Remote power feeding*

### 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

#### 3.1 Definitions from IEC 60950-1

##### 3.1.1

###### **a.c. mains supply**

a.c. power distribution system external to the equipment for supplying power to a.c. powered equipment. These power sources include public or private utilities and, unless otherwise specified in the standard, equivalent sources such as motor-driven generators and uninterruptible power supplies

[IEC 60950-1, definition 1.2.8.1]

##### 3.1.2

###### **hazardous voltage**

voltage exceeding 42,4 V peak, or 60 V d.c., existing in a circuit which does not meet the requirements for either a **limited current circuit** or a **TNV circuit**

[IEC 60950-1, definition 1.2.8.5]

##### 3.1.3

###### **limited current circuit**

circuit which is so designed and protected that, under both normal operating conditions and single fault conditions, the current which can be drawn is not hazardous

[IEC 60950-1, definition 1.2.8.8]

##### 3.1.4

###### **primary circuit**

circuit which is directly connected to the **a.c. mains supply**. It includes, for example, the means for connection to the **a.c. mains supply**, the primary windings of transformers, motors and other loading devices

[IEC 60950-1, definition 1.2.8.3]

##### 3.1.5

###### **secondary circuit**

circuit which has no direct connection to a **primary circuit** and derives its power from a transformer, converter or equivalent isolation device, or from a battery

[IEC 60950-1, definition 1.2.8.4]

##### 3.1.6

###### **SELV circuit**

**secondary circuit** which is so designed and protected that under normal operating conditions and single fault conditions, its voltages do not exceed a safe value

[IEC 60950-1, definition 1.2.8.7]

##### 3.1.7

###### **TNV circuit (including TNV-1 circuit, TNV-2 circuit, TNV-3 circuit)**

circuit that is in the equipment and to which the accessible area of contact is limited and that is so designed and protected that, under normal operating conditions and single fault conditions, the voltages do not exceed specified limit values

[IEC 60950-1, definition 1.2.8.10]

**3.1.8****telecommunication network**

metallically terminated transmission medium intended for communication between equipment that may be located in separate buildings, excluding:

- the mains system for supply, transmission and distribution of electrical power, if used as a telecommunication transmission medium;
- **cable distribution systems**;
- **SELV circuits** connecting units of data processing equipment

NOTE 1 The term **telecommunication network** is defined in terms of its functionality, not its electrical characteristics. A **telecommunication network** is not itself defined as being either an **SELV circuit** or a **TNV circuit**. Only the circuits in the equipment are so classified.

NOTE 2 A **telecommunication network** may be:

- publicly or privately owned;
- subject to transient overvoltages due to atmospheric discharges and faults in power distribution systems;
- subject to longitudinal (common mode) voltages induced from nearby power lines or electric traction lines.

NOTE 3 Examples of **telecommunication networks** are:

- a public switched telephone network;
- a public data network;
- an Integrated Services Digital Network (ISDN);
- a private network with electrical interface characteristics similar to the above.

[IEC 60950-1, definition 1.2.13.8]

**3.1.9****cable distribution system**

metallically terminated transmission medium using coaxial cable, mainly intended for transmission of video and/or audio signals between separate buildings or between outdoor antennas and buildings, excluding:

- the mains system for supply, transmission and distribution of electric power, if used as a communication transmission medium;
- **telecommunication networks**;
- **SELV** circuits connecting units of information technology equipment

NOTE 1 Examples of **cable distribution systems** are:

- local area cable networks, community antenna television systems and master antenna television systems providing video and audio signal distribution;
- outdoor antennas including satellite dishes, receiving antennas, and other similar devices.

NOTE 2 **Cable distribution systems** may be subjected to greater transients than **telecommunication networks**.

[IEC 60950-1, definition 1.2.13.14]

**3.1.10****service person**

person having appropriate technical training and experience necessary to be aware of hazards to which that person may be exposed in performing a task and of measures to minimize the risks to that person or other persons

[IEC 60950-1, definition 1.2.13.5]

**3.1.11****user**

any person, other than a **service person**

[IEC 60950-1, definition 1.2.13.6]

### 3.2 Definitions from IEC 60950-21

#### 3.2.1

##### **RFT circuit**

remote feeding telecommunication circuit

a **secondary circuit** within the equipment, intended to supply or receive d.c. power via a **telecommunication network** at voltages equal to or exceeding the limits for **TNV circuits**, and on which overvoltages from **telecommunication networks** are possible

[IEC 60950-1, definition 3.1]

#### 3.2.2

##### **RFT-C circuit**

an **RFT circuit** which is so designed and protected that under normal operating conditions and single fault conditions, the currents in the circuit do not exceed defined values

[IEC 60950-1, definition 3.2]

#### 3.2.3

##### **RFT-V circuit**

an **RFT circuit** which is so designed and protected that under normal operating conditions and single fault conditions the voltages are limited and the accessible area of contact is limited

[IEC 60950-1, definition 3.3]

### 3.3 Additional definitions for this document

#### 3.3.1

##### **antenna interface**

a port for connection of a radio frequency antenna to equipment

#### 3.3.2

##### **coaxial cable interface**

a port for connection of a coaxial cable providing for asymmetrical transmission to equipment

NOTE In this technical report the use of both indoor and outdoor coaxial cables is considered separately.

#### 3.3.3

##### **network termination point**

the physical point at the boundary of a network intended to accept the connection of a terminal equipment or to be interconnected to another network

#### 3.3.4

##### **paired conductor interface**

a port for connection of a cable providing for symmetrical transmission (for example, twisted pair) to equipment

NOTE In this technical report the use of both indoor and outdoor twisted pair cables is considered separately.

#### 3.3.5

##### **terminal connection point**

the physical point of the terminal equipment intended to be connected to a network

### 3.4 Abbreviations


For the purposes of this technical report, the following abbreviations apply to Clause 4, Annex B and Annex C:

ADSL	Asymmetric Digital Subscriber Line
DLL	Digital Local Line
DSL	Digital Subscriber Line
ESD	Electrostatic Discharge
HPNA	Home Phone-Line Networking Architecture
ISDN	Integrated Services Digital Network
KYBD	Keyboard
LAN	Local Area Network
LEPM	Primary Multiplex
LPZ	Lightning Protection Zone
LTU	Line termination unit
NCP	Network Connection Point
NO	Network Operator
NT	Network Termination
NTBA	Network Termination, Basic Access
NTP	Network Termination Point
NTU	Network Terminating Unit
PABX	Private Automatic Branch Exchange
PC	Personal Computer
PCM	Pulse Code Modulation
PNO	Public Network Operator
POTS	Plain Old Telephone Service
PSTN	Public Switched Telephone Network
RFT	Remote Feeding Telecommunication
RPS	Remote Power Supply
RS	Recommended Standard
SDH	Synchronous Digital Hierarchy
TA	Terminal Adapter
TCP	Terminal Connection Point
TE	Terminal Equipment
USB	Universal Serial Bus
VGA	Video Graphics Array
ZWRBA	Regenerator, Basic Access

## 4 Reference configuration

Figure 1 illustrates a hypothetical configuration of "network clouds" giving examples of the types of equipments covered by this technical report. Certain of these equipments will only have one or two interface types, others may have many. Certain of the "network clouds" will be elements within the PSTN (where the possibility of more than one network operator exists) and others may be private networks. The equipment connected to this "network cloud" and part of the "network cloud" itself can be any type covered by the scope of this technical report.

This technical report provides a framework for safety requirements and protection levels by reference to the particular examples given in Figures 1 and 2. Configurations not covered should be treated using the same principles.

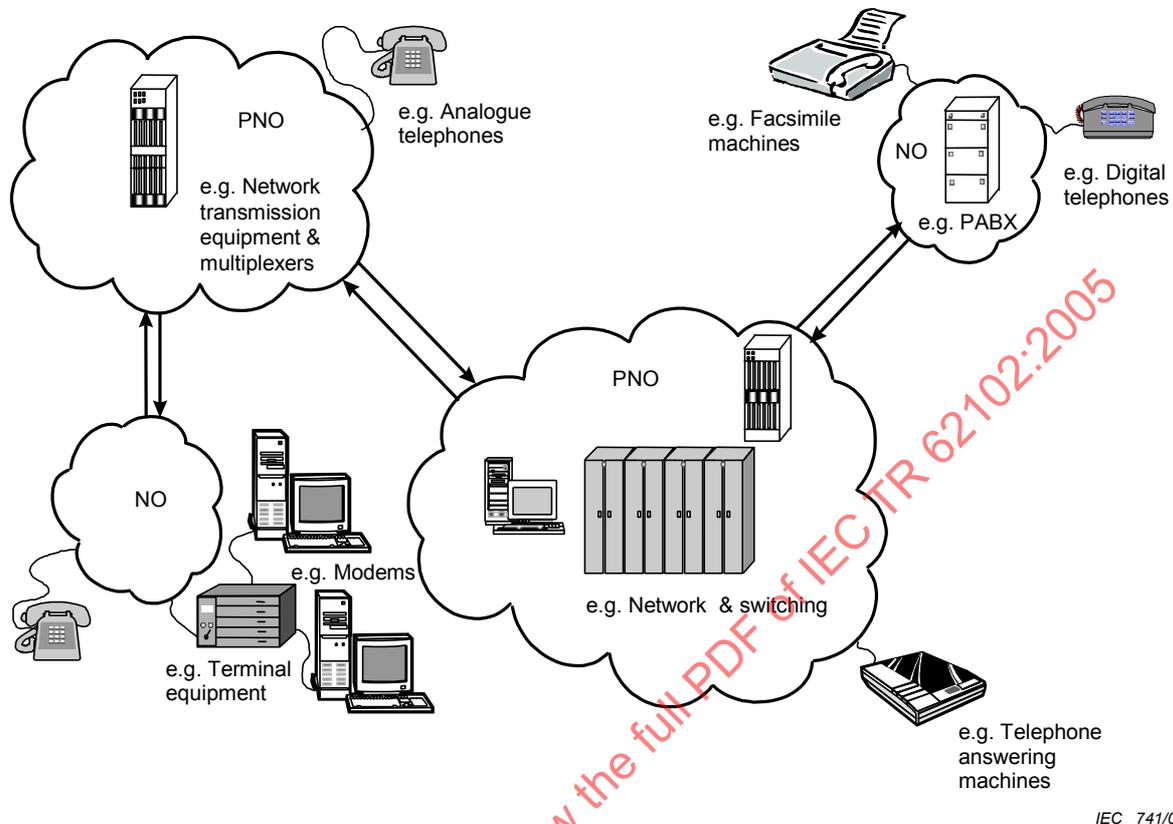


IEC 741/05

**Figure 1 – Reference configuration**


Where, in a practical situation, an equipment has two or more interfaces of different types, it is normally necessary to provide safety separation within the equipment between those interfaces in accordance with IEC 60950-1 and IEC 60950-21.

Figure 2 illustrates examples of possible network configurations. Included are some of the network elements involved in such networks and an indication of the various commercial organizations, both Public Network Operators (PNOs) and Network Operators (NOs) generally (public or private) that are involved in providing network infrastructures to service the end customer.

Example 1

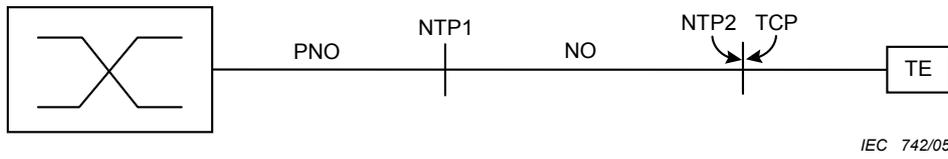

Example 2

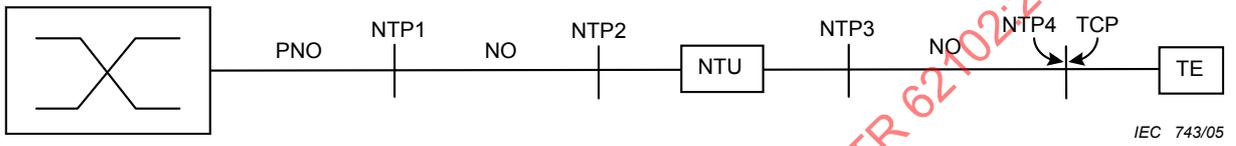

Example 3

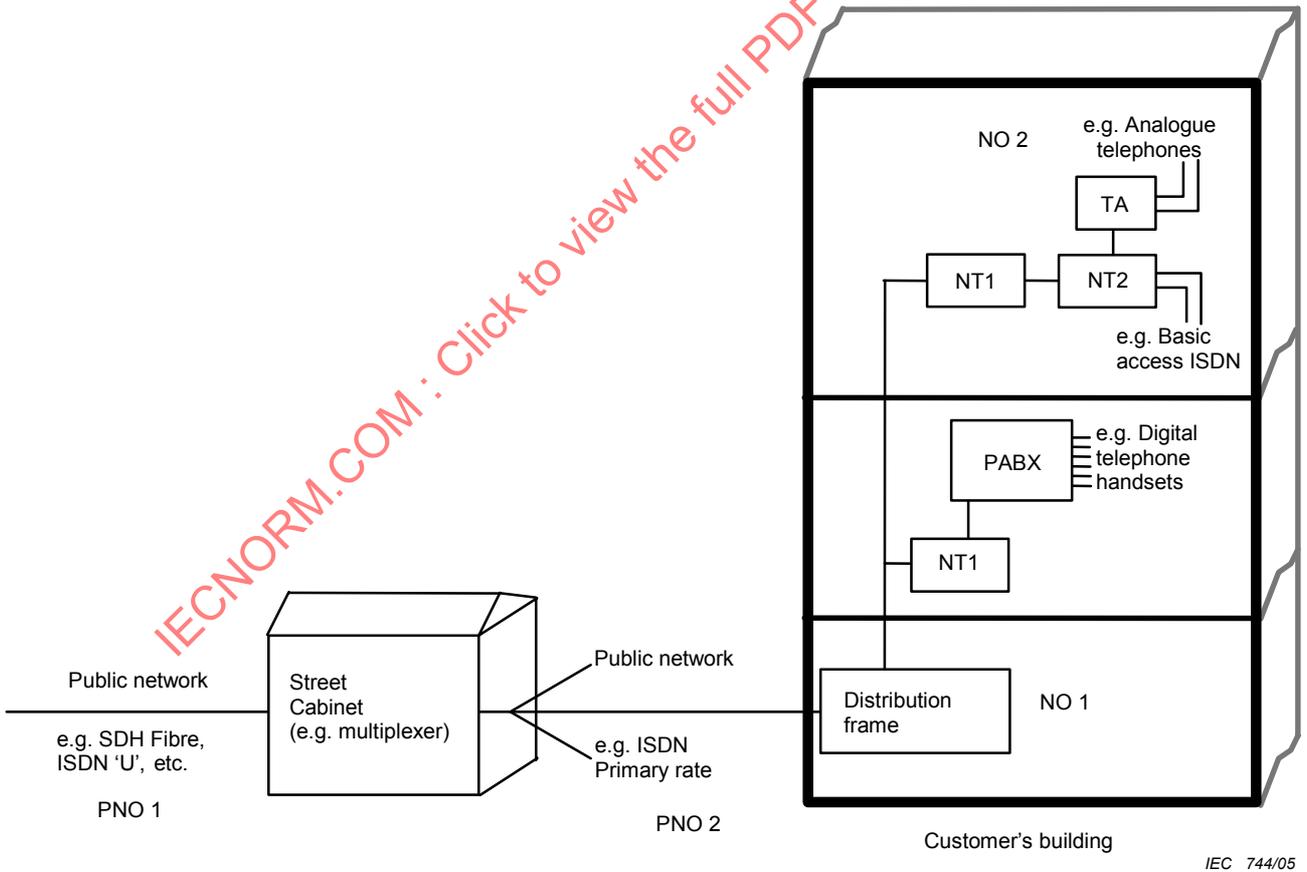


Figure 2 – Examples of network configurations

## 5 Safety categories of interfaces provided for connection to an information and communications technology network

NOTE Both **primary circuits** and **secondary circuits** can be subject to transient overvoltages. Refer to IEC 60950-1.

### 5.1 SELV circuits

The requirements for **SELV circuits** are as specified in IEC 60950-1.

### 5.2 TNV circuits

The requirements for **TNV circuits** are as specified in IEC 60950-1. **TNV circuits** are further sub-divided into **TNV-1 circuits**, **TNV-2 circuits** and **TNV-3 circuits**, depending on their nominal operating voltage and on the likelihood of their being subject to overvoltages.

### 5.3 User information

The safety classification (for example, **SELV circuit**, **TNV-1 circuit**, **TNV-2 circuit** or **TNV-3 circuit**) of ports for networks, and any restrictions applicable to the network topology (for example, whether they are in a Network Environment 0 or Network Environment 1, see 6.1 and 6.2) are to be stated in the manufacturer's documentation supplied with the equipment if confusion could result in a safety hazard (see 1.7.2 of IEC 60950-1).

NOTE Depending on the design of the interface, it is possible for one port to be suitable for connection to more than one type of circuit in other equipment. For example, consider circuitry in an equipment which meets the requirements for a **SELV circuit** and where the telecommunication interface port is separated from this circuitry in accordance with 6.2.1 of IEC 60950-1; this telecommunication interface port would be suitable for connection to either a **SELV circuit** or a **TNV-1 circuit**.

For equipment intended to be installed by the **user** it is recommended to either:

- provide telecommunication interface ports with circuitry intended for connection to a Network Environment 1 (for example, a **TNV-1 circuit** instead of a **SELV circuit**, or a **TNV-3 circuit** instead of a **TNV-2 circuit**); or
- provide sufficient information in the instructions to the **user** to avoid connection to a **telecommunication network** in a Network Environment 1.

### 5.4 RFT circuits

The requirements for **RFT circuits** are as specified in IEC 60950-21.

## 6 Phenomena affecting the safety of interface ports

Annex A identifies a number of phenomena, some of which can affect a **telecommunication network** in such a way that an overvoltage can be induced and transmitted to the interface port of the equipment. These phenomena are typically independent of the normal operating voltage on the circuit, but can be affected by the circuit impedance.

To determine the safety status of circuits within the equipment for connection to a particular network it is necessary to know:

- the normal operating voltage on the circuit (due to the circuit under consideration and any voltages coming from the **telecommunication network**);
- the severity and frequency of overvoltages;
- if the circuit presents an energy hazard;
- if the circuit is supplied from a limited power source.

### 6.1 Network Environment 0

A **telecommunication network** is considered to be in a Network Environment 0 if the following conditions apply to all parts of that network:

- a) the possible effect of indirect lightning has been reduced (for details see Annex C, point 1);
- b) the possibility of having different earth potentials has been reduced (for details see Annex C, point 2);
- c) the possibility of power cross/contact has been reduced (for details see Annex C, point 3);
- d) the possibility of induced transients and voltages has been reduced (for details see Annex C, points 4 and 5).

### 6.2 Network Environment 1

A **telecommunication network** is considered to be in a Network Environment 1 if one or more of the requirements for a Network Environment 0 are not fulfilled.


IECNORM.COM : Click to view the full PDF of IEC TR 62102:2005

## 7 Determination of circuit type

In order to determine which circuit type is applicable to a particular interface it is necessary to know:

- the operating voltage (or current for certain circuits) under normal and single fault conditions within the equipment; and
- if the network is a Network Environment 0 or a Network Environment 1.

This is shown in Figure 3.

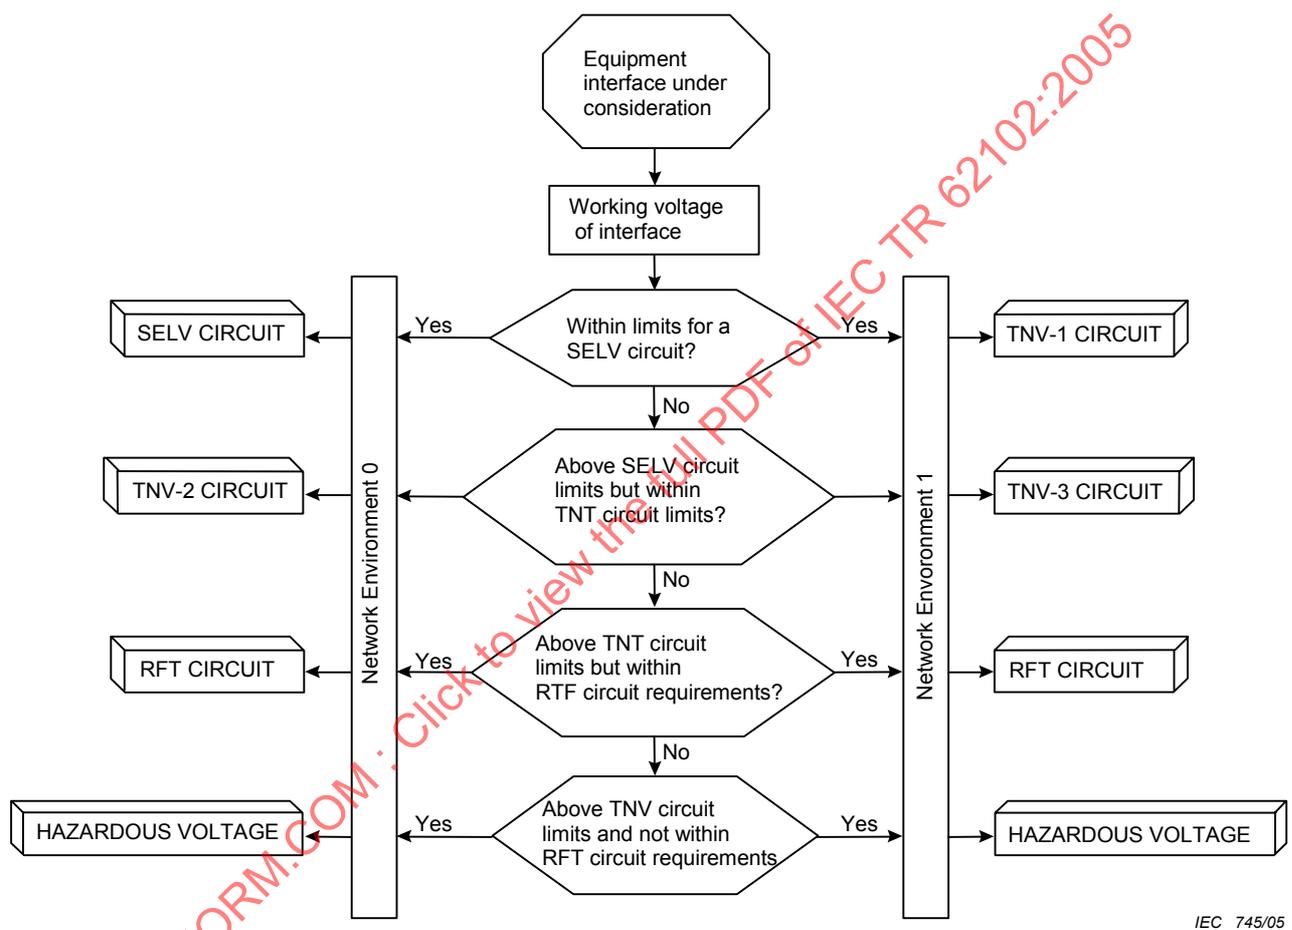

IEC 745/05

NOTE 1 The requirements for separating **SELV circuits**, **TNV circuits** and **RFT circuits** from **hazardous voltages** are as specified in IEC 60950-1 and IEC 60950-21. A **hazardous voltage** can exist in a **primary circuit** or a **secondary circuit**.

NOTE 2 Characterization of circuit types involves more than the voltage characteristics used to illustrate networks, such as isolation method, current limits, energy limits, overvoltages and transients. Refer to the circuit requirements for proper details.

**Figure 3 – Flowchart for determination of circuit type**

Examples of certain network interfaces are shown in Annex B. Voltage ranges of SELV circuits and TNV circuits are indicated in Annex D.

**Annex A**  
(informative)

**Consideration of interface phenomenon**  
**Table A.1 – Consideration of interface phenomenon**

Phenomenon	Interface port to be covered	Existing standards/Other documents	Safety considerations
Normal operating voltage	Outdoor paired conductor		TNV-1 circuit (if within limits for a SELV circuit) or TNV-3 circuit (if within limits for a TNV-3 circuit), or RFT circuits (if within the limits of <b>RFT circuits</b> ) due to induced overvoltages or hazardous voltage.
	Outdoor coaxial cable		TNV-1 circuit (if within limits for a SELV circuit) or TNV-3 circuit (if within limits for a TNV-3 circuit), due to induced overvoltages or hazardous voltage.
	Indoor paired conductor		Could be SELV circuit, TNV-1 circuit, TNV-2 circuit, TNV-3 circuit, or RFT circuits or hazardous voltage.
	Indoor coaxial cable		Could be SELV circuit, TNV-1 circuit, TNV-2 circuit, TNV-3 circuit or hazardous voltage.
	AC mains supply		Primary circuit, hazardous voltage.
	Outdoor antenna	IEC Guide 112	Covered by the surge test of IEC 60065, 10.1.
			Could be TNV-1 circuit (if within voltage limits for a SELV circuit) or TNV-3 circuit (if within limits for a TNV-3 circuit).
Induced disturbance due to lightning	Outdoor paired conductor		Network installation must limit transients to 1,5 kV per IEC 60950 series.
	Outdoor coaxial cable		Network installation must limit transients to 4,0 kV, if for signals, and 5,0 kV, if for powering repeaters, and 10 kV if connected to an outdoor antenna per IEC 60950 series.
	Indoor paired conductor	IEC 61312-1	Covered by 1,5 kV transient requirement of IEC 60950 series for TNV-1 circuits and TNV-3 circuits if the installation provides adequate protection means.
	Indoor coaxial cable	IEC 61312-1	Covered by 1,5 kV transient requirement of IEC 60950 series for TNV-1 circuits and TNV-3 circuits if the installation provides adequate protection means.
	AC mains supply		This is covered by IEC 60664-1.

Table A.1 (continued)

Phenomenon	Interface port to be covered	Existing standards/Other documents	Safety considerations
Direct lightning stroke	Outdoor paired conductor		The voltages expected as a result of a direct lightning stroke on a paired conductor cable are in excess of those considered by IEC 60950 series and so are beyond the scope of this technical report.
	Outdoor coaxial cable		Covered by earthing practices of the network operator which are beyond the scope of this technical report.
Induced by electric power and traction systems	Antenna		Outdoor antennas require protective earthing, the provision of which is covered by earthing practices of the network operator or the national code which are beyond the scope of this technical report.
	Outdoor paired conductor		Requirements of ITU-T Directives, volume VI, were considered when writing IEC 60950 series and so no further action is required for TNV-1 circuits, TNV-3 circuits and RFT circuits.
	Outdoor coaxial cable		Requirements of ITU-T Directives, volume VI, were considered when writing IEC 60950 series and so no further action is required for TNV-1 circuits and TNV-3 circuits.
ESD			Beyond the scope of this technical report.
Surges due to high voltage switching	AC mains supply	IEC 60664-1	Covered by IEC 60664-1.
Differences in earth potential	Outdoor paired conductor		Ensure that interfaces are separated from earth in accordance with 6.2.1 c) of IEC 60950-1.
	Outdoor coaxial cable		Ensure that either the installation meets ITU-T Recommendation K.27 or ITU-T Recommendation K.31, as applicable to the installation, or that interfaces are separated from earth in accordance with 6.2.1 c) of IEC 60950-1.
	Indoor paired conductor		Covered by consideration of Network Environment, which cross-refers to equipotential bonding per IEC 60364. For Network Environment 1, the interfaces should be treated as for outdoor paired conductors.
	Indoor coaxial cable		Covered by consideration of Network Environment, which cross-refers to equipotential bonding per IEC 60364. For Network Environment 1, the interfaces should be treated as for outdoor coaxial cables.

Phenomenon	Interface port to be covered	Existing standards/Other documents	Safety considerations
Power cross (direct contact)	Outdoor paired conductor	ITU-T Recommendations K.20, K.21	
	Outdoor coaxial cable		
Mains induced	Outdoor paired conductor		Ensure that the installation meets ITU-T Recommendation K.27 or ITU-T Recommendation K.31, as applicable to the installation.
	Outdoor coaxial cable		Ensure that the installation meets ITU-T Recommendation K.27 or ITU-T Recommendation K.31, as applicable to the installation.
	Indoor paired conductor		Ensure that the installation meets ITU-T Recommendation K.27 or ITU-T Recommendation K.31, as applicable to the installation.
	Indoor coaxial cable		Ensure that the installation meets ITU-T Recommendation K.27 or ITU-T Recommendation K.31, as applicable to the installation.

[www.iec-norm.com](http://www.iec-norm.com) : Click to view the full PDF of IEC TR 62102:2005

## Annex B (informative)

### Worked examples of certain network interfaces

Table B.1 provides some worked examples of common network interfaces. This table recognizes that interfaces for information and communications technology networks are often standardized regionally or nationally, rather than internationally. It is not intended for this list to be exhaustive.

**Table B.1 – Worked examples of certain network interfaces**

Interface or connection point	Documents relevant for the interface	Approximate operating voltage	Earthing <sup>a</sup>	Network environment per Clause 6	IEC 60950 series circuit category
"48 V" station battery <sup>b</sup>	ETSI EN 300 132-2, ANSI T1.315-1994	max. -57 V d.c.	yes/no	0	<b>SELV</b>
"60 V" station battery <sup>b</sup>	ETSI EN 300 132-2	max. -75 V d.c.	yes/no	0	<b>TNV-2</b>
1394a	IEEE 1394a and 1394-1995 (IEEE 1394ta)	30 V d.c.	yes	0	<b>SELV</b>
1394b	IEEE 1394b (IEEE 1394ta)	30 V d.c.	no	1	<b>TNV-1</b>
Analogue PSTN 48 V battery	ETSI EN 300 001 ETSI TBR21	-57 V d.c. 80 V <sup>c</sup> a.c.	yes/no	1	<b>TNV-3</b>
Analogue PSTN 60 V battery	ETSI EN 300 001 ETSI TBR 21	-75 V d.c. 80 V a.c. <sup>c</sup>	yes/no	1	<b>TNV-3</b>
Centronics/parallel interface (PC)	Manufacturer's specification	5 V d.c.	yes/no	0	<b>SELV <sup>d</sup></b>
[Unstructured] E1	ETSI EN 300 416, ETSI EN 300 247	± 2 V d.c.	no	1/0	<b>TNV-1/SELV <sup>d</sup></b>
Ethernet 10Base2	ISO/IEC 8802-3	± 2 V d.c.	no	0	<b>SELV</b>
Ethernet 10Base5	ISO/IEC 8802-3	± 2 V d.c.	no	1	<b>TNV-1</b>
Ethernet 10BaseT	ISO/IEC 8802-3	± 2 V d.c.	no	0	<b>SELV</b>
G.703	ITU T Rec. G.703	± 3 V d.c.	yes/no	1/0	<b>TNV-1/SELV <sup>d</sup></b>
HPNA	HPNA 1M8 PHY spec	80 V a.c. -75 V d.c.	yes/no	1	<b>TNV-3</b>
ISDN DLL (former ISDN UK0)	ETSI TS 102 080	115 V d.c.	yes/no	1	<b>TNV-3</b>
ISDN S0 bus	ETSI EN 300 012-1	40 V d.c.	no	1/0	<b>TNV-1/SELV <sup>d</sup></b>
KYBD (PS/2, 6 pin DIN Type)	Manufacturer's specification	± 5 V d.c.	yes	0	<b>SELV</b>
LEPM V2M (LTU side)	ETSI EN 300 233 ITU-T Rec. G.703	± 3 V d.c.	no	0	<b>SELV</b>
Monitor (VGA DB-15 connector)	Manufacturer's specification	5 V d.c.	yes	0	<b>SELV</b>
MOUSE (PS/2, 6 pin DIN Type)	Manufacturer's specification	± 5 V d.c.	yes	0	<b>SELV</b>
PCM11TA Tin (NTU side) Analogue PSTN	ETSI EN 300 001 ETSI TBR 21	31 V d.c. 40 V a.c. <sup>c</sup>	no	1	<b>TNV-3</b>
PCM11V A Tin (LTU side)	ETSI EN 300 001 ETSI TBR 21	-75 V d.c. 80 V a.c. <sup>c</sup>	yes	0	<b>TNV-2</b>

**Table B.1 – (continued)**

Interface or connection point	Documents relevant for the interface	Approximate operating voltage	Earthing <sup>a</sup>	Network environment per Clause 6	IEC 60950 series circuit category
PCM11VA SISA (LTU side)	QD2 TS 0076/96	± 1,5 V d.c.	yes	0	<b>SELV</b>
PCM11VA UB (LTU side)	ETSI EN 300 132-2	-75 V d.c.	yes	0	<b>TNV-2</b>
PCM2FA UK0	ITU-T Rec. G.703	115 V d.c.	no	1	<b>TNV-3</b>
PCM2TA TIn (NTU side)	ETSI EN 300 001 ETSI TBR 21 ETSI EN 300 659-2	31 V d.c. 40 V a.c. <sup>c</sup>	no	1	<b>TNV-3</b>
PCM2TA UK0 (NTU side)	ITU-T Rec. G.703	115 V d.c.	no	1	<b>TNV-3</b>
PCM2VA TIn (LTU side)	ETSI EN 300 001 ETSI TBR 21	-75 V d.c. 80 V a.c. <sup>c</sup>	yes	0	<b>TNV-2</b>
PCM2VA UK0 (LTU side)	ITU-T Rec. G.703	115 V d.c.	no	1	<b>TNV-3</b>
<b>RFT-C</b> Remote power feeding	IEC 60950-21	<1 500 V d.c.; 60 mA	yes/no	1	<b>RFT-C</b>
<b>RFT-V</b> Remote power feeding	IEC 60950-21	100 VA ± 200 V d.c. leakage current 10 mA by 10 kΩ after 10 s	yes/no	1	<b>RFT-V</b>
<b>RFT-V</b> Remote power feeding	IEC 60950-21	100 VA +140 V d.c.	yes/no	1	<b>RFT-V</b>
RPS Remote power supply	IEC 60950-21	110 V d.c.	no	1	<b>TNV-3</b>
RS 232 C/V.28	ITU-T Rec. V.28	± 15 V d.c.	yes/no	0	<b>SELV</b>
RS 422	ITU-T Rec. V.11	± 6 V d.c.	yes/no	1/0	<b>TNV-1/SELV <sup>d</sup></b>
RS 423	ITU-T Rec. V.10	± 6 V d.c.	yes/no	1/0	<b>TNV-1/SELV <sup>d</sup></b>
RS 485	ITU-T Rec. V.11	± 6 V d.c.	yes/no	1/0	<b>TNV-1/SELV <sup>d</sup></b>
SCSI (standard, wide and ultrawide)	Small computer system interface (STA)	5 V d.c.	yes	0	<b>SELV</b>
USB (Universal Serial Bus)	Manufacturer's specification USB 1.0 or 2.0	± 5 V d.c.	no	0	<b>SELV</b>
V 5.1	ETSI EN 300 324-1	± 3 V d.c.	no	1	<b>TNV-1</b>
V 5.2	ETSI EN 300 347-1	± 3 V d.c.	no	1	<b>TNV-1</b>
Video interface (PC)	Manufacturer's specification	5 V d.c.	yes/no	0	<b>SELV</b>
X26/V10	ITU-T V.10	± 6 V d.c.	yes/no	1/0	<b>TNV-1/SELV <sup>d</sup></b>
X27/V11	ITU-T V.11	± 6 V d.c.	yes/no	1/0	<b>TNV-1/SELV <sup>d</sup></b>
xDSL	IEC TS 62367	<28 V a.c. peak	no	1	<b>TNV 1</b>
xDSL over ISDN or with power feeding for underlying or embedded systems/services	IEC TS 62367	<120 V d.c. + xDSL	no	1	<b>TNV 3</b>