

TECHNICAL REPORT



**Field device tool (FDT) interface specification –
Part 52-32: Communication implementation for common language
infrastructure – IEC 61784 CP 3/4, CP 3/5 and CP 3/6**

IECNORM.COM : Click to view the full PDF of IEC TR 62453-52-32:2017



THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2017 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

IEC Catalogue - webstore.iec.ch/catalogue

The stand-alone application for consulting the entire bibliographical information on IEC International Standards, Technical Specifications, Technical Reports and other documents. Available for PC, Mac OS, Android Tablets and iPad.

IEC publications search - www.iec.ch/searchpub

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing 20 000 terms and definitions in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

65 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: csc@iec.ch.

IECNORM.COM : Click to view the full PDF IEC 60335-32:2017

TECHNICAL REPORT



**Field device tool (FDT) interface specification –
Part 52-32: Communication implementation for common language
infrastructure – IEC 61784 CP 3/4, CP 3/5 and CP 3/6**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 25.040.40; 35.100.05; 35.110

ISBN 978-2-8322-4331-2

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
1 Scope.....	8
2 Normative references	8
3 Terms, definitions, symbols, abbreviated terms and conventions	9
3.1 Terms and definitions.....	9
3.2 Abbreviations.....	9
3.3 Conventions.....	9
3.3.1 Datatype names and references to datatypes	9
3.3.2 Vocabulary for requirements.....	9
3.3.3 Use of UML	9
4 Bus Category.....	9
5 Access to instance and device data	9
5.1 General.....	9
5.2 IO signals provided by DTM.....	10
5.3 Data interfaces	10
5.3.1 General	10
5.3.2 Mapping PROFINET datatypes to FDT datatypes	10
5.3.3 SemanticInfo	11
6 Protocol specific behavior.....	12
6.1 PROFINET device model	12
6.2 Configuration and parameterization of PROFINET devices	13
6.3 PROFINET – related information of a Device DTM.....	13
6.4 Remarks on FDT 1.2 / 2 Compatibility.....	14
7 Protocol specific usage of general FDT datatypes	14
8 Protocol specific common datatype: PnDeviceAddress	14
9 Network management	15
9.1 General.....	15
9.2 Configuration.....	16
9.3 Process Data Items.....	28
9.4 Parameterization.....	28
10 Communication datatypes.....	28
10.1 General.....	28
10.2 ConnectRequest and ConnectResponse Services	28
10.2.1 PnConnectRequest Service	28
10.2.2 PnConnectResponse Service.....	29
10.3 DisconnectRequest and DisconnectResponse Services	30
10.3.1 PnDisconnectRequest Service.....	30
10.3.2 PnDisconnectResponse Service	31
10.4 TransactionRequest and TransactionResponse Services	32
10.4.1 PnReadRequest Service.....	32
10.4.2 PnReadResponse Service	33
10.4.3 PnWriteRequest Service.....	35
10.4.4 PnWriteResponse Service	36
10.4.5 PnCancelRequest Service	37
10.4.6 PnCancelResponse Service.....	38

10.5	SubscribeRequest and SubscribeResponse Service	39
10.5.1	PnSubscribeRequest	39
10.5.2	PnSubscribeResponse.....	40
10.6	UnsubscribeRequest and UnsubscribeResponse Service.....	41
10.6.1	PnUnsubscribeRequest Service.....	41
10.6.2	PnUnsubscribeResponse Service	41
10.7	AbortMessage Service	42
10.8	PnResponseError	42
10.8.1	Communication error	42
10.8.2	Handling of errors during Connect and Disconnect	43
11	Datatypes for process data information.....	43
11.1	General.....	43
11.2	PnIOSignalInfo.....	43
11.3	Mapping of PROFINET datatypes to FDT datatypes.....	45
12	Device identification	45
12.1	General.....	45
12.2	PnDeviceScanInfo datatype	45
12.3	PnDeviceIdentInfo datatype	49
	Bibliography.....	51
	Figure 1 – Part 52-32 of the IEC 62453 series	7
	Figure 2 – PROFINET Device Model.....	13
	Figure 3 – PROFINET Device Address.....	15
	Figure 4 – PROFINET Network Data.....	16
	Figure 5 – PnConnectRequest	29
	Figure 6 – PnConnectResponse.....	30
	Figure 7 – PnDisconnectRequest.....	31
	Figure 8 – PnDisconnectResponse	32
	Figure 9 – PnReadRequest	33
	Figure 10 – PnReadResponse	34
	Figure 11 – PnWriteRequest.....	36
	Figure 12 – PnWriteResponse	37
	Figure 13 – PnCancelRequest	38
	Figure 14 – PnCancelResponse.....	39
	Figure 15 – PnSubscribeRequest.....	40
	Figure 16 – PnSubscribeResponse	40
	Figure 17 – PnUnsubscribeRequest.....	41
	Figure 18 – PnUnsubscribeResponse	41
	Figure 19 – PnAbortMessage.....	42
	Figure 20 – PnResponseError.....	43
	Figure 21 – ProtocolIOSignalInfo	44
	Figure 22 – PnDeviceScanInfo datatype	46
	Figure 23 – PnDeviceIdentInfo.....	49
	Table 1 – Mapping of datatypes	11

Table 2 – Usage of SemanticInfo	12
Table 3 – Usage of general datatypes	14
Table 4 – PnDeviceAddress	15
Table 5 – PROFINET Network Data	17
Table 6 – PnConnectRequest datatype	29
Table 7 – PnConnectResponse datatype	30
Table 8 – PnDisconnectRequest datatype	31
Table 9 – PnDisconnectResponse datatype	32
Table 10 – PnReadRequest datatype	33
Table 11 – PnReadResponse datatype	35
Table 12 – PnWriteRequest datatype	36
Table 13 – PnWriteResponse datatype	37
Table 14 – PnCancelRequest datatype	38
Table 15 – PnCancelResponse datatype	39
Table 16 – PnSubscribeRequest datatype	40
Table 17 – PnSubscribeResponse datatype	40
Table 18 – PnUnsubscribeRequest datatype	41
Table 19 – PnUnsubscribeResponse datatype	42
Table 20 – PnAbortMessage datatype	42
Table 21 – PnResponseError datatype	43
Table 22 – PnDatatypeInfo	44
Table 23 – ProtocolIIOSignalInfo datatypes	45
Table 24 – PnDeviceScanInfo datatype	46
Table 25 – PnDeviceScanInfo specific mapping	47
Table 26 – PnDeviceIdentInfo datatypes	49
Table 27 – PnDeviceIdentInfo specific mapping	50

IECNORM.COM : Click to view the full PDF of IEC TR 62453-52-32:2017

INTERNATIONAL ELECTROTECHNICAL COMMISSION

FIELD DEVICE TOOL (FDT) INTERFACE SPECIFICATION –

Part 52-32: Communication implementation for common language infrastructure – IEC 61784 CP 3/4, CP 3/5 and CP 3/6

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. However, a technical committee may propose the publication of a technical report when it has collected data of a different kind from that which is normally published as an International Standard, for example "state of the art".

IEC TR 62453-52-32, which is a technical report, has been prepared by subcommittee 65E: Devices and integration in enterprise systems, of IEC technical committee 65: Industrial-process measurement, control and automation.

Each part of the IEC 62453-52-xy series is intended to be read in conjunction with its corresponding part in the IEC 62453-3xy series. This document corresponds to IEC 62453-303-2.

The text of this technical report is based on the following documents:

Enquiry draft	Report on voting
65E/440/DTR	65E/514/RVC

Full information on the voting for the approval of this technical report can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

The list of all parts of the IEC 62453 series, under the general title *Field device tool (FDT) interface specification*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

IECNORM.COM : Click to view the full PDF of IEC TR 62453-52-32:2017

INTRODUCTION

This part of IEC 62453 is an interface specification for developers of Field Device Tool (FDT) components for function control and data access within a client/server architecture. The specification is a result of an analysis and design process to develop standard interfaces to facilitate the development of servers and clients by multiple vendors that need to interoperate seamlessly.

With the integration of fieldbuses into control systems, there are a few other tasks which need to be performed. In addition to fieldbus- and device-specific tools, there is a need to integrate these tools into higher-level system-wide planning or engineering tools. In particular, for use in extensive and heterogeneous control systems, typically in the area of the process industry, the unambiguous definition of engineering interfaces that are easy to use for all those involved is of great importance.

A device-specific software component, called Device Type Manager (DTM), is supplied by the field device manufacturer with its device. The DTM is integrated into engineering tools via the FDT interfaces defined in this specification. The approach to integration is in general open for all kind of fieldbuses and thus meets the requirements for integrating different kinds of devices into heterogeneous control systems.

Figure 1 shows how this part of the IEC 62453-52-xy series is aligned in the structure of the IEC 62453 series.

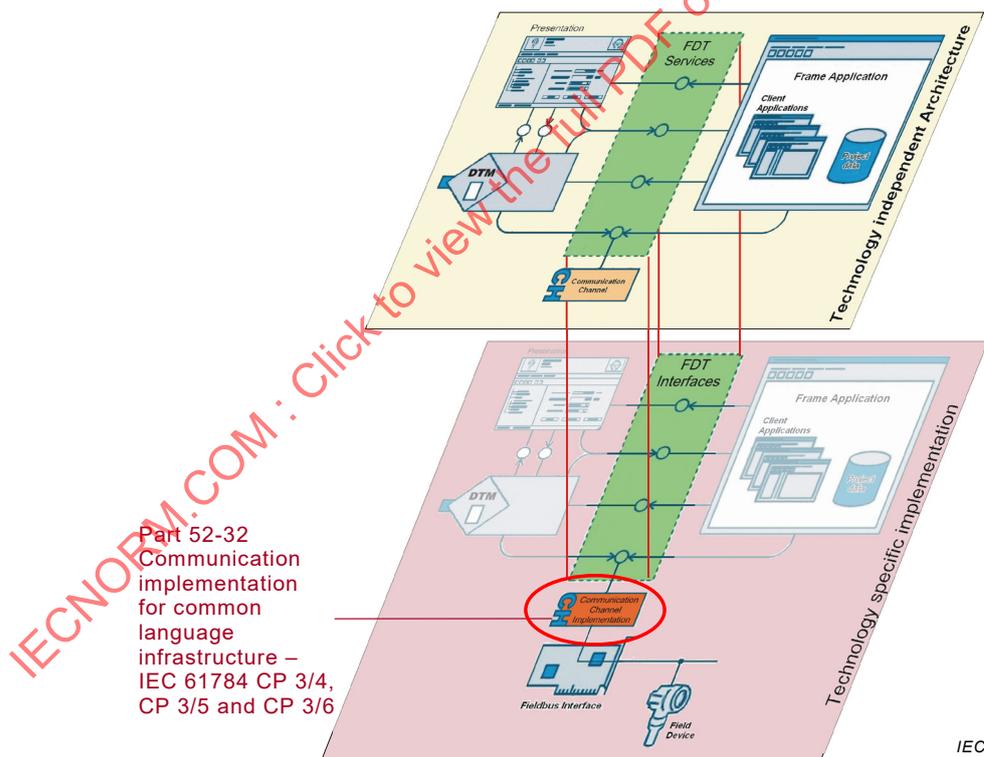


Figure 1 – Part 52-32 of the IEC 62453 series

FIELD DEVICE TOOL (FDT) INTERFACE SPECIFICATION –

Part 52-32: Communication implementation for common language infrastructure – IEC 61784 CP 3/4, CP 3/5 and CP 3/6

1 Scope

This part of the IEC 62453-52-xy series, which is a Technical Report, provides information for integrating the PROFINET®¹ technology into the CLI-based implementation of FDT interface specification (IEC TR 62453-42).

This part of IEC 62453 specifies implementation of communication and other services based on IEC 62453-303-2.

This document neither contains the FDT specification nor modifies it.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61131-3:2013, *Programmable controllers – Part 3: Programming languages*

IEC 61158-6-10, *Industrial communication networks – Fieldbus specifications – Part 6-10: Application layer protocol specification – Type 10 elements*

IEC 61158 (all parts), *Industrial communication networks – Fieldbus specifications*

IEC 61784-1:2014, *Industrial communication networks – Profiles – Part 1: Fieldbus profiles*

IEC 62453-1:2016, *Field device tool (FDT) interface specification – Part 1: Overview and guidance*

IEC 62453-2:2016, *Field device tool (FDT) interface specification – Part 2: Concepts and detailed description*

IEC TR 62453-42: 2016, *Field device tool (FDT) interface specification – Part 42: Object model integration profile – Common language infrastructure*

IEC 62453-303-2:2009, *Field device tool (FDT) interface specification – Part 303-2: Communication profile integration – IEC 61784 CP 3/4, CP 3/5 and CP 3/6*
IEC 62453-303-2:2009/AMD1:2016

¹ PROFINET ® is the trademark of PROFIBUS Nutzerorganisation e.V. (PNO). PNO is a non-profit trade organization to support the fieldbus PROFIBUS. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this profile does not require use of the registered trademark. Use of the trademark PROFIBUS and PROFINET requires permission of the trade name holder.

3 Terms, definitions, symbols, abbreviated terms and conventions

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 62453-1, IEC 62453-2, IEC TR 62453-42 and IEC 62453-303-2 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.2 Abbreviations

For the purposes of this document, the abbreviations given in IEC 62453-1, IEC 62453-2, IEC 62453-303-2, IEC TR 62453-42, and the following apply.

I&M	Identification and maintenance functions
-----	--

3.3 Conventions

3.3.1 Datatype names and references to datatypes

The conventions for naming and referencing of datatypes are explained in FDT 2.0 Specification.

3.3.2 Vocabulary for requirements

The following expressions are used when specifying requirements.

Usage of “shall” or “mandatory”	No exceptions allowed.
Usage of “should” or “recommended”	Strong recommendation. It may make sense in special exceptional cases to differ from the described behaviour.
Usage of “can” or “optional”	Function or behaviour may be provided, depending on defined conditions.

3.3.3 Use of UML

Figures in this document are using UML notation as defined in Annex A of IEC 62453-1:2016.

4 Bus Category

PROFINET protocols are identified by the unique identifiers in busCategory attributes as specified in IEC 62453-303-2.

5 Access to instance and device data

5.1 General

Used at interfaces:

- IInstanceData
- IDeviceData

The minimum set of provided data shall be:

- Process values shall be modeled as ProcessData including ranges and scaling, where applicable.
- All network configuration related parameters shall be exposed in NetworkData (see Clause 9).
- All startup parameters of sub modules shall be exposed in NetworkData (see Clause 9).
- It is recommended to expose startup parameters in the IDeviceData and IInstanceData interfaces; exposure of additional parameters is at the device vendor's discretion. Profiles may define a mandatory set of parameters.

5.2 IO signals provided by DTM

A DTM shall provide IO signal information for the device using the IProcessData interface. The IO signals describe datatype and address parameters of process data as detailed in Clause 11.

5.3 Data interfaces

5.3.1 General

Exposure of device parameters is at the vendor's discretion. Profiles may define the mandatory exposure of profile specific parameters. It is recommended to expose at least all startup parameters.

5.3.2 Mapping PROFINET datatypes to FDT datatypes

PROFINET uses datatypes as specified in IEC 61158 for the transmission on the fieldbus. The FDT interfaces IDeviceData and IInstanceData use .NET datatypes, while PLC applications use datatypes as defined in IEC 61131-3. This subclause defines the mapping of parameter datatypes, whereas mapping of process datatypes is defined in Clause 11. The mapping of parameter datatypes is described in Table 1.

IECNORM.COM : Click to view the full PDF of IEC TR 62453-52-32:2017

Table 1 – Mapping of datatypes

PROFINET datatype	FDT datatype	IEC datatype
Bit	boolean	BOOL
Integer8	int	SINT
Integer16	int	INT
Integer32	int	DINT
Integer64	int	LINT
Unsigned8	byte	USINT
Unsigned16	unsigned	UINT
Unsigned32	unsigned	UDINT
Unsigned64	unsigned	ULINT
Float32	float	REAL
Float64	double	LREAL
Date	date	LWORD
TimeOfDay	dateAndTime	LWORD
TimeOfDayWithoutDateIndication	time	TIME_OF_DAY
TimeDifference	structured	LWORD
TimeOfDayWithoutDateIndication	duration	DWORD
NetworkTime	structured	LWORD
NetworkTimeDifference	structured	LWORD
VisibleString	string	STRING
OctetString	hexString	STRING
Unsigned8Unsigned8	-	WORD
Float32Unsigned8	-	LWORD
Float32Status8	structured	LWORD
F_MessageTrailer4Byte	structured	DWORD
F_MessageTrailer5Byte	structured	LWORD
additional GSDML datatypes		
Bit	boolean	BOOL
BitArea	BinaryBitArray	ARRAY OF BYTE

5.3.3 SemanticInfo

The SemanticInfo provides means to uniquely identify parameters. The usage of SemanticInfo attributes is defined in Table 2.

Table 2 – Usage of SemanticInfo

Attribute	Description of use for PROFINET
SemanticInfo.ReadAddress SemanticInfo.WriteAddress	<p>The value of ReadAddress and WriteAddress is a string conforming to a pattern as follows:</p> <p style="text-align: center;">Api.Slot.Subslot.Index.ByteOffset.BitOffset.BitLength</p> <p>where</p> <p>Api = API number Slot = Slot number Subslot = Subslot number Index = Index number ByteOffset = start byte within the index BitOffset = start bit within the index BitLength = length in bits</p> <p>All values are unsigned integers. NOTE Profiles may define additional address formats.</p>
SemanticInfo.ApplicationDomain	<p>The value of ApplicationDomain is as follows:</p> <p>FDT PROFINET FDT PROFIDRIVE</p> <p>NOTE Profiles may define additional ApplicationDomain values.</p>
SemanticInfo.SemanticId	<p>The value of SemanticId is vendor specific. Profiles may define a distinct set of mandatory SemanticId values.</p>

6 Protocol specific behavior

6.1 PROFINET device model

The PROFINET device model is captured in a hierarchical structure of ProtocolNetworkData class (see Figure 2). Further details on attributes and methods are provided in Clause 9.

IECNORM.COM : Click to view the full PDF of IEC TR 62453-52-32:2017

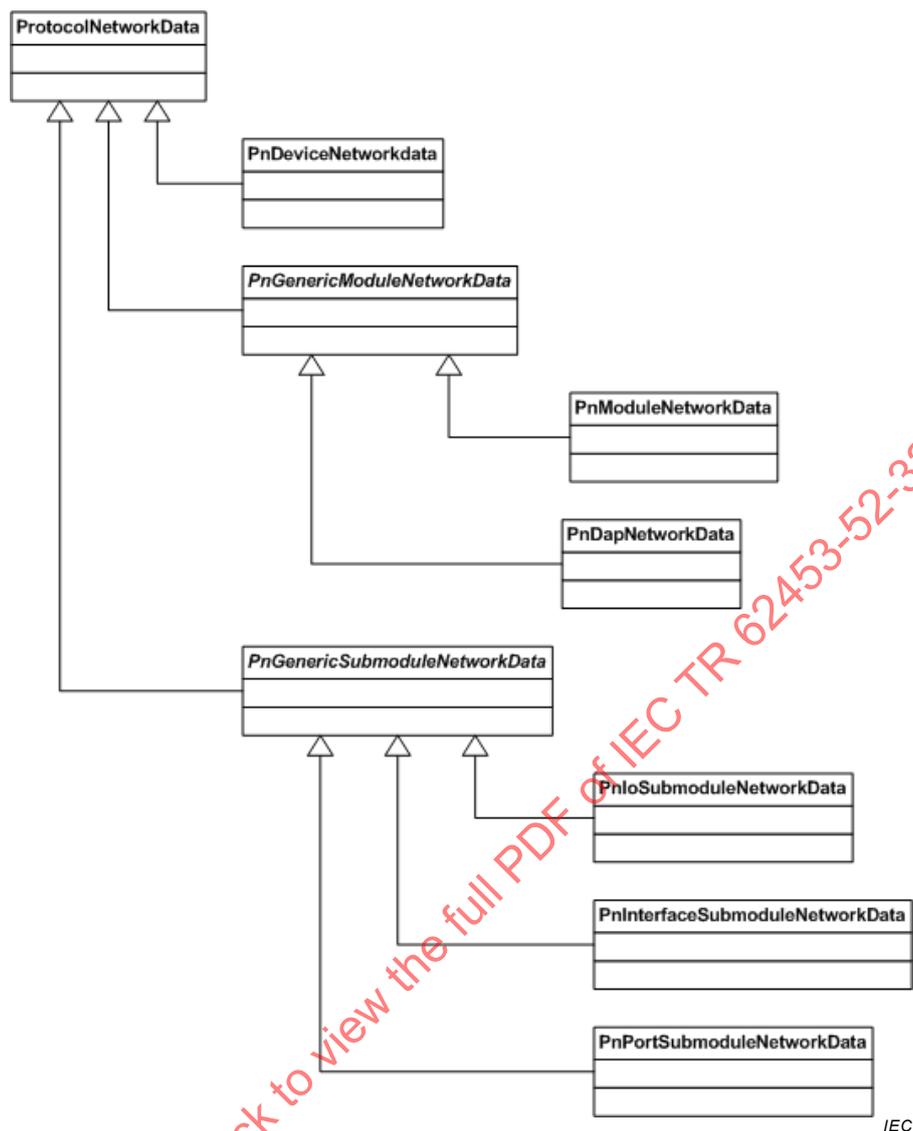


Figure 2 – PROFINET Device Model

6.2 Configuration and parameterization of PROFINET devices

In order to enable a PROFINET Communication DTM to configure and parameterize a PROFINET Network, all type data usually included in a vendor specific GSDML file, are provided in NetworkData (see Clause 9 for further details). The Communication DTM is responsible for calculating or querying any instance data needed for network configuration.

6.3 PROFINET – related information of a Device DTM

The information used by a PROFINET controller to set up the PROFINET network properly and allow cyclic communication between control system and PROFINET devices is provided by a DTM in:

- PROFINET network data
- Process data items.

A DTM of a PROFINET device shall deliver these parts of PROFINET related information to get integrated into an FDT-based engineering system. Below (see Clauses 8, 9 and 11), a more detailed description is given on how to generate and how to provide this information.

This specification makes no assumptions whether a modular PROFINET device is modeled in a Device DTM, Composite DTM or Gateway DTM. All types of DTMs have to provide all mandatory information defined in the following chapters.

6.4 Remarks on FDT 1.2 / 2 Compatibility

A variety of features and capabilities have been included in PROFINET since the release of the FDT 1.2 Annex for PROFINET. In order to utilize these additional features, a pure FDT 2.0 environment is required. For mixed topologies, Table 5 provides information on which data is available with FDT 1.2 DTMs and consequently, is available in a mixed topology after transformation. Conversely, only this subset is available when using FDT 2.0 DTMs (as child DTMs) below a FDT 1.2 DTM (as parent DTM) in a mixed topology.

7 Protocol specific usage of general FDT datatypes


The FDT2.0 Specification already defines a set of datatypes that can be used to identify a device and to provide device information. This clause describes how these datatypes are used with PROFINET.

Table 3 – Usage of general datatypes

Attribute	Description for use in PROFINET
ProtocolId	See Clause 4
PhysicalLayer	See Clause 4
ApplicationDomain/ SemanticId	See 5.3.3
Address	See Clause 8
ManufacturerId	See 'IM0.IM_Vendor_ID' and 'DCP.DeviceVendorValue' given in 12.3
DeviceTypeId	See 'DCP_DeviceIdentNumber' given in 12.3
HardwareRevision	See 'IM_Hardware_Revision' given in 12.3
SoftwareRevision	See 'IM_Software_Revision' given in 12.3
ProtocolIdentificationProfile	Identifies the protocol specific profile that was used for device identification. It contains one of the values "DCP" or "IM".
Tag	See 'DeviceName' in 12.2
SerialNumber	See 12.2
ProtocolSpecificProperties	See 'DCP_ManufacturerSpecificString', 'IM_OrderID', 'IM_Profile_ID', 'IM_Profile_Specific_Type' 'DCP_DeviceRoleDetail', 'ConfiguredState' in 12.3

8 Protocol specific common datatype: PnDeviceAddress

The only protocol-specific common datatype is PnDeviceAddress. The protocol specific device address relates to network management and communication. See Figure 3 and Table 4.

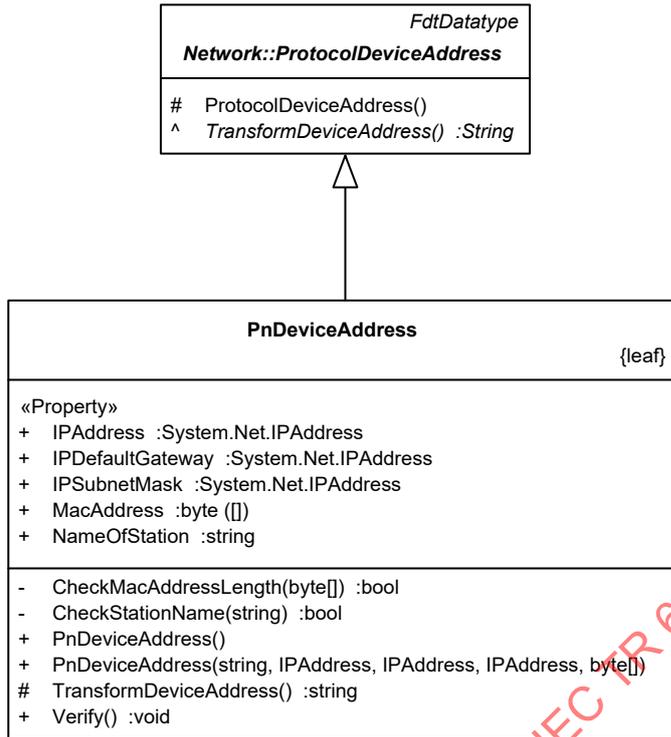

IEC

Figure 3 – PROFINET Device Address


Table 4 – PnDeviceAddress

Property	Usage	Multiplicity	Description
IPAddress	M	[1..1]	The attribute contains the IP address that is assigned to the device. The IP address is a secondary address. The default value is System.Net.IPAddress(new byte[] { 0, 0, 0, 0 }).
IPDefaultGateway	M	[1..1]	The attribute contains the default gateway address. The default value is null.
IPSubnetMask	M	[1..1]	The attribute contains the subnet mask. The default value is System.Net.IPAddress(new byte[] { 255, 255, 255, 255 }).
MacAddress	M	[1..1]	The attribute contains the MAC address of the device. The MAC address is a secondary address. The default Value is new byte[6].
NameOfStation	M	[1..1]	The station name is the primary address. The default value is an empty string.

9 Network management

9.1 General

The data needed for management of the network is exposed by the Device DTM in the INetworkData interface. See Figure 4.

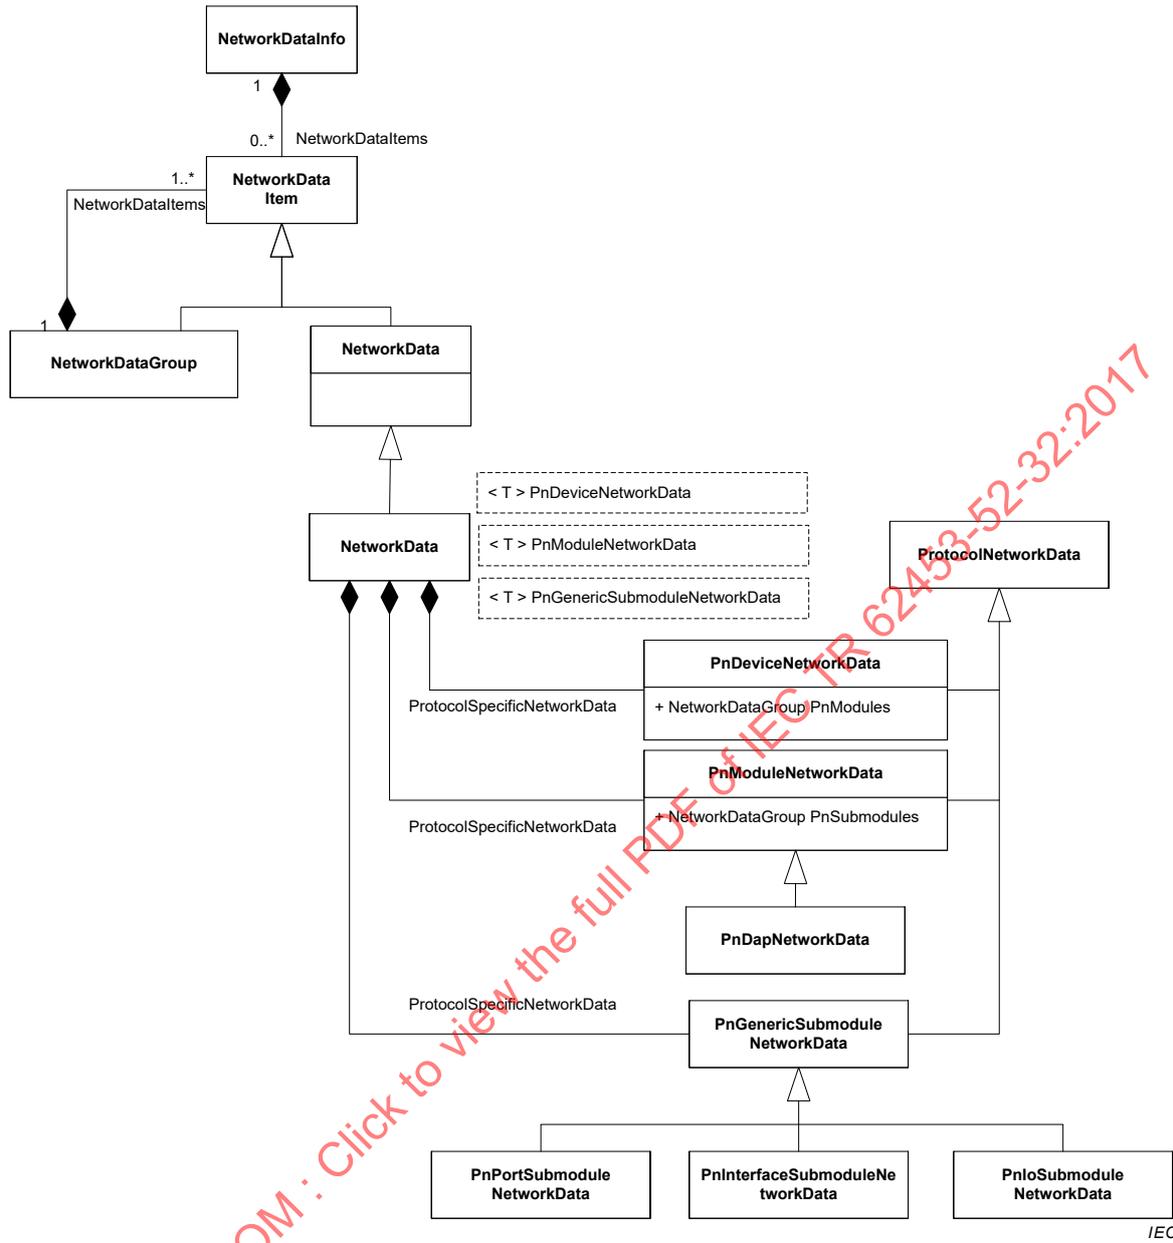

Used in:

INetworkData::GetNetworkDataInfo()

Figure 4 – PROFINET Network Data

The datatype PnDeviceAddress is used for defining the network address of a device.

The protocol specific datatypes are based on definitions given in the IEC 61784 and IEC 61158 specifications. Furthermore, they contain additional information about the device that is needed by systems to configure PROFINET links and to establish communication between the PROFINET Controller and the PROFINET devices.

9.2 Configuration

The configuration of the device itself is done with the aid of the DTM’s GUI. Downloading the configuration into the PROFINET device is performed via the PROFINET controller. To do that and in order to set up the bus communication, the PROFINET controller needs information from the DTM. Table 5 describes the properties of PROFINET specific network data.

Table 5 – PROFINET Network Data

Name	Datatype	Description	FDT 1.2.1	FDT 2.0
PnDeviceNetworkData	Class			
PnModules	NetworkDataGroup	The related modules of the Device.		M
PnRole	Enumeration	Specifies the role for shared Device.		M
ObjectUUID_LocalIndex	UInt16	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
DeviceID	UInt16	//ISO15745Profile/ProfileBody/DeviceIdentity		M
DeviceName	string	Address information according to the PROFINET specification.		M
VendorID	UInt16	//ISO15745Profile/ProfileBody/DeviceIdentity		M
InfoText	string	Additional textual information. Shall only be set by DTM.	O	M
VendorName	string	//ISO15745Profile/ProfileBody/DeviceIdentity/VendorName		M
ArType	UInt16	ARType according to the PROFINET specification. Shall only be set by Parent.	M	M
ArUUID	Guid	ARUUID according to the PROFINET specification. Shall only be set by Parent.	M	M
ArProperties	UInt32	ARProperties according to the PROFINET specification. Shall only be set by Parent.	M	M
DeviceTypeInformation	Document	The attribute contains the path to the device description file. For Profinet devices it is mandatory to provide this attribute. Only a parent developed according to the Profinet Annex can handle GSDML information.	O	M
PnModuleNetworkData	Class			
PnSubmodules	NetworkDataGroup	Contains the elements for addressing a IO Device.		M
SlotNumber	UInt16	The slot address that is used by the module. Shall be set by DTM during configuration. Can be set by Parent during topology scan.	M	M
ModuleIdentNumber	UInt32	The ModuleIdentNumber according to the PROFINET specification. Shall be set by DTM during configuration. Can be set by Parent during topology scan.	M	M
Name	string	Name for the enclosing module. Shall only be set by DTM.	M	M

Name	Datatype	Description	FDT 1.2.1	FDT 2.0
Descriptor	string	Description for the enclosing module. Shall only be set by DTM.	O	M
PnDapNetworkData	Class			
PnDeviceAddress	Class	Contains the elements for addressing a PROFINET Device.		M
MaxInputLength	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/IOConfigData		M
MaxOutputLength	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/IOConfigData		M
MinDeviceInterval	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
PNIO_Version	string	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
AddressAssignment	FdtList	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
CiR_Supported	bool	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
DeviceAccessSupported	bool	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
IOXS_Required	bool	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
LLDP_NoD_Supported	bool	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
MaxApplicationDataLength	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/IOConfigData		M
MaxApplicationInputLength	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/IOConfigData		M
MaxApplicationOutputLength	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/IOConfigData		M
MaxDataLength	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/IOConfigData		M
MaxSupportedRecordSize	UInt32	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M

Name	Datatype	Description	FDT 1.2.1	FDT 2.0
MultipleWriteSupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
NameOfStationNotTransferable	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
ParameterizationSpeedupSupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
PowerOnToCommReady	UInt32	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
RemoteApplicationTimeout	UInt16	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem		M
PnGenericSubmodule NetworkData	Class			
SubslotNumber	UInt32	The subslot address that is used by the submodule. Shall be set by DTM during configuration. Can be set by Parent during topology scan.	M	M
Writeable_IM_Records	Array of UInt32	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem		M
SubModuleIdentifierNumber	UInt32	The SubmoduleIdentifierNumber according to the PROFINET specification. Shall be set by DTM during configuration. Can be set by Parent during topology scan.	M	M
Name	string	Name for the enclosing submodule. Shall only be set by DTM.		M
Descriptor	string	Description for the enclosing submodule. Shall only be set by DTM.		M
RecordParamData	Class	Encapsulates the address of the desired record data object, the binary data that will be written to the submodule during startup or connect and the transfer sequence to order the elements. The record data implicitly contain the record data length. Shall only be set by DTM.	M	M
PnPortSubmodule NetworkData	Class			
CheckMAUTypeSupported	Bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/PortSubmoduleItem //ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/PortSubmoduleItem		M

Name	Datatype	Description	FDT 1.2.1	FDT 2.0
FiberOpticTypes	FDTList	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/PortSubmoduleItem //ISO15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/SystemDefinedSubmoduleList/PortSubmoduleItem		M
IsDefaultRingport	Bool			M
LinkStateDiagnosisCapability	Enumeration			M
MAUTypes	FdtList			M
MaxPortRxDelay	UInt16			M
MaxPortTxDelay	UInt16	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/PortSubmoduleItem //ISO15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/SystemDefinedSubmoduleList/PortSubmoduleItem		M
ParameterizationDisallowed	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/PortSubmoduleItem //ISO15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/SystemDefinedSubmoduleList/PortSubmoduleItem		M
PortDeactivationSupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/PortSubmoduleItem //ISO15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/SystemDefinedSubmoduleList/PortSubmoduleItem		M
PowerBudgetControlSupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/PortSubmoduleItem //ISO15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/SystemDefinedSubmoduleList/PortSubmoduleItem		M
ShortPreamble100MBitSupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/PortSubmoduleItem //ISO15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/SystemDefinedSubmoduleList/PortSubmoduleItem		M
PnInterfaceSubmoduleNetworkData	Class			M
RT_Class3MaxBridgeDelay	UInt16	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleList/RT_Class3Proper		M

Name	Datatype	Description	FDT 1.2.1	FDT 2.0
AlarmCrType	UInt16	AlarmCrType according to the PROFINET specification. Shall only be set by Parent.	M	M
AlarmCRProperties	UInt32	AlarmCRProperties according to the PROFINET specification. Shall only be set by Parent.	M	M
RTATimeoutFactor	UInt16	RTATimeoutFactor according to the PROFINET specification. Shall only be set by Parent.	M	M
RTARetries	UInt16	RTARetries according to the PROFINET specification. Shall only be set by Parent.	M	M
LocalAlarmReference	UInt16	LocalAlarmReference according to the PROFINET specification. Shall only be set by Parent.	M	M
MaxAlarmDataLength	UInt16	MaxAlarmDataLength according to the PROFINET specification. Shall only be set by Parent.	M	M
ARTimingProperty WatchdogFactor	UInt16	IEC 61158-6-10, 5.2.4.66		M
ARTimingPropertyDataHoldFactor	UInt16	IEC 61158-6-10, 5.2.4.66		M
ARTimingPropertyReductionRatio	UInt16	IEC 61158-6-10, 5.2.4.63		M
ARTimingProperty SendclockFactor	UInt16	IEC 61158-6-10, 5.2.4.62		M
SupportedMibs	FdtList	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem		M
SupportedProtocols	FdtList	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem		M
SynchronisationMaxLocalJitter	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/SynchronisationMode		M
PTP_BoundarySupported	bool	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem		M
ARNumberOfAdditionalOutputCR	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/ApplicationRelations		M
ARNumberOfAR	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/ApplicationRelations		M

Name	Datatype	Description	FDT 1.2.1	FDT 2.0
ARNumberOfMulticastConsumerCR	UInt16	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations		M
ARPullModuleAlarmSupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations		M
ARRT_Class3TimingPropertiesPreferredSendClock	UInt16	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations/RT_Class3TimingProperties		M
ARRT_Class3TimingPropertiesReductionRatios	FdtList	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations/RT_Class3TimingProperties		M
ARRT_Class3TimingPropertiesSendClock	FdtList	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations/RT_Class3TimingProperties		M
ARStartupMode	Enumeration	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations		M
ARTimingPropertyPreferredSendClock	UInt16	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations/TimingProperties		M
ARTimingPropertyReductionRatios	FdtList	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations/TimingProperties		M
ARTimingPropertyReductionRatiosNonPow2	FdtList	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations/TimingProperties		M
ARTimingPropertyReductionRatiosPow2	FdtList	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations/TimingProperties		M
ARTimingPropertySendClockFactors	FdtList	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations/TimingProperties		M
DCP_BoundarySupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem		M
DCP_FlashOnceSignalUnit	string	//ISO15745Profile/ProfileBody/ApplicationProcess/General/DCP_FlashOnceSignalUnit		M

Name	Datatype	Description	FDT 1.2.1	FDT 2.0
DCP_HelloSupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem		M
ARNumberOfAdditionalMulticastProviderCR	UInt16	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations		M
DelayMeasurementSupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem		M
isochroneModelInRT_Classes	FdtList	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem		M
MediaRedundancyAdditionalProtocolsSupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/MediaRedundancy		M
MediaRedundancyMRPD_Supported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/MediaRedundancy		M
MediaRedundancyMRT_Supported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/MediaRedundancy		M
MediaRedundancySupportedRole	FdtList	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/MediaRedundancy		M
MulticastBoundarySupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem		M
NetworkComponentDiagnosisSupported	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem		M
ParameterizationDisallowed	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem		M
RT_Class3AlignDFP_Subframes	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/RT_Class3Properties		M
RT_Class3ForwardingMode	FdtList	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/RT_Class3Properties		M
RT_Class3FragmentationType	Enumeration	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/RT_Class3Properties		M

Name	Datatype	Description	FDT 1.2.1	FDT 2.0
RT_Class3MaxDFP_Feed	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/RT_Class3Proper ties		M
RT_Class3MaxDFP_Frames	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/RT_Class3Proper ties		M
RT_Class3MaxNumberIR_FrameData	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/System DefinedSubmoduleList/InterfaceSubmoduleItem/RT_Class3Proper ties		M
RT_Class3MaxRangeIR_FrameID	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/System DefinedSubmoduleList/InterfaceSubmoduleItem/RT_Class3Proper ties		M
RT_Class3MaxRedPeriodLength	UInt32	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/System DefinedSubmoduleList/InterfaceSubmoduleItem/RT_Class3Proper ties		M
RT_Class3MaxBridgeDelayFFW	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/System DefinedSubmoduleList/InterfaceSubmoduleItem/RT_Class3Proper ties		M
RT_Class3MinFSO	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/System DefinedSubmoduleList/InterfaceSubmoduleItem/RT_Class3Proper ties		M
RT_Class3StartupMode	Enumeration	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/System DefinedSubmoduleList/InterfaceSubmoduleItem/RT_Class3Proper ties		M
SupportedRT_Classes	FdtList	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/System DefinedSubmoduleList/InterfaceSubmoduleItem		M
SynchronisationT_PLL_MAX	UInt16	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/System DefinedSubmoduleList/InterfaceSubmoduleItem/SynchronisationM ode		M
SynchronisationSupported SyncProtocols	FdtList	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/System DefinedSubmoduleList/InterfaceSubmoduleItem/SynchronisationM ode		M
SynchronisationSupportedRole	FdtList	//ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/System DefinedSubmoduleList/InterfaceSubmoduleItem/SynchronisationM ode		M

Name	Datatype	Description	FDT 1.2.1	FDT 2.0
SynchronisationPeerToPeerJitter	UInt16	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/SynchronisationMode		M
ARNumberofAdditionalInputCR	UInt16	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/SystemDefinedSubmoduleList/InterfaceSubmoduleItem/ApplicationRelations		M
PnloSubmoduleNetworkData	Class			
SubmodulePropertiesType	Enumeration	Allowed values are: Input, Output, InputAndOutput Values and meaning according PROFINET specification – SubmoduleProperties.Type. Shall be set by DTM during configuration. Can be set by Parent during topology scan.	M	M
SubmodulePropertiesSharedInput	Enumeration	Allowed values are: IOController, IOControllerShared. Values and meaning according PROFINET specification – SubmoduleProperties.SharedInput Shall be set by DTM during configuration. Can be set by Parent during topology scan.	M	M
SubmodulePropertiesReduceInputSubmoduleDataLength	Enumeration	Allowed values are: Expected, Zero. Values and meaning according PROFINET specification – SubmoduleProperties.ReduceInputSubmoduleDataLength. Shall be set by DTM during configuration. Can be set by Parent during topology scan.	M	M
SubmodulePropertiesReduceOutputSubmoduleDataLength	Enumeration	Allowed values are: Expected, Zero. Values and meaning according PROFINET specification – SubmoduleProperties.ReduceOutputSubmoduleDataLength. Shall be set by DTM during configuration. Can be set by Parent during topology scan.	M	M
SubmodulePropertiesDiscardIOXS	Enumeration	Allowed values are: Expected, Zero. Values and meaning according PROFINET specification - SubmoduleProperties.DiscardIOXS. Shall be set by DTM during configuration. Can be set by Parent during topology scan.	M	M
API	UInt32	The API according to the PROFINET specification. Shall be set by DTM during configuration. Can be set by Parent during topology scan.	M	M
InputDataConsistency	Enumeration	The consistency of the input data. Shall only be set by DTM during configuration.	O	M
InputDataList	FdtList	List of input data provided by a submodule. The list refers to the corresponding FDT channel objects.	O	M
OutputDataConsistency	Enumeration	The consistency of the output data. Shall only be set by DTM during configuration.	O	M
OutputDataList	FdtList	List of output data provided by a submodule. The list refers to the corresponding FDT channel objects.	O	M

Name	Datatype	Description	FDT 1.2.1	FDT 2.0
IsochronModeRequired	bool	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/VirtualSubmoduleItem/VirtualSubmoduleItem/IsochroneMode //ISO15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO15745Profile/ProfileBody/ApplicationProcess/SubmoduleList/SubmoduleItem/IsochroneMode		M
IsochroneModeT_DC_Base	UInt32	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO15745Profile/ProfileBody/ApplicationProcess/SubmoduleList/SubmoduleItem/IsochroneMode		M
IsochroneModeT_DC_Max	UInt32	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO15745Profile/ProfileBody/ApplicationProcess/SubmoduleList/SubmoduleItem/IsochroneMode		M
IsochroneModeT_DC_Min	UInt32	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO15745Profile/ProfileBody/ApplicationProcess/SubmoduleList/SubmoduleItem/IsochroneMode		M
IsochroneModeT_IO_Base	UInt64	//ISO15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO15745Profile/ProfileBody/ApplicationProcess/SubmoduleList/SubmoduleItem/IsochroneMode		M

Name	Datatype	Description	FDT 1.2.1	FDT 2.0
IsochroneModeT_IO_InputMin	UInt64	<pre> //ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/VirtualSubmoduleItem/VirtualSubmoduleItem/IsochroneMode //ISO 15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO 15745Profile/ProfileBody/ApplicationProcess/SubmoduleList/SubmoduleItem/IsochroneMode </pre>		M
IsochroneModeT_IO_OutputMin	UInt64	<pre> //ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO 15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/VirtualSubmoduleList/VirtualSubmoduleItem/IsochroneMode //ISO 15745Profile/ProfileBody/ApplicationProcess/SubmoduleList/SubmoduleItem/IsochroneMode </pre>		M
PROFIenergy	bool	<pre> //ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/VirtualSubmoduleList/VirtualSubmoduleItem/PROFIenergy //ISO 15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/VirtualSubmoduleList/VirtualSubmoduleItem/PROFIenergy //ISO 15745Profile/ProfileBody/ApplicationProcess/SubmoduleList/SubmoduleItem/PROFIenergy </pre>		M
PROFI safeSupported	bool	<pre> //ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/VirtualSubmoduleList/VirtualSubmoduleItem //ISO 15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/VirtualSubmoduleList/VirtualSubmoduleItem </pre>		M
SupportedSubstitutionModes	FdtList	<pre> //ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/VirtualSubmoduleList/VirtualSubmoduleItem //ISO 15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/VirtualSubmoduleList/VirtualSubmoduleItem </pre>		M
Max_iParameterSize	UInt32	<pre> //ISO 15745Profile/ProfileBody/ApplicationProcess/DeviceAccessPointList/DeviceAccessPointItem/VirtualSubmoduleList/VirtualSubmoduleItem //ISO 15745Profile/ProfileBody/ApplicationProcess/ModuleList/ModuleItem/VirtualSubmoduleList/VirtualSubmoduleItem </pre>		M

9.3 Process Data Items

For a detailed description about Process Data Items, please refer to Clause 11.

9.4 Parameterization

For a detailed description about parameterization, please refer to 6.2.

10 Communication datatypes

10.1 General

The datatypes described in this clause are used at following services:

- ConnectRequest and ConnectResponse
- DisconnectRequest and DisconnectResponse
- TransactionRequest and TransactionResponse
- SubscribeRequest and SubscribeResponse
- UnsubscribeRequest and UnsubscribeResponse
- AbortMessage

10.2 ConnectRequest and ConnectResponse Services


10.2.1 PnConnectRequest Service

The class PnConnectRequest describes the communication request according to the IEC 61784 CPF 3/3 specification to establish a communication link to a certain device (see Figure 5 and Table 6).

It encapsulates the necessary information to establish a connection. The default constructor for this class creates an empty instance. When using this constructor, the caller is responsible for providing the values of the required fields of this class.

Additionally, the class provides a custom constructor. This overload of the constructor accepts values for all mandatory fields as arguments.

The client can indicate the intended usage of the communication link through the field ReadOnly. If the client specifies this field, the client can only use Read Request (in the case of ReadOnly = true) or Read and Write Request (in case of ReadOnly = false). On the other side, the server can use this information to perform optimizations, e.g. use of an implicit AR instead of an explicit AR (in the case of ReadOnly = true).

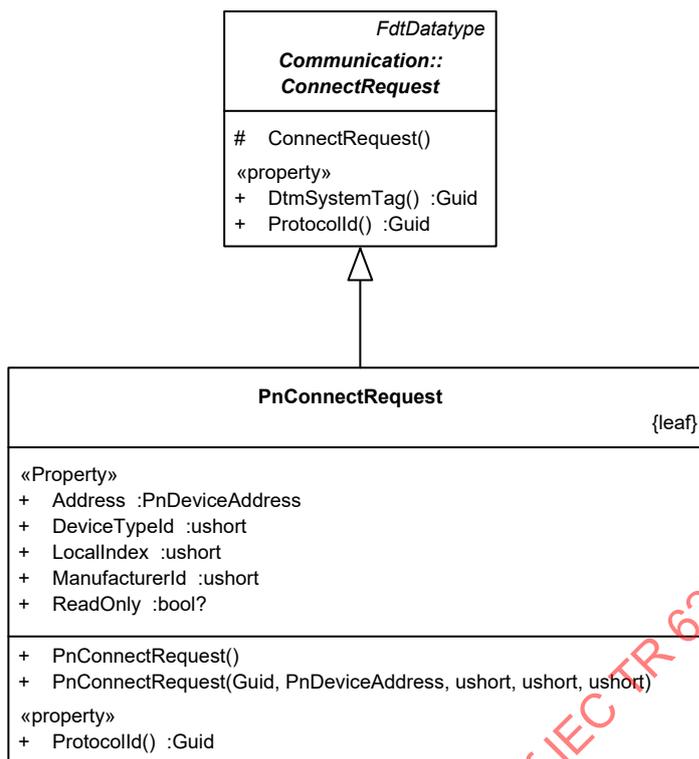

IEC

Figure 5 – PnConnectRequest

Table 6 – PnConnectRequest datatype

Property	Usage	Multiplicity	Description
Address	M	[1..1]	See Clause 8
DeviceTypeid	M	[1..1]	Device identifier
LocalIndex	M	[1..1]	Local Index, Instance identifier
ManufacturerId	M	[1..1]	Manufacturer identifier
ProtocolId	M	[1..1]	Protocol Identifier
ReadOnly	O	[0..1]	Only read support required on this connection. The CommunicationChannel can use this information for optimized connection management e.g. use implicit AR.

10.2.2 PnConnectResponse Service

The class PnConnectResponse describes the communication response according to the IEC 61784 CPF 3/3 specification to establish a communication link to a certain device (see Figure 6 and Table 7).

It encapsulates the response data when establishing a connection. The default constructor for this class creates an empty instance. When using this constructor, the caller is responsible for providing the values of the required fields of this class.

Additionally, the class provides a custom constructor. This overload of the constructor accepts values for all mandatory fields as arguments.

The field CommunicationReference in this class contains the identifier of the established logical connection link that can be used for later communication requests.

The server may return additional information within the optional fields AddData1 and AddData2 from the underlying PROFINET response.

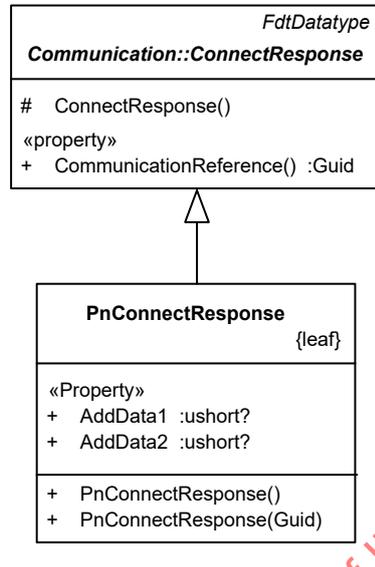


Figure 6 – PnConnectResponse

Table 7 – PnConnectResponse datatype

Property	Usage	Multiplicity	Description
CommunicationReference	M	[1..1]	Mandatory identifier for a communication link to a device. This identifier is allocated by the communication component during the Connect. The address information shall be used for all following communication calls
AddData1	O	[0..1]	Address information according to the IEC 61784 CPF 3/3 specification
AddData2	O	[0..1]	Address information according to the IEC 61784 CPF 3/3 specification


10.3 DisconnectRequest and DisconnectResponse Services

10.3.1 PnDisconnectRequest Service

The class PnDisconnectRequest describes the communication request according to the IEC 61784 CPF 3/3 specification to release an existing communication link to a certain device (see Figure 7 and Table 8).

It encapsulates the necessary information to release a connection. The default constructor for this class creates an empty instance. When using this constructor, the caller is responsible for providing the values of the required fields of this class.

Additionally, the class provides a custom constructor. This overload of the constructor accepts values for all mandatory fields as arguments.

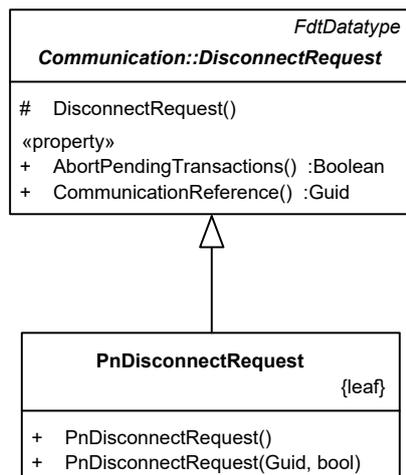

IEC

Figure 7 – PnDisconnectRequest

Table 8 – PnDisonnnectRequest datatype

Property	Usage	Multiplicity	Description
CommunicationReference	M	[1..1]	Mandatory identifier for a communication link to a device. This identifier is allocated by the communication component during the Connect. The address information shall be used for all following communication calls.
AbortPendingTransactions	M	[1..1]	The flag indicates whether the communication component should handle or abort pending transaction.


10.3.2 PnDisconnectResponse Service

The class PnDisconnectResponse describes the communication response according to the IEC 61784 CPF 3/3 specification to release a communication link to a certain device (see Figure 8 and Table 9).

It encapsulates the response data when releasing a connection. The default constructor for this class creates an empty instance. When using this constructor, the caller is responsible for providing the values of the required fields of this class.

Additionally, the class provides a custom constructor. This overload of the constructor accepts values for all mandatory fields as arguments.

The server may return additional information within the optional fields AddData1 and AddData2 from the underlying PROFINET response.

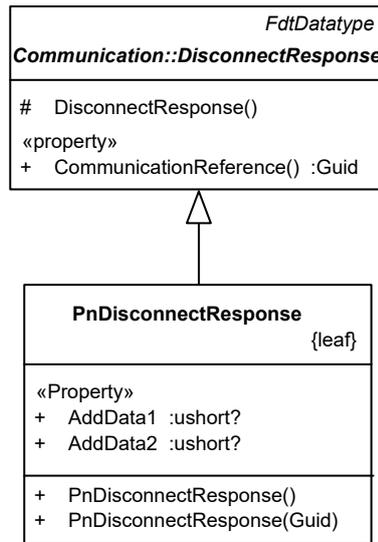

IEC

Figure 8 – PnDisconnectResponse

Table 9 – PnDisconnectResponse datatype

Property	Usage	Multiplicity	Description
AddData1	O	[0..1]	Address information according to the IEC 61784 CPF 3/3 specification
AddData2	O	[0..1]	Address information according to the IEC 61784 CPF 3/3 specification

10.4 TransactionRequest and TransactionResponse Services

10.4.1 PnReadRequest Service

The class PnReadRequest describes the communication request according to the IEC 61784 CPF 3/3 specification to read information from a device (see Figure 9 and Table 10).

It encapsulates the necessary information for reading information. The default constructor for this class creates an empty instance. When using this constructor, the caller is responsible for providing the values of the required fields of this class.

Additionally, the class provides a custom constructor. This overload of the constructor accepts values for all mandatory fields as arguments.

Using the optional field Length, the client can limit the amount of data to read. The optional field Id that is derived from the base class is mandatory for the protocol PROFINET. The constructor fills this field with a unique value. The value of the field is necessary in mixed topology scenarios for compatibility reasons. It identifies a request and the client utilizes it for cancelling a request using PnCancelRequest.

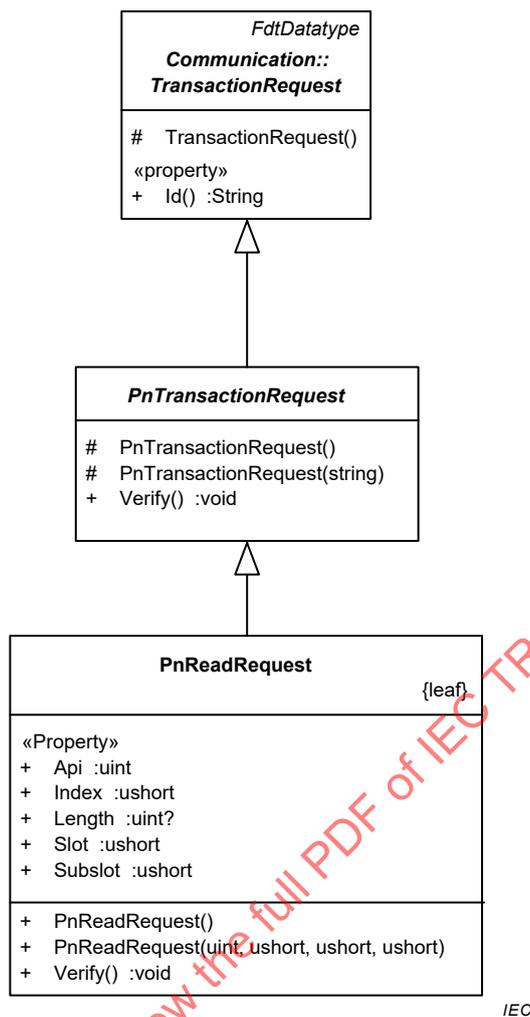


Figure 9 – PnReadRequest

Table 10 – PnReadRequest datatype

Property	Usage	Multiplicity	Description
Api	M	[1..1]	Address information according to the IEC 61784 CPF 3/3
Index	M	[1..1]	Address information according to the IEC 61784 CPF 3/3
Slot	M	[1..1]	Address information according to the IEC 61784 CPF 3/3
Subslot	M	[1..1]	Address information according to the IEC 61784 CPF 3/3
Length	O	[0..1]	Maximum length of communication data in read request
Id	O	[0..1]	Unique identifier of the transaction; The constructor provides a unique initial value.

10.4.2 PnReadResponse Service

The class PnReadResponse describes the communication response according to the IEC 61784 CPF 3/3 specification to read information from a device (see Figure 10 and Table 11).

It encapsulates the necessary information for reading information. The default constructor for this class creates an empty instance. When using this constructor, the caller is responsible for providing the values of the required fields of this class.

Additionally, the class provides a custom constructor. This overload of the constructor accepts values for all mandatory fields as arguments.

If the service was executed successfully, the field CommunicationData provides the device data.

Otherwise, the field CommunicationData shall be set to null and the communication component shall provide error information using the fields ErrorInformation or ResponseError.

The server may return additional information within the optional fields AddData1 and AddData2 from the underlying PROFINET response.

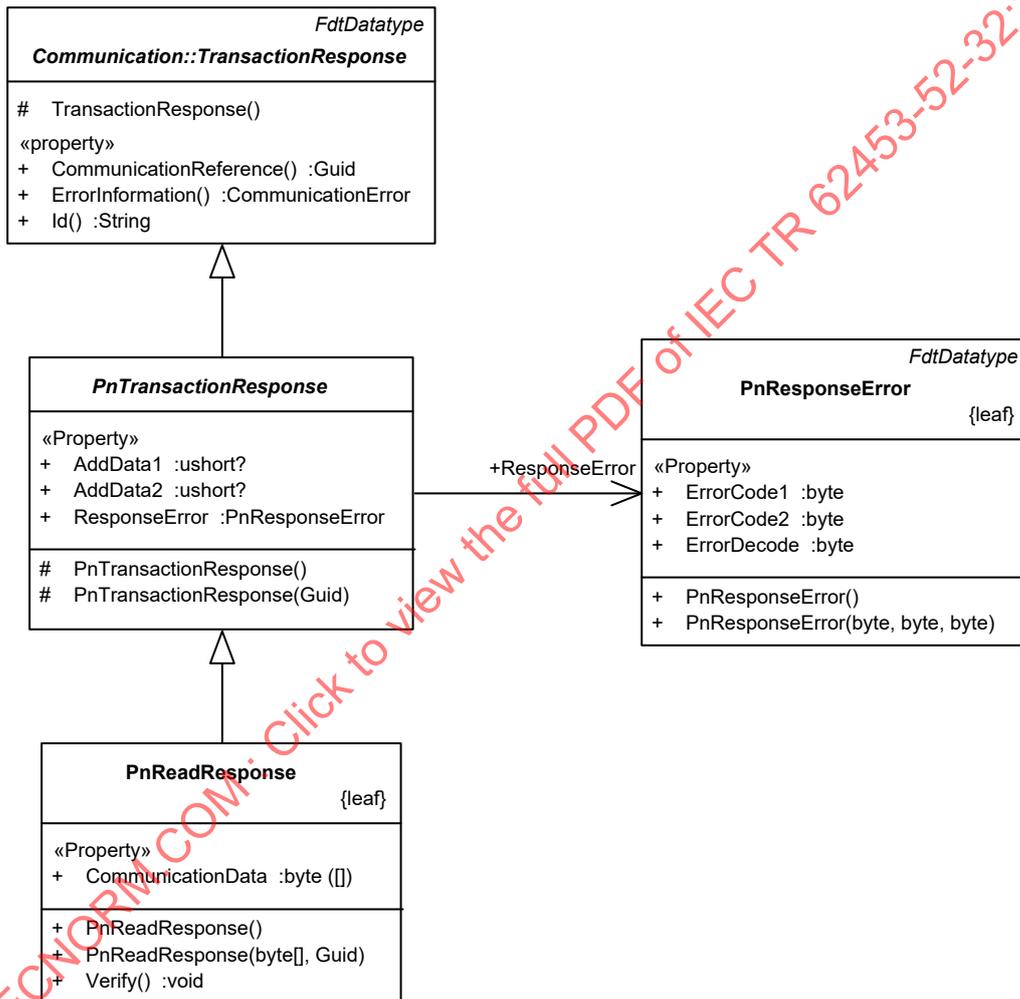


Figure 10 – PnReadResponse

Table 11 – PnReadResponse datatype

Property	Usage	Multiplicity	Description
CommunicationData	M	[1..1]	The communication data as byte array
CommunicationReference	M	[1..1]	Mandatory identifier for a communication link to a device. This identifier is allocated by the communication component during the Connect. The address information shall be used for all following communication calls.
ErrorInformation	O	[0..1]	See [2] ²
Id	O	[0..1]	Unique identifier of the transaction; The value shall match to the corresponding request.
AddData1	O	[0..1]	Address information according to the IEC 61784 CPF 3/3 specification
AddData2	O	[0..1]	Address information according to the IEC 61784 CPF 3/3 specification
ResponseError	O	[0..1]	See 10.8

10.4.3 PnWriteRequest Service


The class PnWriteRequest describes the communication request according to the IEC 61784 CPF 3/3 specification to write information to a device (see Figure 11 and Table 12).

It encapsulates the necessary information for writing information. The default constructor for this class creates an empty instance. When using this constructor, the caller is responsible for providing the values of the required fields of this class.

Additionally, the class provides a custom constructor. This overload of the constructor accepts values for all mandatory fields as arguments.

The optional field Id that is derived from the base class is mandatory for the protocol PROFINET. The constructor fills this field with a unique value. The value of the field is necessary in mixed topology scenarios for compatibility reasons. It identifies a request and the client utilizes it for cancelling a request using PnCancelRequest.

² Figures in square brackets refer to the bibliography.

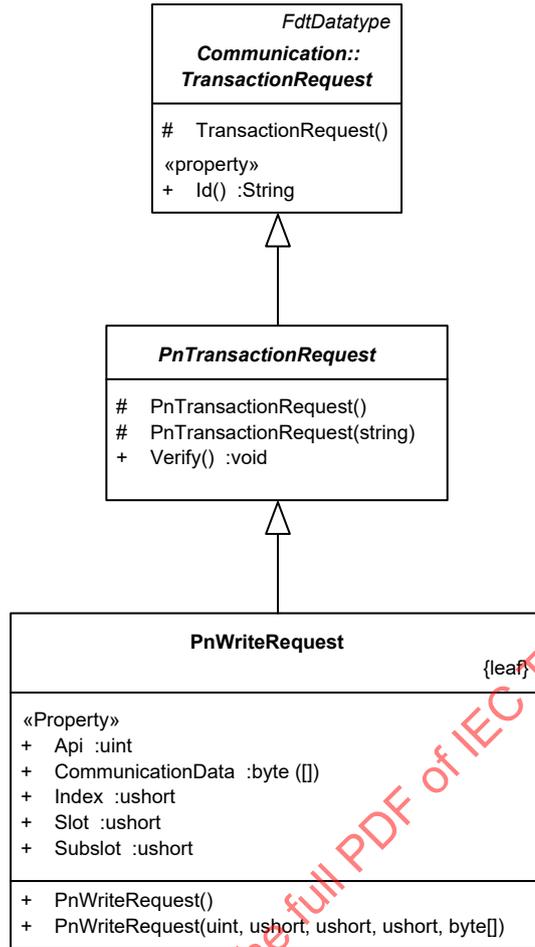

IEC

Figure 11 – PnWriteRequest

Table 12 – PnWriteRequest datatype

Property	Usage	Multiplicity	Description
Api	M	[1..1]	Address information according to the IEC 61784 CPF 3/3
CommunicationData	M	[1..1]	The communication data as byte array
Index	M	[1..1]	Address information according to the IEC 61784 CPF 3/3
Slot	M	[1..1]	Address information according to the IEC 61784 CPF 3/3
Subslot	M	[1..1]	Address information according to the IEC 61784 CPF 3/3
Id	O	[0..1]	Unique identifier of the transaction. The constructor provides a unique initial value.

10.4.4 PnWriteResponse Service


The class PnWriteResponse describes the communication response according to the IEC 61784 CPF 3/3 specification to write information to a device (see Figure 12 and Table 13).

It encapsulates the necessary information for writing information. The default constructor for this class creates an empty instance. When using this constructor, the caller is responsible for providing the values of the required fields of this class.

Additionally, the class provides a custom constructor. This overload of the constructor accepts values for all mandatory fields as arguments.

If the execution of the service fails, the communication component shall provide error information using the fields `ErrorInformation` or `ResponseError`.

The server may return additional information within the optional fields `AddData1` and `AddData2` from the underlying PROFINET response.

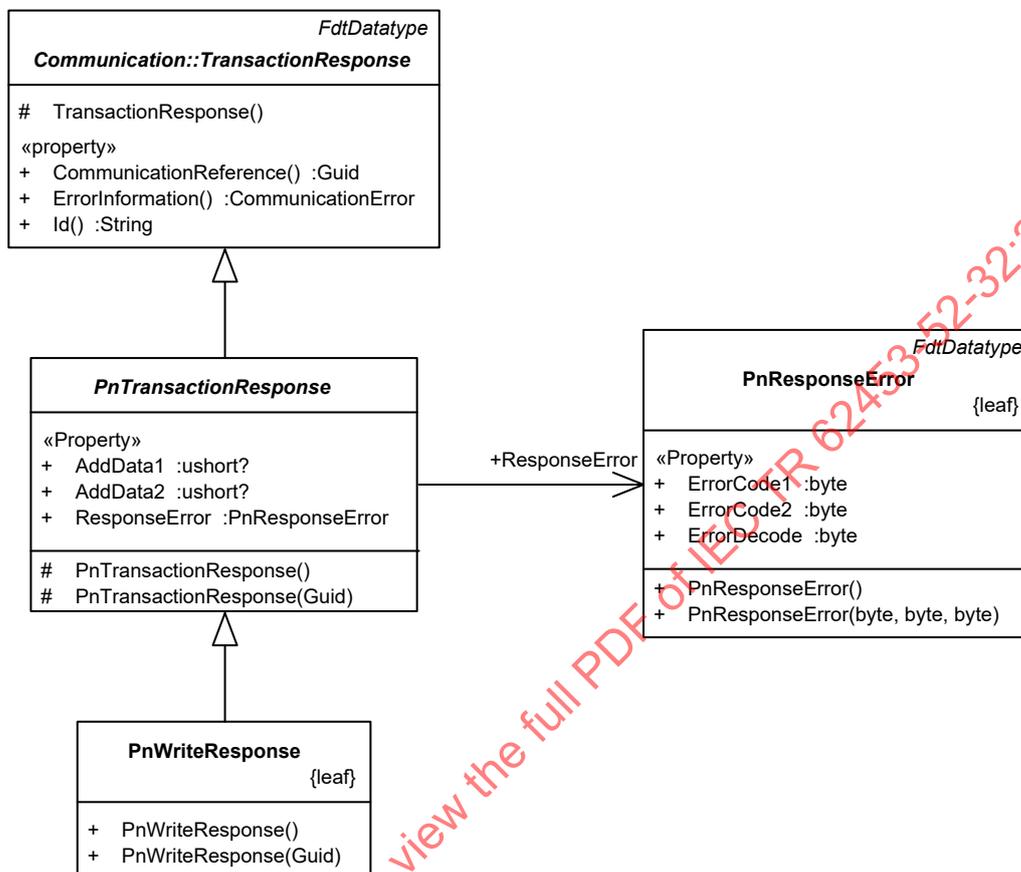

IEC

Figure 12 – PnWriteResponse

Table 13 – PnWriteResponse datatype

Property	Usage	Multiplicity	Description
CommunicationReference	M	[1..1]	Mandatory identifier for a communication link to a device. This identifier is allocated by the communication component during the Connect. The address information shall be used for all following communication calls.
AddData1	O	[0..1]	Address information according to the IEC 61784 CPF 3/3 specification
AddData2	O	[0..1]	Address information according to the IEC 61784 CPF 3/3 specification
ErrorInformation	O	[0..1]	See [2]
Id	O	[0..1]	Unique identifier of the transaction; The value shall match to the corresponding request.
ResponseError	O	[0..1]	See 10.8

10.4.5 PnCancelRequest Service


The class `PnCancelRequest` describes a specific transaction request to cancel a pending transaction. The pending transaction that should be cancelled is identified by the field `Id` (see Figure 13 and Table 14).

The class is defined for compatibility reasons and should be used only in mixed topology scenarios that combine DTMs according to FDT Specification 1.2.1 and FDT Specification 2.0. The communication component shall implement the same behavior to handle this request as method `ICommunication::CancelCommunicationRequest()`.

Otherwise, in a topology that contains only DTMs according to FDT Specification 2.0, the client shall use method `ICommunication::CancelCommunicationRequest()`.

If there is no pending transaction having the provided Id, the communication component shall generate a `CommunicationError` instead of a response of type `PnCancelResponse`. The field `ErrorCode` of `CommunicationError` object contains `CommunicationErrors.NoPendingRequest`.

No transaction response can be expected for the previous pending request.

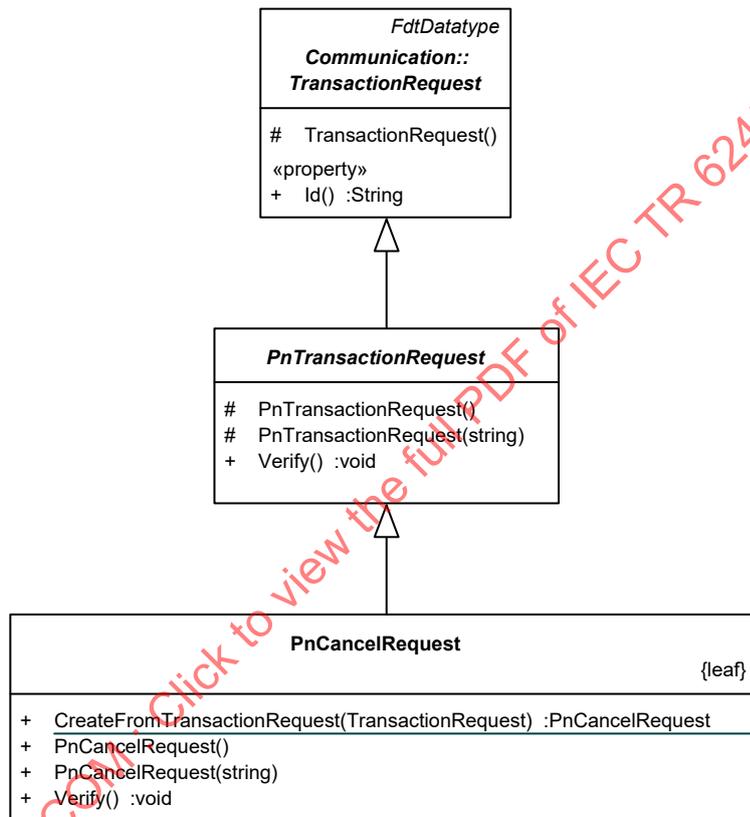

IEC


Figure 13 – PnCancelRequest

Table 14 – PnCancelRequest datatype

Property	Usage	Multiplicity	Description
Id	O	[0..1]	Id of the pending transaction

10.4.6 PnCancelResponse Service

The class `PnCancelResponse` was introduced for compatibility reasons (see Figure 14 and Table 15).

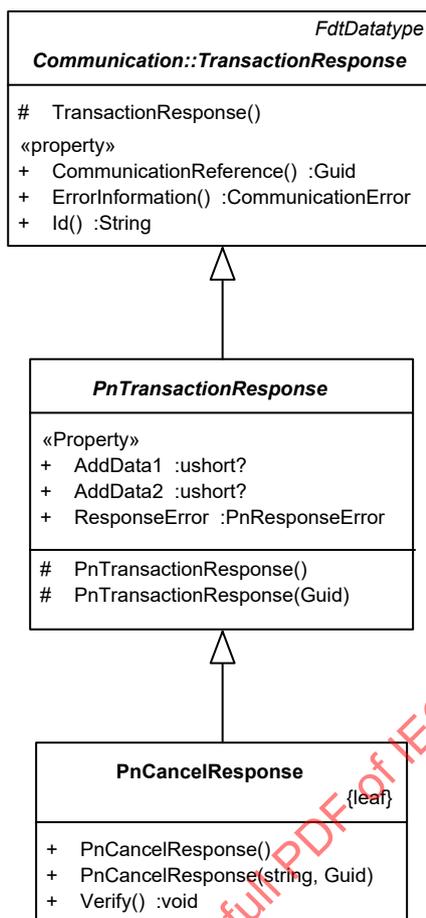

IEC

Figure 14 – PnCancelResponse


Table 15 – PnCancelResponse datatype

Property	Usage	Multiplicity	Description
CommunicationReference	M	[1..1]	Mandatory identifier for a communication link to a device. This identifier is allocated by the communication component during the Connect. The address information shall be used for all following communication calls.
AddData1	O	[0..1]	Address information according to the IEC 61784 CPF 3/3 specification
AddData2	O	[0..1]	Address information according to the IEC 61784 CPF 3/3 specification
ErrorInformation	O	[0..1]	See [2]
Id	O	[0..1]	Unique identifier of the transaction; The value shall match to the corresponding request.
ResponseError	O	[0..1]	See 10.8

10.5 SubscribeRequest and SubscribeResponse Service

10.5.1 PnSubscribeRequest

The class PnSubscribeRequest describes a request in order to subscribe to device-initiated data transfer. This specification provides a generic definition (see Figure 15 and Table 16).

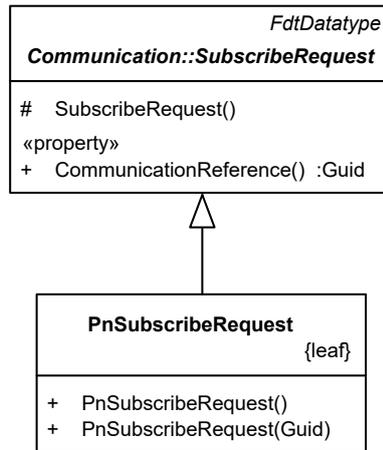

IEC


Figure 15 – PnSubscribeRequest

Table 16 – PnSubscribeRequest datatype

Property	Usage	Multiplicity	Description
CommunicationReference	M	[1..1]	Mandatory identifier for a communication link to a device. This identifier is allocated by the communication component during the Connect. The address information shall be used for all following communication calls.

10.5.2 PnSubscribeResponse

The class PnSubscribeResponse describes a response when subscribing to device-initiated data transfer. This specification provides a generic definition (see Figure 16 and Table 17).

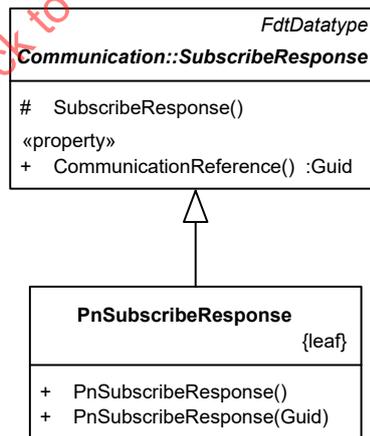

IEC

Figure 16 – PnSubscribeResponse

Table 17 – PnSubscribeResponse datatype

Property	Usage	Multiplicity	Description
CommunicationReference	M	[1..1]	Mandatory identifier for a communication link to a device. This identifier is allocated by the communication component during the Connect. The address information shall be used for all following communication calls.

10.6 UnsubscribeRequest and UnsubscribeResponse Service

10.6.1 PnUnsubscribeRequest Service

The class PnUnsubscribeRequest describes a request in order to unsubscribe from device-initiated data transfer. This specification provides a generic definition (see Figure 17 and Table 18).

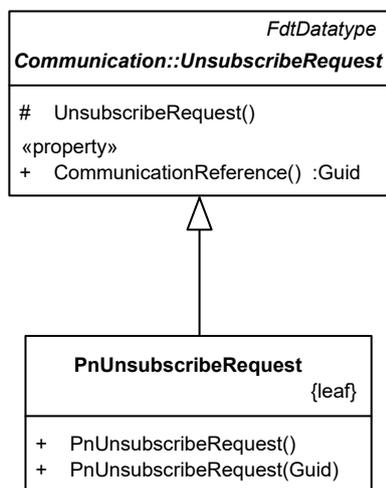


Figure 17 – PnUnsubscribeRequest

Table 18 – PnUnsubscribeRequest datatype

Property	Usage	Multiplicity	Description
CommunicationReference	M	[1..1]	Mandatory identifier for a communication link to a device. This identifier is allocated by the communication component during the Connect. The address information shall be used for all following communication calls.

10.6.2 PnUnsubscribeResponse Service

The class PnUnsubscribeResponse describes a response when unsubscribing from device-initiated data transfer. This specification provides a generic definition (see Figure 18 and Table 19).

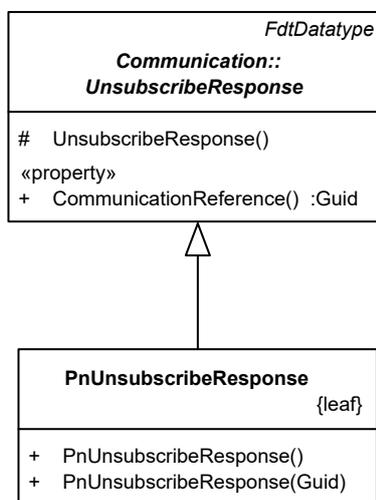


Figure 18 – PnUnsubscribeResponse

Table 19 – PnUnsubscribeResponse datatype

Property	Usage	Multiplicity	Description
CommunicationReference	M	[1..1]	Mandatory identifier for a communication link to a device. This identifier is allocated by the communication component during the Connect. The address information shall be used for all following communication calls.

10.7 AbortMessage Service

The class PnAbortMessage describes the abort. This message shall be sent when the communication component recognizes the loss of the physical connection (see Figure 19 and Table 20).

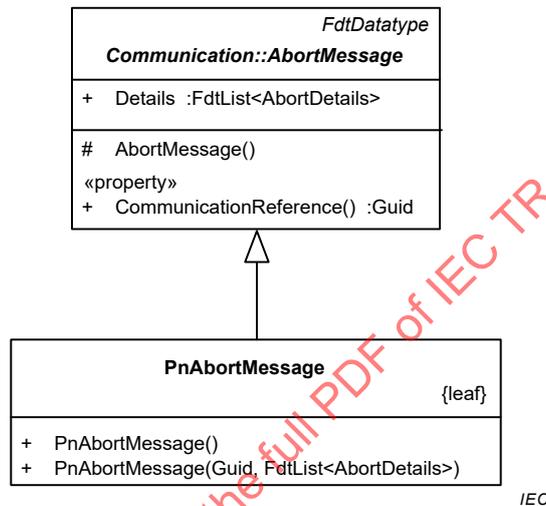


Figure 19 – PnAbortMessage

Table 20 – PnAbortMessage datatype

Property	Usage	Multiplicity	Description
CommunicationReference	M	[1..1]	Mandatory identifier for a communication link to a device. This identifier is allocated by the communication component during the Connect. The address information shall be used for all following communication calls.

10.8 PnResponseError

10.8.1 Communication error

The class PnResponseError describes the IEC 61784 CPF 3/3 specific communication error (see Figure 20 and Table 21). If a transaction fails, the response object shall provide either the response error or error information. If the failure is specific to PROFINET, the response error shall be used. If the failure is related to nested communication, the error information shall be used.