

TECHNICAL REPORT



**OPC unified architecture –
Part 1: Overview and concepts**

IECNORM.COM : Click to view the full PDF of IEC TR 62541-1:2020



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2020 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IECNORM.COM : Click to view the full PDF of IEC 618254-1:2020

TECHNICAL REPORT



**OPC unified architecture –
Part 1: Overview and concepts**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 25.040.40; 35.100.01

ISBN 978-2-8322-9076-7

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD	4
1 Scope	6
2 Normative references	6
3 Terms, definitions, and abbreviated terms	7
3.1 Terms and definitions	7
3.2 Abbreviated terms	11
4 Structure of the OPC UA series	12
4.1 Specification organization	12
4.2 Core specification parts	12
4.3 Access Type specification parts	13
4.4 Utility specification parts	13
5 Overview	14
5.1 UA scope	14
5.2 General	14
5.3 Design goals	14
5.4 Integrated models and services	16
5.4.1 Security model	16
5.4.2 Integrated AddressSpace model	17
5.4.3 Integrated object model	18
5.4.4 Integrated services	18
5.5 Sessions	18
6 Systems concepts	19
6.1 Client Server Overview	19
6.2 OPC UA Clients	19
6.3 OPC UA Servers	20
6.3.1 General	20
6.3.2 Real objects	20
6.3.3 Server application	20
6.3.4 OPC UA AddressSpace	21
6.3.5 Subscription entities	21
6.3.6 OPC UA Service Interface	21
6.3.7 Server to Server interactions	22
6.4 Redundancy	23
6.5 Publish-Subscribe	23
6.6 Synergy of models	24
7 Service Sets	25
7.1 General	25
7.2 Discovery Service Set	25
7.3 SecureChannel Service Set	25
7.4 Session Service Set	26
7.5 NodeManagement Service Set	26
7.6 View Service Set	26
7.7 Query Service Set	26
7.8 Attribute Service Set	27
7.9 Method Service Set	27
7.10 MonitoredItem Service Set	27

7.11 Subscription Service Set 28

Figure 1 – OPC UA specification organization 12

Figure 2 – OPC UA target applications 15

Figure 3 – OPC UA System architecture 19

Figure 4 – OPC UA Client architecture 19

Figure 5 – OPC UA Server architecture 20

Figure 6 – Peer-to-peer interactions between Servers 22

Figure 7 – Chained Server example 23

Figure 8 – Integrated Client Server and PubSub models 24

Figure 9 – SecureChannel and Session Services 26

IECNORM.COM : Click to view the full PDF of IEC TR 62541-1:2020

INTERNATIONAL ELECTROTECHNICAL COMMISSION

OPC UNIFIED ARCHITECTURE –

Part 1: Overview and concepts

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. However, a technical committee may propose the publication of a technical report when it has collected data of a different kind from that which is normally published as an International Standard, for example “state of the art”.

IEC TR 62541-1, which is a Technical Report, has been prepared by subcommittee 65E: Devices and integration in enterprise systems, of IEC technical committee 65: Industrial-process measurement, control and automation.

This third edition cancels and replaces the second edition of IEC TR 62541-1, published in 2016. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) added Subclauses 6.5 and 6.6 and other text throughout to include PubSub introduction;
- b) added new transports and encodings to existing overview sections;
- c) removed WS-SecureConversation example since this mapping has been deprecated;

d) improved the definition of Certificate.

The text of this Technical Report is based on the following documents:

Enquiry draft	Report on voting
65E/678/DTR	65E/702/RVDTR

Full information on the voting for the approval of this technical report can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

Throughout this document and the referenced other Parts of the series, certain document conventions are used:

Italics are used to denote a defined term or definition that appears in the “Terms and definition” clause in one of the parts of the series.

Italics are also used to denote the name of a service input or output parameter or the name of a structure or element of a structure that are usually defined in tables.

The *italicized terms* and names are also often written in camel-case (the practice of writing compound words or phrases in which the elements are joined without spaces, with each element's initial letter capitalized within the compound). For example, the defined term is *AddressSpace* instead of Address Space. This makes it easier to understand that there is a single definition for AddressSpace, not separate definitions for Address and Space.

A list of all parts of the IEC 62541 series, published under the general title OPC Unified Architecture, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

OPC UNIFIED ARCHITECTURE –

Part 1: Overview and concepts

1 Scope

This part of IEC 62541 presents the concepts and overview of the OPC Unified Architecture (OPC UA). Reading this document is helpful to understand the remaining parts of this multi-part document set. Each of the other parts of IEC 62541 is briefly explained along with a suggested reading order.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC TR 62541-2, *OPC unified architecture – Part 2: Security Model*

IEC 62541-3, *OPC unified architecture – Part 3: Address Space Model*

IEC 62541-4, *OPC unified architecture – Part 4: Services*

IEC 62541-5, *OPC unified architecture – Part 5: Information Model*

IEC 62541-6, *OPC unified architecture – Part 6: Mappings*

IEC 62541-7, *OPC unified architecture – Part 7: Profiles*

IEC 62541-8, *OPC unified architecture – Part 8: Data access*

IEC 62541-9, *OPC unified architecture – Part 9: Alarms and Conditions*

IEC 62541-10, *OPC unified architecture – Part 10: Programs*

IEC 62541-11, *OPC unified architecture – Part 11: Historical Access*

IEC 62541-12, *OPC unified architecture – Part 12: Discovery and global services*

IEC 62541-13, *OPC Unified Architecture – Part 13: Aggregates*

IEC 62541-14, *OPC unified architecture – Part 14: PubSub*

ITU X.509, *Information technology – Open Systems Interconnection – The Directory: Public-key and attribute certificate frameworks*
<https://www.itu.int/rec/T-REC-X.509>

3 Terms, definitions, and abbreviated terms

3.1 Terms and definitions

For the purposes of this document, the following terms apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1.1

AddressSpace

collection of information that a *Server* makes visible to its *Clients*

Note 1 to entry: See IEC 62541-3 for a description of the contents and structure of the *Server AddressSpace*.

3.1.2

Aggregate

function that calculates derived values from *Raw data*

Note 1 to entry: Raw data may be from a historian or buffered real time data. Common *Aggregates* include averages over a given time range, minimum over a time range and maximum over a time range.

3.1.3

Alarm

type of *Event* associated with a state condition that typically requires acknowledgement

Note 1 to entry: See IEC 62541-9 for a description of *Alarms*.

3.1.4

Attribute

primitive characteristic of a *Node*

Note 1 to entry: All *Attributes* are defined by OPC UA, and may not be defined by *Clients* or *Servers*. *Attributes* are the only elements in the *AddressSpace* permitted to have data values.

3.1.5

Broker

intermediary program module that routes *NetworkMessages* from *Publishers* to *Subscribers*

Note 1 to entry: Brokers are building blocks of *Message Oriented Middleware*.

3.1.6

Certificate

digitally signed data structure that contains a public key and the identity of a *Client* or *Server*

3.1.7

Client

software application that sends *Messages* to OPC UA *Servers* conforming to the *Services* specified in this set of specifications

3.1.8

Condition

generic term that is an extension to an *Event*

Note 1 to entry: A *Condition* represents the conditions of a system or one of its components and always exists in some state.

3.1.9

Communication Stack

layered set of software modules between the application and the hardware that provides various functions to encode, encrypt and format a *Message* for sending, and to decode, decrypt and unpack a *Message* that was received

3.1.10

DataSet

list of named data values

Note 1 to entry: A *DataSet* typically consists of *Event* fields or *Variable* values.

3.1.11

DataSetMessage

payload of a *NetworkMessage* created from a *DataSet*

Note 1 to entry: The *DataSetMessage* is an immutable payload of the *NetworkMessage* handed off to the *Message Oriented Middleware* (transport layer) for delivery by the *Publisher*. The *Subscriber* receives the *DataSetMessage* as the payload of a *NetworkMessage* from the *Publisher* with additional headers that may be supplied by the *Message Oriented Middleware* along the way.

3.1.12

Discovery

process by which *Client* obtains information about *Servers*, including endpoint and security information

3.1.13

Event

generic term used to describe an occurrence of some significance within a system or system component

3.1.14

EventNotifier

special *Attribute* of a *Node* that signifies that a *Client* may subscribe to that particular *Node* to receive *Notifications* of *Event* occurrences

3.1.15

Information Model

organizational framework that defines, characterizes and relates information resources of a given system or set of systems

Note 1 to entry: The core *AddressSpace* model supports the representation of *Information Models* in the *AddressSpace*. See IEC 62541-5 for a description of the base OPC UA Information Model.

3.1.16

Message

data unit conveyed between *Client* and *Server* that represents a specific *Service* request or response

3.1.17

Message Oriented Middleware

infrastructure supporting sending and receiving *NetworkMessages* between distributed systems

Note 1 to entry: An OPC UA *Application* may support different types of *Message Oriented Middleware* infrastructures and protocols like AMQP, MQTT, or UDP with IP multicast. Other types like DDS or XMPP can also be integrated into the OPC UA *PubSub* model.

3.1.18

Method

callable software function that is a component of an *Object*

3.1.19

MonitoredItem

Client-defined entity in the *Server* used to monitor *Attributes* or *EventNotifiers* for new values or *Event* occurrences and that generates *Notifications* for them

3.1.20

NetworkMessage

DataSetMessages and header to facilitate delivery, routing, security and filtering

Note 1 to entry: The *Publisher* hands off the *NetworkMessage* to the *Message Oriented Middleware* (transport layer) to deliver *DataSetMessages* to the *Subscribers*.

Note 2 to entry: The term message is used with various connotations in the messaging world. The *Publisher* might like to think of the message as an immutable payload handed off to the *Message Oriented Middleware* for delivery. The *Subscriber* often thinks of the message as not only that immutable payload from the sender, but also various annotations supplied by the *Message Oriented Middleware* along the way. To avoid confusion, the term *DataSetMessage* is used to mean the message as supplied by the *Publisher* for a *DataSet* and the term *NetworkMessage* is used to mean the *DataSetMessage* plus sections for annotation at the head and tail of the *DataSetMessage*.

3.1.21

Node

fundamental component of an *AddressSpace*

3.1.22

NodeClass

class of a *Node* in an *AddressSpace*

Note 1 to entry: *NodeClasses* define the metadata for the components of the OPC UA object model. They also define constructs, such as *Views*, that are used to organize the *AddressSpace*.

3.1.23

Notification

generic term for data that announces the detection of an *Event* or of a changed *Attribute* value; *Notifications* are sent in *NotificationMessages*.

3.1.24

NotificationMessage

Message published from a *Subscription* that contains one or more *Notifications*

3.1.25

Object

Object Instance

Node that represents a physical or abstract element of a system

Note 1 to entry: *Objects* are modelled using the OPC UA Object Model. Systems, subsystems and devices are examples of *Objects*. An *Object* may be defined as an instance of an *ObjectType*.

3.1.26

ObjectType

Node that represents the type definition for an *Object*

3.1.27

OPC UA Application

Client, which calls OPC UA *Services*, or a *Server*, which performs those *Services*, or an OPC UA *Publisher* or an OPC UA *Subscriber*

3.1.28

Publisher

entity sending *NetworkMessages* to a *Message Oriented Middleware*

Note 1 to entry: A *Publisher* can be a native OPC UA *Application* or an application that only has knowledge about the *Message Oriented Middleware* and the rules for encoding the *NetworkMessages* and *DataSetMessages*.

3.1.29

PubSub

OPC UA variant of the publish subscribe messaging pattern

3.1.30

Profile

specific set of capabilities to which a *Server* may claim conformance

Note 1 to entry: Each *Server* may claim conformance to more than one *Profile*.

Note 2 to entry: The set of capabilities are defined in IEC 62541-7.

3.1.31

Program

executable *Object* that, when invoked, immediately returns a response to indicate that execution has started, and then returns intermediate and final results through *Subscriptions* identified by the *Client* during invocation

3.1.32

Reference

explicit relationship (a named pointer) from one *Node* to another

Note 1 to entry: The *Node* that contains the *Reference* is the source *Node*, and the referenced *Node* is the target *Node*. All *References* are defined by *ReferenceTypes*.

3.1.33

ReferenceType

Node that represents the type definition of a *Reference*

Note 1 to entry: The *ReferenceType* specifies the semantics of a *Reference*. The name of a *ReferenceType* identifies how source *Nodes* are related to target *Nodes* and generally reflects an operation between the two, such as "A contains B".

3.1.34

Server

software application that implements and exposes the *Services* specified in this set of specifications

3.1.35

Service

Client-callable operation in a *Server*

Note 1 to entry: *Services* are defined in IEC 62541-4. A *Service* is similar to a method call in a programming language or an operation in a Web services WSDL contract.

3.1.36

Service Set

group of related *Services*

3.1.37

Session

logical long-running connection between a *Client* and a *Server*

Note 1 to entry: A *Session* maintains state information between *Service* calls from the *Client* to the *Server*.

3.1.38

Subscriber

entity receiving *DataSetMessages* from a *Message Oriented Middleware*

Note 1 to entry: A *Subscriber* can be a native OPC UA *Application* or an application that has just knowledge about the *Message Oriented Middleware* and the rules for decoding the *NetworkMessages* and *DataSetMessages*. A *Subscription* in the OPC UA *Client Server* model has a different meaning than the *Subscriber* in the *PubSub* model.

3.1.39

Subscription

Client-defined endpoint in the *Server*, used to return *Notifications* to the *Client*

Note 1 to entry: "Subscription" is a generic term that describes a set of *Nodes* selected by the *Client* (1) that the *Server* periodically monitors for the existence of some condition, and (2) for which the *Server* sends *Notifications* to the *Client* when the condition is detected.

3.1.40

Underlying System

hardware or software platforms that exist as an independent entity

Note 1 to entry: *UA Applications* are dependent on an entity's existence in order to perform UA services. However, the entity is not dependent on *UA Applications*.

Note 2 to entry: : Hardware and software platforms include physical hardware, firmware, operating system, networking, non-UA applications, as well as other *UA Applications*. A Distributed Control System, PLC/Device, and UA Server are examples of an *Underlying System*.

3.1.41

Variable

Node that contains a value

3.1.42

View

specific subset of the *AddressSpace* that is of interest to the *Client*

3.2 Abbreviated terms

A&E	Alarms and Events
AMQP	Advanced Message Queuing Protocol
API	Application Programming Interface
COM	Component Object Model
DA	Data Access
DCS	Distributed Control System
DDS	Data Distribution Service
HDA	Historical Data Access
HMI	Human-Machine Interface
JSON	JavaScript Object Notation
LDAP	Lightweight Directory Access Protocol
MES	Manufacturing Execution System
MQTT	Message Queue Telemetry Transport
OPC	OPC Foundation (a non-profit industry association) formerly an acronym for "OLE for Process Control". Acronym no longer used.
PLC	Programmable Logic Controller
SCADA	Supervisory Control And Data Acquisition
UA	Unified Architecture
WSDL	Web Services Definition Language
XML	Extensible Markup Language
XMPP	Extensible Messaging and Presence Protocol

4 Structure of the OPC UA series

4.1 Specification organization

This specification is organized as a multi-part specification, as illustrated in Figure 1.

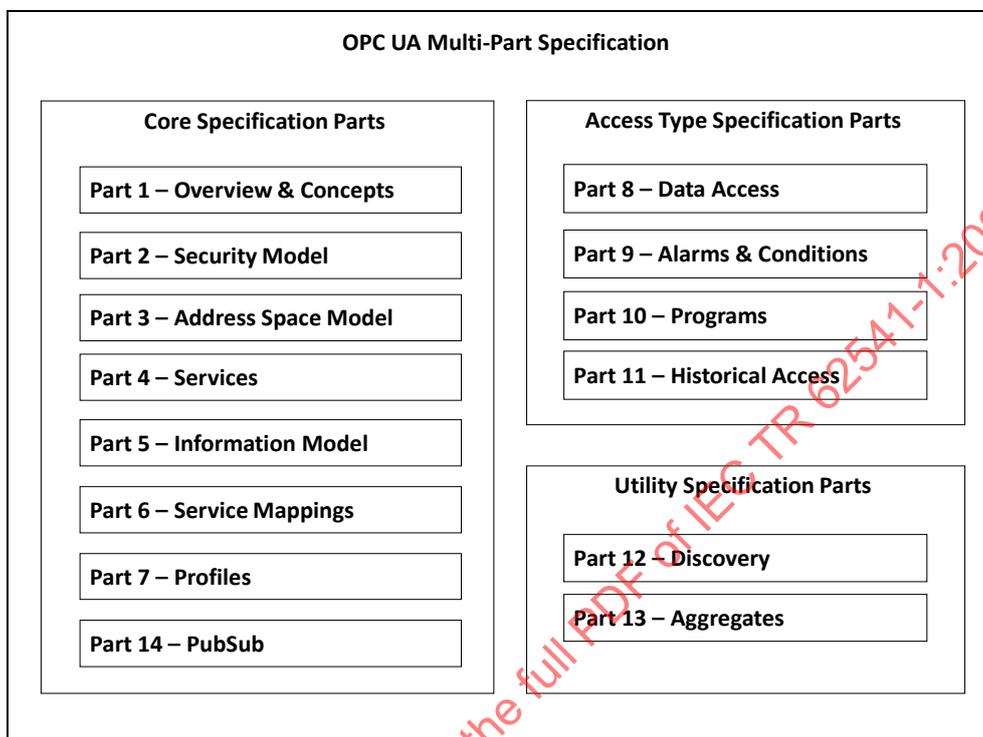


Figure 1 – OPC UA specification organization

IEC 62541-1 through IEC 62541-7 and IEC 62541-14 specify the core capabilities of OPC UA. These core capabilities define the structure of the OPC *AddressSpace* and the *Services* that operate on it. IEC 62541-14¹ defines an OPC UA publish subscribe pattern in addition to the *Client Server* pattern defined by the *Services* in IEC 62541-4. IEC 62541-8 through IEC 62541-11 apply these core capabilities to specific types of access previously addressed by separate OPC COM specifications, such as Data Access (DA), Alarms and Events (A&E) and Historical Data Access (HDA). IEC 62541-12 describes *Discovery* mechanisms for OPC UA and IEC 62541-13 describes ways of aggregating data.

Readers are encouraged to read IEC 62541-1 through IEC 62541-5 of the core specifications before reading IEC 62541-8 through IEC 62541-14. For example, a reader interested in UA Data Access should read IEC 62541-1 through IEC 62541-5 and IEC 62541-8. References in IEC 62541-8 may direct the reader to other parts of this specification.

4.2 Core specification parts

Part 1 – Overview and Concepts

Part 1 (this document) presents the concepts and overview of OPC UA.

¹ Under preparation. Stage at the time of publication: IEC 62541-14/FDIS:2019.

Part 2 – Security Model

IEC TR 62541-2 describes the model for securing interactions between *OPC UA Applications*.

Part 3 – Address Space Model

IEC 62541-3 describes the contents and structure of the *Server's AddressSpace*.

Part 4 – Services

IEC 62541-4 specifies the *Services* provided by *Servers*.

Part 5 – Information Model

IEC 62541-5 specifies the types and their relationships defined for *Servers*.

Part 6 – Mappings

IEC 62541-6 specifies the mappings to transport protocols and data encodings supported by OPC UA.

Part 7 – Profiles

IEC 62541-7 specifies the *Profiles* that are available for *OPC UA Applications*. These *Profiles* provide groupings of functionality that can be used for conformance level certification. *OPC UA Applications* will be tested against the *Profiles*.

4.3 Access Type specification parts

Part 8 – Data Access

IEC 62541-8 specifies the use of OPC UA for data access.

Part 9 – Alarms and Conditions

IEC 62541-9 specifies use of OPC UA support for access to *Alarms* and *Conditions*. The base system includes support for simple *Events*; this specification extends that support to include support for *Alarms* and *Conditions*.

Part 10 – Programs

IEC 62541-10 specifies OPC UA support for access to *Programs*.

Part 11 – Historical Access

IEC 62541-11 specifies use of OPC UA for historical access. This access includes both historical data and historical *Events*.

4.4 Utility specification parts

Part 12 – Discovery

IEC 62541-12 specifies how *Discovery Servers* operate in different scenarios and describes how *UA Clients* and *Servers* should interact with them. It also defines how UA related information should be accessed using common directory service protocols such as LDAP.

Part 13 – Aggregates

IEC 62541-13 specifies how to compute and return aggregates like minimum, maximum, average, etc. *Aggregates* can be used with current and historical data.

Part 14 – PubSub

IEC 62541-14 specifies the OPC Unified Architecture (OPC UA) *PubSub* communication model. The *PubSub* communication model defines an OPC UA publish subscribe pattern in addition to the *Client Server* pattern defined by the *Services* in IEC 62541-4.

5 Overview

5.1 UA scope

OPC UA is applicable to components in all industrial domains, such as industrial sensors and actuators, control systems, Manufacturing Execution Systems and Enterprise Resource Planning Systems, including the Industrial Internet of Things (IIoT), Machine To Machine (M2M) as well as Industrie 4.0 and China 2025. These systems are intended to exchange information and to use command and control for industrial processes. OPC UA defines a common infrastructure model to facilitate this information exchange. OPC UA specifies the following:

- the information model to represent structure, behaviour and semantics;
- the message model to interact between applications;
- the communication model to transfer the data between end-points;
- the conformance model to guarantee interoperability between systems.

5.2 General

OPC UA is a platform-independent standard through which various kinds of systems and devices can communicate by sending request and response *Messages* between *Clients* and *Servers* or *NetworkMessages* between *Publishers* and *Subscribers* over various types of networks. It supports robust, secure communication that assures the identity of *OPC UA Applications* and resists attacks.

In the *Client Server* model, OPC UA defines sets of *Services* that *Servers* may provide, and individual *Servers* specify to *Clients* what *Service* sets they support. Information is conveyed using OPC UA-defined and vendor-defined data types, and *Servers* define object models that *Clients* can dynamically discover. *Servers* can provide access to both current and historical data, as well as *Alarms* and *Events* to notify *Clients* of important changes. OPC UA can be mapped onto a variety of communication protocols and data can be encoded in various ways to trade off portability and efficiency.

In addition to the *Client Server* model, OPC UA defines a mechanism for *Publishers* to transfer the information to *Subscribers* using the *PubSub* model.

5.3 Design goals

OPC UA provides a consistent, integrated *AddressSpace* and service model. This allows a single *Server* to integrate data, *Alarms* and *Events*, and history into its *AddressSpace*, and to provide access to them using an integrated set of *Services*. These *Services* also include an integrated security model.

OPC UA also allows *Servers* to provide *Clients* with type definitions for the *Objects* accessed from the *AddressSpace*. This allows information models to be used to describe the contents of the *AddressSpace*. OPC UA allows data to be exposed in many different formats, including binary structures and XML or JSON documents. The format of the data may be defined by OPC,

other standard organizations or vendors. Through the *AddressSpace*, *Clients* can query the *Server* for the metadata that describes the format for the data. In many cases, *Clients* with no pre-programmed knowledge of the data formats will be able to determine the formats at runtime and properly utilize the data.

OPC UA adds support for many relationships between *Nodes* instead of being limited to just a single hierarchy. In this way, a *Server* may present data in a variety of hierarchies tailored to the way a set of *Clients* would typically like to view the data. This flexibility, combined with support for type definitions, makes OPC UA applicable to a wide array of problem domains. As illustrated in Figure 2, OPC UA is not targeted at just the SCADA, PLC and DCS interface, but also as a way to provide greater interoperability between higher level functions.

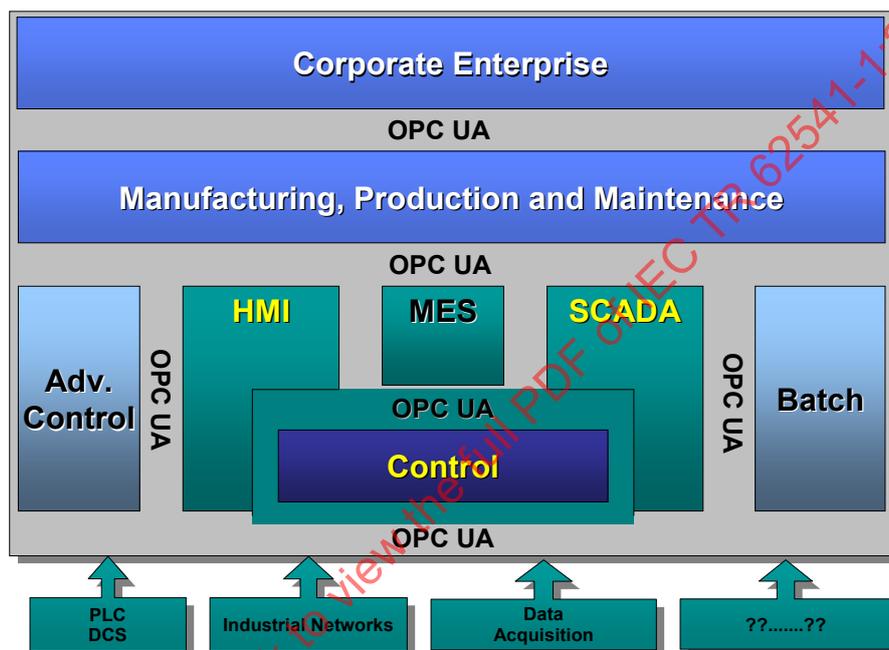


Figure 2 – OPC UA target applications

OPC UA is designed to provide robustness of published data. A major feature of all OPC servers is the ability to publish data and *Event Notifications*. OPC UA provides mechanisms for *Clients* to quickly detect and recover from communication failures associated with these transfers without having to wait for long timeouts provided by the underlying protocols.

OPC UA is designed to support a wide range of *Servers*, from plant floor PLCs to enterprise *Servers*. These *Servers* are characterized by a broad scope of size, performance, execution platforms and functional capabilities. Therefore, OPC UA defines a comprehensive set of capabilities, and *Servers* may implement a subset of these capabilities. To promote interoperability, OPC UA defines subsets, referred to as *Profiles*, to which *Servers* may claim conformance. *Clients* can then discover the *Profiles* of a *Server*, and tailor their interactions with that *Server* based on the *Profiles*. *Profiles* are defined in IEC 62541-7.

The OPC UA specifications are layered to isolate the core design from the underlying computing technology and network transport. This allows OPC UA to be mapped to future technologies as necessary, without negating the basic design. Mappings and data encodings are described in IEC 62541-6. Three data encodings are defined:

- XML/text,
- UA Binary,
- JSON.

In addition, several protocols are defined:

- OPC UA TCP,
- HTTPS,
- WebSockets.

OPC UA Applications that support multiple transports and encodings will allow the end users to make decisions about trade-offs between performance and compatibility at the time of deployment, rather than having these trade-offs determined by the OPC vendor at the time of product definition.

OPC UA is designed as the migration path for OPC clients and servers that are based on Microsoft COM technology. Care has been taken in the design of OPC UA so that existing data exposed by OPC COM servers (DA, HDA and A&E) can easily be mapped and exposed via OPC UA. Vendors may choose migrating their products natively to OPC UA or use external wrappers to convert from OPC COM to OPC UA and vice-versa. Each of the previous OPC specifications defined its own address space model and its own set of *Services*. OPC UA unifies the previous models into a single integrated address space with a single set of *Services*.

OPC UA *PubSub* opens new application fields for OPC UA. The following are some example uses for *PubSub*:

- Configurable peer to peer communication between controllers and between controllers and HMIs. The peers are not directly connected and do not even need to know about the existence of each other. The data exchange often requires a fixed time-window; it may be point-to-point or a multi-point connection.
- Asynchronous workflows. For example, an order processing application can place an order on a message queue or an enterprise service bus. From there it can be processed by one or more workers.
- Logging to multiple systems. For example, sensors or actuators can write logs to a monitoring system, an HMI, an archive application for later querying, and so on.
- *Servers* representing services or devices can stream data to applications hosted in the cloud; for example, backend servers, big data analytics for system optimization and predictive maintenance.

PubSub is not bound to a particular messaging system. Rather, it can be mapped to various different systems as illustrated with two examples:

- *PubSub* with UDP may be well-suited in production environments for frequent transmissions of small amounts of data. It also allows data exchange in one-to-one and one-to-many configurations.
- The use of established messaging protocols (e.g. the ISO/IEC AMQP 1.0 protocol) with JSON data encoding supports the cloud integration path and readily allows handling of the information in modern stream and batch analytics systems.

5.4 Integrated models and services

5.4.1 Security model

5.4.1.1 General

OPC UA security is concerned with the authentication of *Clients* and *Servers*, the authentication of users, the integrity and confidentiality of their communications, and the verifiability of claims of functionality. It does not specify the circumstances under which various security mechanisms are required. That specification is crucial, but it is made by the designers of the system at a given site and may be specified by other standards.

Rather, OPC UA provides a security model, described in IEC TR 62541-2, in which security measures can be selected and configured to meet the security needs of a given installation.

This model includes security mechanisms and parameters. In some cases, the mechanism for exchanging security parameters is defined, but the way that applications use these parameters is not. This framework also defines a minimum set of security *Profiles* that all *OPC UA Applications* support, even though they may not be used in all installations. Security *Profiles* are defined in IEC 62541-7.

5.4.1.2 Discovery and Session establishment

Application level security relies on a secure communication channel that is active for the duration of the application *Session* and ensures the integrity of all *Messages* that are exchanged. This means users need to be authenticated only once, when the application *Session* is established. The mechanisms for discovering *Servers* and establishing secure communication channels and application *Sessions* are described in IEC 62541-4 and IEC 62541-6. Additional information about the *Discovery* process is described in IEC 62541-12.

When a *Session* is established, the *Client* and *Server* applications negotiate a secure communications channel. Digital (ITU X.509) *Certificates* are utilized to identify the *Client* and *Server*. The *Server* further authenticates the user and authorizes subsequent requests to access *Objects* in the *Server*.

5.4.1.3 Auditing

OPC UA includes support for security audit trails with traceability between *Client* and *Server* audit logs. If a security-related problem is detected at the *Server*, the associated *Client* audit log entry can be located and examined. OPC UA also provides the capability for *Servers* to generate *Event Notifications* that report auditable *Events* to *Clients* capable of processing and logging them. OPC UA defines security audit parameters that can be included in audit log entries and in audit *Event Notifications*. IEC 62541-5 defines the data types for these parameters. Not all *Servers* and *Clients* provide all of the auditing features. *Profiles*, found in IEC 62541-7, indicate which features are supported.

5.4.1.4 Transport security

OPC UA security complements the security infrastructure provided by most web service capable platforms.

Transport level security can be used to encrypt and sign *Messages*. Encryption and signatures protect against disclosure of information and protect the integrity of *Messages*. Encryption capabilities are provided by the underlying communications technology used to exchange *Messages* between *OPC UA Applications*. IEC 62541-7 defines the encryption and signature algorithms to be used for a given *Profile*.

5.4.2 Integrated AddressSpace model

The set of *Objects* and related information that the *Server* makes available to *Clients* is referred to as its *AddressSpace*. The OPC UA *AddressSpace* represents its contents as a set of *Nodes* connected by *References*.

Primitive characteristics of *Nodes* are described by OPC-defined *Attributes*. *Attributes* are the only elements of a *Server* that have data values. Data types that define attribute values may be simple or complex.

Nodes in the *AddressSpace* are typed according to their use and their meaning. *NodeClasses* define the metadata for the OPC UA *AddressSpace*. IEC 62541-3 defines the OPC UA *NodeClasses*.

The *Base NodeClass* defines *Attributes* common to all *Nodes*, allowing identification, classification and naming. Each *NodeClass* inherits these *Attributes* and may additionally define its own *Attributes*.

To promote interoperability of *Clients* and *Servers*, the OPC UA *AddressSpace* is structured hierarchically with the top levels the same for all *Servers*. Although *Nodes* in the *AddressSpace* are typically accessible via the hierarchy, they may have *References* to each other, allowing the *AddressSpace* to represent an interrelated network of *Nodes*. The model of the *AddressSpace* is defined in IEC 62541-3.

Servers may subset the *AddressSpace* into *Views* to simplify *Client* access. Subclause 6.3.4.3 describes *AddressSpace Views* in more detail.

5.4.3 Integrated object model

The OPC UA Object Model provides a consistent, integrated set of *NodeClasses* for representing *Objects* in the *AddressSpace*. This model represents *Objects* in terms of their *Variables*, *Events* and *Methods*, and their relationships with other *Objects*. IEC 62541-3 describes this model.

The OPC UA object model allows *Servers* to provide type definitions for *Objects* and their components. Type definitions may be subclassed. They also may be common or they may be system-specific. *ObjectTypes* may be defined by standards organizations, vendors or end-users.

This model allows data, *Alarms* and *Events*, and their history to be integrated into a single *Server*. For example, *Servers* are able to represent a temperature transmitter as an *Object* that is composed of a temperature value, a set of alarm parameters, and a corresponding set of alarm limits.

5.4.4 Integrated services

The interface between *Clients* and *Servers* is defined as a set of *Services*. These *Services* are organized into logical groupings called *Service Sets*. *Service Sets* are discussed in 6.4 and specified in IEC 62541-4.

OPC UA *Services* provide two capabilities to *Clients*. They allow *Clients* to issue requests to *Servers* and receive responses from them. They also allow *Clients* to subscribe to *Servers* for *Notifications*. *Notifications* are used by the *Server* to report occurrences such as *Alarms*, data value changes, *Events*, and *Program* execution results.

OPC UA *Messages* may be encoded as text (XML or JSON) or in binary format for efficiency purposes. They may be transferred using multiple underlying transports, for example TCP or HTTP. *Servers* may provide different encodings and transports as defined by IEC 62541-6.

5.5 Sessions

OPC UA *Client Server* interaction requires a stateful model. The state information is maintained inside an application *Session*. Examples of state-information are *Subscriptions*, user credentials and continuation points for operations that span multiple requests.

Sessions are defined as logical connections between *Clients* and *Servers*. *Servers* may limit the number of concurrent *Sessions* based on resource availability, licensing restrictions, or other constraints. Each *Session* is independent of the underlying communications protocols. Failures of these protocols do not automatically cause the *Session* to terminate. *Sessions* terminate based on *Client* or *Server* request, or based on inactivity of the *Client*. The inactivity time interval is negotiated during *Session* establishment.

6 Systems concepts

6.1 Client Server Overview

The OPC UA systems architecture models *Clients* and *Servers* as interacting partners. Each system may contain multiple *Clients* and *Servers*. Each *Client* may interact concurrently with one or more *Servers*, and each *Server* may interact concurrently with one or more *Clients*. An application may combine *Server* and *Client* components to allow interaction with other *Servers* and *Clients* as described in 6.3.7.

Clients and *Servers* are described in 6.2 and 6.3. Figure 3 illustrates the architecture that includes a combined *Server* and *Client*.

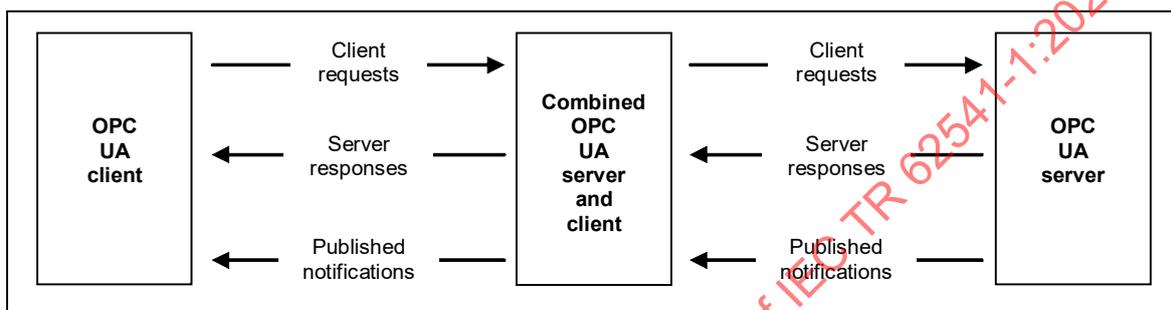


Figure 3 – OPC UA System architecture

6.2 OPC UA Clients

The OPC UA *Client* architecture models the *Client* endpoint of client/server interactions. Figure 4 illustrates the major elements of a typical *Client* and how they relate to each other.

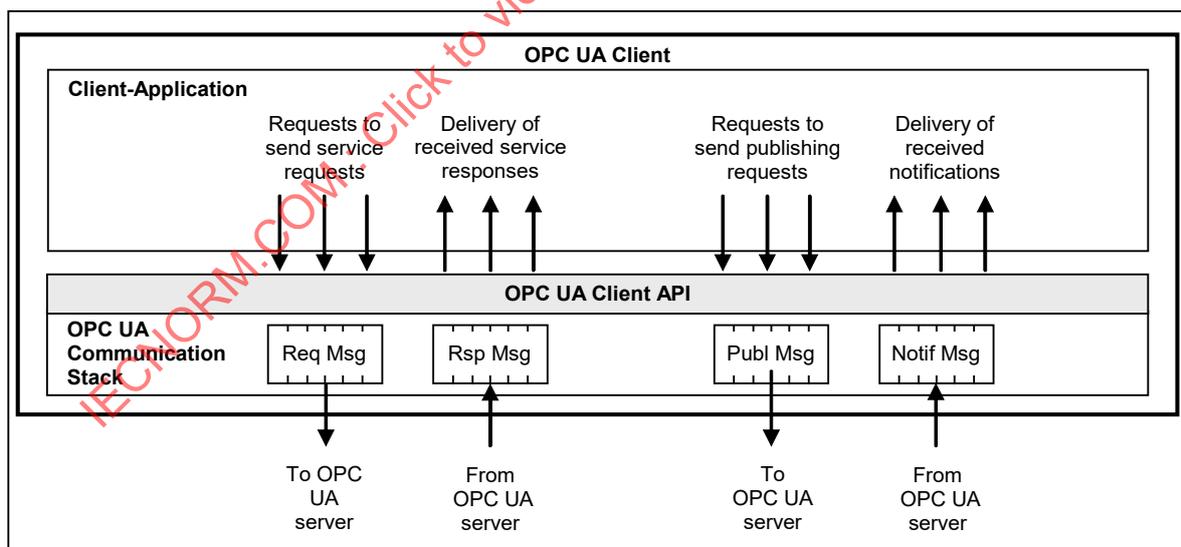


Figure 4 – OPC UA Client architecture

The *Client* Application is the code that implements the function of the *Client*. It uses the *Client* API to send and receive OPC UA *Service* requests and responses to the *Server*. The *Services* defined for OPC UA are described in 6.4, and specified in IEC 62541-4.

Note that the “*Client API*” is an internal interface that isolates the *Client* application code from an OPC UA Communication Stack. The OPC UA Communication Stack converts *Client API* calls into *Messages* and sends them through the underlying communications entity to the *Server* at the request of the *Client* application. The OPC UA Communication Stack also receives response and *NotificationMessages* from the underlying communications entity and delivers them to the *Client* application through the *Client API*.

6.3 OPC UA Servers

6.3.1 General

The OPC UA *Server* architecture models the *Server* endpoint of client/server interactions. Figure 5 illustrates the major elements of the *Server* and how they relate to each other.

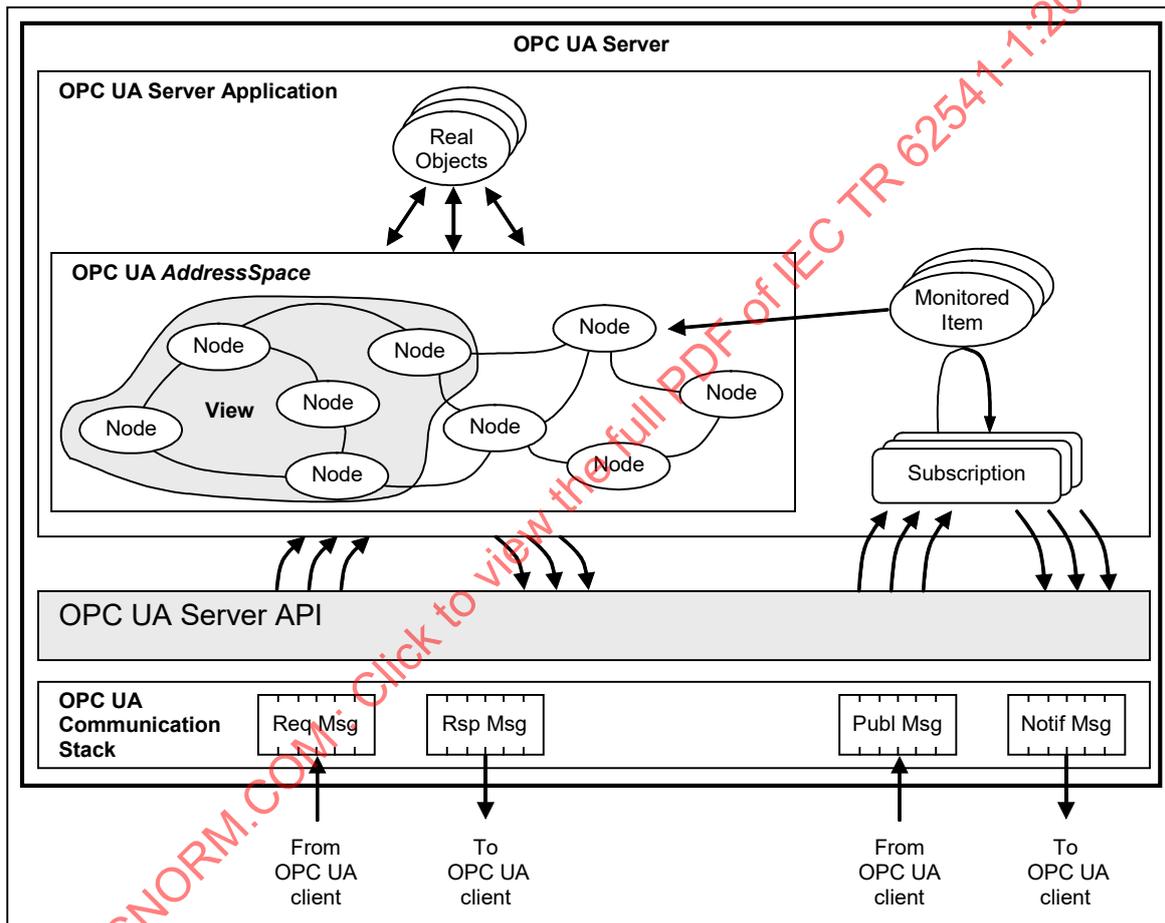


Figure 5 – OPC UA Server architecture

6.3.2 Real objects

Real objects are physical or software objects that are accessible by the *Server* application or that it maintains internally. Examples include physical devices and diagnostics counters.

6.3.3 Server application

The *Server* application is the code that implements the function of the *Server*. It uses the *Server API* to send and receive OPC UA *Messages* from *Clients*. Note that the “*Server API*” is an internal interface that isolates the *Server* application code from an OPC UA Communication Stack.

6.3.4 OPC UA AddressSpace

6.3.4.1 AddressSpace Nodes

The *AddressSpace* is modelled as a set of *Nodes* accessible by *Clients* using OPC UA *Services* (interfaces and methods). *Nodes* in the *AddressSpace* are used to represent real objects, their definitions and their *References* to each other.

6.3.4.2 AddressSpace organization

IEC 62541-3 contains the details of the meta model “building blocks” used to create an *AddressSpace* out of interconnected *Nodes* in a consistent manner. *Servers* are free to organize their *Nodes* within the *AddressSpace* as they choose. The use of *References* between *Nodes* permits *Servers* to organize the *AddressSpace* into hierarchies, a full mesh network of *Nodes*, or any possible mix.

IEC 62541-5 defines OPC UA *Nodes* and *References* and their expected organization in the *AddressSpace*. Some *Profiles* will not require that all of the UA *Nodes* be implemented.

6.3.4.3 AddressSpace Views

A *View* is a subset of the *AddressSpace*. *Views* are used to restrict the *Nodes* that the *Server* makes visible to the *Client*, thus restricting the size of the *AddressSpace* for the *Service* requests submitted by the *Client*. The default *View* is the entire *AddressSpace*. *Servers* may optionally define other *Views*. *Views* hide some of the *Nodes* or *References* in the *AddressSpace*. *Views* are visible via the *AddressSpace* and *Clients* are able to browse *Views* to determine their structure. *Views* are often hierarchies, which are easier for *Clients* to navigate and represent in a tree.

6.3.4.4 Support for information models

The OPC UA *AddressSpace* supports information models. This support is provided through:

- *Node References* that allow *Objects* in the *AddressSpace* to be related to each other.
- *ObjectType Nodes* that provide semantic information for real *Objects* (type definitions).
- *ObjectType Nodes* to support subclassing of type definitions.
- Data type definitions exposed in the *AddressSpace* that allow industry specific data types to be used.
- OPC UA companion standards that permit industry groups to define how their specific information models are to be represented in *Server AddressSpace*.

6.3.5 Subscription entities

6.3.5.1 MonitoredItems

MonitoredItems are entities in the *Server* created by the *Client* that monitor *AddressSpace Nodes* and their real-world counterparts. When they detect a data change or an event/alarm occurrence, they generate a *Notification* that is transferred to the *Client* by a *Subscription*.

6.3.5.2 Subscriptions

A *Subscription* is an endpoint in the *Server* that publishes *Notifications* to *Clients*. *Clients* control the rate at which publishing occurs by sending *Publish Messages*.

6.3.6 OPC UA Service Interface

6.3.6.1 General

The *Services* defined for OPC UA are described in 6.4, and specified in IEC 62541-4.

6.3.6.2 Request/response Services

Request/response *Services* are *Services* invoked by the *Client* through the OPC UA *Service* Interface to perform a specific task on one or more *Nodes* in the *AddressSpace* and to return a response.

6.3.6.3 Subscription Services

The *Publish Service* is invoked through the OPC UA *Service* Interface for the purpose of periodically sending *Notifications* to *Clients*. Notifications include *Events*, *Alarms*, data changes and *Program* outputs.

6.3.7 Server to Server interactions

Server to Server interactions in the *Client Server* model are interactions in which one *Server* acts as a *Client* of another *Server*. *Server to Server* interactions allow for the development of servers that:

- a) exchange information with each other on a peer-to-peer basis, this could include redundancy or remote *Servers* that are used for maintaining system wide type definitions (see Figure 6),
- b) are chained in a layered architecture of *Servers* to provide:
 - 1) aggregation of data from lower-layer *Servers*,
 - 2) higher-layer data constructs to *Clients*, and
 - 3) concentrator interfaces to *Clients* for single points of access to multiple underlying *Servers*.

Figure 6 illustrates interactions between Servers.

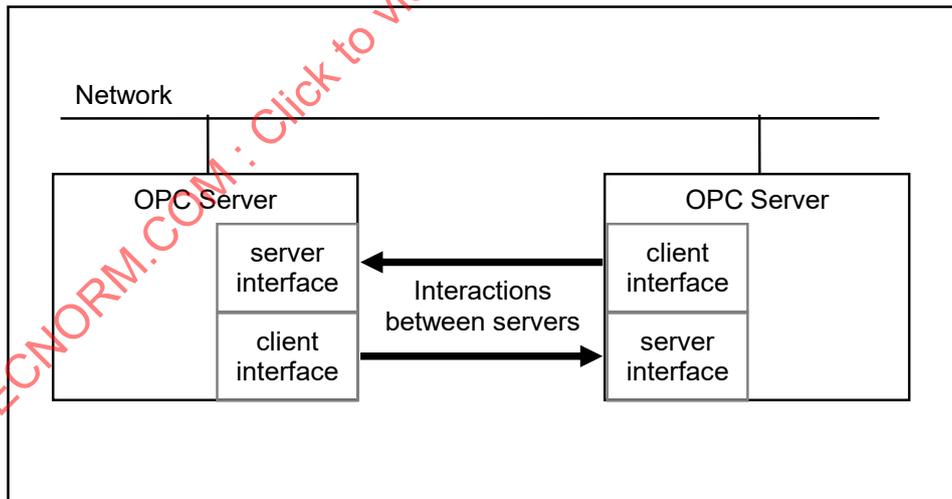


Figure 6 – Peer-to-peer interactions between Servers

Similar peer-to-peer interactions can also be accomplished using the OPC UA *PubSub* model where each peer *Application* is both a *Publisher* and a *Subscriber*.

Figure 7 extends the previous example and illustrates the chaining of *Servers* together for vertical access to data in an enterprise.

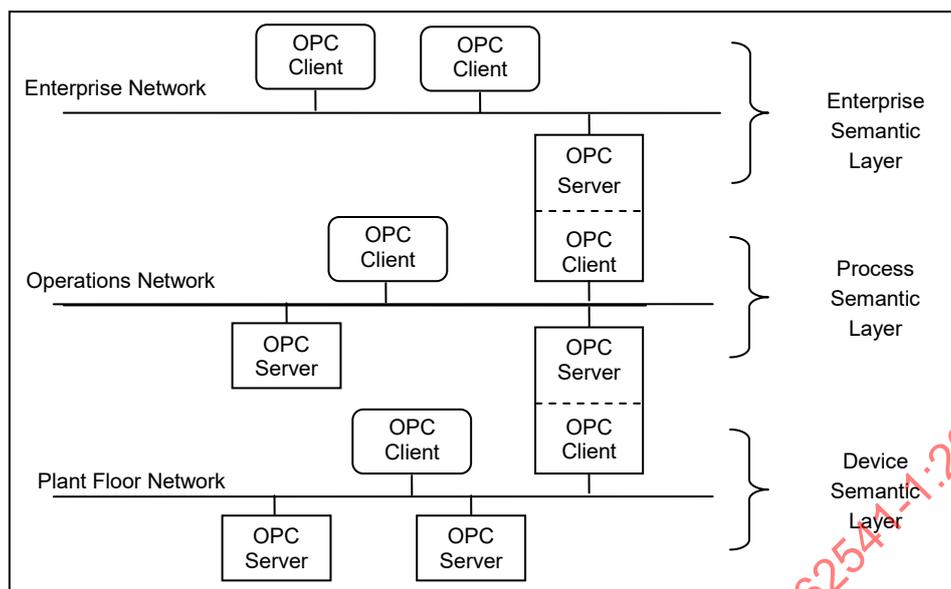


Figure 7 – Chained Server example

6.4 Redundancy

OPC UA provides the data structures and services by which *Redundancy* may be achieved in a standardized manner. *Redundancy* may be used for high availability, fault tolerance and load balancing. IEC 62541-4 formally defines *Client*, *Server* and *Network Redundancy*. Whether and what *Redundancy* is supported by an OPC UA *Application* is defined by its *Profiles*. *Profiles* are described in IEC 62541-7.

Required client and server behaviours are associated with two distinct modes of *Server Redundancy*, transparent and non-transparent. The *Client* and *Server* responsibilities when using either transparent or non-transparent redundancy are defined in IEC 62541-4.

Servers that support non-transparent redundancy can also support client controlled load balancing. The health of a *Server* including its ability to *Service* requests is collectively defined as *ServiceLevel*. See IEC 62541-5 for a formal definition of *ServiceLevel*. IEC 62541-4 defines four distinct *ServiceLevel* sub-ranges and example usage.

6.5 Publish-Subscribe

With *PubSub*, OPC UA *Applications* do not directly exchange requests and responses. Instead, *Publishers* send messages to a *Message Oriented Middleware*, without knowledge of what, if any, *Subscribers* there may be. Similarly, *Subscribers* express interest in specific types of data, and process messages that contain this data, without knowledge of what *Publishers* there are.

Message Oriented Middleware is software or hardware infrastructure supporting sending and receiving messages between distributed systems. It depends on the *Message Oriented Middleware* how this distribution is implemented.

To cover a large number of use cases, OPC UA *PubSub* supports two largely different *Message Oriented Middleware* variants. These are:

- A broker-less form, where the *Message Oriented Middleware* is the network infrastructure that is able to route datagram-based messages. *Subscribers* and *Publishers* use datagram protocols like UDP multicast.