

TECHNICAL REPORT



Power measurement applications within electrical distribution networks and electrical installations

IECNORM.COM : Click to view the full PDF of IEC TR 63213:2019



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2019 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IECNORM.COM : Click to view the full text of IEC 60321-3:2019

TECHNICAL REPORT



Power measurement applications within electrical distribution networks and electrical installations

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 17.220.20

ISBN 978-2-8322-7292-3

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD.....	4
INTRODUCTION.....	6
1 Scope.....	7
2 Normative references	7
3 Terms, definitions and notations	7
3.1 Measurement definitions	7
3.2 Measurement applications	9
3.3 Grid definitions	9
3.4 Stakeholder definitions.....	11
3.5 Notations	13
3.5.1 Abbreviated terms	13
3.5.2 Indices.....	13
4 State-of-the-art measurement applications	13
4.1 General.....	13
4.2 Grid power quality.....	14
4.2.1 General	14
4.2.2 State of the art on measurement to perform.....	14
4.2.3 State of the art on standards	14
4.3 Power monitoring application	15
4.3.1 General	15
4.3.2 Power monitoring application, general	15
4.3.3 Power monitoring application, demand side power quality.....	16
4.4 Billing application.....	17
4.4.1 General	17
4.4.2 State of the art on measurement to perform.....	18
4.4.3 State of the art on standards	18
4.5 Energy management application	19
4.5.1 General	19
4.5.2 Energy management application, cost management.....	19
4.5.3 Energy management application, energy efficiency.....	20
Annex A (informative) Example of electrical installation for a mall.....	22
Annex B (informative) Explanation about measurements performed by PQIs (IEC 62586), PMDs (IEC 61557-12) and analogue meters (IEC 60051 series)	23
B.1 General.....	23
B.2 Differences	23
B.3 Differences between power quality, power monitoring and troubleshooting	24
B.3.1 General	24
B.3.2 Power quality.....	24
B.3.3 Power monitoring.....	24
B.3.4 Troubleshooting.....	24
B.4 Key parameters measured	24
Annex C (informative) Explanation about measurements performed by PMD (IEC 61557-12), IEC 62053-2x, MID	26
Annex D (informative) Explanation about the scope of various standards.....	27
Bibliography.....	28

Figure 1 – Measurement applications within the grid	13
Figure A.1 – Example of shops within a mall, where all shops are final energy users	22
Table 1 – List of main applications	14
Table 2 – Standards for grid power quality application	15
Table 3 – Benefits of measurements for power monitoring application	16
Table 4 – Standards for power monitoring application	16
Table 5 – Standards for demand side power quality application	17
Table 6 – Simplified overview of billing application.....	18
Table 7 – Benefits of measurements for billing application	18
Table 8 – Standards for billing application.....	18
Table 9 – Simplified overview of EM/cost management application	19
Table 10 – Benefits of measurements for EM/cost management application.....	19
Table 11 – Benefits of measurements for EM/energy efficiency application.....	20
Table 12 – Benefits of measurements for EM/energy efficiency application in industrial processes	21
Table 13 – Standards for EM/energy efficiency application	21
Table B.1 – Rough comparison between devices	23
Table B.2 – Measurement needs.....	25
Table C.1 – Rough comparison of energy measurement standards	26
Table D.1 – Rough comparison of measurement parameters	27

IECNORM.COM : Click to view the full PDF of IEC TR 63213:2019

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**POWER MEASUREMENT APPLICATIONS WITHIN ELECTRICAL
DISTRIBUTION NETWORKS AND ELECTRICAL INSTALLATIONS**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. However, a technical committee may propose the publication of a Technical Report when it has collected data of a different kind from that which is normally published as an International Standard, for example "state of the art".

IEC TR 63213, which is a Technical Report, has been prepared by IEC technical committee 85: Measuring equipment for electrical and electromagnetic quantities.

The text of this Technical Report is based on the following documents:

Draft TR	Report on voting
85/662/DTR	85/690/RVDTR

Full information on the voting for the approval of this Technical Report can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

IECNORM.COM : Click to view the full PDF of IEC TR 63213:2019

INTRODUCTION

Utility engineers and facility managers are requesting rich power and energy data from many locations, with guaranteed and reliable accuracy. This data is essential for helping to understand and ensure the reliability, efficiency, and cost effectiveness of their power distribution systems and the energy generated or consumed.

A good understanding of the different kinds of measurement applications is critical to choosing the proper type and capabilities of measuring devices for each location that will deliver the required information.

To achieve these goals, a complete energy measurement plan supported by a network of metering devices.

This report offers an overview of the different categories of measurement applications, with detailed descriptions and illustrations of each, including references to the most relevant international standards.

IECNORM.COM : Click to view the full PDF of IEC TR 63213:2019

POWER MEASUREMENT APPLICATIONS WITHIN ELECTRICAL DISTRIBUTION NETWORKS AND ELECTRICAL INSTALLATIONS

1 Scope

This Technical Report intends to provide state-of-the-art information on the various electricity measurement applications made in the grid (supply side) or in electrical installation (demand side), and on the related standards covering these applications.

This Technical Report does not address measurements made for specific purposes such as protection, control, automation or indication.

2 Normative references

There are no normative references in this document.

3 Terms, definitions and notations

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1 Measurement definitions

3.1.1

power quality instrument PQI

instrument whose main function is to measure, record and possibly monitor power quality parameters in power supply systems, and whose measuring methods (class A or class S) are defined in IEC 61000-4-30

[SOURCE: IEC 62586-1:2017, 3.1.1]

3.1.2

power quality assessment function

power quality functions whose measurement methods are defined in IEC 61000-4-30

[SOURCE: IEC 61557-12:2018, 3.1.2]

3.1.3

energy meter

instrument intended to measure electrical energy by integrating power with respect to time

[SOURCE: IEC 60050-313:2001, 313-01-35]

3.1.4

watt-hour meter
active energy meter
energy meter

instrument intended to measure active energy by integrating active power with respect to time

[SOURCE: IEC 60050-313:2001, 313-06-01, modified – The term "(active) energy meter" has been changed to "active energy meter" and the term "energy meter" has been added to comply with the ISO/IEC Directives Part 2:2018]

3.1.5

var-hour meter
reactive energy meter

instrument intended to measure reactive energy by integrating reactive power with respect to time

[SOURCE: IEC 60050-313:2001, 313-06-02]

3.1.6

power metering and monitoring device
PMD

combination in one or more devices of several functional modules dedicated to metering and monitoring electrical parameters in energy distribution systems or electrical installations, used for applications such as energy efficiency, power monitoring and network performance

Note 1 to entry: Under the generic term "monitoring" are also included functions of recording, alarm management, etc.

Note 2 to entry: These devices may include demand side quality functions for monitoring inside commercial/industrial installations.

[SOURCE: IEC 61557-12:2018, 3.1.1, modified – Note 3 to entry has been deleted.]

3.1.7

revenue meter
utility meter
billing meter
electricity meters for billing

energy meter used to meter energy delivered by an energy supplier and to calculate the related amount of money according to an agreed contract, defining the rate(s) and the time of use

Note 1 to entry: These devices are used to bill or invoice final customers.

3.1.8

rate

amount to be paid per unit purchased (e.g. 1 kWh, 1 kW, 1 kVA)

[SOURCE: IEC 60050-691:1973, 691-11-21]

3.1.9

time of use

segregation of energy rates based on the time in which the energy is being consumed

3.1.10

meter index

non-resettable numerical value representing the total energy measured by the meter

3.2 Measurement applications

3.2.1

grid power quality assessment

process that allows energy suppliers and/or their customers to verify that the quality of energy delivered/received fulfils requirements of a defined contract or regulation

Note 1 to entry: Limits for European public networks are defined in EN 50160.

3.2.2

power monitoring

process that allows a facility manager to monitor its electrical installation in order to ensure availability and reliability of energy as well as durability of electrical equipment.

3.2.3

energy management

process that allows a facility manager to monitor and control the energy consumption according to the uses and the cost of energy within an electrical installation

3.2.4

billing

process that allows energy suppliers or their representatives to invoice their customers according to a defined contract

Note 1 to entry: These applications can be covered by international standards, regulations such as MID in Europe or NMI in Australia, and/or utility specifications.

3.2.5

sub-billing

process that allows a landlord, property management firm, condominium association, homeowner association or other multi-tenant property to spread out invoice over energy users (assign portions of invoice to users), for measured usages or services.

Note 1 to entry: This fee is usually combined with other tenant's facility fees.

Note 2 to entry: The landlord does not commit on the quality of the supply.

3.2.6

cost allocation

process that allows a facility manager to account for energy costs from internal cost centres that consume energy

EXAMPLE: process line, test and inspection, administration.

3.2.7

calculation of tax incentives

process that allows an owner to get incentives from the state, based on measurements showing improvement in energy efficiency, according to a regulation

3.3 Grid definitions

3.3.1

electric power system

electricity supply system

all installations and plant provided for the purpose of generating, transmitting and distributing electricity

[SOURCE: IEC 60050-601:1985, 601-01-01, modified – The term "electricity supply system (in a broad sense)" has been changed to "electricity supply system" in order to comply with the ISO/IEC Directives Part 2:2018.]

3.3.2

generation of electricity

process whereby electrical energy is obtained from some other form of energy

[SOURCE: IEC 60050-601:1985, 601-01-06]

3.3.3

distribution of electricity

transfer of electricity to consumers within an area of consumption

[SOURCE: IEC 60050-601:1985, 601-01-10]

3.3.4

power station

electrical generating station

installation whose purpose is to generate electricity, and which includes civil engineering works, energy conversion equipment and all the necessary ancillary equipment

[SOURCE: IEC 60050-601:1985, 601-03-01]

3.3.5

substation

<of a power system> part of an electrical system, confined to a given area, mainly including ends of transmission or distribution lines, electrical switchgear and control gear, buildings and transformers

Note 1 to entry: The substation can be qualified according to the designation of the system of which it forms a part. Examples: transmission, substation (transmission system), distribution substation, 400 kV or 20 kV substation.

Note 2 to entry: A substation generally includes safety or control devices (for example, protection).

[SOURCE: IEC 60050-601:1985, 601-03-02, modified – In order to comply with the ISO/IEC Directives Part 2:2018, "(of a power system)" has been deleted from the term and added as a domain, and the last sentence of the definition has been moved to Note 2 to entry.]

3.3.6

supply side

part of the grid where electric energy is generated, transmitted and distributed to end-use customers through the public supply network

Note 1 to entry: This definition encompasses micro-grids, decentralised generators or renewable energy generators.

Note 2 to entry: This definition encompasses the electric power system defined in IEC 60050-601:1985, 601-01-01.

[SOURCE: IEC 61557-12:2018, 3.1.3, modified – Note 2 to entry has been added.]

3.3.7

demand side

part of the grid where electric energy is consumed by end-use customers within their electric distribution system

Note 1 to entry: This concept also encompasses prosumers.

[SOURCE: IEC 61557-12:2018, 3.1.4, modified – Note 1 to entry has been added.]

3.3.8

power quality

characteristics of the electric current, voltage and frequencies at a given point in an electric power system, evaluated against a set of reference technical parameters

Note 1 to entry: These parameters might, in some cases, relate to the compatibility between electricity supplied in an electric power system and the loads connected to that electric power system

[SOURCE: IEC 60050-617:2009, 617-01-05]

3.4 Stakeholder definitions

3.4.1

electricity supplier

supplier

energy supplier

party having a contract to supply electric power and energy to a customer

[SOURCE: IEC 60050-617:2009, 617-02-08, modified – The term "energy supplier" has been added.]

3.4.2

final customer

end-use customer

party purchasing electric power for a given interval and energy for its own use

[SOURCE: IEC 60050-617:2009, 617-02-04]

3.4.3

wholesale customer

wholesaler

party purchasing electric power for a given interval and energy for the purpose of their sale inside or outside the electric power system to which the party is connected

[SOURCE: IEC 60050-617:2009, 617-02-03]

3.4.4

owner

landlord

consumer that owns a property

Note 1 to entry: Property management firms, condominium associations, homeowner associations or multi-tenant properties are considered to be owners.

3.4.5

tenant

consumer that rents a property from an owner or a landlord

3.4.6

final energy user

user of energy-consuming assets located in individual units of multi-apartment or multi-purpose buildings, where such units are supplied from a central source, and where energy is not purchased, but inclusive or reimbursed

Note 1 to entry: Examples of final energy users are:

- service users, where energy cost is usually included in the service itself, e.g. hotel customers;
- mall shops, where energy cost is usually included in reimbursement fees, in the framework of a flat rate pricing contract, based on steady figures such as surfaces or volumes;

- colocation data centres, where energy cost is usually included in reimbursement fees, in the framework of a sub-metering pricing contract.

3.4.7

facility manager

party that operates, maintains and secures a facility or a plant

3.4.8

cost centre

defined department, division, or unit of an organization, or alternatively area, machine, or person to whom direct and indirect costs can be allocated

3.4.9

contract

document agreed between two or more parties and committing both parties

3.4.10

commercial transaction

trading transaction

interaction between two or more parties in which goods, services or something of value is exchanged for some type of remuneration, resulting in the issuance of an invoice

Note 1 to entry: A transaction that consists in dividing an invoice between parties without any profit is not considered as a commercial transaction.

3.4.11

incentive

inducement or supplemental reward that serves as a motivational means for a desired action or behaviour

3.4.12

dispute

disagreement followed by opposition against something

3.4.13

invoice

bill

non-negotiable commercial instrument issued by a seller to a buyer that identifies both the trading parties and defines the items sold, shows the date of shipment and mode of transport, prices and discounts (if any), and delivery and payment terms

3.4.14

reimbursement fee

portion of an invoice in contracts based on cost reimbursement pricing

Note 1 to entry: In sub-metering pricing contracts, the portion is calculated according to metered figures, e.g. a measured consumption of electrical energy.

Note 2 to entry: In flat rate pricing contracts, the portion is calculated according to steady figures, e.g. a shop surface.

Note 3 to entry: Each invoice (related to electricity, gas water, cleaning, services, etc.) can be spread out between final energy users. The sum of each fee results into "fees".

3.4.15

prosumer

network user that consumes and produces electrical energy

[SOURCE: IEC 60050-617:2009,617-02-16]

3.5 Notations

3.5.1 Abbreviated terms

N.R. Not requested

N.A. Not applicable

3.5.2 Indices

min minimum value

max maximum value

4 State-of-the-art measurement applications

4.1 General


Power generation, transmission, and distribution are typically terms of the "supply side". Within this side, there are two main categories of contractual applications:

- BIL: billing application
- GPQ: grid power quality monitoring application

Industrial, commercial, and institutional facilities represent the demand side of energy. For these users, electrical system designers shall specify solutions within two categories of application:

- EM: energy management applications (cost allocation, bill checking, sub-billing, energy efficiency and cost savings, energy usage analysis).
- PM: power monitoring (power availability and reliability, network monitoring).

These categories of application are illustrated in Figure 1:

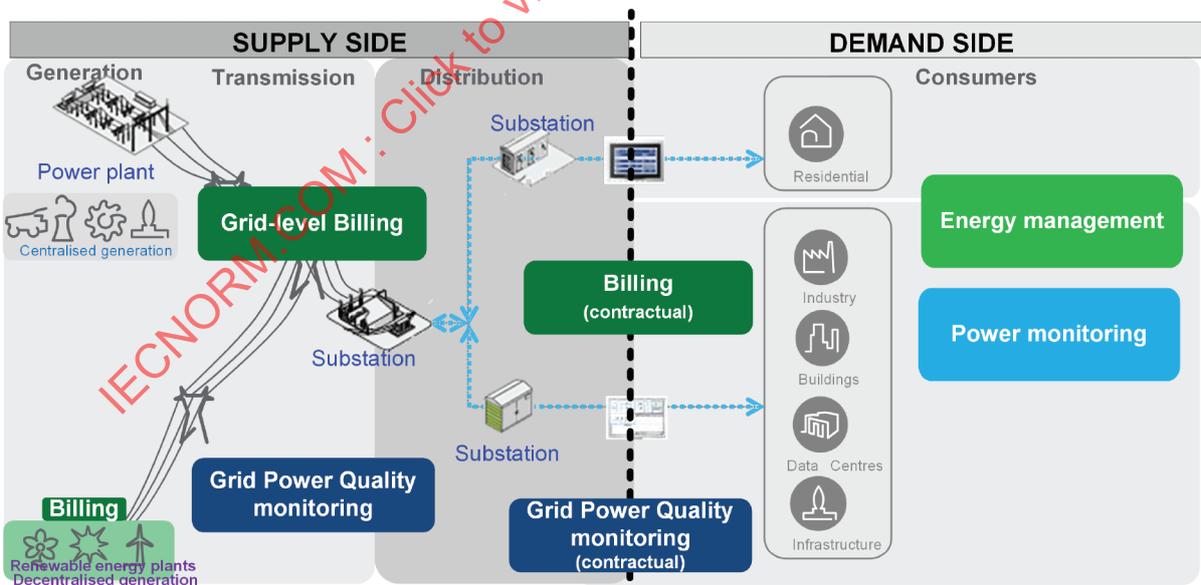

IEC

Figure 1 – Measurement applications within the grid

Table 1 provides a definition of the main applications.

Table 1 – List of main applications

Type	Application	Purpose	Stakeholder
GPQ	Grid power quality monitoring	to verify the quality of energy delivered/received fulfils requirements of a defined contract or regulation. For example, limits for European public networks are defined in EN 50160.	Energy suppliers and/or their customers
PM	Power monitoring, network monitoring, facility planning.	to monitor its electrical installation in order to ensure availability and reliability of energy as well as durability of electrical equipment.	Facility manager
BILL	Billing	to invoice customers according to a defined contract regarding their energy consumption, for measured usage or services. These applications can for example be covered by international standards or covered by regulations such as MID in Europe or NMI in Australia most often in addition to utility specifications.	Energy suppliers or their representatives
EM	Energy management	to monitor and control the energy consumption according to the uses and the cost of energy within an electrical installation.	Facility managers

4.2 Grid power quality

4.2.1 General

According to relevant standards (see Table 2), class A power quality measurements are suitable for contractual applications that can require resolving disputes and verifying compliance with standards.

Class S power quality measurements are used for statistical applications such as surveys or power quality assessment.

4.2.2 State of the art on measurement to perform

The class of power quality measurements should be selected based on the applicable regulations, assessment rules, and the scope of the survey.

4.2.3 State of the art on standards

Table 2 specifies the state of the art related to standards.

Table 2 – Standards for grid power quality application

Application assessment standards or rules	Method standards	Usual product standards
<p>EN 50160</p> <p>Voltage characteristics of electricity supplied by public electricity networks</p> <p>IEC/TS 62749</p> <p>Assessment of power quality – Characteristics of electricity supplied by public electricity networks</p>	<p>IEC 61000-4-30^{(a) (c)} class A</p> <p>Testing and measuring techniques – Power quality measurement methods</p>	<p>Power quality instruments (PQI)^(b)</p> <p>IEC 62586-1</p> <p>Power quality instruments (PQI)</p> <p>+</p> <p>IEC 62586-2^(a)</p> <p>Functional tests and uncertainty requirements</p>
<p>(a) Compliance with IEC 62586-2 means compliance with IEC 61000-4-30</p> <p>(b) Usually, energy providers are checking the power quality they deliver to users with a PQI-A, and energy users are checking the power quality they receive from energy providers with a PQI-A.</p> <p>(c) IEC 61000-4-30 provides the following definitions:</p> <p>Class A: this class is used where precise measurements are necessary, for example, for contractual applications that may require resolving disputes, verifying compliance with standards, etc. Any measurements of a parameter carried out with two different instruments complying with the requirements of Class A, when measuring the same signals, will produce matching results within the specified uncertainty for that parameter.</p> <p>Class S: this class is used for statistical applications such as surveys or power quality assessment, possibly with a limited subset of parameters. Although it uses equivalent intervals of measurement as Class A, the Class S processing requirements are much lower. Some surveys may assess power quality parameters of several measurement sites on a network; other surveys assess power quality parameters at a single site over a period of time, or at locations within a building or even within a single large piece of equipment.</p>		

4.3 Power monitoring application

4.3.1 General

Information about the difference between PMDs (compliant with IEC 61557-12 measurement methods) and PQIs (compliant with IEC 62586-1 and 62586-2 and based on IEC 61000-4-30 measurement methods) is provided in Annex B.

4.3.2 Power monitoring application, general

4.3.2.1 General

Power monitoring is recommended to prevent unwanted outages, premature failures of electrical equipment and other abnormal operation of the electrical installation. It is also a tool to improve and to optimize the electrical installation.

4.3.2.2 State of the art on measurements to perform

Table 3 specifies the state of the art related to measurements.

Table 3 – Benefits of measurements for power monitoring application

Electrical quantities to measure	Symbol	Benefits of measurement
Current	I, I_N	Detect overheating or conditions that may lead to nuisance trips.
Voltage	U, V	Detect abnormal supply conditions of sensitive loads (e.g. motors) leading to premature failure.
Frequency	f	Detect abnormal speed of rotating machines.
Individual voltage harmonics, THD_u	U_h, THD_u	Monitor non-positive-sequence harmonics causing overheating of components (motors, transformers, cables, capacitors...), and motor shaft vibrations, resulting in premature failure.
Individual current harmonics, THD_i	I_h, THD_i	
Voltage unbalance	U_{nb}	Monitor non-positive-sequence voltage causing motors and generators to overheat and fail prematurely.
Current unbalance	I_{nb}	
Voltage dips, voltage interruptions Voltage swells	U_{dip}, U_{int} U_{swl}	Detect degradation of supply quality before it leads to process stoppages with financial impact.
Power demand or Current demand	P	Optimize the load distribution, determine where new loads may be placed, or which feeder needs to be upgraded to serve the planned capacity.
Load profiles	LP	Detect abnormal load profiles
Reactive power	Q	Detect abnormal reactive power consumption
Apparent power	S	Detect abnormal apparent power consumption
NOTE In general, it is useful to detect drifts, to log measurements and possibly to alarm if a measurement is out of some specified limits.		

4.3.2.3 State of the art on standards

Table 4 specifies the state of the art related to standards.

Table 4 – Standards for power monitoring application

Application assessment standards or rules	Method standards	Usual product standards
Electrical distribution monitoring, asset management, facility planning	included in IEC 61557-12	<u>PMD (Power Metering and Monitoring Devices)</u> IEC 61557-12 Power metering and monitoring devices (PMD)
	included in IEC 60051 series	<u>Analog electrical measuring instruments</u> IEC 60051 series Direct acting indicating analogue electrical measuring instruments

4.3.3 Power monitoring application, demand side power quality

4.3.3.1 General

Demand side power quality relates to power quality events appearing inside consumer electrical distribution network (see Figure 1), downstream from the utility service entrance.

4.3.3.2 State of the art on measurement to perform

Measurements to perform depend on the kind of plant or network to assess.

4.3.3.3 State of the art on standards

Table 5 specifies the state of the art related to standards.

Table 5 – Standards for demand side power quality application

Application assessment standards or rules	Method standards	Usual product standards
IEC TR 63191 Demand side power quality	included in IEC 61557-12	<u>PMD (Power Metering and Monitoring Devices)</u> IEC 61557-12 Power Metering and Monitoring devices (PMD)
	IEC 61000-4-30 ^(a) class S or class A Testing and measuring techniques – Power quality measurement methods	<u>Power quality instruments (PQI-S^(b) or PQI-A)</u> IEC 62586-1 Power quality instruments (PQI) + IEC 62586-2^(a) Functional tests and uncertainty requirements
^(a) Compliance with IEC 62586-2 means compliance with IEC 61000-4-30. ^(b) Usually PQI-S are used for this purpose.		

4.4 Billing application

4.4.1 General

Legal metrology requirements usually cover billing applications, to ensure a fair trading, by:

- protecting consumers:
 - preventing consumers from being over-invoiced;
 - give consumers a way to verify that the invoice index is consistent with the meter index displayed on the meter.
- protecting energy suppliers against unintentional misuses or fraudulent uses of the meter, usually installed in customer premises.

Table 6 shows a simplified overview of the billing application.

Table 6 – Simplified overview of billing application

Application	Interaction between:		2nd party needs to access the energy index displayed on the meter operating in his premises?	Transaction	
	1 st party	2 nd party		Profit on kWh price	Money exchange mean
Billing	Energy supplier ^a	Final customer	Yes, in order to let the 2 nd party verify his invoice in comparison with the meter index	Yes ^b	Invoice (commercial transaction, including state taxes, e.g. VAT)
^a Billing is also covering the case of energy resale (e.g. through a wholesaler) ^b Profit is usually made on the kWh price (this rate can be different for each time of use). NOTE Billing is part of legal metrology applications, these applications usually require a meter that is approved by an accredited test laboratory, and/or a government legal metrology agency.					

4.4.2 State of the art on measurement to perform

Table 7 specifies the state of the art related to measurements.

Table 7 – Benefits of measurements for billing application

Electrical quantities to measure	Symbol	Benefits of measurement
Active energy	E_a	Calculate energy consumption per time of use.
Reactive energy	E_r	Calculate energy consumption per time of use.
Demand active power	P_{demand}	Calculate the active power demand
NOTE 1 There can be other electrical billing quantities such as demand, cos phi, PF, THD, etc. used for direct billing or penalties, especially where a contract with a utility is involved. NOTE 2 There can be billing based on quadrant measurements.		

4.4.3 State of the art on standards

Table 8 specifies the state of the art related to standards.

Table 8 – Standards for billing application

Application assessment standards or rules or regulation	Methods standards	Usual product standards for revenue meter, utility meter, billing meter, billing electricity meters
Any countries can define its own regulation and/or can refer to international standards.	---	IEC 62052-11 and IEC 62053-2x
European regulation (MID Measuring Instruments Directive)	---	EN 50470
US state regulations	---	ANSI C12
Australian regulation	---	NMI M 6
NOTE This list of standards is far from being exhaustive		

4.5 Energy management application

4.5.1 General

The main applications for energy management concern the management of energy costs and the optimization of electrical consumptions. PMD complying with IEC 61557-12 are recommended for energy management applications owing to additional useful embedded features. PMDs are able to operate in harsh environmental conditions (especially those of switchboards, panels and cubicles).

4.5.2 Energy management application, cost management

4.5.2.1 General

Table 9 shows a simplified overview of EM/cost management application.

Table 9 – Simplified overview of EM/cost management application

Application	Interaction between:		2nd party needs to access the energy index displayed on the meter operating in his premises?	Transaction	
	1 st party	2 nd party		Profit on kWh price	Money exchange mean
Cost allocation	Final customer	Cost centre managed by the final customer	No, the meter is usually installed in the 1 st party premises ^a	No	No money exchange
Sub-billing	Final customer	Final energy user	No, the meter is usually installed in the 1 st party premises ^{a b}	No ^b	Fee (combined with other fees)

^a When the meter is located within a switchboard, a panel or a cubicle, usually the meter display cannot be accessed for safety reasons, except by the facility manager. The meter index is then transmitted to a remote system via a communication line.

^b In case of profit on kWh price, the first party would become a wholesaler, it would then not be a sub-billing application anymore.

An example of sub-billing application is provided in Annex A.

4.5.2.2 State of the art on measurement to perform

Table 10 specifies the benefits of measurements for EM/cost management application.

Table 10 – Benefits of measurements for EM/cost management application

Electrical quantities to measure	Symbol	Benefits of measurement
Active energy	E_a	Calculate energy consumption per time of use.
Reactive energy	E_r	Calculate energy consumption per time of use.
Apparent energy	E_{ap}	Calculate energy consumption per time of use.
Power, power demand	P	Better control the demand in order to optimize the supply contract.
Power factor	$PF, \cos\varphi$	Optimize power factor to avoid penalties.

NOTE These measurements are usually performed in combination with other applications, e.g. power monitoring or energy efficiency.

4.5.2.3 State of the art on standards

Legal metrology requirements usually apply to billing applications (see 4.4) for the measurement of active energy, in the framework of a commercial transaction between an energy supplier and a final consumer.

For other applications, PMDs complying with IEC 61557-12 are recommended.

In some countries, IEC 62053-2x may be also be recommended even though this set of standards specifies requirement only for active and reactive energy measurement. IEC 61557-12 provides requirements for all electrical measurements (U, I, P, PF, THD...).

Annex C and Annex D provide information about IEC 61557-12 and IEC 62053-2x standards.

4.5.3 Energy management application, energy efficiency

4.5.3.1 General

Energy efficiency management concerns the optimization of electrical consumptions, one goal being the reduction of the global electrical energy cost.

4.5.3.2 State of the art on measurement to perform

Table 11 specifies the benefits of measurements.

Table 11 – Benefits of measurements for EM/energy efficiency application

Electrical quantities to measure	Symbol	Benefits of measurement
Active energy	E_a	Monitor energy and manage costs more closely, by zone and/or usage.
Reactive energy	E_r	Monitor energy and manage costs more closely, by zone and/or usage. Monitor the operation of reactive loads e.g. motors, transformers, capacitors.
Power, power demand	P	Better control the demand in order to optimize the supply contract.
Power factor	$PF, \cos\phi$	Optimize power factor to avoid penalties.
Load profiles (energy consumption)	LP	Optimize the supply contract
NOTE One intent of energy efficiency is to optimize the supply contract and to avoid penalties.		

In the framework of an industrial process, other factors part of power monitoring can contribute to the EE assessment, see IEC 60364-8-1. Table 12 specifies the benefits of measurements.

Table 12 – Benefits of measurements for EM/energy efficiency application in industrial processes

Electrical quantities to measure	Symbol	Benefits of measurement
Voltage harmonics	THD_u	Detect non-positive-sequence harmonics causing excessive energy losses in motors or transformers.
Current harmonics	THD_i	
Frequent deviations of voltage	U	Detect devices frequently operating outside their specified range and over consuming energy.
Voltage unbalance	U_{nb}	Detect non-positive-sequence components causing excessive energy losses in motors.

4.5.3.3 State of the art on standards

Table 13 specifies the state of the art related to standards.

Table 13 – Standards for EM/energy efficiency application

Methodology standards or Rules (for an organisation, e.g. a plant, commercial building, ...)	Application standards (applicable to a plant, commercial building, ...)	Usual product standards
<p>ISO 50001 Energy management systems – Requirements with guidance for use</p> <p>Green labels for buildings (LEED, BREEAM, HQE, E+C-, DGNB, Passivhaus, Title24, Minergie, ...)</p>	<p>ISO 50006 Energy Baseline (EnBs) & Energy Performance Indicators (EnPis)</p> <p>IEC 60364-8-1 Low voltage installations – Part 8-1: Energy Efficiency</p> <p>EN 17267 Energy measurement and monitoring plan: Design and implementation</p> <p>EN 50600-2-2 Information technology – Data centre facilities and infrastructures – Part 2-2: Power distribution</p>	<p><u>PMD (Power Metering and Monitoring Devices)</u> IEC 61557-12 Power metering and monitoring devices (PMD)</p> <p><u>Gateways, energy servers, data loggers</u> IEC 62974-1 Monitoring and measuring systems used for data collection, gathering and analysis – Part 1: Device requirements</p>
<p>NOTE Energy efficiency and cost savings, energy usage analysis is the process that allows a facility manager to assign energy consumption/costs to zones (plant, floor, workshop...) and to usages (HVAC, lighting, appliances, process...) over the time in order to allow optimization of energy consumption and energy costs.</p>		

Annex A (informative)

Example of electrical installation for a mall

Figure A.1 provide examples of distribution systems within a mall with shops.

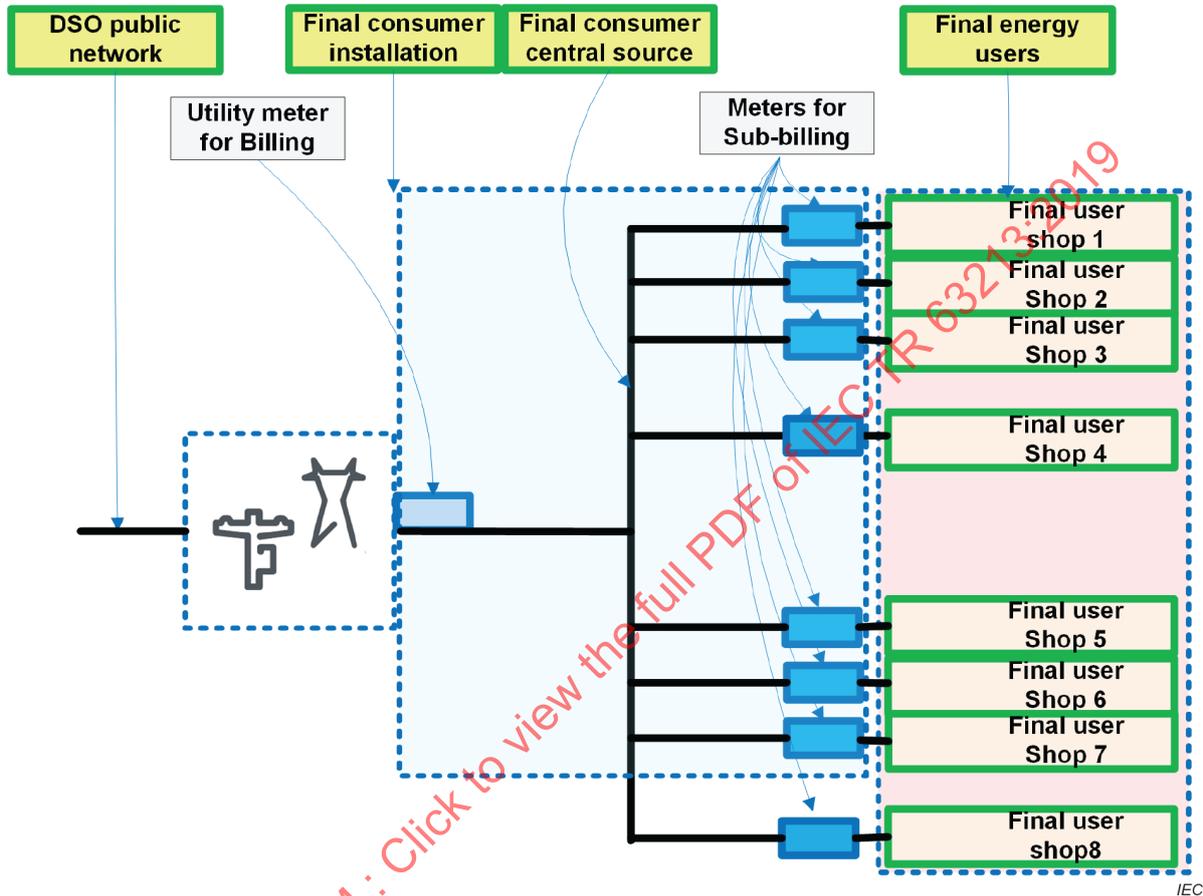


Figure A.1 – Example of shops within a mall, where all shops are final energy users

Annex B (informative)

Explanation about measurements performed by PQIs (IEC 62586), PMDs (IEC 61557-12) and analogue meters (IEC 60051 series)

B.1 General

For a simple parameter such as voltage, 2 different meters can provide 2 different measurement results, depending on the measurement method used by the meter:

- the measurement time (e.g. is measurement resulting from a 20 ms sampling time period, or from a 1 s sampling time period?);
- the measurement method (e.g. is THD based on an arithmetic measurement or on a vector measurement?).

Measurement may be identical in steady-state conditions, but it may happen to be drastically different in other conditions. The below study aims at specifying the main differences between devices.

B.2 Differences

Table B.1 provides a rough comparison of devices with power measurement functions.

Table B.1 – Rough comparison between devices

Criteria for comparison	Product standards			
	PQI-A acc to IEC 62586-1	PQI-S acc to IEC 62586-1	PMD acc to IEC 61557-12	Analog meters acc to IEC 60051 series
Device price	++++	+++	++	+
Repeatability	2 instruments will provide comparable results ^a	2 instruments will provide similar results ^b	2 instruments will provide similar results for steady states ^c	2 instruments will provide similar visual results for steady states ^d
Accuracy	As specified in IEC 61000-4-30 class A	As specified in IEC 61000-4-30 class S	As designed among the list of classes defined in IEC 61557-12	As designed among the list of classes defined in IEC 60051 series
Grid power quality assessment (EN 50160, IEC/TS 62479, ...)	Mandatory in contractual applications	---	---	---
Grid power Quality survey	Possible	Best compromise between cost and functions	---	---
Demand side power quality	Possible	Best compromise between cost and functions	Possible	---
Power monitoring or problem identification	Possible	Possible	Best compromise between cost and functions	Possible
Troubleshooting	Best compromise between cost and functions	Possible	Possible	---

NOTE 1 Class A measurement methods are all fully specified

NOTE 2 Class S measurement methods are for the most fully specified, but some parts depend on manufacturer implementations.

NOTE 3 IEC 61557-12 measurement methods are, for the most, well specified, but some parts depend on manufacturer implementations

NOTE 4 IEC 60051 series measurement methods are, for the most, roughly specified