

TECHNICAL SPECIFICATION



**Recommendations for small renewable energy and hybrid systems for rural
electrification –
Part 1: General introduction to rural electrification**



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2003 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.

Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland
Email: inmail@iec.ch
Web: www.iec.ch

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: www.iec.ch/searchpub

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: www.iec.ch/online_news/justpub

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.

- Customer Service Centre: www.iec.ch/webstore/custserv

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: csc@iec.ch
Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00

IECNORM.COM : Click to view the full PDF of IEC 62257-1:2003

TECHNICAL SPECIFICATION



**Recommendations for small renewable energy and hybrid systems for rural electrification –
Part 1: General introduction to rural electrification**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

PRICE CODE



ICS 27.160; 27.180

ISBN 2-8318-7162-X

CONTENTS

| | |
|--|----|
| FOREWORD | 3 |
| INTRODUCTION | 5 |
| 1 Scope and overview | 6 |
| 2 Normative references | 6 |
| 3 Terms, definitions and abbreviations | 7 |
| 4 Rural electrification: which solution to choose? | 8 |
| 5 Decentralized electrification requires a range of systems | 9 |
| Figure 1 – Example of electrification progress following a master plan methodology | 9 |
| Table 1 – Some advantages and disadvantages of the proposed single and multiple user systems | 10 |

IECNORM.COM : Click to view the full PDF of IEC TS 62257-1:2003

Without watermark

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**RECOMMENDATIONS FOR SMALL RENEWABLE ENERGY
AND HYBRID SYSTEMS FOR RURAL ELECTRIFICATION –****Part 1: General introduction to rural electrification**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. In exceptional circumstances, a technical committee may propose the publication of a technical specification when

- the required support cannot be obtained for the publication of an International Standard, despite repeated efforts, or
- the subject is still under technical development or where, for any other reason, there is the future but no immediate possibility of an agreement on an International Standard.

Technical specifications are subject to review within three years of publication to decide whether they can be transformed into International Standards.

IEC 62257-1, which is a technical specification, has been prepared by IEC technical committee 82: Solar photovoltaic energy systems. It was developed in cooperation with other IEC technical committees and subcommittees dealing with renewable energies and related matters, namely technical committee 21 ("Secondary cells and batteries"), subcommittee 21A ("Secondary cells and batteries containing alkaline or other non-acid electrolytes"), technical committee 64 ("Electrical installations and protection against electric shock"), technical committee 88 ("Wind turbines"), and others.

This document is based on IEC/PAS 62111; it cancels and replaces the relevant parts of IEC/PAS 62111.

This technical specification shall be used in conjunction with the other documents of the IEC 62257 series.

The text of this technical specification is based on the following documents:

| | |
|---------------|------------------|
| Enquiry draft | Report on voting |
| 82/300/DTS | 82/318/RVC |

Full information on the voting for the approval of this technical specification can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

The committee has decided that the contents of this publication will remain unchanged until 2006. At this date, the publication will be

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

A bilingual edition of this publication may be issued at a later date.

IMPORTANT – The “colour inside” logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this publication using a colour printer.

INTRODUCTION

Rural electrification is one of the predominant policy actions designed to increase the well-being of rural populations together with improved healthcare, education, personal advancement and economical development.

The present document introduces general considerations on rural electrification and the IEC 62257 series. This series intends to provide to different players involved in rural electrification projects documents for the setting up of low voltage renewable energy and hybrid systems.

IECNORM.COM : Click to view the full PDF of IEC TS 62257-1:2003
Withdrawn

RECOMMENDATIONS FOR SMALL RENEWABLE ENERGY AND HYBRID SYSTEMS FOR RURAL ELECTRIFICATION –

Part 1: General introduction to rural electrification

1 Scope and overview

Rural electrification is one of the predominant policy actions designed to increase the well being of rural populations together with improved healthcare, education, personal advancement and economical development. Rural electrification can be completed through connection to a national or regional electrification grid. This document applies to cases where the grid is too far away (too costly) or the individual demand centres are too small to make grid access economic, where autonomous power systems may be used to supply these services.

This series of documents intends to provide to different players involved in rural electrification projects (such as project developers, project implementers, installers, etc.) documents for the setting up of renewable energy and hybrid systems with AC voltage below 500 V, DC voltage below 50 V and power below 50 kVA.

These documents are recommendations:

- a) to choose the right system for the right place,
- b) to design the system,
- c) to operate and maintain the system.

These documents are focused only on rural electrification concentrating on but not specific to developing countries. They must not be considered as all inclusive to rural electrification. The documents try to promote the use of renewable energies in rural electrification; they do not deal with clean mechanisms development at this time (CO₂ emission, carbon credit, etc.) Further developments in this field could be introduced in future steps.

This consistent set of documents is best considered as a whole with different parts corresponding to items for safety, sustainability of systems and at the lowest life cycle cost as possible. One of the main objectives is to provide the minimum sufficient requirements, relevant to the field of application that is: small renewable energy and hybrid off-grid systems.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 62257-2, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 2: From requirements of users to a range of electrification systems* ¹

IEC 62257-3, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 3: Project development and management* ²

¹ To be published.

² Under consideration.

IEC 62257-4, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 4: System selection and design*³

IEC 62257-5, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 5: Safety rules*³

IEC 62257-6, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 6: Acceptance, operation, maintenance and replacement*³

IEC 62257-7, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 7: Technical specifications: generators*³

IEC 62257-8, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 8: Technical specifications: batteries and converters*³

IEC 62257-9, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 9: Technical specifications: integrated systems*³

IEC 62257-10, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 10: Technical specifications: energy manager*³

IEC 62257-11, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 11: Technical specifications: considerations for grid connection*³

IEC 62257-12, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 12: Other topics*³

3 Terms, definitions and abbreviations

For the purposes of the IEC 62257 series, the following terms, definitions and abbreviations apply.

3.1

REN

renewable energy

3.2

hybrid system

multi-sources system

3.3

dispatchable power system

source, generator, system is dispatchable if delivered power is available at any specified time (for example, a genset is a dispatchable system, REN generator is a non-dispatchable power system)

3.4

non-dispatchable power system

a non dispatchable system is resource dependent; power might not be available at a specified time

³ Under consideration.

3.5**storage**

storage of energy produced by one of the generator of the system and which can be reconverted through the system to electricity

3.6**micropower plant**

power plant that produces less than 50 kVA through the use of a single resource or hybrid system

3.7**microgrid**

grid that transfers a capacity level less than 50 kVA and powered by a micropower plant

3.8**Individual Electrification System****IES**

micropower plant system that supplies electricity to one consumption point usually with a single energy resource point

3.9**Collective Electrification System****CES**

micropower plant and microgrid that supplies electricity to multiple consumption points using a single or multiple energy resource points

4 Rural electrification: which solution to choose?

When developing a policy of electrification for a given country or region, there is a requirement to envision the target situation in the medium term (10 years) and long term (20 to 30 years). This means that a "master plan" for electrifying the country or this region should preferably be constructed in order to define the lowest life cycle cost solution. Essentially, this master plan must take into account both grid extension and autonomous systems solutions.

The master plan should allow selection between two modes of electrification (national/regional grids or decentralized system) and also, to determine the most suitable time frame to execute the work. Regarding the decentralized part, each village needs to be investigated to obtain a variety of sociological, economical and geophysical data. With this approach, the demand needs can be assessed for each village. This assessment should include possible changes in the power requirements as a function of the future economical development for each village. The urban development and the demographic characteristics of each village are also important to determine the best electrification solution and to assess the amount of capital investment needed.

Electrification can be achieved by installing decentralized systems if at some points the community can be (economically) interconnected. Provision can also be made for the integration or relocation of such systems. Obviously, the solution of using both a local (grid) and dispersed RE sources generation may be appropriate.

Geographical Information Systems (GIS) are readily available off-the-shelf today and allow a beneficial and useful graphical presentation of the master plan. In such a representation, each village can be identified on an appropriate map with color codes depicting the corresponding type of power supply.

Furthermore in such a master plan, villages can be prioritized for further scheduling of the electrification work on a yearly or 5 year basis. In this process, the cost effectiveness of the electrification per village would be taken as one of the most significant prioritizing criteria.

This criterion is less important in the developed world but is critical in developing countries. Simulations can also be made by varying all the relevant parameters to allow a comprehensive financial analysis of the selected system. Figure 1 is an illustration of electrification progress following such a master plan methodology.

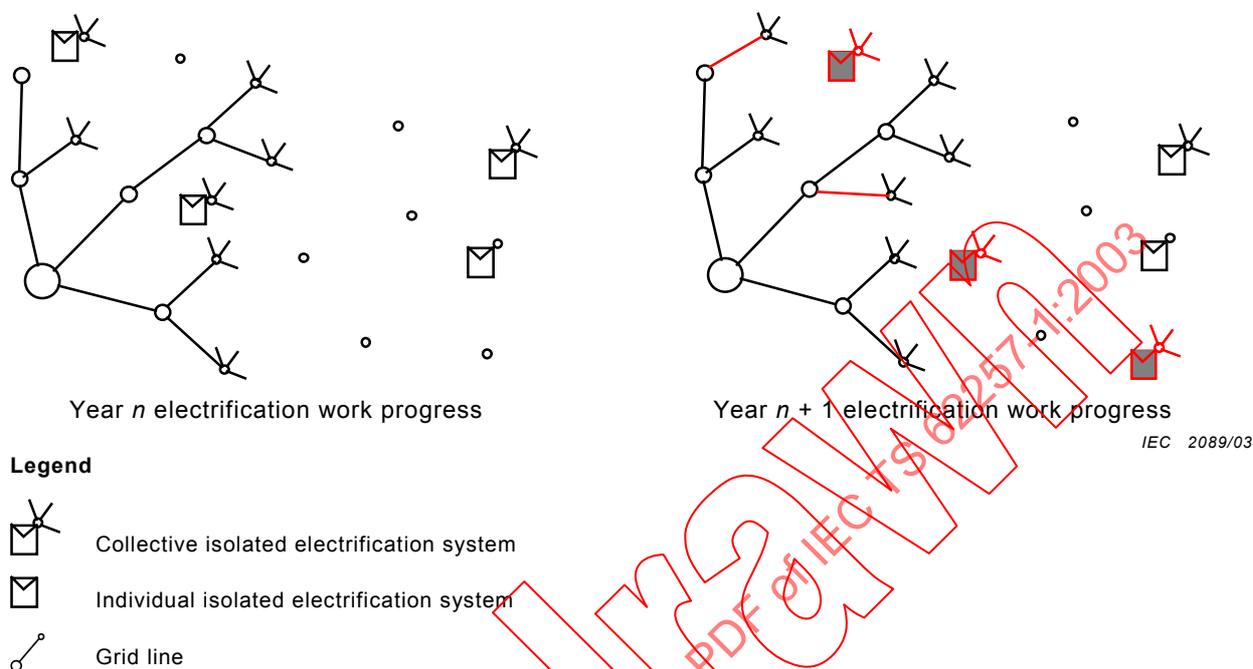


Figure 1 – Example of electrification progress following a master plan methodology

5 Decentralized electrification requires a range of systems

Rural electrification using decentralized systems are designed to supply power to demand points located in rural areas that cannot be easily (economically) connected to national grids.

In most cases, these consumption points would consist of the following types of demand:

- specific processes (for example public pumping, battery charging center),
- isolated homes,
- collective facilities (for example public lighting, schools, health and care center, places of worship, administrative buildings, etc.),
- business activities (for example workshop, micro industry, trade, etc.).

The decentralized system solution can have two basic topologies: Collective Electrification Systems (CES) which supply electricity to multiple consumption points using a single (or multiple energy resource points) and Individual Electrification Systems (IES) which supply electricity to one consumption point (usually with a single energy resource point).

CES systems may be appropriate for rural, relatively highly populated areas, for example, large villages whereas the IES may be appropriate for more sparsely populated regions and (or) isolated households.

Individual Electrification Systems (IES) for single users would incorporate two subsystems:

- one electrical power production subsystem,
- one subsystem for utilizing this electrical power.

Collective Electrification Systems (CES) for multiple users on the other hand would incorporate three subsystems:

- an electrical power production subsystem,
by convention, this part is designated “micropower plant” where ‘micro’ refers to a modest production power level (from a few kVA to a few tens kVA),
- a secondary grid for sharing/distributing this power,
by convention, this part is designated “microgrid” where the prefix ‘micro’ refers to a modest transit capacity level,
- one demand subsystem including the in house wiring and user’s electrical appliances.

The decision whether to utilize a CES or IES can be decided upon by looking at the two technological solutions and calculating the discounted costs. Such an analysis, however, must take into account the pertinent sociological and cultural aspects.

The final decision may also be influenced by other considerations, for example, the daily operating time. Simply designed systems making use of small gensets and a microgrid is required for sharing and distributing power among the users. Typically, gensets often are run for limited periods of time during the day, for example between 7 p.m. and 10 p.m.

The use of hybrid micropower plants can allow for a better reliability of the supply. Power is produced by renewable energy sources when available and stored in batteries. Power can be made available to the microgrid during a greater part of the day or even all day. Additional power may be supplied from the genset when renewable energies are insufficient.

In many developing countries, there is often a very low demand of electricity in rural households and a concurrent limited capacity for payment. The individual users requirements typically range between a few tens and a few thousands Wh/day. In developed countries, energy requirements may be larger as is the expected quality of service.

With very scattered houses, the IES solution may be the obvious choice. If the individual electricity demand is low, the cost of such small systems can also be relatively low – provided the systems can be produced in large quantities. Table 1 shows some of the advantages and disadvantages of collective and individual systems.

Table 1 – Some advantages and disadvantages of the proposed single and multiple user systems

| | Advantages | Disadvantages |
|---|---|--|
| Individual Electrification Systems (IES) | <ul style="list-style-type: none"> • Power consumption is user managed. Consumption will be user determined from one day to another. • Systems failures imply just only one user. • Systems can be exchanged and returned to manufacturer. | <ul style="list-style-type: none"> • In case of inadequate management of the power, the user will be self impaired. • Failures. • Monitoring individual systems can be expensive and difficult. • Maintenance and repair service are not commonly organized in rural areas especially in developing countries. |
| Collective Electrification Systems (CES) | <ul style="list-style-type: none"> • Power saving can be practiced (possibly) using improved management tools without impairing the reliability of power supply. • Telemetry can be economic for monitoring system status. | <ul style="list-style-type: none"> • No possibility exists of exceeding the subscribed credit of power (assuming an automatic cut off?). • If the central system fails, everybody is cut off. • Systems generally need to be serviced on site. |