

TECHNICAL SPECIFICATION

Recommendations for small renewable energy and hybrid systems for rural electrification –
Part 2: From requirements to a range of electrification systems

IECNORM.COM : Click to view the full PDF of IEC/TS 62257-2:2004



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2004 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.

If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.

Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland
Email: inmail@iec.ch
Web: www.iec.ch

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

- Catalogue of IEC publications: www.iec.ch/searchpub

The IEC on-line Catalogue enables you to search by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, withdrawn and replaced publications.

- IEC Just Published: www.iec.ch/online_news/justpub

Stay up to date on all new IEC publications. Just Published details twice a month all new publications released. Available on-line and also by email.

- Electropedia: www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 20 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary online.

- Customer Service Centre: www.iec.ch/webstore/custserv

If you wish to give us your feedback on this publication or need further assistance, please visit the Customer Service Centre FAQ or contact us:

Email: csc@iec.ch
Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00

IECNORM.COM : Click to view the full PDF of IEC TS 62257-2:2004

TECHNICAL SPECIFICATION

**Recommendations for small renewable energy and hybrid systems for rural electrification –
Part 2: From requirements to a range of electrification systems**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

PRICE CODE **XB**

ICS 27.160; 27.180

ISBN 2-8318-7525-0

CONTENTS

| | |
|---|----|
| FOREWORD..... | 5 |
| INTRODUCTION..... | 7 |
| 1 Scope..... | 8 |
| 2 Normative references..... | 8 |
| 3 Terms and definitions | 9 |
| 4 Methodology for non technical preliminary studies..... | 10 |
| 4.1 Place and role of preliminary studies in a decentralized rural electrification project..... | 10 |
| 4.2 Specifications of the preliminary study | 10 |
| 4.3 The stages of a socio-economic study..... | 15 |
| 5 Classification of electrification systems | 15 |
| 5.1 Introduction to a range of systems | 15 |
| 5.2 Users requirements | 16 |
| 5.3 Typology of qualitative requirements | 16 |
| 5.4 Typology of quantitative requirements | 17 |
| 5.5 Classification for electricity services provided..... | 18 |
| 5.6 Assisted selection of production subsystem | 18 |
| 5.7 Typology of decentralized electrification systems | 18 |
| 6 Electrification systems architecture..... | 21 |
| 6.1 General | 21 |
| 6.2 General presentation of isolated electrification systems..... | 21 |
| 6.3 Combining subsystems | 22 |
| 6.4 Functional diagrams..... | 24 |
| 6.5 Related references | 25 |
| 6.6 Limits between production, distribution and demand/application subsystems | 25 |
| 6.7 Summary of the different electrification system types | 25 |
| Annex A (informative) Stages of a socio-economic study (see Clause 4)..... | 26 |
| A.1 General | 26 |
| A.2 Preparation phase | 26 |
| A.3 Drawing up of the questionnaires, choice of surveyors and choice of sample..... | 27 |
| A.4 Conducting the survey - Analysis of the results..... | 27 |
| A.5 Extrapolation of the results | 27 |
| Annex B (informative) Analysis of the type of receivers installed versus types of use and demonstrating reasonable variability (where applicable) (see Clause 5)..... | 28 |
| B.1 Domestic use..... | 28 |
| B.2 Analysis of the type of receivers versus usage types | 30 |
| Annex C (informative) Supply quality indicators for isolated electrification systems (see Clause 5)..... | 32 |

| | |
|--|----|
| Annex D (informative) Assisted selection of production subsystem (see Clause 5) | 34 |
| D.1 Characteristics of possible production subsystems | 34 |
| D.2 Assisted selection of a decentralized production system suited to the requirement..... | 34 |
| | |
| Annex E (informative) Functional diagrams (See Clause 6)..... | 36 |
| E.1 Glossary of symbols..... | 36 |
| E.2 Architectures of systems | 37 |
| | |
| Figure 1 – Example of the content of a non technical preliminary study | 11 |
| Figure 2 – Systems architecture and dispatchable energy | 19 |
| Figure 3 – General configuration of an electrification system..... | 23 |
| Figure A.1 – Flowchart of the stages of a socio economic study..... | 26 |
| Figure D.1 – Better adequacy of production subsystems solutions with supply availability and daily duration of service | 35 |
| Figure E.1 – Type T ₁ I-a system | 38 |
| Figure E.2 – Type T ₁ I-b system | 39 |
| Figure E.3 – Type T ₁ I-c system | 40 |
| Figure E.4 – Type T ₁ I-d system | 41 |
| Figure E.5 – Type T ₂ I system | 43 |
| Figure E.6 – Type T ₃ I-a system | 45 |
| Figure E.7 – Type T ₃ I-b system | 46 |
| Figure E.8 – Type T ₄ I system | 48 |
| Figure E.9 – Type T ₅ I system | 49 |
| Figure E.10 – Type T ₆ I system | 50 |
| Figure E.11 – General architecture of a micropower plant supplying a microgrid | 52 |
| Figure E.12 – Type T ₂ C system | 53 |
| Figure E.13 – Type T ₃ C-a system | 55 |
| Figure E.14 – Type T ₃ C-b system | 56 |
| Figure E.15 – Type T ₄ C-a system | 58 |
| Figure E.16 – Type T ₄ C-b system | 59 |
| Figure E.17 – Type T ₅ C system | 61 |
| Figure E.18 – Type T ₆ C system | 63 |
| | |
| Table 1 – Application types and types of uses..... | 16 |
| Table 2 – Expected quality of the supply..... | 17 |
| Table 3 – Synthesis of quantitative requirements/category (examples of type of user and use) | 17 |
| Table 4 – Typology of decentralized electrification systems..... | 18 |
| Table 5 – Preliminary range of relevant (as a minimum) decentralized electrification systems | 20 |
| Table 6 – Recapitulation of characteristics of different types of isolated electrification systems | 25 |
| Table C.1 – Combined categorization | 32 |
| Table C.2 – Service specification (example) | 33 |

| | |
|---|----|
| Table D.1 – Principles and characteristics of production subsystems | 34 |
| Table E.1 – Glossary of symbols | 36 |
| Table E.2 – List of cases, type T ₁ I | 37 |
| Table E.3 – List of cases, type T ₃ I | 44 |
| Table E.4 – List of cases, type T ₃ C | 54 |
| Table E.5 – List of cases, type T ₄ C | 57 |

IECNORM.COM : Click to view the full PDF of IEC TS 62257-2:2004

Withdrawn

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**RECOMMENDATIONS FOR SMALL RENEWABLE ENERGY
AND HYBRID SYSTEMS FOR RURAL ELECTRIFICATION –****Part 2: From requirements to a range of electrification systems**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC provides no marking procedure to indicate its approval and cannot be rendered responsible for any equipment declared to be in conformity with an IEC Publication.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. In exceptional circumstances, a technical committee may propose the publication of a technical specification when

- the required support cannot be obtained for the publication of an International Standard, despite repeated efforts, or
- the subject is still under technical development or where, for any other reason, there is the future but no immediate possibility of an agreement on an International Standard.

Technical specifications are subject to review within three years of publication to decide whether they can be transformed into International Standards.

IEC 62257-2, which is a technical specification, has been prepared by IEC technical committee 82: Solar photovoltaic energy systems.

This technical specification is to be used in conjunction with IEC 62257 series.

The text of this technical specification is based on the following documents:

| | |
|---------------|------------------|
| Enquiry draft | Report on voting |
| 82/302/DTS | 82/320/RVC |

Full information on the voting for the approval of this technical specification can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2. It was developed in cooperation with other IEC technical committees and subcommittees dealing with renewable energies and related matters, namely technical committee 21 ("Secondary cells and batteries"), subcommittee 21A ("Secondary cells and batteries containing alkaline or other non-acid electrolytes"), technical committee 64 ("Electrical installations and protection against electric shock"), technical committee 88 ("Wind turbines"), and others.

This document is based on IEC/PAS 62111(1999); it cancels and replaces the relevant parts of IEC/PAS 62111.

The committee has decided that the contents of this publication will remain unchanged until 2007. At this date, the publication will be

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

INTRODUCTION

The IEC 62257 series intends to provide to different players involved in rural electrification projects (such as project implementers, project contractors, project supervisors, installers, etc.) documents for the setting up of renewable energy and hybrid systems with AC voltage below 500 V, DC voltage below 50 V and power below 50 kVA.

These documents are recommendations:

- a) to choose the right system for the right place,
- b) to design the system,
- c) to operate and maintain the system.

These documents are focused only on rural electrification concentrating on but not specific to developing countries. They shall not be considered as all inclusive to rural electrification. The documents try to promote the use of renewable energies in rural electrification; they do not deal with clean mechanisms development at this time (CO₂ emission, carbon credit, etc.). Further developments in this field could be introduced in future steps.

This consistent set of documents is best considered as a whole with different parts corresponding to items for safety, sustainability of systems and at the lowest life cycle cost as possible. One of the main objectives is to provide the minimum sufficient requirements, relevant to the field of application that is: small renewable energy and hybrid off-grid systems.

The purpose of this part of the IEC 62257 series is to propose a range of renewable energy based electrification systems able to meet the requirements of customers identified in the field of decentralized rural electrification projects.

IECNORM.COM : Click to view the full PDF file of IEC 62257-2:2004

RECOMMENDATIONS FOR SMALL RENEWABLE ENERGY AND HYBRID SYSTEMS FOR RURAL ELECTRIFICATION –

Part 2: From requirements to a range of electrification systems

1 Scope

The scope of this part of the IEC 62257 series is to propose a methodological approach for the setting up and carrying out of socio-economic studies as part of the framework of decentralized rural electrification projects. It is addressed to project teams and in particular to experts in charge of socio-economic studies in international projects.

The amount of detail gathered and the requisite number of experts needed would depend on the scale of the proposed project. For large projects involving many households, a detailed study would be required, for a project which involves a single or few households, the study could be truncated.

The information coming from such preliminary studies could be used for several purposes, such as more complete economic and financial studies of the electrification project.

This part of IEC 62257 also provides some structures as technical solutions that could be recommended, depending on the qualitative and quantitative energy demands, consistent with the needs and financial situation of the customers.

Then, in relation with each model of the proposed range of systems, electrical architectures are proposed to technical project managers to assist in designing the systems.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60617 (all parts)[DB]¹, *Graphical symbols for diagrams*

IEC 62257-1, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 1: General introduction to rural electrification*

IEC 62257-3, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 3: Project development and management*²

IEC 62257-4, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 4: System selection and design*²

IEC 62257-5, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 5: Safety rules*²

¹ "DB" refers to the IEC on-line database.

² Under consideration.

IEC 62257-6, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 6: Acceptance, operation, maintenance and replacement*²

IEC 62257-7, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 7: Technical specifications: generators*²

IEC 62257-8, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 8: Technical specifications: batteries and converters*²

IEC 62257-9, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 9: Technical specifications: integrated systems*²

IEC 62257-10, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 10: Technical specifications: energy manager*²

IEC 62257-11, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 11: Technical specifications: considerations for grid connection*²

IEC 62257-12, *Recommendations for small renewable energy and hybrid systems for rural electrification – Part 12: Other topics*²

3 Terms and definitions

For the purposes of this part of the IEC 62257 series, the following terms and definitions apply.

3.1

REN

renewable energy

3.2

hybrid system

multi-sources system with at least two kinds of technologies

3.3

dispatchable power system

source, generator, system is dispatchable if delivered power is available at any specified time (for example, a genset is a dispatchable system, REN generator is usually a non dispatchable power system)

3.4

non dispatchable power system

a non dispatchable system is resource dependent; power might not be available at a specified time

3.5

storage

storage of energy produced by one of the generators of the system and which can be reconverted through the system to electricity

3.6

micropower plant

power plant that produces less than 50 kVA through the use of a single resource or hybrid system

² Under consideration.

3.7**microgrid**

grid that transfers a capacity level less than 50 kVA and powered by a micropower plant

3.8**Individual Electrification System****IES**

micropower plant system that supplies electricity to one consumption point usually with a single energy resource point

3.9**Collective Electrification System****CES**

micropower plant and microgrid that supplies electricity to multiple consumption points using a single or multiple energy resource points

3.10**isolated site**

electric characteristic to define a specific location not currently connected to a national/regional grid

3.11**remote site/area**

geographic characteristic to define a specific location far from developed infrastructures, specifically energy distribution

4 Methodology for non technical preliminary studies**4.1 Place and role of preliminary studies in a decentralized rural electrification project**

It is strongly recommended that it is unwise to launch an electrification project against the wishes of the local institutions and populations. A good understanding of the needs and wishes of the local populations is recommended, to know what is their demand, their capacity and willingness to pay for a modern energy service.

If all the socio-economic data are available, they have to be properly collected and processed for this purpose.

If not, a preliminary study is recommended that will be the first stage in the establishment of a feasibility study for a decentralized rural electrification project. Its role is to allow a better understanding of the areas concerned by the various project experts and such a study would make available some of the data needed for technical evaluations, economic, financial and legal analyses, and for the carrying out of the project in general.

In this Clause, a method is suggested to obtain the various information needed.

Some of the information described in the following section might be obtained from governmental organizations prior to specific sites visits.

4.2 Specifications of the preliminary study**4.2.1 General**

A socio-economic study shall provide a certain amount of data to the experts in charge of the financial, techno-economic and organizational studies. It also allows a better understanding of the global environment of the project and can provide information to the community about the scope of the project.

The following subclauses suggest some considerations concerning data to be collected and analyzed in consideration with:

- general information on the environment of the project,
- techno economic study,
- organizational study,
- financial analysis.

Figure 1 is an illustration of the main topics that should be investigated in the socio-economic study.

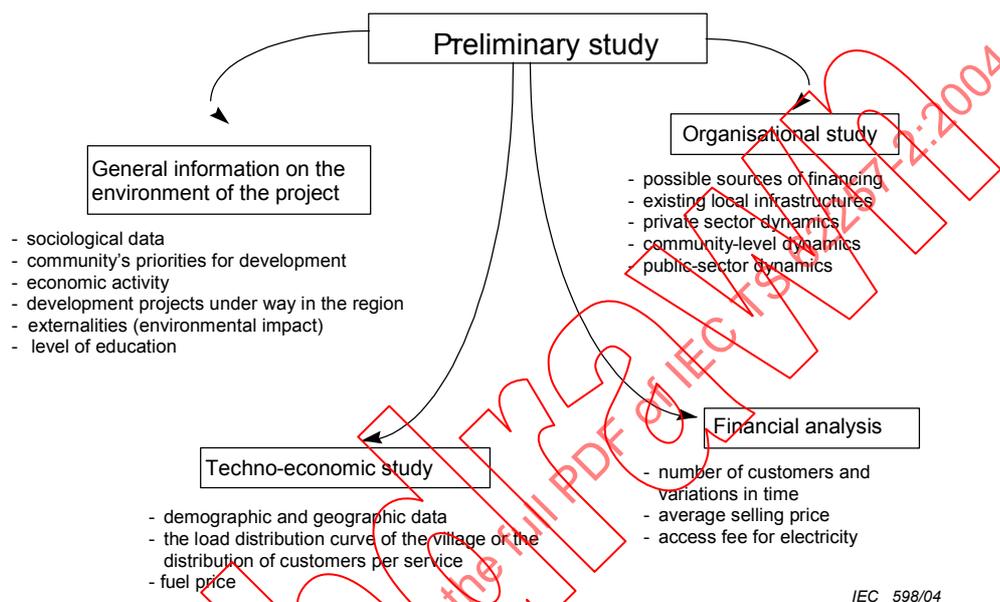


Figure 1 – Example of the content of a non technical preliminary study

4.2.2 General data for a better understanding of the project environment

The following topics should be considered by project contractors. It's their role to determine the relevant importance of each of these categories in regard to a specific project or programme.

4.2.2.1 Sociological data

This data is important for an understanding of the local population. It is essential to look at the organizational, cultural and ethnological structures of the society. In particular, one should investigate the way of life, the sanitary conditions, the national and local languages, the level of education and literacy, the technical sophistication level and the presence of organizations and associations. In addition, the role of male and female in the social organization of the village shall be taken into account.

4.2.2.2 The communities' priorities for development

It is important to understand the population's opinions of their village. What are their priorities for improvement in their daily life? (Such as water pumping, construction of a hospital, of a school, communications infrastructure, electricity, etc.).

In the case of a rural electrification project, what are the priorities for the village as expressed by the population and the local authorities?

4.2.2.3 Economic activities and possible development

Knowledge of the economic activities in the community allows a better general understanding of the environment of the project; it also helps in understanding the dynamics of local development, in order to evaluate the evolution of demand in energy in the coming years.

One can compile the economic activities of the village (commerce, handicrafts, animal husbandry, agriculture, etc.) and look at their relative importance. It would also be useful to look at potential activities due to electricity.

4.2.2.4 The development projects under way in the region

One should look at the local development projects under way, who are the instigators and who are the beneficiaries, what are the impacts on the population, and what would be the impacts on a future electrification project.

4.2.2.5 Environmental considerations

One of the clear drivers in the use of renewable technology is the favorable impact of these systems on the environment as compared to the conventional sources, primarily diesel and grid extension. The impact of any technology choice on the environment, from a carbon, plant footprint, noise and visual impact should be assessed. Understanding the desires of the local participants will be important in this endeavor.

4.2.3 Necessary data for the techno-economic study

Although this information is not strictly in the domain of the socio-economic expert, it shall be collected in the initial phases of any analysis as it is essential to the techno-economic study. The socio-economic expert is therefore asked to collect this data, being usually the first project person to visit a rural community.

4.2.3.1 Geographic and demographic data

In particular one shall obtain the geographical coordinates of the village, its topography, local fauna, and the geographical distribution of the inhabitants. The geographic layout of the community is important because it impacts the economics of meeting the power requirements for the community. If the community is widely dispersed, the cost of a local distribution network may be prohibitive, at which point individual home systems or small cluster systems may be the most cost-effective solutions. The analysis will require specification of the location, power, and energy requirements of each load. It is also important to obtain an understanding of the acceptance of different qualities of service that these electrification options offer. If possible, one should collect data on the climate, local natural resources, site transportation issues and other important sighting issues such as land ownership and right of way issues.

4.2.3.2 Human resources

The personnel resources available in the community, region and country shall be considered when conducting an analysis for renewable based power systems. The infrastructure required for the project installation, long term operation, and system maintenance shall be in place to insure its long-term sustainability. In most cases, a multi layer infrastructure is required, a local system operator who is able to address short term incidents, a regional service center capable of conducting system repair and component assessment and a country or globally regional center that can provide timely replacement of major components and detailed service. Without a specified institutional framework, it will be impossible to provide a quality level of service at a cost that can be sustainable over the life of the project. The whole infrastructure framework relies on people with the right level of training and equipment to perform their specified tasks in the right geographic area with enough systems to guarantee a successful business model. If the infrastructure is not currently in place, care shall be taken to investigate whether the resources are available to create one.

4.2.3.3 Energy, resources assessments

Data on the local (renewable) energy sources such as wind, insolation, biomass and hydraulic potential should be collected. If a sufficient amount of reliable data is not available, the project should be postponed until the necessary data have been collected. For wind and solar energy, a measurement program may be necessary. For wind measurements, a duration of at least one full year or the ability to comfortably correlate the data to other long-term data collection sites, is recommended. Information on the daily or seasonal resource pattern is also important in the assessment of the available resource. Modern site assessment techniques should be utilized to establish the best possible prediction of the resource and the energy production potential, including the use of resource assessment modeling techniques such as the Wind Atlas Analysis and Application Program (WASP) Riso National Laboratories, Denmark; MesoMap, True Wind Solutions, United States; and the Wind Resource Assessment and Mapping System (WRAMS), National renewable Energy Laboratory, United States. This data can then be used in performance simulation models such as RAPSIM, Australia; RETScreen, Canada; HOMER, Hybrid2, PVSYST, and Wattsun, United States. At locations without electric service, it will also be important to obtain an assessment of all of the electrification options for the community or dwelling in question. This would include information like the distance to any existing distribution network and the cost of diesel fuel transported to the site.

4.2.3.4 Environmental conditions, climate

Data on the local environment and climate should be collected. For warm climates with high temperatures, humidity and possibly corrosive environments may influence design criteria, choice of material and systems layout. For cold climates with low temperatures, icing and again possible corrosive environment may, in different ways, influence design criteria, choice of material, systems layout and performance. Altitude may also be an important parameter. Local conditions may also influence transport, installation and access to the site as well as operation and maintenance costs. Extreme conditions such as earthquakes, floods and hurricanes may influence design criteria and expected systems lifetime. Data on all these matters should be collected and, if possible considered in relation to any national and/or international standard.

4.2.3.5 Existing energy supply

The structure of the existing energy supply in terms of fuel, gas, wood, candles and other sources should be mapped with respect to sources, amounts, availability and costs. Existing infrastructure in terms of power plants, fuel storage and distribution lines should be listed and specified in considerable detail. Costs and metering principles should be accounted for, and subsidies, if any, on the existing energy supply should be accounted for. Special care should be taken in the determination the real cost of diesel fuel delivered to an existing diesel power station. The number of hours of service per day and the customer's impression of the level of service are important factors to consider for any existing power stations.

4.2.3.6 Present and future consumer demands

The expected loads in a community, as well as the projected growth, or reduction, of those loads will impact the specification and configuration of the hybrid system. Determining the initial loads and the growth projections can be very difficult, and is often based on historical values for similar situations. It is very clear that the load and projected growth have a clear relation to system design and the life-cycle cost of energy for systems providing various levels of service. The quality of the electric service, the number of hours per day the system is expected to operate, and whether there are large inductive loads, such as motors, need to be considered. Investigation should also be made into areas of potential power use, for example animal driven agricultural water pumps that could be electrified or grain drying operations that could be converted to biogas.

4.2.4 Necessary data for the financial analysis

The financial expert needs a number of data to make his analysis, and the socio-economic expert shall provide them. For the financial analysis, one shall know the following:

4.2.4.1 Number of customers and variation in time

This data is deduced from the data on the demand expressed by the population for a modern energy service. In order to evaluate the potential number of customers at the beginning of the project, one shall take into account the social demand (willingness to pay) and the capacity to pay.

To estimate the variations in the number of customers with time, one shall know the demographic growth, and in particular the growth in the number of households (or the average number of persons per household).

4.2.4.2 Availability, willingness to pay

To determine the average selling price for implementing the financial plan, one generally uses the average capacity to pay determined in the previous stage. However it is preferable to determine the willingness to pay of customers for a given service and the distribution of potential customers per service. One then determines the average selling price for each service.

4.2.4.3 Potential sources of financing for the user

It is important to know the various financial institutions and the habits of the local population in their money management. Understanding of their sources of income, and in particular the regularity of their income, allows for better customer management. Questions put to the households lead to knowledge of their preferences and the social acceptability of the different payment methods envisaged.

4.2.4.4 Institutional organizations: potential sources for financing

International and national organizations are potential sources for financing. In relation with the specific goals of the project, it is recommended to have a look to the updated list of these organizations (governmental and NGOs) in order to request their support. Such institutions or organizations can be used to fill the gap between the true project cost and the income coming from the local community. Some projects can be financed only by the local resources, but most of them require assistance from such organizations, commonly the case in developing countries.

4.2.4.5 Connection charge for electricity (initial equipment)

It is important to know if an access fee for electricity can be accepted by the population. If so, what is the adequate fee and what is the willingness to pay of the populations for this access fee?

4.2.5 Necessary data for the organizational study

4.2.5.1 Existing local infrastructures

In order to optimize any decentralized electrification system, one needs to know the transport and communication infrastructures in place. It is necessary to know if they operate all year round (if for example one needs to supply petrol to the village).

One needs to know the distance to the national grid to evaluate the social acceptability of a decentralized system, what are the existing equipments and services available, what electricity supply (if any) the population has access to, and the available communication infrastructures.

4.2.5.2 Private sector dynamics

Private sector dynamics can be evaluated through the number of commerce and handicrafts in the village, as well as the local technical skills: presence of electrical technicians, mechanics, and other activities, etc.

This gives a measure of the capacity of the private sector to support electrification projects in terms of customer management, or even in terms of investment. It is therefore interesting to note the private initiatives under way, such as private micro-grids, battery charging, rental of solar home systems, etc.

4.2.5.3 Community-level dynamics

The capacity for initiative and organization of the local communities should be looked at. This may be evaluated by noting the presence (or absence) of structured local organizations or associations: professional guilds, community infrastructure associations, socio-cultural associations, etc. It is also essential to note the presence of community-level electrification projects, such as micro-grids.

Generally, the fewer of these organizations are present, the lower will be the organizational capacity of the community. In this case, it is difficult to imagine a management of the electrification project purely on a community level.

4.2.5.4 Public sector dynamics

This dynamic can be evaluated by looking at the public sector (state, local authorities) projects under way in the village. If they are few, one can conclude that generally speaking, a public sector management approach for electrification projects is not appropriate.

4.2.5.5 Local governmental issues

There will be a number of local and federal governmental issues that will have to be assessed prior to project implementation. Items include financing and subsidy issues, responsibility for system operational status, import tariffs, land use issues and power production legislation and regulation. In many cases, governmental barriers to the use of new and renewable rural electrification technology are the hardest to overcome and result in the most project delays.

4.2.5.6 Institutional organizations

International and national organizations are potential sources for organization support. In relation with the specific goals of the project, it is possible to find organizations with specific experience, for example business development.

4.3 The stages of a socio-economic study

The main steps recommended to be followed for the carrying out of a socio economic study are presented at the end of the present document as Annex A.

5 Classification of electrification systems

5.1 Introduction to a range of systems

This section establishes a classification system of decentralized electrification systems for rural areas not connected to a national/regional grid, based on a range of system types.

5.2 Users requirements

Two kinds of requirements from the users point of view should be considered:

- 1) Quality requirements, including:
 - time availability: the ability to use power whenever needed,
 - waveform quality of the supply neither impairing the operation nor the life duration of receivers.
- 2) Quantity requirements, whose characteristics are:
 - quantity of energy required for a given period, allowing to take advantage of the number of utilization hours expected from installed receivers.

5.3 Typology of qualitative requirements

5.3.1 Type of desired use

Energy use/application types are listed in Table 1. The categories shown are issued from an analysis of user types (individual or collective) and from the use they desire to (or can) make of their power/energy:

Table 1 – Application types and types of uses

| Application types | Types of uses |
|---|--|
| Home applications | Lighting Audio/video Refrigerator(s) Small household appliances Washing machine Irons Freezer(s) Odd jobs |
| Public areas applications (places of collective life: worship places, community center, health center, etc.) | The same appliances as above are used, but commonly more numerous and more powerful Public lighting Collective pumping |
| Economic activities applications | Process equipment supply (mainly motors) |

5.3.2 Availability

Considering the daily duration of the desired/required service availability, each type of use can be identified in relation to increasing requirements in terms of

- Duration of service (h per day)
- Service availability (% per year)
- Power quality.

5.3.3 Quality of the supply

Concerning the quality of the supply, the expectations of the users will bear upon parameters which allow satisfactory usage of appliances. Table 2 lists examples of qualitative expectations versus categories of receivers.

Table 2 – Expected quality of the supply

| Type of receivers | Qualitative expectations |
|-------------------|--|
| DC | Voltage measured at receivers level ($U \pm \Delta U$) Signal distortion |
| AC | Voltage measured from the point of delivery ($U \pm \Delta U$) Frequency ($f \pm \Delta f$) Harmonic distortion (THD) Grid $\cos \varphi$ |

The specific values are given in Table C.1.

5.4 Typology of quantitative requirements

Annex B provides a detailed analysis of power quantitative requirements linked to the types of commonly used receivers installed in each aforementioned application; it also provides an estimate of the time during which these receivers may be used.

Using this detailed analysis, power and energy requirements were broken down into four categories as shown in Table 3.

**Table 3 – Synthesis of quantitative requirements/category
(examples of type of user and use)**

| | Category 1 | Category 2 | Category 3 | Category 4 |
|---|---|--|---|---|
| User type (examples of type of use) | Individual services (lighting and audio/video) and collective services "low energy consumption" (places of worship, community center, administrative premises, communication systems, etc.) | individual services (same as category 1 + freezer(s) and household appliances) and collective services (health and care center: lighting and freezer(s), etc.) | Individual services (same as category 2 + freezer(s), washing machine, odd jobs, etc.) and collective services (public lighting) | Collective services (pumping, etc.) and business activities (motors, etc.) |
| Essential consumption characteristics | <ul style="list-style-type: none"> • Low number of receivers • Low power of receivers • Slim consumption profile | <ul style="list-style-type: none"> • Number of receivers is a little higher • Receivers more powerful | <ul style="list-style-type: none"> • High number of receivers • Some receivers are powerful • High instantaneous power inrush calls (possibly) • "Variable" consumption profile | <ul style="list-style-type: none"> • Powerful receivers • High instantaneous power inrush calls |
| Probable needed power | $P \leq 100 \text{ W}$ | $0,1 \text{ kW} < P < 0,5 \text{ kW}$ | $0,5 \text{ kW} \leq P < 2 \text{ kW}$ | $2 \text{ kW} \leq P$ |
| Average energy required over 24h (to satisfy the users as may be expected from using electricity) | $E \leq 0,5 \text{ kWh}$ | $E \leq 1,5 \text{ kWh}$ | $E < 4 \text{ kWh}$ | $E < n \times 10 \text{ kWh}$ |

Most domestic users in developing countries apply to category 1 and to a lesser extent, to category 2.

5.5 Classification for electricity services provided

Several levels of service can exist to meet the quantitative requirements shown in Table 3; these levels of service can be distinguished from one another through the indicators.

As a suggestion, Annex C indicates values to specify supply quality for small rural electrification systems. (Table C.1)

5.6 Assisted selection of production subsystem

Annex D, an informative Annex, suggests how to determine the most adequate power production subsystem solution with supply availability and daily duration of service.

5.7 Typology of decentralized electrification systems

The following classification is provided in order to better communicate the different types of commonly used isolated electrification systems.

5.7.1 Selection process


A production subsystem is selected as a function of qualitative requirements for power availability and offer related constraints. Production and distribution shall then be sized in order to fulfil quantitative requirements.

Table 4 categorizes the production subsystems (generators) in terms of the possible system architectures:

Table 4 – Typology of decentralized electrification systems

| Type of generator | | Classification of associated systems | |
|--|------------|--------------------------------------|------------------|
| | | Individual | Collective |
| RE only, hybrid or not | no storage | T ₁ I | T ₁ C |
| RE only, hybrid or not | storage | T ₂ I | T ₂ C |
| RE, hybrid or not + Genset | no storage | T ₃ I | T ₃ C |
| RE, hybrid or not + Genset | storage | T ₄ I | T ₄ C |
| Genset only | no storage | T ₅ I | T ₅ C |
| Genset only | storage | T ₆ I | T ₆ C |
| Notation principle: T _i I = individual system, type <i>i</i> ; T _j C = collective system, type <i>j</i> . | | | |
| NOTE "Storage" = storage of energy produced by one of the generators of the system and which can be reconverted "on demand" to electricity through the system. | | | |

Figure 2 categorizes systems depending on whether they are dispatchable or not.

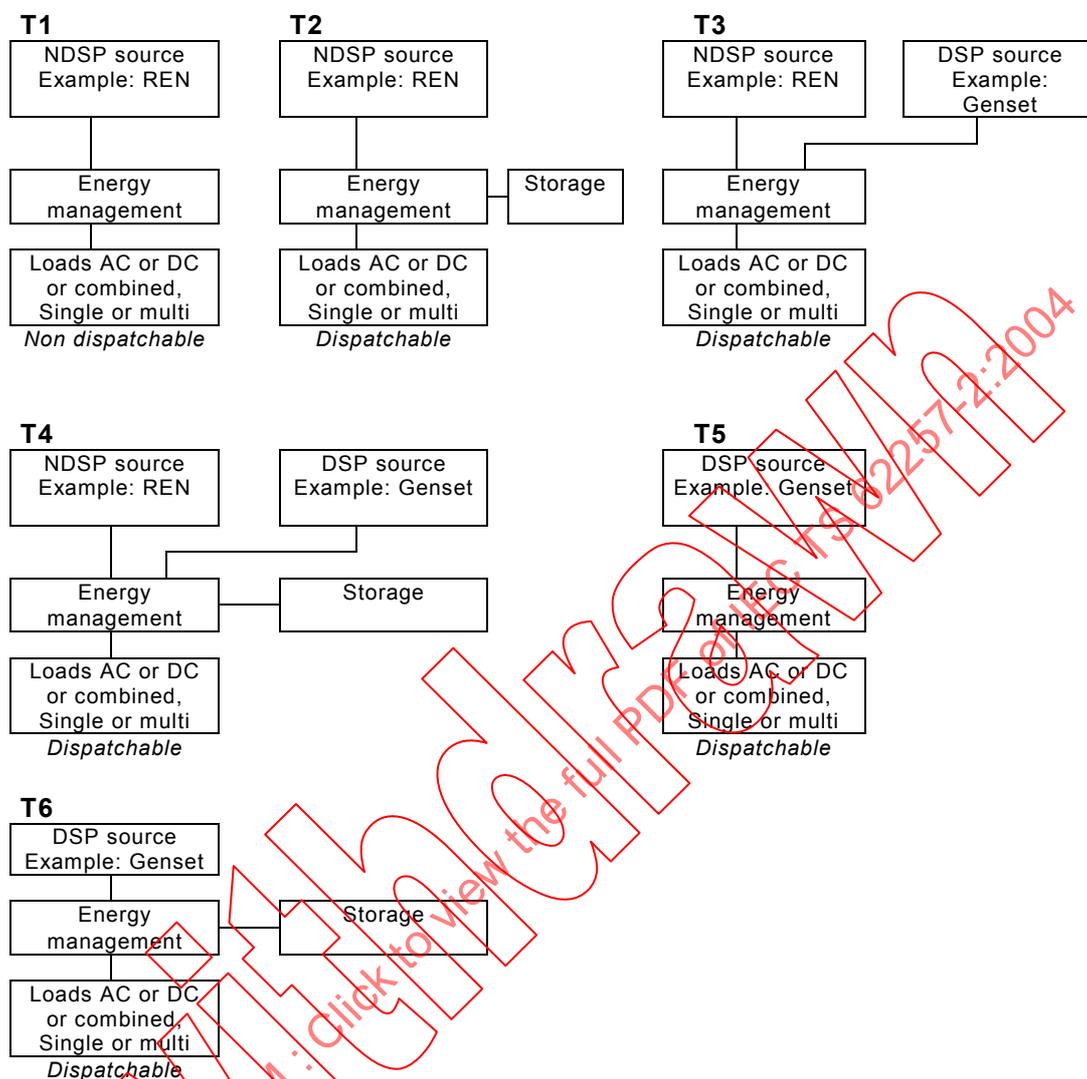

Key:

REN = Renewable source; DSP = dispatchable; NDSP = non dispatchable

A source, generator, system is dispatchable if delivered power is available at any specified time.

A non dispatchable system is resource dependent; power might not be available at a specified time.

IEC 599/04

Figure 2 – Systems architecture and dispatchable energy

5.7.2 From user needs to electrification system: summary for a range of electrification systems

Table 5 specifies the range of electrification systems including their architectures and the demand requirements

- type of recommended production subsystem;
- type of sources constituting the production subsystem;
- type of rural decentralized electrification systems integrating the said production subsystems;
- contractual commitments between suppliers, operators and users.

Table 5 – Preliminary range of relevant (as a minimum) decentralized electrification systems

| Requirement | Proposed production subsystem | | | Electrification system | | Proposals for contractual commitments between suppliers, operators and users (when applicable) |
|--|---|---------|--------|------------------------|------------------|---|
| | REN | Storage | Genset | IES | CES | |
| User requests a given result of process over a given period; no quality requirement | X | | | T ₁ I | N/A | Commitment to supply: <ul style="list-style-type: none"> process result defined for a period of one month, one week, for a number of <i>n</i> months out of 12, <i>n</i> weeks out of 52 or <i>n</i> days out of 365 |
| Every day, user would like to have multiple hour energy supply at constant voltages with several appliances on, simultaneously and accepts a lack of energy because of adverse climatic conditions | X | X | | T ₂ I | T ₂ C | Commitment to supply: <ul style="list-style-type: none"> the quantity of subscribed power/energy defined for a period of one month, one week, for a number of <i>n</i> months out of 12, <i>n</i> weeks out of 52 or <i>n</i> days out of 365 |
| Every day, user would like to have multiple hour energy supply at constant voltages with several appliances on, simultaneously and requires energy even in adverse climatic conditions and accepts to have energy only during defined periods in the day | X | | X | T ₃ I | T ₃ C | Commitment to supply: <ul style="list-style-type: none"> the quantity of subscribed power/energy defined for a period of one month, one week, for a number of <i>n</i> months out of 12, <i>n</i> weeks out of 52 or <i>n</i> days out of 365 |
| | X | X | X | T ₄ I | T ₄ C | <ul style="list-style-type: none"> adequate fuel source(s) and sufficient fuel storage capabilities to support genset operations <p>NOTE Renewable based systems will require less fuel than non-renewable.</p> |
| | X | X | X | T ₆ I | T ₆ C | <ul style="list-style-type: none"> service availability over fixed time periods |
| or would like to have energy 24 h/day | Same solutions, but different sizing and operating conditions | | | | | Same as above, but 24 h service availability |
| <p>NOTE In this presentation, possible system failures do not account as days of unavailability. Unavailability is here considered either linked</p> <ul style="list-style-type: none"> to system maintenance, or to generator (if one exists) overhaul, or to climatic trouble (number of consecutive days with no sun or wind). | | | | | | |

6 Electrification systems architecture

6.1 General

This Clause presents the architecture of the six system types defined in the typology in Table 4.

6.2 General presentation of isolated electrification systems

In general isolated electrification system can be broken down into three parts:

- 1) energy production subsystem,
- 2) energy distribution subsystem,
- 3) energy application subsystem.

6.2.1 Production subsystem

The production system comprises equipment for:

- generating electricity, supplied by:
 - renewable energies such as the sun or wind, hydro, biomass (photovoltaic panels, wind-turbines),
 - fossil energy (gas-oil, motor spirit, kerosene) used as fuel for a generator set.
- storage of electric energy.
- conversion/transformation of energy by converters:
 - DC / DC convertors,
 - AC / DC (rectifiers),
 - DC / AC (inverters).
- protection of persons and goods by:
 - circuit-breakers,
 - fuses
 - neutral and earthing control devices.
- management of energy by:
 - basic regulators without energy management systems,
 - energy management systems (may include monitoring capability and remote access).

Certain parts of this equipment may be placed in boxes, cabinets or other edifices also comprising functions such as ventilation or alarm systems.

6.2.2 Distribution subsystem

The distribution subsystem comprises the equipment for distributing the energy in the form of alternating or direct current from the production subsystem to the demand subsystem. It comprises:

- **distribution** equipment:
 - switchboards, cabinets, etc.
- **energy transmission** equipment:
 - cables (overhead or underground),
 - poles,
 - protection.
- **instrumentation** equipment.

NOTE This subsystem is defined only for collective electrification systems.

6.2.3 User or application subsystem or demand subsystem

This subsystem consists of all the equipment using the energy:

- the user power supply box (including metering and safety equipment),
- the internal wiring installation,
- the demand appliances including:
 - receivers operating on DC,
 - receivers operating on AC.

6.3 Combining subsystems

In the most basic form, a rural micropower plant can be made up of multiple energy production, distribution and application subsystems as shown in Figure 3. The distribution subsystems make up the common connection between distinct production subsystems and distinct applications subsystems. In most cases, the distribution subsystems will be specified for AC supply quality.

Because of the requirement that multiple AC supplying production subsystems shall be able to maintain consistent AC quality of supply, the most simple form of rural micropower plant will contain one production subsystem, one distribution subsystem and one application subsystem itself made up of multiple users. However, multiple production, distribution and application subsystems are encompassed by this document.

The specific functional diagrams addressed in the Annexes A to E address a single production subsystem while the complexities of combinations of multiple production, distribution and application subsystems is addressed in future IEC 62257-12.

For a glossary of symbols, see Table E.1.

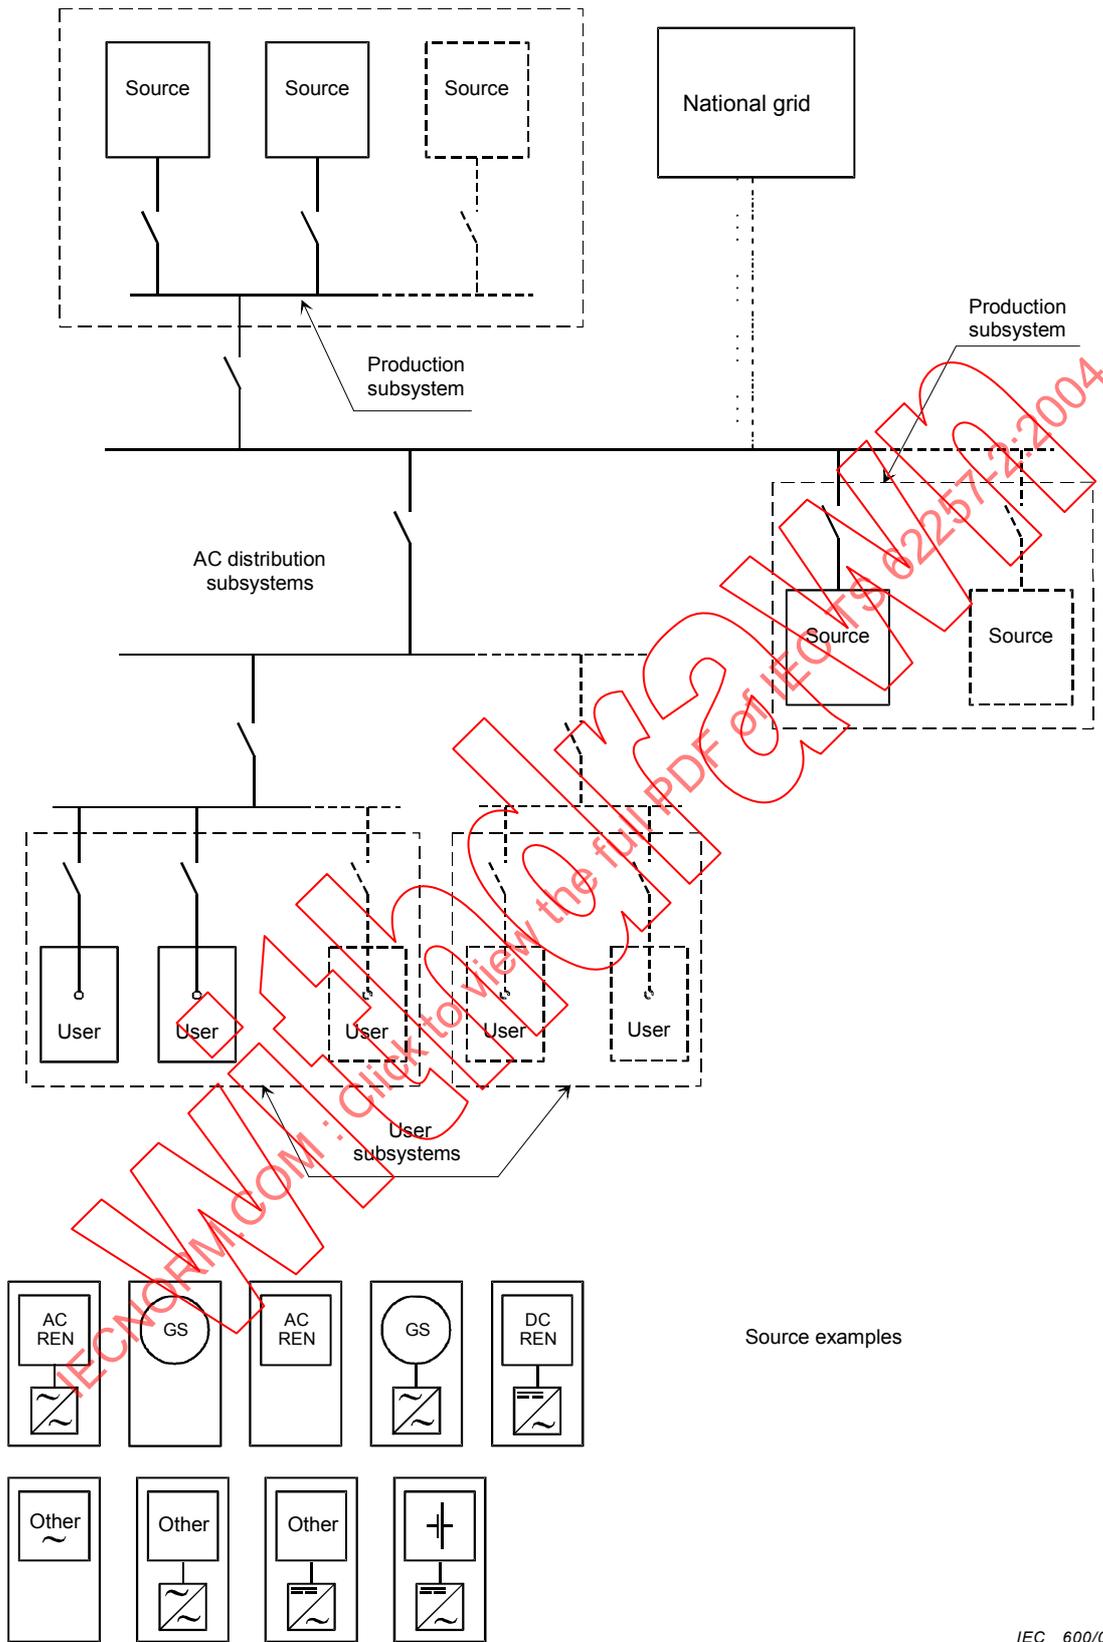


Figure 3 – General configuration of an electrification system

6.4 Functional diagrams

Annex E, an informative Annex, introduces suggested diagrams that could be considered as a first step to implement electrification systems as simply as possible, referring to the general configuration as illustrated in Clause 6.3.

The diagrams shown in Figures E.1 to E.18 are functional diagrams and not electrical diagrams.

They are highly general in nature and capable of adapting to a wide variety of situations. In particular, they do not suggest ownership.

The intention is to provide these functional diagrams as examples of systems capable of being used throughout the world, both in developed and developing countries. The systems can be further sub categorised using the quantity and quality of supply performance indicators as given in Annex C. The quantity and quality of supply determines the dimensions of the different parts of the system: generators, storage, cut-off points, types of protection, etc.

The switch points indicated on the diagrams are common-purpose, with no indication as to the specific type of switchgear to be used.

The limits between the subsystem types (production, distribution, demand/application) are drawn.

Individual Electrification Systems (IES) for single users incorporate two subsystems:

- an electrical power production subsystem,
- a demand subsystem for utilizing this electrical power.

Collective Electrification Systems (CES) for multiple users incorporate three subsystems:

- an electrical power production subsystem (micropower plant),
- a distribution grid for sharing/ this power to individual users (microgrid),
- a demand subsystem including inhome wiring and user's electrical appliances for all individual users.

These subsystems may correspond to systems operated and maintained by different persons or bodies. In certain cases, the entire system may be owned, operated and used by the same person.

Persons or bodies who may have the task of operating such systems can choose best suited type of supply system.

Typically, such supply options may be:

- delivery of DC power,
- delivery of AC power, with the inverter forming part of the production subsystem,
- delivery of power in two forms (AC and DC),
- a single delivery point (AC or DC),
- several delivery points.

6.5 Related references

There is in future IEC 62257-9 a proposal for a standard about house wiring for locations with no existing standards.

6.6 Limits between production, distribution and demand/application subsystems

Where there are several different operators, they may choose to set the supply modes for their respective areas of action that they consider the best suited to them, taking into consideration the priorities they themselves set, namely:

- a single delivery point,
- several delivery points,
- delivery in DC form,
- delivery in AC form,
- a back-up set forming part of the application subsystem,
- etc.

NOTE Delivery at a standard voltage yet to be defined ($24 V_{DC}$, $230 V_{AC}$, for instance) implies in certain cases that certain converters be taken over by the production system operator.

In designing the systems, it should be possible when working on installations, to apply the safety rules stipulated by the standards applicable in the countries concerned or, failing this, rules set by the Owner or local operator.

6.7 Summary of the different electrification system types

Table 6 summarizes the main functional characteristics of the different types of isolated electrification systems.

Table 6 – Recapitulation of characteristics of different types of isolated electrification systems

| Electrification system | System type | Production system | | | Conversion | Coupling REN/group synchronous coupling | Application | | |
|---|--------------------|----------------------------|---------|---------------|------------|--|-------------|----|--------------|
| | | REN | Storage | Generator set | | | DC | AC | Dedicated AC |
| REN in-sync process supply systems and Individual systems (IES) | T ₁ l-a | * | | | | | * | | |
| | T ₁ l-b | * | | | | | | * | |
| | T ₁ l-c | * | | | * | | | * | |
| | T ₁ l-d | * | | | * | | * | | |
| | T ₂ l | * | * | | * | | * | * | |
| | T ₃ l | * | | * | * | | | * | |
| Collective systems (CES) | T ₄ l | * | * | * | * | | * | * | * |
| | T ₁ C | Considered as non relevant | | | | | | | |
| | T ₂ C | * | * | | * | | | * | |
| | T ₃ C-a | * | * | * | * | * | | * | |
| | T ₃ C-b | * | * | * | * | * | | * | |
| | T ₄ C | * | * | * | * | | | * | * |
| T ₅ C | | | * | | | | * | | |
| T ₆ C | | * | * | * | | | * | | |

*: Equipment present.


Annex A (informative)

Stages of a socio-economic study (see Clause 4)

A.1 General

This annex briefly presents the principal steps to be followed when carrying out a socio-economic survey or study in decentralized rural electrification. Depending on the type of project considered, the stages to be followed may vary slightly or be optional.

Figure A.1 is an example of what could be done.

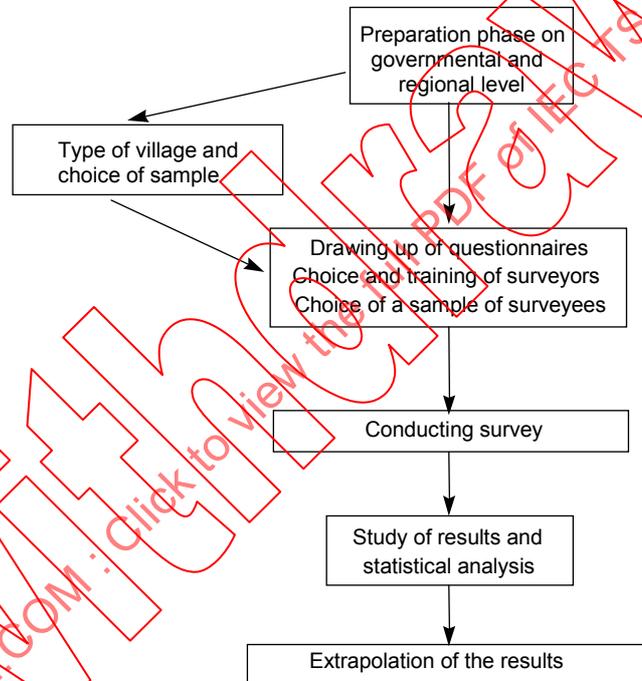

IEC 601/04

Figure A.1 – Flowchart of the stages of a socio economic study

A.2 Preparation phase

When a rural electrification project is to be set up, a preliminary analysis of the general characteristics of the zone should be made before launching exploratory trips. This analysis should look at the factors that characterise the zone such as the geographical situation and the political system, the national energy situation and the different sources of energy, and the economic situation.

To supplement this data and to understand the local context optimally, it is recommended to make a first exploratory trip.

A.3 Drawing up of the questionnaires, choice of surveyors and choice of sample

Surveys allow the collection of data necessary for the setting up of a decentralized rural electrification project. The quality of the surveyors determines to a large extent the reliability and exactitude of the data collected. It is therefore preferable to make use of surveyors who are used to participating in field surveys in rural areas. In addition, in some countries several languages or dialects are used and it is necessary to have surveyors fluent in the language(s) used in the villages concerned.

The reliability of the extrapolation of the results to the whole of the village or villages strongly depends on the quality of the sample and its representativity. This supposes that the size of the sample be sufficient, and that the sample includes the various geographical and socio-economic situations encountered in the zone concerned.

A.4 Conducting the survey - Analysis of the results

The questionnaires should be created by professional operators, often recruited in local or national statistical organizations. To avoid errors, a backup can be made. Treatment of the data should allow elimination of inconsistent answers.

A.5 Extrapolation of the results

Since only a sample of the population is surveyed, the results should then be extrapolated to the whole of the village.

The corrected data is then treated to determine the statistical data necessary for the rest of the project; input for the technical, financial and organizational studies are available. The survey results give, for each surveyee, current expenditures in energy (assimilated to the capacity to pay), the choice of an energy service and the willingness to pay. This data allows an evaluation of the solvable demand for each survey.

Annex B
(informative)

Analysis of the type of receivers installed versus types of use and demonstrating seasonable variability (where applicable) (see Clause 5)

B.1 Domestic use

NOTE 1 This data is listed for guidance and concerns villages located in developing countries

B.1.1 Utilisation example 1

| | | | | | | Total daily energy (Wh/day) | | | | | | | | | | | |
|--|----------------------|----------------|------|----------------------------|--------------------------|--|-----------|------------|---|------------|------------|------------|---|------------|------------|-------------|-------------|
| | | | | | | Category I (lighting and audio/video) | | | Category II (category I + freezer(s) + household appliances) | | | | Category III (category II + washing machine, odd jobs) | | | | |
| | | | | | | 90 | 280 | 400 | 590 | 880 | 970 | 1030 | 1120 | 1680 | 2730 | 2830 | 3180 |
| | Equipment | Unit power (W) | Qty. | Operating duration (h/day) | Installed appliances (W) | Daily energy (Wh/day) | | | | | | | | | | | |
| Lighting | Lamps | 10 | 3 | 3 | 30 | 90 | 1 | 1 | 1 | | 1 | | 1 | | | | |
| | | 10 | 6 | 3 | 60 | 180 | 1 | 1 | | 1 | 1 | 1 | | 1 | 1 | 1 | 1 |
| Audio/video | Radio | 20 | 1 | 5 | 20 | 100 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | TV | 70 | 1 | 3 | 70 | 210 | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | Video | 50 | 1 | 2 | 50 | 100 | | | 1 | | | 1 | 1 | | | 1 | 1 |
| Cold | Refrigerator | 80 | 1 | 6 | 80 | 480 | | | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | Freezer | 160 | 1 | 6 | 160 | 960 | | | | | | | | | 1 | 1 | 1 |
| Comfort | Household appliances | 100 | 1 | 0,5 | 100 | 50 | | | | | | 1 | 1 | 1 | 1 | 1 | 1 |
| | Washing machine | 500 | 1 | 1,5 | 500 | 750 | | | | | | | | 1 | 1 | 1 | 1 |
| | Odd jobs | 700 | 1 | 0,5 | 700 | 350 | | | | | | | | | | | 1 |
| Total installed power P_{inst} (W) | | | | | | 30 | 80 | 120 | 200 | 200 | 230 | 350 | 380 | 800 | 990 | 1040 | 1740 |

B.1.2 Utilisation example 2

| | | | | | | | Category I (lighting and audio/video) | | | Category II (category I + freezer(s) + household appliances) | | | | Category III (category II + washing machine, odd jobs) | | | | |
|---|----------------------|----------------|------|----------------------------|--------------------------|-----------------------|--|-----------|------------|---|------------|------------|------------|---|------------|------------|-------------|-------------|
| | | | | | | | 180 | 560 | 730 | 1010 | 1210 | 1390 | 1360 | 1540 | 2010 | 3150 | 3250 | 3600 |
| Total daily energy (Wh/day) | | | | | | | | | | | | | | | | | | |
| | Equipment | Unit power (W) | Qty. | Operating duration (h/day) | Installed appliances (W) | Daily energy (Wh/day) | | | | | | | | | | | | |
| Lighting | Lamps | 10 | 3 | 6 | 30 | 180 | 1 | | 1 | | 1 | | 1 | | 1 | | | |
| | | 10 | 6 | 6 | 60 | 360 | | 1 | | 1 | | 1 | | 1 | | 1 | 1 | 1 |
| Audio/video | Radio | 20 | 1 | 10 | 20 | 200 | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | TV | 70 | 1 | 5 | 70 | 350 | | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | Video | 50 | 1 | 2 | 50 | 100 | | | | 1 | | 1 | 1 | | | | 1 | 1 |
| Cold | Refrigerator | 80 | 1 | 6 | 80 | 480 | | | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | Freezer | 160 | 1 | 6 | 160 | 960 | | | | | | | | | 1 | 1 | 1 | 1 |
| Comfort | Household appliances | 100 | 1 | 0,5 | 100 | 50 | | | | | | | | 1 | 1 | 1 | 1 | 1 |
| | Washing machine | 500 | 1 | 1,5 | 500 | 750 | | | | | | | | 1 | 1 | 1 | 1 | 1 |
| | Odd jobs | 700 | 1 | 0,5 | 700 | 350 | | | | | | | | | | | | 1 |
| Total installed power P_{inst} (W) | | | | | | | 30 | 80 | 120 | 200 | 200 | 230 | 350 | 380 | 800 | 990 | 1040 | 1740 |

NOTE 2 These tables are only examples and of course it is possible to use any relevant appliances, or combination of appliances, matching the available power.

B.2 Analysis of the type of receivers versus usage types

Collective use

NOTE This data is shown for guidance and concerns villages of developing countries.

B.2.1 Health and care centre

| Equipment | Unit power (W) | Quantity | Operating duration (h/d) | Installed appliances (W) | Related daily energy (Wh/d) |
|----------------------------------|----------------|----------|--------------------------|--------------------------|-----------------------------|
| Lamps | 10 | 3 | 6 | 30 | 180 |
| Refrigerator | 80 | 1 | 6 | 80 | 480 |
| Sterilizer | 400 | 1 | 0,5 | 400 | 200 |
| Energy/day (Wh/day) | | | | | 10 200 |
| P_{inst} (W) | | | | | 510 |

NOTE Sizing should account for the powers called for on starting up generator motors (if such motors exist).

B.2.2 Worship places

| Equipment | Unit power (W) | Quantity | Operating duration (h/d) | Installed appliances (W) | Related daily energy (Wh/d) |
|----------------------------------|----------------|----------|--------------------------|--------------------------|-----------------------------|
| Lamps | 10 | 3 | 2 | 30 | 60 |
| Microphone + P.A. amplifier | 50 | 1 | 1 | 50 | 50 |
| Energy/day (Wh/day) | | | | | 110 |
| P_{inst} (W) | | | | | 80 |

B.2.3 Community centre

| Equipment | Unit power (W) | Quantity | Operating duration (h/d) | Installed appliances (W) | Related daily energy (Wh/d) |
|----------------------------------|----------------|----------|--------------------------|--------------------------|-----------------------------|
| Lamps | 10 | 4 | 6 | 40 | 240 |
| TV | 70 | 1 | 5 | 70 | 350 |
| Radio | 20 | 1 | 5 | 20 | 100 |
| Energy/day (Wh/day) | | | | | 690 |
| P_{inst} (W) | | | | | 130 |

B.2.4 School

| Equipment | Unit power (W) | Quantity | Operating duration (h/d) | Installed appliances (W) | Related daily energy (Wh/d) |
|----------------------------------|----------------|----------|--------------------------|--------------------------|-----------------------------|
| Lamps | 10 | 6 | 6 | 60 | 360 |
| Energy/day (Wh/day) | | | | | 360 |
| P_{inst} (W) | | | | | 60 |

B.2.5 Administrative premises

| Equipment | Unit power (W) | Quantity | Operating duration (h/d) | Installed appliances (W) | Related daily energy (Wh/d) |
|----------------------------------|----------------|----------|--------------------------|--------------------------|-----------------------------|
| Lamps | 10 | 2 | 6 | 20 | 120 |
| Energy/day (Wh/day) | | | | | 120 |
| P_{inst} (W) | | | | | 20 |

B.2.6 Communication system

| Equipment | Unit power (W) | Quantity | Operating duration (h/d) | Installed appliances (W) | Related daily energy (Wh/d) |
|----------------------------------|----------------|----------|--------------------------|--------------------------|-----------------------------|
| System | 100 | 1 | 2 | 100 | 200 |
| Energy/day (Wh/day) | | | | | 200 |
| P_{inst} (W) | | | | | 100 |

B.2.7 Public lighting

| Equipment | Unit power (W) | Quantity | Operating duration (h/d) | Installed appliances (W) | Related daily energy (Wh/d) |
|----------------------------------|----------------|----------|--------------------------|--------------------------|-----------------------------|
| Lamps | 18 | 30 | 6 | 540 | 3 240 |
| Energy/day (Wh/day) | | | | | 3 240 |
| P_{inst} (W) | | | | | 540 |

B.2.8 Pumping

| Equipment | Unit power (W) | Quantity | Operating duration (h/d) | Installed appliances (W) | Related daily energy (Wh/d) |
|----------------------------------|----------------|----------|--------------------------|--------------------------|-----------------------------|
| Pump | 1500 | 4 | 12 | 6 000 | 72 000 |
| Energy/day (Wh/day) | | | | | 72 000 |
| P_{inst} (W) | | | | | 6 000 |

B.2.9 Battery charging station

| Equipment | Unit power (W) | Quantity | Operating duration (h/d) | Installed appliances (W) | Related daily energy (Wh/d) |
|----------------------------------|----------------|----------|--------------------------|--------------------------|-----------------------------|
| Charger | 500 | 1 | 10 | 500 | 5 000 |
| Energy/day (Wh/day) | | | | | 5 000 |
| P_{inst} (W) | | | | | 500 |

Annex C
(informative)

Supply quality indicators for isolated electrification systems
(see Clause 5)

Table C.1 – Combined categorization

| Require ment class | Specified duration of service ^{a)} (h/day) | Power quality indicators | | | | | |
|--|---|--|------|------|---|---|--|
| | | Specified supply availability (%/year) | | | Required power quality | | |
| | | 1 | 2 | 3 | 1 | 2 | 3 |
| A | = 24 h | | | | | | |
| B | 16 ≤ h < 24 | | | | | | |
| C | 8 ≤ h < 16 | ≥ 99 | ≥ 98 | ≥ 95 | $ \pm\Delta U \leq 10\% U_N$ $ \pm\Delta f \leq 1 \text{ Hz}$ THD ≤ 3 % | $ \pm\Delta U \leq 15\% U_N$ $ \pm\Delta f \leq 2 \text{ Hz}$ THD ≤ 5 % | $ \pm\Delta U \leq 20\% U_N$ $ \pm\Delta f \leq 3 \text{ Hz}$ THD ≤ 10 % |
| D | 4 ≤ h < 8 | | | | | | |
| E | h < 4 | | | | | | |
| F | Systems requiring power quality indicators either above or below these values may be specified according to special requirements. | | | | | | |
| U_N : the r.m.s. voltage at a given time at the supply terminals, measured over a given interval. f : the nominal frequency of the supply voltage U_N should be f . Under normal operating conditions the mean value of the fundamental frequency measured over 10 s should be within the range of $f \pm \Delta f$. ^{a)} Start time and end time of the period for the duration of service should be implemented in the contract. | | | | | | | |

Finally, the service provided will be a combination of quantitative and qualitative requirements to fulfill the user's power and energy needs:

In reference to Table 3 and Table C.1, RE systems will be specified as follows:

Service X = (power-energy category combined with qualitative class)

As an example, Table C.2 illustrates the content of a specification of a Cat 1-D13 service:

Table C.2 – Service specification (example)

| Cat 1 | | D | 1 | 3 |
|-----------------------------------|--------------------------|--|---|--|
| Maximum available power demand: | $P \leq 100 \text{ W}$ | Weekly average service providing energy 4 h per day, as a maximum. | Service provided for more than 99 % of the year | $ \pm\Delta U \leq 20\% U_N,$ $ \pm\Delta f \leq 3 \text{ Hz},$ THD $\leq 10 \%$ |
| Average energy provided over 24 h | $E \leq 0,5 \text{ kWh}$ | | | |

IECNORM.COM : Click to view the full PDF of IEC TS 62257-2:2004
 WithDrawn

Annex D
(informative)

Assisted selection of production subsystem
(see Clause 5)

D.1 Characteristics of possible production subsystems

The various production subsystems envisioned for Decentralized Rural Electrification (DRE), are shown in Table D.1 below.

Table D.1 – Principles and characteristics of production subsystems

| Principle | Remarks | Production characteristics |
|---|--|-----------------------------|
| Production without storage | The production issued from renewable energies alone is erratic and depends on climatic conditions. The availability from a genset alone can be operated in accordance with the demand. | Time dependent On demand |
| Production with short term energy storage | In this case, the storage associated with REs is limited to a low capacity buffer storage. This short-term energy storage is used both for setting voltages to users requirements and compensating for production trouble as may occur during the generator start up period. The storage is not designed for the storage of RE produced energy. | Rigid |
| Production with long term energy storage | In this production mode, storage is combined with RE, hence providing flexibility compared to the previous solutions. Because of climatic problems, it may occur that this type of system will be unavailable several days per year. In this configuration, supply problems can occur several days per year. | Flexible |
| | With a generator set, any possible unavailability due to climatic problems is removed. Here supply is secured. | |

D.2 Assisted selection of a decentralized production system suited to the requirement

If the user is satisfied with a supply of energy per week or per month and there is no user's demand regarding the quality of the supply, a production of Renewable Energies as-they-go (REs alone) will be suitable.

In case the user desires a daily supply and likewise, accepts that his/her system will be unavailable several days per year because of climatic hazards, a solution combining a storage and REs will be suitable.

If the user desires a daily supply and likewise, wants to be fully protected against climatic hazards (meaning a generator set is provided or oversized RE and storage exist), several solutions may be suitable:

- One generator set alone (in case of multiple user systems) or a multi sources solution (generator set + REs) with synchronous coupling and buffer storage (generator set associated with a pseudo-as-it-goes production of REs). In this case, provisions should be made to make sure the user accepts to be supplied according to predetermined time zones.

- A production with storage either including a generator alone or, a multi source production (generator set + REs) or, REs in which case both REs and storage should be oversized. These solutions will provide the user with flexibility for utilizing his/her system. The allocated energy can be consumed by the user at his/her own discretion over a cycle of 24 hours.

Figure D.1 summarizes the selection process of the appropriate production sources that are recommended as relevant with the user's requirements.

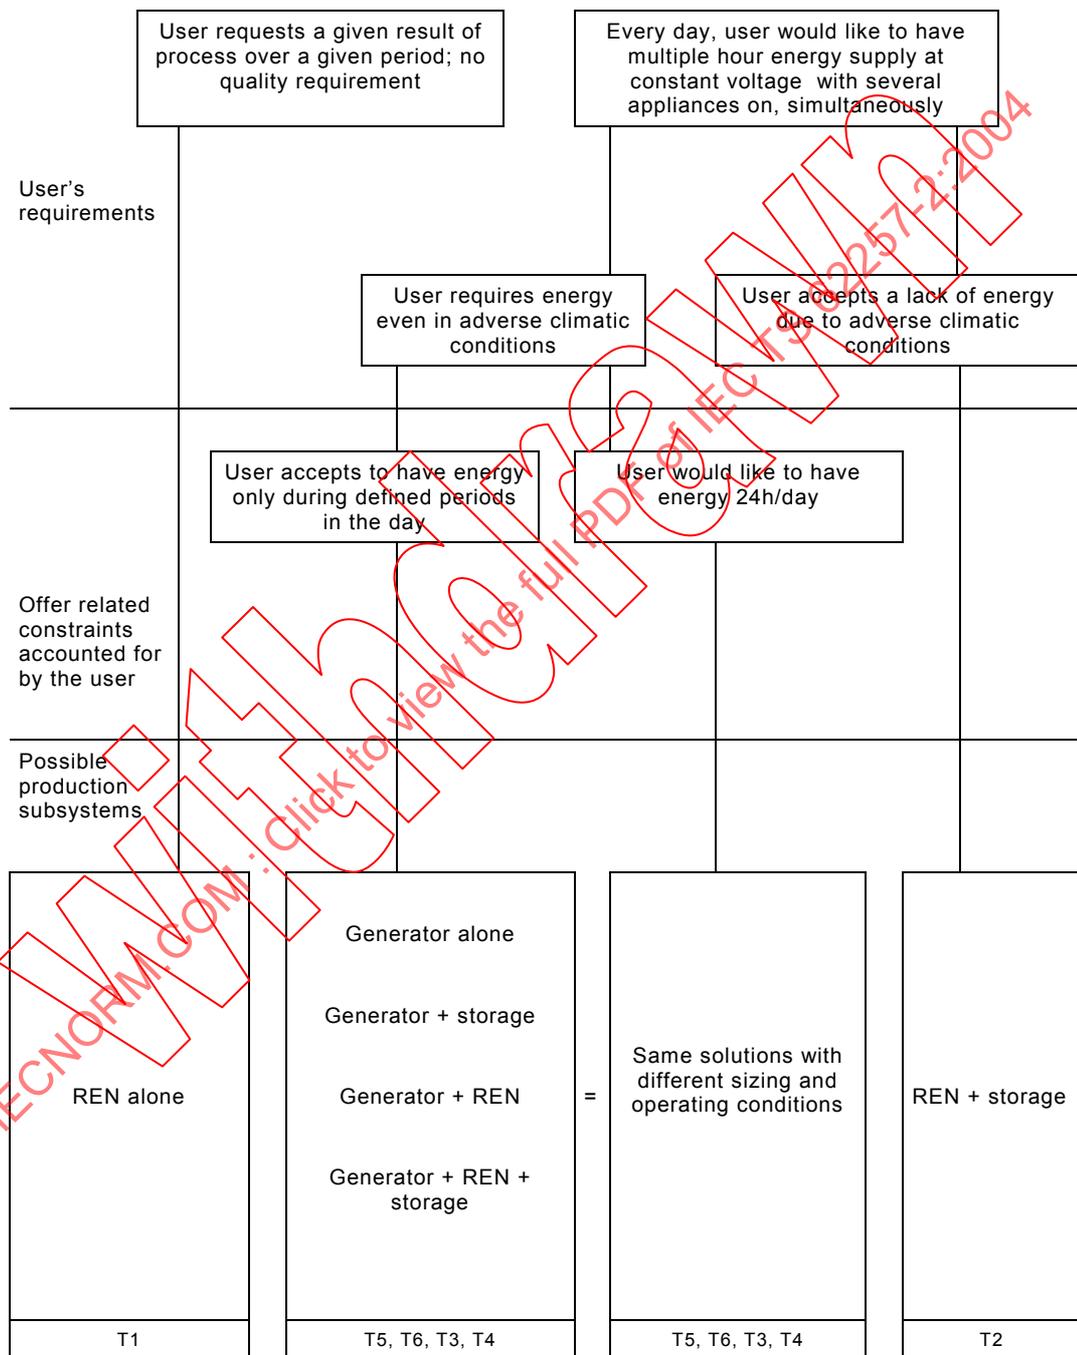


Figure D.1 – Better adequacy of production subsystems solutions with supply availability and daily duration of service

Annex E (informative) Functional diagrams (See Clause 6)

E.1 Glossary of symbols

Table E.1 – Glossary of symbols

| Symbol | IEC 60617 Reference | Description | Specific note | | | | |
|---|---|--|--|-----------|-------------------------------------|-----------|-------------------------------------|
|  | IEC 60617-2-S00059 (DB:2001-7) ^{a)} | Object (equipment, functional unit, component) | Suitable legends should be inserted in or added to the symbol outline to indicate the type of object For example: <table border="1" style="display: inline-table; vertical-align: middle;"> <tr> <td style="text-align: center;">DC REN</td> <td>DC generator using renewable energy</td> </tr> <tr> <td style="text-align: center;">AC REN</td> <td>AC generator using renewable energy</td> </tr> </table> | DC REN | DC generator using renewable energy | AC REN | AC generator using renewable energy |
| DC REN | DC generator using renewable energy | | | | | | |
| AC REN | AC generator using renewable energy | | | | | | |
|  | IEC 60617-6-S00819 (DB:2001-7) ^{a)} | Synchronous generator | Alternatively genset (synchronous generator of the genset) | | | | |
|  | IEC 60617-6-S00894 (DB:2001-7) ^{a)} | Rectifier | | | | | |
|  | IEC 60617-6-S00896 (DB:2001-7) ^{a)} | Inverter | | | | | |
|  | IEC 60617-3-S00017 (DB:2001-7) ^{a)} | Terminal | | | | | |
|  | IEC 60617-2-S00154 (DB:2001-7) ^{a)} | Mechanical interlock between two devices | | | | | |
|  | IEC 60617-6-S01342 (DB:2001-7) ^{a)} | Battery of secondary cells | | | | | |
|  | IEC 60617-S01410 (DB:2001-11) ^{a)} | Frame, chassis | | | | | |
|  | IEC 60617-2-S00200 (DB:2001-7) ^{a)} | Ground (earth), general symbol | | | | | |
|  | IEC 60617-7-S00227 (DB:2001-7) ^{a)} | General symbol for a switch, make contact | | | | | |
|  | IEC 60617-7-S00229 (DB:2001-7) ^{a)} | Break contact | | | | | |
|  | IEC 60617-7-S00373 (DB:2001-7) ^{a)} | Lightning arrester | | | | | |

^{a)}"DB" refers to the IEC on-line database.

E.2 Architectures of systems

E.2.1 Type T₁I: REN Systems operating with no storage (in sync with solar, wind or water energy sources):³; “REN production”


This type of system is primarily intended for supplying processes in situations where it is not desired or possible to store the electrical energy. Examples of application: pumping of water, ventilation of premises, etc.

Several cases can be envisaged, depending on the type of production source (photovoltaic or wind-turbine) and the type of application equipment to be supplied (AC or DC). The cases shown in Table E.2 can be distinguished.

Table E.2 – List of cases, type T₁I


| Type | Figure number | Source | Application |
|--------------------|---------------|------------------------------------|-----------------|
| T ₁ I-a | Figure E.1 | DC For example: PV | DC |
| T ₁ I-b | Figure E.2 | AC For example: wind-turbine | AC |
| T ₁ I-c | Figure E.3 | DC For example: PV | AC (conversion) |
| T ₁ I-d | Figure E.4 | AC For example: wind-turbine | DC (conversion) |

³ "in sync": when REN sources are available.

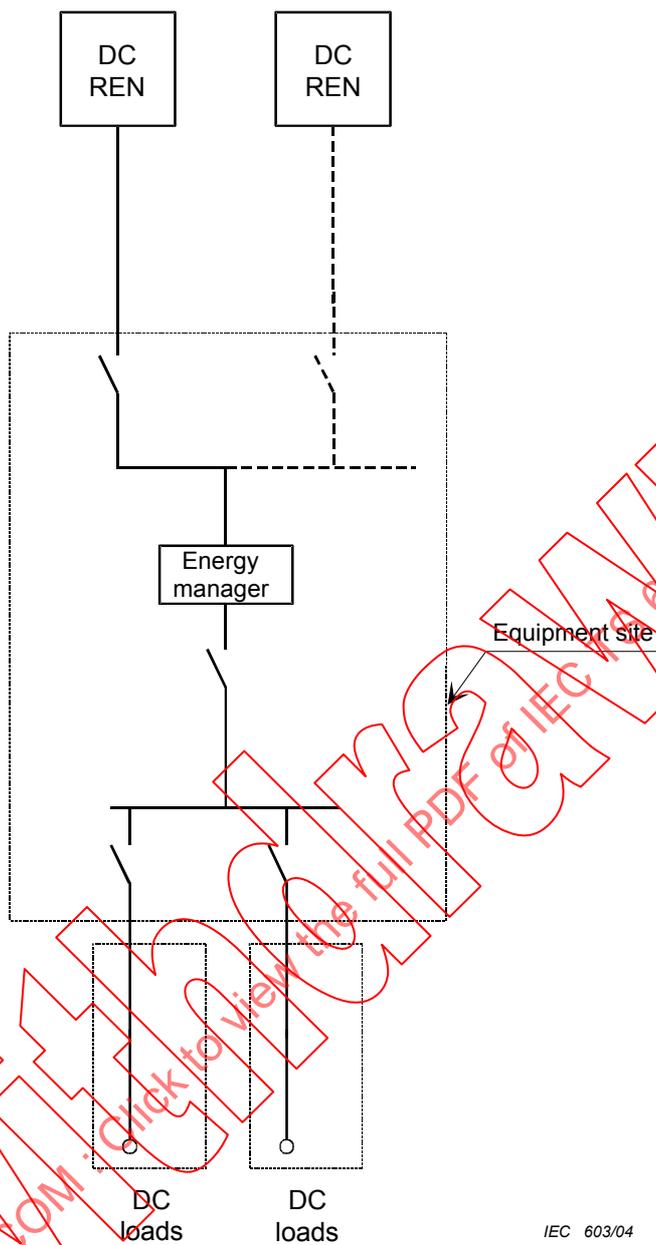

IEC 603/04

Figure E.1 – Type T_{1I}-a system

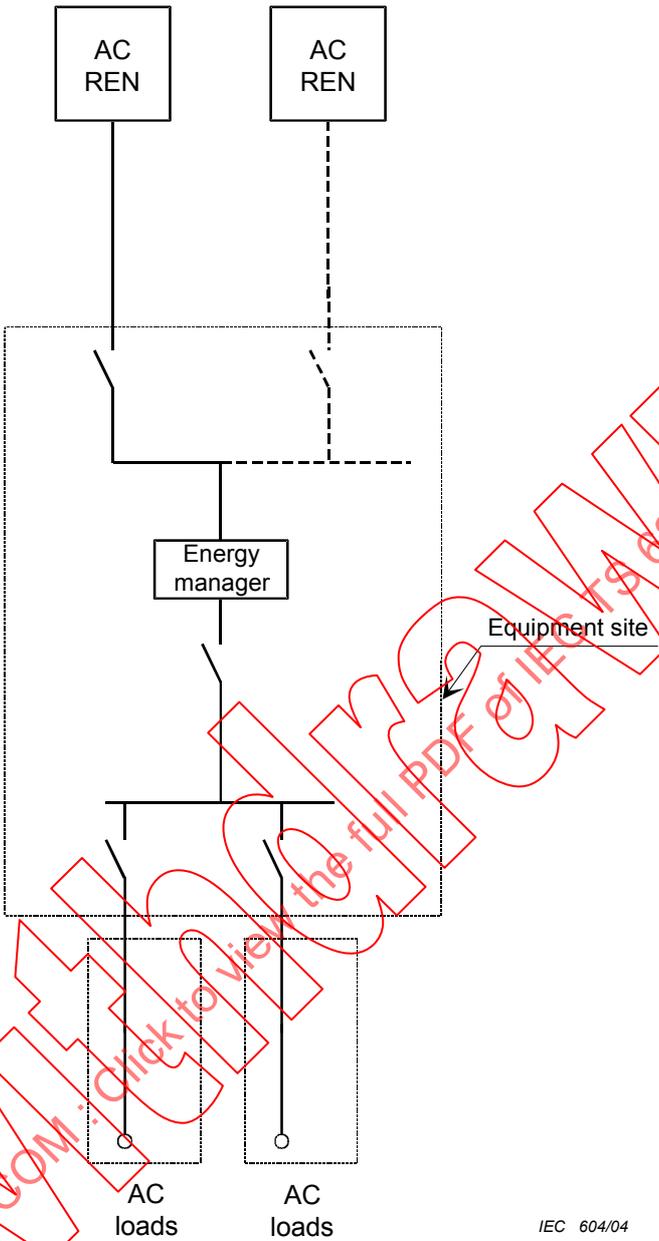

IEC 604/04

Figure E.2 – Type T₁I-b system

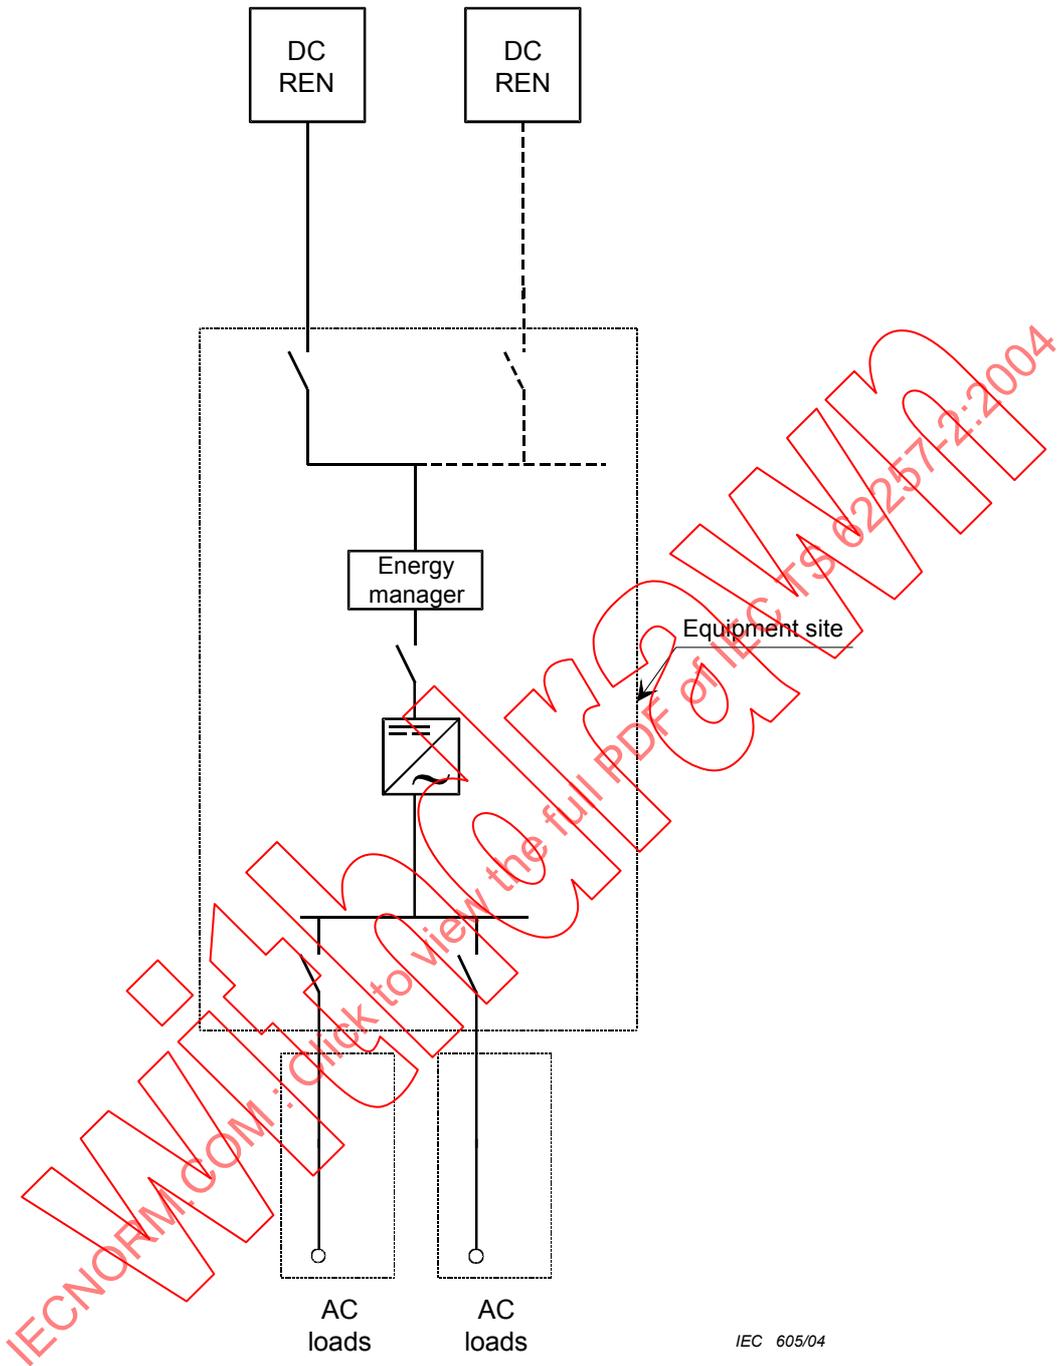


Figure E.3 – Type T_{1I-c} system

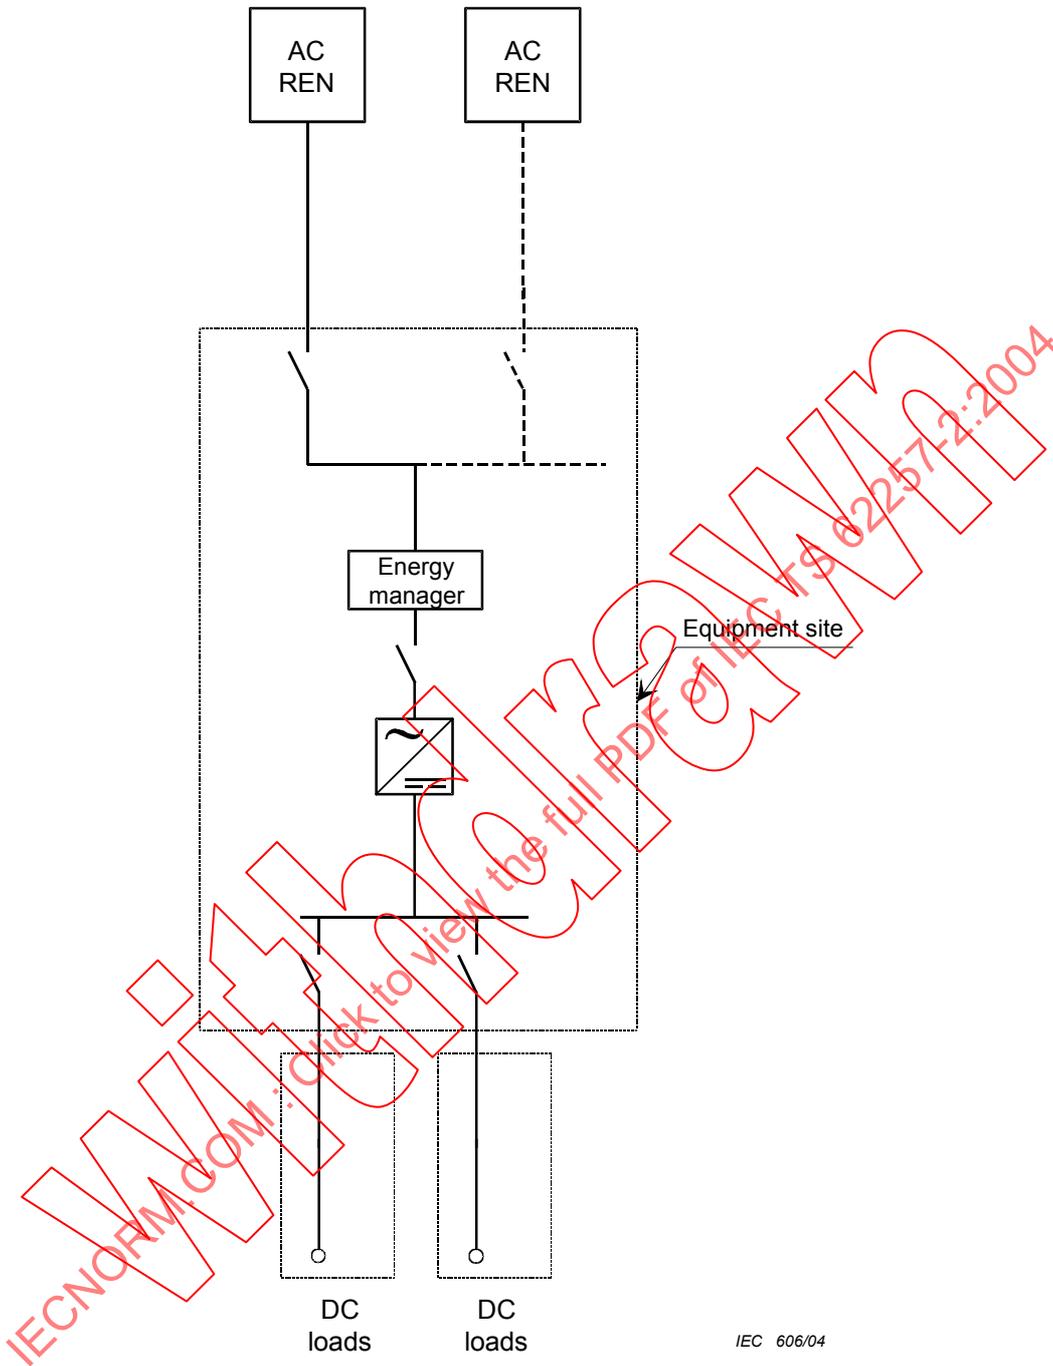


Figure E.4 – Type T_{1-l-d} system

E.2.2 Type T₂I: Individual electrification systems - "REN production with energy storage"


This type of system, illustrated by Figure E.5, is primarily intended for users who specify having electric power when the sun is not shining or the not wind blowing. Accordingly, the system should have a capability of storing energy. However, the user does not specify a back up supply and accepts that limited storage will mean that some times will occur when the supply fails).

The demand appliances shall have equipment adapted to the appropriate voltage (for example 24 V_{DC} or 230 V_{AC}). Where necessary, the system should take into consideration the constraints specific to direct current: power sockets, protection devices, earthing, etc.

The demand appliances may operate:

- on DC only,
- on AC only,
- dual DC/AC.

IECNORM.COM : Click to view the full PDF of IEC TS 62257-2:2004
Withdrawn

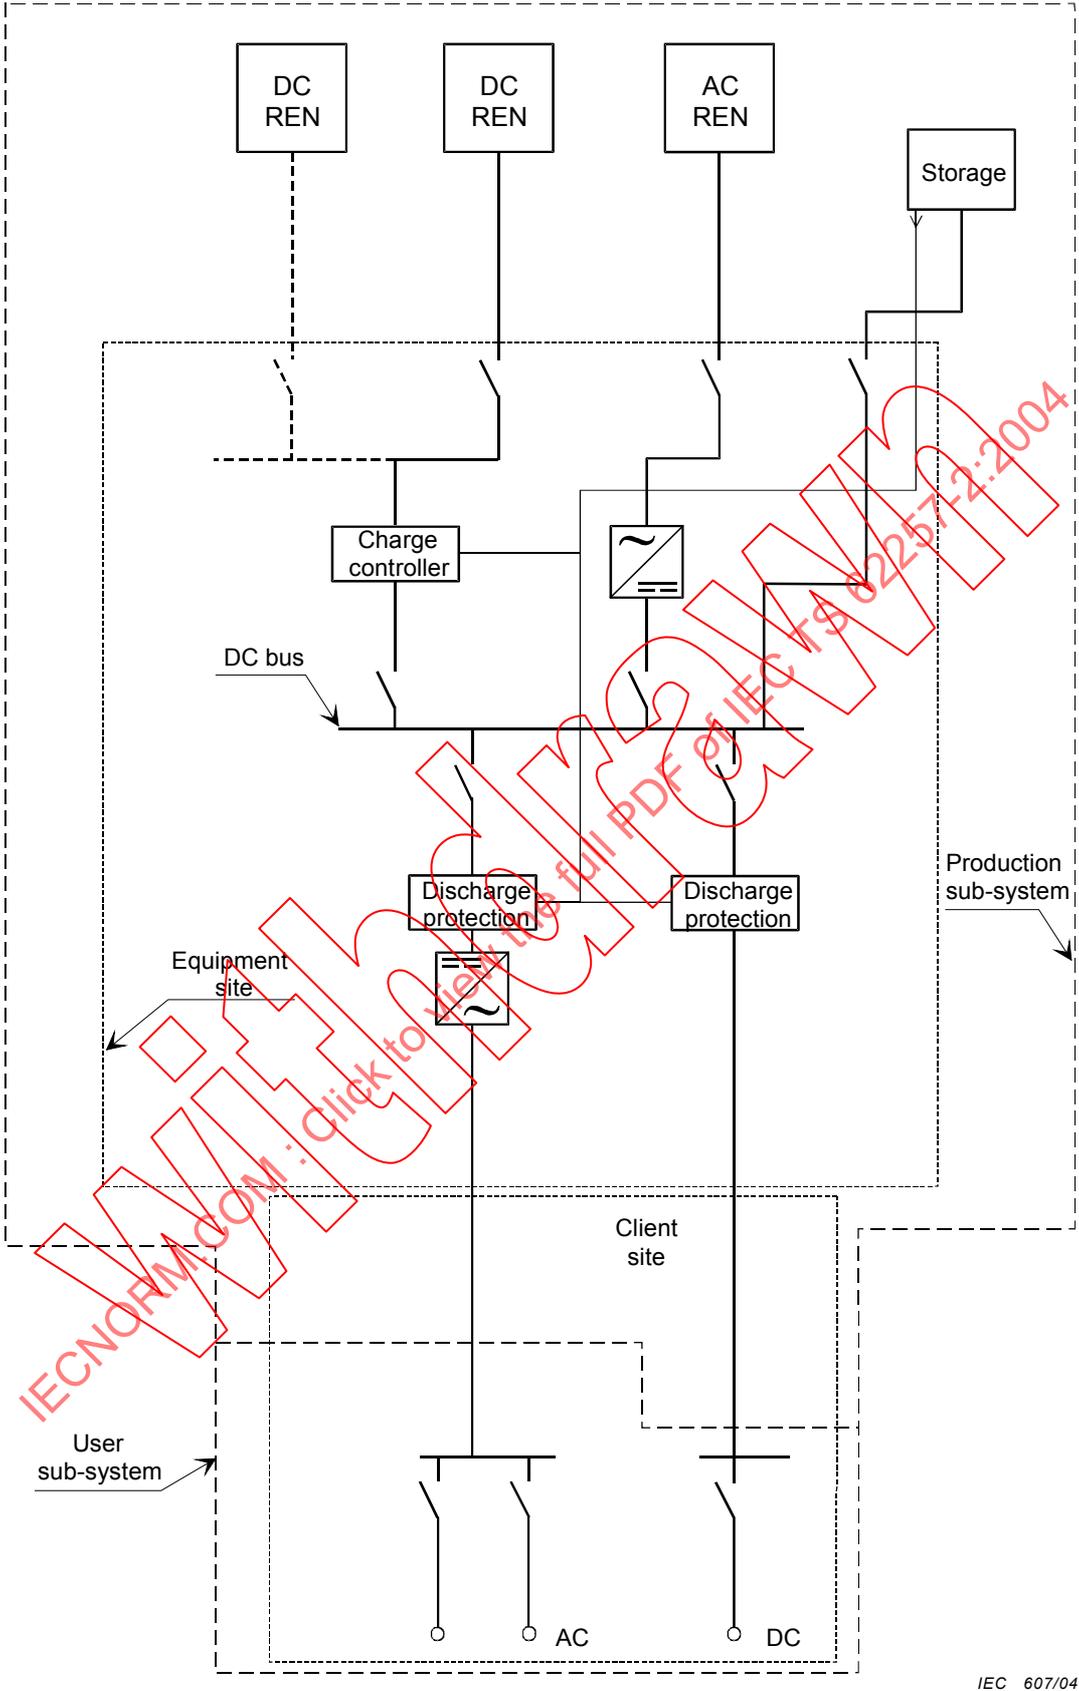

IEC 607/04

Figure E.5 – Type T₂I system


E.2.3 Type T₃I: Individual electrification systems: Type T₃I - "(REN + diesel) production without energy storage"

Table E.3 – List of cases, type T₃I

| Type | Figure number | Source | Application |
|--------------------|---------------|------------------------------------|-------------|
| T ₃ I-a | Figure E.6 | DC For example: PV | DC |
| T ₃ I-b | Figure E.7 | AC For example: wind-turbine | AC |

In such systems, there is no energy storage, but a "minimum storage" equipment is required to ensure the voltage level.


IECNORM.COM : Click to view the full PDF of IEC TS 62257-2:2004
Withdrawing

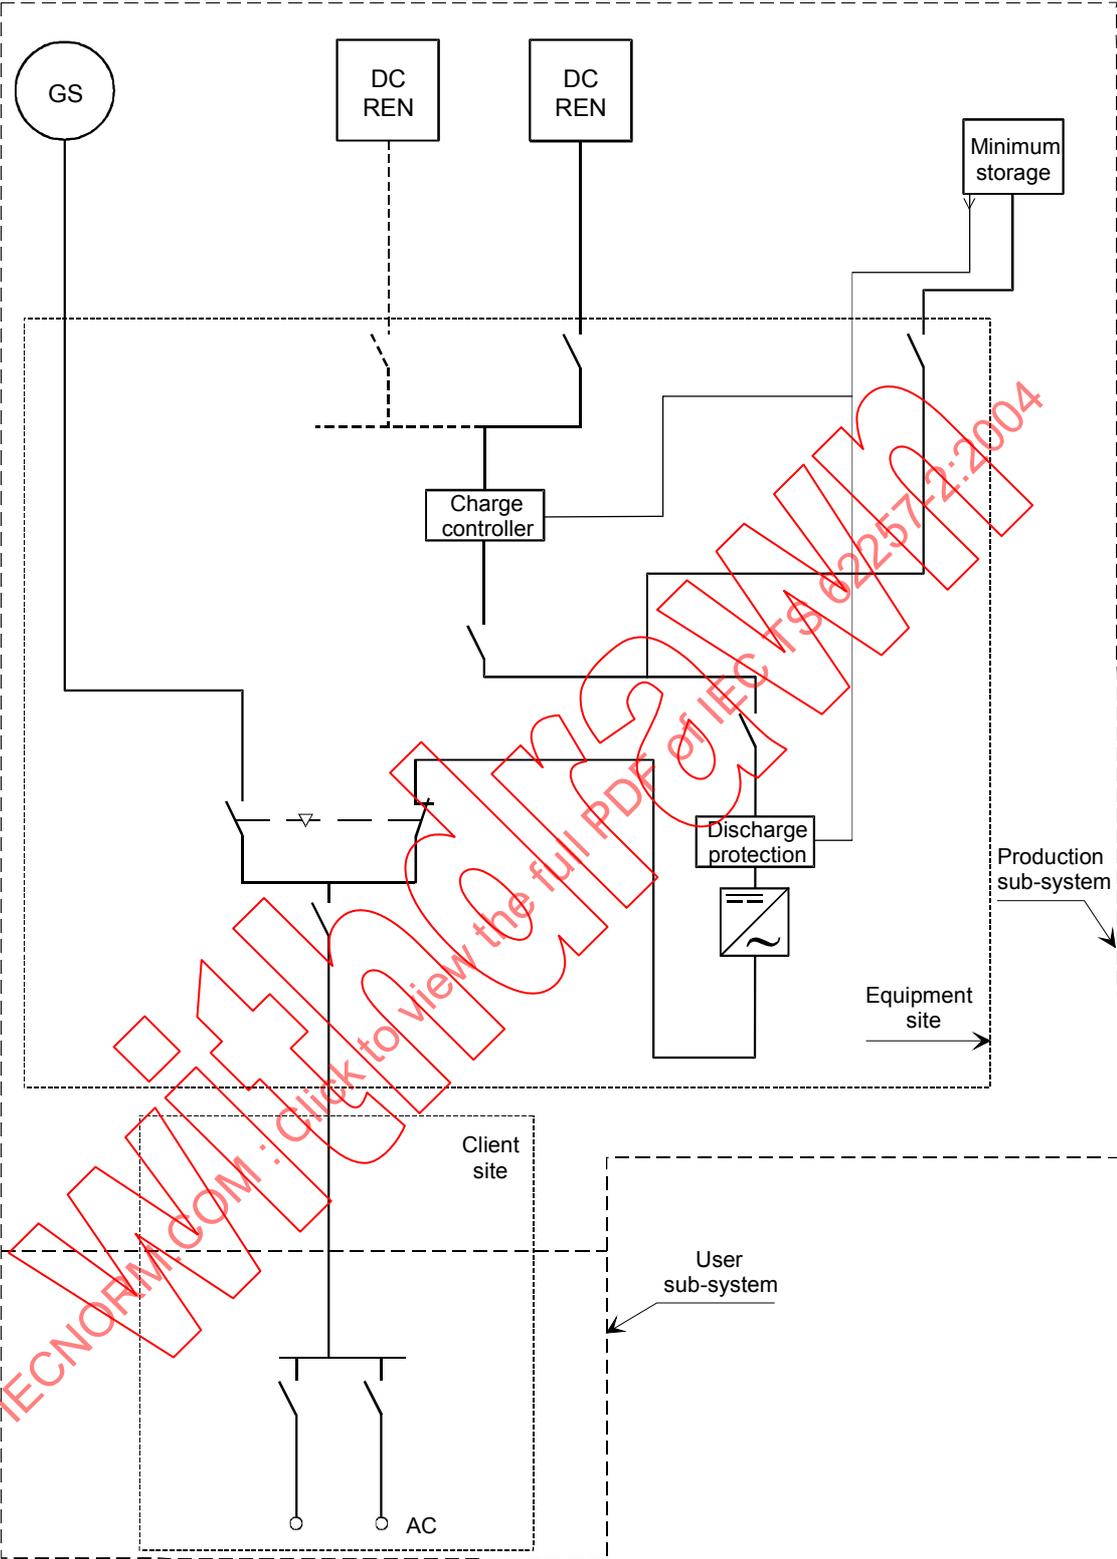

NOTE Minimum storage if applicable.

IEC 608/04

Figure E.6 – Type T₃I-a system

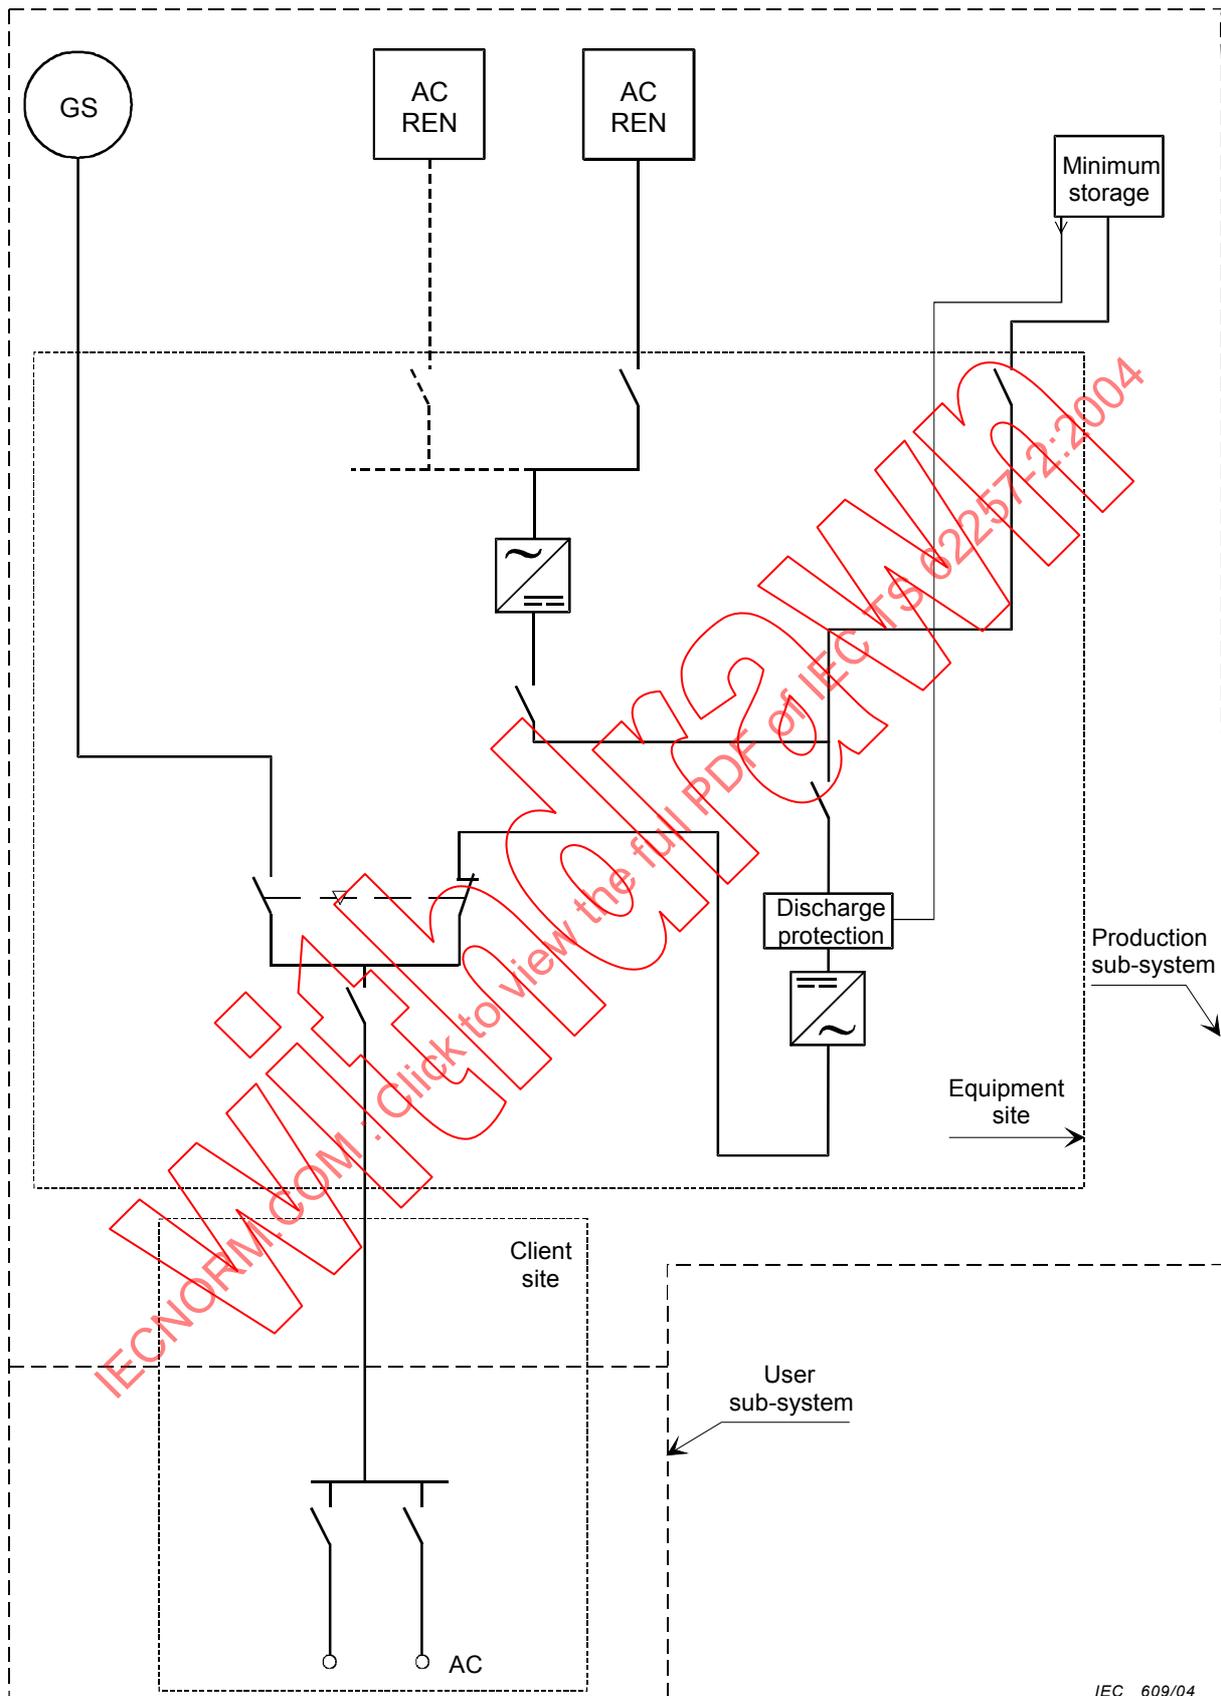

NOTE Minimum storage if applicable.

IEC 609/04

Figure E.7 – Type T_{3I-b} system

E.2.4 Type T₄I: Individual electrification systems: "(RE + diesel) production with energy storage"

This type of system, illustrated by Figure E.8 can meet energy requirements whether or not offset with relation to the production periods of renewable energy sources. The presence of a back-up set will provide the user with energy in unfavourable meteorological conditions without which storage would be unavailable or an over-dimensioned system would be required.

Two types of application can be supplied (DC and AC). Where both co-exist, two separate distribution circuits are required.


The AC application is normally supplied from storage batteries through an inverter. Typical reasons for starting the generator set would be:

- periodical recharging of the batteries (maintenance, equalising charge),
- imperative requirement to recharge batteries when the energy management system indicates "low battery",
- the need to supply user equipment when the system is unavailable.

The availability of the generator set will then enable a dedicated application to be supplied from time to time when it is not possible or undesirable to do so from renewable energy sources.

The applications supplied may operate on:

- DC.
- AC. In this case, AC applications can be backed up by the set in the event of breakdown of the system. The applications cannot be supplied simultaneously by the generator set and the RE systems.
- both types (dual AC/DC supply). AC type applications can be backed up by the generator set under the same circumstances as above.
- both types, together with use of AC current dedicated to the generator set. In this case, in addition to backup identical to that of the two previous types, the generator set can supply a dedicated application. Where the application requires more power than the RE system is capable of providing, it will be supplied exclusively by the back-up generators or batteries.
- AC. In this case, AC applications can be backed up by the set in the event of breakdown of the system. The applications can be supplied simultaneously by the generator set and the RE systems.

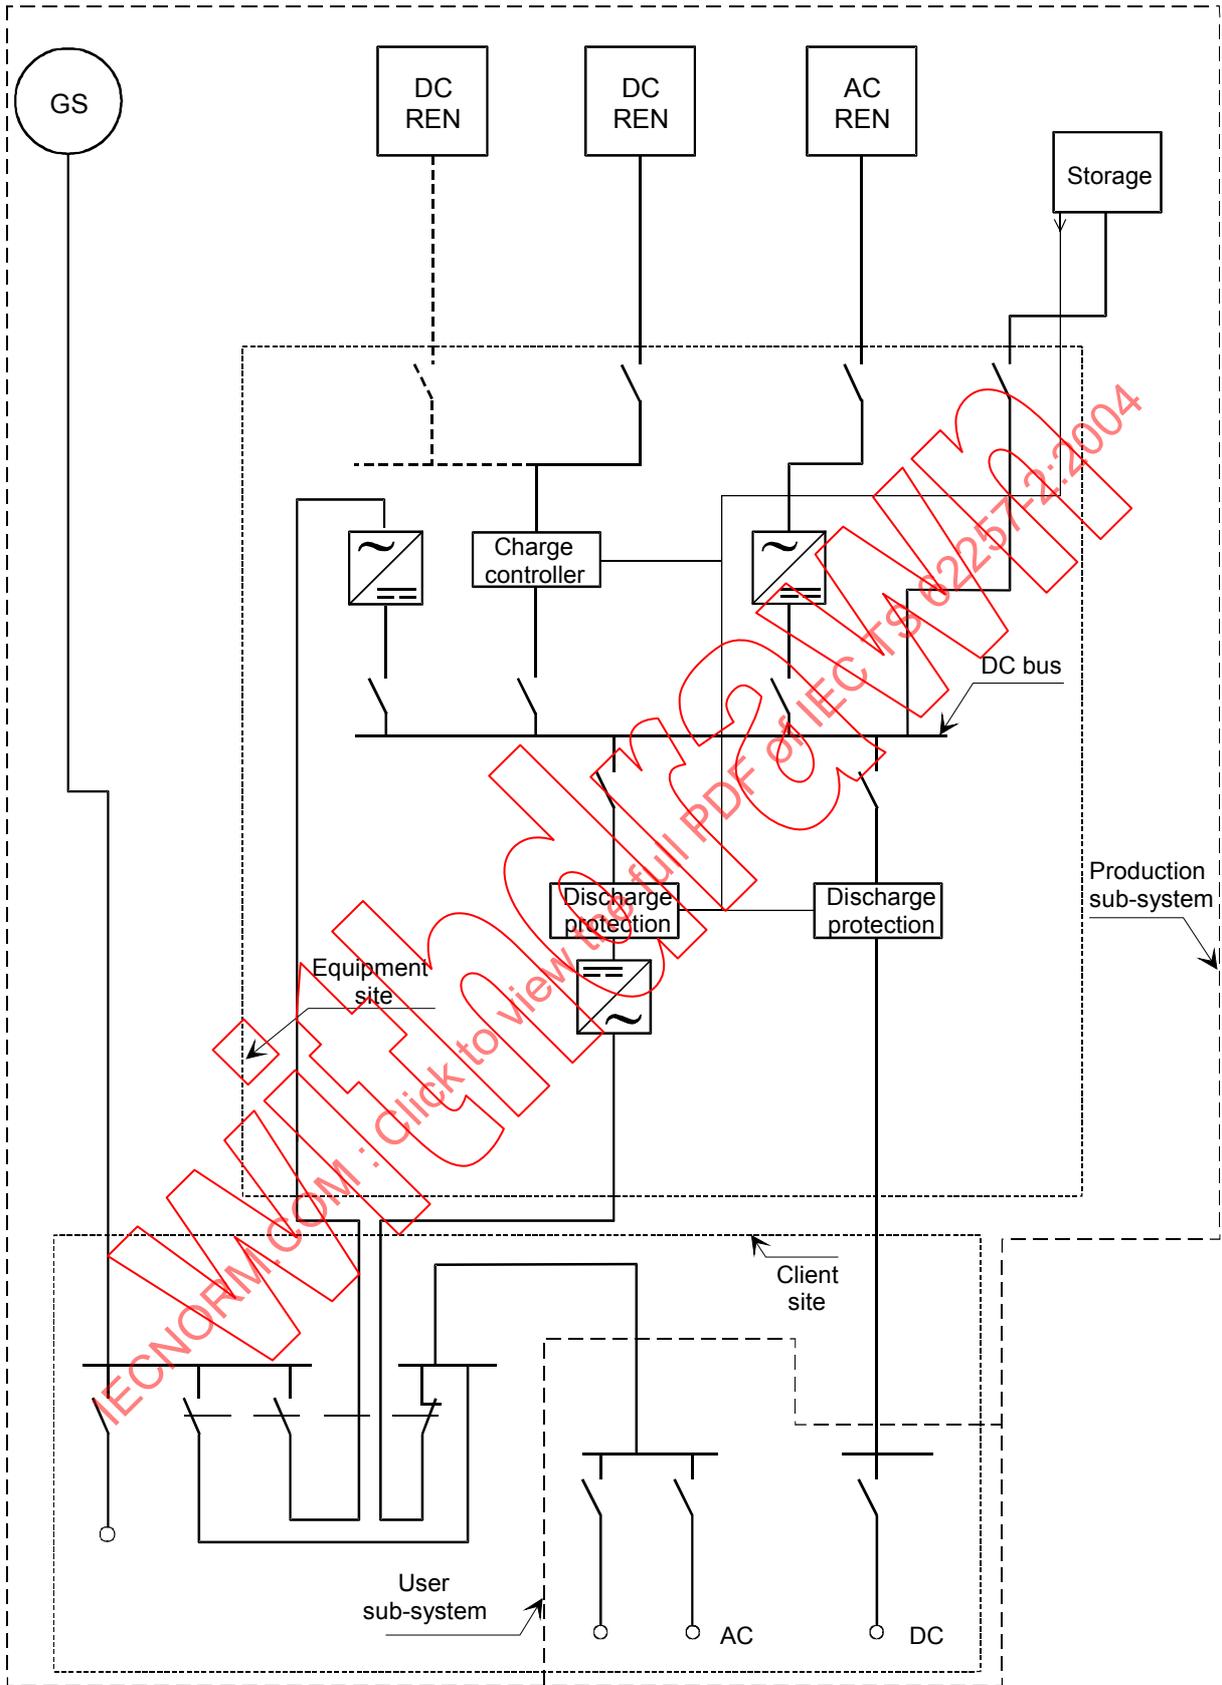

IEC 610/04

Figure E.8 – Type T₄I system

E.2.5 Type T₅I: Individual electrification systems: "genset only without storage"

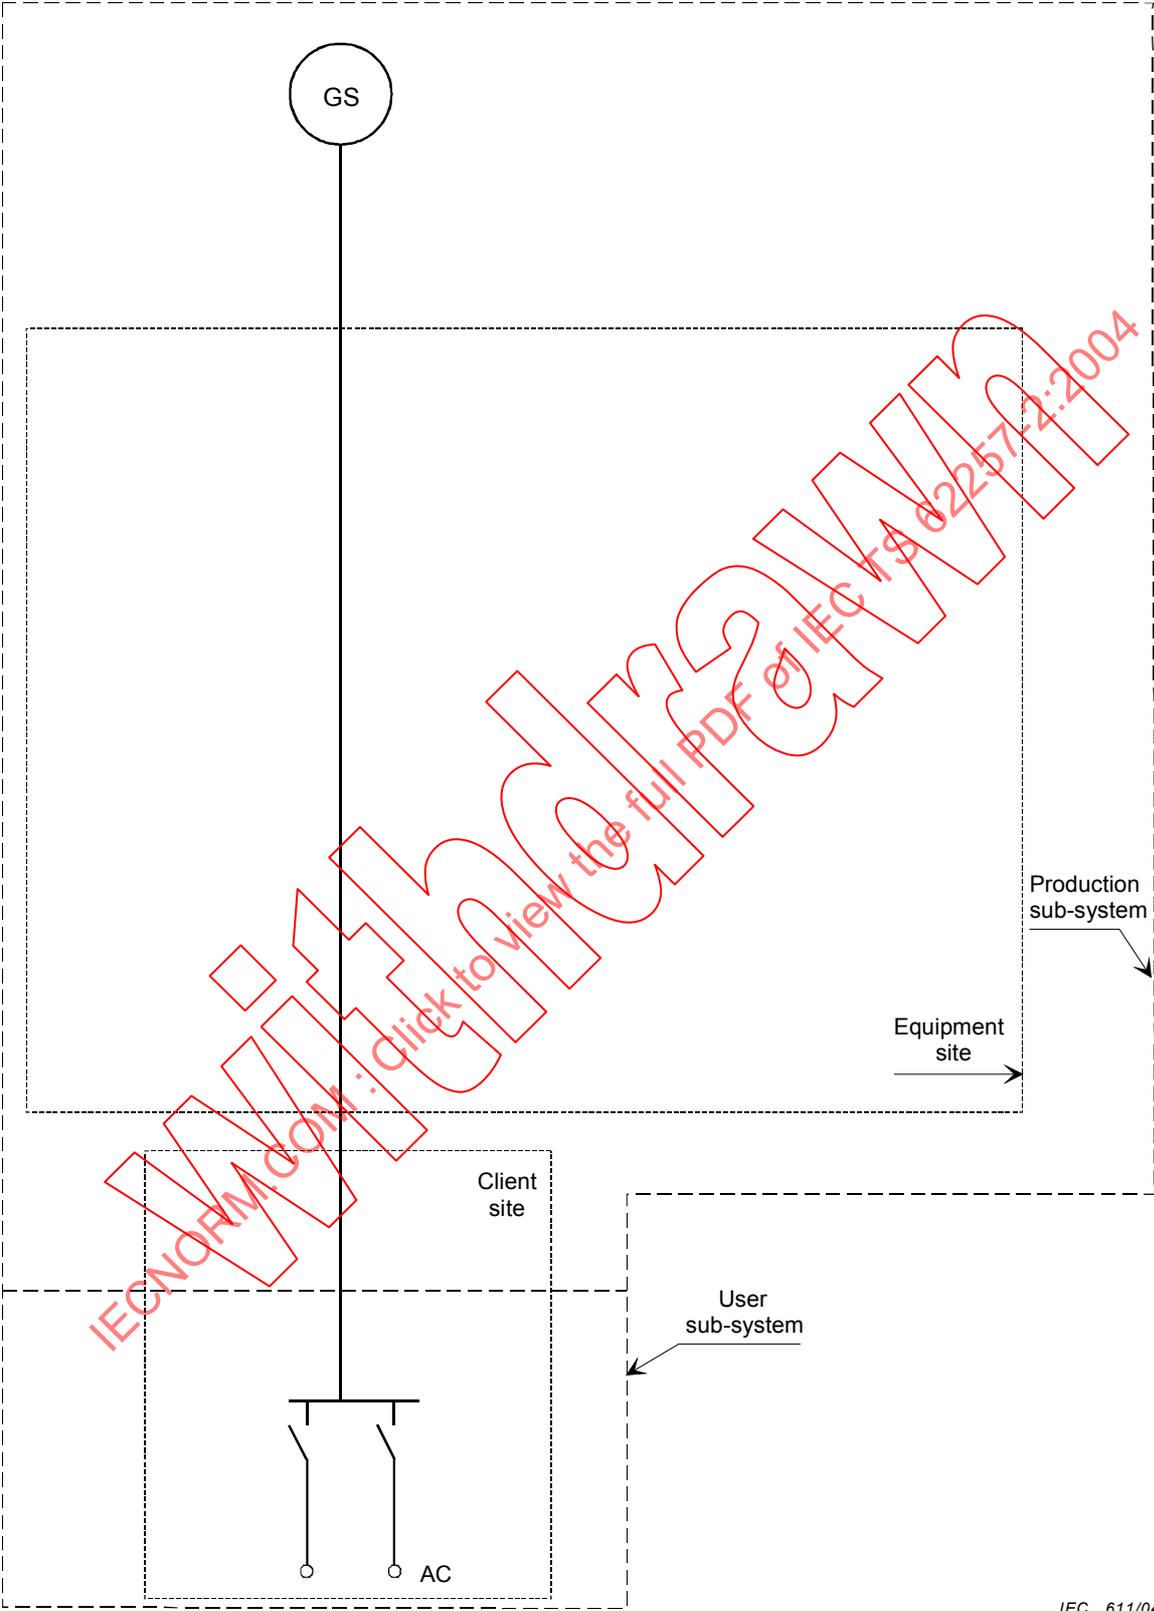


Figure E.9 – Type T₅I system

E.2.6 Type T₆I: Individual electrification systems: "genset only with storage"

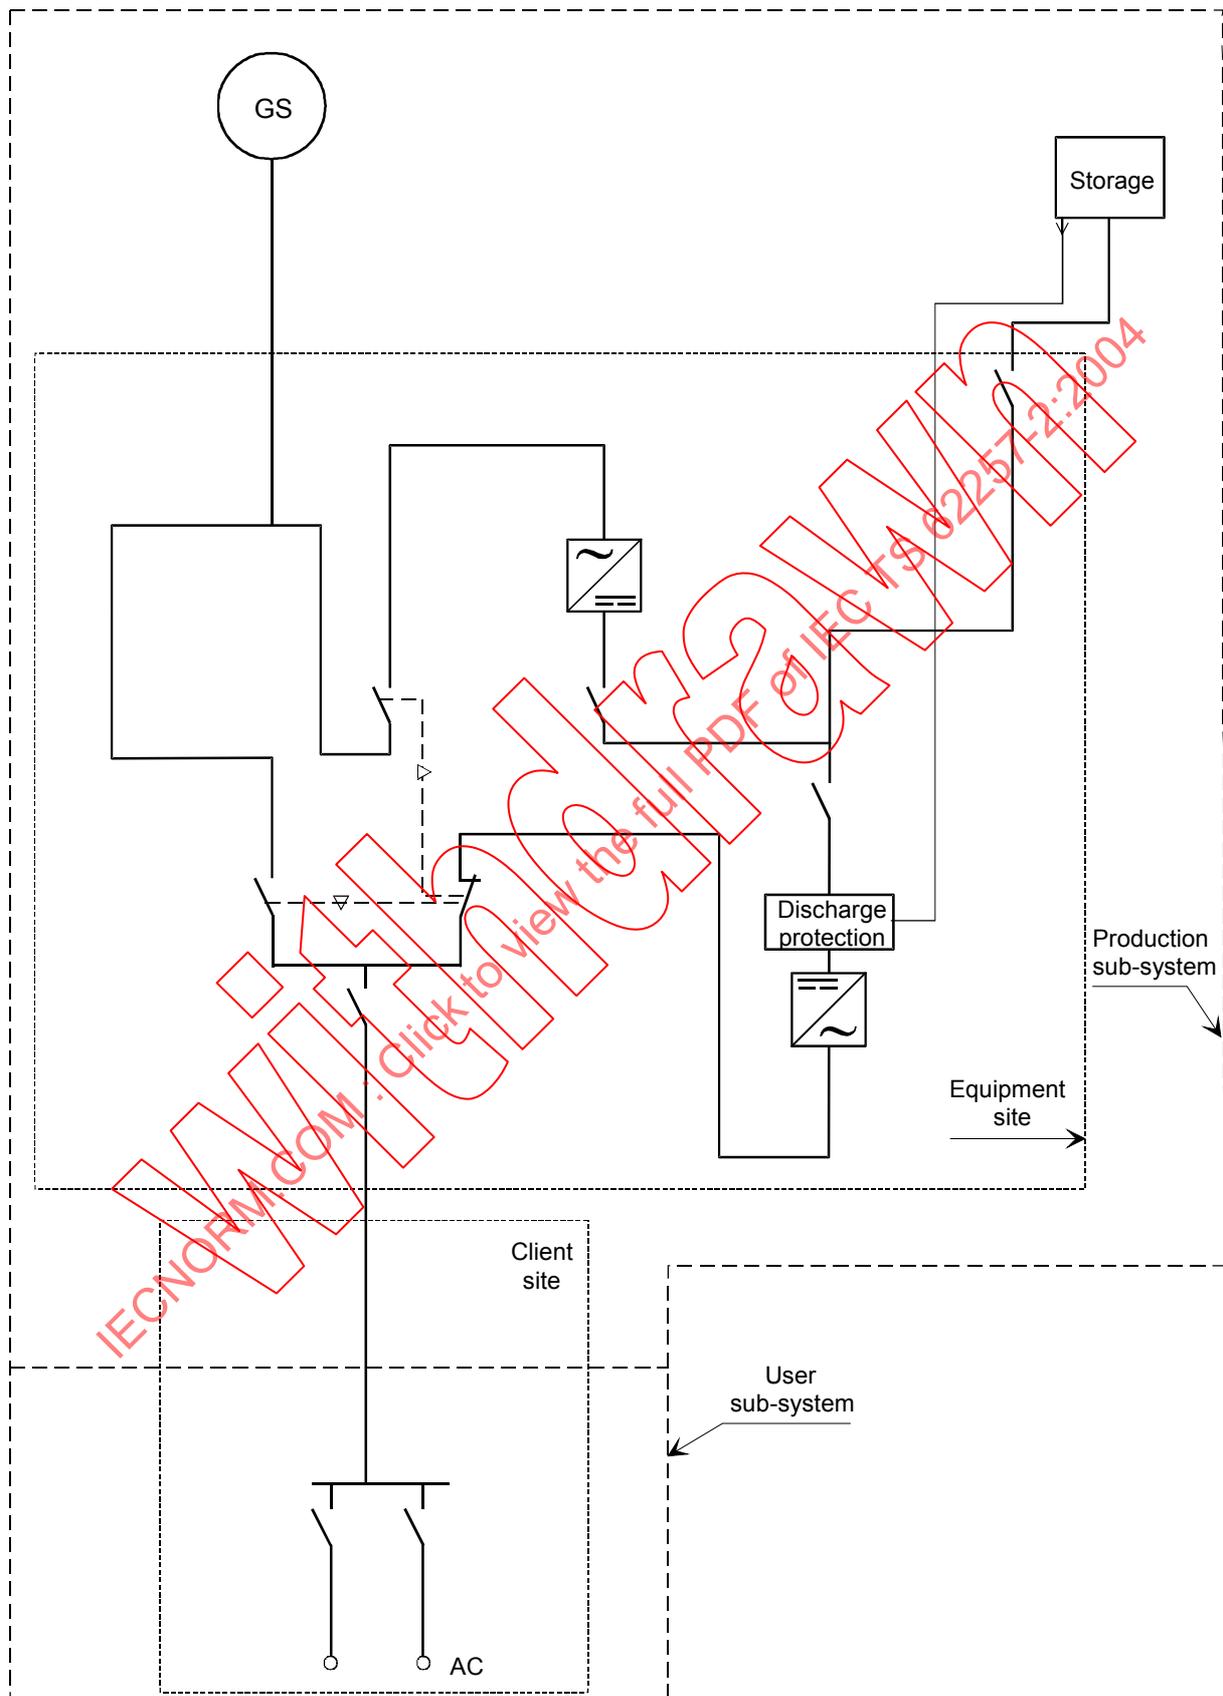


Figure E.10 – Type T₆I system

E.2.7 Type T₁C: Collective electrification systems: “REN only without storage”

Considered as non relevant system.

E.2.8 Type T₂C: Collective electrification systems: "REN Micropower plant supplying a microgrid"

The type T₂C systems illustrated by Figure E.12 consists of REN micropower plants featuring energy storage supplying a microgrid to supply power to a few users or even a considerable number of users in concentrated rural dwellings (groups of houses, hamlets).

The production sub-system consists of generators (photovoltaic and/or wind-turbine), distribution boards providing network offtakes and converters for supplying energy at standard voltages (generally 230 V AC).

The distribution subsystem also comprises offtakes connected to the distribution boards of the production subsystem, the overhead lines or buried cables and the terminal delivery boxes at the user points. It is organised into a radial structure illustrated by Figure E.11.

The application subsystem starts from the terminals downstream from the user's delivery box and comprises the installations and equipment of the user, operating exclusively on AC.

The general architecture of the global system is illustrated by Figure E.11.

IECNORM.COM : Click to view the full PDF of TS 62257-2:2004

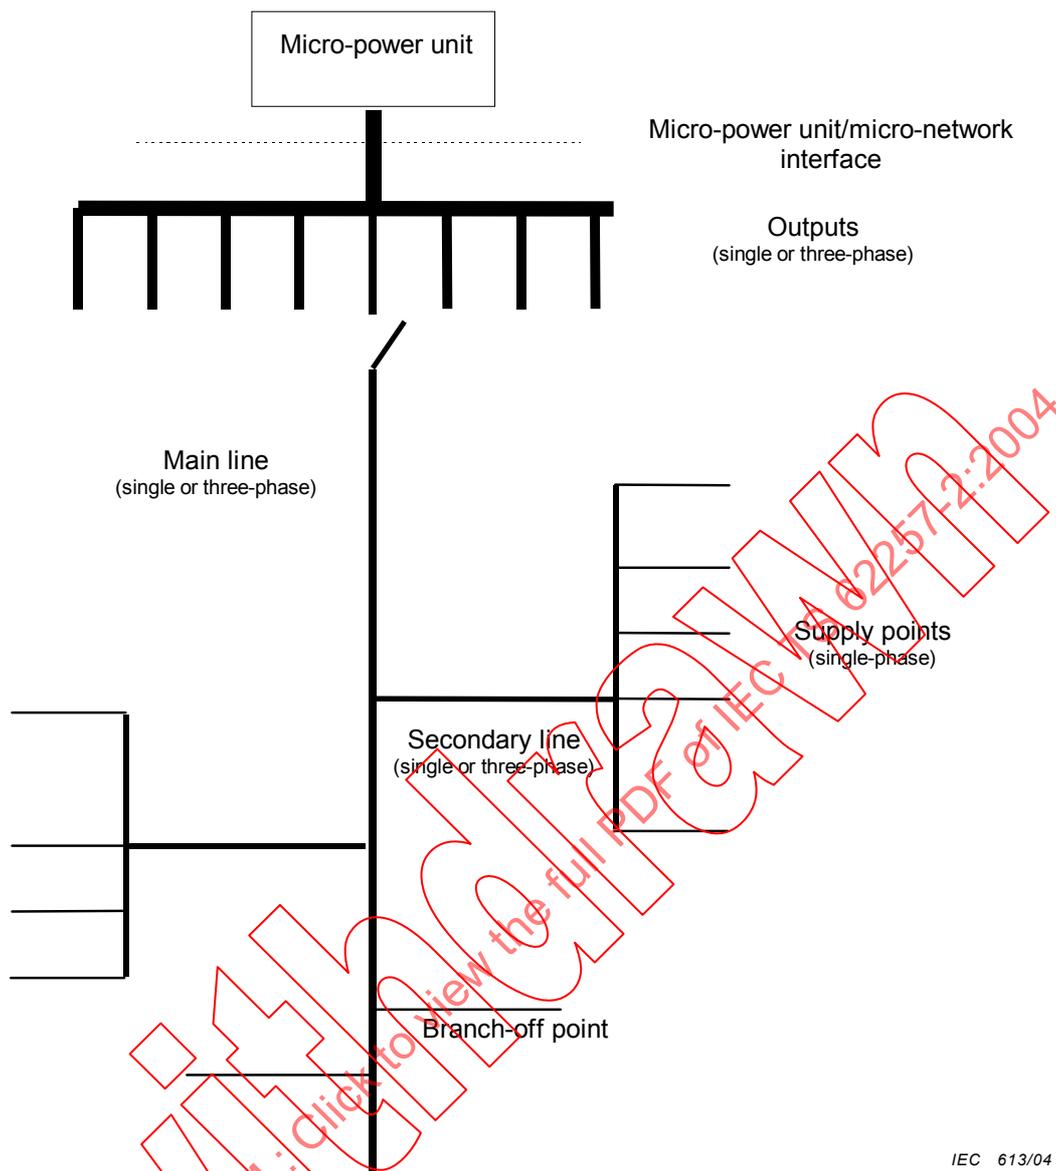


Figure E.11 – General architecture of a micropower plant supplying a microgrid