

# TECHNICAL SPECIFICATION

Reliability and availability evaluation of HVDC systems –  
Part 1: HVDC systems with line commutated converters

IECNORM.COM : Click to view the full PDF of IEC/TS 62672-1:2013

Without watermark



**THIS PUBLICATION IS COPYRIGHT PROTECTED**  
**Copyright © 2013 IEC, Geneva, Switzerland**

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.  
If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland

Tel.: +41 22 919 02 11  
Fax: +41 22 919 03 00  
[info@iec.ch](mailto:info@iec.ch)  
[www.iec.ch](http://www.iec.ch)

### About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

### About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

#### Useful links:

IEC publications search - [www.iec.ch/searchpub](http://www.iec.ch/searchpub)

The advanced search enables you to find IEC publications by a variety of criteria (reference number, text, technical committee,...).

It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)

Stay up to date on all new IEC publications. Just Published details all new publications released. Available on-line and also once a month by email.

Electropedia - [www.electropedia.org](http://www.electropedia.org)

The world's leading online dictionary of electronic and electrical terms containing more than 30 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary (IEV) on-line.

Customer Service Centre - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: [csc@iec.ch](mailto:csc@iec.ch).

IECNORM.COM : Click to view the full PDF file  
WATERMOUNTS 62872-1:2013

# TECHNICAL SPECIFICATION

Reliability and availability evaluation of HVDC systems –  
Part 1: HVDC systems with line commutated converters

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

PRICE CODE



ICS 29.240.01

ISBN 978-2-8322-1182-3

**Warning! Make sure that you obtained this publication from an authorized distributor.**

## CONTENTS

FOREWORD.....	5
1 Scope.....	7
2 Normative references .....	7
3 Terms, definitions and abbreviations .....	8
3.1 Outage terms.....	8
3.2 Capacity terms.....	8
3.3 Outage duration terms .....	9
3.4 Time categories .....	9
3.5 Availability and utilization terms.....	10
3.6 Commutation failure performance terms.....	11
3.7 Abbreviations and symbols .....	11
4 Classification of HVDC transmission system equipment.....	12
4.1 General.....	12
4.2 AC and auxiliary equipment (AC-E).....	12
4.2.1 General .....	12
4.2.2 AC filter and other reactive power equipment (AC-E.F).....	13
4.2.3 AC control and protection (AC-E.CP).....	13
4.2.4 Converter transformer (AC-E.TX).....	13
4.2.5 Synchronous compensator (AC-E.SC) .....	13
4.2.6 Auxiliary equipment and auxiliary power (AC-E.AX).....	13
4.2.7 Other AC switchyard equipment (AC-E.SW).....	13
4.3 Valves (V).....	14
4.3.1 General.....	14
4.3.2 Valve electrical (V.E) .....	14
4.3.3 Valve cooling (V.VC).....	14
4.4 DC control and protection equipment (C-P).....	14
4.4.1 General.....	14
4.4.2 Local control and protection (C-P.L) .....	14
4.4.3 Master control and protection (C-P.M) .....	14
4.4.4 Telecommunications equipment (C-P.T) .....	14
4.5 Primary DC equipment (DC-E) .....	15
4.5.1 General .....	15
4.5.2 DC filters (DC-E.F) .....	15
4.5.3 DC smoothing reactors (DC-E.SR).....	15
4.5.4 DC switching equipment (DC-E.SW) .....	15
4.5.5 DC measuring equipment (DC-E.ME).....	15
4.5.6 DC earth electrode (DC-E.GE).....	15
4.5.7 DC earth electrode line (DC-E.EL).....	15
4.5.8 Other DC switchyard and valve hall equipment (DC-E.O).....	15
4.6 Other (O) .....	16
4.7 DC transmission line (TL).....	16
4.7.1 General .....	16
4.7.2 DC overhead transmission line (TL-OH).....	16
4.7.3 DC underground/submarine cable (TL-C).....	16
4.8 External (EXT).....	16
5 Classification and severity of fault events and restoration codes.....	16

5.1	Classification of fault events .....	16
5.2	Severity codes .....	17
5.3	Restoration codes .....	18
6	Instructions for compilation of report .....	18
6.1	General .....	18
6.2	General instructions .....	18
6.3	Instructions for Table 2 and Table 3 .....	19
6.3.1	Section 1 .....	19
6.3.2	Section 2 .....	19
6.3.3	Sections 3, 4 and 5 .....	19
6.3.4	Section 6 .....	20
6.3.5	Section 7 .....	20
6.4	Instructions for Table 4 and Table 5 .....	23
6.4.1	Forced outages – Table 4 .....	23
6.4.2	Scheduled outages – Table 5 .....	23
6.5	Instructions for Table 6 .....	25
6.6	Instructions for Table 7 .....	26
6.7	Instructions for Table 8 .....	26
6.8	Instructions for Table 9 .....	27
7	Interpretation and evaluation of reports .....	28
7.1	Calculation of outage duration .....	28
7.2	External events .....	28
7.3	Protective operation .....	28
7.4	Performance of special controls .....	28
Annex A (informative)	Outage log form and examples .....	30
A.1	Example of an outage log .....	30
A.2	Examples of application of rule f) of 6.3 scheduled outage during a forced outage .....	32
A.2.1	Case 1: Scheduled outage does not increase ODF or extends outage duration .....	32
A.2.2	Case 2: Scheduled outage increases ODF .....	33
A.3	Examples of application of rule g) of 6.3 second outage during an outage .....	34
A.3.1	Case 1: Second outage does not increase ODF or extends outage duration .....	34
A.3.2	Case 2: Second outage extends duration .....	35
A.3.3	Case 3: Second outage with variable ODF .....	36
Annex B (informative)	Sample annual report .....	37
Bibliography	.....	43
Figure A.1	– Scheduled outage does not increase ODF or extends outage duration .....	32
Figure A.2	– Scheduled outage increases ODF .....	33
Figure A.3	– Second outage does not increase ODF or extends outage duration .....	34
Figure A.4	– Second outage extends duration .....	35
Figure A.5	– Second outage with variable ODF .....	36
Table 1	– Classification of fault events .....	17
Table 2	– DC system performance for back-to-back systems and for two terminal systems reporting jointly (corresponding to Table 1 of Cigré TB 346:2008) .....	21

Table 3 – DC system performance for multi-terminal systems and for stations reporting separately as part of two-terminal systems (corresponding to Table 1 M/S of Cigré TB 346:2008) .....	22
Table 4 – Forced outages HVDC substation (corresponding to Table 2FS of Cigré TB 346:2008) .....	24
Table 5 – Scheduled outages HVDC substation (corresponding to Table 2 SS of Cigré TB 346:2008) .....	24
Table 6 – HVDC overhead line protection operations (corresponding to Table 3 of Cigré TB 346:2008).....	25
Table 7 – AC system faults and commutation failure starts (back-to-back, two terminal or multi-terminal systems) (corresponding to Table 4 of Cigré TB 346:2008).....	26
Table 8 – Converter unit hours and semiconductor devices failed (corresponding to Table 5 of Cigré TB 346:2008).....	27
Table 9 – Forced outage summary (corresponding to Table 6 of Cigré TB 346:2008).....	29
Table A.1 – Example of an outage log.....	30
Table B.1 – DC system performance for two terminal systems reporting jointly .....	37
Table B.2 – Forced outages HVDC substation .....	38
Table B.3 – Scheduled outages HVDC substation.....	39
Table B.4 – HVDC overhead line protection operations.....	40
Table B.5 – AC system faults and commutation failure starts.....	40
Table B.6 – Converter unit hours and semiconductor devices failed.....	41
Table B.7 – Forced outage summary.....	42

IECNORM.COM : Click to view the full PDF of IEC TS 62672-1:2013

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**RELIABILITY AND AVAILABILITY EVALUATION OF HVDC SYSTEMS –****Part 1: HVDC systems with line commutated converters**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

The main task of IEC technical committees is to prepare International Standards. In exceptional circumstances, a technical committee may propose the publication of a technical specification when

- the required support cannot be obtained for the publication of an International Standard, despite repeated efforts, or
- the subject is still under technical development or where, for any other reason, there is the future but no immediate possibility of an agreement on an International Standard.

Technical specifications are subject to review within three years of publication to decide whether they can be transformed into International Standards.

IEC/TS 62672-1, which is a technical specification, has been prepared by IEC technical committee 115: High voltage direct current (HVDC) transmission for DC voltages above 100 kV.

The text of this technical specification is based on the following documents:

Enquiry draft	Report on voting
115/68/DTS	115/75/RVC

Full information on the voting for the approval of this technical specification can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

Annexes A and B are for information only.

A list of all parts in the IEC 62672 series, published under the general title *Reliability and availability evaluation of HVDC systems*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- transformed into an International standard,
- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

IECNORM.COM : Click to view the full PDF of IEC 62672-1:2013

## RELIABILITY AND AVAILABILITY EVALUATION OF HVDC SYSTEMS –

### Part 1: HVDC systems with line commutated converters

#### 1 Scope

This part of IEC 62672 applies to all line-commutated high-voltage direct current (HVDC) transmission systems used for power exchange in utility systems. HVDC stations with voltage sourced converters (VSC) are not covered.

In order to assess the operational performance of HVDC transmission systems, reliability and availability need to be evaluated. For this purpose the HVDC users/owners are encouraged to compile reports on an annual basis based on the recommendations given in this Technical Specification. The purpose of this part of IEC 62672 is to define a standardized reporting protocol so that data collected from different HVDC transmission systems can be compared on an equitable basis. It is recommended that such reports are sent to Cigré SC B4, "HVDC and Power Electronics" (<http://b4.cigre.org>) who collects such data and publishes a survey of HVDC systems throughout the world on a bi-annual basis.

This part of IEC 62672 covers point-to-point transmission systems, back-to-back interconnections and multi-terminal transmission systems. For point-to-point systems and back-to-back interconnections, i.e. two-terminal systems, statistics are to be reported based on the total transmission capability from the sending end to the receiving end measured at a given point. If, however, the two terminals are operated by different users/owners, or are composed of equipment of different vintage or of equipment from different suppliers, statistics can be reported on an individual station basis if so desired by those responsible for reporting. In such a case, the outage should only be reported under the originating converter station taking care not to report the same event twice. For distributed multi-terminal systems, i.e. systems with more than two terminals, statistics are to be reported separately for each converter station based on its own individual capability.

Multi-terminal systems, incorporating parallel converters but having only two converter stations on the d.c. line, can be considered as either point-to-point systems or as multi-terminal systems for purpose of reporting. Therefore, statistics for this special type of multi-terminal system can be reported based on either total transmission capability or on individual station capability. If the converters at one station use different technology, converter station statistics can be reported separately for each different type of capacity if desired. Multiple bipoles are also to be reported individually. Special mention should be given in the text and in the tabulations to any common events resulting in bipolar outages.

NOTE Usually the agreement between the purchaser and the turnkey suppliers of the HVDC converter station includes specific requirements regarding contractual evaluation. Such specific requirements will govern over this Technical Specification.

#### 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60633:1998, *Terminology for high-voltage direct current (HVDC) transmission* Amendment 1:2009

### 3 Terms, definitions and abbreviations

For the purpose of this document, the following terms and definitions apply.

#### 3.1 Outage terms

##### 3.1.1 outage

state in which the HVDC system is unavailable for operation at its rated continuous capacity due to an event directly related to the converter station equipment or d.c. transmission line

Note 1 to entry: Failure of equipment not needed for power transmission shall not be considered as an outage for purposes of this evaluation. AC system related outages will be recorded but not included in HVDC system reliability calculations.

Note 2 to entry: For purposes of this evaluation, outages taken for major reconfiguration or upgrading, such as addition of converters, shall not be reported.

##### 3.1.2 scheduled outage

outage, which is either planned or which can be deferred until a suitable time

Note 1 to entry: Scheduled outages can be planned well in advance, primarily for preventive maintenance purposes such as annual maintenance program. During such planned maintenance outage, it is usual to work on several different equipment or systems concurrently. It is not necessary to allocate such outage time to individual equipment categories. Only the elapsed time should be reported in Table 5 as "PM".

Note 2 to entry: Classified under the scheduled outage category are also outages for work which could be postponed until a suitable time (usually night or weekend) but cannot be postponed until the next planned outage. Equipment category code in Table 5 should be used to identify the affected equipment. This includes discretionary outages based on operating policies, user/owner's preference and maintenance of redundant equipment.

Note 3 to entry: If the scheduled outage is extended due to additional work which would otherwise have necessitated a forced outage, the excess period is to be counted as a forced outage.

##### 3.1.3 forced outage

state in which equipment is unavailable for normal operation but is not in the scheduled outage state

###### 3.1.3.1

##### trips

sudden interruption in transmission by automatic protective action or manual emergency shutdown

###### 3.1.3.2

##### other forced outages

other unexpected HVDC equipment problems that force immediate reduction in capacity of HVDC converter stations or system but do not cause or require a trip

Note 1 to entry: Also in this category are outages caused by start-up or de-block delays caused by HVDC equipment.

Note 2 to entry: In some cases the opportunity exists during forced outages to perform some of the repairs or maintenance that would otherwise be performed during the next scheduled outage. See 6.3, rule (f).

#### 3.2 Capacity terms

##### 3.2.1 rated capacity

$P_m$

maximum capacity (MW), excluding the added capacity available through means of redundant equipment, for which continuous operation under designed conditions is possible

Note 1 to entry: For two-terminal systems reporting jointly, the rated capacity is referred to a particular point in the system, usually at one or the other converter station. For multi-terminal systems or two-terminal systems reporting separately, the rated capacity refers to the rating of the individual converter station.

Note 2 to entry: When the maximum continuous capacity varies according to seasonal conditions, the highest value can be used as the capacity for the purpose of reports prepared according to this Specification for reason of simplicity. However this excludes over-load capability such as available during low – ambient temperature.

### 3.2.2 outage capacity

$P_o$   
capacity reduction (MW) which the outage would have caused if the system were operating at its rated capacity ( $P_m$ ) at the time of the outage

Note 1 to entry: The outage capacity is referred to the same point in the system used for defining  $P_m$ .

### 3.2.3 outage derating factor ODF

ratio of outage capacity to rated capacity

$$\text{ODF} = P_o / P_m$$

## 3.3 Outage duration terms

### 3.3.1 actual outage duration AOD

time elapsed in decimal hours between the start and the end of an outage

Note 1 to entry: The start of an outage is typically the first switching action related to the outage. The end of an outage is typically the last switching action related to return of the equipment to operational readiness.

Note 2 to entry: In some contractual evaluations between Purchaser and Supplier, AOD can be subjected to correction to adjust for long waiting times, administrative delays, non-availability of tools and tackles, non-availability of spare parts or other needed resources including trained man power, delay in permits etc.

### 3.3.2 equivalent outage duration EOD

actual outage duration (AOD) in decimal hours, multiplied by the outage derating factor (ODF), so as to take account of partial loss of capacity

$$\text{EOD} = \text{AOD} \times \text{ODF}$$

Note 1 to entry: Each equivalent outage duration (EOD) may be classified according to the type of outage involved: equivalent forced outage duration (EFOD) and equivalent scheduled outage duration (ESOD).

## 3.4 Time categories

### 3.4.1 period hours PH

number of calendar hours in the reporting period

Note 1 to entry: In a full calendar year the period hours are 8760, or 8784 in leap years.

Note 2 to entry: If the equipment is commissioned part way through a year, the period hours will be proportionately less.

### 3.4.2 actual outage hours AOH

sum of actual outage durations within the reporting period

$$AOH = \Sigma AOD$$

Note 1 to entry: The actual outage hour (AOH) may be classified according to the type of outage involved: actual forced outage hours (AFOH) and, actual scheduled outage hours (ASOH).

$$AFOH = \Sigma AFOD$$

$$ASOH = \Sigma ASOD$$

### 3.4.3 equivalent outage hours EOH

sum of equivalent outage durations within the reporting period

$$EOH = \Sigma EOD$$

Note 1 to entry: The equivalent outage hours (EOH) may be classified according to the type of outage involved: equivalent forced outage hours (EFOH) and equivalent scheduled outage hours (ESOH).

$$EFOH = \Sigma EFOD$$

$$ESOH = \Sigma ESOD$$

## 3.5 Availability and utilization terms

### 3.5.1 energy unavailability EU

measure of the energy which could not have been transmitted due to outages

Note 1 to entry: The energy unavailability is calculated based on the same point in the system used for defining  $P_m$ .

Note 2 to entry: The energy unavailability (EU) may be classified according to the type of outage involved: forced energy unavailability (FEU) and scheduled energy unavailability (SEU).

$$EU = (EOH / PH) \times 100 \quad (\%)$$

$$FEU = (EFOH / PH) \times 100 \quad (\%)$$

$$SEU = (ESOH / PH) \times 100 \quad (\%)$$

Note 3 to entry: SEU covers both scheduled energy unavailability due to planned outage (SEUP) as well as scheduled energy unavailability due to deferred outage (SEUD).

### 3.5.2 energy availability EA

measure of the energy which could have been transmitted except for limitations of capacity due to outages

Note 1 to entry: The energy availability is calculated based on the same point in the system used for defining  $P_m$ .

$$EA = 100 - EU \quad (\%)$$

### 3.5.3 energy utilization U

factor giving a measure of the energy actually transmitted over the system.

Note 1 to entry: The energy utilization is calculated based on the same point in the system used for defining  $P_m$ .

$$U = \frac{E_{total}}{P_m \cdot P_h} = \frac{E_{total}}{P_m \cdot P_h} \times 100 \quad \%$$

Where

$E_{\text{total}}$  is the total energy transmitted (MWh);

$P_m$  is the rated capacity (MW);

$P_h$  is the period hours (h).

Note 2 to entry: The total energy transmitted is the sum of energy exported and energy imported (expressed in MWh), both referred to the point at which  $P_m$  is defined.

### 3.6 Commutation failure performance terms

#### 3.6.1

##### **recordable a.c. system fault**

a.c. system fault which causes one or more of the inverter a.c. bus phase voltages, referred to the terminals of the harmonic filter, to drop immediately following the fault initiation below 90 % of the voltage prior to the fault

Note 1 to entry: AC system faults at, or near, the rectifier are not relevant in this context and are not required to be included in this reporting. An exception to this rule is a special case where the network topology dictates that an a.c. fault near the rectifier also produces a simultaneous recordable fault at the inverter or where specific converter configuration (e.g. no smoothing reactor) is susceptible to a commutation failure in rectifier operation.

#### 3.6.2

##### **commutation failure start**

##### **CFS(A)**

initiation or onset of commutation failure(s) in any valve group immediately following the occurrence of an a.c. system fault, regardless of whether or not the a.c. fault is “recordable” as defined in 3.6.1

Note 1 to entry: Commutation failures as a result of control problems or switching events are not to be included.

#### 3.6.3

##### **commutation failure start**

##### **CFS(B)**

initiation or onset of commutation failure(s) in any valve group as a result of control problems, switching events or other causes, but excluding those initiated by a.c. system faults under 3.6.2 above.

### 3.7 Abbreviations and symbols

For the purpose of this document, the following abbreviations apply.

AC (a.c.)	alternating current
AFOH	actual forced outage hours
AOD	actual outage duration
AOH	actual outage hours
ASOH	actual scheduled outage hours
CFS	commutation failure start
CT	current transformer
DC (d.c.)	direct current
DMR	dedicated metallic return (conductor)
EA	energy availability
EFOD	equivalent forced outage duration
EFOH	equivalent forced outage hours
EOD	equivalent outage duration
EOH	equivalent outage hours

ESOD	equivalent scheduled outage duration
ESOH	equivalent scheduled outage hours
EU	energy unavailability
FEU	forced energy unavailability
HVDC	high voltage direct current
PH	period hours
PLC	power line carrier
$P_m$	rated capacity
$P_o$	outage capacity
ODF	outage derating factor
RAM	reliability, availability, maintainability
RI	radio interference
SEU	scheduled energy unavailability
SEUD	scheduled energy unavailability deferred
SEUP	scheduled energy unavailability planned
STATCOM	static compensator
SVC	static var compensator
$U$	(energy) utilisation

## 4 Classification of HVDC transmission system equipment

### 4.1 General

For the purpose of reporting the cause of capacity reduction or converter outages, converter station equipment is classified into major categories. Failure of equipment resulting in an outage or loss of converter capacity shall be charged to the category to which the failed equipment belongs. The outage may be forced as a direct consequence of the failure or mis-operation, or the outage may be scheduled due to maintenance requirements. Only scheduled outages classified as deferred are categorized according to the equipment type.

The major categories are listed in the following subclauses and are as follows:

- a) AC and auxiliary equipment (AC-E): 4.2
- b) Valves (V): 4.3
- c) DC control and protection equipment (C-P): 4.4
- d) Primary DC equipment (DC-E): 4.5
- e) Other (O): 4.6
- f) DC transmission line (TL): 4.7
- g) External (EXT): 4.8.

The above major categories are further divided into subcategories.

### 4.2 AC and auxiliary equipment (AC-E)

#### 4.2.1 General

This major category covers all a.c. main circuit equipment at the converter station. This includes everything from the incoming a.c. connection to the external connecting clamp on the valve winding bushing of the converter transformer. This category also covers low voltage auxiliary power, valve cooling equipment (including pumps, fans, electrical auxiliaries etc. but

excluding parts at high potential integral within valve, see 4.3.3) and a.c. control and protection.

NOTE This category does not apply to capacity outages resulting from events in the a.c. network external to the converter station.

The "AC and auxiliary equipment" category is divided into six subcategories described in 4.2.2 to 4.2.7.

#### **4.2.2 AC filter and other reactive power equipment (AC-E.F)**

Loss of converter station capacity due to failure of a.c. filters (passive and/or active) or other reactive power compensation equipment shall be assigned to this subcategory. The types of components included in this subcategory are capacitors, reactors, resistors, CTs and arresters comprised within the a.c. filtering or reactive power compensation equipment of the converter station.

NOTE Associated disconnectors/breakers, etc. with filters/reactive compensated equipment are excluded from this subcategory, as those are included in 4.2.7.

AC PLC/RI filters, SVCs, series capacitors (including those between converter transformers and valves), STATCOM, etc. when included in a converter station shall also be reported under this subcategory.

#### **4.2.3 AC control and protection (AC-E.CP)**

Loss of converter station capacity due to failure of a.c. protections, a.c. controls, or a.c. current and voltage measuring devices shall be assigned to this subcategory. AC protections or control could be for the main circuit equipment, for the auxiliary power equipment or for the valve cooling equipment.

NOTE CTs with a.c. filters, CTs on transformer bushings are not reported in this subcategory.

#### **4.2.4 Converter transformer (AC-E.TX)**

Loss of converter station capacity due to failure of a converter transformer shall be assigned to this subcategory. Any equipment integral with the converter transformer such as tap changers, bushings, bushing CTs or transformer cooling equipment is included in this subcategory.

#### **4.2.5 Synchronous compensator (AC-E.SC)**

Loss of converter station capacity due to failure of a synchronous compensator shall be charged to this subcategory. Anything integral or directly related to the synchronous machine such as its cooling system or exciter is included in this subcategory.

#### **4.2.6 Auxiliary equipment and auxiliary power (AC-E.AX)**

Loss of converter station capacity due to failure or miss-operation of any auxiliary equipment shall be assigned to this subcategory. Such equipment includes auxiliary transformers, pumps, battery chargers, heat exchangers, cooling system process instrumentation, low voltage switchgear, motor control centres, fire protection and civil works.

#### **4.2.7 Other AC switchyard equipment (AC-E.SW)**

Loss of converter station capacity due to failure of circuit breakers, disconnected switches or earthing switches in the a.c. switchyard (including for a.c. filtering and reactive power compensation) shall be assigned to this subcategory. Also included are other a.c. switchyard equipment such as a.c. surge arresters, bus-work or insulators.

### **4.3 Valves (V)**

#### **4.3.1 General**

This major category covers all parts of the thyristor valve itself. The valve is the complete operative array forming an arm, or part of an arm of the converter bridge. It includes all auxiliaries and components integral with the valve and forming part of the operative array.

The "valves" category is divided into two subcategories described in 4.3.2 and 4.3.3.

#### **4.3.2 Valve electrical (V.E)**

Loss of converter station capacity due to any failure of the valve except for those related to the part of the valve cooling system integral with the valve shall be assigned to this subcategory.

#### **4.3.3 Valve cooling (V.VC)**

Loss of converter station capacity due to any failure of the valve, related to the valve cooling system at high potential integral with the valve, shall be assigned to this subcategory.

### **4.4 DC control and protection equipment (C-P)**

#### **4.4.1 General**

This major category covers the equipment used for control of the overall HVDC system and for the control, monitoring and protection of each HVDC substation excluding control and protection of a conventional type which is included in 4.2.3. This also excludes the a.c. measuring transducers which are included in 4.2.3 as well as d.c. measuring transducers which are included in 4.5.5.

NOTE The equipment provided for the coding of control and indication information to be sent over a telecommunication circuit and the circuit itself is included. Devices such as disconnectors, circuit-breakers and transformer tap changers which can actually perform the control or protection action are excluded from this subcategory.

The "DC control and protection equipment" category is divided into three subcategories described in 4.4.2 to 4.4.4.

#### **4.4.2 Local control and protection (C-P.L)**

Loss of converter station capacity due to any failure of the control, protection or monitoring equipment of the local HVDC station shall be assigned to this subcategory. Examples would include failures of the converter firing control, current and voltage regulators, converter and d.c. yard protections, valve control and protection, and local station control sequences.

#### **4.4.3 Master control and protection (C-P.M)**

Loss of converter station capacity due to any failure of the master control equipment shall be assigned to this subcategory. The master control equipment usually includes bipolar control, inter-station coordination of current and voltage orders, inter-station sequences, auxiliary controls such as damping controls or higher level controls such as run-back/run-up, power control or frequency control.

#### **4.4.4 Telecommunications equipment (C-P.T)**

Loss of converter station capacity due to any failure of the equipment provided for the coding of control and indication information to be sent over a telecommunication circuit as well as the telecommunication circuit itself, for example, optical communication or microwave or PLC, shall be assigned to this subcategory.

NOTE The earth wire itself, when optical fibre is integrated with such wire, is included in 4.7.

## **4.5 Primary DC equipment (DC-E)**

### **4.5.1 General**

This major category covers all equipment at the HVDC substations except for that in the three categories "a.c. and auxiliary equipment" which includes converter transformers, "valves" and "d.c. control and protection equipment".

The "Primary DC equipment" category is divided into seven subcategories presented in 4.5.2 to 4.5.8.

### **4.5.2 DC filters (DC-E.F)**

Loss of converter station capacity due to failure of shunt/series d.c. filters (active and/or passive) or d.c.-side PLC/RI filters shall be assigned to this subcategory. Types of components included in this subcategory are capacitors, reactors, resistors, CTs and arresters, etc. which comprise the d.c. filtering of the converter station.

### **4.5.3 DC smoothing reactors (DC-E.SR)**

Loss of converter station capacity due to failure of the d.c. smoothing reactors shall be assigned to this subcategory.

### **4.5.4 DC switching equipment (DC-E.SW)**

Loss of converter station capacity due to failure of any d.c. circuit breakers, d.c. commutating switches, d.c. disconnect switches, isolating switches, by-pass switches or earthing switches shall be assigned to this subcategory.

Components forming active/passive circuits for any commutating switch/breaker shall also be included under this subcategory.

### **4.5.5 DC measuring equipment (DC-E.ME)**

Loss of converter station capacity due to failure of the direct current and voltage measuring devices shall be assigned to this subcategory.

### **4.5.6 DC earth electrode (DC-E.GE)**

Loss of converter station capacity due to problems with or failure of the earth electrode and its local termination or connecting equipment shall be assigned to this subcategory.

This shall cover all type of electrode arrangements for example land, shore, sea type.

NOTE Earth electrodes are also called as ground electrodes.

### **4.5.7 DC earth electrode line (DC-E.EL)**

Loss of converter station capacity due to failure of the earth electrode line or cable shall be assigned to this subcategory.

### **4.5.8 Other DC switchyard and valve hall equipment (DC-E.O)**

Loss of converter station capacity due to failure of other d.c. switchyard and valve hall equipment shall be assigned to this subcategory. This subcategory includes valve arresters and other d.c.-side surge arresters, bus-work insulators and wall bushings.

NOTE Arresters within filters are excluded from this subcategory, as those are included in 4.5.2.

#### 4.6 Other (O)

Loss of converter station capacity or extension of outage duration due to human error, administrative delays or unknown causes shall be assigned to this category. If, after an outage due to an event in another category, the outage duration is extended due to human error in maintenance or operation, the consequential extension in outage time shall be assigned to this category.

#### 4.7 DC transmission line (TL)

##### 4.7.1 General

Loss of transmission capacity due to faults on the d.c. transmission line, which may be overhead, underground or submarine cable shall be assigned to this category. Only permanent d.c. line faults are classified as forced outages and successful automatic restarts after a d.c. line fault are excluded.

When a dedicated metallic return (DMR) conductor is used, instead of electrode lines and electrode arrangement, such DMR shall be considered under this category.

The "DC transmission line" category is divided into two subcategories described in 4.7.2 and 4.7.3.

##### 4.7.2 DC overhead transmission line (TL-OH)

Loss of transmission capacity due to any faults on the d.c. overhead transmission line shall be assigned to this subcategory.

##### 4.7.3 DC underground/submarine cable (TL-C)

Loss of transmission capacity due to faults on the underground or submarine cable or cable terminal shall be assigned to this subcategory. This category covers auxiliaries associated with oil-filled cables but does not cover outages related to false operation of line protection.

#### 4.8 External (EXT)

Loss of transmission capacity due to faults or events in the a.c. network external to the converter station shall be assigned to this category. Examples include a.c. network instability, a.c. over-voltage in excess of the converter protective rating, short circuit level lower than the minimum design level, loss of a.c. outlet line(s) or loss of generation etc.

Loss of transmission capacity due to events (including natural disasters) or operating conditions beyond specified design considerations shall also be assigned to this category. Examples include higher ambient temperature or higher pollution than the maximum specified design levels etc.

### 5 Classification and severity of fault events and restoration codes

#### 5.1 Classification of fault events

Fault events are classified according to the converter equipment classification given in Clause 4 and summarised as in below Table 1:

**Table 1 – Classification of fault events**

Fault classification	Outage category and subcategory codes
AC and auxiliary equipment AC filter and other reactive power equipment AC control and protection Converter transformer Synchronous compensator Auxiliary equipment and auxiliary power Other AC switchyard equipment	AC-E AC-E.F AC-E.CP AC-E.TX AC-E.SC AC-E.AX AC-E.SW
Valves Valve electrical Valve cooling (integral to valve)	V V.E V.VC
DC control and protection equipment Local control and protection Master control and protection Telecommunication equipment	C-P C-P.L C-P.M C-P.T
Primary DC Equipment DC filters DC smoothing reactor DC switching equipment DC measuring equipment DC earth electrode DC earth electrode line Other DC switchyard and valve hall equipment	DC-E DC-E.F DC-E.SR DC-E.SW DC-E.ME DC-E.GE DC-E.EL DC-E.O
Other	O
DC transmission line DC overhead transmission line DC underground/submarine cable	TL TL-OH TL-C
External	EXT

## 5.2 Severity codes

Each forced outage shall be classified according to an outage severity code as follows:

- BP bipolar total outage
- P monopolar total outage
- C converter total outage
- RP other capacity reduction

For reporting purposes, bipolar outage is one in which both poles are lost as a direct or immediate consequence of a single event. Since such bipole outages are of special significance, it is advised to include a narrative discussion of every bipole outage in the discussion section of the report. The discussion should indicate whether both poles tripped simultaneously, and if not, the sequence of events involved.

Overlapping pole outages due to different events or with a prior outage of the other pole should be reported as separate pole outages, not as a bipole outage. A converter or valve group is the smallest switchable operating unit of capacity in the converter station.

Overlapping converter outages in the same pole due to different events or with prior outages of another converter should be reported as two separate converter outages rather than a pole outage.

For converter stations not having series or parallel connected converters, the converter category does not apply. For converter stations having only a single d.c. circuit or monopole, the bipole category does not apply. If an outage affects multiple bipoles, each bipole should be reported separately but the event should be described in the annual report.

Failures or outages of redundant equipment which do not result in a loss of converter capacity are not reported.

### 5.3 Restoration codes

Each outage is classified according to a restoration code as follows:

Equipment causing outage is repaired or adjusted	R
Failed equipment is replaced by spare	S
No equipment failure, manual restart	M

## 6 Instructions for compilation of report

### 6.1 General

A report on the operational performance of each HVDC power transmission system or back-to-back interconnection in commercial service is recommended to be prepared for each year. These reports are to be made in accordance with this Specification to ensure uniformity and comparability of the data. From time to time older systems, for which further data is judged to be of only marginal value, can be specifically excluded from the reporting. For an established system, the reporting period is to be from January to December. For a system in its initial calendar year of commercial operation, the report is to cover the period from the start of commercial operation to December of that year.

### 6.2 General instructions

The blank tables given in this Specification, completed in accordance with these instructions, will form the basis of each annual report. It is recognized that these blank tables may not suit exactly each and every HVDC station/system, but since the comparison of performance of different HVDC systems is a central purpose of the evaluation and reporting, the standard blank tables shall be used throughout.

The tables are recommended to be commented with an explanation of the major contributions of unavailability.

The presentation of information or clarification of the data in the tables shall be considered under the following topics:

- a) Utilization: State the reason for exceptionally high or low figures, for example, low generator availability.
- b) Availability: Elaborate on major or abnormal factors influencing availability, for example, special maintenance requirements, expansion or upgrade of equipment.
- c) Reliability: Give reasons behind exceptionally high outage rate, for example, repetitive outage due to an intermittent control problem difficult to find and not initially corrected.
- d) Severity of outage: Comment on the relative frequency of valve group, pole or bipole outages. Elaborate on major outages especially bipolar outages.

NOTE An example of Tables that have been filled out is shown in Annex B for information.

### 6.3 Instructions for Table 2 and Table 3

#### 6.3.1 Section 1

For back-to-back and for two-terminal systems reporting in the preferred manner as a combined system, complete lines 1.1 and 1.2 with the HVDC substation names so as to indicate the direction of the energy flow and give the total energy in each direction in GWh. In the case of an HVDC back-to-back system, identify the direction of energy flow by using the names of the a.c. systems so connected. In the case of converters operating in a multi-terminal system or in a two-terminal system which is reporting separately, record station energy for both rectifier and inverter operation by completing one Table 3 for each station.

#### 6.3.2 Section 2

Calculate the Energy Utilization per cent in accordance with clause 3.5.3 and complete the line. For two-terminal systems, the preferred method of Energy Utilization is calculation based on a system basis whereas for multi-terminal systems, Energy Utilization is calculated and reported separately for each converter station.

#### 6.3.3 Sections 3, 4 and 5

In order to calculate the availability and unavailabilities for these sections, it is necessary to maintain a log of outages through the year. The system log can most conveniently be prepared by first preparing separate logs for each HVDC substation and for the transmission line. For two-terminal systems, these separate logs can then be merged into a single combined log for the system which eliminates the effects of concurrent outages. For multi-terminal systems or two-terminal systems reporting separately, no combination of station outages is to be made. Care shall be taken, however, that outages due to the other stations are correctly assigned without duplication.

NOTE An example of a typical log is given as Appendix A for information only. The completed log need not be submitted as part of the annual report.

The rules set out here shall be applied when preparing the log and subsequently calculating the availability and unavailabilities.

- a) Record all outages in the log that cause a reduction in system capacity below the rated capacity.
- b) Indicate if the outage involves a total converter (valve group), a total pole, or a total bipole or other capacity reduction by supplying the appropriate severity code as described in 5.2.
- c) Classify each outage as either a scheduled or a forced outage. For each scheduled outage record if the outage is scheduled according to the definitions given in 3.1.2.
- d) For each forced outage or scheduled outage, determine the primary cause of the outage and select the one most appropriate category from the seven major equipment and fault categories and associated subcategories given in Clause 4 "Classification of HVDC transmission system ". All equipment in the HVDC system is included uniquely in one of these categories and subcategories.
- e) For each outage determine the outage derating factor, ODF as per 3.2.3. Calculate the equivalent outage duration (EOD) of each outage (3.3.2).
- f) If during a forced outage, an opportunity is taken to carry out some repair or maintenance that would otherwise be done during the next scheduled outage, record this as a scheduled outage with its own outage reference number. Record the equivalent outage duration (EOD) as zero, however, unless this scheduled outage increases the outage derating factor above that caused by the forced outage, or extends in time beyond the end of the forced outage. Should either of these events occur, calculate the outage derating factor and equivalent outage duration attributable to the scheduled outage (see Clause A.2).
- g) If during a forced outage a further forced outage occurs, record the new outage also. When determining the equivalent outage duration (EOD) of the new outage take into

account only the extent to which the new outage increases the outage derating factor or extends in time the pre-existing outage (see Clause A.3).

At the end of the year when the outage log is complete, proceed as follows to calculate the numerical data required to complete sections 3, 4 and 5 of Table 2 or Table 3.

- 1) Step 1: Group the outages into scheduled and forced. Group the forced outages according to the major outage categories and severity code.
- 2) Step 2: Total the equivalent scheduled outage durations (ESOD) to obtain the equivalent scheduled outage hours (ESOH). Calculate the energy unavailability due to scheduled outages (3.5.1) and complete line 4.1.
- 3) Step 3: Total the equivalent forced outage durations (EFOD) to obtain the equivalent forced outage hours (EFOH). Calculate the energy unavailability due to forced outages (3.5.1) and complete line 4.2. Break down the equivalent forced outage hours and forced energy unavailability into those due to HVDC substations and those due to the d.c. transmission line and complete lines 4.21 and 4.22.
- 4) Step 4: Add the energy unavailability percent due to scheduled outages (line 4.1) to that for forced outages (line 4.2) and subtract from 100 to obtain the energy availability percent and complete line 3.
- 5) Step 5: Record the number of forced outage events in each of the seven classification and fault categories. Likewise total the equivalent forced outage durations (EFOD) for each of the seven categories to obtain the equivalent forced outage hours (EFOH) for each category. Record values in lines 5.11 to 5.15 and lines 5.2 and 5.3.
- 6) Step 6: Total the number of events and equivalent outage hours for categories AC-E, V, C-P, DC-E and O (lines 5.11 to 5.15) to obtain the number of events and equivalent outage hours for line 5.1 HVDC substations.

#### 6.3.4 Section 6

Transfer the number of commutation failure starts CFS(A) and recordable a.c. faults from Table 4 to complete line 6.

#### 6.3.5 Section 7

Record the number of forced outage events in each of the four severity codes. Compute the forced energy unavailabilities for each of the severity codes. The forced energy unavailabilities are calculated in accordance with 3.5.1 using the equivalent forced outage hours in Table 6 for each of the severity codes. Only the outage time due to the HVDC substations and d.c. line are to be used. Outages due to the external causes (4.8) like external a.c. system are to be excluded. Total the number of events and the forced energy unavailabilities to complete Section 7. The total FEU should equal the value on line 4.2.

**Table 2 – DC system performance for back-to-back systems and for two terminal systems reporting jointly (corresponding to Table 1 of Cigré TB 346:2008)**

System \_\_\_\_\_  
Year \_\_\_\_\_

1. Energy transmitted (GWh)										
1.1 From: _____		To: _____								
1.2 From: _____		To: _____								
1.3 Total										
2. Energy utilisation (%)		$P_m =$		MW						
		$U$								
3. Energy availability (%)		EA								
4. Energy unavailability (%) due to:										
4.1 Scheduled outages		SEU								
4.11 Deferred		SEUD								
4.12 Planned		SEUP								
4.2 Forced outages		FEU								
4.21 HVDC Substations		FEUS								
4.22 DC Transmission Line <sup>a</sup>		FEUTL								
5. Forced outages due to:								Number of Events	Equip Outage Hours	
5.1 HVDC Substations		SS								
5.11 AC and Auxiliary Equipment		AC-E								
5.12 Valves		V								
5.13 HVDC Control and Protection Equip.		C-P								
5.14 Primary DC Equipment		DC-E								
5.15 Other		O								
5.2 DC Transmission Line <sup>a</sup>		TL								
5.3 External <sup>b</sup>		EXT								
6. Commutation Failure Starts CFS(A) / Recordable a.c. faults										
7. Forced outage severity	Capacity Reduction		Converter		Pole		Bipole		Total	
	Number of Events	Forced Energy Unavail.	Number of Events	Forced Energy Unavail.	Number of Events	Forced Energy Unavail.	Number of Events	Forced Energy Unavail.	Number of Events	Forced Energy Unavail.
<sup>a</sup> Not applicable for back-to-back systems										
<sup>b</sup> Not included in unavailability										

**Table 3 – DC system performance for multi-terminal systems and for stations reporting separately as part of two-terminal systems (corresponding to Table 1 M/S of Cigré TB 346:2008)**

System \_\_\_\_\_  
 Station \_\_\_\_\_  
 Year \_\_\_\_\_

1. Energy transmitted (GWh)												
1.1 As Rectifier												
1.2 As Inverter												
1.3 Total												
2. Energy utilization (%)				$P_m =$		MW						
				$U$								
3. Energy availability (%)				EA								
4. Energy unavailability (%) due to:												
4.1 Scheduled outages				SEU								
4.11 Deferred				SEUD								
4.12 Planned				SEUP								
4.2 Forced outages				FEU								
4.21 HVDC Substations				FEUS								
4.22 DC Transmission Line <sup>a</sup>				FEUTL								
5. Forced outages due to:												
5.1 HVDC substations												
5.11 AC and auxiliary equipment												
5.12 Valves												
5.13 HVDC control and protection equip.												
5.14 Primary DC Equipment												
5.15 Other												
5.2 DC Transmission Line <sup>a</sup>												
5.3 External <sup>b</sup>												
6. Commutation failure starts CFS(A) / recordable AC faults												
7. Forced outage severity												
			Capacity Reduction		Converter		Pole		Bipole		Total	
		Number of events	Forced energy unavail.									
<sup>a</sup> Not applicable for back-to-back systems <sup>b</sup> Not included in unavailability.												

## 6.4 Instructions for Table 4 and Table 5

### 6.4.1 Forced outages – Table 4

Record details of all forced outages that cause a reduction in rated capacity. The log used to compile Table 2 data can additionally provide the input for Table 4. Appendix A gives an example of this.

For two-terminal systems, either a common table for both stations or separate tables for each station can be provided as long as the same outage is not reported twice. For multi-terminal systems, separate tables shall be provided for each station.

- 1) Step 1: For each forced outage determine which of the equipment and fault category codes and subcodes applies. Record code and subcode in first column. Record severity code (5.2) and percent capacity reduction.
- 2) Step 2: Identify the failed equipment by a brief description, e.g. the code and subcode may be AC-E.AX while the description could be auxiliary power transformer. Record the forced outage type after the description (e.g. delayed deblock (DD), ramped down and blocked (RB), reduction in MW (RE), stopped ramp (SR), automatic trip (TR)).
- 3) Step 3: Record actual outage duration and restoration code (5.3) to indicate the corrective measure for example was repair (R) or replacement by a spare (S).

### 6.4.2 Scheduled outages – Table 5

Record details of all scheduled outages that cause a reduction in rated capacity. The log used to compile Table 2 data can additionally provide the input for Table 5. If the scheduled outage can be attributed to a certain category of equipment, supply the appropriate outage code. For two-terminal systems, either a common Table for both stations or separate Tables for each station can be provided as long as the same outage is not reported twice. For multi-terminal systems, separate Tables shall be provided for each station.

- 1) Step 1: Record code and subcode in first column. Record severity code (5.2) and percent capacity reduction.
- 2) Step 2: Identify the maintained equipment by a brief description, for example the code may be AC-E.TX, while the description could be converter transformer failed bushing. If the outage is for planned maintenance program use the code "PM".
- 3) Step 3: Record actual outage duration and restoration code (5.3) to indicate the corrective measure for example was repair (R) or replacement by a spare (S).



**6.5 Instructions for Table 6**

If the HVDC system includes one or more HVDC overhead line sections, and line protection is arranged to initiate auto-restart, perhaps at a lower pole operating voltage, for occurrences such as pollution or lightning induced flashovers, complete Table 6 as follows:

- 1) Step 1: Give each line protection event a unique number and record this together with the date and time using the 24 hour clock. Treat repeated operations of the protection within the reset time, usually some tens of seconds, as one event.
- 2) Step 2: Record the actual steady operating voltage and polarity, disregarding transients, of the affected pole immediately prior to the protection operation.
- 3) Step 3: Complete the event entry with the number of automatically attempted restart sequences, and whether or not the final automatic restart is successful. If the restart is unsuccessful, record the actual outage time. Give in a note any available information relevant to the cause of the protection operation and subsequent restoration if successful. If the d.c. system is multi-terminal, indicate any automatic sectionalizing that takes place.

**Table 6 – HVDC overhead line protection operations  
(corresponding to Table 3 of Cigré TB 346:2008)**

System \_\_\_\_\_  
Year \_\_\_\_\_

Event No.	Date	Time of Day	Pole Voltage and Polarity	Number of Attempted Restarts	Final Restart Successful/ Unsuccessful	Actual Outage Duration If Unsucc.	Notes <sup>a</sup>

<sup>a</sup> For example record if the restart was successful at reduced voltage, or which line section was affected or if automatic sectionalising occurred.

### 6.6 Instructions for Table 7

In order to complete Table 7 it is necessary to keep a log at each inverter HVDC substation to record information about a.c. system faults and any associated commutation failure starts.

NOTE See 3.6.2 if/when other station is applicable.

The rules set out here shall be applied in the preparation of this log:

- Determine if the a.c. system fault is recordable or not at the station as defined in 3.6.1.  
NOTE When determining whether or not the voltage drops to or below 90 % of the pre-fault voltage, consider only the fundamental voltage, i.e. disregard distortion. Take into account only reductions in voltage caused by phase-to-phase or phase-to-earth faults on the a.c. system.
- Exclude the cases of temporary voltage reduction caused by other means such as normal switching of lines, transformers or reactive compensation, or faulty a.c. voltage regulating equipment.

For the reporting period complete table as follows:

- 1) Step 1: Complete the first column of lines 1.1 and 1.2 with the HVDC substation names. In the case of an HVDC coupling system identify the two sides of the coupling by the names of the a.c. systems so coupled. For a multi-terminal system, record data for each station.
- 2) Step 2: Count the number of recordable a.c. system faults during inverter operation at each HVDC substation and record the separate totals.
- 3) Step 3: Count the number of commutation failure starts, CFS(A), as defined in 3.6.2. A CFS may be determined by automatic recording for each converter unit or by inspection of the oscillographic records, but no more than one CFS(A) shall be attributed to each a.c. system fault.
- 4) Step 4: Count the number of commutation failure starts, CFS(B), as defined in 3.6.3.

**Table 7 – AC system faults and commutation failure starts  
(back-to-back, two terminal or multi-terminal systems)  
(corresponding to Table 4 of Cigré TB 346:2008)**

System \_\_\_\_\_  
Year \_\_\_\_\_

	Number of a.c. recordable system faults at inverter	Number of CFS(A)	Number of CFS(B)
1.1 HVDC Substation A:			
1.2 HVDC Substation B:			
1.3 HVDC Substation C:			
1.4 HVDC Substation D:			
1.5 HVDC Substation E:			
2. Complete HVDC System			
CFS(A) – Commutation failure starts by a.c. system faults (See 3.6.2)			
CFS(B) – Commutation failure starts initiated by control problems, switching events or other causes. (See 3.6.3)			

### 6.7 Instructions for Table 8

For the reporting period complete Table 8 as follows:

- 1) Step 1: Complete the first column by listing separately the converter units at both HVDC substations or both sides in the case of coupling systems for example 1, 2, 3 and 4, or Pole 1 Norway, Pole 2 Norway, Pole 1 Denmark, Pole 2 Denmark.
- 2) Step 2: For each converter unit record whether it is a 6 or 12 pulse converter unit.
- 3) Step 3: Record the hours each converter unit is available, irrespective of whether transmitting power or not.
- 4) Step 4: Record the number of semiconductor devices failed in each converter unit. To provide uniformity in reporting, all failure modes of a semiconductor device due to any cause shall be recorded.

NOTE If two or more semiconductor devices are used in parallel in a valve, record the short circuiting of the parallel connected semiconductor devices as a single failure. For example, when 2 or more semiconductor devices are used in parallel within a valve, record the short circuiting of the parallel semiconductor devices as a single failure even though 2 or more of the semiconductor devices have in fact failed.

**Table 8 – Converter unit hours and semiconductor devices failed  
(corresponding to Table 5 of Cigré TB 346:2008)**

System _____			
Year _____			
Converter unit reference <sup>a</sup>	6 or 12 Pulse	Hours available	Number of semiconductor devices failed <sup>b</sup>
	Totals:		
<sup>a</sup> Converter unit reference refers to station, pole or converter designator per 6.7. <sup>b</sup> See 6.7, Step 4.			

**6.8 Instructions for Table 9**

Table 9 summarizes the information contained in Table 4. All forced outages are summed by outage classification and by sub-classification as well as by severity code. Completion of Table 9 is an intermediate step in preparation for filling out Table 2 or Table 3.

## 7 Interpretation and evaluation of reports

### 7.1 Calculation of outage duration

Reported outage time should be the calendar time that the d.c. system or station is not available. The maintenance or forced outages often span several working days, possibly including weekends. The purpose of recording scheduled outage time is to develop a data base indicating the actual maintenance time. Therefore, clarification is needed on how “non-working” time is to be considered. If the system is made available but not operated during a portion of the non-working time or can be made available if required to be operated, for example on a weekend, then such time should be excluded from the scheduled outage time. The key to computation of chargeable scheduled outage time is not whether or not work is performed, but whether or not the system is or can be available for operation.

In some cases, outage duration may be longer than would normally be required. For example, there may be a period of low demand during which there is no economic loss due to unavailability of the d.c. link. This may permit the annual maintenance to be conducted on a more leisurely basis. Other examples could be inclement weather causing delay in accessibility for maintenance or non-availability of required spare, needed tools and tackles or manpower at hand. Such extenuating circumstances should be noted in the discussion section of the report.

Similarly, lack of d.c. transmission resulting from scheduled outage of a generating plant which supplies the d.c. link should not be recorded as an outage of the d.c. system, provided that the d.c. system remains available for service. If maintenance is conducted on the d.c. link during such times, then the maintenance time should be reported as scheduled outage time.

### 7.2 External events

Events external to the HVDC system which result in interruption of HVDC power transmission are not to be considered as outages of the d.c. system as long as the d.c. system operates as designed and is available for service after the event is over. For example, if the a.c. lines feeding the d.c. link open due to faults or if the ac system hosting the d.c. link goes unstable, the outage time is not recordable.

### 7.3 Protective operation

Transient faults which are successfully cleared by correct operation of protection equipment do not constitute outages and should not be recorded in Table 2 FS. Incorrect operation of protection equipment, either operation when not intended (false trip) or failure to automatically restart, would be reported as an outage, regardless of duration. Interruptions which require manual restart should be counted as forced outages if the system is designed to recover from such events.

### 7.4 Performance of special controls

A number of d.c. systems are equipped with special supplementary controls, such as frequency control, damping control or runback, to help support the a.c. system. It is encouraged to include narrative comments regarding any significant positive or negative system aspects due to operation of such controls.

Operations of special controls when those operate to support the a.c. system shall not be counted as d.c. forced outages but shall be recorded as forced external a.c. outage.

**Table 9 – Forced outage summary  
(corresponding to Table 6 of Cigré TB 346:2008)**

System: \_\_\_\_\_ Station: \_\_\_\_\_ Year: \_\_\_\_\_

FORCED OUTAGE due to	Outage Code	Capacity Reduction			Converter			Pole			Bipole			Total		
		Number of events	Actual outage hours	Equip outage hours	Number of events	Actual outage hours	Equip outage hours	Number of events	Actual outage hours	Equip outage hours	Number of events	Actual outage hours	Equip outage hours	Number of events	Actual outage hours	Equip outage hours
AC filter and other RP equipment	AC-E.F															
AC control and protection	AC-E.CP															
Converter transformer	AC-E.TX															
Synchronous compensator	AC-E.SC															
Aux. equipment and aux. power	AC-E.AX															
Other AC switchyard equipment	AC-E.SW															
<b>Total AC and aux. equipment</b>	<b>AC-E</b>															
Valve electrical	V.E															
Valve cooling	V.VC															
<b>Total valve</b>	<b>V</b>															
Local control and protection	C-P.L															
Master control and protection	C-P.M															
Telecommunication equipment <sup>a</sup>	C-P.T															
<b>Total DC C and P equipment</b>	<b>C-P</b>															
DC filters <sup>a</sup>	DC-E.F															
DC smoothing reactor	DC-E.SR															
DC switching equipment	DC-E.SW															
DC measuring equipment	DC-E.ME															
DC earth electrode <sup>a</sup>	DC-E.GE															
DC earth electrode line <sup>a</sup>	DC-E.EL															
Other DC switchyard and VH equipment	DC-E.O															
<b>Total Primary DC equipment</b>	<b>DC-E</b>															
Other	O															
<b>TOTAL HVDC substations</b>	<b>SS</b>															
DC overhead transmission line	TL-OH															
DC underground/submarine cable	TL-C															
<b>Total DC transmission line<sup>a</sup></b>	<b>TL</b>															
External <sup>b</sup>	EXT															

<sup>a</sup> Not applicable for back-to-back systems.

<sup>b</sup> Not included in unavailability.

**Annex A**  
(informative)

**Outage log form and examples**

**A.1 Example of an outage log**

Table A.1 is an example of an outage log.

**Table A.1 – Example of an outage log**

System: \_\_\_\_\_ Station: \_\_\_\_\_ Year: \_\_\_\_\_

- Outage due to faulty equipment
- AC and Auxiliary Equipment
- Valves
- DC Control and Protection Equipment
- Primary DC Equipment
- Other
- DC Transmission Line
- External


Outage Code <sup>a</sup>

- Forced: F.AC-E
- F.V
- F.C-P
- F.DC-E
- F.O
- F.TL
- F.EXT
- Scheduled: S.AC-E
- S.V
- S.C-P
- S.DC-E
- S.O
- S.TL
- S.PM

Scheduled outage for planned maintenance

Outage reference number	Date and Time		Actual outage duration AOD	Outage derating factor ODF	Equivalent outage duration EOD	Outage code <sup>a</sup>	Severity code BP, P, C, RP	Description of event, equipment or component causing outage	Restoration code R, S, M
	Start	Finish							

<sup>a</sup> See 5.1 for outage code sub-classification for forced or for deferred scheduled outages.

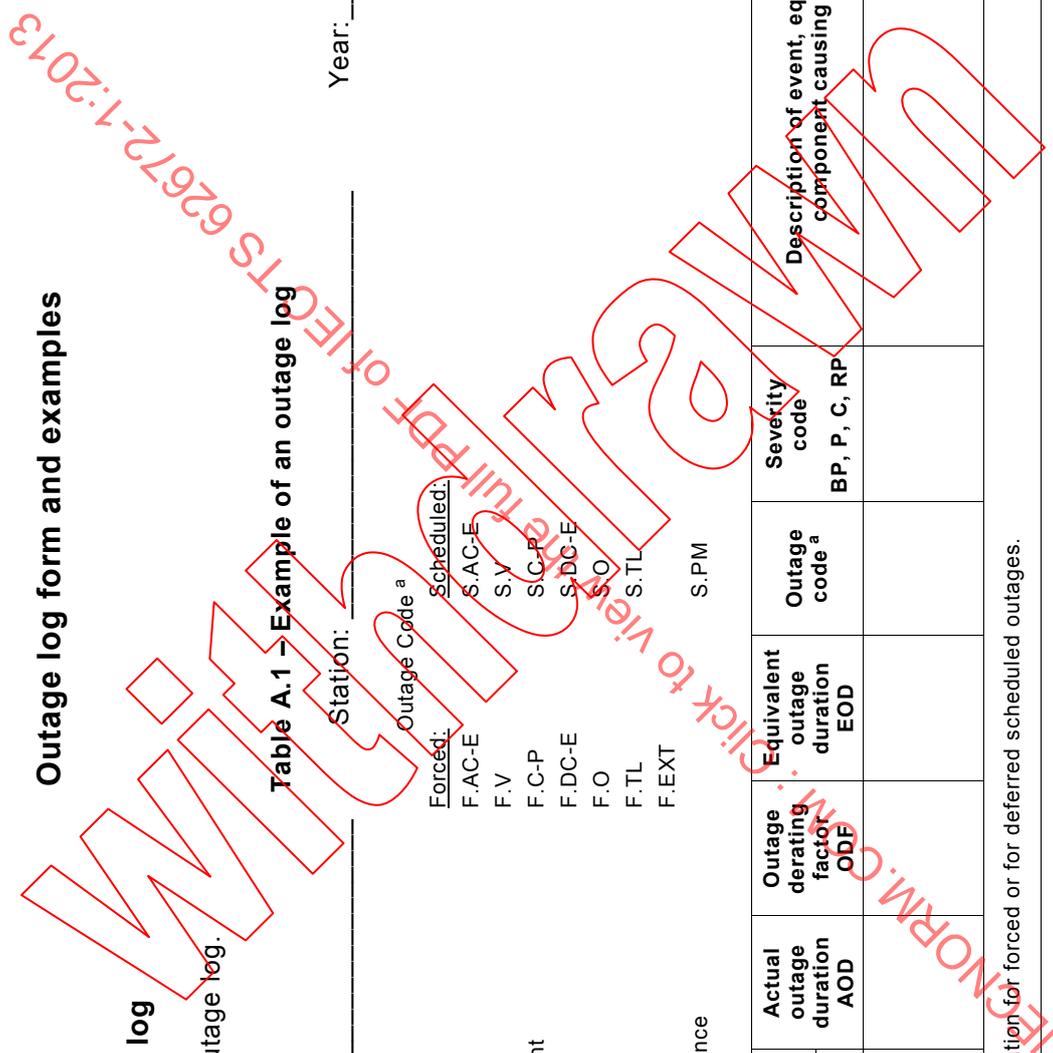

Care shall be taken to not report the same outage twice. Therefore, only record an outage code for outages caused by the respective station. If the outage is caused by a remote station and leads to a consequential outage of the local station, the outage should be charged to the remote station. Exclude outages caused by remote stations in the preparation of Table 2 for the local station.

For single non-overlapping outages having a constant outage derating factor complete the log as follows:


- 1) Step 1: Assign the Outage Reference Number. This is a unique number given to each outage event at the start of the outage.
- 2) Step 2: Record the date and time at the start of the outage and subsequently the date and time at the end of the outage. Record times to the nearest minute using the 24 hour clock.
- 3) Step 3: Determine and record the main cause of the outage using only one of the outage codes given at the head of the form. For forced outages and for deferred scheduled outages extend the outage code by appending the outage sub-classification from 5.1. For example, the primary cause of the outage can be indicated by "F.AC-E.AX" indicating a forced outage caused by a.c. equipment in the station auxiliaries.
- 4) Step 4: Calculate and record the actual outage duration (AOD) which is the time elapsed between the start and end of the outage in accordance with 3.3.1.
- 5) Step 5: Describe the event, equipment or component causing the outage.
- 6) Step 6: Determine and record the restoration code to indicate if the restoration required equipment repair (R), replacement by spare (S) or just a manual restart (M).
- 7) Step 7: Determine and record the outage derating factor (ODF) in accordance with 3.2.3.
- 8) Step 8: Calculate and record the equivalent outage duration (EOD) which is the product  $AOD \times ODF$  in accordance with 3.3.2.

For single non-overlapping outages having a variable outage derating factor and for overlapping outages, additional information shall be recorded in order to calculate the correct EOD.

**A.2 Examples of application of rule f) of 6.3 scheduled outage during a forced outage**

**A.2.1 Case 1: Scheduled outage does not increase ODF or extends outage duration**

Figure A.1 shows an example where scheduled outage does not increase ODF or extends outage duration.

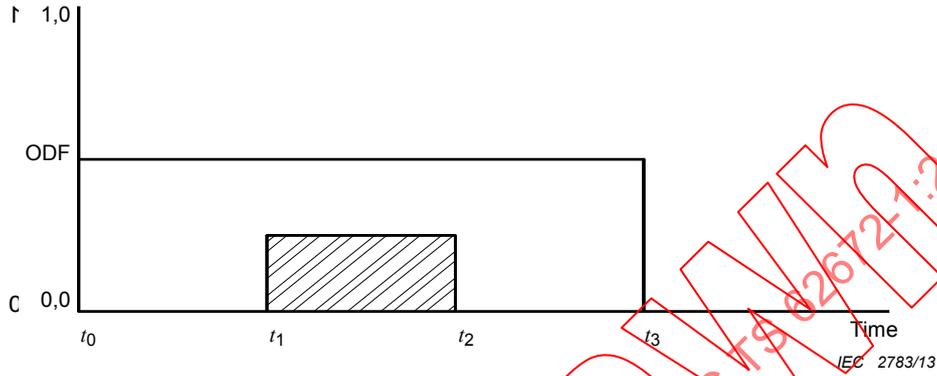

**Figure A.1 – Scheduled outage does not increase ODF or extends outage duration**

- $t_0$  forced outage due to AC-E starts      ODF = 0,5
- $t_1$  scheduled outage starts              ODF = 0,25
- $t_2$  scheduled outage ends
- $t_3$  forced outage ends

AOD =  $t_3 - t_0$

ODF = 0,5

EOD due to AC-E = 0,5 ( $t_3 - t_0$ )

Scheduled outage does not contribute to unavailability.

### A.2.2 Case 2: Scheduled outage increases ODF

Figure A.2 shows an example where scheduled outage increases ODF.

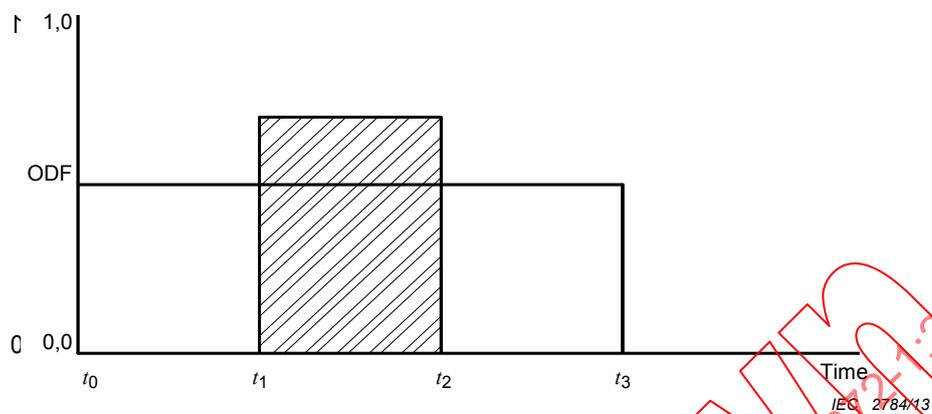


Figure A.2 – Scheduled outage increases ODF

$t_0$  forced outage due to TL starts

$t_1$  scheduled outage starts

$t_2$  scheduled outage ends

$t_3$  forced outage ends

AOD due to TL =  $t_3 - t_0$

ODF due to TL = 0,5

EOD due to TL = 0,5 ( $t_3 - t_0$ )

AOD due to scheduled outage =  $t_2 - t_1$


Excess ODF due to scheduled outage = 0,75 – 0,5 = 0,25

Scheduled outage contributes to unavailability.

**A.3 Examples of application of rule g) of 6.3 second outage during an outage**

**A.3.1 Case 1: Second outage does not increase ODF or extends outage duration**

Figure A.3 shows an example where second outage does not increase ODF or extends outage duration.

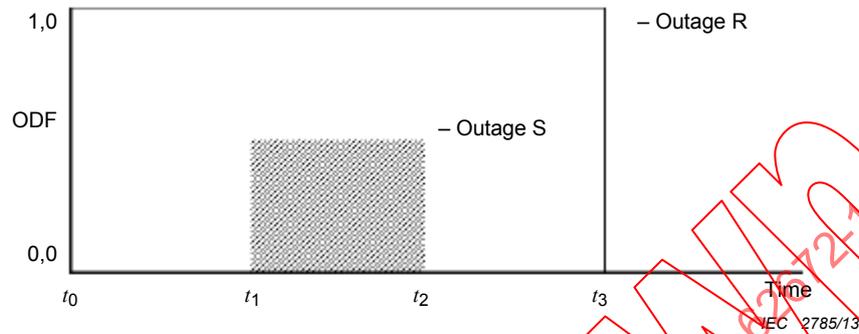

**Figure A.3 – Second outage does not increase ODF or extends outage duration**

$t_0$  forced outage due to TL starts – outage reference R ODF = 1,0

$t_1$  forced outage due to DC-E starts – outage reference S ODF = 0,5

$t_2$  forced outage due to DC-E ends

$t_3$  forced outage due to TL ends

AOD due to TL =  $t_3 - t_0$

ODF due to TL = 1,0

EOD due to TL = 1,0 ( $t_3 - t_0$ )

Outage reference R is counted in the total number of events attributable to TL.

Outage due to DC-E does not increase ODF and so the EOD = 0. Since EOD is zero, outage reference S is not counted in the total number of events attributable to DC-E.

### A.3.2 Case 2: Second outage extends duration

Figure A.4 shows an example where second outage extends duration.

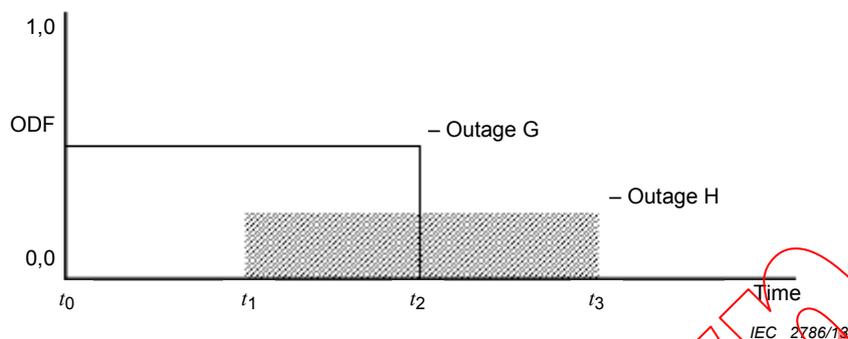


Figure A.4 – Second outage extends duration

$t_0$  forced outage due to AC-E starts – outage reference G ODF = 0,5

$t_1$  forced outage due to another event AC-E starts – outage reference H ODF = 0,25

$t_2$  forced outage – reference G ends

$t_3$  forced outage – reference H ends

AOD due to AC-E reference G =  $t_2 - t_0$

ODF for outage reference G = 0,5

EOD due to AC-E reference G = 0,5 ( $t_2 - t_0$ )

AOD due to AC-E reference H =  $t_3 - t_1$ , but period  $t_1$  to  $t_2$  already accounted for so effectively it is taken as =  $t_3 - t_2$ .

ODF due to outage reference H = 0,25

EOD due to AC-E reference H = 0,25 ( $t_3 - t_2$ )

Since both outages are category AC-E and both EOD are non-zero, 2 is added to the total number of AC-E events by these two outages.

