

# TECHNICAL SPECIFICATION



**Photovoltaic direct-driven appliance controllers –  
Part 2: Operation modes and graphic display**

IECNORM.COM : Click to view the full PDF of IEC TS 63349-2:2022



**THIS PUBLICATION IS COPYRIGHT PROTECTED**  
**Copyright © 2022 IEC, Geneva, Switzerland**

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Secretariat  
3, rue de Varembe  
CH-1211 Geneva 20  
Switzerland

Tel.: +41 22 919 02 11  
[info@iec.ch](mailto:info@iec.ch)  
[www.iec.ch](http://www.iec.ch)

**About the IEC**

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

**About IEC publications**

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

**IEC publications search - [webstore.iec.ch/advsearchform](http://webstore.iec.ch/advsearchform)**

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

**IEC Just Published - [webstore.iec.ch/justpublished](http://webstore.iec.ch/justpublished)**

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

**IEC Customer Service Centre - [webstore.iec.ch/csc](http://webstore.iec.ch/csc)**

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: [sales@iec.ch](mailto:sales@iec.ch).

**IEC Products & Services Portal - [products.iec.ch](http://products.iec.ch)**

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

**Electropedia - [www.electropedia.org](http://www.electropedia.org)**

The world's leading online dictionary on electrotechnology, containing more than 22 300 terminological entries in English and French, with equivalent terms in 19 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IECNORM.COM : Click to view the full PDF of IEC 60334-2:2022

# TECHNICAL SPECIFICATION



---

**Photovoltaic direct-driven appliance controllers –  
Part 2: Operation modes and graphic display**

INTERNATIONAL  
ELECTROTECHNICAL  
COMMISSION

---

ICS 27.160

ISBN 978-2-8322-1072-2

**Warning! Make sure that you obtained this publication from an authorized distributor.**

## CONTENTS

FOREWORD.....	3
INTRODUCTION.....	5
1 Scope.....	6
2 Normative references .....	6
3 Terms and definitions .....	6
4 Equipment configuration and operation modes .....	7
4.1 Equipment configuration .....	7
4.2 Power flow direction.....	7
4.3 Operation modes .....	8
4.4 Operation mode under different equipment configurations.....	8
5 Graphic display.....	10
5.1 General.....	10
5.2 Information on display.....	10
5.2.1 Required information on display.....	10
5.2.2 Recommended information on display .....	10
5.2.3 Elements of display .....	11
5.2.4 Examples of display.....	11
Figure 1 – Common elements on the display.....	11
Figure 2 – Display of operation mode PA//P→A.....	12
Figure 3 – Display of operation mode PAG//P→G.....	12
Figure 4 – Display of operation mode PAS//S→A.....	13
Figure 5 – Display of operation mode PAGS//G→AS.....	14
Table 1 – Equipment notation .....	7
Table 2 – Operation mode under equipment configuration PA.....	9
Table 3 – Operation modes under equipment configuration PAG.....	9
Table 4 – Operation modes under equipment configuration PAS.....	9
Table 5 – Operation modes under equipment configuration PAGS .....	10

IECNORM.COM · Click to view the full PDF of IEC TS 63349-2:2022

## INTERNATIONAL ELECTROTECHNICAL COMMISSION

**PHOTOVOLTAIC DIRECT-DRIVEN APPLIANCE CONTROLLERS –****Part 2: Operation modes and graphic display**

## FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

IEC TS 63349-2 has been prepared by IEC technical committee 82: Solar photovoltaic energy systems. It is a Technical Specification.

The text of this Technical Specification is based on the following documents:

Draft	Report on voting
82/1948/DTS	82/1984/RVDTS 82/1984A/RVDTS

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this Technical Specification is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at [www.iec.ch/members\\_experts/refdocs](http://www.iec.ch/members_experts/refdocs). The main document types developed by IEC are described in greater detail at [www.iec.ch/standardsdev/publications](http://www.iec.ch/standardsdev/publications).

A list of all parts in the IEC 63349 series, published under the general title *Photovoltaic direct-driven appliance controllers*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under [webstore.iec.ch](http://webstore.iec.ch) in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

**IMPORTANT – The "colour inside" logo on the cover page of this document indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.**

IECNORM.COM : Click to view the full PDF of IEC TS 63349-2:2022

## INTRODUCTION

The distributed solar energy industry has been developing rapidly in recent years. Utilizing photovoltaic (PV) installation to drive appliances directly is more and more popular among solar energy applications, which will boost energy efficiency, simplify control system, reduce dependence on electrical grid and expand solar energy application. Photovoltaic direct-driven appliances (PVDDA) are an emerging type of PV installation. The PVDDA controller is an essential component of the PVDDA that lacks standardization. When PVDDA is operating, users might want to have a graphic display to monitor the real-time status and energy generating/consuming situation, which is what this document focuses on.

[IECNORM.COM](https://www.iecnorm.com) : Click to view the full PDF of IEC TS 63349-2:2022

# PHOTOVOLTAIC DIRECT-DRIVEN APPLIANCE CONTROLLERS –

## Part 2: Operation modes and graphic display

### 1 Scope

This part of IEC 63349 defines operation modes of photovoltaic direct-driven appliance (PVDDA) controllers and describes one example of a graphic display. The graphic display is an interface to PVDDA users, which uses easily understood graphics to show a real-time operation mode, such as what equipment is installed, controlled and monitored in the system, which equipment is generating power and how much it generates, and which equipment is consuming power and how much it consumes. This helps with user's interest, knowledge, planning on renewable energy usage.

IEC 63349 is a series of standards for PVDDA controllers which can be used in various appliances including air conditioners, water pumps, refrigerators, etc. These standards only cover the requirements of PVDDA controllers.

Requirements for appliances are covered by their specific standards, for example, standards developed by IEC TC 59 on performance of household and similar electrical appliances, or by IEC TC 61 on safety of household and similar electrical appliances.

### 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC TS 61836, *Solar photovoltaic energy systems – Terms, definitions and symbols*

IEC 61850-7-420, *Communication networks and systems for power utility automation – Part 7-420: Basic communication structure – Distributed energy resources and distribution automation logical nodes*

IEC 63349-1, *Photovoltaic direct-driven appliance controllers – Part 1: General requirements*<sup>1</sup>

### 3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC TS 61836, IEC 63349-1 as well as the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

---

<sup>1</sup> To be published.

**3.1****PV direct-driven appliance (PVDDA) controller**

controller used for converting and regulating power conditions and flows among PV array, grid, energy storage, etc., and appliances (such as air-conditioner, refrigerator)

**3.2****equipment configuration**

combination of one or more equipment installed in a given PVDDA system

**3.3****operation mode**

real-time working status of a given PVDDA system with various energy flows “from” and “to” different equipment

**3.4****power from**

one or more equipment supplying power under specific operation mode, such as PV array or battery under discharging condition

**3.5****power to**

one or more equipment consuming power under specific operation mode, such as appliance, or battery under charging condition

**4 Equipment configuration and operation modes****4.1 Equipment configuration**

Equipment configuration indicates what type of equipment is installed in the PVDDA system. PV array and appliance within the scope of this document are two pieces of essential equipment. The system may also include one or more of these: electrical grid, energy storage, and other equipment. Table 1 shows the notations of the equipment and their orders on operation mode description.

**Table 1 – Equipment notation**

No.	Notation	Equipment
1	P	Photovoltaic array
2	A	Appliance
3	G	electrical Grid
4	S	energy Storage
5	V	electrical Vehicle
6	W	Wind turbine
7	F	Fuel cell
8	H	Hydraulic turbine
9	E1	other Equipment 1
10	E2	other Equipment 2
	...	

**4.2 Power flow direction**

From power flow direction point of view, installed equipment can be unidirectional or bi-directional:

- P is unidirectional equipment, only for power generation, or “power from”. In some special cases, such as PV array running a PID recovering mode, that is to supply reverse DC current to PV array, PV array becomes a power consumption equipment, or “power to”. However, these special cases are beyond the scope of this document, and will not be discussed hereinafter.
- A is unidirectional equipment, only for power consumption, or “power to”.
- G and S are bi-directional equipment. As a power source or “power from”, they provide power to other equipment. They can also consume power or “power to”, such as supplying electricity to the grid, or charging the battery.
- V, W, F, H, and others, depending on the nature of the equipment, could be unidirectional or bi-directional. The Wind turbine is unidirectional equipment. The Fuel cell may be bi-directional if it can run reversely to generate and store hydrogen. Hydraulic generator may also be bi-directional if it can pump water reversely to a higher level reservoir for energy storage.

### 4.3 Operation modes

The purpose of defining operation modes is to facilitate information and command communication between the controller and different equipment. The general communication network is defined and described in IEC 61850-7-420. Specific application of this communication network to PVDDA system may be developed in a later edition.

An Operation mode is described by 3 blocks. The first block is equipment configuration, followed by a double slash (//), then the second block is for “power from”, followed by an arrow (→), and the third block for “power to”.

Equipment configuration//Power from→Power to

In each block, equipment notations should be in the order presented in Table 1, and if any of these equipment is not presented in a block, just omit it.

For example:

PAGS//PG→A

where:

- PAGS The First block is equipment configuration: installed equipment includes PV array, appliance, electrical grid, and energy storage;
- PG The Second block is power from: power is from PV array and electrical grid. S is not in this block, because the energy storage is not providing power;
- A The third block is power to: power is consumed by appliance. S and G are not present in this block, because the energy storage and the grid are not consuming power in this case.

### 4.4 Operation mode under different equipment configurations

Four common equipment configurations are PA, PAG, PAS, and PAGS. Under each of these configurations, there could be one or more operation modes.

Equipment configuration PA: equipment includes PV array and appliances. There is only one operation mode under this equipment configuration, and it is shown in Table 2.

**Table 2 – Operation mode under equipment configuration PA**

Operation mode	Equipment configuration	Power from	Power to
PA//P→A	PA	P	A

Equipment configuration PAG: equipment includes PV array, appliances, and electrical grid. All operation modes under this equipment configuration are listed in Table 3.

**Table 3 – Operation modes under equipment configuration PAG**

Operation mode	Equipment configuration	Power from	Power to
PAG//P→A	PAG	P	A
PAG//P→AG	PAG	P	AG
PAG//P→G	PAG	P	G
PAG//PG→A	PAG	PG	A
PAG//G→A	PAG	G	A

Equipment configuration PAS includes PV array, appliances, and energy storage. All operation modes under this equipment configuration are listed in Table 4.

**Table 4 – Operation modes under equipment configuration PAS**

Operation mode	Equipment configuration	Power from	Power to
PAS//P→A	PAS	P	A
PAS//P→S	PAS	P	S
PAS//P→AS	PAS	P	AS
PAS//PS→A	PAS	PS	A
PAS//S→A	PAS	S	A

Equipment configuration PAGES: equipment includes PV array, appliances, electrical grid, and energy storage. All operation modes of this equipment configuration are listed in Table 5.

**Table 5 – Operation modes under equipment configuration PAGS**

Operation mode	Equipment configuration	Power from	Power to
PAGS//P→A	PAGS	P	A
PAGS//P→AG	PAGS	P	AG
PAGS//P→AGS	PAGS	P	AGS
PAGS//P→AS	PAGS	P	AS
PAGS//P→G	PAGS	P	G
PAGS//P→GS	PAGS	P	GS
PAGS//P→S	PAGS	P	S
PAGS//PG→A	PAGS	PG	A
PAGS//PG→AS	PAGS	PG	AS
PAGS//PG→S	PAGS	PG	S
PAGS//PGS→A	PAGS	PGS	A
PAGS//PS→A	PAGS	PS	A
PAGS//PS→AG	PAGS	PS	AG
PAGS//PS→G	PAGS	PS	G
PAGS//G→A	PAGS	G	A
PAGS//G→AS	PAGS	G	AS
PAGS//G→S	PAGS	G	S
PAGS//GS→A	PAGS	GS	A
PAGS//S→A	PAGS	S	A
PAGS//S→AG	PAGS	S	AG
PAGS//S→G	PAGS	S	G

When additional types of equipment such as V, W, H, F, E1, E2 are installed in a PVDDA system, description of equipment configuration can be derived accordingly, such as PAGSW.

## 5 Graphic display

### 5.1 General

One example of graphic display is described herein. Other types of graphic displays can be used as long as they present the necessary information and are easy to understand by users.

### 5.2 Information on display

#### 5.2.1 Required information on display

The following information is required on the user interface display:

- a) all installed equipment, such as PV array, appliances, energy storage and connected equipment such as grid;
- b) PVDDA controller;
- c) power flow directions by arrows or similar indicators;
- d) real-time power by value and units, e.g. 20 kW.


#### 5.2.2 Recommended information on display

The following information is recommended on the user interface display:

- appliance operation conditions, such as temperature set-point and actual point of an air-conditioner;
- state of charge of the storage system (percentage of charging);
- total amount of energy generated or consumed by a given equipment during user selectable time span.

### 5.2.3 Elements of display

As a display example, commonly used elements are shown in Figure 1. In a particular installation, where some equipment, such as energy storage is not installed, the element will not be shown in the display. In Figure 1, elements in black are required information (5.2.1); elements in blue are recommended information (5.2.2).

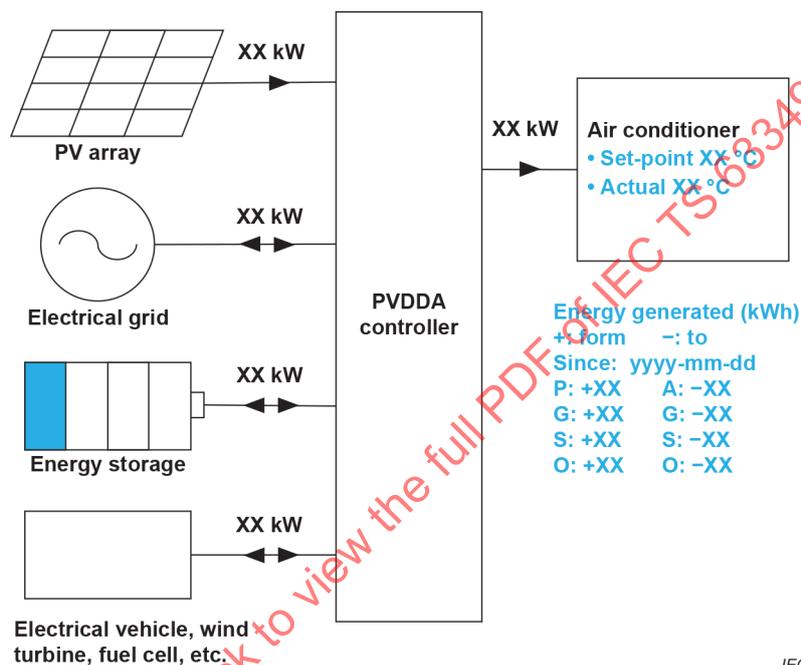

IEC

Figure 1 – Common elements on the display

### 5.2.4 Examples of display

#### 5.2.4.1 General

In following examples, the value stated in kW is a real-time power where energy loss in the PVDDA controller is not considered.

### 5.2.4.2 Display example of equipment configuration PA

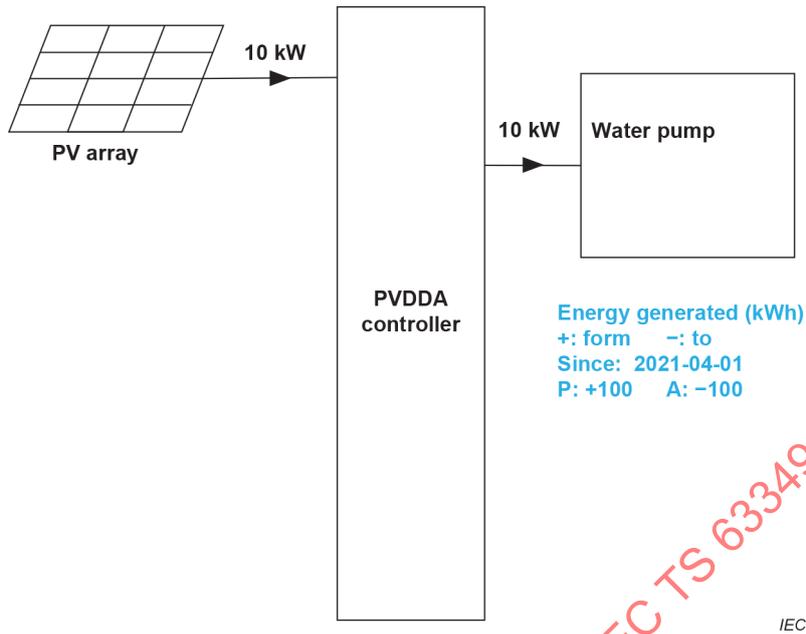


Figure 2 – Display of operation mode PA//P→A

A display shown in Figure 2 is for equipment configuration PA.

- PV array is the only power generation equipment.
- The appliance in this configuration is water pump.
- When there is sufficient sunlight, water pump works; when there is insufficient sunlight, water pump stops.

### 5.2.4.3 Display example of equipment configuration PAG

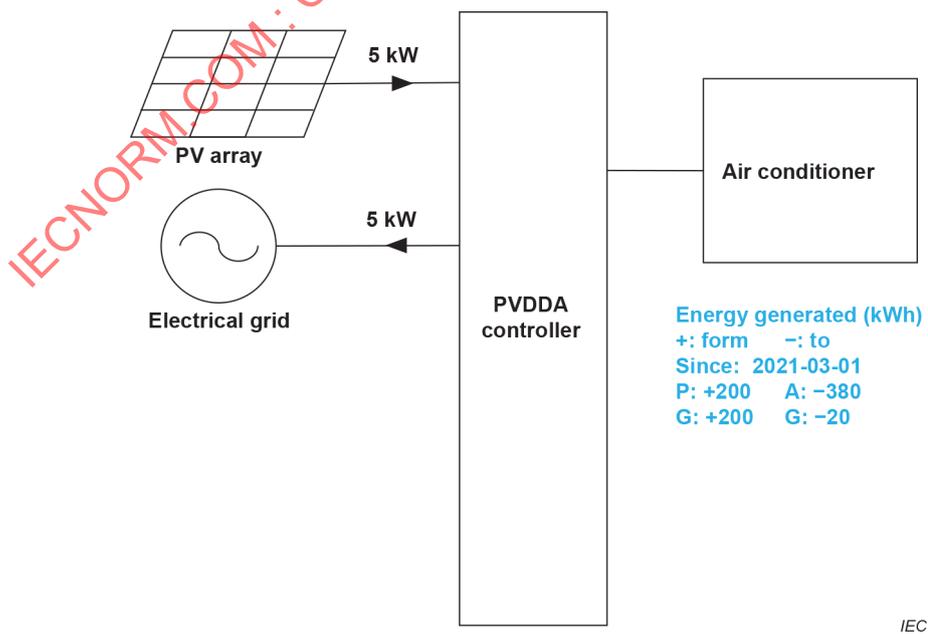


Figure 3 – Display of operation mode PAG//P→G