



BSI Standards Publication

# Light and lighting — Lighting of work places

---

Part 1: Indoor work places

STANDARDSISO.COM: Click to view the full PDF of BS EN 12464-1 (WGT) 2021  
Copyrighted document for Work on Lighting.  
No reproduction or further distribution permitted without the prior written permission of BSI.

## National foreword

This British Standard is the UK implementation of EN 12464-1:2021. It supersedes BS EN 12464-1:2011, which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee EL/1, Light and lighting applications.

A list of organizations represented on this committee can be obtained on request to its committee manager.

### Contractual and legal considerations

This publication has been prepared in good faith, however no representation, warranty, assurance or undertaking (express or implied) is or will be made, and no responsibility or liability is or will be accepted by BSI in relation to the adequacy, accuracy, completeness or reasonableness of this publication. All and any such responsibility and liability is expressly disclaimed to the full extent permitted by the law.

This publication is provided as is, and is to be used at the recipient's own risk.

The recipient is advised to consider seeking professional guidance with respect to its use of this publication.

This publication is not intended to constitute a contract. Users are responsible for its correct application.

© The British Standards Institution 2021  
Published by BSI Standards Limited 2021

ISBN 978 0 539 02751 8

ICS 13.180; 91.160.10

### Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 August 2021.

### Amendments/corrigenda issued since publication

| Date | Text affected |
|------|---------------|
|------|---------------|

---

EUROPEAN STANDARD

**EN2464-1**

NORME EUROPÉENNE

EUROPÄISCHE NORM

August 2021

ICS 91.160.10

Supersedes EN 12464-1:2011

English Version

## Light and lighting - Lighting of work places - Part 1: Indoor work places

Lumière et éclairage - Éclairage des lieux de travail -  
Partie 1 : Lieux de travail intérieurs

Licht und Beleuchtung - Beleuchtung von  
Arbeitsstätten - Teil 1: Arbeitsstätten in Innenräumen

This European Standard was approved by CEN on 9 May 2021.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

## Contents

Page

|  |    |
|--|----|
| European foreword.....   | 5  |
| Introduction .....   | 7  |
| 1 Scope.....   | 8  |
| 2 Normative references.....  | 8  |
| 3 Terms and definitions .....  | 9  |
| 4 Symbols and abbreviations .....                                      | 9  |
| 5 Lighting design criteria.....  | 10 |
| 5.1 Luminous environment .....   | 10 |
| 5.2 Luminance distribution .....                                       | 11 |
| 5.2.1 General.....   | 11 |
| 5.2.2 Reflectance of surfaces.....                                     | 12 |
| 5.2.3 Illuminance on surfaces.....                                     | 12 |
| 5.3 Illuminance.....   | 12 |
| 5.3.1 General.....   | 12 |
| 5.3.2 Scale of illuminance.....  | 12 |
| 5.3.3 Illuminances on the task area or activity area .....             | 13 |
| 5.3.4 Illuminance on the immediate surrounding area.....               | 14 |
| 5.3.5 Illuminance on the background area.....                          | 15 |
| 5.3.6 Illuminance uniformity.....                                      | 15 |
| 5.4 Illuminance grid .....   | 16 |
| 5.5 Glare.....   | 18 |
| 5.5.1 General.....   | 18 |
| 5.5.2 Limiting luminaire luminance.....                                | 19 |
| 5.5.3 Discomfort glare.....  | 20 |
| 5.5.4 Veiling reflections and reflected glare .....                    | 22 |
| 5.6 Lighting in the interior space.....                                | 22 |
| 5.6.1 General.....   | 22 |
| 5.6.2 Cylindrical illuminance requirement in the activity space.....   | 22 |
| 5.6.3 Modelling.....   | 22 |
| 5.6.4 Directional lighting of visual tasks .....                       | 23 |
| 5.7 Colour aspects .....   | 23 |
| 5.7.1 General.....   | 23 |
| 5.7.2 Colour appearance of the light.....                              | 23 |
| 5.7.3 Colour rendering.....  | 24 |
| 5.8 Flicker and stroboscopic effects .....                             | 24 |
| 5.8.1 General.....   | 24 |
| 5.8.2 Flicker.....   | 24 |
| 5.8.3 Stroboscopic effect.....   | 25 |
| 5.9 Lighting of work stations with Display Screen Equipment (DSE)..... | 25 |
| 5.9.1 General.....   | 25 |
| 5.9.2 Luminaire luminance limits with downward flux.....               | 25 |
| 6 Lighting design considerations.....                                  | 26 |
| 6.1 General.....   | 26 |
| 6.2 Illuminance requirements and recommendations.....                  | 27 |
| 6.2.1 General.....   | 27 |

|       |  |           |
|-------|--|-----------|
| 6.2.2 | Lighting of the task area or activity area and its immediate surrounding area (see 5.3)  | 2         |
| 7     |  |           |
| 6.2.3 | Lighting of the space  | 27        |
| 6.2.4 | Adjustability of the lighting system   | 28        |
| 6.3   | Maintenance factor   | 28        |
| 6.4   | Energy efficiency requirements   | 29        |
| 6.5   | Additional benefits of daylight  | 29        |
| 6.6   | Variability of light   | 30        |
| 6.7   | Room brightness  | 30        |
| 7     | Schedule of specific lighting requirements   | 30        |
| 7.1   | Composition of the tables  | 30        |
| 7.2   | Schedule of task and activity areas  | 31        |
| 7.3   | Lighting requirements for task areas, activity areas, room and space brightness  | 33        |
| 8     | Verification procedures  | 91        |
| 8.1   | General  | 91        |
| 8.2   | Illuminances   | 91        |
| 8.3   | Unified Glare Rating   | 91        |
| 8.4   | Colour rendering and colour appearance   | 91        |
| 8.5   | Luminaire luminance  | 91        |
| 8.6   | Maintenance schedule   | 91        |
|       | <b>Annex A (informative) Recommended practice regarding implementation of UGR tabular method for 'non-standard' situations</b> | <b>92</b> |
| A.1   | General  | 92        |
| A.2   | Recommended Practices  | 92        |
| A.2.1 | Deviating luminaire sizes  | 92        |
| A.2.2 | Irregular area shapes  | 92        |
| A.2.3 | Irregular luminaire placement patterns   | 92        |
| A.2.4 | Deviating room reflectances  | 92        |
| A.2.5 | Multiple luminaire types   | 93        |
| A.2.6 | Luminaires with (only) up-lighting or luminous   |           |

|  |           |
|--|-----------|
| ceilings.....  | 93        |
| A.2.7 Room dimensions smaller or larger than the tabular values.....   | 93        |
| <b>Annex B (informative) Additional information on visual and non-visual (non-image forming) effects of light.....</b> | <b>94</b> |
| <b>B.1</b>   |           |
| <b>General .....</b>   | <b>94</b> |
| <b>B.2 Perceived room brightness.....</b>  | <b>94</b> |
| <b>B.3 Alternative parameters.....</b>   | <b>94</b> |
| <b>B.3.1</b>   |           |
| <b>General .....</b>   | <b>94</b> |
| <b>B.3.2 Mean ambient illuminance, <math>\bar{E}_{amb}</math> (Govén et al.)[1].....</b>                               | <b>94</b> |
| <b>B.3.3 Mean room surface luminous exitance, <math>M_{RS}</math> (Cuttle)[2].....</b>                                 | <b>95</b> |
| <b>B.3.4 Visual lightness and interest - 40 degree band luminance (Loe et al.)[3].....</b>                             | <b>95</b> |
| <b>B.4 Adaptation luminance within the normal visual field .....</b>   | <b>96</b> |
| <b>B.5 The influence of spectral power distribution on non-image forming effects.....</b>                              | <b>96</b> |

STANDARDSISO.COM : Click to view the full PDF of BS EN 12464 -1 (WG):2021

|                     |  |            |
|---------------------|--|------------|
| <b>B.6</b>          | <b>Varying lighting conditions .....</b>                                 | <b>96</b>  |
| <b>B.7</b>          | <b>Daylight provision .....</b>  | <b>97</b>  |
| <b>Annex C</b>      | <b>(informative) Lighting design considerations - Examples .....</b>     | <b>98</b>  |
| <b>C.1</b>          | <b>Example for offices .....</b>   | <b>98</b>  |
| <b>C.2</b>          | <b>Example for industry machine workshop.....</b>                        | <b>99</b>  |
| <b>C.3</b>          | <b>Example for industrial machine workshop with inspection area.....</b> | <b>101</b> |
| <b>C.4</b>          | <b>Example for electronics industry .....</b>                            | <b>102</b> |
| <b>Annex D</b>      | <b>(informative) Transportation areas – Railway installations.....</b>   | <b>104</b> |
| <b>D.1</b>          | <b>Platform edge .....</b>   | <b>104</b> |
| <b>D.2</b>          | <b>Limitation of glare for train drivers.....</b>                        | <b>104</b> |
| <b>D.3</b>          | <b>Maintenance sheds.....</b>  | <b>104</b> |
| <b>D.4</b>          | <b>Circulation areas .....</b>   | <b>104</b> |
| <b>Annex E</b>      | <b>(informative) A-deviations.....</b>                                   | <b>105</b> |
| <b>Bibliography</b> | <b>.....</b>   | <b>106</b> |
| <b>Index</b>        | <b>.....</b>   | <b>109</b> |

STANDARDSISO.COM: Click to view the full PDF of BS EN 12464 - 1 (WGI):2021  
Copyrighted document for WGI on Lighting.  
No reproduction or circulation without permission.

## European foreword

This document (EN 12464-1:2021) has been prepared by Technical Committee CEN/TC 169 "Light and lighting", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by February 2022, and conflicting national standards shall be withdrawn at the latest by February 2022.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN 12464-1:2011.

The original standard EN 12464-1:2002 was already further developed in its first revision EN 12464-1:2011. It specifies the requirements for good lighting solutions rather than giving design guidelines. With the experience of applying the standard next steps are taken in the development of this new edition and human and user needs are given broader acknowledgement. Lighting requirements for task areas to fulfil visual tasks are given a close relation to the space in which they are carried out. Technologically LED has taken over as the main light source from previous technologies. The main changes with respect to the previous edition are:

- The recommendations given in the tables in Clause 7 take user needs more into account than in the past. Thus, the requirements for necessary illuminance according to Clause 7 are more differentiated.
- The impact of visual and non-visual (non-image forming) effects of light on people's performance and well-being are elaborated in the new informative Annex B.
- Requirements for walls, ceilings and cylindrical illuminances are moved from the main text to the tables in Clause 7 for increased visibility and usability.
- A new chapter on design considerations (Clause 6) gives advice on how to apply the requirements when designing lighting for visual tasks and activities within a space.
- Relation between task area and its immediate surround and the background area is more detailed (5.3.3, 5.3.4, 5.3.5).
- Glare requirements have been clarified for improved usability including clarification for shielding in 5.5 and recommended practices for UGR in non-standard situations has been added in a new informative Annex A.
- Flicker and stroboscopic effect is updated (5.8).
- A new informative Annex C is introduced including examples on how to derive the requirements in different applications (office/industry) for designing lighting.
- A new informative Annex D is introduced to provide additional information on the specific requirements for railway installations that are given in Table 61.

Any feedback and questions on this document should be directed to the users' national standards body. A complete listing of these bodies can be found on the CEN website.

According to the CEN -CENELEC Internal Regulations, the national standards organisations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

STANDARDSISO.COM: Click to view the full PDF of BS EN 12464 -1 (WG):2021  
Copyrighted document for WG on Lighting.  
No reproduction or circulation allowed.

## Introduction

Adequate and appropriate lighting enables people to perform visual tasks efficiently and accurately including tasks performed over a prolonged time period or of a repetitive nature. The degree of visibility and comfort required in a wide range of work places is governed by the type and duration of the activity. The lighting also affects circadian rhythms and mood as well as improving our performance and well-being.

The final designed, installed and operated lighting system should provide efficient and effective good quality lighting for the user needs tailored to their visual capacity, e.g. elderly users in workplaces.

It is important that all clauses of this document are followed although the target values for lighting criteria and specific requirements, depending of each type of task/activity, are tabulated in the schedule of lighting requirements (see Clause 7).

This document reflects the generally recognized best practice.

STANDARDSISO.COM: Click to view the full PDF of BS EN 12464 -1 (WG1202)  
Copyrighted document for WG on Lighting.  
No reproduction or circulation allowed.

## 1 Scope

This document specifies lighting requirements for humans in indoor work places, which meet the needs for visual comfort and performance of people having normal, or corrected to normal ophthalmic (visual) capacity. All usual visual tasks are considered, including Display Screen Equipment (DSE).

This document specifies requirements for lighting solutions for most indoor work places and their associated areas in terms of quantity and quality of illumination. In addition, recommendations are given for good lighting practice including visual and non-visual (non-image forming) lighting needs. This document does not specify lighting requirements with respect to the safety and health of people at work and has not been prepared in the field of application of Article 169 of Treaty on the Functioning of the European Union although the lighting requirements, as specified in this document, usually fulfil safety needs.

NOTE Lighting requirements with respect to the safety and health of workers at work can be contained in Directives based on Article 169 of Treaty on the Functioning of the European Union, in national legislation of member states implementing these directives or in other national legislation of member states.

This document neither provides specific solutions, nor restricts the designers' freedom from exploring new techniques nor restricts the use of innovative equipment. The illumination can be provided by daylight, electric lighting or a combination of both.

This document is not applicable for the lighting of outdoor work places and underground mining or emergency lighting. For outdoor work places, see EN 12464-2 and for emergency lighting, see EN 1838 and EN 13032-3.

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 12193, *Light and lighting — Sports lighting*

EN 12665, *Light and lighting — Basic terms and criteria for specifying lighting requirements*

EN 17037:2018, *Daylight in buildings*

EN 60601-2-41:2009,<sup>1</sup> *Medical electrical equipment — Part 2 -41: Particular requirements for basic safety and essential performance of surgical luminaires and luminaires for diagnosis*

EN ISO 9680, *Dentistry — Operating lights (ISO 9680)*

ISO 3864-1, *Graphical symbols — Safety colours and safety signs — Part 1: Design principles for safety signs and safety markings*

ISO/CIE TS 22012, *Light and lighting — Maintenance factor determination — Way of working*

---

<sup>1</sup> As impacted by EN 60601-2-41:2009/A11:2011 and EN 60601-2-41:2009/A1:2015.

### 3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 12665, EN 17037 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <https://www.electropedia.org/>
- ISO Online browsing platform: available at <https://www.iso.org/obp>

#### 3.1

##### activity area

area which contains one or more visual tasks

Note 1 to entry: Visual tasks can be different in type and/or position.

Note 2 to entry: A room can contain one or more activity areas.

Note 3 to entry: The spatial orientation needs to be specified by the designer.

Note 4 to entry: An activity area is not to be considered as aggregation of a number of distinct task areas across a larger area.

#### 3.2

##### modelling

effect of directional lighting to reveal the depth, shape and texture of an object or person

[SOURCE: CIE S 017:2020, 17-29-170]

### 4 Symbols and abbreviations

|                       |  |         |
|-----------------------|--|---------|
| $\bar{E}_{m,wall}$    | maintained illuminance on walls              | 5.2.3   |
| $\bar{E}_{m,ceiling}$ | maintained illuminance on ceiling            | 5.2.3   |
| $U_o$                 | illuminance uniformity                       | 5.2.3   |
| $\bar{E}_m$           | maintained illuminance <sup>2</sup>          | 5.3.3   |
| $\alpha$              | shielding angle                              | 5.5.2   |
| $\gamma$              | vertical photometric angle                   | 5.5.2   |
| DGP                   | Daylight Glare Probability                   | 5.5.3.1 |
| $R_{UG}$              | CIE Unified Glare Rating (UGR)               | 5.5.3.2 |
| $R_{UGL}$             | $R_{UG}$ limit value                         | 5.5.3.2 |
| $\bar{E}_z$           | average cylindrical illuminance <sup>3</sup> | 5.6.2   |
| $\bar{E}_{m,z}$       | maintained average cylindrical illuminance   | 5.6.2   |

<sup>2</sup> According to EN 12655,  $\bar{E}_m$  is the value below which the average illuminance on a specified area shall not fall.

<sup>3</sup> approximation of the average of the four main directions

|             |   |       |
|-------------|---|-------|
| $T_{cp}$    | correlated colour temperature                     | 5.7.2 |
| $R_a$       | colour rendering index                            | 5.7.3 |
| $R_i$       | special colour rendering index                    | 5.7.3 |
| TLA         | temporal light artefacts                          | 5.8.1 |
| $P_{stL}^M$ | IEC short-term light modulation/flicker indicator | 5.8.2 |
| SVM         | Stroboscopic Visibility Measure                   | 5.8.3 |
| $\bar{E}$   | average illuminance                               | 5.8.3 |
| DSE         | Display Screen Equipment                          | 5.9   |
| $L$         | luminance   | 5.9.2 |
| $f_m$       | maintenance factor                                | 6.3   |
| $\bar{E}_i$ | initial illuminance                               | 6.3   |
| LENI        | lighting energy numeric indicator                 | 6.4   |

## 5 Lighting design criteria

### 5.1 Luminous environment

For good lighting practice it is essential that as well as the required illuminances, additional qualitative and quantitative needs are satisfied.

Lighting requirements are determined by the satisfaction of three basic human needs:

- visual comfort, where the workers have a feeling of well-being; in an indirect way this also contributes to a higher productivity level and a higher quality of work;
- visual performance, where the workers are able to perform their visual tasks, even under difficult circumstances and during longer periods;
- safety.

The main criteria determining the luminous environment with respect to electric lighting and daylighting are:

- luminance distribution;
- illuminance;
- glare;
- directionality of light, lighting in the interior space;
- colour rendering and colour appearance of the light;
- flicker;
- variability of light (levels and colour of light).

These criteria are further detailed in Clause 5 and 6, requirements and recommendations are given in Clause 7.

**NOTE** In addition to the lighting there are other visual ergonomic parameters which influence visual performance, such as:

- the intrinsic task properties (size, shape, position, colour and reflectance properties of detail and background),
- ophthalmic capacity of the person (visual acuity, depth perception, colour perception) (see CIE 227),
- for the visually impaired, for example those who are sensitive to glare, have visual field defects, adaptation and decreased contrast and colour vision where dimming, protection against glare and colour rendering are especially important factors to consider, see CIE 227.

## 5.2 Luminance distribution

### 5.2.1 General

The luminance distribution in the visual field controls the adaptation level of the eyes which affects task visibility.

A well balanced adaptation luminance is needed to increase:

- visual acuity (sharpness of vision);
- contrast sensitivity (discrimination of small relative luminance differences);
- efficiency of the ocular functions (such as accommodation, convergence, pupillary contraction, eye movements, etc.).

The luminance distribution in the visual field also affects visual comfort. The following should be avoided for the reasons given:

- too high luminances and luminance contrasts which can give rise to glare;
- too high luminance variation which will cause fatigue because of constant re-adaptation of the eyes;
- too low luminances and too low luminance contrasts which result in a dull and non-stimulating working environment.

To create a well-balanced luminance distribution the luminances of all surfaces shall be taken into consideration. They are determined by the reflectance of and the illuminance on the surfaces. To avoid gloom and to raise adaptation levels and comfort of people in buildings, it is highly desirable to have bright interior surfaces. Room brightness is considered by specifying illuminances on walls and ceiling (see Clause 7) and by recommending reflectances. Annex B provides further details of possible measures.

Although luminance requirements would be a representative way of describing the visual environment, this document lists illuminance requirements as luminance requirements are more complex due to their dependence on exact material characteristics and viewing positions.

The lighting designer shall consider and select appropriate reflectance (5.2.2) and illuminance requirements for the interior surfaces (5.2.3) based on the guidance below.

## 5.2.2 Reflectance of surfaces

High surface reflectances contribute to energy savings and can lead to better visual comfort. For choice of materials, the following ranges of reflectances are recommended:

- ceiling: 0,7 to 0,9;
- walls: 0,5 to 0,8;
- floor: 0,2 to 0,6.

The reflectance of major objects (like furniture, machinery, etc.) should be in the range of 0,2 to 0,7.

NOTE Clear interior glass has a typical reflectance of 0,1.

In design calculations, surface reflectances should be defined as close to the real surfaces as possible taking into account the variation in reflectance across the surface.

## 5.2.3 Illuminance on surfaces

Illuminances on walls and ceilings together with surface reflectances (see 5.2.2) contribute to luminances and are indicators for perceived room brightness.

Clause 7 provides minimum requirements for the maintained illuminance on walls ( $\bar{E}_{m,wall}$ ) and ceiling ( $\bar{E}_{m,ceiling}$ ) depending on the tasks and/or activities being performed in the space. Uniformity for walls and ceiling shall be  $U_o \geq 0,10$  (see 5.3.6).

NOTE Additional guidance can be found in Clause 6.

## 5.3 Illuminance

### 5.3.1 General

Areas to be lit are task and activity areas, the immediate surrounding area and background area, walls, ceiling and objects in the space.

The illuminance and its distribution on the task area and on its immediate surrounding area have a great impact on how quickly, safely and comfortably a person perceives and carries out the visual task.

All values of illuminances given in this document are maintained illuminances specified to fulfil visual comfort and performance needs.

Designing for higher illuminances allows enough capacity for applying context modifiers (see Table 1 and Table 2) and controls. Higher illuminances shall be used when relevant, e.g. only parts of the day.

For calculation and measurement of illuminance averages and uniformities the grid specification in 5.4 shall be used.

### 5.3.2 Scale of illuminance

To give a perceptual difference the recommended steps of illuminance (in lx) are according to EN 12665:

5 - 7,5 - 10 - 15 - 20 - 30 - 50 - 75 - 100 - 150 - 200 - 300 - 500 - 750 - 1 000 - 1 500 - 2 000 - 3 000 - 5 000 - 7 500 - 10 000

### 5.3.3 Illuminances on the task area or activity area

The maintained illuminance value shall at least meet the requirement as given in Clause 7 ( $\bar{E}_m$ , required) and shall be used for normal visual conditions taking into account the following factors:

- psycho-physiological aspects such as visual comfort and well-being;
- requirements for visual tasks;
- visual ergonomics;
- practical experience;
- contribution to functional safety;
- economy.

The values given in Clause 7 are maintained illuminances over the task area or activity area on the reference surface which can be horizontal, vertical or inclined.

However, it is recommended to increase the maintained illuminance (by one or two steps in the scale of illuminances (see 5.3.2)), depending on the context modifiers given in Table 1 if the assumptions differ from the normal visual conditions.

As an example an increase of one step is recommended if one or two of the conditions listed in Table 1 apply and an increase of two steps is recommended if more than two of these conditions apply. For examples see Annex C.

A modified value which considers common context modifiers is given in Clause 7 ( $\bar{E}_m$ , modified). This modified value shall not be seen as an upper limit.

**Table 1 — Context modifiers for increase of maintained illuminance**

|  |
|--|
| visual work is critical;   |
| errors are costly to rectify;  |
| accuracy, higher productivity or increased concentration is of great importance; |
| task details are of unusually small size or low contrast;                        |
| the task is undertaken for an unusually long time;                               |
| the task area or activity area has a low daylight provision;                     |
| the visual capacity of the worker is below normal.                               |

NOTE 1 Retinal illuminance declines with age due to reduced pupil size and increased spectral absorption of the crystalline lens. It is reasonable for lighting practitioners to increase task illuminance to help older people compensate for the age-related losses in retinal illuminance. More information can be found in CIE 227:2017.

NOTE 2 Daylight provision is considered in 6.5.

The required  $\bar{E}_m$  in 7.3 is a minimum value for normal working conditions.

Decreasing illuminance by one step may be considered when conditions from Table 2 apply.

**Table 2 — Context modifiers for decrease of required maintained illuminance**

|   |
|---|
| task details are of an unusually large size or high contrast; |
| the task is undertaken for an unusually short time.           |

Using dimming will accommodate for possible future change in working conditions.

NOTE 3 For visually impaired people special requirements can be necessary with regard to illuminances and contrasts.

The size and position of the task or the activity area shall be stated and documented, see Figure 1.

For work stations where the size and/or location of the task area or activity area(s) is/are unknown, either:

- the whole area is treated as the task area; or
- the whole area is uniformly ( $U_o \geq 0,40$ ) lit to an illuminance level specified by the designer; if the task area becomes known, the lighting scheme shall be re-designed to provide the required or modified illuminances.

If the type of the task is not known the designer has to make assumptions about the likely tasks and state task requirements.

If the whole area is lit to a given illuminance value then it is recommended that the lighting is controlled in appropriate zones.

When multiple tasks take place in the area, requirements for all these tasks shall be complied with.

This applies also to an activity area.

### 5.3.4 Illuminance on the immediate surrounding area

Large spatial variations in illuminance around the task area or activity area can lead to visual stress and discomfort.

The illuminance of the immediate surrounding area shall be related to the illuminance of the task area or activity area and should provide a well-balanced luminance distribution in the visual field. The immediate surrounding area should be a band with a width of at least 0,5 m around the task area within the visual field.

The illuminance of the immediate surrounding area may be lower than the illuminance on the task area but shall be not less than the values given in Table 3.

In addition to the illuminance on the task and activity area the lighting shall provide adequate adaptation luminance in accordance with 5.2.

The size and position of the immediate surrounding area shall be stated and documented.

**Table 3 — Relationship of illuminances on immediate surrounding to the illuminance on the task area or activity area**

| Illuminance on the task area<br>or activity area<br>$\bar{E}_m$<br>lx | Illuminance on immediate<br>surrounding areas<br>lx |
|---|---|
| ≥ 750   | 500   |
| 500   | 300   |
| 300   | 200   |
| 200   | 150   |
| ≤ 150   | <i>equal to task area</i>                           |


Figure 1 illustrates the minimum dimension of immediate surrounding area in relation to task area.

### 5.3.5 Illuminance on the background area

In indoor work places, particularly those devoid of daylight, a large area outside the immediate surrounding area needs to be illuminated. The background area is a horizontal area on floor level. It is adjacent to the immediate surrounding area within the limits of space and shall be illuminated with a maintained illuminance of 1/3 of the value of the immediate surrounding area. For larger rooms the band shall be at least 3 m wide.

The size and position of the background area shall be stated and documented.

Figure 1 illustrates the minimum dimension of background area in relation to task and immediate surrounding area.

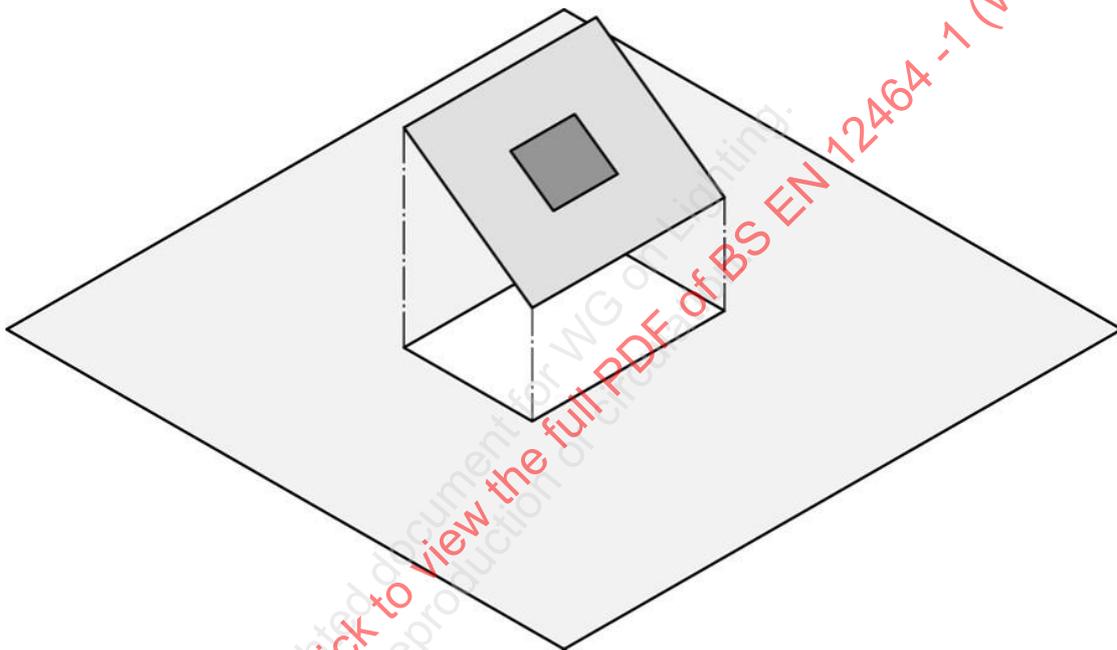

#### Key

- task area or activity area (not true to scale) in a specified size and position (see 5.3.3)
- immediate surrounding area (band with a width of at least 0,5 m around the task area or activity area within the visual field)
- background area (band with a width of at least 3 m adjacent to the immediate surrounding area or up to the limits of the space for smaller rooms) horizontal on floor level

**Figure 1 — Minimum dimensions of immediate surrounding area and background area in relation to task and activity area (figure is not true to scale)**

### 5.3.6 Illuminance uniformity

In the task area or activity area, the illuminance uniformity ( $U_0$ ) shall be not less than the minimum uniformity values given in the tables in 7.3.

Uniformity in the immediate surrounding area shall be  $U_0 \geq 0,40$ .

On the background area, the walls and the ceiling the uniformity shall be  $U_0 \geq 0,10$ .

These uniformity levels shall only be applied with electric lighting.

Illuminance uniformity levels when daylight is available are not applicable because light intensity and distribution changes continuously due to weather conditions and outdoor context. Additional benefits of daylight can compensate for the lack of uniformity. More information can be found in 6.5 and B.7.

#### 5.4 Illuminance grid

Grid systems shall be created to indicate the points at which the illuminance values are calculated and verified for the task and activity area(s), immediate surrounding area(s) and background area(s).

Grid cells approximating to a square are preferred, the ratio of length to width of a grid cell shall be kept between 0,5 and 2 (see also EN 12193 and EN 12464-2). The maximum grid size shall be:

$$p = 0,2 \times 5^{\log_{10}(d)} \quad (1)$$

where

$$p \leq 10 \text{ m}$$

$d$  is the longer dimension of the calculation area (m), however if the ratio of the longer to the shorter side is 2 or more then  $d$  becomes the shorter dimension of the area, and

$p$  is the maximum grid cell size (m).

The number of points in the relevant dimension is given by the nearest whole number of  $d/p$ .

The resulting spacing between the grid points is used to calculate the nearest whole number of grid points in the other dimension. This will give a ratio of length to width of a grid cell close to 1.


NOTE 1 Formula (1) (coming from CIE x005 -1992) has been derived under the assumption that  $p$  is proportional to  $\log(d)$ , where:

$$p = 0,2 \text{ m for } d = 1 \text{ m};$$

$$p = 1 \text{ m for } d = 10 \text{ m};$$

$$p = 5 \text{ m for } d = 100 \text{ m}.$$

The illuminance values are calculated and measured at the centre point of grid rectangles. A typical grid is shown in Figure 2.

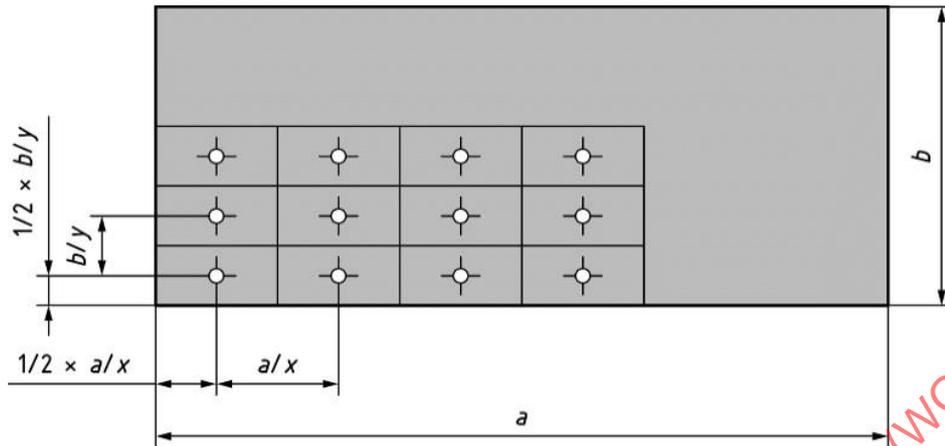

**Key**


- $a$  dimension of the longer side of the calculation area/verification area
- $b$  dimension of the shorter side of the calculation area/verification area
- $x$  number of points along the longer side
- $y$  number of points along the shorter side

**Figure 2 — Typical grid**

To avoid high impact on uniformity from calculation points near the wall, a band next to the wall can be excluded from the calculation except when the task area is in or extends into this border area. The width of this band is specified as 15 % of the smallest dimension of the area under consideration or 0,5 m, whichever of the two is smaller.

The grid cell size as function of calculation/measurement area dimension is shown in Figure 3.

STANDARDSISO.COM: Click to view the full PDF of BS EN 12464 -1 (WG):2021  
No reproduction or distribution in any form or by any means without the prior written permission of the copyright holder.

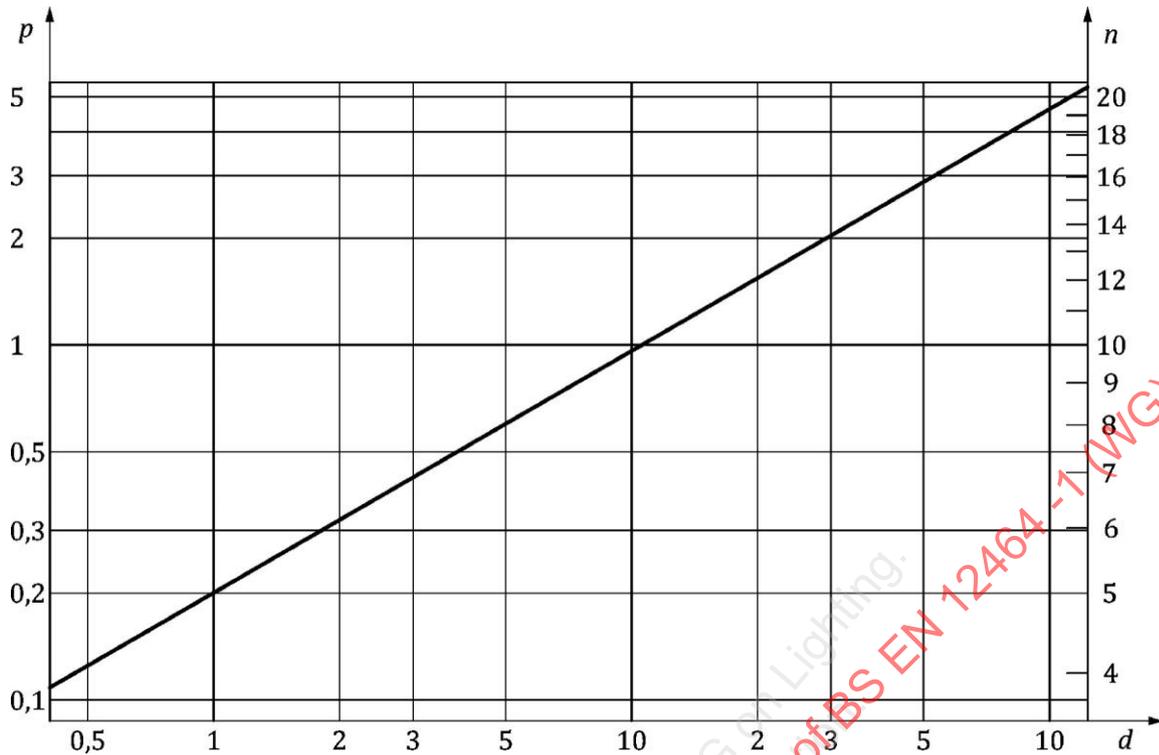

**Key**

- $d$  longer dimension of the calculation area (m), however if the ratio of the longer to the shorter side is 2 or more then  $d$  becomes the shorter dimension of the area
- $p$  maximum grid cell size (m)
- $n$  number of points in relevant dimension

**Figure 3 — Grid cell size as function of calculation/measurement area dimension**

An appropriate grid size shall be applied to walls and ceiling and a band of 0,5 m may be applied also.

The grid point spacing should not coincide with the luminaire spacing.

NOTE 2 A separate grid for the calculation of daylight provision is specified in Annex B to EN 17037:2018. This grid is not applicable for electric lighting.

**5.5 Glare**

**5.5.1 General**

Glare is the unpleasant sensation produced by bright areas within the visual field, such as lit surfaces, parts of the luminaires, windows and/or roof lights. Glare shall be limited to avoid errors, fatigue and accidents. Glare can be experienced either as discomfort glare or as disability glare.

Glare caused by reflections in specular surfaces is usually known as veiling reflections or reflected glare.

Glare shall be avoided:

1. By shielding the light source and/or by limiting the luminance of the luminous surfaces (according to 5.5.2); and
2. By limiting the discomfort glare. For luminaires the UGR method shall be applied where valid (according to 5.5.3).

NOTE Special care is needed to avoid glare when the direction of view is significantly above the horizontal viewing direction, e.g. cases where a regular aspect of the work is looking high up/into the luminaires such as the storage racks, etc.

### 5.5.2 Limiting luminaire luminance

Bright sources of light can cause glare and can impair the vision of objects. It shall be avoided for example by suitable shielding of light sources or suitable shading from bright light through daylight openings.

For luminaires where the light source is directly visible, the minimum shielding angles (see Figure 4) in the visual field given in Table 4 shall be applied for the specified light source luminance.

For luminaires where a direct view of the light source is obscured via optics, the maximum average luminaire luminance for the values of vertical photometric angle given in Table 5 shall be applied (see Figure 4).


The values given in Table 4 and Table 5 do not apply to luminaires with an upward component only, mounted above normal eye level or to luminaires with a downward component only, mounted below normal eye level.

**Table 4 — Minimum shielding angles at specified light source luminance**

| Light source luminance<br>kcd m <sup>-2</sup> | Minimum shielding angle<br>$\alpha$ |
|---|-------------------------------------|
| 20 to < 50                                    | 15°                                 |
| 50 to < 500                                   | 20°                                 |
| ≥ 500   | 30°                                 |

**Table 5 — Maximum average luminance of a luminous optical element at specified vertical photometric angles**

| Vertical photometric angle<br>$\gamma$ | Maximum average luminance of a luminous optical element<br>kcd m <sup>-2</sup> |
|--|--|
| $75^\circ \leq \gamma < 90^\circ$      | ≤ 20   |
| $70^\circ \leq \gamma < 75^\circ$      | ≤ 50   |
| $60^\circ \leq \gamma < 70^\circ$      | ≤ 500  |

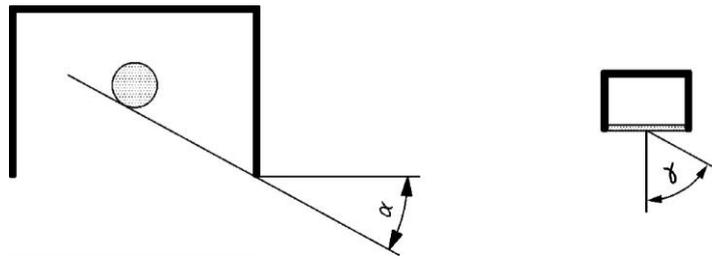

**Key**

- $\alpha$  shielding angle
- $\gamma$  vertical photometric angle

NOTE Left figure shows a cross section of a conventional luminaire with a separate light source. Right picture shows a cross section of a luminous part of the optical element, e.g. a part of a LED luminaire.

**Figure 4 — Shielding angle  $\alpha$  and vertical photometric angle  $\gamma$**

**5.5.3 Discomfort glare**

**5.5.3.1 Discomfort glare from daylight**

In areas with daylight access, glare from daylight openings can occur either by direct sunlight entering and/or when the luminance in the field of view seen through daylight openings is too high compared to the adaptation levels for which the occupant is adapted at a given time.

NOTE 1 To assess the occurrence of discomfort glare from daylight openings, EN 14501 and EN 17037 provide recommended levels for glare protection by the Daylight Glare Probability (DGP).

NOTE 2 For workspaces requiring higher visual comfort due to the tasks performed consider the glare protection classes from Annex A to EN 17037:2018.

NOTE 3 Glare caused by daylight openings differs from glare caused by electric light sources regarding size of the glare sources, complex luminance distributions and user's acceptance.

**5.5.3.2 Discomfort glare from electric light - application of UGR tabular method**

To select a luminaire suitable for the lighting installation of a given space the rating of discomfort glare caused directly from the luminaires shall be determined using the CIE Unified Glare Rating (UGR) tabular method.

NOTE 1 The UGR tabular method is detailed in CIE 117-1995 and in CIE 190:2010.

This UGR value determined using the UGR tabular method shall not exceed the  $R_{UG}$  limit value ( $R_{UGL}$ ) given in Clause 7.

All assumptions made concerning luminaire, room dimensions, room surface reflectance's and spacing to height ratio in the determination of the  $R_{UGL}$  (formerly: UGR) shall be stated in the scheme documentation.

The tabular method is based on applying Formula (2) to a set of standard conditions (observer position, room dimensions and reflection factors).

$$R_{UG} = 8 \log_{10} \left\{ \frac{0,25}{L_B} \sum \frac{L^2 \omega}{p^2} \right\} \tag{2}$$

where

- $R_{UG}$  is the value of the Unified Glare Rating (UGR),
- $L_B$  is the background luminance in  $\text{cd}\cdot\text{m}^{-2}$ , calculated as  $E_{\text{ind}} \cdot \pi^{-1}$ , in which  $E_{\text{ind}}$  is the vertical indirect illuminance at the observer's eye,
- $L$  is the luminance in  $\text{cd}\cdot\text{m}^{-2}$  of the luminous parts of each luminaire in the direction of the observer's eye,
- $\omega$  is the solid angle in steradian of the luminous parts of each luminaire at the observer's eye,
- $p$  is the Guth position index for each individual luminaire which relates to its displacement from the line of sight.

NOTE 2 For more information on discomfort caused by glare from luminaires with a non-uniform source luminance, refer to CIE 232:2019.

NOTE 3 The limiting values of the  $R_{UGL}$  form a series whose steps indicate noticeable changes in glare. This series of  $R_{UGL}$  is: 16, 19, 22, 25, 28 where a low value means "little likelihood of discomfort glare" and a high value means "significant possibility of discomfort glare".

NOTE 4 For a tabular UGR value a variation of  $\pm$  can also be given. This variation of UGR within the room can be determined using the comprehensive tables for different observer positions, as detailed in CIE 117-1995. A high variation indicates that even small changes in the observer position can result in larger changes in glare. The compliance of the indoor lighting installation is not considering any variation in the CIE Unified Glare Rating (UGR) tabular method.

The boundary conditions for the determination of the UGR value by the tabular method include having one type of luminaire only in a rectangular space, a regular luminaire grid, same installation height, same orientation (C and  $\gamma$  angles).

The UGR tabular method does also not apply to following luminaires:

- wall washers;
- totally indirect;
- asymmetric and double asymmetric;
- adjustable spots;
- very small or very large luminous surfaces (see A.2.1).

This limits the application of the methodology to some extent but does not exclude its use. To maximize the applicability of the tabular method, A.2 covers recommended practices when the above boundary conditions are not met.

### 5.5.3.3 Determination by UGR formula

If the tabular method is not applicable and the observer position and the viewing directions are known the UGR value can be determined by using the UGR Formula (2) from 5.5.3.2. However, the limits given in Clause 7 have to be considered as benchmarks and not mandatory limits.

Account should be taken of possible variations in observer position and viewing direction, up to the expected displacement/rotation of the head of a person

NOTE UGR values calculated by the formula are also suitable for making decision on optimal position(s) of the observer in the room.

All assumptions made concerning the calculation shall be stated in the scheme documentation.

#### 5.5.4 Veiling reflections and reflected glare

High brightness reflections in the visual task can alter task visibility, usually detrimentally. Veiling reflections and reflected glare can be prevented or minimised by the following measures:

- arrangement of work stations with respect to luminaires and daylight openings;
- surface finish (matt surfaces);
- luminance restriction of luminaires and daylight openings;
- bright ceiling and bright walls.

### 5.6 Lighting in the interior space

#### 5.6.1 General

In addition to lighting of the task and the activity areas the volume of space occupied by people should be lit. This light is required to highlight objects, reveal texture and improve the appearance of people within the space. The terms “average cylindrical illuminance”, “modelling” and “directional lighting” describe the lighting conditions.

#### 5.6.2 Cylindrical illuminance requirement in the activity space

Good visual communication and recognition of objects within a space require that the volume of space in which people move or work shall be illuminated. This is fulfilled by providing adequate average cylindrical illuminance,  $\bar{E}_{z'}$ , in the space.

The required maintained average cylindrical illuminance ( $\bar{E}_{m,z}$ ) to be determined on a horizontal plane in the room and space (as in Table 8) is given in Clause 7 for each type of task or activity. The uniformity of the average cylindrical illuminance shall be  $U_o \geq 0,10$ . The height of the horizontal plane shall be 1,2 m for seated people and 1,6 m for standing people above the floor.

Special attention is given to those spaces where visual recognition and communication is of higher importance.

When the complete space is treated as the task area or activity area and is used for the calculation of the required horizontal average illuminance,  $\bar{E}_m$ , the maintained average cylindrical illuminance,  $\bar{E}_{m,z'}$ , shall be calculated for the same area size and position. When the task area and activity area / immediate surrounding area / background area are defined separately, the cylindrical illuminance requirement given in the tables in 7.3 shall be calculated and fulfilled for the space including task area and activity area and the immediate surrounding area.

NOTE As an approximation for the cylindrical illuminance, the average value of four vertical illuminances orthogonal to one another can be used.

#### 5.6.3 Modelling

The general appearance of an interior is enhanced when its structural features, the people and objects within it are lit so that form and texture are revealed clearly and pleasingly.

The lighting should not be too directional or it will produce harsh shadows, neither should it be too diffuse or the modelling effect will be lost entirely, resulting in a very dull luminous environment. Multiple shadows caused by directional lighting from more than one position should be avoided as this can result in a confused visual effect.

Modelling describes the balance between diffuse and directed light and should be considered.

The ratio of cylindrical to horizontal illuminance at a point is an indicator of modelling. The grid points for cylindrical and horizontal illuminances shall coincide in x, y and z.

NOTE 1 For uniform arrangement of luminaires or roof lights a ratio of cylindrical to horizontal illuminance between 0,30 and 0,60 is an indicator of good modelling.

NOTE 2 Daylight from vertical openings has a large impact on modelling. For this reason, the additional benefits of daylight (see 6.5) can compensate for the above indicator of modelling, see Note 1.

#### 5.6.4 Directional lighting of visual tasks

Lighting from a specific direction can reveal details within a visual task, increase their visibility and making the task easier to perform. Unintended veiling reflections and reflected glare should be avoided, see 5.5.4.

Harsh shadows that interfere with the visual task should be avoided. But some shadows help to increase the visibility of the task.

### 5.7 Colour aspects

#### 5.7.1 General

The colour qualities of a near -white light source or transmitted daylight are characterized by two attributes:

- the colour appearance of the light;
- its colour rendering capabilities.

These two attributes shall be considered separately.

#### 5.7.2 Colour appearance of the light

The colour appearance of a light source refers to the apparent colour (chromaticity) of the light emitted. It is quantified by its correlated colour temperature ( $T_{cp}$ ), see Table 6.

**Table 6 — Light source colour appearance groups**

| Colour appearance | Correlated colour temperature $T_{cp}$ |
|-------------------|--|
| warm              | below 3 300 K                          |
| neutral           | 3 300 K to 5 300 K                     |
| cool              | above 5 300 K                          |

The choice of colour appearance of the light is a matter of psychology, aesthetics and what is preferred. The choice will depend on illuminance level, colours of the room and furniture, surrounding climate and the application. Additionally, dynamic colour temperature can be considered for increased personalization.

For further information on the physiological impact of spectral distribution and colour temperature change see Annex B. Careful consideration is necessary, especially in the case of night shift work.

In Clause 7, for specific applications a restricted band of suitable colour temperatures is given. These are applicable for daylighting as well as electric lighting.

### 5.7.3 Colour rendering

For visual performance and the feeling of comfort and well-being colours in the environment, of objects and of human skin, shall be rendered with sufficient accuracy according to the task requirements given in Clause 7.

To provide an objective indication of the colour rendering properties of a light source the general colour rendering index  $R_a$  is used. The maximum value of  $R_a$  is 100.

The minimum value of colour rendering index for distinct types of task and activity areas within a space are given in Clause 7.

Safety colours according to ISO 3864-1 shall always be identifiable as such.

Colour rendering properties of light from luminaires can be influenced by optics, glazing and coloured surfaces.

NOTE 1 Colour rendering properties for an observer in a space are affected by the reflectance properties of all surfaces.

NOTE 2 If coloured light is used, the colour rendering requirements given in Clause 7 are not applicable.

For accurate rendition of colours of objects and human skin the appropriate special colour rendering index ( $R_i$ ) should be considered.

A colour rendering index below 80 should not be accepted in areas where people work permanently.

## 5.8 Flicker and stroboscopic effects

### 5.8.1 General

Flicker and stroboscopic effect (also called temporal light artefacts - TLA) can lead to undesired effects such as reducing visual comfort and reducing task performance and can lead to physiological effects such as fatigue or headaches.

Stroboscopic effects can also lead to dangerous situations by changing the perceived motion of rotating or reciprocating machinery. This is, however, outside of the scope of this document.

Lighting systems should be designed to avoid the negative effects of flicker and stroboscopic effect throughout the full dimming range (this includes light sources and control gears). Background information and methods to objectively quantify these effects can be found in CIE TN 006:2016.

### 5.8.2 Flicker

Flicker is specified by using the IEC short-term flicker indicator ( $P_{stL}^M$ ) and test method as described in IEC TR 61547-1:2020.

NOTE The product-related EU regulation 2019/2020 and its amendments laying down ecodesign requirements for light sources and separate control gears includes requirements for  $P_{stL}^{LM}$  for some specific lighting products. For details and definitions see the ecodesign regulation.

### 5.8.3 Stroboscopic effect

Stroboscopic effect perceived by individuals in indoor work places executing typical tasks, can be objectively quantified using the Stroboscopic Visibility Measure (SVM). The SVM can be used to quantify the visibility of this effect for applications where human motion is dominant and  $\bar{E} > 100$  lx. Limits for this measure are application dependent and currently under consideration. The test method is described in IEC TR 63158:2018.

NOTE 1 SVM is not suitable to quantify the effects of lighting on health and rotating or reciprocating machinery as described in 5.8.1.

NOTE 2 The product -related EU regulation 2019/2020 and its amendments laying down ecodesign requirements for light sources and separate control gears includes requirements for SVM for some specific lighting products. For details and definitions see the ecodesign regulation.

## 5.9 Lighting of work stations with Display Screen Equipment (DSE)

### 5.9.1 General

The lighting for DSE work stations shall be appropriate for all tasks performed at the work station, e.g. reading from the screen, reading printed text, writing on paper, keyboard work.

For these areas the lighting criteria and system shall be chosen in accordance with type of task area or activity area, from the schedule in Clause 7.

Reflections in DSE and, in some circumstances, reflections from the keyboard can cause disability and discomfort glare. It is therefore necessary to select, locate and arrange the luminaires to avoid high brightness reflections.

The luminance of the background wall should be balanced to the brightness of the screen.

The designer shall determine the offending mounting zone and shall choose equipment and plan mounting positions which will cause no disturbing reflections.

### 5.9.2 Luminaire luminance limits with downward flux

Light can lower the contrast of the presentation on DSE by:

- veiling reflection caused by the illuminance on the display surface and
- luminances from luminaires and bright surfaces reflecting in the display.

EN ISO 9241-307 gives recommendations for the visual qualities of displays concerning unwanted reflections.

This subclause describes luminance limits for luminaires which can be reflected in DSE for normal viewing directions.

Table 7 gives the limits of the average luminaire luminance at elevation angles of 65° and above from the downward vertical, radially around the luminaires, for work stations where display screens which are vertical or inclined up to 15° tilt angle are used.

**Table 7 — Limits for the average luminance of luminaires, which can be reflected in flat screens**

| Screen high state luminance   | High luminance screen<br>$L > 200 \text{ cd}\cdot\text{m}^{-2}$ | Medium luminance screen<br>$L \leq 200 \text{ cd}\cdot\text{m}^{-2}$ |
|---|---|--|
| Case A<br>(positive polarity and normal requirements concerning colour and details of the shown information, as used in office, education, etc.)  | $\leq 3\,000 \text{ cd}\cdot\text{m}^{-2}$                      | $\leq 1\,500 \text{ cd}\cdot\text{m}^{-2}$                           |
| Case B<br>(negative polarity and/or higher requirements concerning colour and details of the shown information, as used for CAD, colour inspection, etc.)                               | $\leq 1\,500 \text{ cd}\cdot\text{m}^{-2}$                      | $\leq 1\,000 \text{ cd}\cdot\text{m}^{-2}$                           |
| NOTE Screen high state luminance (see EN ISO 9241-302) describes the maximum luminance of the white part of the screen and this value is available from the manufacturer of the screen. |   |  |

If screen types are not known at the lighting design stage, the designer should inform the user about the luminance criteria chosen to the luminaires of the space.

If a high luminance screen is intended to be operated at luminances below  $200 \text{ cd}\cdot\text{m}^{-2}$  the conditions specified for a medium luminance screen shall be considered.

Some tasks, activities or display screen technologies require different lighting treatment (e.g. lower luminance limits, special shading, individual dimming, etc.).

In areas of industrial activities and crafts screens are sometimes protected by additional front glasses. The unwanted reflections on these protection glasses have to be reduced by suitable methods (such as anti-reflection treatment, tilting of the protection glass or by shutters).

## 6 Lighting design considerations

### 6.1 General

To apply the lighting design criteria from Clause 5, the following aspects should be taken into account for the lighting design:

- recommended illuminance requirements, see 6.2;
- operation of the lighting system;
- energy efficiency requirements, see 6.4;
- variability of light, see 6.2.4.

Examples for the application of the processes described in 6.2 are given in Annex C.

Verification procedure can be found in Clause 8.

## 6.2 Illuminance requirements and recommendations

### 6.2.1 General

To allow for a larger variety in application requirements, Clause 7 provides maintained illuminances  $\bar{E}_m$  in steps according to the scale of illuminances in 5.3.2 from required to modified values.

### 6.2.2 Lighting of the task area or activity area and its immediate surrounding area (see 5.3)

The following steps shall be followed in selecting the appropriate lighting criteria for the task area or activity area and immediate surrounding area:

1. Define the task area and activity areas in the space.
2. Determine the appropriate type of task or activity based on the visual tasks executed in that area.

Note that the task area or activity area may be horizontal, vertical or inclined, and multiple tasks or activities may take place in the same area (consult 5.3.3 for guidance).

3. Select the “task or activity related requirements” from the tables in 7.3 ( $\bar{E}_m$ ,  $U_o$ ,  $R_a$ ,  $R_{UGL}$ ). For activity areas with multiple tasks the most onerous requirements shall be used for design (see 5.3.3).
4. Select the adequate maintained illuminance  $\bar{E}_m$  in steps using the scale of illuminance in 5.3.2 starting from the required value for the actual working condition according to the specific context modifiers as specified in 5.3.3 (Table 1 and Table 2).

It is recommended to design higher illuminances by up to two steps than the required (minimum) maintained value on the task area or activity area ( $\bar{E}_m$ ) to allow adjustment of the illuminance on the task to cater for higher visual performance. To ensure satisfaction during different times of operation dimmable lighting can be used. When the task or activity is not being performed, or an activity of less visual difficulty is being performed, lower light levels can be employed using dimming or switching if appropriate. Further information is contained in CIE 222 and CIE 227.

5. Select the appropriate illuminance requirements for the immediate surrounding area and background area based upon the  $\bar{E}_m$  selection in step 3 and Table 3 (see 5.3.4 and 5.3.5)

### 6.2.3 Lighting of the space

To enhance the visual appearance and brightness impression of the room and space and good visual communication and recognition of objects, the following steps shall be followed:

1. Determine the relevant room surfaces around the workplaces (the walls and ceiling). The surfaces to be illuminated are at least those that contribute to the perception of room brightness.

For example in high industrial halls the upper part of the wall and the ceiling may be excluded.

2. Select the requirements for “objects and people” and for “room brightness” from the tables in 7.3 ( $\bar{E}_{m,z}$ ,  $\bar{E}_{m,wall}$ ,  $\bar{E}_{m,ceiling}$ ) based on all selected tasks and activities in 6.2.2 steps 1 and 2. If different requirements apply select the highest requirements to respect all specified tasks and activities within the space.
3. In areas with high distance to the ceiling, a lower ceiling illuminance can be accepted. E.g. in industrial premises or other areas with only direct lighting and lower reflectance than the recommended values in 5.2.2, or areas where illumination of the ceiling is not appropriate.

The  $R_{UGL}$  determined by the task or activity requirements needs to be fulfilled by luminaires in the field of view within the space.

If in step 3 of 6.2.2 higher values have been selected for  $\bar{E}_m$  on the task area or activity area, the wall, ceiling and cylindrical illuminance values should also be increased by up to the same number of steps (see 5.3.2 for step sizes).

#### 6.2.4 Adjustability of the lighting system

A lighting installation can be adjusted by dimming and/or controlling. Dimming increases or decreases the lumen output from a luminaire. Controlling can have additional functionality to modify the operation of the luminaire(s) in an installation, for example variation in colour temperature or different lighting scenes or according to daylight provision.

Lighting should be adjustable to the actual user needs (see also 6.6). The system should ensure that illuminances can be achieved that meet or exceed the recommended maintained illuminance level using only the electric lighting (assuming a worst case scenario without daylight contribution). Illuminance can be achieved by both daylight and electric lighting or any combination of the two.

An adjustable system ensures that

- the benefit of available daylight is maximized;
- occupancy of the space can be taken into account;
- changes of visual tasks can be catered for;
- changes of occupants, occupant preferences or needs can be catered for.

This document recommends the use of the higher maintained illuminance  $\bar{E}_m$  to give the user the full use of the lit environment. Designing a basic lighting installation only fulfilling the minimum criteria limits the possible benefits of good lighting quality.

#### 6.3 Maintenance factor

The lighting scheme shall be designed taking into account an overall maintenance factor ( $f_m$ ) calculated for the selected lighting equipment, environment and specified maintenance schedule for the task area or activity area according to ISO/CIE TS 22012.

The illuminance requirements for each task as specified in Clause 7 are given as maintained illuminance ( $\bar{E}_m$ ) values. The initial illuminance  $\bar{E}_i$  can be calculated from  $\bar{E}_m$  as follows:

$$\bar{E}_i = \frac{\bar{E}_m}{f_m} \quad (3)$$

where

$\bar{E}_m$  is maintained illuminance

$\bar{E}_i$  is initial illuminance

$f_m$  is maintenance factor

The designer shall:

- state the  $f_m$  and list all assumptions made in the derivation of the value;
- specify lighting equipment suitable for the application environment; and
- prepare a maintenance schedule to include e.g. frequency of light source replacement, luminaire and room cleaning intervals.

The maintenance factor  $f_m$  has a large impact on energy efficiency. The assumptions made in the derivation of the  $f_m$  shall be both realistically achievable and optimized in a way that leads to a high value.

NOTE 1 Guidance on the determination of the maintenance factor can be found in ISO/CIE TS 22012 and further information on the derivation of  $f_m$  for electric indoor lighting systems can be found in CIE 97.

NOTE 2 For daylight calculations, reduction of transmittance of daylight openings due to dirt deposition has an influence on daylight supply.

## 6.4 Energy efficiency requirements

Lighting should be designed to meet the lighting requirements of a particular task, activity or space in an energy efficient manner. It is important not to compromise the visual aspects of a lighting installation simply to reduce energy consumption. The required minimum illuminance values as set in this document are minimum values and shall be maintained over time (see 7.3).

Energy savings can be made by harvesting daylight, responding to occupancy patterns, improving maintenance characteristics of the installation, and making full use of controls.

Daylight can supply all or part of the light needed for visual tasks or activities, and therefore offers potential energy savings. The amount of daylight indoors depends firstly on the availability of daylight outside (i.e. the prevailing climate at the site) and, thereafter, the environment surrounding the building, the components immediately around the daylight opening and the configuration of the interior spaces. With a near vertical daylight opening in the façade, the daylight availability decreases rapidly with the distance from the façade. Supplementary lighting (e.g. electric light or additional daylight openings) can be needed to ensure the required illuminance levels at the work station are achieved and to balance the luminance distribution within the room. Controls can be used to ensure appropriate integration between electric lighting and daylight.

A procedure for the estimation of the energy requirements of a lighting installation is given in EN 15193-1. It gives a methodology for the calculation of a lighting energy numeric indicator (LENI), representing the energy performance of lighting within buildings. This indicator may be used for single rooms on a comparative basis only, as the benchmark values given in the CEN/TR 15193-2 are drawn up for some types of room or application areas. EN 15193-1 provides a simplified method for calculating the potential energy savings of daylight.

## 6.5 Additional benefits of daylight

Daylight can provide significant quantities of light indoors, with high colour rendering and variability in illuminance, direction and spectral composition throughout the day and season. Daylight openings in a vertical, inclined or horizontal surface are strongly favoured in work places for the light they deliver, and for the visual contact they provide with the outside environment. Additionally, daylight provides variable modelling and luminance patterns, which is also perceived as being beneficial for people in indoor working environments. For any space with daylight openings, it is recommended to provide shading devices to reduce risk of glare or thermal discomfort. Direct view of the sun or to a reflection of the sun should be avoided.

For a more comprehensive method EN 17037 defines metrics, gives principles of calculation and verification, with respect to using daylight to provide lighting within interiors.

## 6.6 Variability of light

Light is important to people's health and well-being. Light affects the mood, emotion and mental alertness of people. It can also support and adjust the circadian rhythms and influence people's physiological and psychological state. Varying illuminances in time and season (with values higher or temporarily lower than specified in this document) and varying in colour temperature or spectrum can enhance people's well-being. Up to date research indicates that these phenomena, in addition to the lighting design criteria defined in this document, can be provided by the so-called "non-image forming" illuminances and colour appearance of light, as described in CEN/TR 16791 and in CIE S 026. The non-image-forming effects will depend on quantity and time of light exposure, spectral power distribution, duration of exposure, and individual parameters like circadian phase, light history, and others. These objectives can be achieved with daylight and electric lighting solutions.

More information about non-image forming aspects can be found in Annex B.

When varying lighting (e.g. using personal control) it is possible that lighting requirements (as stated in the tables in 7.3) are no longer met. However, the values listed in the tables in 7.3 shall remain achievable.

NOTE Variability of light is important in spaces that are occupied for extended periods. Examples are classrooms, healthcare, offices and productions spaces.

## 6.7 Room brightness

An indication of perceived room brightness in spaces where visual tasks or activities are carried out is obtained by a combination of reflectances and illuminances on walls and the ceiling.

Additional indications of perceived room brightness are explained in Annex B.

# 7 Schedule of specific lighting requirements

## 7.1 Composition of the tables

For the application of the tables in 7.3, see Clause 6.

**Column 1** lists the **reference** number for each task area or activity area.

**Column 2** lists those **tasks areas or activities areas**, for which specific requirements are given. If the particular task or activity is not listed, the values given for a similar, comparable situation should be adopted. Task areas or activity areas can also be a room, e.g. a corridor or resting room.

**Column 3** gives the required **maintained illuminance**  $\bar{E}_m$  on the reference surface (see 5.3) for the interior (area) in which the task or activity from Column 2 is performed.

**Column 4** gives the modified **maintained illuminance**  $\bar{E}_m$  considering common context modifiers when the visual conditions differ from the normal assumptions (see 5.3.3) on the reference surface (see 5.3) for the interior (area) in which the task or activity from Column 2 is performed.

NOTE Lighting control can be required to achieve adequate flexibility for the variety of tasks performed.

**Column 5** gives the **minimum illuminance uniformity**  $U_0$  on the reference surface for the maintained illuminance  $\bar{E}_m$  chosen according to Clause 7.

**Column 6** gives the **minimum colour rendering indices** ( $R_a$ ) (see 5.7.3) for the situation listed in Column 2.

**Column 7** gives the **UGR limits** (Unified Glare Rating limit,  $R_{UGL}$ ) that are applicable to the situation listed in Column 2 (see 5.5.3.2).

**Column 8** gives the **maintained cylindrical illuminance**  $\bar{E}_{m,z}$  for the recognition of objects and people as described in 5.6.2.

**Column 9** gives the **maintained illuminance on walls**  $\bar{E}_{m,wall}$  as described in 5.2.3.

**Column 10** gives the **maintained illuminance on ceilings**  $\bar{E}_{m,ceiling}$  as described in 5.2.3.

**Column 11** gives **specific requirements** for the situations listed in Column 2.

## 7.2 Schedule of task and activity areas

Table 9 — Traffic zones inside buildings

Table 10 — General areas inside buildings – Rest, sanitation and first aid rooms

Table 11 — General areas inside buildings – Control rooms

Table 12 — General areas inside buildings – Store rooms, cold stores

Table 13 — Logistics and warehouses

Table 14 — Industrial activities and crafts – Agriculture

Table 15 — Industrial activities and crafts – Bakeries

Table 16 — Industrial activities and crafts – Cement, cement goods, concrete, bricks

Table 17 — Industrial activities and crafts – Ceramics, tiles, glass, glassware

Table 18 — Industrial activities and crafts – Chemical, plastics and rubber industry

Table 19 — Industrial activities and crafts – Electrical and electronic industry

Table 20 — Industrial activities and crafts – Food stuffs and luxury food industry

Table 21 — Industrial activities and crafts – Foundries and metal casting

Table 22 — Industrial activities and crafts – Hairdressers

Table 23 — Industrial activities and crafts – Jewellery manufacturing

Table 24 — Industrial activities and crafts – Laundries and dry cleaning

Table 25 — Industrial activities and crafts – Leather and leather goods

Table 26 — Industrial activities and crafts – Metal working and processing

Table 27 — Industrial activities and crafts – Paper and paper goods

Table 28 — Industrial activities and crafts – Power stations

Table 29 — Industrial activities and crafts – Printers

Table 30 — Industrial activities and crafts – Rolling mills, iron and steel works

Table 31 — Industrial activities and crafts – Textile manufacture and processing

Table 32 — Industrial activities and crafts – Vehicle construction and repair

Table 33 — Industrial activities and crafts – Wood working and processing

Table 34 — Offices

Table 35 — Retail premises

Table 36 — Places of public assembly – General areas

Table 37 — Places of public assembly – Restaurants and hotels

Table 38 — Places of public assembly – Theatres, concert halls, cinemas, places for entertainment

Table 39 — Places of public assembly – Trade fairs, exhibition halls

Table 40 — Places of public assembly – Museums

Table 41 — Places of public assembly – Libraries

Table 42 — Places of public assembly – Car parks (indoor)

Table 43 — Educational premises – Nursery school, play school

Table 44 — Educational premises – Educational buildings

Table 45 — Health care premises – Rooms for general use

Table 46 — Health care premises – Staff rooms

Table 47 — Health care premises – Wards, maternity wards

Table 48 — Health care premises – Examination rooms (general)

Table 49 — Health care premises – Eye Examination rooms

Table 50 — Health care premises – Ear Examination rooms

Table 51 — Health care premises – Scanner rooms

Table 52 — Health care premises – Delivery rooms

Table 53 — Health care premises – Treatment rooms (general)

Table 54 — Health care premises – Operating areas

Table 55 — Health care premises – Intensive care unit

Table 56 — Health care premises – Dentists

Table 57 — Health care premises – Laboratories and pharmacies

Table 58 — Health care premises – Decontamination rooms

Table 59 — Health care premises – Autopsy rooms and mortuaries

Table 60 — Transportation areas – Airports

Table 61 — Transportation areas – Railway installations

### 7.3 Lighting requirements for task areas, activity areas, room and space brightness

The requirements for task areas and activity areas are given in Table 8 to Table 61. The columns are understood as shown in Table 8.

The requirements for the specific tasks and activities are given by  $\bar{E}_m$ ,  $U_o$ ,  $R_a$  and  $R_{UGL}$ . The requirements for the space in which the task(s) or activities are carried out are given by  $\bar{E}_{m,z}$  for the perception of objects and people within this space and  $\bar{E}_{m,wall}$  and  $\bar{E}_{m,ceiling}$  for room brightness. The latter are used for designing the room and the space including  $R_{UGL}$ . Glare (by  $R_{UGL}$ ) is dedicated to the space in which a task is carried out. The first four columns are used for of task area of activity area design and more than one of these areas can occur within onespace. This applies to column 3 to column 10 in all tables in 7.3.

**Table 8 — Assignment of columns to requirements**

| Task area or activity area design     |                       | Room or space design requirements                           |  |                             |
|---------------------------------------|-----------------------|---|--|-----------------------------|
| Task or activity related requirements |                       | For visual communication and recognition of objects (5.6.2) | Brightness appearance of rooms (5.2.2/5.2.3) |                             |
| $\bar{E}_m$<br>lx                     | $U_o$                 | $\bar{E}_{m,z}$<br>lx                                       | $\bar{E}_{m,wall}$<br>lx                     | $\bar{E}_{m,ceiling}$<br>lx |
| required <sup>a</sup>                 | modified <sup>b</sup> | $R_{UGL}$   | $U_o \geq 0,10$                              |                             |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 9 — Traffic zones inside buildings

| Ref. no. | Type of task/activity area      | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements   |
|----------|---------------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---|
|          |                                 | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |   |
| 9.1      | Corridors and circulation areas | 100                   | 150                   | 0,40  | 40    | 28        | 50                 | 50                       | 30                       | Illuminance at floor level.<br>$R_a$ and $R_{UGL}$ similar to adjacent areas.<br>150 lx if there are vehicles on the route.<br>The lighting of exits and entrances shall provide a transition zone to avoid sudden changes in illuminance between inside and outside by day or night.<br>Care should be taken to avoid glare to drivers and pedestrians |
| 9.2      | Stairs, escalators, travelators | 100                   | 150                   | 0,40  | 40    | 25        | 50                 | 50                       | 30                       | Illuminance at floor level.<br>Requires enhanced contrast on leading edge of the steps.   |
| 9.3      | Elevators, lifts                | 100                   | 150                   | 0,40  | 40    | 25        | 50                 | 50                       | 30                       | Illuminance at floor level. Light in front of elevator, see Ref.no. 8.4.  |

| Ref. no. | Type of task/activity area                       | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}'_{mY}$ all | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|---------------------|--------------------------|--|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                     |                          |  |
| 9.4      | Area in front of lifts, elevators and escalators | 200                   | 300                   | 0,40  | 40    | 25        | 75                 | 75                  | 50                       | Area up to 1 m in front of lift, elevators and escalators. Illuminance at floor level.         |
| 9.5      | Loading ramps/bays                               | 150                   | 200                   | 0,40  | 40    | 25        | 50                 | 50                  | -                        |  |
| 9.6      | Building entrance with canopy                    | 30                    | 50                    | 0,40  | -     | -         | -                  | -                   | -                        |  |
| 9.7      | Gangways: manned                                 | 150                   | 200                   | 0,40  | 60    | 25        | -                  | 50                  | 30                       | Illuminance at floor level.<br>For storage rack face – see Table 13 – Logistics and warehouses |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

STANDARDSISO.COM: Click to view the full PDF of BS EN 12464 -1 (WG):2021

Table 10 — General areas inside buildings – Rest, sanitation and first aid rooms

| Ref. no. | Type of task/activity area   | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 10.1     | Canteens and break areas   | 200                   | 500                   | 0,40  | 80    | 22        | 75                 | 75                       | 50                       |  |
| 10.2     | Resting rooms  | 100                   | 200                   | 0,40  | 80    | 22        | 50                 | 50                       | 30                       |  |
| 10.3     | Rooms for physical exercise  | 300                   | 500                   | 0,40  | 80    | 22        | 100                | 100                      | 75                       |  |
| 10.4     | Cloakroom (area), washrooms, bathrooms, dressing, lockers, shower-, sink- and toilet areas | 200                   | 300                   | 0,40  | 80    | 25        | 75                 | 75                       | 50                       | In each individual toilet if these are fully enclosed.         |
| 10.5     | Facial lighting in front of mirrors  | 200                   | 300                   | 0,40  | 80    | -         | -                  | -                        | -                        | Vertical illuminance, 0,5 m in front of mirror at head height. |
| 10.6     | Sick bay   | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 100                      |  |
| 10.7     | Rooms for medical attention  | 500                   | 1 000                 | 0,60  | 90    | 19        | 150                | 150                      | 100                      | 4 000 K $\leq T_{cb} \leq$ 5 000 K                             |
| 10.8     | General cleaning   | 100                   | 150                   | 0,40  | -     | -         | 50                 | 50                       | 30                       | Applicable where regular cleaning is necessary.                |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 11 — General areas inside buildings – Control rooms

| Ref. no. | Type of task/activity area     | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|--------------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |                                | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 11.1     | Plant rooms, switch gear rooms | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       |  |
| 11.2     | Post sorting, switchboard      | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 100                      |  |
| 11.3     | Surveillance station           | 300                   | 500                   | 0,60  | 80    | 19        | 100                | 100                      | 75                       | 1. Control panels are often vertical<br>2. Lighting should be dimmable, see 6.2.4<br>3. DSE-work, see 5.9. |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 12 — General areas inside buildings – Store rooms, cold stores

| Ref. no. | Type of task/activity area      | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements   |
|----------|---------------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---|
|          |                                 | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |   |
| 12.1     | Store and stockrooms            | 100                   | 150                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       | 200 lx if continuously occupied.                              |
| 12.2     | Dispatch packing handling areas | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 50                       | 30                       |   |
| 12.3     | Larder                          | 200                   | 300                   | 0,40  | 80    | 25        | -                  | -                        | -                        | Sufficient vertical illuminances shall be applied to shelving |

For Logistics and warehouses – see Table 13 — Logistics and warehouses.

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

STANDARDS100.COM: Click to view the full PDF of BS EN 12464 -1 (WG):2021

Table 13 — Logistics and warehouses

| Ref. no. | Type of task/activity area                 | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,w}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 13.1     | Unloading / loading area                   | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       |  |
| 13.2     | Packing / grouping area                    | 300                   | 500                   | 0,50  | 80    | 25        | 100                | 100                      | 30                       |  |
| 13.3     | Configuration and rehandling               | 750                   | 1000                  | 0,60  | 80    | 22        | 150                | 150                      | 30                       |  |
| 13.4     | Open goods storage                         | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       |  |
| 13.5     | Rack storage - floor                       | 150                   | 200                   | 0,50  | 80    | 25        | -                  | -                        | 30                       | Illuminance at floor level,<br>$R_{UGL}$ only in the viewing direction of the luminaire. |
| 13.6     | Rack storage - rack face                   | 75                    | 100                   | 0,40  | 80    | -         | -                  | -                        | -                        | On aisle rack face.<br>Band of 1,0 m may be excluded from the perimeter (see 5.4).       |
| 13.7     | Central logistics corridor (heavy traffic) | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 100                      | 30                       |  |
| 13.8     | Automated zones (unmanned)                 | 75                    | 100                   | 0,40  | 80    | 25        |                    |                          |                          |  |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 14 — Industrial activities and crafts – Agriculture

| Ref. no. | Type of task/activity area                                       | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|-----------------------|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                       |
| 14.1     | Loading and operating of goods, handling equipment and machinery | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | -                        | $U_o \geq 0,10$       |
| 14.2     | Buildings for livestock  | 50                    | 75                    | 0,40  | 40    | -         | -                  | -                        | -                        |                       |
| 14.3     | Sick animal pens; calving stalls                                 | 200                   | -                     | 0,60  | 80    | 25        | 50                 | 50                       | -                        |                       |
| 14.4     | Feed preparation; dairy; utensil washing                         | 200                   | -                     | 0,60  | 80    | 25        | 50                 | 50                       | -                        |                       |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 15 — Industrial activities and crafts – Bakeries

| Ref. no. | Type of task/activity area     | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|--------------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|-----------------------|
|          |                                | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                       |
| 15.1     | Preparation and baking         | 300                   | 500                   | 0,60  | 80    | 22        | 100                | 100                      | 50                       |                       |
| 15.2     | Finishing, glazing, decorating | 500                   | 750                   | 0,70  | 80    | 22        | 150                | 150                      | 75                       |                       |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 16 — Industrial activities and crafts – Cement, cement goods, concrete, bricks

| Ref. no. | Type of task/activity area                         | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                 |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---------------------------------------|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                                       |
| 16.1     | Drying   | 50                    | -                     | 0,40  | 20    | 28        | -                  | -                        | -                        | Safety colours shall be identifiable. |
| 16.2     | Preparation of materials; work on kilns and mixers | 200                   | 300                   | 0,40  | 40    | 28        | 50                 | 50                       | -                        |                                       |
| 16.3     | General machine work                               | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 100                      | -                        |                                       |
| 16.4     | Rough forms  | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 100                      | -                        |                                       |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 17 — Industrial activities and crafts – Ceramics, tiles, glass, glassware

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,w}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                  |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 17.1     | Drying  | 50                    | -                     | 0,40  | 20    | 28        | -                  | -                        | -                        | Safety colours shall be identifiable.  |
| 17.2     | Preparation, general machine work   | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 100                      | -                        |  |
| 17.3     | Enamelling, rolling, pressing, shaping simple parts, glazing, glass blowing                     | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 100                      | -                        |  |
| 17.4     | Grinding, engraving, glass polishing, shaping precision parts, manufacture of glass instruments | 750                   | 1 000                 | 0,70  | 80    | 19        | 150                | 150                      | 100                      |  |
| 17.5     | Grinding of optical glass, crystal, hand grinding and engraving                                 | 750                   | 1 000                 | 0,70  | 80    | 16        | 150                | 150                      | 100                      |  |
| 17.6     | Precision work, e.g. decorative grinding, hand painting   | 1 000                 | 1 500                 | 0,70  | 90    | 16        | 150                | 150                      | 100                      | $4\ 000\ K \leq T_{cd} \leq 6\ 500\ K$ |
| 17.7     | Manufacture of synthetic precious stones  | 1 500                 | 2 000                 | 0,70  | 90    | 16        | 150                | 150                      | 100                      | $4\ 000\ K \leq T_{cd} \leq 6\ 500\ K$ |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 18 — Industrial activities and crafts – Chemical, plastics and rubber industry

| Ref. no. | Type of task/activity area                                  | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}$ all lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                  |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|------------------------|--------------------------|--|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                        |                          |  |
| 18.1     | Remote-operated processing installations                    | 50                    | -                     | 0,40  | 20    | -         | -                  | -                      | -                        | Safety colours shall be identifiable.  |
| 18.2     | Processing installations with limited manual intervention   | 150                   | 200                   | 0,40  | 40    | 28        | 50                 | 50                     | 30                       |  |
| 18.3     | Constantly manned work stations in processing installations | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 100                    | 50                       |  |
| 18.4     | Precision measuring rooms, laboratories                     | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                    | 75                       |  |
| 18.5     | Pharmaceutical production                                   | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                    | 75                       |  |
| 18.6     | Tyre production   | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                    | 75                       |  |
| 18.7     | Colour inspection   | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                | 150                    | 100                      | $4\ 000\ K \leq T_{cb} \leq 6\ 500\ K$ |
| 18.8     | Cutting, finishing, inspection                              | 750                   | 1 000                 | 0,70  | 80    | 19        | 150                | 150                    | 100                      |  |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 19 — Industrial activities and crafts – Electrical and electronic industry

| Ref. no. | Type of task/activity area                                    | $\bar{E}_m$<br>lx     |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$<br>lx | $\bar{E}_{m,wall}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|-----------------------|-----------------------|--------------------------|-----------------------|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                       |                       |                          |                       |
| 19.1     | Cable and wire manufacture                                    | 300                   | 500                   | 0,60  | 80    | 25        | 100                   | 100                   | 50                       |                       |
| 19.2     | Winding:  |                       |                       |       |       |           |                       |                       |                          |                       |
| 19.2.1   | - large coils   | 300                   | 500                   | 0,60  | 80    | 25        | 100                   | 100                   | 50                       |                       |
| 19.2.2   | - medium-sized coils  | 500                   | 750                   | 0,60  | 80    | 22        | 150                   | 150                   | 75                       |                       |
| 19.2.3   | - small coils   | 750                   | 1000                  | 0,70  | 80    | 19        | 150                   | 150                   | 100                      |                       |
| 19.3     | Coil impregnating   | 300                   | 500                   | 0,60  | 80    | 25        | 100                   | 100                   | 50                       |                       |
| 19.4     | Galvanising   | 300                   | 500                   | 0,60  | 80    | 25        | 100                   | 100                   | 50                       |                       |
| 19.5.    | Assembly work:  |                       |                       |       |       |           |                       |                       |                          |                       |
| 19.5.1   | - rough, e.g. large transformers                              | 300                   | 500                   | 0,60  | 80    | 25        | 100                   | 100                   | 50                       |                       |
| 19.5.2   | - medium, e.g. switchboards                                   | 500                   | 750                   | 0,60  | 80    | 22        | 150                   | 150                   | 100                      |                       |
| 19.5.3   | - fine, e.g. telephones, radios, IT equipment (computers)     | 750                   | 1 000                 | 0,70  | 80    | 19        | 150                   | 150                   | 100                      |                       |
| 19.5.4   | - precision, e.g. measuring equipment, printed circuit boards | 1 000                 | 1 500                 | 0,70  | 80    | 16        | 150                   | 150                   | 100                      |                       |
| 19.6     | Electronic workshops, testing, adjusting                      | 1 500                 | 2 000                 | 0,70  | 80    | 16        | 150                   | 150                   | 100                      |                       |

<sup>a</sup> required: minimum value

| Ref. no.  | Type of task/activity area | $\bar{E}_m$<br>lx     |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$<br>lx | $\bar{E}_{m,wall}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|---|----------------------------|-----------------------|-----------------------|-------|-------|-----------|-----------------------|-----------------------|--------------------------|-----------------------|
|   |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                       |                       |                          |                       |
| <sup>b</sup> modified: considers common context modifiers in 5.3.3<br>$U_o \geq 0,10$ |                            |                       |                       |       |       |           |                       |                       |                          |                       |

Table 20 — Industrial activities and crafts – Food stuffs and luxury food industry

| Ref. no. | Type of task/activity area  | $\bar{E}_m$<br>lx     |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$<br>lx | $\bar{E}_{m,wall}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|-----------------------|-----------------------------|--------------------------|-----------------------|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                       |                             |                          |                       |
| 20.1     | Work stations and zones in:<br>- breweries, malting floor,<br>- for washing, barrel filling, cleaning, sieving, peeling,<br>- cooking in preserve and chocolate factories,<br>- work stations and zones in sugar factories,<br>- for drying and fermenting raw tobacco, fermentation cellar | 200                   | 300                   | 0,40  | 80    | 25        | 50                    | 50                          | 30                       |                       |
| 20.2     | Sorting and washing of products, milling, mixing, packing   | 300                   | 500                   | 0,60  | 80    | 25        | 100                   | 100                         | 50                       |                       |

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                  |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 20.3     | Work stations and critical zones in slaughter houses, butchers, dairies mills, on filtering floor in sugar refineries | 500                   | 750                   | 0,60  | 80    | 25        | 150                | 150                      | 75                       | $U_0 \geq 0,10$                        |
| 20.4     | Cutting and sorting of fruit and vegetables   | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 100                      | 50                       |  |
| 20.5     | Manufacture of delicatessen foods, kitchen work, manufacture of cigars and cigarettes                                 | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                      | 75                       |  |
| 20.6     | Inspection of glasses and bottles, product control, trimming, sorting, decoration                                     | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                      | 100                      |  |
| 20.7     | Laboratories  | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 100                      |  |
| 20.8     | Colour inspection   | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                | 150                      | 100                      | $4\ 000\ K \leq T_{cp} \leq 6\ 500\ K$ |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 21 — Industrial activities and crafts – Foundries and metal casting

| Ref. no. | Type of task/activity area                 | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                 |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---------------------------------------|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                                       |
| 21.1     | Man-size underfloor tunnels, cellars, etc. | 50                    | -                     | 0,40  | 20    | -         | -                  | -                        | -                        | Safety colours shall be identifiable. |
| 21.2     | Platforms                                  | 100                   | -                     | 0,40  | 40    | 25        | 50                 | 50                       | 30                       |                                       |
| 21.3     | Sand preparation                           | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       |                                       |
| 21.4     | Dressing                                   | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       |                                       |
| 21.5     | Work stations at cupola and mixer          | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       |                                       |
| 21.6     | Casting bay                                | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       |                                       |
| 21.7     | Shake out areas                            | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       |                                       |
| 21.8     | Machine moulding                           | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       |                                       |
| 21.9     | Hand and core moulding                     | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 100                      | 50                       |                                       |
| 21.10    | Die casting                                | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 100                      | 50                       |                                       |
| 21.11    | Model building                             | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                      | 75                       |                                       |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 22 — Industrial activities and crafts – Hairdressers

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|-----------------------|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                       |
| 22.1     | Hairdressing               | 500                   | 750                   | 0,60  | 90    | 19        | 150                | 150                      | 100                      | $U_o \geq 0,10$       |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 23 — Industrial activities and crafts – Jewellery manufacturing

| Ref. no. | Type of task/activity area   | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                  |
|----------|------------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |                              | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 23.1     | Working with precious stones | 1 500                 | 2 000                 | 0,70  | 90    | 16        | 150                | 150                      | 100                      | $4\ 000\ K \leq T_{cp} \leq 6\ 500\ K$ |
| 23.2     | Manufacture of jewellery     | 1 000                 | 1 500                 | 0,70  | 90    | 16        | 150                | 150                      | 100                      |  |
| 23.3     | Watch making (manual)        | 1 500                 | 2 000                 | 0,70  | 80    | 16        | 150                | 150                      | 100                      |  |
| 23.4     | Watch making (automatic)     | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 100                      |  |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 24 — Industrial activities and crafts – Laundries and dry cleaning

| Ref. no. | Type of task/activity area    | $\bar{E}_m$<br>lx     |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$<br>lx | $\bar{E}_{m,ceiling}$<br>lx | $\bar{E}_{m,all}$<br>lx | Specific requirements |
|----------|-------------------------------|-----------------------|-----------------------|-------|-------|-----------|-----------------------|-----------------------------|-------------------------|-----------------------|
|          |                               | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                       |                             |                         |                       |
| 24.1     | Goods in, marking and sorting | 300                   | 500                   | 0,60  | 80    | 25        | 100                   | 50                          | 100                     | $U_o \geq 0,10$       |
| 24.2     | Washing and dry cleaning      | 300                   | 500                   | 0,60  | 80    | 25        | 100                   | 50                          | 100                     |                       |
| 24.3     | Ironing, pressing             | 300                   | 500                   | 0,60  | 80    | 25        | 100                   | 50                          | 100                     |                       |
| 24.4     | Inspection and repairs        | 750                   | 1 000                 | 0,70  | 80    | 19        | 150                   | 100                         | 150                     |                       |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 25 — Industrial activities and crafts – Leather and leather goods

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements        |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|------------------------------|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                              |
| 25.1     | Work on vats, barrels, pits   | 200                   | 300                   | 0,40  | 80    | 25        | 75                 | 75                       | 30                       |                              |
| 25.2     | Fleshing, skiving, rubbing, tumbling of skins   | 300                   | 500                   | 0,40  | 80    | 25        | 100                | 100                      | 50                       |                              |
| 25.3     | Saddlery work, shoe manufacture: stitching, sewing, polishing, shaping, cutting, punching | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                      | 100                      |                              |
| 25.4     | Sorting   | 500                   | 750                   | 0,60  | 90    | 22        | 150                | 150                      | 100                      | 4 000 K ≤ $T_{cd}$ ≤ 6 500 K |
| 25.5     | Leather dyeing (machine)  | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                      | 100                      |                              |
| 25.6     | Quality control   | 1 000                 | 1 500                 | 0,70  | 80    | 19        | 150                | 150                      | 100                      |                              |
| 25.7     | Colour inspection   | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                | 150                      | 100                      | 4 000 K ≤ $T_{cd}$ ≤ 6 500 K |
| 25.8     | Shoe making   | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                      | 100                      |                              |
| 25.9     | Glove making  | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                      | 100                      |                              |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 26 — Industrial activities and crafts – Metal working and processing

| Ref. no. | Type of task/activity area                            | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------|--------------------------|-----------------------|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                    |                          |                       |
| 26.1     | Open die forging                                      | 200                   | 300                   | 0,60  | 80    | 25        | 50                 | 50                 | 30                       |                       |
| 26.2     | Drop forging  | 300                   | 500                   | 0,60  | 80    | 25        | 75                 | 75                 | 30                       |                       |
| 26.3     | Welding   | 300                   | 500                   | 0,60  | 80    | 25        | 75                 | 75                 | 30                       |                       |
| 26.4     | Rough and average machining: tolerances $\geq 0,1$ mm | 300                   | 500                   | 0,60  | 80    | 22        | 75                 | 75                 | 30                       |                       |
| 26.5     | Precision machining; grinding: tolerances $< 0,1$ mm  | 500                   | 750                   | 0,70  | 80    | 19        | 150                | 150                | 75                       |                       |
| 26.6     | Scribing; inspection                                  | 750                   | 1000                  | 0,70  | 80    | 19        | 150                | 150                | 100                      |                       |
| 26.7     | Wire and pipe drawing shops; cold forming             | 300                   | 500                   | 0,60  | 80    | 25        | 75                 | 75                 | 30                       |                       |
| 26.8     | Plate machining: thickness $\geq 5$ mm                | 200                   | 300                   | 0,60  | 80    | 25        | 50                 | 50                 | 30                       |                       |
| 26.9     | Sheet metalwork: thickness $< 5$ mm                   | 300                   | 500                   | 0,60  | 80    | 22        | 75                 | 75                 | 30                       |                       |
| 26.10    | Tool making; cutting equipment manufacture            | 750                   | 1 000                 | 0,70  | 80    | 19        | 150                | 150                | 75                       |                       |
| 26.11    | Assembly:   |                       |                       |       |       |           |                    |                    |                          |                       |
| 26.11.1  | - rough   | 200                   | 300                   | 0,60  | 60    | 25        | 50                 | 50                 | 30                       |                       |
| 26.11.2  | - medium  | 300                   | 500                   | 0,60  | 80    | 25        | 75                 | 75                 | 30                       |                       |
| 26.11.3  | - fine  | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                | 75                       |                       |

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}$ all lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|------------------------|--------------------------|-----------------------|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                        |                          |                       |
| 26.11.4  | - precision   | 750                   | 1 000                 | 0,70  | 80    | 19        | 150                | 150                    | 100                      | $U_o \geq 0,10$       |
| 26.12    | Galvanizing   | 300                   | 500                   | 0,60  | 80    | 25        | 75                 | 75                     | 30                       |                       |
| 26.13    | Surface preparation and painting                                    | 750                   | 1 000                 | 0,70  | 80    | 25        | 150                | 150                    | 100                      |                       |
| 26.14    | Tool, template and jig making, precision mechanics, micro-mechanics | 1 000                 | 1 500                 | 0,70  | 80    | 19        | 150                | 150                    | 100                      |                       |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

STANDARDSISO.COM: Click to view the full PDF of BS EN 12464 -1 (WG):2021

No reproduction or distribution for WG on Lighting.

Table 27 — Industrial activities and crafts – Paper and paper goods

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,w}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|-----------------------|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                       |
| 27.1     | Edge runners, pulp mills  | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       | $U_o \geq 0,10$       |
| 27.2     | Paper manufacture and processing, paper and corrugating machines, cardboard manufacture | 300                   | 500                   | 0,60  | 80    | 25        | 75                 | 75                       | 50                       |                       |
| 27.3     | Standard bookbinding work, e.g. folding, sorting, gluing, cutting, embossing, sewing    | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                      | 100                      |                       |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 28 — Industrial activities and crafts – Power stations

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,wall}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements   |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|-----------------------|--------------------------|---|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                       |                          |   |
| 28.1     | Fuel supply plant   | 50                    | -                     | 0,40  | 20    | -         | -                  | -                     | -                        | Safety colours shall be identifiable.   |
| 28.2     | Boiler house  | 100                   | 150                   | 0,40  | 40    | 28        | 50                 | 50                    | 30                       |   |
| 28.3     | Machine halls   | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                    | 30                       |   |
| 28.4     | Side rooms, e.g. pump rooms, condenser rooms, etc.; switchboards (inside buildings) | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                    | 30                       |   |
| 28.5     | Control rooms   | 500                   | 1 000                 | 0,70  | 80    | 19        | 150                | 150                   | 100                      | 1. Control panels are often vertical.<br>2. Dimming might be required.<br>3. DSE-work, see 5.9. |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 29 — Industrial activities and crafts – Printers

| Ref. no. | Type of task/activity area   | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements              |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|------------------------------------|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                                    |
| 29.1     | Cutting, gilding, embossing, block engraving, work on stones and platens, printing machines, matrix making | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 75                       |                                    |
| 29.2     | Paper sorting and hand printing  | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 75                       |                                    |
| 29.3     | Type setting, retouching, lithography  | 1 000                 | 1 500                 | 0,70  | 80    | 19        | 150                | 150                      | 100                      |                                    |
| 29.4     | Colour inspection in multicoloured printing  | 1 500                 | 2 000                 | 0,70  | 90    | 16        | 150                | 150                      | 100                      | 4 000 K $\leq T_{cd} \leq$ 6 500 K |
| 29.5     | Steel and copper engraving   | 2 000                 | 3 000                 | 0,70  | 80    | 16        | 150                | 150                      | 100                      | For directionality, see 5.6.4.     |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 30 — Industrial activities and crafts – Rolling mills, iron and steel works

| Ref. no. | Type of task/activity area                                 | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                 |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---------------------------------------|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                                       |
| 30.1     | Production plants without manual operation                 | 50                    | -                     | 0,40  | 20    | -         | -                  | -                        | -                        | Safety colours shall be identifiable. |
| 30.2     | Production plants with occasional manual operation         | 150                   | 200                   | 0,40  | 40    | 28        | 50                 | 50                       | 30                       |                                       |
| 30.3     | Production plants with continuous manual operation         | 200                   | 300                   | 0,60  | 80    | 25        | 50                 | 50                       | 30                       |                                       |
| 30.4     | Slab Store   | 50                    | -                     | 0,40  | 20    | -         | -                  | -                        | -                        | Safety colours shall be identifiable. |
| 30.5     | Furnaces   | 200                   | 300                   | 0,40  | 20    | 25        | 50                 | 50                       | 30                       | Safety colours shall be identifiable. |
| 30.6     | Mill train; coiler; shear line                             | 300                   | 500                   | 0,60  | 40    | 25        | 75                 | 75                       | 30                       |                                       |
| 30.7     | Control platforms; control panels                          | 300                   | 500                   | 0,60  | 80    | 22        | 75                 | 75                       | 30                       |                                       |
| 30.8     | Test, measurement and inspection                           | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                      | 100                      |                                       |
| 30.9     | Underfloor man-sized tunnels; belt sections, cellars, etc. | 50                    | -                     | 0,40  | 20    | -         | -                  | -                        | -                        | Safety colours shall be identifiable. |

<sup>a</sup> required: minimum value

| Ref. no.  | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|---|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|-----------------------|
|   |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           | $U_o \geq 0,10$    |                          |                          |                       |
| b modified: considers common context modifiers in 5.3.3 |                            |                       |                       |       |       |           |                    |                          |                          |                       |

Table 31 — Industrial activities and crafts – Textile manufacture and processing

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,wall}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                  |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|-----------------------|--------------------------|--|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           | $U_o \geq 0,10$    |                       |                          |  |
| 31.1     | Work stations and zones in baths, bale opening  | 200                   | 300                   | 0,60  | 60    | 25        | 50                 | 50                    | 30                       |  |
| 31.2     | Carding, washing, ironing, devilling machine work, drawing, combing, sizing, card cutting, pre-spinning, jute and hemp spinning | 300                   | 500                   | 0,60  | 40    | 22        | 100                | 100                   | 50                       |  |
| 31.3     | Spinning, plying, reeling, winding  | 500                   | 750                   | 0,60  | 40    | 22        | 150                | 150                   | 75                       | Prevent stroboscopic effects.          |
| 31.4     | Warping, weaving, braiding, knitting  | 500                   | 750                   | 0,60  | 60    | 22        | 150                | 150                   | 75                       | Prevent stroboscopic effects.          |
| 31.5     | Sewing, fine knitting, taking up stitches   | 750                   | 1 500                 | 0,70  | 80    | 22        | 150                | 150                   | 100                      |  |
| 31.6     | Manual design, drawing patterns   | 750                   | 1 500                 | 0,70  | 90    | 22        | 150                | 150                   | 100                      | $4\ 000\ K \leq T_{cp} \leq 6\ 500\ K$ |
| 31.7     | Finishing, dyeing   | 500                   | 1 000                 | 0,60  | 80    | 22        | 150                | 150                   | 100                      |  |
| 31.8     | Drying room   | 100                   | -                     | 0,40  | 60    | 28        | 50                 | 50                    | 30                       |  |
| 31.9     | Automatic fabric printing   | 500                   | -                     | 0,60  | 90    | 25        | 100                | 100                   | 50                       |  |
| 31.10    | Burling, picking, trimming  | 1 000                 | 1 500                 | 0,70  | 80    | 19        | 150                | 150                   | 100                      |  |
| 31.11    | Colour inspection; fabric control   | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                | 150                   | 100                      | $4\ 000\ K \leq T_{cp} \leq 6\ 500\ K$ |

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,wall}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements        |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|-----------------------|--------------------------|------------------------------|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                       |                          |                              |
| 31.12    | Invisible mending          | 1 500                 | 2 000                 | 0,70  | 90    | 19        | 150                | 150                   | 100                      | 4 000 K ≤ $T_{cp}$ ≤ 6 500 K |
| 31.13    | Hat manufacturing          | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                   | 75                       |                              |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 32 — Industrial activities and crafts – Vehicle construction and repair

| Ref. no. | Type of task/activity area                    | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}$ lx <sup>all</sup> | $\bar{E}_{m,ceiling}$ lx | Specific requirements        |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|-----------------------------------|--------------------------|------------------------------|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                                   |                          |                              |
| 32.1     | Press shop - large parts                      | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 50                                | 30                       |                              |
| 32.2     | Press shop - visual inspection                | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 50                                | 30                       |                              |
| 32.3     | Body work and assembly - automatic line       | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 50                                | 30                       |                              |
| 32.4     | Body work and assembly - manual welding       | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 50                                | 30                       |                              |
| 32.5     | Painting, spraying chamber, polishing chamber | 750                   | 1 000                 | 0,70  | 80    | 22        | 150                | 150                               | 30                       |                              |
| 32.6     | Painting, inspection, touch-up and polishing  | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                | 150                               | 30                       | 4 000 K ≤ $T_{cp}$ ≤ 6 500 K |
| 32.7     | Upholstery manufacture (manual)               | 1 000                 | 1 500                 | 0,70  | 80    | 19        | 150                | 50                                | 30                       |                              |

| Ref. no. | Type of task/activity area   | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements   |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |   |
| 32.8     | Detailing:<br>- Subparts assembly (doors, dashboard, upholstery)<br>- Underchassis assembly<br>- Motor and mechanical assembly<br>- Final assembly conveyor line | 750                   | 1 000                 | 0,70  | 80    | 22        | 150                | 50                       | 30                       |   |
| 32.9     | Detailing:<br>- work with electronics  | 750                   | 1 000                 | 0,60  | 90    | 22        | 150                | 50                       | 30                       | 4 000 K $\leq T_{cp} \leq$ 6 500 K for recognition of colours |
| 32.10    | Final inspection   | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                | 150                      | 30                       |   |
| 32.11    | General vehicle services, repair and testing   | 500                   | 750                   | 0,60  | 80    | 22        | 100                | 50                       | 30                       | Consider local lighting.                                      |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

**Table 33 — Industrial activities and crafts – Wood working and processing**

| Ref. no. | Type of task/activity area                               | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|-----------------------|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                       |
| 33.1     | Automatic processing, e.g. drying, plywood manufacturing | 50                    | -                     | 0,40  | 40    | 28        | -                  | -                        | -                        |                       |
| 33.2     | Steam pits   | 150                   | 200                   | 0,40  | 40    | 28        | 50                 | 50                       | 30                       |                       |

| Ref. no. | Type of task/activity area   | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                  |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 33.3     | Saw frame  | 300                   | 500                   | 0,60  | 60    | 25        | 100                | 100                      | 50                       | Prevent stroboscopic effects.          |
| 33.4     | Work at joiner's bench, gluing, assembly   | 300                   | 500                   | 0,60  | 80    | 25        | 100                | 100                      | 50                       |  |
| 33.5     | Polishing, painting, fancy joinery   | 750                   | 1 000                 | 0,70  | 80    | 22        | 150                | 150                      | 100                      |  |
| 33.6     | Work on wood working machines, e.g. turning, fluting, dressing, rebating, grooving, cutting, sawing, sinking | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 75                       | Prevent stroboscopic effects.          |
| 33.7     | Selection of veneer woods  | 750                   | 1 000                 | 0,70  | 90    | 22        | 150                | 150                      | 100                      | $4\ 000\ K \leq T_{cp} \leq 6\ 500\ K$ |
| 33.8     | Marquetry, inlay work  | 750                   | 1 000                 | 0,70  | 90    | 22        | 150                | 150                      | 100                      | $4\ 000\ K \leq T_{cp} \leq 6\ 500\ K$ |
| 33.9     | Quality control, inspection  | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                | 150                      | 100                      | $4\ 000\ K \leq T_{cp} \leq 6\ 500\ K$ |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 34 — Offices

| Ref. no. | Type of task/activity area                | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,wall}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|-----------------------|--------------------------|--|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                       |                          |  |
| 34.1     | Filing, copying, etc.                     | 300                   | 500                   | 0,40  | 80    | 19        | 100                | 100                   | 75                       |  |
| 34.2     | Writing, typing, reading, data processing | 500                   | 1 000                 | 0,60  | 80    | 19        | 150                | 150                   | 100                      | DSE-work, see 5.9<br>Room brightness, see 6.7 and Annex B<br>Lighting should be controllable, see 6.2.4.<br>For smaller cellular offices the wall requirement applies to the front wall. For other walls a lower requirement of minimum 75 lx could be accepted. |
| 34.3     | Technical drawing                         | 750                   | 1 500                 | 0,70  | 80    | 16        | 150                | 150                   | 100                      | DSE-work, see 5.9<br>room brightness, see 6.7  |
| 34.4     | CAD work stations                         | 500                   | 1 000                 | 0,60  | 80    | 19        | 150                | 150                   | 100                      | DSE-work, see 5.9.   |
| 34.5.1   | Conference and meeting rooms              | 500                   | 1 000                 | 0,60  | 80    | 19        | 150                | 150                   | 100                      | Lighting should be controllable, see 6.2.4.  |
| 34.5.2   | Conference table                          | 500                   | 1 000                 | 0,60  | 80    | 19        | 150                | 150                   | 100                      | Lighting should be controllable, see 6.2.4.  |
| 34.6     | Reception desk                            | 300                   | 750                   | 0,60  | 80    | 22        | 100                | 100                   | 75                       | If reception desk includes regular work station tasks these should be lit accordingly.   |
| 34.7     | Archiving                                 | 200                   | 300                   | 0,40  | 80    | 25        | 75                 | 75                    | 50                       |  |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 35 — Retail premises

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $R_a$ | $U_o$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,wall}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements   |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|-----------------------|--------------------------|---|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                       |                          |   |
| 35.1     | General sales area         | 300                   | 750                   | 80    | 0,40  | 22        | 75                 | 75                    | 30                       | Ensure sufficient vertical illuminance on shelves.              |
| 35.2     | Till area                  | 500                   | 1 000                 | 80    | 0,60  | 19        | 100                | 75                    | 30                       |   |
| 35.3     | Wrapper table              | 500                   | 1 000                 | 80    | 0,60  | 22        | 100                | -                     | 50                       |   |
| 35.4     | Storage area               | 300                   | 500                   | 80    | 0,40  | 25        | 50                 | -                     | -                        |   |
| 35.5     | Dressing/fitting room      | 300                   | 500                   | 90    | 0,4   | -         | -                  | -                     | -                        | Consider vertical illuminance and modelling in front of mirror. |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 36 — Places of public assembly – General areas

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $R_a$ | $U_o$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,wall}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements        |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|-----------------------------|--------------------------|------------------------------|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                             |                          |                              |
| 36.1     | Entrance halls             | 100                   | 200                   | 80    | 0,40  | 22        | 50                 | 50                          | 30                       | $R_{UGL}$ only if applicable |
| 36.2     | Cloakrooms                 | 200                   | 300                   | 80    | 0,40  | 25        | 75                 | 75                          | 50                       |                              |
| 36.3     | Lounges                    | 200                   | 300                   | 80    | 0,40  | 22        | 75                 | 75                          | 50                       |                              |
| 36.4     | Ticket offices             | 300                   | 500                   | 80    | 0,60  | 22        | 75                 | 75                          | 50                       |                              |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 37 — Places of public assembly – Restaurants and hotels

| Ref. no. | Type of task/activity area             | $\bar{E}_m$<br>lx     |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$<br>lx | $\bar{E}_{m,wall}$<br>lx | $\bar{E}_{m,ceiling}$<br>lx | Specific requirements  |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|-----------------------|--------------------------|-----------------------------|--|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                       |                          |                             |  |
| 37.1     | Reception/cashier desk, porters desk   | 300                   | 500                   | 0,60  | 80    | 22        | 100                   | 100                      | 75                          |  |
| 37.2     | Kitchen                                | 500                   | 1 000                 | 0,60  | 80    | 22        | 100                   | 100                      | 75                          | There should be a transition zone between kitchen and restaurant.            |
| 37.3     | Restaurant, dining room, function room | -                     | -                     | -     | 80    | -         | -                     | -                        | -                           | The lighting should be designed to create the appropriate atmosphere.        |
| 37.4     | Self-service restaurant                | 200                   | 300                   | 0,40  | 80    | 22        | 75                    | 75                       | 50                          |  |
| 37.5     | Buffet                                 | 300                   | 500                   | 0,60  | 80    | 22        | 75                    | 75                       | 50                          |  |
| 37.6     | Conference rooms                       | 500                   | 1 000                 | 0,60  | 80    | 19        | 150                   | 150                      | 100                         | Lighting should be controllable, see 6.2.4.<br>Room brightness, see 6.7      |
| 37.7     | Corridors                              | 100                   | 150                   | 0,40  | 80    | 25        | 50                    | 50                       | 30                          | During night-time lower levels are acceptable.<br>Illuminance on floor level |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 38 — Places of public assembly – Theatres, concert halls, cinemas, places for entertainment

| Ref. no. | Type of task/activity area            | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements   |
|----------|---------------------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---|
|          |                                       | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |   |
| 38.1     | Practice rooms                        | 300                   | 500                   | 0,60  | 80    | 22        | 100                | 100                      | 75                       |   |
| 38.2     | Dressing rooms                        | 300                   | 500                   | 0,60  | 90    | 22        | 100                | 100                      | 75                       | Lighting at mirrors for make-up shall be “glare-free”. Disability glare should be avoided at mirrors for make-up. |
| 38.3     | Seating areas – maintenance, cleaning | 200                   | 500                   | 0,50  | 80    | 22        | 50                 | 50                       | 30                       | Illuminance at floor level.   |
| 38.4     | Stage area rigging                    | 300                   | 500                   | 0,40  | 80    | 25        | 75                 | 75                       | 30                       | Illuminance at floor level.   |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 39 — Places of public assembly – Trade fairs, exhibition halls

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|-----------------------|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                       |
| 39.1     | General lighting           | 300                   | 500                   | 0,40  | 80    | 22        | 50                 | 50                       | 30                       |                       |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 40 — Places of public assembly – Museums

| Ref. no. | Type of task/activity area     | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,all}^{xy}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|--------------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|---------------------------|--------------------------|--|
|          |                                | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                           |                          |  |
| 40.1     | Exhibits, insensitive to light | -                     | -                     | -     | 80    | -         | -                  | -                         | -                        | Lighting is determined by the display requirements.  |
| 40.2     | Exhibits sensitive to light    | -                     | -                     | -     | 80    | -         | -                  | -                         | -                        | 1. Lighting is determined by the display requirements.<br>2. Protection against damaging radiation is paramount. |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

STANDARDS101.COM: Click to view the full PDF of BS EN 12464 -1 (WG):2021

Table 41 — Places of public assembly – Libraries

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 41.1     | Bookshelves                | 200                   | 300                   | 0,40  | 80    | 19        | -                  | -                        | -                        | Vertical illuminance on shelves.<br>For dedicated bookshelf lighting the $R_{UGL}$ value does not apply. |
| 41.2     | Reading area               | 500                   | 750                   | 0,60  | 80    | 19        | 100                | 100                      | 50                       | Pleasant atmosphere should be achieved   |
| 41.3     | Counters                   | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 50                       |  |
| 41.4     | General lighting           | 300                   | 500                   | 0,40  | 80    | 22        | 75                 | 75                       | 50                       |  |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 42 — Places of public assembly – Car parks (indoor)

| Ref. no. | Type of task/activity area               | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 42.1     | Entry/exit ramps (during daylight hours) | 300                   | 500                   | 0,40  | 40    | 25        | 75                 | 75                       | 50                       | 1. Illuminance level to extend 5 m into parking floor<br>2. Illuminances at floor level. |
| 42.2     | Entry/exit ramps (at night)              | 75                    | 100                   | 0,40  | 40    | 25        | 50                 | 50                       | 30                       | 1. Illuminances at floor level.  |

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 42.3     | Traffic lanes, internal ramps and pedestrian paths  | 75                    | 100                   | 0,40  | 40    | 25        | 50                 | 50                       | 30                       | 1. Illuminances at floor level.<br>2. A high vertical illuminance increases recognition of people's faces and therefore the feeling of safety. |
| 42.4     | Parking areas – not open to public  | 75                    | 100                   | 0,25  | 40    | -         | 50                 | 30                       | 15                       | 1. Illuminances at floor level.<br>2. A high vertical illuminance increases recognition of people's faces and therefore the feeling of safety. |
| 42.5     | Parking areas – open to public with a large number of users e.g shopping centers, arenas. | 150                   | 200                   | 0,40  | 40    | -         | 50                 | 50                       | 15                       | 1. Illuminances at floor level.<br>2. A high vertical illuminance increases recognition of people's faces and therefore the feeling of safety. |
| 42.6     | Ticket office   | 300                   | 500                   | 0,60  | 80    | 19        | 75                 | 75                       | 50                       | 1. Reflections in the windows shall be avoided.<br>2. Glare from outside shall be prevented.   |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 43 — Educational premises – Nursery school, play school

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,w}^{all}$ | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|-----------------------|--------------------------|--|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                       |                          |  |
| 43.1     | Play room                  | 300                   | 500                   | 0,40  | 80    | 22        | 100                | 100                   | 75                       | High luminances should be avoided in viewing directions from below by use of diffuse covers. |
| 43.2     | Nursery                    | 300                   | 500                   | 0,40  | 80    | 22        | 100                | 100                   | 75                       | High luminances should be avoided in viewing directions from below by use of diffuse covers. |
| 43.3     | Handicraft room            | 300                   | 500                   | 0,60  | 80    | 19        | 100                | 100                   | 75                       |  |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 44 — Educational premises – Educational buildings

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,w}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 44.1     | Classroom - General activities                                      | 500                   | 1 000                 | 0,60  | 80    | 19        | 150                | 150                      | 100                      | Lighting should be controllable, see 6.2.4, for different activities and scene settings. For classrooms used by young children, an $\bar{E}_m$ required of 300 lx may be used by dimming (see 5.3.3). Ambient light should be considered, see Annex B, room brightness, see 6.7. |
| 44.2     | Auditorium, lecture halls   | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 50                       | Lighting should be controllable, see 6.2.4, to accommodate various A/V needs, room brightness, see 6.7.  |
| 44.3     | Attending lecture in seating areas in auditoriums and lecture halls | 200                   | 300                   | 0,60  | 80    | 19        | 75                 | 75                       | 50                       | Reduction by dimming. DSE-work, see 5.9.   |
| 44.4     | Black, green and white boards                                       | 500                   | 750                   | 0,70  | 80    | 19        | -                  | -                        | -                        | Vertical illuminances. Specular reflections shall be prevented. Presenter/teacher shall be illuminated with suitable vertical illuminance.   |

| Ref. no. | Type of task/activity area                                    | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 44.5     | Black, green and white boards in auditorium and lecture halls | 500                   | 750                   | 0,60  | 80    | 19        | -                  | -                        | -                        | Vertical illuminances. Specular reflections shall be prevented. Presenter/teacher shall be illuminated with suitable vertical illuminance.   |
| 44.6     | Projector and smartboard presentation                         | -                     | -                     | -     | -     | -         | -                  | -                        | -                        | 1. Lighting should be controllable, see 6.2.4.<br>2. Specular reflections shall be prevented.<br>3. 200 lx vertically behind (around) screen.<br>4. Direct lighting on screen when displaying content shall be avoided |
| 44.7     | Display board   | 200                   | 300                   | 0,60  | 80    | 19        | -                  | -                        | -                        | Vertical illuminances  |
| 44.8     | Demonstration table in auditoriums and lecture halls          | 750                   | 1 000                 | 0,70  | 80    | 19        | -                  | -                        | -                        |  |
| 44.9     | Light on teacher / presenter                                  | -                     | -                     | -     | 80    | -         | 150                | -                        | -                        | At 1,6 m above the floor. Suitable vertical illuminance.   |
| 44.10    | Light on podium area  | 300                   | 500                   | 0,70  | 80    | -         | -                  | -                        | -                        | Illuminance should be vertical in direction of audience, Lighting should be controllable, see 6.2.4, to accommodate various A/V needs.   |

| Ref. no. | Type of task/activity area       | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|----------------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |                                  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 44.11    | Computer work only               | 300                   | 500                   | 0,60  | 80    | 19        | 100                | 100                      | 75                       | DSE-work, see 5.9, lighting should be controllable, see 6.2.4, room brightness, see 6.7  |
| 44.12    | Art rooms in art schools         | 750                   | 1 000                 | 0,70  | 90    | 19        | 150                | 150                      | 100                      | Lighting should be controllable, see 6.2.4. Ambient light should be considered, see Annex B, room brightness see 6.7. 4 000 K $\leq T_{cd} \leq$ 6 500 K |
| 44.13    | Technical drawing rooms          | 750                   | 1 000                 | 0,60  | 80    | 19        | 150                | 150                      | 100                      | Lighting should be controllable, see 6.2.4. Ambient light should be considered, see Annex B, room brightness see 6.7.                                    |
| 44.14    | Practical rooms and laboratories | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 100                      | Lighting should be controllable, see 6.2.4. Ambient light should be considered, see Annex B, room brightness see 6.7.                                    |
| 44.15    | Handcraft rooms                  | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 100                      | 100                      | Lighting should be controllable, see 6.2.4. Ambient light should be considered, see Annex B, room brightness see 6.7.                                    |

| Ref. no. | Type of task/activity area              | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,w}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements   |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |   |
| 44.16    | Teaching workshop                       | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 100                      | Lighting should be controllable, see 6.2.4. Ambient light should be considered, see Annex B, room brightness see 6.7. |
| 44.17    | Preparation rooms and workshops         | 500                   | 750                   | 0,60  | 80    | 22        | 150                | 150                      | 100                      | Lighting should be controllable, see 6.2.4. Ambient light should be considered, see Annex B, room brightness see 6.7. |
| 44.18    | Entrance halls                          | 200                   | 300                   | 0,40  | 80    | 22        | 75                 | 75                       | 50                       |   |
| 44.19    | Circulation areas, corridors            | 100                   | 150                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       | Horizontal illuminance floor level.   |
| 44.20    | Stairs                                  | 150                   | 200                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       | Horizontal illuminance at floor level.  |
| 44.21    | Student common rooms and assembly halls | 200                   | 300                   | 0,40  | 80    | 22        | 75                 | 75                       | 50                       |   |
| 44.22    | Teachers rooms                          | 300                   | 500                   | 0,60  | 80    | 19        | 100                | 100                      | 50                       | For office work see Table 34 —Offices.  |
| 44.23    | Library: bookshelves                    | 200                   | 300                   | 0,60  | 80    | 19        | -                  | -                        | -                        | Vertical illuminance on shelves.<br>For dedicated bookshelves lighting the $R_{UGL}$ value does not apply.            |

| Ref. no. | Type of task/activity area               | $\bar{E}_m$<br>lx     |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$<br>lx | $\bar{E}_{m,y}^{all}$<br>lx | $\bar{E}_{m,ceiling}$<br>lx | Specific requirements  |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|-----------------------|-----------------------------|-----------------------------|--|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                       |                             |                             |  |
| 44.24    | Library: reading areas                   | 500                   | 750                   | 0,60  | 80    | 19        | 100                   | 100                         | 50                          | See Table 41 —Places of public assembly – Libraries  |
| 44.25    | Stock rooms for teaching materials       | 100                   | 150                   | 0,40  | 80    | 25        | 50                    | 50                          | 30                          |  |
| 44.26    | Sports halls, gymnasiums, swimming pools | 300                   | 500                   | 0,60  | 80    | 22        | 100                   | 75                          | 30                          | These requirements are only applicable for schools. For non-school use, training and competition, apply the specific requirements given in EN 12193. |
| 44.27    | School canteens                          | 200                   | 300                   | 0,40  | 80    | 22        | 75                    | 75                          | 50                          |  |
| 44.28    | Kitchen                                  | 500                   | 750                   | 0,60  | 80    | 22        | 100                   | 100                         | 75                          |  |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 45 — Health care premises – Rooms for general use

| Ref. no.  | Type of task/activity area   | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements               |
|---|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|-------------------------------------|
|   |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                                     |
| 45.1  | Waiting rooms  | 200                   | 300                   | 0,40  | 80    | 22        | 75                 | 75                       | 30                       |                                     |
| 45.2  | Corridors: during the day  | 100                   | 200                   | 0,40  | 80    | 22        | 50                 | 50                       | 30                       | Illuminance at floor level.         |
| 45.3  | Corridors: cleaning  | 100                   | 200                   | 0,40  | 80    | 22        | 50                 | 50                       | 30                       | Illuminance at floor level.         |
| 45.4  | Corridors: during the night  | 50                    | -                     | 0,40  | 80    | 22        | -                  | -                        | -                        | Illuminance at floor level.         |
| 45.5  | Corridors with multi-purpose use (e.g. preexamination of patients) | 200                   | 300                   | 0,60  | 80    | 22        | 75                 | 75                       | 50                       | Illuminance at task/activity level. |
| 45.6  | Day rooms  | 300                   | 500                   | 0,60  | 80    | 22        | 75                 | 75                       | 50                       |                                     |
| 45.7  | Elevators, lifts for persons and visitors                          | 100                   | 200                   | 0,60  | 80    | 22        | 50                 | 50                       | 30                       | Illuminance at floor level.         |
| 45.8  | Service lifts  | 200                   | 300                   | 0,60  | 80    | 22        | 75                 | 75                       | 50                       | Illuminance at floor level.         |
| Too high luminances in the patients' visual field shall be prevented. |  |                       |                       |       |       |           |                    |                          |                          |                                     |
| <sup>a</sup> required: minimum value                                  |  |                       |                       |       |       |           |                    |                          |                          |                                     |
| <sup>b</sup> modified: considers common context modifiers in 5.3.3    |  |                       |                       |       |       |           |                    |                          |                          |                                     |

Table 46 — Health care premises – Staff rooms

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|-----------------------|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                       |
| 46.1     | Staff office               | 500                   | 1 000                 | 0,60  | 80    | 19        | 150                | 150                      | 100                      | $U_o \geq 0,10$       |
| 46.2     | Staff rooms                | 300                   | 750                   | 0,60  | 80    | 19        | 100                | 100                      | 50                       |                       |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 47 — Health care premises – Wards, maternity wards

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 47.1     | General lighting           | 100                   | 200                   | 0,40  | 80    | 19        | 50                 | 50                       | 30                       | Illuminance at floor level.<br>Lighting for the walls should be controllable.<br>Room brightness, see 6.7. |
| 47.2     | Reading lighting           | 300                   | 750                   | 0,70  | 80    | 19        | 100                | 100                      | 75                       |  |

| Ref. no.  | Type of task/activity area           | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|---|--------------------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|   |                                      | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 47.3  | Wards - Simple examinations          | 300                   | 500                   | 0,60  | 80    | 19        | 100                | 100                      | 75                       | For normal examination and special treatment see also Table 48 —Health care premises – Examination rooms (general) and Table 59 — Health care premises – Autopsy rooms and mortuaries. |
| 47.4  | Examination and treatment            | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                | 150                      | 100                      | Room brightness, see 6.7, should be considered. Lighting should be controllable, see 6.2.4.  |
| 47.5  | Night lighting, observation lighting | 5                     | -                     | -     | 80    | -         | -                  | -                        | -                        | 2 200 K $\leq T_{cp} \leq$ 3 000 K<br>Illuminance at floor level.  |
| 47.6  | Bathrooms and toilets for patients   | 200                   | 300                   | 0,40  | 90    | 22        | 75                 | 75                       | 50                       | Lower colour temperature and lower illuminance for night lighting should be considered.  |
| Too high luminances in the patients' visual field shall be prevented. |                                      |                       |                       |       |       |           |                    |                          |                          |  |
| <sup>a</sup> required: minimum value                                  |                                      |                       |                       |       |       |           |                    |                          |                          |  |
| <sup>b</sup> modified: considers common context modifiers in 5.3.3    |                                      |                       |                       |       |       |           |                    |                          |                          |  |

Table 48 — Health care premises – Examination rooms (general)

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,wall}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                  |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|-----------------------|--------------------------|--|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                       |                          |  |
| 48.1     | General lighting           | 500                   | 750                   | 0,60  | 90    | 19        | 150                | 150                   | 100                      | $4\ 000\ K \leq T_{cp} \leq 5\ 000\ K$ |
| 48.2     | Examination and treatment  | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                | 150                   | 100                      | $4\ 000\ K \leq T_{cp} \leq 5\ 000\ K$ |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 49 — Health care premises – Eye Examination rooms

| Ref. no. | Type of task/activity area                         | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                  |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 49.1     | General lighting                                   | 500                   | 750                   | 0,60  | 90    | 19        | 150                | 150                      | 100                      | $4\ 000\ K \leq T_{cp} \leq 5\ 000\ K$ |
| 49.2     | Examination of the outer eye                       | 1 000                 | 1 500                 | -     | 90    | -         | 150                | 150                      | 100                      | $4\ 000\ K \leq T_{cp} \leq 5\ 000\ K$ |
| 49.3     | Reading and colour vision tests with vision charts | 500                   | 750                   | 0,70  | 90    | 16        | 150                | 150                      | 100                      | $4\ 000\ K \leq T_{cp} \leq 6\ 500\ K$ |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 50 — Health care premises – Ear Examination rooms

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,w}$ lx <sup>all</sup> | $\bar{E}_{m,ceiling}$ lx | Specific requirements        |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|-----------------------------------|--------------------------|------------------------------|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                                   |                          |                              |
| 50.1     | General lighting           | 500                   | 750                   | 0,60  | 90    | 19        | 150                | 150                               | 100                      | 4 000 K ≤ $T_{cp}$ ≤ 5 000 K |
| 50.2     | Ear examination            | 1 000                 | 1 500                 | -     | 90    | -         | 150                | 150                               | 100                      | 4 000 K ≤ $T_{cp}$ ≤ 5 000 K |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 51 — Health care premises – Scanner rooms

| Ref. no. | Type of task/activity area                           | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,w}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------|--------------------------|-----------------------|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                    |                          |                       |
| 51.1     | General lighting                                     | 300                   | 500                   | 0,60  | 80    | 19        | 100                | 100                | 75                       |                       |
| 51.2     | Scanners with image enhancers and television systems | 50                    | -                     | -     | 80    | 19        | -                  | -                  | -                        | DSE-work, see 5.9     |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 52 — Health care premises – Delivery rooms

| Ref. no. | Type of task/activity area | $\bar{E}_m$<br>lx     |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$<br>lx | $\bar{E}_{m,wall}$<br>lx | $\bar{E}_{m,ceiling}$<br>lx | Specific requirements                      |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|-----------------------|--------------------------|-----------------------------|--|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                       |                          |                             |  |
| 52.1     | General lighting           | 300                   | 500                   | 0,60  | 90    | 19        | 100                   | 100                      | 75                          | Lighting should be controllable, see 6.2.4 |
| 52.2     | Examination and treatment  | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                   | 150                      | 100                         | Lighting should be controllable, see 6.2.4 |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 53 — Health care premises – Treatment rooms (general)

| Ref. no. | Type of task/activity area | $\bar{E}_m$<br>lx     |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$<br>lx | $\bar{E}_{m,wall}^{all}$<br>lx | $\bar{E}_{m,ceiling}$<br>lx | Specific requirements                       |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|-----------------------|--------------------------------|-----------------------------|---|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                       |                                |                             |   |
| 53.1     | Dialysis                   | 500                   | 750                   | 0,60  | 80    | 19        | 150                   | 150                            | 100                         | Lighting should be controllable, see 6.2.4. |
| 53.2     | Dermatology                | 500                   | 750                   | 0,60  | 90    | 19        | 150                   | 150                            | 100                         |   |
| 53.3     | Endoscopy                  | 300                   | 500                   | 0,60  | 80    | 19        | 100                   | 100                            | 75                          |   |
| 53.4     | Plastering                 | 500                   | 750                   | 0,60  | 80    | 19        | 150                   | 150                            | 100                         |   |
| 53.5     | Medical baths              | 300                   | 500                   | 0,60  | 80    | 19        | 100                   | 100                            | 75                          |   |
| 53.6     | Massage and radiotherapy   | 300                   | 500                   | 0,60  | 80    | 19        | 100                   | 100                            | 75                          |   |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 54 — Health care premises – Operating areas

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements   |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |   |
| 54.1     | Pre-op and recovery rooms  | 500                   | 750                   | 0,60  | 90    | 19        | 150                | 150                      | 100                      |   |
| 54.2     | Operating cavity surround  | 1 000                 | 1 500                 | 0,60  | 90    | 19        | 150                | 150                      | 100                      | The illuminance of the cavity area should be luminance balanced to the immediate surrounding. |
| 54.3     | Operating theatre          | 1 000                 | 1 500                 | 0,60  | 90    | 19        | -                  | -                        | -                        |   |
| 54.4     | Operating cavity           | -                     | -                     | -     | 90    | -         | -                  | -                        | -                        | Apply specific requirements given in EN 60601-2-41:2009 <sup>4</sup> .                        |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

<sup>4</sup> As impacted by EN 60601-2-41:2009/A11:2011 and EN 60601-2-41:2009/A1:2015.

Table 55 — Health care premises – Intensive care unit

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                    |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 55.1     | General lighting           | 300                   | 500                   | 0,60  | 90    | 19        | 50                 | 50                       | 30                       | Illuminance at floor level.              |
| 55.2     | Simple examinations        | 500                   | 750                   | 0,60  | 90    | 19        | 100                | 100                      | 75                       | Illuminance at bed level.                |
| 55.3     | Examination and treatment  | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                | 150                      | 100                      | Illuminance at bed level.                |
| 55.4     | Night watch                | 20                    | -                     | -     | 90    | 19        | -                  | -                        | -                        | Colour temperature should be considered. |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 56 — Health care premises – Dentists

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                             |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |   |
| 56.1     | General lighting           | 500                   | 750                   | 0,60  | 90    | 19        | 150                | 150                      | 100                      | Lighting should be glare-free for the patient.    |
| 56.2     | At the patient             | 1 000                 | 1 500                 | 0,70  | 90    | -         | 150                | 150                      | 100                      |   |
| 56.3     | Operating cavity           | -                     | -                     | -     | -     | -         | -                  | -                        | -                        | Apply specific requirements given in EN ISO 9680. |
| 56.4     | White teeth matching       | -                     | -                     | -     | -     | -         | -                  | -                        | -                        | Apply specific requirements given in EN ISO 9680. |

| Ref. no. | Type of task/activity area                            | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|-----------------------|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           | $U_0 \geq 0,10$    |                          |                          |                       |
| a        | required: minimum value                               |                       |                       |       |       |           |                    |                          |                          |                       |
| b        | modified: considers common context modifiers in 5.3.3 |                       |                       |       |       |           |                    |                          |                          |                       |

STANDARDSISO.COM: Click to view the full PDF of BS EN 12464 -1 (WG):2021  
 No reproduction or circulation of this document for WG on Lighting.

Table 57 — Health care premises – Laboratories and pharmacies

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements        |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|------------------------------|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                              |
| 57.1     | General lighting           | 500                   | 750                   | 0,60  | 80    | 19        | 150                | 150                      | 100                      |                              |
| 57.2     | Colour inspection          | 1 000                 | 1 500                 | 0,70  | 90    | 19        | 150                | 150                      | 100                      | 4 000 K ≤ $T_{cD}$ ≤ 6 500 K |

a required: minimum value  
b modified: considers common context modifiers in 5.3.3

Table 58 — Health care premises – Decontamination rooms

| Ref. no. | Type of task/activity area | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements |
|----------|----------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|-----------------------|
|          |                            | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |                       |
| 58.1     | Sterilization              | 500                   | 750                   | 0,60  | 80    | 22        | 100                | 100                      | 75                       |                       |
| 58.2     | Disinfection               | 500                   | 750                   | 0,60  | 80    | 22        | 100                | 100                      | 75                       |                       |

a required: minimum value  
b modified: considers common context modifiers in 5.3.3

Table 59 — Health care premises – Autopsy rooms and mortuaries

| Ref. no. | Type of task/activity area         | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                          |
|----------|------------------------------------|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |                                    | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 59.1     | General lighting                   | 500                   | 750                   | 0,60  | 90    | 19        | 150                | 150                      | 100                      |  |
| 59.2     | Autopsy table and dissecting table | 5 000                 | 7 500                 | 0,70  | 90    | -         | 150                | 150                      | 100                      | Values higher than 5 000 lx might be required. |

<sup>a</sup> required: minimum value  
<sup>b</sup> modified: considers common context modifiers in 5.3.3

Table 60 — Transportation areas – Airports

| Ref. no. | Type of task/activity area                       | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                  |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 60.1     | Arrival and departure halls, baggage claim areas | 200                   | 300                   | 0,40  | 80    | 22        | 75                 | 75                       | 30                       |  |
| 60.2     | Connecting areas                                 | 150                   | 200                   | 0,40  | 80    | 22        | 50                 | 50                       | 30                       |  |
| 60.3     | Information desks, check-in desks                | 500                   | 750                   | 0,70  | 80    | 19        | 150                | 150                      | 100                      | DSE-work, see 5.9.                     |
| 60.4     | Customs and passport control desks               | 500                   | 750                   | 0,70  | 80    | 19        | 150                | 150                      | 100                      | Facial recognition has to be provided. |
| 60.5     | Waiting areas                                    | 200                   | 300                   | 0,40  | 80    | 22        | 50                 | 50                       | 30                       |  |
| 60.6     | Luggage storage rooms                            | 200                   | 300                   | 0,40  | 80    | 25        | 50                 | 50                       | 30                       |  |
| 60.7     | Security check areas                             | 300                   | 500                   | 0,60  | 80    | 19        | 100                | 100                      | 75                       | DSE-work, see 5.9.                     |

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements   |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |   |
| 60.8     | Air traffic control tower   | 500                   | 750                   | 0,60  | 80    | 16        | 50                 | -                        | -                        | <ol style="list-style-type: none"> <li>1. Lighting should be dimmable, see 6.2.4.</li> <li>2. DSE-work, see 5.9.</li> <li>3. Glare from daylight shall be avoided.</li> <li>4. Reflections in windows, especially at night shall be avoided.</li> </ol> |
| 60.9     | Tasks in hangars:<br>- Testing and repair areas<br>- Engine test areas<br>- Measuring areas | 500                   | 750                   | 0,60  | 80    | 22        | 50                 | 50                       | 30                       |   |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

STANDARDSISO.COM: Click to view the full PDF of BS EN 12464 -1 (WG):2021

Table 61 — Transportation areas – Railway installations

| Ref. no. | Type of task/activity area                            | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 61.1.1   | Fully enclosed platforms, small number of passengers  | 50                    | -                     | 0,30  | 80    | -         | -                  | -                        | -                        | 1. Special attention to the edge of the platform, see also D.1<br>2. Avoid glare for vehicle drivers and passengers. See also D.2 and D.3.<br>3. Illuminance at floor level in reference area. |
| 61.1.2   | Fully enclosed platforms, medium number of passengers | 100                   | -                     | 0,40  | 80    | -         | -                  | -                        | -                        | 1. Special attention to the edge of the platform, see also D.1<br>2. Avoid glare for vehicle drivers and passengers. See also D.2 and D.3.<br>3. Illuminance at floor level in reference area. |
| 61.1.3   | Fully enclosed platforms, large number of passengers  | 200                   | -                     | 0,50  | 80    | -         | -                  | -                        | -                        | 1. Special attention to the edge of the platform, see also D.1<br>2. Avoid glare for vehicle drivers and passengers. See also D.2 and D.3.<br>3. Illuminance at floor level in reference area. |

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 61.2.1   | Fully enclosed passenger subways (underpasses), small number of passengers  | 50                    | -                     | 0,30  | 80    | -         | -                  | -                        | -                        | <ol style="list-style-type: none"> <li>1. Avoid glare for passengers. See also D.3.</li> <li>2. Illuminance at floor level in reference area.</li> <li>3. In case of high reflecting enclosure surfaces the average illuminance level can be reduced by 50 %.</li> <li>4. See also D.4.</li> </ol> |
| 61.2.2   | Fully enclosed passenger subways (underpasses), medium number of passengers | 100                   | -                     | 0,40  | 80    | -         | -                  | -                        | -                        | <ol style="list-style-type: none"> <li>1. Avoid glare for passengers. See also D.3.</li> <li>2. Illuminance at floor level in reference area.</li> <li>3. In case of high reflecting enclosure surfaces the average illuminance level can be reduced by 50 %.</li> <li>4. See also D.4.</li> </ol> |

STANDARDSISO.COM: Click to view the full PDF of BS EN 12464 -1 (WG):2021

No reproduction or distribution for WG on Lighting.

| Ref. no. | Type of task/activity area   | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements  |
|----------|--|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|--|
|          |  | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |  |
| 61.2.3   | Fully enclosed passenger subways (underpasses), large number of passengers | 200                   | -                     | 0,50  | 80    | -         | -                  | -                        | -                        | <ol style="list-style-type: none"> <li>1. Avoid glare for passengers. See also D.3.</li> <li>2. Illuminance at floor level in reference area.</li> <li>3. In case of high reflecting enclosure surfaces the average illuminance level can be reduced by 50 %.</li> <li>4. See also D.4.</li> </ol> |
| 61.3.1   | Stairs, escalators, small number of passengers                             | 50                    | -                     | 0,30  | 80    | -         | -                  | -                        | -                        | <ol style="list-style-type: none"> <li>1. Avoid glare for passengers. See also D.3.</li> <li>2. Special attention to landings.</li> </ol>  |
| 61.3.2   | Stairs, escalators, medium number of passengers                            | 100                   | -                     | 0,40  | 80    | -         | -                  | -                        | -                        | <ol style="list-style-type: none"> <li>1. Avoid glare for passengers. See also D.3.</li> <li>2. Special attention to landings.</li> </ol>  |
| 61.3.3   | Stairs, escalators, large number of passengers                             | 200                   | -                     | 0,50  | 80    | -         | -                  | -                        | -                        | <ol style="list-style-type: none"> <li>1. Avoid glare for passengers. See also D.3.</li> <li>2. Special attention to landings.</li> </ol>  |
| 61.4     | Ticket hall and concourse  | 200                   | 300                   | 0,50  | 80    | 28        | 75                 | 75                       | 50                       | Illuminance at floor level in reference area   |
| 61.5     | Ticket counters and luggage offices  | 300                   | 500                   | 0,50  | 80    | 19        | 100                | 100                      | 75                       | Illuminance in task areas  |

| Ref. no. | Type of task/activity area                  | $\bar{E}_m$ lx        |                       | $U_o$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements   |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |   |
| 61.6     | Waiting rooms                               | 200                   | 300                   | 0,40  | 80    | 22        | 75                 | 75                       | 30                       | $U_o \geq 0,10$   |
| 61.7     | Entrance halls, station halls               | 200                   | 300                   | 0,40  | 80    | -         | 75                 | 75                       | 30                       |   |
| 61.8     | Switch and plant rooms                      | 200                   | 300                   | 0,50  | 80    | 28        | 50                 | 50                       | 30                       |   |
| 61.8.1   | Railway control centre (area of dispatcher) | 200                   | 300                   | 0,50  | 80    | 16        | -                  | -                        | -                        | Illuminance in task areas (horizontal, vertical, inclined), individually dimmable in task areas.<br><br>Illuminance in task areas and uniformity (horizontal, vertical, inclined).<br>1. Lighting should be controllable preferably by dimming, see 6.2.4.<br>2. DSE work, see 5.9.<br>3. Glare from daylight should be avoided.<br>4. Reflections in windows, especially at night shall be avoided.<br>5. Safety colours shall be identifiable.<br>6. Control desks and control walls require a constant illuminance over the whole surface. |
| 61.9     | Access tunnels                              | 50                    | 75                    | 0,40  | 20    | -         | -                  | -                        | -                        | Illuminance at floor level.   |

| Ref. no. | Type of task/activity area  | $\bar{E}_m$ lx        |                       | $U_0$ | $R_a$ | $R_{UGL}$ | $\bar{E}_{m,z}$ lx | $\bar{E}_{m,y}^{all}$ lx | $\bar{E}_{m,ceiling}$ lx | Specific requirements                     |
|----------|---|-----------------------|-----------------------|-------|-------|-----------|--------------------|--------------------------|--------------------------|---|
|          |   | required <sup>a</sup> | modified <sup>b</sup> |       |       |           |                    |                          |                          |   |
| 61.10.1  | Assembly work in maintenance sheds - rough  | 200                   | -                     | 0,40  | 80    | -         | -                  | -                        | -                        | Avoid glare for passengers. See also D.3. |
| 61.10.2  | Assembly work in maintenance sheds - medium   | 300                   | -                     | 0,50  | 80    | -         | -                  | -                        | -                        | Avoid glare for passengers. See also D.3. |
| 61.10.3  | Assembly work in maintenance sheds - fine   | 500                   | -                     | 0,60  | 80    | -         | -                  | -                        | -                        | Avoid glare for passengers. See also D.3. |
| 61.10.4  | Assembly work in maintenance sheds - precision  | 750                   | -                     | 0,70  | 80    | -         | -                  | -                        | -                        | Avoid glare for passengers. See also D.3. |
| 61.10.5  | Circulation areas for maintenance halls for railway vehicles (without additional vehicular traffic) | 100                   | 150                   | 0,25  | 80    | -         | -                  | -                        | -                        |   |
| 61.10.6  | Circulation areas for maintenance halls for railway vehicles (with additional vehicular traffic)    | 150                   | 200                   | 0,40  | 80    | -         | -                  | -                        | -                        |   |

<sup>a</sup> required: minimum value

<sup>b</sup> modified: considers common context modifiers in 5.3.3

## 8 Verification procedures

### 8.1 General

Specified design criteria which are listed in this document shall be verified by the following procedures.

In lighting design, calculations and measurements, certain assumptions including degree of accuracy have been made. These shall be declared.

The installation and the environment shall be checked against the design assumptions.

### 8.2 Illuminances

When verifying conformity to the illuminance requirements the measurement points shall coincide with any design points or grids used. Verification shall be made to the criteria of the relevant surfaces.

For subsequent measurements, the same measurement points shall be used.

Verification of illuminances that relate to specific tasks shall be measured perpendicular to the plane of the task.

When verifying illuminances, account should be taken of the calibration of the light meters used, the conformity of the light source and luminaires to the published photometric data, and of the design assumptions made about surface reflectance, etc., compared with the real values.

The average illuminance and uniformity shall be calculated from the measured values and taking into account the maintenance factor shall be not less than the values specified.

### 8.3 Unified Glare Rating

Authenticated UGR data produced by the tabular method shall be provided for the luminaire scheme by the manufacturer of the luminaire. The spacing shall be declared for the UGR-tables provided.

### 8.4 Colour rendering and colour appearance

Authenticated colour rendering index  $R_a$  and correlated colour temperatures  $T_{cp}$  data shall be provided for the light source in the scheme by the manufacturer of the light source. The light sources shall be checked against the design specifications.

### 8.5 Luminaire luminance

The average luminance of the luminous parts of the luminaire shall be measured and/or calculated in the C-plane (azimuth) at intervals of  $15^\circ$  starting at  $0^\circ$  and the  $\gamma$ -plane (elevation) for angles of  $65^\circ$ ,  $70^\circ$ ,  $75^\circ$ ,  $80^\circ$  and  $85^\circ$ . Usually the manufacturer of the luminaire shall provide these data based on maximum (light source/luminaire) output (see also EN 13032-1, EN 13032-2 and EN 13032-4).

### 8.6 Maintenance schedule

The maintenance schedule shall be provided according to 6.3.

## Annex A (informative)

### Recommended practice regarding implementation of UGR tabular method for 'non-standard' situations

#### A.1 General

The boundary conditions for the determination of the UGR value include having a rectangular space, a regular luminaire grid and only one type of luminaire. The UGR methodology does not apply to totally indirect luminaires. The UGR tabular method is only applicable for luminaires with at least 2-axis symmetrical light distribution in horizontal position of the light emission surface. This limits the application of the methodology to some extent, but does not exclude its use. However, as the limiting values (in the tables in 7.3) have been determined based on the UGR tabular method, the limiting values cannot be applied to other uses of the UGR formula (such as individual point calculations) without further scientific validation. To maximize the applicability of the tabular method, A.2 covers recommended practices when specific boundary conditions are not met.

NOTE 1 The UGR methodology is intended to support the selection of luminaires which are appropriate for the given application. It is not intended as an exact prediction of glare in the given space.

NOTE 2 The highest UGR value will generally occur in the largest room with the lowest reflectances. When using the recommended practices below it is advisable to keep this in mind when determining the worst-case scenarios.

#### A.2 Recommended Practices

##### A.2.1 Deviating luminaire sizes

The UGR methodology can be applied to luminaires visible in boundaries  $0,0003$  sr to  $0,1$  sr as given in CIE 117 (for usual room heights (except high halls) this corresponds to luminaires from  $0,005$  m<sup>2</sup> to  $1,5$  m<sup>2</sup>). For luminaires outside this range some advice is given in CIE 147.

##### A.2.2 Irregular area shapes

The UGR methodology is based upon rectangular rooms. For a non-rectangular room, the room dimensions can be approximated by fitting it with a rectangle. The used dimensions of the approximated rectangle should be documented in the lighting design.

##### A.2.3 Irregular luminaire placement patterns

As the UGR-tabular method uses a 'virtual' luminaire placement to determine the UGR value, the exact luminaire placement pattern can be disregarded. However, in extreme cases such as clusters of luminaires tightly grouped together, the UGR-tabular method should not be used.

##### A.2.4 Deviating room reflectances

If the exact reflectances are not given in the standard UGR table, the set of reflectances closest to these reflectances should be used as a best approximation. Keep in mind that the lower the reflectances, the higher the UGR value. As such, for the worst-case scenario it is preferable to select a set of values lower than the requested values. Alternatively, a set of transfer values can be calculated allowing the calculation of standard UGR values for the required reflectances.

### **A.2.5 Multiple luminaire types**

When multiple luminaire types are used, the UGR should be determined for each individual luminaire type. For the worst-case scenario, the luminaire type with the highest UGR value should be referenced against the set limiting value.

### **A.2.6 Luminaires with (only) up-lighting or luminous ceilings**

The UGR methodology does not apply to up-lighters (i.e. luminaires with only up-light or luminaires in which the downward component only has an aesthetic function and does not contribute to achieving the lighting requirements specified within this document). Additionally, the UGR methodology does not apply to luminous ceilings (see size limits in A.2.1).

### **A.2.7 Room dimensions smaller or larger than the tabular values**

Assuming 'H' as the distance between the observer and luminaire plane, for room dimensions larger than 12H (the maximum dimension ratio in the tabular method), 12H can be taken as a representative value. In this case, the used dimension should be reported. For room dimensions smaller than 2H, discomfort glare is unlikely to occur.

For room dimensions > 12H or in production facilities with large height differences between the height of the user's eye and the mounting height (e.g. > 7 m), it should be checked whether the UGR method should be used or whether in these cases disability glare could be more important than discomfort glare.

STANDARDSISO.COM: Click to view the full PDF of BS EN 12464-1 (WG):2021  
No reproduction or distribution without the explicit written permission of Standards & Technical Drawings Ltd.