

INTERNATIONAL STANDARD

ISO 11600

Second edition
2002-10-01

Corrected version
2004-09-01

Building construction — Jointing products — Classification and requirements for sealants

*Construction immobilière — Produits pour joints — Classification et
exigences pour les mastics*

STANDARDSISO.COM : Click to view the full PDF of ISO 11600:2002



Reference number
ISO 11600:2002(E)

© ISO 2002

PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

STANDARDSISO.COM : Click to view the full PDF of ISO 11600:2002

© ISO 2002

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.ch
Web www.iso.ch

Printed in Switzerland

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 3.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this International Standard may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

International Standard ISO 11600 was prepared by Technical Committee ISO/TC 59, *Building construction*, Subcommittee SC 8, *Jointing products*.

This second edition cancels and replaces the first edition (ISO 11600:1993), clauses 7 and 8 of which have been technically revised.

This corrected version of ISO 11600:2002 incorporates the following corrections:

- in Table 2, the tensile properties, secant tensile modulus at + 23 °C, have been changed from “> 4 N/mm²” to “> 0,4 N/mm²” for classes 25HM and 20HM;
- in Clause 9, item b), “test number” has been changed to “test report number”.

STANDARDSISO.COM : Click to view the full PDF of ISO 11600:2002

Building construction — Jointing products — Classification and requirements for sealants

1 Scope

This International Standard specifies the types and classes of sealants used in building construction according to their applications and performance characteristics.

The requirements and respective test methods for the different classes are also given.

2 Normative references

The following normative documents contain provisions which, through reference in this text, constitute provisions of this International Standard. For dated references, subsequent amendments to, or revisions of, any of these publications do not apply. However, parties to agreements based on this International Standard are encouraged to investigate the possibility of applying the most recent editions of the normative documents indicated below. For undated references, the latest edition of the normative document referred to applies. Members of ISO and IEC maintain registers of currently valid International Standards.

ISO 6927, *Building construction — Jointing products — Sealants — Vocabulary*

ISO 7389, *Building construction — Jointing products — Determination of elastic recovery of sealants*

ISO 7390, *Building construction — Jointing products — Determination of resistance to flow of sealants*

ISO 8339, *Building construction — Sealants — Determination of tensile properties (Extension to break)*

ISO 8340, *Building construction — Sealants — Determination of tensile properties at maintained extension*

ISO 9046, *Building construction — Jointing products — Determination of adhesion/cohesion properties of sealants at constant temperature*

ISO 9047, *Building construction — Jointing products — Determination of adhesion/cohesion properties of sealants at variable temperatures*

ISO 10563, *Building construction — Jointing products — Determination of change in mass and volume of sealants*

ISO 10590, *Building construction — Jointing products — Determination of tensile properties of sealants at maintained extension after immersion in water*

ISO 10591, *Building construction — Jointing products — Determination of adhesion/cohesion properties of sealants after immersion in water*

ISO 11431:2002, *Building construction — Jointing products — Determination of adhesion/cohesion properties of sealants after exposure to heat, water and artificial light through glass*

ISO 11432, *Building construction — Jointing products — Determination of resistance to compression of sealants*

ISO 13640, *Building construction — Jointing products — Specifications for test substrates*

3 Terms and definitions

For the purposes of this International Standard, the terms and definitions given in ISO 6927 apply.

4 Classification

4.1 Types

According to their applications, sealants are separated into two types:

Type G: glazing sealants for use in glazing joints;

Type F: construction sealants for use in building joints other than glazing.

4.2 Classes

Sealants are classified according to their ability to fulfil sealing functions in joints with movement parameters as given in Table 1.

Table 1 — Sealant classes

Class ^a	Test amplitude %	Movement capability ^b %
25	± 25	25,0
20	± 20	20,0
12,5	± 12,5	12,5
7,5	± 7,5	7,5

^a Classes 25 and 20 apply to both types of sealant G and F, while classes 12,5 and 7,5 apply to sealants of type F only.

^b For the correct interpretation and application of movement capability to the design of joints, relevant national standards and advisory documents should be considered.

4.3 Subclasses

4.3.1 Sealants of class 25 and 20 are additionally sub-classified according to their secant tensile modulus (see ISO 6927):

low modulus: code LM;

high modulus: code HM.

If the measured secant tensile modulus value exceeds the values specified below for either or both temperatures, the sealant shall be classified as **high modulus**. Specified values (see Tables 2 and 3, second row) are as follows:

0,4 N/mm² at + 23 °C;

0,6 N/mm² at – 20 °C.

The secant modulus shall be the mean value of the three measured values. Round the mean value to one decimal place.

EXAMPLE Measured values 0,43 N/mm², 0,40 N/mm² and 0,46 N/mm². Mean value 0,43 N/mm². Reported value 0,4 N/mm².

4.3.2 Sealants of class 12,5 are additionally classified according to their elastic recovery:

elastic recovery equal to or more than 40 %: Code E (elastic);

elastic recovery less than 40 %: Code P (plastic).

Sealants of classes 25, 20 and 12,5E are called **elastic sealants**; sealants of classes 12,5P and 7,5P are called **plastic sealants**. The full classification scheme is shown in Figure 1.

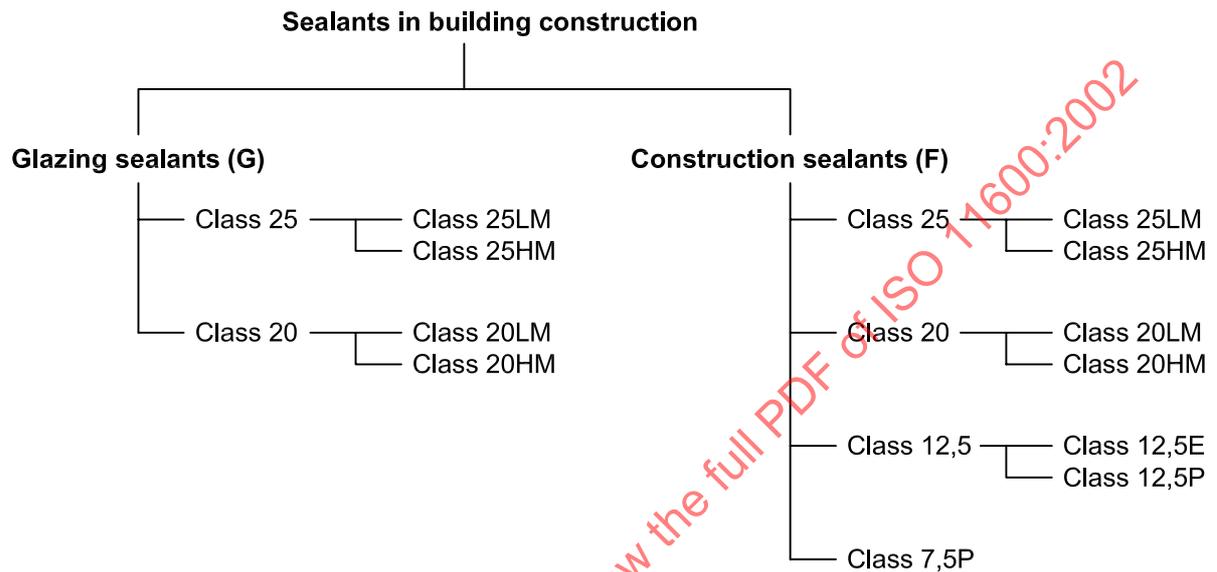


Figure 1 — Diagram of classification of sealants in building construction

5 Requirements and test methods

The requirements and test methods are as specified in Tables 2 and 3 for Type G and Type F sealants respectively. For specific test conditions, see Table 4.

Table 2 — Requirements for glazing sealants (G)

Properties	Class				Test method
	25LM	25HM	20LM	20HM	
Elastic recovery (%)	≥ 60	≥ 60	≥ 60	≥ 60	ISO 7389
Tensile properties, secant tensile modulus at + 23 °C (N/mm ²)	≤ 0,4	> 0,4	≤ 0,4	> 0,4	ISO 8339
at – 20 °C (N/mm ²)	and ≤ 0,6	or > 0,6	and ≤ 0,6	or > 0,6	
Tensile properties at maintained extension	nf	nf	nf	nf	ISO 8340
Adhesion/cohesion properties at variable temperature	nf	nf	nf	nf	ISO 9047
Adhesion/cohesion properties after exposure to heat and artificial light and to water (see Note 1)	nf	nf	nf	nf	ISO 11431
Adhesion/cohesion properties at maintained extension after water immersion	nf	nf	nf	nf	ISO 10590
Resistance to compression (N/mm ²)	see Note 2	see Note 2	see Note 2	see Note 2	ISO 11432
Loss of volume (%)	≤ 10	≤ 10	≤ 10	≤ 10	ISO 10563
Resistance to flow (mm) (see Note 3)	≤ 3	≤ 3	≤ 3	≤ 3	ISO 7390

nf = no failure as defined in clause 7.

NOTE 1 Use the standard conditions of exposure, as described in ISO 11431:2002, 8.2.2 or 8.2.3.

NOTE 2 Record the value for compression.

NOTE 3 Use the U-profile, made from anodized aluminium, with a nominal width of 20 mm and a nominal depth of 10 mm. Apply test temperatures of (50 ± 2) °C and (5 ± 2) °C. Test to procedure A and procedure B. If the flow exceeds 3 mm, the test may be repeated once.

Table 3 — Requirements for construction sealants (F)

Properties	Class							Test method
	25LM	25HM	20LM	20HM	12,5E	12,5P	7,5P	
Elastic recovery (%)	≥ 70	≥ 70	≥ 60	≥ 60	≥ 40	< 40	< 40	ISO 7389
Tensile properties								
a) secant tensile modulus at + 23 °C (N/mm ²)	≤ 0,4	> 0,4	≤ 0,4	> 0,4	—	—	—	ISO 8339
and at – 20 °C (N/mm ²)	≤ 0,6	> 0,6	≤ 0,6	> 0,6	—	—	—	
b) elongation at break (%) at + 23 °C	—	—	—	—	—	≥ 100	≥ 25	
Tensile properties at maintained extension	nf	nf	nf	nf	nf	—	—	ISO 8340
Adhesion/cohesion properties at variable temperatures	nf	nf	nf	nf	nf	—	—	ISO 9047
Adhesion/cohesion properties at constant temperature	—	—	—	—	—	nf	nf	ISO 9046
Adhesion/cohesion properties at maintained extension after water immersion	nf	nf	nf	nf	nf	—	—	ISO 10590
Adhesion/cohesion properties after water immersion. Elongation at break (%) at + 23 °C	—	—	—	—	—	≥ 100	≥ 25	ISO 10591
Loss of volume (%)	≤ 10 see Note 1	≤ 10 see Note 1	≤ 10 see Note 1	≤ 10 see Note 1	≤ 25	≤ 25	≤ 25	ISO 10563
Resistance to flow (mm) (Note 2)	≤ 3	≤ 3	≤ 3	≤ 3	≤ 3	≤ 3	≤ 3	ISO 7390

nf = no failure as defined in clause 7.

NOTE 1 A maximum of 25 % for water-based dispersion sealants.

NOTE 2 Use the U-profile made from anodized aluminium with a nominal width of 20 mm and a nominal depth of 10 mm. Apply test temperatures of (50 ± 2) °C and (5 ± 2) °C. Test to procedure A and procedure B. If the flow exceed 3 mm, the test may be repeated once.

Table 4 — Specific test conditions for Type F and Type G sealants

	Test method	Class						
		25LM	25HM	20LM	20HM	12,5E	12,5P	7,5P
Elongation ^a	ISO 7389 ISO 8339 ISO 8340 ISO 10590 ISO 11431	100 %	100 %	60 %	60 %	60 %	60 %	25 %
Amplitude	ISO 9046 ISO 9047	± 25 %	± 25 %	± 20 %	± 20 %	± 12,5 %	± 12,5 %	± 7,5 %
Compression	ISO 11432	25 %	25 %	20 %	20 %	—	—	—

^a The value of elongation is given as a percentage of the original width:

$$\text{elongation \%} = \left[\frac{\text{final width} - \text{original width}}{\text{original width}} \right] \times 100 \%$$

6 Conditioning, test procedure and substrates

When determining the classification of a sealant according to the requirements of this International Standard, the same conditioning procedure (cure) shall be used in all the relevant test methods (use only Method A or Method B), for which details are given in the test methods.

For each test method, three test specimens for each substrate shall be tested (see also clause 7). The same batch of sealant (and primer, if used) shall be used in all tests. The same substrates (material and surface finish) shall be used in all tests.

The test substrates, as defined in ISO 13640, shall be selected as follows:

Type G sealants

Obligatory, glass

Optional, anodized aluminium

Type F sealants

Mortar and/or anodized aluminium and/or glass

7 Definition of failure

7.1 General

After preparation, the sealant test specimens shall be examined for defects. Any test specimens deemed unsuitable for testing shall be rejected. After testing, the sealant test specimens shall be examined for evidence of loss of adhesion or cohesion. Wherever it is observed, the depth of adhesion loss and/or cohesion loss shall be measured using a suitable measuring device capable of reading to 0,5 mm. The highest observed value of the depth of either shall be recorded and used to determine a pass or failure.

Because of the excessive stress experienced by the sealant near the ends of the test specimens, during both the preparation and testing, loss of adhesion or cohesion observed within the excluded volume 2 mm × 12 mm × 12 mm, at either or both ends of the sealant, shall not be reported as a failure (Figure 2).

Each test shall be carried out in triplicate. In any test method, if two or more of the test specimens fail, then the sealant shall be reported as failing the test. If only one of the test specimens fails, then the complete test shall be repeated. If one of the three repeat test specimens fails, then the sealant has failed the test.

7.2 Failure of subclass P sealants

Reference test methods are as given in ISO 8339, ISO 9046 and ISO 10591.

If loss of adhesion or cohesion extends through the whole depth of the sealant, then the sealant test specimen has failed. The principle of light transmission through the defect can be applied to determine pass or failure.

7.3 Failure of subclass E sealants

Reference test methods are as given in ISO 8340, ISO 9047, ISO 10590 and ISO 11431.

If loss of adhesion or cohesion in the depth of the sealant exceeds 2 mm, anywhere on the sealant surface, then the sealant test specimen has failed (see Figure 2).

