
**Building environment design —
Design, dimensioning, installation and
control of embedded radiant heating
and cooling systems —**

**Part 6:
Control**

*Conception de l'environnement des bâtiments — Conception,
construction et fonctionnement des systèmes de chauffage et de
refroidissement par rayonnement —*

Partie 6: Contrôle

STANDARDSISO.COM : Click to view the full PDF of ISO 11855-6:2018



STANDARDSISO.COM : Click to view the full PDF of ISO 11855-6:2018



COPYRIGHT PROTECTED DOCUMENT

© ISO 2018

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Controls	2
4.1 General.....	2
4.2 Central control.....	4
4.3 Zone control.....	5
4.4 Local (room) control.....	5
4.5 Influence of thermal mass of embedded systems.....	5
4.6 Self-regulating effect.....	5
4.7 Control of TABS.....	6
4.8 Flow control.....	6
Annex A (informative) Control of radiant floor heating-cooling systems	7
Bibliography	12

STANDARDSISO.COM : Click to view the full PDF of ISO 11855-6:2018

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see: www.iso.org/iso/foreword.html.

This document was prepared by ISO/TC 205, *Building environment design*.

This second edition cancels and replaces the first edition (ISO 11855-6:2012), which has been technically revised. The main changes compared to the previous edition are as follows:

- addition of [4.8](#) (Flow control);
- correction of errors.

A list of all the parts in the ISO 11855 series, can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Introduction

The radiant heating and cooling system consists of heat emitting/absorbing, heat supply, distribution, and control systems. The ISO 11855 series deals with the embedded surface heating and cooling system that directly controls heat exchange within the space. It does not include the system equipment itself, such as heat source, distribution system and controller.

The ISO 11855 series addresses an embedded system that is integrated with the building structure. Therefore, the panel system with open air gap, which is not integrated with the building structure, is not covered by this series.

The ISO 11855 series is intended to be applied to systems using not only water but also other fluids or electricity as a heating or cooling medium.

The objective of the ISO 11855 series is to provide criteria to effectively design embedded systems. To do this, it presents comfort criteria for the space served by embedded systems, heat output calculation, dimensioning, dynamic analysis, installation, operation, and control method of embedded systems.

The ISO 11855 series consists of the following:

- Part 1 specifies the comfort criteria which should be considered in designing embedded radiant heating and cooling systems, since the main objective of the radiant heating and cooling system is to satisfy thermal comfort of the occupants.
- Part 2 provides steady-state calculation methods for determination of the heating and cooling capacity.
- Part 3 specifies design and dimensioning methods of radiant heating and cooling systems to ensure the heating and cooling capacity.
- Part 4 provides dimensioning and calculation method to design TABS (Thermo Active Building Systems) for energy-saving purposes, since radiant heating and cooling systems can reduce energy consumption and heat source size by using renewable energy.
- Part 5 addresses the installation process for the system to operate as intended.
- Part 6 shows a proper control method of the radiant heating and cooling systems to ensure the maximum performance which was intended in the design stage when the system is actually being operated in a building.
- Part 7 addresses the connection to the energetic calculation in ISO 52031¹⁾ and provides input parameters for ISO 52031 based on the product properties.

1) Under preparation. Stage at time of publication: ISO/CD 52031:2018.

[STANDARDSISO.COM](https://standardsiso.com) : Click to view the full PDF of ISO 11855-6:2018

Building environment design — Design, dimensioning, installation and control of embedded radiant heating and cooling systems —

Part 6: Control

1 Scope

This document establishes guidelines for the control of embedded radiant heating and cooling systems. It specifies uniform requirements for the design and construction of heating and cooling floors, ceiling and wall structures to ensure that the heating/cooling systems are suited to the particular application. The requirements specified in this document are applicable only to the components of the heating/cooling systems and the elements which are part of the heating/cooling surface and which are installed due to the heating/cooling systems.

This document is applicable to water-based embedded surface heating and cooling systems in residential, commercial and industrial buildings. The methods apply to systems integrated into the wall, floor or ceiling construction without any open air gaps. It is not applicable to panel systems with an open air gap which is not integrated with the building structure.

This document also applies, as appropriate, to the use of fluids other than water as a heating or cooling medium. This document is not applicable for testing of systems. The methods do not apply to heated or chilled ceiling panels or beams.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 11855-1, *Building environment design — Design, dimensioning, installation and control of embedded radiant heating and cooling systems — Part 1: Definition, symbols, and comfort criteria*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 11855-1 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

NOTE All terms and definitions in this document are consistent with ISO 7345, ISO 9229, ISO 9288, ISO 9346 and ISO 16818.

4 Controls

4.1 General


This clause describes the control of hydronic systems to enable all embedded systems to perform as simulated. The design documents shall include specifications for the control system. The control system shall be capable of varying heating or cooling outputs as well as maintaining predetermined room or surface temperatures.

Control of the heating and cooling system shall enable the specified designed indoor temperatures to be achieved under the specified variation on internal loads and external climate. The control system shall, if specified, protect buildings and equipment against frost and moisture damage where necessary (when normal comfort temperature level is not required) and prevent condensation from occurring.

The design of the control system shall take into account the dynamics of building, its intended use and the effective functioning of the embedded system, efficient use of energy and avoiding conditioning the building to full design conditions when not required. This shall include keeping distribution heat losses as low as possible, e.g., by reducing flow rates and temperatures, when normal comfort temperature level is not required. Control and operation of the system will enable control of the conditioning systems to obtain possible savings of operational costs and enable the maintenance of required indoor environmental conditions.

In order to maintain a stable thermal environment, the control system needs to maintain the balance between supplied energy from the system and the losses/gains of building environment under transient conditions. Slowly varying energy flows in the form of energy losses or gains through the envelope are determined by indoor and outdoor temperature, and direction and speed of wind. [Annex A](#) provides further informative control concepts as well as examples for central systems.

STANDARDSISO.COM : Click to view the full PDF of ISO 11855-6:2018

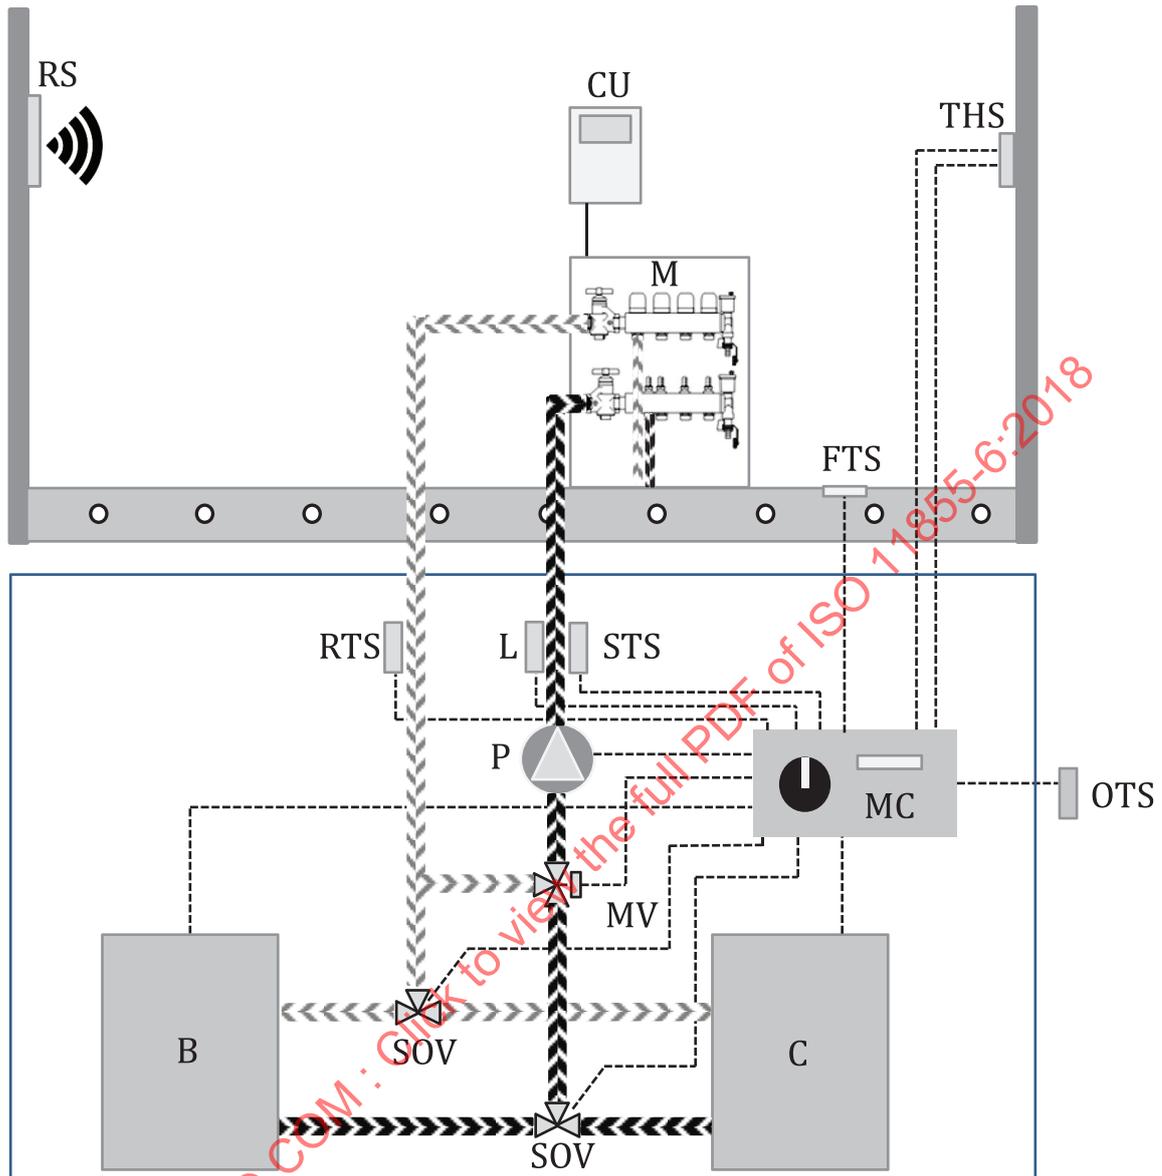**Key**

B	boiler	OTS	outside temperature sensor
C	chiller	P	pump
CU	control unit	RS	room sensor
FTS	floor temperature sensor	RTS	return medium temperature sensor
L	limiter	SOV	shut off valve
M	manifold	STS	supply medium temperature sensor
MC	main controller	THS	temperature-humidity sensor
MV	mixing valve		

Figure 1 — Principal of an embedded radiant heating and cooling system exemplified by a floor system

[Figure 1](#) shows the principles of control. The supply water temperature is controlled by a mixing valve, actuated to maintain the design condition. In the occupied space there is a sensor for temperature and humidity, which can be used for zone control and/or give input to the control of the mixing valve and provide information to the building management system (BMS) to determine space dew point temperature which is necessary to ensure condensation in the building (surface, construction). Outside

temperature sensors, supply-return water temperature sensors and in some cases surface temperature sensors are to be installed to influence the control. The control modes of panel systems are based on three system levels:

- a) Local (room) control, where the energy supplied to a room is controlled;
- b) Zone control normally consisting of several spaces (rooms);
- c) Central control where energy supplied to the whole building is controlled by a central system.

The control system classification is based on performance level:

- Manual: The energy supply to the conditioned space is only controlled by a manually operated device.
- Automatic: A suitable system or device automatically controls energy to the conditioned spaces.
- Timing: Function of energy supplied to a conditioned space is shut off or reduced during scheduled periods, e.g., night setback (not necessarily applicable for cooling).
- Advanced timing: Function of energy supply to the conditioned space is shut-off or reduced during scheduled periods, e.g., daytime with more expensive electricity tariff. Re-starting of the energy supply is optimized based on various considerations, including reduction of energy use (not applicable in commercial buildings).

4.2 Central control

The central control shall control the water temperature through the embedded system. In residential systems the control is normally done according to the outside climate (based on the heating/cooling curve, which is influenced by building mass, heat loss, and differences in heat required by the individual rooms).

To reduce losses in the distribution system the central control has to control according to outside temperature, i.e. higher water temperature for lower outside temperatures, for heating only.

Instead of controlling the supply water temperature it is recommended to control the water temperature θ_m (mean value of supply and return water temperature) according to outside and/or indoor temperatures. This is more directly related to the energy flux into the space. If during the heating period for example the internal load in the space increases, the heat output of the floor system will decrease and the return temperature will increase.

If the embedded system is operated intermittently (e.g. night and/or weekend set-back) the central control is also important for providing high enough water temperatures (Boost effect) during the pre-conditioning period in the morning. The energy savings by night set-back in residential buildings are, however, relatively low due to the high thermal insulation standard in new houses.

For commercial systems the control is normally done according to the heat loss or gain, and differences in heat or cooling required by the individual rooms which control the supply water temperature to the system.

For cooling it is also recommended to control the supply water temperature based on the zone with the highest dew point temperature. In many buildings with cooling, the internal load is of significant importance and it is recommended to let the room temperature and humidity of representative space influence the control of the water temperature.

Radiant surface cooling systems shall include controls to avoid condensation on internal cooled surfaces or condensation in critical parts of the building. This can be done by a central control of the supply water temperature and a limit on the minimum water temperature based on a measured dew point in the conditioned space.

4.3 Zone control

To optimize energy and control performance larger buildings should be divided in zones, where the individual spaces in each zone require about the same water temperature (north – south). An apartment or one-family house is normally regarded as one zone. The whole zone can be controlled with reference to a temperature sensor in a representative space of the zone.

4.4 Local (room) control

National building codes shall be followed regarding individual room control.

The installation of individual room temperature controls is recommended in order to improve comfort and for potential energy savings. Besides energy benefits it is essential for the thermal comfort of the occupants that they have a possibility for individual adjustment of the room temperature set-point from room to room.

In the case of a radiant surface heating systems, the valve (and then the water flow) on the manifold is controlled by a room sensor (wired or wireless). The wiring is often installed together with the main power wiring. Room sensors are therefore often installed near a switch for the main power (door), and not in a representative position of the occupied zone. In order to eliminate this problem, individual room temperature control systems, using a link based on radiofrequency transmission between the room sensors and the control valves ([Figure 1](#)), can improve the quality of the control.

In terms of comfort, it is preferable to control the room temperature as a function of the operative temperature in the area occupied by the person. Besides the position, it is important to consider the shape, size and colour (important for short wave radiation, sun lights) of the sensor in order to express convective and radiant heat exchange between sensor and space similarly as for the person (refer to EN 7726).

4.5 Influence of thermal mass of embedded systems

The heat capacity of surfaces with embedded pipes (e.g., as the floor screed), play a significant role for the thermodynamic properties of the heating system and hence for the control strategy. The temperature level of the heat carrier, the time response and the thermal capacity of systems will depend on the thickness of the surface layer where the pipes are embedded. The highest capacity involve systems E, F with slow response to load changes on water side in concrete core followed by Types A, C, D, B and the lowest capacity gain systems typed as G. In most cases the time constant of the building is several times higher than embedded systems.


The mass has a significant effect if a change in room temperature level is needed. On the other hand, regarding controlling for changes in external climate and internal loads (people, sun, etc.), all the systems are quite fast in response on the room side because of the self-regulating effect (see [4.6](#)).

4.6 Self-regulating effect

Due to the high impact that fast varying heat gains (e.g., sunshine through windows) may have on the room temperature, it is necessary that the heating system control compensate this by reducing or increasing the heat difference between room and heated/cooled surface and partly on the difference between room and the average temperature output. For a low temperature heating system and high temperature cooling systems such as embedded radiant systems, a significant effect is so called “self-regulating”. The “self-regulating” depends partly on the temperature in the layer, where the tubes are embedded. It means that fast change of operative temperature will equally change heat exchange and result in influence of total heat exchange (see [Figure 2](#)). This impact is bigger for systems with surface temperatures close to room temperature because the change of one degree represents a higher percentage based on a small temperature difference than on a high temperature difference.

The self-regulating effect of low temperature heating systems supports the control equipment (e.g. individual room temperature control) in maintaining a stable thermal environment providing comfort to the person in the room.

Figure 2 shows the “self-regulating” effect of a radiant floor for heating and cooling.

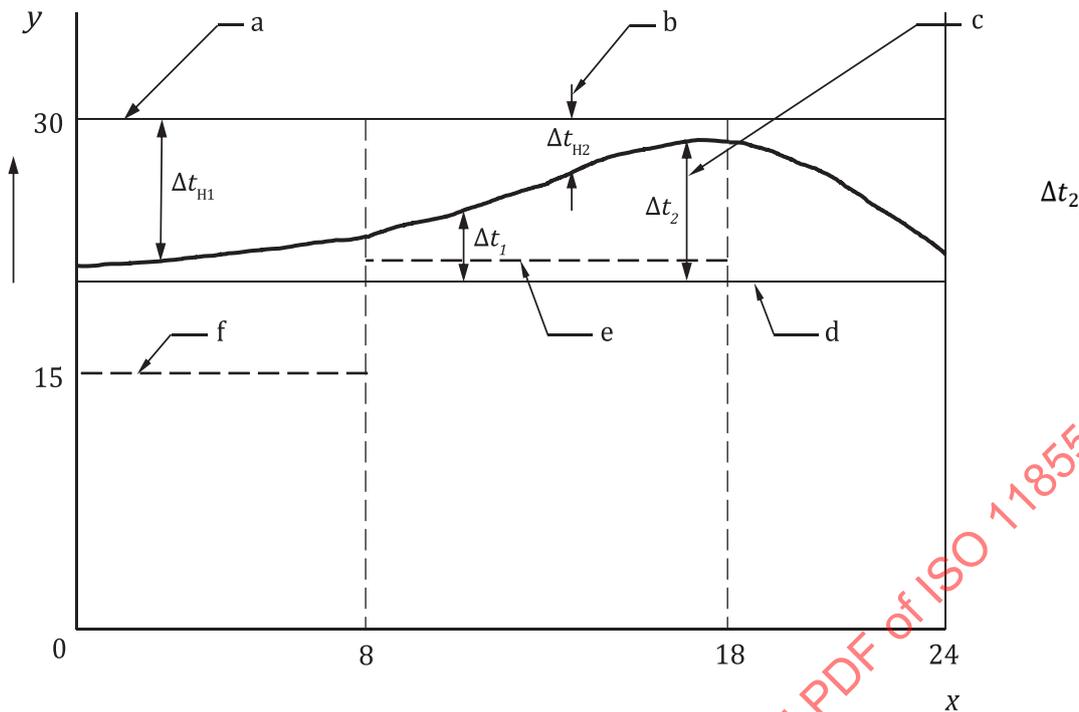

Key

- x hour
- y temperature
- a maximum floor surface temperature 28 °F
- b as Δt_{H2} decreases so does heat output
- c as Δt increases so does cooling output
- d 19 °C minimum cooling surface temperature
- e 20 °C minimum day temperature
- f 15 °C minimum night temperature

Figure 2 — Self-regulating effect of a radiant floor (surface temperature depend on the time)

4.7 Control of TABS

Individual room control is not advisable for TABS systems, but a zone control (south – north), where the supply water temperature, average water temperature or the flow rate may differ from zone to zone, is available. The zoning should consider the external and/or internal heat loads.

Relatively small temperature differences between the heated or cooled surface and the space are typical for TABS systems. This matter results in a significant degree of self-control. In specific cases by well-designed systems with low heating/cooling load, a concrete slab can be controlled at a near constant core (water) temperature year round. If, for example, the core is kept at 22 °C, the system will heat at room temperature below 22 °C and cool above the room temperature of 22 °C.

4.8 Flow control

Water-based floor heating systems need a hydronic balancing. The components have to be adjusted in order to ensure the required flow rates. Under dynamic conditions, e.g., during the heating up period, it shall be ensured that the hydraulic interaction between the different heating circles is small (the flow rates in the different circles should not be greater than the design flow rates). Depending on the situation of the heating system the floor heating distribution system shall be equipped with facilities for degassing and sludge separation.

Annex A (informative)

Control of radiant floor heating-cooling systems


A.1 Concepts

In conditioned spaces, the cooling power of radiant heat exchange may be limited to avoid condensation on the surface and in the building structure. The risk of indoor surface condensation is avoided in practice by limiting the supply water temperature according to the dew point temperature in the space, by maintaining the floor surface temperature above the space dew point temperature. Simultaneously dehumidifying the ventilation air to a certain level will result in lower dew point and higher cooling capacity, as the cooler temperature of the radiant surface increases radiation asymmetry and decreases operative temperature; precautions have to be taken in such a case so as to not exceed the comfort limits in the space. In particular, the temperature of the cooling surface should not be reduced below the limit of 17 °C and 19 °C for wall or ceiling and floor, respectively, and the indoor operative temperature should be controlled according to the standard required temperature.

A central control is also essential when using floor cooling. Due to the limitation of the cooling capacity a floor system will not always be able to control the room temperature at a fixed level. Basically the control should provide the maximum cooling power taking into account comfort (floor temperature, room temperature) and the risk for condensation (dew point temperature). The central control for floor cooling then has to take into account the dew point in the building/space when controlling the supply water temperature. This is done by adding a humidity sensor in the building/space connected to the central control unit.

A.2 Example of control system components

[Figure A.1](#) shows the control system components which comprise a closed circuit complete with circulating pumps. This circuit is connected to the supply and return header. The circuit is also provided with all the necessary isolating and balancing valves. There are two mixing pipes installed in the circuit. One is for heating and the other is for cooling. The heating mixing pipe is connected to a heating supply which can have a variable temperature together with a return. The cooling mixing pipe is connected to a cooling supply which can have a variable temperature together with a return.

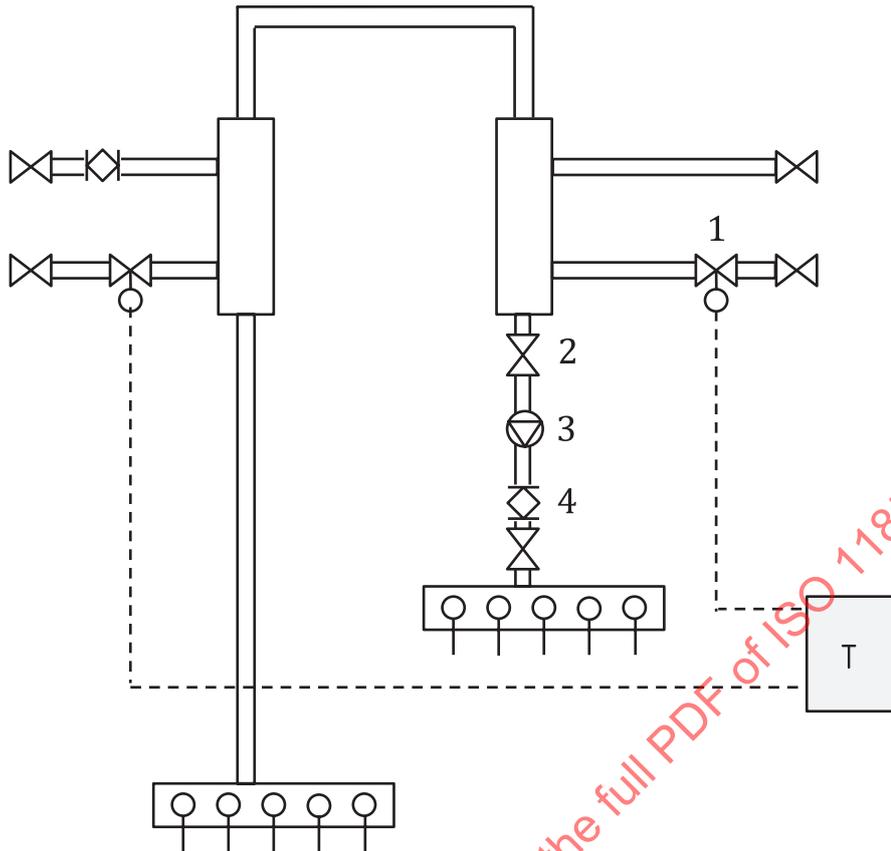

Key

- 1 control valve
- 2 valve
- 3 pump
- 4 balancing valve
- T temperature

Figure A.1 — typical radiant floor header connection

The performance of a radiant floor subjected to different solar radiation intensities will depend on the controllability of the radiant cooled floor to maintain certain conditions such as space temperatures and floor surface temperatures. Embedded systems with and without coverings have to be analysed to assess the influence of floor coverings.

A.3 Dew point

The floor surface temperature of the radiant floor cooling system is lower than the air temperature in the space. Therefore, if the surface temperature of the floor falls down below the space air dew point at any area, water falls out and the floor gets wet. The floor surface temperature is dependent on the water temperature at the specific area, the cooling load of this area and the distance between the tubes within the floor construction. Because of the distance between the tubes, the floor surface temperature is not uniform. It is recommended to select a minimal supply water temperature equal to the supposed maximal dew point temperature to avoid condensation on the floor surface and to guarantee the selected cooling capacity of the radiant system. Additionally, the supply water temperature should be controlled by a humidity control sensor.

If for any reason a water supply temperature below the supposed dew point is selected, the minimal possible surface temperature of the floor in areas with reduced loads shall be calculated carefully.

For example, when the indoor air is controlled at a dry bulb temperature of 24 °C and a relative humidity of 50 %, the suggested dew point is approximately 13 °C. Therefore, a minimal supply water temperature of 13 °C may be selected.

The combination of the radiant floor cooling system with a natural ventilation concept requires an accurate calculation of the maximal suggested dew points within the space, considering the outdoor air conditions as well as the latent loads of the space.

A.4 Supply water temperature

The supply water temperature of the radiant floor cooling system is a function of many aspects and decreases with increasing thermal resistance of the floor construction, increasing water temperature difference between supply and return water temperature, increasing cooling capacity and increasing distances between the water pipes.

It is recommended to select in a first step a supply water temperature equal to the maximum suggested dew point temperature of the space air, however usually not below 13 °C. The water temperature difference between supply and return may be selected as 3 K to 5 K. With these fixed values and the given or suggested floor construction, it is possible to calculate the maximum cooling capacity of the radiant floor system and the needed water flow rate.


If necessary, the supply water temperature, the temperature difference between supply and return as well as the pipe distance can be changed to achieve a maximum performance of the system.

A.4.1 Constant flow, variable supply water temperature

By maintaining a constant flow rate through the radiant loop it is possible to maintain the surface temperature at a constant, i.e., 20 °C, by varying the supply water temperature. The radiant floor pump can be provided with a single-speed motor and the floor surface temperature monitored by a surface-mounted temperature sensor. As the space-specific load and/or short-wave load decreases, the surface temperature will begin to decrease; the surface temperature can be maintained by allowing the supply water temperature to increase.

[Figure A.2](#) shows a plot of the surface temperature, supply and return water temperature at varying load conditions under this control strategy.

As expected, as the space load decreases so does the difference between the supply and return water temperature.

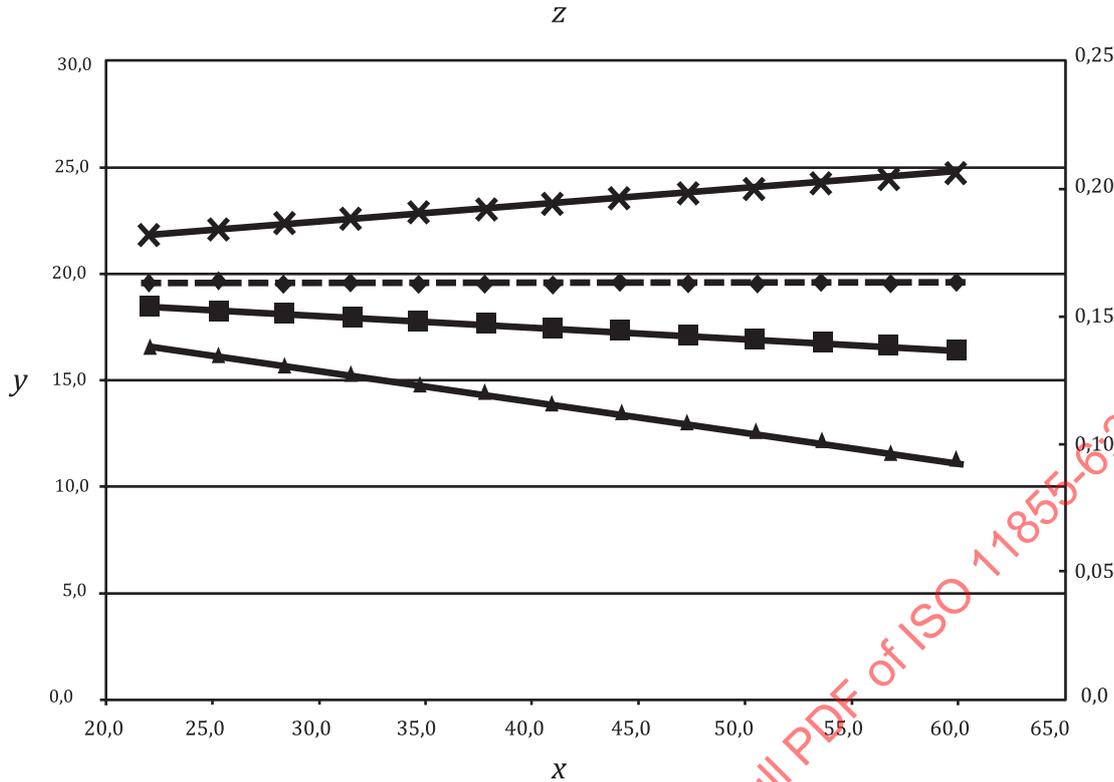

- Key**
- w flow rate in LPM/m²
 - x cooling load in W/m²
 - y Temperature in °C
 - z constant flow variable temperature
 - leaving water temperature
 - ▲ entering water temperature
 - × floor surface temperature
 - ◆ flow rate

Figure A.2 — Constant flow variable supply water temperature control strategy

A.4.2 Variable flow, constant supply water temperature

Alternatively, it is possible to vary the flow rate through the radiant loop while maintaining a constant supply water temperature. This control strategy requires a variable-speed motor and controls for a very small motor. It would still be possible to track the volume flow rate against the surface temperature and adjust the flow as the specific space load changed.

Figure A.3 shows a plot of the surface temperature supply and return water temperature at varying load conditions under this control strategy.

Again, as expected, the difference between the supply and return water temperature decreases with the space load. Compared with the control strategy shown in Figure A.3, the difference for the minimum operating point of a variable-volume control strategy is considerably higher than with a constant volume, variable supply water temperature strategy; 17 °C, 6 °C respectively.