
Fans — Efficiency classification for fans —

**Part 3:
Fans without drives at maximum
operating speed**

Ventilateurs — Classification du rendement des ventilateurs —

Partie 3: Ventilateurs non entraînés à vitesse maximale de fonctionnement

STANDARDSISO.COM : Click to view the full PDF of ISO 12759-3:2019



STANDARDSISO.COM : Click to view the full PDF of ISO 12759-3:2019



COPYRIGHT PROTECTED DOCUMENT

© ISO 2019

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Symbols and units	2
5 General information	2
5.1 General	2
5.2 Use of test configurations	3
5.3 Tolerances	4
6 Efficiency grade evaluation	4
Annex A (informative) Energy efficiency grades for fans without drives	6

STANDARDSISO.COM : Click to view the full PDF of ISO 12759-3:2019

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 117, *Fans*.

This first edition cancels and replaces ISO 12759:2010, which has been technically revised. It also incorporates the Amendment ISO 12759:2010/Amd.1:2013.

A list of all parts in the ISO 12759 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Introduction

The last decade has seen both an escalation in the price and an increasing recognition of the finite life of many of the fossil fuels currently used. There is also a belief by many that climatic change is due to increasing levels of carbon dioxide in the atmosphere. This has led to many nations reviewing methods of energy generation and usage.

To maintain economic growth there is therefore a need to promote energy efficiency. This requires better selection of equipment by users and thus better design of this equipment by its manufacturers.

Fans of all types are used for ventilation and air conditioning, for process engineering (drying, pneumatic conveying and combustion air supply) and for agriculture. Indeed, energy usage by fans has been calculated to be nearly 20 % of total worldwide energy usage.

The fan industry is of a global nature, with a considerable degree of exporting and licensing. To ensure that the defining fan performance characteristics are common throughout the world a series of standards have been developed. It is the belief of the industry that there is now a need for minimum efficiency standards to be recognized. To encourage their implementation, a classification system is proposed which incorporates a series of efficiency bands. With improvements in technology and manufacturing processes, the minimum efficiency levels can be reviewed and increased in time.

There have been comments concerning the long-standing definition of wide bands used in this document so that, for example, a fan measured as having an efficiency of 68 % is classified as belonging to class FEG71. In other parts of the ISO 12759 series fans are classified as belonging to a certain class only if the measured value is equal to or greater than the class number.

Work is being undertaken to reach a more common approach between the various parts of the ISO 12759 series, for example by renaming the classes or by introducing narrower classes, so that a fan measured with an efficiency of 68 % is said to belong to class FEG68.

[STANDARDSISO.COM](https://standardsiso.com) : Click to view the full PDF of ISO 12759-3:2019

Fans — Efficiency classification for fans —

Part 3:

Fans without drives at maximum operating speed

1 Scope

This document establishes a system for the classification of fan efficiency for all fan types which have a nominal fan shaft power rating of 0,125 kW and above. This document is applicable to fans only. It does not apply to drives or the system in which fans are installed. This document can be used by legislators or regulatory bodies for defining future energy saving targets.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 5801:2017, *Fans — Performance testing using standardized airways*

ISO 13348:2007, *Industrial fans — Tolerances, methods of conversion and technical data presentation*

ISO 13349, *Fans — Vocabulary and definitions of categories*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

3.1 fan

rotary bladed machine which receives mechanical energy and utilizes it by means of one or more impellers fitted with blades to maintain a continuous flow of air or other gas passing through it and whose work per unit mass does not normally exceed 25 kJ/kg

Note 1 to entry: Fans are defined according to their test configuration, function, fluid path and operating conditions (see ISO 13349).

3.2 fan size

nominal diameter of the impeller

3.3 drive

mechanism used to power the fan

Note 1 to entry: A drive can include the motor and any combination of devices such as couplings and mechanical or electrical transmissions such as belts, chains, gears and variable frequency drives (VFDs).

3.4

fan without drives

fan without attachments or accessories

Note 1 to entry: See [Figure 1](#).

3.5

optimum efficiency

maximum efficiency achieved on the fan air characteristic with all operational parameters, except the air system resistance, being fixed

3.6

fan efficiency grade

FEG

value detailing the efficiency metric for a fan without drives

4 Symbols and units

The following primary symbols and units for the parameters listed shall be used.

Symbol	Term	Unit
d	Fan size (diameter)	mm
η_{opt}	Optimum efficiency	Expressed as a decimal ^a
^a Efficiency in percent (%) divided by 100 equals the efficiency expressed as a decimal.		

5 General information

5.1 General

Fans range from the purpose-built single fan to the series produced certified ranges manufactured in large quantities. A fan may be an impeller on a shaft with no drive mechanism attached (fan without drive), [Figure 1](#).

The variation in design has led to efficiency being defined in a number of ways to suit the demands of the fan type and the market place.

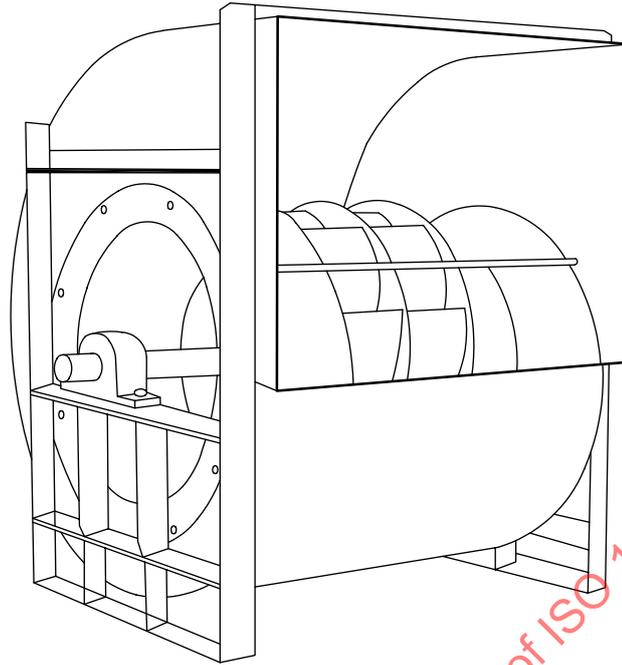


Figure 1 — An example of a centrifugal fan without drives

5.2 Use of test configurations

The manufacturer shall choose the most appropriate test configuration and declare it on the test report.

To determine the operating point of the fan, four test configurations (A, B, C and D) shall be considered, see [Figure 2](#). The following test methods specified in ISO 5801:2017, 11.3 to 11.6 shall be used:

- Category A installations;
- Category B installations;
- Category C installations;
- Category D installations.

The standardised test configuration used for rating the fan shall be clearly stated.

Test configuration E, see ISO 13349, is not included in this document.

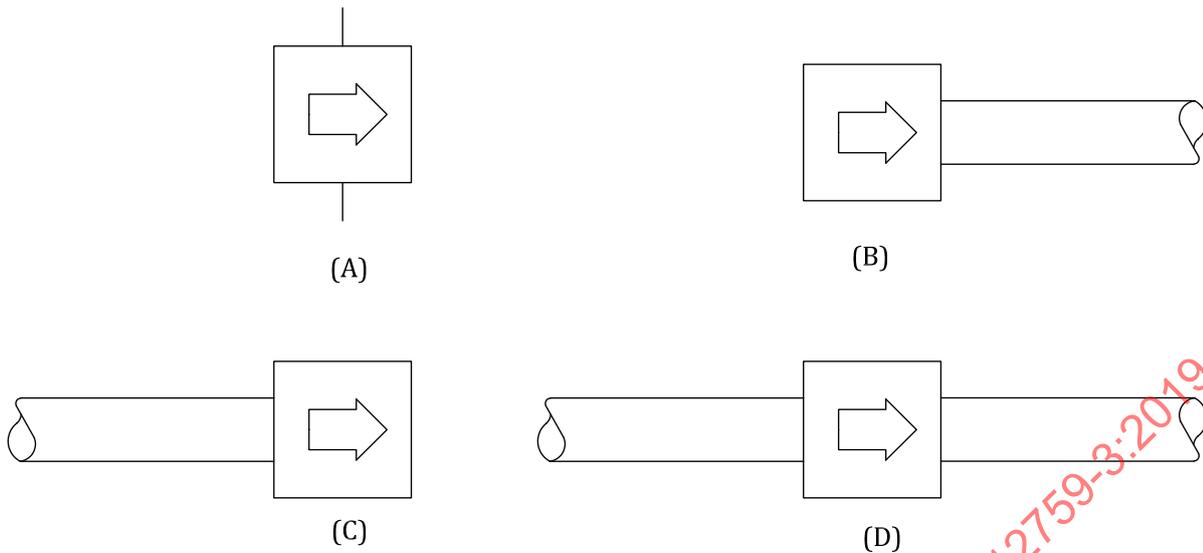


Figure 2 — Test configurations

5.3 Tolerances

For the purposes of this document the tolerances given in ISO 13348:2007, Clauses 5 and 6 shall apply.

6 Efficiency grade evaluation

The variation of fan type and drive option leads to efficiency being derived in different ways.

When the efficiency of the fan alone is required on a driven unit (ISO 12759-4¹⁾) then [Figure 3](#) still applies. In these cases the motor efficiency may be obtained from a dynamometer test or by calibrated motor performance curves.

The following is a guide to the optimum efficiency (best efficiency point) levels that are achievable by the fan types addressed by this document. The minimum levels of acceptability are dependent on consultation between regulators and manufacturers' representatives or local legislation where this exists.

The efficiency grade for a fan is based on its performance characteristics at maximum permissible rotational speed to obtain its best efficiency point.

A number of fixed efficiency grades are defined based on fan diameter and optimum efficiency.

[Formula \(A.1\)](#) in [Annex A](#) defines an efficiency boundary as a function of impeller diameter.


The fan belongs to a given efficiency grade if its efficiency at its best efficiency duty point is equal to or lower than the efficiency value calculated along its efficiency boundary for its grade, based on fan diameter, and above the value provided for the efficiency boundary calculated for the grade immediately below.

The relationship between the fan efficiency grade (FEG) and fan size is shown in [Figure 3](#).

The efficiency grade is based on the optimum (peak) efficiency of the fan.

In simple terms a fan belongs to an FEG (e.g. FEG85) if its efficiency, at best efficiency duty and maximum speed, is below the curve according to its designation, but above the next curve beneath (e.g. FEG80). An example of how to calculate the efficiency grade is given in [Annex A](#).

1) Under preparation. Stage at the time of publication: ISO/DIS 12759-4:2019.

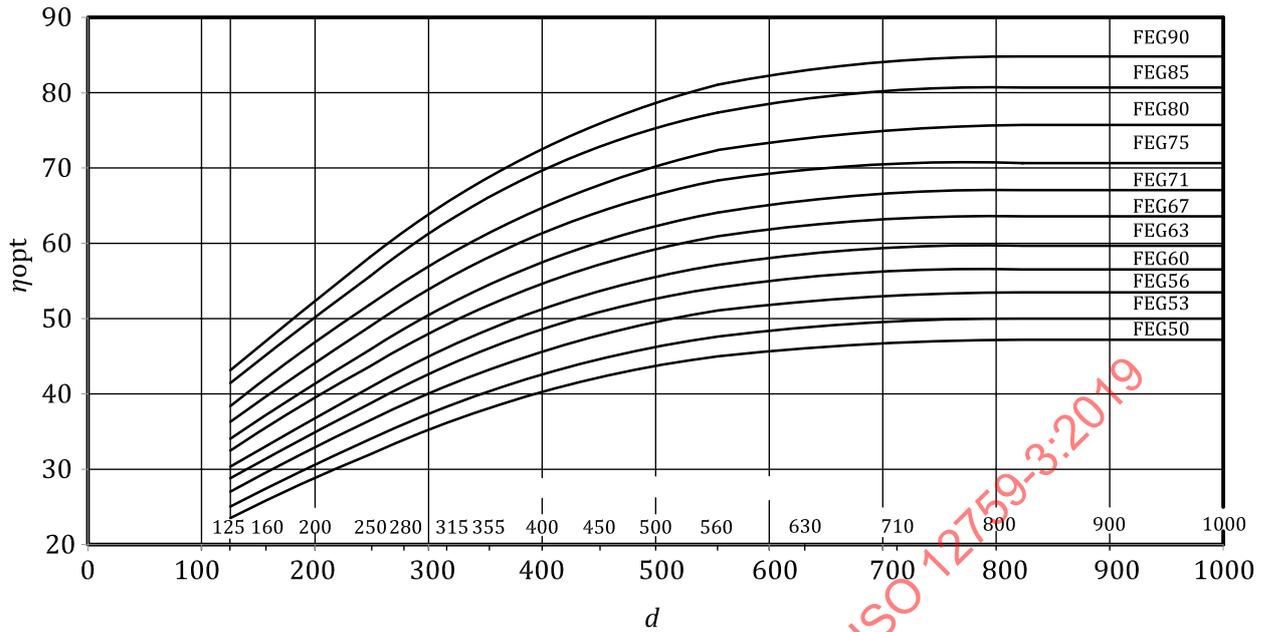

Key

- d (lower scale) fan size (mm)
- d (upper scale) fan size in preferred numbers (mm)
- η_{opt} optimum (peak) fan efficiency (%)

NOTE 1 Fan size is the nominal impeller diameter.

NOTE 2 The optimum (peak) fan efficiency can be calculated from the total fan pressure or from the effective fan pressure (see ISO 5801:2017, Annex A).

NOTE 3 The FEG label for a given fan size is assigned when the optimum (peak) fan efficiency is equal to or lower than the efficiency at the grade upper limit and higher than the efficiency at the grade lower limit for the fan size.

NOTE 4 No label is considered for fans with an optimum (peak) efficiency below FEG50.

NOTE 5 For any fan size larger than 1 000 mm the values of the grade limits are the same as for a fan size of 1 000 mm.

NOTE 6 If this method is used for a direct driven fan without the shaft and bearings integral to the fan, the fan efficiency is the impeller efficiency.

Figure 3 — Fan efficiency grades (FEGs) for fans without drives

The incremental efficiency grades for fans without drives are given in [Table A.2](#). An explanation of how to determine the FEG is given in [Annex A](#).

Annex A (informative)

Energy efficiency grades for fans without drives

A.1 General

The calculation of the upper limit efficiencies of the grade FEG85 is based on a datum fan diameter, d_0 , of 1 016 mm, and a series of constants given in Table A.1, using the fan size d as the independent variable. The limit is given by [Formula \(A.1\)](#).

$$\eta_{\text{opt } 85_d^{\text{upp}}} = k_0 + \left[81 + \frac{d}{k_1} - \left(\frac{d}{k_2} \right)^2 \right]^{0,5} - 112 \exp\left(-\frac{d_0}{k_3} \right) \tag{A.1}$$

where

- $\eta_{\text{opt } 85_d^{\text{upp}}}$ is efficiency value at the upper limit of FEG85 for a given fan size;
- d is fan size (impeller diameter) in mm;
- exp is exponential;
- d_0 is base fan size (impeller diameter): 1 016 mm;
- k_0, k_1, k_2, k_3 are constants.

Table A.1 — Constants for defining the upper efficiency limit of FEG85

Constant	Constant definition mm
d_0	1 016 (exactly)
k_0	$10 \left[1 + \left(\frac{37}{40} \right) \right] - 15 + 112 \exp\left(-\frac{d_0}{k_3} \right)$
k_1	$\frac{793,75}{15^2} = 3,527\bar{7}$
k_2	$\frac{1\,270}{15} = 84,6\bar{6}$
k_3	113,92 (exactly)

It is advisable to use the constants as they are defined rather than using their rounded values.