

---

---

**Ceramic tiles — Grouts and adhesives —**

Part 5:

**Requirements, test methods,  
evaluation of conformity,  
classification and designation  
of liquid-applied waterproofing  
membranes for use beneath ceramic  
tiling bonded with adhesives**

*Carreaux céramiques — Mortiers de joints et colles —*

*Partie 5: Exigences, méthodes d'essai, évaluation de conformité,  
classification et la désignation des membranes liquides étanches à  
l'eau appliquées pour la pose de carreaux céramiques*



STANDARDSISO.COM : Click to view the full PDF of ISO 13007-5:2015



**COPYRIGHT PROTECTED DOCUMENT**

© ISO 2015, Published in Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
Ch. de Blandonnet 8 • CP 401  
CH-1214 Vernier, Geneva, Switzerland  
Tel. +41 22 749 01 11  
Fax +41 22 749 09 47  
copyright@iso.org  
www.iso.org

# Contents

	Page
Foreword .....	iv
<b>1 Scope</b> .....	<b>1</b>
<b>2 Normative references</b> .....	<b>1</b>
<b>3 Terms and definitions</b> .....	<b>2</b>
<b>4 Requirements</b> .....	<b>2</b>
<b>5 Evaluation of conformity</b> .....	<b>3</b>
5.1 General .....	3
5.2 Reaction to fire .....	3
<b>6 Classification and designation</b> .....	<b>3</b>
<b>7 Marking and labelling</b> .....	<b>5</b>
<b>Annex A (normative) Test methods</b> .....	<b>6</b>
<b>Bibliography</b> .....	<b>19</b>

STANDARDSISO.COM : Click to view the full PDF of ISO 13007-5:2015

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see [www.iso.org/directives](http://www.iso.org/directives)).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see [www.iso.org/patents](http://www.iso.org/patents)).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the WTO principles in the Technical Barriers to Trade (TBT) see the following URL: [Foreword - Supplementary information](#)

The committee responsible for this document is ISO/TC 189, *Ceramic tile*.

ISO 13007 consists of the following parts, under the general title *Ceramic tiles — Grouts and adhesives*:

- *Part 1: Terms, definitions and specifications for adhesives*
- *Part 2: Test methods for adhesives*
- *Part 3: Terms, definitions and specifications for grouts*
- *Part 4: Test methods for grouts*
- *Part 5: Requirements, test methods, evaluation of conformity, classification and designation of liquid-applied waterproofing products for use beneath ceramic tiling bonded with adhesives*

# Ceramic tiles — Grouts and adhesives —

## Part 5:

# Requirements, test methods, evaluation of conformity, classification and designation of liquid-applied waterproofing membranes for use beneath ceramic tiling bonded with adhesives

## 1 Scope

This part of ISO 13007 gives terminology concerning the products, and specifies test methods (see [Annex A](#)) and values of performance requirements, for liquid-applied waterproofing products associated with tile adhesives. It specifies the evaluation of conformity and the classification and designation of liquid-applied waterproofing products beneath ceramic tiling.

It is applicable to all liquid-applied waterproofing membranes — including polymer modified cementitious coatings, dispersions and reaction resin coatings — used beneath ceramic tiling for internal and external tile installations on walls and floors.

NOTE Liquid-applied waterproofing products can also be used beneath other types of tiles (natural and agglomerated stones, etc.), as long as an adverse reaction does not occur between the membrane and the alternative tile.

## 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 13006, *Ceramic tiles — Definitions, classification, characteristics and marking*

ISO 13007-1, *Ceramic tiles — Grouts and adhesives — Part 1: Terms, definitions and specifications for adhesives*

ISO 13007-2, *Ceramic tiles — Grouts and adhesives — Part 2: Test methods for adhesives*

ISO 15605, *Adhesives — Sampling*

EN 196-1, *Methods of testing cement — Part 1: Determination of strength*

EN 197-1, *Cement — Part 1: Composition, specifications and conformity criteria for common cements*

EN 480-1:2006, *Admixture for concrete, mortar and grout — Test methods — Part 1: Reference concrete and mortar for testing*

EN 1008, *Mixing water for concrete — Specification for sampling, testing and assessing the suitability of water, including water recovered from processes in the concrete industry, as mixing water for concrete*

EN 1067, *Adhesives — Examination and preparation of samples for testing*

EN 12390-2, *Testing hardened concrete — Making and curing specimens for strength tests*

EN 12620, *Aggregates for concrete*

### 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

**3.1 liquid-applied waterproofing membrane**  
single- or multi component waterproofing material applied in a uniform layer or layers, beneath ceramic tiling

Note 1 to entry: The final waterproofing membrane can include a reinforcing cloth or mesh.

**3.2 polymer modified cementitious liquid-applied waterproofing membrane**  
**CM**  
mixture of hydraulic binding agents, aggregates and organic additives that has only to be mixed with water or liquid admixture just before use

**3.3 dispersion liquid-applied waterproofing membrane**  
**DM**  
mixture of organic binding agent(s) in the form of an aqueous polymer dispersion, organic additives and mineral fillers

Note 1 to entry: The mixture is ready for use.

**3.4 reaction resin liquid-applied waterproofing membrane**  
**RM**  
mixture of synthetic resin, mineral fillers and organic additives in which hardening occurs by chemical reaction

Note 1 to entry: They are available in one or more component forms.

**3.5 crack bridging ability**  
ability of the cured waterproofing material to withstand propagation of cracks without deterioration

**3.6 primer**  
liquid coating applied to the surface, prior to the application of a liquid waterproofing product, to improve adhesion and durability of the bond between the substrate and the membrane

**3.7 fundamental characteristics**  
characteristics that a liquid-applied waterproofing membrane product always needs to have

**3.8 optional characteristics**  
characteristics for specific service conditions where enhanced levels of performance are required or which provide further information about its general performance

### 4 Requirements

The liquid-applied waterproofing membrane products shall comply with the characteristics specified in [Table 1](#).

[Table 2](#) gives the additional characteristics that might be required for special service conditions.

The amount of water and/or liquid admixture required for preparing the cementitious liquid-applied water waterproofing membrane shall be the same for all tests of that product.

**Table 1 — Product requirements — Fundamental characteristics**

Characteristic	Requirement	Test method
Initial tensile adhesion strength	≥ 0,5 N/mm <sup>2</sup>	<a href="#">A.6.2</a>
Tensile adhesion strength after water contact	≥ 0,5 N/mm <sup>2</sup>	<a href="#">A.6.3</a> or <a href="#">A.6.4</a>
Tensile adhesion strength after heat ageing	≥ 0,5 N/mm <sup>2</sup>	<a href="#">A.6.5</a>
Tensile adhesion strength after freeze-thaw cycles	≥ 0,5 N/mm <sup>2</sup>	<a href="#">A.6.6</a>
Tensile adhesion strength after contact with lime water	≥ 0,5 N/mm <sup>2</sup>	<a href="#">A.6.9</a>
Waterproofing	No visual penetration below membrane and ≤ 20 g weight gain	<a href="#">A.7</a>
Crack bridging ability under standard conditions	≥ 0,75 mm	<a href="#">A.8.2</a>

**Table 2 — Product requirements — Optional characteristics**

Characteristic	Requirement	Test method
Tensile adhesion strength after contact with chlorinated water	≥ 0,5 N/mm <sup>2</sup>	<a href="#">A.6.7</a> or <a href="#">A.6.8</a>
Crack bridging ability at low temperature (- 5°C)	≥ 0,75 mm	<a href="#">A.8.3</a>
Crack bridging ability at very low temperature (- 20°C)	≥ 0,75 mm	<a href="#">A.8.3</a>

## 5 Evaluation of conformity

### 5.1 General

The liquid-applied waterproofing membrane shall be considered conformant if test results indicate compliance with all of the fundamental characteristics listed in [Table 1](#). For those products claiming the optional classifications in [Clause 5](#), test results must also indicate compliance with the optional characteristics listed in [Table 2](#).

### 5.2 Reaction to fire

Reaction to fire may be of concern in individual countries, and may need to be considered in light of local standards or regulatory requirements

## 6 Classification and designation

The liquid-applied waterproofing membranes are classified into one of the three types, according to the definitions given in [Clause 3](#):

- CM** cementitious liquid-applied waterproofing membrane;
- DM** dispersion liquid-applied waterproofing membrane;
- RM** reaction resin liquid-applied waterproofing membrane.

For each type it is possible to have different classes, related to the different optional characteristics given in [Table 2](#). These classes are designated by the following abbreviations:

- O1** with improved crack bridging ability at -5°C;
- O2** with improved crack bridging ability at -20°C;
- P** resistant to contact with chlorinated water (i.e. for use in swimming pools).

The product is designated by the symbol for the type (CM, DM or RM), followed by the abbreviation of the class or classes it belongs to. [Table 3](#) describes the designation of the products types and classes which shall be used.

**Table 3 — Classification and designation of liquid-applied waterproofing membranes**

Symbol		Description
Type	Class	
CM		Normal cementitious liquid-applied waterproofing membrane
DM		Normal dispersion liquid-applied waterproofing membrane
RM		Normal reaction resin liquid-applied waterproofing membrane
CM	01	Cementitious liquid-applied waterproofing membrane with crack bridging ability at low temperature (-5°C)
CM	02	Cementitious liquid-applied waterproofing membrane with crack bridging ability at low temperature (-20°C)
DM	01	Dispersion liquid-applied waterproofing membrane with crack bridging ability at low temperature (-5°C)
DM	02	Dispersion liquid-applied waterproofing membrane with crack bridging ability at low temperature (-20°C)
RM	01	Reaction resin liquid-applied waterproofing membrane with crack bridging ability at low temperature (-5°C)
RM	02	Reaction resin liquid-applied waterproofing membrane with crack bridging ability at low temperature (-20°C)
CM	P	Cementitious liquid-applied waterproofing membrane resistant to contact with chlorinated water
DM	P	Dispersion liquid-applied waterproofing membrane resistant to contact with chlorinated water
RM	P	Reaction resin liquid-applied waterproofing membrane resistant to contact with chlorinated water
CM	01P	Cementitious liquid-applied waterproofing membrane with crack bridging ability at low temperature (-5°C) and resistant to contact with chlorinated water
CM	02P	Cementitious liquid-applied waterproofing membrane with crack bridging ability at low temperature (-20°C) and resistant to contact with chlorinated water
DM	01P	Dispersion liquid-applied waterproofing membrane with crack bridging ability at low temperature (-5°C) and resistant to contact with chlorinated water
DM	02P	Dispersion liquid-applied waterproofing membrane with crack bridging ability at low temperature (-20°C) and resistant to contact with chlorinated water
RM	01P	Reaction resin liquid-applied waterproofing membrane with crack bridging ability at low temperature (-5°C) and resistant to contact with chlorinated water
RM	02P	Reaction resin liquid-applied waterproofing membrane with crack bridging ability at low temperature (-20°C) and resistant to contact with chlorinated water

## 7 Marking and labelling

Products complying with the requirements of this part of ISO 13007 shall be clearly marked with the following information:

- a) name of the product;
- b) manufacturer's mark and place of origin;
- c) date or code of production, shelf life and conditions of storage;
- d) dated reference to this part of ISO 13007, i.e. ISO 13007-5:2015;
- e) type of product according to [Clause 6](#) and using symbols given in [Clause 6](#);
- f) instructions for use:
  - mix proportions (where applicable);
  - maturing time (where applicable);
  - pot life;
  - mode of application (including recommended primer and/or reinforcement mesh);
  - minimum quantity or thickness of the product as applied wet as well as the final cured film thickness;
  - delay for installing ceramic tiles;
  - suitable adhesive(s), type and class in accordance with ISO 13007-1;
  - field of application (internal, external, wall, floor etc.)

In the designation of a liquid-applied waterproofing membrane, information about special properties may also be included when the product is intended for use in specific applications.

This information shall be marked on the packaging and/or on the product's technical data sheet.

NOTE This does not remove the requirement that all manufacturers claiming compliance with this part of ISO 13007 state declared values for the properties of their products, when required.

## Annex A (normative)

### Test methods

#### A.1 Sampling

Take a sample of at least 2 kg of the product to be tested in accordance with ISO 15605 and EN 1067.

#### A.2 Test conditions

Standard conditions shall be  $(23 \pm 2)$  °C and  $(50 \pm 5)$  % relative humidity (RH) and a circulation of air in the working area less than 0,2 m/s.

When the test specimens have to be conditioned according to the test method, the tolerances in the time of conditioning for all test specimens shall be as follows:

Conditioning	Tolerance
24 h	±0,5 h
7 days	±3 h
14 days	±6 h
21 days	±9 h
28 days	±12 h

#### A.3 Test materials

##### A.3.1 General

Condition all test materials for at least 24 h under standard conditions. The materials to be tested shall be within their shelf life.

##### A.3.2 Ceramic tiles

The tiles shall be clean and dry.

The tiles used for this method shall be of

**Type Bia**, fully vitrified tile complying with ISO 13006, with a water absorption  $\leq 0,5$  % by mass, unglazed and with a plain adhering surface, with facial dimensions of  $(50 \pm 1)$  mm  $\times$   $(50 \pm 1)$  mm.

##### A.3.3 Test substrate

###### A.3.3.1 Concrete slab

The concrete slab shall comply with ISO 13007-2.

### A.3.3.2 Other substrates (optional)

Other substrates may be used upon agreement if the substrate is recommended for the ceramic tile application by the manufacturer. To demonstrate compatibility with other optional substrates, the product shall be applied to the selected substrate in accordance with the initial adhesion test method (A.6.2). When a result of  $\geq 0,5$  N/mm<sup>2</sup> is achieved or cohesive failure occurs in the substrate, the requirement is considered satisfied.

### A.3.4 Ceramic tile adhesive

The ceramic tile adhesive shall comply with ISO 13007-1.

### A.3.5 Sodium hypochlorite

Analytical grade sodium hypochlorite.

## A.4 Apparatus

### A.4.1 Weight

A weight of less than 50 mm × 50 mm cross-sectional area, capable of exerting a force of  $(20 \pm 0,05)$  N.

### A.4.2 Pull head plates

Square metallic plates, with dimensions of 50 mm × 50 mm and a minimum thickness of 10 mm with a suitable fitting for connection to the test machine.

### A.4.3 Machine for pull testing

A test machine for direct pull tensile force test and with suitable capacity and sensitivity for the test. The machine shall be capable of applying the load to the pull-head plate at the rate of  $(250 \pm 50)$  N/s through a suitable fitting that does not exert any bending force.

### A.4.4 Air-circulating oven

An air-circulating oven capable of controlling the temperature to within  $\pm 3$  °C.

### A.4.5 Mould

The mould shall consist of six horizontal compartments so that six prismatic specimens  $(12 \pm 0,1)$  mm ×  $(40 \pm 1)$  mm ×  $(160 \pm 1)$  mm, with a square hole, with  $(4 \pm 0,1)$  mm side, in the middle of the narrowest face, can be prepared simultaneously. In order to avoid the sliding of the sample in the dynamometer, the ends of the specimen shall be greater than the middle (see Figure A.1) and a clamp as shown in Figure A.2 shall be used.

Dimensions in millimetres

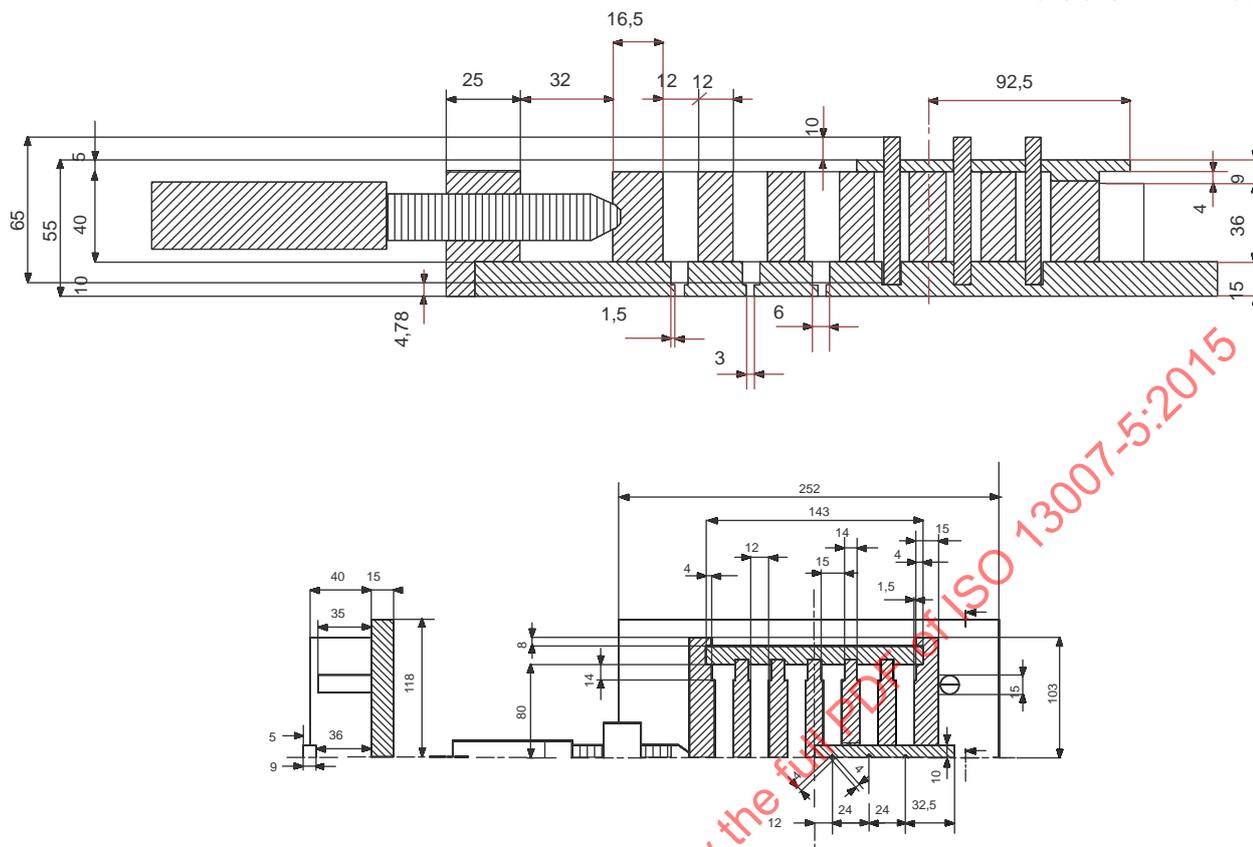


Figure A.1 Mould

STANDARDSISO.COM : Click to view the full PDF of ISO 13007-5:2015



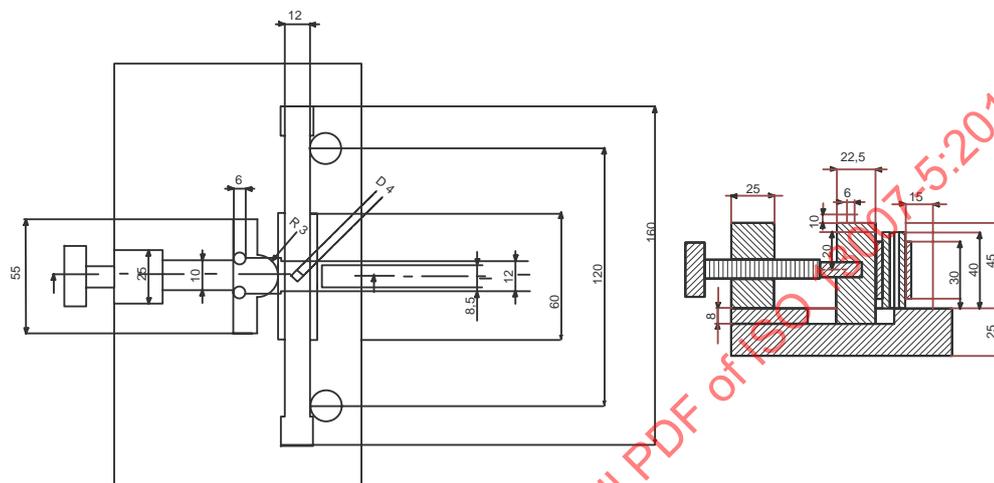
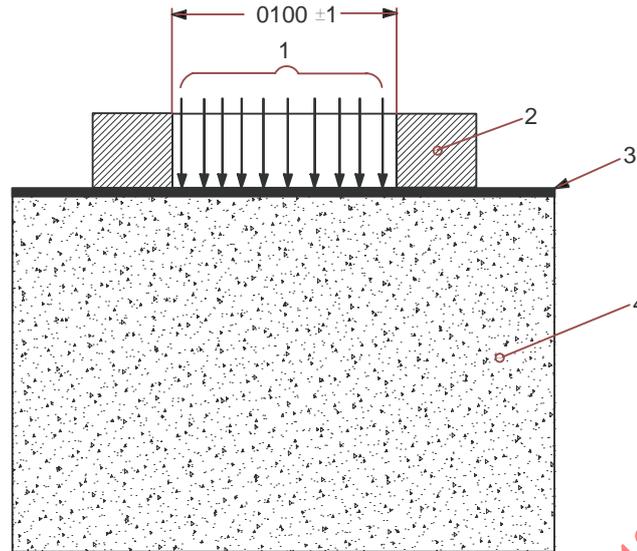


Figure A.3 — Jig

#### A.4.7 Equipment for permeability test

Any equipment which permits the specified specimen (A.7) to be placed in such a way that the water pressure acts from above the specimen. The machine shall permit the unexposed faces to be observed to detect any possible sign of water permeation (see Figure A.4). The internal diameter of the sealing ring shall be  $(100 \pm 1)$  mm.

**Key**

- 1 water pressure
- 2 sealing ring
- 3 liquid-applied waterproofing membrane
- 4 concrete slab

**Figure A.4 — Typical arrangement for determining the waterproofing**

**A.4.8 Machine for tensile testing**

A machine for tensile testing, capable of measuring the elongation with a precision of 0,01 mm and the load with a precision of 1 N.

**A.5 Mixing of liquid-applied waterproofing membrane**

To prepare the cementitious, dispersion or reaction resin liquid waterproofing membrane: follow the manufacturer's instructions.

The amount of water and/or liquid admixture required for preparing the cementitious waterproofing membrane shall be as stated by the manufacturer in parts by mass, i.e. liquid to dry powder (if a range of values is given, the arithmetic mean shall be used).

The amount of water and/or liquid admixture required for preparing the product shall be the same for all tests of that product.

**A.6 Adhesion tests****A.6.1 Preparation of test units**

Apply the liquid waterproofing membrane to the surface of the substrate (A.3.3) in accordance with the manufacturer's instructions, including a primer if required. Where recommended, the waterproofing membrane material should be applied in two or more layers, inserting if requested a reinforcing cloth or mesh. With some products, a sprinkling of silica sand into the top layer is required to improve adhesion to the surface.

Before applying the adhesive, allow the coated concrete slabs to dry under standard conditions for at least 24 h, unless the manufacturer gives different instructions.

Apply a thin layer of the adhesive to the waterproofing membrane product with a straight edge trowel. Then apply a thicker layer and comb with a notched trowel having 6 mm × 6 mm notches at 12 mm centres.

After 5 min place nine type BI<sub>a</sub> tiles on the adhesive at a distance apart of 50 mm and load each tile with (20 ± 0,05) N for 30 s.

The trowel shall be held at an angle of approximately 60° to the substrate at a right angle to one edge of the slab and drawn across the slab parallel to that edge, in a straight line. The adhesive between the tiles must not be removed.

### A.6.2 Initial adhesion

Prepare the test units in accordance with [A.6.1](#).

After 27 days bond the pull head plates to the tiles with a suitable high strength adhesive (e.g. epoxide).

After a total of 28 days storage under standard conditions determine the tensile adhesion strength by applying a force at a constant rate of (250 ± 50) N/s. Before the bond strength is determined, the sample surface shall be cut through to the surface of the concrete slab, around the perimeter of each tile.

Report the results in newtons (N).

### A.6.3 Adhesion strength after water contact

Prepare the test units in accordance with [A.6.1](#). Then, form an upstand, approximately 10 mm high, around the perimeter of the upper surface of the coated slab by applying, for example, a bead of silicone sealant. Condition the test units under standard conditions for 7 days.

Fill the reservoir formed by the sealant upstand to about 6 mm depth of water at the standard temperature. After 20 days, during which time the water level should be maintained at about 6 mm, pour away the water and wipe the surface of the test piece tiles dry with a cloth, before bonding the pull head plates to the tiles. After a further 7 h, fill the reservoir with a 6 mm depth of water at the standard temperature once again.

The following day pour away the water and immediately carry out the tensile adhesion test in accordance with [A.6.2](#).

Report the results in newtons (N).

### A.6.4 Alternative method for adhesion strength after water contact

Prepare the surface of the test units in accordance with [A.6.1](#).

All remaining faces of the slab, including the underside, shall then be sealed with an impervious, waterproof coating material, such as an epoxide or polyester based product, ensuring complete integrity of the coating on all the edges and at the junction with the liquid-applied waterproofing membrane on the upper face.

Condition the test units under standard conditions for 7 days and immerse them in water at the standard temperature.

After 20 days remove the test units from the water, wipe with a cloth and bond the pull head plates to the tiles. After a further 7 h immerse the test units in water at the standard temperature.

The following day remove the test units from water and immediately carry out the tensile adhesion test in accordance with [A.6.2](#).

### A.6.5 Adhesion strength after heat ageing

Prepare the test units in accordance with [A.6.1](#).

Condition the test units under standard conditions for 14 days and then place them in an air-circulating oven at  $(70 \pm 3)^\circ\text{C}$  for a further 14 days. Remove from the oven and bond the pull head plates to the tiles with a suitable high strength adhesive (e.g. epoxide).

Condition the test units for a further 24 h under standard conditions.

Determine the tensile adhesion strength in accordance with [A.6.2](#).

Report the results in newtons (N).

#### **A.6.6 Adhesion after freeze–thaw cycle**

Prepare the surface of the test units in accordance with [A.6.1](#). In addition, a layer of the adhesive approximately 1 mm thick, shall be applied with a straight edge trowel to the back face of the type Bla tile before placing.

All remaining faces of the slab, including the underside, shall then be sealed with an impervious, waterproof coating material, such as an epoxide or polyester based product, ensuring complete integrity of the coating on all the edges and at the junction with the liquid-applied waterproofing membrane on the upper face.

Condition the test units for 7 days under standard conditions, followed by immersing in water for 21 days before carrying out 25 freeze–thaw cycles.

For each freeze–thaw cycle:

1. remove the test units from the water and lower the temperature of the test units to  $(-15 \pm 3)^\circ\text{C}$  within  $2\text{ h} \pm 20\text{ min}$ ;
2. maintain the test units at  $(-15 \pm 3)^\circ\text{C}$  for  $2\text{ h} \pm 20\text{ min}$ ;
3. immerse in water at  $(20 \pm 3)^\circ\text{C}$  and raise the temperature of the test units to  $(15 \pm 3)^\circ\text{C}$  and maintain between this temperature and  $(20 \pm 3)^\circ\text{C}$  for a minimum of 2 h.

Repeat the cycle 25 times. After the last cycle wipe the surface of the tiles with a cloth and bond the pull head plates to the tiles. Allow the test units to reach standard conditions for at least 7 h and then determine the tensile strength in accordance with [A.6.2](#).

Report the results in newtons (N).

#### **A.6.7 Adhesion after contact with chlorinated water**

Prepare the test units in accordance with [A.6.1](#) and form the reservoir in accordance with [A.6.3](#).

Condition for 28 days before pouring an approximate 6 mm depth of chlorinated water into the reservoir. After 7 days pour away the chlorine water, rinse with clean tap water, wipe with a cloth and bond the pull head plates to the tiles. After a further 24 h under standard conditions, carry out the tensile adhesion test in accordance with [A.6.2](#).

Report the results in newtons (N).

The testing solution, with a chloride and sulfate content of 200 mg/l each, shall be prepared with the addition of sodium chloride and sodium sulfate to fresh water.

The water shall be chlorinated by addition of technically pure sodium hypochlorite ([A.3.5](#)).

The chlorinated water concentration shall be kept constant within the range 0,3 mg/l to 0,6 mg/l checking the active chlorine content in water by titration.

The pH value shall be determined daily and shall be kept in the range 6,5 to 7,8; any correction required should be carried out by increasing pH with the addition of sodium hydroxide, or by decreasing it with the addition of hydrochloric acid, daily.

The immersion time of the test units shall be extended for the time the active chlorine content was below the limit value of 0,3 mg/l (for example, on a day of rest or public holiday).

#### **A.6.8 Alternative method for adhesion after contact with chlorinated water**

Prepare the surface of the test units in accordance with [A.6.1](#).

All remaining faces of the slab, including the underside, shall then be sealed with an impervious, waterproof coating material, such as an epoxide or polyester based product, ensuring complete integrity of the coating on all the edges and at the junction with the liquid-applied waterproofing membrane product on the upper face.

Condition the test units under standard conditions for 28 days, and immerse them in chlorinated water at the standard temperature.

After 7 days remove the test units from the chlorinated water, wipe with a cloth and bond the pull head plates to the tiles.

After a further 24 h under standard conditions, carry out the tensile adhesion test in accordance with [A.6.2](#).

The testing solution, with a chloride and sulfate content of 200 mg/l each, shall be prepared with the addition of sodium chloride and sodium sulfate to fresh water.

The water shall be chlorinated by addition of sodium hypochlorite ([A.3.5](#)).

The chlorinated water concentration shall be kept constant within the range 0,3 mg/l to 0,6 mg/l checking the active chlorine content in water by titration. Possible change here after data review.

The pH value shall be determined daily and shall be kept in the range 6,5 to 7,8; any correction required should be carried out by increasing pH with the addition of sodium hydroxide, or by decreasing it with the addition of hydrochloric acid, daily.

The immersion time of the test units shall be extended for the time the active chlorine content was below the limit value of 0,3 mg/l (for example, on a day of rest or public holiday).

#### **A.6.9 Adhesion after contact with lime water**

Prepare the test units in accordance with [A.6.1](#). All remaining faces of the slab, including the underside, shall then be sealed with an impervious, waterproof coating material, such as an epoxide or polyester based product, ensuring complete integrity of the coating on all the edges and at the junction with the liquid-applied waterproofing membrane on the upper face.

Condition the test piece under standard conditions for 28 days and then immerse them in saturated lime water (pH  $\geq$  12) at 40 °C.

After 7 days remove the test units from the lime water, rinse with clean water, wipe with a cloth and bond the pull head plates to the tiles. After a further 24 h under standard conditions, carry out the tensile adhesion test in accordance with [A.6.2](#).

Report the results in newtons (N).

### A.6.10 Evaluation and expression of results

The individual tensile adhesion strength is determined to an accuracy of  $\pm 0,1$  N/ mm<sup>2</sup> using the following equation:

$$S = L/A$$

where

$S$  is the individual tensile adhesion strength in newtons/square millimetres;

$L$  is the total load in newtons;

$A$  is the bonding area in square millimetres (2 500 mm<sup>2</sup>).

The tensile adhesion strength for each set of conditions is determined as follows:

- determine the mean of the 10 values;
- discard the values falling out of the range of  $\pm 20$  % from the mean value;
- if five or more than five values remain, determine the new mean value;
- if less than five values remain, repeat the test;
- determine the mode of failure of the test units.

### A.7 Water impermeability

The test sample is based on a permeable concrete substrate sealed in all faces apart from the test area, covered with the liquid applied, waterproofing membrane, where a water pressure shall be applied.

The substrate is a slab with minimum dimension 150 mm  $\times$  150 mm  $\times$  100 mm prepared using a water permeable concrete and with a plane surface ([Figure A.4](#)). In order to have a permeable concrete it is necessary to use a water/cement ratio  $\geq 1$ . The concrete shall be manufactured according to the following mix-design:

- CEM 32,5 R or 42,5 R type I, II, III and IV according to EN 197-1, 250 kg/m<sup>3</sup>
- aggregate with particle size range 0 mm to 16 mm according to EN 12620 750, 1 kg/m<sup>3</sup>
- mixing water according to EN 1008, -250 kg/m<sup>3</sup>

NOTE In case of bleeding, the addition of WRA (water retention admixture, according to EN 934-2) can be used.

The particle size distribution of the aggregate is in compliance with [Table A.1](#).