



International  
Standard

**ISO 13265**

Second edition  
2024-05

**Thermoplastics piping systems  
for non-pressure underground  
drainage and sewerage — Joints for  
buried non-pressure applications  
— Test method for the long-term  
sealing performance of joints with  
elastomeric seals by estimating the  
sealing pressure**

*Systèmes de canalisations thermoplastiques pour branchements  
et collecteurs d'assainissement enterrés sans pression —  
Assemblages pour applications enterrées sans pression —  
Méthode d'essai de la performance à long terme des assemblages  
avec garnitures d'étanchéité en élastomère par l'estimation de la  
pression d'étanchéité*

STANDARDSISO.COM : Click to view the full PDF of ISO 13265:2024



**COPYRIGHT PROTECTED DOCUMENT**

© ISO 2024

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
CP 401 • Ch. de Blandonnet 8  
CH-1214 Vernier, Geneva  
Phone: +41 22 749 01 11  
Email: [copyright@iso.org](mailto:copyright@iso.org)  
Website: [www.iso.org](http://www.iso.org)

Published in Switzerland

# Contents

	Page
Foreword.....	iv
<b>1 Scope</b> .....	<b>1</b>
<b>2 Normative references</b> .....	<b>1</b>
<b>3 Terms and definitions</b> .....	<b>1</b>
<b>4 Symbols</b> .....	<b>2</b>
<b>5 Principle</b> .....	<b>2</b>
<b>6 Apparatus</b> .....	<b>3</b>
<b>7 Test pieces</b> .....	<b>4</b>
7.1 General.....	4
7.2 Assembly.....	4
7.3 Leaktightness of the test system.....	4
<b>8 Test procedure</b> .....	<b>5</b>
8.1 General.....	5
8.2 Procedure for determining the pressure.....	5
<b>9 Calculation and expression of results</b> .....	<b>6</b>
9.1 Calculation.....	6
9.2 Example of calculation results.....	6
9.3 Continuation of test.....	7
<b>10 Test report</b> .....	<b>8</b>
<b>Annex A (informative) Example of a tube manufacturer's specification</b> .....	<b>9</b>
<b>Annex B (informative) Description of a training test assembly</b> .....	<b>10</b>
<b>Bibliography</b> .....	<b>13</b>

STANDARDSISO.COM : Click to view the full PDF of ISO 13265:2024

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO document should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see [www.iso.org/directives](http://www.iso.org/directives)).

ISO draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). ISO takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, ISO had not received notice of (a) patent(s) which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at [www.iso.org/patents](http://www.iso.org/patents). ISO shall not be held responsible for identifying any or all such patent rights.

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see [www.iso.org/iso/foreword.html](http://www.iso.org/iso/foreword.html).

This document was prepared by Technical Committee ISO/TC 138, *Plastics pipes, fittings and valves for the transport of fluids*, Subcommittee SC 1, *Plastics pipes and fittings for soil, waste and drainage (including land drainage)*.

This second edition cancels and replaces the first edition (ISO 13265:2010), which has been technically revised.

The main changes are as follows:

- the principle of the method has been reviewed and updated;
- the apparatus and procedure have been reviewed and updated;
- the document has been editorially revised.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at [www.iso.org/members.html](http://www.iso.org/members.html).

# Thermoplastics piping systems for non-pressure underground drainage and sewerage — Joints for buried non-pressure applications — Test method for the long-term sealing performance of joints with elastomeric seals by estimating the sealing pressure

## 1 Scope

This document specifies a method for determining the long-term sealing pressure of elastomeric seals in assembled joints for buried non-pressure sewerage plastics piping and ducting systems.

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 9967, *Thermoplastics pipes — Determination of creep ratio*

EN 681-1, *Elastomeric seals — Materials requirements for pipe joint seals used in water and drainage applications — Part 1: Vulcanized rubber*

EN 681-2, *Elastomeric seals — Materials requirements for pipe joint seals used in water and drainage applications — Part 2: Thermoplastic elastomers*

EN 681-3, *Elastomeric seals — Materials requirements for pipe joint seals used in water and drainage applications — Part 3: Cellular materials of vulcanized rubber*

EN 681-4, *Elastomeric seals — Materials requirements for pipe joint seals used in water and drainage applications — Part 4: Cast polyurethane sealing elements*

EN 837-1, *Pressure gauges — Part 1: Bourdon tube pressure gauges — Dimensions, metrology, requirements and testing*

## 3 Terms and definitions

No terms and definitions are listed in this document.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

## 4 Symbols

$B$	theoretical pressure, in bar <sup>1)</sup> , in the polytetrafluoroethylene (PTFE) tube at $t = 1$ h
$D$	drop factor of extrapolated pressure data at 24 h and 100 years
$M$	gradient of the curve
$p$	pressure
$p_t$	pressure measured in the PTFE tube at a flow of 120 ml/min and the time $t$ hours
$p_0$	initial leakage pressure, in bar, measured in the PTFE tube after completing the assembly
$p_{ta}, p_{tb}, p_{tc}$	pressure measured in the three PTFE tubes in the tested joint, marked a, b and c, respectively, at time $t$ hours
$p_x$	extrapolated pressure, in bar, at 100 years
$p_y$	calculated pressure, in bar, at 24 h
$p_{xa}, p_{xb}, p_{xc}$	extrapolated pressure, in bar, at 100 years in the three PTFE tubes in the tested joint, marked a, b and c, respectively
$p_{100y}$	arithmetic mean value of the pressures obtained for each of the three extrapolated values, $p_x$ , at 100 years
$p_{24h}$	arithmetic mean value of the pressures obtained for each of the three calculated values, $p_y$ , at 24 h
$R$	correlation coefficient
$t$	time, in hours

## 5 Principle


The sealing pressure in a joint is estimated by measuring the pressure necessary to lift the seal, in each of three PTFE tubes, unless otherwise specified in other standards, equally distributed over the circumference of a joint located between the rubber seal and the spigot or socket, as appropriate (see [Figure 1](#)).

In a temperature-controlled environment and at increasing time intervals, a constant flow rate of 120 ml/min of nitrogen or air is forced through three flexible PTFE tubes.

If it was not possible to keep the pressure constant at 120 ml/min during the measurement, calculate the pressure value,  $p$ , at a flow rate of 120 ml/min according to [8.2](#). For this purpose, the intersection point of the pressure at 120 ml/min shall be read from the recorded pressure/flow curve and this resulting pressure shall be recorded.

The nitrogen or air pressure,  $p$ , necessary to achieve this flow, is measured. The pressure,  $p_t$ , is measured at increasing time intervals over a period of time. The extrapolated regression lines for  $p_t$  are used to calculate the estimated value  $p_x$  at 100 years and  $p_y$  at 24 h.

1) 1 bar = 0,1 MPa = 10<sup>5</sup> Pa; 1 MPa = 1 N/mm<sup>2</sup>.

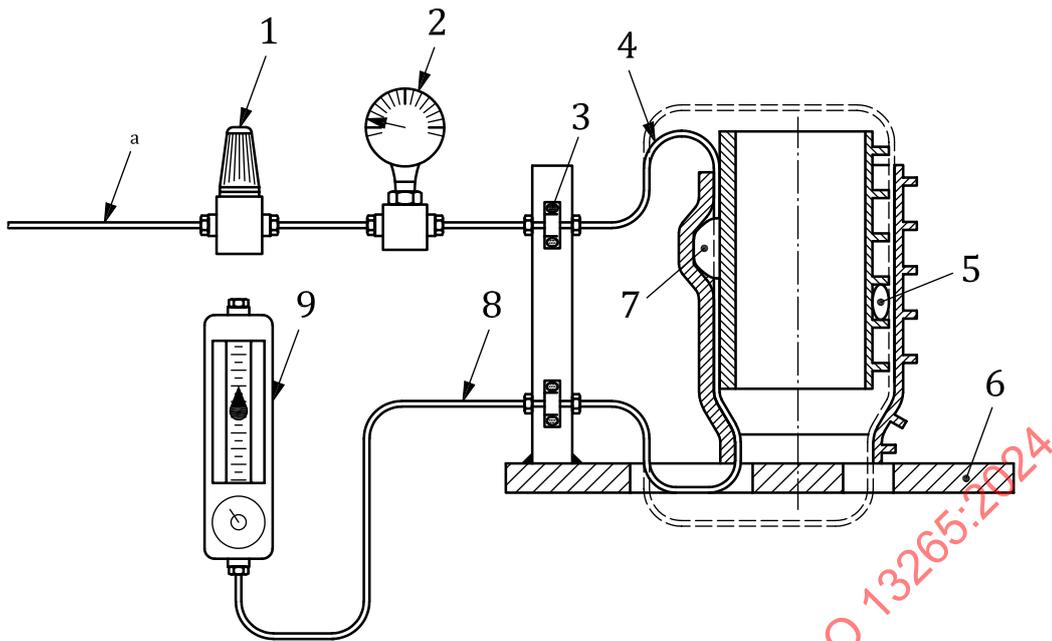

**Key**

- |   |  |   |  |
|---|--|---|--|
| 1 | regulator/pressure controller  | 6 | test assembly base   |
| 2 | pressure gauge   | 7 | position of the tube in a joint with sealing ring positioned in the socket |
| 3 | fixed coupler  | 8 | connecting tube  |
| 4 | PTFE tube  | 9 | flow meter   |
| 5 | position of the tube in a joint with the sealing ring positioned on the spigot | a | Source of nitrogen or clean air.   |

**Figure 1 — Typical arrangement of the test assembly**

**6 Apparatus**

**6.1 Source of nitrogen**, with a purity of at least 99,8 % or, alternatively, cleaned air (oil-free), capable of supplying a pressure of at least 10 bar.

**6.2 Regulator/pressure controller**, capable of regulating of pressure at least 10 bar and a flow at least of up to 200 ml/min.

**6.3 Pressure gauge**, for measuring the pressure in the main line and capable of checking conformity to 8.2 (class 0,6 or better, in accordance with EN 837-1).

**6.4 Connecting tube**, with an inside diameter of at least 4 mm.

**6.5 PTFE tube**, conforming to the following:

- a) capable of sustaining at least 10 bar pressure;
- b) the total thickness of the flattened PTFE tube shall be between 0,12 mm and 0,24 mm, measured in the middle of the sample and carried out in two positions perpendicular to each other;
- c) the total width of the flattened tube shall be between 6 mm and 10 mm.

**NOTE** The PTFE tube used for this test is a blown-up tube, normally applied as a shrinkage tube. The original diameter and wall thickness after shrinkage are normally specified. Attention is drawn that the blown-up dimensions are normally not specified.

Care should be taken that the wall thickness and the diameter of the tube as received are verified. The given tolerances should be seen as a guide for the supplier.

**6.6 Flow meter**, with a capacity of up to 200 ml/min and a tolerance of  $\pm 5$  ml/min.

**6.7 Means for storing test assembly**, capable of fixing and storing the test assembly in such a way that no additional movements in the joint can occur. It shall be capable of fixing the PTFE tubes in such a way that, when connecting or disconnecting to the pressure gauge and flow meter, no movement of the PTFE tube in the sealing area can occur.

**6.8 Lubricant**, an aerosol of silicon (polydimethylsiloxane) with gas propellant (propane/butane).

## 7 Test pieces

### 7.1 General

Each test piece shall consist of a complete joint, together with its elastomeric seal and PTFE tube(s). Unless otherwise specified in the referring standard, the number of PTFE tubes shall be three, marked as a, b and c, equally spaced around the spigot.

### 7.2 Assembly

Prior to assembly, the test pieces shall be conditioned at the test temperature for at least 24 h.

Clean the rubber sealing ring, the socket and the spigot.

Prepare the PTFE tube by pressing it together several times until permanently flattened and place it along the smooth surface of the spigot or socket.

Lubricate the smooth wall in the joint (spigot or socket), the seal and PTFE tube(s). The lubricant defined in 6.8 shall be used. Use sufficient lubricant to ensure that the PTFE shrinkage tube(s) and seal can be assembled without damage, and the seal can equalize its position within the groove circumference.

Assemble the socket and spigot, including the seal, in accordance with the manufacturer's instructions and the following requirements.

- a) The joint shall be assembled in such a way that the PTFE tubes are mounted between the spigot or socket and the seal (see [Figure 1](#)); precautions shall be taken to avoid squeezing the PTFE tube outside the sealing area.
- b) It is permitted to mill a groove, insert thin plastics strips along the tube, drill holes in the spigot or socket or any other method that gives room for sufficient flow through the tube outside the sealing area. The method selected shall not significantly influence the creep behaviour of the joint in the sealing housing area.
- c) Ensure that the PTFE tube can move freely in the axial direction and that the flattened section of the PTFE tube is located under the sealing ring, and not distorted, when the joint is made.

### 7.3 Leaktightness of the test system

Ensure the pressurized side of the test equipment is leaktight after installation. Identify any leakage by soap solution. If necessary, reassemble the leaking joints. Avoid flow through the sealing zone during this operation.

## 8 Test procedure

### 8.1 General

The testing shall start between half an hour and 8 h after assembly and a leaktightness test performed in accordance with [Clause 7](#).

For each of the installed PTFE tubes, carry out the procedure according to [8.2](#) with the test pieces kept in the temperature-controlled environment at  $(23 \pm 2)$  °C.

Measure and record the sealing pressure, in each tube,  $p$ , in bar, at 24 h, 168 h, 336 h, 504 h, 600 h, 696 h, 862 h, 1 008 h, 1 392 h and 2 000 h.

Where it is not possible to read the pressure at the appropriate time between 500 h and 2 000 h, it is permitted to deviate by up to 48 h, provided the actual measurement time is used in preparing the plots described in [Clause 9](#).

### 8.2 Procedure for determining the pressure

**8.2.1** Measure the leakage pressure,  $p_0$ , in each of the three tubes individually, using the following procedure.

- a) Using the procedure described in [8.2.2 a\)](#), steadily increase pressure until a flow of 120 ml/min through the PTFE tube occurs.

If it is not possible to achieve a constant flow rate of 120 ml/min at a uniform pressure, then a constant pressure increase (stepless gradient) shall be applied until a flow rate is achieved.

- b) Measure and record this initial leakage pressure,  $p_0$ .
- c) Reduce pressure to zero.

**8.2.2** At each time interval as specified in [8.1](#) achieve a flow of 120 ml/min and measure and record the nitrogen (or air) pressure,  $p_t$ , in bar, using the following procedure for each of the three tubes individually.

- a) Increase pressure in increments of 0,5 bar until the level is 0,5 bar below  $p_0$  or the previous measurement. Then continue to increase the pressure gradually and slowly. Occasionally, allow time for the pressure and flow to stabilize. Continue this process until the flow rate has been  $(120 \pm 5)$  ml/min for 60 s at the same pressure. Record the pressure as  $p_{ta}$ , in bar, for tube "a", as  $p_{tb}$ , in bar, for tube "b" and  $p_{tc}$ , in bar, for tube "c".

If the resistance of the seal allows the pressure to pass abruptly (e.g. due to the geometry) and the flow rate of  $(120 \pm 5)$  ml/min cannot be achieved for 60 s, the pressure shall be increased continuously with a flat rising curve until a flow can be measured.

If the pressure reaches 10 bar, stop pressurizing and record the pressure as 10 bar.

If the pressure in all three tubes is recorded as 10 bar after the reading at 504 h, the assembly shall be deemed to have passed the requirements.

If one or two of the tubes show a pressure less than 10 bar at the 504 h reading, the test shall be continued and the calculation shall be performed based on the pressure readings below 10 bar.

- b) Reduce pressure to zero.

If, during the test, the actual flow rate reaches a value 10 % higher than 120 ml/min, or if the seal opens abruptly, the entire procedure shall be repeated three times, each time after a waiting period of at least 30 min. The individual values may not deviate from each other by more than 10 %.

The mean value from the three measurements is to be used as the measurement result.

## 9 Calculation and expression of results

### 9.1 Calculation

Calculate the extrapolated 100 years pressure for each individual tube using the measurements of the pressure,  $p_{ta}$ ,  $p_{tb}$ ,  $p_{tc}$  respectively, taken at each period of time,  $t$ , in accordance with [8.1](#) and [8.2](#), and determine the best-fit straight line by using least squares analysis in accordance with ISO 9967.

Plot the measured values against the logarithm of time, in hours, into a semi-logarithmic co-ordinate system.

Determine the linear regression through all 10 points, through the last 9 points and through the last 5 points (see [Table 1](#)), where the values for  $B$  and  $M$  and the correlation coefficient,  $R$ , are determined using the method of least squares and [Formula \(1\)](#); the factor  $R$  shall be calculated to five digits:

$$p_t = B + M \lg t \quad (1)$$

where

$p_t$  is the theoretical extrapolated pressure, in bar, in the PTFE tube marked a, b or c, at time  $t$ ;

$B$  is the theoretical pressure, in bar, in the PTFE tube at  $t = 1$  h;

$M$  is the gradient of the curve;

$t$  time in hours.

For each of the six equations  $p_t = B + M \lg t$ , calculate the extrapolated pressure  $p_x$  at 100 years and, if applicable, the pressure  $p_y$  at 24 h.

Choose, as the value for  $p_x$  and  $p_y$ , the value that has the highest correlation coefficient,  $R$ . The value for  $R$  shall be at least 0,90.

If the highest value of  $R$  is less than 0,90, extend the measurements for all of the three tubes according to [9.3](#).

### 9.2 Example of calculation results

A typical set of data of measured pressures at one position is given in [Table 1](#).

In the fourth column, the range of measuring points are given, from which the regression factors at the right-hand side of [Table 1](#) are derived. To select the highest value of  $R$ , five digits are needed.

Calculate the arithmetic mean value of  $p_{100y}$  and, if applicable, of  $p_{24h}$  of the values obtained for each of the three extrapolated values of  $p_x$  and  $p_y$ , using [Formulae \(2\)](#) and [\(3\)](#), as applicable:

$$p_{100y} = \frac{(p_{xa} + p_{xb} + p_{xc})}{3} \quad (2)$$

$$p_{24h} = \frac{(p_{ya} + p_{yb} + p_{yc})}{3} \quad (3)$$

If applicable, calculate the pressure drop (in %) using [Formula \(4\)](#):


$$D = \frac{p_{24h} - p_{100y}}{p_{24h}} \times 100 \quad (4)$$

Table 1 — Typical set of data and regression analysis for one measuring position

Test report No.			Joint identification		Tube marked a, b or c				
Measurement data				Linear logarithmic regression of the data					
Point number	Time		Pressure	Range of points	$p_t = M \times \lg t + B$				
	$t$	$\lg t$	$p$		$p_x: 100 \text{ y}$		$p_y: 24 \text{ h}^a$		
	hours		bar <sup>b</sup>	$M$	$B$	$R$	bar <sup>b</sup>	bar <sup>b</sup>	
1	24	1,38	7,50	1 to 10	-0,889 8	8,810 3	0,982 23	3,52	7,58
2	168	2,23	7,00	2 to 10	-1,031 7	9,220 5	0,983 76	3,09	7,8
3	336	2,53	6,54	3 to 10	-0,912 5	8,865 1	0,993 67	3,44	7,61
4	504	2,70	6,40	4 to 10	-0,944 3	8,962 0	0,993 44	3,35	7,66
5	600	2,78	6,35	5 to 10	-0,960 1	9,011 0	0,992 04	3,31	7,69
6	696	2,84	6,30	6 to 10	-0,947 2	8,970 4	0,988 71	3,34	7,66
7	862	2,94	6,18						
8	1 008	3,00	6,10						
9	1 392	3,14	6,00						
10	2 000	3,30	5,85						

<sup>a</sup> If applicable.  
<sup>b</sup> 1 bar = 0,1 MPa = 10<sup>5</sup> Pa; 1 MPa = 1 N/mm<sup>2</sup>.

The resulting plot is given in [Figure 2](#).

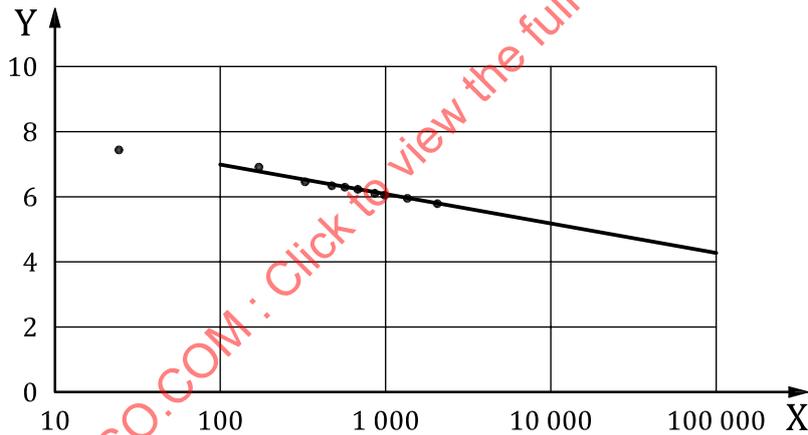

**Key**

- X time in hours (logarithmic scale)
- Y pressure in bar<sup>2</sup>)

Figure 2 — Plot of measured pressures for one measuring position, and extrapolation curve for the highest calculated  $R$  value

**9.3 Continuation of test**

In all cases, except if the pressures are recorded as 10 bar [see 8.2.2 a)], there shall be a trend to lower pressures after 504 h for all of the three PTFE tubes. If this condition is not fulfilled, the test result(s) shall be disregarded. If after 504 h, the measured values in the three tubes deviate by more than 30 % from their average value, the test results shall be disregarded. In both cases a new test with a new test piece conforming to [Clause 7](#) shall be carried out.

2) 1 bar = 0,1 MPa = 10<sup>5</sup> Pa; 1 MPa = 1 N/mm<sup>2</sup>.

If the calculation procedure does not lead to a correlation coefficient,  $R$ , higher than 0,90 in the regression analysis, for any of the measuring positions, the test results shall either be disregarded, or the test shall be continued by measuring the sealing pressure with increments in time of at least 200 h until the correlation coefficient,  $R$ , exceeds the value of 0,90, using all the measurements from and including 504 h.

## 10 Test report

The test report shall include the following information:

- a) identification of the laboratory and the responsible person;
- b) reference to this document, i.e. ISO 13265:2024, and the referring standard;
- c) number of test pieces;
- d) gas used in the test, i.e. nitrogen or cleaned air;
- e) full description of the piping components forming the test piece (e.g. manufacturer's name, production date, material, type, diameter, wall thickness, shape of the sealing zone);
- f) identity of the seal (type of material in accordance with EN 681-1, EN 681-2, EN 681-3 or EN 681-4, as applicable; hardness of material; shape/type; diameter);
- g) at each test time, the measured pressure,  $p_{ta}$ ,  $p_{tb}$ ,  $p_{tc}$ , in bar;
- h) results of regression analysis for each position;
- i) average pressure,  $p_{24\text{ h}}$ , in bar, if applicable;
- j) average pressure,  $p_{100\text{ yr}}$ , in bar;
- k) pressure drop,  $D$ , if applicable;
- l) any factors that could have affected the results, such as any incidents or any operating details not specified in this document;
- m) any unusual features observed;
- n) dates of the tests.

STANDARDSISO.COM : Click to view the full PDF of ISO 13265:2024

**Annex A**  
(informative)

**Example of a tube manufacturer's specification**

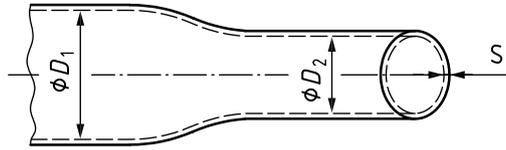


Figure A.1 — Product specification sheet

Table A.1 — Item No. 24-316-10-1220S3


Type	V3/16	Manufactured by	IFK-Isofluor GmbH
Order-No.	A24V3/1610	Dimension	0,188" (= 4,78 mm)
Expanded ID, $D_1$	4,75 mm	Tolerance	+0,65/-0,00 mm
Shrunk ID, $D_2$	1,27 mm	Tolerance	+0,00/-0,30 mm
Wall after max. shrinkage, $S$	0,30 mm	Tolerance	$\pm 0,08$ mm
Wall	standard wall	Colour	natural transparent
Material	IFK PTFE201TB	Shrink tested	yes
Length	production length on spool	Elongation at tear at 23 °C	>200 %
Length	1,220 mm fixed	Yield point at 23 °C	>10 N/mm <sup>2</sup>
Thermal conductivity at 23 °C	0,23 (W/K*m)	upper temperature for continued use, no load	250 °C to 260 °C
Combustibility	non-combustible	Shrink temperature	320 °C to 360 °C
Specified according to	MIL-DTL 23053 Revision E/12, Class 5 <sup>[1]</sup>	Tubing material specified according to	AMS 3584 <sup>[2]</sup>
Approved	H.E. de la Motte	Date	2003-09-02

## Annex B (informative)

### Description of a training test assembly

#### B.1 General

The following is a description of a simple procedure for first test trials in a new laboratory or for new laboratory personnel and equipment. In this test rig, a correlation coefficient of  $R = 0,98$  is generally easily obtainable.

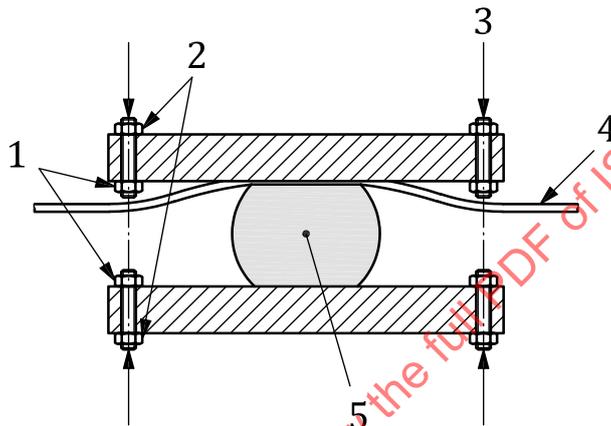

#### Key

- |   |              |   |                 |
|---|--------------|---|-----------------|
| 1 | distance nut | 4 | shrinkable tube |
| 2 | counter nut  | 5 | rubber seal     |
| 3 | screw        |   |                 |

Figure B.1 — Basic test assembly

#### B.2 Test assembly

Basic test rig consisting of two rigid plates of size approximately 50 mm × 50 mm and thickness  $W$  5 mm (no bending of the plate during assembly).

At the four corners, screw connections of approximately 5 mm are positioned, with distance nuts used for adjustment of the distance and parallelism of the plates. They are locked with counter nuts after adjustments.

An O-ring (or a similar stable design) should be chosen (e.g. from pipes DN 150 to DN 250) as the seal.

Seal the 50 mm long segment, positioned between the plates. Crosswise, a shrinkage tube is positioned between the seal and one plate. To support quick settlement of the seal and tube between the pressed plates, sufficient lubricant should be used around the seal segment.

The seal is compressed to about 30 %.

In a first test, air is blown through the tube. The required air pressure for the flow of 120 ml/min should be close to 10 bar, and at least 7 bar (in order to obtain measurable relaxation drops in a relatively short time).