
**Heating systems in buildings —
Method and design for calculation of
the system energy performance —
Combustion systems (boilers)**

*Systèmes de chauffage dans les bâtiments — Méthode de conception
et de calcul de la performance énergétique des systèmes — Systèmes
de combustion (chaudières)*

STANDARDSISO.COM : Click to view the full PDF of ISO 13675:2013



STANDARDSISO.COM : Click to view the full PDF of ISO 13675:2013



COPYRIGHT PROTECTED DOCUMENT

© ISO 2013

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

| | Page |
|---|-----------|
| Foreword | iv |
| Introduction | v |
| 1 Scope | 1 |
| 2 Normative references | 1 |
| 3 Terms, definitions and symbols | 1 |
| 3.1 Terms and definitions..... | 1 |
| 3.2 Symbols and units..... | 4 |
| 4 Alignment of the parts of the heating system standards | 5 |
| 4.1 Physical factors taken into account..... | 5 |
| 4.2 Input quantities from other parts of the heating system standards..... | 6 |
| 4.3 Output quantities for other parts of the heating system standards..... | 6 |
| 4.4 Heat balance of the generation sub-system, including control of heat generation..... | 7 |
| 4.5 Generation sub-system basic energy balance..... | 8 |
| 5 Generation sub-system calculation | 9 |
| 5.1 Available methodologies..... | 9 |
| 5.2 Boiler efficiency..... | 10 |
| Annex A (informative) Additional formulas and default values for parametering the boiler efficiency method | 19 |
| Annex B (informative) General part default values and information | 31 |
| Annex C (normative) Maximum heating power in the building zone | 32 |
| Annex D (informative) Calculation examples for modulating condensing boiler | 35 |
| Annex E (informative) Generation sub-systems and gross calorific values | 39 |
| Bibliography | 43 |

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the WTO principles in the Technical Barriers to Trade (TBT) see the following URL: Foreword - Supplementary information

The committee responsible for this document is ISO/TC 205, *Building environment design*.

Introduction

This International Standard presents methods for calculation of the energy losses of a heat generation system. The calculation is based on the performance characteristics of the products given in product standards and on other characteristics required to evaluate the performance of the products as included in the system.

This method can be used for the following applications:

- judging compliance with regulations expressed in terms of energy targets;
- optimization of the energy performance of a planned heat generation system, by applying the method to several possible options;
- assessing the effect of possible energy conservation measures on an existing heat generation system, by calculating the energy use with and without the energy conservation measure.

Refer to other International Standards or to regional or national documents for input data and detailed calculation procedures not provided by this International Standard.

Heating systems also include the effect of attached systems such as hot water production systems.

This International Standard is a systems standards, i.e. it is based on requirements addressed to the system as a whole and not dealing with requirements to the products within the system.

Where possible, reference is made to applicable product standards. However, use of products complying with relevant product standards is no guarantee of compliance with the system requirements.

The requirements are mainly expressed as functional requirements, i.e. requirements dealing with the function of the system and not specifying shape, material, dimensions or the like.

Heating systems and cooling systems differ globally due to climate, traditions and national regulations. In some cases, requirements are given as classes so national or individual needs can be accommodated.

STANDARDSISO.COM : Click to view the full PDF of ISO 13675:2013

Heating systems in buildings — Method and design for calculation of the system energy performance — Combustion systems (boilers)

1 Scope

This International Standard is the general standard on generation by combustion sub-systems (boilers) for oil, gas, coal and biomass burning.

It specifies the

- required inputs,
- calculation method, and
- resulting outputs

for space heating generation by combustion sub-systems (boilers) including control.

This International Standard is also intended for the case of generation for both domestic hot water production and space heating.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 7345:1987, *Thermal insulation — Physical quantities and definitions*

ISO 13790, *Energy performance of buildings — Calculation of energy use for space heating and cooling*

3 Terms, definitions and symbols

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 7345:1987 and the following apply.

3.1.1

auxiliary energy

electrical energy used by technical building systems for heating, cooling, ventilation and/or domestic water to support energy transformation to satisfy energy needs

Note 1 to entry: This includes energy for fans, pumps, electronics, etc. Electrical energy input to the ventilation system for air transport and heat recovery is not considered as auxiliary energy, but as energy use for ventilation.

3.1.2

boiler

gas, liquid or solid fuelled appliance designed to provide hot water for space heating

Note 1 to entry: It can also be designed to provide domestic hot water heating.

3.1.3

biomass boiler

biomass fuelled appliance designed to provide heating medium (e.g. water, fluid)

3.1.4

condensing boiler

oil or gas boiler designed to make use of the latent heat released by condensation of water vapour in the combustion flue products

Note 1 to entry: A condensing boiler allows the condensate to leave the heat exchanger in liquid form by way of a condensate drain.

Note 2 to entry: Boilers not so designed, or without the means to remove the condensate in liquid form, are called 'non-condensing'.

3.1.5

low temperature boiler

non-condensing boiler which can work continuously with a water supply temperature of 35 °C to 40 °C

3.1.6

modulating boiler

boiler with the capability to vary continuously (from a set minimum to a set maximum) the fuel burning rate whilst maintaining continuous burner firing

3.1.7

multistage boiler

boiler with the capability to vary the fuel burning rate stepwise whilst maintaining continuous burner firing

3.1.8

on/off boiler

boiler without the capability to vary the fuel burning rate whilst maintaining continuous burner firing

Note 1 to entry: This includes boilers with alternative burning rates set once only at the time of installation, referred to as range rating.

3.1.9

calculation period

period of time over which the calculation is performed

Note 1 to entry: The calculation period can be divided into a number of calculation steps.

3.1.10

calculation step

discrete time interval for the calculation of the energy needs and uses for heating, cooling, humidification and dehumidification

Note 1 to entry: Typical discrete time intervals are one hour, one month or one heating and/or cooling season, operating modes, and bins.

3.1.11

combustion power

product of the fuel flow rate and the net calorific power of the fuel

3.1.12

domestic hot water heating

process of heat supply to raise the temperature of cold water to the intended delivery temperature

3.1.13**external temperature**

temperature of external air

Note 1 to entry: For transmission heat transfer calculations, the radiant temperature of the external environment is supposedly equal to the external air temperature; long-wave transmission to the sky is calculated separately.

Note 2 to entry: The measurement of external air temperature is defined in ISO 15927[3].

3.1.14**gross calorific value**

quantity of heat released by a unit quantity of fuel, when it is burned completely with oxygen at a constant pressure equal to 101 320 Pa, and when the products of combustion are returned to ambient temperature

Note 1 to entry: This quantity includes the latent heat of condensation of any water vapour contained in the fuel and of the water vapour formed by the combustion of any hydrogen contained in the fuel.

Note 2 to entry: According to ISO 13602-2[2], the gross calorific value is preferred to the net calorific value.

3.1.15**heat recovery**

heat generated by a technical building system or linked to a building use (e.g. domestic hot water) which is utilized directly in the related system to lower the heat input and which would otherwise be wasted

EXAMPLE Preheating of combustion air by a flue gas heat exchanger.

3.1.16**heat transfer coefficient**

factor of proportionality of heat flow governed by a temperature difference between two environments

3.1.17**heated space**

room or enclosure which for the purposes of the calculation is assumed to be heated to a given set-point temperature or set-point temperatures

3.1.18**load factor**

ratio between the time with the boiler on and the total generator operation time

3.1.19**modes of operation**

various modes in which the heating system can operate

EXAMPLE Set-point mode, cut-off mode, reduced mode, set-back mode, boost mode.

3.1.20**net calorific value**

gross calorific value minus latent heat of condensation of the water vapour in the products of combustion at ambient temperature

3.1.21**operation cycle**

time period of the operation cycle of a boiler

3.1.22**recoverable system thermal loss**

part of a system thermal loss which can be recovered to lower either the energy need for heating or cooling or the energy use of the heating or cooling system

Note 1 to entry: This depends on the calculation approach chosen to calculate the recovered gains and losses (holistic or simplified approach).

3.1.23

recovered system thermal loss

part of the recoverable system thermal loss which has been recovered to lower either the energy need for heating or cooling or the energy use of the heating or cooling system

Note 1 to entry: This depends on the calculation approach chosen to calculate the recovered gains and losses (holistic or simplified approach).

3.1.24

space heating

process of heat supply for thermal comfort

3.1.25

system thermal loss

thermal loss from a technical building system for heating, cooling, domestic hot water, humidification, dehumidification or ventilation that does not contribute to the useful output of the system

Note 1 to entry: A system loss can become an internal heat gain for the building if it is recoverable.

Note 2 to entry: Thermal energy recovered directly in the subsystem is not considered as a system thermal loss but as heat recovery and directly treated in the related system standard.

3.1.26

total system thermal loss

total of the technical system thermal loss, including recoverable system thermal losses

3.2 Symbols and units

For the purposes of this document, the following symbols and units ([Table 1](#)) and indices ([Table 2](#)) apply.

Table 1 — Symbols and units

| Symbol | Name of quantity | Unit |
|--------|--|--------------------------------------|
| D | day | d/mth |
| A | area | m ² |
| E | energy in general [except quantity of heat, mechanical work and auxiliary (electrical) energy] | J ^b or Wh ^a |
| f | factor | - |
| P | power in general including electrical power | kW, W |
| Q | quantity of heat | J or Wh ^a |
| t | time, period of time | s or H/d, h/mth ^a |
| W | auxiliary (electrical) energy | J or Wh ^a |
| X | gas content | Vol-% |
| α | heat transfer coefficient | W/(m ² K) |
| β | load factor | — |
| η | efficiency | — |
| θ | temperature | °C |

^a If seconds (s) is used as the unit of time, the unit for energy shall be J; if hours (h) is used as the unit of time, the unit for energy shall be Wh.

^b The unit depends on the type of energy carrier.

Table 2 — Indices

| | | | | | |
|-----------------|--|-------|---------------------------------|------|------------------|
| C | cooling | day | day | od | operating day |
| CO ₂ | carbon dioxide | del | delivered | on | running |
| H | heating | dis | distribution system | op | operational |
| HC | heating circuit | dry | dry gases | out | output |
| O ₂ | oxygen | e | external | pa | partial area |
| Pn | at nominal load | env | envelope | prio | priority |
| Pint | at intermediate load | fg | flue gas | ren | renewable energy |
| P0 | at zero load | gen | generation, generator | rbl | recoverable |
| RT | return | i,j,k | indices | res | reheating |
| V | ventilation | in | input | rvd | recovered |
| W | hot water | int | internal | sat | saturation |
| Hs/Hi | ratio of gross calorific/net calorific value | ls | loss | sim | simultaneous |
| an | annual | m | mean | sink | sink |
| air | air | max | maximum | st | stoichiometric |
| aux | auxiliary | mech | mechanical (ventilation system) | test | test |
| brm | boiler room | min | minimum | th | thermal |
| ch | chimney | meas | measured | tr | transmission |
| cond | condensation | mth | month | use | use |
| corr | corrected/correction | nrbl | non recoverable | ve | ventilation |
| ctr | control | n | radiator index | wfg | water to fluegas |

4 Alignment of the parts of the heating system standards

4.1 Physical factors taken into account

The calculation method of the generation sub-system takes into account heat losses and/or recovery due to the following physical factors:

- heat losses to the chimney (or flue gas exhaust) and through the envelope of the storage tank and the generator(s) during total time of generator operation (running and stand-by);
- heat losses through the generator(s) envelope during total time of generator operation (running and stand-by);
- auxiliary energy.

The relevance of these effects on the energy requirements depends on:

- type of heat generator(s);
- type of buffer tank(s);
- location of heat generator(s);
- type of buffer tank(s);
- part load ratio;
- operating conditions (temperature, control, etc.);
- control strategy (on/off, multistage, modulating, cascading, etc.).

4.2 Input quantities from other parts of the heating system standards

Table 3 — Input quantities

| Notation | Meaning | Reference |
|---|--|---------------------------|
| H_{tr} | heat transfer coefficient of transmission | see ISO 13790 |
| H_{ve} | heat transfer coefficient of ventilation | see ISO 13790 |
| $P_{H,max}$ | heat load | see heat load calculation |
| t_H | heating hours (in the calculation interval), in h/mth | see ISO 13790 |
| t_W | availability period for hot water production – when connected, in h/mth | see input data |
| d_{mth} | number of days per month, in d/mth | see project data |
| β_{Pn} | load factor at full load | see input data |
| β_{Pint} | load factor at intermediate load | see input data |
| $\beta_{H,gen}$ | actual load factor | see input data |
| θ_e | external air temperature, in °C | see external climate data |
| $\theta_{e,min}$ | daily average design temperature, in °C; | see external climate data |
| $\theta_{HC,m}$ | generator average water temperature (or return temperature to the generator for condensing boilers) as a function of the specific operating conditions | see input data |
| $\theta_{HC,RT}$ | average return temperature to the generator for condensing boilers as a function of the specific operating conditions | |
| θ_{int} | ambient temperature, in °C | |
| $\theta_{nt,H,op}$ | space temperature during the operation time, in °C | see project data |
| <p>^a $\theta_{int,H}$ is to be used for system components in a heated zone, taking into account reduced heating operation (without taking into account weekends and holidays).</p> <p>$\theta_{int,C}$ is to be used for system components in a cooled zone (the user shall decide whether a cooled zone exists).</p> <p>θ_e is to be used for system components in an unheated and uncooled zone.</p> <p>If a zone is heated and cooled in the same month, it shall be determined which occurred more often and the appropriate temperature used.</p> | | |

The daily operation is taken into account by the heating time (operating hours/period of duration), $t_{H,op}$. The assumption is made that there is always only one user. Where there are a number of different loads, a differentiation must be made between the individual requirements for each case.

Only if the useful heat demand $Q_{H,dis,in} > 1$ kWh (in the calculation interval) is heating necessary.

4.3 Output quantities for other parts of the heating system standards

The calculation of the values takes place basically for the zones defined in ISO 13790.

If a number of parts of systems are contained in the various process domains then the values are to be added together for further analysis.

Here it is to be taken into account that the heating data are to be related to the gross calorific value.

In the following sections the thermal and auxiliary energy components of the different process domains are determined for further analysis.


Table 4 — Output quantities

| Notation | Description | Reference |
|--------------------|---|-------------|
| $E_{H,gen,in}$ | Fuel heat requirement | see 4.5 |
| $Q_{H,gen,ls,rbl}$ | Recoverable generation heat losses for heating system (in the calculation interval), in kWh | see 5.2.4.2 |
| $W_{H,gen,}$ | heat generation auxiliary energy for the heating system (in the calculation interval), in kWh | see 5.2.3 |

4.4 Heat balance of the generation sub-system, including control of heat generation

Figure 1 shows the calculation inputs and outputs of the generation sub-system.

NOTE For commercial purpose, Figure 1 can be simplified by grouping the different type of losses.

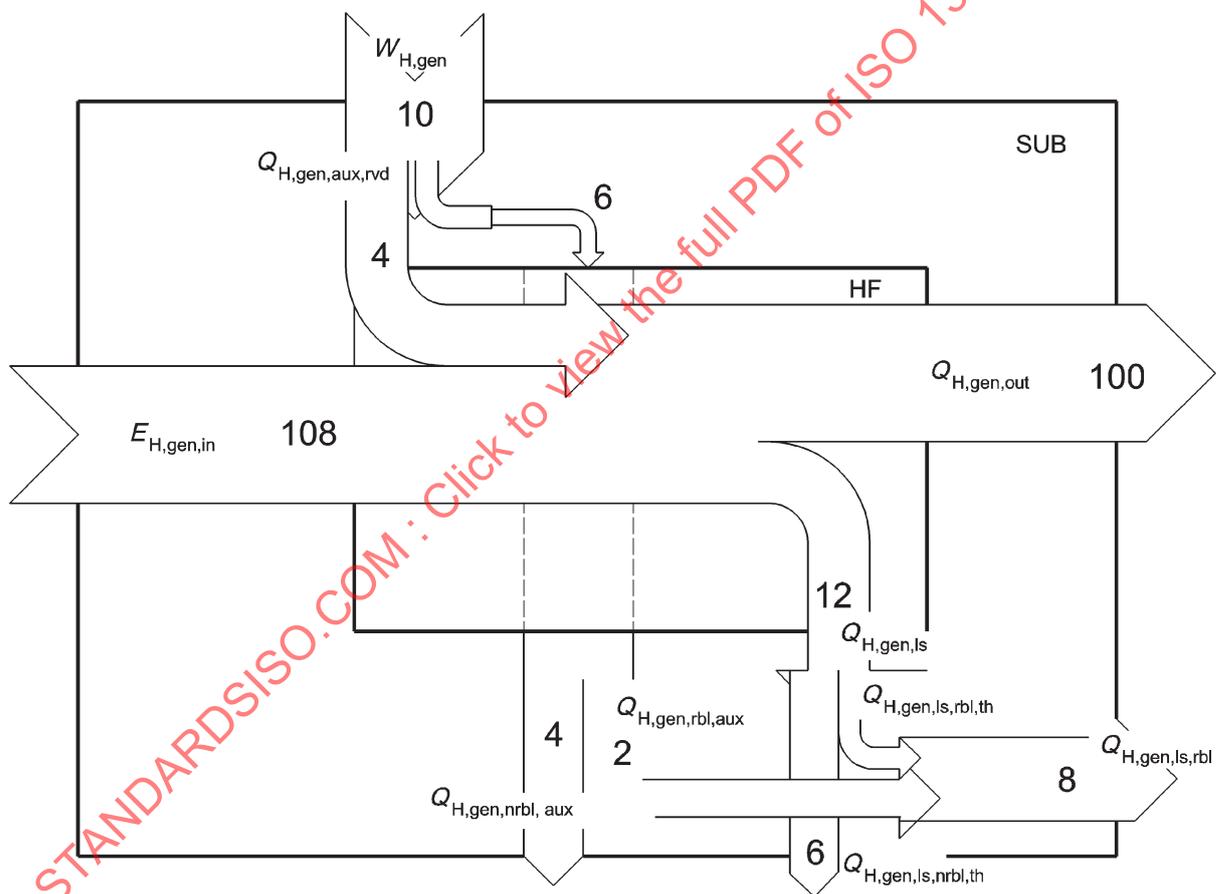

Key

- SUB Generation sub-system balance boundary
- HF Heating fluid balance boundary (see Formula 1)
- $Q_{H,gen,out}$ Generation sub-system heat output [input to distribution sub-system(s)]
- $E_{H,gen,in}$ Generation sub-system fuel input (energyware)
- $W_{H,gen}$ Generation sub-system total auxiliary energy
- $Q_{H,gen,aux,rvd}$ Generation sub-system recovered auxiliary energy

| | |
|------------------------|---|
| $Q_{H,gen,ls}$ | Generation sub-system total thermal losses |
| $Q_{H,gen,ls,rbl}$ | Generation sub-system thermal loss recoverable for space heating |
| $Q_{H,gen,ls,rbl,th}$ | Generation sub-system thermal loss (thermal part) recoverable for space heating |
| $Q_{H,gen,rbl,aux}$ | Generation sub-system recoverable auxiliary energy |
| $Q_{H,gen,ls,nrbl,th}$ | Generation sub-system thermal loss (thermal part) non recoverable |
| $Q_{H,gen,nrbl,aux}$ | Generation sub-system non recoverable auxiliary energy |

NOTE Figures shown are sample percentages.

Figure 1 — General generation sub-system inputs, outputs and energy balance

4.5 Generation sub-system basic energy balance

The basic energy balance of the generation sub-system is given by

$$E_{gen,in} = Q_{gen,out} - Q_{gen,aux,rvd} + Q_{gen,ls} - Q_{gen,ren} \quad (1)$$

where

- $E_{gen,in}$ is the energy input of the generation sub-system (fuel input) (in the calculation interval), in kWh;
- $Q_{gen,out}$ is the energy supplied to the distribution sub-systems (e.g. space heating and domestic hot water) (in the calculation interval), in kWh;
- $Q_{gen,aux,rvd}$ is the auxiliary energy recovered by the generation sub-system (e.g. pumps, burner fan, etc.) (in the calculation interval), in kWh;
- $Q_{gen,ls}$ is the thermal losses of the generation sub-system (e.g. through the chimney, generator envelope, etc.) (in the calculation interval), in kWh;
- $Q_{gen,ren}$ is the regenerative energy contribution (in the calculation interval), in kWh.

NOTE 1 $Q_{gen,ls}$ takes into account flue gas and generator envelope losses, part of which may be recoverable for space heating according to location of the generator. See 5.2.2.

NOTE 2 Generally biomass boilers are not designed for controlling the emission part of heating systems.

NOTE 3 $Q_{gen,ren}$ is normally not used with boilers.

The heat output from the boiler equals the sum of heat input to the connected distribution systems:

$$Q_{\text{gen,out}} = f_{\text{ctr,ls}} \cdot \sum_i Q_{\text{H,dis,in,i}} + \sum_j Q_{\text{W,dis,in,j}} \quad (2)$$

where

- $f_{\text{ctr,ls}}$ is the factor taking into account emission control losses. Default value of $f_{\text{ctr,ls}}$ is given in [Table B.1](#). Other values may be specified in a national annex, provided that emission control losses have not been already taken into account in the emission part or in the distribution part;
- $Q_{\text{H,dis,in}}$ is the heat input to the connected heat distribution system (in the calculation interval), in kWh;
- $Q_{\text{W,dis,in}}$ is the heat input to the connected DHW distribution system (in the calculation interval), in kWh.

If there are multiple generation sub-systems or multiple boilers, see input data “generator systems”.

If the generator provides heat for heating, cooling, ventilation and domestic hot water, the index H shall be replaced by C, V or W. In the following only H is used for simplicity.

The heat load calculation will be written in another standard.

5 Generation sub-system calculation

5.1 Available methodologies

This subclause describes the calculation method for the heat generation sub-system.

This method takes into account the specific operation conditions of the individual installation by taking the certified product value provided either by the manufacturer or taken from informative [Annex A](#), or by measuring the needed values on-site.

The considered calculation step can be the heating season but may also be a shorter period (month, week and/or the operation modes according to ISO 13790). The method is not limited and can be used with the default values given in informative [Annex A](#).

For existing boilers the calculation by measured values takes the losses of a generator which occurs during boiler cycling (i.e. combustion losses) in consideration. This method is well adapted for existing buildings and to take into account condensation heat recovery according to operating conditions.

The calculation methods for biomass combustion systems differ with respect to:

- type of stoking device (automatic or by hand);
- type of biomass fuel (pellets, chipped wood or log wood).

Data to characterize the boiler shall be taken from one of the following sources, listed in priority order:

- a) measured data (see [5.2.1](#));
- b) product data from the manufacturer, if the boiler has been tested and certified (see [5.2.2](#));
- c) default data from [Annex A](#) (see [5.2.2](#)).

It shall be recorded if the efficiency values include or not auxiliary energy recovery.

NOTE Biomass boilers with automatic stocking fired by pellets or chipped wood.

5.2 Boiler efficiency

5.2.1 Generator thermal losses measurement

5.2.1.1 Thermal losses through the chimney with the burner on at full load $f_{ch,on}$

Thermal losses through the chimney with the burner on $f_{ch,on}$ can be calculated according to the flue gas analysis results:

Measuring O_2

$$f_{ch,on,meas} = (\theta_{ch} - \theta_{brm}) \cdot \left(\frac{c_{10}}{21\% - X_{O_2}} + c_{11} \right) \quad (3)$$

where measured values are as follows:

θ_{ch} is the flue gas temperature, in °C;

θ_{brm} is the installation room (combustion air) temperature (see [Table A.7](#)), in °C;

X_{O_2} is the flue gas oxygen contents, in Vol%.

The constants c_{10} and c_{11} are given in [Table A.9](#).

The measured value shall be corrected to reference conditions according to water temperature using the formula:

$$f_{ch,on} = \left[f_{ch,on,meas} - (\theta_{gen,ref} - \theta_{gen,meas}) \cdot f_{corr,ch,on} \right] \quad (4)$$

where

$f_{ch,on,meas}$ is the measured losses through the chimney with burner on;

$\theta_{gen,ref}$ is the reference average water temperature in the boiler at test conditions (average of flow and return temperature, usually flow temperature 80 °C, return temperature 60 °C);

$\theta_{gen,meas}$ is the average water temperature in the boiler during measurement of $f_{ch,on,meas}$;

$f_{corr,ch,on}$ is the correction factor for $f_{ch,on}$. Default values for $f_{corr,ch,on} = 0,045$ [%/°C].

5.2.1.2 Thermal losses through the generator envelope, $f_{\text{gen,env}}$

Actual specific thermal losses through the generator envelope, $f_{\text{gen,env}}$, are given by measurement in site:

$$f_{\text{gen,env}} = \frac{\sum (A_{\text{pa}} \cdot \alpha \cdot \Delta\theta_{\text{pa}})}{1000 \cdot P_{\text{gen,del}}} \quad (5)$$

where

A_{pa} is the partial area of the envelop of the boiler, in m²;

α is the heat transfer coefficient, normally $\alpha = 10$ [for a more exact calculation see [Figure A.1](#)], in W/(m² K);

$\Delta\theta_{\text{pa}}$ is the average temperature difference of the partial area of the envelope and the ambient temperature, in K;

$P_{\text{gen,del}}$ is the power input, in kW.

The average water temperature in the boiler at actual conditions has to be about 70 °C but higher than 60 °C.

5.2.1.3 Thermal losses through the chimney with the burner off, $f_{\text{ch,off}}$

$f_{\text{ch,off}}$ is the heat losses through the chimney when the burner is off at test conditions. $f_{\text{ch,off}}$ is expressed as a percentage of the nominal power P_n .

For existing systems, $f_{\text{ch,off}}$ can be calculated by measuring the flow rate and the temperature at the boiler flue gas outlet.

If no data are available, default values are given in [Table A.11](#).

The source of data shall be clearly stated in the calculation report.

5.2.1.4 Measured total thermal losses, power input and calculated gains

Thermal losses through the chimney with the burner on $P_{\text{gen,ls,ch,on}}$ are given by:

$$P_{\text{gen,ls,ch,on}} = \frac{f_{\text{ch,on}}}{100} \cdot P_{\text{gen,del}} \quad (6)$$

Thermal losses through the chimney with the burner off $P_{\text{gen,ls,ch,off}}$ are given by:

$$P_{\text{gen,ls,ch,off}} = \frac{f_{\text{ch,off}}}{100} \cdot P_{\text{gen,del}} \quad (7)$$

Thermal losses through the generator envelope $P_{\text{gen,ls,env}}$ are given by:

$$P_{\text{gen,ls,env}} = f_{\text{gen,env}} \cdot P_{\text{gen,del}} \quad (8)$$

The calculation procedure for condensation at part load is based on gross calorific values to get positive values, so the recovered latent heat of condensation P_{cond} is calculated by (see A.6):

$$P_{\text{cond}} = \frac{Q_{\text{cond}}}{H_s} \cdot P_{\text{gen,del}} \quad (9)$$

where

Q_{cond} is the specific condensation heat (see A.6);

H_s is the gross calorific value (see A.6).

The average power input to the generator $P_{\text{gen,del}}$ in kW is calculated depending on the energy carrier:

$$P_{\text{gen,del}} = E_{\text{gen,in}} \cdot H_i \left[\frac{\text{kWh}}{3\,600 \text{ kJ}} \right] \quad (10)$$

5.2.1.5 Boiler efficiencies from measured values

The efficiency of the boiler at full load $\eta_{\text{gen,Pn}}$ is:

$$\eta_{\text{gen,Pn}} = \frac{P_{\text{gen,del}} - P_{\text{gen,ls,ch,on}} - P_{\text{gen,ls,env}}}{P_{\text{gen,del}}} \quad (11)$$

The efficiency of the boiler at part load is:

$$\eta_{\text{gen,Pint}} = \frac{P_{\text{gen,del}} \cdot \beta_{\text{Pint}} - (\beta_{\text{Pint}} \cdot (P_{\text{gen,ls,ch,on}} - P_{\text{cond}} + P_{\text{gen,ls,env}}) + (1 - \beta_{\text{Pint}}) \cdot (P_{\text{gen,ls,ch,off}} + P_{\text{gen,ls,env}}))}{P_{\text{gen,del}} \cdot \beta_{\text{Pint}}} \quad (12)$$

For condensing boiler P_{cond} is needed, otherwise $P_{\text{cond}} = 0$, see A.6.

The value for stand-by heat losses are:

$$f_{\text{gen,ls,P0}} = f_{\text{ch,off}} + f_{\text{gen,env}} \quad (13)$$

5.2.2 Generator thermal loss calculation at full load

The efficiency at full load $\eta_{\text{gen,Pn}}$ is measured at a reference generator average water temperature $\theta_{\text{gen, test,Pn}}$. This efficiency shall be adjusted to the actual generator average water temperature of the individual installation.

The temperature corrected efficiency at full load for non-condensing boilers $\eta_{\text{gen,Pn,corr}}$ is calculated by:

$$\eta_{\text{gen,Pn,corr}} = \eta_{\text{gen,Pn}} + f_{\text{corr,Pn}} \cdot (\theta_{\text{gen,test,Pn}} - \theta_{\text{HC,m}}) \quad (14)$$

where

$\eta_{\text{gen,Pn}}$ is the generator efficiency at full load. If the performance of the generator has been tested according to relevant standards (see Bibliography) or if the losses are calculated from measured values according to 5.2.1, it can be taken into account. If no values are available, default values shall be found in the relevant national annex or in [Table A.1](#);

$f_{\text{corr,Pn}}$ is the correction factor taking into account variation of the full load efficiency as a function of the generator average water temperature. The value should be given in a national annex. In the absence of national values, default values are given in [Table A.4](#). If the performance of the generator has been tested according to relevant standards (see Bibliography), it can be taken into account;

$\theta_{\text{gen,test,Pn}}$ is the generator average water temperature at test conditions for full load (see [Table A.4](#));

$\theta_{\text{HC,m}}$ is the generator average water temperature as a function of the specific operating conditions (see input data).

The generator efficiency at full load of condensing boilers is tested at a boiler average return temperature of 60 °C and 30 °C.

In that case the temperature corrected efficiency of condensing boilers at full load $\eta_{\text{gen,Pn,corr}}$ is calculated by:

$$\eta_{\text{gen,Pn,corr}} = \eta_{\text{gen,Pn,60}} - \frac{\eta_{\text{gen,Pn,60}} - \eta_{\text{gen,Pn,30}}}{\theta_{\text{gen,test,Pn,60}} - \theta_{\text{gen,test,Pn,30}}} \cdot (\theta_{\text{gen,test,Pn,60}} - \theta_{\text{HC,RT}}) \quad (15)$$

where

$\eta_{\text{gen,Pn,70}}$ is the generator efficiency at full load at a boiler average return temperature of 60 °C (80/60 °C). If the performance of the generator has been tested according to relevant standards (see Bibliography) or if the losses are calculated from measured values according to chapter 5.2.1, it can be taken into account. If no values are available, default values shall be found in the relevant national annex or in [Table A.1](#);

$\eta_{\text{gen,Pn,30}}$ is the generator efficiency at full load at a boiler average return temperature of 30 °C (50/30 °C). If the performance of the generator has been tested according to relevant standards (see Bibliography) or if the losses are calculated from measured values according to 5.2.1, it can be taken into account. If no values are available, default values shall be found in the relevant national annex or in [Table A.1](#);

$\theta_{\text{gen,test,Pn,60}}$ is the generator average return temperature at test conditions for full load (80/60 °C) (see [A.1.1.1](#));

$\theta_{\text{gen,test,Pn,30}}$ is the generator average return temperature at test conditions for full load (50/30 °C) (see [A.1.1.1](#));

$\theta_{\text{HC,RT}}$ is the generator average return temperature to the generator for condensing boilers as a function of the specific operating conditions (see input data).

In order to simplify the calculations, the efficiencies and heat losses determined at test conditions are adjusted to the actual generator average water temperature.

The corrected generator thermal loss at full load $P_{\text{gen,ls,Pn,corr}}$ is calculated by:

$$P_{\text{gen,ls,Pn,corr}} = \frac{(f_{\text{Hs/Hi}} - \eta_{\text{gen,Pn,corr}})}{\eta_{\text{gen,Pn,corr}}} \cdot P_{\text{n}} \quad (16)$$

where

P_{n} is the generator output at full load, in kW;

$f_{\text{Hs/Hi}}$ is the ratio of gross calorific value/net calorific value according to energy carrier, see [Table A.9](#).

5.2.2.1 Generator thermal loss calculation at intermediate load

The efficiency at intermediate load $\eta_{\text{gen,Pint}}$ is measured at a reference generator average water temperature $\theta_{\text{gen,test,Pint}}$. This efficiency has to be adjusted to the actual generator average water temperature of the individual installation.

The temperature corrected efficiency at intermediate load $\eta_{\text{gen,Pint,corr}}$ is calculated by:

$$\eta_{\text{gen,Pint,corr}} = \eta_{\text{gen,Pint}} + f_{\text{corr,Pint}} \cdot (\theta_{\text{gen,test,Pint}} - \theta_{\text{HC,m}}) \quad (17)$$

where

$\eta_{\text{gen,Pint}}$ is the generator efficiency at intermediate load. If the performance of the generator has been tested according to relevant standards (see Bibliography) or if the losses are calculated from measured values according to [5.2.1](#), it can be taken into account. If no values are available, default values shall be found in the relevant national annex or in [Table A.1](#);

$f_{\text{corr,Pint}}$ is the correction factor taking into account variation of the efficiency as a function of the generator average water temperature. The value should be given in a national annex. In the absence of national values, default values are given in [A.1.1.1](#). If the performance of the generator has been tested according to relevant standards (see Bibliography), it can be taken into account;

$\theta_{\text{gen,test,Pint}}$ is the generator average water temperature (or return temperature to the boiler for condensing boilers) at test conditions for intermediate load (see [A.1.1.1](#));

$\theta_{\text{HC,m}}$ is the generator average water temperature (or return temperature to the generator for condensing boilers) as a function of the specific operating conditions (see input data).

The intermediate load depends on the generator type. Default values are given in [Annex B](#).

The corrected generator thermal loss at intermediate load $P_{\text{gen,ls,Pint,corr}}$ is calculated by:

$$P_{\text{gen,ls,Pint,corr}} = \frac{(f_{\text{Hs/Hi}} - \eta_{\text{gen,Pint,corr}})}{\eta_{\text{gen,Pint,corr}}} \cdot P_{\text{int}} \quad (18)$$

where

P_{int} generator output at intermediate load, in kW;

$f_{\text{Hs/Hi}}$ conversion factor for delivered energy (see [Table A.9](#)).

5.2.2.2 Generator thermal loss calculation at 0 % load

The generator heat loss at 0 % load $P_{\text{gen,ls,P0}}$ is determined for a test temperature difference according to relevant testing standards (see Bibliography). If the performance of the generator has been tested according to relevant standards (see Bibliography) or if the losses are measured depending on 5.2.1, it can be taken into account. If no manufacturer or national annex data are available, default values are given in A.1.1.2.

The temperature corrected generator thermal loss at 0 % load $P_{\text{gen,ls,P0,corr}}$ is calculated by:

$$P_{\text{gen,ls,P0,corr}} = \frac{P_n}{\eta_{\text{gen,Pn}}} \cdot f_{\text{gen,ls,P0}} \cdot f_{\text{Hs/Hi}} \cdot \left(\frac{\theta_{\text{HC,m}} - \theta_{\text{i,brm}}}{\Delta\theta_{\text{gen,test,P0}}} \right)^{1,25} \quad (19)$$

where

- $P_{\text{gen,ls,P0}}$ is the stand-by heat loss at 0 % load at test temperature difference $\Delta\theta_{\text{gen,test,P0}}$;
- $\eta_{\text{gen,Pn}}$ is the generator efficiency at full load; for condensing boiler is $\eta_{\text{gen,Pn,60}}$;
- $f_{\text{Hs/Hi}}$ is the conversion factor for delivered energy (see A.2);
- $\theta_{\text{HC,m}}$ is the generator average water temperature (or return temperature to the generator for condensing boilers) as a function of the specific operating conditions (see input data);
- $\theta_{\text{i,brm}}$ is the indoor temperature of the boiler room. Default values are given in A.1.3.3;
- $\Delta\theta_{\text{gen,test,P0}}$ is the difference between generator mean water temperature and room temperature at test conditions. Default values of mean water temperature of the generator at test conditions are given in A.1.1.1.

5.2.2.3 Boiler thermal loss at specific load ratio $\beta_{\text{H,gen}}$ and power output P_{Px}

The actual load ratio $\beta_{\text{H,gen}}$ of each boiler is calculated according to input data.

If $0 \leq \beta_{\text{H,gen}} \leq \beta_{\text{Pint}}$ the generator thermal loss $P_{\text{gen,ls,Px}}$ is calculated by:

$$P_{\text{gen,ls,Px}} = \frac{\beta_{\text{H,gen}}}{\beta_{\text{Pint}}} \cdot (P_{\text{gen,ls,Pint,corr}} - P_{\text{gen,ls,P0,corr}}) + P_{\text{gen,ls,P0,corr}} \quad (20)$$

If $\beta_{\text{Pint}} < \beta_{\text{H,gen}} \leq 1$ the generator thermal loss $P_{\text{gnr,ls,Px}}$ is calculated by:

$$P_{\text{gen,ls,Px}} = \frac{\beta_{\text{H,gen}} - \beta_{\text{Pint}}}{\beta_{\text{Pn}} - \beta_{\text{Pint}}} \cdot (P_{\text{gen,ls,Pn,corr}} - P_{\text{gen,ls,Pint,corr}}) + P_{\text{gen,ls,Pint,corr}} \quad (21)$$

The total boiler thermal loss $Q_{\text{gen,ls}}$ during the considered time of operation of the boiler for heating is calculated by:

$$Q_{\text{gen,ls}} = P_{\text{gen,ls,Px}} \cdot (t_{\text{H}} - t_{\text{W}}) \quad (22)$$

where

- t_{H} are the heating hours (see input data), in h/mth;
- t_{W} is the running time for hot water production – when connected (see Table 3), in h/mth.

5.2.2.4 Total generation thermal losses

The total generation sub-system thermal losses are the sum of the boiler thermal losses:

$$Q_{H,gen,ls} = \sum Q_{gen,ls} \quad (23)$$

5.2.3 Total auxiliary energy

The average auxiliary power for each boiler $P_{aux,Px}$ is calculated by linear interpolation, according to the boiler load β_{gen} (calculated according to input data), between:

- $P_{aux,Pn}$ auxiliary power of the boiler at full load ($\beta_{H,gen} = 1$),
- $P_{aux,Pint}$ auxiliary power of the boiler at intermediate load ($\beta_{H,gen} = \beta_{Pint}$),
- $P_{aux,P0}$ auxiliary power of the boiler at stand-by ($\beta_{H,gen} = 0$).

If no declared or measured data are available, default values are given in [A.1.2](#).

If $0 \leq \beta_{H,gen} \leq \beta_{Pint}$ then $P_{aux,Px}$ is given by:

$$P_{aux,Px} = \frac{\beta_{H,gen}}{\beta_{Pint}} \cdot (P_{aux,Pint} - P_{aux,P0}) + P_{aux,P0} \quad (24)$$

If $\beta_{Pint} < \beta_{H,gen} \leq 1$ then $P_{aux,Px}$ is given by:

$$P_{aux,Px} = \frac{\beta_{H,gen} - \beta_{Pint}}{1 - \beta_{Pint}} \cdot (P_{aux,Pn} - P_{aux,Pint}) + P_{aux,Pint} \quad (25)$$

The total auxiliary energy for a boiler is given by:

$$W_{gen} = P_{aux,Px} \cdot (t_H - t_W) + P_{aux,P0} \cdot (24 \cdot d_{mth} - t_H) \quad (26)$$

where

- $P_{aux,P0}$ is the stand-by auxiliary power;
- t_H is the running time (in the calculation interval) (see input data), in h/mth;
- t_W is the running time for hot water production – when connected (see [Table 3](#)), in h/mth;
- d_{mth} is the number of days per month (see [Table 3](#)).

The generation sub-system auxiliary energy $W_{H,gen}$ is given by:

$$W_{H,gen} = \sum W_{gen} \quad (27)$$

5.2.4 Recoverable generation system thermal losses

5.2.4.1 Auxiliary energy

For the recoverable auxiliary energy, a distinction is made between:

- recoverable auxiliary energy transmitted to the heating medium (e.g. water). It is assumed that the auxiliary energy transmitted to the energy vector is totally recovered;
- recoverable auxiliary energy transmitted to the heated space.

The recovered auxiliary energy transmitted to the heating medium $Q_{\text{gen,aux,rvd}}$ is calculated by:

$$Q_{\text{gen,aux,rvd}} = W_{\text{gen}} \cdot f_{\text{rvd,aux}} \quad (28)$$

where

$f_{\text{rvd,aux}}$ is the part of the auxiliary energy transmitted to the distribution sub-system. The value should be given in a national annex. In the absence of national values, a default value is given in [A.1.3.1](#). If the performance of the generator has been declared by the manufacturer, it can be taken into account.

Recovered auxiliary energy already taken into account in efficiency data shall not be calculated for recovery again. It has to be calculated for auxiliary energy need only.

NOTE Measured efficiency according to relevant standards usually includes the effect of heat recovered from auxiliary energy for oil heating, combustion air fan, control devices, primary pump (i.e. heat recovered from auxiliaries is measured with the useful output).

The recoverable auxiliary energy transmitted to the heated space $Q_{\text{gen,aux,rbl}}$ is calculated by:

$$Q_{\text{gen,aux,rbl}} = W_{\text{gen}} \cdot (1 - f_{\text{brm}}) \cdot f_{\text{rbl,aux}} \quad (29)$$

where

$f_{\text{rbl,aux}}$ is the part of the auxiliary energy not transmitted to the distribution sub-system. The value should be given in a national annex. In the absence of national values, a default value is given in [A.1.3.1](#). If the performance of the generator has been certified, it can be taken into account;

f_{brm} is the temperature reduction factor depending on location of the generator. The value of f_{brm} should be given in a national annex. In the absence of national values, a default value is given in [A.1.3.3](#).

5.2.4.2 Generator thermal losses through the jacket (generator envelope)

Only the thermal losses through the jacket (generator envelope) are considered as recoverable and depend on the burner type. The thermal losses through the generator envelope are expressed as a fraction of the total stand-by heat losses.

The recoverable thermal losses through the jacket (generator envelope) $Q_{\text{gen,ls,env,rbl}}$ are calculated by:

$$Q_{\text{gen,ls,env,rbl}} = P_{\text{gen,ls,P0,corr}} \cdot (1 - f_{\text{brm}}) \cdot f_{\text{env}} \cdot (t_{\text{H}} - t_{\text{W}}) \quad (30)$$

where

f_{env} is the thermal losses through the generator and the jacket (generator envelope) expressed as a fraction of the total stand-by heat losses. The value of f_{env} should be given in a national annex. In the absence of national values, default values are given in [A.1.3.2](#). If the performance of the generator has been tested, it can be taken into account;

f_{brm} is the temperature reduction factor depending on location of the generator. The value of f_{brm} should be given in a national annex. In the absence of national values, a default value is given in [A.1.3.3](#);

t_{H} is the analytical running time (during a day), in h/mth;

t_{W} is the daily running time for hot water production – when connected, in h/mth.

5.2.4.3 Total recoverable generation system thermal losses

The total recovered auxiliary energy $Q_{\text{H,gen,aux,rvd}}$ is calculated by:

$$Q_{\text{H,gen,aux,rvd}} = \sum Q_{\text{gen,aux,rvd}} \quad (31)$$

The total recoverable generation system thermal losses $Q_{\text{H,gen,ls,rbl}}$ are calculated by:

$$Q_{\text{H,gen,ls,rbl}} = \sum Q_{\text{gen,ls,env,rbl}} + \sum Q_{\text{gen,aux,rbl}} \quad (32)$$

5.2.5 Fuel input

Fuel heat input $E_{\text{H,gen,in}}$ is calculated according to Formula 1.

Annex A (informative)

Additional formulas and default values for parametering the boiler efficiency method

A.1 Information on the method

A.1.1 Generator efficiencies and stand-by losses

A.1.1.1 Default values for generator efficiency at full load and intermediate load as a function of the generator power output

The generator efficiency at full load and intermediate load as a function of the generator power output is given by:

$$\eta_{\text{gen},P_n} = \frac{c_1 + c_2 \cdot \log P_n}{100} \quad (\text{A.1})$$

For condensing boilers the generator efficiency at full load is to elaborate between 60°C and 30°C return temperature:

$$\eta_{\text{gen},P_n,60} = \frac{c_1 + c_2 \cdot \log P_n}{100} \quad (\text{A.2})$$

$$\eta_{\text{gen},P_n,30} = \frac{c_1 + c_2 \cdot \log P_n}{100} \quad (\text{A.3})$$

The generator efficiency at intermediate load as a function of the generator power output is given by:

$$\eta_{\text{gen},P_{\text{int}}} = \frac{c_3 + c_4 \cdot \log P_n}{100} \quad (\text{A.4})$$

where

P_n is the nominal power output, in kW limited to a maximum value of 400 kW. If the nominal power output of the generator is higher than 400 kW, then the value of 400 kW is adopted in Formulae A.1, and A.2;

c_1, c_2, c_3, c_4 are the coefficients given in [Table A.1](#).

Table A.1 — Parameters for calculation of generator efficiency and temperature limitation

| Boiler type | Build year | Factor c_1 | Factor c_2 | Factor c_3 | Factor c_4 | $\theta_{\text{gen,test,Pn}}$ °C | $\theta_{\text{gen,test,Pint}}$ °C |
|--|--------------|--------------|--------------|--------------|--------------|-------------------------------------|---------------------------------------|
| Standard boilers: | | | | | | | |
| Multi-fuel boiler | before 1978 | 77,0 | 2,0 | 70,0 | 3,0 | 70 | 50 |
| | 1978 to 1987 | 79,0 | 2,0 | 74,0 | 3,0 | 70 | 50 |
| Atmospheric solid fuel boiler (fossil and biomass fuel) | before 1978 | 78,0 | 2,0 | 72,0 | 3,0 | 70 | 50 |
| | 1978 to 1994 | 80,0 | 2,0 | 75,0 | 3,0 | 70 | 50 |
| | after 1994 | 81,0 | 2,0 | 77,0 | 3,0 | 70 | 50 |
| Atmospheric gas boiler | before 1978 | 79,5 | 2,0 | 76,0 | 3,0 | 70 | 50 |
| | 1978 to 1994 | 82,5 | 2,0 | 78,0 | 3,0 | 70 | 50 |
| | after 1994 | 85,0 | 2,0 | 81,5 | 3,0 | 70 | 50 |
| Fan-assisted boiler (fossil and biomass fuel) | before 1978 | 80,0 | 2,0 | 75,0 | 3,0 | 70 | 50 |
| | 1978 to 1986 | 82,0 | 2,0 | 77,5 | 3,0 | 70 | 50 |
| | 1987 to 1994 | 84,0 | 2,0 | 80,0 | 3,0 | 70 | 50 |
| | after 1994 | 85,0 | 2,0 | 81,5 | 3,0 | 70 | 50 |
| Burner replacement (only fan- assisted boilers) | before 1978 | 82,5 | 2,0 | 78,0 | 3,0 | 70 | 50 |
| | 1978 to 1994 | 84,0 | 2,0 | 80,0 | 3,0 | 70 | 50 |
| Low temperature boilers: | | | | | | | |
| Atmospheric gas boiler | 1978 to 1994 | 85,5 | 1,5 | 86,0 | 1,5 | 70 | 40 |
| | after 1994 | 88,5 | 1,5 | 89,0 | 1,5 | 70 | 40 |
| Circulation water heater (11 kW, 18 kW and 24 kW) | before 1987 | 84,0 | 1,5 | 82,0 | 1,5 | 70 | 40 |
| | 1987 to 1994 | 86,0 | 1,5 | 82,0 | 1,5 | 70 | 40 |
| Fan-assisted boiler | before 1987 | 84,0 | 1,5 | 82,0 | 1,5 | 70 | 40 |
| | 1987 to 1994 | 86,0 | 1,5 | 86,0 | 1,5 | 70 | 40 |
| | after 1994 | 88,5 | 1,5 | 89,0 | 1,5 | 70 | 40 |
| Burner replacement (only fan- assisted boilers) | before 1987 | 86,0 | 1,5 | 85,0 | 1,5 | 70 | 40 |
| | 1987 to 1994 | 86,0 | 1,5 | 86,0 | 1,5 | 70 | 40 |
| Condensing boiler (oil/gas) | | | | | | | |
| Condensing boiler | before 1987 | 89,0 | 1,0 | 95,0 | 1,0 | 60 ^c | 30 ^b |
| | 1987 to 1994 | 91,0 | 1,0 | 97,5 | 1,0 | 60 ^c | 30 ^b |
| | | 92,0 | 1,0 | | | 30 ^c | |
| | after 1994 | 92,0 | 1,0 | 98,0 | 1,0 | 60 ^c | 30 ^b |
| | | 93,0 | 1,0 | | | 30 ^c | |
| Condensing boiler, improved ^a from 1999 | oil/gas | 94,0 | 1,0 | 103 | 1,0 | 60 ^c | 30 ^b |
| | oil | 102,0 | 0,3 | | | 30 ^c | |
| | gas | 102,0 | 1,0 | | | 30 ^c | |
| ^a If standard values for “condensing boilers improved” are used for the calculation, the product value for the boiler installed must exhibit the above given efficiency. ^b For condensing boilers according to directive 92/42/EEC ^[28] , testing applies at a return path temperature of 30 °C. ^c For condensing boilers, testing applies at a return path temperature of 60 °C respectively 30 °C. | | | | | | | |

Table A.2 — Parameters for calculation of boiler efficiency and temperature limitation based on EN 303-5^[10]

| Boiler type | c ₁ | c ₂ | c ₃ | c ₄ | θ _{gen,test,Pn} °C | θ _{gen,test,Pint} °C |
|-------------|----------------|----------------|----------------|----------------|--------------------------------|----------------------------------|
| Class 1 | 47 | 6 | 48 | 6 | 70 | 50 |
| Class 2 | 57 | 6 | 58 | 6 | 70 | 50 |
| Class 3 | 67 | 6 | 68 | 6 | 70 | 50 |

A.1.1.2 Stand-by heat losses

Default value for the stand-by heat losses $f_{gen,ls,P0}$ as a function of the generator power output is calculated by:

$$f_{gen,ls,P0} = \frac{c_5 \cdot (P_n)^{c_6}}{100} \tag{A.5}$$

where

P_n is the nominal power output, in kW;

c_5, c_6 are the parameters given in [Table A.3](#).

Table A.3 — Parameters for calculation of stand-by heat losses

| Boiler type | Build year | Factor c ₅ | Factor c ₆ | θ _{gen,test,P0} °C |
|--|--------------|-----------------------|-----------------------|--------------------------------|
| Standard boilers: | | | | |
| Multi-fuel boilers | before 1987 | 12,5 | -0,28 | 70 |
| Atmospheric solid fuel boiler (fossil and biomass fuel) | before 1978 | 12,5 | -0,28 | 70 |
| | 1978 to 1994 | 10,5 | -0,28 | 70 |
| | after 1994 | 8,0 | -0,28 | 70 |
| atmospheric gas boilers | before 1978 | 8,0 | -0,27 | 70 |
| | 1978 to 1994 | 7,0 | -0,3 | 70 |
| | after 1994 | 8,5 | -0,4 | 70 |
| Fan-assisted boilers (fossil and biomass fuel) | before 1978 | 9,0 | -0,28 | 70 |
| | 1978 to 1994 | 7,5 | -0,31 | 70 |
| | after 1994 | 8,5 | -0,4 | 70 |
| Biomass boilers | after 1994 | 14 | -0,28 | 70 |
| Low temperature boilers: | | | | |
| Atmospheric gas boilers | before 1994 | 6,0 | -0,32 | 70 |
| | after 1994 | 6,1 | -0,4 | 70 |
| Circulation water heaters (combination boilers 11 kW, 18 kW and 24 kW) | before 1994 | 2,2 | 0 | 70 |
| Combination boilers KSp ^b | after 1994 | 2,2 | 0 | 70 |
| ^a DL: Boiler with integrated domestic water heating working on the instantaneous principle with heat exchanger ($V < 2$ l). ^b KSp: Boiler with integrated domestic water heating working on the instantaneous principle with small storage tank ($2 < V < 10$ l). | | | | |

Table A.3 (continued)

| Boiler type | Build year | Factor c_5 | Factor c_6 | $\theta_{\text{gen,test,P0}}$ °C |
|---|-------------|--------------|--------------|-------------------------------------|
| Combination boilers DL ^a | after 1994 | 1,2 | 0 | 70 |
| Fan-assisted boilers (oil/gas) | before 1994 | 7,0 | -0,37 | 70 |
| | after 1994 | 4,25 | -0,4 | 70 |
| Condensing boilers (oil/gas): | | | | |
| Condensing boilers (oil/gas) | before 1994 | 7,0 | -0,37 | 70 |
| | after 1994 | 4,0 | -0,4 | 70 |
| Combination boilers KSp ^b (11 kW, 18 kW and 24 kW) | after 1994 | 2,2 | 0 | 70 |
| Combination boilers DL ^a (11 kW, 18 kW and 24 kW) | after 1994 | 1,2 | 0 | 70 |

^a DL: Boiler with integrated domestic water heating working on the instantaneous principle with heat exchanger ($V < 2$ l).

^b KSp: Boiler with integrated domestic water heating working on the instantaneous principle with small storage tank ($2 < V < 10$ l).

A.1.1.3 Correction factor taking into account variation of efficiency depending on generator average water temperature

A.1.1.3.1 Default values

See [Tables A.4](#) and [A.5](#).

Table A.4 — Default values for full load correction factor $f_{\text{corr,Pn}}$

| Generator type | Boiler average water temperature at boiler test conditions for full load $\theta_{\text{gen,test,Pn}}$ | Correction factor $f_{\text{corr,Pn}}$ |
|--|---|---|
| Solid fuel boiler (fossil and biomass fuel) | | |
| Standard boiler | 70 °C | 0,0 %/°C |
| Oil/gas boiler | | |
| Standard boiler | 70 °C | 0,0 %/°C |
| Low temperature boiler | 70 °C | 0,04 %/°C |

Table A.5 — Intermediate load correction factor $f_{\text{corr,Pint}}$

| Generator type | Generator average water temperature at boiler test conditions for intermediate load $\theta_{\text{gen,test,Pint}}$ | Correction factor $f_{\text{corr,Pint}}$ |
|--|--|---|
| Solid fuel boiler (fossil and biomass fuel) | | |
| Standard boiler | 70 °C | 0,04 %/°C |
| Oil/gas boiler | | |
| Standard boiler | 50 °C | 0,04 %/°C |
| Low temperature boiler | 40 °C | 0,04 %/°C |
| Gas condensing boiler | 30 °C ^a | 0,20 %/°C |
| Oil condensing boiler | 30 °C ^a | 0,10 %/°C |
| ^a Return temperature. | | |

For a condensing boiler, testing is not made with a defined generator average water temperature (average of the supply and return temperature), but with a return temperature of 30 °C. The efficiency corresponding to this return temperature can be applied for the generator average water temperature of 35 °C.

A.1.1.3.2 Calculated values

Correction factor $f_{\text{corr,Pn}}$ may be calculated using efficiency data from additional tests performed at a lower average water temperature, using the following formula:

$$f_{\text{corr,Pn}} = \frac{\eta_{\text{Pn}} - \eta_{\text{Pn,add}}}{\theta_{\text{gen,test,Pn,add}} - \theta_{\text{gen,test,Pn}}} \quad (\text{A.6})$$

where

η_{Pn} is the full load efficiency at standard test conditions with average water temperature $\theta_{\text{gen,test,Pn}}$;

$\eta_{\text{Pn,add}}$ is the full load efficiency with mean water temperature $\theta_{\text{gen,test,Pn,add}}$.

Correction factor $f_{\text{corr,Pint}}$ may be calculated using efficiency data from additional tests performed at a higher average water temperature, using the following formula:

$$f_{\text{corr,Pint}} = \frac{\eta_{\text{Pint}} - \eta_{\text{Pint,add}}}{\theta_{\text{gen,test,Pint,add}} - \theta_{\text{gen,test,Pint}}} \quad (\text{A.7})$$

where

η_{Pint} is the intermediate load efficiency at standard test conditions with average water temperature $\theta_{\text{gen,test,Pint}}$;

$\eta_{\text{Pint,add}}$ is the intermediate load efficiency with average water temperature $\theta_{\text{gen,test,Pint,add}}$.

A.1.2 Auxiliary energy

Default value for the power consumption of auxiliary equipment is calculated by:

$$P_{aux,Px} = \frac{c_7 + c_8 \cdot (P_n)^n}{1000} \tag{A.8}$$

where

P_n is the nominal power output, in kW;

c_7, c_8, n are the parameters given in [Table A.6](#).

Table A.6 — Parameters for calculation of power consumption of auxiliary equipment

| Boiler type | Load | c_7 W | c_8 W | n |
|--|-----------|-----------------|------------|------|
| Since 1994 | | | | |
| Heating boiler with forced draught burner ^a (fossil and biomass fuel) | P_n | 0 | 45 | 0,48 |
| | P_{int} | 0 | 15 | 0,48 |
| | P_0 | 15 | 0 | 0 |
| Atmospheric gas boiler and solid fuel boiler (fossil and biomass fuel) up to 250 kW | P_n | 40 | 0,35 | 1 |
| | P_{int} | 20 | 0,1 | 1 |
| | P_0 | 15 | 0 | 0 |
| Atmospheric gas boiler with more than 250 kW | P_n | 80 | 0,7 | 1 |
| | P_{int} | 40 | 0,2 | 1 |
| | P_0 | 15 | 0 | 0 |
| Automatically-fed pellet central boiler ^a , system with buffer tank | P_n | 40 | 2 | 1 |
| | P_{int} | 40 | 1,8 | 1 |
| | P_0 | 15 | 0 | 0 |
| Automatically-fed wood chips central boiler ^a , system with buffer tank | P_n | 60 | 2,6 | 1 |
| | P_{int} | 70 | 2,2 | 1 |
| | P_0 | 15 | 0 | 0 |
| All other boilers | | | | |
| Standard boiler | | | | |
| Multi fuel boiler | P_n | 0 | 45 | 0,48 |
| | P_{int} | 0 | 15 | 0,48 |
| | P_0 | 20 ^b | 0 | 0 |
| Solid fuel boiler (fossil and biomass fuel) | P_n | 15 ^b | 0 | 0 |
| | P_{int} | 15 ^b | 0 | 0 |
| | P_0 | 15 ^b | 0 | 0 |
| Atmospheric gas boiler | P_n | 40 | 0,148 | 1 |
| | P_{int} | 40 | 0,148 | 1 |
| | P_0 | 15 ^b | 0 | 0 |

Table A.6 (continued)

| Boiler type | Load | c_7 W | c_8 W | n |
|---|-----------|-----------------|------------|------|
| Heating boiler with forced draught burner (oil/gas) | P_n | 0 | 45 | 0,48 |
| | P_{int} | 0 | 15 | 0,48 |
| | P_0 | 15 ^b | 0 | 0 |
| Low temperature boiler | | | | |
| Atmospheric gas boiler | P_n | 40 | 0,148 | 1 |
| | P_{int} | 40 | 0,148 | 1 |
| | P_0 | 15 ^b | 0 | 0 |
| Circulation water heaters | P_n | 0 | 45 | 0,48 |
| | P_{int} | 0 | 15 | 0,48 |
| | P_0 | 15 ^b | 0 | 0 |
| Heating boiler with forced draught burner (oil/gas) | P_n | 0 | 45 | 0,48 |
| | P_{int} | 0 | 15 | 0,48 |
| | P_0 | 15 ^b | 0 | 0 |
| Condensing boiler (oil/gas) | | | | |
| condensing boiler (oil/gas) | P_n | 0 | 45 | 0,48 |
| | P_{int} | 0 | 15 | 0,48 |
| | P_0 | 15 ^b | 0 | 0 |
| ^a If there is a forced draught ventilator assisting the burner than the values $P_{aux,Pn}$; $P_{aux,Pint}$ increase by 40 %. ^b If an electronic controller is used, otherwise $P_{aux,P0} = 0$. | | | | |

A.1.3 Recoverable generation thermal losses

A.1.3.1 Auxiliary energy

Default value of the part of the auxiliary energy transmitted to the distribution sub-system $f_{rvd,aux}$ is 0,75.

The part of the auxiliary energy transmitted to the heated space $f_{rbl,aux}$ is calculated by:

$$f_{rbl,aux} = 1 - f_{rvd,aux} \quad (A.9)$$

A.1.3.2 Generator envelope

The part of stand-by heat losses attributed to heat losses through the generator envelope is given by f_{env} . Default values of f_{env} are given in [Table A.7](#).

Table A.7 — Part of stand-by heat losses attributed to losses through the generator envelope

| Burner type | f_{env} |
|---------------------|-----------|
| Atmospheric boiler | 0,50 |
| Fan assisted boiler | 0,75 |

A.1.3.3 Default data according to boiler location

Table A.8 — Temperature reduction factor and default installation room temperature

| Generator location | Temperature reduction factor, f_{brm} — | Installation room temperature, $\theta_{i,brm}$ °C |
|--|--|---|
| Outdoors (for room independent boiler) | 1 | θ_e |
| In the boiler room | 0,3 | 13 |
| Under roof | 0,2 | 5 |
| Inside heated space | 0,0 | 20 |

A.2 Conversion of the energy content of energy carriers

Factors for converting the energy content of energy carriers are specified in [Table A.9](#).

Table A.9 — Conversion factors, as a function of energy carriers

| Energy carrier | | Ratio of gross calorific value H_s/H_i (Conversion factor for delivered energy) f_{H_s/H_i} |
|---|-----------------------------|--|
| Fuels | Fuel oil | 1,06 |
| | Natural gas | 1,11 |
| | Liquid petroleum gas | 1,09 |
| | Anthracite coal | 1,04 |
| | Lignite coal | 1,07 |
| | Wood | 1,08 |
| Area/district heating by CHP ^a | Fossil fuels | 1,00 |
| | Renewable fuels | 1,00 |
| Area/district heating power plants | Fossil fuels | 1,00 |
| | Renewable fuels | 1,00 |
| Electricity | Electrical power source mix | 1,00 |

^a These values are typical for average area heating/district heating systems with a 70 % contribution by CHP plants.

A.3 Deviation from default values

The above values need not to be used if the real net and gross calorific values of fuels are known. The factor H_s/H_i is then the ratio of gross calorific value to net calorific value.

A.4 Fuel constants for flue gas measurement depending on Siegert constants

Table A.10 — Fuel constants for flue gas measurement depending on Sievert constants

| | Natural gas | LPG | Light oil EL | Heavy fuel oil | Town gas |
|----------|-------------|-------|--------------|----------------|----------|
| c_{10} | 0,66 | 0,63 | 0,68 | 0,68 | 0,63 |
| c_{11} | 0,009 | 0,008 | 0,007 | 0,007 | 0,011 |

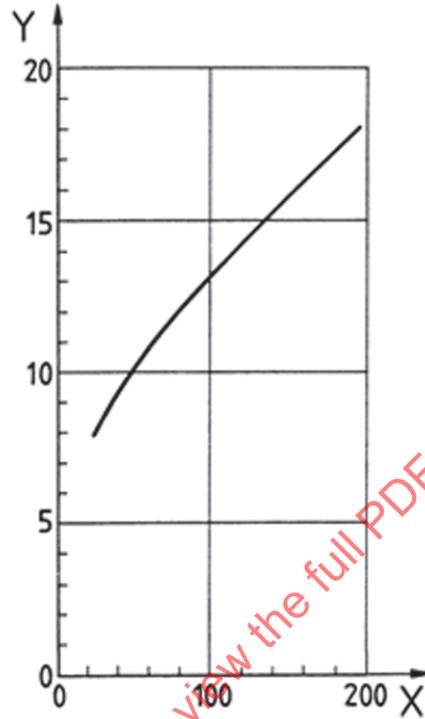
**Key**X θ_{env} in °CY α in Wh/(m² K)

Figure A.1 — Heat transfer coefficient α for radiation and convection at horizontal and vertical area at ambient temperature $\theta_{brm} = 20$ °C depending on the average envelope temperature θ_{env}

A.5 Default values for calculation of thermal losses through the chimney with the burner off

See [Table A.11](#).

Table A.11 — Default value of $f_{ch,off}$

| Description | $f_{ch,off}$ % |
|--|-------------------|
| Liquid fuel or gas fired boiler with the fan before the combustion chamber and automatic closure of air intake with burner off: Premixed burners | 0,2 0,2 |
| Wall mounted, gas fired boiler with fan and wall flue gas exhaust | 0,4 |
| Liquid fuel or gas fired boiler with the fan before the combustion chamber and no closure of air intake with burner off: Chimney height ≤ 10 m Chimney height > 10 m | 1,0 1,2 |

A.6 Additional default data and calculation for condensing boilers

Flue gas temperature (at boiler outlet connection to flue gas), if not measured, is calculated by:

$$\theta_{fg} = \theta_{gen,RT} + \Delta\theta_{wfg} \tag{A.10}$$

where

$\theta_{gen,RT}$ is the boiler return water temperature, calculated according to [Annex A](#).

The return temperature for part load measurement is 30 °C. The temperature difference between boiler return water temperature and flue gas temperature at part load is normally 5 K.

Actual amount of dry flue gas $V_{fg,dry}$ in Nm³/Nm³ or Nm³/kg is calculated by:

$$V_{fg,dry} = V_{fg,st,dry} \cdot \frac{20,94}{20,94 - X_{O_2,fg,dry}} \tag{A.11}$$

Actual amount of dry combustion air $V_{air,dry}$ in Nm³/Nm³ or Nm³/kg is calculated by:

$$V_{air,dry} = V_{air,st,dry} + V_{fg,dry} - V_{fg,st,dry} \tag{A.12}$$

NOTE $V_{fg,dry} - V_{fg,st,dry}$ is excess air.

Combustion air temperature θ_{brm} is assumed either equal to installation room temperature for type B appliances or to external air temperature for type C appliances.

Saturation humidity of air $m_{H_2O,air,sat}$ and flue gas $m_{H_2O,fg,sat}$ shall be calculated according to θ_{brm} (combustion air temperature) and θ_{fg} (flue gas temperature), respectively, and expressed as kg of humidity per Nm³ of dry air or dry flue gas. Data can be found in [Table A.12](#). Linear or polynomial interpolation shall be used for intermediate temperatures.

Table A.12 — Saturation humidity as a function of temperature

| Temperature (θ_{air} or θ_{fg}) | °C | 0 | 10 | 20 | 30 | 40 | 50 | 60 | 70 |
|--|-----------------------------------|----------|----------|----------|----------|----------|---------|---------|---------|
| Saturation humidity $m_{H_2O,air,sat}$ or $m_{H_2O,fg,sat}$ | kg/Nm ³ _{dry} | 0,004 93 | 0,009 86 | 0,019 12 | 0,035 21 | 0,063 31 | 0,111 2 | 0,197 5 | 0,359 6 |

NOTE Saturation humidity is expressed as kg of water vapour per Nm³ of dry gas (either air or flue gas).

Total humidity of combustion air $m_{\text{H}_2\text{O,air}}$ in kg/Nm³ or kg/kg is calculated by:

$$m_{\text{H}_2\text{O,air}} = m_{\text{H}_2\text{O,air,sat}} \cdot V_{\text{air,dry}} \cdot \frac{x_{\text{air}}}{100} \quad (\text{A.13})$$

where

x_{air} is the combustion air relative humidity. Default value is given in [Table A.14](#).

Total humidity of flue gas $m_{\text{H}_2\text{O,fg}}$ in kg/Nm³ or kg/kg is calculated by:

$$m_{\text{H}_2\text{O,fg}} = m_{\text{H}_2\text{O,fg,sat}} \cdot V_{\text{fg,dry}} \cdot \frac{x_{\text{fg}}}{100} \quad (\text{A.14})$$

where

x_{fg} is the flue gas relative humidity. Default value is given [Table A.14](#).

The amount of condensing water $m_{\text{H}_2\text{O,cond}}$ in kg/Nm³ or kg/kg is calculated by:

$$m_{\text{H}_2\text{O,cond}} = m_{\text{H}_2\text{O,st}} + m_{\text{H}_2\text{O,air}} - m_{\text{H}_2\text{O,fg}} \quad (\text{A.15})$$

If $m_{\text{H}_2\text{O,cond}}$ is negative, there is no condensation. Then $m_{\text{H}_2\text{O,cond}} = 0$ and $f_{\text{cond}} = 0$.

The specific latent heat of condensation $h_{\text{cond,fg}}$ in kJ/kg is calculated by:

$$h_{\text{cond,fg}} = 2\,500,6 \text{ kJ/kg} - \theta_{\text{fg}} \times 2,435 \text{ kJ/kg}\cdot^\circ\text{C} \quad (\text{A.16})$$

or

$$h_{\text{cond,fg}} = 694,61 \text{ Wh/kg} - \theta_{\text{fg}} \times 0,676\,4 \text{ Wh/kg}\cdot^\circ\text{C} \quad (\text{A.17})$$

Use Formula A.16 or A.17 according to the choice of units for energy and time.

The specific condensation heat Q_{cond} in kJ/kg is calculated with:

$$Q_{\text{cond}} = m_{\text{H}_2\text{O,cond}} \cdot h_{\text{cond,fg}} \quad (\text{A.18})$$

The calculation is based on gross calorific values to get positive values, so the recovered latent heat of condensation P_{cond} is calculated by:

$$P_{\text{cond}} = \frac{Q_{\text{cond}}}{H_s} \cdot P_{\text{gen,del}} \quad (\text{A.19})$$

Table A.13 — Default fuel data for condensation heat recovery calculation

| Property | Symbol | Unit | Fuel | | | |
|-------------------|--------|------|-------------------------|-------------------|-------------------|--------------|
| | | | Natural gas (Groningen) | Propane | Butane | Light oil EL |
| Unit mass of fuel | | | 1 Nm ³ | 1 Nm ³ | 1 Nm ³ | 1 kg |

Table A.13 (continued)

| Property | Symbol | Unit | Fuel | | | |
|---------------------------------|------------------|---|---|--|---|------------------------------|
| | | | Natural gas (Groningen) | Propane | Butane | Light oil EL |
| Gross calorific value | H_s | kJ/kg or kJ/Nm ³ | 35 169 kJ/Nm ³ | 101 804 kJ/Nm ³ | 131 985 kJ/Nm ³ | 45 336 kJ/kg |
| Net calorific value | H_i | kJ/kg or kJ/Nm ³ | 31 652 kJ/Nm ³ | 93 557 kJ/Nm ³ | 121 603 kJ/Nm ³ | 42 770 kJ/kg |
| Stoichiometric dry air | $V_{air,st,dry}$ | Nm ³ /kg or Nm ³ /Nm ³ | 8,4 Nm ³ /Nm ³ | 23,8 Nm ³ /Nm ³ | 30,94 Nm ³ /Nm ³ | 11,23 Nm ³ /kg |
| Stoichiometric dry flue gas | $V_{fg,st,dry}$ | Nm ³ /kg or Nm ³ /Nm ³ | 7,7 Nm ³ /Nm ³ | 21,8 Nm ³ /Nm ³ | 28,44 Nm ³ /Nm ³ | 10,49 Nm ³ /kg |
| Stoichiometric water production | $m_{H_2O,st}$ | kg/kg or kg/Nm ³ | 1,405 kg/Nm ³ | 3,3 kg/Nm ³ | 4,03 kg/Nm ³ | 1,18 kg/kg |

Table A.14 — Default values for the calculation of Q_{cond}

| Description | Symbol | Unit | Case | Value |
|--|------------------|------|-----------|-------|
| Combustion air relative humidity | x_{air} | % | All cases | 50 |
| Flue gas relative humidity | x_{fg} | % | All cases | 100 |
| Flue gas oxygen contents at maximum combustion power | $X_{O_2,fg,dry}$ | — | All cases | 6 |

Annex B (informative)

General part default values and information

B.1 Control factor

See [Table B.1](#).

Table B.1 — Default values for control factor $f_{ctr,ls}$ in Formula 2

| Description | $f_{ctr,ls}$ |
|-------------------|--------------|
| All control types | 1,0 |

Other values may be specified in a national annex, provided that emission control losses have not been taken into account in the emission part.

NOTE The effect of heat emission control is taken into account in the emission and control part. The effect of the control of generation is taken into account through losses and efficiency corrections according to the operating temperature of the generator.

[Table B.2](#) is an example of such table to be given in a national annex.

Table B.2 — Sample default national table for control factor in Formula 2

| Boiler type | Control type | $f_{ctr,ls}$ |
|-----------------------|--------------------------------|--------------|
| Floor standing boiler | Outdoor temperature controlled | 1,00 |
| Wall hanged boiler | Outdoor temperature controlled | 1,03 |
| | Room temperature controlled | 1,06 |

B.2 Intermediate load

Intermediate load P_{int} is given by:

$$P_{int} = P_n \cdot \beta_{P_{int}} \quad (B.1)$$

For gas and oil fuelled generators, the default value of $\beta_{P_{int}}$ is 0,3.

Annex C (normative)

Maximum heating power in the building zone

C.1 General considerations

The value of the maximum heating power installed in the building zone is needed in order to calculate the utilization of the system components and, on the basis of this, the corresponding energy need using the methods described in ISO 13790.

The maximum heated power required for a building zone is calculated by an approximate balance calculation of the quasi-steady-state heat flows due to transmission and ventilation heat sinks for the climatic conditions of the heating season for which the system was designed. Heat source must be neglected in these approximations. Where no ventilation systems are installed, the value is determined as described in C.2.

If a ventilation system is installed, additional reheating of the supply air from the ventilation system must be taken into consideration when calculating the utilization of the individual system components. This is discussed in C.4.

Conditioning of outdoor air to achieve indoor air conditions in ventilation systems is not included in the calculations for the maximum heating power. The power required for this process must be calculated separately for HVAC systems.

NOTE The maximum heating power calculated by the method described here cannot be used to substitute design calculation of system components in accordance with the applicable technology standards.

C.2 Calculation of the maximum heating power $P_{n,max}$ for a design-rating day (without ventilation system)

$$P_{n,max} = P_{sink,max} = P_{tr,max} + P_{ve,max} \quad (C.1)$$

where

$$P_{tr,max} = \sum H_{tr} \cdot (\theta_{H,int,min} - \theta_{e,min}) \quad (C.2)$$

$$P_{ve,max} = \sum H_{ve} \cdot (\theta_{H,int,min} - \theta_{e,min}) \quad (C.3)$$

and

H_{tr} is the heat transfer coefficient of transmission;

H_{ve} is the heat transfer coefficient of ventilation;

$\theta_{H,int,min}$ is the design room, zone temperature for heating operation;

$\theta_{e,min}$ is the design external air temperature.

C.3 Design rating conditions

The following boundary conditions must be taken into consideration:

- climatic conditions ($\theta_{e,\min}$) on the day are taken as a design reference for heating operations;
- internal heat gains and solar heat gains are assumed to be zero;
- reduced heating at night times is not taken into consideration;
- the air volume flow values (infiltration and window airing) applying to normal usage times are applied;
- heat and cold gains due to heat generation and refrigeration, storage and distribution process are not taken into consideration.

C.4 Maximum heating power required, taking into consideration a ventilation system

To take a ventilation system into consideration when determining the maximum heating power required in the building zone, the calculations must account for cooling due to the supply air induced by the ventilation system. In this case, the calculation must include the volume flow of the ventilation system for the winter design conditions and corresponding to the type of usage and/or the requirements of the system, as well as the supply-air temperature at design rating conditions. The ventilation system must be taken into consideration when determining values for infiltration and air change due to window airing.

The necessary heating power, including the power required for reheating supply air is thus calculated as follows:

$$P_{H,\max,\text{res}} = P_{\text{sink},\max} = P_{\text{tr},\max} + P_{\text{ve},\max} + P_{\text{ve,mech},\min} \quad (\text{C.4})$$

with

$$P_{\text{tr},\max} = \sum H_{\text{tr}} \cdot (\theta_{H,\text{int},\min} - \theta_{e,\min}) \quad (\text{C.5})$$

$$P_{\text{ve},\max} = \sum H_{\text{ve}} \cdot (\theta_{H,\text{int},\min} - \theta_{e,\min}) \quad (\text{C.6})$$

$$P_{\text{ve,mech},\min} = \dot{V}_{\text{mech},\min} \cdot c_{p,\text{air}} \cdot \rho_{\text{air}} \cdot (\theta_{H,\text{int},\min} - \theta_{\text{ve,mech}}) \quad \text{in cases where } \theta_{H,\text{int},\min} > \theta_{\text{ve,mech}} \quad (\text{C.7})$$

where

H_{tr} is the heat transfer coefficient of transmission;

H_{ve} is the heat transfer coefficient of ventilation;

$\dot{V}_{\text{mech},\min}$ is the minimum volume flow of the ventilation system under design conditions for heating operation without special requirements;

$c_{p,\text{air}}$ is the specific heat capacity of air;

ρ_{air} is the density of air;

$c_{p,\text{air}} \cdot \rho_{\text{air}}$ is assigned a value of 0,34 Wh/(m³ K);

$\theta_{H,\text{int},\min}$ is the design room, zone temperature for heating operation;

$\theta_{e,min}$ is the design external air temperature;

$\theta_{ve,mech}$ is the supply-air temperature of the ventilation system under design conditions for heating operation (without special requirements and taking into consideration the design temperature $\theta_{e,min}$).

If no ventilation system is installed $P_{H,max,res} = P_{H,max}$.

STANDARDSISO.COM : Click to view the full PDF of ISO 13675:2013

Annex D (informative)

Calculation examples for modulating condensing boiler

D.1 Input data

See [Table D.1](#).

Table D.1 — Boiler data

| Description | Symbol | Value |
|--|--------------------|--|
| Boiler type | | Gas condensing boiler 2005 |
| Nominal power (heat output) | P_n | 70 kW |
| Efficiency test results produced in accordance with standard tests | $\eta_{gen,Pn,60}$ | 95,8 % (full-load net efficiency) $\theta_{gen,test,Pn} = 60 \text{ }^\circ\text{C}$ |
| | $\eta_{gen,Pn,30}$ | 95,8 % (full-load net efficiency) $\theta_{gen,test,Pn} = 30 \text{ }^\circ\text{C}$ |
| | $\eta_{gen,Pint}$ | 104,8 % (30% part-load net efficiency) $\theta_{gen,test,Pint} = 30 \text{ }^\circ\text{C}$ |
| Auxiliary electric power at full load | $P_{aux,Pn}$ | 364 W |
| Auxiliary electric power at intermediate load | $P_{aux,Pint}$ | 115 W |
| Auxiliary electric power at zero load | $P_{aux,P0}$ | 15 W |
| Fuel used. | | Natural gas |
| Burner type | | Modulating, fan assisted |
| Boiler location | | Boiler room |
| Type of control | | Depending on outside temperature |
| Generation circuit typology | | Direct connection of boiler |
| Operation time of the generator | t_H | 2 592 000 s = 720 h ^a |
| Generator heat output | $Q_{H,gen,out}$ | 80,9 GJ = 22 472 kWh |
| Generation average temperature | $\theta_{HC,m}$ | 48,9 °C |
| Generation return temperature | $\theta_{HC,RT}$ | 37,7 °C |
| generation average power | input data | $P_{gen,out} = \frac{80,9 \text{ GJ}}{2\,592\,000 \text{ s}} = 31,2 \text{ kW}$ |
| load factor | input data | $\beta_{H,gen} = \frac{31,2 \text{ kW}}{70 \text{ kW}} = 0,446$ (single boiler, only heating load) |
| load factor at full load | input data | $\beta_{Pn} = 1,0$ (single boiler, only heating load) |
| load factor at intermediate load | input data | $\beta_{Pint} = 0,3$ (single boiler, only heating load) |
| ^a Example estimated as 30 days, continuous operation. | | |