

---

---

**Reaction-to-fire tests for façades —**  
**Part 2:**  
**Large-scale test**

*Essais de réaction au feu des façades —*  
*Partie 2: Essai à grande échelle*

STANDARDSISO.COM : Click to view the full PDF of ISO 13785-2:2002



**PDF disclaimer**

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

STANDARDSISO.COM : Click to view the full PDF of ISO 13785-2:2002

© ISO 2002

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
Case postale 56 • CH-1211 Geneva 20  
Tel. + 41 22 749 01 11  
Fax + 41 22 749 09 47  
E-mail [copyright@iso.ch](mailto:copyright@iso.ch)  
Web [www.iso.ch](http://www.iso.ch)

Printed in Switzerland

**Contents**

	Page
1 Scope .....	1
2 Normative references .....	1
3 Terms and definitions .....	2
4 Principle .....	3
5 Test facility and test facility calibration .....	3
6 Fire source and exposure .....	5
7 Test specimen .....	6
8 Test specimen instrumentation .....	6
9 Test specimen conditioning .....	8
10 Test environment .....	9
11 Procedure .....	9
12 Expression of results .....	9
13 Precision .....	9
14 Test report .....	10
 <b>Annexes</b>	
A Standard ignition source .....	11
B Alternative ignition sources .....	13
B.1 Liquids .....	13
B.2 Wooden cribs .....	13
Bibliography.....	16

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 3.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this part of ISO 13785 may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

International Standard ISO 13785-2 was prepared by Technical Committee ISO/TC 92, *Fire safety*, Subcommittee SC 1, *Fire initiation and growth*.

ISO 13785 consists of the following parts, under the general title *Reaction-to-fire tests for façades*:

- *Part 1: Intermediate-scale test*
- *Part 2: Large-scale test*

Annex A forms a normative part of this part of ISO 13785. Annex B is for information only.

STANDARDSISO.COM : Click to view the full PDF of ISO 13785-2:2002

## Introduction

Fire is a complex phenomenon. Its behaviour and effects depend on a number of interrelated factors. The behaviour of materials and products depends on the characteristics of the fire, the method of use of the materials and the environment in which they are exposed. The theory of “reaction to fire tests” is explained in <sup>[2]</sup>.

The need for improved thermal insulation of buildings, both for single- and multi-storey dwellings and for industrial buildings, has led to an increased use of insulated and often ventilated façades.

In their end use, façade assemblies can potentially be subjected to three primary fire exposure scenarios. These are:

- a) an interior compartment fire venting through a window on to a façade;
- b) an exterior fire in combustibles accumulated near a wall (e.g. rubbish, vegetation, bush fires);
- c) radiant exposure from fire in an adjacent building.

This part of ISO 13785 only covers items a) and b). Item c) is typically regulated by spatial separation and allowable openings in the building codes.

The test specified in this part of ISO 13785 is for a post-flashover fire scenario within a building compartment venting through a window opening and impinging directly on to a façade. The window fire exposure may also simulate a fire from combustibles accumulated near a wall. The results may not, however, reflect the actual performance of exterior wall assemblies under all fire exposure conditions.

Fire on a façade can spread in several ways, with the most significant over a combustible exterior surface. Fire can also travel vertically and horizontally through air cavities within cladding or façade components or through an insulation core. Experience from real fire accidents, and also laboratory studies worldwide on configurations with and without internal corners, show that the worst-case situation is with an internal corner. This part of ISO 13785 therefore includes an internal corner.

Fire incidents show that fire can spread along an exterior façade, from the level of fire origin to the level above, regardless of the contribution from façade components. This test method therefore is intended to determine the contribution from the façade components to upward fire spread, beyond the floor immediately above the level of fire origin (i.e. the contribution from façade components for fire to spread from the level of fire origin to two levels above, also called leap-frogging).

The two parts of ISO 13785 provide two methods of test: an intermediate-scale test specified in Part 1 which should only be used for screening or for evaluation of subcomponents or “families of products”, and the large scale test specified in this part, which should be used to provide an end-use evaluation of all aspects of the façade system. A direct correspondence between the intermediate-scale test, specified in Part 1, and the full-scale test specified in this part, should not be assumed. The purpose of Part 1 is only to reduce the burden of testing in Part 2 by eliminating systems which fail Part 1.

The test specified in this part of ISO 13785 is intended to evaluate external wall or facing materials and constructions of façades which are not suitable for assessment using ISO 9705<sup>[3]</sup>, which evaluates the fire growth from a surface product intended to be used for internal wall and ceiling linings.

The test specified in this part of ISO 13785 does not rely on the use of asbestos-based materials.

[STANDARDSISO.COM](https://standardsiso.com) : Click to view the full PDF of ISO 13785-2:2002

# Reaction-to-fire tests for façades —

## Part 2: Large-scale test

**WARNING** — So that suitable precautions may be taken to safeguard health, all persons involved in the fire tests should be aware of the possibility that toxic or harmful gases may be evolved during exposure of test specimens.

Hazards are encountered when assessing the fire performance of any product on a large scale and it is essential that adequate precautions be taken.

Particular attention should be paid to the potential evolution of smoke and toxic gases and to the fact that extensive flaming of specimens can occur sometimes, resulting in mechanical failure of fixings and joints and possible structural collapse.

An adequate means of extinguishing the specimen should be provided.

### 1 Scope

This part of ISO 13785 specifies a method of test for determining the reaction to fire of materials and construction of façade claddings when exposed to heat and flames from a simulated interior compartment fire with flames emerging through a window opening and impinging directly on the façade. The information generated from this test may also be applicable to the scenario of an external fire impinging on a façade; however, the results may not be applicable for all fire exposure conditions.

This method is applicable only to façades and claddings that are non-loadbearing. No attempt is made to determine the structural strength of the façade or cladding.

This test is not intended to determine the fire behaviour of a given building façade. Details such as balconies, windows, window shutters, curtains, etc., are not considered in this test. This test does not include the risk of fire spread, for example through the window details of the façade system, as it only is constructed as a façade wall. There is clear evidence that an internal corner (also called a re-entrant corner) configuration produces a more intense fire exposure than a flat façade. The most commonly encountered internal re-entrant corner is with an angle of 90°. The test façade specimen therefore contains an internal corner with a re-entrant angle of 90°.

The test method described is intended to evaluate the inclusion of combustible components within façades and claddings of buildings which are otherwise of non-combustible construction.

### 2 Normative references

The following normative documents contain provisions which, through reference in this text, constitute provisions of this part of ISO 13785. For dated references, subsequent amendments to, or revisions of, any of these publications do not apply. However, parties to agreements based on this part of ISO 13785 are encouraged to investigate the possibility of applying the most recent editions of the normative documents indicated below. For undated references, the latest edition of the normative document referred to applies. Members of ISO and IEC maintain registers of currently valid International Standards.

ISO 13943:2000, *Fire safety — Vocabulary*

IEC 60584-2, *Thermocouples — Part 2: Tolerances*

### 3 Terms and definitions

For the purposes of this part of ISO 13785, the terms and definitions given in ISO 13943:2000 and the following apply.

#### 3.1

##### **assembly**

fabrication of materials and/or composites

EXAMPLE Sandwich panels.

NOTE An assembly may include an air gap, and vertical and horizontal joints.

#### 3.2

##### **composite**

combination of materials that are generally recognized in building construction as discrete entities

EXAMPLES Coated, laminated or heterogeneous mixed materials.

#### 3.3

##### **exposed surface**

surface of a product subjected to the heating conditions of the test

#### 3.4

##### **façade**

##### **cladding**

products or constructions added to the external surface of an existing wall or frame

NOTE The structure can be of concrete, lightweight concrete block work, masonry, steel, timber, etc. The cladding may be applied directly to this structure or may incorporate an air gap and/or an insulating layer.

#### 3.5

##### **material**

single substance or uniformly dispersed mixture

EXAMPLES Metal, stone, timber, concrete, mineral wool, polymers.

#### 3.6

##### **product**

material, composite or assembly about which information is required

#### 3.7

##### **specimen**

façade or cladding representing the product of the end-use façade including joints and fixings

NOTE 1 The specimen does not include the lightweight concrete block wall, if used, of the test rig.

NOTE 2 The specimen may include an air gap.

#### 3.8

##### **surface product**

any part of a building that constitutes an exposed surface on the walls and/or the ceiling/roof

EXAMPLES Panels, boards.

## 4 Principle

The reaction to fire behaviour of a façade or cladding is assessed when exposed to flames impinging directly on the face of the façade or cladding after venting through a window aperture. The specimen is constructed with a re-entrant angle of 90°, creating a re-entrant corner.

Fire exposure of the façade specimen is specified by the level of total heat flux measured on the exterior surface of the façade 0,5 m above the top of the window opening. In addition, minimum temperature conditions are set for the hot air plume venting from the fire compartment in order to ensure that the exposure simulates a post-flashover compartment fire.

Fire compartment dimensions are not considered paramount for the evaluation of the façade assembly. However, the fire compartment volume is specified, within a broad range, to eliminate extreme fire exposures. Testing laboratories may find that an existing combustion chamber can be suitably adapted for façade testing purposes. An example of a typical facility is shown in Figure 1. The choice of fuel is left to the discretion of the testing laboratory. The fire source should not produce smoke to a level that could obstruct visual observation of the façade performance.

Visual observation of flame spread will constitute an important measurement for qualitative assessment of the performance of the façade assembly. The resulting flame spread and mechanical behaviour on or within the façade construction will, however, be quantified by measurements such as total heat flux and temperature, in addition to visual observation.

The objective of this test is to determine if the façade components could contribute to spreading the fire from the level of origin to two levels above.

## 5 Test facility and test facility calibration

### 5.1 Test facility

**5.1.1** The test facility shall comprise a vertically-held main façade, containing a window opening to the combustion chamber (fire compartment). The facility shall also contain a vertically held wing façade to form a re-entrant corner with a re-entrant angle of 90°. The location of the re-entrant corner shall be in the proximity of one vertical edge of the window opening. An example of a test facility is shown in Figure 1.

**5.1.2** The height of the test facility shall be at least 4 m above the window opening. The width of the main façade shall be at least 3 m. The width of the wing façade shall be at least 1,2 m. Both the main and the wing façades shall be mounted on a horizontal floor with no gaps between the horizontal floor and the vertical façades. Preferably, the wing wall should be movable horizontally, in parallel with the main façade, 0 m to 0,5 m from the edge of the window, to accommodate specimen thickness in the range 0 m to 0,5 m.

**5.1.3** The combustion chamber shall be of a regular shape with an internal volume not less than 20 m<sup>3</sup> and not more than 100 m<sup>3</sup>.


**5.1.4** The combustion chamber shall have only one opening in the main façade that shall be flush with the wall. The width of the opening shall be (2,0 ± 0,1) m. The height of the opening shall be (1,2 ± 0,1) m.

NOTE Other openings in the other walls of the combustion chamber are allowed in order to allow for natural ventilation and to fulfil the calibration requirements.

**5.1.5** The walls and ceiling of the combustion chamber shall be constructed of concrete, masonry or any combination of materials that provide and maintain integrity, thermal properties and leakage characteristics that are consistent between calibration and specimen tests.

**5.1.6** The walls and ceiling of the combustion chamber shall be lined on the room side with high temperature resistant insulation material.

NOTE Ceramic fibre insulation of nominal density 100 kg/m<sup>3</sup> and a thickness of 25 mm is suitable for this.

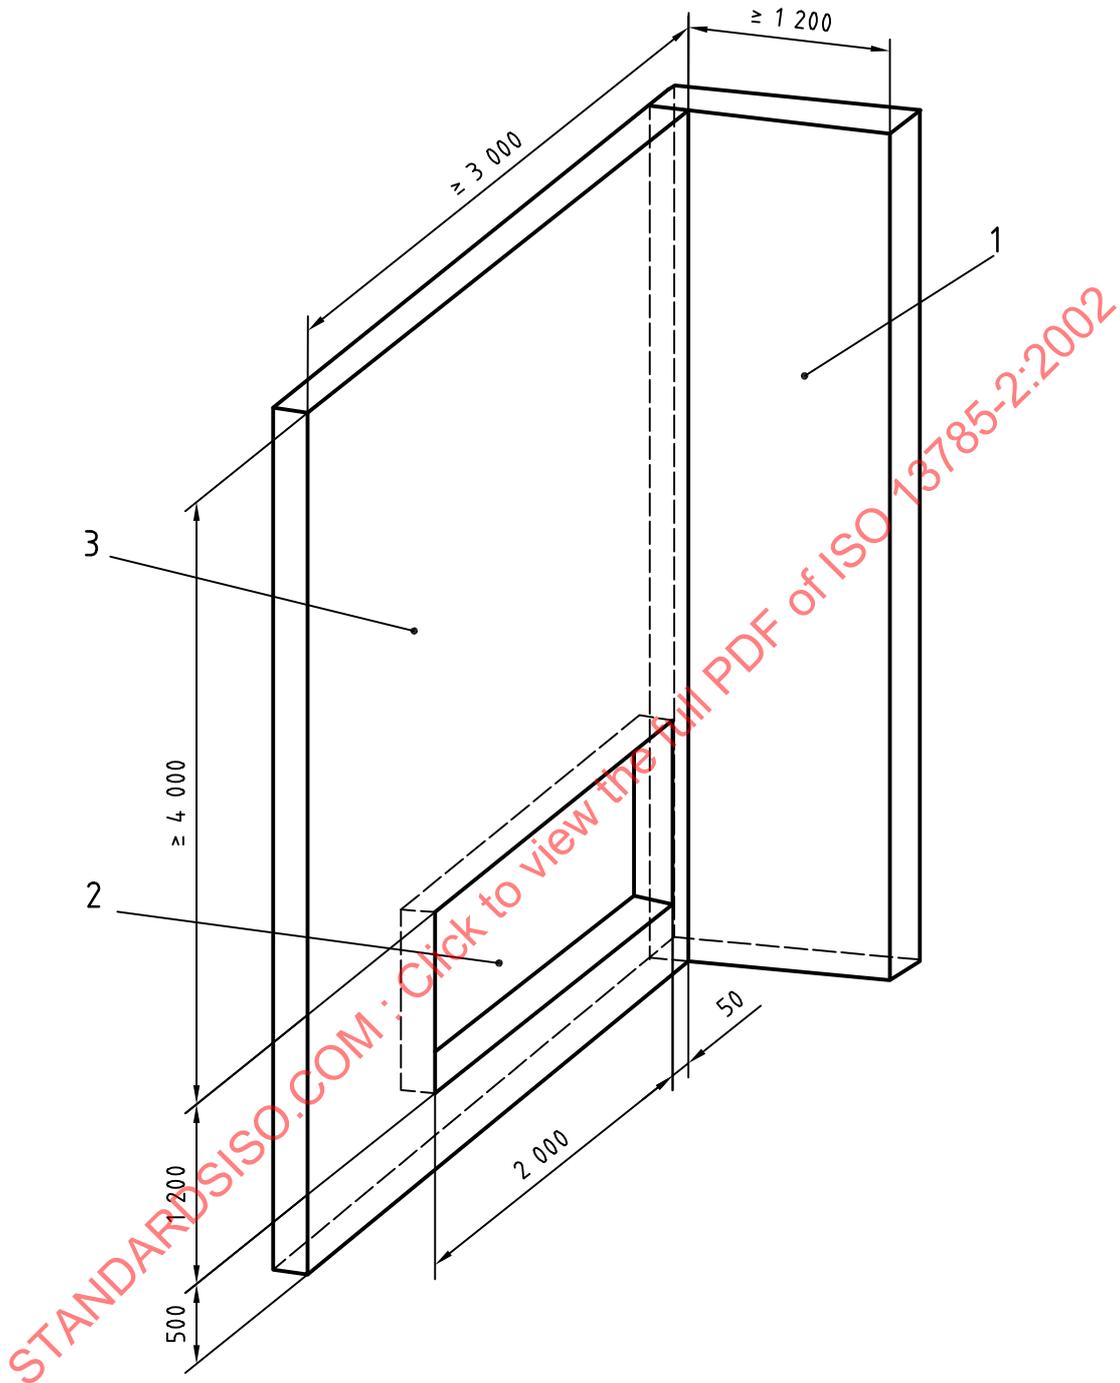

**Key**

- 1 Side wall specimen (wing)
- 2 Window opening to combustion chamber
- 3 Main wall specimen (main façade)

NOTE Combustion chamber not drawn.

**Figure 1 — Test facility**

## 5.2 Test facility calibration

**5.2.1** The objective of the calibration procedure is to establish the level of fire exposure on the test specimen. The calibration should be done after each considerable change in the test rig or at least every year.

**5.2.2** During calibration the appropriate quantity or rate of fuel supply shall be determined.

**5.2.3** The main and wing façades of the test facility shall be clad with non-combustible board. A 13 mm thick non-combustible board with a nominal density of  $(700 \pm 200) \text{ kg/m}^3$  is suitable for this. The cladded area may be limited to the area extending from the top of the window opening to 4 m above.

**5.2.4** After installation of the cladding, the horizontal distance from the vertical edge of the window opening to the wing façade shall be less than 50 mm.

**5.2.5** Three total heat flux meters shall be installed 600 mm directly above along a line parallel to the horizontal centreline of the top of the window opening, with its sensing faces flush with the outer face of the cladding board (see Figure 2, flux meters 1, 7 and 8). One total heat flux meter shall be installed on the vertical centreline of the window opening 1,6 m above the top of the opening, with its sensing faces flush with the outer face of the cladding board (see Figure 2, flux meter 2). Heat flux meters in the range  $0 \text{ kW/m}^2$  to  $100 \text{ kW/m}^2$  are suitable for this purpose.

**5.2.6** Thermocouples shall be installed as specified in 8.2.

**5.2.7** The test environment specified in 10.1 to 10.4 shall be achieved prior to initiating the calibration procedure.

**5.2.8** Start the data acquisition system 1 min before igniting the fuel.

**5.2.9** Commence the calibration process by igniting the fuel(s) in the combustion chamber.

**5.2.10** Adjust the fuel flow rate and/or ventilation gradually to increase the fire growth to full fire exposure. The levels of exposure shall be as specified in 6.2 to 6.4.

**5.2.11** Record the amount of fuel and/or the fuel flow rate and/or rate of supply of air by ventilation during the calibration test.

**5.2.12** The amount of fuel and/or the fuel flow rate established in a successful calibration run shall be used in testing until re-calibration is required.

The amount of fuel and/or fuel flow rate shall be established at least each year or after each considerable change in the test rig.

## 6 Fire source and exposure

**6.1** The standard source of fuel used in the combustion chamber is propane. An example of the standard propane ignition source is given in annex A. Other choices of fuel can be made (see annex B), but the amount of smoke generated shall not obstruct visual observation of the performance of the façade assembly and the fuel shall conform to 6.2 to 6.5.

**6.2** The duration of full fire exposure in the calibration test shall be 15 min, during which flames emerging from the opening shall impinge on the outer face of the cladding. Full fire exposure shall be preceded by 4 min to 6 min of gradual increase in fire intensity. The full fire exposure shall be followed by a gradual decrease in intensity of 4 min to 6 min. The total test duration shall be between 23 min and 27 min.

**6.3** During full fire exposure in the calibration test the front face of the façade shall be subjected to a total heat flux of  $(55 \pm 5) \text{ kW/m}^2$  measured by the total heat flux meters 1, 7 and 8 at 600 mm directly above along a line parallel to the horizontal centreline of the window opening (see Figure 2). The total heat flux at 1,6 m above the window opening shall be  $(35 \pm 5) \text{ kW/m}^2$  (see 8.2).

The total heat fluxes may be calculated as an average over the 15 min as described in 6.2 when flames emerge from the opening.

**6.4** During full fire exposure in the calibration test, the temperature measured by each of the three thermocouples placed at the window opening (see 8.2) shall be above 800 °C, calculated as an average over the 15 min (see 6.2).

**6.5** The combustion chamber shall have only one opening in the main façade that allows air for combustion and that vents flames on to the façade. Additional air through openings in the combustion chamber is allowed in order to meet the total heat flux requirements (see 6.3) and temperature requirements (see 6.4).

Other openings in the other walls of the combustion chamber are permitted in order to allow for natural ventilation and to fulfil the calibration requirements. No mechanical ventilation is allowed.

## 7 Test specimen

**7.1** The test specimen shall be installed in accordance with the manufacturer's instructions.

**7.2** The test specimen shall be representative of a façade used in practice, both in construction and products.

**7.3** The test specimen shall extend from the bottom of the window opening to a minimum height of 4 m above the top of the window opening. The minimum widths of the test specimen on the main and wing façades shall be 3 m and 1,2 m, respectively.

**7.4** The specimen shall be constructed so that a re-entrant corner is placed between the main façade and the wing façade.

**7.5** Once completed and installed in the test facility, the horizontal distance to the wing façade of the specimen from the (vertical) edge of the window opening shall be 50 mm.

**7.6** The test specimen shall include an opening coincident with the opening in the combustion chamber.

**7.7** Constructional details of the window opening, including the lintel and the jambs, shall be as in end use practice.

**7.8** The test specimen shall be representative of a complete non-loadbearing exterior wall assembly, but the interior finish is not required.

**7.9** If horizontal joints are normally incorporated in the exterior wall assembly, the test specimen shall incorporate a horizontal joint. The joint shall be located above the window opening and within 3 m vertical distance from the top of the window opening. The horizontal joint shall extend from the main façade on to the wing façade.

NOTE Window details one level above the opening are not included. This means that the risk of fire spread through these details is not included in this test.

**7.10** If vertical joints are normally incorporated in the exterior wall assembly, the test specimen shall incorporate a vertical joint. The joint shall be located within 0,25 m of the horizontal centre of the window opening. The joint shall extend from the top of the window opening to a horizontal joint as specified in 7.9 or to a minimum vertical distance of 3 m.

The test specimen should be built by persons suitably qualified in construction of this type of structure in practice.

## 8 Test specimen instrumentation

**8.1** Four total heat flux meters (3, 4, 5 and 6 of Figure 2) shall be installed through the test facility and the test specimen at 3,6 m above the top of the window opening. One shall be installed along the centreline of the window opening, one on each side of the main façade and one on the wing façade, 150 mm offset from the inner corner joint, and one 100 mm in from the vertical edge of the window opening furthest from the inner corner.



When installing heat flux meters care shall be taken to avoid damage to the specimen supporting structure (e.g. by introducing studs) while maintaining the dimensions as closely as possible. The heat flux meters shall be installed so that the sensing faces are, as far as possible, flush with the outer face of the test specimen. For specimens with outer surfaces that are not flat (contoured, corrugated, etc.), the heat flux meters shall be positioned at the most prominent part of the profile (not a joint).

Only total heat flux meters shall be used (without window). The instrument shall be robust, simple to set up and to use, unaffected by draughts and stable during calibration. The instrument shall be accurate to within  $\pm 3\%$  and precise to within 0,5 %. The heat flux meter shall be calibrated over its whole range.

**8.2** A total of seven thermocouples shall be installed on the exterior surface of the test specimen. All the thermocouples shall be either sheathed thermocouples or welded thermocouples. In the case of sheathed thermocouples, they shall be type K chromel-alumel stainless steel sheathed thermocouples with a wire diameter of 0,3 mm and an outer diameter of  $(1,5 \pm 0,1)$  mm. The hot junction shall be insulated and not earthed. In the case of welded thermocouples, they shall have a maximum diameter of 0,3 mm. The thermocouples on the external surface of the panels shall have their hot junctions in contact with the surface of the panel. The use of surface thermocouples with a copper disk is recommended for surface temperature measurements and welded non-sheathed thermocouple for gas temperature measurements. The thermocouples shall be of tolerance class 1 in accordance with IEC 60584-2.

Three thermocouples (positions T1 to T3 in Figure 2) shall be installed to measure the temperature of the hot plume and flames venting through the window opening. The thermocouples shall be located 50 mm directly above a line parallel to the top of the window opening and may be passed through the test facility wall or structure. One shall be located at the horizontal centre of the window opening and one at each side 100 mm from the vertical edge of the window opening.

**8.3** Four of the thermocouples (positions T4 to T7) shall be located on a horizontal line 4 m above the top of the window opening vertically in line with the heat flux meters specified in 8.1, corresponding to flux meters at positions 3 to 6 in Figure 2.

The hot junction of four of the thermocouples should be installed flush with the exterior face of the membrane. The other four thermocouples shall be installed with the hot junction 10 mm extended outward from the exterior surface of the test specimen. The thermocouples shall be held in place so as not to damage the test specimen nor move during fire exposure.

**8.4** When testing a façade specimen containing several layers of material, each layer shall have four thermocouples attached. An air gap installed within a façade specimen should be treated as a material layer for this purpose. Thermocouples shall be located at a height 4 m above the top of the window opening vertically in line with the heat flux meters specified in 8.1.

Some examples of layers and their recommended attachments are:

- substrate: attach thermocouples flush with the exterior face of the substrate with the hot junction exposed;
- insulation: attach thermocouples to the exterior face of the insulation with the hot junction embedded.

**8.5** Other instrumentation deemed necessary by the testing laboratory to monitor fire exposure and to determine potential for fire spread on the test specimen shall be provided as appropriate.

**8.6** A single digital data acquisition system able to scan and log all above data inputs with not more than 20 s intervals should be used.

**8.7** To facilitate post-test visual observations, at least one stationary video recording device, able to view both the main and the wing façades, shall be used.

## 9 Test specimen conditioning

**9.1** Test specimens shall be left to stand following installation on the test facility for a period sufficient for all the components to cure before being subjected to the test. The ambient temperature during the conditioning shall be not

less than 10 °C and not greater than 30 °C. The duration of the conditioning period shall conform to the manufacturer's instructions for curing components.

**9.2** During curing, the test specimen shall be protected from precipitation and kept within the temperature range specified by the manufacturer for curing components.

## 10 Test environment

**10.1** The ambient temperature during the calibration and test periods shall be no less than 10 °C and no greater than 30 °C.

**10.2** There shall be no fog or precipitation on the test facility during calibration and testing.

**10.3** There shall be no visible moisture on the test specimen or the test facility at the time of calibration and testing.

**10.4** The ambient air velocity shall not exceed 2 m/s during the calibration and test period.

## 11 Procedure

Proceed as follows for the test.

- a) Ensure that the test environment specified in clause 10 is achieved prior to starting the test.
- b) Start the data acquisition system and video recorder 1 min before igniting the fuel.
- c) Use the same amount of fuel and/or adjust the fuel flow rate to match the values determined in the calibration test.
- d) Ignite the fuel.
- e) Determine, by visual observation, the position of the flame front throughout the test and record the observations. Visual observations may be supplemented with still photography.
- f) Following fire exposure, continue data acquisition until the specimen self-extinguishes.
- g) Allow the test specimen to cool, then remove each layer of the specimen and record damage.

## 12 Expression of results

**12.1** The performance of the test specimen shall be assessed on the basis of visual observations recorded and recorded data.

Averaging of total heat flux and temperature data over a 1-min period is required to eliminate momentary fluctuations in the values.

**12.2** Thermocouples installed within the specimen shall provide information about fire spread within each layer of the specimen and within any cavities.

## 13 Precision

The precision of this test method has not been determined. Results of a planned inter-laboratory test series will be included when available.

## 14 Test report

A test report shall contain the following information:

- a) name and address of the testing laboratory;
- b) date and identification number of the test report;
- c) name and address of client and manufacturer or supplier of the product and type or identification mark(s) of the product;
- d) description of the test specimen, including assembly drawings and still photography, material specifications and details of the joints and fixings;
- e) date of supply of the product and date of test;
- f) reference to this part of ISO 13785, i.e. ISO 13785-2;
- g) curing information on the test specimen, applicable ambient data during the test (temperature, pressure, relative humidity, wind velocity, etc.);
- h) identification of the measurement instrumentation and their locations on the façade;
- i) graphs of the total heat flux measurements with time at 0,5 m and 1,5 m from the Calibration test;
- j) graphs of the fuel flow rate;
- k) graphs of the temperature measurements with time for three thermocouples (T1 to T3 in Figure 2) located above the window in the calibration test (the average of the three temperature measurements shall also be included);
- l) graphs of the temperature measurements with time for three thermocouples (T1 to T3 in Figure 2) located above the window in the specimen test (the average of the three temperature measurements shall also be included);

NOTE Comparison of the average measurements of the two graphs [see k) and l)] should indicate the similarity of the fire exposure conditions in the calibration and specimen tests.

- m) graphs of the four total heat flux measurements with time (at 3,6 m above the top of the window opening) for the calibration test (the average of the four total heat flux measurements shall also be included);
- n) graphs of the four total heat flux measurements with time (at 3,6 m above the top of the window opening) for the specimen test (the average of the four total heat flux measurements shall also be included);
- o) graphs of the difference in average total heat flux (at 3,6 m above the top of the window opening) between the calibration test and the specimen test [difference between the averages of the heat flux data from m) and n)];

NOTE The increase in total heat flux (at 3,6 m above the top of the window opening) between the calibration test with a non-combustible cladding and the specimen test should provide the best indicator for quantification of the behaviour of the test specimen. Together with the other flux measurements and the temperature measurements it can be used for definition of failure levels.


- p) graphs of all other temperature and heat flux measurements;
- q) documented visual observations of fire spread (lateral and vertical flame spread) on or within the test specimen and still photography (in particular, document extent of burned or damaged area and destruction to the front facing of the specimen in terms of height above the window opening);
- r) any deviations from the procedure or any operations regarded as optional.

## Annex A (normative)

### Standard ignition source

Figure A.1 gives a set-up for the standard propane ignition source. Figure A.2 shows the fuel flow rate of the standard propane ignition source. Depending on the calibration of the test rig this fuel flow rate can differ from one laboratory to another. The positions of the burner pipes may be different from the ones given as examples in Figure A.1.

Dimensions in millimetres

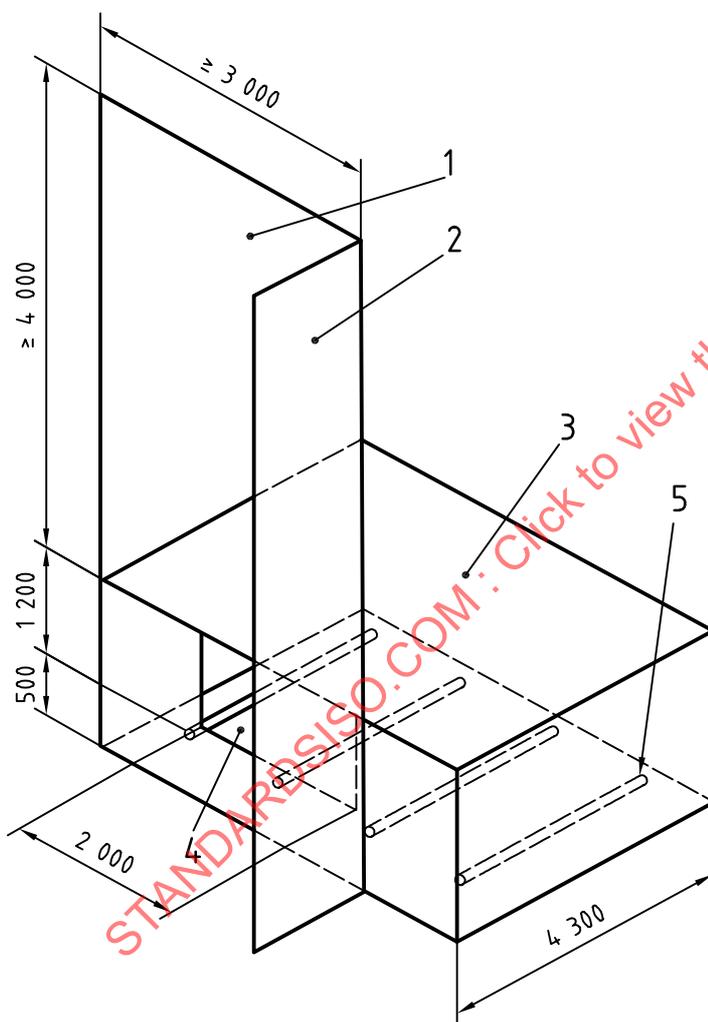

Fuel: vaporized commercial propane  
 Fuel flow rate: maximum 120 g/s; see Figure A.2

#### Key

- 1 Main wall specimen (main façade)
- 2 Side wall specimen (wing)
- 3 Combustion chamber
- 4 Window opening to combustion chamber
- 5 Burner (four, of diameter 100 mm and 3 700 mm long, perforated steel pipes wrapped in 25 mm thick ceramic fibre insulation)

Figure A.1 — Standard ignition source

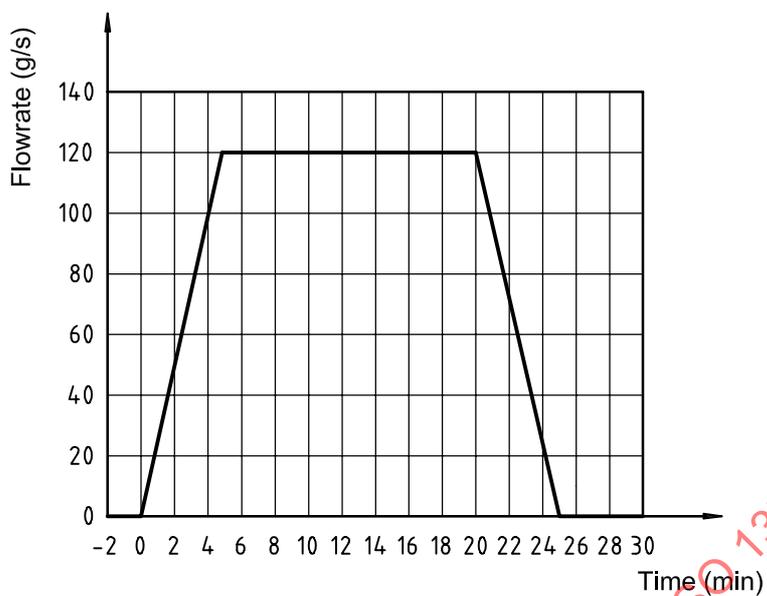


Figure A.2 — Fuel flow rate

STANDARDSISO.COM : Click to view the full PDF of ISO 13785-2:2002

## Annex B (informative)

### Alternative ignition sources

#### B.1 Liquids

As an alternative to the standard ignition source, liquid pool fires can be used with for instance heptane or acetone.

Amounts of approximately 60 l of, for instance, heptane have been proved to be suitable to attain the requirements of this part of ISO 13785.

#### B.2 Wooden cribs

As an alternative to the standard ignition source, wood crib fires may be used. The following fire load is a suitable example of this.

Dimension of the fire room (chamber): height 2 m, width 4 m, depth 4 m; height of the lintel 0,3 m.

Fire load density: 25 kg wood per square metre, total amount 400 kg.

Wood: soft-wood with a density between 450 kg/m<sup>3</sup> and 500 kg/m<sup>3</sup> (e.g. spruce), humidity 10 % to 12 %, stocked in a standard atmosphere of 23 °C and 50 % humidity.

Cribs: sticks (40 mm × 40 mm), length 500 mm, crosswise pile-up and nailed to separate cribs with a mass of 25 kg, air/wood ratio  $\approx 1 : 1$ , at 200 mm above the floor on a metal rack, underside open.

Distribution: 16 cribs evenly distributed on the floor of the fire room.

Ignition: 200 ml isopropanol for each crib in small trays. All cribs should be ignited within 1 min.

Examples of wooden crib configurations are given in Figures B.1 and B.2.