
**Thermal performance of building
components — Dynamic thermal
characteristics — Calculation methods**

*Performance thermique des composants de bâtiment —
Caractéristiques thermiques dynamiques — Méthodes de calcul*

STANDARDSISO.COM : Click to view the full PDF of ISO 13786:2007



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

STANDARDSISO.COM : Click to view the full PDF of ISO 13786:2007



COPYRIGHT PROTECTED DOCUMENT

© ISO 2007

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword.....	iv
Introduction	v
1 Scope	1
2 Normative references	1
3 Terms, definitions, symbols and units	2
3.1 Terms and definitions.....	2
3.2 Symbols and units	5
3.3 Subscripts	6
3.4 Other symbols	6
4 Period of the thermal variations	6
5 Data required	6
6 Heat transfer matrix of a multi-layer component.....	7
6.1 General.....	7
6.2 Procedure	7
6.3 Heat transfer matrix of a homogeneous layer	7
6.4 Heat transfer matrix of plane air cavities	8
6.5 Heat transfer matrix of a building component.....	8
7 Dynamic thermal characteristics	8
7.1 Characteristics for any component	8
7.2 Characteristics for components consisting of plane and homogeneous layers	8
8 Report	10
8.1 Calculation report	10
8.2 Summary of results	10
Annex A (normative) Simplified calculation of the heat capacity	11
Annex B (informative) Principle of the method and examples of applications.....	13
Annex C (informative) Further information for computer programming	17
Annex D (informative) Examples	19
Bibliography	22

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 13786 was prepared by Technical Committee ISO/TC 163, *Thermal performance and energy use in the built environment*, Subcommittee SC 2, *Calculation methods*.

This second edition cancels and replaces the first edition (ISO 13786:1999), which has been technically revised.

The following principal changes have been made to the first edition:

- all equations in Clause 3 have been reviewed and corrected as appropriate; the definition of heat capacity (3.1.1.5) has been modified;
- all equations in 7.2.1 and 7.2.2 have been reviewed and corrected as appropriate;
- 7.2.4 contains a new equation for periodic thermal transmittance, and a new note;
- Equation (A.4) has been corrected;
- B.2 has undergone minor revisions;
- Table C.1 has been added;
- Annex D contains amended examples to align with changes to the formulae in the main body of the text.

Introduction

This International Standard provides the means (in part) to assess the contribution that building products and services make to energy conservation and to the overall energy performance of buildings.

The dynamic thermal characteristics of a building component describe the thermal behaviour of the component when it is subject to variable boundary conditions, i.e. variable heat flow rate or variable temperature on one or both of its boundaries. In this International Standard, only sinusoidal boundary conditions are considered: boundaries are submitted to sinusoidal variations of temperature or heat flow rate.

The properties considered are thermal admittances and thermal dynamic transfer properties, relating cyclic heat flow rate to cyclic temperature variations. Thermal admittance relates heat flow rate to temperature variations on the same side of the component. Thermal dynamic transfer properties relate physical quantities on one side of the component to those on the other side. From the aforementioned properties, it is possible to define the heat capacity of a given component which quantifies the heat storage property of that component.

The dynamic thermal characteristics defined in this International Standard can be used in product specifications of complete building components.

The dynamic thermal characteristics can also be used in the calculation of:

- the internal temperature in a room;
- the daily peak power and energy needs for heating or cooling;
- the effects of intermittent heating or cooling, etc.

STANDARDSISO.COM : Click to view the full PDF of ISO 13786:2007

Thermal performance of building components — Dynamic thermal characteristics — Calculation methods

1 Scope

This International Standard specifies the characteristics related to the dynamic thermal behaviour of a complete building component and provides methods for their calculation. It also specifies the information on building materials required for the use of the building component. Since the characteristics depend on the way materials are combined to form building components, this International Standard is not applicable to building materials or to unfinished building components.

The definitions given in this International Standard are applicable to any building component. A simplified calculation method is provided for plane components consisting of plane layers of substantially homogeneous building materials.

Annex A specifies simpler methods for the estimation of the heat capacities in some limited cases. These methods are suitable for the determination of dynamic thermal properties required for the estimation of energy use. These approximations are not appropriate, however, for product characterization.

Annex B gives the basic principle and examples of applications of the dynamic thermal characteristics defined in this International Standard.

Annex C provides information for programming the calculation method.

Annex D gives examples of calculation for a building component.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 6946, *Building components and building elements — Thermal resistance and thermal transmittance — Calculation method*

ISO 7345, *Thermal insulation — Physical quantities and definitions*

ISO 10211, *Thermal bridges in building construction — Heat flows and surface temperatures — Detailed calculations*

3 Terms, definitions, symbols and units

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 7345 and the following apply.

3.1.1 Definitions valid for any component

3.1.1.1

component

part of a building, such as a wall, floor or roof, or a part of such an element

3.1.1.2

thermal zone of a building

part of a building throughout which the internal temperature is assumed to have negligible spatial variations

NOTE 1 A component separates two zones, designated in this International Standard by m and n .

NOTE 2 The external environment can also be considered a zone.

3.1.1.3

sinusoidal conditions

conditions in which the variations of the temperature and heat flows around their long term average values are described by a sine function of time

NOTE Using complex numbers, the temperature in zone n can be described by Equation (1) and the heat flow by Equation (2):

$$\theta_n(t) = \bar{\theta}_n + |\hat{\theta}_n| \cos(\omega t + \psi) = \bar{\theta}_n + \frac{1}{2} [\hat{\theta}_{+n} e^{j\omega t} + \hat{\theta}_{-n} e^{-j\omega t}] \quad (1)$$

$$\phi_n(t) = \bar{\phi}_n + |\hat{\phi}_n| \cos(\omega t + \varphi) = \bar{\phi}_n + \frac{1}{2} [\hat{\phi}_{+n} e^{j\omega t} + \hat{\phi}_{-n} e^{-j\omega t}] \quad (2)$$

where

$\bar{\theta}_n$ and $\bar{\phi}_n$ are average values of temperature and heat flow;

$|\hat{\theta}_n|$ and $|\hat{\phi}_n|$ are amplitudes of temperature and heat flow variations;

$\hat{\theta}_{\pm n}$ and $\hat{\phi}_{\pm n}$ are complex amplitudes defined by:

$$\hat{\theta}_{\pm n} = |\hat{\theta}_n| e^{\pm j\psi} \text{ and } \hat{\phi}_{\pm n} = |\hat{\phi}_n| e^{\pm j\varphi} \quad (3)$$

ω is the angular frequency of the variations.

3.1.1.4

periodic thermal conductance

L_{mn}

complex number relating the periodic heat flow into a component to the periodic temperatures on either side of it under sinusoidal conditions

Another representation of the concept:

$$\hat{\phi}_m = L_{mm} \hat{\theta}_m - L_{mn} \hat{\theta}_n \quad (4)$$

NOTE 1 L_{mm} relates the periodic heat flow on side m to the periodic temperature on side m when the temperature amplitude on side n is zero. L_{mn} relates the periodic heat flow on side m to the periodic temperature on side n when the temperature amplitude on side m is zero.

NOTE 2 As a convention within this International Standard, the heat flow rate is defined as positive when it enters the surface of the component.

3.1.1.5 heat capacity

modulus of the net periodic thermal conductance divided by the angular frequency

Another representation of the concept:

$$C_m = \frac{1}{\omega} |L_{mm} - L_{mn}| \quad (5)$$

3.1.1.6 time shift

Δt

period of time between the maximum amplitude of a cause and the maximum amplitude of its effect

3.1.2 Definitions valid only for one dimensional heat flow

3.1.2.1 plane component

component for which the smallest curvature radius is at least five times its thickness

3.1.2.2 homogeneous material layer

layer of material in which the largest size of inhomogeneities does not exceed one fifth of the thickness of the layer

3.1.2.3 thermal admittance

complex quantity defined as the complex amplitude of the density of heat flow rate through the surface of the component adjacent to zone m , divided by the complex amplitude of the temperature in the same zone when the temperature on the other side is held constant

Another representation of the concept:

$$Y_{mm} = \frac{\hat{q}_m}{\hat{\theta}_m} \quad (6)$$

3.1.2.4 periodic thermal transmittance

complex quantity defined as the complex amplitude of the density of heat flow rate through the surface of the component adjacent to zone m , divided by the complex amplitude of the temperature in zone n when the temperature in zone m is held constant

Another representation of the concept:

$$Y_{mn} = -\frac{\hat{q}_m}{\hat{\theta}_n} \quad (7)$$

3.1.2.5

areal heat capacity

heat capacity divided by area of element

Another representation of the concept:

$$\kappa_m = \frac{C_m}{A} = \frac{1}{\omega} |Y_{mm} - Y_{mn}| \quad (8)$$

NOTE 1 Using Equation (8), the heat capacities are then:

$$C_m = A\kappa_m \quad (9)$$

NOTE 2 There are two thermal admittances and two heat capacities for a component separating two zones, all of which depend on the period of the thermal variations.

3.1.2.6

decrement factor

ratio of the modulus of the periodic thermal transmittance to the steady-state thermal transmittance U

Another representation of the concept:

$$f = \frac{|\hat{q}_m|}{|\hat{\theta}_n|U} = \frac{|Y_{mn}|}{U} \quad (10)$$

where $m \neq n$

3.1.2.7

periodic penetration depth

δ

depth at which the amplitude of the temperature variations are reduced by the factor "e" in a homogeneous material of infinite thickness subjected to sinusoidal temperature variations on its surface

Another representation of the concept:

$$\delta = \sqrt{\frac{\lambda T}{\pi \rho c}} \quad (11)$$

NOTE e is the base of natural logarithms; e = 2,718...

3.1.2.8

heat transfer matrix

Z

matrix relating the complex amplitudes of temperature and heat flow rate on one side of a component to the complex amplitudes of temperature and heat flow rate on the other side

Another representation of the concept:

$$Z = \begin{pmatrix} \hat{\theta}_2 \\ \hat{q}_2 \end{pmatrix} = \begin{pmatrix} Z_{11} & Z_{12} \\ Z_{21} & Z_{22} \end{pmatrix} \cdot \begin{pmatrix} \hat{\theta}_1 \\ \hat{q}_1 \end{pmatrix} \quad (12)$$

3.2 Symbols and units

Symbol	Quantity	Unit
A	area	m ²
C	heat capacity	J/K
L_{mn}	periodic thermal conductance	W/K
R	thermal resistance	m ² ·K/W
T	period of the variations	s
U	thermal transmittance under steady state boundary conditions	W/(m ² ·K)
Y_{mn}	thermal admittance	W/(m ² ·K)
Y_{mn}	periodic thermal transmittance	W/(m ² ·K)
Z	heat transfer matrix environment to environment	—
Z_{mn}	element of the heat transfer matrix	—
a	thermal diffusivity	m ² /s
c	specific heat capacity	J/(kg·K)
d	thickness of a layer	m
f	decrement factor	—
j	unit on the imaginary axis for a complex number; $j = \sqrt{-1}$	—
q	density of heat flow rate	W/m ²
t	time	s or h
x	distance through the component	m
Δt	time shift: time lead (if positive), or time lag (if negative)	s or h
δ	periodic penetration depth of a heat wave in a material	m
Φ	heat flow rate	W
ξ	ratio of the thickness of the layer to the penetration depth	—
κ	areal heat capacity	J/(m ² ·K)
λ	design thermal conductivity	W/(m·K)
ρ	density	kg/m ³
θ	temperature	°C
ω	angular frequency; $\omega = \frac{2\pi}{T}$	rad/s
φ, ψ	phase differences	rad

3.3 Subscripts

Subscript	Definition
a	air layer
e	external
i	internal
<i>m, n</i>	for the thermal zones
s	related to surface
ee	from environment to environment

3.4 Other symbols

Symbol	Definition
\wedge	complex amplitude
–	mean value
$ $	modulus of a complex number
arg	argument of a complex number

4 Period of the thermal variations

The definition of dynamic thermal characteristics and the formulae for their calculation are valid for any period of thermal variations.

The values of dynamic thermal characteristics depend on the periods. If more than one period is considered, an additional suffix shall be added to all quantities affected so as to distinguish between the values for different periods.

Practical time periods are:

- one hour (3 600 s), which corresponds to very short time variations, such as those resulting from temperature control systems;
- one day (86 400 s), corresponding to daily meteorological variations and temperature setback;
- one week (604 800 s), corresponding to longer term averaging of the building;
- one year (31 536 000 s), useful for treatment of heat transfer through the ground.

5 Data required

The data required to compute the dynamic thermal characteristics are:

- a) the detailed drawings of the product, with dimensions;
- b) for each material used in the product:
 - the thermal conductivity, λ ;

- the specific heat capacity, c ;
- the density, ρ .

These values shall be the design values of the materials used.

6 Heat transfer matrix of a multi-layer component

6.1 General

The procedure in 6.2 applies to building components consisting of plane homogeneous layers. Thermal bridges usually present in such building components do not affect significantly the dynamic thermal characteristics, and can hence be neglected.

The calculation of dynamic thermal characteristics of non-plane components and of components containing very important thermal bridges shall be made by solving the equation of heat transfer under periodic boundary conditions. For this purpose, the rules for modelling the component as given in ISO 10211 shall be used together with numerical methods, such as finite difference and finite element techniques.

6.2 Procedure

The procedure is as follows:

- a) identify the materials comprising the layers of the building component and the thickness of these layers, and determine the thermal characteristics of the materials;
- b) specify the period of the variations at the surfaces;
- c) calculate the penetration depth for the material of each layer;
- d) determine the elements of the heat transfer matrix for each layer;
- e) multiply the layer heat transfer matrices, including those of the boundary layers, in the correct order, so as to obtain the transfer matrix of the component.

6.3 Heat transfer matrix of a homogeneous layer

The periodic penetration depth for the material of the layer, δ , is calculated from its thermal properties and the period T using Equation (11).

The ratio of the thickness of the layer to the penetration depth is then

$$\xi = \frac{d}{\delta} \quad (13)$$

The matrix elements, Z_{mn} , are calculated as follows:

$$\begin{aligned} Z_{11} &= Z_{22} = \cosh(\xi) \cos(\xi) + j \sinh(\xi) \sin(\xi); \\ Z_{12} &= -\frac{\delta}{2\lambda} \left\{ \sinh(\xi) \cos(\xi) + \cosh(\xi) \sin(\xi) + j \left[\cosh(\xi) \sin(\xi) - \sinh(\xi) \cos(\xi) \right] \right\}; \\ Z_{21} &= -\frac{\lambda}{\delta} \left\{ \sinh(\xi) \cos(\xi) - \cosh(\xi) \sin(\xi) + j \left[\sinh(\xi) \cos(\xi) + \cosh(\xi) \sin(\xi) \right] \right\}. \end{aligned} \quad (14)$$

6.4 Heat transfer matrix of plane air cavities

The specific heat capacity of such layers is neglected. Hence, if R_a is the thermal resistance of the air layer, including convection, conduction and radiation, its heat transfer matrix is

$$\mathbf{Z}_a = \begin{pmatrix} 1 & -R_a \\ 0 & 1 \end{pmatrix} \quad (15)$$

The thermal resistance of the air layer shall be calculated in accordance with ISO 6946.

6.5 Heat transfer matrix of a building component

The heat transfer matrix of the building component from surface to surface is

$$\mathbf{Z} = \begin{pmatrix} Z_{11} & Z_{12} \\ Z_{21} & Z_{22} \end{pmatrix} = \mathbf{Z}_N \mathbf{Z}_{N-1} \dots \mathbf{Z}_3 \mathbf{Z}_2 \mathbf{Z}_1 \quad (16)$$

where $\mathbf{Z}_1, \mathbf{Z}_2, \mathbf{Z}_3, \dots, \mathbf{Z}_N$, are the heat transfer matrices of the various layers of the building component, beginning from layer 1. As a convention for building envelope components, layer 1 shall be the innermost layer.

The heat transfer matrix from environment to environment through the building component is

$$\mathbf{Z}_{ee} = \mathbf{Z}_{s2} \mathbf{Z} \mathbf{Z}_{s1} \quad (17)$$

where \mathbf{Z}_{s1} and \mathbf{Z}_{s2} are the heat transfer matrices of the boundary layers, given by

$$\mathbf{Z}_s = \begin{pmatrix} 1 & -R_s \\ 0 & 1 \end{pmatrix} \quad (18)$$

where R_s is the surface resistance of the boundary layer, including convection and radiation. Values of surface resistance shall be in accordance with ISO 6946.

In most cases, the heat transfer matrix and the dynamic characteristics of a building component shall be calculated using the surface resistance values appropriate to the intended orientation of the component. If the orientation of the component is not known, the calculations shall be done for vertical orientation (heat flow horizontal). For certain applications where boundary layers are taken into account separately, the periodic heat capacity of the component should be calculated omitting the boundary layers.

7 Dynamic thermal characteristics

7.1 Characteristics for any component

The dynamic thermal characteristics of any component are four periodic thermal conductances, L_{mn} , and two heat capacities, C_m , as given in 3.1.1.4 and 3.1.1.5.

7.2 Characteristics for components consisting of plane and homogeneous layers

7.2.1 Thermal admittances and periodic thermal conductances

The thermal admittances are

$$Y_{11} = -\frac{Z_{11}}{Z_{12}} \quad \text{and} \quad Y_{22} = -\frac{Z_{22}}{Z_{12}} \quad (19)$$

where Y_{11} is for the internal side of the component, while Y_{22} is for the external side.

The time shift of admittance, is:

$$\Delta t_Y = \frac{T}{2\pi} \arg(Y_{mm}) \quad (20)$$

with the argument evaluated in the range 0 to 2π .

7.2.2 Modified admittance for internal partitions

For internal partitions within a building, where the temperature variations are the same on either side of the partition, the periodic heat flow is related to the periodic temperature variations by a modified admittance:

$$Y_{mm}^* = Y_{mm} - Y_{mn} \quad (21)$$

where Y_{mn} is the periodic thermal transmittance (see also 7.2.3, Note).

7.2.3 Areal heat capacities

The areal heat capacities are

$$\kappa_1 = \frac{T}{2\pi} \left| \frac{Z_{11} - 1}{Z_{12}} \right| \quad (22)$$

and

$$\kappa_2 = \frac{T}{2\pi} \left| \frac{Z_{22} - 1}{Z_{12}} \right| \quad (23)$$

Equations (22) and (23) apply to both external elements and to internal partitions.

NOTE For an internal partition, $\kappa_m = |Y_{mm}^*| / \omega$.

7.2.4 Periodic thermal transmittance and decrement factor

The periodic thermal transmittance is given by

$$Y_{12} = \frac{1}{Z_{12}} \quad (24)$$

and the decrement factor is given by

$$f = \frac{|Y_{12}|}{U_0} \quad (25)$$

where the thermal transmittance, U_0 , is calculated in accordance with ISO 6946 ignoring any thermal bridges.

NOTE U_0 is calculated ignoring thermal bridges for consistency with the calculation of the dynamic characteristics (see 6.1).

The decrement factor is always less than 1.

The time shift of the periodic thermal transmittance is:

$$\Delta t_f = \frac{T}{2\pi} \arg(Z_{12}) \quad (26)$$

with the argument evaluated in the range -2π to 0.

8 Report

8.1 Calculation report

The calculation report shall include a description of the building component, its normal use (part of the envelope or internal component) and enumeration of zones in contact with it.

Each homogeneous part shall be clearly defined with dimensions and identification of the material used in the part, as well as the thermal conductivity, the density and the specific heat capacity used for the calculations.

The report shall provide, for any component, the periodic thermal conductances and the heat capacities, together with the period, T , used for the calculations.

In addition, for plane components made of homogeneous layers, the report shall contain:

- the area of the element;
- a list of the layers beginning with side 1; side 1 adopted for the calculation shall be clearly designated; for building envelope components, side 1 shall be that of the innermost layer;
- the values of the surface resistances, R_{si} and R_{se} , used for the calculation;
- the four elements of the transfer matrix, Z ; these complex numbers are given by their modulus and argument, in angular units; the arguments may also be converted into the corresponding time shifts;
- the two thermal admittances, described by their modulus and arguments;
- the decrement factor;
- the thermal transmittance, U_0 , used for the calculation of the decrement factor; the thermal transmittance including thermal bridges, calculated in accordance with ISO 6946, shall also be included where possible: if that is not possible it shall be made clear in the report that the thermal transmittance does not include thermal bridges and is not suitable for steady-state heat transfer calculations.

The heat transfer matrix of the reversed component shall also be provided for building envelope components which could be installed with either side in contact with the external environment.

If the calculation is performed for several periods, the results shall be provided for each period.

8.2 Summary of results

If only some of the characteristics are extracted from the calculation report for use as product specifications, then these shall include at least the heat capacities and the decrement factor for a period of one day.

For components where the decrement factor cannot be calculated, the periodic thermal conductance is given instead of the decrement factor.

Annex A (normative)

Simplified calculation of the heat capacity

A.1 Limits of use

The simplified methods described below apply only to plane components. They are based on the penetration depth of a heat wave calculated for the material adjacent to the surface [see Equation (11)].

When the accuracy of the calculation is of secondary importance, e.g. when a rough estimate of the internal thermal inertia of a whole thermal zone is required, the following simplified methods can be used. However, these approximations cannot be used to define the thermal inertia characteristics of a product.

The results obtained by following the methods described in this annex shall be accompanied by a note mentioning that they are calculated in accordance with this annex and stating which approximation was used.

A.2 Simplified methods

A.2.1 Procedure

The heat capacity of the component is calculated first without taking account of the surface resistance, using the most suitable of the approximations in A.2.2 to A.2.4. Account is then taken of the surface resistance in accordance with A.3.

A.2.2 Thin layer approximation

If, for the side under consideration, the first layer of the building component has a thickness d less than half its periodic penetration depth, and if the next layer is an insulating material, then the first layer can be assumed to be isothermal and the areal heat capacity of the component for the side under consideration is assessed by

$$\kappa_m = d \rho c \quad (\text{A.1})$$

A.2.3 Semi-infinite medium approximation

If, for the side under consideration, the first layer of the building component has a thickness greater than twice its periodic penetration depth, then that layer can be considered as infinitely thick and the areal heat capacity of the component for the side under consideration is assessed by

$$\kappa_m \cong \frac{\delta \rho c}{\sqrt{2}} \quad (\text{A.2})$$

A.2.4 Effective thickness method

This method uses the approximations given in A.2.2 and A.2.3, together with a conventional value of the thermal diffusivity, $\alpha = 0,7 \times 10^{-6} \text{ m}^2/\text{s}$.

The effective thickness, d_T , of one side of a component is the minimum value of the following:

- a) half the total thickness of the component;
- b) the thickness of materials between the surface of interest and the first thermal insulating layer, not taking account of coatings which are not part of the component;
- c) a maximum effective thickness, depending on the period of the variations.

Table A.1 gives indicative values of maximum effective thickness. Values for specific materials may be provided on a national basis.

Table A.1 — Maximum effective thickness depending on the period of the variations

Period of the variations	1 hour	1 day	1 week
Maximum effective thickness	20 mm	100 mm	250 mm

NOTE These effective thicknesses are very approximate values. The conventional value of thermal diffusivity is close to that of concrete, plaster and mortar. Thermal diffusivity of usual building materials (excluding insulating materials and metals) range from $0,12 \times 10^{-6} \text{ m}^2/\text{s}$ (pine wood) to $1 \times 10^{-6} \text{ m}^2/\text{s}$ (limestone). Actual effective thickness can then range from 40 % to 120 % of the conventional value.

The areal heat capacity is calculated by

$$\kappa_m = \sum_i \rho_i d_i c_i \quad \text{with} \quad \sum_i d_i = d_T \tag{A.3}$$

The heat capacity of a component completely contained within the thermal zone under consideration is calculated as the sum of the heat capacities calculated from both surfaces of the component.

This simplified method can overestimate the heat capacity for some materials, such as wood or aerated concrete, and can provide results somewhat different from those given by the calculation method described in this International Standard.

A.3 Effect of surface resistance

The equivalent areal heat capacity, κ'_m , of a building component including the surface resistance, R_s , or of a high-mass component covered by a layer of negligible mass but representing a thermal resistance, R , is estimated by

$$\kappa'_m = \sqrt{\frac{\kappa_m^2}{1 + \omega^2 \kappa_m^2 (R + R_s)^2}} \tag{A.4}$$

where

R_s is the surface resistance;

κ_m is the areal heat capacity for the high-mass component.

Annex B (informative)

Principle of the method and examples of applications

B.1 Principle

The method given in this International Standard is based on heat conduction in building components composed of several plane, parallel, homogeneous layers, under regular sinusoidal boundary conditions and one dimensional heat flow.

That means that at any location in the component, the temperature variations can be modelled by

$$\theta_n(x,t) = \bar{\theta}(x) + \frac{\hat{\theta}_{+n}(x)e^{j\omega t} + \hat{\theta}_{-n}(x)e^{-j\omega t}}{2} \quad (\text{B.1})$$

and the variations of the density of heat flow rate are

$$q_n(x,t) = \bar{q}(x) + \frac{\hat{q}_{+n}(x)e^{j\omega t} + \hat{q}_{-n}(x)e^{-j\omega t}}{2} \quad (\text{B.2})$$

with

$$\hat{\theta}_{\pm}(x) = |\hat{\theta}(x)| e^{\pm j\psi} \quad \text{and} \quad \hat{q}_{\pm}(x) = |\hat{q}(x)| e^{\pm j\varphi} \quad (\text{B.3})$$

Temperature and density of heat flow rate variations are those around the mean values $\bar{\theta}$ and \bar{q} of these variables, which are linked by

$$\bar{q} = U(\bar{\theta}_i - \bar{\theta}_e) \quad (\text{B.4})$$

where U is the thermal transmittance of the component.

The one dimensional equation of heat can be solved for a single layer of homogenous material with sinusoidal boundary conditions (e.g. see [1]). The solution can be represented by Equation (12), the element being represented by the heat transfer matrix.

The heat transfer matrix, Z , then allows the calculation of the variations of the temperature, θ_2 , and of the density of heat flow rate, q_2 , on one side of the building component, when these quantities, θ_1 and q_1 , are known on the other side.

The elements of the heat transfer matrix have the physical interpretation indicated below. Each element is a complex number, which can be represented by its modulus, $|Z_{mn}|$, and its argument, $\varphi_{mn} = \arg(Z_{mn})$.

- $|Z_{11}|$ is a temperature amplitude factor, i.e. the amplitude of the temperature variations on side 2 resulting from an amplitude of 1 K on side 1.
- φ_{11} is the phase difference between temperatures on both sides of the component.
- $|Z_{21}|$ gives the amplitude of the density of heat flow rate through side 2 resulting from a periodic variation of temperature on side 1 with an amplitude of 1 K.

- φ_{21} is the phase difference between the density of heat flow rate through side 2 and the temperature of side 1.
- $|Z_{12}|$ gives the amplitude of the temperature on side 2 when side 1 is subjected to a periodically varying density of heat flow rate with an amplitude of 1 W/m^2 .
- φ_{12} is the phase difference between the temperature on side 2 and the density of heat flow rate through side 1.
- $|Z_{22}|$ is the heat flow rate amplitude factor, i.e. the amplitude of the variations of the density of heat flow rate through side 2 resulting from an amplitude of density of heat flow rate of 1 W/m^2 through side 1.
- φ_{22} is the phase difference between the densities of heat flow rate through both sides of the component.

The time delays between the maximum of an effect and the maximum corresponding cause can be calculated from the phase shift of the transfer matrix element, Z_{ij} :

$$\Delta t_{ij} = \frac{T}{2\pi} \varphi_{ij} = \frac{T}{2\pi} \arg(Z_{ij}) \quad (\text{B.5})$$

B.2 Examples of application

B.2.1 General

The applications of the dynamic thermal characteristics are numerous. Some general examples are given in B.2.2 and B.2.3.

B.2.2 One component

The heat transfer matrix, Z , can be used for any application linking the boundary conditions on one side to the temperature and heat flow on the other side, as shown in Equation (12).

For example, the heat flow rate required to maintain a constant temperature on side 2 despite temperature and heat flow rate variations on side 1 is given by

$$\hat{q}_2 = Z_{21} \hat{\theta}_1 + Z_{22} \hat{q}_1 \quad (\text{B.6})$$

Similarly, the variation of the temperature on side 2 can be obtained by

$$\hat{\theta}_2 = Z_{11} \hat{\theta}_1 + Z_{12} \hat{q}_1 \quad (\text{B.7})$$

The variations of heat flow rate entering into the component on both sides can be calculated from the variations of temperatures by solving Equation (12) for the densities of heat flow rates:

$$\begin{pmatrix} \hat{q}_1 \\ -\hat{q}_2 \end{pmatrix} = \frac{1}{Z_{12}} \begin{pmatrix} -Z_{11} & 1 \\ 1 & -Z_{22} \end{pmatrix} \cdot \begin{pmatrix} \hat{\theta}_1 \\ \hat{\theta}_2 \end{pmatrix} \quad (\text{B.8})$$

NOTE The sign of \hat{q}_2 is changed because the positive direction is going out of the element at side 2.

Thermal admittance is the amplitude of the density of heat flow rate on one side resulting from a unit temperature amplitude on the same side, when the temperature amplitude on the other side is zero:

$$Y_{11} = \frac{\hat{q}_1}{\hat{\theta}_1} \text{ for } \hat{\theta}_2 = 0, \text{ so } Y_{11} = -\frac{Z_{11}}{Z_{12}} \quad (\text{B.9})$$

$$Y_{22} = \frac{-\hat{q}_2}{\hat{\theta}_2} \text{ for } \hat{\theta}_1 = 0, \text{ so } Y_{22} = -\frac{Z_{22}}{Z_{12}} \quad (\text{B.10})$$

Periodic thermal transmittance is amplitude of the density of heat flow rate on one side when the temperature amplitude on that side is zero and there is unit temperature amplitude on the other side:

$$Y_{12} = \frac{\hat{q}_2}{\hat{\theta}_1} \text{ for } \hat{\theta}_2 = 0, \text{ so } Y_{12} = -\frac{1}{Z_{12}} \quad (\text{B.11})$$

NOTE Y_{22} is, in general, different from Y_{11} , but always $Y_{21} = Y_{12}$.

Heat capacities represent the ability of a building component to store energy from either side when the corresponding temperature varies periodically.

The component having heat capacity C_1 on one side will store, on that side, an amount of energy equal to

$$Q = 2 C_1 |\hat{\theta}_1| \quad (\text{B.12})$$

resulting from a periodic change in the temperature of side 1 from $-|\hat{\theta}_1|$ to $+|\hat{\theta}_1|$ during a half period. The same applies to side 2.

B.2.3 Several components

When several components are linked to the same zone, j ,

$$\hat{\Phi}_j = \sum_k (L_{11,k} \hat{\theta}_j - L_{12,k} \hat{\theta}_k) \quad (\text{B.13})$$

where the summation is over all zones, k , that are thermally connected to zone j . The thermal conductances can be calculated directly by solving the time-dependent equation of heat transfer using a geometrical model in accordance with ISO 10211. For components in which one dimensional heat flow can be assumed, however, the calculation method provided in this International Standard can be used to obtain $L_{mn,k}$.

For example, let us consider a cold store built outside and consisting of two types of components: the walls and the roof. Assuming that these components have a relatively small thermal inertia, only the daily variations are considered. It is also assumed that the mass of the products stored in the cold store should not be taken into account and that the cold store is well insulated from the ground. Therefore, as far as thermal bridges can be neglected, the daily average cooling power, $\bar{\Phi}_i$, required to maintain a fixed internal temperature, θ_i , when the daily average external temperature is $\bar{\theta}_e$, is

$$\bar{\Phi}_i = (A_w U_w + A_r U_r) (\bar{\theta}_e - \theta_i) \quad (\text{B.14})$$

where

A_r is the area of the roof;

U_r is steady state thermal transmittance of the roof;

A_w is the area of the wall;

U_w is the steady state thermal transmittance of the wall.

A negative cooling power means a heating power.

However, some supplementary power can be required to maintain a constant internal temperature despite a daily variation of the external temperature. If this variation is considered as sinusoidal of amplitude $\hat{\theta}_e$, this supplementary power amplitude will be

$$\hat{\Phi}_i = |A_w Y_{12,w} + A_r Y_{12,r}| \hat{\theta}_e \quad (\text{B.15})$$

where Y_{12} is calculated with a period of 24 h and with the innermost layer as the first layer. Here again, thermal bridges are neglected. The total peak power will then be

$$\Phi_p = \bar{\Phi}_i + \hat{\Phi}_i \quad (\text{B.16})$$

NOTE 1 The simplifying assumptions in this example are made for sake of simplicity and are not necessary. For example, solving the heat transfer equation for two- and three-dimensional heat flow allows one to take account of heat transfer to the ground and thermal bridges. Higher thermal inertia and non sinusoidal (but periodic) external temperature variations can be considered by using a representation of the temperature and heat flow as Fourier series, with several time periods (1, 2, 4, 8, ... days).

NOTE 2 The absorption of solar radiation on the external surface could be taken into account as an external heat flow, or by introducing an equivalent radiation temperature.

STANDARDSISO.COM : Click to view the full PDF of ISO 13786:2007

Annex C (informative)

Further information for computer programming

C.1 General

The calculations in accordance with this International Standard will usually be done on a computer. The following can assist the programmer.

C.2 Flow chart for the calculation method

Figure C.1 shows the sequence of operations, from top to bottom.

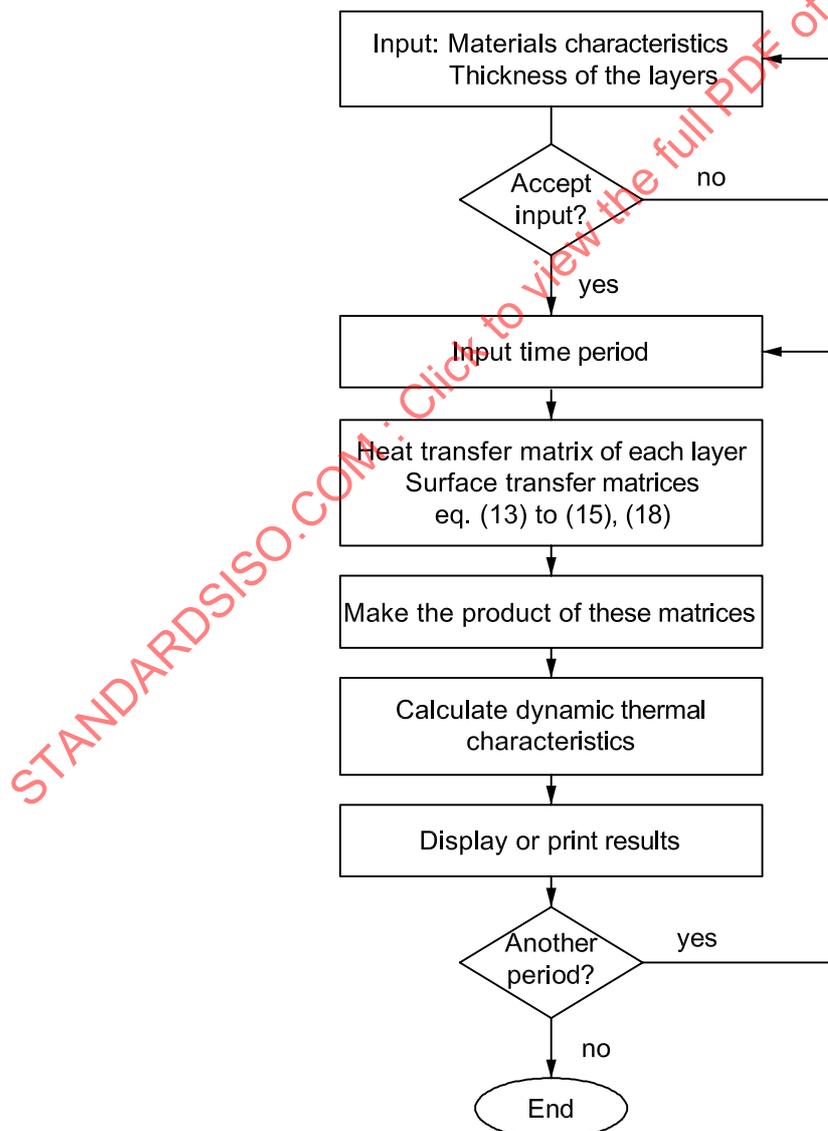


Figure C.1 — Flow chart of the calculation method

C.3 Representation of complex numbers

This International Standard requires computation with complex numbers. This can be done on computers, even if the mathematical language does not include complex numbers, by using the technique presented below.

Let a and b be respectively the real and imaginary parts of a complex number, z . This number can be represented in matrix notation:

$$z = \begin{pmatrix} a & b \\ -b & a \end{pmatrix} \tag{C.1}$$

This changes a complex number into a real matrix of order 2, and a complex matrix of order 2 into a real matrix of order 4. Then the calculations with complex numbers are replaced by conventional matrix calculations. The matrix resulting from the calculation contains, in its odd rows, the real and imaginary parts of the corresponding complex number.

The modulus and argument of a complex number can be obtained from the real and imaginary parts by

$$|z| = \sqrt{a^2 + b^2} \tag{C.2}$$

Assuming that the arctan function is evaluated in the range $-\pi/2$ to $+\pi/2$, $\arg(z)$ is obtained from the appropriate formula in Table C.1.

Table C.1 — Argument of complex number

Values of a and b	$\arg(z)$ for admittance	$\arg(z)$ for periodic thermal transmittance
$b = 0$	0	0
$a > 0, b > 0$	$\arctan\left(\frac{b}{a}\right)$	$\arctan\left(\frac{b}{a}\right) - 2\pi$
$a = 0, b > 0$	$\pi/2$	$-3\pi/2$
$a < 0, b > 0$	$\arctan\left(\frac{b}{a}\right) + \pi$	$\arctan\left(\frac{b}{a}\right) - \pi$
$a > 0, b < 0$	$\arctan\left(\frac{b}{a}\right) + 2\pi$	$\arctan\left(\frac{b}{a}\right)$
$a = 0, b < 0$	$3\pi/2$	$-\pi/2$
$a < 0, b < 0$	$\arctan\left(\frac{b}{a}\right) + \pi$	$\arctan\left(\frac{b}{a}\right) - \pi$