
**Safety of machinery — Permanent means
of access to machinery —**

**Part 4:
Fixed ladders**

*Sécurité des machines — Moyens d'accès permanents aux
machines —*

Partie 4: Échelles fixes

STANDARDSISO.COM : Click to view the full PDF of ISO 14122-4:2004



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

STANDARDSISO.COM : Click to view the full PDF of ISO 14122-4:2004

© ISO 2004

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 14122-4 was prepared by the European Committee for Standardization (CEN) in collaboration with Technical Committee ISO/TC 199, *Safety of machinery*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

Throughout the text of this document, read “...this European Standard...” to mean “...this International Standard...”.

ISO 14122 consists of the following parts, under the general title *Safety of machinery — Permanent means of access to machinery*:

- *Part 1: Choice of fixed means of access between two levels*
- *Part 2: Working platforms and walkways*
- *Part 3: Stairs, stepladders and guard-rails*
- *Part 4: Fixed ladders*

For the purposes of this part of ISO 14122, the CEN annex regarding fulfilment of European Council Directives has been removed.

Contents

	Page
Foreword.....	v
Introduction.....	vi
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Safety requirements	6
4.1 General requirements.....	6
4.2 Strength of fixed ladders	6
4.2.1 General requirements.....	6
4.2.2 Fixing elements.....	7
4.2.3 Platforms	8
4.3 Conditions for installation of an fall protection device	11
4.3.1 Conditions requiring the installation of an fall protection device	11
4.3.2 Choice of the type of fall protection device	12
4.4 Ladder	12
4.4.1 Position of the rungs	12
4.4.2 Rungs.....	13
4.4.3 Devices against slipping-off.....	15
4.4.4 Spacing between the ladder and any permanent obstruction	15
4.5 Safety cage	15
4.6 Guided type fall arrester on a rigid anchorage line.....	15
4.7 Departure and arrival areas - Platforms	15
4.7.1 Departure areas.....	16
4.7.2 Arrival areas	17
4.7.3 Access openings	18
4.7.4 Climbing off and getting on to a fixed ladder safely	18
4.7.5 Platforms	20
5 Verification of safety requirements.....	21
5.1 General.....	21
5.2 Tests of fixed ladders with two stiles	22
5.3 Testing of the safety cage.....	22
5.4 Tests of fixed ladders with one stile	24
5.4.1 Strength and bending of a ladder element; Torsion of the rungs	24
5.4.2 Strength of the rungs	25
5.4.3 Strength of the stile	26
5.5 Test of the anchor points.....	26
5.5.1 Fixed ladders with two stiles without fall arrester	26
5.5.2 Fixed ladders with one stile.....	27
5.5.3 Fixed ladders with fall arrester.....	27
6 Assembly and operating instructions	28
6.1 Assembly instructions	28
6.2 Operating instructions for ladders with fall arrester.....	28
6.3 Marking at points of entry and exit	28
Bibliography.....	29

Foreword

This document (EN ISO 14122-4:2004) has been prepared by Technical Committee CEN/TC 114 "Safety of machinery", the secretariat of which is held by DIN, in collaboration with Technical Committee ISO/TC 199 "Safety of machinery".

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by June 2005, and conflicting national standards shall be withdrawn at the latest by June 2005.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s).

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Slovenia, Spain, Poland, Sweden, Switzerland and the United Kingdom.

STANDARDSISO.COM : Click to view the full PDF of ISO 14122-4:2004

Introduction

This is the fourth part of the standard "Safety of machinery — Permanent means of access to machinery". The parts of the standard are:

Part 1: Choice of a fixed means of access between two levels

Part 2: Working platforms and walkways

Part 3: Stairs, stepladders and guard-rails

Part 4: Fixed ladders.

This European standard is a type B standard as stated in EN ISO 12100.

This standard is to be read in conjunction with Clause 1.6.2 "Access to operating position and servicing points" and 1.5.15 "Risk of slipping, tripping or falling" of the essential safety requirements expressed in Annex A of EN 292-2:1991/A1:1995. See also 5.5.6 "Measures for safe access to machinery" of EN ISO 12100-2:2003 which supersedes EN 292-2.

The provisions of this document can be supplemented or modified by a type C standard.

NOTE 1 For machines which are covered by the scope of a type C standard and which have been designed and built according to the provisions of that standard, the provisions of that type C standard will take precedence over the provisions of this type B standard.

NOTE 2 The use of materials other than metals (composite materials, so-called "advanced" materials, etc.) does not alter the application of the present standard.

1 Scope

This standard applies to all machinery (stationary and mobile) where fixed means of access are necessary.

The purpose of this standard is to define the general requirements for safe access to machines mentioned in EN ISO 12100-2. EN ISO 14122-1 gives advice about the correct choice of access means when the necessary access to the machine is not possible directly from the ground level or from a floor.

This standard applies to fixed ladders, which are a part of a machine.

This standard may also be applied to fixed ladders to that part of the building where the machine is installed, providing the main function of that part of the building is to provide a means of access to the machine.

NOTE This standard may be used also for means of access which are outside the scope of this standard. In those cases the possible relevant national or other regulations should be taken into account.

This standard applies also to ladders which are not permanently fixed to the machine and which may be removed, moved to the side or pivoted (swivel-mounted) for some operations of the machine (e.g. changing tools in a large press).

For the significant hazards covered by this standard, see Clause 4 of EN ISO 14122-1.

This standard is not applicable to machinery which are manufactured before the date of publication of this standard by CEN.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 131-2:1993, *Ladders — Requirements, tests, markings*.

EN 353-1, *Personal protective equipment against falls from a height — Part 1: Guided type fall arresters including a rigid anchorage line*.

EN 363, *Personal protective equipment against falls from a height — Fall arrest systems*.

EN ISO 12100-1:2003, *Safety of machinery — Basic concepts, general principles for design — Part 1: Basic terminology, methodology (ISO 12100-1:2003)*

EN ISO 12100-2:2003, *Safety of machinery — Basic concepts, general principles for design — Part 2: Technical principles (ISO 12100-2:2003)*.

EN ISO 14122-1, *Safety of machinery — Permanent means of access to machinery — Part 1: Choice of a fixed means of access between two levels (ISO 14122-1:2001)*.

EN ISO 14122-2, *Safety of machinery — Permanent means of access to machinery — Part 2: Working platforms and walkways (ISO 14122-2:2001)*.

EN ISO 14122-3, *Safety of machinery — Permanent means of access to machinery — Part 3: Stairs, stepladders and guard-rails (ISO 14122-3:2001)*.

3 Terms and definitions

For the purposes of this European Standard, the terms and definitions given in EN ISO 12100-1:2003, EN ISO 14122-1:2001 and the following apply.

The main terms used in the present standard are given as an example in Figures 1, 2, 3 and 4.

3.1

fixed ladder with two stiles

ladder, according to 3.1 of EN ISO 14122-1, which is stationary and where the rungs are arranged between and attached to the stiles. The stiles carry the load (see Figure 2)

3.2

fixed ladder with one stile

ladder, according to 3.1 of EN ISO 14122-1, which is stationary and where the rungs are attached to both sides of the stile. The stile carries the load alone (see Figure 3)

3.3

ladder flight

continuous part of the fixed ladder (see Figure 1):

- between arrival and departure area, in the case of ladders without platforms; or
- between the arrival area respectively departure area and the nearest platform; or
- between rest platforms following each other

3.4

climbing height H of a fixed ladder

total vertical distance between the walking surface of the arrival area at the top of the ladder(s) and the walking surface of the departure area at the base of the ladder(s) (see Figure 1)

3.5

height h of the ladder flight

vertical distance between the level at the beginning and the level at the end of each flight (see Figure 1)

3.6

fall protection

technical measure to prevent or reduce the risk of people falling from fixed ladders

NOTE Commonly used fall protection devices are defined in 3.6.1 and 3.6.2.

3.6.1

safety cage

assembly which serves to limit the risk of people falling from the ladder (see Figure 2)

3.6.2

guided type fall arrester on a rigid anchorage line

fall arrester

protective equipment fixed to ladder used in combination with personal protective equipment that everyone has available before being allowed to use the ladder. (See also definition in EN 353-1 and EN 363)

In the following text the abbreviation "fall arrester" will also be used for this type of fall protection device.

3.7

arrival level

upper level of the surroundings or of the intermediate platform to which, the person steps after the ascent (see Figure 1)

3.8

departure level

lower level of the surroundings or of the intermediate platform from which the person starts to climb the fixed ladder (see Figure 1)

3.9

intermediate platform

horizontal structure (platform) between two consecutive flights of a ladder (used with ladders having staggered flights) (see Figure 1 and 4b)

3.10

rest platform

area equipped with the required protective means designed so that the user of the ladder can have a physical rest (See Figures 1b, 10, 11 and 12)

3.11

access platform

horizontal structure at the arrival or departure area used by a person for means of access

3.12

trap door

normally closed device which can be opened to give access through a platform or through other similar horizontal structures

STANDARDSISO.COM : Click to view the full PDF of ISO 14122-4:2004

Position of the rest platforms

Dimensions in millimetres

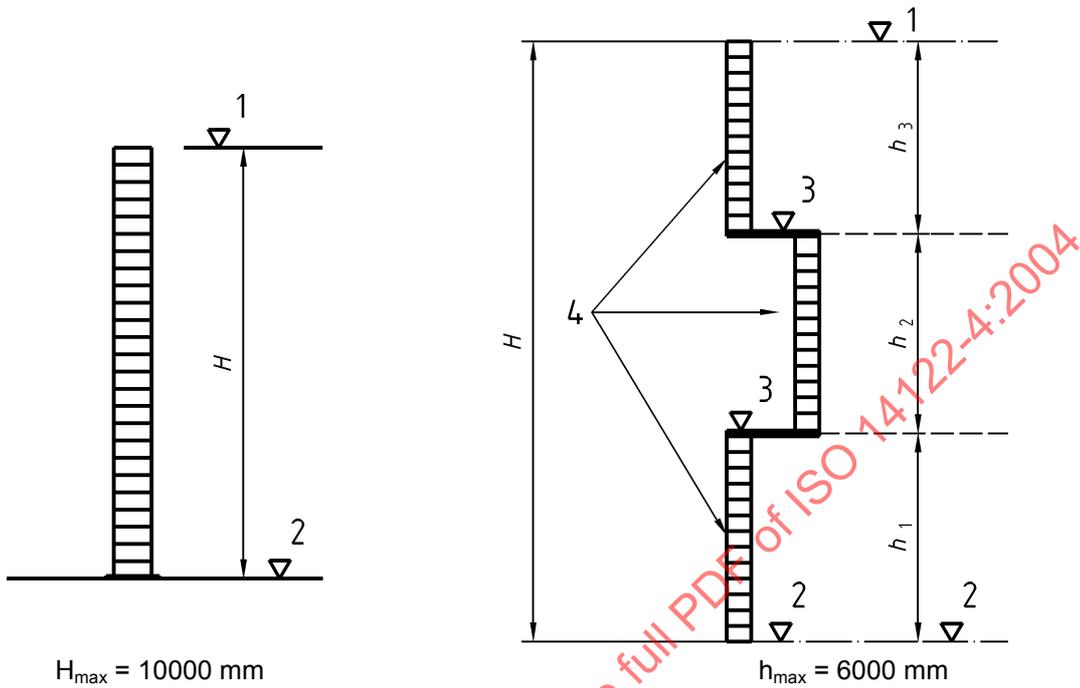



Figure 1.a : Ladder without rest platform (single flight)

Figure 1.b : Ladder with staggered flights

Key

- 1 Arrival area
- 2 Departure area
- 3 Intermediate platform or rest platform
- 4 Ladder flight


Figure 1 — Height of flights and location of platforms

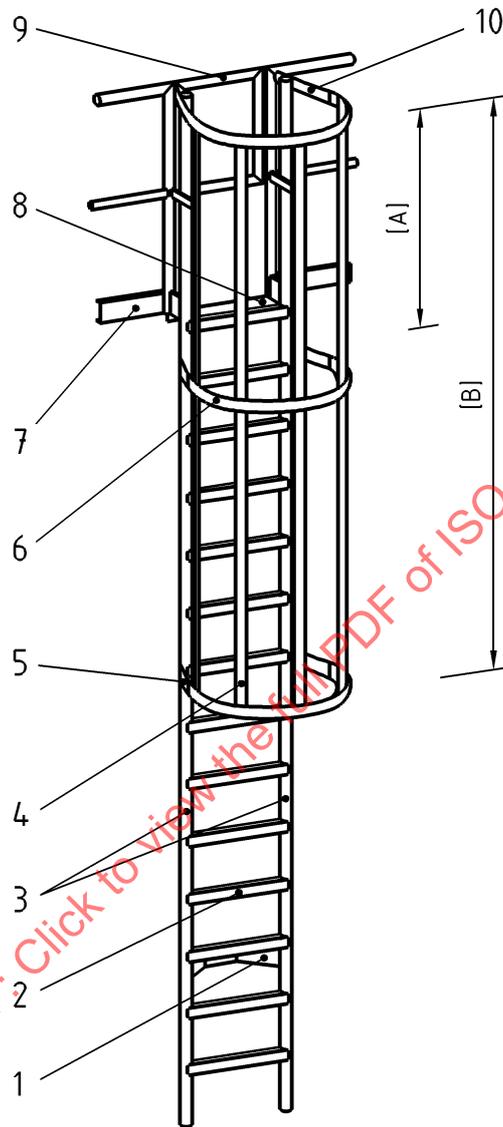

Key

- 1 Anchor bracket
- 2 Rung
- 3 Ladder stile
- 4 Safety cage vertical members
- 5 Lowest hoop
- 6 Intermediate hoop
- 7 Toe plate
- 8 Platform step
- 9 Gate
- 10 Upper hoop
- [A] Exit section
- [B] Safety cage

Figure 2 — Terminology

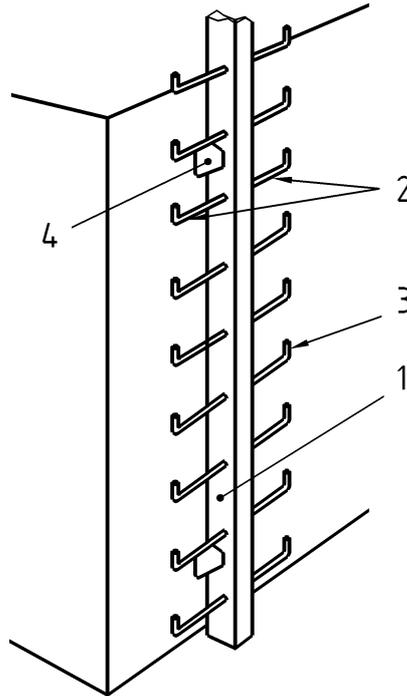

Key

- 1 Stile
- 2 Rung
- 3 Protective device against slipping-off
- 4 Anchor point

Figure 3 — Example of a ladder less than 3000 mm with one stile

4 Safety requirements

4.1 General requirements

The materials, dimensions of constituent elements and construction mode used shall meet the safety objectives of this standard.

Ladders shall be designed to meet the same installation requirements as the machine, taking into consideration where necessary, conditions such as harsh environment, vibrations, etc.

As far as possible, fixed ladders should be designed with two stiles. In exceptional circumstances (e. g. a continuous ladder with a varying angle of pitch or insufficient space to provide two stiles), fixed ladders may be provided with only one stile.

All parts likely to be in contact with users shall be designed so as not to catch, hurt or hinder i. e. sharp corners, welds with burrs, or rough edges, etc. should be avoided. Opening or closing the mobile parts (gate) shall not cause further hazards (e. g. shearing or accidental falling) for persons using the ladder and those in the vicinity.

Fittings, hinges, anchor points, supports and mounting points shall hold the assembly sufficiently rigid and stable to ensure the safety of users under normal conditions of use.

4.2 Strength of fixed ladders

4.2.1 General requirements

A ladder, platform and safety cage (when installed) shall meet the following design requirements:

4.2.1.1 Ladder element

The ladder elements are considered to fulfil the requirements mentioned in 4.2.1 when they meet the requirements of EN 131-2. The maximum deflection as indicated in 5.1 shall not exceed 50 mm.

In case of fixed ladders with one stile instead of the lateral bending test (see 4.4 of EN 131-2:1993) a torsion test shall be made by application of two test loads each 400 N. The deflection of the ladder shall not exceed 20 mm (see 5.4.3 and Figure 16). For the rungs, the load is applied on a length of 100 mm close to the lateral devices against slipping off. The residual deflection of the rungs shall be not more than 0,3 % related to the length of the rung (see 5.4.2, and Figure 15).

4.2.1.2 Safety cage

The safety cage is considered to meet these requirements if the permanent deformation as the result of a vertical load of 1000 N is not more than 10 mm and as the result of a horizontal load of 500 N is not more than 10 mm. (see 5.3 and Figure 13).

4.2.1.3 Fixed ladders equipped with a fall arrester

In addition to the requirements of 4.2.1.1, the combination of fall arrester and ladder shall be capable of stopping the user from falling (see Clause 5).

4.2.2 Fixing elements

4.2.2.1 General

Fixing elements such as fittings, anchorage points, hinges, supports and mountings shall hold the assembly sufficiently rigid and stable to ensure the safety of user under normal conditions of use (see verification in 5.5).

In case of fixed ladders equipped with a fall arrester the connecting elements shall withstand the stresses caused by the fall arrester catching the person who falls down.

4.2.2.2 Anchoring points of fixed ladders

The anchoring points and connections to them shall be capable of supporting 3000 N per stile. Up to four anchorages may be considered to contribute to this support. See 5.5 for the test method.

4.2.3 Platforms

All platforms shall comply with the requirements of EN ISO 14122-2.

Dimensions in millimetres

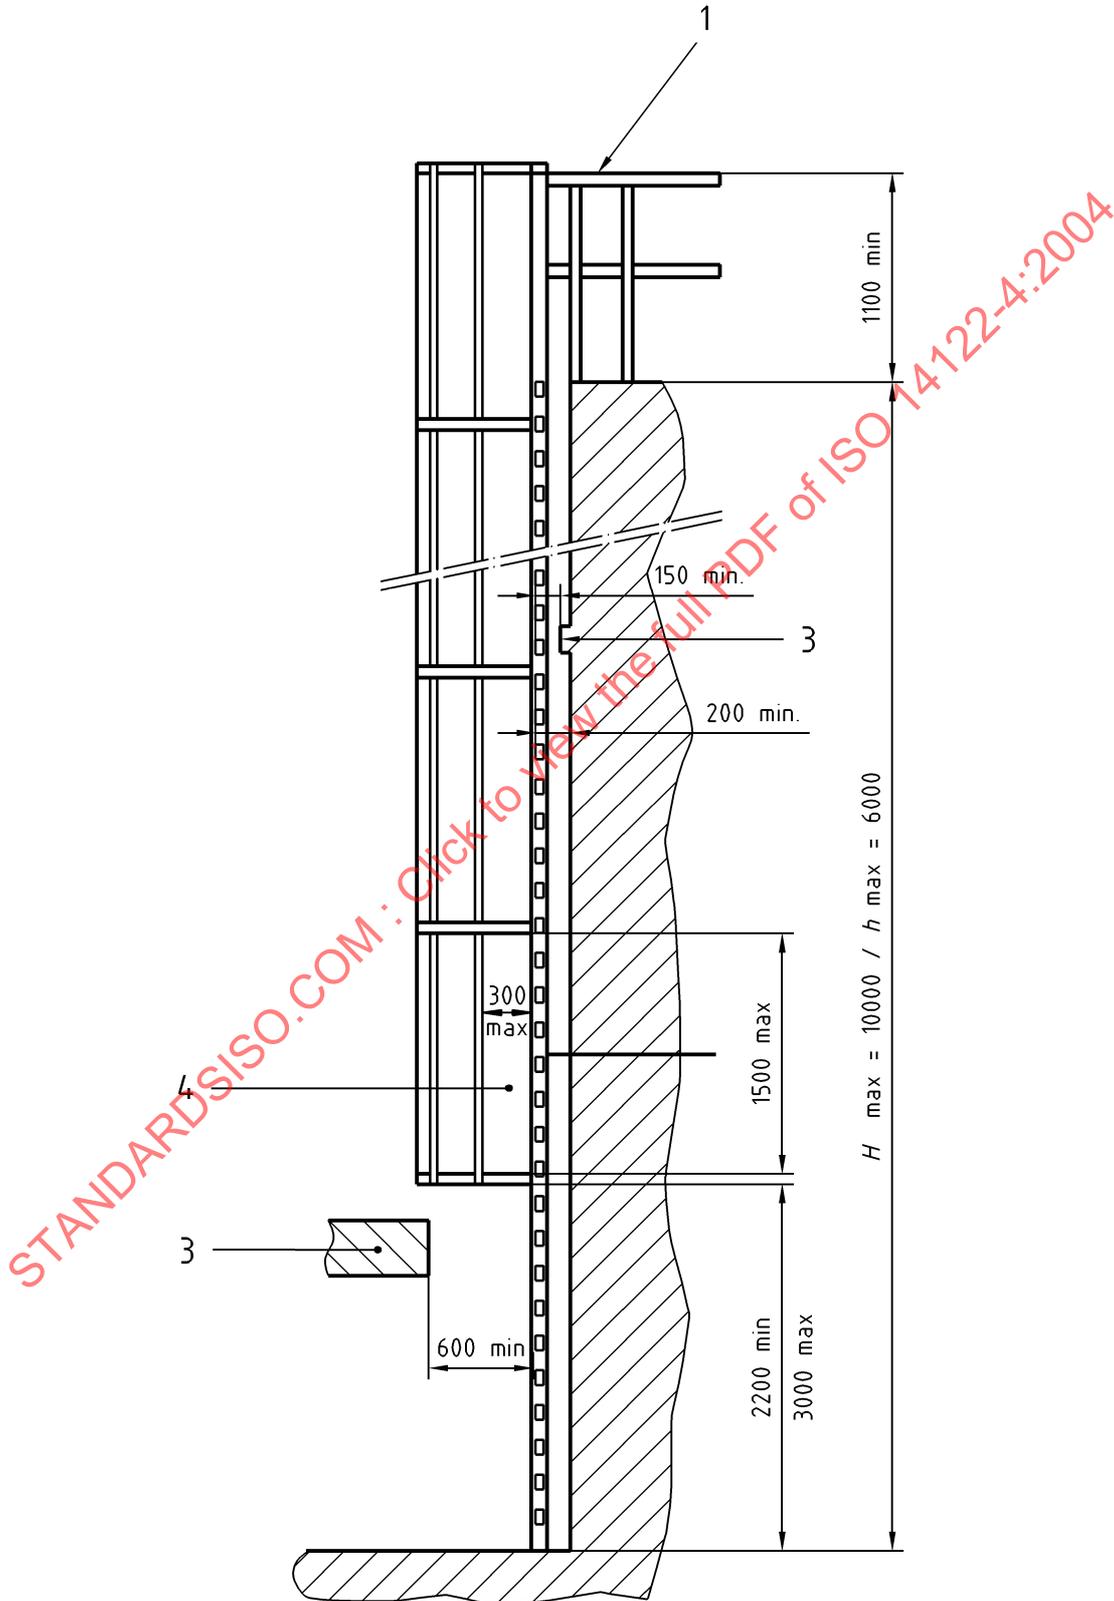


Figure 4a — Side elevation on ladder with a safety cage

Dimension in millimetres

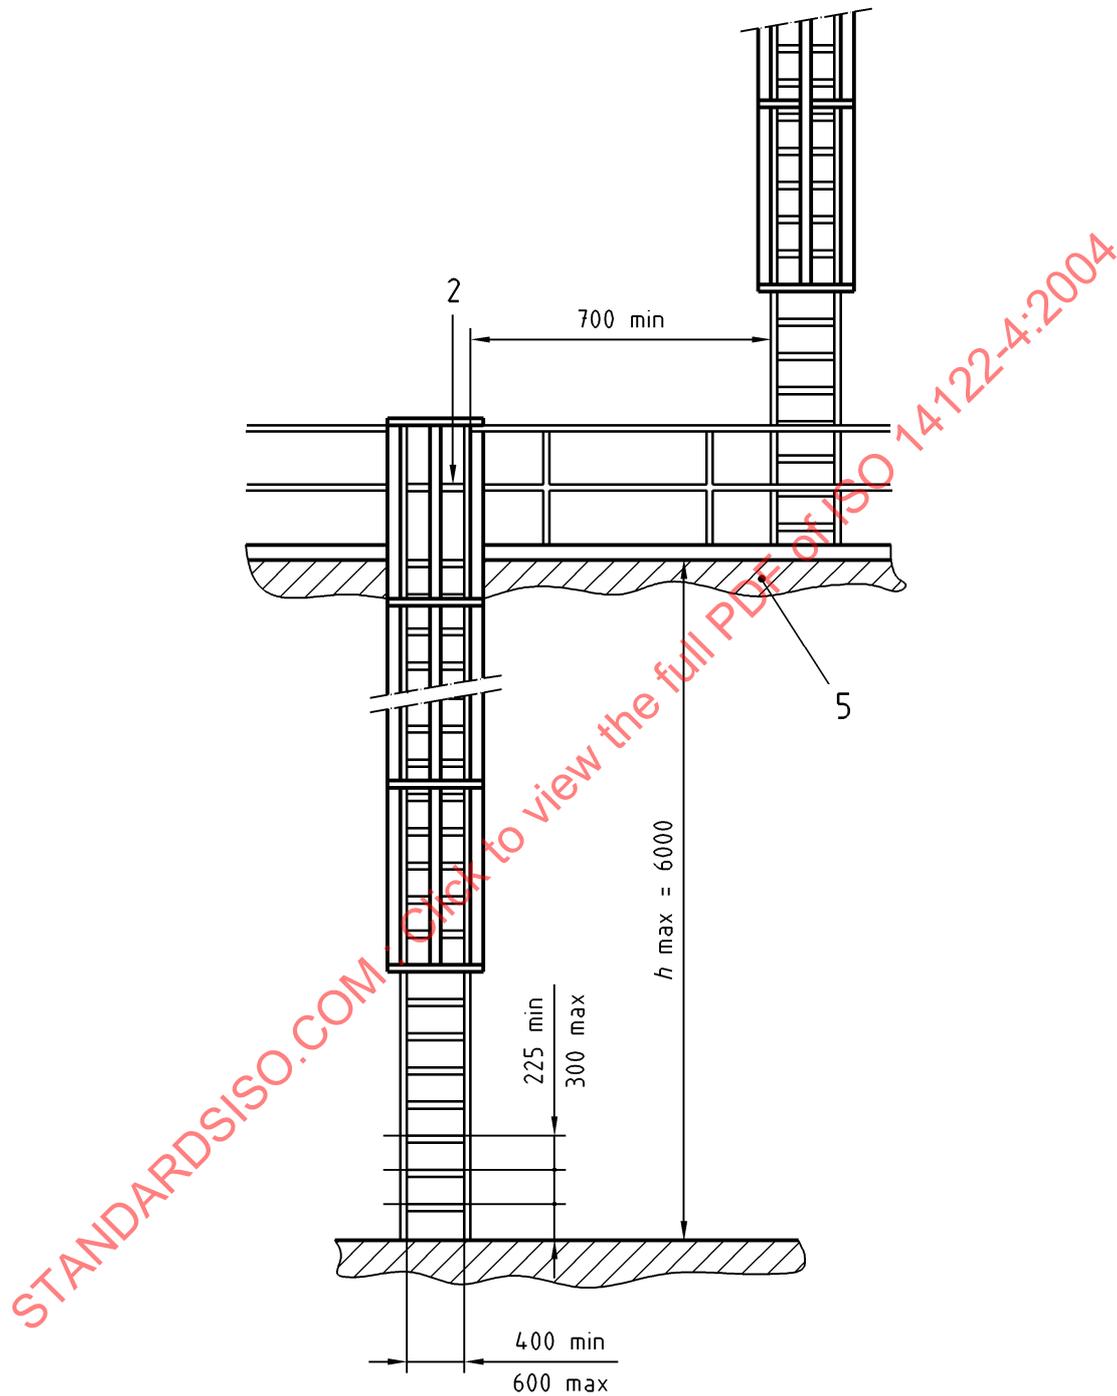


Figure 4b — Front elevation on ladder with safety cage

Dimensions in millimetres

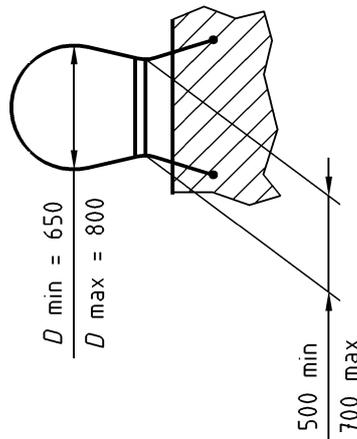


Figure 4.c – Plan view of a ladder with a safety cage

Dimensions in millimetres

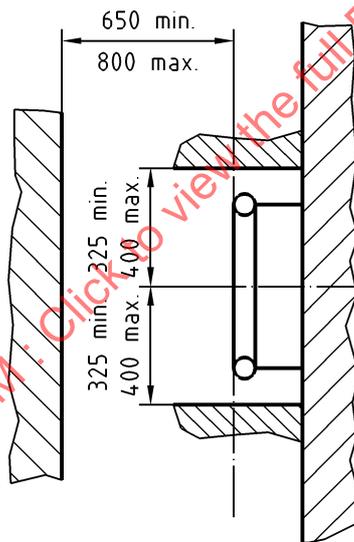



Figure 4.d – Plan view of a ladder without safety cage

Key

- 1 Connection element
- 2 Gate
- 3 Discontinuous obstacle
- 4 To suit maximum open area $\leq 0,4 \text{ m}^2$
- 5 Intermediate platform

Figure 4 — Principal dimensions of ladders and safety cages

Dimensions in millimetres

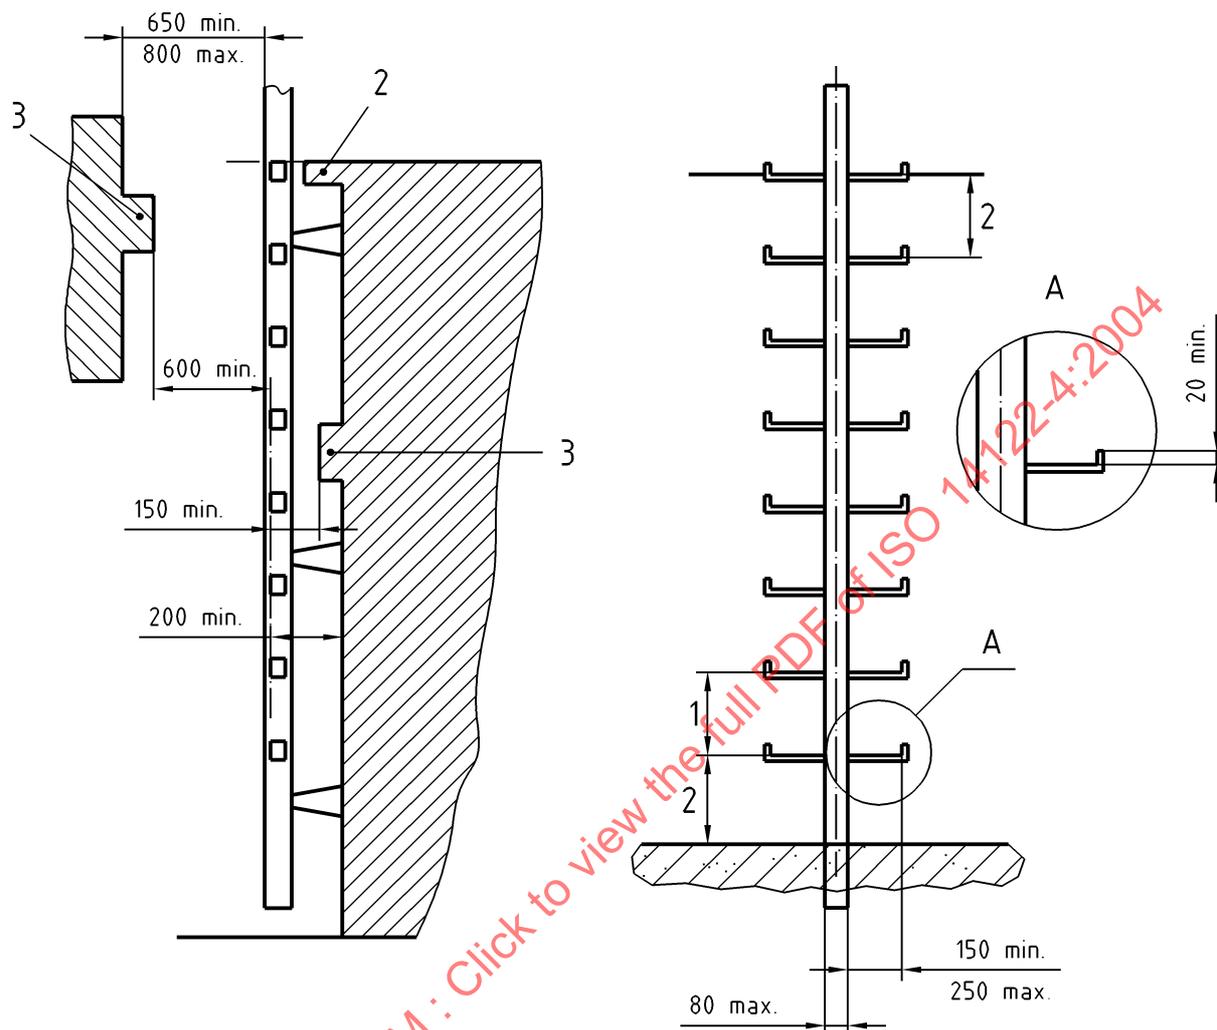**Key**

- 1 See 4.4.1.1
- 2 See 4.4.1.2 and Figure 6.a
- 3 Discontinuous obstacle

Figure 5 — Principal dimensions of a fixed ladder with one stile

4.3 Conditions for installation of a fall protection device

4.3.1 Conditions requiring the installation of a fall protection device

The ladder shall be fitted with a fall protection device when:

- a) height of the ladder flight is more than 3000 mm;
- b) height of the ladder is 3000 mm or less, but at the departure area there is the risk of falling an additional distance. In this case, the total distance of fall from the upper level of the ladder could be more than 3000 mm.

NOTE Risk of falling is considered to exist when the distance from the centre of the ladder to the unprotected side of a platform (or similar structure) is less than 3000 mm.

4.3.2 Choice of the type of fall protection device

Two main alternatives for protection of the users of fixed ladders against falls from a height are safety cages or fall arresters:

- The cage shall be the required choice, as it is a means which is always present and the actual safety function is independent of the operator's actions,
- Where it is not possible to use a cage, individual protective equipment shall be provided. The fall arrester is only effective if the user chooses to use it. If a harness with an incompatible sliding system is used with a guided type fall arrester, there will be a risk (requirements for information for use see Clause 6).

A fall arrester shall be designed only for low frequency and specialised access (e. g. maintenance).

NOTE An appropriate individual fall protection device is able to arrest a fall better than a cage.

4.4 Ladder

The principal dimensions of the ladder shall be determined in accordance with 4.4.1 to 4.4.4 (See also Figures 4 and 5).

4.4.1 Position of the rungs

4.4.1.1 Spacing between the rungs

The spacing between successive rungs shall be constant and shall be between 225 mm and 300 mm.

4.4.1.2 Spacing between rungs and the departure and arrival area

The distance between the walking surface of the departure area and the first rung shall not exceed the spacing between two consecutive rungs.

NOTE In case of mobile machinery to be used on uneven ground, the distance between the walking surface of the departure area and the first rung may be 400 mm max..

The top rung shall be positioned at the same level as the walking surface of the arrival area (see Figure 6a). If the gap between the walking surface and the ladder is greater than 75 mm, a floor extension shall be provided at the arrival area to reduce this gap.

4.4.1.3 Position of rungs of fixed ladders with one stile

The rungs at one side of the stile shall be on the same level as the respective rung at the opposite side of the stile (see Figure 5).

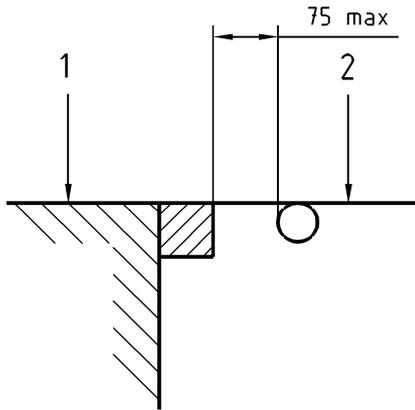


Figure 6.a — Position of top rung

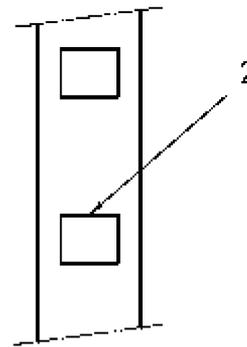


Figure 6.b — Design of polygonal rungs – Recommended mounting

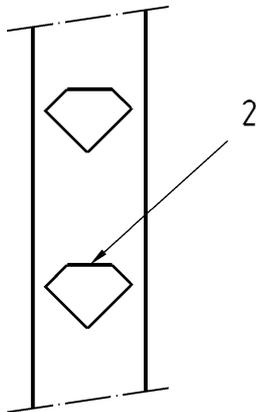


Figure 6.c — Design of polygonal rungs — Mounting for special use only

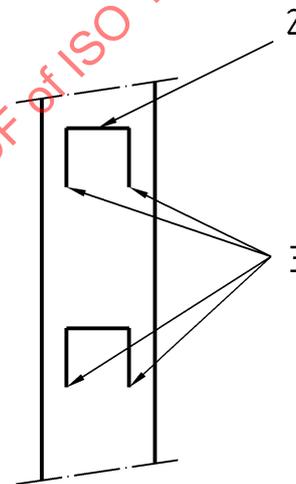


Figure 6.d — Design of U-shaped profile rungs

Key

- 1 Walking surface of the arrival area
- 2 Rung/tread surface
- 3 No sharp edges

Figure 6 — Position of rungs

4.4.2 Rungs

4.4.2.1 Position of polygonal and U-shaped rungs

Polygonal and U-shaped rungs shall be positioned so that the tread walking surface is horizontal (see Figure 6.b, 6.c and 6.d).

4.4.2.2 Length of the rungs

a) Length of rungs of fixed ladders with two stiles

The clear width between the two stiles shall be between 400 mm and 600 mm (see Figure 4). However, a shorter length between 300 mm and 400 mm is permissible, in cases where the immediate environment makes it


ISO 14122-4:2004(E)

impossible to use 400 mm. Before a shorter length is considered a check should be carried out to see if it is possible to find a more favourable position for the ladder allowing a clear width of 400 mm or more.

b) Length of rungs of fixed ladders with two stiles and a fall arrester.

The clear width between the stiles and the rigid anchorage line for a guided type fall arrester shall be at least 150 mm and the thickness of the anchorage line shall not be more than 80 mm (see Figure 7).

Dimension in millimetres

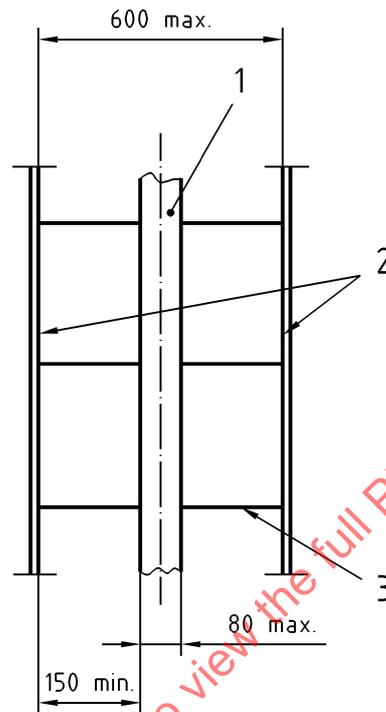

Key

- 1 Rigid anchorage line
- 2 Stile
- 3 Rung

Figure 7 — Length of the rungs of a fixed ladder with two stiles and a rigid anchorage line for a guided type fall arrester

c) Rungs of fixed ladders with one stile

The clear width between the stile and the protective device against slipping-off shall be between 150 mm and 250 mm and the thickness of the stile shall not be more than 80 mm (see Figure 5).

4.4.2.3 Cross-section of the rungs

The diameter of the rungs shall be at least 20 mm, or the walking surface of the tread of polygonal or U-shaped rungs shall have a depth of at least 20 mm.

The cross-section of the rungs shall not be given dimensions difficult to grasp by hand. The diameter of the rung shall not be more than 35 mm.

4.4.2.4 Surface of the rungs

The surface of the rungs shall not cause injuries, notably to hands, e. g. no sharp edges (see Figure 6.d).

The surface of the rung shall have a slip resistant walking surface. Special measures to prevent slipping may be necessary when the risk of slipping is increased due to environmental conditions (oil, ice, etc.).

4.4.3 Devices against slipping-off

The ends of the rungs of fixed ladders with one stile shall be fitted with protective devices against slipping-off laterally from the rungs. These protective devices against slipping-off shall have a height of at least 20 mm (see detail A of Figure 5).

4.4.4 Spacing between the ladder and any permanent obstruction

The space between the ladder and any permanent obstruction or obstacles shall be:

- in front of the ladder:
 - at least 650 mm and 600 mm in case of a discontinuous obstacle;
- behind the front side of the rungs:
 - at least 200 mm and 150 mm in case of a discontinuous obstacle.

See Figures 4 and 5.

4.5 Safety cage

The lowest part of safety cage, e. g. the lowest hoop shall start at a height of between 2200 mm and 3000 mm above the departure area. Below the cage on the chosen access side, the safety cage shall not have elements likely to obstruct the access to the area situated in front of the ladder. At the arrival area the safety cage shall be extended up to the height of the guard-rail of the arrival area (see Figure 4).

The clear distances within the hoop of the safety cage shall be between 650 mm and 800 mm (see Figure 4.c). This applies equally to non-circular as well as circular safety cages. The distance from the rung to the safety cage shall be between 650 mm and 800 mm (see Figure 4.d). With regard to the ladder axis, the distance from the surrounding structure in the absence of a safety cage shall be between 325 mm and 400 mm (see Figure 4.d).

The clearance within the cage at the arrival area, measured along the transverse axis of the ladder rungs between the inside face of the cage shall be between 500 mm and 700 mm (see Figure 4.c).

The distance between two hoops shall not exceed 1500 mm and the distance between two uprights on the cage shall not exceed 300 mm. The hoops shall be placed at right angles to the uprights on the cage. The safety cage uprights shall be fixed to the inside of the hoop and be equally spaced.

The spacing of safety cage components shall be designed so that the empty spaces are in any case not more than 0,40 m².

A cage is not necessary if surrounding structures (walls, parts of machines, etc.) in front of and on the sides of the ladder provide a similar safety function (e. g. by providing similar dimensions).

4.6 Guided type fall arrester on a rigid anchorage line

Fall arresters shall meet the relevant requirements of EN 353-1.

4.7 Departure and arrival areas - Platforms

Departure and arrival areas as well as intermediate platforms shall meet the relevant requirements of EN ISO 14122-2.

When required, guard-rails as protective devices against the risk of falling from a height at departure and arrival areas as well as at intermediate platforms shall meet the relevant requirements for guard-rails according to EN ISO 14122-3.

4.7.1 Departure areas

If the walking surface of the departure area has been raised by more than 500 mm above the surroundings or the departure area borders on areas which are not able to take a load, e. g. area made of glass or synthetic material, the departure area shall have guard-rails or equivalent means that are able to protect persons against falling from a height.

4.7.1.1 Access platforms

If the departure area on the structure of a machine, a building, etc. cannot be considered as an area which meets the relevant requirements of EN ISO 14122, an access platform shall be provided.

4.7.1.2 Fixed ladders with a safety cage

If the horizontal distance from a fixed ladder, equipped with a safety cage, to the guard-rail of the raised departure area is not more than 1500 mm, the guard-rail shall be fitted with an extension or the structure of the cage shall be extended down to the guard-rail (see Figure 8).


The top of the extension shall at least meet the following requirements:

- no dimension between the cage and the extension shall exceed 400 mm, or
- it shall have an angle, formed by the vertical and a straight line linking the upper section of the extension to the nearest part of the safety cage of 45 degrees or more.

The components shall be positioned so that:

- horizontal width of any space is not more than 300 mm and,
- area of a free space is $\leq 0,4 \text{ m}^2$.

Dimension in millimetres

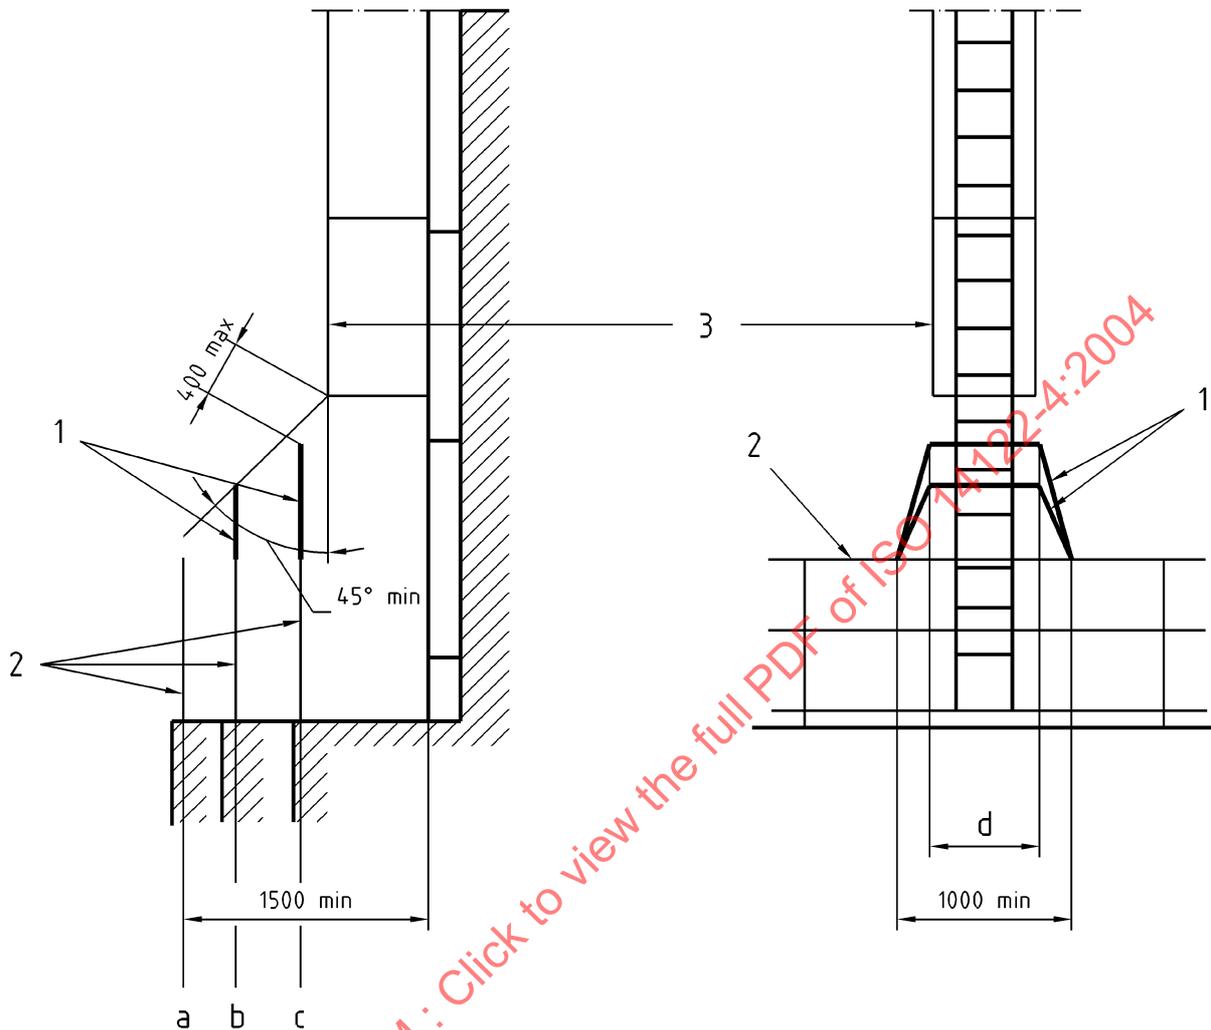**Key**

- 1 Extension
- 2 Guard-rail
- 3 Safety cage

- a guard-rail without an extension
- b height of the extension determined by an angle 45° minimum
- c height of the extension determined by a distance 400 mm maximum
- d diameter of the safety cage

Figure 8 — Extension completing the protective function of guard-rails at the departure area

4.7.2 Arrival areas

4.7.2.1 Access platform

If the arrival area on the structure of a machine, a building, etc. cannot be considered as an area which meets the relevant requirements of EN ISO 14122, an access platform shall be provided.

4.7.2.2 Falling from a height

Suitable means to prevent persons falling from a height, e. g. guard-rails, shall be provided at drop edges of arrival areas, over a length of at least 1500 mm on both sides of the vertical axis of the ladder or over the entire length of the edge, if this is less than 3000 mm. This is independent of any fall protection device fitted beyond this length.

4.7.3 Access openings

4.7.3.1 Front or side exit

Ladders may have a front or side exit to the arrival area.

The width of the access opening shall be between 500 mm and 700 mm.

4.7.3.2 Gates

To prevent falling through the access opening at arrival areas the opening shall be provided with a gate.

The gates shall meet the following requirements:

- a) opening direction of this gate shall not be towards the edge of the drop (outwards);
- b) gate shall be designed so, that it can be opened easily;
- c) gate shall close automatically, e. g. by means of springs or the effects of gravity;
- d) gate shall have at least a handrail and a kneerail according to relevant requirements of EN ISO 14122-3.

4.7.3.3 Access through platforms by means of trap doors

When it is necessary for technical reasons, a platform may have an opening to permit access to (and exit from) a ladder below the platform.

Protection against the risk of falling through such an opening shall be provided by a trap door or by guard-rails in combination with a gate. The guard-rail shall meet the requirements of EN ISO 14122-3 and the gate shall be according to 4.7.3.2 of this standard.

The trap door shall be designed so that:

- a) The opening shall be at least equal to the required size of the ladder cage (see 4.5).
- b) The trap door shall not open downwards. It shall move upwards or horizontally.
- c) Opening the trap door shall be manual and easy.
- d) The trap door shall allow the safe passage of the operator whilst in the open position.
- e) Closing of the trap door shall be done following safe passage without much strain of the operator for example, springs, hydraulic means.

4.7.4 Climbing off and getting on to a fixed ladder safely


4.7.4.1 Ladder with two stiles and without a fall arrester (3000 mm max)

Handrails shall be fitted connecting the ladder stiles to the handrail of the guard-rail. Those handrails shall be fixed to the guard-rail at the arrival area (see Figure 9).

See also 4.7.3.1 and Figure 4.c.

4.7.4.2 Ladder with one stile and without a fall arrester (3000 mm max)

Handrails shall be fitted on both sides of the ladder beginning at the level of the rung before the last rung, extending up the level of and connected to the handrail of the guard-rail at the arrival area (see Figure 9).

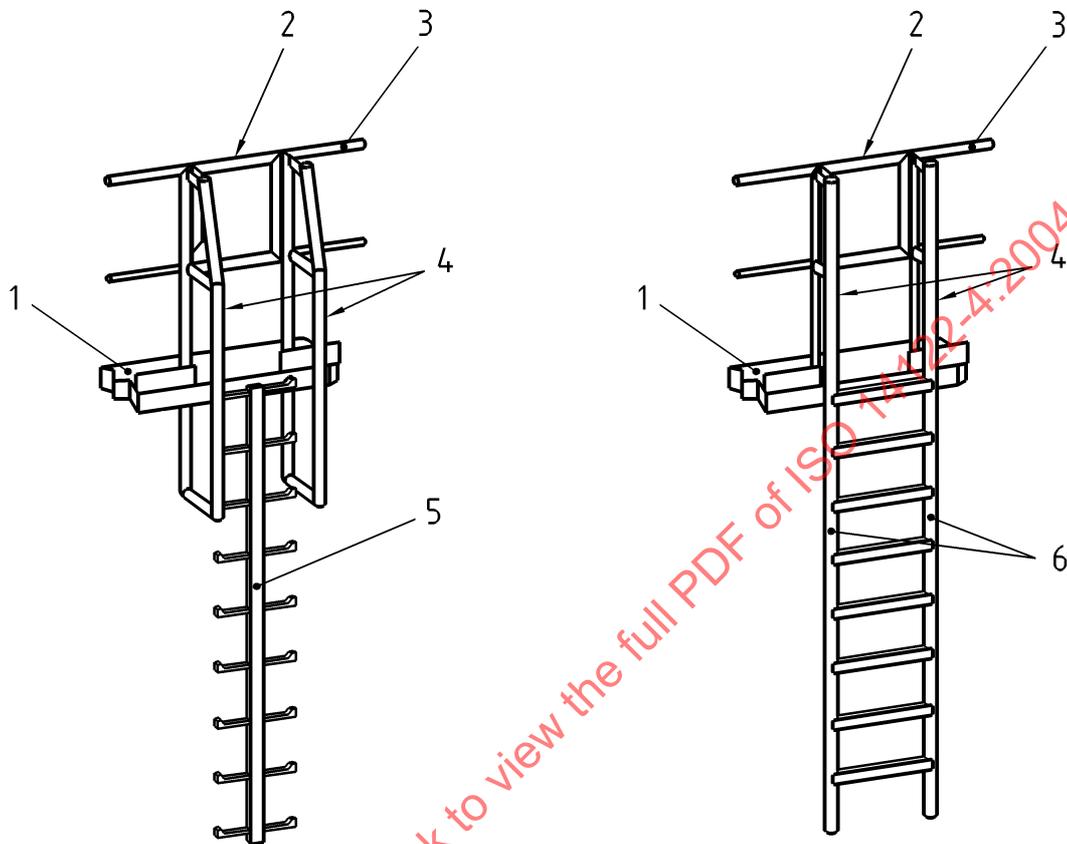

Key

- 1 Walking surface of the arrival area
- 2 Gate
- 3 Guard-rail
- 4 Handrail
- 5 Ladder with one stile and without a fall arrester
- 6 Ladder with two stiles and without a fall arrester

Figure 9 — Connected handrail at the arrival area

4.7.4.3 Arrangement for getting on and off ladders with a guided-type fall arrester

Suitable safeguards shall be provided, e. g. a locked device, to ensure that only authorised, trained and fully equipped operators (see also 4.3.2), can use the ladder.

NOTE A written warning or audible signal are not adequate safeguards.

In addition, the fall arrester and its surroundings shall be designed so that the operator has to connect or disconnect in a safe position, e. g. by providing a continuous line or an automatically closing extendable platform.

4.7.5 Platforms

4.7.5.1 Cases where the installation of platforms are required

Generally, if the climbing height H of fixed ladders is more than 6000 mm the ladders shall be equipped with one or more platform(s).

Where there are several flights, the height h of a ladder flight between the departure area and the nearest platform or between consecutive rest platforms shall be no more than 6000 mm.

But in the case of a single flight only (no rest platform), the height h between departure area and the arrival area (see Figures 1.a and 1.b) can be extended to no more than 10000 mm.

4.7.5.2 Intermediate platforms

The length of the intermediate platform shall be at least 700 mm installed between the two flights of the ladder (see Figure 4.b). In this case the requirement of 4.7.1 and 4.7.2 apply.

These platforms shall be equipped with a gate with dimensions to suit emergency situations.

4.7.5.3 Rest platforms

The width of a rest platform shall be at least 700 mm (see Figure 12).

4.7.5.4 Movable rest platforms

For ladders with one stile or guided type fall arresters the movable rest platforms shall be at least 400 mm wide and 300 mm long (see Figure 10) or consist of 2 parts at least 130 mm wide and 300 mm long (see Figure 11).

Dimensions in millimetres

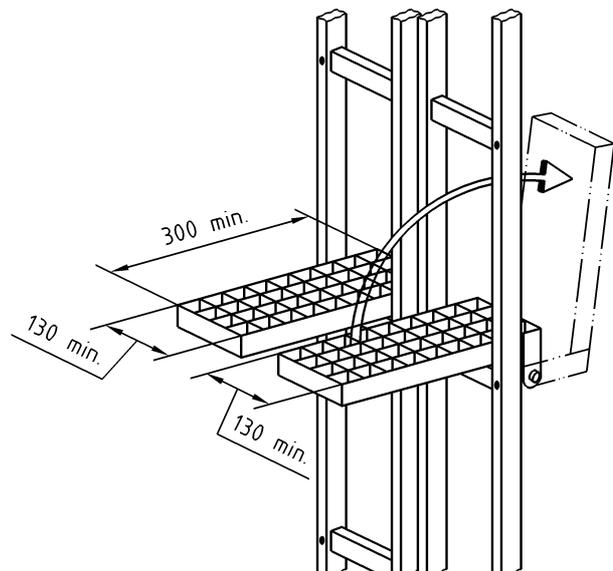
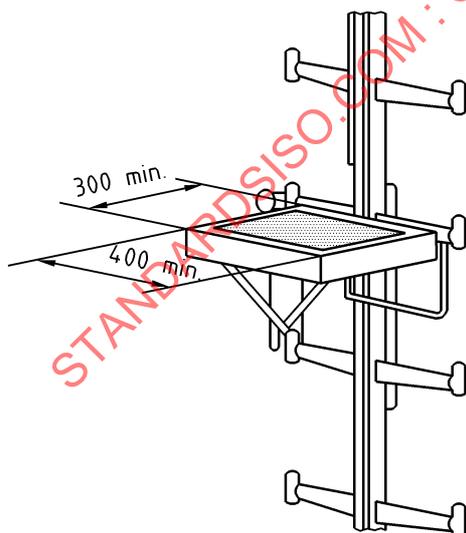


Figure 10 — Example of a movable rest platform (one part)

Figure 11 — Example of a movable rest platform (two parts)

4.7.5.5 Staggered ladder flights

If the layout of the machine or its environment make it unavoidable to do otherwise, two successive ladder flights may be adjacent, without a separate platform. In this case the lower flight of the ladder shall be extended to where the highest rung is at least 1 680 mm above the platform to provide good handholds for the user of the ladder. The height of the guarding above the platform shall be at least 1 600 mm (see Figure 12).

The clear height for the passage between the platform and the lowest complete hoop of the safety cage on the upper ladder shall be between 2 200 mm and 2 300 mm.

Dimensions in millimetres

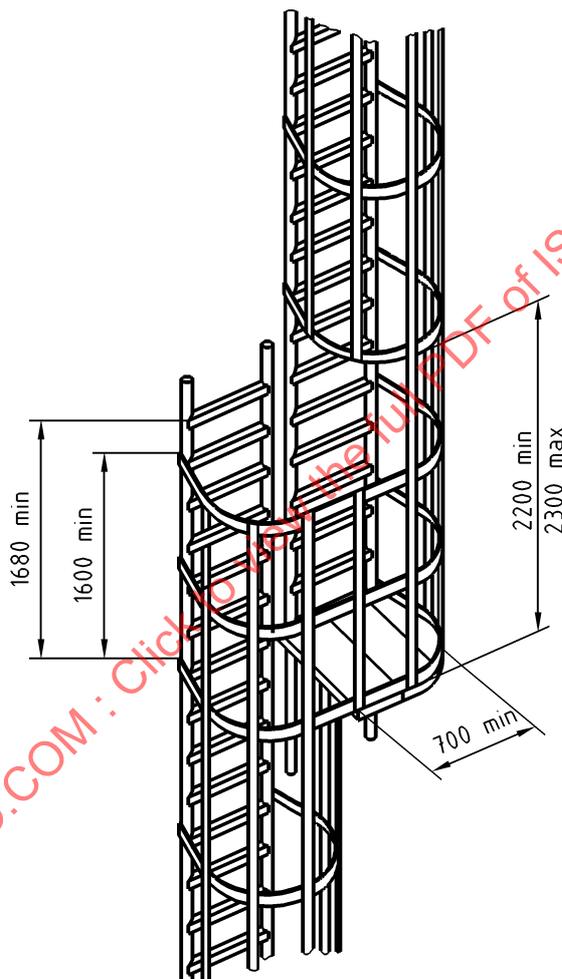


Figure 12 — Example of adjacent staggered ladder flights including a rest platform

5 Verification of safety requirements

5.1 General

The stipulated safety requirements and/or measures may be assessed by measurement, inspection, calculation and/or testing. When testing is used it shall be according to the testing procedure described in this Clause.

5.2 Tests of fixed ladders with two stiles

- The ladder element shall satisfy the following tests:
- strength test of the ladder (see 4.2 of EN 131-2:1993);
- bend test of ladder (see 4.3 of EN 131-2:1993);
- lateral bending test of ladder (see 4.4 of EN 131-2:1993);
- bend test of rungs (see 4.6 of EN 131-2:1993);
- torsion test of rungs (see 4.7 of EN 131-2:1993).

These tests are carried out on a ladder according to the requirements of 4.1 of EN 131-2:1993 in the order indicated above.

The distance L to be taken into account for the strength, bend and lateral bending tests, is the distance in mm between two consecutive anchor points of the ladder, see point 4 in Figure 16.

Acceptance criterion of the bending test (see 4.3 of EN 131-2:1993) is modified as follows: The maximum deflection admissible under load shall be no more than $5 \times L^2 \times 10^{-6}$ in mm without exceeding 50 mm.

5.3 Testing of the safety cage

5.3.1 The test is carried out under the same conditions as those likely to exist at the place where it would be used. The safety cage is fixed to the ladder. The two tests take place in accordance with Figures 13 and 14.

5.3.2 For the safety cage hoop, a preload (F_{PL}) of 200 N is applied vertically at the most unfavourable point (see Figure 13). The preload may be distributed over three horizontal safety cage hoops for one minute providing the connections between the uprights of the cage and the safety cage hoops are tension proof. The position of the lowest safety cage hoop after removing the preload is taken into account as a reference position for the test to be carried out for a test load (F_T) of 1000 N. The permissible permanent deformation which is measured at the point of application of the load is no more than 10 mm.