



**International
Standard**

ISO 14520-5

**Gaseous fire-extinguishing
systems — Physical properties and
system design —**

**Part 5:
FK-5-1-12 extinguishant**

*Systemes d'extinction d'incendie utilisant des agents gazeux —
Propriétés physiques et conception des systèmes —*

Partie 5: Agent extincteur FK-5-1-12

**Fourth edition
2024-01**

STANDARDSISO.COM : Click to view the full PDF of ISO 14520-5:2024

STANDARDSISO.COM : Click to view the full PDF of ISO 14520-5:2024



COPYRIGHT PROTECTED DOCUMENT

© ISO 2024

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	iv
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Characteristics and uses	1
4.1 General.....	1
4.2 Use of FK-5-1-12 systems.....	2
5 Safety of personnel	5
6 System design	6
6.1 Fill density.....	6
6.2 Superpressurization.....	7
6.3 Extinguishant quantity.....	7
6.4 Other fill density and superpressurization levels.....	10
7 Environmental properties	10
Bibliography	11

STANDARDSISO.COM : Click to view the full PDF of ISO 14520-5:2024

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO document should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

ISO draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). ISO takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, ISO had not received notice of (a) patent(s) which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at www.iso.org/patents. ISO shall not be held responsible for identifying any or all such patent rights.

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 21, *Equipment for fire protection and fire fighting*, Subcommittee SC 8, *Gaseous media and firefighting systems using gas*.

This fourth edition cancels and replaces the third edition (ISO 14520-5:2019), which has been technically revised.

The main changes are as follows:

- new specifications for dimers have been added to [Table 1](#).

A list of all parts in the ISO 14520 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Gaseous fire-extinguishing systems — Physical properties and system design —

Part 5: FK-5-1-12 extinguishant

1 Scope

This document contains specific requirements for gaseous fire-extinguishing systems, with respect to FK-5-1-12 extinguishant. It includes details of physical properties, specifications, usage and safety aspects.

This document is applicable only to systems operating at nominal pressures of 25 bar, 34,5 bar, 42 bar and 50 bar¹⁾ with nitrogen propellant. This does not preclude the use of other systems.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 14520-1, *Gaseous fire-extinguishing systems — Physical properties and system design — Part 1: General requirements*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 14520-1 apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

4 Characteristics and uses

4.1 General

Extinguishant FK-5-1-12 shall conform to the specifications shown in [Table 1](#).

FK-5-1-12 is a clear, colourless, almost odourless, electrically non-conductive gas with a density approximately 11 times that of air.

The physical properties are shown in [Table 2](#).

FK-5-1-12 extinguishes fires mainly by physical means, but also by some chemical means.

1) 1 bar = 0,1 MPa = 10⁵ Pa; 1 MPa = 1 N/mm².

Table 1 — Specifications for FK-5-1-12

Property	Requirement
Purity	99,0 % mol/mol min.
Acidity	3×10^{-6} by mass, max.
Water content	0,001 % by mass, max.
Non-volatile residue	0,03 % by mass, max.
Suspended matter or sediment	None visible
Kinetic dimers of HFP ^a	<2 850 mg/kg
Thermodynamic dimer of HFP + HF adduct ^b	<95 mg/kg

^a Kinetic dimers of HFP (CAS Registry Number® 2070-70-4). (Chemical Abstracts Service (CAS) Registry Number® is a trademark of the American Chemical Society (ACS). This information is given for the convenience of users of this document and does not constitute an endorsement by ISO of the product named. Equivalent products may be used if they can be shown to lead to the same results).

^b Thermodynamic dimer of HFP (CAS 1584-03-8) and its adduct (CAS 30320-28-6).

Table 2 — Physical properties of FK-5-1-12

Property	Units	Value
Molecular mass	n/a	316,04
Boiling point at 1 013 bar (absolute)	°C	49,2
Freezing point	°C	-108,0
Critical temperature	°C	168,66
Critical pressure	bar	18,646
Critical volume	cc/mole	494,5
Critical density	kg/m ³	639,1
Vapour pressure 20 °C	bar abs	0,326 0
Liquid density 20 °C	g/ml	1,616
Saturated vapour density 20 °C	kg/m ³	4,330 5
Specific volume of superheated vapour at 1 013 bar and 20 °C	m ³ /kg	0,071 9
Heat of vapourization at boiling point	KJ/kg	88,0
Chemical formula	CF ₃ CF ₂ C(O)CF(CF ₃) ₂	
Chemical name	Dodecafluoro-2-methylpentan-3-one	

NOTE 1 bar = 0,1 MPa = 10⁵ Pa; 1 MPa = 1 N/mm².

4.2 Use of FK-5-1-12 systems

FK-5-1-12 total flooding systems may be used for extinguishing fires of all classes within the limits specified in ISO 14520-1:2023, Clause 4.

The extinguishant requirements per volume of protected space are shown in [Table 3](#) for various levels of concentration. These are based on methods shown in ISO 14520-1:2023, 7.7.

The extinguishing concentrations and design concentrations for heptane and Surface Class A hazards are shown in [Table 4](#). Concentrations for other fuels are shown in [Table 5](#) and inerting concentrations in [Table 6](#).

Table 3 — FK-5-1-12 total flooding quantity

Temperature <i>T</i> °C	Specific volume <i>S</i> m ³ /kg	FK-5-1-12 mass requirements per unit volume of protected space, <i>m/V</i> (kg/m ³)							
		Design concentration (by volume)							
		3 %	4 %	5 %	6 %	7 %	8 %	9 %	10 %
-20	0,060 9	0,507 7	0,684 0	0,864 0	1,040 7	1,235 7	1,427 5	1,623 6	1,824 1
-15	0,062 3	0,496 5	0,669 0	0,845 0	1,024 8	1,208 4	1,396 1	1,587 9	1,783 9
-10	0,063 7	0,485 9	0,654 5	0,826 8	1,002 7	1,182 4	1,366 0	1,553 7	1,745 5
-5	0,065 0	0,475 6	0,640 7	0,809 4	0,981 6	1,157 5	1,337 2	1,520 9	1,708 7
0	0,066 4	0,465 8	0,627 5	0,792 6	0,961 3	1,133 6	1,309 6	1,489 5	1,673 4
5	0,067 8	0,456 4	0,614 8	0,776 6	0,941 8	1,110 6	1,283 1	1,459 3	1,639 5
10	0,069 1	0,447 3	0,602 6	0,761 2	0,923 2	1,088 6	1,257 6	1,430 4	1,607 0
15	0,070 5	0,438 6	0,590 9	0,746 4	0,905 2	1,067 4	1,233 2	1,402 6	1,575 7
20	0,071 9	0,430 2	0,579 6	0,732 2	0,887 9	1,047 1	1,209 6	1,375 8	1,545 7
25	0,073 3	0,422 2	0,568 8	0,718 4	0,871 3	1,027 5	1,187 0	1,350 0	1,516 7
30	0,074 6	0,414 4	0,558 3	0,705 2	0,855 3	1,008 6	1,165 2	1,325 2	1,488 8
35	0,076 0	0,406 9	0,548 2	0,692 5	0,839 9	0,990 4	1,144 2	1,301 3	1,462 0
40	0,077 4	0,399 7	0,538 5	0,680 2	0,825 0	0,972 8	1,123 9	1,278 3	1,436 1
45	0,078 7	0,392 8	0,529 1	0,668 4	0,810 6	0,955 9	1,104 3	1,256 0	1,411 1
50	0,080 1	0,386 0	0,520 1	0,657 0	0,796 7	0,939 5	1,085 4	1,234 5	1,386 9
55	0,081 5	0,379 5	0,511 3	0,645 9	0,783 3	0,923 7	1,067 1	1,213 7	1,363 6
60	0,082 9	0,373 3	0,502 9	0,635 2	0,770 4	0,908 4	1,049 5	1,193 6	1,341 0
65	0,084 2	0,367 2	0,494 7	0,624 7	0,757 8	0,893 6	1,032 4	1,174 2	1,319 1
70	0,085 6	0,361 3	0,486 8	0,614 8	0,745 7	0,879 3	1,015 8	1,155 4	1,298 0
75	0,087 0	0,355 6	0,479 1	0,605 2	0,733 9	0,865 4	0,999 8	1,137 2	1,277 5
80	0,088 3	0,350 1	0,471 6	0,595 8	0,722 5	0,852 0	0,984 3	1,119 5	1,257 7
85	0,089 7	0,344 7	0,464 4	0,586 6	0,711 5	0,839 0	0,969 2	1,102 4	1,238 5

NOTE This information refers only to FK-5-1-12 and does not represent any other product containing dodecafluoromethylpentan-3-one as a component.

Key

m/V is the agent mass requirements (kg/m³), i.e. mass, *m*, in kg of agent required per m³ of protected volume, *V*, to produce the indicated concentration at the temperature specified;

V is the net volume of hazard (m³), i.e. the enclosed volume minus the fixed structures impervious to extinguishant.

m is calculated using the following formula:

$$m = \left(\frac{c}{100 - c} \right) \frac{V}{S}$$

where

c is the concentration (%), i.e. the volumetric concentration of FK-5-1-12 in air at the temperature indicated and a pressure of 1,013 bar absolute;

S is the specific volume (m³/kg).

The specific volume, *S*, of superheated FK-5-1-12 vapour at a pressure of 1,013 bar can be approximated by the following formula:

$$S = k_1 + k_2 T$$

where

$$k_1 = 0,066 4;$$

$$k_2 = 0,000 274;$$

T is the temperature (°C), i.e. the design temperature in the hazard area.

Table 3 (continued)

Temperature <i>T</i> °C	Specific volume <i>S</i> m ³ /kg	FK-5-1-12 mass requirements per unit volume of protected space, <i>m/V</i> (kg/m ³)							
		Design concentration (by volume)							
		3 %	4 %	5 %	6 %	7 %	8 %	9 %	10 %
90	0,091 1	0,339 5	0,457 4	0,577 8	0,700 8	0,826 3	0,954 7	1,085 8	1,219 8
95	0,092 5	0,334 5	0,450 7	0,569 2	0,690 4	0,814 1	0,940 5	1,069 7	1,201 4
100	0,093 8	0,329 6	0,444 1	0,560 9	0,680 3	0,802 2	0,926 7	1,054 0	1,184 2

NOTE This information refers only to FK-5-1-12 and does not represent any other product containing dodecafluoromethylpentan-3-one as a component.

Key

m/V is the agent mass requirements (kg/m³), i.e. mass, *m*, in kg of agent required per m³ of protected volume, *V* to produce the indicated concentration at the temperature specified;

V is the net volume of hazard (m³), i.e. the enclosed volume minus the fixed structures impervious to extinguishant.

m is calculated using the following formula:

$$m = \left(\frac{c}{100 - c} \right) \frac{V}{S}$$

where

c is the concentration (%), i.e. the volumetric concentration of FK-5-1-12 in air at the temperature indicated and a pressure of 1,013 bar absolute;

S is the specific volume (m³/kg).

The specific volume, *S*, of superheated FK-5-1-12 vapour at a pressure of 1,013 bar can be approximated by the following formula:

$$S = k_1 + k_2 T$$

where

$$k_1 = 0,066 4;$$

$$k_2 = 0,000 274;$$

T is the temperature (°C), i.e. the design temperature in the hazard area.

Table 4 — FK-5-1-12 reference extinguishing and design concentrations

Fuel	Extinguishment % by volume	Minimum design % by volume
Class B		
Heptane (cup burner)	4,5	5,9
Heptane (room test)	4,4	
Surface Class A		
Wood crib	3,4	5,3
PMMA	4,1	

NOTE 1 The extinguishment values for the Class B and the Surface Class A fuels are determined by testing in accordance with ISO 14520-1:2023, Annexes B and C.

NOTE 2 The minimum design concentration for the Class B fuel is the higher value of the heptane cup burner or room test heptane extinguishment concentration multiplied by 1,3.

NOTE 3 The minimum design concentration for Surface Class A fuel is the highest value of the wood crib, PMMA, PP or ABS extinguishment concentrations multiplied by 1,3. In the absence of any of the four extinguishment values, the minimum design concentration for Surface Class A is that of Higher Hazard Class A.

NOTE 4 The minimum design concentration for Higher Hazard Class A fuels is the higher of the Surface Class A or 95 % of the Class B minimum design concentration.

NOTE 5 See ISO 14520-1:2023, 7.6.1.3 for guidance on Class A fuels.

Table 4 (continued)

Fuel	Extinguishment % by volume	Minimum design % by volume
PP	4,0	
ABS	4,0	
Higher Hazard Class A	See NOTE 4	5,6

NOTE 1 The extinguishment values for the Class B and the Surface Class A fuels are determined by testing in accordance with ISO 14520-1:2023, Annexes B and C.

NOTE 2 The minimum design concentration for the Class B fuel is the higher value of the heptane cup burner or room test heptane extinguishment concentration multiplied by 1,3.

NOTE 3 The minimum design concentration for Surface Class A fuel is the highest value of the wood crib, PMMA, PP or ABS extinguishment concentrations multiplied by 1,3. In the absence of any of the four extinguishment values, the minimum design concentration for Surface Class A is that of Higher Hazard Class A.

NOTE 4 The minimum design concentration for Higher Hazard Class A fuels is the higher of the Surface Class A or 95 % of the Class B minimum design concentration.

NOTE 5 See ISO 14520-1:2023, 7.6.1.3 for guidance on Class A fuels.

Table 5 — FK-5-1-12 concentrations for other fuels

Fuel	Extinguishment % by volume	Minimum design % by volume
Acetone	4,5	5,9
Ethyl alcohol	5,5	7,2
Marine diesel	4,5	5,9
Methyl alcohol	6,5	8,5
Methyl ethyl ketone	4,5	5,9
<i>n</i> -heptane	4,5	5,9
Technical heptane	4,5	5,9

NOTE 1 Extinguishing concentrations for all Class B fuels listed were derived in accordance with ISO 14520-1:2023, Annex B.

NOTE 2 Minimum design values have been increased to the minimum design concentration established for heptane in accordance with ISO 14520-1:2023, 7.6.1.

Table 6 — FK-5-1-12 inerting and design concentrations

Fuel	Inertion %	Minimum design %
Methane	8,8	9,7
Propane	8,1	8,9

NOTE Determined in accordance with ISO 14520-1.

5 Safety of personnel

Any hazard to personnel created by the discharge of FK-5-1-12 shall be considered in the design of the system.

Potential hazards can arise from the following:

- the extinguishant itself;
- the combustion products of the fire;
- the breakdown products of the extinguishant resulting from exposure to fire.

For minimum safety requirements, see ISO 14520-1:2023, Clause 5.

Toxicological information for FK-5-1-12 is shown in [Table 7](#).

Table 7 — Toxicological information for FK-5-1-12

Property	Value %
4 h LC ₅₀	>10 %
No observed adverse effect level (NOAEL)	10 %
Lowest observed adverse effect level (LOAEL)	>10 %
NOTE LC ₅₀ is the concentration lethal to 50 % of the rat population during a 4 h exposure.	

6 System design

6.1 Fill density

The fill density of the container shall not exceed the values shown in [Tables 8](#) to [11](#) for 25 bar, 34,5 bar, 42 bar or 50 bar systems.

Exceeding the maximum fill density can result in the container becoming "liquid full", with the effect that an extremely high rise in pressure occurs with small increases in temperature, which could adversely affect the integrity of the container assembly.

The relationships between pressure and temperature are shown in [Figure 1](#) for various levels of fill density.

Table 8 — 25 bar storage container characteristics for FK-5-1-12

Property	Unit	Value
Maximum fill density	kg/m ³	1 480
Maximum container working pressure at 50 °C	bar	29
Superpressurization at 20 °C	bar	25
NOTE 1 Figure 1 shows further data on pressure/temperature relationships.		
NOTE 2 1 bar = 0,1 MPa = 10 ⁵ Pa; 1 MPa = 1 N/mm ² .		

Table 9 — 34,5 bar storage container characteristics for FK-5-1-12

Property	Unit	Value
Maximum fill density	kg/m ³	1 200
Maximum container pressure at 50 °C	bar	38
Superpressurization at 20 °C	bar	34,5
NOTE 1 Figure 2 shows further data on pressure/temperature relationships.		
NOTE 2 1 bar = 0,1 MPa = 10 ⁵ Pa; 1 MPa = 1 N/mm ² .		

Table 10 — 42 bar storage container characteristics for FK-5-1-12

Property	Unit	Value
Maximum fill density	kg/m ³	1 440
Maximum container pressure at 50 °C	bar	48
Superpressurization at 20 °C	bar	42
NOTE 1 Figure 3 shows further data on pressure/temperature relationships.		
NOTE 2 1 bar = 0,1 MPa = 10 ⁵ Pa; 1 MPa = 1 N/mm ² .		

Table 11 — 50 bar storage container characteristics for FK-5-1-12

Property	Unit	Value
Maximum fill density	kg/m ³	1 200
Maximum container pressure at 50 °C	bar	57
Superpressurization at 20 °C	bar	50
NOTE 1 Figure 4 shows further data on pressure/temperature relationships.		
NOTE 2 1 bar = 0,1 MPa = 10 ⁵ Pa; 1 MPa = 1 N/mm ² .		

6.2 Superpressurization


Containers shall be superpressurized with nitrogen with a moisture content of not more than 60×10^{-6} by mass to an equilibrium pressure of 25 bar $^{+5}_0$ %, 34,5 bar $^{+5}_0$ %, 42 bar $^{+5}_0$ % or 50 bar $^{+5}_0$ % at a temperature of 20 °C.

6.3 Extinguishant quantity

The quantity of extinguishant shall be the minimum required to achieve the design concentration within the hazard volume at the minimum expected temperature, determined using [Table 3](#) and the method in ISO 14520-1:2023, 7.7.

The design concentrations shall be that specified for relevant hazards shown in [Table 4](#). This includes at least a 1,3 safety factor on the extinguishing concentration.


Consideration should be given to increasing this for particular hazards and seeking advice from the relevant authority.

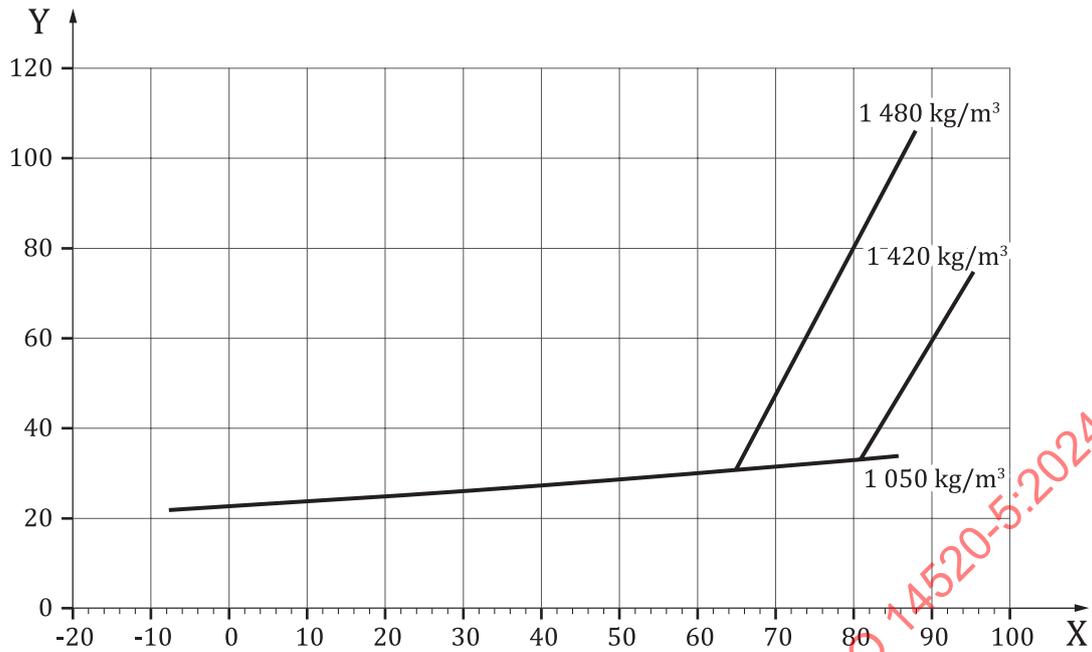

Key

- X temperature, °C
- Y pressure, bar (1 bar = 0,1 MPa = 10⁵ Pa; 1 MPa = 1 N/mm².)

Figure 1 — Temperature/pressure graph for FK-5-1-12 superpressurized with nitrogen 25 bar at 20 °C

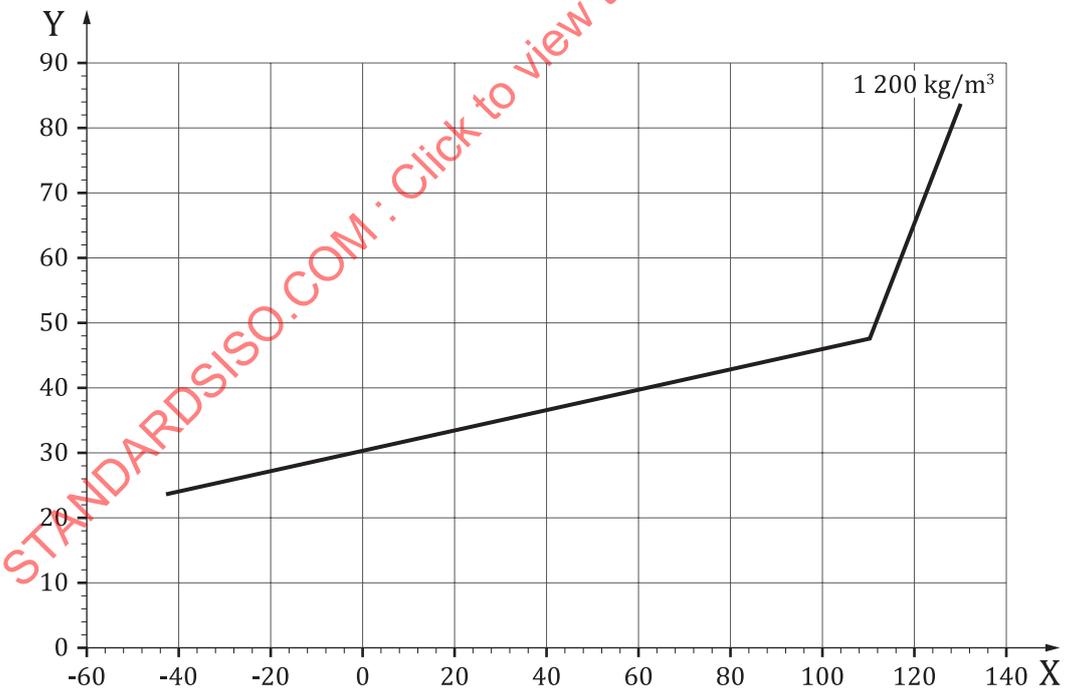

Key

- X temperature, °C
- Y pressure, bar (1 bar = 0,1 MPa = 10⁵ Pa; 1 MPa = 1 N/mm².)

Figure 2 — Temperature/pressure graph for FK-5-1-12 superpressurized with nitrogen to 34,5 bar at 20 °C