
**Multiple split-system air conditioners
and air-to-air heat pumps — Testing
and rating for performance**

*Climatiseurs et pompes à chaleur air/air multi-split — Essais et
détermination des caractéristiques de performance*

STANDARDSISO.COM : Click to view the full PDF of ISO 15042:2017



STANDARDSISO.COM : Click to view the full PDF of ISO 15042:2017



COPYRIGHT PROTECTED DOCUMENT

© ISO 2017, Published in Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Ch. de Blandonnet 8 • CP 401
CH-1214 Vernier, Geneva, Switzerland
Tel. +41 22 749 01 11
Fax +41 22 749 09 47
copyright@iso.org
www.iso.org

Contents

	Page
Foreword	vi
1 Scope	1
2 Normative references	2
3 Terms and definitions	2
4 Symbols	5
5 Airflow setting	8
5.1 General.....	8
5.2 Airflow setting for ducted indoor units.....	8
5.2.1 General.....	8
5.2.2 Airflow setting procedure for ducted indoor units.....	8
5.3 ESP for rating.....	8
5.4 Airflow setting for non-ducted indoor units measured by air enthalpy method.....	10
5.5 Outdoor airflow.....	10
5.6 Unit supplied without indoor fan.....	10
6 Cooling tests	10
6.1 Cooling capacity test.....	10
6.1.1 General conditions.....	10
6.1.2 Temperature conditions.....	11
6.1.3 Test conditions.....	12
6.2 Maximum cooling performance test.....	13
6.2.1 General conditions.....	13
6.2.2 Temperature conditions.....	13
6.2.3 Airflow conditions.....	13
6.2.4 Test conditions.....	13
6.2.5 Performance requirements.....	13
6.3 Minimum cooling test.....	15
6.3.1 General conditions.....	15
6.3.2 Temperature conditions.....	15
6.3.3 Airflow conditions.....	15
6.3.4 Test condition.....	15
6.3.5 Performance requirements.....	16
6.4 Freeze-up drip test (applies to non-ducted multi-splits).....	16
6.4.1 General conditions.....	16
6.4.2 Temperature conditions.....	16
6.4.3 Airflow conditions.....	16
6.4.4 Test conditions.....	17
6.4.5 Performance requirements.....	17
6.5 Condensate control test and enclosure sweat test.....	17
6.5.1 General conditions.....	17
6.5.2 Temperature conditions.....	17
6.5.3 Airflow conditions.....	17
6.5.4 Test conditions.....	18
6.5.5 Performance requirements.....	18
7 Heating tests	18
7.1 Heating capacity tests.....	18
7.1.1 General conditions.....	18
7.1.2 Temperature conditions.....	19
7.1.3 Airflow conditions.....	20
7.1.4 Defrost operation.....	20
7.1.5 Test procedure — General.....	21
7.1.6 Preconditioning period.....	21
7.1.7 Equilibrium period.....	21

7.1.8	Data collection period	21
7.1.9	Test procedure when a defrost cycle (whether automatically or manually initiated) ends the preconditioning period (7.1.6)	22
7.1.10	Test procedure when a defrost cycle does not end the preconditioning period (7.1.6)	22
7.1.11	Test procedure for transient tests	23
7.1.12	Heating capacity test results	24
7.2	Maximum heating performance test	24
7.2.1	General conditions	24
7.2.2	Temperature conditions	24
7.2.3	Airflow conditions	25
7.2.4	Test conditions	25
7.2.5	Performance requirements	25
7.3	Minimum heating performance test	25
7.3.1	General conditions	25
7.3.2	Temperature conditions	25
7.3.3	Airflow conditions	26
7.3.4	Test conditions	26
7.3.5	Performance requirements	26
7.4	Automatic defrost performance test	26
7.4.1	General conditions	26
7.4.2	Temperature conditions	27
7.4.3	Airflow conditions	27
7.4.4	Test conditions	27
7.4.5	Performance requirements	27
8	Heat recovery test	27
8.1	Heat recovery capacity ratings	27
8.1.1	General conditions	27
8.1.2	Temperature conditions	27
9	Test methods and uncertainties of measurement	28
9.1	Test methods	28
9.1.1	General	28
9.1.2	Calorimeter test method	28
9.1.3	Indoor air enthalpy method	28
9.1.4	Capacity tests	29
9.2	Uncertainty of measurement	29
9.3	Test tolerances for the capacity tests	30
9.4	Test tolerances for performance tests	31
10	Test results	31
10.1	Capacity results	31
10.1.1	General	31
10.1.2	Adjustments	32
10.1.3	Cooling capacity calculations	32
10.1.4	Heating capacity calculations	32
10.1.5	Power input of fans	33
10.2	Data to be recorded	33
10.3	Test report	36
10.3.1	General information	36
10.3.2	Rating test results	36
10.3.3	Performance tests	36
11	Marking provisions	37
11.1	Nameplate requirements	37
11.2	Nameplate information	37
11.3	Split systems	37
12	Publication of ratings	38
12.1	Standard ratings	38

12.2 Other ratings.....	38
Annex A (normative) Airflow settings for ducted units.....	39
Annex B (normative) Test requirements.....	44
Annex C (informative) Airflow measurement.....	51
Annex D (normative) Calorimeter test method.....	57
Annex E (normative) Indoor air enthalpy test method.....	65
Annex F (informative) Part-load capacity tests and determination of energy efficiency ratios and coefficients of performance.....	72
Annex G (informative) Individual indoor unit capacity tests.....	73
Annex H (normative) Heat recovery test method.....	75
Annex I (informative) Refrigerant enthalpy test method.....	76
Annex J (informative) Outdoor air enthalpy test method.....	78
Annex K (informative) Indoor calorimeter confirmative test method.....	81
Annex L (informative) Outdoor calorimeter confirmative test method.....	83
Annex M (informative) Balanced-type calorimeter confirmative test method.....	85
Annex N (informative) Cooling condensate measurements.....	86
Annex O (normative) Supplemental requirements when rating fan-less (coil only) type units.....	87
Annex P (informative) Pictorial examples of the heating capacity test procedures given in 7.1.....	90
Bibliography.....	97

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see the following URL: www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 86, *Refrigeration and air-conditioning*, Subcommittee SC 6, *Testing and rating of air-conditioners and heat pumps*.

This second edition cancels and replaces the first edition (ISO 15042:2011), which has been technically revised.

Multiple split-system air conditioners and air-to-air heat pumps — Testing and rating for performance

1 Scope

This document specifies the performance testing, the standard conditions and the test methods for determining the capacity and efficiency ratings of air-cooled air conditioners and air-to-air heat pumps.

This document is applicable to the following equipment:

- basic multi-split systems, modular multi-split systems and modular heat recovery multi-split systems. These multi-split systems include air-to-air systems with non-ducted and/or ducted indoor units with integral fans and indoor units supplied without fans.

This document is limited to:

- residential, commercial and industrial split-system air conditioners and heat pumps;
- factory-made, electrically driven and use mechanical compression;
- single- and multiple-circuit split-systems which utilize one or more compressors with no more than two steps of control of the outdoor unit;

or

- split-systems with a single refrigeration circuit which utilize one or more variable-speed compressors or alternative compressor combinations for varying the capacity of the system by three or more steps.

These split-systems are designed to operate with a combination of one or more outdoor units and two or more indoor units designed for individual operation, and such modular systems are capable of transferring recovered heat from one or more indoor units to other units in the same system.

The requirements of testing and rating contained in this document are based on the use of matched assemblies.

This document is not applicable to the rating and testing of the following:

- a) water-cooled or water source equipment;
- b) mobile (single-duct) units having a condenser exhaust duct;
- c) individual assemblies not constituting a complete refrigeration system;
- d) equipment using the absorption refrigeration cycle.
- e) ducted air conditioners and/or ducted heat pumps, rated at less than 8 kW and intended to operate at external static pressures of less than 25 Pa, controlled by a single thermostat/controller (refer to ISO 5151);
- f) multiple split-system utilizing one or more refrigeration systems, one outdoor unit and one or more indoor units, controlled by a single thermostat/controller (refer to ISO 5151 or ISO 13253).

This document does not cover the determination of seasonal efficiencies or seasonal part-load performances, which can be required in some countries because they provide a better indication of efficiency under actual operating conditions.

NOTE Throughout this document, the terms “equipment” and “systems” mean “multi-split air conditioners” and/or “multi-split heat pumps”.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 817, *Refrigerants — Designation and safety classification*

ISO 5151, *Non-ducted air conditioners and heat pumps — Testing and rating for performance*

ISO/IEC Guide 98-3, *Uncertainty of measurement — Part 3: Guide to the expression of uncertainty in measurement (GUM:1995)*

3 Terms and definitions

For the purposes of this document, the following definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1 standard air

dry air at 20 °C and at a standard barometric pressure of 101,325 kPa, having a mass density of 1 204 kg/m³

3.2 full capacity

capacity of the system when all indoor units and outdoor units are operated in the same mode

3.3 latent cooling capacity room dehumidifying capacity

amount of latent heat that the equipment can remove from the conditioned space in a defined interval of time

Note 1 to entry: Latent cooling capacity and room dehumidifying capacity are expressed in units of watts.

3.4 part-load capacity

capacity of the system when the capacity ratio is less than 1

3.5 capacity ratio

ratio of the total stated cooling capacity of all operating indoor units to the stated cooling capacity of the outdoor unit at the rating conditions

3.6**heating capacity**

amount of heat that the equipment can add to the conditioned space (but not including supplementary heat) in a defined interval of time

Note 1 to entry: Heating capacity is expressed in units of watts.

3.7**sensible cooling capacity**

amount of sensible heat that the equipment can remove from the conditioned space in a defined interval of time

Note 1 to entry: Sensible cooling capacity is expressed in units of watts.

3.8**total cooling capacity**

amount of sensible and latent heat that the equipment can remove from the conditioned space in a defined interval of time

Note 1 to entry: Total cooling capacity is expressed in units of watts.

3.9**energy efficiency ratio****EER**

ratio of the total cooling capacity to the effective power input to the device at any given set of rating conditions

Note 1 to entry: Where the EER is stated without an indication of units, it is understood that it is derived from watts/watts.

3.10**coefficient of performance****COP**

ratio of the heating capacity to the effective power input to the device at any given set of rating conditions

Note 1 to entry: Where the COP is stated without an indication of units, it is understood that it is derived from watts/watts.

3.11**heat recovery efficiency****HRE**

ratio of the total capacity of the system (heating and cooling capacity) to the effective power when operating in the heat recovery mode

Note 1 to entry: Where HRE is stated without an indication of units, it is understood that it is derived from watts/watts.

3.12**air conditioner**

encased assembly or assemblies designed primarily to provide free or ducted delivery of conditioned air to an enclosed space room or zone (conditioned space)

Note 1 to entry: It can be either single-package or split-system and comprises a primary source of refrigeration for cooling and dehumidification. It can also include means for heating other than a heat pump, as well as means for circulating, cleaning, humidifying, ventilating or exhausting air. Such equipment can be provided in more than one assembly, the separated assemblies (split-systems) of which are intended to be used together.

3.13

heat pump

encased assembly or assemblies designed primarily to provide free or ducted delivery of conditioned air to an enclosed space, room or zone (conditioned space) and includes a prime source of refrigeration for heating

Note 1 to entry: It can be constructed to remove heat from the conditioned space and discharge it to a heat sink if cooling and dehumidification are desired from the same equipment. It can also include means for circulating, cleaning, humidifying, ventilating or exhausting air. Such equipment can be provided in more than one assembly, the separated assemblies (split-systems) of which are intended to be used together.

3.14

basic multi-split system

split-system air conditioner or heat pump incorporating a single refrigerant circuit with one or more compressors, multiple evaporators (indoor units) designed for individual operation, and one outdoor unit

Note 1 to entry: The system has no more than two steps of control and is capable of operating either as an air conditioner or as a heat pump. Alternatively, a system having a variable speed compressor and a fixed combination of indoor units specified by the manufacturer can also be considered a basic multi-split system.

3.15

multiple-circuit multi-split system

split-system air conditioner or heat pump incorporating multiple refrigerant circuits, two or more compressors, multiple evaporators (indoor units) and an integrated heat exchanger in a single outdoor unit

Note 1 to entry: The system has no more than two steps of control and is capable of operating either as an air conditioner or as a heat pump.

3.16

modular multi-split system

split-system air conditioner or heat pump incorporating a single refrigerant circuit, at least one variable speed compressor or an alternative compressor combination for varying the capacity of the system by three or more steps, multiple indoor units, each of which can be individually controlled, and one or more outdoor units

Note 1 to entry: The system is capable of operating either as an air conditioner or as a heat pump

3.17

modular heat recovery multi-split system

split-system air conditioner or heat pump incorporating a single refrigerant circuit, at least one variable-speed compressor or an alternate compressor combination for varying the capacity of the system by three or more steps, multiple evaporators (indoor units, each capable of being individually controlled), and one or more condensers (outdoor units)

Note 1 to entry: This system is capable of operating as a heat pump where recovered heat from the indoor units operating in the cooling mode can be transferred to one or more other indoor units operating in the heating mode. Heat recovery can be achieved by a gas/liquid separator or a third line in the refrigeration circuit.

3.18

effective power input

P_E

average electrical power input to the equipment obtained from

- the power input for operation of the compressor(s),
- the power input to electric heating devices used only for defrosting,
- the power input to all control and safety devices of the equipment, and
- the power input for operation of all fans, whether provided with the equipment or not

Note 1 to entry: Effective power input is expressed in units of watts.

3.19

total power input

P_t

average electrical power input to the equipment as measured during the test

Note 1 to entry: Total power input is expressed in units of watts

3.20

full-load operation

operation with the equipment and controls configured for the maximum continuous duty refrigeration capacity specified by the manufacturer and allowed by the unit controls

Note 1 to entry: Unless otherwise regulated by the automatic controls of the equipment, all indoor units and compressors are functioning during full-load operations.

4 Symbols

Symbol	Description	Unit
A_l	coefficient, heat leakage	J/(s·K)
A_n	nozzle area	m ²
C_d	nozzle discharge coefficient	— ^a
c_{pa1}	specific heat of moist air entering indoor-side ^b	J/(kg ^b ·K)
c_{pa2}	specific heat of moist air leaving indoor-side ^b	J/(kg ^b ·K)
c_{pa3}	specific heat of moist air entering outdoor side ^b	J/(kg ^b ·K)
c_{pa4}	specific heat of moist air leaving outdoor side ^b	J/(kg ^b ·K)
c_{pw}	specific heat of water	J/(kg ^b ·K)
D_e	equivalent diameter	m
D_i	diameter of circular ducts, inlet	m
D_n	nozzle throat diameter	m
D_o	diameter of circular ducts, outlet	m
D_t	outside diameter of refrigerant tube	m
h_{a1}	specific enthalpy of air entering indoor-side	J/kg ^b
h_{a2}	specific enthalpy of air leaving indoor-side	J/kg ^b
h_{a3}	specific enthalpy of air entering outdoor side	J/kg ^b
h_{a4}	specific enthalpy of air leaving outdoor side	J/kg ^b
h_{f1}	specific enthalpy of refrigerant liquid entering expansion device	J/kg
h_{f2}	specific enthalpy of refrigerant liquid leaving condenser	J/kg
h_{g1}	specific enthalpy of refrigerant vapour entering compressor	J/kg
h_{g2}	specific enthalpy of refrigerant vapour leaving compressor	J/kg
h_{r1}	specific enthalpy of refrigerant entering indoor-side	J/kg
h_{r2}	specific enthalpy of refrigerant leaving indoor-side	J/kg
h_{w1}	specific enthalpy of water or steam supplied to indoor-side test chamber	J/kg
h_{w2}	specific enthalpy of condensed moisture leaving indoor-side test chamber	J/kg

^a Dimensionless value.

^b It means the mass of dry air; the mass, kg of denominator in this unit is based on dry air (or DA). For units practically used in the air conditioning field, “kg(DA)” is very often used as the denominator.

Example: J/kg(DA), m³/kg(DA), kg/kg(DA).

NOTE All parameters are in relation to the unit being tested unless specified otherwise.

Symbol	Description	Unit
h_{w3}	specific enthalpy of condensed moisture leaving outdoor-side test chamber	J/kg
h_{w4}	specific enthalpy of the water supplied to the outdoor-side test chamber	J/kg
h_{w5}	specific enthalpy of the condensed water (in the case of H1 test condition) and the frost, respectively (in the case of H2 or H3 test conditions) in the test unit	J/kg
K_1	latent heat of vaporization of water ($2\,460 \times 10^3$ J/kg at 15 °C)	J/kg
L	length of refrigerant line	m
L_d	length of duct	m
L_m	length to external static pressure measuring point	m
p_a	barometric pressure	kPa
p_c	test chamber equalization pressure	Pa
p_e	external static pressure (ESP)	Pa
p_{isc}	internal static pressure drop of the indoor coil cabinet assembly measured from cooling capacity test	Pa
p_m	external static pressure (p_e during the blowing test)	Pa
p_n	absolute pressure at nozzle throat	Pa
p_v	velocity pressure at nozzle throat or static pressure difference across nozzle	Pa
P_{fan}	estimated fan power to circulate indoor air	W
P_i	power input (indoor-side data)	W
P_K	power input to compressor	W
P_t	total power input to equipment	W
q_m	air mass flow rate	kg/s
q_r	refrigerant flow rate	kg/s
q_{ro}	refrigerant and oil mixture flow rate	kg/s
q_s	standard flow rate	m ³ /s
q_v	air volume flow rate	m ³ /s
q_{vi}	air volume flow rate, indoor-side	m ³ /s
q_{vo}	air volume flow rate, outdoor-side	m ³ /s
q_w	condenser water flow rate	kg/s
q_{wc}	rate at which water vapour is condensed by the equipment	kg/s
q_{wo}	water mass flow supplied to the outside test chamber for maintaining the test conditions	kg/s
Re	Reynolds number	— ^a
t_a	temperature, ambient of compressor calorimeter	°C
t_{a1}	temperature of air entering indoor-side, dry bulb	°C
t_{a2}	temperature of air leaving indoor-side, dry bulb	°C
t_{a3}	temperature of air entering outdoor side, dry bulb	°C
t_{a4}	temperature of air leaving outdoor-side, dry bulb	°C
t_c	temperature of surface of condenser of the compressor calorimeter	°C
t_e	temperature of surface of evaporator of the compressor calorimeter	°C
t_{w1}	temperature of water entering condenser of the compressor calorimeter	°C
t_{w2}	temperature of water leaving condenser of the compressor calorimeter	°C
v_a	velocity of air at nozzle	m/s

^a Dimensionless value.

^b It means the mass of dry air; the mass, kg of denominator in this unit is based on dry air (or DA). For units practically used in the air conditioning field, "kg(DA)" is very often used as the denominator.
Example: J/kg(DA), m³/kg(DA), kg/kg(DA).

NOTE All parameters are in relation to the unit being tested unless specified otherwise.

Symbol	Description	Unit
v_n	specific volume of dry air portion of mixture at nozzle ^b	m ³ /kg ^b
v'_n	specific volume of dry air portion of mixture at nozzle	m ³ /kg
W_1	mass of cylinder and bleeder assembly, empty	g
W_3	mass of cylinder and bleeder assembly, with sample	g
W_5	mass of cylinder and bleeder assembly, with oil from sample	g
W_{i1}	specific humidity of air entering indoor-side ^b	kg/kg ^b
W_{i2}	specific humidity of air leaving indoor-side ^b	kg/kg ^b
W_n	specific humidity at nozzle inlet ^b	kg/kg ^b
W_r	water vapour (rate) condensed	kg/s
X_o	concentration of oil to refrigerant-oil mixture	— ^a
X_r	mass ratio, refrigerant to refrigerant-oil mixture	— ^a
Y	expansion factor	— ^a
α	pressure ratio	— ^a
α_a	interconnecting tubing heat transfer coefficient	W/(m ² ·K)
λ	thermal conductivity	W/(m·K)
ν	kinematic viscosity of air	m ² /s
$\eta_{fan,i}$	estimated indoor fan static efficiency	— ^a
$\eta_{mot,i}$	estimated indoor motor efficiency	— ^a
ΣP_{ic}	other power input to the indoor-side test chamber (e.g. illumination, electrical and thermal power input to the compensating device, heat balance of the humidification device)	W
ΣP_{oc}	sum of all total power input to the outdoor-side test chamber, not including power to the equipment under test	W
ϕ_c	heat removed by cooling coil in the outdoor-side test chamber	W
ϕ_{ci}	heat removed by cooling coil in the indoor-side test chamber	W
ϕ_d	latent cooling capacity (dehumidifying)	W
ϕ_e	heat input to evaporator of compressor calorimeter	W
ϕ_{hi}	heating capacity, indoor-side test chamber	W
ϕ_{ho}	heating capacity, outdoor-side test chamber	W
ϕ_{li}	heat leakage into indoor-side test chamber through walls, floor and ceiling	W
ϕ_{lo}	heat leakage out of outdoor-side test chamber through walls, floor and ceiling	W
ϕ_{lp}	heat leakage into indoor-side test chamber through partition separating indoor-side from outdoor side	W
ϕ_L	line heat loss in interconnecting tubing	W
ϕ_{sci}	sensible cooling capacity, indoor-side	W
ϕ_{tc}	refrigerating capacity of a refrigerant compressor	W
ϕ_{tci}	total cooling capacity, indoor-side	W
ϕ_{tco}	total cooling capacity, outdoor-side	W
ϕ_{thi}	total heating capacity, indoor-side	W
ϕ_{tho}	total heating capacity, outdoor-side	W

^a Dimensionless value.

^b It means the mass of dry air; the mass, kg of denominator in this unit is based on dry air (or DA). For units practically used in the air conditioning field, “kg(DA)” is very often used as the denominator.

Example: J/kg(DA), m³/kg(DA), kg/kg(DA).

NOTE All parameters are in relation to the unit being tested unless specified otherwise.

5 Airflow setting

5.1 General

This document specifies airflow settings for ducted and non-ducted units and units supplied without a fan.

Ducted indoor units rated less than 8 kW and intended to operate at an external static pressure of less than 25 Pa shall be tested as non-ducted units.

5.2 Airflow setting for ducted indoor units

5.2.1 General

The airflow rate shall be specified by the manufacturer. This flow rate shall be for full-load cooling and be expressed in cubic metres per second (m^3/s) of standard air conditions, as defined in [3.1](#), and correspond to a non-operating compressor.

P_{fan} is the estimated fan power required to circulate indoor air, in watts.

5.2.2 Airflow setting procedure for ducted indoor units

The airflow rate setting shall be made when only the fan is operating, at an ambient temperature between 20 °C and 30 °C and a relative humidity between 30 % and 70 %. The airflow settings of the units shall be in accordance with [Annex A](#) for units supplied with a fan, and in accordance with [Annex O](#) for units supplied without a fan.

The rated airflow rate given by the manufacturer shall be set and the resulting external static pressure, p_e , (ESP) measured. The measured ESP shall be larger than the ESP for rating, defined in [Table 1](#). If the unit has an adjustable speed, it shall be adjusted to the lowest speed that provides at least the ESP for rating.

5.3 ESP for rating

5.3.1 If the rated ESP specified by the manufacturer is greater than or equal to the minimum value given in [Table 1](#), the specified rated ESP is used as the ESP for rating.

5.3.2 If the rated ESP specified by the manufacturer is less than the minimum value given in [Table 1](#), and larger than or equal to the 80 % of the maximum ESP, the specified rated ESP is used as the ESP for rating. The maximum ESP may either be specified by the manufacturer or identified from fan curves provided by the manufacturer.

5.3.3 If the rated ESP specified by the manufacturer is less than the minimum value given in [Table 1](#) and less than 80 % of the maximum ESP, the value of [Table 1](#) or 80 % of the maximum ESP, whichever is smaller, is used as the ESP for rating.

5.3.4 If the rated ESP is not specified by the manufacturer, the value of [Table 1](#) or 80 % of the maximum ESP, whichever is smaller, is used as the ESP for rating.

5.3.5 The process of selecting the ESP for rating is shown in [Figure 1](#).

If the determined ESP for rating is less than 25 Pa, the unit can be considered a non-ducted indoor unit.

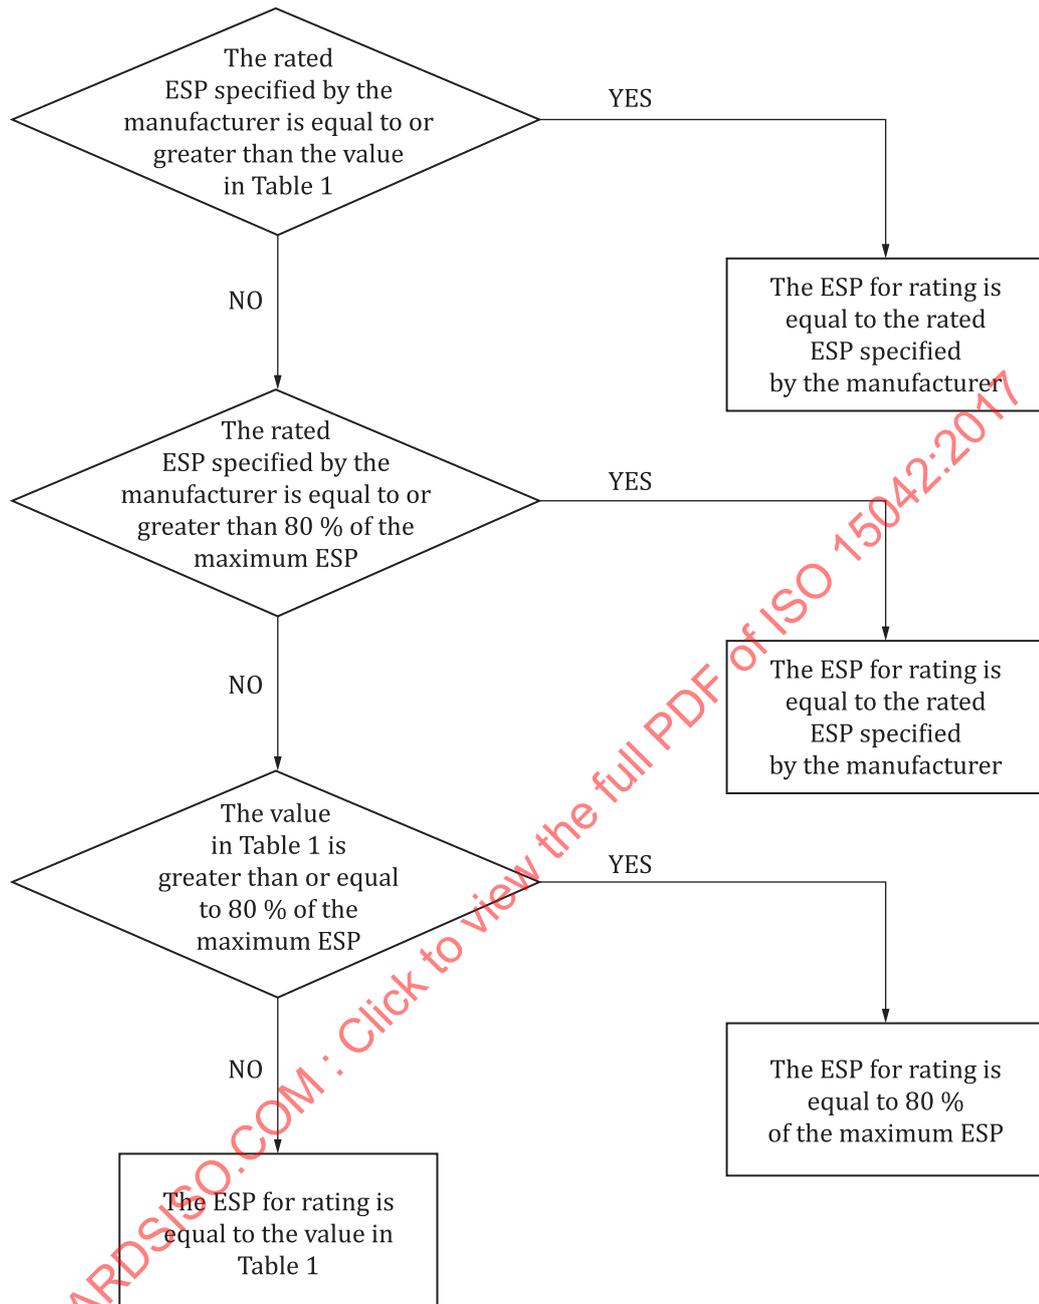


Figure 1 — Flowchart for selecting ESP for rating

Table 1 — Pressure requirement for comfort air conditioners

Standard capacity ratings kW	Minimum external static pressure ^a Pa
$0 < Q < 8$	25
$8 \leq Q < 12$	37
$12 \leq Q < 20$	50
$20 \leq Q < 30$	62

^a For equipment tested without an air filter installed, the minimum ESP, p_e , shall be increased by 10 Pa.

Table 1 (continued)

Standard capacity ratings kW	Minimum external static pressure ^a Pa
$30 \leq Q < 45$	75
$45 \leq Q < 82$	100
$82 \leq Q < 117$	125
$117 \leq Q < 147$	150
$Q > 147$	175

^a For equipment tested without an air filter installed, the minimum ESP, p_e , shall be increased by 10 Pa.

5.4 Airflow setting for non-ducted indoor units measured by air enthalpy method

5.4.1 Tests shall be conducted with 0 Pa static pressure maintained at the air discharge of the equipment. All air quantities shall be expressed as m³/s of standard air.

When the fan speed is adjustable, the difference of the mass airflow rate from the standard air due to low barometric pressure should be adjusted by the fan speed.

5.4.2 Airflow measurements shall be made in accordance with the provisions specified in [Annex C](#), as appropriate, as well as the provisions established in other appropriate annexes of this document.

NOTE Additional guidance for making airflow measurements can be found in ISO 3966 and ISO 5167-1.

5.5 Outdoor airflow

If the outdoor airflow is adjustable, all tests shall be conducted at the outdoor-side air quantity or fan control setting that is specified by the manufacturer. Where the fan is non-adjustable, all tests shall be conducted at the outdoor-side air volume flow rate inherent in the equipment when operated with the following in place: all of the resistance elements associated with inlets, louvers, and any ductwork and attachments considered by the manufacturer as normal installation practice. Once established, the outdoor-side air circuit of the equipment shall remain unchanged throughout all tests prescribed herein, except to adjust for any change caused by the attachment of the airflow measuring device when using the outdoor air enthalpy test method (see [J.2.1](#)).

5.6 Unit supplied without indoor fan

If no fan is supplied with the unit (i.e. coil-only units), supplemental requirements given in [Annex O](#) also apply.

6 Cooling tests

6.1 Cooling capacity test

6.1.1 General conditions

6.1.1.1 All equipment within the scope of this document shall have the cooling capacities and energy efficiency ratios determined in accordance with the provisions of this document and rated using the cooling conditions specified in [Table 2](#). All tests shall be carried out in accordance with the test requirements of [Annex B](#) and the test methods of [Annex D](#) and [Annex E](#) as specified in [Clause 9](#). All tests shall be conducted with the equipment functioning at full-load operation, as defined in [3.20](#). The electrical input values used for rating purposes shall be measured during the cooling capacity test.

6.1.1.2 The tests shall be conducted with all indoor units and compressors functioning during this test. Modular multi-split systems and modular heat recovery systems shall, for the purpose of this test, have the capacity ratio of indoor units to outdoor units equal to 1 ($\pm 5\%$).

6.1.1.3 Tests for modular and modular heat recovery systems may be conducted at part-load cooling capacities. If conducted, part-load cooling capacities shall be determined in accordance with the requirements of [Annex F](#).

6.1.1.4 Tests may be conducted to determine the cooling capacities of individual indoor units, either operating with all other indoor units functioning or without any other indoor units functioning. If tests of the cooling capacities of individual indoor units are conducted, the capacities shall be determined in accordance with the requirements of [Annex G](#).

6.1.1.5 The manufacturer shall specify, for variable-capacity compressors, the specific setting that is needed to give full-load capacity and the equipment shall be maintained at that setting. If the manufacturer does not define the setting, the thermostat or controller shall be set to its minimum allowable temperature setting.

6.1.1.6 If the equipment cannot be maintained at steady-state conditions by its normal controls, then the manufacturer shall modify or override such controls so that steady-state conditions are achieved.

6.1.2 Temperature conditions

6.1.2.1 The temperature conditions stated in [Table 2](#) (columns T1, T2 and T3) shall be considered standard rating conditions for the determination of cooling capacity.

6.1.2.2 Equipment manufactured for use in a moderate climate similar to that specified in [Table 2](#), column T1 only, shall have a rating determined by tests conducted at these specified T1 conditions and shall be designated type T1 equipment.

6.1.2.3 Equipment manufactured for use in a cool climate similar to that specified in [Table 2](#), column T2 only, shall have a rating determined by tests conducted at these specified T2 conditions and shall be designated type T2 equipment.

6.1.2.4 Equipment manufactured for use in a hot climate similar to that specified in [Table 2](#), column T3 only, shall have a rating determined by tests conducted at these specified T3 conditions and shall be designated type T3 equipment.

6.1.2.5 Equipment manufactured for use in more than one of the types of climate defined in [Table 2](#) (columns T1, T2 and T3) shall have its rating determined by tests for each of the specified [Table 1](#) conditions for which they have been designated and tested.

Table 2 — Cooling capacity rating conditions

Parameter	Standard rating conditions		
	T1	T2	T3
Temperature of air entering indoor-side:			
— dry-bulb	27 °C	21 °C	29 °C
— wet-bulb	19 °C	15 °C	19 °C
Temperature of air entering outdoor-side:			
— dry-bulb	35 °C	27 °C	46 °C
— wet-bulb ^a	24 °C	19 °C	24 °C
Test frequency ^b	Rated frequency		
Test voltage	See Table 3		
NOTE:			
T1 = Standard cooling capacity rating conditions for moderate climates.			
T2 = Standard cooling capacity rating conditions for cool climates.			
T3 = Standard cooling capacity rating conditions for hot climates.			
^a The wet-bulb temperature condition shall only be required when testing air-cooled condensers that evaporate the condensate.			
^b Equipment with dual-rated frequencies shall be tested at each frequency.			

Table 3 — Voltages for capacity and performance tests (except maximum cooling and maximum heating performance tests)

Rated (nameplate) voltages ^a	Test voltage ^b
V	V
90 to 109	100
110 to 127	115
180 to 207	200
208 to 253	230
254 to 341	265
342 to 420	400
421 to 506	460
507 to 633	575
^a For equipment with dual-rated voltages such as 115/230 and 220/440, the test voltages would be 115 V and 230 V in the first example, and 230 V and 460 V in the second example. For equipment with an extended voltage range, such as 110 V to 120 V or 220 V to 240 V, the test voltage would be 115 V or 230 V, respectively. Where the extended voltage range spans two or more of the rated voltage ranges, the mean of the rated voltages shall be used to determine the test voltage from the table. EXAMPLE For equipment with an extended voltage range of 200 V to 220 V, the test voltage would be 230 V, based on the mean voltage of 210 V.	
^b The voltages in this table are for capacity and performance tests other than the maximum cooling and maximum heating performance tests.	

6.1.3 Test conditions

6.1.3.1 Preconditions

The test room reconditioning apparatus and the equipment under test shall be operated until equilibrium conditions are attained. Equilibrium conditions as required by [9.3](#) shall be maintained for not less than 1 h before capacity test data are recorded.

6.1.3.2 Testing requirements

The test capacity shall include the determination of the sensible, latent and total cooling capacity as determined on the indoor-side.

6.1.3.3 Duration of test

The data shall be recorded at equal intervals that span 1 min or less. The recording of the data shall continue for at least a 30 min period during which the tolerances specified in 9.3 shall be met.

6.2 Maximum cooling performance test

6.2.1 General conditions

The conditions which shall be used during the maximum cooling test are given in Table 4. The test shall be conducted with the equipment functioning at full capacity, as defined in 3.2. The test voltages in Table 3 shall be maintained at the specified percentages under running conditions. In addition, the test voltage shall be adjusted so that it is not less than 86 % of the rated voltage at the moment of restarting the equipment after the shut-down required in 6.2.4.2. The determination of cooling capacity and electrical power input is not required for this performance test.

6.2.2 Temperature conditions

Tests shall be carried out according to the conditions in column T1, T2, or T3 of Table 4 based on intended use, as determined in 6.1.2. For equipment rated for use under more than one set of operating conditions, the highest relevant set of the intended operating conditions shall be applied for test purposes.

6.2.3 Airflow conditions

The maximum cooling test shall be conducted with an indoor-side fan speed setting as determined in 5.2.

6.2.4 Test conditions

6.2.4.1 Preconditions

The controls of the equipment shall be set for maximum cooling and, if provided, all ventilating air dampers and exhaust air dampers shall be closed.

6.2.4.2 Duration of test


The equipment shall be operated continuously for 1 h after the specified air temperatures have been established (see Tables 4 and 14). All power to the equipment shall then be cut off for 3 min and then restored. The equipment may be restarted either automatically or through the use of a remote controller or similar device. The test shall continue for 60 min after the equipment restarts.

6.2.5 Performance requirements

6.2.5.1 Air conditioners and heat pumps shall meet the following requirements when operating at the conditions specified in Table 4:

- a) during one entire test, the equipment shall operate without any indication of damage;
- b) the motors of the equipment shall operate continuously for the first hour of the test without the tripping of any protective device, and

c) after the interruption of power, the equipment shall resume operation within 30 min and run continuously for 1 h, except as specified in 6.2.5.2 and 6.2.5.3. See Figure 2.

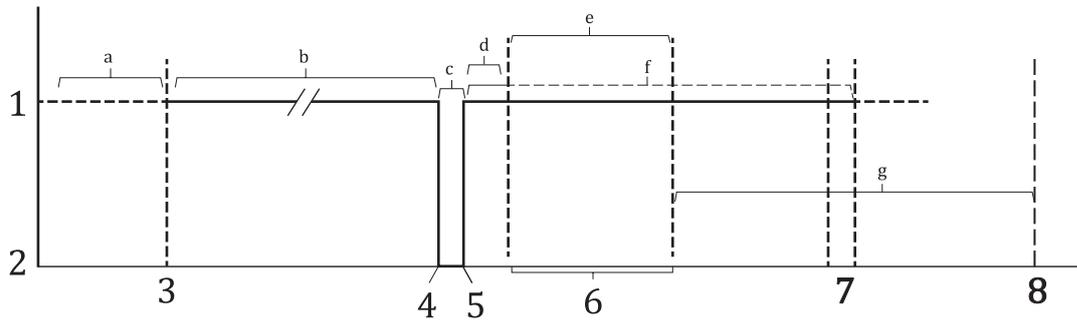

Key

- 1 power supply to equipment unit is on
- 2 power supply to equipment is off
- 3 official test period begins
- 4 power supply to equipment is turned off
- 5 power supply to equipment is turned back on
- 6 maximum time before equipment resumes continuous operation
- 7 end of test, if equipment restarted upon re-energization of power
- 8 end of test, if equipment utilized full 30 min for protective device to reset
- a 30 min, steady-state operation
- b 60 min, continuous operation running at reduced or increased supply voltage
- c 3 min, power off
- d 5 min, in which a protective device may trip
- e 30 min
- f, g 60 min of continuous operation after equipment restarts

Figure 2 — Maximum performance test operation

6.2.5.2 The protective devices may trip only during the first 5 min of operation after the shut-down period of 3 min. During the remainder of that 1 h test period, no motor overload protective device shall trip. The equipment shall be permitted to start and stop under the control of an automatic limit device, if provided.

6.2.5.3 For those models designed so that resumption of operation does not occur after an initial trip within the first 5 min, the equipment may remain out of operation for not longer than 30 min. It shall then operate continuously for 1 h.

Table 4 — Maximum cooling test conditions

Parameter	Standard rating conditions		
	T1	T2	T3
Temperature of air entering indoor-side:			
— dry-bulb	32 °C	27 °C	32 °C
— wet-bulb	23 °C	19 °C	23 °C
Temperature of air entering outdoor-side:			
— dry-bulb	43 °C	35 °C	52 °C
— wet-bulb ^a	26 °C	24 °C	31 °C
Test frequency ^b	Rated frequency		
Test voltage	a) 90 % and 110 % of rated voltage with a single nameplate voltage rating. b) 90 % of the lower rated voltage and 110 % of the higher rated voltage for units with a dual or extended nameplate voltage rating.		
^a The wet-bulb temperature condition shall only be required when testing air-cooled condensers that evaporate the condensate.			
^b Equipment with dual-rated frequencies shall be tested at each frequency.			

6.3 Minimum cooling test

6.3.1 General conditions

The test conditions specified in [Table 5](#) shall be used when conducting the minimum cooling and freeze-up air blockage test. All indoor units shall be functioning during this test. The test shall be conducted with the equipment functioning at full-load operation, as defined in [3.20](#), except as required in [6.3.3](#). The determination of cooling capacity and electrical power input is not required for this performance test.

6.3.2 Temperature conditions

Tests shall be conducted at the temperature conditions specified in [Table 5](#). If lower minimum operating temperature conditions are specified in the manufacturer's specification sheets, they shall be used in lieu of those given in [Table 5](#).

6.3.3 Airflow conditions

The controls, fan speeds, dampers and grilles of the equipment shall be set to produce the maximum tendency to frost or ice the evaporator, providing such settings are not contrary to the manufacturer's operating instructions. The test apparatus shall remain in the configuration established in [5.2](#) and in [Annex A](#).

6.3.4 Test condition

6.3.4.1 Preconditions

The equipment shall be started and operated until operating conditions have stabilized.

6.3.4.2 Duration of test

After the operating conditions have stabilized ([Table 5](#) and [Table 14](#)), the equipment shall be operated for a period of 4 h. The equipment shall be permitted to stop and start under the control of an automatic limit device, if provided.

6.3.5 Performance requirements

6.3.5.1 The equipment shall operate under the conditions specified without any indication of damage.

6.3.5.2 At the end of the 4 h test, any accumulation of frost or ice on the indoor coil shall not cover more than 50 % of the indoor-side face area of the indoor coil or reduce the airflow rate by more than 25 % of the initial airflow rate. If the equipment and test apparatus do not allow visual observation of the indoor coil or if the indoor air volume rate is not measured, then the requirements of [6.3.5.3](#) shall be met.

6.3.5.3 During the 4 h test period, the midpoint temperature of every indoor coil circuit or the refrigerant suction pressure shall be measured at equal intervals that span 1 min or less. The measurement(s) made 10 min after beginning the 4 h test shall be defined as the initial value(s). If the suction pressure is measured, it shall be used to calculate the saturated suction temperature.

- a) If the compressor(s) does(do) not cycle off on automatic controls during the test and
 - if coil circuit temperatures are measured, the temperatures shall not remain more than 2 K below the corresponding initial value for each circuit for more than 20 consecutive min, or
 - if suction pressure is measured, the saturated suction temperature shall not remain more than 2 K below the initial value for more than 20 consecutive min.
- b) If the compressor(s) cycle(s) on and off on the automatic controls during the test and
 - if coil circuit temperatures are measured, the individual circuit temperatures measured 10 min after the beginning of any on cycle during the test shall not be more than 2 K below the corresponding initial circuit temperature(s), or
 - if suction pressure is measured, the saturated suction temperature measured 10 min after the beginning of any “on” cycle during the test shall not be more than 2 K below the initial saturated suction temperature.
 - If the indoor fan is stopped by the automatic controls during the test, the airflow through the indoor coil shall be reduced to zero.

6.4 Freeze-up drip test (applies to non-ducted multi-splits)

6.4.1 General conditions

The freeze-up drip test shall be run immediately after completion of the minimum cooling and freeze-up air blockage test and at the conditions specified in [Table 5](#). The test shall be conducted with the equipment functioning at full-load operation, as defined in [3.20](#), except as required in [5.4](#). The determination of capacity and electrical power is not required for this performance test.

6.4.2 Temperature conditions

The temperature conditions for the freeze-up drip test are given in [Table 5](#).

6.4.3 Airflow conditions

The air inlet to the indoor coil shall be covered to completely block the passage of air, so as to attempt to achieve complete blockage of the evaporator by frost or ice.

6.4.4 Test conditions

6.4.4.1 Preconditions

The equipment shall be started and operated until the operating conditions have stabilized.

6.4.4.2 Duration of test

After the operating conditions have stabilized, the equipment shall be operated for a period of 4 h. The equipment shall be permitted to stop and start under the control of an automatic limit device, if provided. At the end of the 4 h test, the equipment shall be stopped and the air inlet covering removed until the accumulation of frost or ice has melted. The equipment shall then be turned on with the fan(s) operating at the highest speed for 5 min.

6.4.5 Performance requirements

During the test, no ice shall drip from the coil and no water shall drip or blow off the equipment on the indoor-side.

Table 5 — Minimum cooling — Freeze-up air blockage and freeze-up drip test conditions

Parameter	Standard test conditions	
	T1 and T3	T2
Temperature of air entering indoor-side:		
— dry-bulb	21 °C	21 °C
— wet-bulb	15 °C	15 °C
Temperature of air entering outdoor-side:		
— dry-bulb	21 °C	10 °C
— wet-bulb ^a	—	—
Test frequency ^b	Rated frequency	
Test voltage	See Table 3	
^a The wet-bulb temperature condition shall only be required when testing air-cooled condensers that evaporate the condensate.		
^b Equipment with dual-rated frequencies shall be tested at each frequency.		

6.5 Condensate control test and enclosure sweat test

6.5.1 General conditions

The conditions which shall be used during the condensate control and enclosure sweat test are given in [Table 6](#). All indoor units shall be functioning during this test. This test is not required for ducted units. The test shall be conducted with the equipment functioning at full-load operation, as defined in [3.20](#), except as required in [6.5.3](#). The determination of cooling capacity and electrical power input is not required for this performance test.

6.5.2 Temperature conditions

The temperature conditions which shall be used during this test are given in [Table 6](#).

6.5.3 Airflow conditions

The controls, fans, dampers and grilles of the equipment shall be set to produce the maximum tendency to sweat, provided such settings are not contrary to the manufacturer's operating instructions.

6.5.4 Test conditions

6.5.4.1 Preconditions

After establishing the specified temperatures, equipment without condensate pumps shall be started with the condensate collection pan filled to the overflowing point and shall be run until the condensate flow has become uniform (see [Tables 6](#) and [14](#)).

6.5.4.2 Duration of test

The equipment shall be operated for a period of 4 h.

6.5.5 Performance requirements

6.5.5.1 When operating at the test conditions specified in [Table 6](#), no condensed water shall drip, run or blow from the equipment nor shall the equipment shut down.

6.5.5.2 Equipment that rejects condensate to the condenser air shall dispose of all condensate and there shall be no dripping or blowing-off of water from the equipment such that the building or surroundings become wet.

Table 6 — Condensate control test conditions

Parameter	Standard test conditions
Temperature of air entering indoor-side:	
— dry-bulb	27 °C
— wet-bulb	24 °C
Temperature of air entering outdoor-side:	
— dry-bulb	27 °C
— wet-bulb ^a	24 °C
Test frequency ^b	Rated frequency
Test voltage ^c	See Table 3
^a The wet-bulb temperature condition shall only be required when testing air-cooled condensers that evaporate the condensate. ^b Equipment with dual-rated frequencies shall be tested at each frequency. ^c Equipment with dual-rated voltages shall be tested at the higher voltage.	

7 Heating tests

7.1 Heating capacity tests

7.1.1 General conditions

7.1.1.1 For all heating capacity tests, the requirements specified in [Annex B](#) shall apply. Testing shall be conducted using the method(s) and instrumentation that meet the requirements of [9.1](#) and [9.2](#). To constitute a valid test, the test tolerances specified in [9.3](#) shall be satisfied.

7.1.1.2 All heating capacity tests ([Clause 7](#)) shall be conducted at the standard rating conditions specified in [Table 7](#) with the heat pump operating at full capacity, as defined in [3.2](#), with all indoor units and compressors functioning. Modular multi-split systems and modular heat recovery systems shall, for the purposes of this test, have a capacity ratio of indoor units to outdoor units equal to 1 ($\pm 5\%$).

7.1.1.3 The electrical input values used for rating purposes shall be measured during the heating capacity tests. Resistive elements used for heating indoor air other than those used for defrosting shall be prevented from operating during the heating capacity tests.

7.1.1.4 Tests of modular systems and modular heat recovery systems may be conducted at part-load heating capacities. If conducted, part-load heating capacities shall be determined in accordance with the requirements of [Annex F](#).

7.1.1.5 Tests may be conducted to determine the heating capacities of individual indoor units, either operating with all other indoor units functioning or without any other indoor units functioning. If tests are conducted, the capacities shall be determined in accordance with the requirements of [Annex G](#).

7.1.1.6 The manufacturer shall specify, for inverter-controlled compressors, the specific frequency that is needed to give full-load operation. The heat pump shall be maintained at this frequency for all heating capacity tests. If the manufacturer of a heat pump having a variable-speed compressor fails to provide information on the full-load operating frequency and how to achieve it during heating capacity tests, then the heat pump shall be operated with its thermostat or controller set to its maximum allowable temperature setting.

7.1.1.7 The test setup shall include instrumentation to allow measurement of the temperature change across the indoor coil. If using the indoor air enthalpy method, the same dry-bulb temperature sensors as used to measure capacity may be used. If using the calorimeter test method, the temperature change shall be determined using the sensors specified in [Annex D](#).

7.1.2 Temperature conditions

7.1.2.1 Three different outdoor-side temperature conditions, designated as H1-moderate cold condition, H2-cold condition, and H3-very cold condition, are specified in [Table 7](#).

7.1.2.2 [Table 7](#) temperature conditions for the air entering the indoor-side of the equipment shall be used for all heating capacity tests.

7.1.2.3 All heat pumps shall be rated based on testing at the H1-moderate cold condition temperature conditions. Heating capacity tests shall also be conducted at the H2-cold condition and/or H3-very cold condition temperature conditions if the manufacturer rates the equipment for operation at one or both of these temperature conditions.

7.1.2.4 If the heat pump is rated for operation at two frequencies or, in some cases, if the equipment has a dual-rated voltage, then more than one heating capacity test shall be conducted at each applicable outdoor-side temperature condition. [Table 7](#) (and [Table 3](#)) shall be used to determine if additional heating capacity tests are required.

Table 7 — Heating capacity rating conditions

Parameter	Standard rating conditions		
	H1 ^a -moderate cold condition	H2 ^a -cold condition	H3 ^a -very cold condition
Temperature of air entering indoor-side:			
— dry-bulb	20 °C		
— wet-bulb (maximum)	15 °C		
Temperature of air entering outdoor-side:			
— dry-bulb	7 °C	2 °C	-7 °C
— wet-bulb	6 °C	1 °C	-8 °C
Test frequency ^b	Rated frequency		
Test voltage	See Table 3		
^a If a defrosting cycle occurs during the H1, H2 or H3 heating capacity tests, testing under these conditions shall be accomplished using either the calorimeter or the indoor air enthalpy method (see Annexes D and E).			
^b Equipment with dual-rated frequencies shall be tested at each frequency.			

7.1.3 Airflow conditions

7.1.3.1 For ducted indoor units, measurement of the indoor-side air volume rate is required in all cases, regardless of whether the calorimeter test method or the indoor air enthalpy test method is used to provide the primary measurement of heating capacity.

7.1.3.2 Airflow measurements shall be made in accordance with the provisions specified in [Annex A](#) for ducted units and [Annex C](#) for other units, as appropriate, as well as the provisions established in the other annexes of this document.

NOTE 1 Additional guidance concerning airflow measurement can be found in ISO 3966 and ISO 5167-1.

NOTE 2 All airflow rates are expressed in units of cubic metres per second of standard air. For the heating capacity calculations described in [Annex E](#), the indoor-side airflow rate is expressed in units of cubic metres per second of the air-water vapour mixture.

7.1.3.3 When tests are made at settings other than those prescribed in [7.1.3.4](#) and [7.1.3.5](#), these alternative settings shall be noted together with the heating capacity ratings.

7.1.3.4 Equipment settings, both on the indoor and outdoor air sides, shall be the same as those established during the cooling capacity tests. The heating capacity tests shall be conducted at the outdoor-side airflow rate that is inherent in the outdoor-side air circuit, with the exception of any adjustments allowed if using the outdoor air enthalpy test method (see [Annex K](#)).

7.1.3.5 For ducted indoor units, heating capacity tests shall be conducted with the same setting of the damper or exhaust fan as for the cooling capacity test. If cooling capacity tests are conducted for more than one climatic condition (T1, T2, T3) with different flow rates, then the setting giving the highest flow rate shall be used to conduct the heating capacity tests.

7.1.3.6 The heat pump setup used for the H1 test shall be used during the H2 and/or H3 tests, if conducted. There is no minimum required ESP, p_e , when testing at the H2 and H3 test conditions.

7.1.4 Defrost operation

7.1.4.1 Overriding of automatic defrost controls shall be prohibited. The controls may only be overridden when manually initiating a defrost cycle during preconditioning.

7.1.4.2 Any defrost cycle, whether automatically or manually initiated, that occurs while preparing for or conducting a heating capacity test, shall always be automatically terminated by the action of the heat pump's defrost controls.

7.1.4.3 If the heat pump turns the indoor fan off during the defrost cycle, airflow through the indoor coil shall cease.

7.1.5 Test procedure — General

7.1.5.1 The test procedure consists of three periods: a preconditioning period, an equilibrium period and a data collection period. The duration of the data collection period differs depending on whether the heat pump's operation is steady-state or transient. In addition, in the case of transient operation, the data collection period specified when using the indoor air enthalpy method (see [7.1.11.5](#)) is different from the data collection period required if using the calorimeter method (see [7.1.11.6](#)).

7.1.5.2 [Annex P](#) pictorially represents most of the different test sequences which are possible when conducting a heating capacity test.

7.1.6 Preconditioning period

7.1.6.1 The test room reconditioning apparatus and the heat pump under test shall be operated until the test tolerances specified in [9.3](#) are attained for at least 10 min.

7.1.6.2 A defrost cycle may end a preconditioning period. If a defrost cycle does end a preconditioning period, the heat pump shall operate in the heating mode for at least 10 min after defrost termination prior to beginning the equilibrium period.

7.1.6.3 It is recommended that the preconditioning period end with an automatic or manually induced defrost cycle when testing at the H2 and H3 temperature conditions.

7.1.7 Equilibrium period

7.1.7.1 The equilibrium period immediately follows the preconditioning period.

7.1.7.2 A complete equilibrium period is 1 h in duration.

7.1.7.3 Except as specified in [7.1.11.3](#), the heat pump shall operate while meeting the [9.3](#) test tolerances.

7.1.8 Data collection period

7.1.8.1 The data collection period immediately follows the equilibrium period.

7.1.8.2 Data shall be collected as specified for the test method(s) chosen from [9.1](#). If using the calorimeter method, heating capacity shall be calculated as specified in [Annex D](#). If using the indoor air enthalpy method, heating capacity shall be calculated as specified in [Annex E](#). For cases where one of the confirmative test methods of [9.1.3.1](#) is used, heating capacity shall be calculated as specified in the appropriate annex.

7.1.8.3 An integrating electrical power (watt-hour) meter or measuring system shall be used for measuring the electrical energy supplied to the equipment. During defrost cycles and for the first 10 min following a defrost termination, the meter or measuring system shall have a sampling rate of at least every 10 s.

7.1.8.4 Except as specified in [7.1.8.3](#) and [7.1.8.5](#), data shall be sampled at equal intervals that span 30 s or less.

7.1.8.5 During defrost cycles, plus the first 10 min following defrost termination, certain data used in evaluating the integrated heating capacity of the heat pump shall be sampled at equal intervals that span 10 s or less. When using the indoor air enthalpy method, these more frequently sampled data include the change in indoor-side dry-bulb temperature. When using the calorimeter method, these more frequently sampled data include all measurements required to determine the indoor-side capacity.

7.1.8.6 For heat pumps that automatically cycle off the indoor fan during a defrost, the contribution of the net heating delivered and/or the change in indoor-side dry-bulb temperature shall be assigned the value of zero when the indoor fan is off, if using the indoor air enthalpy method. If using the calorimeter test method, the integration of capacity shall continue while the indoor fan is off.

7.1.8.7 For both the indoor air enthalpy and calorimeter test methods, the difference between the dry-bulb temperature of the air leaving and entering the indoor coil shall be measured. For each 5 min interval during the data collection period, an average temperature difference shall be calculated, $\Delta t_i(\tau)$. The average temperature difference for the first 5 min of the data collection period, $\Delta t_i(\tau = 0)$, shall be saved for the purpose of calculating the change, Δt , expressed as a percentage, as given in [Formula \(1\)](#):

$$\% \Delta t = \left[\frac{\Delta t_i(\tau = 0) - \Delta t_i(\tau)}{\Delta t_i(\tau = 0)} \right] \times 100 \% \quad (1)$$

7.1.9 Test procedure when a defrost cycle (whether automatically or manually initiated) ends the preconditioning period ([7.1.6](#))

7.1.9.1 If the quantity $\% \Delta t$ exceeds 2,5 % during the first 35 min of the data collection period, the heating capacity test shall be designated as a transient test (see [7.1.11](#)). Likewise, if the heat pump initiates a defrost cycle during the equilibrium period or during the first 35 min of the data collection period, the heating capacity test shall be designated as a transient test.

7.1.9.2 If the conditions specified in [7.1.9.1](#) do not occur and the test tolerances given in [9.3](#) are satisfied during both the equilibrium period and the first 35 min of the data collection period, then the heat capacity test shall be designated a steady-state test. Steady-state tests shall be terminated after 35 min of data collection.

7.1.10 Test procedure when a defrost cycle does not end the preconditioning period ([7.1.6](#))

7.1.10.1 If the heat pump initiates a defrost cycle during the equilibrium period or during the first 35 min of the data collection period, the heating capacity test shall be restarted as specified in [7.1.10.3](#).

7.1.10.2 If the quantity $\% \Delta t$ exceeds 2,5 % any time during the first 35 min of the data collection period, the heating capacity test shall be restarted as specified in [7.1.10.3](#). Prior to the restart, a defrost cycle shall occur. This defrost cycle may be manually initiated or delayed until the heat pump initiates an automatic defrost.

7.1.10.3 If either [7.1.10.1](#) or [7.1.10.2](#) apply, then the restart shall begin 10 min after the defrost cycle terminates with a new, 1-h-long equilibrium period. This second attempt shall follow the requirements of [7.1.7](#) and [7.1.8](#), and the test procedure of [7.1.9](#).

7.1.10.4 If the conditions specified in [7.1.10.1](#) or [7.1.10.2](#) do not occur and the test tolerances given in [9.3](#) are satisfied during both the equilibrium period and the first 35 min of the data collection period, then the heat capacity test shall be designated as a steady-state test. Steady-state tests shall be terminated after 35 min of data collection.

7.1.11 Test procedure for transient tests

7.1.11.1 When, in accordance with [7.1.9.1](#), a heating capacity test is designated as a transient test, the adjustments specified in [7.1.11.2](#) to [7.1.11.6](#) shall apply.

7.1.11.2 The outdoor air enthalpy test method shall not be used and its associated outdoor-side measurement apparatus shall be disconnected from the heat pump. In all cases, the normal outdoor-side airflow of the heat pump shall not be disturbed. The use of other confirming test methods is not required.

7.1.11.3 To constitute a valid transient heating capacity test, the test tolerances specified in [Table 8](#) shall be achieved during both the equilibrium period and the data collection period. As noted in [Table 8](#), the test tolerances are specified for two subintervals. Interval H consists of data collected during each heating interval, with the exception of the first 10 min after defrost termination. Interval D consists of data collected during each defrost cycle plus the first 10 min of the subsequent heating interval.

7.1.11.4 The test tolerance parameters in [Table 8](#) shall be sampled throughout the equilibrium and data collection periods. All data collected during each interval, H or D, shall be used to evaluate compliance with the [Table 8](#) test tolerances. Data from two or more H intervals or two or more D intervals shall not be combined and then used in evaluating [Table 8](#) compliance. Compliance is based on evaluating data from each interval separately.

7.1.11.5 If using the indoor air enthalpy method, the data collection period shall be extended until 3 h have elapsed or until the heat pump completes three complete cycles during the period, whichever occurs first. If, at an elapsed time of 3 h, the heat pump is conducting a defrost cycle, the cycle shall be completed before terminating the collection of data. A complete cycle consists of a heating period and a defrost period, from defrost termination to defrost termination.

7.1.11.6 If using the calorimeter method, the data collection period shall be extended until 6 h have elapsed or until the heat pump completes six complete cycles during the period, whichever occurs first. If, at an elapsed time of 6 h, the heat pump is conducting a defrost cycle, the cycle shall be completed before terminating the collection of data. A complete cycle consists of a heating period and a defrost period, from defrost termination to defrost termination.

NOTE Consecutive cycles are repetitive with similar frost and defrost intervals before selecting data used for calculating the integrated capacity and power.

7.1.11.7 Because of the confirming test method requirement of [9.1.3.1](#), the outdoor air enthalpy test apparatus may have to be disconnected from the heat pump, as specified in [7.1.11.2](#), during a heating capacity test. If removal during a test is required, the changeover interval shall not be counted as part of the elapsed time of the equilibrium or data collection periods. The changeover interval shall be defined as starting the instant the heating capacity test is designated a transient test and ending when the test tolerances from [Table 8](#) are first re-established after the outdoor air enthalpy apparatus is disconnected from the heat pump.

Table 8 — Variations allowed in heating capacity tests when using the transient (T) test procedure

Reading	Variation of arithmetical mean values from specified test conditions		Variation of individual readings from specified test conditions	
	Interval H ^a	Interval D ^b	Interval H ^a	Interval D ^b
Temperature of air entering indoor-side:				
— dry-bulb	±0,6 K	±1,5 K	±1,0 K	±2,5 K
— wet-bulb	—	—	—	—
Temperature of air entering outdoor-side:				
— dry-bulb	±0,6 K	±1,5 K	±1,0 K	±5,0 K
— wet-bulb	±0,3 K	±1,0 K	±0,6 K	—
Voltage	—	—	±2 %	±2 %
^a Applies when the heat pump is in the heating mode, except for the first 10 min after termination of a defrost cycle. ^b Applies during a defrost cycle and during the first 10 min after the termination of a defrost cycle when the heat pump is operating in the heating mode.				

7.1.12 Heating capacity test results

7.1.12.1 The electrical energy supplied to the heat pump during the applicable test period specified in [7.1.8](#) shall be measured along with the corresponding elapsed time, in hours, of the test period.

7.1.12.2 Average heating capacity and average electrical power input shall be calculated in accordance with [10.1.4](#) and [10.1.5](#) using data from the total number of complete cycles that are achieved before data collection is terminated. In the event that the equipment does not undergo a defrost cycle during the data collection period of a transient test, the entire data set shall be used for the calculations.

The test shall be conducted with the equipment functioning at full-load operation, as defined in [3.20](#).

7.2 Maximum heating performance test

7.2.1 General conditions

The conditions given in [Table 9](#) shall be used during the maximum heating performance test. The test shall be conducted with the equipment functioning at full-load operation, as defined in [3.20](#). All indoor units and compressors shall be functioning during this test.

The test voltages in [Table 9](#) shall be maintained at the specified percentages under running conditions.

The determination of heating capacity and electrical power input is not required for this performance test.

7.2.2 Temperature conditions

The temperature conditions given in [Table 9](#) shall be used during these tests, unless the manufacturer specifies higher temperature conditions in the manufacturer's equipment specification sheets.

Table 9 — Maximum heating test conditions

Parameter	Standard test conditions
Temperature of air entering indoor-side: — dry-bulb	27 °C
Temperature of air entering outdoor-side: — dry-bulb — wet-bulb	24 °C 18 °C
Test frequency ^a	Rated frequency
Test voltage	a) 90 % and 110 % of rated voltage for equipment with a single nameplate voltage rating b) 90 % of the lower rated voltage and 110 % of the higher rated voltage for equipment with a dual or extended nameplate voltage rating
^a Equipment with dual-rated frequencies shall be tested at each frequency.	

7.2.3 Airflow conditions

The maximum heating test shall be conducted using the indoor-side fan speed setting determined in [5.2](#) and [Annex A](#), except as required in [7.2.4.1](#).

7.2.4 Test conditions

7.2.4.1 Preconditions

The controls of the equipment shall be set for maximum heating. All ventilating air dampers and exhaust air dampers, if provided, shall be closed.

7.2.4.2 Duration of test

The equipment shall be operated for 1 h after the specified air temperatures have been attained from [Table 9](#) and [Table 13](#). The equipment shall be permitted to stop and start under the control of an automatic limit device, if provided.

7.2.5 Performance requirements

The equipment shall operate under the conditions specified in [Table 9](#) and [7.2.4.2](#), without indication of damage. The equipment shall be permitted to stop and start under the control of an automatic limit device, if provided. After the interruption of operation, the equipment shall resume operation within 30 min. See [Figure 2](#).

7.3 Minimum heating performance test

7.3.1 General conditions

The conditions given in [Table 10](#) shall be used for this test. The test shall be conducted with the equipment functioning at full-load operation, as defined in [3.20](#). The voltage shall be maintained at the specified value under running conditions. All indoor units and compressors shall be functioning during this test. The determination of the heating capacity and electrical power input is not required for this performance test. This test is only applicable to units including a rating to region H3.

7.3.2 Temperature conditions

The temperature conditions shall be as given in [Table 10](#), unless the manufacturer specifies lower conditions in the manufacturer's equipment specification sheets.

7.3.3 Airflow conditions

The controls of the equipment shall be set for maximum heating. All ventilating air dampers and exhaust air dampers, if provided, shall be closed.

Table 10 — Minimum heating test conditions

Parameter	Standard test conditions
Temperature of air entering indoor-side: — dry-bulb	20 °C
Temperature of air entering outdoor-side ^a : — dry-bulb — wet-bulb	-7 °C -8 °C
Test frequency ^b	Rated frequency
Test voltage ^c	See Table 3
^a If the equipment can be operated under the H3 temperature condition, -7 °C dry-bulb and -8 °C wet-bulb shall be used in lieu of -5 °C/-6 °C. ^b Equipment with dual-rated frequencies shall be tested at each frequency. ^c Equipment with dual-rated voltage shall be tested at the higher voltage. This requirement for testing at a single voltage shall supersede.	

7.3.4 Test conditions

7.3.4.1 Preconditions

The equipment shall be operated for a sufficient period of time to reach stable operating conditions as specified in [Table 10](#).

7.3.4.2 Duration of test

After the equipment has reached stable operating conditions ([Tables 10](#) and [14](#)), these conditions shall be maintained for 1 h.

7.3.5 Performance requirements

The equipment shall operate throughout the test without activation of any manual reset device. The equipment shall be permitted to stop and start under the control of an automatic limit device, if provided.

The equipment shall operate under the conditions specified in [Table 10](#) and [7.3.4.2](#), without indication of damage.

7.4 Automatic defrost performance test

7.4.1 General conditions

This test is not required if provision is made to ensure that cool air (less than 18 °C) is not blown into the conditioned space during defrost. The test shall be conducted with the equipment functioning at full capacity, as defined in [3.2](#), except as required in [7.4.3](#). The conditions for test frequency and test voltage given in [Table 7](#) shall be used during the automatic defrost test. The determination of heating capacity and electrical power input is not required for this performance test.

7.4.2 Temperature conditions

The temperature conditions specified for H2 conditions in [Table 7](#) shall be used during the automatic defrost test. The temperature of air entering the outdoor side shall be set as specified for the H2 test conditions in [Table 7](#).

7.4.3 Airflow conditions

Unless prohibited by the manufacturer, the indoor-side fan is to be adjusted to the highest speed and the unit outdoor-side fan to the lowest speed, if separately adjustable. All other parameters shall be set as specified in [7.1.3.1](#).

7.4.4 Test conditions

7.4.4.1 Duration of test

The equipment shall be operated until the temperatures specified for H2 conditions in [Table 7](#) have been stabilized.

The heat pump shall remain in operation for two complete defrosting periods or for 3 h, whichever is longer.

7.4.5 Performance requirements

During the defrosting period, the temperature of the air from the indoor-side of the equipment shall not be lower than 18 °C for longer than 1 min.

8 Heat recovery test

8.1 Heat recovery capacity ratings

8.1.1 General conditions

8.1.1.1 All modular heat recovery systems shall have heat recovery capacities and heat recovery efficiencies (HRE) determined in accordance with the provisions of this document. All tests shall be carried out in accordance with the test requirements of [Annex B](#) and the test methods described in [Annex D](#), [Annex E](#) and [Annex H](#).

8.1.1.2 All indoor units shall be functioning during this test, with the system operating at the capacity ratio of 1, or as close thereto as possible.

8.1.1.3 The manufacturer shall specify the inverter frequency of the compressor needed to give full-load conditions, as defined in [3.20](#), and the equipment shall be maintained at that frequency. If the equipment cannot be maintained at steady-state conditions by its normal controls, then the manufacturer shall specify how to modify or over-ride such controls so that steady-state conditions can be achieved.

8.1.2 Temperature conditions

The temperature conditions shall be as specified in [Table 11](#).

Table 11 — Heat recovery test conditions

	3-room calorimeter or air enthalpy		2-room air enthalpy	
	Dry-bulb temperature	Wet-bulb temperature	Dry-bulb temperature	Wet-bulb temperature
Outdoor-side	7 °C	6 °C	7 °C	6 °C
Indoor-side:				
— heating	20 °C	15 °C (max)	20 °C	19 °C
— cooling	27 °C	19 °C	20 °C	19 °C
Test frequency ^a	Rated frequency			
Test voltage ^b	See Table 3			
^a	Equipment with dual-rated frequencies shall be tested at each frequency.			
^b	The test voltage of dual-rated equipment shall be tested at the higher voltage of Table 2 .			

9 Test methods and uncertainties of measurement

9.1 Test methods

9.1.1 General

Capacity tests shall be conducted in accordance with the testing requirements specified in [Annex B](#) using either the calorimeter test method (see [Annex D](#)) or the indoor air enthalpy test method (see [Annex E](#)), subject to the provision that the test results are within the limits of uncertainties of measurements established in [9.2](#).

9.1.2 Calorimeter test method

9.1.2.1 When using the calorimeter test method, two simultaneous methods for determining capacities shall be used. One method determines the capacity on the indoor-side, the other measures the capacity on the outdoor side. In order to be valid, the capacity determined using the outdoor-side data shall agree within 5 % of the value obtained using the indoor-side data for the test.

9.1.2.2 For steady-state tests, the measurements shall be considered valid only if the measured capacity at each 5-min time interval does not vary by more than 2 % from the average measured capacity over the previous 35 min.

9.1.2.3 The apparatus used to make the indoor-side airflow and static pressure measurements shall be located within the indoor-side test chamber of the calorimeter for all tests, except where specifications in [A.3](#) are used for setting the airflow. In this case, the airflow measuring apparatus may be removed after the damper has been set in order to obtain the required airflow and external static pressure as specified in [Annex A](#).

9.1.3 Indoor air enthalpy method

9.1.3.1 For cooling capacity tests and steady-state heating capacity tests, a confirming test may be conducted to verify the results obtained using the indoor air enthalpy test method. One of the following test methods may be used for confirmative purposes:

- refrigerant enthalpy method (see [Annex I](#));
- outdoor air enthalpy test method (see [Annex J](#));
- indoor calorimeter confirmative test method (see [Annex K](#));

- d) outdoor calorimeter confirmative test method (see [Annex L](#));
- e) balanced-type calorimeter confirmative test method (see [Annex M](#)).

NOTE [Annex M](#) is not used as a confirmative test by testing laboratories (see [M.1.1](#)).

9.1.3.2 The results of the primary test shall agree with the results of the confirmative test within 5 % to be valid.

Steady-state conditions are achieved when the measured capacity at each 5-min time interval does not vary by more than 2,5 % from the average measured capacity over the previous 35 min.

9.1.4 Capacity tests

On the cooling cycle, it is recommended that the latent cooling capacity be determined using the cooling condensate method (see [Annex N](#)) subject to the provision that the test results are within the limits of uncertainties of measurements established in [9.2](#).

9.2 Uncertainty of measurement

9.2.1 The uncertainty of measurement shall not exceed the values specified in [Table 12](#).

NOTE Uncertainties of measurement can be estimated. ISO/TS 16491 is available as appropriate guidance.

Table 12 — Uncertainties of measurement

Measured quantity	Uncertainty of measurement ^a
Water:	
— temperature	0,1 K
— temperature difference	0,1 K
— volume flow	1 %
— static pressure difference	5 %
Air:	
— dry-bulb temperature	0,2 K
— wet-bulb temperature greater than 0 °C ^b	0,2 K
— wet-bulb temperature less than or equal to 0 °C ^b	0,3 K
— volume flow	5 %
— static pressure difference	5 Pa for pressure ≤100 Pa 5 % for pressure >100 Pa
Electrical measurements	0,5 %
Time	0,2 %
Mass	1,0 %
Speed	1,0 %
Refrigerant pressure	2,0 %

NOTE Uncertainty of measurement comprises, in general, many components. Some of these components may be estimated on the basis of the statistical distribution of the results of a series of measurements and can be characterized by experimental standard deviations. Estimates of other components can be based on experience or other information. ISO/TS 16491 is available as an appropriate guidance.

^a Uncertainty of measurement is an estimate characterizing the range of values within which the true value of the measurement lies, based on a 95 % confidence interval (see ISO/IEC Guide 98-3).

^b Can be measured directly or indirectly.

9.2.2 The steady-state cooling and heating capacities determined using the calorimeter method shall be determined with a maximum uncertainty of 5 %. This value is an expanded uncertainty of measurement expressed at the level of confidence of 95 %.

9.2.3 Heating capacity determined during transient operation (defrost cycles) using the calorimeter method shall be determined with a maximum uncertainty of 10 %. This value is an expanded uncertainty of measurement expressed at the level of confidence of 95 %.

9.2.4 The heating and cooling capacities measured on the air side using the air enthalpy method shall be determined with a maximum uncertainty of 10 %. This value is an expanded uncertainty of measurement expressed at the level of confidence of 95 %.

9.3 Test tolerances for the capacity tests

9.3.1 The maximum permissible variation of any individual observation from a specific test condition during a steady-state cooling and heating capacity test is listed in column 3 of Table 13. If a test condition is not specified, the values in column 3 of Table 13 represent the greatest permissible difference between maximum and minimum instrument observations during the test. When expressed as a percentage, the maximum allowable variation is the specified percentage of the arithmetical average of the observations.

Table 13 — Variations allowed during steady-state cooling and heating capacity tests

Reading	Variations of arithmetical mean values from specified test conditions	Maximum variation of individual readings from specified test conditions ^a
Temperature of air entering indoor-side:		
— dry-bulb	±0,3 K	±0,5 K
— wet-bulb	±0,2 K ^a	±0,3 K ^a
Temperature of air entering outdoor-side:		
— dry-bulb	±0,3 K	±0,5 K
— wet-bulb	±0,2 K ^b	0,3 K ^b
Voltage	±1 %	±2 %
Air volume flow rate ^c	±5 %	±10 % ^c
^a Not applicable for heating tests. ^b Only applies to cooling capacity tests if equipment rejects condensate to the outdoor coil. ^c Only applies to the indoor air enthalpy method. The test condition is defined as the measured arithmetical mean of airflow taken within the first 5 min of the data collection period.		

9.3.2 The maximum permissible variations of the average of the test observations from this document or specified test conditions are show in column 2 of Table 13.

9.3.3 For cooling capacity tests, the dry-bulb and wet-bulb temperatures of the air entering the indoor-side and outdoor side shall be sampled at equal intervals spanning 30 s or less throughout the preconditioning and data collection periods. The specified sampling of the wet-bulb temperature of the air entering the outdoor side shall be waived for equipment that rejects condensate to a location other than the outdoor coil.

9.3.4 For steady-state heating capacity tests, the dry-bulb temperature of the air entering the indoor-side and the dry-bulb and wet-bulb temperatures of the air entering the outdoor side shall be sampled at equal intervals spanning 30 s or less throughout the preconditioning and data collection periods.

9.3.5 Except as noted in 9.3.3, all applicable parameters from Table 11 shall be sampled at equal intervals that span 5 min or less during cooling capacity tests. Except as noted in 9.3.4, all applicable parameters from Table 11 shall be sampled at equal intervals spanning 30 s or less during heating capacity tests

9.3.6 For the preconditioning period, equilibrium shall be defined as an interval of specified duration where the applicable test tolerances in Table 14 are satisfied. When a defrost cycle occurs during the preconditioning period of a heating capacity test, the parameters sampled between defrost initiation and 10 min after defrost termination shall be excluded when evaluating compliance to the test tolerances in Table 14. As noted in 7.1.8.5, the sampling frequency of the indoor dry-bulb temperature is subject to change during defrost cycles, if using the indoor air enthalpy test method.

9.3.7 For the data collection period used in determining the equipment's measured space conditioning capacity, compliance with the applicable test tolerances in Table 14 shall be achieved.

9.4 Test tolerances for performance tests

The maximum allowable variation of any individual observation made during a performance test from the specified test condition is established in Table 14.

Table 14 — Test tolerances for performance tests

Readings	Maximum variation of individual readings from specified test conditions ^a
Air temperatures:	
— dry-bulb	±1,0 K
— wet-bulb	±0,5 K
Voltage	±2 %
^a The test tolerances do not apply when the equipment is stopped, changing compressor speed or from defrost initiation to 10 min after defrost termination. Except during these intervals, dry-bulb temperature tolerances of ±2,5 K on the indoor-side and ±5 K on the outdoor side shall apply.	

10 Test results

10.1 Capacity results

10.1.1 General

The results of a capacity test shall express quantitatively the effects produced upon air by the equipment being tested. For given test conditions, the capacity test results shall include the following quantities as are applicable to cooling or heating:

- a) total cooling capacity, in watts;
- b) sensible cooling capacity, in watts;
- c) latent cooling capacity, in watts;
- d) heating capacity, in watts;
- e) indoor-side airflow rate, in cubic metres per second of standard air;
- f) external resistance to indoor airflow, in Pa;
- g) effective power input to the equipment or individual power inputs to each of the electrical equipment components, in watts.

NOTE For determination of latent cooling capacity, see [Annex D](#) if using the calorimeter test method and [Annex E](#) if using the indoor air enthalpy test method.

10.1.2 Adjustments

Test results shall be used to determine capacities without adjustment for permissible variations in test conditions. Air enthalpies, specific volumes and isobaric specific heat capacities shall be based on the measured barometric pressure.

For calorimetric testing, variations from standard barometric pressure can have an impact on the measured capacity. If capacity, adjusted for standard barometric pressure, is additionally reported, an explanation of the adjustment method should be included in the test report.

10.1.3 Cooling capacity calculations

10.1.3.1 An average cooling capacity shall be determined from the set of cooling capacities recorded over a data collection period of at least 30 min.

10.1.3.2 An average electrical power input shall be determined from the set of electrical power inputs recorded over the data collection period or from the integrated electrical power for the same interval in cases where an electrical energy meter is used.

10.1.3.3 Standard ratings of capacities shall include the effects of circulating-fan heat, but shall not include supplementary heat. For units provided without a fan, the effects to be taken into account shall be calculated according to [Annex O](#).

10.1.4 Heating capacity calculations

10.1.4.1 Steady-state capacity calculations

10.1.4.1.1 If the heating capacity test is conducted in accordance with the provisions of [7.1.9.2](#) or [7.1.10.4](#), a heating capacity shall be calculated using data from each data sampling in accordance with [Annex D](#), if using the calorimeter test method, or in accordance with [Annex E](#), if using the indoor air enthalpy test method.

10.1.4.1.2 An average heating capacity shall be determined from the set of heating capacities recorded over 35 min of the data collection period.

10.1.4.1.3 An average electrical power input shall be determined from the set of electrical power inputs recorded over 35 min of the data collection or from the integrated electrical power for the same data collection period.

10.1.4.2 Transient capacity tests

10.1.4.2.1 If the heating capacity test is conducted in accordance with the provisions of [7.1.11](#), an average heating capacity shall be determined (see Example 1 in [Annex P](#)). This average heating capacity shall be calculated as specified in [Annex D](#) if using the calorimeter test method and as specified in [Annex E](#) if using the indoor air enthalpy test method.

10.1.4.2.2 For equipment where one or more complete cycles occur during the data collection period, the following shall apply. The average heating capacity shall be determined using the integrated capacity and the elapsed time corresponding to the total number of complete cycles that occurred over the data collection period (see Examples 4, 5 and 6 in [Annex P](#)). The average electrical power input shall be determined using the integrated power input and the elapsed time corresponding to the total number of complete cycles during the same data collection period as the one used for the heating capacity.

NOTE A complete cycle consists of a heating period and a defrost period from defrost termination to defrost termination.

10.1.4.2.3 For equipment that does not conduct a complete cycle during the data collection period, the following shall apply. The average heating capacity shall be determined using the integrated capacity and the elapsed time corresponding to the total data collection period (3 h if using the indoor air enthalpy test method; 6 h if using the calorimeter test method). The average electrical power input shall be determined using the integrated power input and the elapsed time corresponding to the same data collection period as the one used for the heating capacity (see Example 2 in [Annex P](#)).

10.1.4.2.4 For equipment in which a single defrost occurs during the test period, the following shall apply. The average heating capacity shall be determined using the integrated capacity and the elapsed time corresponding to the total test period (3 h if using the indoor air enthalpy test method; 6 h if using the calorimeter test method). The average electrical power input shall be determined using the integrated power input and the elapsed time corresponding to the total test period (see Example 3 in [Annex P](#)).

10.1.5 Power input of fans

The fan power measured during the test shall be included in the declared power consumption and in the calculation of efficiencies. Standard ratings of capacities shall include the effects of circulating-fan heat, but shall not include supplementary heat. For units provided without a fan, the effect of the fan to be taken into account shall be calculated according to [Annex Q](#).

10.2 Data to be recorded

The data to be recorded for the capacity tests are given in [Table 15](#) for the indoor air enthalpy test method and [Tables 16](#) and [17](#) for the room calorimeter test method and [Table 18](#) for the blowing test. The tables identify the general information required but are not intended to limit the data to be obtained. Electrical input values used for rating purposes shall be those measured during the capacity tests.

Table 15 — Data to be recorded for the indoor air enthalpy capacity tests

No.	Data
1	Date
2	Observers
3	Barometric pressure, in kPa
4	Time of tests
5	Power input to equipment ^a , in W
6	Energy input to equipment ^b , in Wh
7	Applied voltage(s), in V
8	Total current input to equipment, in A
9	Frequency, in Hz
10	External resistance to airflow for each indoor unit, in Pa
11	Fan speed setting for each indoor and outdoor units
12	Setting of variable capacity compressor at full load
13	Dry-bulb temperature of air entering equipment, in °C
14	Wet-bulb temperature of air entering equipment, in °C
15	Dry-bulb temperature of air leaving measuring device, in °C
16	Wet-bulb temperature of air entering measuring device, in °C
17	Outdoor dry-bulb and wet-bulb temperatures, in °C
^a	Total power input and, where required, input to equipment components.
^b	Energy input to equipment is required only during defrost operations.

Table 15 (continued)

No.	Data
18	Volume flow rate of air and all relevant measurements for its calculation, in m ³ /s
19	Refrigerant charge added by the test house, in kg
20	Value of C (for adjusted exhaust fan setting method)
21	External static pressure (ESP), in Pa (for fixed duct resistance method)
22	Factory charge, in kg
a	Total power input and, where required, input to equipment components.
b	Energy input to equipment is required only during defrost operations.

Table 16 — Data to be recorded for calorimeter cooling capacity tests

No.	Data
1	Date
2	Observers
3	Barometric pressure, in kPa
4	Fan speed setting indoor and outdoor
5	Applied voltage, in V
6	Frequency, in Hz
7	Total current input to equipment, in A
8	Total power input to equipment ^a , in W
9	Setting of variable capacity compressor at full load
10	Dry-bulb and wet-bulb temperatures of air (indoor-side calorimeter test chamber), in °C
11	Dry-bulb and wet-bulb temperature of air (outdoor-side calorimeter test chamber), in °C
12	Average air temperature outside the calorimeter if calibrated (see Figure D.1), in °C
13	Total power input to indoor-side and outdoor-side test chambers, in W
14	Quantity of water evaporated in humidifier, in kg
15	Temperature of humidifier water entering indoor-side and outdoor-side (if used) test chambers or in humidifier tank, in °C
16	Cooling water flow rate through outdoor-side test chamber heat-rejection coil, in l/s
17	Temperature of cooling water entering outdoor-side test chamber, for heat-rejection coil, in °C
18	Temperature of cooling water leaving outdoor-side test chamber, from heat-rejection coil, in °C
19	Temperature of condensed water leaving outdoor-side test chamber, in °C
20	Mass of water from equipment which is condensed in the reconditioning equipment ^c , in kg
21	Volume of airflow through measuring nozzle of the separating partition, in m ³ /s
22	Air-static pressure difference across the separating partition of calorimeter test chambers, in Pa
23	Refrigerant charge added by the test house, in kg
24	External resistance to airflow, in Pa
25	Volume flow rate of air and all relevant measurements for its calculation, in m ³ /s
26	Value of C (for adjusted exhaust fan setting method)
27	External static pressure (ESP), in Pa (for fixed duct resistance method)
28	Factory charge, in kg
a	Total power input to the equipment, except if more than one external power connection is provided on the equipment; record input to each connection separately.
c	For equipment which evaporates condensate on the outdoor coil.

Table 17 — Data to be recorded for calorimeter heating capacity tests

No.	Data
1	Date
2	Observers
3	Barometric pressure, in kPa
4	Fan speed setting indoor and outdoor
5	Applied voltage, in V
6	Frequency, in Hz
7	Total current input to equipment, in A
8	Total power input to equipment ^a , in W
9	Setting of variable capacity compressor at full load
10	Control dry-bulb and wet-bulb temperature of air (indoor-side calorimeter test chamber) ^b , in °C
11	Control dry-bulb and wet-bulb temperature of air (outdoor-side calorimeter test chamber) ^b , in °C
12	Average air temperature outside the calorimeter if calibrated (see Figure D.1), in °C
13	Total power input to indoor-side and outdoor-side test chambers, in W
14	Quantity of water evaporated in humidifier, in kg
15	Temperature of humidifier water entering indoor-side and outdoor-side (if used) test chambers or in humidifier tank, in °C
16	Cooling water flow rate through outdoor-side test chamber heat-rejection coil, in l/s
17	Temperature of cooling water entering outdoor-side test chamber, for heat-rejection coil, in °C
18	Temperature of cooling water leaving outdoor-side test chamber, from heat-rejection coil, in °C
19	Mass of condensed water from equipment, in kg
20	Temperature of condensed water leaving outdoor-side test chamber, in °C
21	Volume of airflow through measuring nozzle of the separating partition, in m ³ /s
22	Air-static pressure difference across the separating partition of calorimeter test chambers, in Pa
23	Refrigerant charge added by the test house, in kg
24	External static pressure of indoor units, in Pa
25	Measured airflow rate of indoor units, in m ³ /s
26	Value of C (for adjusted exhaust fan setting method)
27	External static pressure (ESP), in Pa (for fixed duct resistance method)
28	Factory charge, in kg

^a Total power input to the equipment, except if more than one external power connection is provided on the equipment; record input to each connection separately.

^b See [D.1.5](#).

Table 18 — Data to be recorded for the blowing test

No.	Data
1	Date
2	Observers
3	Applied voltage, in V
4	Frequency, in Hz
5	Total current input to equipment, in A
6	Total power input to equipment, in W
7	Fan speed setting, indoor
8	Dry-bulb temperatures of the inlet air, °C
9	Wet-bulb temperatures of the inlet air, °C

Table 18 (continued)

No.	Data
10	Barometric pressure, in kPa
11	External static pressure (ESP) p_e , (p_m for A.4 adjusted exhaust fan setting method), in Pa
12	Value of C [calculate from Formula (A.2) for A.4 adjusted exhaust fan setting method]
13	Static pressure of the discharge chamber (applies to A.3 Fixed duct resistance method), in kPa
14	Dry-bulb temperatures at the nozzle inlet, °C
15	Pressure at the nozzle inlet, in kPa
16	Static pressure difference at the nozzle or nozzle velocity pressure p_v , in Pa
17	Air mass flow rate, q_m , in kg/s
18	Air volume flow rate, q_v , in m ³ /s
19	standard air flow rate, q_s , in m ³ /s

10.3 Test report

10.3.1 General information

As a minimum, the test report shall contain the following general information:

- a) a reference to this document, i.e. ISO 15042;
- b) the date;
- c) the test institute;
- d) the test location;
- e) the primary test and confirming test methods;
- f) the test supervisor;
- g) the cooling climate type designations and heating rating conditions (i.e. T1, T2, T3, H1, H2, and H3);
- h) a description of the test setup, including equipment location;
- i) the nameplate information (see [11.2](#)).

10.3.2 Rating test results

The values reported shall be the mean of the values taken over the data collection period and shall be stated with an uncertainty of measurement at a confidence level of 95 % and in accordance with ISO/IEC Guide 98-3.

10.3.3 Performance tests

The test report shall indicate whether the test passed or failed based upon recorded data.

For all performance tests relevant information shall be recorded to show the specific requirements for each test has been met. This shall be as a minimum the data requirements of [Table 13](#), [14](#) or [15](#) (as appropriate) recorded at least once every 5 min, and additionally.

10.3.3.1 For Maximum cooling performance tests ([6.2](#)):

- current, in amperes, recorded at least once every 5 min,
- time at which the power to the unit was interrupted,

- time(s) at which the unit automatically starts and/or stops operating

10.3.3.2 For Freeze-up drip performance test (6.4):

- pictures or sketches of the unit at the end of the test that clearly depict any areas of moisture outside of the unit

10.3.3.3 For Condensate control and enclosure sweat performance test (6.5):

- pictures or sketches of the unit at the end of the test that clearly depict any areas of moisture outside of the unit

10.3.3.4 For Maximum heating performance test (7.2):

- Current, in amperes, recorded at least every 5 min,
- time(s) at which the unit automatically starts and/or stops operating

10.3.3.5 For Automatic defrost performance test (7.4):

- temperature of the air leaving the indoor-side of the equipment, in °C, recorded at least once every 1 min

NOTE No additional data is required for Minimum heating performance test (7.3).

11 Marking provisions

11.1 Nameplate requirements

Each individual unit of the air conditioner and heat pump system shall have a durable nameplate firmly attached to it and in a location accessible for reading.

11.2 Nameplate information

The nameplate shall provide the following minimum information in addition to the information required in international safety standards:

- the manufacturer's name or trademark;
- any distinctive type or model designation and serial number;
- the rated voltage(s);
- the rated frequency(ies);
- the cooling climate designations and heating rating conditions (i.e. T1, T2, T3, H1, H2, H3, as applicable);
- the refrigerant designation in accordance with ISO 817, or specified in the national regulations;
- the factory refrigerant mass charge [listed on the unit containing the compressor(s)].

11.3 Split systems

The information in 11.2 a), b), c), d), and f) shall also be provided on each indoor element of a split system and g) shall be provided on the outdoor unit.

12 Publication of ratings

12.1 Standard ratings

12.1.1 Standard ratings shall be published for cooling capacities (sensible, latent and total), heating capacity, EER and COP, as appropriate, for all systems produced in conformance with this document. These ratings shall be based on data obtained at the established rating conditions in accordance with the provisions of this document.

12.1.2 The values of standard capacities shall be expressed in kilowatts, rounded to three significant figures.

12.1.3 The values of EER and COP shall be expressed in multiples, rounded to three significant figures.

12.1.4 Each capacity rating shall be followed by the corresponding test voltage (see column 2 of [Table 3](#)) and frequency rating.

12.2 Other ratings

Additional ratings may be published based on conditions other than those specified as standard rating conditions, or based on conditions specified in national regulations, or based on the testing of various combinations of operating evaporators and/or compressors, if they are clearly specified and if the data are determined by the methods specified in this document, or by analytical methods which are verifiable by the test methods specified in this document.

STANDARDSISO.COM : Click to view the full PDF of ISO 15042:2017

Annex A (normative)

Airflow settings for ducted units

A.1 General

Two methods of airflow settings are applicable:

- a) fixed duct resistance method;
- b) adjusted exhaust fan setting method.

Both methods with their respective test apparatus are described in this annex.

To measure the static pressure of the discharged air from the ducted equipment, a measuring duct is connected to the duct flange of the equipment. This measuring duct is used for both methods. If the dimensions of the outlet duct section are A and B , the equivalent diameter, D_e , is determined using [Formula \(A.1\)](#):

$$D_e = \sqrt{(4AB) / \pi} \quad (\text{A.1})$$

If the outlet duct is circular in section with diameter D , the equivalent diameter D_e is equal to D .

The length of the measuring duct, L_d , needs to be no smaller than $2,5D_e$. The static pressure taps should be located at the distance $L_m = 2D_e$ from the outlet flange.

A.2 Test method

A.2.1 The flow setting of the units shall be by means of the fixed duct resistance method as shown in [Figure A.1](#) or the adjusted exhaust fan setting method as shown in [Figure A.2](#).

A.2.2 The static pressure measurement taps shall be arranged as shown in [Figure A.1](#) and [Figure A.2](#). The unit under test shall be operated without the compressor running.

A.2.3 Airflow measurements should be made in accordance with the provisions specified in [Annex C](#), as appropriate, as well as other provisions established in this document.

NOTE Additional guidance concerning airflow measurements can be found in ISO 3966 and ISO 5167-1.

A.3 Fixed duct resistance method

A.3.1 General

A measuring duct shall be connected to the test unit and a damper installed on the opposite end of the measuring duct, to which a discharge chamber is connected. The discharge chamber shall have sufficient cross-sectional dimensions so that airflow velocities along the wall surface at the static pressure tap ([Figure A.1](#), item 4) is 1,25 m/s or less. The minimum length of the discharge chamber in the flow direction J is $2D_e$.

NOTE The setup of the test unit, measuring duct and discharge chamber is illustrated in [Figure A.1](#).

A.3.2 Test procedure

A.3.2.1 Test conditions

The temperature and humidity conditions of the test room shall be within the range specified in 5.2. The test unit shall be operated in the blowing mode without the compressor running. The damper shall be adjusted so that the rated airflow rate in standard air is obtained. At the same time, the airflow rate of the airflow measuring apparatus shall be adjusted so that static pressure in the discharge chamber is (0 ± 2) Pa. The above conditions shall be maintained for at least 1 h. External static pressure shall be maintained per Table A.1 during the blowing test.

Table A.1 — Variations allowed during blowing test

Reading	Variation of arithmetical mean values from specified test conditions		Variation of individual readings from specified test conditions	
	≤100 Pa	>100 Pa	≤100 Pa	>100 Pa
External static pressure (ESP)	±0,5 Pa	±5 %	±0,10 Pa	±10 %

A.3.2.2 Blowing test

The dry- and wet-bulb temperatures of the inlet air, airflow rate, ESP, p_e , dry- and wet-bulb temperatures in front of the nozzle, and barometric pressure shall be measured. The measured airflow rate, q_m , shall be calculated according to Formula (C.3). The measured airflow rate, q_m , shall be converted into the standard flow rate, q_s . See Formula (C.8).


A.3.2.3 Evaluation

The ESP, p_e , shall be that specified in 5.2.

A.3.2.4 Cooling and heating tests

The damper's position shall remain fixed at the setting obtained in A.3.2.1 for all cooling and heating tests, which shall be conducted at the respective temperature and humidity conditions. During the cooling and heating tests, the static pressure of the discharge chamber shall be maintained at (0 ± 2) Pa.

The ESP, p_e , of the measuring duct at the cooling and heating tests is for reference only, and does therefore not need to be published. The airflow rate measured when the equipment is operating in the cooling or heating mode is used for calculation of cooling and heating capacities.

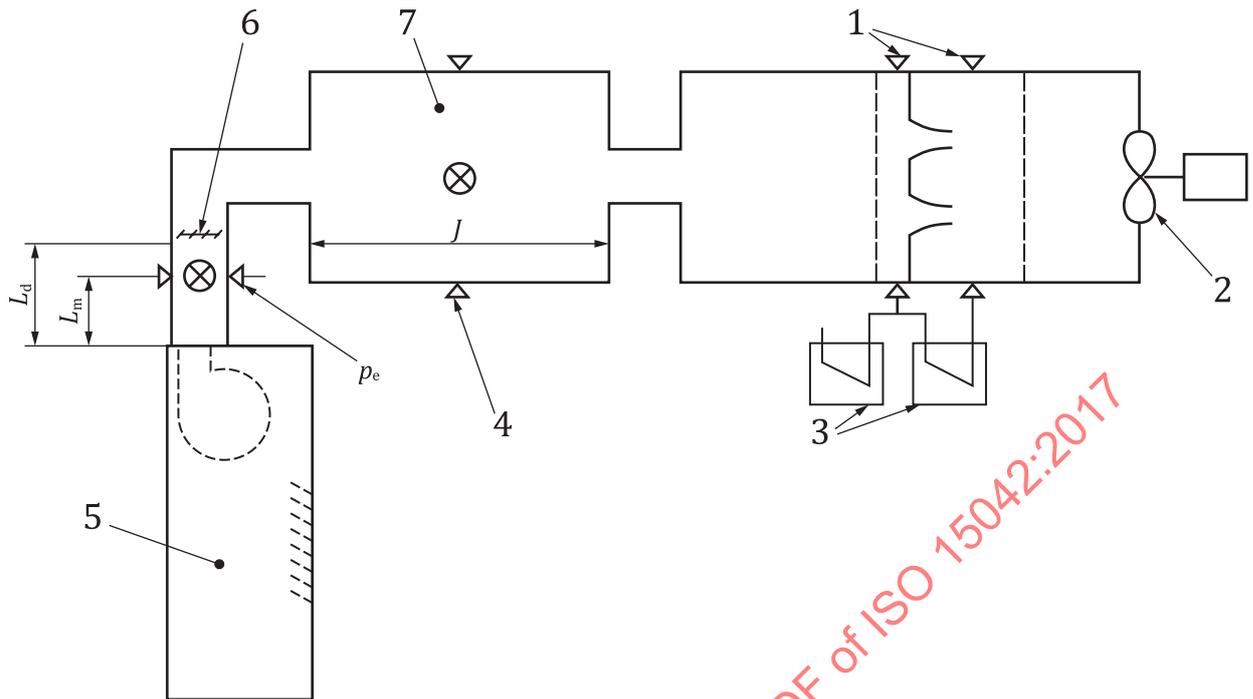

Key

- | | | | |
|---|---|-------|----------------------------------|
| 1 | airflow measuring apparatus | J | minimum length |
| 2 | exhaust fan | L_d | length of the measuring duct |
| 3 | manometers | L_m | distance to static pressure taps |
| 4 | static pressure taps of discharge chamber | p_e | ESP of the equipment under test |
| 5 | equipment under test | | |
| 6 | damper | | |
| 7 | discharge chamber | | |

Figure A.1 — Fixed duct resistance method setup

A.4 Adjusted exhaust fan setting method

A measuring duct shall be connected to the test unit and an airflow measuring apparatus connected to the opposite end of the measuring duct.

NOTE The setup of the test unit, measuring duct and airflow measuring apparatus is illustrated in [Figure A.2](#).

A.4.1 Test procedure

The temperature and humidity conditions of the test room shall be within the range specified in [5.2](#). The test unit is operated in the blowing mode without the compressor running. The airflow measuring apparatus shall be adjusted so that the rated airflow rate in standard air is obtained. The above conditions shall be maintained for at least 1 h. External static pressure shall be maintained per [Table A.1](#) during the blowing test.

A.4.2 Blowing test

The dry- and wet-bulb temperatures of the inlet air, airflow rate, ESP, p_e , dry- and wet-bulb temperatures in front of the nozzle, and barometric pressure shall be measured. The measured airflow rate, q_m , shall be calculated according to [Formula \(C.3\)](#). The measured airflow rate, q_m , shall be converted into the standard flow rate, q_s . See [Formula \(C.8\)](#).

A.4.3 Calculation of the value of C

Calculate the value of C from [Formula \(A.2\)](#).

$$C = \frac{p_m}{q_m^2} \quad (\text{A.2})$$

where

p_m is external static pressure at the measuring duct (in Pa), especially for blowing test using adjusted exhaust fan setting method, and p_m is considered to be equal to the external static pressure, p_e .

A.4.4 Evaluation

The ESP, p_e , shall be that specified by [5.2](#).

A.4.5 Cooling and heating tests


Cooling and heating tests shall be performed following the blowing test, at their respective temperature and humidity conditions. The speed of the exhaust fan of the airflow measuring apparatus shall be adjusted for the cooling and heating tests in the following manner.

For the cooling test, operate the equipment with the compressor in the cooling mode and allow the temperature to stabilize. Once the temperature is stabilized adjust the airflow measuring apparatus to achieve the same value of C by changing its exhaust fan speed in small increments. The resulting value of C shall be in the range of ± 1 % of that measured during the blowing test. Once stabilized, the cooling airflow rate and ESP shall be measured.

For the heating test, repeat the cooling test above, this time with the compressor operating in the heating mode. Measure the heating airflow rate and ESP.

The airflow rate measured when the equipment is operating in the cooling or heating mode shall be used to calculate the cooling and heating capacities.

The ESP of the measuring duct during the cooling and heating tests is for reference only, and does therefore not need to be published.

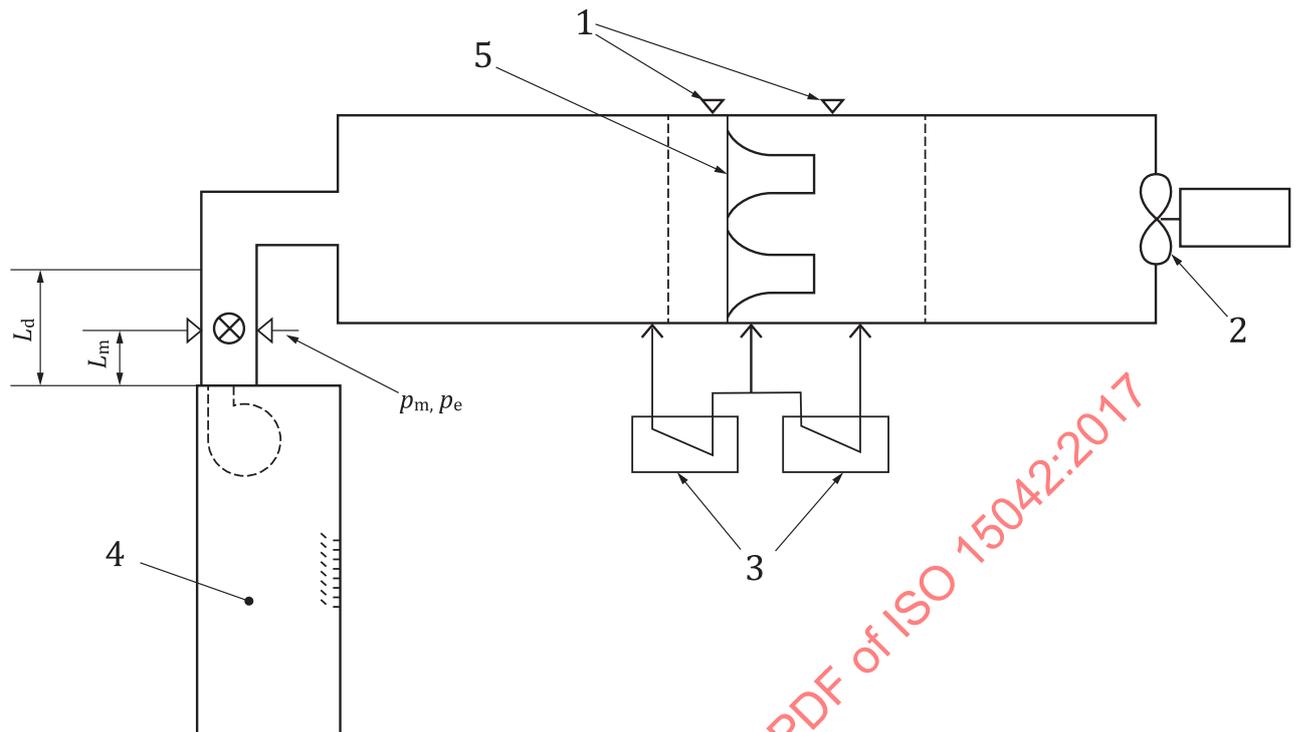

Key

- 1 airflow measuring apparatus
- 2 exhaust fan
- 3 manometers
- 4 equipment under test
- 5 nozzles

- L_d length of the measuring duct
- L_m distance to static pressure taps
- p_e ESP of the equipment under test
- p_m external static pressure at the measuring duct, especially for blowing test using adjusted exhaust fan setting method

Figure A.2 — Adjusted exhaust fan setting method setup

A.5 Unit without indoor fan

If no fan is supplied with the unit, i.e. coil only units, the supplemental requirements given in [Annex O](#) also apply.

Annex B (normative)

Test requirements

B.1 General test room requirements

B.1.1 If an indoor condition test room is required, it shall be a room or space in which the desired test conditions can be maintained within the prescribed tolerances. It is recommended that air velocities in the vicinity of the equipment under test do not exceed 2,5 m/s.

B.1.2 If an outdoor condition test room or space is required, it shall be of sufficient volume and shall circulate air in such a manner that it does not change the normal air circulating pattern of the equipment under test. It shall be of such dimensions that the distance from any room surface to any equipment surface from which air is discharged is not less than 1,8 m and the distance from any other room surface to any other equipment surface is not less than 1,0 m, except for floor or wall relationships required for normal equipment installation. The room conditioning apparatus should handle air at a rate not less than the outdoor airflow rate, and should preferably take this air from the direction of the equipment air discharge and return it at the desired conditions uniformly and at low velocities.

B.1.3 If the calorimeter room method is used with a facility having more than two rooms, then the additional rooms shall also comply with the requirements of [Annex D](#). If the air enthalpy method is used with a facility having more than two rooms, then the additional rooms shall also comply with the requirements of [Annex E](#).

B.2 Equipment installation

B.2.1 The equipment to be tested shall be installed in accordance with the manufacturer's installation instructions using recommended installation procedures and accessories. If the equipment can be installed in multiple positions, all tests shall be conducted using the least favourable configuration according to the manufacturer's recommendation. In all cases, the manufacturer's recommendations with respect to distances from adjacent walls, amount of extensions through walls, etc. shall be followed.

B.2.2 No other alterations to the equipment shall be made except for the attachment of the required test apparatus and instruments in the prescribed manner.

B.2.3 Ducted equipment rated at less than 8 kW and intended to operate at external static pressures of less than 25 Pa shall be tested at free delivery of air according to ISO 5151.

B.2.4 If necessary, the equipment shall be evacuated and charged with the type and amount of refrigerant specified in the manufacturer's instructions.

B.2.5 All standard ratings for equipment in which the condenser and the evaporator are two separate assemblies shall be determined by manufacturer's specifications within 5 m to 7,5 m of connecting tubing on each line. The lengths shall be actual lengths, not equivalent lengths, and no account shall be taken of the resistance provided by bends, branches, connecting boxes or other fittings used in the installation for the test piece. The length of the connecting tubing shall be measured from the enclosure of the indoor unit to the enclosure of the outdoor unit. Such equipment in which the interconnecting tubing is furnished as an integral part of the unit and not recommended for cutting to length shall be tested with the complete length of tubing furnished. Not less than 40 % of the total length of the interconnecting tubing shall

be exposed to the outdoor conditions with the rest of the tubing exposed to the indoor conditions. The line diameters, insulation, details of installation, evacuation and charging shall be in accordance with the manufacturer's published recommendations.

B.3 Static pressure measurements across indoor coil

B.3.1 Equipment with a fan and a single outlet

B.3.1.1 A short plenum shall be attached to the outlet of the equipment. This plenum shall have cross-sectional dimensions equal to the dimensions of the equipment outlets. A static pressure tap shall be added at the centre of each side of the discharge plenum, if rectangular, or at four evenly distributed locations along the circumference of an oval or round plenum. These four static pressure taps shall be manifolded together. The minimum length of the discharge plenum and the location of the static pressure taps relative to the equipment outlets shall be as shown in [Figure B.1](#), if testing a split-system, and as shown in [Figure B.2](#), if testing a single-package unit.

B.3.1.2 A short plenum should be attached to the inlet of the equipment. If used, the inlet plenum shall have the same cross-sectional dimensions as the equipment inlet. In addition, four static pressure taps shall be added and manifolded together. This plenum should otherwise be constructed as shown for the inlet plenum in [Figure B.2](#), if testing a single-package unit, and as shown in [Figure B.3](#), if testing a split-system.

NOTE [Figure B.3](#) is referenced here for guidance even though it specifically applies to ducted units tested without an indoor fan.


B.3.2 Equipment with fans and multiple outlets or multiple indoor units

B.3.2.1 Equipment with multiple outlet duct connections or multiple indoor units shall have a short plenum attached to each outlet connection or indoor unit, respectively. Each of these short plenums shall be constructed as described in [B.3.1.1](#), including static pressure taps. All outlet plenums shall discharge into a single common duct section. For the purpose of equalizing the static pressure in each plenum, an adjustable restrictor shall be located in the plane where each outlet plenum enters the common duct section. Multiple blower units employing a single discharge duct connection flange shall be tested with a single outlet plenum in accordance with [B.3.1](#). Any other test plenum arrangements shall not be used except to stimulate duct designs specifically recommended by the equipment manufacturer.

B.3.2.2 A short plenum should be attached to the inlet of each inlet duct connection or indoor unit. Each of these short plenums shall be constructed as described in [B.3.1.2](#), including static pressure taps.

B.3.3 Equipment without a fan and a single outlet

For an indoor coil that does not incorporate a fan, a short plenum shall be attached to both the inlet and outlet of the equipment. These plenums shall have cross-sectional dimensions equal to the dimensions of the equipment inlet and outlet, respectively. A static pressure tap shall be added at the centre of each side of each plenum, if rectangular, or at four evenly distributed locations along the circumference of oval or round plenums. For each plenum, the four static pressure taps shall be manifolded together. The minimum length of the plenums and the location of the static pressure taps relative to the equipment inlet and outlet shall be as shown in [Figure B.3](#).

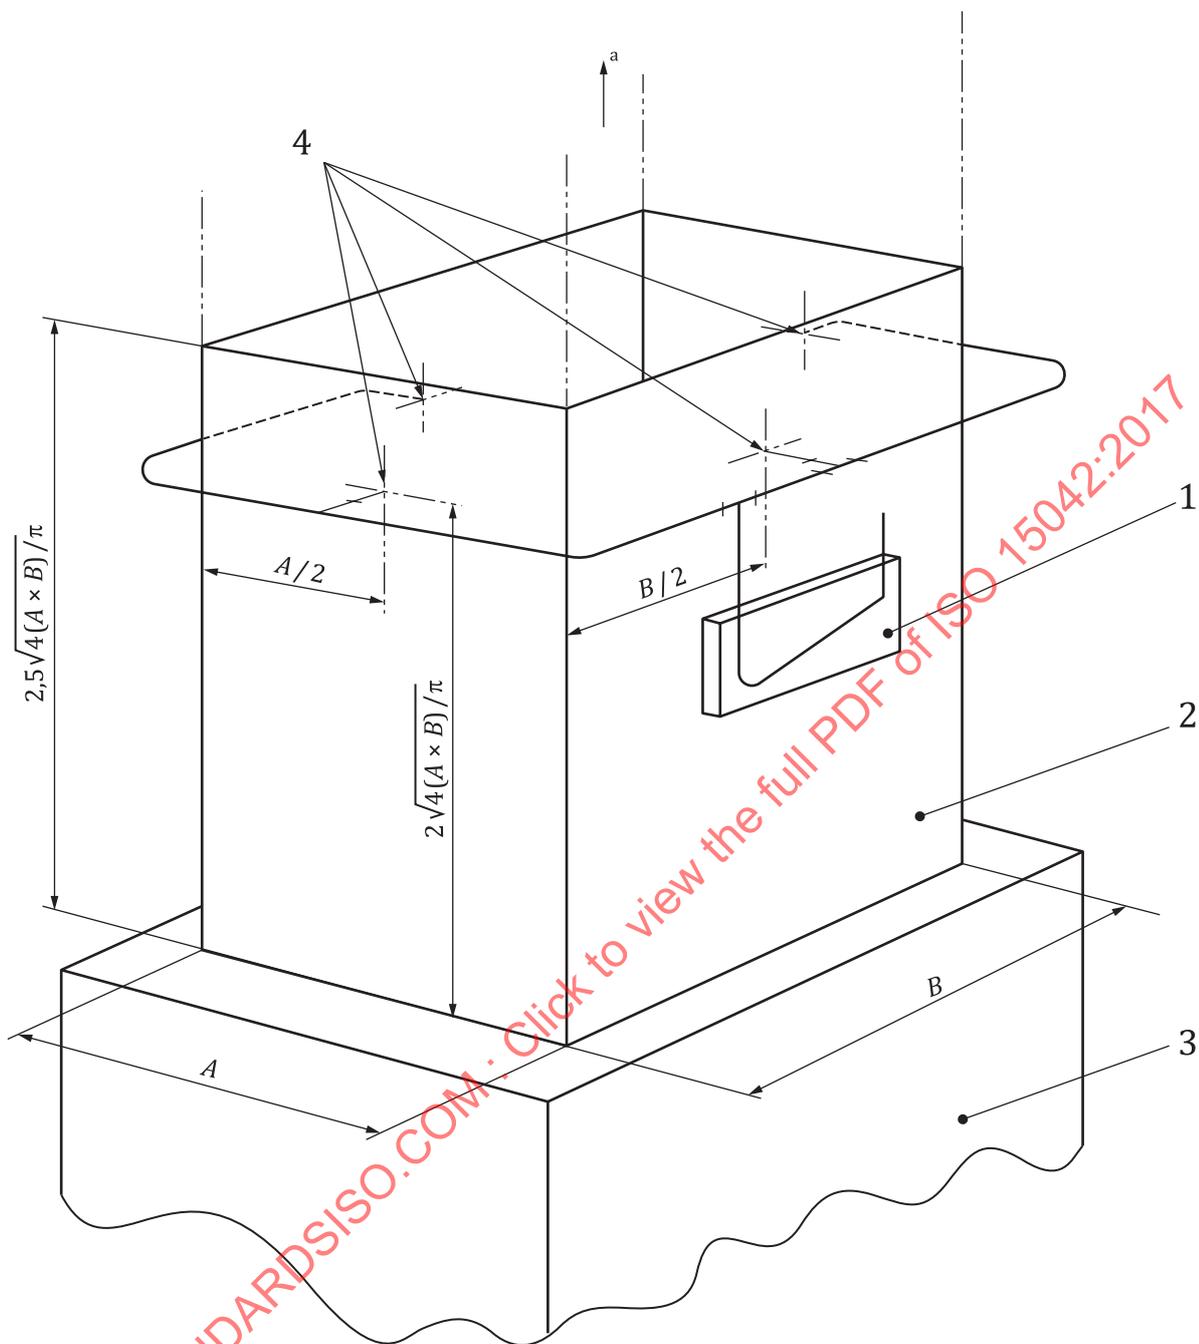



Key

- 1 manometer
- 2 exhaust plenum
- 3 equipment under test
- 4 static pressure taps
- a To airflow measuring apparatus.

NOTE A and B dimensions of equipment under test.

Figure B.1 — ESP measurement— Split system

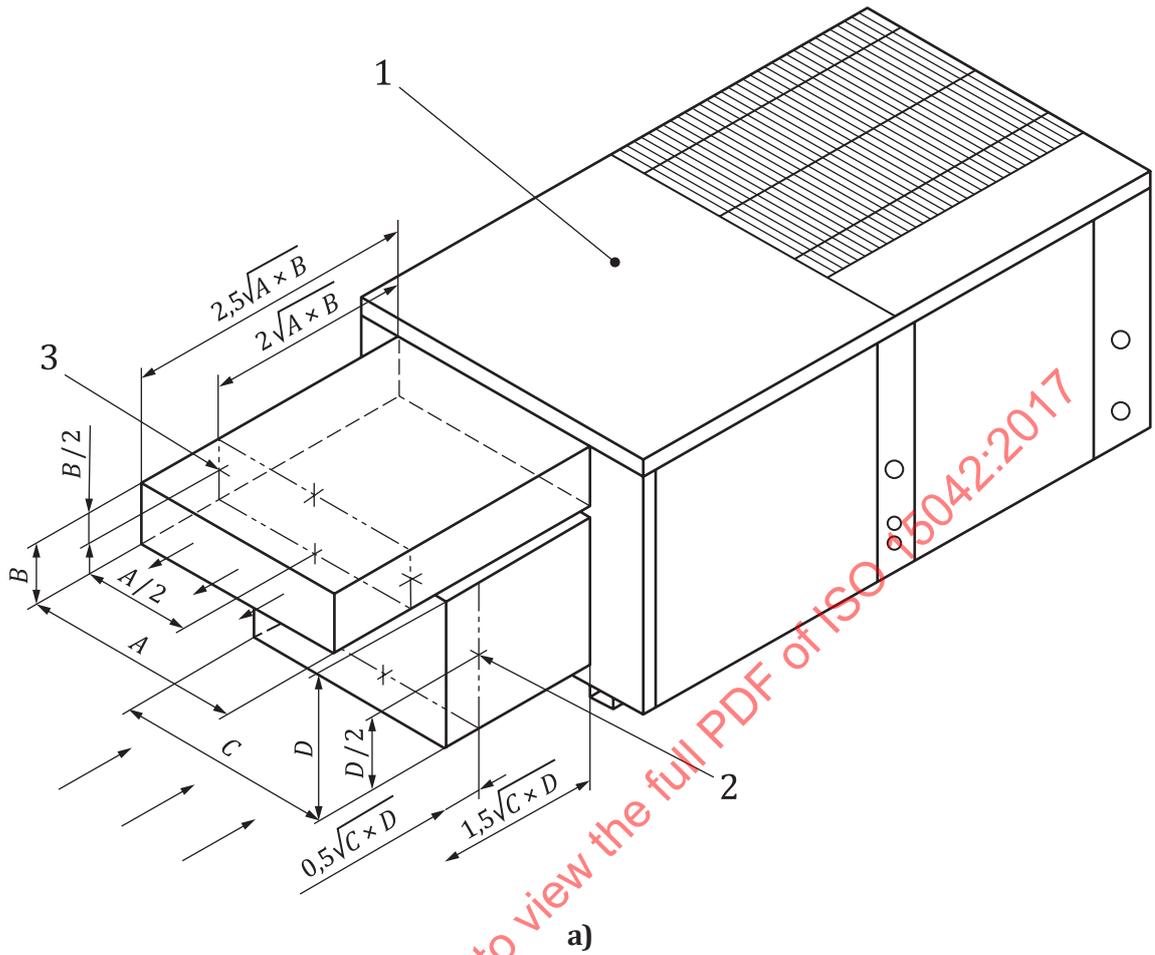

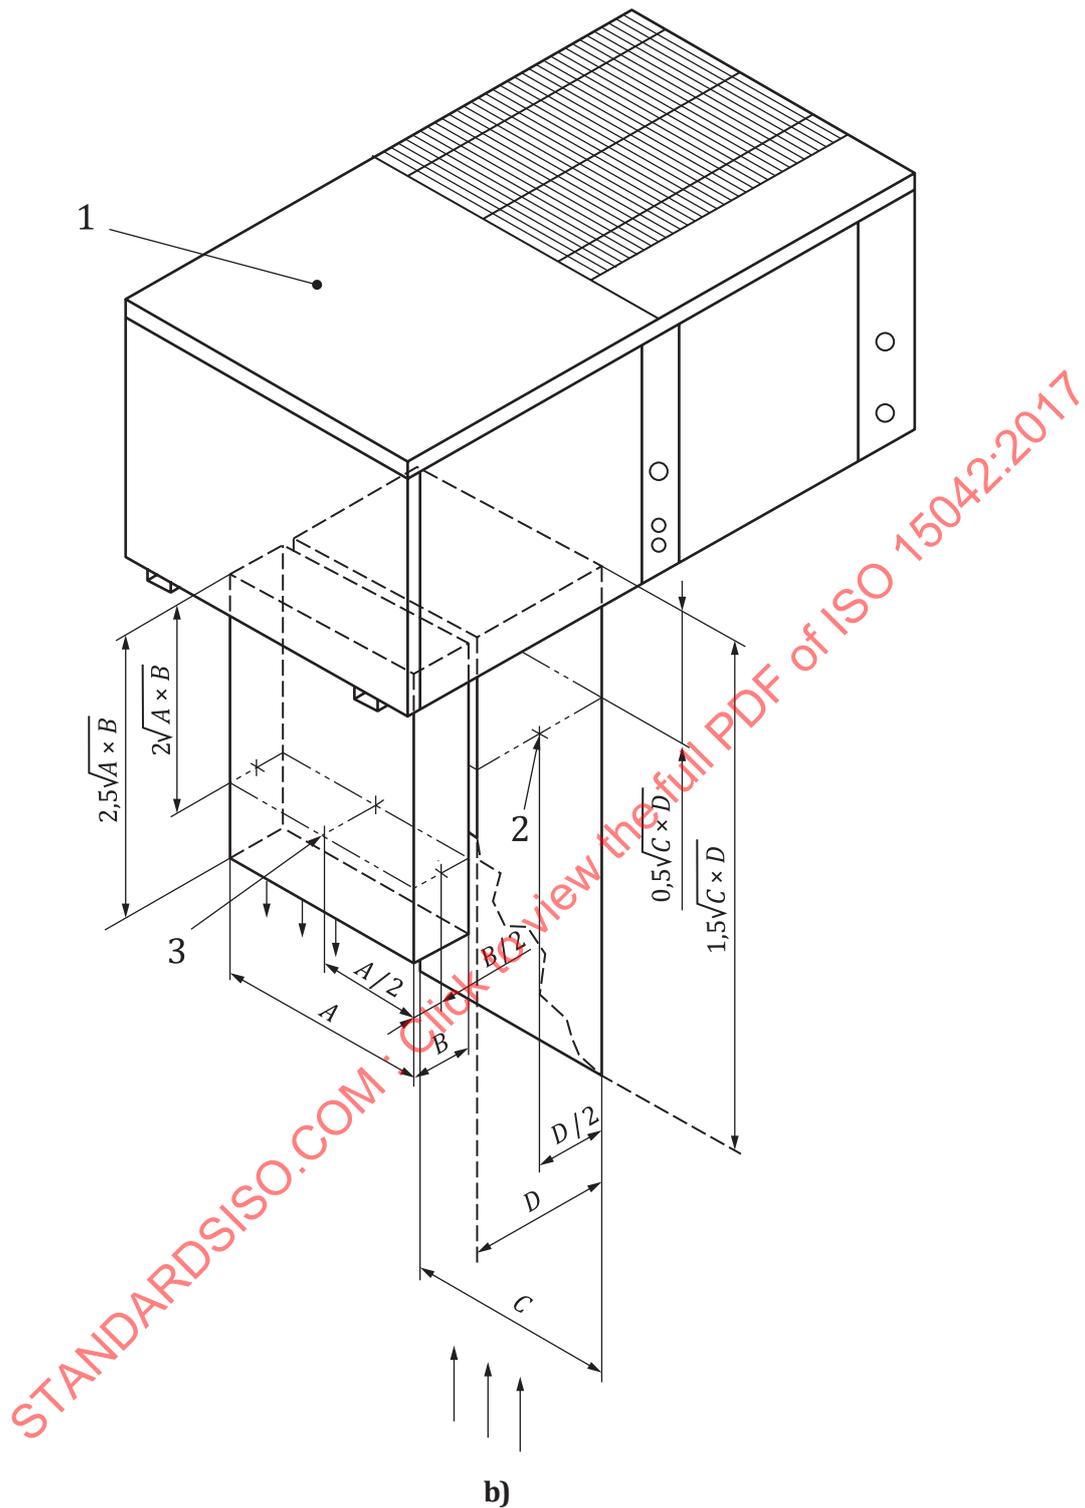


Key

- 1 equipment under test — single package unit
- 2 static pressure tap, inlet (4 required)
- 3 static pressure tap, outlet (4 required)

NOTE For circular ducts with diameter, D , substitute $\pi D^2/4$ for $(A \times B)$ or $(C \times D)$.

Figure B.2 — ESP measurements — Single package

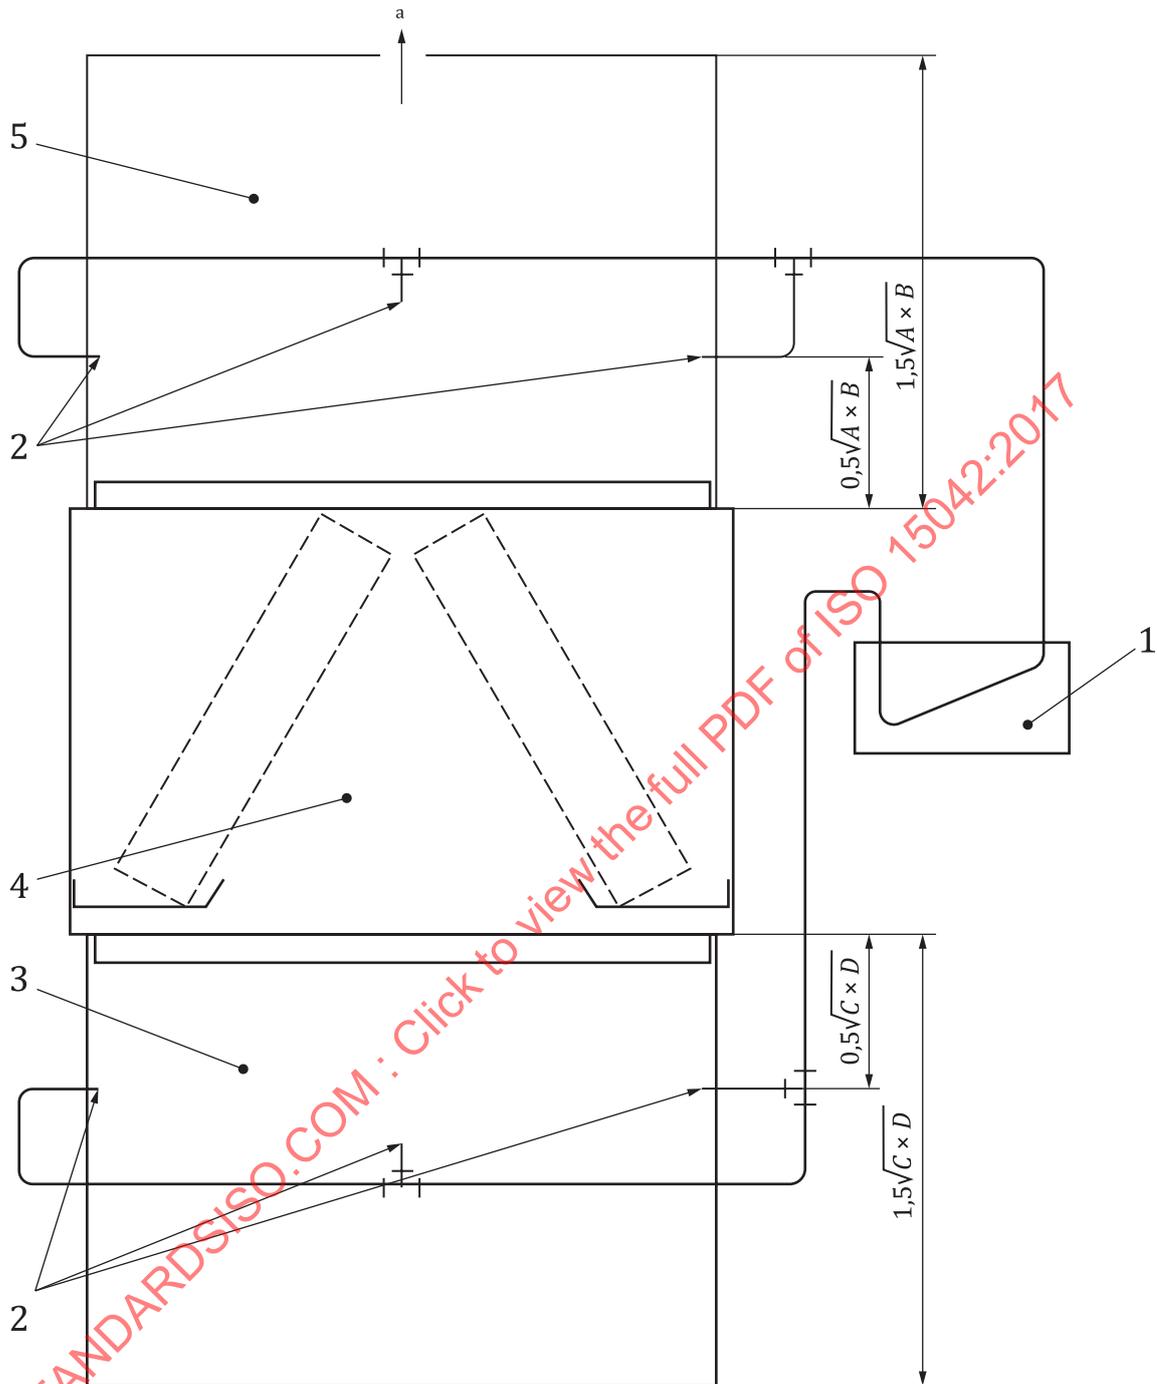

Key

- | | | | |
|---|----------------------|---|---------------------------------|
| 1 | manometer | 4 | coil section |
| 2 | outlet pressure taps | 5 | outlet duct |
| 3 | inlet duct | a | To airflow measuring apparatus. |

NOTE 1 A and B are outlet dimensions, C and D are inlet dimensions.

NOTE 2 For circular ducts with diameter D , substitute $\pi D_i^2/4$ for $(C \times D)$ and $\pi D_o^2/4$ for $(A \times B)$, where D_i is the inlet duct diameter and D_o is the outlet duct diameter.

NOTE 3 The length of the inlet duct, $1,5\sqrt{C \times D}$, is a minimum dimension. For more precise results, use $4\sqrt{C \times D}$.

Figure B.3 — Air-static pressure drop measurement for coil and coil-only unit

STANDARDSISO.COM : Click to view the full PDF of ISO 15042:2017

Annex C (informative)

Airflow measurement

C.1 Airflow determination

C.1.1 Airflow should be measured using the apparatus and testing procedures given in this annex.

C.1.2 Airflow quantities are determined as mass flow rates. If airflow quantities are to be expressed for rating purposes in volume flow rates, such ratings should state the conditions (pressure, temperature and humidity) at which the specific volume is determined.


C.2 Airflow and static pressure

The area of a nozzle, A_n , should be determined by measuring its diameters to an accuracy of $\pm 0,2$ % in four locations approximately 45° apart around the nozzle in each of two places through the nozzle throat, one at the outlet and the other in the straight section near the radius.

C.3 Nozzle apparatus

C.3.1 Nozzle apparatus, consisting of a receiving chamber and a discharge chamber separated by a partition in which one or more nozzles are located (see [Figure C.1](#)). Air from the equipment under test is conveyed via a duct to the receiving chamber, passes through the nozzle(s), and is then exhausted to the test room or channelled back to the equipment's inlet.

The nozzle apparatus and its connections to the equipment's inlet should be sealed such that air leakage does not exceed 1,0 % of the airflow rate being measured.

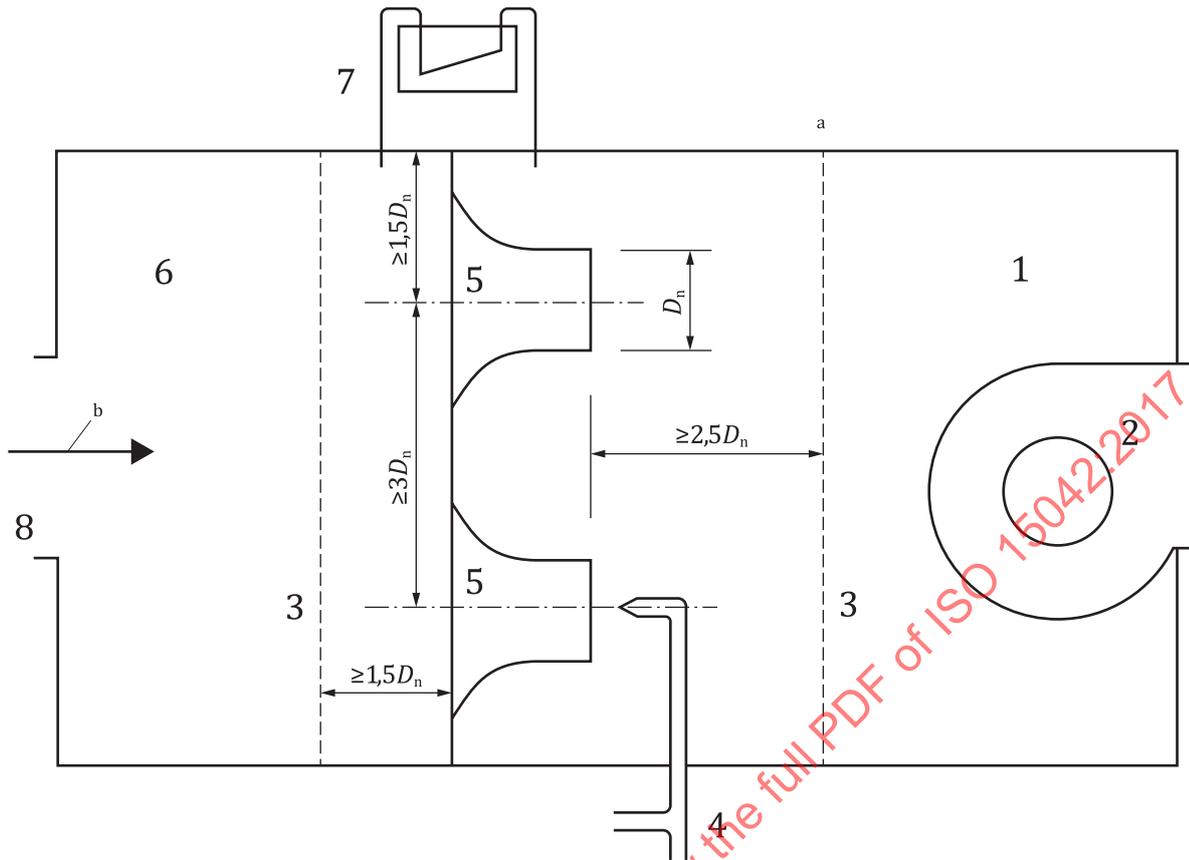

Key

- | | | | |
|---|-----------------------|-------|---|
| 1 | discharge chamber | 7 | apparatus for differential pressure measurement |
| 2 | exhaust fan | 8 | adaptor duct (see C.5.1) |
| 3 | diffusion baffle | D_n | nozzle throat diameter, mm |
| 4 | Pitot tube (optional) | a | Diffusion baffles should have uniform perforations, with approximately 40 % of free area. |
| 5 | nozzle | b | Airflow. |
| 6 | receiving chamber | | |

Figure C.1 — Airflow measuring apparatus

The centre-to-centre distance between nozzles in use should be not less than three times the throat diameter of the larger nozzle, and the distance from the centre of any nozzle to the nearest discharge or receiving chamber side wall should not be less than 1,5 times its throat diameter.

C.3.2 Diffusers, installed in the receiving chamber (at a distance of at least 1,5 times the largest nozzle throat diameter) upstream of the partition wall and in the discharge chamber (at a distance of at least 2,5 times the largest nozzle throat diameter) downstream of the exit plane of the largest nozzle.

C.3.3 Exhaust fan, capable of providing the desired static pressure at the equipment’s outlet; it should be installed in one wall of the discharge chamber and means should be provided to vary the capacity of this fan.

C.3.4 Manometers, for measuring the static pressure drop across the nozzle(s). One end of the manometer should be connected to a static pressure tap located flush with the inner wall of the receiving chamber and the other end to a static pressure tap located flush with the inner wall of the discharge chamber, or, preferably, several taps in each chamber should be connected to several manometers in parallel or manifolded to a single manometer. Static pressure connections should be located so as not to be affected by airflow. Alternatively, the velocity head of the air stream leaving the nozzle(s) may be

measured by a Pitot tube as shown in [Figure C.1](#), but when more than one nozzle is in use, the Pitot tube reading should be determined for each nozzle.

C.3.5 Means for determining the air velocity at the nozzle throat

C.3.5.1 The throat velocity of any nozzle in use should be not less than 15 m/s and not more than 35 m/s.

C.3.5.2 Nozzles should be constructed in accordance with [Figure C.2](#), and applied in accordance with the provisions of [C.3.5.3](#) and [C.3.5.4](#).

C.3.5.3 Nozzle discharge coefficients, C_d , for the construction shown in [Figure C.2](#), which have a throat-length-to-throat-diameter ratio of 0,6, may be determined using [Formula \(C.1\)](#):

$$C_d = 0,9986 - \frac{7,006}{\sqrt{Re}} + \frac{134,6}{Re} \quad (\text{C.1})$$

for Reynolds numbers, Re , of 12 000 and above.

The Reynolds number is defined as in [Formula \(C.2\)](#):

$$Re = \frac{v_a D_n}{\nu} \quad (\text{C.2})$$


where

v_a is the mean airflow velocity at the throat of the nozzle;

D_n is the diameter of the throat of the nozzle;

ν is the kinematic viscosity of air.

C.3.5.4 Nozzles may also be constructed in accordance with appropriate national standards, provided they can be used in the apparatus described in [Figure C.1](#) and result in equivalent accuracy.

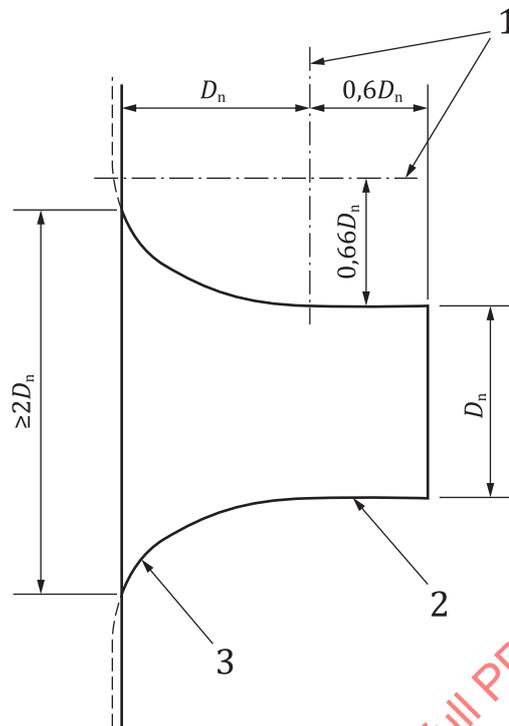

Key

- 1 axes of ellipse
- 2 throat section
- 3 elliptical approach
- D_n diameter of nozzle throat, mm

Figure C.2 — Airflow measuring nozzle

C.4 Static pressure measurements

C.4.1 The pressure taps should consist of $(6,25 \pm 0,25)$ mm diameter nipples soldered to the outer plenum surfaces and centred over 1 mm diameter holes through the plenum. The edges of these holes should be free of burrs and other surface irregularities.

C.4.2 The plenum and duct section should be sealed to prevent air leakage, particularly at the connections to the equipment and the air measuring device, and should be insulated to prevent heat leakage between the equipment outlet and the temperature measuring instruments.

C.5 Discharge airflow measurements

C.5.1 The outlet or outlets of the equipment under test should be connected to the receiving chamber by adapter ducting of negligible air resistance, as shown in [Figure C.1](#).

C.5.2 To measure the static pressure of the receiving chamber, a manometer should have one side connected to one or more static pressure connections located flush with the inner wall of the receiving chamber.

C.6 Indoor-side airflow measurements

C.6.1 The following readings should be taken:

- barometric pressure;
- nozzle dry- and wet-bulb temperatures or dew point temperatures;
- static pressure difference at the nozzle(s) or, optionally, nozzle velocity pressure.

C.6.2 Air mass flow rate, q_m , through a single nozzle is determined using [Formula \(C.3\)](#):

$$q_m = Y \times C_d \times A_n \sqrt{\frac{2p_v}{V'_n}} \quad (\text{C.3})$$

where p_v is the velocity pressure at the nozzle throat or the static pressure difference across the nozzle.

The expansion factor, Y , is obtained using [Formula \(C.4\)](#):

$$Y = 0,452 + 0,548\alpha \quad (\text{C.4})$$

The pressure ratio, α , is obtained using [Formula \(C.5\)](#):

$$\alpha = 1 - \frac{p_v}{p_n} \quad (\text{C.5})$$

Air volume flow rate through a single nozzle is determined using [Formula \(C.6\)](#):

$$q_v = Y \times C_d \times A_n \sqrt{2p_v V'_n} \quad (\text{C.6})$$

where V'_n is calculated using [Formula \(C.7\)](#):

$$V'_n = \frac{v_n}{1 + W_n} \quad (\text{C.7})$$

and W_n is the specific humidity at nozzle inlet.

Air volume flow rate expressed in terms of standard air, q_s , is calculated by [Formula \(C.8\)](#)

$$q_s = \frac{q_v}{1,204v'_n} \quad (\text{C.8})$$

C.6.3 Airflow through multiple nozzles may be calculated in accordance with [C.6.2](#), except that the total flow rate is then the sum of the q_m or q_v values for each nozzle used.


C.7 Ventilation, exhaust and leakage airflow measurements — Calorimeter test method

C.7.1 Ventilation, exhaust and leakage airflows should be measured using apparatus similar to that illustrated in [Figure C.3](#) with the refrigeration system in operation and after condensate equilibrium has been obtained.

C.7.2 With the equalizing device adjusted for a maximum static pressure differential between the indoor-side and outdoor-side test chambers of 1 Pa, the following readings should be taken:

- a) barometric pressure;
- b) nozzle wet- and dry-bulb temperatures;
- c) nozzle velocity pressure.

C.7.3 Airflow values should be calculated in accordance with C.6.2.

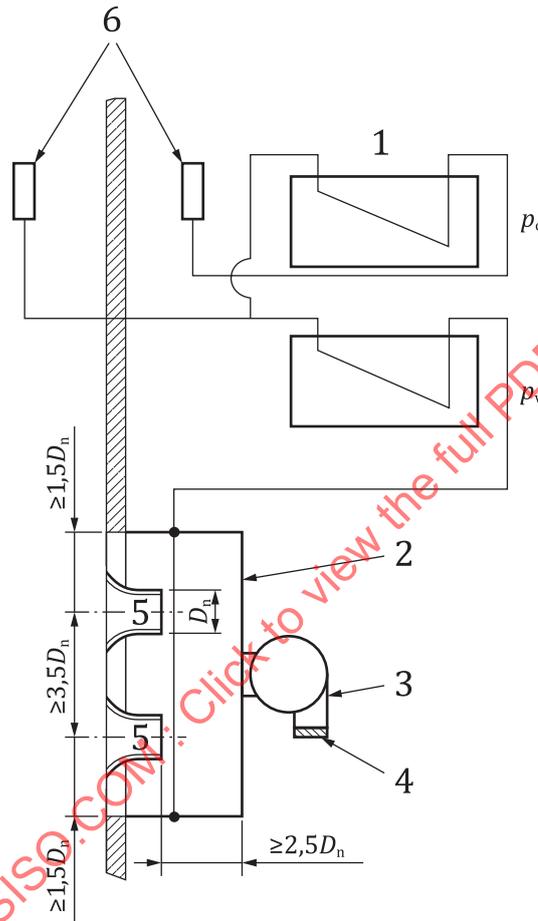

Key

- 1 pressure manometers
- 2 discharge chamber
- 3 exhaust fan
- 4 damper
- 5 nozzle
- 6 pick-up tube
- D_n nozzle throat diameter
- p_c test chamber equalization pressure
- p_v nozzle velocity pressure

Figure C.3 — Pressure-equalizing device

Annex D (normative)

Calorimeter test method

D.1 General

D.1.1 The calorimeter provides a method for determining capacity simultaneously on both the indoor-side and the outdoor side. In the cooling mode, the indoor-side capacity determination should be made by balancing the cooling and dehumidifying effects with measured heat and water inputs. The outdoor-side capacity provides a confirmative test of the cooling and dehumidifying effect by balancing the heat and water rejection on the condenser side with a measured amount of cooling.

D.1.2 The two calorimeter test chambers, indoor-side and outdoor side, are separated by an insulated partition having an opening into which the non-ducted, single-packaged equipment is mounted. The equipment should be installed in a manner similar to a normal installation. No effort should be made to seal the internal construction of the equipment to prevent air leakage from the condenser side to the evaporator side or vice versa. No connections or alterations should be made to the equipment which might in any way alter its normal operation.

D.1.3 A pressure-equalizing device as illustrated in [Figure C.3](#) should be provided in the partition wall between the indoor-side and the outdoor-side test chambers to maintain a balanced pressure between these test chambers and to permit measurement of leakage, exhaust and ventilation air. This device consists of one or more nozzles of the type shown in [Figure C.2](#), a discharge chamber equipped with an exhaust fan, and manometers for measuring test chamber and airflow pressures.

Since the airflow from one test chamber to the other may be in either direction, two such devices mounted in opposite directions or a reversible device should be used. The manometer pressure pick-up tubes should be so located as to be unaffected by air discharged from the equipment or by the exhaust from the pressure-equalizing device. The fan or blower, which exhausts air from the discharge chamber, should permit variation of its airflow by any suitable means, such as a variable speed drive, or a damper as shown in [Figure C.3](#). The exhaust from this fan or blower should be such that it does not affect the inlet air to the equipment.

The pressure equalizing device should be adjusted during calorimeter tests or airflow measurements so that the static pressure difference between the indoor-side and outdoor-side test chambers is not greater than 1,25 Pa.

D.1.4 The size of the calorimeter should be sufficient to avoid any restriction to the intake or discharge openings of the equipment. Perforated plates or other suitable grilles should be provided at the discharge opening of the reconditioning equipment to avoid face velocities exceeding 0,5 m/s. Sufficient space should be allowed in front of any inlet or discharge grilles of the equipment to avoid interference with the airflow. Minimum distance from the equipment to the side walls or ceiling of the test chamber(s) should be 1 m, except for the back of console-type equipment, which should be in normal relation to the wall. Ceiling-mounted equipment should be installed at a minimum distance of 1,8 m from the floor. [Table D.1](#) gives the suggested dimensions for the calorimeter. To accommodate peculiar sizes of equipment, it may be necessary to alter the suggested dimensions to comply with the space requirements.

Table D.1 — Sizes of calorimeter

Rated cooling capacity of equipment ^a W	Suggested minimum inside dimensions of each room of calorimeter		
	m		
	Width	Height	Length
3 000	2,4	2,1	1,8
6 000	2,4	2,1	2,4
9 000	2,7	2,4	3,0
12 000 ^b	3,0	2,4	3,7

^a All figures are round numbers.

^b Larger capacity equipment will require larger calorimeters.

D.1.5 Each test chamber should be provided with reconditioning equipment to maintain specified airflow and prescribed conditions. Reconditioning apparatus for the indoor-side test chamber should consist of heaters to supply sensible heat and a humidifier to supply moisture. Reconditioning apparatus for the outdoor-side test chamber should provide cooling, dehumidification and humidification. The energy supply should be controlled and measured.

D.1.6 When calorimeters are used for heat pumps, they should have heating, humidifying and cooling capabilities for both rooms (see [Figures D.1](#) and [D.2](#)). Other means, such as rotating the equipment, may be used as long as the rating conditions are maintained.

D.1.7 Reconditioning apparatus for both test chambers should be provided with fans of sufficient capacity to ensure airflows of not less than twice the quantity of air discharged by the equipment under test in the calorimeter. The calorimeter should be equipped with means of measuring or determining specified wet- and dry-bulb temperatures in both calorimeter test chambers.

D.1.8 It is recognized that in both the indoor-side and outdoor-side test chambers, temperature gradients and airflow patterns result from the interaction of the reconditioning apparatus and test equipment. Therefore, the resultant conditions are peculiar to, and dependent upon, a given combination of test chamber size, arrangement and size of reconditioning apparatus, and the air discharge characteristics of the equipment under test.


The point of measurement of specified test temperatures, both wet- and dry-bulb, should be such that the following conditions are fulfilled.

- a) The measured temperatures should be representative of the temperature surrounding the equipment, and should simulate the conditions encountered in an actual application for both indoor and outdoor sides, as indicated above.
- b) At the point of measurement, the temperature of air should not be affected by air discharged from any piece of the equipment. This makes it mandatory that the temperatures be measured upstream of any recirculation produced by the equipment.
- c) Air sampling tubes should be positioned on the intake side of the equipment under test.
- d) When testing multi-split air conditioners and heat pumps, temperature of air entering all indoor units or an outdoor unit shall be within 0,5 K of the average.

D.1.9 During a heating capacity test, the temperature of the air leaving the indoor-side of the heat pump shall be monitored to determine if its heating performance is being affected by a build-up of ice on the outdoor-side heat exchanger. A single temperature measuring device, placed at the centre of the indoor-air outlet, will be sufficient to indicate any change in the indoor-air discharge temperature caused by a build-up of ice on the outdoor-side heat exchanger.

D.1.10 Interior surfaces of the calorimeter test chambers should be of non-porous material with all joints sealed against air and moisture leakage. The access door should be tightly sealed against air and moisture leakage by use of gaskets or other suitable means.


D.1.11 If defrost controls on the heat pump provide for stopping the indoor airflow, provision shall be made to stop the test apparatus airflow to the equipment on both the indoor and outdoor sides during such a defrost period. If it is desirable to maintain operation of the reconditioning apparatus during the defrost period, provision may be made to bypass the conditioned air around the equipment as long as assurance is provided that the conditioned air does not aid in the defrosting. A watt-hour meter shall be used to obtain the integrated electrical input to the equipment under test.

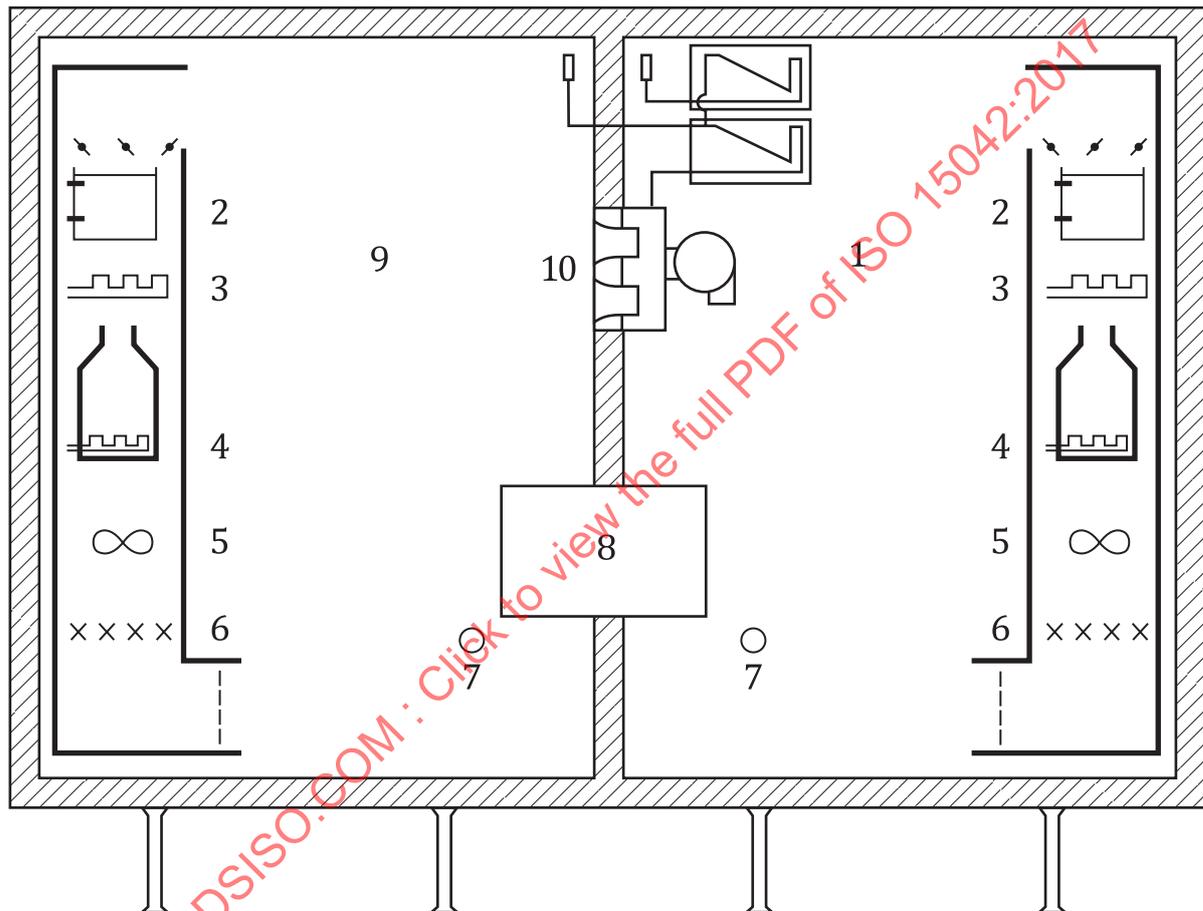

Key

- | | |
|-----------------------------|---------------------------------|
| 1 outdoor-side test chamber | 6 mixer |
| 2 cooling coil | 7 air sampling tube |
| 3 heating coil | 8 equipment under test |
| 4 humidifier | 9 indoor-side test chamber |
| 5 fan | 10 pressure equalization device |

Figure D.1 — Typical calibrated room-type calorimeter

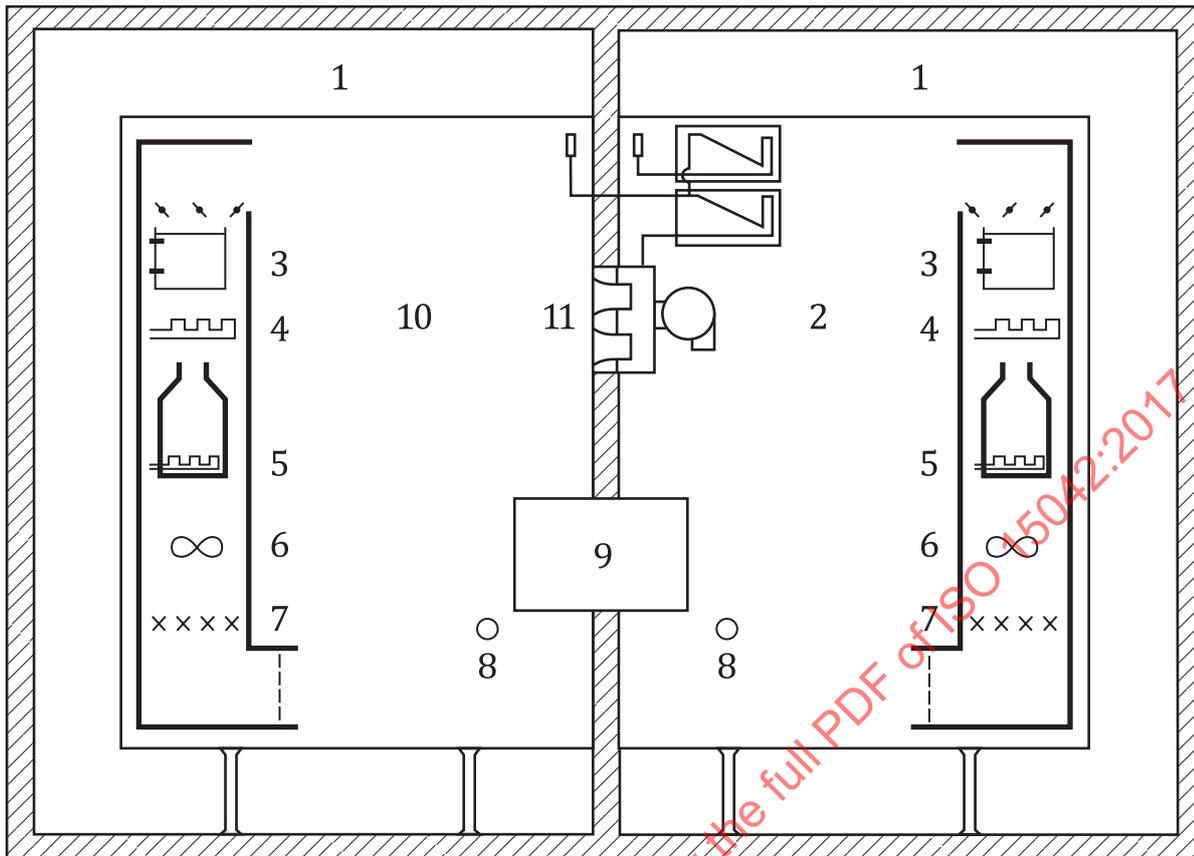

Key

- | | | | |
|---|----------------------------------|----|------------------------------|
| 1 | controlled-temperature air space | 7 | mixer |
| 2 | outdoor-side test chamber | 8 | air sampling tube |
| 3 | cooling coil | 9 | equipment under test |
| 4 | heating coil | 10 | indoor-side test chamber |
| 5 | humidifier | 11 | pressure equalization device |
| 6 | fan | | |

Figure D.2 — Typical balanced ambient room-type calorimeter

D.2 Calibrated room-type calorimeter

D.2.1 Heat leakage may be determined in either the indoor-side or outdoor-side test chamber by the following method. All openings should be closed. Either test chamber may be heated by electric heaters to a temperature of at least 11 K above the surrounding ambient temperature. The ambient temperature should be maintained constant within ± 1 K outside all six enveloping surfaces of the test chamber, including the separating partition. If the construction of the partition is identical to that of the other walls, the heat leakage through the partition may be determined on a proportional area basis.

D.2.2 For calibrating the heat leakage through the separating partition alone, the following procedure may be used. A test is carried out as described above. Then the temperature of the adjoining area on the other side of the separating partition is raised to equal the temperature in the heated test chamber, thus eliminating heat leakage through the partition, while the 11 K differential is maintained between the heated test chamber and the ambient surrounding the other five enveloping surfaces.

The difference in heat input between the first test and second test determines the leakage through the partition alone.

D.2.3 For the outdoor-side test chamber equipped with means for cooling, an alternative means of calibration may be to cool the test chamber to a temperature at least 11 K below the ambient temperature (on six sides) and carry out a similar analysis.

D.2.4 In addition to the two-room simultaneous method of determining capacities, the performance of the indoor room-side test chamber shall be verified at least every six months using an industry standard cooling capacity calibrating device. A calibrating device may also be another equipment whose performance has been measured by the simultaneous indoor and outdoor measurement method at an accredited national test laboratory as part of an industry-wide cooling capacity verification programme.

The indoor-side calorimeter including the central partition and the outdoor-side calorimeter shall be insulated so that heat leakage (including radiation) does not exceed 5 % of the equipment capacity. Space where enough air circulation is available shall be secured under the floor of the room-type calorimeter.

D.3 Balanced ambient room-type calorimeter

D.3.1 The balanced ambient room-type calorimeter is shown in [Figure D.2](#) and is based on the principle of maintaining the dry-bulb temperatures surrounding the particular test chamber equal to the dry-bulb temperatures maintained within that test chamber. If the ambient wet-bulb temperature is also maintained equal to that within the test chamber, the vapour-proofing provisions of [D.1.10](#) are not required.


D.3.2 The floor, ceiling and walls of the calorimeter test chambers shall be spaced a sufficient distance away from the floor, ceiling and walls of the controlled areas in which the test chambers are located in order to provide a uniform air temperature in the intervening space. It is recommended that this distance be at least 0,3 m. Means shall be provided to circulate the air within the surrounding space to prevent stratification.

D.3.3 Heat leakage through the separating partition shall be introduced into the heat balance calculation and may be calibrated in accordance with [D.2.2](#) or may be calculated.

D.3.4 It is recommended that the floor, ceiling and walls of the calorimeter test chambers be insulated so as to limit heat leakage (including radiation) to no more than 10 % of the test equipment's capacity, for an 11 K temperature difference, or 300 W for the same temperature difference, whichever is greater, as tested using the procedure given in [D.2.2](#).

D.4 Calculations for cooling capacities

D.4.1 The energy flow quantities used to calculate the total cooling capacity based on indoor-side and outdoor-side measurements are shown in [Figure D.3](#).

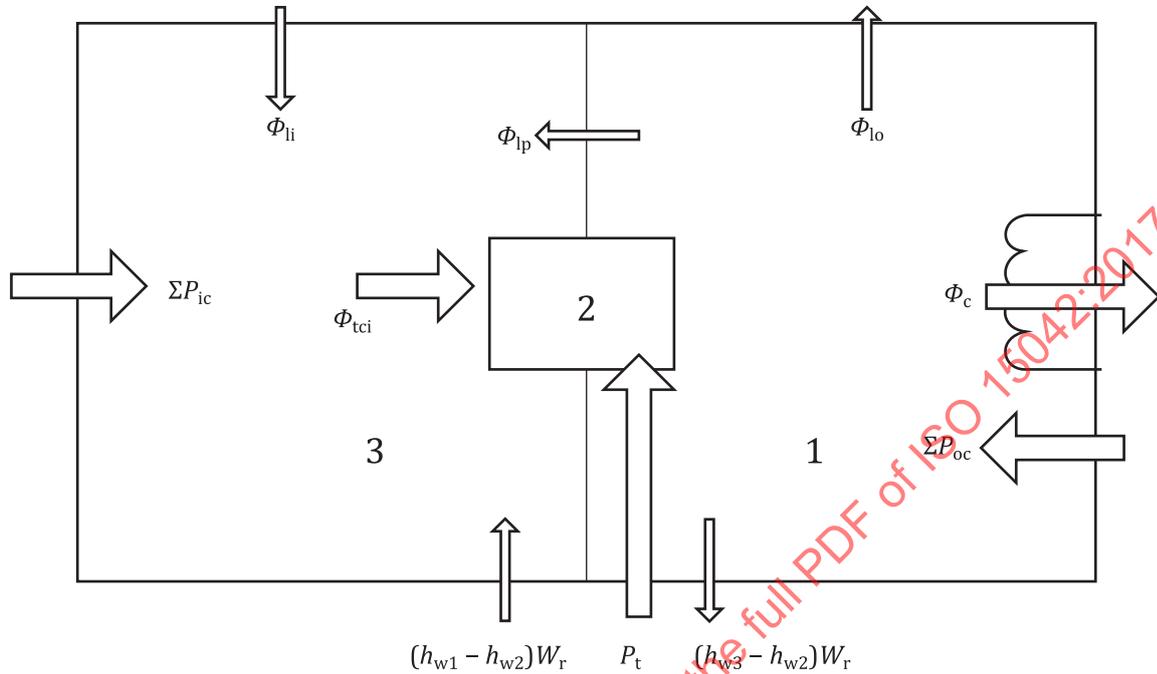

- Key**
- 1 outdoor-side test chamber
 - 2 equipment under test
 - 3 indoor-side test chamber

NOTE Values for the variables identified in the figure are calculated using [Formulae \(D.1\)](#) to [\(D.6\)](#).

Figure D.3 — Calorimeter energy flows during cooling capacity tests

D.4.2 The total cooling capacity on the indoor-side, as tested in either the calibrated- or balanced-ambient room-type calorimeter (see [Figures D.1](#) and [D.2](#)), is calculated using [Formula \(D.1\)](#):

$$\phi_{tci} = \Sigma P_{ic} + (h_{w1} - h_{w2})W_r + \phi_{lp} + \phi_{li} \tag{D.1}$$

NOTE If no water is introduced during the test, h_{w1} is taken at the temperature of the water in the humidifier tank of the conditioning apparatus.

When a cooling coil of the indoor-side calorimeter is used for testing of small capacity units, in order to stabilize the test condition, [Formula \(D.2\)](#) shall be used and requirements for uncertainties of measurements specified in [9.2.2](#) shall be satisfied. ϕ_{ci} in [Formula \(D.2\)](#) is the amount of heat exchanged in the cooling coil of the indoor-side calorimeter.

$$\phi_{tci} = \Sigma P_{ic} + (h_{w1} - h_{w2})W_r + \phi_{lp} + \phi_{li} - \phi_{ci} \tag{D.2}$$

D.4.3 When it is not practical to measure the temperature of the air leaving the indoor-side test chamber to the outdoor-side test chamber, the temperature of the condensate may be assumed to be at the measured or estimated wet-bulb temperature of the air leaving the test equipment.

D.4.4 The water vapour condensed by the equipment under test, W_r , may be determined by the amount of water evaporated into the indoor-side test chamber by the reconditioning equipment to maintain the required humidity.

D.4.5 Heat leakage, ϕ_{lp} , into the indoor-side test chamber through the separating partition between the indoor-side and outdoor-side test chambers may be determined from the calibrating test or, in the case of the balanced-ambient room-type test chamber, may be based on calculations.

D.4.6 The total cooling capacity on the outdoor side, ϕ_{tco} , as tested in either the calibrated- or balanced-ambient room-type calorimeter (see [Figures D.1](#) and [D.2](#)), is calculated using [Formula \(D.3\)](#):

$$\phi_{tco} = \phi_c - \Sigma P_{oc} - P_t + (h_{w3} - h_{w2})W_r + \phi_{lp} + \phi_{lo} \quad (D.3)$$

NOTE The h_{w3} enthalpy is taken at the temperature at which the condensate leaves the outdoor-side test chamber of the reconditioning apparatus.

D.4.7 The heat leakage rate into the indoor-side test chamber through the separating partition, ϕ_{lp} , between the indoor-side and outdoor-side test chambers may be determined from the calibrating test or, in the case of the balanced-ambient room-type test chamber, may be based on calculations.

NOTE This quantity will be numerically equal to that used in [Formula \(D.1\)](#) if, and only if, the area of the separating partition exposed to the outdoor-side is equal to the area exposed to the indoor-side test chamber.

D.4.8 The latent cooling capacity (room dehumidifying capacity), ϕ_d , is calculated using [Formula \(D.4\)](#):

$$\phi_d = K_1 W_r \quad (D.4)$$

D.4.9 The sensible cooling capacity, ϕ_{sci} , is calculated using [Formula \(D.5\)](#):


$$\phi_{sci} = \phi_{tci} - \phi_d \quad (D.5)$$

D.4.10 Sensible heat ratio (SHR) is calculated using the following:

$$\text{SHR} = \phi_{sci} / \phi_{tci} \quad (D.6)$$

D.5 Calculation of heating capacity

D.5.1 The energy flow quantities used to calculate the total heating capacity based on indoor- and outdoor-side measurements are shown in [Figure D.4](#).

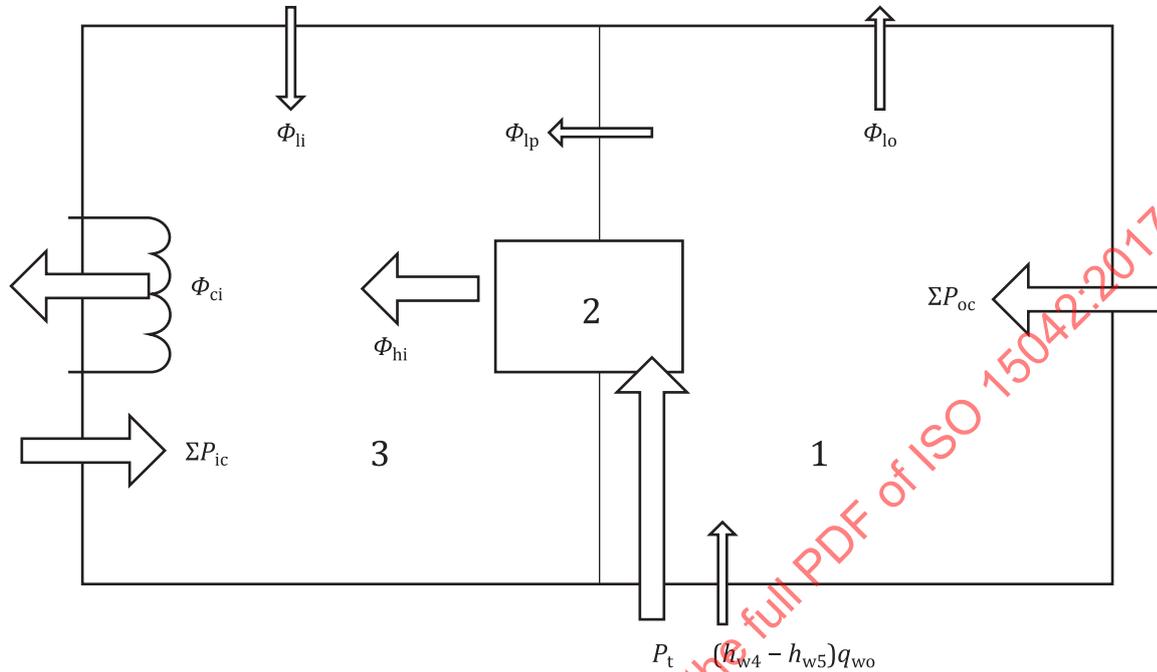

- Key**
- 1 outdoor-side test chamber
 - 2 equipment under test
 - 3 indoor-side test chamber

NOTE Values for the variables identified in this figure are calculated using [Formulae \(D.7\)](#) and [\(D.8\)](#).

Figure D.4 — Calorimeter energy flows during heating capacity tests

D.5.2 Determination of the indoor-side heating capacity by measurement in the indoor-side test chamber of the calorimeter is calculated using [Formula \(D.7\)](#):

$$\phi_{hi} = \phi_{ci} - \Sigma P_{ic} - \phi_{lp} - \phi_{li} \tag{D.7}$$

NOTE ΣP_{ic} is the other power input to the indoor-side test chamber (e.g. illumination, electrical and thermal power input to the compensating device, heat balance of the humidification device), in watts.

D.5.3 Determination of the heating capacity by measurement of the heat-absorbing side, ϕ_{ho} , is calculated for equipment where the evaporator takes the heat from an airflow using [Formula \(D.8\)](#):

$$\phi_{ho} = \Sigma P_{oc} + P_t + (h_{w4} - h_{w5})q_{wo} - \phi_{lp} - \phi_{lo} \tag{D.8}$$

Annex E (normative)

Indoor air enthalpy test method

E.1 General

In the air enthalpy method, capacities are determined from measurements of entering and leaving wet- and dry-bulb temperatures and the associated airflow rate.

E.2 Application

E.2.1 Air leaving the equipment under test shall lead directly to the discharge chamber. If a direct connection cannot be made between the equipment and the discharge chamber, a short plenum shall be attached to the equipment. In this case, the short plenum shall have the same size as the discharge opening of the equipment or shall be constructed so as not to prevent the leaving air from expanding. The cross-section area of the airflow channel through the discharge chamber shall be such that the average air velocity is less than 1,25 m/s against the airflow rate of the equipment under test. The static pressure difference between the discharge chamber and intake opening of the equipment under test shall be zero. An example of the discharge chamber test setup is shown in [Figure E.1](#).

E.2.2 Airflow measurements shall be made in accordance with the provisions specified in [Annex C](#).


NOTE Additional guidance can be found in ISO 3966 and ISO 5167-1, as appropriate, and in the provisions of this annex.

E.2.3 When conducting cooling or steady-state heating capacity tests using the indoor air enthalpy test method, the additional test tolerances given in [Table E.1](#) shall apply.

NOTE The test condition is defined as the measured arithmetical mean of static pressure taken within the first 5 min of the data collection period.


Table E.1 — Variations allowed during steady-state cooling and heating capacity tests that only apply when using the indoor air enthalpy method

Reading	Variation of arithmetical mean values from specified test conditions		Variation of individual readings from specified test conditions	
	≤100 Pa	>100 Pa	≤100 Pa	>100 Pa
External static pressure (ESP)	±0,5 Pa	±5 %	±0,10 Pa	±10 %

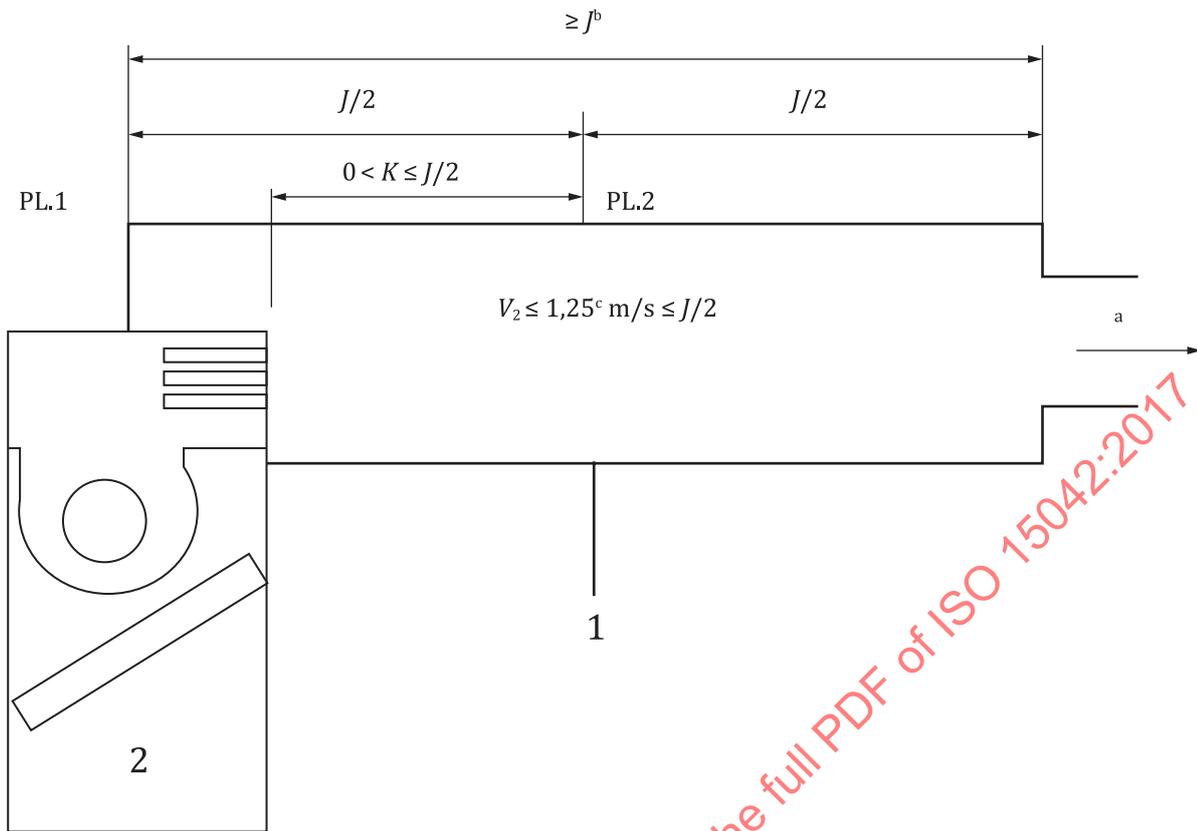

a) For non-ducted equipment

STANDARDSISO.COM : Click to view the full PDF of ISO 15042:2017

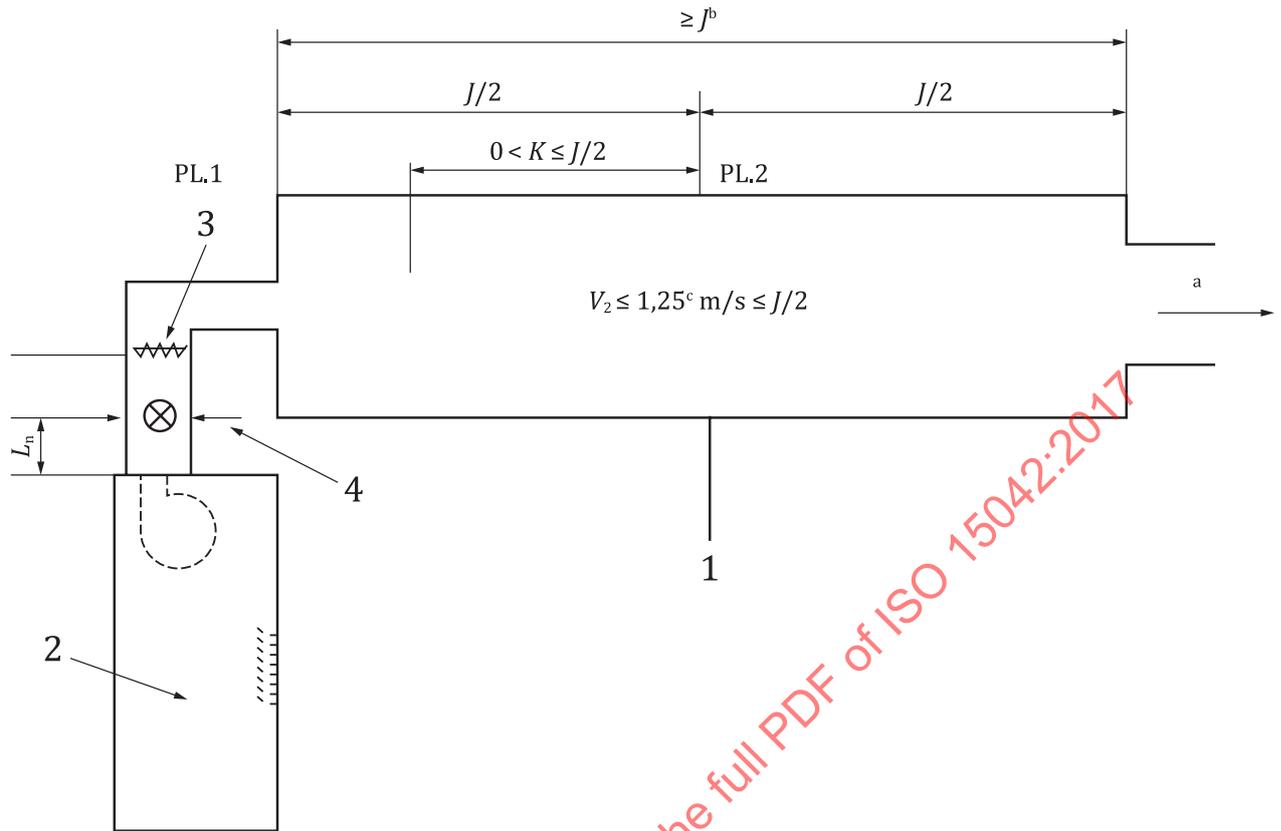

b) For ducted equipment using the fixed duct resistance method

Key

- 1 static pressure tapings
- 2 equipment under test
- 3 damper for Fixed duct resistance method
- 4 external static pressure
- a To air sampler and airflow measuring apparatus.
- b $J = 2D_e$, where $D_e = \sqrt{4AB/\pi}$ and A and B are dimensions of the equipment's outlet.
- c V_2 is the average air velocity at PL.2.

Figure E.1 — Discharge chamber requirements when using the indoor air enthalpy test method

E.2.4 When conducting transient heating capacity tests using the indoor air enthalpy test method, the additional test tolerances given in [Table E.2](#) shall apply.

When testing multi-split air conditioners and heat pumps, temperature of air entering all indoor units or an outdoor unit shall be within 0,5 K of the average.

Table E.2 — Variations allowed during the transient heating tests that only apply when using the indoor air enthalpy test method

Reading	Variations of arithmetical mean values from specified test conditions		Variation of individual readings from specified test conditions	
	Interval H ^a	Interval D ^b	Interval H ^a	Interval D ^b
External resistance to airflow	±5 Pa	—	±5 Pa	—

NOTE For transient heating tests, see 7.1.11.

^a Applies when the heat pump is in the heating mode, except for the first 10 min after termination of a defrost cycle.

^b Applies during a defrost cycle and during the first 10 min after the termination of a defrost cycle when the heat pump is operating in the heating mode.

E.3 Calculations for cooling capacities

The total capacity based on the indoor-side test data, ϕ_{tci} , shall be calculated using [Formula \(E.1\)](#):

$$\phi_{tci} = \frac{q_{vi} (h_{a1} - h_{a2})}{V_n} = \frac{q_{vi} (h_{a1} - h_{a2})}{V'_n (1 + W_n)} \quad (E.1)$$

The sensible cooling capacity based on the indoor-side test data, ϕ_{sci} , shall be calculated using [Formula \(E.2\)](#):

$$\phi_{sci} = \frac{q_{vi} (c_{pa1} t_{a1} - c_{pa2} t_{a2})}{V_n} = \frac{q_{vi} (c_{pa1} t_{a1} - c_{pa2} t_{a2})}{V'_n (1 + W_n)} \quad (E.2)$$

The latent cooling capacity based on the indoor-side test data, ϕ_d , shall be calculated using [Formula \(E.3\)](#) or [Formula \(E.4\)](#):

$$\phi_d = \frac{K_1 q_{vi} (W_{i1} - W_{i2})}{V_n} = \frac{K_1 q_{vi} (W_{i1} - W_{i2})}{V'_n (1 + W_n)} \quad (E.3)$$

$$\phi_d = \phi_{tci} - \phi_{sci} \quad (E.4)$$

E.4 Calculations for heating capacities

Total heating capacity based on indoor-side data, ϕ_{thi} , shall be calculated using [Formula \(E.5\)](#):

$$\phi_{thi} = \frac{q_{vi} (c_{pa2} t_{a2} - c_{pa1} t_{a1})}{V_n} = \frac{q_{vi} (c_{pa2} t_{a2} - c_{pa1} t_{a1})}{V'_n (1 + W_n)} \quad (E.5)$$


NOTE 1 C_{pa1} can be equal to C_{pa2} .

[Formulae \(E.1\)](#), [\(E.2\)](#), [\(E.3\)](#) and [\(E.5\)](#) do not take into consideration heat leakage in the test duct and the discharge chamber. It is recommended to include correction for heat loss from receiving chamber and/or connecting ducts.

E.5 Airflow enthalpy measurements

The following test apparatus arrangements are recommended.

inlet (see [Figure E.3](#)). The resulting test “loop” shall be sealed so that air leakage at places that would influence capacity measurements does not exceed 1,0 % of the test airflow rate. The dry-bulb temperature of the air surrounding the equipment shall be maintained within $\pm 3,0$ K of the desired test inlet dry-bulb temperature. Wet- and dry-bulb temperatures and external resistance are to be measured by suitable means.

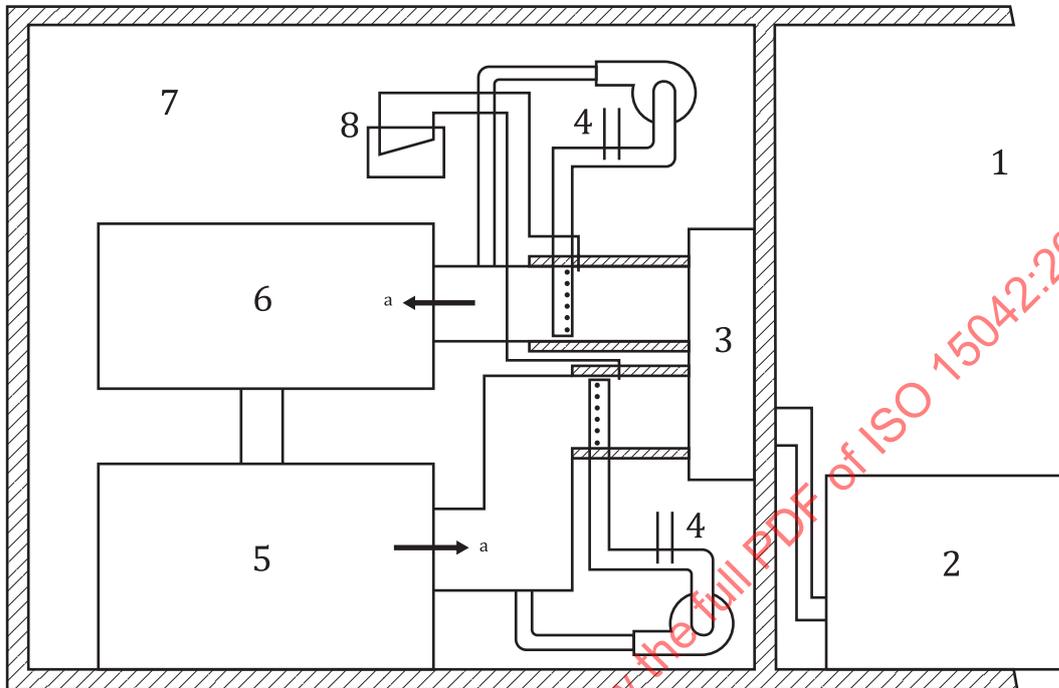


Key

- | | |
|--|---|
| 1 outdoor-side test room | 5 reconditioning apparatus |
| 2 outdoor unit of equipment under test | 6 airflow measuring apparatus |
| 3 indoor unit of equipment under test | 7 indoor-side test room |
| 4 temperature and humidity measuring instruments | 8 apparatus for differential pressure measurement |
| a Airflow. | |

Figure E.3 — Loop air enthalpy test method arrangement

E.5.3 Calorimeter air enthalpy method

For equipment in which the compressor is ventilated independently of the indoor air stream, the calorimeter air enthalpy method arrangement shall be employed to take into account compressor heat radiation (see [Figure E.4](#)). In this arrangement, an enclosure is placed over the equipment, or applicable part of the equipment, under test. This enclosure may be constructed of any suitable material, but shall be non-hygroscopic, airtight and preferably insulated. It shall be large enough to permit inlet air to circulate freely between the equipment and the enclosures and in no case shall the enclosure be closer than 150 mm to any part of the equipment. The inlet to the enclosure shall be remotely located from the equipment’s inlet so as to cause circulation throughout the entire enclosed space. An air measuring device is to be connected to the equipment’s discharge. This device shall be well insulated where it passes through the enclosed space. Wet- and dry-bulb temperatures of the air entering the equipment are to be measured at the enclosure inlet. Temperature and external resistance measurements shall be carried out by suitable means.

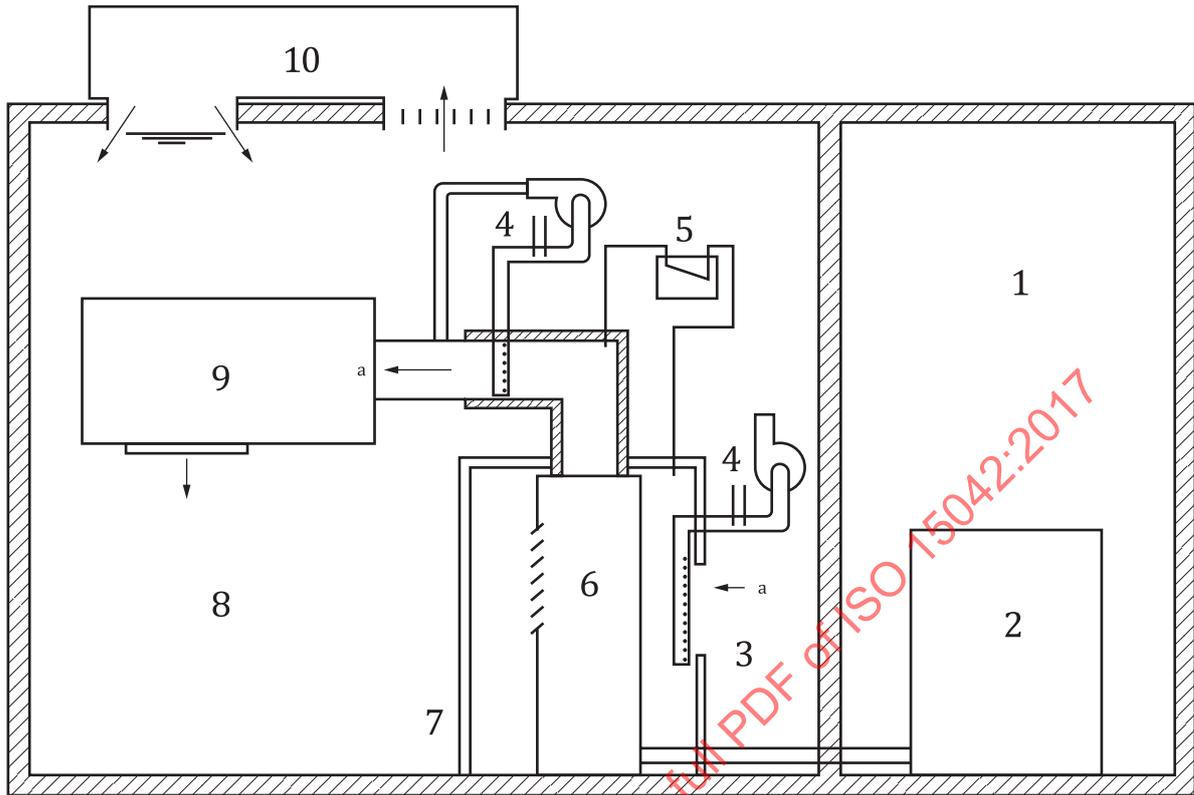**Key**

- | | | | |
|---|--|----|--|
| 1 | outdoor-side test room | 6 | indoor-side coil section of equipment under test |
| 2 | outdoor unit of equipment under test | 7 | enclosure |
| 3 | air inlet | 8 | indoor-side test room |
| 4 | air temperature and humidity measuring instruments | 9 | airflow measuring apparatus |
| 5 | apparatus for differential pressure measurement | 10 | room conditioning apparatus |
| a | Airflow. | | |

Figure E.4 — Calorimeter air enthalpy test method arrangement

Annex F (informative)

Part-load capacity tests and determination of energy efficiency ratios and coefficients of performance

F.1 General

Part-load capacities and energy efficiency ratios or coefficients of performance are determined in accordance with the provisions specified in [6.1.1](#) and [7.1.1](#), except that the capacity ratio of indoor units to outdoor units shall be 0,5 ($\pm 5\%$), by switching off indoor units using the controls provided, if the arrangement of indoor units allows; if not, an alternative ratio shall be selected.

NOTE Other part-load capacities and energy efficiency ratios or coefficients of performance can be determined, if required, at capacity ratios different from 0,5.

F.2 Temperature conditions

Temperature conditions shall be as specified in [Table 2](#) for the cooling test. The heating test shall be conducted at 7 °C dry-bulb and 6 °C wet-bulb outdoor-side conditions and 20 °C dry-bulb and 15 °C wet-bulb indoor-side conditions.

F.3 Airflow conditions

Airflow conditions shall be as specified in [Clause 5](#).

F.4 Test conditions

Test conditions shall be as specified in [6.1.3](#) and [7.1.4](#) to [7.1.12](#).

F.5 Selection of units

The modular multi-split system shall be selected so that one or a combination of indoor units can be utilized to give the part-load capacity required in [6.1.1.3](#) and [7.1.1.4](#).

F.6 Test methods and uncertainty of measurement

Test methods and uncertainty of measurement shall be as specified in [Clause 9](#).

F.7 Test results

Test results shall be recorded and expressed as specified in [Clause 10](#).

F.8 Published ratings

The publication of part-load ratings and energy efficiency ratios or coefficients of performance shall be as specified in [Clause 12](#).

Annex G (informative)

Individual indoor unit capacity tests

G.1 General

The test methods described provide means to determine the capacity of an individual indoor unit, either operating on its own with the other indoor units switched off, or with all indoor units operating.

All tests shall be made in accordance with the requirements of [Annex B](#).

G.2 The calorimeter method

If measurements are made by the calorimeter method, then the testing of an individual unit, with all others operating, will require at least a three-room calorimeter test facility. If only one unit is operating, a two-room calorimeter will suffice. Each calorimeter shall satisfy requirements described in [Annex D](#).

G.3 The air enthalpy method

G.3.1 If measurements are made by the air enthalpy method, then the testing shall be done with one or more indoor rooms and one or more air measuring devices connected to the indoor units. The outdoor unit shall be situated at least in an environmental test room.

G.3.2 The test facility shall satisfy the requirements described in [Annex E](#), except that the individual indoor unit to be tested shall have its own plenum and airflow measuring device.

G.4 Temperature conditions

Temperature conditions shall be as specified in [6.1.2](#) and [7.1.2](#).

G.5 Airflow conditions

All air quantities shall be as specified in [Clause 5](#).

G.6 Test conditions

Test conditions shall be as specified in [6.1.3](#) and from [7.1.4](#) to [7.1.11](#).

G.7 Test methods and uncertainty of measurement

Test methods and uncertainty of measurement shall be as specified in [Clause 9](#).

G.8 Test results

Test results shall be recorded and expressed as specified in [Clause 10](#).

G.9 Published ratings

The publication of individual capacities of indoor units shall be as specified in [Clause 12](#). The published results shall specify if all indoor units are operating or only one indoor unit is operating during the test.

STANDARDSISO.COM : Click to view the full PDF of ISO 15042:2017

Annex H (normative)

Heat recovery test method

H.1 General

The test methods described provide means to determine the total capacity of a heat recovery system as required in [Clause 8](#).

H.2 Three-room calorimeter method

H.2.1 If measurements are made by the calorimeter method, then the testing of a heat recovery system shall need a three-room calorimeter test facility. The indoor units in the cooling mode shall be assembled in one room and the indoor units in the heating mode in the other. The outdoor unit shall be installed in the third room.

H.2.2 Each of the calorimeter rooms shall satisfy the requirements described in [Annex D](#).

H.2.3 For the results to be valid, the sum of the cooling capacity of the indoor units (see [D.4.2](#)) and the power input to the compressor and any fans shall differ by not more than 4 % from the sum of the heating capacity of the indoor units (see [D.5.2](#)) and the heat from the outdoor unit. The heat from the outdoor unit may be negative if the unit is absorbing heat (see [D.5.3](#)), or positive if the unit is rejecting heat (see [D.4.6](#)).

H.3 Three-room air enthalpy method

H.3.1 The indoor units in the cooling mode shall be assembled in one room and the indoor units in the heating mode in another room. The outdoor unit shall be installed in the third room.

H.3.2 The test facility shall satisfy the requirements described in [Annex E](#).

H.4 Two-room air enthalpy method

H.4.1 All indoor units, operating either in cooling or heating mode, are assembled in one indoor room. The outdoor unit shall be installed in the other room.

H.4.2 All units operating in the heating mode shall be connected to a common plenum, all units operating in the cooling mode shall be connected to another common plenum, both in accordance with the requirements established in [Annex E](#).

H.5 Test results

Test results shall be recorded and expressed as specified in [Clause 10](#).

H.6 Published ratings

The publication of individual capacities of indoor units shall be as specified in [Clause 12](#).

Annex I (informative)

Refrigerant enthalpy test method

I.1 General

I.1.1 In this method, capacity is determined from the refrigerant enthalpy change and flow rate. Enthalpy changes are determined from measurements of entering and leaving pressures and temperatures of the refrigerant, and the flow rate is determined by a suitable flow meter in the liquid line.

I.1.2 This method may be used for tests of equipment in which the refrigerant charge is not critical and where normal installation procedures involve the field connection of refrigerant lines.

I.1.3 This method should neither be used for tests in which the refrigerant liquid leaving the flow meter is sub-cooled less than 2,0 K nor for tests in which the superheat of the vapour leaving the indoor-side is less than 3,0 K.

I.1.4 Cooling and heating capacities obtained by the refrigerant enthalpy method should include the thermal effects of the fan.

I.2 Refrigerant flow method

I.2.1 The refrigerant flow rate should be measured with an integrating-type flow meter connected in the liquid line upstream of the refrigerant control device. This meter should be sized such that its pressure drop does not exceed the vapour pressure change that a 2,0 K temperature change would produce.

I.2.2 Temperature and pressure measuring instruments and a sight glass should be installed immediately downstream of the meter to determine if the refrigerant liquid is adequately sub-cooled. Sub-cooling of 2,0 K and the absence of any vapour bubbles in the liquid leaving the meter are considered adequate. It is recommended that the meter be installed at the bottom of a vertical downward loop in the liquid line to take advantage of the static head of the liquid thus provided.

I.2.3 At the end of the test, a sample of the circulating refrigerant and oil mixture may be taken from the equipment and its percentage of oil, X_o , calculated using [Formula \(I.1\)](#):

$$X_o = \frac{W_5 - W_1}{W_3 - W_1} \quad (I.1)$$

The total indicated flow rate should be corrected for the amount of oil circulating.

I.3 Refrigerant temperature and pressure measurements

The temperature of the refrigerant entering and leaving the indoor-side of the equipment should be measured with instruments having an accuracy of $\pm 0,1$ K. The pressure of the refrigerant entering and leaving the indoor-side of the equipment should be measured with instruments having an accuracy of $\pm 2,0$ % of the indicated value.

I.4 Calculation of cooling capacity

The total cooling capacity, ϕ_{tci} , based on volatile refrigerant flow data is calculated using [Formula \(I.2\)](#):

$$\phi_{\text{tci}} = X_{\text{r}} q_{\text{ro}} (h_{\text{r2}} - h_{\text{r1}}) - P_{\text{i}} \quad (\text{I.2})$$

I.5 Calculation of heating capacity

The total heating capacity, ϕ_{thi} , based on volatile refrigerant flow data is calculated using [Formula \(I.3\)](#):

$$\phi_{\text{thi}} = X_{\text{r}} q_{\text{ro}} (h_{\text{r1}} - h_{\text{r2}}) + P_{\text{i}} \quad (\text{I.3})$$

STANDARDSISO.COM : Click to view the full PDF of ISO 15042:2017