

First edition  
2001-09-15

**AMENDMENT 1**  
2019-05

---

---

**Nuclear facilities — Ventilation  
penetrations for shielded enclosures**

**AMENDMENT 1**

*Installations nucléaires — Traversées de ventilation pour enceintes  
blindées*

*AMENDEMENT 1*

STANDARDSISO.COM : Click to view the full PDF of ISO 15080:2001/Amd 1:2019



Reference number  
ISO 15080:2001/Amd.1:2019(E)

© ISO 2019

STANDARDSISO.COM : Click to view the full PDF of ISO 15080:2001/Amd 1:2019



**COPYRIGHT PROTECTED DOCUMENT**

© ISO 2019

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
CP 401 • Ch. de Blandonnet 8  
CH-1214 Vernier, Geneva  
Phone: +41 22 749 01 11  
Fax: +41 22 749 09 47  
Email: [copyright@iso.org](mailto:copyright@iso.org)  
Website: [www.iso.org](http://www.iso.org)

Published in Switzerland

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see [www.iso.org/directives](http://www.iso.org/directives)).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see [www.iso.org/patents](http://www.iso.org/patents)).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see [www.iso.org/iso/foreword.html](http://www.iso.org/iso/foreword.html).

This document was prepared by This document was prepared by ISO/TC 85, *Nuclear energy, nuclear technologies, and radiological protection*, Subcommittee SC 2, *Radiological protection*.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at [www.iso.org/members.html](http://www.iso.org/members.html).

STANDARDSISO.COM : Click to view the full PDF of ISO 15080:2001/Amd 1:2019

# Nuclear facilities — Ventilation penetrations for shielded enclosures

## AMENDMENT 1

### Clause 2

Delete ISO 3452, *Non-destructive testing — Penetrant inspection — General principles*.

### 4.2, third and fourth paragraph

Replace the paragraphs with the following:

“Where the ventilation duct penetrates the wall in a zigzag, the duct-mounting appliance shall be enclosed in a material providing the same level of protection as the shielding wall. The material should be at least three times denser than the wall, if it is made in concrete with an usual density (for example between 2,2 t/m<sup>3</sup> and 2,4 t/m<sup>3</sup>) (see Figure 2).

Annex C gives other examples of conventional duct penetrations for shielded enclosures.

These rules are applied to cast-iron screws for protection against gamma radiation with an 0,5 MeV < energy < 2,5 MeV (1 MeV = 1,6 10<sup>-13</sup> J) used for the reconstitution of the shielding properties of the walls.

All these calculations have to be verified by radiological protection calculation, in order to validate the effectiveness of the reconstitution of the shielding properties, in particular to cover other energies or concrete density.”

### 4.3.1, second paragraph

Replace the paragraph with the following:

“The helixes are made from a metallic material (examples for the helix unit can be the use of a lamellar graphite cast iron or spheroidal graphite cast iron as a result of a preliminary material study, stainless steel,...).

NOTE The consideration of this paragraph doesn't apply for neutron shielding.”

### 4.3.2

Replace the text with the following:

“Because of their helical shape, these protection helixes can ensure the following:

- a) shielding continuity with an attenuation against gamma radiation equivalent to that of the wall to be penetrated;
- b) the passage of air or gas through the wall with the creation of a pressure drop as low as possible.

The design of the additional protection in order to reconstitute protection equivalent to straight through passages shall be conducted on a case-by-case basis.”

4.3.3, third paragraph

Replace the paragraph with the following:


“The helix is fastened to the housing with pins or by mechanical means (threaded fastenings). The number and the size of the pins are determined according to load calculations (seismic event, fire, overpressure ...).”

Figure 4

After subtitle a), add the following text:

“In order to avoid deposit of aerosol contamination, the handling screw hole should be filled”.

Subfigure b), replace the figure and the key with the following.

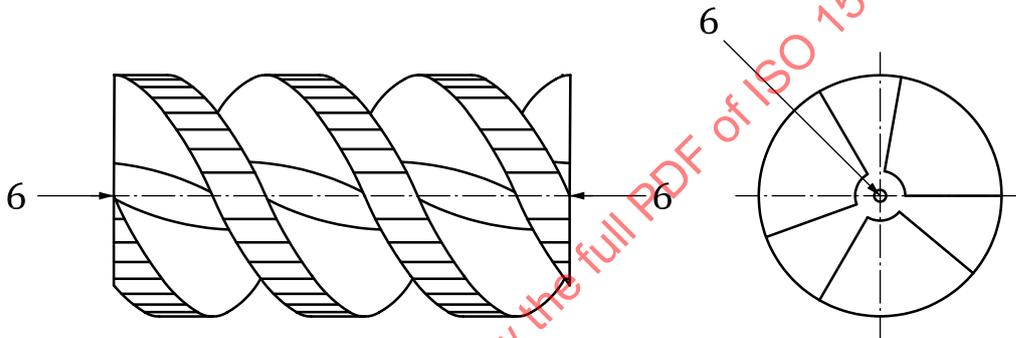

“Key

- 1 pin
- 2 housing
- 3 helix
- 4 flange
- 5 blind nuts
- 6 handling screws”

4.3.4.2, second bullet list

Replace the text with the following:

“whose average density is usually between of 2,2 t/m<sup>3</sup> and 2,4 t/m<sup>3</sup> so that the helix length is greater than the wall thickness.”

A.1.1

Replace the text with the following:

“For the essential factors such as mechanical resistance, machining, homogeneity and radiation attenuation behaviour, the use of cast iron with lamellar graphite of grade EN-GJL-200 according to EN 1561 (Europe) or HT200 (China) or FC200 (Japan) or grade 30B for ASTM A-48 (USA) is recommended for the helix unit.”

A.1.2, first and second paragraphs

Replace the text with the following:

“The housings and flanges are generally made of non-alloy carbon steel, or of austenitic stainless steel, depending on the gamma radiation level inside the enclosure. The grade shall be resistant to the corrosive characteristics of the air or the gas carried and chosen in accordance with the internal covering of the enclosure.

The housings are produced entirely by a mechanical-welded process. The welds shall be continuous, perfectly penetrated and caulked. The welders shall be trained and qualified professionals in accordance with the jurisdictional requirements of the facility using the components. In the absence of such requirements, ISO 9606-1 may be used.”

A.2.2

Replace the text and Table A.1 with the following:

“The normal dimensions of cast iron helixes and recommendation for dimensions of flanges are given in Table A.1.

**Table A.1 — Standardized dimensions of cast iron helixes**

Description		Type Ø 300	Type Ø 500	Type Ø 750
<b>Helix</b> (in cast iron)	Nominal diameter	300 mm	500 mm	750 mm
	Standard length, multiple of	100 mm	100 mm	100 mm
	Theoretical minimum length to be installed	450 mm <sup>a</sup>	600 mm	800 mm
	Maximum length advised	2 200 mm	2 200 mm	2 200 mm
	Pitch of helix	600 <sup>+2</sup> <sub>0</sub> mm	800 <sup>+2</sup> <sub>0</sub> mm	1 000 <sup>+2</sup> <sub>0</sub> mm
	Number of threads at L <sub>min</sub>	3	4	5
	Thickness of a thread on axis	60 mm	60 mm	60 mm
	Diameter of core	50 mm	80 mm	110 mm
	Minimum weight of an element per linear metre without housing (relative density: 7)	155 kg	430 kg	950 kg
	Useful cross-section for air flow	0,033 6 m <sup>2</sup>	0,104 m <sup>2</sup>	0,300 m <sup>2</sup>
<b>Housing</b> (in non-alloyed carbon steel or stainless steel)	Recommended thicknesses	2 mm	2 mm	3 mm

Table A.1 (continued)

Description		Type Ø 300	Type Ø 500	Type Ø 750
<b>Flanges</b>	Outside diameter	380 mm	580 mm	855 mm
	Drilling diameter	340 mm	540 mm	805 mm
	Number of holes	10 mm	16 mm	24 mm
	Diameter of drilling holes	8 mm	10 mm	10 mm
	Thickness	8 mm	10 mm	>10 mm

<sup>a</sup> This dimension can be obtained from an element of length 500 mm machined to 450 mm

NOTE Dimensional tolerances of helix for machining:

— for the diameter: 0 mm

−0,3 mm

— for the length: 0 mm

−2 mm

Play between helix and housing:

— less than 0,5 mm along the radius

Dimensional tolerances for housings:

— for the length: 0 mm

+2 mm

Table B.1

Replace the line with the following.

331	Lamellar graphite cast iron or spheroidal graphite The helix is made entirely in cast iron: put an X.
-----	--

*Bibliography*

Replace the text with the following:

[1] CEA Document, Guide CETREVE: *Principles of ventilation of nuclear plants, Volume III B: Detailed technical specifications — Protection helix, Code 280, folio 1/4 to 4/4*

[2] IAEA Document, Manual on safety aspects of the design and equipment of Hot Laboratories, N° 30. 1981

[3] ISO 9606-1, *Qualification testing of welders — Fusion welding — Part 1: Steels*

[4] EN 1561, *Founding — Grey cast irons*

[5] ISO 3452-3, *Non-destructive testing — Penetrant testing — Part 3: Reference test blocks*

[6] ASTM A-48, *Standard specification for gray iron castings*