

---

---

**Thermal insulating products for building applications — Determination of long-term water absorption by immersion**

*Produits isolants thermiques destinés aux applications du bâtiment — Détermination de l'absorption d'eau à long terme par immersion*

STANDARDSISO.COM : Click to view the full PDF of ISO 16535:2012



STANDARDSISO.COM : Click to view the full PDF of ISO 16535:2012



**COPYRIGHT PROTECTED DOCUMENT**

© ISO 2012

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
Case postale 56 • CH-1211 Geneva 20  
Tel. + 41 22 749 01 11  
Fax + 41 22 749 09 47  
E-mail [copyright@iso.org](mailto:copyright@iso.org)  
Web [www.iso.org](http://www.iso.org)

Published in Switzerland

# Contents

Page

Foreword .....	iv
Introduction .....	v
1 Scope .....	1
2 Normative references .....	1
3 Principle .....	1
4 Apparatus .....	1
5 Test specimens .....	4
5.1 Dimensions of test specimens .....	4
5.2 Number of test specimens .....	4
5.3 Preparation of test specimens .....	4
5.4 Conditioning of test specimens .....	4
6 Procedure .....	5
6.1 Test conditions .....	5
6.2 Test procedure .....	5
7 Calculation and expression of results .....	7
7.1 General .....	7
7.2 Long-term water absorption by partial immersion .....	7
7.3 Long-term water absorption by total immersion .....	7
8 Accuracy of measurement .....	8
9 Test report .....	8

STANDARDSISO.COM : Click to view the full PDF of ISO 16535:2012

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 16535 was prepared by Technical Committee ISO/TC 163, *Thermal performance and energy use in the built environment*, Subcommittee SC 1, *Test and measurement methods*.

ISO 16535 includes the original EN 12087 prepared by Technical Committee CEN/TC 88 "Thermal insulating materials and products", with the following clauses modified to reflect the conditions for tropical countries:

- Clause 5.4: Conditioning of test specimens;
- Clause 6.1: Test conditions;
- Clause 9: Test report.

STANDARDSISO.COM : Click to view the full PDF of ISO 16535:2012

## Introduction

ISO 16535 is one of a series of existing European Standards on test methods which were adopted by ISO. This group of International Standards comprises the following group of interrelated standards:

ISO	Title	Respective EN standard
12344	Thermal insulating products for building applications — Determination of bending behaviour	EN 12089
12968	Thermal insulation products for building applications — Determination of the pull-off resistance of external thermal insulation composite systems (ETICS) (foam block test)	EN 13495
29465	Thermal insulating products for building applications — Determination of length and width	EN 822
29466	Thermal insulating products for building applications — Determination of thickness	EN 823
29467	Thermal insulating products for building applications — Determination of squareness	EN 824
29468	Thermal insulating products for building applications — Determination of flatness	EN 825
29469	Thermal insulating products for building applications — Determination of compression behaviour	EN 826
29470	Thermal insulating products for building applications — Determination of the apparent density	EN 1602
29471	Thermal insulating products for building applications — Determination of dimensional stability under constant normal laboratory conditions (23 degrees C/50 % relative humidity)	EN 1603
29472	Thermal insulating products for building applications — Determination of dimensional stability under specified temperature and humidity conditions	EN 1604
29764	Thermal insulating products for building applications — Determination of deformation under specified compressive load and temperature conditions	EN 1605
29765	Thermal insulating products for building applications — Determination of tensile strength perpendicular to faces	EN 1607
29766	Thermal insulating products for building applications — Determination of tensile strength parallel to faces	EN 1608
29767	Thermal insulating products for building applications — Determination of short-term water absorption by partial immersion	EN 1609
29768	Thermal insulating products for building applications — Determination of linear dimensions of test specimens	EN 12085
29769	Thermal insulating products for building applications — Determination of behaviour under point load	EN 12430
29770	Thermal insulating products for building applications — Determination of thickness for floating-floor insulating products	EN 12431
29771	Thermal insulating materials for building applications — Determination of organic content	EN 13820

## ISO 16535:2012(E)

29803	Thermal insulation products for building applications — Determination of the resistance to impact of external thermal insulation composite systems (ETICS)	EN 13497
29804	Thermal insulation products for building applications — Determination of the tensile bond strength of the adhesive and of the base coat to the thermal insulation material	EN 13494
29805	Thermal insulation products for building applications — Determination of the mechanical properties of glass fibre meshes	EN 13496
16534	Thermal insulating products for building applications — Determination of compressive creep	EN 1606
16535	Thermal insulating products for building applications — Determination of long-term water absorption by immersion	EN 12087
16536	Thermal insulating products for building applications — Determination of long-term water absorption by diffusion	EN 12088
16537	Thermal insulating products for building applications — Determination of shear behaviour	EN 12090
16546	Thermal insulating products for building applications — Determination of freeze-thaw resistance	EN 12091
16544	Thermal insulating products for building applications — Conditioning to moisture equilibrium under specified temperature and humidity conditions	EN 12429
16545	Thermal insulating products for building applications — Determination of behaviour under cyclic loading	EN 13793

A further group of existing European Standards on test methods for products used to insulate building equipment and industrial installations comprises the following group of interrelated International Standards:

ISO 12623	Thermal insulating products for building equipment and industrial installations — Determination of short-term water absorption by partial immersion of preformed pipe insulation	EN 13472
ISO 12624	Thermal insulating products for building equipment and industrial installations — Determination of trace quantities of water soluble chloride, fluoride, silicate, sodium ions and pH	EN 13468
ISO 12628	Thermal insulating products for building equipment and industrial installations — Determination of dimensions, squareness and linearity of preformed pipe insulation	EN 13467
ISO 12629	Thermal insulating products for building equipment and industrial installations — Determination of water vapour transmission properties of preformed pipe insulation	EN 13469

# Thermal insulating products for building applications — Determination of long-term water absorption by immersion

## 1 Scope

This International Standard specifies the equipment and procedures for determining the long-term water absorption of test specimens. It is applicable to thermal insulating products.

This International Standard specifies two options:

- Method 1: partial immersion; and
- Method 2: total immersion.

The long-term water absorption by partial immersion is intended to simulate the water absorption caused by long-term water exposure.

The long-term water absorption by total immersion is not directly related to the conditions on site, but has been recognized as a relevant condition of test for some products in some applications.

## 2 Normative references

The following referenced document is indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 29768, *Thermal insulating products for building applications — Determination of linear dimensions of test specimens*

## 3 Principle

**3.1 Partial immersion** (Method 1). The long-term water absorption by partial immersion is determined by measuring the change in mass of a test specimen, the lower part of which is in contact with water for a period of 28 days.

The excess water adhering to the surface, not absorbed by the test specimen, is removed by drainage in Method 1A or taken into account by deduction of the initial water uptake in Method 1B.

**3.2 Total immersion** (Method 2). The long-term water absorption by total immersion is determined by measuring the change in mass of the test specimen, totally immersed in water, over a period of 28 days.

The excess water adhering to the surface, not absorbed by the test specimen, is removed by drainage in Method 2A or taken into account by deduction of the initial water uptake in Method 2B.

## 4 Apparatus


**4.1 Balance**, allows the determination of the mass of a test specimen to 0,1 g.

**4.2 Water tank**, with a device for keeping the water level constant to within  $\pm 2$  mm, and a device to keep the test specimen in the required position. Examples of test devices are given in Figures 1, 2 and 3. The device to keep the test specimen in position shall not cover more than 15 % of the cross-sectional area of the test specimen, which is exposed to water. The device shall be such that the original form of the test specimen is maintained.

4.3 Tap water, adjusted to a temperature of  $(23 \pm 5)$  °C.

4.4 Equipment for drainage. The principle for Methods 1A and 2A is illustrated in Figures 4a) and 4b).

Dimensions in millimetres.

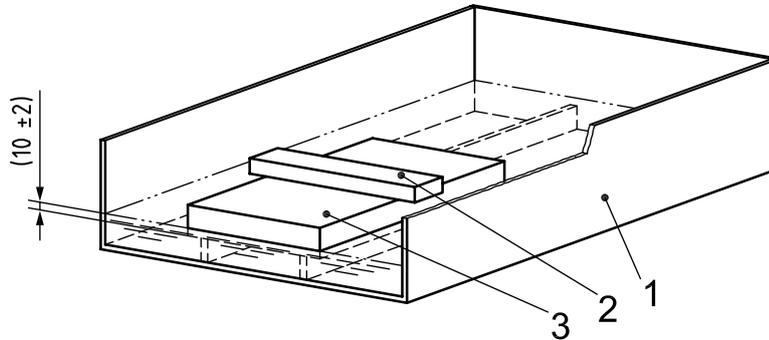


**Key**

- 1 water tank
- 2 load to keep the test specimen in position
- 3 test specimen

**Figure 1 — Example of equipment for the determination of water absorption by partial immersion (Methods 1A and 1B)**

Dimensions in millimetres.

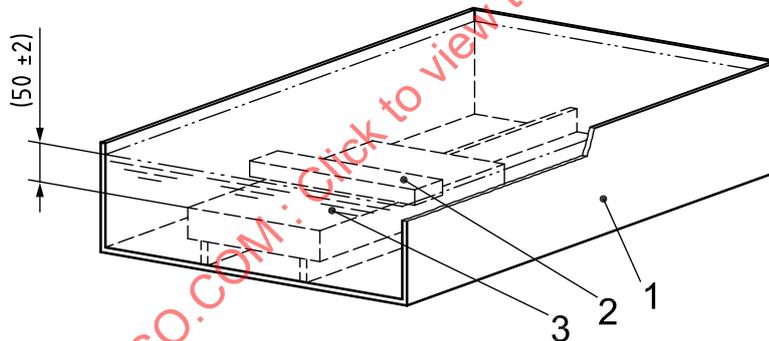


**Key**

- 1 water tank
- 2 load to keep the test specimen in position
- 3 test specimen

**Figure 2 — Example of equipment for the determination of water absorption by total immersion (Methods 2A and 2B)**


Dimensions in millimetres.

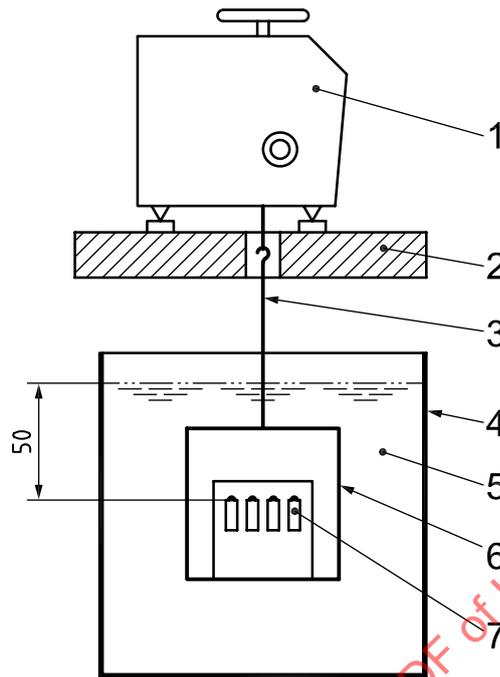


**Key**

- 1 balance
- 2 weighing table
- 3 linkage
- 4 water container
- 5 water
- 6 mesh cage made of stainless material with fixing rods or a sinker large enough in mass to compensate for the upthrust of the test specimen
- 7 test specimen

**Figure 3 — Example of equipment for the determination of water absorption by total immersion (Method 2C)**

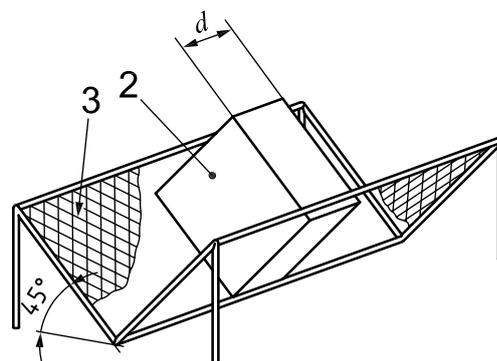

a)

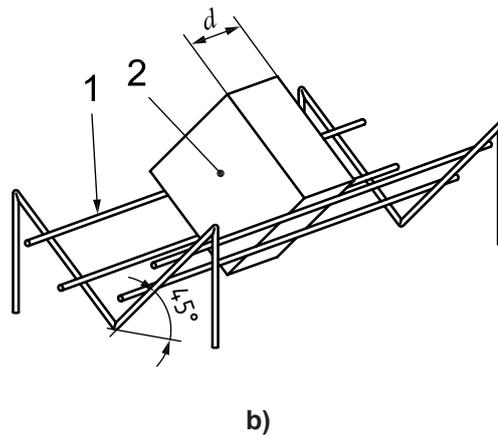

**Key**

- 1 stainless steel mesh
- 2 test specimen
- 3 perforated stainless steel

**Figure 4 — Examples of equipment for drainage**

**5 Test specimens**

**5.1 Dimensions of test specimens**

The thickness of the test specimens shall be the original product thickness.

The test specimens shall be squares with squarely cut edges having sides of  $(200 \pm 1)$  mm.

**5.2 Number of test specimens**

The number of test specimens shall be as specified in the relevant product standard or any other European technical specification. In the absence of such a specification, at least four test specimens shall be used.

NOTE In the absence of a product standard or any other technical specification, the number of test specimens can be agreed between parties.

**5.3 Preparation of test specimens**

The test specimens shall be cut so that they do not include original product edges.

Test specimens shall be prepared by methods that do not substantially change the original structure of the product. Any skins, facings and/or coatings shall be retained.

NOTE Special methods of preparation, when needed, are given in the relevant product standard or any other European technical specification.

**5.4 Conditioning of test specimens**

The test specimens shall be stored for at least 6 h at  $(23 \pm 5)$  °C. In case of dispute, they shall be stored at  $(23 \pm 2)$  °C and  $(50 \pm 5)$  % relative humidity (RH) for the time stated in the relevant product standard with a minimum of 6 h.

In tropical countries, different conditioning and testing conditions are relevant. In this case, the conditions shall be  $(27 \pm 5)$  °C and  $(65 \pm 5)$  % RH, and be stated clearly in the test report.

## 6 Procedure

### 6.1 Test conditions

The test shall be carried out at  $(23 \pm 5)$  °C. In case of dispute it shall be carried out at  $(23 \pm 2)$  °C.

In tropical countries, different conditioning and testing conditions can be relevant. In this case, the conditions shall be  $(27 \pm 2)$  °C and  $(65 \pm 5)$  % RH.

### 6.2 Test procedure

The method shall be as specified in the relevant product standard or any other European technical specification.

NOTE 1 In the absence of such a specification the method can be agreed between parties.

The long-term water absorption is determined after 28 days immersion.

NOTE 2 If requested, readings can be made at shorter time periods, e.g. after 7 day and 14 day immersion periods.

The dimensions of the test specimens shall be measured in accordance with ISO 29768 to the nearest 0,5 mm before the test.

If any dimensional changes are noticed after the immersion period, the dimensions of the test specimens should be measured again.

#### 6.2.1 Long-term water absorption by partial immersion (Method 1)

##### 6.2.1.1 Method 1A (drainage)

Weigh the test specimen to the nearest 0,1 g to determine its initial mass,  $m_0$ .

The test is made with half of the test specimens with one major face upwards. The other half are tested with the same major face downwards.

Place the test specimen in the empty water tank and apply a sufficient load to keep it partially immersed when water is added. Carefully add the water to the tank until the bottom face of the test specimen is  $(10 \pm 2)$  mm below the surface of the water (see example in Figure 1). Ensure that the water level remains constant during the test.

After 28 days, remove the test specimen; drain it for  $(10 \pm 0,5)$  min by placing it vertically on a mesh, inclined at  $45^\circ$ , as shown in Figure 4a) and 4b). Weigh the test specimen again to determine its mass,  $m_{28}$ .

##### 6.2.1.2 Method 1B (deduction of initial water uptake)

Weigh the test specimen to the nearest 0,1 g to determine its initial mass,  $m_0$ .

The test is made with half of the test specimens with one major face upwards. The other half are tested with the same major face downwards.

Place the test specimen in the water tank in such a position that it is partially immersed in water with the bottom face of the test specimen  $(10 \pm 2)$  mm below the water level. Remove the test specimen after 10 s, holding it horizontally and place it, within 5 s, in a plastic tray of known mass. Reweigh this tray with the test specimen to determine the mass,  $m_1$ , of the test specimen including the initial water uptake.

Replace the test specimen in the water tank and apply a sufficient load to keep it partially immersed in water with the bottom face of the test specimen  $(10 \pm 2)$  mm below the water level (see example in Figure 1). Ensure that the water level remains constant during the test.

The test is made with half of the test specimens with one major face upwards and with the other half with the same major face downwards.

After 28 days, remove the test specimen holding it horizontally and place it, within 5 s, in the plastic tray of previously determined mass to determine its mass,  $m_{28}$ .

Method 1B is only applicable if the initial water uptake is less than or equal to  $0,5 \text{ kg/m}^2$ , where this is calculated using the expression:

$$\frac{m_1 - m_0}{A_p}$$

where

$m_0$  is the initial mass of the test specimen as determined in Method 1B, in kg;

$m_1$  is the mass of the test specimen including the initial water uptake in Method 1B, in kg;

$A_p$  is the bottom surface area of the test specimen, in  $\text{m}^2$ .

## 6.2.2 Long-term water absorption by total immersion (Method 2)

### 6.2.2.1 Method 2A (drainage)

Weigh the test specimen to the nearest 0,1 g to determine its initial mass,  $m_0$ .

Place the test specimen in the empty water tank and apply a sufficient load to keep the test specimen totally immersed in water. Carefully add water to the tank until the top face of the test specimen is  $(50 \pm 2)$  mm below the surface of the water (see Figure 2). Ensure that the water level remains constant during the test.

After 28 days, remove the test specimen; drain it for  $(10 \pm 0,5)$  min by placing it vertically on a mesh, inclined at  $45^\circ$ , as shown in Figure 4a) and 4b). Then weigh the test specimen again to determine its mass,  $m_{28}$ .

### 6.2.2.2 Method 2B (deduction of initial water uptake)

Weigh the test specimen to the nearest 0,1 g to determine its initial mass,  $m_0$ .

Place the test specimen in the water tank in such a position that it is totally immersed in water with the top face of the test specimen  $(50 \pm 2)$  mm below the water level. Remove the test specimen after 10 s, holding it horizontally and place it, within 5 s, in a plastic tray of known mass. Reweigh this tray with the test specimen to determine the mass of the test specimen,  $m_1$ , including the initial water uptake.

Replace the test specimen in the water tank and apply a sufficient load to keep the test specimen totally immersed in water, with the top face of the test specimen  $(50 \pm 2)$  mm below the water level (see example in Figure 2). Ensure that the water level remains constant during the test.

After 28 days remove the test specimen, holding it horizontally, and place it within 5 s in the plastic tray of previously determined mass to determine its mass,  $m_{28}$ .

Method 2B is only applicable if the initial water uptake is less than or equal to  $0,5 \text{ kg/m}^2$ , where this is calculated using the expression:

$$\frac{m_1 - m_0}{A_t}$$

where

$m_0$  is the initial mass of the test specimen as determined in method 2B, in kg;

$m_1$  is the mass of the test specimen including the initial water uptake in method 2B, in kg;

$A_t$  is the total surface area of the test specimen exposed to water, in  $\text{m}^2$ .