
**Energy performance of buildings —
Schedule and condition of building,
zone and space usage for energy
calculation —**

**Part 1:
Non-residential buildings**

*Performance énergétique des bâtiments — Plan et conditions
d'utilisation des espaces, zones et bâtiments pour le calcul
d'énergie —*

Partie 1: Bâtiments non résidentiels



STANDARDSISO.COM : Click to view the full PDF of ISO 18523-1:2016



COPYRIGHT PROTECTED DOCUMENT

© ISO 2016, Published in Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Ch. de Blandonnet 8 • CP 401
CH-1214 Vernier, Geneva, Switzerland
Tel. +41 22 749 01 11
Fax +41 22 749 09 47
copyright@iso.org
www.iso.org

Contents

Foreword	v
Introduction	vi
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Framework of the schedule and condition for building energy calculation	7
4.1 Indispensable schedules	7
4.2 Daily schedule	8
4.3 Division of year and daily, weekly, monthly, seasonal and annual allocations of daily schedule	10
5 Conditions for energy calculation included in the schedule and condition of building, zone and space usage	13
5.1 Energy needs and uses.....	13
5.2 Condition	13
5.2.1 General information on occupancy and usage	13
5.2.1.1 Occupancy density.....	13
5.2.1.2 Simultaneous usage ratio of a set of zones and spaces.....	14
5.2.2 Operation of technical building systems and requirement for the services	14
5.2.2.1 Space heating and cooling	14
5.2.2.2 Ventilation for conditioned zone or space	14
5.2.2.3 Lighting	15
5.2.2.4 Domestic hot water	15
5.2.2.5 Ventilation for unconditioned zone or space	15
5.2.3 Internal heat gains	16
5.2.3.1 Person	16
5.2.3.2 Lighting	16
5.2.3.3 Appliances	16
6 Category of building, zone and space	17
6.1 General	17
6.2 Category of building.....	17
6.3 Category of space or zone	17
Annex A (informative) Format of daily schedule	19
Annex B (informative) A set of annual schedules by daily allocation of daily schedules	21
Annex C (informative) Categories of space and zone	27
Annex D (informative) A set of daily schedules for categories of space and zone	35
Annex E (informative) Examples of building	207
Bibliography	252

STANDARDSISO.COM : Click to view the full PDF of ISO 18523-1:2016

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see the following URL: www.iso.org/iso/foreword.html.

The committee responsible for this document is ISO/TC 163, *Thermal Performance and energy use in the built environment*.

Introduction

There is a strong need to improve the environment to make the evaluation of energy performance of buildings more reliable and practical, so that energy efficiency of buildings is improved by referring to the evaluation results. To realize such environment, one important standard on how to prescribe the ways of using buildings has been missed, even though many assumptions on the building usage have appeared in standards relevant to the energy calculation.

This document prescribes the indispensable information on the formats to express the usage of building, zone and space in energy calculation for non-residential buildings.

STANDARDSISO.COM : Click to view the full PDF of ISO 18523-1:2016

Energy performance of buildings — Schedule and condition of building, zone and space usage for energy calculation —

Part 1:

Non-residential buildings

1 Scope

This document specifies the formats to present schedule and condition of building, zone and space usage, which is to be referred to as input data of energy calculations for non-residential buildings.

The schedule and condition include schedules of occupancy, operation of technical building systems, ventilation rate, hot water usage and internal heat gains due to occupancy, lighting and equipment.

This document also gives categories of building, zone and space according to differentiating schedule and condition.

Depending on necessary minuteness of the energy calculation, different levels of schedule and condition from the view point of time and space averaging are specified.

The values and categories for the schedule and condition are given in annexes for more information for the application when the users of this document do not have detailed information on the values and categories for the schedule and condition.

The schedule and condition in this document is basically different from assumptions in order to determine the size of technical building systems in the process of design, where possible largest values are to be assumed. Instead, most usual and average values, which are assumed for the building energy calculation, are dealt with in this document.

2 Normative references

There are no normative references in this document.

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1 Space

3.1.1

space

part of a room, a room or group of adjacent rooms with assumed uniform properties for all considered types of zones (3.1.2)

3.1.2

zone

part of a *building* (3.1.3) consisting of (part of) one or more spaces with assumed uniform properties related to a specific service or service component, or (in absence of a service) assumed uniform indoor environmental conditions

3.1.3

building

construction as a whole, including its envelope and all *technical building systems* (3.3.5), where energy is used to condition the indoor thermal environment and to provide domestic hot water, lighting according to visual tasks and other services related to the use of the building

3.1.4

thermally conditioned space

thermally conditioned zone

heated and/or cooled *space* (3.1.1) or *zone* (3.1.2)

3.1.5

thermally unconditioned space

thermally unconditioned zone

space (3.1.1) or *zone* (3.1.2) that is not heated nor cooled

3.2 Schedule

3.2.1

schedule

information on condition(s) of usage of *building* (3.1.3), *zone* (3.1.2) or *space* (3.1.1) throughout a cycle of period, such as day, week, month, season and year

3.2.2

daily schedule

conditions (3.3.1) of *occupancy* (3.3.2), service system operations, requirement for the functions of the service systems and internal heat gains in each time of a day

3.2.3

daily schedule with hourly conditions

set of hourly *conditions* (3.3.1) of *occupancy* (3.3.2), service system operations, requirement for the functions of the service systems and internal heat gains in a day

3.2.4

set of daily schedules

complete set of daily schedules representing usage of a category of *building* (3.1.3), *zone* (3.1.2) or *space* (3.1.1) in one year

3.2.5

daily operating hours

hours when service system is operated or the length of the hours

3.2.6

annual operating hours

total length of hours in the *standard year* (3.2.15) when *technical building system* (3.3.5) is operated

3.2.7**annual schedule**

allocation of *daily schedule(s)* (3.2.2) for one year

Note 1 to entry: Division of the year can be selected from 365 days, 53 weeks, 12 months, seasons or no division [a *set of daily schedules* (3.2.4) is uniformly applied throughout the year].

3.2.8**seasonal schedule**

allocation of *daily schedule(s)* (3.2.2) to each season of the year

3.2.9**monthly schedule**

allocation of *daily schedule(s)* (3.2.2) to each month of the year

3.2.10**weekly schedule**

allocation of *daily schedule(s)* (3.2.2) to each week of the year

3.2.11**whole set of annual schedules**

complete set of *annual schedules* (3.2.7) representing usage of all types of *building* (3.1.3), *zone* (3.1.2) and *space* (3.1.1), as objects of *energy calculation* (3.3.20)

3.2.12**whole set of seasonal schedules**

complete set of *seasonal schedules* (3.2.8) representing usage of all types of *building* (3.1.3), *zone* (3.1.2) and *space* (3.1.1), as objects of *energy calculation* (3.3.20)

3.2.13**whole set of monthly schedules**

complete set of *monthly schedules* (3.2.9) representing usage of all types of *building* (3.1.3), *zone* (3.1.2) and *space* (3.1.1), as objects of *energy calculation* (3.3.20)

3.2.14**number of days in one year**

total number of days, which shall be 365

3.2.15**standard year**

selected year, of which number of day has to be 365 and arrangement of weekdays, weekends and holidays are referred in weekly, monthly, seasonal and *annual schedules* (3.2.7)

3.3 Parameters for conditions of building, zone and space usage**3.3.1****condition**

status of *occupancy* (3.3.2), operation of service systems, requirement for the functions of the *technical building systems* (3.3.5) and internal heat gains

3.3.2**occupancy**

presence of users in *building* (3.1.3), *zone* (3.1.2) or *space* (3.1.1)

3.3.3

occupancy density

number of present user in *building* (3.1.3), *zone* (3.1.2) or space per unit floor area of the *space* (3.1.1)

Note 1 to entry: Occupancy density is used mainly for the calculations for space heating/cooling and ventilation.

3.3.4

simultaneous usage ratio (of a set of spaces)

ratio of the number of *zones* (3.1.2) or *spaces* (3.1.1), which belong to a group of zones and spaces and are occupied or used at the time, to the total number of zones or spaces in the group

Note 1 to entry: This concept is applied to a group of zones or spaces of the same category, such as a group of guest rooms in hotels, a series of personal office rooms in office buildings, etc.

3.3.5

technical building system

all energy-using or energy-distributing components in a *building* (3.1.3) that are operated to support the occupant or process functions housed therein

Note 1 to entry: These include HVAC, domestic hot water, illumination, transportation, laundering or similar functions.

3.3.6

luminaire

apparatus which distributes, filters or transforms the light transmitted from one or more lamps

Note 1 to entry: Except for the lamps themselves, all the parts necessary for fixing and protecting the lamps and, where necessary, circuit auxiliaries together with the means for connecting them to the electric supply

[SOURCE: CIE S 017/E: 2011, 17–707]

3.3.7

in operation

status of a *technical building system* (3.3.5), in which the technical building system can function to satisfy the requirement for the technical building system, such as the set-point temperature and the *maintained average illuminance* (3.3.9)

Note 1 to entry: When the requirement is satisfied without its functioning, the technical building system stands by.

3.3.8

out of operation

status of a *technical building system* (3.3.5) in which the technical building system cannot function regardless of the relevant requirement or due to inexistence of any requirement for the technical building system

3.3.9

maintained average illuminance

value below which the average illuminance over the specified surface is not allowed to fall, lux

[SOURCE: CIE S 017/E: 2011, 17–750]

3.3.10**height of the working plane**

height of the plane, on which the assumed visual task is done, from the floor

Note 1 to entry: It is expressed in metres (m).

3.3.11**demand control ventilation**

ventilation, of which rate is controlled according to the necessity of the ventilation, such as to the emission rate of target pollutant

3.3.12**energy need for space heating and cooling**

heat to be delivered to or extracted from a conditioned *space* (3.1.1) to maintain the intended temperature and/or humidity conditions during a given period of time

3.3.13**energy use for space heating and cooling**

energy input to the heating and cooling system to satisfy the *energy need for space heating and cooling* (3.3.12)

3.3.14**energy need for ventilation for outdoor air supply**

work by electric motors to convey outdoor air to satisfy ventilation requirement

3.3.15**energy use for ventilation for outdoor air supply**

energy input to the ventilation system to satisfy the *energy need for ventilation for outdoor air supply* (3.3.14)

3.3.16**energy need for domestic hot water**

heat to be delivered to the needed amount of domestic hot water to raise its temperature from the cold network temperature to the prefixed delivery temperature at the delivery point

3.3.17**energy use for domestic hot water**

energy input to the domestic hot water system to satisfy the *energy need for domestic hot water* (3.3.16)

3.3.18**energy use for lighting**

energy consumed by *luminaires* (3.3.6) and lamps

3.3.19**energy use for transportation**

energy consumed by equipment for transportation, such as elevators

3.3.20**energy calculation**

calculation of energy uses for *technical building systems* (3.3.5)

3.4 Descriptions for daily schedule

3.4.1

reference ventilation requirement

most probable estimation of outdoor air supply (in volume flow rate per unit floor area or in air change per hour) to the *space* (3.1.1) or *zone* (3.1.2) in compliance with relevant regulation

3.4.2

reference domestic hot water usage

maximum hourly service hot water usage by users of the *space* (3.1.1) or *zone* (3.1.2) in volume flow rate per person, in volume flow rate per unit floor area or in volume flow rate per bed

Note 1 entry: The volume flow rate is calculated with the assumption on hot water temperature.

3.4.3

total daily usage of domestic hot water

total volume of service hot water usage in one day in volume per person, in volume per unit floor area or in volume per bed

Note 1 entry: The volume flow rate is calculated with the assumption on hot water temperature.

3.4.4

reference occupancy density

maximum hourly *occupancy density* (3.3.3) of the *space* (3.1.1) or *zone* (3.1.2) in person per unit floor area

Note 1 to entry: To be multiplied by *hourly ratios* (3.4.12), occupancy density at the time can be calculated.

3.4.5

reference heat gain due to person

maximum hourly total (sensitive and latent) heat gain due to person inside the room or *zone* (3.1.2) in watt per unit floor area

Note 1 to entry: To be multiplied by *hourly ratios* (3.4.12), heat gain due to person at the time can be calculated.

3.4.6

reference sensible heat gain due to person

maximum hourly sensible heat gain due to person inside the room or *zone* (3.1.2) in watt per unit floor area

Note 1 to entry: To be multiplied by *hourly ratios* (3.4.12), sensible heat gain due to person at the time can be calculated.

3.4.7

reference latent heat gain due to person

maximum hourly latent heat gain due to person inside the room or *zone* (3.1.2) in watt per unit floor area

Note 1 to entry: To be multiplied by *hourly ratios* (3.4.12), latent heat gain due to person at the time can be calculated.

3.4.8**reference heat gain due to lighting**

maximum hourly sensible heat gain due to lighting inside the room or *zone* (3.1.2) in watt per unit floor area

Note 1 to entry: To be multiplied by hourly ratios, heat gain due to lighting at the time can be calculated.

3.4.9**reference heat gain due to appliances**

maximum hourly total (sensible and latent) heat gain due to appliances inside the room or *zone* (3.1.2) in watt per unit floor area

Note 1 to entry: To be multiplied by *hourly ratios* (3.4.12), heat gain due to appliances at the time can be calculated.

3.4.10**reference sensible heat gain due to appliances**

maximum hourly sensible heat gain due to appliances inside the room or *zone* (3.1.2) in watt per unit floor area

Note 1 to entry: To be multiplied by *hourly ratios* (3.4.12), sensible heat gain due to appliances at the time can be calculated.

3.4.11**reference latent heat gain due to appliances**

maximum hourly latent heat gain due to appliances inside the room or *zone* (3.1.2) in watt per unit floor area

Note 1 to entry: To be multiplied by *hourly ratios* (3.4.12), latent heat gain due to appliances at the time can be calculated.

3.4.12**hourly ratio**

ratio of hourly value of parameters to their reference value

Note 1 to entry: Multiplying hourly ratios by the reference value, hourly values of the parameter can be calculated.

4 Framework of the schedule and condition for building energy calculation**4.1 Indispensable schedules**

The building energy calculations are characterized by the division number of the year, the calculation period or the calculation interval. Each calculation method has its appropriate calculation interval according to characteristics of the target physical phenomenon (for example, unsteadiness) and minuteness of the calculation responding to changes of climatic condition, occupants' behaviour, behaviour of service systems and so on.

Due to the variety of calculation method, there is a variety of form of the schedule and condition of building, zone and space usage. Nevertheless, there is a fundamental unit of form, daily schedule, which shall be included in forms for the schedule and condition. The daily schedule corresponds to the minimum cycle of building, zone and space usage, and also of climatic and solar condition.

Some nations adopt so called "monthly calculation" for space heating and cooling energy needs and uses, taking monthly variation of outdoor temperature and solar irradiance into consideration. One daily schedule for business day and the number of the business days is given to each month for each type of building, zone and space. Monthly means of outdoor air condition (for example, temperature)

and solar irradiance for different orientations and inclinations are given for the calculation. The expression of the daily schedule varies from detailed expression with hourly values to simplified expression such as daily mean values and the like. Additional schedule for closing day can be given in a simplified way such as only with daily mean values.

Similarly, in so called “seasonal calculation”, one daily schedule for business day and the number of the business days for each season are given to each season for each type of building, zone and space, and the calculation is done with seasonal mean values for climatic condition.

For the calculation of more steady phenomena, so called “annual calculation” can work if seasonal change of solar condition is integrated throughout the year and condensed in specific coefficients. Nevertheless, one daily schedule for business day and the number of annual business days are necessary. Additional daily schedule for closing day can be given.

For the calculation of lighting, monthly or yearly calculation is mainly used, but unsteady aspects of lighting still can be dealt with. In the calculation for lighting, when input parameters such as operating hours with and without daylight are prescribed, daily schedule as described in the column (2) of Table 1 and annual schedule by monthly allocation of daily schedules (Table 5) or annual schedule without division of the year (Table 7) should be explicitly given, so that the operating hours for light is well harmonized with those for other technical systems.

Therefore, for each category of building, zone and space, necessary number of daily schedules (e.g. two daily schedules for business day and closing day), and one of annual, seasonal, monthly and weekly schedules shall be given in order that the daily schedules are allocated for the year.

4.2 Daily schedule

The daily schedule shall contain hourly values of condition for one day or shall contain condensed or simplified information on conditions for the day. With some assumptions, the hourly detailed values can be generated from condensed or simplified information and used even for detailed calculation. If necessary, multiple daily schedules representing different daily patterns of usage should be given such as for weekdays, weekends and holidays. The number of daily schedules depends on minuteness of the schedule and condition, as well as on the category of building, zone and space under consideration.

The conditions described in the daily schedule are grouped into the following three categories:

- a) general information on occupancy and usage of building, zone and space;
- b) operation of technical building systems and requirement for their services;
- c) internal heat gains.

The basic structure of daily schedule is shown in Table 1.

Table 1 — Framework of daily schedule for building, zone or space

Parameters and their categories		(1) description by hourly values for 0 h to 24 h	(2) condensed or simplified description
a) General information on occupancy and usage	Occupancy density	Hourly occupancy density	Times of start and end of occupancy or total hours of occupancy, and average occupancy density during usage
	Simultaneous usage ratio of a set of rooms	Hourly simultaneous usage ratio	Mean simultaneous usage ratio during usage
b) Operation of technical building systems and requirement for their building services	Space heating and/or cooling	Hourly status of space heating and/or cooling system (in or out of operation)	Times of start and end of operation, or total hours of operation
		Hourly set-points of room temperature and/or humidity	Set-point temperature and/or humidity during operation, and/or information on set-back operation
	Ventilation for thermally conditioned zone or space	Hourly status of ventilation system (in or out of operation)	Times of start and end of operation, or total hours of operation
		Hourly ventilation requirement	Ventilation requirement during operation
	Lighting	Hourly status of lighting system (in or out of operation)	Times of start and end of operation, or total hours of operation
		Maintained average illuminance and height of working plane	Maintained average illuminance and height of working plane
	Domestic hot water	Hourly status of domestic hot water system	Times of start and end of operation, or total hours of operation
		Hourly service hot water usage	Daily total hot water usage
	Ventilation for thermally unconditioned zone or space	Hourly ventilation requirement	Ventilation requirement
		Set-point of room temperature (upper limit)	Set-point of room temperature (upper limit)
c) Internal heat gains (sensitive and/or latent)	Person (watt per unit floor area)	Hourly heat gains	Times of start and end of occupancy or total hours of occupancy
			Average heat gains during occupancy
	Lighting (watt per unit floor area)	Hourly heat gains	Times of start and end of lighting or total hours of lighting
			Average heat gain during operation
	Appliances (watt per unit floor area)	Hourly heat gains	Times of start and end of use of appliances or total hours of the usage
			Average heat gain during usage

4.2.1 General information on occupancy and usage

The principal parameter for the general information on occupancy and usage is the occupancy density. It can be given hourly in the day if detailed daily schedule is necessary. In such case, as shown in examples of the daily schedules in Annex D, the reference occupancy density and hourly ratios can be used to give hourly occupancy densities.

4.2.2 Operation of technical building systems and requirement for their building services

Daily schedules of operation of technical building systems and of requirement for those (e.g. room temperature and/or humidity, ventilation requirement, lighting requirements) shall be given hourly in the day if detailed daily schedule is necessary. The combination of reference ventilation requirement or reference domestic hot water and hourly ratios can be used to give hourly schedules.

The operational status of technical building systems can be described as “in operation” or “out of operation”. “In operation” is defined as the status in which the technical building system can function to satisfy the requirement for the system. When the requirement is satisfied without its functioning, the technical building system stands by. On the contrary, “out of operation” is defined as the status in which the technical building system cannot function regardless of the relevant requirement. Instead of giving the status hourly, the times of start and end can be given or the total hours of daily operation can be given as condensed or simplified description.

4.2.3 Internal heat gains

Daily schedules of internal heat gains shall be given hourly in the day if detailed daily schedule is necessary. The combination of reference heat gains such as reference heat gain due to person and hourly ratios can be used to give hourly schedules.

4.3 Division of year and daily, weekly, monthly, seasonal and annual allocations of daily schedules

The standard year shall be the year 2015, which has 365 days. Since national holidays and working days for buildings differs in nations and states, annual schedules can be determined on a national basis, even though there is a need for any common annual schedule patterns for research purposes. The annual schedule given in Annex B can be used as such a common annual schedule with daily 365 divisions. The basic structures of the annual schedule are shown in Table 2.

Table 2 — Annual schedules with different divisions of the year

(1) Daily 365 divisions																
The standard year																
1	2	3	4	5	6	7	8	...	358	359	360	361	362	363	364	365
(2) Weekly 53 divisions																
The standard year																
1	2	3	4	...	50	51	52	53								
(3) Monthly 12 divisions																
The standard year																
January	February	March	...	October	November	December										
(4) Seasonal 3 divisions																
The standard year																
Winter	Medium	Summer	Medium	Winter												
(5) No division of the year																
The standard year																
Common set of daily schedules throughout the year																

The annual schedule shall be made by allocating one of daily schedules to each day or a set of daily schedules to each week, month or season. Each week, month and season can contain different daily schedules such as for weekdays and the rest. If there is no need to divide the year, a set of daily schedules shall be allocated to the whole year without division. For example, for an indoor parking garage, a set of daily schedules of ventilation and lighting for each of business day and closing day is specified with numbers of the days as the annual schedule. Structures of the annual schedules by daily, weekly, monthly, seasonal and yearly allocation are prescribed in Table 3, Table 4, Table 5, Table 6 and Table 7, respectively.

**Table 3 — Annual schedule by daily allocation of daily schedules
(daily schedule allocation is exemplified)**

Date	#1	#2	#3	#4	#5	#6	#7	#8	#9	#10	#11	#12	#13	#14	...
	January														
	1st Th.	2nd Fr.	3rd Sa.	4th Su.	5th Mo.	6th Tu.	7th We.	8th Th.	9th Fr.	10th Sa.	11th Su.	12th Mo.	13th Tu.	14th We.	...
Daily schedule	<i>c</i>	<i>c</i>	<i>c</i>	<i>c</i>	<i>a</i>	<i>a</i>	<i>a</i>	<i>a</i>	<i>a</i>	<i>b</i>	<i>c</i>	<i>a</i>	<i>a</i>	<i>a</i>	...
The daily schedules <i>a</i> , <i>b</i> and <i>c</i> are allocated to weekdays except for Saturdays and Sundays/holidays, respectively.															

**Table 4 — Annual schedule by weekly allocation of daily schedules
(daily schedule allocation is exemplified)**

Daily schedule \ Week	#1	#2	#3	#4	#5	#6	#7	#8	#9	#10	#11	#12	...
	Jan. 1st to 4th	5th to 11th	12th to 18th	19th to 25th	26th to Feb. 1st	2nd to 8th	9th to 15th	16th to 22nd	23rd to Mar. 1st	2nd to 8th	9th to 15th	16th to 22nd	...
<i>a</i>	0	5	4	5	5	5	4	5	5	5	5	5	...
<i>b</i>	0	1	1	1	1	1	1	1	1	1	1	0	...
<i>c</i>	4	1	2	1	1	1	2	1	1	1	1	2	...
Total number of days	4	7	7	7	7	7	7	7	7	7	7	7	...
The daily schedules <i>a</i> , <i>b</i> and <i>c</i> are allocated to weekdays except for Saturdays, Saturdays and Sundays/holidays, respectively.													

**Table 5 — Annual schedule by monthly allocation of daily schedules
(daily schedule allocation is exemplified)**

Daily schedule \ Month	Jan.	Feb.	Mar.	Apr.	May	Jun.	Jul.	Aug.	Sep.	Oct.	Nov.	Dec.	Total
	Jan.	Feb.	Mar.	Apr.	May	Jun.	Jul.	Aug.	Sep.	Oct.	Nov.	Dec.	Total
<i>a</i>	19	19	22	21	19	22	22	21	19	21	20	19	244
<i>b</i>	4	4	3	4	4	4	4	5	4	5	4	4	49
<i>c</i>	8	5	6	5	8	4	5	5	7	5	6	8	72
Total number of days	31	28	31	30	31	30	31	31	30	31	30	31	365
The daily schedules <i>a</i> , <i>b</i> and <i>c</i> are allocated to weekdays except for Saturdays, Saturdays and Sundays/holidays, respectively.													

**Table 6 — Annual schedule by seasonal allocation of daily schedules
(daily schedule allocation is exemplified)**

Daily schedule \ Season	Winter	Intermediate	Summer	Total
	Winter	Intermediate	Summer	Total
<i>a</i>	n_{W1}	n_{M1}	n_{S1}	$244 (=n_{W1} + n_{M1} + n_{S1})$
<i>b</i>	n_{W2}	n_{M2}	n_{S2}	$49 (=n_{W2} + n_{M2} + n_{S2})$
<i>c</i>	n_{W3}	n_{M3}	n_{S3}	$72 (=n_{W3} + n_{M3} + n_{S3})$
Total number of days	$n_{W1} + n_{W2} + n_{W3}$	$n_{M1} + n_{M2} + n_{M3}$	$n_{S1} + n_{S2} + n_{S3}$	365
The daily schedules <i>a</i> , <i>b</i> and <i>c</i> are allocated to weekdays except for Saturdays, Saturdays and Sundays/holidays, respectively.				

**Table 7 — Annual schedule without division of the year
(daily schedule allocation is exemplified)**

Daily schedule	Total
<i>a</i>	244
<i>b</i>	49
<i>c</i>	72
Total number of days	365
The daily schedules <i>a</i> , <i>b</i> and <i>c</i> are allocated to weekdays except for Saturdays, Saturdays and Sundays/holidays, respectively.	

5 Conditions for energy calculation included in the schedule and condition of building, zone and space usage

5.1 Energy needs and uses

In this document, input parameters for the calculation of the following energy needs and uses are dealt with.

- Energy need and use for space heating and cooling.
- Energy need and use for ventilation for outdoor air supply for conditioned and unconditioned zone or space.
- Energy use for lighting.
- Energy need and use for domestic hot water.
- Energy use for transportation (i.e. elevators).

5.2 Condition

5.2.1 General information on occupancy and usage

5.2.1.1 Occupancy density

The occupancy density is directly or indirectly related to energy uses of technical building systems, such as of space heating and cooling, ventilation, lighting, domestic hot water and transportation in the building. It also represents unused status of the space by zero occupancy density. Total number of occupants can be calculated by multiplying the occupancy density by the floor area of the space, of which prescription should be dealt with by calculation methods standardized by other standards.

The occupancy density shall be assumed and given by taking the correlation with relevant conditions such as hourly status or hours of space heating and cooling, ventilation, lighting and domestic hot water, as well as with hourly status or hours of internal heat gains.

For lighting, other parameters for occupancy such as the absence factor may be added, but such parameters relevant to the occupancy should be well coordinated without contradiction.

NOTE The occupancy-relevant parameter for lighting is given in ISO 20086.

5.2.1.2 Simultaneous usage ratio of a set of zones or spaces

This parameter is not always necessary, but is useful when there is a group of zones or spaces of the same category and characteristics and the utilization rate of the group is not always full. Demands for technical building systems are to be reduced by the simultaneous usage ratio.

5.2.2 Operation of technical building systems and requirement for their services

5.2.2.1 Space heating and cooling

As operational conditions for space heating and cooling, status of the space heating and/or cooling system (in or out of operation) and indoor environmental set-points (temperature and/or humidity) shall be given.

There can be different indoor environmental set-points for a building, zone and space. They differentiate due to seasons (heating, cooling, intermediate and so on), daily usage (business day, closing day and so on) and set-back operation such as for during night. The condition for the set-point shall be given in a schedule by referring to the table for the set-point patterns, as shown in Table 8. If the set-point pattern can be allocated to any part of the year without calculations, periods shall be determined and be specified in the table for each of set-point patterns. If the set-point patterns depend on climatic condition in each day, week and month, determination of the set-point patterns shall be done as a part of the energy calculation.

Table 8 — Set-point patterns (symbols, values and notes are exemplified)

Symbol of set-point pattern	During normal operation		During set-back operation		Note for set-back operation
	Indoor set-point temperature	Indoor set-point relative humidity	Indoor set-point temperature	Indoor set-point relative humidity	
w1	22 °C	40 %		—	—
w2	22 °C	—	—	—	—
s1	26 °C	50 %	—	—	—
m1	24 °C	50 %	—	—	—

5.2.2.2 Ventilation for thermally conditioned zone or space

The ventilation (outdoor air supply) for thermally conditioned zones or spaces has an influence on the energy needs for space heating and cooling, as well as the energy use for mechanical ventilation. Status of the ventilation system (in or out of service) shall be given in the schedule or it shall be assumed to be the same as space heating and/or cooling system operation. As for ventilation rate during the operation, there are two ways how to estimate the amount of outdoor air supply, as follows.

- Estimation by regulated ventilation requirement of the building, zone and space, which can be defined as per unit floor area or per occupant. The requirement can also be described by acceptable concentration of target gas. If the requirement per occupant or by the acceptable concentration of the target gas is adopted, capacity of occupants of the zone or space, which has to be equal to or larger than the reference occupancy density, shall be assumed. This way is possible even before fixing detailed specifications of the ventilation system of the space.
- Estimation by designed air flow rate of the target building, zone and space, which is to be confirmed by design calculation based on the specifications of adopted ventilation components. The design value of the ventilation rate can be used, if the value shall be confirmed later in more detailed design stage of the building and technical building system.

In the energy calculation, when demand control ventilation or any other techniques to control ventilation rate is considered, the above-mentioned estimated amount of outdoor air can be adjusted by taking relevant parameters (e.g. schedule of occupancy density, outdoor temperature and/or humidity) into consideration.

In the calculation of energy use of the ventilation system, electric power of the designed system is used, or assumptions on the efficiency of the system, such as a specific fan power, are used with the ventilation rate.

5.2.2.3 Lighting

The status of the lighting system (in or out of operation) shall be given in the schedule. The status shall be coordinated with the occupancy of the zone or space, but they are not necessarily the same.

If the effect of dimming control for daylight utilization or any other lighting control methods are considered, the operation and electric power is adjusted by taking the specification of the control system and space configuration into consideration.

The energy use for lighting can be estimated by using the duration of the operation and the electric power for luminaires and lamps, which can be determined by the following ways.

- a) In the simplified utilization factor method, the installed lighting power density can be calculated by using maintained average illuminance, luminaire and lamp performance, and utilization factor as a function of the luminaire, space reflectance and room index. More detailed method can also be used for the calculation of the installed lighting power.
- b) Total assumed electric power of designed luminaires and lamps for the zone or space, or the target installed electric power for lighting.

NOTE Calculation methods for lighting are standardized in relevant standards such as ISO 20086.

When internal heat gain due to lighting is generated interactively by using results of energy use calculation for lighting, more realistic and accurate estimation of the internal heat gain due to lighting become possible. Such interactive calculation method should be applied in case the visual task and lighting schemes in spaces and zones are known.

5.2.2.4 Domestic hot water

The amount of service hot water usage shall be given as hourly volume or as total volume used during the specified period. In addition, assumed hot water temperature and type of faucet or shower nozzle shall be specified for the calculation of energy need. The saving of service hot water usage by energy-saving faucets or shower nozzles shall be evaluated by comparing with the performance of the assumed type of those in the schedule and condition. Supplied water temperature shall be given in the calculation methods.

5.2.2.5 Ventilation for thermally unconditioned zone or space

As thermally unconditioned zones or spaces, indoor parking garage, machine room, electric room, etc. are dealt with. The ventilation (outdoor air supply) for the thermally unconditioned zone or space has an influence on the energy use for mechanical ventilation. Status of ventilation system (in or out of service) shall be given in the schedule. As for ventilation rate in the operation, there are two ways in order to estimate the amount of outdoor air supply, as follows.

- a) Estimation by regulated ventilation requirement of the unconditioned zone or space, which can be defined as per unit floor area or air change rate. The requirement can also be described by allowable concentration of target gas such as CO for indoor parking garage or allowable temperature for machine and electric room with assumptions on internal heat gain in those spaces. This way is possible even before fixing detailed specifications of the ventilation system of the space,

but the schedule of ventilation target such as pollutant gas by cars and heat from contained equipment is necessary.

- b) Estimation by designed air flow rate of the target zone and space, which is to be confirmed by design calculation based on the specifications of adopted ventilation components. The design value of the ventilation rate can be used, if the value shall be confirmed later in more detailed design stage of the building and technical building system.

In the energy calculation, when demand control ventilation or any other techniques to control ventilation rate is considered, the above-mentioned estimated amount of outdoor air can be adjusted by taking relevant parameters (e.g. schedule of pollutant source, outdoor temperature) into consideration.

In the calculation of energy use of the ventilation system, electric power of the designed system is used, or assumptions on the efficiency of the system, such as a specific fan power, are used with the ventilation rate.

5.2.3 Internal heat gains

Internal heat gains due to persons, lighting and other appliances used in building, zone and space also affect energy needs for space heating and cooling. The schedule of the heat gains shall be given.

5.2.3.1 Person

The amount of internal heat gain due to person per unit floor area is the product of heat dissipation per person and occupancy density.

5.2.3.1.1 Heat gains per person

Heat gains per person (occupant) in watt per person depends on his/her activity level and other physiological conditions. Therefore, they shall be given, taking human activity in the zone or space into consideration. Values for the heat dissipation can be found in references such as Reference [19]. The heat dissipation from human body consists of sensitive and latent heats, but it is possible to assume only the sensitive heat, such as when calculating only energy need for sensitive heat.

5.2.3.1.2 Occupancy density

The occupancy density is described as general information in 5.2.1.1.

5.2.3.2 Lighting

For the energy calculation of lighting, conditions other than the status of the lighting system (in or out of operation) and the lighting requirement (e.g. maintained average illuminance on height of working plane and further criteria according to ISO 8995-1) can be determined by the lighting design and shall be used in the calculation methods as input data for target building, zone and space. The result of such energy calculation of lighting can be used as the basis of heat gain due to lighting.

When rough estimation on the heat gain due to lighting is needed before the lighting design and energy calculation of lighting, the target installed power for lighting can be used.

5.2.3.3 Appliances

The appliances include electric appliances and other machines or instruments dissipating heat, which can consist of sensible and latent heats. The electric appliances, such as computer, television, copy machine, refrigerator and special decorative illumination irrelevant with the lighting requirement for visual tasks, use energy and shall be taken into consideration when determining internal heat gain due to appliances.

6 Category of building, zone and space

6.1 General

Buildings are characterized basically by their principal function. However, there are not only complex buildings with different principal functions, but also buildings naturally having mutually related plural principal functions, such as hospitals containing functions for outpatient consultation and inpatient healthcare. Even among buildings of the same category, there is possibly considerable difference in factors influencing energy use due to composition of multiple functions. Therefore, from the view point of energy calculation, the schedule and condition shall be prescribed not by building category, but by the category of zone and space. Another reason why the zone and space shall be focused is that zones and spaces, which have secondary functions to support the principal ones, still have impacts on overall energy use of the building.

6.2 Category of building

This document is focused upon the categories of non-residential building as shown in Table 9. However, the categorization of the building for the energy calculation may be dependent on existing categorizations of any national building regulations and should not be defined exclusively in an International Standard.

The definitions for the building categories, which are given in ISO/TR 16344 and coordinated with Table 9, should be referred.

Table 9 — Categories of non-residential buildings for schedule and condition of building, zone and space usage for energy calculation

Category of building	Representing zone(s) or space(s) for principal function(s) of building
1 Office	Office room, office room with heavy electrical load
2 Hotel	Guest room, banquet hall, conference hall
3 Hospital	Ward, consultation room
4 Shop	Large store, Small store, supermarket
5 Educational	Class room of junior and junior high school, class room of high school, lecture room of university, study room, experimental laboratory, lecture hall and gymnasium
6 Restaurant	Dining room of restaurant, guest room of coffee house, bar, kitchen
7 Library	Reading room, book stack
8 Museum	Exhibition room, storeroom
9 Sport and amusement	Gymnasium, spectator stand
10 Theatre	Auditorium, stage
11 Religious	Assembly room
12 Warehouse	Storage room

6.3 Category of space or zone

Categories of space or zone are provided in Annex C.

Minuteness of categories of space and zone should be determined by taking the characteristics of methods for energy calculation and their procedures. If fewer categories of space and zone are used for the calculation method, any rule shall be given on which type of space and zone and its schedule and

condition should be applied to spaces and zones of the object building for the energy calculation. The rule shall be developed by taking all energy uses to be calculated into consideration. Some energy uses may need minuteness of types, while other energy uses may not need such minuteness.

Schedule and condition for types of space or zone are not only used directly as input parameters but also as the basis to draw more simplified input parameters for energy calculation. When merging adjacent spaces of different types according to the rule of an energy calculation method, their similarity and appropriateness to merge shall be checked by comparing their schedules and conditions.

The more types of space or zone are assumed, the more minute input parameters can be supplied. Since the minuteness of the energy calculation methods differs nation to nation, number of types of space or zone can be determined by taking the characteristic of the calculation method into calculation.

STANDARDSISO.COM : Click to view the full PDF of ISO 18523-1:2016

Annex A (informative)

Format of daily schedule

Figure A.1 is an example of format of daily schedule, which contains three different daily schedules (*a*, *b* and *c*). The actual examples for different spaces are given in Annex C. In Figure A.1, explanations of parameters are given around the format.

STANDARDSISO.COM : Click to view the full PDF of ISO 18523-1:2016

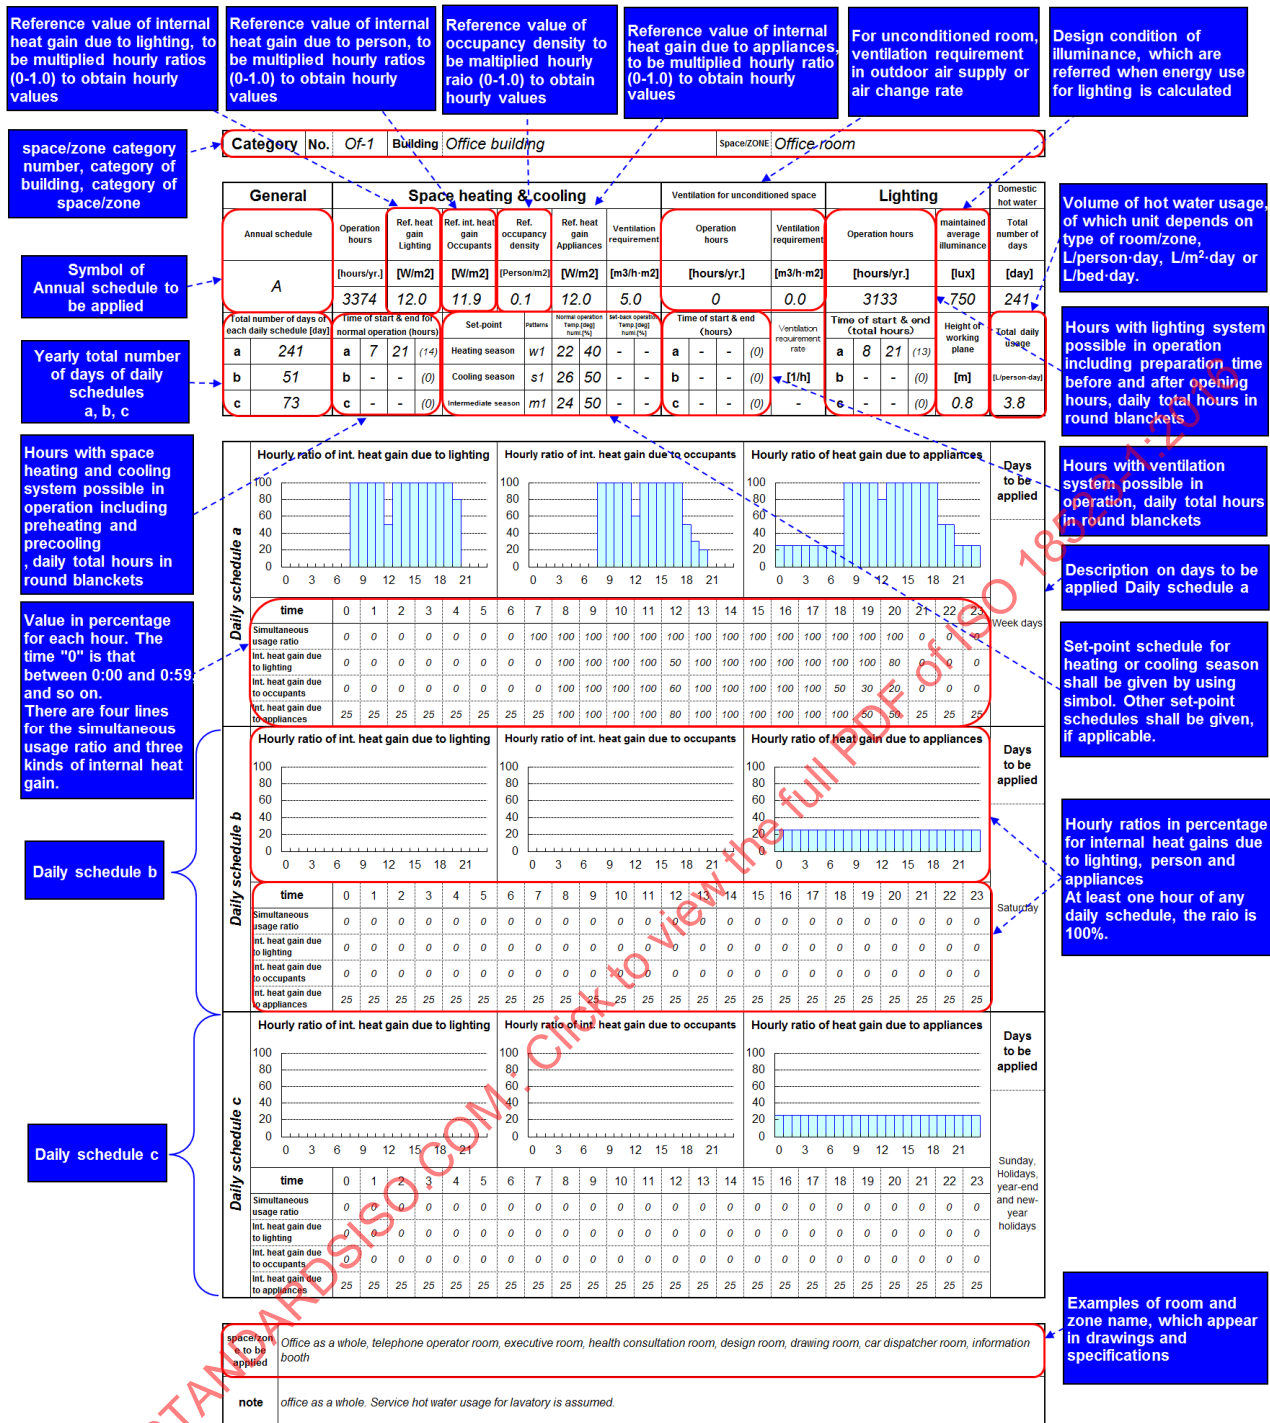


Figure A.1 — Format of a set of daily schedule for each category of space and zone

Annex B (informative)

Annual schedule by daily allocation of daily schedules

An example of the set of annual schedules by daily allocation of daily schedules is given in Table B.1. The daily allocation is for the minutest division of the year as prescribed in 4.3 (Table 3).

Table B.1 — Set of annual schedules by daily allocation of daily schedules

Annual schedule A			Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.			
January	Date						1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17			
	Daily schedule						c*	c*	c*	c	a	a	a	a	a	b	c	c*	a	a	a	a	b			
a	b	c	18	19	20	21	22	23	24	25	26	27	28	29	30	31										
19	4	8	Daily schedule	c	a	a	a	a	a	b	c	a	a	a	a	b										
February	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
	Daily schedule		c	a	a	a	a	a	b	c	a	a	a	c*	a	a	b	c	a	a	a	a	b			
a	b	c	22	23	24	25	26	27	28																	
19	4	5	Daily schedule	c	a	a	a	a	a	b																
March	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
	Daily schedule		c	a	a	a	a	a	b	c	a	a	a	a	a	b	c	a	a	a	a	c*	b			
a	b	c	22	23	24	25	26	27	28	29	30	31														
21	4	6	Daily schedule	c	a	a	a	a	a	b	c	a	a													
April	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18			
	Daily schedule					a	a	a	b	c	a	a	a	a	a	b	c	a	a	a	a	a	b			
a	b	c	19	20	21	22	23	24	25	26	27	28	29	30												
21	4	5	Daily schedule	c	a	a	a	a	b	c	a	a	c*	a												
May	Date							1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16			
	Daily schedule							a	b	c*	c*	c*	c*	a	a	b	c	a	a	a	a	a	b			
a	b	c	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31									
18	5	8	Daily schedule	c	a	a	a	a	a	b	c	a	a	a	a	a	b	c								
June	Date			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
	Daily schedule			a	a	a	a	a	b	c	a	a	a	a	a	b	c	a	a	a	a	a	b			
a	b	c	21	22	23	24	25	26	27	28	29	30														
22	4	4	Daily schedule	c	a	a	a	a	b	c	a	a														
July	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18			
	Daily schedule					a	a	a	b	c	a	a	a	a	a	b	c	a	a	a	a	a	b			
a	b	c	19	20	21	22	23	24	25	26	27	28	29	30	31											
22	4	5	Daily schedule	c	c*	a	a	a	a	b	c	a	a	a	a	a										
August	Date								1	2	3	4	5	6	7	8	9	10	11	12	13	14	15			
	Daily schedule								b	c	a	a	a	a	a	a	b	c	a	a	a	a	b			
a	b	c	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31								
21	5	5	Daily schedule	c	a	a	a	a	b	c	a	a	a	a	a	b	c	a								
September	Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			
	Daily schedule				a	a	a	a	b	c	a	a	a	a	a	b	c	a	a	a	a	a	b			
a	b	c	20	21	22	23	24	25	26	27	28	29	30													
19	4	7	Daily schedule	c	c*	c*	c*	a	a	b	c	a	a	a												
October	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17				
	Daily schedule					a	a	b	c	a	a	a	a	a	b	c	c*	a	a	a	a	b				
a	b	c	18	19	20	21	22	23	24	25	26	27	28	29	30	31										
21	5	5	Daily schedule	c	a	a	a	a	b	c	a	a	a	a	a	b										
November	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
	Daily schedule		c	a	c*	a	a	a	b	c	a	a	a	a	a	b	c	a	a	a	a	a	b			
a	b	c	22	23	24	25	26	27	28	29	30															
19	4	7	Daily schedule	c	c*	a	a	a	a	b	c	a														
December	Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			
	Daily schedule				a	a	a	a	b	c	a	a	a	a	a	b	c	a	a	a	a	a	b			
a	b	c	20	21	22	23	24	25	26	27	28	29	30	31												
19	4	8	Daily schedule	c	a	a	c*	a	a	b	c	a	c*	c*												
Yearly total			a: Week days																							
a			b: Saturday																							
b			c: Sunday																							
c																										
241																										
51																										
73																										

a: Week days

b: Saturday

c: Sunday

*: Holidays, year-end and new-year holidays

Table B.1 (continued)

Annual schedule B			Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.		
January	Date						1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17		
	Daily schedule						c*	c*	c*	b	b	b	b	b	b	b	b	b*	a	a	a	a	b		
a	b	c																							
14	14	3																							
Date			18	19	20	21	22	23	24	25	26	27	28	29	30	31									
Daily schedule			b	a	a	a	a	a	b	b	a	a	a	a	a	b									
February	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21		
	Daily schedule		b	a	a	a	a	a	b	b	a	a	b*	a	a	b	b	a	a	a	a	a	b		
a	b	c																							
19	9	0																							
Date			22	23	24	25	26	27	28																
Daily schedule			b	a	a	a	a	a	b																
March	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21		
	Daily schedule		b	a	a	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	b*	b		
a	b	c																							
14	17	0																							
Date			22	23	24	25	26	27	28	29	30	31													
Daily schedule			b	b	b	b	b	b	b	b	b	b													
April	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18		
	Daily schedule					b	b	b	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b		
a	b	c																							
18	12	0																							
Date			19	20	21	22	23	24	25	26	27	28	29	30											
Daily schedule			b	a	a	a	a	a	b	b	a	a	b*	a											
May	Date							1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16		
	Daily schedule							a	b	b*	b*	b*	b*	a	a	b	b	a	a	a	a	a	b		
a	b	c																							
18	13	0																							
Date			17	18	19	20	21	22	23	24	25	26	27	28	29	30	31								
Daily schedule			b	a	a	a	a	a	b	b	a	a	a	a	a	b	b								
June	Date			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
	Daily schedule			a	a	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b		
a	b	c																							
22	8	0																							
Date			21	22	23	24	25	26	27	28	29	30													
Daily schedule			b	a	a	a	a	a	b	b	a	a													
July	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18		
	Daily schedule					a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b		
a	b	c																							
16	15	0																							
Date			19	20	21	22	23	24	25	26	27	28	29	30	31										
Daily schedule			b	b*	a	a	a	b	b	b	b	b	b	b	b										
August	Date								1	2	3	4	5	6	7	8	9	10	11	12	13	14	15		
	Daily schedule								b	b	b	b	b	b	b	b	b	b	b	b	b	b	b		
a	b	c																							
0	31	0																							
Date			16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31							
Daily schedule			b	b	b	b	b	b	b	b	b	b	b	b	b	b	b	b							
September	Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19		
	Daily schedule				a	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b		
a	b	c																							
19	11	0																							
Date			20	21	22	23	24	25	26	27	28	29	30												
Daily schedule			b	b*	b*	b*	a	a	b	b	a	a	a												
October	Date						1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17		
	Daily schedule						a	a	b	b	a	a	a	a	a	b	b	b*	a	a	a	a	b		
a	b	c																							
21	10	0																							
Date			18	19	20	21	22	23	24	25	26	27	28	29	30	31									
Daily schedule			b	a	a	a	a	a	b	b	a	a	a	a	a	b									
November	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21		
	Daily schedule		b	a	b*	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b		
a	b	c																							
19	11	0																							
Date			22	23	24	25	26	27	28	29	30														
Daily schedule			b	b*	a	a	a	a	b	b	a														
December	Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19		
	Daily schedule				a	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b		
a	b	c																							
16	12	3																							
Date			20	21	22	23	24	25	26	27	28	29	30	31											
Daily schedule			b	a	a	b*	b	b	b	b	b	c*	c*	c*											
Yearly total																									
a	b	c																							
196	163	6																							
			a: Week days																						
			b: Saturday, Sunday, Holidays, Spring summer and winter holidays																						
			c: Year-end and new-year holidays																						

Table B.1 (continued)

Annual schedule C			Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.			
January	Date						1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17			
	Daily schedule						c*	c*	c*	b	b	b	b	b	b	b	b	b*	a	a	a	a	b			
a b c	Date		18	19	20	21	22	23	24	25	26	27	28	29	30	31										
14 14 3	Daily schedule		b	a	a	a	a	a	b	b	a	a	a	a	a	b										
February	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
	Daily schedule		b	a	a	a	a	a	b	b	a	a	b*	a	a	b	b	a	a	a	a	a	b			
a b c	Date		22	23	24	25	26	27	28																	
14 14 0	Daily schedule		b	b	b	b	b	b	b																	
March	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
	Daily schedule		b	b	b	b	b	b	b	b	b	b	b	b	b	b	b	b	b	b	b*	b	b			
a b c	Date		22	23	24	25	26	27	28	29	30	31														
0 31 0	Daily schedule		b	b	b	b	b	b	b	b	b	b														
April	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18			
	Daily schedule					b	b	b	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b			
a b c	Date		19	20	21	22	23	24	25	26	27	28	29	30												
18 12 0	Daily schedule		b	a	a	a	a	a	b	b	a	a	b*	a												
May	Date							1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16			
	Daily schedule							a	b	b*	b*	b*	b*	a	a	b	b	a	a	a	a	a	b			
a b c	Date		17	18	19	20	21	22	23	24	25	26	27	28	29	30	31									
18 13 0	Daily schedule		b	a	a	a	a	a	b	b	a	a	a	a	a	b	b									
June	Date			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
	Daily schedule			a	a	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b			
a b c	Date		21	22	23	24	25	26	27	28	29	30														
22 8 0	Daily schedule		b	a	a	a	a	a	b	b	a	a														
July	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18			
	Daily schedule					a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b			
a b c	Date		19	20	21	22	23	24	25	26	27	28	29	30	31											
16 15 0	Daily schedule		b	b*	a	a	a	b	b	b	b	b	b	b	b											
August	Date								1	2	3	4	5	6	7	8	9	10	11	12	13	14	15			
	Daily schedule								b	b	b	b	b	b	b	b	b	b	b	b	b	b	b			
a b c	Date		16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31								
0 31 0	Daily schedule		b	b	b	b	b	b	b	b	b	b	b	b	b	b	b	b								
September	Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			
	Daily schedule				b	b	b	b	b	b	b	b	b	b	b	b	b	b	b	b	b	b	b			
a b c	Date		20	21	22	23	24	25	26	27	28	29	30													
5 25 0	Daily schedule		b	b*	b*	b*	a	a	b	b	a	a	a													
October	Date						1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17			
	Daily schedule						a	a	b	b	a	a	a	a	a	b	b	b*	a	a	a	a	b			
a b c	Date		18	19	20	21	22	23	24	25	26	27	28	29	30	31										
21 10 0	Daily schedule		b	a	a	a	a	a	b	b	a	a	a	a	a	b										
November	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
	Daily schedule		b	a	b*	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b			
a b c	Date		22	23	24	25	26	27	28	29	30															
19 11 0	Daily schedule		b	b*	a	a	a	a	b	b	a															
December	Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			
	Daily schedule				a	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b			
a b c	Date		20	21	22	23	24	25	26	27	28	29	30	31												
16 12 3	Daily schedule		b	a	a	b*	b	b	b	b	b	c*	c*	c*												
Yearly total			a: Week days																							
a			b: Saturday, Sunday, Holidays, Spring summer and winter holidays																							
b			c: Year-end and new-year holidays																							
c																										
163			196																							
196			6																							

Table B.1 (continued)

Annual schedule D				Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.		
January		Date						1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17		
		Daily schedule						c*	c*	c*	b	c	a	a	a	a	b	b	b*	a	a	a	a	b		
a	b	c	Date	18	19	20	21	22	23	24	25	26	27	28	29	30	31									
18	9	4	Daily schedule	b	a	a	a	a	a	b	b	a	a	a	a	a	b									
February		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
		Daily schedule	b	c	a	a	a	a	b	b	a	a	b*	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date	22	23	24	25	26	27	28																
18	9	1	Daily schedule	b	a	a	a	a	a	b																
March		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
		Daily schedule	b	c	a	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	b	b			
a	b	c	Date	22	23	24	25	26	27	28	29	30	31													
20	10	1	Daily schedule	b	a	a	a	a	a	b	b	a	a													
April		Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18			
		Daily schedule				a	a	a	b	b	c	a	a	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date	19	20	21	22	23	24	25	26	27	28	29	30											
20	9	1	Daily schedule	b	a	a	a	a	a	b	b	a	a	b*	a											
May		Date						1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16			
		Daily schedule						a	b	b*	b*	b*	b*	a	a	b	b	c	a	a	a	a	b			
a	b	c	Date	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31								
17	13	1	Daily schedule	b	a	a	a	a	a	b	b	a	a	a	a	a	b	b								
June		Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
		Daily schedule		c	a	a	a	a	b	b	a	a	a	a	a	a	b	b	a	a	a	a	b			
a	b	c	Date	21	22	23	24	25	26	27	28	29	30													
21	8	1	Daily schedule	b	a	a	a	a	a	b	b	a	a													
July		Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18			
		Daily schedule				a	a	a	b	b	c	a	a	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date	19	20	21	22	23	24	25	26	27	28	29	30	31										
21	9	1	Daily schedule	b	b*	a	a	a	a	b	b	a	a	a	a											
August		Date							1	2	3	4	5	6	7	8	9	10	11	12	13	14	15			
		Daily schedule							b	b	c	a	a	a	a	a	b	b	a	a	a	a	b			
a	b	c	Date	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31							
20	10	1	Daily schedule	b	a	a	a	a	a	b	b	a	a	a	a	a	b	b	a							
September		Date			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			
		Daily schedule			a	a	a	a	b	b	c	a	a	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date	20	21	22	23	24	25	26	27	28	29	30												
18	11	1	Daily schedule	b	b*	b*	b*	a	a	b	b	a	a	a												
October		Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17				
		Daily schedule				a	a	b	b	c	a	a	a	a	b	b	b*	a	a	a	a	b				
a	b	c	Date	18	19	20	21	22	23	24	25	26	27	28	29	30	31									
20	10	1	Daily schedule	b	a	a	a	a	a	b	b	a	a	a	a	a	b									
November		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
		Daily schedule	b	c	b*	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date	22	23	24	25	26	27	28	29	30														
18	11	1	Daily schedule	b	b*	a	a	a	a	b	b	a														
December		Date			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			
		Daily schedule			a	a	a	a	b	b	c	a	a	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date	20	21	22	23	24	25	26	27	28	29	30	31											
18	9	4	Daily schedule	b	a	a	b*	a	a	b	b	a	c*	c*	c*											
Yearly total				a: Week days																						
a				b: Saturday, Sunday, Holidays																						
b				c: One day a month, Year-end and new-year holidays																						
c																										
229				118																						
118				18																						

Table B.1 (continued)

Annual schedule E			Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.		
January	Date						1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17		
	Daily schedule						c*	c*	c*	b	c	a	a	a	a	b	b	b*	c	a	a	a	b		
a b c	Date		18	19	20	21	22	23	24	25	26	27	28	29	30	31									
15 9 7	Daily schedule		b	c	a	a	a	a	b	b	c	a	a	a	a	b									
February	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21		
	Daily schedule		b	c	a	a	a	a	b	b	c	a	b*	a	a	b	b	c	a	a	a	a	b		
a b c	Date		22	23	24	25	26	27	28																
15 9 4	Daily schedule		b	c	a	a	a	a	b																
March	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21		
	Daily schedule		b	c	a	a	a	a	b	b	c	a	a	a	a	b	b	c	a	a	a	b*	b		
a b c	Date		22	23	24	25	26	27	28	29	30	31													
16 10 5	Daily schedule		b	c	a	a	a	a	b	b	c	a													
April	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18		
	Daily schedule					a	a	a	b	b	c	a	a	a	a	b	b	c	a	a	a	a	b		
a b c	Date		19	20	21	22	23	24	25	26	27	28	29	30											
17 9 4	Daily schedule		b	c	a	a	a	a	b	b	c	a	b*	a											
May	Date							1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16		
	Daily schedule							a	b	b*	b*	b*	b*	c	a	b	b	c	a	a	a	a	b		
a b c	Date		17	18	19	20	21	22	23	24	25	26	27	28	29	30	31								
14 13 4	Daily schedule		b	c	a	a	a	a	b	b	c	a	a	a	a	b	b								
June	Date			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
	Daily schedule			c	a	a	a	a	b	b	c	a	a	a	a	b	b	c	a	a	a	a	b		
a b c	Date		21	22	23	24	25	26	27	28	29	30													
17 8 5	Daily schedule		b	c	a	a	a	a	b	b	c	a													
July	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18		
	Daily schedule					a	a	a	b	b	c	a	a	a	a	b	b	c	a	a	a	a	b		
a b c	Date		19	20	21	22	23	24	25	26	27	28	29	30	31										
18 9 4	Daily schedule		b	b*	c	a	a	a	b	b	c	a	a	a	a										
August	Date								1	2	3	4	5	6	7	8	9	10	11	12	13	14	15		
	Daily schedule								b	b	c	a	a	a	a	b	b	c	a	a	a	a	b		
a b c	Date		16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31							
16 10 5	Daily schedule		b	c	a	a	a	a	b	b	c	a	a	a	a	b	b	c							
September	Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19		
	Daily schedule				a	a	a	a	b	b	c	a	a	a	a	b	b	c	a	a	a	a	b		
a b c	Date		20	21	22	23	24	25	26	27	28	29	30												
15 11 4	Daily schedule		b	b*	b*	b*	c	a	b	b	c	a	a												
October	Date						1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17		
	Daily schedule						a	a	b	b	c	a	a	a	a	b	b	b*	c	a	a	a	b		
a b c	Date		18	19	20	21	22	23	24	25	26	27	28	29	30	31									
17 10 4	Daily schedule		b	c	a	a	a	a	b	b	c	a	a	a	a	b									
November	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21		
	Daily schedule		b	c	b*	a	a	a	b	b	c	a	a	a	a	b	b	c	a	a	a	a	b		
a b c	Date		22	23	24	25	26	27	28	29	30														
14 11 5	Daily schedule		b	b*	c	a	a	a	b	b	c														
December	Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19		
	Daily schedule				a	a	a	a	b	b	c	a	a	a	a	b	b	c	a	a	a	a	b		
a b c	Date		20	21	22	23	24	25	26	27	28	29	30	31											
15 9 7	Daily schedule		b	c	a	b*	a	a	b	b	c	c*	c*	c*											
Yearly total			a: Week days																						
a			b: Saturday, Sunday, Holidays																						
b			c: One day a week, Year-end and new-year holidays																						
c																									
189			118																						
118			58																						
58																									

Table B.1 (continued)

Annual schedule F			Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.	Su.	Mo.	Tu.	We.	Th.	Fr.	Sa.			
January	Date						1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17			
	Daily schedule						c*	c*	b*	b	a	a	a	a	a	b	b	b*	a	a	a	a	b			
a	b	c	Date		18	19	20	21	22	23	24	25	26	27	28	29	30	31								
9	10	12	Daily schedule		b	c	c	c	c	c	b	b	c	c	c	c	c	b								
February	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
	Daily schedule		b	a	a	a	a	a	b	b	a	a	b*	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date		22	23	24	25	26	27	28															
14	9	5	Daily schedule		b	c	c	c	c	c	b															
March	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
	Daily schedule		b	c	c	c	c	c	b	b	a	a	a	a	a	b	b	a	a	a	a	b*	b			
a	b	c	Date		22	23	24	25	26	27	28	29	30	31												
9	10	12	Daily schedule		b	c	c	c	c	c	b	b	c	c												
April	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18			
	Daily schedule					c	c	c	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date		19	20	21	22	23	24	25	26	27	28	29	30										
10	9	11	Daily schedule		b	c	c	c	c	c	b	b	c	c	b*	c										
May	Date							1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16			
	Daily schedule							c	b	b*	b*	b*	b*	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date		17	18	19	20	21	22	23	24	25	26	27	28	29	30	31							
7	13	11	Daily schedule		b	c	c	c	c	c	b	b	c	c	c	c	b	b								
June	Date			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
	Daily schedule			a	a	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date		21	22	23	24	25	26	27	28	29	30												
15	8	7	Daily schedule		b	c	c	c	c	c	b	b	c	c												
July	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18			
	Daily schedule					c	c	c	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date		19	20	21	22	23	24	25	26	27	28	29	30	31									
10	9	12	Daily schedule		b	b*	c	c	c	c	b	b	c	c	c	c	c									
August	Date								1	2	3	4	5	6	7	8	9	10	11	12	13	14	15			
	Daily schedule								b	b	a	a	a	a	a	a	b	b	a	a	a	a	b			
a	b	c	Date		16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31						
11	10	10	Daily schedule		b	c	c	c	c	c	b	b	c	c	c	c	c	b	b	a						
September	Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			
	Daily schedule				a	a	a	a	b	b	a	a	a	a	a	a	b	b	a	a	a	a	b			
a	b	c	Date		20	21	22	23	24	25	26	27	28	29	30											
14	11	5	Daily schedule		b	b*	b*	b*	c	c	b	b	c	c	c											
October	Date					1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17				
	Daily schedule					c	c	b	b	a	a	a	a	a	a	b	b	b*	a	a	a	a	b			
a	b	c	Date		18	19	20	21	22	23	24	25	26	27	28	29	30	31								
9	10	12	Daily schedule		b	c	c	c	c	c	b	b	c	c	c	c	c	b								
November	Date		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21			
	Daily schedule		b	a	b*	a	a	a	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date		22	23	24	25	26	27	28	29	30													
14	11	5	Daily schedule		b	b*	c	c	c	c	b	b	c													
December	Date				1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			
	Daily schedule				c	c	c	c	b	b	a	a	a	a	a	b	b	a	a	a	a	a	b			
a	b	c	Date		20	21	22	23	24	25	26	27	28	29	30	31										
10	9	12	Daily schedule		b	c	c	b*	c	c	b	b	c	c*	c*	c*										
Yearly total																										
a	b	c																								
132	119	114																								
a: Week days b: Saturday, Sunday, Holidays c: Two weeks a month																										

Annex C (informative)

Categories of space and zone

C.1 General

Annex C provides an example of categories of space or zone for buildings listed in Table 9. In tables, spaces or zones in bold letters are representing ones for each category of building. This annex includes rather detailed categories of spaces or zones when they are compared with current categories used for building energy calculations. However, in practices for application process of complying with energy standard or for energy certification, any standardized rule to allocate one schedule and condition to any possible kinds of space and zone of target kinds of building has to be prepared for energy calculation. Therefore, even though it is not indispensable to prepare different schedules and conditions for each of different categories of space and zone, it is indispensable to set a table giving correspondence between possible names in drawings and categories of space and zone for energy calculations.

C.2 Categories of space or zone

C.2.1 Office building

Representing space or zone is “office room” or “office room with heavy electrical load”. For a set of personal offices or meeting room, the application of simultaneous usage ratio is recommended in order to make energy calculation more accurate, when partial air-conditioning is possible in the building. If the building contains other functions such as shops, restaurant and so on, types of space or zone for relevant categories of building shall be used.

Table C.1 — Categories of space or zone for office building

Of-1 Office room
Of-2 Office room with heavy electrical load
Of-3 Meeting room
Of-4 Tea room
Of-5 Canteen
Of-6 Central monitor room
Of-7 Changing room
Of-8 Corridor
Of-9 Lobby
Of-10 Lavatory
Of-11 Smoking room
Of-12 Kitchen
Of-13 Indoor parking garage
Of-14 Machine room
Of-15 Electric room
Of-16 Kitchenette with hot water server
Of-17 Storage room
Of-18 Printing room
Of-19 Garbage storage

C.2.2 Hotel building

C.2.2 Hotel building

Representative spaces or zones are “guest room”, and “banquet hall”, “conference hall” or “wedding hall”. Especially the characteristics of “guest room” and the halls are quite different to each other. For the guest room and the halls, the application of simultaneous usage ratio is recommended in order to make energy calculation more accurate.

Table C.2 — Categories of space or zone for hotel building

Ht-1 Guest room
Ht-2 Bath room inside guest room
Ht-3 Front desk open all day
Ht-4 Office room open all day
Ht-5 Corridor open all day
Ht-6 Lobby open all day
Ht-7 Lavatory open all day
Ht-8 Smoking room open all day
Ht-9 Banquet hall
Ht-10 Conference hall
Ht-11 Wedding ceremony hall
Ht-12 Restaurant
Ht-13 Lounge
Ht-14 Bar
Ht-15 Shop
Ht-16 Staff canteen
Ht-17 Changing room
Ht-18 Front desk open not all day
Ht-19 Office room open not all day
Ht-20 Corridor open not all day
Ht-21 Lobby open not all day
Ht-22 Lavatory open not all day
Ht-23 Smoking room open not all day
Ht-24 Kitchen
Ht-25 Indoor parking garage
Ht-26 Machine room
Ht-27 Electric room
Ht-28 Kitchenette with hot water server
Ht-29 Storage room
Ht-30 Printing room
Ht-31 Garbage storage room

C.2.3 Hospital building

The representative spaces or zones are “ward” and “consultation room”. The schedules of those spaces are quite different to each other and some hospital buildings have only one of those spaces or zones.

Table C.3 — Categories of space or zone for hospital building

Hp-1 Ward
Hp-2 Bathroom
Hp-3 Nurses' station
Hp-4 Corridor open all day
Hp-5 Lobby open all day
Hp-6 Lavatory for common use open all day
Hp-7 Smoking room open all day
Hp-8 Consultation room
Hp-9 Waiting room
Hp-10 Operating room
Hp-11 Examination room
Hp-12 Intensive care unit
Hp-13 Dissecting room
Hp-14 Restaurant
Hp-15 Office room
Hp-16 Changing room
Hp-17 Corridor open not all day
Hp-18 Lobby open not all day
Hp-19 Lavatory for common use open not all day
Hp-20 Smoking room open not all day
Hp-21 Kitchen
Hp-22 Indoor parking garage
Hp-23 Machine room
Hp-24 Electric room
Hp-25 Kitchenette with hot water server
Hp-26 Storage room
Hp-27 Printing room
Hp-28 Garbage storage room

C.2.4 Shop building

The representative spaces or zones are “large store”, “small store” and “supermarket”. Among shop buildings, there are various categories of room or zone depending on sold goods and the way of displaying them. The change of occupancy density during a week and seasons is remarkable for some categories of shop building.

Table C.4 — Categories of space or zone for shop building

Sh-1 Large store
Sh-2 Small store
Sh-3 Supermarket
Sh-4 Storage and goods disposal room
Sh-5 Office room
Sh-6 Changing room
Sh-7 Lobby
Sh-8 Lavatory
Sh-9 Smoking room
Sh-10 Kitchen
Sh-11 Indoor parking garage
Sh-12 Machine room
Sh-13 Electric room
Sh-14 Kitchenette with hot water server
Sh-15 Storage room
Sh-16 Printing room
Sh-17 Garbage storage room

C.2.5 Educational building

There are various categories of educational building, from nursery school to university. Heat gains due to person can be different according to the size of occupants, and composition of spaces or zones can be different according to their function. The representative spaces or zones are “class room”, “lecture room” and “lecture hall”, but “office room”, “study room” and “experimental laboratory” should be added in the case of universities. Most of educational organizations have “gymnasium”, whose schedule and condition is quite different from other spaces or zones. “Canteen of junior, junior high and high school” and “kitchen” resemble “dining room of restaurant” and its “kitchen”, respectively, but their schedules are different to each other.

Table C.5 — Categories of space or zone for educational building

Ed-1 Class room of junior and junior high school
Ed-2 Class room of high school
Ed-3 Teachers' room
Ed-4 Canteen of junior, junior high and high school
Ed-5 Lecture room of university
Ed-6 Canteen of university
Ed-7 Office room
Ed-8 Study room
Ed-9 Computer exercise room
Ed-10 Laboratory
Ed-11 Practice room
Ed-12 Lecture hall and gymnasium
Ed-13 Night watchman's room
Ed-14 Changing room
Ed-15 Corridor
Ed-16 Lobby
Ed-17 Lavatory
Ed-18 Smoking room
Ed-19 Kitchen
Ed-20 Indoor parking garage
Ed-21 Machine room
Ed-22 Electric room
Ed-23 Kitchenette with hot water server
Ed-24 Storage room
Ed-25 Printing room
Ed-26 Garbage storage room

C.2.6 Restaurant building

The representative spaces or zones are “dining room for restaurant”, “guest room of coffee house”, “bar” and “kitchen”.

Table C.6 — Categories of space or zone for restaurant building

Rs-1 Dining room of restaurant
Rs-2 Guest room of Cafeteria
Rs-3 Guest room of coffee house
Rs-4 Bar
Rs-5 Reception
Rs-6 Office room
Rs-7 Changing room
Rs-8 Corridor
Rs-9 Lobby
Rs-10 Lavatory
Rs-11 Smoking room
Rs-12 Kitchen
Rs-13 Indoor parking garage
Rs-14 Machine room
Rs-15 Electric room
Rs-16 Kitchenette with hot water server
Rs-17 Storage room
Rs-18 Printing room
Rs-19 Garbage storage room

C.2.7 Library building

The representative space or zone is “reading room”. Categories of attached space or zone are given in C.2.12.

Table C.7 — Categories of space or zone for library building

Lb-1 Reading room
Lb-2 Lobby
Lb-3 Lavatory
Lb-4 Smoking room

C.2.8 Museum building

The representative space or zone is “exhibition room”. Categories of attached space or zone are given in C.2.12.

Table C.8 — Categories of space or zone for museum building

Ms-1 Exhibition room
Ms-2 Lobby
Ms-3 Lavatory
Ms-4 Smoking room

C.2.9 Sports and amusement building

Categories of attached space or zone are given in C.2.12.

Table C.9 — Categories of space or zone for sports facilities building

Sa-1 Exercise room of sports club
Sa-2 Lobby of sports club
Sa-3 Lavatory of sports club
Sa-4 Smoking room of sports club
Sa-5 Skating rink for official competition
Sa-6 Gymnasium for official competition
Sa-7 Skating rink for general competition
Sa-8 Gymnasium for general competition
Sa-9 Skating rink for recreation
Sa-10 Gymnasium for recreation
Sa-11 Spectator stand of gymnasium or skating rink
Sa-12 Lobby of gymnasium or skating rink
Sa-13 Lavatory of gymnasium or skating rink
Sa-14 Smoking room of gymnasium or skating rink
Sa-15 Spectator stand of racing course
Sa-16 Betting shop of racing course
Sa-17 Lobby of racing course
Sa-18 Lavatory of racing course
Sa-19 Smoking room of racing course
Sa-20 Bowling alley
Sa-21 Karaoke room
Sa-22 Pachinko or slot machine hall
Sa-23 Bath hall of bathhouse
Sa-24 Changing room of bathhouse
Sa-25 Lounge of bathhouse
Sa-26 Lobby of bathhouse
Sa-27 Lavatory of bathhouse
Sa-28 Smoking room of bathhouse

C.2.10 Theatre building

Categories of attached space or zone are given in C.2.12.

Table C.10 — Categories of space or zone for theatre building

Th-1 Auditorium of theatre
Th-2 Stage of theatre
Th-3 Backstage of theatre
Th-4 Lobby of theatre
Th-5 Lavatory of theatre
Th-6 Smoking room of theatre
Th-7 Auditorium of movie theatre
Th-8 Lobby of movie theatre
Th-9 Lavatory of movie theatre
Th-10 Smoking room of movie theatre

C.2.11 Religious building

Categories of attached space or zone are given in C.2.12.

Table C.11 — Categories of space or zone for religious building

Re-1 Main hall of religious building
Re-2 Lobby
Re-3 Lavatory
Re-4 Smoking room

C.2.12 Attached space or zone for assembly buildings

The following spaces or zones are attached ones to library (C.2.7), museum (C.2.8), sports and amusement (C.2.9), theatre (C.2.10) and religious (C.2.11) buildings.

Table C.12 — Categories of attached space or zone for assembly buildings

At_As-1 Kitchen
At_As-2 Indoor parking garage
At_As-3 Machine room
At_As-4 Electric room
At_As-5 Kitchenette with hot water server
At_As-6 Storage room
At_As-7 Printing room
At_As-8 Garbage storage room

C.2.13 Warehouse building

Table C.13 — Categories of space or zone for warehouse building

Fc-1 Storage room
Fc-2 Outdoor parking garage

Annex D

(informative)

A set of daily schedules for categories of space and zone

D.1 General

Annex D provides an example of a set of daily schedules is provided for the categories of space and zone listed in Table C.1 to Table C.13. The format and the items of the daily schedules are explained in Annex A. The annual schedules *A* to *F* referred in the part “General” are given in Annex B.

This set of daily schedules is developed in 2011 to 2012 for the energy calculation of non-residential buildings.^[15] The values were determined on the basis of the questionnaire and the interview to designers of building technical systems and on the field measurement of electricity consumption for lighting equipment and electric appliances. As for the internal heat gain due to lighting, it should be noted that the values are based on the situation before a wide spread of LEDs. Therefore, the values in the daily schedules in this annex should be used only when no original daily schedule is available.

In the part “Lighting”, the maintained average illuminance on the height of working plane are given as part of the requirement of lighting design. The values are given just as examples and the relevant standards, i.e. ISO 8995-1, shall be applied and referenced when determining the values.

D.2 Daily schedules

D.2.1 Office building

Category	No.	Of-1	Building	Office building	Space/ZONE	Office room
----------	-----	------	----------	-----------------	------------	-------------

General		Space heating & cooling						Ventilation for unconditioned space			Lighting			Domestic hot water									
Annual schedule	Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days										
A	[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]										
	3374	12.0	11.9	0.1	12.0	5.0	0		0.0	3133		750	241										
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp. (deg) hum.(%)	Set-back operation Temp. (deg) hum.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage							
a	241	a	7	21	(14)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	8	21	(13)	[m]	(L/person-day)	
b	51	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied						
																						Week days						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23			
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0			
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	50	100	100	100	100	100	100	100	80	0	0	0		
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	60	100	100	100	100	100	100	50	30	20	0	0	0		
Int. heat gain due to appliances	25	25	25	25	25	25	25	25	100	100	100	100	100	80	100	100	100	100	100	100	50	50	25	25	25			
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied						
																						Saturday						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23			
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0				
Int. heat gain due to appliances	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25				
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied						
																						Sunday, Holidays, year-end and new-year holidays						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23			
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0				
Int. heat gain due to appliances	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25	25				

space/zone to be applied	Office as a whole, telephone operator room, executive room, health consultation room, design room, drawing room, car dispatcher room, information booth
note	office as a whole. Service hot water usage for lavatory is assumed.

Category	No.	Of-2	Building	Office building	Space/ZONE	Office room with heavy electrical load
----------	-----	------	----------	-----------------	------------	--

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		3374	12.0	11.9	0.1	30.0	5.0	0		0.0	3133		750	241									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	7	21	(14)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	8	21	(13)			
b	51	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied	
	time						time								time								Week days	
	0 1 2 3 4 5						6 7 8 9 10 11 12 13 14								15 16 17 18 19 20 21 22 23									
	Simultaneous usage ratio						Simultaneous usage ratio								Simultaneous usage ratio									
Int. heat gain due to lighting						Int. heat gain due to lighting								Int. heat gain due to lighting										
Int. heat gain due to occupants						Int. heat gain due to occupants								Int. heat gain due to occupants										
Int. heat gain due to appliances						Int. heat gain due to appliances								Int. heat gain due to appliances										
0 0 0 0 0 0						0 0 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 0 0 0								0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0										
0 0 0 0 0 0						0 0 100 100 100 100 100 50 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100								0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0										
25 25 25 25 25 25						25 25 100 100 100 100 100 80 100 100 100 100 100 100 100 100 100 100 100 100 100 50 50 25 25 25								25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25										

Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied	
	time						time								time								Saturday	
	0 1 2 3 4 5						6 7 8 9 10 11 12 13 14								15 16 17 18 19 20 21 22 23									
	Simultaneous usage ratio						Simultaneous usage ratio								Simultaneous usage ratio									
Int. heat gain due to lighting						Int. heat gain due to lighting								Int. heat gain due to lighting										
Int. heat gain due to occupants						Int. heat gain due to occupants								Int. heat gain due to occupants										
Int. heat gain due to appliances						Int. heat gain due to appliances								Int. heat gain due to appliances										
0 0 0 0 0 0						0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0								0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0										
0 0 0 0 0 0						0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0								0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0										
25 25 25 25 25 25						25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25								25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25										

Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied	
	time						time								time								Sunday, Holidays, year-end and new-year holidays	
	0 1 2 3 4 5						6 7 8 9 10 11 12 13 14								15 16 17 18 19 20 21 22 23									
	Simultaneous usage ratio						Simultaneous usage ratio								Simultaneous usage ratio									
Int. heat gain due to lighting						Int. heat gain due to lighting								Int. heat gain due to lighting										
Int. heat gain due to occupants						Int. heat gain due to occupants								Int. heat gain due to occupants										
Int. heat gain due to appliances						Int. heat gain due to appliances								Int. heat gain due to appliances										
0 0 0 0 0 0						0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0								0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0										
0 0 0 0 0 0						0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0								0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0										
25 25 25 25 25 25						25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25								25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25 25										

space/zone to be applied	Computerized office room, server space, recording studio, control room, research room
note	office room with heavy electrical load. Service hot water usage for lavatory is assumed.

Category	No.	Of-3	Building	Office building	Space/ZONE	Meeting room
----------	-----	------	----------	-----------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		2410	10.0	29.8	0.3	2.0	12.0	0		0.0		2169		500	241							
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	8	18	(10)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	9	18	(9)	[m]	[L/person-day]	
b	51	b	-	-	(0)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	50	50	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

Category	No.	Of-4	Building	Office building	Space/ZONE	Tea room
----------	-----	------	----------	-----------------	------------	----------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		2410	10.0	29.8	0.3	2.0	12.0	0			0.0	2169		300	241								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns		Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage		
a	241	a	8	18	(10)	Heating season		w1	22	40	-	-	a	-	-	(0)	-	a	9	18	(9)	-	-
b	51	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/m2·day]
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	32.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	50	50	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Resting room
note	service hot water usage for cafeteria and coffee house is assumed.

Category	No.	Of-5	Building	Office building	Space/ZONE	Canteen
----------	-----	------	----------	-----------------	------------	---------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		723	30.0	59.5	0.5	0.0	15.0	0		0.0		723		500	241							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	11	14	(3)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	11	14	(3)			
b	51	b	-	-	(0)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/m2·day]
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	48.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting					Hourly ratio of int. heat gain due to occupants					Hourly ratio of heat gain due to appliances					Days to be applied									
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	100	100	100	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	100	100	100	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	25	100	25	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Week days																									
Daily schedule b	Hourly ratio of int. heat gain due to lighting					Hourly ratio of int. heat gain due to occupants					Hourly ratio of heat gain due to appliances					Days to be applied									
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Saturday																									
Daily schedule c	Hourly ratio of int. heat gain due to lighting					Hourly ratio of int. heat gain due to occupants					Hourly ratio of heat gain due to appliances					Days to be applied									
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Staff canteen, cafeteria, restaurant
note	service hot water usage for restaurant is assumed.

Category	No.	Of-6	Building	Office building	Space/ZONE	Central monitor room
----------	-----	------	----------	-----------------	------------	----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		8760	20.0	17.9	0.2	30.0	4.0	0		0.0	8760		500	365									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	-	24	(24)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	-	24	(24)			
b	51	b	-	24	(24)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	24	(24)	[m]	[L/person-day]
c	73	c	-	24	(24)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	24	(24)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	50	
Int. heat gain due to appliances	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	
Int. heat gain due to appliances	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	
Int. heat gain due to appliances	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
Week day																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Central control room, disaster prevention center, guardroom, night watchman's room
note	Continuous usage is assumed throughout the year.

Category	No.	Of-8	Building	Office building	Space/ZONE	Corridor
----------	-----	------	----------	-----------------	------------	----------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		3133	15.0	3.6	0.0	0.0	2.5	0		0.0		3133		200	0								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage					
a	241	a	8	21	(13)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	8	21	(13)	[m]	-	
b	51	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
STANDARDS50.COM																									
Click to view the full PDF of ISO 18523-1:2017																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	passage, stairs, vending machine corner
note	

Category	No.	Of-9	Building	Office building	Space/ZONE	Lobby
----------	-----	------	----------	-----------------	------------	-------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		3133	15.0	3.6	0.0	0.0	2.5	0		0.0		3133		500	241							
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	8	21	(13)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	8	21	(13)	[m]	[L/person-day]	
b	51	b	-	-	(0)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied					
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23		
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
Week days																											
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied					
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23		
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
Saturday																											
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied					
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23		
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
Sunday, Holidays, year-end and new-year holidays																											

space/zone to be applied	Atrium, elevator hall, entrance hall, entrance, lounge, gallery, reception, stand, waiting room
note	Service hot water usage for lavatory is assumed.

Category	No.	Of-10	Building	Office building	Space/ZONE	Lavatory
----------	-----	-------	----------	-----------------	------------	----------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		3133	15.0	3.6	0.0	0.0	2.5	3133			40.5	3133		300	0								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241	a	8	21	(13)	Heating season		w1	22	40	-	-	a	8	21	(13)		a	8	21	(13)		
b	51	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	15	c	-	-	(0)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
STANDARDS50.COM																									
Click to view the full PDF of ISO 18523-1:2015																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Of-11	Building	Office building	Space/ZONE	Smoking room
----------	-----	-------	----------	-----------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		3133	15.0	3.6	0.0	0.0	2.5	3133		81.0		3133		300	0								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns		Normal operation Temp. [deg] hum. [%]		Set-back operation Temp. [deg] hum. [%]		Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	8	21	(13)	Heating season		w1	22	40	-	-	a	8		21	(13)			b	8	21	(13)
b	51	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	30	c	-	-	(0)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

Category	No.	<i>Of-12</i>	Building	<i>Office building</i>	Space/ZONE	<i>Kitchen</i>
-----------------	------------	--------------	-----------------	------------------------	-------------------	----------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
		0	-	-	-	-	-	2000	135.0	2000	750	0				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season		0	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season		0	-	-	-	b	-	-	(0)	
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	c	-	-	(0)	

space/zone to be applied	<i>caboose, inspection and receiving room, syringing room, pantry, service room</i>
note	<i>Air change rate of 50 1/h is assumed.</i>

Category	No.	<i>Of-13</i>	Building	<i>Office building</i>	Space/ZONE	<i>Indoor parking garage</i>
-----------------	------------	--------------	-----------------	------------------------	-------------------	------------------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days			
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]			
		0	-	-	-	-	-	3500		30.0	3500		150	0			
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp. [deg] humi. (%)	Set-back operation Temp. [deg] humi. (%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	

space/zone to be applied	<i>Parking, carriage porch, car barn</i>
note	<i>Air change rate of 10 1/h is assumed.</i>

Category	No.	<i>Of-14</i>	Building	<i>Office building</i>	Space/ZONE	<i>Machine room</i>
-----------------	------------	--------------	-----------------	------------------------	-------------------	---------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water	
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]		
		0	-	-	-	-	-	8760		13.5		200		200	0		
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.[deg] humi. [%]	Set-back operation Temp.[deg] humi. [%]	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)		
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	<i>Air conditioning room, boiler room, fan room, pump room, gas container room</i>
note	<i>Air change rate of 5 1/h is assumed.</i>

Category	No.	<i>Of-15</i>	Building	<i>Office building</i>	Space/ZONE	<i>Electric room</i>
-----------------	------------	--------------	-----------------	------------------------	-------------------	----------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting				Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days			
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]			
		0	-	-	-	-	-	8760		27.0	200		200	0			
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage		
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	[m]	-
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	<i>MDF room, CPU room, server room, PBX room, lift-motor room, battery room</i>
note	<i>electric machine with large heat emission and air change rate of 10 1/h are assumed.</i>

Category	No.	<i>Of-16</i>	Building	<i>Office building</i>	Space/ZONE	<i>Kitchenette with hot water server</i>
-----------------	------------	--------------	-----------------	------------------------	-------------------	--

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water					
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days					
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]					
		0	-	-	-	-	-	2000	13.5	1000	300	0					
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage		
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[m]
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0.8

space/zone to be applied	<i>Pantry, refresh corner</i>
note	<i>Air change rate of 5 1/h is assumed.</i>

Category	No.	<i>Of-17</i>	Building	<i>Office building</i>	Space/ZONE	<i>Storage room</i>
-----------------	------------	--------------	-----------------	------------------------	-------------------	---------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water
Annual schedule	Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days		
A	[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]		
	0	-	-	-	-	-	2000	13.5	1000	300	0		
Total number of days of each daily schedule [day]	Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp. [deg] humi. (%)	Set-back operation Temp. [deg] humi. (%)	Time of start & end (hours)		Time of start & end (total hours)		Height of working plane	Total daily usage
a	241	a	-	(0)	Heating season	0	-	-	-	a	-	(0)	
b	51	b	-	(0)	Cooling season	0	-	-	-	b	-	(0)	[m]
c	73	c	-	(0)	Intermediate season	0	-	-	-	c	-	(0)	0.0

space/zone to be applied	
note	<i>Air change rate of 5 1/h is assumed.</i>

Category	No.	Of-18	Building	Office building	Space/ZONE	Printing room
----------	-----	-------	----------	-----------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water	
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]		
		0	-	-	-	-	-	2000		27.0		1000		500	0		
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	-	-
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0.8	0.0

space/zone to be applied	Copy room
note	Air change rate of 10 1/h is assumed.

Category	No.	Of-19	Building	Office building	Space/ZONE	Garbage storage
----------	-----	-------	----------	-----------------	------------	-----------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days					
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]	[m ³ /h·m ²]	[hours/yr.]	[lux]	[day]					
		0	-	-	-	-	-	2000	40.5	1000	150	0					
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.[deg] humi [%]	Set-back operation Temp.[deg] humi [%]	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage			
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	-	
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	garbage collection point, waste-collection point
note	Air change rate of 15 1/h is assumed.

D.2.2 Hotel building

Category	No.	Ht-1	Building	Hotel building	Space/ZONE	Guest room
----------	-----	------	----------	----------------	------------	------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
		5475	15.0	6.4	0.1	4.0	4.0	0	0.0	2920	300	365				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (to total hours)	Height of working plane	Total daily usage		
a	241	a	19	10	(15)	Heating season	w1	22	40	-	-	a	19	10	(8)	
b	51	b	19	10	(15)	Cooling season	s1	26	50	-	-	b	19	10	(8)	[L/person-day]
c	73	c	19	10	(15)	Intermediate season	m1	24	50	-	-	c	19	10	(8)	0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	50	50	50	50	50	50	50	50	50	25	0	0	0	0	0	0	0	0	0	25	50	50	50	50
	Int. heat gain due to lighting	100	0	0	0	0	0	0	0	0	50	50	0	0	0	0	0	0	0	0	100	100	100	100	100
Int. heat gain due to occupants	80	80	80	80	80	80	80	80	80	80	0	0	0	0	0	0	0	0	0	80	80	80	80	80	
Int. heat gain due to appliances	50	20	20	20	20	20	20	20	20	50	50	20	20	20	20	20	20	20	20	100	100	100	100	50	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	80	80	80	80	80	80	80	80	80	40	0	0	0	0	0	0	0	0	0	40	80	80	80	80
	Int. heat gain due to lighting	100	0	0	0	0	0	0	0	0	50	50	0	0	0	0	0	0	0	0	100	100	100	100	100
Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0	0	100	100	100	100	100	
Int. heat gain due to appliances	50	20	20	20	20	20	20	20	20	50	50	20	20	20	20	20	20	20	20	100	100	100	100	50	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	40	40	40	40	40	40	40	40	40	20	0	0	0	0	0	0	0	0	0	20	40	40	40	40
	Int. heat gain due to lighting	100	0	0	0	0	0	0	0	0	50	50	0	0	0	0	0	0	0	0	100	100	100	100	100
Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0	0	100	100	100	100	100	
Int. heat gain due to appliances	50	20	20	20	20	20	20	20	20	50	50	20	20	20	20	20	20	20	20	100	100	100	100	50	
STANDARD ISO 18523																									
Click to view the full PDF of ISO 18523																									
Week days																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Guest room as a whole, single room, twin room
note	Service hot water usage for bathing or shower of city hotels is assumed.

Category	No.	Ht-2	Building	Hotel building	Space/ZONE	Bath room inside guest room
----------	-----	------	----------	----------------	------------	-----------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		5475	15.0	6.4	0.1	4.0	4.0	5475		21.6		2920		300	365							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage				
a	241	a	19	10	(15)	Heating season	w1	22	40	-	-	a	19	10	(15)	a	19	10	(8)	[m]	[L/person-day]	
b	51	b	19	10	(15)	Cooling season	s1	26	50	-	-	b	19	10	(15)	[1/h]	b	19	10	(8)	[m]	[L/person-day]
c	73	c	19	10	(15)	Intermediate season	m1	24	50	-	-	c	19	10	(15)	8	c	19	10	(8)	0	165.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied	
	time						time								time								Week days	
	0 1 2 3 4 5						6 7 8 9 10 11 12 13 14								15 16 17 18 19 20 21 22 23									
	Simultaneous usage ratio						50 50 50 50 50 50								50 50 50 25 0 0 0 0 0 0 0 0 0 0 0 0 0 25 50 50 50 50									
	Int. heat gain due to lighting						100 0 0 0 0 0 0 0 50 50 0 0 0 0 0 0 0 0 0 0 100 100 100 100 100								0 0 0 0 0 100 100 100 100 100									
Daily schedule b	Int. heat gain due to occupants						80 80 80 80 80 80 80 80 80 80 0 0 0 0 0 0 0 0 0 0 80 80 80 80 80								80 80 80 80 80 80 80 80 80 80 80 80 80 80 80 80 80 80 80									
	Int. heat gain due to appliances						50 20 20 20 20 20 20 20 50 50 20 20 20 20 20 20 20 20 20 100 100 100 100 50								20 20 20 20 20 100 100 100 100 50									
	Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied
		time						time								time								Sunday, Holidays, year-end and new-year holidays
		0 1 2 3 4 5						6 7 8 9 10 11 12 13 14								15 16 17 18 19 20 21 22 23								
Simultaneous usage ratio						40 40 40 40 40 40 40 40 40 20 0 0 0 0 0 0 0 0 0 0 20 40 40 40 40								0 0 0 0 20 40 40 40 40										
Int. heat gain due to lighting						100 0 0 0 0 0 0 0 50 50 0 0 0 0 0 0 0 0 0 0 100 100 100 100 100								0 0 0 0 100 100 100 100 100										
Int. heat gain due to occupants						100 100 100 100 100 100 100 100 100 100 0 0 0 0 0 0 0 0 0 0 100 100 100 100 100								0 0 0 0 100 100 100 100 100										
Int. heat gain due to appliances						50 20 20 20 20 20 20 20 50 50 20 20 20 20 20 20 20 20 20 100 100 100 100 50								20 20 20 20 100 100 100 100 50										

space/zone to be applied	Lavatory, bathroom, dressing room
note	Service hot water usage for bathing or shower of city hotels is assumed. Air change rate of 8 1/h is assumed.

Category	No.	Ht-3	Building	Hotel building	Space/ZONE	Front desk open all day
----------	-----	------	----------	----------------	------------	-------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		8760	20.0	11.9	0.1	0.0	2.5	0		0.0	8760		500	0									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	-	24	(24)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	-	24	(24)			
b	51	b	-	24	(24)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	24	(24)	[m]	-
c	73	c	-	24	(24)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	24	(24)	0.8	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
STANDARDS SO.COM																									
Click to view the full PDF of ISO 18523-1:2017																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Reception desk, cloak counter
note	Continuous usage is assumed throughout the year.

Category	No.	Ht-4	Building	Hotel building	Space/ZONE	Office room open all day
----------	-----	------	----------	----------------	------------	--------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days					
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]					
		8760	20.0	23.8	0.2	10.0	5.0	0		0.0		8760		750	365					
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241	a	-	24 (24)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	-	24 (24)	[m]	[L/person-day]	
b	51	b	-	24 (24)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	24 (24)	[m]	[L/person-day]
c	73	c	-	24 (24)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	24 (24)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to occupants	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	20
Int. heat gain due to appliances	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	50	50
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to occupants	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	20
Int. heat gain due to appliances	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	50	50
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to occupants	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	20
Int. heat gain due to appliances	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	50	50
STANDARDS50.COM - Click to view the full PDF of ISO 18523-1:2017																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Hotel office, central disaster prevention room, nap room, control room, control room
note	Continuous usage is assumed throughout the year.

Category	No.	Ht-5	Building	Hotel building	Space/ZONE	Corridor open all day
----------	-----	------	----------	----------------	------------	-----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		8760	10.0	6.0	0.1	0.0	2.5	0		0.0		8760		150	0								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	-	24	(24)	Heating season		w1	22	40	-	-	a	-	-	(0)	-	-					
b	51	b	-	24	(24)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	24	(24)	[m]	-
c	73	c	-	24	(24)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	24	(24)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	0	0	0	0	0	0	0	0	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	0	0	0	0	0	0	0	0	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	0	0	0	0	0	0	0	0	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Passage, stairs, vending machine corner, linen room, laundromet
note	Continuous usage is assumed throughout the year.

Category	No.	Ht-6	Building	Hotel building	Space/ZONE	Lobby open all day
----------	-----	------	----------	----------------	------------	--------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting		Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days					
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]					
		8760	20.0	11.9	0.1	0.0	2.5		0		0.0	8760		300	365					
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp. [deg] hum. [%]	Set-back operation Temp. [deg] hum. [%]	Time of start & end [hours]			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241	a	-	24 (24)	Heating season		w1	22 40	-	-	a	-	-	(0)	a	-	24 (24)	[m]	[L/person·day]	
b	51	b	-	24 (24)	Cooling season		s1	26 50	-	-	b	-	-	(0)	[1/h]	b	-	24 (24)	[m]	[L/person·day]
c	73	c	-	24 (24)	Intermediate season		m1	24 50	-	-	c	-	-	(0)	-	c	-	24 (24)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			

Category	No.	Ht-7	Building	Hotel building	Space/ZONE	Lavatory open all day
----------	-----	------	----------	----------------	------------	-----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		8760	20.0	11.9	0.1	0.0	2.5	8760		40.5	8760		300	0									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	-	24	(24)	Heating season		w1	22	40	-	-	a	-	24	(24)							
b	51	b	-	24	(24)	Cooling season		s1	26	50	-	-	b	-	24	(24)	[1/h]	b	-	24	(24)	[m]	-
c	73	c	-	24	(24)	Intermediate season		m1	24	50	-	-	c	-	24	(24)	15	c	-	24	(24)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Continuous usage is assumed throughout the year. Air change rate of 15 1/h is assumed.

Category	No.	Ht-8	Building	Hotel building	Space/ZONE	Smoking room open all day
----------	-----	------	----------	----------------	------------	---------------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days						
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]						
		8760	20.0	11.9	0.1	0.0	2.5	8760	81.0	8760	300	0						
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp. [deg] hum. [%]		Set-back operation Temp. [deg] hum. [%]		Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	- 24 (24)	Heating season		w1	22	40	-	-	a	- 24 (24)		b				- 24 (24)
b	51	b	- 24 (24)	Cooling season		s1	26	50	-	-	b	- 24 (24)	[1/h]		b	- 24 (24)	[m]	-
c	73	c	- 24 (24)	Intermediate season		m1	24	50	-	-	c	- 24 (24)	30		c	- 24 (24)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	20	20	20	20	20	20	20	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	20	20	20	20	20	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Week days																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Smoking corner
note	Continuous usage is assumed throughout the year. Air change rate of 30 1/h is assumed.

Category	No.	Ht-9	Building	Hotel building	Space/ZONE	Banquet hall
----------	-----	------	----------	----------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		4380	100.0	101.5	0.7	12.0	20.0	0		0.0	4380		750	365									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	9	21	(12)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	9	21	(12)			
b	51	b	9	21	(12)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	21	(12)	[m]	[L/person-day]
c	73	c	9	21	(12)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	9	21	(12)	60	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	70	70	70	70	70	70	70	70	70	70	70	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0		

space/zone to be applied	Wedding hall, grand hall
note	

Category	No.	Ht-10	Building	Hotel building	Space/ZONE	Conference hall
----------	-----	-------	----------	----------------	------------	-----------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		4380	50.0	101.5	0.7	0.0	20.0	0		0.0		4380		750	365							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage					
a	241	a	9	21	(12)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	9	21	(12)			
b	51	b	9	21	(12)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	21	(12)	[m]	[L/person-day]
c	73	c	9	21	(12)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	9	21	(12)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
																						Week days				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			20	21	22
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	70	70	70	70	70	70	70	70	70	70	70	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
																						Saturday				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			20	21	22
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
																						Sunday, Holidays, year-end and new-year holidays				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			20	21	22
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Conference hall, seminar hall
note	

Category	No.	Ht-12	Building	Hotel building	Space/ZONE	Restaurant
----------	-----	-------	----------	----------------	------------	------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		5475	20.0	59.5	0.5	10.0	12.5	0		0.0		4745		300	365							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage					
a	241	a	6	21	(15)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	6	21	(13)	[m]	[L/m ² ·day]	
b	51	b	6	21	(15)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	6	21	(13)	[m]	[L/m ² ·day]
c	73	c	6	21	(15)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	6	21	(13)	0.8	48.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	100	100	100	100	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	40	40	40	0	0	80	80	0	0	0	0	80	80	80	80	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	100	100	100	100	0	0	0
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	100	100	100	100	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	50	50	50	0	0	100	100	0	0	0	0	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	100	100	100	100	0	0	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	100	100	100	100	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	50	50	50	0	0	100	100	0	0	0	0	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	100	100	100	100	0	0	0

space/zone to be applied	Cafeteria, tea room
note	service hot water usage for restaurant is assumed.

Category	No.	Ht-13	Building	Hotel building	Space/ZONE	Lounge
----------	-----	-------	----------	----------------	------------	--------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		5110	20.0	23.8	0.2	0.0	5.0	0			0.0	5110		300	365								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	7	21	(14)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	7	21	(14)			
b	51	b	7	21	(14)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	7	21	(14)	[m]	[L/person-day]
c	73	c	7	21	(14)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	7	21	(14)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	80	80	25	25	80	25	25	25	25	80	80	80	80	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	30	30	100	30	30	30	30	30	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	30	30	100	30	30	30	30	30	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Exhibition hall, recreation room, game corner
note	Daytime usage is assumed

Category	No.	Ht-14	Building	Hotel building	Space/ZONE	Bar
----------	-----	-------	----------	----------------	------------	-----

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours			maintained average illuminance	Total number of days						
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]			[m ³ /h·m ²]	[hours/yr.]			[lux]	[day]						
		2190	10.0	23.8	0.2	0.0	5.0	0			0.0	2190			150	365						
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	18	24	(6)	Heating season	w1	22	40	-	-	a	-	-	(0)	-	a	18	24	(6)		
b	51	b	18	24	(6)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	18	24	(6)	[m]	[L/person-day]
c	73	c	18	24	(6)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	18	24	(6)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	40	80	80	80	80	80
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Bar lounge
note	Nighttime usage is assumed

Category	No.	Ht-16	Building	Hotel building	Space/ZONE	Staff canteen
----------	-----	-------	----------	----------------	------------	---------------

General			Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		5475	20.0	59.5	0.5	0.0	12.5		0		0.0		5110		500	365							
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns		Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate		Time of start & end (total hours)		Height of working plane		Total daily usage	
a	241	a	6	21	(15)	Heating season		w1	22	40	-	-	a	-	-	(0)	-	a	7	21	(14)	-	-
b	51	b	6	21	(15)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	7	21	(14)	[m]	[L/m2·day]
c	73	c	6	21	(15)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	7	21	(14)	0.8	48.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	40	40	20	20	100	100	100	20	20	20	20	100	100	20	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	40	40	20	20	100	100	100	20	20	20	20	100	100	20	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	40	40	20	20	100	100	100	20	20	20	20	100	100	20	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Employee canteen
note	service hot water usage for restaurant is assumed.

Category	No.	Ht-17	Building	Hotel building	Space/ZONE	Changing room
----------	-----	-------	----------	----------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water		
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days			
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]			
		8760	15.0	11.9	0.1	0.0	5.0	8760		13.5	8760		300	365			
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	24	(24)	Heating season		w1	22	40	-	-	a	-	24	(24)	
b	51	b	-	24	(24)	Cooling season		s1	26	50	-	-	b	-	24	(24)	[m]
c	73	c	-	24	(24)	Intermediate season		m1	24	50	-	-	c	-	24	(24)	60

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week day
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100		
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100		
Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100			
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100		
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100		
Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100			
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100		
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100		
Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100			
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Locker room, dressing room, collector waiting room, storage room, library
note	Continuous usage is assumed throughout the year. Air change rate of 5 1/h is assumed.

Category	No.	Ht-18	Building	Hotel building	Space/ZONE	Front desk open not all day
----------	-----	-------	----------	----------------	------------	-----------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		4745	35.0	23.8	0.2	0.0	7.5	0		0.0		4745		500	0							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage					
a	241	a	8	21	(13)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	8	21	(13)			
b	51	b	8	21	(13)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	21	(13)	[m]	-
c	73	c	8	21	(13)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	8	21	(13)	0.8	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Reception desk for banquet, cloak counter for banquet
note	Daytime usage is assumed

Category	No.	Ht-20	Building	Hotel building	Space/ZONE	Corridor open not all day
----------	-----	-------	----------	----------------	------------	---------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		4745	10.0	11.9	0.1	0.0	5.0	0		0.0		4745		150	0							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage					
a	241	a	8	21	(13)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	8	21	(13)			
b	51	b	8	21	(13)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	21	(13)	[m]	-
c	73	c	8	21	(13)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	8	21	(13)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	80	80	80	80	80	80	80	80	80	80	80	80	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Corridor for banquet halls, passage, stairs, vending machine corner
note	Daytime usage is assumed

Category	No.	Ht-21	Building	Hotel building	Space/ZONE	Lobby open not all day
----------	-----	-------	----------	----------------	------------	------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		4745	35.0	23.8	0.2	0.0	7.5	0		0.0	4745		300	365									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	8	21	(13)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	8	21	(13)			
b	51	b	8	21	(13)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	21	(13)	[m]	[L/person-day]
c	73	c	8	21	(13)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	8	21	(13)	60	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Lobby for banquet halls, entrance for banquet halls
note	Daytime usage is assumed

Category	No.	Ht-22	Building	Hotel building	Space/ZONE	Lavatory open not all day
----------	-----	-------	----------	----------------	------------	---------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		4745	35.0	23.8	0.2	0.0	7.5	4745		40.5		4745		300	0							
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage				
a	241	a	8	21	(13)	Heating season	w1	22	40	-	-	a	8	21	(13)		a	8	21	(13)		
b	51	b	8	21	(13)	Cooling season	s1	26	50	-	-	b	8	21	(13)	[1/h]	b	8	21	(13)	[m]	-
c	73	c	8	21	(13)	Intermediate season	m1	24	50	-	-	c	8	21	(13)	15	c	8	21	(13)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Daytime usage is assumed

Category	No.	Ht-23	Building	Hotel building	Space/ZONE	Smoking room open not all day
----------	-----	-------	----------	----------------	------------	-------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		4745	35.0	23.8	0.2	0.0	7.5	4745		81.0		4745		300	0								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	8	21	(13)	Heating season		w1	22	40	-	-	a	8	21	(13)	a	8	21	(13)	[m]	-	
b	51	b	8	21	(13)	Cooling season		s1	26	50	-	-	b	8	21	(13)	[1/h]	b	8	21	(13)	[m]	-
c	73	c	8	21	(13)	Intermediate season		m1	24	50	-	-	c	8	21	(13)	30	c	8	21	(13)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Smoking corner for banquet halls
note	Daytime usage is assumed

Category	No.	Ht-24	Building	Hotel building	Space/ZONE	Kitchen
----------	-----	-------	----------	----------------	------------	---------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days						
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]						
		0	-	-	-	-	-		3200		135.0		3200		750	0						
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.[deg] humi [%]	Set-back operation Temp.[deg] humi [%]	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	a	-	-	(0)			
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	50	c	-	-	(0)	0.8	0.0

space/zone to be applied	caboose, inspection and receiving room, syringing room, pantry, service room											
note	Air change rate of 50 1/h is assumed.											

Category	No.	Ht-25	Building	Hotel building	Space/ZONE	Indoor parking garage
----------	-----	-------	----------	----------------	------------	-----------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting				Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days			
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]			
		0	-	-	-	-	-	8760		30.0	8760		150	0			
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. [deg] humi [%]	Set-back operation Temp. [deg] humi [%]	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage		
a	241	a	-	-	(0)	Heating season	0	-	-	-	(0)	a	-	-	(0)	[m]	-
b	51	b	-	-	(0)	Cooling season	0	-	-	-	(0)	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	(0)	c	-	-	(0)	0	0.0

space/zone to be applied	Parking, carriage porch, car barn											
note	Air change rate of 10 1/h is assumed.											

Category	No.	Ht-26	Building	Hotel building	Space/ZONE	Machine room
----------	-----	-------	----------	----------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days					
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]					
		0	-	-	-	-	-	8760	13.5	320	200	0					
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage			
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	[m]	-
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	Air conditioning room, boiler room, fan room, pump room, gas container room																
note	Air change rate of 5 1/h is assumed.																

Category	No.	Ht-27	Building	Hotel building	Space/ZONE	Electric room
----------	-----	-------	----------	----------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting				Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days					
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]					
		0	-	-	-	-	-	8760	27.0	320	200	0					
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage			
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	[m]	-
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	MDF room, CPU room, server room, PBX room, lift-motor room, battery room																
note	electric machine with large heat emission and air change rate of 10 1/h are assumed.																

Category	No.	Ht-28	Building	Hotel building	Space/ZONE	Kitchenette with hot water server
----------	-----	-------	----------	----------------	------------	-----------------------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water					
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days						
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]						
		0	-	-	-	-	-	3200	13.5	1600	300	0						
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage			
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)		
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0.8	0.0

space/zone to be applied	Pantry, refresh corner
note	Air change rate of 5 1/h is assumed.

Category	No.	Ht-29	Building	Hotel building	Space/ZONE	Storage room
----------	-----	-------	----------	----------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
		0	-	-	-	-	-	3200	13.5	1600	300	0				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage		
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0
																0.0

space/zone to be applied	
note	Air change rate of 5 1/h is assumed.

Category	No.	Ht-30	Building	Hotel building	Space/ZONE	Printing room
----------	-----	-------	----------	----------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
		0	-	-	-	-	-	3200	27.0	1600	500	0				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage		
a	241	a	-	-	(0)	Heating season	0	-	-	-	a	-	-	(0)	-	-
b	51	b	-	-	(0)	Cooling season	0	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	c	-	-	(0)	0.8	0.0

space/zone to be applied	Copy room
note	Air change rate of 10 1/h is assumed.

Category	No.	Ht-31	Building	Hotel building	Space/ZONE	Garbage storage room
----------	-----	-------	----------	----------------	------------	----------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
		0	-	-	-	-	-	3200	40.5	1600	150	0				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage		
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	-
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0

space/zone to be applied	garbage collection point, waste-collection point
note	Air change rate of 15 1/h is assumed.

D.2.3 Hospital building

Category	No.	Hp-1	Building	Hospital building	Space/ZONE	Ward
----------	-----	------	----------	-------------------	------------	------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days			
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]			
		8760	12.0	7.4	0.1	3.0	4.0	0	0.0	5110	300	365			
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage	
a	241	a	- 24 (24)	Heating season		w1	22 40	- -	a	- - (0)		a	7 21 (14)		
b	51	b	- 24 (24)	Cooling season		s1	26 50	- -	b	- - (0)	[1/h]	b	7 21 (14)	[m]	[L/bed-day]
c	73	c	- 24 (24)	Intermediate season		m1	24 50	- -	c	- - (0)	-	c	7 21 (14)	0	284.2

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied					
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23		
	Simultaneous usage ratio	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100			
Int. heat gain due to appliances	10	10	10	10	10	10	10	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	10	10	10		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied					
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23		
	Simultaneous usage ratio	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100			
Int. heat gain due to appliances	10	10	10	10	10	10	10	100	100	100	100	100	100	100	100	100	100	100	100	100	100	10	10	10			
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied					
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23		
	Simultaneous usage ratio	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100			
Int. heat gain due to appliances	10	10	10	10	10	10	10	100	100	100	100	100	100	100	100	100	100	100	100	100	100	10	10	10			
Week days																											
Saturday																											
Sunday, Holidays, year-end and new-year holidays																											

space/zone to be applied	Patient room, private room, isolation room, newborn room, recovery room
note	Continuous usage is assumed throughout the year.

Category	No.	Hp-2	Building	Hospital building	Space/ZONE	Bathroom
----------	-----	------	----------	-------------------	------------	----------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		8760	12.0	7.4	0.1	3.0	4.0		8760		21.6		5110		300	365							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns		Normal operation Temp.(deg) hum.(%)		Set-back operation Temp.(deg) hum.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	-	24	(24)	Heating season		w1	22	40	-	-	a	-		24	(24)			a	7	21	(14)
b	51	b	-	24	(24)	Cooling season		s1	26	50	-	-	b	-	24	(24)	[1/h]	b	7	21	(14)	[m]	[L/bed-day]
c	73	c	-	24	(24)	Intermediate season		m1	24	50	-	-	c	-	24	(24)	8	c	7	21	(14)	0	284.2

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
Int. heat gain due to appliances	10	10	10	10	10	10	10	100	100	100	100	100	100	100	100	100	100	100	100	100	100	10	10	10	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
Int. heat gain due to appliances	10	10	10	10	10	10	10	100	100	100	100	100	100	100	100	100	100	100	100	100	100	10	10	10	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90	90
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
Int. heat gain due to appliances	10	10	10	10	10	10	10	100	100	100	100	100	100	100	100	100	100	100	100	100	100	10	10	10	
Week days																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Shower room, dressing room, shampoo room, laundry room
note	Continuous usage is assumed throughout the year. Air change rate of 8 1/h is assumed.

Category	No.	Hp-4	Building	Hospital building	Space/ZONE	Corridor open all day
----------	-----	------	----------	-------------------	------------	-----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		8760	20.0	6.0	0.1	0.0	5.0		0		0.0	8760		300	0								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	-	24	(24)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	-	24	(24)	[m]	-	
b	51	b	-	24	(24)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	24	(24)	[m]	-
c	73	c	-	24	(24)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	24	(24)	0.0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	
Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	
Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	
Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Corridor of ward, passage of ward, stairs of ward, vending machine corner of ward
note	Continuous usage is assumed throughout the year.

Category	No.	Hp-5	Building	Hospital building	Space/ZONE	Lobby open all day
----------	-----	------	----------	-------------------	------------	--------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water		
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]		
		8760	20.0	6.0	0.1	0.0	5.0	0	0.0	8760	300	365		
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)		Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage	
a	241	a	- 24 (24)	Heating season	w1	22 40	- -	a	- - (0)		a	- 24 (24)	[m]	[L/person-day]
b	51	b	- 24 (24)	Cooling season	s1	26 50	- -	b	- - (0)	[1/h]	b	- 24 (24)	[m]	[L/person-day]
c	73	c	- 24 (24)	Intermediate season	m1	24 50	- -	c	- - (0)	-	c	- 24 (24)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	50	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50
Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	50	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50
Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	50	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50
Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Week days																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Lobby of ward, reception of ward, main entrance of ward, elevator hall of ward, telephone booth of ward
note	Continuous usage is assumed throughout the year.

Category	No.	Hp-6	Building	Hospital building	Space/ZONE	Lavatory for common use open all day
----------	-----	------	----------	-------------------	------------	--------------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		8760	20.0	6.0	0.1	0.0	5.0	8760		40.5		8760		300	0								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	-	24	(24)	Heating season		w1	22	40	-	-	a	-	24	(24)	a	-	24	(24)			
b	51	b	-	24	(24)	Cooling season		s1	26	50	-	-	b	-	24	(24)	[1/h]	b	-	24	(24)	[m]	-
c	73	c	-	24	(24)	Intermediate season		m1	24	50	-	-	c	-	24	(24)	15	c	-	24	(24)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants														Hourly ratio of heat gain due to appliances														Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week day										
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100											
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50											
	Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50											
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0												
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants														Hourly ratio of heat gain due to appliances														Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday										
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100											
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50											
	Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50											
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0												
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants														Hourly ratio of heat gain due to appliances														Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays										
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100											
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50											
	Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50											
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0												

Category	No.	Hp-7	Building	Hospital building	Space/ZONE	Smoking room open all day
----------	-----	------	----------	-------------------	------------	---------------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water	
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]	[m ³ /h·m ²]	[hours/yr.]	[lux]	[day]		
		8760	20.0	6.0	0.1	0.0	5.0	8760	81.0	8760	300	0		
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)		Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage	
a	241	a	- 24 (24)	Heating season	w1	22 40	- -	a	- 24 (24)		a	- 24 (24)		
b	51	b	- 24 (24)	Cooling season	s1	26 50	- -	b	- 24 (24)	[1/h]	b	- 24 (24)	[m]	-
c	73	c	- 24 (24)	Intermediate season	m1	24 50	- -	c	- 24 (24)	30	c	- 24 (24)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50
Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50
Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50
Int. heat gain due to occupants	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Smoking corner of ward
note	Air change rate of 30 1/h is assumed.

Category	No.	Hp-8	Building	Hospital building	Space/ZONE	Consultation room
----------	-----	------	----------	-------------------	------------	-------------------

General		Space heating & cooling							Ventilation for unconditioned space				Lighting				Domestic hot water												
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days														
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]														
		2818	20.0	23.8	0.2	15.0	5.0	0			0.0	2818		750	292														
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns		Normal operation Temp (deg) humi (%)		Set-back operation Temp (deg) humi (%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage									
a	241	a	8	18	(10)	Heating season		w1	22	40	-	-	a	-	-	(0)	-	a	8	18	(10)	-	-	-	-	-	-	-	-
b	51	b	8	16	(8)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	16	(8)	-	-	-	-	-	-	-	-
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	-	-	-	-	-	-	-	-

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Consultation room of departments, chemotherapy room, exercise room, nursery, hydrotherapy room, blood purification room, speech therapy, triage room
note	Maintained average illuminance 750 is assumed

Category	No.	Hp-9	Building	Hospital building	Space/ZONE	Waiting room
----------	-----	------	----------	-------------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		2818	20.0	23.8	0.2	15.0	5.0	0		0.0		2818		500	292							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage					
a	241	a	8	18	(10)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	8	18	(10)	[m]	[L/m ² ·day]	
b	51	b	8	16	(8)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	16	(8)	[m]	[L/m ² ·day]
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0	3.3

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Waiting space, reception desk, information desk, consultation desk, visiting room, telephone booth, suckling room, family room, playroom, lounge
note	Maintained average illuminance 500lx is assumed

Category	No.	Hp-11	Building	Hospital building	Space/ZONE	Examination room
----------	-----	-------	----------	-------------------	------------	------------------

General		Space heating & cooling							Ventilation for unconditioned space				Lighting				Domestic hot water					
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		2920	20.0	11.9	0.1	30.0	10.0	0		0.0		2920		750	292							
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage				
a	241	a	8	18	(10)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	8	18	(10)	[m]	[L/m ² -day]	
b	51	b	8	18	(10)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	18	(10)	[m]	[L/m ² -day]
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	6.3

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Manipulation room, sterilization room, pasteurization room, detergent room, culture test room, medicine room, CT room, MRI room, angiography room, ultrasonic echo room, electromyogram room, fluoroscope room, treadmill room, anesthesia room, electrocardiogram
note	Maintained average illuminance 750 is assumed

Category	No.	Hp-12	Building	Hospital building	Space/ZONE	Intensive care unit
----------	-----	-------	----------	-------------------	------------	---------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		8760	20.0	9.2	0.1	30.0	4.0		0		0.0		8760		750	365							
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns		Normal operation Temp (deg) humi (%)		Set-back operation Temp (deg) humi (%)		Time of start & end (hours)			Ventilation requirement rate		Time of start & end (total hours)		Height of working plane	Total daily usage		
a	241	a	-	24	(24)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	-	24	(24)	[m]	[L/m2·day]	
b	51	b	-	24	(24)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	24	(24)	[m]	[L/m2·day]
c	73	c	-	24	(24)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	24	(24)	0.8	6.3

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	
Int. heat gain due to occupants	70	70	70	70	70	70	70	100	100	100	100	100	100	100	100	100	100	100	100	100	100	70	70	70		
Int. heat gain due to appliances	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	
Int. heat gain due to occupants	70	70	70	70	70	70	70	100	100	100	100	100	100	100	100	100	100	100	100	100	100	70	70	70		
Int. heat gain due to appliances	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	50	50	50	50	50	50	50	100	100	100	100	100	100	100	100	100	100	100	100	100	100	50	50	50	
Int. heat gain due to occupants	70	70	70	70	70	70	70	100	100	100	100	100	100	100	100	100	100	100	100	100	100	70	70	70		
Int. heat gain due to appliances	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100		

Category	No.	Hp-13	Building	Hospital building	Space/ZONE	Dissecting room
----------	-----	-------	----------	-------------------	------------	-----------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		2920	20.0	23.8	0.2	15.0	5.0	0		0.0		2628		75	292							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)				Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	8	18	(10)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	9	18	(9)	[m]	[L/person-day]	
b	51	b	8	18	(10)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	18	(9)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			

space/zone to be applied	Transfusion storage room, narcotic control room, specimen room, mortuary, experimental animal room
note	Maintained average illuminance 750 is assumed

Category	No.	Hp-15	Building	Hospital building	Space/ZONE	Office room
----------	-----	-------	----------	-------------------	------------	-------------

General			Space heating & cooling							Ventilation for unconditioned space				Lighting			Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		2920	20.0	23.8	0.2	15.0	5.0		0		0.0		2628		750	292							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp. [deg] hum. [%]		Set-back operation Temp. [deg] hum. [%]		Time of start & end [hours]			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	8	18	(10)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	9	18	(9)	[m]	[L/person-day]	
b	51	b	8	18	(10)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	18	(9)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Medical office, conference room, meeting room, drawing room, library, study room, director room, president room, clinical record room
note	office as a whole. Service hot water usage for lavatory is assumed.

Category	No.	Hp-16	Building	Hospital building	Space/ZONE	Changing room
----------	-----	-------	----------	-------------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		2920	15.0	11.9	0.1	0.0	5.0	2920		13.5		2628		300	292								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	8	18	(10)	Heating season		w1	22	40	-	-	a	8	18	(10)	a	9	18	(9)			
b	51	b	8	18	(10)	Cooling season		s1	26	50	-	-	b	8	18	(10)	[1/h]	b	9	18	(9)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	5	c	-	-	(0)	60	62.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Locker room, dressing room, shower room
note	Continuous usage is assumed throughout the year. Air change rate of 5 1/h is assumed.

Category	No.	Hp-17	Building	Hospital building	Space/ZONE	Corridor open not all day
----------	-----	-------	----------	-------------------	------------	---------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		2920	20.0	7.3	0.1	0.0	5.0	0		0.0		2920		300	0							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage					
a	241	a	8	18	(10)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	8	18	(10)			
b	51	b	8	18	(10)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	18	(10)	[m]	-
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied	
	time							time							time							Week days	
	0 1 2 3 4 5							6 7 8 9 10 11 12 13 14							15 16 17 18 19 20 21 22 23								
	Simultaneous usage ratio							Simultaneous usage ratio							Simultaneous usage ratio								
0 0 0 0 0 0 0							0 0 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 0 0 0 0 0							0 0 0 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 0 0 0 0 0							Saturday		
0 0 0 0 0 0 0							0 0 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 0 0 0 0 0							0 0 0 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 0 0 0 0 0									
0 0 0 0 0 0 0							0 0 0 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 0 0 0 0 0							0 0 0 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 100 0 0 0 0 0									
0 0 0 0 0 0 0							0 0																

space/zone to be applied	Corridor for outpatients' departments, passage, stairs, vending machine corner
note	Daytime usage is assumed

Category	No.	Hp-18	Building	Hospital building	Space/ZONE	Lobby open not all day
----------	-----	-------	----------	-------------------	------------	------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		2920	20.0	7.3	0.1	0.0	5.0	0			0.0	2920		300	292								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	8	18	(10)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	8	18	(10)			
b	51	b	8	18	(10)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	18	(10)		
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	3.8	

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
STANDARDS50.COM																									
Click to view the full PDF of ISO 18523-1:2017																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Reception desk for outpatients, main entrance, elevator hall, telephone booth, locker room
note	Daytime usage is assumed

Category	No.	Hp-19	Building	Hospital building	Space/ZONE	Lavatory for common use open not all day
----------	-----	-------	----------	-------------------	------------	--

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		2920	20.0	7.3	0.1	0.0	5.0	2920		40.5		2920		300	0							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	8	18	(10)	Heating season	w1	22	40	-	-	a	8	18	(10)	a	8	18	(10)			
b	51	b	8	18	(10)	Cooling season	s1	26	50	-	-	b	8	18	(10)	[1/h]	b	8	18	(10)	[m]	-
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	15	c	-	-	(0)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Daytime usage is assumed

Category	No.	Hp-20	Building	Hospital building	Space/ZONE	Smoking room open not all day
----------	-----	-------	----------	-------------------	------------	-------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		2920	20.0	7.3	0.1	0.0	5.0	2920		81.0		2920		300	0								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	8	18	(10)	Heating season		w1	22	40	-	-	a	8	18	(10)	a	8	18	(10)			
b	51	b	8	18	(10)	Cooling season		s1	26	50	-	-	b	8	18	(10)	[1/h]	b	8	18	(10)	[m]	-
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	30	c	-	-	(0)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	50	50	50	50	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

Category	No.	Hp-21	Building	Hospital building	Space/ZONE	Kitchen
----------	-----	-------	----------	-------------------	------------	---------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water		
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]		[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]		
		0	-	-	-	-	-		5500		135.0		5500		750	0		
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. [deg] humi. [%]		Set-back operation Temp. [deg] humi. [%]		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)		
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0.8	0.0

space/zone to be applied	caboose, inspection and receiving room, syringing room, pantry, service room											
note	Air change rate of 50 1/h is assumed.											

Category	No.	Hp-22	Building	Hospital building	Space/ZONE	Indoor parking garage
----------	-----	-------	----------	-------------------	------------	-----------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting				Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]				
		0	-	-	-	-	-	8760		30.0	8760		150	0				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241	a	-	-	(0)	Heating season	0	-	-	-	(0)	a	-	-	(0)	[m]	-	
b	51	b	-	-	(0)	Cooling season	0	-	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	(0)	10	c	-	-	(0)	0	0.0

space/zone to be applied	Parking, carriage porch, car barn											
note	Air change rate of 10 1/h is assumed.											

Category	No.	<i>Hp-23</i>	Building	<i>Hospital building</i>	Space/ZONE	<i>Machine room</i>
-----------------	------------	--------------	-----------------	--------------------------	-------------------	---------------------

General		Space heating & cooling						Ventilation for unconditioned space			Lighting			Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days			
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]			
		0	-	-	-	-	-	8760		13.5	550		200	0			
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season		0	-	-	-	a	-	-	(0)		
b	51	b	-	-	(0)	Cooling season		0	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	c	-	-	(0)	60	0.0

space/zone to be applied	<i>Air conditioning room, boiler room, fan room, pump room, gas container room</i>
note	<i>Air change rate of 5 1/h is assumed.</i>

Category	No.	<i>Hp-24</i>	Building	<i>Hospital building</i>	Space/ZONE	<i>Electric room</i>
-----------------	------------	--------------	-----------------	--------------------------	-------------------	----------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
		0	-	-	-	-	-	8760	27.0	550	200	0				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.[deg] humi.(%)	Set-back operation Temp.[deg] humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	

space/zone to be applied	<i>MDF room, CPU room, server room, PBX room, lift-motor room, battery room</i>
note	<i>electric machine with large heat emission and air change rate of 10 1/h are assumed.</i>

Category	No.	Hp-25	Building	Hospital building	Space/ZONE	Kitchenette with hot water server
----------	-----	-------	----------	-------------------	------------	-----------------------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water						
Annual schedule	Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days							
A	[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]							
	0	-	-	-	-	-	5500	13.5	2800	300	0							
Total number of days of each daily schedule [day]	Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage					
a	241	a	-	-	(0)	Heating season		0	-	-	-	(0)	a	-	-	(0)		
b	51	b	-	-	(0)	Cooling season		0	-	-	-	(0)	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	(0)	c	-	-	(0)	0.8	0.0

space/zone to be applied	Pantry, refresh corner
note	Air change rate of 5 1/h is assumed.

Category	No.	Hp-26	Building	Hospital building	Space/ZONE	Storage room
----------	-----	-------	----------	-------------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water				
Annual schedule	Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days					
A	[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]					
	0	-	-	-	-	-	5500	13.5	2800	300	0					
Total number of days of each daily schedule [day]	Time of start & end for normal operation (hours)		Set-point	Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage				
a	241	a	-	-	(0)	Heating season	0	-		-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season	0	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	
note	Air change rate of 5 1/h is assumed.

Category	No.	<i>Hp-27</i>	Building	<i>Hospital building</i>	Space/ZONE	<i>Printing room</i>
-----------------	------------	--------------	-----------------	--------------------------	-------------------	----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water		
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]		
		0	-	-	-	-	-		5500		27.0		2800		500	0		
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) hum.(%)	Set-back operation Temp.(deg) hum.(%)	Time of start & end [hours]			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage
a	241	a	-	-	(0)	Heating season		0	-	-	-	-		a	-	-		
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0.8	0.0

space/zone to be applied	<i>Copy room</i>
note	<i>Air change rate of 10 1/h is assumed.</i>

Category	No.	<i>Hp-28</i>	Building	<i>Hospital building</i>	Space/ZONE	<i>Garbage storage room</i>
-----------------	------------	--------------	-----------------	--------------------------	-------------------	-----------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours			maintained average illuminance	Total number of days						
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]			[lux]	[day]						
		0	-	-	-	-	-	5500			40.5	2800			150	0						
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) hum.(%)	Set-back operation Temp.(deg) hum.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage				
a	241	a	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)	a	-	-	(0)			
b	51	b	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	15	c	-	-	(0)	0	0.0

space/zone to be applied	<i>garbage collection point, waste-collection point</i>
note	<i>Air change rate of 15 1/h is assumed.</i>

D.2.4 Shop building

Category	No.	Sh-1	Building	Shop building	Space/ZONE	Large store
----------	-----	------	----------	---------------	------------	-------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		4745	30.0	23.8	0.2	40.0	7.5	0		0.0		4745		750	365							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point	Patterns	Normal operation Temp. [deg] humi. (%)	Set-back operation Temp. [deg] humi. (%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	9	22	(13)	Heating season	w1	22	40	-	-	a	-	-	(0)	-	a	9	22	(13)	[m]	[Person-day]
b	51	b	9	22	(13)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	22	(13)	[m]	[Person-day]
c	73	c	9	22	(13)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	9	22	(13)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0		
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	20	20	30	30	30	30	30	30	30	10	10	10	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0		
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	100	50	30	10	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0		
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	100	50	30	10	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	0		

space/zone to be applied	Electrical appliance store, sports shop, exhibition room, convenience store
note	Maintained average illuminance 750 is assumed. Service hot water usage for lavatory is assumed.

Category	No.	Sh-2	Building	Shop building	Space/ZONE	Small store
----------	-----	------	----------	---------------	------------	-------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		4745	30.0	23.8	0.2	40.0	7.5	0		0.0	4745		500	365									
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	9	22	(13)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	9	22	(13)			
b	51	b	9	22	(13)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	22	(13)	[m]	[L/person-day]
c	73	c	9	22	(13)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	9	22	(13)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	20	20	30	30	30	30	30	30	10	10	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	100	50	30	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	100	50	30	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Click to view the full PDF of ISO 18523-1:2017																									
Standards360.COM																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Shop for musical instruments, book shop, music CD shop, boutique, grocery shop, after-school study center, studio, exhibition hall, clinic, pet shop, beauty salon, beauty treatment salon, travel agency
note	Maintained average illuminance 500 is assumed. Service hot water usage for lavatory is assumed.

Category	No.	Sh-3	Building	Shop building	Space/ZONE	Supermarket
----------	-----	------	----------	---------------	------------	-------------

General			Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water						
Annual schedule			Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days						
A			[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]						
			4745	30.0	23.8	0.2	40.0	7.5	0		0.0		4745		750	365						
Total number of days of each daily schedule (day)			Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241		a	9	22 (13)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	9	22 (13)	[m]	[L/person-day]	
b	51		b	9	22 (13)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	22 (13)	[m]	[L/person-day]
c	73		c	9	22 (13)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	9	22 (13)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	20	20	30	30	30	30	30	30	10	10	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	50	30	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	50	30	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	0	0	0	
Week days																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Food section, food shop
note	Service hot water usage for lavatory is assumed.

Category	No.	Sh-4	Building	Shop building	Space/ZONE	Storage and goods disposal room
----------	-----	------	----------	---------------	------------	---------------------------------

General		Space heating & cooling							Ventilation for unconditioned space				Lighting				Domestic hot water					
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]							
		2920	15.0	11.9	0.1	5.0	5.0	0			0.0	2920		200	365							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns		Normal operation Temp (deg) humi (%)		Set-back operation Temp (deg) humi (%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage		
a	241	a	10	18	(8)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	10	18	(8)		
b	51	b	10	18	(8)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	10	18	(8)	[m]
c	73	c	10	18	(8)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	10	18	(8)	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	50	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	50	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	50	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
Click to view the full PDF of ISO 18523-1:2017																									
Standards60.com																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Food preparation room, product administration room, locker room, storage room
note	Maintained average illuminance 200 is assumed

Category	No.	Sh-5	Building	Shop building	Space/ZONE	Office room
----------	-----	------	----------	---------------	------------	-------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		4745	20.0	23.8	0.2	15.0	5.0	0		0.0		4745		750	365							
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage					
a	241	a	9	22	(13)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	9	22	(13)			
b	51	b	9	22	(13)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	22	(13)	[m]	[L/person-day]
c	73	c	9	22	(13)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	9	22	(13)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	100	100	100	100	50	25	25	25	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	60	60	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	100	100	100	100	50	25	25	25	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	60	60	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	100	100	100	100	50	25	25	25	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	60	60	0	0		

space/zone to be applied	Manager's room, office space, reception desk
note	office as a whole. Service hot water usage for lavatory is assumed.

Category	No.	Sh-6	Building	Shop building	Space/ZONE	Changing room
----------	-----	------	----------	---------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours		Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days						
A		[hours/yr.]		[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]						
		4745		15.0	11.9	0.1	0.0	5.0		4745		13.5		4745		300	365						
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)				Height of working plane	Total daily usage		
a	241	a	9	22	(13)	Heating season		w1	22	40	-	-	a	9		22	(13)	a	9			22	(13)
b	51	b	9	22	(13)	Cooling season		s1	26	50	-	-	b	9	22	(13)	[1/h]	b	9	22	(13)	[m]	[L/person-day]
c	73	c	9	22	(13)	Intermediate season		m1	24	50	-	-	c	9	22	(13)	5	c	9	22	(13)	60	62.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	100	100	100	100	50	25	25	25	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	100	100	100	100	50	25	25	25	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	50	50	100	100	100	100	50	25	25	25	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Collector waiting room, nap room, strage room, rest area
note	Air change rate of 5 1/h is assumed.

Category	No.	Sh-7	Building	Shop building	Space/ZONE	Lobby
----------	-----	------	----------	---------------	------------	-------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		4745	30.0	11.9	0.1	0.0	2.5	0		0.0		4745		750	365							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage					
a	241	a	9	22	(13)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	9	22	(13)			
b	51	b	9	22	(13)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	22	(13)	[m]	[L/person-day]
c	73	c	9	22	(13)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	9	22	(13)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	20	20	30	30	30	30	30	30	10	10	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	50	30	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	50	30	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Elevator hall, entrance hall, atrium, mall concourse, shopping mall, corridor, information booth
note	Service hot water usage for lavatory is assumed.

Category	No.	Sh-8	Building	Shop building	Space/ZONE	Lavatory
----------	-----	------	----------	---------------	------------	----------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		4745	30.0	11.9	0.1	0.0	2.5	4745		40.5	4745		300	0									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	9	22	(13)	Heating season		w1	22	40	-	-	a	9	22	(13)	a	9	22	(13)	[m]	-	
b	51	b	9	22	(13)	Cooling season		s1	26	50	-	-	b	9	22	(13)	[1/h]	b	9	22	(13)	[m]	-
c	73	c	9	22	(13)	Intermediate season		m1	24	50	-	-	c	9	22	(13)	15	c	9	22	(13)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	Week days
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	20	20	30	30	30	30	30	30	30	10	10	10	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	Saturday
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	100	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	50	30	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	Sunday, Holidays, year-end and new-year holidays
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	100	100	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	50	30	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Sh-9	Building	Shop building	Space/ZONE	Smoking room
----------	-----	------	----------	---------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water		
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days			
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]			
		4745	30.0	11.9	0.1	0.0	2.5	4745		81.0		4745		300	0			
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	9	22	(13)	Heating season	w1	22	40	-	-	a	9	22	(13)			
b	51	b	9	22	(13)	Cooling season	s1	26	50	-	-	b	9	22	(13)	[1/h]	[m]	-
c	73	c	9	22	(13)	Intermediate season	m1	24	50	-	-	c	9	22	(13)	30	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	20	20	30	30	30	30	30	10	10	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	50	30	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	50	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	10	50	50	50	100	100	100	100	50	30	10	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Week days																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

Category	No.	<i>Sh-10</i>	Building	<i>Shop building</i>	Space/ZONE	<i>Kitchen</i>
-----------------	------------	--------------	-----------------	----------------------	-------------------	----------------

General		Space heating & cooling						Ventilation for unconditioned space			Lighting			Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days			
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]			
		0	-	-	-	-	-	3400		135.0	3400		750	0			
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end [hours]			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)	-
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0.0

space/zone to be applied	<i>caboose, inspection and receiving room, syringing room, pantry, service room</i>
note	<i>Air change rate of 50 1/h is assumed.</i>

Category	No.	<i>Sh-11</i>	Building	<i>Shop building</i>	Space/ZONE	<i>Indoor parking garage</i>
-----------------	------------	--------------	-----------------	----------------------	-------------------	------------------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water		
Annual schedule	Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
A	[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
	0	-	-	-	-	-	5500	30.0	5500	150	0				
Total number of days of each daily schedule [day]	Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp. [deg] humi. (%)	Set-back operation Temp. [deg] humi. (%)	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season	0	-	-	-	a	-	-	(0)	-
b	51	b	-	-	(0)	Cooling season	0	-	-	-	b	-	-	(0)	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	c	-	-	(0)	0.0

space/zone to be applied	<i>Parking, carriage porch, car barn</i>
note	<i>Air change rate of 10 1/h is assumed.</i>

Category	No.	Sh-12	Building	Shop building	Space/ZONE	Machine room
----------	-----	-------	----------	---------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water						
Annual schedule	Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days							
A	[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]							
	0	-	-	-	-	-	8760	13.5	340	200	0							
Total number of days of each daily schedule [day]	Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)		
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	Air conditioning room, boiler room, fan room, pump room, gas container room
note	Air change rate of 5 1/h is assumed.

Category	No.	Sh-13	Building	Shop building	Space/ZONE	Electric room
----------	-----	-------	----------	---------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space			Lighting			Domestic hot water		
Annual schedule	Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days			
A	[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]			
	0	-	-	-	-	-	8760		27.0	340		200	0			
Total number of days of each daily schedule [day]	Time of start & end for normal operation (hours)				Set-point	Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season	0	-	-	-		a	-			-
b	51	b	-	-	(0)	Cooling season	0	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	MDF room, CPU room, server room, PBX room, lift-motor room, battery room
note	electric machine with large heat emission and air change rate of 10 1/h are assumed.

Category	No.	<i>Sh-14</i>	Building	<i>Shop building</i>	Space/ZONE	<i>Kitchenette with hot water server</i>
-----------------	------------	--------------	-----------------	----------------------	-------------------	--

General		Space heating & cooling						Ventilation for unconditioned space			Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		0	-	-	-	-	-	3400		13.5	1700		300	0								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	-	-	(0)	Heating season		0	-	-	-	a	-	-	(0)	a	-	-	(0)			
b	51	b	-	-	(0)	Cooling season		0	-	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	c	-	-	(0)	5	c	-	-	(0)	0.8	0.0

space/zone to be applied	<i>Pantry, refresh corner</i>
note	<i>Air change rate of 5 1/h is assumed.</i>

Category	No.	<i>Sh-15</i>	Building	<i>Shop building</i>	Space/ZONE	<i>Storage room</i>
-----------------	------------	--------------	-----------------	----------------------	-------------------	---------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water					
Annual schedule	Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days							
A	[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]							
	0	-	-	-	-	-	3400	13.5	1700	300	0							
Total number of days of each daily schedule [day]	Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp.[deg] humi.(%)	Set-back operation Temp.[deg] humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)		
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	
note	<i>Air change rate of 5 1/h is assumed.</i>

Category	No.	<i>Sh-16</i>	Building	<i>Shop building</i>	Space/ZONE	<i>Printing room</i>
-----------------	------------	--------------	-----------------	----------------------	-------------------	----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water	
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]		
		0	-	-	-	-	-	3400		27.0		1700		500	0		
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.[deg] humi. [%]	Set-back operation Temp.[deg] humi. [%]	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)		
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0.8	0.0

space/zone to be applied	<i>Copy room</i>
note	<i>Air change rate of 10 1/h is assumed.</i>

Category	No.	<i>Sh-17</i>	Building	<i>Shop building</i>	Space/ZONE	<i>Garbage storage room</i>
-----------------	------------	--------------	-----------------	----------------------	-------------------	-----------------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting				Domestic hot water		
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
		0	-	-	-	-	-	3400	40.5	1700	150	0				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0
																0.0

space/zone to be applied	<i>garbage collection point, waste-collection point</i>
note	<i>Air change rate of 15 1/h is assumed.</i>

D.2.5 Educational building

Category	No.	Ed-1	Building	Educational building	Space/ZONE	Class room of junior and junior high school
----------	-----	------	----------	----------------------	------------	---

General		Space heating & cooling						Ventilation for unconditioned space			Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
B		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		1568	20.0	59.5	0.5	0.5	12.5	0		0.0	1568		500	196								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp (deg) humi. (%)	Set-back operation Temp (deg) humi. (%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage					
a	196	a	8	16	(8)	Heating season	w1	22	40	-	-		a	-	-			(0)	a	8	16	(8)
b	-	b	-	-	(0)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/person-day]
c	6	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	10.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	70	70	70	70	70	70	70	70	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	-
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Lecture room, homeroom, nursery
note	Summer, winter and spring holidays are assumed. Service hot water usage for school-provided lunch is assumed.

Category	No.	Ed-3	Building	Educational building	Space/ZONE	Teachers' room
----------	-----	------	----------	----------------------	------------	----------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
B		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		3590	20.0	23.8	0.2	10.0	5.0	0		0.0	3590		500	359									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	196	a	8	18	(10)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	8	18	(10)			
b	-	b	8	18	(10)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	18	(10)	[m]	[L/person-day]
c	6	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	50	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	30	30	30	30	50	30	30	30	100	100	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	50	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	20	20	20	20	20	20	20	20	20	20	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	20	20	20	20	20	20	20	20	20	20	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Staff room, faculty room
note	All days usage is assumed throughout the year except for New year and year end is assumed.

Category	No.	Ed-4	Building	Educational building				Space/ZONE	Canteen of junior, junior high and high school			
----------	-----	------	----------	----------------------	--	--	--	------------	--	--	--	--

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days						
B		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]		[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]						
		588	15.0	59.5	0.5	0.0	12.5		0		0.0		588		500	196						
Total number of days of each daily schedule [day]		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate		Time of start & end (total hours)		Height of working plane	Total daily usage			
a	196	a	11	14	(3)	Heating season	w1	22	40	-	-	a	-	-	(0)	-	a	11	14	(3)	[m]	[L/m ² ·day]
b	-	b	-	-	(0)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/m ² ·day]
c	6	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	32.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	100	100	100	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	100	100	100	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	100	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Category	No.	Ed-5	Building	Educational building	Space/ZONE	Lecture room of university
----------	-----	------	----------	----------------------	------------	----------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
C		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		1630	20.0	59.5	0.5	2.0	10.0	0		0.0	1630		500	163									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	163	a	8	18	(10)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	8	18	(10)			
b	-	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/person-day]
c	6	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	70	70	70	70	70	70	70	70	70	70
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100
Daily schedule b	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6											

space/zone to be applied	Lecture hall, student hall room
note	Summer, winter and spring holidays are assumed. Service hot water usage for lavatory is assumed.

Category	No.	Ed-6	Building	Educational building	Space/ZONE	Canteen of university
----------	-----	------	----------	----------------------	------------	-----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
C		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		3132	15.0	59.5	0.5	0.0	12.5	0		0.0		3132		500	359							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	163	a	8	20	(12)	Heating season	w1	22	40	-	-	a	-	-	(0)	-	a	8	20	(12)	[m]	[L/m ² ·day]
b	-	b	8	14	(6)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	14	(6)	[m]	[L/m ² ·day]
c	6	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	48.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	40	40	10	10	100	100	10	0	0	0	0	40	40	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	20	20	10	10	50	50	10	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13										

space/zone to be applied	Restaurant, cafeteria, student dining hall, staff cafeteria
note	service hot water usage for restaurant is assumed.

Category	No.	Ed-7	Building	Educational building	Space/ZONE	Office room
----------	-----	------	----------	----------------------	------------	-------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		2410	20.0	23.8	0.2	10.0	5.0	0			0.0	2410		750	241								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241	a	8	18	(10)	Heating season		w1	22	40	-	-	a	-	-	(0)	-	a	8	18	(10)	[m]	[L/person-day]
b	51	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	70	100	100	100	100	100
Daily schedule b	Int. heat gain due to occupants	0	0	0	0	0	0	0	100	100	100	100	50	100	100	100	100	100	100
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	100	100	100	100	70	100	100	100	100	100
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4													

space/zone to be applied	Administrative office room, president room, sickroom, professor room, lecturer room, teaching material preparation room, drawing room, employment consultation room, lecturer lounge, meeting room, counseling room, consultation room, interview room, inspect
note	office as a whole. Service hot water usage for lavatory is assumed.

Category	No.	Ed-8	Building	Educational building	Space/ZONE	Study room
----------	-----	------	----------	----------------------	------------	------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		3504	20.0	23.8	0.2	30.0	5.0	0		0.0		3504		750	292							
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	9	21	(12)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	9	21	(12)			
b	51	b	9	21	(12)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	21	(12)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	50	50	50	50	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			

space/zone to be applied	Seminar room, common study room, lounge
note	

Category	No.	Ed-9	Building	Educational building	Space/ZONE	Computer exercise room
----------	-----	------	----------	----------------------	------------	------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		1928	20.0	59.5	0.5	60.0	12.5	0			0.0	1928		750	241								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	8	16	(8)	Heating season		w1	22	40	-	-	a	-	-	(0)	-	-	(0)	[m]	[L/person-day]		
b	51	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time						time						time						Week days						
	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17		18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	70	70	70	70	70	70	70	70	0		0	0	0	0	0	0
Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time						time						time						Saturday						
	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17		18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		0	0	0	0	0	0
Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time						time						time						Sunday, Holidays, year-end and new-year holidays						
	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17		18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		0	0	0	0	0	0
Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	PC room, computer room, studio, CAD room, audiovisual classroom
note	

Category	No.	Ed-10	Building	Educational building	Space/ZONE	Laboratory
----------	-----	-------	----------	----------------------	------------	------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		1928	20.0	59.5	0.5	60.0	12.5	0		0.0		1928		1000	241							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	8	16	(8)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	8	16	(8)	[m]	[L/person-day]	
b	51	b	-	-	(0)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	70	70	70	70	70	70	70	70	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

space/zone to be applied	Precision work classroom, precision experiment classroom, precision drafting classroom, mechanical drawing classroom
note	Maintained average illuminance 1000 is assumed

Category	No.	Ed-11	Building	Educational building	Space/ZONE	Practice room
----------	-----	-------	----------	----------------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		1928	20.0	59.5	0.5	60.0	12.5	0		0.0	1928		750	241									
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	8	16	(8)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	8	16	(8)	[m]	[L/person-day]	
b	51	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	0.8	3.8
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	70	70	70	70	70	70	70	70	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Drawing classroom, closing classroom, science classroom, art classroom, homemaking classroom, music classroom, library, librarian room, reading room, study room
note	Maintained average illuminance 750 is assumed

Category	No.	Ed-12	Building	Educational building				Space/ZONE	Lecture hall and gymnasium		
----------	-----	-------	----------	----------------------	--	--	--	------------	----------------------------	--	--

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		1205	20.0	83.3	0.7	0.0	18.0	0		0.0		723		500	241							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	10	15	(5)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	11	15	(3)	[m]	[L/person-day]	
b	51	b	-	-	(0)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	100	0	100	100	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	100	0	100	100	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Lecture theater, lecture room, auditorium, assembly hall, gymnasium, spectator seat, storage of gymnasium, drill all										
note											

Category	No.	Ed-13	Building	Educational building	Space/ZONE	Night watchman's room
----------	-----	-------	----------	----------------------	------------	-----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		5475	15.0	6.4	0.1	4.0	4.0	0			0.0	2920		500	365								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	19	10	(15)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	19	10	(8)	[m]	[L/person-day]	
b	51	b	19	10	(15)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	19	10	(8)	[m]	[L/person-day]
c	73	c	19	10	(15)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	8	c	19	10	(8)	0.4	165.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	50	50	50	50	50	50	50	50	50	25	0	0	0	0	0	0	0	0	0	25	50	50	50	50
	Int. heat gain due to lighting	100	0	0	0	0	0	0	0	50	50	0	0	0	0	0	0	0	0	0	100	100	100	100	100
	Int. heat gain due to occupants	80	80	80	80	80	80	80	80	80	80	0	0	0	0	0	0	0	0	0	80	80	80	80	80
Int. heat gain due to appliances	50	20	20	20	20	20	20	20	20	50	50	20	20	20	20	20	20	20	20	100	100	100	100	50	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	80	80	80	80	80	80	80	80	80	40	0	0	0	0	0	0	0	0	0	40	80	80	80	80
	Int. heat gain due to lighting	100	0	0	0	0	0	0	0	50	50	0	0	0	0	0	0	0	0	0	100	100	100	100	100
	Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0	0	100	100	100	100	100
Int. heat gain due to appliances	50	20	20	20	20	20	20	20	50	50	20	20	20	20	20	20	20	20	20	100	100	100	100	50	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	40	40	40	40	40	40	40	40	40	20	0	0	0	0	0	0	0	0	0	20	40	40	40	40
	Int. heat gain due to lighting	100	0	0	0	0	0	0	0	50	50	0	0	0	0	0	0	0	0	0	100	100	100	100	100
	Int. heat gain due to occupants	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0	0	0	100	100	100	100	100
Int. heat gain due to appliances	50	20	20	20	20	20	20	20	50	50	20	20	20	20	20	20	20	20	20	100	100	100	100	50	

space/zone to be applied	guard room
note	service hot water usage for city hotel of 75% of capacity usage ratio is assumed.

Category	No.	Ed-14	Building	Educational building	Space/ZONE	Changing room
----------	-----	-------	----------	----------------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]		[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		2410	15.0	11.9	0.1	0.0	5.0		2410		13.5		2410		300	241							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	8	18	(10)	Heating season		w1	22	40	-	-	a	8	18	(10)							
b	51	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	[L/person-day]
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	5	c	-	-	(0)	0	62.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	70	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	50	100	100	100	100	100	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Dressing room, locker room, storage
note	Air change rate of 5 1/h is assumed.

Category	No.	Ed-15	Building	Educational building	Space/ZONE	Corrido
----------	-----	-------	----------	----------------------	------------	---------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		2410	15.0	3.6	0.0	0.0	2.5	0			0.0	2410		200	0								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241	a	8	18	(10)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	8	18	(10)	[m]	-	
b	51	b	-	-	(0)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	70	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	50	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Passage, stairs, vending machine corner
note	

Category	No.	Ed-17	Building	Educational building	Space/ZONE	Lavatory
----------	-----	-------	----------	----------------------	------------	----------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		2410	15.0	3.6	0.0	0.0	2.5	2410		40.5		2410		300	0							
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage				
a	241	a	8	18	(10)	Heating season	w1	22	40	-	-	a	8	18	(10)		a	8	18	(10)		
b	51	b	-	-	(0)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	15	c	-	-	(0)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	70	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	50	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Ed-18	Building	Educational building	Space/ZONE	Smoking room
----------	-----	-------	----------	----------------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water	
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]		
		2410	15.0	3.6	0.0	0.0	2.5	2410		81.0		2410		300	0		
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage
a	241	a	8	18	(10)	Heating season	w1	22	40	-	-	a	8	18	(10)	-	-
b	51	b	-	-	(0)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	-
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	70	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	50	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

Category	No.	<i>Ed-19</i>	Building	<i>Educational building</i>	Space/ZONE	<i>Kitchen</i>
-----------------	------------	--------------	-----------------	-----------------------------	-------------------	----------------

General		Space heating & cooling						Ventilation for unconditioned space			Lighting			Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]				
		0	-	-	-	-	-	1200		135.0	1200		750	0				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)	-	-
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0.8	0.0

space/zone to be applied	<i>caboose, inspection and receiving room, syringing room, pantry, service room</i>
note	<i>Air change rate of 50 1/h is assumed.</i>

Category	No.	<i>Ed-20</i>	Building	<i>Educational building</i>	Space/ZONE	<i>Indoor parking garage</i>
-----------------	------------	--------------	-----------------	-----------------------------	-------------------	------------------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water	
Annual schedule	Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days			
A	[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]			
	0	-	-	-	-	-	3000	30.0	3000	150	0			
Total number of days of each daily schedule [day]	Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp. [deg] humi. (%)	Set-back operation Temp. [deg] humi. (%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage
a	241	a	-	(0)	Heating season	0	-	-	-	a	-	(0)	-	-
b	51	b	-	(0)	Cooling season	0	-	-	-	b	-	(0)	[1/h]	-
c	73	c	-	(0)	Intermediate season	0	-	-	-	c	-	(0)	10	0.0

space/zone to be applied	<i>Parking, carriage porch, car barn</i>
note	<i>Air change rate of 10 1/h is assumed.</i>

Category	No.	Ed-21	Building	Educational building	Space/ZONE	Machine room
-----------------	------------	--------------	-----------------	-----------------------------	-------------------	---------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		0	-	-	-	-	-		8760		13.5		120		200	0							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)	a	-	-	(0)			
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	5	c	-	-	(0)	0	0.0

space/zone to be applied	Air conditioning room, boiler room, fan room, pump room, gas container room
note	Air change rate of 5 1/h is assumed.

Category	No.	Ed-22	Building	Educational building	Space/ZONE	Electric room
-----------------	------------	--------------	-----------------	-----------------------------	-------------------	----------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days					
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]					
		0	-	-	-	-	-	8760	27.0	120	200	0					
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage			
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)		
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	MDF room, CPU room, server room, PBX room, lift-motor room, battery room
note	electric machine with large heat emission and air change rate of 10 1/h are assumed.

Category	No.	<i>Ed-23</i>	Building	<i>Educational building</i>	Space/ZONE	<i>Kitchenette with hot water server</i>
-----------------	------------	--------------	-----------------	-----------------------------	-------------------	--

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water		
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]		
		0	-	-	-	-	-	1200		13.5		600		300	0		
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[m]
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0.8

space/zone to be applied	<i>Pantry, refresh corner</i>
note	<i>Air change rate of 5 1/h is assumed.</i>

Category	No.	<i>Ed-24</i>	Building	<i>Educational building</i>	Space/ZONE	<i>Storage room</i>
-----------------	------------	--------------	-----------------	-----------------------------	-------------------	---------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting				Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days					
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]					
		0	-	-	-	-	-	1200	13.5	600	300	0					
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage		
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[m]
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0
																	0.0

space/zone to be applied	
note	<i>Air change rate of 5 1/h is assumed.</i>

Category	No.	Ed-25	Building	Educational building	Space/ZONE	Printing room
-----------------	------------	--------------	-----------------	-----------------------------	-------------------	----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water	
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]		
		0	-	-	-	-	-	1200		27.0		600		500	0		
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp. [deg] humi [%]	Set-back operation Temp. [deg] humi [%]	Time of start & end (hours)			Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	

space/zone to be applied	Copy room
note	Air change rate of 10 1/h is assumed.

Category	No.	Ed-26	Building	Educational building	Space/ZONE	Garbage storage room
-----------------	------------	--------------	-----------------	-----------------------------	-------------------	-----------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		0	-	-	-	-	-		1200		40.5		600		150	0								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. [deg] humi. [%]		Set-back operation Temp. [deg] humi. [%]		Time of start & end (hours)			Ventilation requirement rate		Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)	a		-	-	(0)			
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[1/h]		b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	15		c	-	-	(0)	0	0.0

space/zone to be applied	garbage collection point, waste-collection point
note	Air change rate of 15 1/h is assumed.

D.2.6 Restaurant building

Category	No.	Rs-1	Building	Restaurant building	Space/ZONE	Dining room of restaurant
----------	-----	------	----------	---------------------	------------	---------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		4745	30.0	72.5	0.5	40.0	12.5	0		0.0	4745		500	365									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi[%]		Set-back operation Temp.(deg) humi[%]		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	10	23	(13)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	10	23	(13)	[m]	[L/m2·day]	
b	51	b	10	23	(13)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	10	23	(13)	0.8	48.0
c	73	c	10	23	(13)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	10	23	(13)	0.8	48.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied										
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days							
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0								
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0								
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	40	80	80	80	80	0	0								
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	80	80	80	80	0	0									
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied										
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday							
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0								
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0								
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	100	100	100	100	0	0									
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	100	100	100	100	0	0									
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied										
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays							
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0								
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0								
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	100	100	100	100	0	0									
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	100	100	100	100	0	0									

space/zone to be applied	Guest room of Restaurant
note	service hot water usage for restaurant is assumed.

Category	No.	Rs-3	Building	Restaurant building	Space/ZONE	Guest room of coffee house
----------	-----	------	----------	---------------------	------------	----------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		5475	25.0	47.6	0.4	10.0	10.0	0		0.0		5475		200	365								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp. (deg) humi (%)		Set-back operation Temp. (deg) humi (%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	7	22	(15)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	7	22	(15)	[m]	[L/m2·day]	
b	51	b	7	22	(15)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	7	22	(15)	[m]	[L/m2·day]
c	73	c	7	22	(15)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	7	22	(15)	0.8	32.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	80	80	50	50	100	50	50	50	50	80	80	50	50	50	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	80	80	50	50	100	50	50	50	50	80	80	50	50	50	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	50	50	50	50	100	80	80	80	80	80	50	50	50	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	50	50	50	50	100	80	80	80	80	80	50	50	50	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	50	50	50	50	100	80	80	80	80	80	50	50	50	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	50	50	50	50	100	80	80	80	80	80	50	50	50	0	0		

space/zone to be applied	Guest room of café, guest room of coffee shop, guest room of tearoom
note	service hot water usage for cafe is assumed.

Category	No.	Rs-4	Building	Restaurant building	Space/ZONE	Bar
----------	-----	------	----------	---------------------	------------	-----

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		1752	10.0	23.8	0.2	0.0	5.0	0		0.0		1752		50	292							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point	Patterns	Normal operation Temp.(deg) hum(%)		Set-back operation Temp.(deg) hum(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241	a	18	24	(6)	Heating season	w1	22	40	-	-	a	-	-	(0)	-	a	18	24	(6)	-	
b	51	b	18	24	(6)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	18	24	(6)	[m]	[L/m2·day]
c	73	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	32.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
																						Week days				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			20	21	22
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	50	100	100	100	100
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
																						Saturday				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			20	21	22
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	40	80	80	80	80	80
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
																						Sunday, Holidays, year-end and new-year holidays				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19			20	21	22
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Bar corner, guest room of shot bar
note	Maintained average illuminance 50 is assumed

Category	No.	Rs-6	Building	Restaurant building	Space/ZONE	Office room
----------	-----	------	----------	---------------------	------------	-------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water					
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days					
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]					
		4745	15.0	11.9	0.1	10.0	5.0	0		0.0		4745		750	365					
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241	a	10	23 (13)	Heating season		w1	22	40	-	-	a	-	- (0)	-	a	10	23 (13)	[m]	[L/person-day]
b	51	b	10	23 (13)	Cooling season		s1	26	50	-	-	b	-	- (0)	[1/h]	b	10	23 (13)	[m]	[L/person-day]
c	73	c	10	23 (13)	Intermediate season		m1	24	50	-	-	c	-	- (0)	-	c	10	23 (13)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
Week days																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Staff room, resting room
note	office as a whole. Service hot water usage for lavatory is assumed.

Category	No.	Rs-7	Building	Restaurant building	Space/ZONE	Changing room
----------	-----	------	----------	---------------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		4745	15.0	11.9	0.1	0.0	5.0	4745		13.5		4745		300	365							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns		Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241	a	10	23	(13)	Heating season		w1	22	40	-	-	a	10	23	(13)	a	10	23	(13)		
b	51	b	10	23	(13)	Cooling season		s1	26	50	-	-	b	10	23	(13)	[1/h]	b	10	23	(13)	[m]
c	73	c	10	23	(13)	Intermediate season		m1	24	50	-	-	c	10	23	(13)	5	c	10	23	(13)	62.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0		
Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0		
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

Category	No.	Rs-8	Building	Restaurant building	Space/ZONE	Corridor
----------	-----	------	----------	---------------------	------------	----------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days					
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]					
		4745	20.0	11.9	0.1	0.0	2.5		0		0.0		4745		150	0					
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns		Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate		Time of start & end (total hours)		Height of working plane		Total daily usage
a	241	a	10	23 (13)	Heating season		w1	22	40	-	-	a	-	-	(0)	-	a	10	23 (13)	-	-
b	51	b	10	23 (13)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	10	23 (13)	[m]	-
c	73	c	10	23 (13)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	10	23 (13)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	80	80	80	80	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	100	100	100	100	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	100	100	100	100	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
																	Sunday, Holidays, year-end and new-year holidays								

Category	No.	Rs-9	Building	Restaurant building	Space/ZONE	Lobby
----------	-----	------	----------	---------------------	------------	-------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		4745	20.0	11.9	0.1	0.0	2.5	0		0.0		4745		300	365								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns		Normal operation Temp. (deg) hum. (%)		Set-back operation Temp. (deg) hum. (%)		Time of start & end (hours)		Ventilation requirement rate		Time of start & end (total hours)		Height of working plane	Total daily usage		
a	241	a	10	23	(13)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	10	23	(13)			
b	51	b	10	23	(13)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	10	23	(13)	[m]	[L/person-day]
c	73	c	10	23	(13)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	10	23	(13)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	40	80	80	80	80	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	40	100	100	100	100	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	40	100	100	100	100	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						

Category	No.	Rs-10	Building	Restaurant building	Space/ZONE	Lavatory
----------	-----	-------	----------	---------------------	------------	----------

General			Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		4745	20.0	11.9	0.1	0.0	2.5	4745		40.5		4745		300	0							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. [deg] hum. [%]	Set-back operation Temp. [deg] hum. [%]	Time of start & end [hours]				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	241	a	10	23	(13)	Heating season	w1	22	40	-	-	a	10	23	(13)	a	10	23	(13)	[m]	-	
b	51	b	10	23	(13)	Cooling season	s1	26	50	-	-	b	10	23	(13)	[1/h]	b	10	23	(13)	[m]	-
c	73	c	10	23	(13)	Intermediate season	m1	24	50	-	-	c	10	23	(13)	15	c	10	23	(13)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied
	time						time								time								
	0 1 2 3 4 5						6 7 8 9 10 11 12 13 14								15 16 17 18 19 20 21 22 23								
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0		
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	80	80	80	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied
	time						time								time								
	0 1 2 3 4 5						6 7 8 9 10 11 12 13 14								15 16 17 18 19 20 21 22 23								
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0		
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	100	100	100	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied
	time						time								time								
	0 1 2 3 4 5						6 7 8 9 10 11 12 13 14								15 16 17 18 19 20 21 22 23								
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0		
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	100	100	100	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Rs-11	Building	Restaurant building	Space/ZONE	Smoking room
----------	-----	-------	----------	---------------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water					
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days						
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]						
		4745	20.0	11.9	0.1	0.0	2.5	4745			81.0	4745		300	0						
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) hum.(%)		Set-back operation Temp.(deg) hum.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241	a	10	23	(13)	Heating season	w1	22	40	-	-	a	10	23	(13)		a	10	23	(13)	
b	51	b	10	23	(13)	Cooling season	s1	26	50	-	-	b	10	23	(13)	[1/h]	b	10	23	(13)	
c	73	c	10	23	(13)	Intermediate season	m1	24	50	-	-	c	10	23	(13)	30	c	10	23	(13)	

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	80	80	80	80	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	100	100	100	100	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	100	100	100	100	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

Category	No.	Rs-12	Building	Restaurant building	Space/ZONE	Kitchen
----------	-----	-------	----------	---------------------	------------	---------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water						
Annual schedule	Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days							
A	[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]							
	0	-	-	-	-	-	3400	135.0	3400	750	0							
Total number of days of each daily schedule [day]	Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	-	-	(0)	Heating season		0	-		-	-			-	a	-	-
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0.8	0.0

space/zone to be applied	caboose, inspection and receiving room, syringing room, pantry, service room
note	Air change rate of 50 1/h is assumed.

Category	No.	Rs-13	Building	Restaurant building	Space/ZONE	Indoor parking garage
----------	-----	-------	----------	---------------------	------------	-----------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water							
Annual schedule	Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days								
A	[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]								
	0	-	-	-	-	-	5000	30.0	5000	150	0								
Total number of days of each daily schedule (day)	Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage						
a	241	a	-	-	(0)	Heating season		0	-					-	-	(0)	a	-	-
b	51	b	-	-	(0)	Cooling season		0	-	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	(0)	10	c	-	-	(0)	0	0.0

space/zone to be applied	Parking, carriage porch, car barn
note	Air change rate of 10 1/h is assumed.

Category	No.	Rs-14	Building	Restaurant building	Space/ZONE	Machine room
----------	-----	-------	----------	---------------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
		0	-	-	-	-	-	8760	13.5	340	200	0				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. (deg) humi. (%)	Set-back operation Temp. (deg) humi. (%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage		
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0.0

space/zone to be applied	Air conditioning room, boiler room, fan room, pump room, gas container room												
note	Air change rate of 5 1/h is assumed.												

Category	No.	Rs-15	Building	Restaurant building	Space/ZONE	Electric room
----------	-----	-------	----------	---------------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space			Lighting			Domestic hot water		
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]		
		0	-	-	-	-	-	8760		27.0	340		200	0		
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0

space/zone to be applied	MDF room, CPU room, server room, PBX room, lift-motor room, battery room												
note	electric machine with large heat emission and air change rate of 10 1/h are assumed.												

Category	No.	Rs-16	Building	Restaurant building	Space/ZONE	Kitchenette with hot water server
----------	-----	-------	----------	---------------------	------------	-----------------------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
		0	-	-	-	-	-	3400	13.5	1700	300	0				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. [deg] humi. [%]	Set-back operation Temp. [deg] humi. [%]	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage		
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0.8

space/zone to be applied	Pantry, refresh corner
note	Air change rate of 5 1/h is assumed.

Category	No.	Rs-17	Building	Restaurant building	Space/ZONE	Storage room
----------	-----	-------	----------	---------------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space			Lighting			Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days		
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]		
		0	-	-	-	-	-	3400		13.5		1700		300	0		
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)		
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	
note	Air change rate of 5 1/h is assumed.

Category	No.	Rs-18	Building	Restaurant building	Space/ZONE	Printing room
----------	-----	-------	----------	---------------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days					
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]					
		0	-	-	-	-	-	3400	27.0	1700	500	0					
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage			
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	[m]	-
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0.8	0.0

space/zone to be applied	Copy room
note	Air change rate of 10 1/h is assumed.

Category	No.	Rs-19	Building	Restaurant building	Space/ZONE	Garbage storage room
----------	-----	-------	----------	---------------------	------------	----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		0	-	-	-	-	-	3400		40.5		1700		150	0								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage					
a	241	a	-	-	(0)	Heating season		0	-	-	-	-		a	-	-			(0)	a	-	-	(0)
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[1/h]	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	15	c	-	-	(0)	0	0.0

space/zone to be applied	garbage collection point, waste-collection point
note	Air change rate of 15 1/h is assumed.

D.2.7 Library building

Category	No.	Lb-1	Building	Library building	Space/ZONE	Reading room
----------	-----	------	----------	------------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water									
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
E		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]	[hours/yr.]		[lux]	[day]								
		3377	15.0	23.8	0.2	3.0	7.0	0		0.0	3070		750	307								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. (deg) hum. (%)	Set-back operation Temp. (deg) hum. (%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	189	a	8	19	(11)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	9	19	(10)			
b	118	b	8	19	(11)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	19	(10)	[m]	[L/person-day]
c	58	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	60	60	60	60	60	60	60	60	60	60	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	reading room, book storeroom, storage, research room
note	Service hot water usage for lavatory is assumed.

Category	No.	Lb-2	Building	Library building	Space/ZONE	Lobby
----------	-----	------	----------	------------------	------------	-------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
E		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		3377	15.0	23.8	0.2	0.0	5.0	0		0.0		3070		300	307								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	189	a	8	19	(11)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	9	19	(10)			
b	118	b	8	19	(11)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	19	(10)	[m]	[L/person-day]
c	58	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	60	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	60	60	60	60	60	60	60	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Hall, foyer, waiting room
note	Service hot water usage for lavatory is assumed.

Category	No.	Lb-3	Building	Library building	Space/ZONE	Lavatory
----------	-----	------	----------	------------------	------------	----------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
E		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		3377	15.0	23.8	0.2	0.0	5.0	3070		40.5		3070		300	0							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	189	a	8	19	(11)	Heating season	w1	22	40	-	-	a	9	19	(10)	a	9	19	(10)			
b	118	b	8	19	(11)	Cooling season	s1	26	50	-	-	b	9	19	(10)	[1/h]	b	9	19	(10)	[m]	-
c	58	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	15	c	-	-	(0)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	60	60	60	60	60	60	60	60	60	60	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday, Sunday, Holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	One day a week, Year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Lb-4	Building	Library building	Space/ZONE	Smoking room
----------	-----	------	----------	------------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
E		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		3377	15.0	23.8	0.2	0.0	5.0	3070		81.0		3070		300	0								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	189	a	8	19	(11)	Heating season		w1	22	40	-	-	a	9	19	(10)	a	9	19	(10)	[m]	-	
b	118	b	8	19	(11)	Cooling season		s1	26	50	-	-	b	9	19	(10)	[1/h]	b	9	19	(10)	[m]	-
c	58	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	30	c	-	-	(0)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	60	60	60	60	60	60	60	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

D.2.8 Museum building

Category	No.	Ms-1	Building	Museum building	Space/ZONE	Exhibition room
----------	-----	------	----------	-----------------	------------	-----------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water											
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days												
E		[hours/yr.]	[W/m²]	[W/m²]	[Person/m²]	[W/m²]	[m³/h·m²]	[hours/yr.]		[m³/h·m²]		[hours/yr.]		[lux]	[day]												
		2763	15.0	3.6	0.0	0.0	6.0	0		0.0		2456		500	307												
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) hum.(%)	Set-back operation Temp.(deg) hum.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage											
a	189	a	8	17	(9)	Heating season	w1	22	40	-	-	a	-	-	(0)	-	-	-	(0)	-	-	(0)	-	-	(0)	0	3.8
b	118	b	8	17	(9)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	17	(8)	[m]	[L/person-day]					
c	58	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0						

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0																							

Category	No.	Ms-2	Building	Museum building	Space/ZONE	Lobby
----------	-----	------	----------	-----------------	------------	-------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
E		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		2763	15.0	23.8	0.2	0.0	5.0		0		0.0		2456		300	307							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns		Normal operation Temp. (deg) hum. (%)		Set-back operation Temp. (deg) hum. (%)		Time of start & end (hours)			Ventilation requirement rate		Time of start & end (total hours)		Height of working plane	Total daily usage		
a	189	a	8	17	(9)	Heating season		w1	22	40	-	-	a	-	-	(0)	-	a	9	17	(8)	[m]	[L/person-day]
b	118	b	8	17	(9)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	17	(8)	[m]	[L/person-day]
c	58	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Week days																									
Saturday, Sunday, Holidays																									
One day a week, Year end and new-year holidays																									

space/zone to be applied	Hall, foyer, waiting room, booking office
note	Service hot water usage for lavatory is assumed.

Category	No.	MS-3	Building	Museum building	Space/ZONE	Lavatory
----------	-----	------	----------	-----------------	------------	----------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water					
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days					
E		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]					
		2763	15.0	23.8	0.2	0.0	5.0	2456	40.5	2456	300	0					
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp. [deg] hum. [%]	Set-back operation Temp. [deg] hum. [%]	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	189	a	8	17	(9)	Heating season		w1	22	40	-	-	a	9	17	(8)	
b	118	b	8	17	(9)	Cooling season		s1	26	50	-	-	b	9	17	(8)	[m]
c	58	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
Daily schedule b	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Ms-4	Building	Museum building	Space/ZONE	Smoking room
----------	-----	------	----------	-----------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days							
E		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]							
		2763	15.0	23.8	0.2	0.0	5.0	2456			81.0	2456		300	0							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp. (deg) hum. (%)		Set-back operation Temp. (deg) hum. (%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	189	a	8	17	(9)	Heating season	w1	22	40	-	-	a	9	17	(8)	a	9	17	(8)			
b	118	b	8	17	(9)	Cooling season	s1	26	50	-	-	b	9	17	(8)	[1/h]	b	9	17	(8)	[m]	-
c	58	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	30	c	-	-	(0)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

Category	No.	Sa-2	Building	Sports and amusement building	Space/ZONE	Lobby of sports club
----------	-----	------	----------	-------------------------------	------------	----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours		Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days						
E		[hours/yr.]		[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]						
		4298		15.0	11.9	0.1	0.0	2.5		0		0.0		3991		500	307						
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)				Height of working plane	Total daily usage		
a	189	a	9	23	(14)	Heating season		w1	22	40	-	-	a	-		-	(0)	a	10			23	(13)
b	118	b	9	23	(14)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	10	23	(13)	[m]	[L/person-day]
c	58	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	60	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	60	60	60	60	60	60
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Week day																			

Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	60	60	60	60	100
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Saturday, Sunday, Holidays																			

Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
One day a week, Year end and new-year holidays																			

space/zone to be applied	Entrance lobby, front desk, waiting room
note	Service hot water usage for lavatory is assumed.

Category	No.	Sa-3	Building	Sports and amusement building	Space/ZONE	Lavatory of sports club
----------	-----	------	----------	-------------------------------	------------	-------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
E		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		4298	15.0	11.9	0.1	0.0	2.5	3991		40.5		3991		300	0							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	189	a	9	23	(14)	Heating season	w1	22	40	-	-	a	10	23	(13)		a	10	23	(13)		
b	118	b	9	23	(14)	Cooling season	s1	26	50	-	-	b	10	23	(13)	[1/h]	b	10	23	(13)	[m]	-
c	58	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	15	c	-	-	(0)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0		
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	60	60	60	60	60	60	100	100	100	60	60	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday, Sunday, Holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0		
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	60	60	60	60	100	100	100	100	60	60	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	One day a week, Year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Sa-4	Building	Sports and amusement building	Space/ZONE	Smoking room of sports club
----------	-----	------	----------	-------------------------------	------------	-----------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days							
E		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]							
		4298	15.0	11.9	0.1	0.0	2.5	3991			81.0	3991		300	0							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage		
a	189	a	9	23	(14)	Heating season		w1	22	40	-	-	a	10	23	(13)		a	10	23	(13)	
b	118	b	9	23	(14)	Cooling season		s1	26	50	-	-	b	10	23	(13)	[1/h]	b	10	23	(13)	
c	58	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	30	c	-	-	(0)	

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	60	60	60	60	60	60	60	100	100	100	60	60	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	60	60	60	60	100	100	100	100	100	60	60	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

Category	No.	Sa-5	Building	Sports and amusement building	Space/ZONE	Skating rink for official competition
----------	-----	------	----------	-------------------------------	------------	---------------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
D		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		4511	60.0	14.5	0.1	0.0	12.5	0		0.0		4164		1500	347							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	229	a	8	21	(13)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	9	21	(12)	[m]	[L/person-day]	
b	118	b	8	21	(13)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	21	(12)	[m]	[L/person-day]
c	18	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	5	c	-	-	(0)	0	62.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	50	80	80	80	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday, Sunday, Holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	80	80	80	80	60	60	60	60	60	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	One day a month, Year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Arena for ice hockey, figure skating, speed skating
note	Maintained average illuminance 1500 is assumed

Category	No.	Sa-6	Building	Sports and amusement building	Space/ZONE	Gymnasium for official competition
----------	-----	------	----------	-------------------------------	------------	------------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		4511	60.0	14.5	0.1	0.0	12.5		0		0.0	4164		1000	347								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	229	a	8	21	(13)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	9	21	(12)			
b	118	b	8	21	(13)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	21	(12)	[m]	[L/person-day]
c	18	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	5	c	-	-	(0)	60	62.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	50	80	80	80	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	80	80	80	80	60	60	60	60	60	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Arena for basketball, gymnastic performance, judo, kendo, fencing
note	Maintained average illuminance 1000 is assumed

Category	No.	Sa-7	Building	Sports and amusement building	Space/ZONE	Skating rink for general competition
----------	-----	------	----------	-------------------------------	------------	--------------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		4511	60.0	14.5	0.1	0.0	12.5	0		0.0		4164		750	347							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	229	a	8	21	(13)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	9	21	(12)	[m]	[L/person-day]	
b	118	b	8	21	(13)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	21	(12)	[m]	[L/person-day]
c	18	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	5	c	-	-	(0)	0	62.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	50	80	80	80	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	80	80	80	80	60	60	60	60	60	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Arena for ice hockey, figure skating, speed skating
note	Maintained average illuminance 750 is assumed

Category	No.	Sa-8	Building	Sports and amusement building	Space/ZONE	Gymnasium for general competition
----------	-----	------	----------	-------------------------------	------------	-----------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		4511	60.0	14.5	0.1	0.0	12.5	0		0.0	4164		500	347									
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	229	a	8	21	(13)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	9	21	(12)	[m]	[L/person-day]	
b	118	b	8	21	(13)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	21	(12)	[m]	[L/person-day]
c	18	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	5	c	-	-	(0)	60	62.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	50	80	80	80	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	80	80	80	80	60	60	60	60	60	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule d	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule e	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule f	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule g	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule h	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule i	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule j	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule k	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule l	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0</												

Category	No.	Sa-9	Building	Sports and amusement building	Space/ZONE	Skating rink for recreation
----------	-----	------	----------	-------------------------------	------------	-----------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
D		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		4511	60.0	14.5	0.1	0.0	12.5	0		0.0		4164		300	347							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	229	a	8	21	(13)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	9	21	(12)			
b	118	b	8	21	(13)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	21	(12)	[m]	[L/person-day]
c	18	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	5	c	-	-	(0)	0	62.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	50	80	80	80	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	80	80	80	80	60	60	60	60	60	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Arena for ice hockey, figure skating, speed skating
note	Maintained average illuminance 300 is assumed

Category	No.	Sa-10	Building	Sports and amusement building	Space/ZONE	Gymnasium for recreation
----------	-----	-------	----------	-------------------------------	------------	--------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		4511	60.0	14.5	0.1	0.0	12.5	0			0.0	4164		200	347								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	229	a	8	21	(13)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	9	21	(12)	[m]	[L/person-day]	
b	118	b	8	21	(13)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	21	(12)	[m]	[L/person-day]
c	18	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	5	c	-	-	(0)	60	62.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	50	50	50	50	50	50	50	80	80	80	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	80	80	80	80	60	60	60	60	60	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Arena for basketball, gymnastic performance, judo, kendo, fencing
note	Maintained average illuminance 200 is assumed

Category	No.	Sa-11	Building	Sports and amusement building	Space/ZONE	Spectator stand of gymnasium or skating rink
----------	-----	-------	----------	-------------------------------	------------	--

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
D		[hours/yr.]	[W/m ²]	[W/m ²]	[Person/m ²]	[W/m ²]	[m ³ /h·m ²]	[hours/yr.]		[m ³ /h·m ²]		[hours/yr.]		[lux]	[day]							
		4511	20.0	58.0	0.4	0.0	10.0	0		0.0		4164		75	347							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	229	a	8	21	(13)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	9	21	(12)	[m]	[L/person-day]	
b	118	b	8	21	(13)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	21	(12)	[m]	[L/person-day]
c	18	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	40	40	40	40	40	40	40	40	40	40	40	40	40	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	50	50	50	50	50	100	100	100	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Audience seats
note	Maintained average illuminance 750 is assumed. Service hot water usage for lavatory is assumed.

Category	No.	Sa-12	Building	Sports and amusement building	Space/ZONE	Lobby of gymnasium or skating rink
----------	-----	-------	----------	-------------------------------	------------	------------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days									
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]									
		4511	15.0	11.9	0.1	0.0	2.5	0		0.0	4164		500	347									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	229	a	8	21	(13)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	9	21	(12)			
b	118	b	8	21	(13)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	21	(12)	[m]	[L/person-day]
c	18	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	60	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	40	40	40	40	40	40	40	40	40	40	40	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Waiting room, entrance hall
note	Maintained average illuminance 500 is assumed. Service hot water usage for lavatory is assumed.

Category	No.	Sa-13	Building	Sports and amusement building	Space/ZONE	Lavatory of gymnasium or skating rink
----------	-----	-------	----------	-------------------------------	------------	---------------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		4511	15.0	11.9	0.1	0.0	2.5	4164		40.5		4164		300	0							
Total number of days of each daily schedule [day]		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	229	a	8	21	(13)	Heating season	w1	22	40	-	-	a	9	21	(12)	a	9	21	(12)			
b	118	b	8	21	(13)	Cooling season	s1	26	50	-	-	b	9	21	(12)	[1/h]	b	9	21	(12)	[m]	-
c	18	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	15	c	-	-	(0)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	40	40	40	40	40	40	40	40	40	40	40	40	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Sa-14	Building	Sports and amusement building	Space/ZONE	Smoking room of gymnasium or skating rink
----------	-----	-------	----------	-------------------------------	------------	---

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		4511	15.0	11.9	0.1	0.0	2.5		4164		81.0		4164		300	0							
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns		Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	229	a	8	21	(13)	Heating season		w1	22	40	-	-	a	9		21	(12)			a	9	21	(12)
b	118	b	8	21	(13)	Cooling season		s1	26	50	-	-	b	9	21	(12)	[1/h]	b	9	21	(12)	[m]	-
c	18	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	30	c	-	-	(0)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	40	40	40	40	40	40	40	40	40	40	40	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants								Hourly ratio of heat gain due to appliances								Days to be applied		
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
STANDARDS ISO 18523-12																									
Click to view the full PDF of ISO 18523-12																									
One day a month, Year-end and new-year holidays																									

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

Category	No.	Sa-16	Building	Sports and amusement building	Space/ZONE	Betting shop of racing course
----------	-----	-------	----------	-------------------------------	------------	-------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		3123	15.0	11.9	0.1	0.0	2.5		0		0.0	2776		500	0								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	229	a	9	18	(9)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	10	18	(8)			
b	118	b	9	18	(9)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	10	18	(8)	[m]	-
c	18	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	100	100	100	100	100	60	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	100	100	100	100	100	60	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
STANDARDS50.COM																									
Click to view the full PDF of ISO 18523-1:2017																									
One day a month, Year-end and new-year holidays																									

space/zone to be applied	Ticket counter
note	

Category	No.	Sa-17	Building	Sports and amusement building	Space/ZONE	Lobby of racing course
----------	-----	-------	----------	-------------------------------	------------	------------------------

General		Space heating & cooling							Ventilation for unconditioned space			Lighting			Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		3123	15.0	11.9	0.1	0.0	2.5	0		0.0	2776		300	347								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi(%)		Set-back operation Temp.(deg) humi(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	229	a	9	18	(9)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	10	18	(8)	[m]	[L/person-day]	
b	118	b	9	18	(9)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	10	18	(8)	[m]	[L/person-day]
c	18	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	100	100	100	100	100	60	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday, Sunday, Holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	100	100	100	100	100	60	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	One day a month, Year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Hall, foyer, waiting room
note	Service hot water usage for lavatory is assumed.

Category	No.	Sa-18	Building	Sports and amusement building	Space/ZONE	Lavatory of racing course
----------	-----	-------	----------	-------------------------------	------------	---------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours	maintained average illuminance	Total number of days								
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]	[lux]	[day]								
		3123	15.0	11.9	0.1	0.0	2.5		3123		40.5		2776	300	0								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage						
a	229	a	9	18	(9)	Heating season		w1	22	40	-	-	a	9	18	(9)	a	10	18	(8)			
b	118	b	9	18	(9)	Cooling season		s1	26	50	-	-	b	9	18	(9)	[1/h]	b	10	18	(8)	[m]	-
c	18	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	15	c	-	-	(0)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	100	100	100	100	100	60	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	100	100	100	100	100	60	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
STANDARDS50.COM																									
Click to view the full PDF of ISO 18523-1:2017																									
One day a month, Year-end and new-year holidays																									

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Sa-19	Building	Sports and amusement building	Space/ZONE	Smoking room of racing course
----------	-----	-------	----------	-------------------------------	------------	-------------------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days									
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]									
		3123	15.0	11.9	0.1	0.0	2.5	3123	81.0	2776	300	0									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage							
a	229	a	9	18	(9)	Heating season	w1	22	40	-	-	a	9	18	(9)	a	10	18	(8)		
b	118	b	9	18	(9)	Cooling season	s1	26	50	-	-	b	9	18	(9)	[1/h]	b	10	18	(8)	[m]
c	18	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	30	c	-	-	(0)	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	100	100	100	100	100	60	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday, Sunday, Holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	100	100	100	100	100	60	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	One day a month, Year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

Category	No.	Sa-20	Building	Sports and amusement building	Space/ZONE	Bowling alley
----------	-----	-------	----------	-------------------------------	------------	---------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours		Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days						
A		[hours/yr.]		[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]						
		5475		15.0	14.5	0.1	15.0	2.5		5110		40.5		5110		400	365						
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)				Height of working plane	Total daily usage	
a	241	a	9	24	(15)	Heating season		w1	22	40	-	-	a	10	24		(14)	a	10	24	(14)	[m]	[L/person-day]
b	51	b	9	24	(15)	Cooling season		s1	26	50	-	-	b	10	24	(14)	[1/h]	b	10	24	(14)	[m]	
c	73	c	9	24	(15)	Intermediate season		m1	24	50	-	-	c	10	24	(14)	15	c	10	24	(14)	60	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	50	50	50	40	40	40	40	40	80	80	80	40	40	40
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	50	50	50	40	40	40	40	40	80	80	80	40	40	40	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	70	70	70	100	100	100	100	100	80	80	80	40	40	40
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	70	70	70	100	100	100	100	100	80	80	80	40	40	40	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	70	70	70	100	100	100	100	100	80	80	80	40	40	40
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	70	70	70	100	100	100	100	100	80	80	80	40	40	40	
STANDARDS40.COM																									
Click to view the full PDF of ISO 18523-1:2015																									
Week day																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	bowling alley
note	Air change rate of 15 1/h is assumed. Service hot water usage for lavatory is assumed.

Category	No.	Sa-21	Building	Sports and amusement building	Space/ZONE	Karaoke room
----------	-----	-------	----------	-------------------------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
		8760	15.0	58.0	0.4	5.0	10.0	8760	40.5	8760	400	365				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)		Set-point	Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage
a	241	a	- 24 (24)	Heating season		w1	22 40	- -	a	- 24 (24)		a	- 24 (24)			
b	51	b	- 24 (24)	Cooling season		s1	26 50	- -	b	- 24 (24)	[1/h]	b	- 24 (24)		[m]	[L/person-day]
c	73	c	- 24 (24)	Intermediate season		m1	24 50	- -	c	- 24 (24)	15	c	- 24 (24)	0		3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	20	20	20	20	20	20	40	40	40	40	60	60	60	60	60	60	60	60	80	80	80	80	40	40	
Int. heat gain due to appliances	20	20	20	20	20	20	40	40	40	40	60	60	60	60	60	60	60	60	80	80	80	80	40	40	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	20	20	20	20	20	20	60	60	60	60	60	60	100	100	100	100	100	100	100	100	100	100	60	60	
Int. heat gain due to appliances	20	20	20	20	20	20	60	60	60	60	60	60	100	100	100	100	100	100	100	100	100	100	60	60	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	20	20	20	20	20	20	60	60	60	60	60	60	100	100	100	100	100	100	100	100	100	100	60	60	
Int. heat gain due to appliances	20	20	20	20	20	20	60	60	60	60	60	60	100	100	100	100	100	100	100	100	100	100	60	60	
Week days																									
Saturday																									
Sunday, Holidays, year-end and new-year holidays																									

space/zone to be applied	Internet café
note	Air change rate of 15 1/h is assumed. Service hot water usage for lavatory is assumed.

Category	No.	Sa-22	Building	Sports and amusement building	Space/ZONE	Pachinko or slot machine hall
----------	-----	-------	----------	-------------------------------	------------	-------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours		Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement		Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days						
A		[hours/yr.]		[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]		[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]						
		5110		60.0	72.5	0.5	100.0	25.0		4745		40.5		4745		1000	365						
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate		Time of start & end (total hours)		Height of working plane	Total daily usage		
a	241	a	9	23	(14)	Heating season		w1	22	40	-	-	a	10	23	(13)		a	10	23	(13)		
b	51	b	9	23	(14)	Cooling season		s1	26	50	-	-	b	10	23	(13)	[1/h]	b	10	23	(13)	[m]	[L/person-day]
c	73	c	9	23	(14)	Intermediate season		m1	24	50	-	-	c	10	23	(13)	15	c	10	23	(13)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	70	70	70	50	50	50	50	50
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	70	70	70	50	50	50	50	50	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	80	80	80	50	50	50	50	100
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	80	80	80	50	50	50	50	100	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	80	80	80	50	50	50	50	100
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	80	80	80	50	50	50	50	100	
Week day																			
Saturday																			
Sunday, Holidays, year-end and new-year holidays																			

Category	No.	Sa-23	Building	Sports and amusement building	Space/ZONE	Bath hall of bathhouse
----------	-----	-------	----------	-------------------------------	------------	------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		5475	10.0	23.8	0.2	0.0	5.0	5110		13.5		5110		300	365							
Total number of days of each daily schedule (day)			Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	229	a	8	23	(15)	Heating season	w1	22	40	-	-	a	9	23	(14)	a	9	23	(14)			
b	118	b	8	23	(15)	Cooling season	s1	26	50	-	-	b	9	23	(14)	[1/h]	b	9	23	(14)	[m]	[L/person-day]
c	18	c	8	23	(15)	Intermediate season	m1	24	50	-	-	c	9	23	(14)	5	c	9	23	(14)	0	300.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	40	40	40	40	40	40	40	40	40	80	80	80	80	40	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	80	80	80	80	80	80	100	100	100	80	80	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	80	80	80	80	80	80	100	100	100	80	80	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Sauna room
note	Service hot water usage for bath house is assumed.

Category	No.	Sa-24	Building	Sports and amusement building	Space/ZONE	Changing room of bathhouse
----------	-----	-------	----------	-------------------------------	------------	----------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		5475	10.0	23.8	0.2	0.0	5.0	5110			13.5	5110		300	365								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	229	a	8	23	(15)	Heating season		w1	22	40	-	-	a	9	23	(14)	[1/h]	a	9	23	(14)	[m]	[L/person-day]
b	118	b	8	23	(15)	Cooling season		s1	26	50	-	-	b	9	23	(14)		b	9	23	(14)		
c	18	c	8	23	(15)	Intermediate season		m1	24	50	-	-	c	9	23	(14)		5	c	9	23		

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	40	40	40	40	40	40	40	40	40	80	80	80	80	40	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	80	80	80	80	80	80	100	100	100	80	80	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	80	80	80	80	80	80	100	100	100	80	80	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	changing room, locker room
note	Service hot water usage for bath house is assumed.

Category	No.	Sa-25	Building	Sports and amusement building	Space/ZONE	Lounge of bathhouse
----------	-----	-------	----------	-------------------------------	------------	---------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		5475	10.0	23.8	0.2	0.0	5.0	5110		13.5		5110		200	365							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	229	a	8	23	(15)	Heating season	w1	22	40	-	-	a	9	23	(14)	a	9	23	(14)			
b	118	b	8	23	(15)	Cooling season	s1	26	50	-	-	b	9	23	(14)	[1/h]	b	9	23	(14)	[m]	[L/person-day]
c	18	c	8	23	(15)	Intermediate season	m1	24	50	-	-	c	9	23	(14)	5	c	9	23	(14)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	40	40	40	40	40	40	40	40	40	80	80	80	80	40	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday, Sunday, Holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	80	80	80	80	80	80	100	100	100	80	80	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	One day a month, Year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	80	80	80	80	80	80	100	100	100	80	80	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Rest room, game room, massage room
note	Service hot water usage for lavatory is assumed.

Category	No.	Sa-27	Building	Sports and amusement building	Space/ZONE	Lavatory of bathhouse
----------	-----	-------	----------	-------------------------------	------------	-----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		5475	15.0	23.8	0.2	0.0	5.0	5110		40.5		5110		300	0							
Total number of days of each daily schedule (day)			Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	229	a	8	23	(15)	Heating season	w1	22	40	-	-	a	9	23	(14)	a	9	23	(14)			
b	118	b	8	23	(15)	Cooling season	s1	26	50	-	-	b	9	23	(14)	[1/h]	b	9	23	(14)	[m]	-
c	18	c	8	23	(15)	Intermediate season	m1	24	50	-	-	c	9	23	(14)	15	c	9	23	(14)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	40	40	40	40	40	40	40	40	40	80	80	80	80	40	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	80	80	80	80	80	80	100	100	100	80	80	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	80	80	80	80	80	80	100	100	100	80	80	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Sa-28	Building	Sports and amusement building	Space/ZONE	Smoking room of bathhouse
----------	-----	-------	----------	-------------------------------	------------	---------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
D		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		5475	15.0	23.8	0.2	0.0	5.0	5110		81.0		5110		300	0								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	229	a	8	23	(15)	Heating season		w1	22	40	-	-	a	9	23	(14)	a	9	23	(14)	[m]	-	
b	118	b	8	23	(15)	Cooling season		s1	26	50	-	-	b	9	23	(14)	[1/h]	b	9	23	(14)	[m]	-
c	18	c	8	23	(15)	Intermediate season		m1	24	50	-	-	c	9	23	(14)	30	c	9	23	(14)	60	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	40	40	40	40	40	40	40	40	40	40	80	80	80	80	40	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	80	80	80	80	80	80	80	100	100	100	80	80	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	50	50	50	80	80	80	80	80	80	80	100	100	100	80	80	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

D.2.10 Theatre building

Category	No.	Th-1	Building	Theatre building	Space/ZONE	Auditorium of theatre
----------	-----	------	----------	------------------	------------	-----------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water		
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days		
F		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]		
		2510	50.0	145.0	1.0	0.0	25.0	0	0.0	2259	300	251		
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)		Set-point	Patterns	Normal operation Temp (deg) humi (%)	Set-back operation Temp (deg) humi (%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage	
a	132	a	10 20 (10)	Heating season	w1	22 40 - -	- -	a	- - - (0)		a	11 20 (9)	[m]	[L/person·day]
b	119	b	10 20 (10)	Cooling season	s1	26 50 - -	- -	b	- - - (0)	[1/h]	b	11 20 (9)	[m]	[L/person·day]
c	114	c	- - (0)	Intermediate season	m1	24 50 - -	- -	c	- - - (0)	-	c	- - (0)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	80	80	80	80	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	100	100	50	50	50	50	100	100	100	100	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Audience seats
note	Service hot water usage for lavatory is assumed.

Category	No.	Th-2	Building	Theatre building	Space/ZONE	Stage of theatre
----------	-----	------	----------	------------------	------------	------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours			maintained average illuminance	Total number of days							
F		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]			[lux]	[day]							
		2510	50.0	145.0	1.0	0.0	25.0	0			0.0	2259			500	251							
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)			Height of working plane	Total daily usage				
a	132	a	10	20	(10)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	11	20	(9)			
b	119	b	10	20	(10)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	11	20	(9)		
c	114	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	60	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	80	80	80	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	100	100	50	50	50	50	100	100	100	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	stage, trap room
note	Service hot water usage for lavatory is assumed.

Category	No.	Th-3	Building	Theatre building	Space/ZONE	Backstage of theatre
----------	-----	------	----------	------------------	------------	----------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
F		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		2761	25.0	29.0	0.2	0.0	5.0	0		0.0		2510		500	251							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi(%)	Set-back operation Temp.(deg) humi(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	132	a	9	20	(11)	Heating season	w1	22	40	-	-	a	-	-	(0)	a	10	20	(10)			
b	119	b	9	20	(11)	Cooling season	s1	26	50	-	-	b	-	-	(0)	[1/h]	b	10	20	(10)	[m]	[L/person-day]
c	114	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	0.8	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	60	60	60	60	60	60	60	60	60	60	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	60	100	100	100	100	100	100	60	60	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	60	60	60	100	100	100	100	100	100	60	60	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	anteroom, waiting room, rehearsal room, costume room, stage setting room
note	Service hot water usage for lavatory is assumed.

Category	No.	Th-4	Building	Theatre building	Space/ZONE	Lobby of theatre
----------	-----	------	----------	------------------	------------	------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting			Domestic hot water								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
F		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		2510	15.0	23.8	0.2	0.0	5.0	0			0.0	2259		300	251								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	132	a	10	20	(10)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	11	20	(9)			
b	119	b	10	20	(10)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	11	20	(9)	[m]	[L/person-day]
c	114	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)	60	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	80	80	80	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	100	100	50	50	50	50	100	100	100	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Hall, foyer, waiting room, booking office, shop
note	Service hot water usage for lavatory is assumed.

Category	No.	Th-5	Building	Theatre building	Space/ZONE	Lavatory of theatre
----------	-----	------	----------	------------------	------------	---------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days							
F		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]							
		2510	15.0	23.8	0.2	0.0	5.0	2259		40.5		2259		300	0							
Total number of days of each daily schedule (day)		Time of start & end of normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	132	a	10	20	(10)	Heating season	w1	22	40	-	-	a	11	20	(9)	a	11	20	(9)			
b	119	b	10	20	(10)	Cooling season	s1	26	50	-	-	b	11	20	(9)	[1/h]	b	11	20	(9)	[m]	-
c	114	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	15	c	-	-	(0)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	80	80	80	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday, Sunday, Holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	100	100	50	50	50	50	100	100	100	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Two weeks a month
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Th-6	Building	Theatre building	Space/ZONE	Smoking room of theatre
----------	-----	------	----------	------------------	------------	-------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
F		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		2510	15.0	23.8	0.2	0.0	5.0	2259		81.0		2259		300	0								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	132	a	10	20	(10)	Heating season		w1	22	40	-	-	a	11	20	(9)	a	11	20	(9)			
b	119	b	10	20	(10)	Cooling season		s1	26	50	-	-	b	11	20	(9)	[1/h]	b	11	20	(9)	[m]	-
c	114	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	30	c	-	-	(0)	30	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	80	80	40	40	40	40	40	80	80	80	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	100	100	50	50	50	50	50	100	100	100	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied						
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

Category	No.	Th-7	Building	Theatre building	Space/ZONE	Auditorium of movie theatre
----------	-----	------	----------	------------------	------------	-----------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]								
		5840	15.0	145.0	1.0	0.0	25.0	0		0.0		1095		300	365								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi(%)		Set-back operation Temp.(deg) humi(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a	241	a	8	24	(16)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	8	24	(3)	[m]	[L/person-day]	
b	51	b	8	24	(16)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	24	(3)	[m]	[L/person-day]
c	73	c	8	24	(16)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	8	24	(3)	0	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	0	0	0	0	0	0	0	0	0	0	0	0	0	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	60	60	60	60	40	40	40	40	40	60	60	60	60	30	30	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	0	0	0	0	0	0	0	0	0	0	0	0	0	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	70	70	70	70	70	100	100	100	100	50	50	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	0	0	0	0	0	0	0	0	0	0	0	0	0	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	70	70	70	70	70	100	100	100	100	50	50	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Audience seats, projection room, monitor room, adjustment room
note	Service hot water usage for lavatory is assumed.

Category	No.	Th-8	Building	Theatre building	Space/ZONE	Lobby of movie theatre
----------	-----	------	----------	------------------	------------	------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours		Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days							
A		[hours/yr.]		[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]							
		5840		15.0	11.9	0.1	0.0	2.5	0			0.0	5475		300	365							
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage				
a 241		a	8	24	(16)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	9	24	(15)	[m]	[L/person-day]	
b 51		b	8	24	(16)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	9	24	(15)	[m]	[L/person-day]
c 73		c	8	24	(16)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	9	24	(15)	60	3.8

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied							
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	60	60	60	60	40	40	40	40	40	40	60	60	60	60	30	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied							
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	70	70	70	70	70	100	100	100	100	50	50	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied							
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Sunday, Holidays, year-end and new-year holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	70	70	70	70	70	100	100	100	100	50	50	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Hall, foyer, waiting room, booking office
note	Service hot water usage for lavatory is assumed.

Category	No.	Th-9	Building	Theatre building	Space/ZONE	Lavatory of movie theatre
----------	-----	------	----------	------------------	------------	---------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water					
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement		Operation hours		maintained average illuminance	Total number of days						
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]		[hours/yr.]		[lux]	[day]						
		5840	15.0	23.8	0.2	0.0	5.0	5475		40.5		5475		300	0						
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage		
a	241	a	8	24	(16)	Heating season		w1	22	40	-	-	a	9	24	(15)	a	9	24	(15)	
b	51	b	8	24	(16)	Cooling season		s1	26	50	-	-	b	9	24	(15)	[1/h]	b	9	24	(15)
c	73	c	8	24	(16)	Intermediate season		m1	24	50	-	-	c	9	24	(15)	15	c	9	24	(15)
		0.0																			

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied					
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23		
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100		
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100		
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	60	60	60	60	40	40	40	40	40	60	60	60	60	30	30			
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
Week days																											

Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied					
time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23			
Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100			
Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100			
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	70	70	70	70	70	100	100	100	100	50	50			
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
Saturday																											
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied					
time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23			
Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100			
Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100			
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	70	70	70	70	70	100	100	100	100	50	50			
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
Sunday, Holidays, year-end and new-year holidays																											

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Th-10	Building	Theatre building	Space/ZONE	Smoking room of movie theatre
----------	-----	-------	----------	------------------	------------	-------------------------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		5840	15.0	23.8	0.2	0.0	5.0	5475			81.0	5475		300	0								
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage			
a	241	a	8	24	(16)	Heating season		w1	22	40	-	-	a	9	24	(15)		a	9	24	(15)		
b	51	b	8	24	(16)	Cooling season		s1	26	50	-	-	b	9	24	(15)	[1/h]	b	9	24	(15)	[m]	-
c	73	c	8	24	(16)	Intermediate season		m1	24	50	-	-	c	9	24	(15)	30	c	9	24	(15)	0	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	60	60	60	60	40	40	40	40	40	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Week day																			
Daily schedule b	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	70	70	70	70	70	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Saturday																			
Daily schedule c	Hourly ratio of int. heat gain due to lighting						Hourly ratio of int. heat gain due to occupants						Hourly ratio of heat gain due to appliances						Days to be applied
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	100	100	100	100	70	70	70	70	70	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Sunday, Holidays, year-end and new-year holidays																			

D.2.11 Religious building

Category	No.	Re-1	Building	Religious building	Space/ZONE	Main hall of religious building
----------	-----	------	----------	--------------------	------------	---------------------------------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting			Domestic hot water																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																								
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																									
F		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																									
		2761	10.0	145.0	1.0	0.0	25.0	0	0.0	2510	300	251																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																									
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp (deg) hum (%)		Set-back operation Temp (deg) hum (%)		Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																			
a	132	a	7	18	(11)	Heating season		w1	22	40	-	-	a	-	-	(0)	-	a	8	18	(10)	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19		20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0		0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0		0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	80	80	80	80	80	80	40	40	40	40	40	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19		20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0		0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0		0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	50	50	50	50	50	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19		20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	chantry, chapel
note	Service hot water usage for lavatory is assumed.

Category	No.	Re-2	Building	Religious building	Space/ZONE	Lobby
----------	-----	------	----------	--------------------	------------	-------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water							
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours		maintained average illuminance	Total number of days								
F		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]		[lux]	[day]								
		2761	15.0	23.8	0.2	0.0	5.0	0			0.0	2510		300	251								
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) hum.(%)	Set-back operation Temp.(deg) hum.(%)	Time of start & end (hours)				Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage					
a	132	a	7	18	(11)	Heating season		w1	22	40	-	-	a	-	-	(0)	a	8	18	(10)	[m]	[L/person-day]	
b	119	b	7	18	(11)	Cooling season		s1	26	50	-	-	b	-	-	(0)	[1/h]	b	8	18	(10)	0	3.8
c	114	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	-	c	-	-	(0)		

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	80	80	80	80	80	80	40	40	40	40	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday, Sunday, Holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	50	50	50	50	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Two weeks a month
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Hall, waiting room
note	Service hot water usage for lavatory is assumed.

Category	No.	Re-3	Building	Religious building	Space/ZONE	Lavatory
----------	-----	------	----------	--------------------	------------	----------

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water				
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days				
F		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]				
		2761	15.0	23.8	0.2	0.0	5.0	2510	40.5	2510	300	0				
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)		Set-point		Patterns	Normal operation Temp. [deg] hum. [%]	Set-back operation Temp. [deg] hum. [%]	Time of start & end [hours]		Ventilation requirement rate	Time of start & end (total hours)	Height of working plane	Total daily usage		
a	132	a	7	18	(11)	Heating season	w1	22	40	-	-	a	8	18	(10)	
b	119	b	7	18	(11)	Cooling season	s1	26	50	-	-	b	8	18	(10)	-
c	114	c	-	-	(0)	Intermediate season	m1	24	50	-	-	c	-	-	(0)	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Week days
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	80	80	80	80	80	80	40	40	40	40	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Saturday, Sunday, Holidays
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	50	50	50	50	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied				
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	Two weeks a month
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		

space/zone to be applied	Toilet (room), multi-purpose lavatory, washroom, rest room, W.C., powder room
note	Air change rate of 15 1/h is assumed.

Category	No.	Re-4	Building	Religious building	Space/ZONE	Smoking room
----------	-----	------	----------	--------------------	------------	--------------

General		Space heating & cooling						Ventilation for unconditioned space				Lighting				Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours			Ventilation requirement	Operation hours			maintained average illuminance	Total number of days						
F		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]			[m3/h·m2]	[hours/yr.]			[lux]	[day]						
		2761	15.0	23.8	0.2	0.0	5.0	2510			81.0	2510			300	0						
Total number of days of each daily schedule [day]		Time of start & end for normal operation (hours)				Set-point		Patterns	Normal operation Temp.(deg) humi.(%)		Set-back operation Temp.(deg) humi.(%)		Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage		
a	132	a	7	18	(11)	Heating season		w1	22	40	-	-	a	8	18	(10)	a	8	18	(10)		
b	119	b	7	18	(11)	Cooling season		s1	26	50	-	-	b	8	18	(10)	[1/h]	b	8	18	(10)	-
c	114	c	-	-	(0)	Intermediate season		m1	24	50	-	-	c	-	-	(0)	30	c	-	-	(0)	0.0

Daily schedule a	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	80	80	80	80	80	40	40	40	40	40	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule b	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	100	100	100	100	100	100	100	100	100	100	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	100	100	100	100	100	100	50	50	50	50	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily schedule c	Hourly ratio of int. heat gain due to lighting							Hourly ratio of int. heat gain due to occupants							Hourly ratio of heat gain due to appliances							Days to be applied			
	time	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23
	Simultaneous usage ratio	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Int. heat gain due to lighting	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Int. heat gain due to occupants	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Int. heat gain due to appliances	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

space/zone to be applied	Smoking corner
note	Air change rate of 30 1/h is assumed.

D.2.12 Attached space or zone for assembly buildings

Category	No.	At_As-1	Building	<i>Attached space or zone for assembly buildings</i>				Space/ZONE	<i>Kitchen</i>		
-----------------	------------	----------------	-----------------	--	--	--	--	-------------------	----------------	--	--

General		Space heating & cooling						Ventilation for unconditioned space		Lighting		Domestic hot water						
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours	Ventilation requirement	Operation hours	maintained average illuminance	Total number of days						
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]	[m3/h·m2]	[hours/yr.]	[lux]	[day]						
		0	-	-	-	-	-	4000	135.0	4000	750	0						
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point		Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)		Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage		
a	241	a	-	-	(0)	Heating season		0	-	-	-	-	a	-	-	(0)	[m]	-
b	51	b	-	-	(0)	Cooling season		0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season		0	-	-	-	-	c	-	-	(0)	0.8	0.0

space/zone to be applied	<i>caboose, inspection and receiving room, syringing room, pantry, service room</i>											
note	<i>Air change rate of 50 1/h is assumed.</i>											

Category	No.	At_As-2	Building	<i>Attached space or zone for assembly buildings</i>				Space/ZONE	<i>Indoor parking garage</i>		
-----------------	------------	----------------	-----------------	--	--	--	--	-------------------	------------------------------	--	--

General		Space heating & cooling						Ventilation for unconditioned space			Lighting			Domestic hot water			
Annual schedule		Operation hours	Ref. heat gain Lighting	Ref. int. heat gain Occupants	Ref. occupancy density	Ref. heat gain Appliances	Ventilation requirement	Operation hours		Ventilation requirement	Operation hours		maintained average illuminance	Total number of days			
A		[hours/yr.]	[W/m2]	[W/m2]	[Person/m2]	[W/m2]	[m3/h·m2]	[hours/yr.]		[m3/h·m2]	[hours/yr.]		[lux]	[day]			
		0	-	-	-	-	-	4000		30.0	4000		150	0			
Total number of days of each daily schedule (day)		Time of start & end for normal operation (hours)			Set-point	Patterns	Normal operation Temp.(deg) humi.(%)	Set-back operation Temp.(deg) humi.(%)	Time of start & end (hours)			Ventilation requirement rate	Time of start & end (total hours)		Height of working plane	Total daily usage	
a	241	a	-	-	(0)	Heating season	0	-	-	-	-	a	-	-	(0)	[m]	-
b	51	b	-	-	(0)	Cooling season	0	-	-	-	-	b	-	-	(0)	[m]	-
c	73	c	-	-	(0)	Intermediate season	0	-	-	-	-	c	-	-	(0)	0	0.0

space/zone to be applied	<i>Parking, carriage porch, car barn</i>											
note	<i>Air change rate of 10 1/h is assumed.</i>											