
Testing of concrete —
Part 3:
Making and curing test specimens

Essais du béton —

Partie 3: Confection et prise des éprouvettes

STANDARDSISO.COM : Click to view the full PDF of ISO 1920-3:2019



STANDARDSISO.COM : Click to view the full PDF of ISO 1920-3:2019



COPYRIGHT PROTECTED DOCUMENT

© ISO 2019

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	iv
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Shape, dimensions and tolerances of specimens and moulds	2
4.1 General	2
4.2 Cubes	2
4.2.1 Nominal sizes	2
4.2.2 Designated sizes	2
4.2.3 Tolerances	2
4.3 Cylinders	3
4.3.1 Nominal sizes	3
4.3.2 Designated sizes	3
4.3.3 Tolerances	3
4.4 Prisms	4
4.4.1 Nominal sizes	4
4.4.2 Designated sizes	4
4.4.3 Tolerances	4
5 Apparatus	4
5.1 Apparatus for measuring the test specimens	4
5.2 Apparatus for making test specimens	5
6 Preparation of test specimens	6
6.1 Sampling	6
6.2 Preparation and filling of the mould	6
6.3 Compaction of the concrete	6
6.4 Surface levelling	6
6.5 Marking	6
6.6 Capping specimens	7
7 Curing of test specimens	7
8 Measurement of dimensions and shape	7
8.1 Specimens made in calibrated moulds	7
8.2 Specimens made in uncalibrated moulds	7
9 Report	7
Annex A (informative) Wet-sieving of concrete	9
Annex B (informative) Application of ISO 1101 to concrete test specimens and moulds	11
Annex C (normative) Lightweight cylindrical moulds	13
Annex D (normative) Methods of compaction	19
Annex E (informative) Example of specimen preparation test report	20
Bibliography	21

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 71, *Concrete, reinforced concrete and prestressed concrete*, Subcommittee SC 1, *Test methods for concrete*.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

This second edition cancels and replaces the first edition (ISO 1920-3:2004), which has been technically revised.

The main changes compared to the previous edition are as follows:

- tolerances of specimens and moulds have been redefined;
- the concept of preparation and filling has been redrafted;
- preferred methods of compaction on the basis of slump value have been included and defined;
- the capping of cylindrical specimens for compressive strength has been included and defined;
- the curing of test specimens under hot climate has been defined.

A list of all parts in the ISO 1920 series can be found on the ISO website.

Testing of concrete —

Part 3: Making and curing test specimens

WARNING — Some concrete specimens can be too heavy for one person to carry and it is necessary that appropriate means be arranged to carry them. The use of vibrating equipment, such as vibration tables, can cause damage to joints and loss of sensation due to nerve damage. It is necessary that moulds, density containers, etc., be clamped to the table and not held in position using one's hands while they are being vibrated.

1 Scope

This document specifies the shape and dimensions of concrete test specimens for strength tests and the methods of making and curing these test specimens.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 1920-1, *Testing of concrete — Part 1: Sampling of fresh concrete*

ISO 1101, *Geometrical product specifications (GPS) — Geometrical tolerancing — Tolerances of form, orientation, location and run-out*

3 Terms and definitions

For the purpose of this document, the terms and definitions given in ISO 1101 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

— ISO Online browsing platform: available at <https://www.iso.org/obp>

— IEC Electropedia: available at <http://www.electropedia.org/>

3.1

nominal size

<specimen> range of commonly used specimen sizes among which a preferred size is specified in this document

3.2

designated size

<specimen> specimen size selected and declared by the user of this document from among the permitted range of *nominal sizes* (3.1)

Note 1 to entry: The size of specimens is expressed in millimetres.

4 Shape, dimensions and tolerances of specimens and moulds

4.1 General

For each shape of test specimen, e.g. cube, cylinder, and prism, the basic dimensions, l or d (Figures 1, 2 and 3), should be chosen to be at least four times the maximum size of the aggregate in the concrete.

NOTE A procedure for wet screening as described in Annex A can be used when the maximum size of the aggregate is larger than $\frac{1}{4}$ of the basic dimension, l or d .

4.2 Cubes

4.2.1 Nominal sizes

The nominal sizes are as shown in Figure 1, where l is 100 mm, 120 mm, 150 mm, 200 mm, 250 mm, 225 mm or 300 mm.

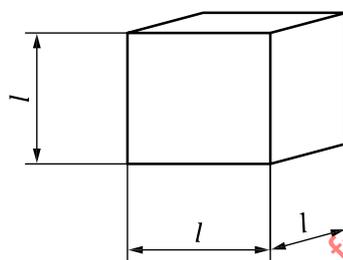


Figure 1 — Nominal sizes of a cube

The preferred sizes are 100 mm and 150 mm.

4.2.2 Designated sizes

The designated size shall be selected from one of the nominal sizes given in 4.2.1.

4.2.3 Tolerances

The following tolerances apply.

- a) The tolerance on the designated size shall be $\pm 0,5\%$;
- b) The tolerance on the flatness of the load-bearing surfaces shall be:
 - i) for new moulds: 0,03 mm;
 - ii) for moulds in use: 0,05 mm;
- c) The load-bearing surfaces shall be parallel to a tolerance of not greater than 0,5 mm;
- d) The tolerance on the perpendicularity of the sides of the cube with reference to the base shall be $\pm 0,5$ mm.

For the definitions of flatness, parallelism, perpendicularity and straightness, see Annex B.

4.3 Cylinders

4.3.1 Nominal sizes

The nominal sizes are as shown in [Figure 2](#), where the diameter, d , equal 100 mm, 113 mm, 125 mm, 150 mm, 200 mm, 250 mm or 300 mm.

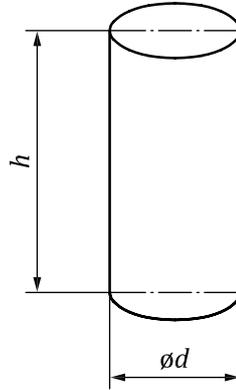


Figure 2 — Nominal sizes of a cylinder

NOTE The diameter of 113 mm corresponds to a load-bearing area of 10 000 mm².

The preferred sizes are 100 mm × 200 mm, 125 mm × 250 mm and 150 mm × 300 mm.

The height, h , of the cylinder shall be $2d$ except for specimens used for the tensile splitting test. In the latter case, the height of the specimen shall be between d and $2d$.

4.3.2 Designated sizes

Designated sizes may be selected within $\pm 10\%$ of a nominal size.

4.3.3 Tolerances

The following tolerances apply:

- the tolerance on the designated diameter, d , shall be $\pm 0,5\%$;
- the tolerance on the flatness of the load-bearing surfaces shall be $\pm 0,000\ 5\ d$, expressed in millimetres, except for cylinders tested by unbonded capping methods;
- the tolerance on the flatness of the load-bearing surfaces of cylinders tested by unbonded capping methods, such as sand box or elastomeric pads, shall be $\pm 0,02\ d$, expressed in millimetres;
- the load-bearing surfaces shall be parallel to a tolerance of not greater than 0,5 millimetres;
- the tolerance on the perpendicularity of the sides of the cylinder with reference to the end faces shall be $\pm 0,5\text{ mm}$;
- the tolerance on the height, h , of the cylinders shall be $\pm 0,5\%$;
- the straightness tolerance on any surface parallel to the centre line of the cylinders to be used in compression tests shall be $\pm 0,5\text{ mm}$;
- the straightness tolerance of any surface parallel to the centre line of the cylinders to be used in tensile splitting tests shall be $\pm 0,2\text{ mm}$.

4.4 Prisms

4.4.1 Nominal sizes

The nominal sizes are as shown in [Figure 3](#), where l equal 100 mm, 150 mm, 200 mm, 250 mm or 300 mm, and length, L , is $L \geq 3,5 l$.

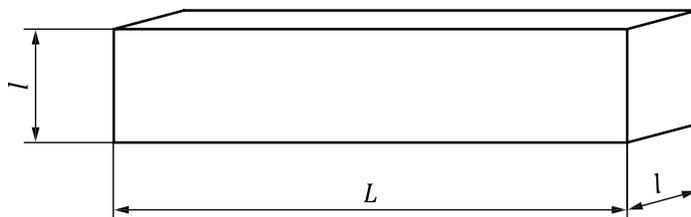


Figure 3 — Nominal sizes of prisms

The preferred sizes are:

- $l = 100$ mm and $L = 400$ mm; or
- $l = 150$ mm and $L = 600$ mm.

4.4.2 Designated sizes

The designated size, l , of prisms shall be selected from one of the nominal sizes given in [4.4.1](#).

The designated length, L , of prisms shall be not less than $3,5 l$.

4.4.3 Tolerances

The following tolerances apply:

- a) the tolerance on the designated size l , shall be $\pm 0,5$ %;
- b) the tolerance on the designated length, l , shall be $\pm 0,5$ %;
- c) the load-bearing surfaces shall be parallel to a tolerance not greater than 0,5 mm;
- d) the tolerance on the perpendicularity of the sides of the prism with reference to the base shall be $\pm 0,5$ mm;
- e) the tolerance on the straightness of the load-bearing area for specimens to be used for bending (flexural) tests shall be $\pm 0,2$ mm.

5 Apparatus

5.1 Apparatus for measuring the test specimens.

5.1.1 Callipers and/or rules, capable of establishing that the relevant dimensions of specimens or moulds are within $\pm 0,5$ % of the dimension.

5.1.2 Gauge, capable of establishing that the relevant flatness of specimens or moulds is within $\pm 0,000 5 l$ or d .

5.1.3 Squares and gauges (or other similar means), capable of establishing the perpendicularity and parallelism of specimens and moulds within $\pm 0,5$ mm.

5.2 Apparatus for making test specimens

5.2.1 Moulds, capable of providing test specimens with the dimensions and tolerances that conform to this document.

The moulds shall be made of steel or cast-iron, which shall be the reference materials. If moulds are manufactured from other materials, performance test data shall be available that demonstrate equivalence with the steel or cast-iron moulds. Lightweight cylindrical moulds shall conform to the requirements in [Annex C](#).

Moulds shall be watertight and shall be non-absorbent.

Moulds shall be checked at intervals of not more than 1 year. If the mould is in calibration at time of use, the checking of parallelism, verticality and flatness of specimens is not required, provided the size measurements are within tolerance.

Individual moulds shall be identifiable. The designation should be an identification number either welded on the mould body or securely tagged to the moulds.

5.2.2 Filling frame, fitted tightly to the mould and used to simplify the filling of the moulds.

The use of a filling frame is optional, but if used, this shall be stated in the test report (see [Clause 9](#)).

5.2.3 Means of compacting the concrete in the mould, which shall be one of the following:

5.2.3.1 Internal vibrator, with a minimum frequency of 120 Hz (7 200 cycles per minutes). The diameter of the tube shall not exceed one-quarter of the smallest dimension of the test specimen;

5.2.3.2 Vibrating table, with a minimum frequency of 40 Hz (2 400 cycles per minute);

5.2.3.3 Compacting rod, of circular cross-section, straight, made of steel, having a diameter of 16 mm \pm 1 mm and a length of 600 mm \pm 5 mm, and with rounded, roughly hemispherical, ends;

5.2.3.4 Compacting bar, 380 mm long steel bar, weighs 1,8 kg and has a square end of 25 mm \times 25 mm or circular cross-section of 25 mm diameter for ramming.

5.2.4 General tools, including the following:

5.2.4.1 Scoop, approximately 100 mm wide;

5.2.4.2 Steel floats, two;

5.2.4.3 Sampling tray, with minimum dimensions of 900 mm \times 900 mm \times 50 mm deep, of rigid construction and made from a non-absorbent material not readily attacked by cement paste;

5.2.4.4 Shovel, square-bladed;

5.2.4.5 Release material, non-reactive;

5.2.4.6 Mallet;

5.2.4.7 Timer, having an accuracy of \pm 1 s.

6 Preparation of test specimens

6.1 Sampling

The samples shall be taken in accordance with ISO 1920-1.

The samples shall be remixed before filling the mould. Concrete mixed in a laboratory need not be remixed.

6.2 Preparation and filling of the mould

Before filling, cover the inner surface of the mould with a thin film of mineral oil or any other material to prevent the concrete from adhering to the mould.

Place the mould on a firm and level area.

If a filling frame is used, the amount of concrete used to fill the mould shall be such that a layer of concrete remains in the filling frame after compaction. The thickness of this layer shall be 10 % to 20 % of the height of the test specimen.

Place the concrete in the mould by means of a scoop, in such a way as to remove as much entrapped air as possible (without significantly reducing the amount of entrained air, if present). The concrete shall be placed in layers of approximately equal depth and not more than 50 mm thick each. The thickness of the layers may be increased proportionally if the minimum size of the specimen exceeds 150 mm.

Use the quantity of material in the final layer that, as nearly as possible, is just sufficient to fill the container without having to remove excess material. A small quantity of additional concrete may be added if necessary and further compacted in order to just fill the container, but the removal of excess material should be avoided.

6.3 Compaction of the concrete

Compact the concrete immediately after each layer is placed in the moulds in such a way as to produce full compaction of the concrete with neither excessive segregation nor laitance. Compact each layer by using one of the methods described in [Annex D](#). The preferred method of compaction may be selected from the guidance given in [Table 1](#).

Table 1 — Methods of compaction

SL. No.	Slump	Preferred methods of compaction
1	Less than 50 mm	Vibrating table or internal vibrator
2	50 mm to 100 mm	Vibrating table or internal vibrator or tamping bar/tamping rod
3	More than 100 mm	Tamping bar/tamping rod

NOTE These methods of compaction are not applicable in case of fibre reinforced concrete and self-compacting concrete.

6.4 Surface levelling

If a filling frame is used, remove it immediately after compaction.

Remove the concrete above the upper edge of the mould using the two steel floats brought together with a sawing action or with a sawing action using a straight edge and level the surface carefully.

6.5 Marking

Identify the test specimens with a clear and durable marking, and without damaging the specimen.

Keep records to ensure that the specimen identity is known from sampling to testing.

6.6 Capping specimens

For capping of cylindrical specimens, refer to ISO 1920-4.

7 Curing of test specimens

Leave the test specimens in the mould for at least 16 h, but not longer than three days from the time of addition of water to the dry ingredients. Protect the specimens against shock, vibration and water evaporation. Store the specimens at a temperature of $20\text{ °C} \pm 5\text{ °C}$ (or $27\text{ °C} \pm 3\text{ °C}$, in case of tropical environment).

After removal from the mould, store the test specimens in water at a temperature of $20\text{ °C} \pm 2\text{ °C}$ or in a chamber at $20\text{ °C} \pm 2\text{ °C}$ ($27\text{ °C} \pm 3\text{ °C}$ in case of tropical environment) and a relative humidity of at least 95 % until just before testing.

Loss of moisture and deviations from the required curing temperature shall be avoided at all stages of transport. The test specimens should, therefore, be packed, for example, in wet sand or wet sawdust or wet cloths, or sealed in plastic bags containing water.

NOTE Maintenance and measurement of high humidity $\geq 95\%$ at $(20 \pm 2)\text{ °C}$ or at $27\text{ °C} \pm 3\text{ °C}$ (in case of tropical environment) is not simple. Regular checks can be made that surfaces of specimens in the chamber are continuously wet.

8 Measurement of dimensions and shape

8.1 Specimens made in calibrated moulds

If specimens have documentation to show that they were made in calibrated moulds, it is unnecessary to verify by measurement their conformity to the requirements for tolerances for flatness, perpendicularity, parallelism and straightness.

Specimens shall be checked to establish that each dimension is within 0,5 % of the designated size.

8.2 Specimens made in uncalibrated moulds

If specimens are not made in calibrated moulds, or there is no documentation to verify that they were made in calibrated moulds, the specimens shall be checked for conformity to the relevant requirements of [Clause 4](#). The following shall be checked:

- a) each dimension of the specimen;
- b) the flatness of all the potential load-bearing surfaces;
- c) the parallelism of all the potential load-bearing surfaces;
- d) the perpendicularity of the sides;
- e) the straightness of any surface parallel to the centre line of the cylinder.

9 Report

9.1 The report shall include the following with regards to making the specimens:

- a) identification of the test sample;
- b) reason for making the specimens (e.g. compression testing), when known;
- c) time of making the specimen(s);

- d) temperature of the remixed concrete (optional);
- e) density of the concrete (optional);
- f) time passing between sampling and making the test specimens;
- g) method of compaction of the concrete in the mould(s);
- h) depending on the method of compaction, either the duration of compaction or the number of tamps;
- i) use of a filling frame (if appropriate);
- j) any deviation from the standard method of making specimen(s) (if appropriate).

9.2 The report shall include the following with regards to curing the specimens:

- a) method of curing specimens prior to demoulding, including duration, curing conditions and temperature range;
- b) condition of specimens at receipt for storage (if appropriate);
- c) method of storing specimens after demoulding including transportation conditions (if appropriate), temperature range and duration of curing;
- d) any deviation from the standard method of making the specimen(s).

9.3 The report shall include a declaration by the person technically responsible that the samples were prepared in accordance with this document, except as noted in [9.1 j](#)) or [9.2 d](#)) (see example test report in [Annex E](#)).

STANDARDSISO.COM : Click to view the full PDF of ISO 1920-3:2019

Annex A (informative)

Wet-sieving of concrete

A.1 General

Wet-sieving of concrete is the process of removing aggregate particles larger than a designated size from the fresh concrete by sieving on a sieve of the designated size.

This procedure is used when the nominal maximum size of the coarse aggregate in the concrete is larger than $\frac{1}{4}$ of the basic dimension, l or d , of the test specimen, cube, cylinder and prism.

The effects of wet-sieving on the test results should be considered or determined by supplementary testing for quality control or test result evaluation purposes.

EXAMPLE Wet-sieving concrete causes the loss of a small amount of air due to additional handling. The air content of the wet-sieved fraction of concrete is greater than that of the total concrete because the larger size aggregate, which is removed, does not contain air. The apparent strength of wet-sieved concrete in smaller specimens is usually greater than that of the total concrete in larger appropriate size specimens.

A.2 Apparatus

A.2.1 Sieves.

A.2.2 Wet-sieving equipment, containing a sieve of the designated size conforming to the applicable specification and conveniently arranged and supported so that one can shake it rapidly by either hand or mechanical means.

Generally, a horizontal back-and-forth motion is preferred. The equipment shall be capable of rapidly and effectively removing particles larger than the designated size of aggregate.

A.2.3 Hand tools, including the following:

A.2.3.1 Shovels;

A.2.3.2 Hand scoops;

A.2.3.3 Steel trowels;

A.2.3.4 Rubber gloves.

A.3 Procedure

After sampling the concrete and before remixing, sieve the concrete through a sieve of the designated size. Place only enough concrete on the sieve at any one time so that after sieving, the thickness of the layer of retained aggregate is not more than one particle thick. Shake or vibrate the sieve by hand or mechanical means until no undersize material remains on the sieve. Do not wipe off the mortar adhering to the aggregate retained on the sieve before it is discarded. Collect the concrete that passes through the sieve in a batch pan of suitable size that has been dampened before use, or on a clean, moist, non-absorbent surface. Scrape any mortar adhering to the sides of the wet-sieving equipment into the batch.

Discard the aggregate particles retained on the sieve. Remix the concrete that has passed through the sieve with a shovel the minimum amount necessary to ensure uniformity and proceed immediately with testing.

STANDARDSISO.COM : Click to view the full PDF of ISO 1920-3:2019


Annex B (informative)

Application of ISO 1101 to concrete test specimens and moulds

B.1 General

ISO 1101 describes the geometric tolerancing. [Figures B.1](#) to [B.4](#) show particular applications of ISO 1101 to the measurement of concrete test specimens and moulds.

B.2 Flatness

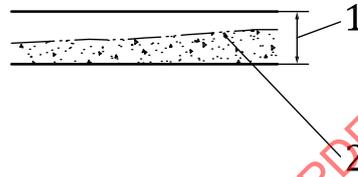


Key

- 1 flatness tolerance
- 2 surface to which flatness tolerance applies

Figure B.1 — Measurement of flatness

B.3 Parallelism

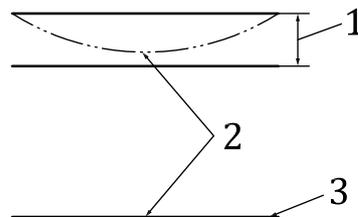


Key

- 1 perpendicular tolerance
- 2 surfaces to which the perpendicularity tolerance applies
- 3 bottom surface as datum surface

Figure B.2 — Measurement of parallelism

B.4 Perpendicularity

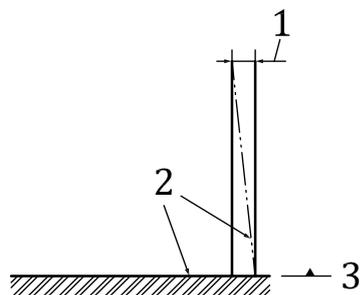


Key

- 1 perpendicular tolerance
- 2 surfaces to which the perpendicularity tolerance applies
- 3 adjacent surface as datum surface

Figure B.3 — Measurement of perpendicularity

B.5 Straightness

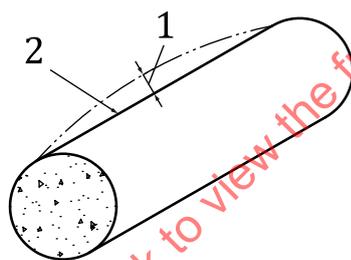

Key

- 1 straightness tolerance on the load-bearing surface
- 2 surface to which the straightness tolerance applies

Figure B.4 — Measurement of straightness

Annex C (normative)

Lightweight cylindrical moulds

C.1 General

This annex covers lightweight cylindrical moulds, both reusable and single-use for use in forming concrete specimens for strength tests (hereinafter referred to as moulds).

C.2 Dimensions, materials, quality and forming capability

C.2.1 Dimensions

Moulds shall be constructed in the form of cylinders with the top open to receive the concrete. They shall consist of a side-wall and bottom plate and conform to the requirements of [Table C.1](#).

C.2.2 Materials

Moulds shall be made of tin plate, plastic or other materials that do not react chemically with Portland cement or other hydraulic cements contained in concrete.

Moulds shall not corrode, deteriorate or be deformed while in use or in storage.

Moulds shall be coated, if necessary, to prevent adherence to concrete at the time of demoulding.

C.2.3 Quality

Moulds shall be watertight and shall not deform while forming concrete specimens. They shall conform to the requirements of [Table C.1](#) when tested in accordance with [C.3](#).

Reusable moulds shall be capable of retaining the qualities specified in [Table C.1](#) when used repeatedly.

Table C.1 — Dimensions and quality requirements for moulds

Item	Requirements	
Dimensions and tolerances on dimensions and shape	In accordance with 4.3	
Leakage	No visual leakage 1 h after filling with water and 1 h after filling with concrete	
Absorption and elongation ^a	Absorption:	100 mm diameter by 200 mm long: ≤1,0 g 125 mm diameter by 250 mm long: ≤1,6 g 150 mm diameter by 300 mm long: ≤2,3 g
	elongation:	≤0,20 %
^a These requirements shall apply only to paper moulds.		

C.2.4 Forming capability

Moulds shall be capable of forming cylindrical concrete specimens using the procedures given in [Clause 6](#). In the case where moulds can be deformed by tapping directly with a mallet, maintain the mould in a holder and tap the side-wall of the holder. The holder may be of steel or plastic, accommodating one to three moulds. The holder shall be sufficiently stiff so that the moulds do not deform when the holder is tapped on the side-wall with a mallet during concrete placing.

When demoulding, moulds shall allow the specimens to be removed easily without any damage.

C.3 Tests

C.3.1 Dimensions

Measure, with callipers, the inside diameters at right angles to each other and inside heights opposite to each other of three randomly selected moulds. Calculate the averages of the two measurements as the inside diameter and inside height of each mould. The maximum (or minimum) difference between the nominal and measured values shall be taken as the dimensional variance.

C.3.2 Leakage

During the absorptivity and elongation tests described in [C.3.4](#), examine for visual leakage from the moulds 1 h after the beginning of the tests.

During forming concrete specimens in accordance with [C.3.3.1](#), examine for visual leakage from the moulds 1 h after the placement.

C.3.3 Flatness of bottom plate and perpendicularity of side wall

C.3.3.1 Concrete specimens

Three concrete specimens shall be formed using randomly selected lightweight moulds, and the flatness and perpendicularity of the specimens shall be measured.

C.3.3.2 Flatness

Two lines both passing the centre of the bottom of a specimen and at right angles to each other shall be taken as traverse lines, and the flatness shall be measured with regard to both ends and the centres of the lines. Measure the distances between each measuring point with a dial gauge (which shall be graduated to 0,001 mm), determine the departure of the centre point from the straight line between both ends of each traverse line, and calculate their average as the flatness of each specimen (see [Figure C.1](#)). The maximum value of three specimens shall be taken as the flatness of the mould.

C.3.3.3 Perpendicularity

The perpendicularity shall be measured as follows: Place a dial gauge stand on a horizontal base and fix the dial gauge at a position corresponding to the height, h , of a specimen. Calculate the difference between the dial gauge reading when a square is placed and when a specimen is placed at the same position (see [Figure C.2](#)).

Measurements shall be made in two directions at right angles to each other, and their average shall be taken as the perpendicularity of the specimen. The maximum value of three specimens shall be taken as the perpendicularity of the mould.

C.3.4 Absorption and elongation

The tests shall be conducted on three randomly selected moulds.

Measure the mass, m_0 , of a mould before testing in a thermostatic chamber at 20 °C (27 °C in case of tropical environment) using a balance capable of measuring to an accuracy of 0,1 g. Place the mould on a flat surface and fill with water at 20 °C (27 °C in case of tropical environment) to a depth of approximately 95 % of the nominal mould height. Immediately cover the mould with a glass plate, place on the dial stand and set the dial gauge so that the axial elongation can be measured on the mould axis at the top of the glass plate. Record the dial gauge reading immediately after filling with water, h_0 (see [Figure C.3](#)).

Allow the mould to stand for 3 h and record the reading of the dial gauge again, h_1 . Empty water from the mould, wipe quickly with a dry towel and record the mass, m_1 , of the mould after testing. Calculate the absorption, A , in accordance with [Formula \(C.1\)](#) to the nearest 0,1 g and the elongation, E , in accordance with [Formula \(C.2\)](#) to the nearest 0,1 %.

$$A = m_1 - m_0 \quad (\text{C.1})$$

where

m_0 is the mass of mould before testing, expressed in grams;

m_1 is the mass of mould after testing, expressed in grams.

$$E = \frac{h_1 - h_0}{h} \times 100 \quad (\text{C.2})$$

where

h is the nominal height, expressed in millimetres, of the mould;


h_0 is the dial gauge reading, expressed in millimetres, immediately after filling with water;

h_1 is the dial gauge reading, expressed in millimetres, 3 h after filling with water.

C.4 Labeling

The following shall be labelled on the container or invoice:

- a) designation (brand);
- b) product dimensions;
- c) amount;
- d) date produced;
- e) name of manufacturer;
- f) production number;
- g) maximum number of reuses;
- h) cautions.

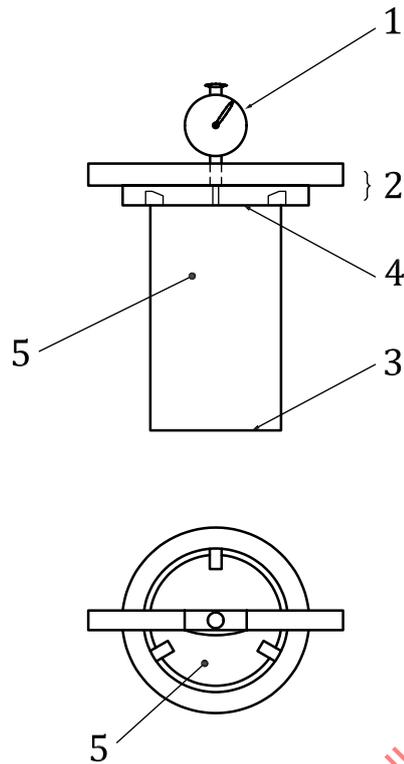

Key

- 1 dial gauge, graduated to 0,001 mm
- 2 device for measuring flatness
- 3 top surface (placing surface)
- 4 bottom
- 5 specimen

Figure C.1 — Device for measuring bottom flatness of specimens

STANDARDSISO.COM: Click to view the full PDF of ISO 1920-3:2019