

INTERNATIONAL
STANDARD

ISO
19372

First edition
2015-02-15

Microturbines applications — Safety

Microturbines — Sécurité

STANDARDSISO.COM : Click to view the full PDF of ISO 19372:2015



Reference number
ISO 19372:2015(E)

© ISO 2015

STANDARDSISO.COM : Click to view the full PDF of ISO 19372:2015



COPYRIGHT PROTECTED DOCUMENT

© ISO 2015

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

	Page
Foreword	viii
Introduction	ix
1 Scope	1
2 Normative references	1
3 Terms and definitions	4
4 List of significant hazards	6
5 Safety requirements	6
5.1 General	6
5.2 Risk assessment	6
5.3 Modifications and replacement parts	7
5.4 Foreseeable misuse	7
5.5 Lifetime	8
5.6 Hazard combinations	8
5.7 Noise	8
5.8 Mechanical	8
5.8.1 Guarding	8
5.8.2 Accessibility for maintenance	9
5.8.3 Casing design	9
5.8.4 Microturbine compressor surge	9
5.8.5 Stability and handling	9
5.8.6 Overload of rotating shafts due to torque	10
5.8.7 Vibration	10
5.8.8 Mechanical failure caused by corrosion	10
5.8.9 Design methods and materials	10
5.8.10 Microturbine temperatures	11
5.8.11 Environmental loads	11
5.8.12 Assembly features	11
5.8.13 Couplings	11
5.8.14 Rotor bearings	11
5.8.15 Rotating part failure	12
5.8.16 Foreign object damage (FOD) screen	12
5.8.17 Gearbox	12
5.8.18 Starting systems	13
5.8.19 Storage and operating ambient temperature conditions	14
5.9 Microturbine air inlet system	14
5.9.1 General	14
5.9.2 Inlet air contamination	14
5.9.3 Icing monitoring and prevention	14
5.9.4 Implosion protection	15
5.9.5 Inlet explosion protection	15
5.9.6 Waste disposal through combustion	15
5.9.7 Recirculation	16
5.9.8 Microturbine compressor air inlet ducting	16

5.10	Fuel systems	16
5.10.1	General	16
5.10.2	Fuel supply quality and supply conditions	17
5.10.3	Pressure testing	17
5.10.4	Fuel supply heating	18
5.10.5	Gas fuel systems	18
5.10.6	Liquid fuel systems	23
5.10.7	Multi-fuel systems	26
5.10.8	Fuel purging	26
5.10.9	Fuel drainage	27
5.11	Combustion supervision	27
5.11.1	General	27
5.11.2	Requirements for ignition	27
5.11.3	Extinction safety time	28
5.11.4	System status indication	28
5.12	Exhaust system	28
5.12.1	Damper controls	28
5.12.2	Flexible joint location	28
5.12.3	Exhaust stack	28
5.12.4	Explosion protection	29
5.13	Enclosures	29
5.13.1	General	29
5.13.2	Enclosure structure	30
5.13.3	Enclosure fire precautions	30
5.13.4	Explosion prevention and protection — Area classification — Ventilation	31
5.13.5	Gas detection	31
5.13.6	Enclosure purging	31
5.13.7	Mist detection	32
5.13.8	Access and doors	32
5.13.9	Entrapment	33
5.14	Lighting	33
5.15	Fire precautions	33
5.15.1	General	33
5.15.2	Structural fire risk reduction	33
5.15.3	Hydrocarbon fire risk reduction	34
5.15.4	Fire protection	34
5.15.5	Fire detection	34
5.15.6	Fire extinguishing systems	35
5.15.7	Water mist extinguishant	36
5.15.8	Extinguishing system controls	36
5.15.9	Escape	38
5.15.10	Uncontrolled release of media and loss of propellant pressure	38
5.15.11	Vessel thermal relief (burst disc)	38
5.15.12	Vessel and/or pipe failure	38
5.15.13	Release of extinguishant into microturbine mechanical rooms, control rooms, etc.	38
5.16	Hazardous area classification and explosion prevention and protection	39
5.16.1	General	39
5.16.2	Area classification	39
5.16.3	Explosion prevention	39
5.16.4	Ignition source control	40
5.16.5	Reduction of explosion effects in an enclosed space	40

5.17	Ventilation.....	42
5.17.1	General.....	42
5.17.2	Cooling.....	42
5.17.3	Heating.....	43
5.17.4	Hazardous area control.....	43
5.17.5	Hot surfaces.....	43
5.17.6	Ventilation inlet location.....	43
5.17.7	Ventilation inlet filtration.....	44
5.17.8	Ventilation inlet ducting.....	44
5.17.9	Ventilation outlet location.....	44
5.17.10	Flow monitoring — Artificial ventilation.....	44
5.18	Fans.....	44
5.18.1	Fan guards and structural failure.....	44
5.18.2	Air blast oil coolers.....	45
5.19	Flammable gas detection.....	45
5.19.1	General.....	45
5.19.2	Type/selection principles.....	45
5.19.3	Location principles.....	45
5.19.4	Settings.....	45
5.19.5	Enclosures containing hot surfaces — Screening tool.....	45
5.19.6	Maintenance and calibration.....	46
5.20	Control and automatic protection systems.....	46
5.20.1	General.....	46
5.20.2	Environmental suitability.....	46
5.20.3	Ergonomics.....	46
5.20.4	Failure.....	47
5.20.5	Calibration.....	47
5.20.6	Testing.....	47
5.20.7	Speed control.....	47
5.20.8	Microturbine emergency shut-down system.....	48
5.20.9	Interlocks.....	48
5.21	Electrical.....	48
5.21.1	Design/Installation.....	48
5.21.2	Isolation and stored energy.....	49
5.21.3	Electrostatic energy and bonding.....	49
5.21.4	Water ingress.....	50
5.21.5	Lightning.....	50
5.21.6	Electromagnetic compatibility (EMC).....	50
5.21.7	Battery installations.....	51
5.21.8	Electrical overload.....	51
5.21.9	Electrical power failure.....	51
5.22	Drains, vents, and bleeds.....	51
5.22.1	General.....	51
5.22.2	Vents for flammable gases.....	52
5.22.3	Toxic and hazardous emissions.....	52
5.22.4	Microturbine compressor bleeds.....	52

5.23	Pressure equipment.....	52
5.23.1	General.....	52
5.23.2	Design.....	53
5.23.3	Hazards.....	53
5.23.4	Misuse.....	53
5.23.5	Safe handling and operation.....	53
5.23.6	Isolation, draining, and venting.....	53
5.23.7	Fluid injection.....	54
5.23.8	Assemblies.....	54
5.23.9	Safety accessories.....	56
5.23.10	Flexible piping (and metal hoses).....	56
5.23.11	External fire.....	57
5.23.12	Material embrittlement and corrosion.....	57
5.23.13	Ultraviolet (UV) resistant pipework.....	57
5.24	Auxiliary systems.....	57
5.24.1	Lubrication systems.....	57
5.24.2	Water systems.....	58
5.24.3	Hydraulic and pneumatic systems.....	58
5.24.4	Utility supplies.....	58
5.25	Installation in a hazardous area.....	58
5.26	Unenclosed microturbines in a mechanical room.....	59
5.27	Decommissioning and disposal.....	59
6	Compliance verification.....	60
6.1	Quality assurance.....	60
6.2	Verification of safety requirements.....	60
6.3	Certification markings.....	60
6.4	Electrical output ratings verification.....	60
6.4.1	Voltage and frequency.....	60
6.4.2	Harmonic Distortion Requirements.....	60
6.5	Electrical ratings for microturbine system.....	60
6.6	Marking of microturbine system.....	61
7	Information for use.....	61
7.1	General.....	61
7.2	Language.....	62
7.3	Packaging.....	62
7.4	Commissioning.....	62
7.5	Operation.....	63
7.5.1	General.....	63
7.5.2	Safety instructions and emergency procedures.....	64
7.6	Enclosure access.....	65
7.6.1	General.....	65
7.6.2	Risk assessment for accessing enclosures.....	65
7.6.3	Limitations under operational conditions.....	65
7.6.4	Limitations under non-operational conditions.....	66
7.6.5	Access during commissioning and re-commissioning.....	66
7.6.6	Installations in a hazardous area.....	66
7.7	Maintenance.....	66
7.7.1	General.....	66
7.7.2	General maintenance hazards.....	67
7.7.3	Accessibility, isolation, and energy dissipation.....	67
7.7.4	Pressure equipment.....	67
7.7.5	Fire protection systems.....	68
7.7.6	Gas detectors.....	68
7.7.7	Control systems: maintenance, calibration, and testing.....	68
7.7.8	Hazardous materials.....	68
7.8	Warning signs and notices.....	69
7.9	Permit to work (PTW).....	69

7.10	Training.....	70
7.11	Decommissioning and disposal.....	70
Annex A (informative) List of significant hazards.....		71
Annex B (normative) Verification of safety requirements and/or measures.....		82
Annex C (informative) Quantitative and qualitative risk assessments and determining SIL levels.....		87
Bibliography.....		88

STANDARDSISO.COM : Click to view the full PDF of ISO 19372:2015

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the WTO principles in the Technical Barriers to Trade (TBT), see the following URL: [Foreword — Supplementary information](#).

The committee responsible for this document is ISO/TC 192, *Gas turbines*.

Introduction

This International Standard is a type C standard as stated in ISO 12100. A type C standard is “a standard dealing with the detailed safety requirements for a particular machine or group of machines”.

The machinery concerned and the extent to which hazards, hazardous situations, and hazardous events are covered are indicated in the scope of this International Standard.

When provisions of this type C standard are different from those that are stated in type A or B standards, the provisions of this type C standard take precedence over the provisions of the other standards for machines that have been designed and built according to the provisions of this type C standard.

The extent of the applicability of the references can be limited by the context of the text within this International Standard. Where a dated standard is specified, this does not preclude the use of later versions provided that the requirements continue to meet the safety issues and identified hazards detailed in this International Standard. Where a reference is made to a specific clause in a standard, only the text of that clause and references therein apply. References within notes are provisions but not normative provisions of this International Standard and are listed in the bibliography.

In addition to covering the relevant safety requirements, this International Standard has also been produced to assist designers, manufacturers, and others by providing methods of compliance with the relevant, essential safety requirements of the following New Approach European Directives for microturbine applications without prejudicing compliance with this International Standard outside the European Union:

- Machinery Directive (2006/42/EC);
- ATEX (Equipment) Directive (94/9/EC);
- Pressure Equipment Directive (97/23/EC);
- Low Voltage Directive (2006/95/EC);
- Electromagnetic Compatibility Directives (2004/108/EC).

Methods are also provided as far as practical and where relevant for compliance with the relevant, essential safety requirements of the following European Directives:

- Integrated Pollution Prevention and Control Directive (96/61/EC);
- Environmental Noise Directive (2002/49/EC);
- Chemical Agents Directive (98/24/EC);
- Classification, Packaging, and Labelling of Dangerous Substances Directive (1999/45/EC);
- Exposure of workers to the risks arising from physical agents (noise) (2003/10/EC).

NOTE When this International Standard was issued, the currently quoted European directives were in force but are subject to updates which may add additional essential safety requirements and users of this standard should check, where applicable, if a later version of a directive is in force or has been released. A later released version of the directives can be used as an alternative before the listed directives are superseded.

[STANDARDSISO.COM](https://standardsiso.com) : Click to view the full PDF of ISO 19372:2015

Microturbines applications — Safety

1 Scope

This International Standard covers the safety requirements for industrial, commercial, and residential automated stationary microturbine (micro gas turbine) engine generator assemblies with an individual system or subsystem output rating with nominal supply voltages not exceeding 1 000 V for alternating current (A.C.) and not exceeding 1 500 V for direct current (D.C.), 500 kW per individual unit/subsystem or less that are intended for installation and use in ordinary and hazardous location using liquid or gaseous fuels and the safety related control and detection systems and essential auxiliaries for all types of open cycles, closed-cycle, and semi-closed (simple, combined, regenerative, reheat, etc.) used in onshore and offshore applications including floating production platforms.

This International Standard applies to driven machinery only where it is an integral part of the microturbine (e.g. a gearbox integral to the microturbine), or is located within the microturbine enclosure and forms part of the enclosure hazardous area classification (e.g. a generator within the microturbine enclosure), or where the driven machinery has a direct effect on the operational safety of the microturbine.

This International Standard details the anticipated significant hazards associated with microturbines and specifies the appropriate preventative measures and processes for reduction or elimination of these hazards. This International Standard addresses the risks of injury or death to humans and risks to the environment. Equipment damage without risk to humans or the environment is not covered.

Microturbine packages are generally specified using International Standards and national standards. Achieving safety is promoted by using additional safety codes and standards, which are shared by microturbines with other technologies.

NOTE It is necessary to recognize that local legislation in the country in which the equipment is to be put to use might not be covered by this International Standard.

This International Standard approaches microturbine safety from an international perspective, based on the content of existing, recognized ISO and IEC standards to the greatest extent possible. Where no ISO or IEC standard exists, other codes or standards (such as EN, NFPA, etc.) have been included. Where local legislation accepts other established codes or standards, or an alternative international or national standard providing equivalent requirements for achieving the desired tolerable level of risk, the use of these alternative codes or standards in place of the references provided in [Clause 2](#) is permissible.

This International Standard excludes microturbines used primarily for direct and indirect propulsion, special heat source applications, and in research and development programmes. It also excludes microturbines for compressed-air energy storage plants. Where appropriate, this International Standard can be used to give general guidance in such applications.

This International Standard is not applicable to machinery or safety components that were manufactured before the date of its publication as an International Standard.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 3864-3, *Graphical symbols — Safety colours and safety signs — Part 3: Design principles for graphical symbols for use in safety signs*

ISO 3977-1, *Gas turbines — Procurement — Part 1: General introduction and definitions*

ISO 19372:2015(E)

- ISO 3977-3, *Gas turbines — Procurement — Part 3: Design requirements*
- ISO 3977-9, *Gas turbines — Procurement — Part 9: Reliability, availability, maintainability and safety*
- ISO 4413:1998, *Hydraulic fluid power — General rules relating to systems*
- ISO 4414:1998, *Pneumatic fluid power — General rules relating to systems*
- ISO 4871, *Acoustics — Declaration and verification of noise emission values of machinery and equipment*
- ISO 6183, *Fire protection equipment — Carbon dioxide extinguishing systems for use on premises — Design and installation*
- ISO 7000, *Graphical symbols for use on equipment — Registered symbols*
- ISO 9772, *Cellular plastics — Determination of horizontal burning characteristics of small specimens subjected to a small flame*
- ISO 10441, *Petroleum, petrochemical and natural gas industries — Flexible couplings for mechanical power transmission — Special-purpose applications*
- ISO 10494, *Gas turbines and gas turbine sets — Measurement of emitted airborne noise — Engineering/survey method*
- ISO 11086, *Gas turbines — Vocabulary*
- ISO 12100:2010, *Safety of machinery — General principles for design — Risk assessment and risk reduction*
- ISO 12499, *Industrial fans — Mechanical safety of fans — Guarding*
- ISO 14001, *Environmental management systems — Requirements with guidance for use*
- ISO 14118, *Safety of machinery — Prevention of unexpected start-up*
- ISO 14120, *Safety of machinery — Guards — General requirements for the design and construction of fixed and movable guards*
- ISO 14123-1, *Safety of machinery — Reduction of risks to health from hazardous substances emitted by machinery — Part 1: Principles and specifications for machinery manufacturers*
- ISO 14520-1, *Gaseous fire-extinguishing systems — Physical properties and system design — Part 1: General requirements*
- ISO 14691, *Petroleum, petrochemical and natural gas industries — Flexible couplings for mechanical power transmission — General-purpose applications*
- ISO 16010, *Elastomeric seals — Material requirements for seals used in pipes and fittings carrying gaseous fuels and hydrocarbon fluids*
- ISO 19353, *Safety of machinery — Fire prevention and protection*
- ISO/TR 13387-7, *Fire safety engineering — Part 7: Detection, activation and suppression*
- IEC 60034-22, *Rotating electrical machines — Part 22: AC generator for reciprocating internal combustion (RIC) engine driven generating sets*
- IEC 60079-0, *Explosive atmospheres — Part 0: Equipment — General requirements*
- IEC 60079-2, *Explosive atmospheres — Part 2: Equipment protection by pressurized enclosures “p”*
- IEC 60079-4, *Electrical apparatus for explosive gas atmospheres — Part 4: Method of test for ignition temperature, amended by IEC 60079-4-AM:1995*
- IEC 60079-10, *Electrical apparatus for explosive gas atmospheres — Part 10: Classification of hazardous areas*

- IEC 60079-14, *Explosive atmospheres — Part 14: Electrical installations design, selection and erection*
- IEC 60079-17:2007, *Explosive atmospheres — Part 17: Electrical installations inspection and maintenance*
- IEC/TR 60079-20, *Electrical apparatus for explosive gas atmospheres — Part 20: Data for flammable gases and vapours, relating to the use of electrical apparatus*
- IEC 60079-29-1:2007, *Explosive atmospheres — Part 29-1: Gas detectors — Performance requirements of detectors for flammable gases*
- IEC 60079-29-2:2007, *Explosive atmospheres — Part 29-2: Gas detectors — Selection, installation, use and maintenance of detectors for flammable gases and oxygen*
- IEC 60068-2-18, *Environmental testing — Part 2-18: Tests — Test R and guidance: Water*
- IEC 60204-1:2009, *Safety of machinery — Electrical equipment of machines — Part 1: General requirements*
- IEC 60364-1, *Low-voltage electrical installations — Part 1: Fundamental principles, assessment of general characteristics, definitions*
- IEC 60417 (all parts), *Graphical symbols for use on equipment*
- IEC 60529, *Degrees of protection provided by enclosures (IP Code)*
- IEC 60695-1-1, *Fire hazard testing — Part 1-1: Guidance for assessing the fire hazard of electrotechnical products — General guidelines*
- IEC 60730-1 Ed. 4, *Automatic electrical controls for household and similar use — Part 1: General requirements*
- IEC/TR 61000-5-1, *Electromagnetic compatibility (EMC) — Part 5: Installation and mitigation guidelines — Section 1: General considerations — Basic EMC publication*
- IEC/TR 61000-5-2, *Electromagnetic compatibility (EMC) — Part 5: Installation and mitigation guidelines — Section 2: Earthing and cabling*
- IEC 61000-6-2, *Electromagnetic compatibility (EMC) — Part 6: Generic standards — Section 2: Immunity for industrial environments*
- IEC 61000-6-4, *Electromagnetic compatibility (EMC) — Part 6: Generic standards — Section 4: Emission standard for industrial environments*
- EN 1127-1:2011, *Explosive atmospheres — Explosion prevention and protection — Part 1: Basic concepts and methodology*
- EN 13463-1:2009, *Non-electrical equipment for potentially explosive atmospheres — Part 1: Basic method and requirements*
- EN 953, *Safety of machinery — Guards — General requirements for the design and construction of fixed and movable guards*
- EN 12845, *Fixed firefighting systems — Automatic sprinkler systems — Design, installation and maintenance*
- EN 13478, *Safety of machinery — Fire prevention and protection*
- EN 50272-2, *Safety requirements for secondary batteries and battery installations — Stationary batteries*
- CEN/TS 14816, *Fixed firefighting systems — Water spray systems — Design, installation and maintenance*
- NFPA 12:2008, *Standard on Carbon Dioxide Extinguishing Systems*
- NFPA 13:2007, *Installation of Sprinkler Systems*
- NFPA 15, *Water Spray Fixed Systems for Fire Protection*

NFPA 68, *Standard on Explosion Protection by Deflagration Venting*

NFPA 750, *Standard on Water Mist Fire Protection Systems*

NFPA 2001, *Clean Agent Fire Extinguishing systems*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 3977-1, ISO 3977-3, ISO 3977-9, ISO 11086, ISO 21789, and ISO 12100, and the following apply.

3.1 auto-ignition temperature

AIT

lowest temperature in degrees Celsius of a heated surface at which the ignition of a combustible substance in the form of gas or vapour mixture with air can occur

Note 1 to entry: AIT is also referred to as ignition temperature, minimum ignition temperature or self-ignition temperature in other standards and in the literature (see [5.16.4.4](#)).

3.2 drain valve

valve that is intended to remove liquids from a pipework system, and that normally drains to atmospheric pressure

3.3 extinction safety time

maximum allowable period of time between the direct or indirect detection of loss of combustion and cessation of the fuel supply

3.4 foreseeable lifetime

includes all phases of life of a part or a system, for example, but not limited to, construction, transportation, commissioning, use, operation, cleaning, trouble-shooting, maintenance, decommissioning, dismantling, final disposal, etc

3.5 ignition safety time

maximum allowable period of time between the opening of the fuel supply valve, which permits fuel to flow, and cessation of the fuel supply, in the absence of confirmation that combustion has commenced (e.g. unsuccessful ignition)

3.6 interlock interlocking device

mechanical, electrical or other type of device, the purpose of which is to prevent the operation of machine elements under specified conditions by an inhibit command from the interlocking device that

- a) directly interrupts the energy supply or directly disconnects parts from the equipment, or
- b) is introduced into the control system so that interruption of the energy or disconnection of parts from the equipment is triggered by the control system

3.7 lower explosive limit

LEL

volume concentration of flammable gas or vapour in air, below which the mixture is not explosive

Note 1 to entry: The terms "explosive limit" and "flammable limit" are equivalent.

3.8**operator**

person or organization having responsibility for the operation of the equipment

3.9**original equipment manufacturer****OEM**

person or company having design responsibility for the equipment or for parts of it

Note 1 to entry: This may be the manufacturer/packager of the equipment.

3.10**packager**

supplier(s) having responsibility for integrating the technical aspects of the equipment and all auxiliary systems included in the scope of the supply

3.11**purchaser**

person or company having authority to specify and to buy the equipment

Note 1 to entry: This, in some cases, may designate the operator.

3.12**relief valve**

safety device used for over-pressure protection and which does not operate under normal running conditions

3.13**safety device**

all elements that are used to measure, limit, or control safety relevant process variables, for processing safety relevant signals or for activation of automatic or manual safety related interventions

3.14**safety related system**

systems/components whose primary failure is shown by the failure analysis as likely to cause a hazard and can require special measures in order to achieve an acceptably low probability of occurrence

3.15**spill valve**

control valve that is intended to divert a portion of the liquids during normal running conditions

3.16**tolerable risk**

risk that is accepted within a given context based on the current values of society

Note 1 to entry: See IEC 61511-3 and/or ISO/IEC Guide 51.

3.17**valve pressure proving**

system to check the effective closure of automatic shut-off valves by detecting leakage

3.18**vent**

opening intended to discharge gases, fumes or mists except the exhaust gas of the microturbine, the latter being called the exhaust system

3.19**diverter valve**

control valve that is intended to divert a portion of the liquids during normal running conditions, also known as an unloader or regulator valve

3.20

electrically operated safety shut-off valve

automatic valve in which the transmission is effected by an electrical prime mover and in which the operation controls the flow of fluid, normally closed valve that prevents the delivery of fluid when de-energized by the action of a limiter, a cut-out, or burner control system

Note 1 to entry: A safety shut-off valve is considered a protective control and may also be used as an operating control.

Note 2 to entry: A safety shut-off valve may be either of the automatic or semi-automatic opening type

Note 3 to entry: A semi-automatic valve is opened manually and closed automatically, this is considered a manual reset condition.

4 List of significant hazards

Anticipated significant hazards are listed in broad outline in [Annex A](#), which indicates the significant corresponding preventative measures and which should be used in conjunction with [Clauses 5](#) through [7](#) to reduce or eliminate these hazards.

5 Safety requirements

5.1 General

The overall objective of the safety requirements is to ensure that equipment is designed, constructed, operated, and maintained throughout its life to attain an appropriate level of safety for its intended application.

To achieve this, the safety management process shall eliminate the hazard or reduce the risk associated with the hazard by applying measures, in the following order :

- design for safety with passive protective measures;
- apply active protective measures (e.g. automatic protection intervention if preset limit values are exceeded);
- communicate the information for use about the residual risk to the installer/operator by instructions to reduce the risk to a tolerable level.

See ISO 12100:2010, 5.4, 5.5, and Clause 6.

Machinery shall comply with the safety requirements and/or protective measures of this clause. In addition, the machine shall be designed according to the principles of ISO 12100 for relevant but not significant hazards which are not dealt with by this International Standard.

The content of this International Standard should not prejudice technical advances in the field of microturbine safety or be used to inhibit innovation that can lead to increased safety.

5.2 Risk assessment

Risk assessments shall be performed to determine whether the microturbine and associated components/equipment can cause injury to people or pose a threat to people's lives, or to the environment, or can cause significant collateral damage. Where risk reduction measures are undertaken, it is essential to ensure that additional measures do not introduce additional hazards. Risks identified during risk assessment should be eliminated but, where this is not possible, risks shall be reduced to a tolerable level for the associated consequence.

The design of microturbine equipment has to account for variations in the applied protective measures necessary to accommodate individual site conditions, the need to relate protective measures to hazards arising from other operations carried out on site, and the need to have options in the selection of

measures to control risk. Therefore, reliance on risk assessment for the selection of protective measures, to supplement the specific protective measures defined in [Clauses 5](#) through [7](#) is essential.

When risk assessment is applied according to this International Standard, the manufacturer of the microturbine equipment shall accept responsibility for ensuring that a tolerable level of risk is achieved by this process.

When this International Standard indicates that a risk assessment shall be carried out, the manufacturer of the microturbine equipment shall demonstrate both that a suitable risk assessment was carried out and the basis on which the selection of protective measures was defined. The results of the assessments shall be documented and retained by the manufacturer. Residual risks identified shall be communicated to the operator who shall take additional mitigation action as necessary. The content of the risk assessment process shall, as a minimum, address the safety issues raised within this International Standard considering reasonably foreseeable activities over the life cycle of the plant.

NOTE Safety is achieved by reducing risk to a tolerable level. Tolerable risk is determined by the search for an optimal balance between the ideal of absolute safety and the demands to be met by a product, process or service and factors such as benefit to the user, suitability for purpose, cost effectiveness, and conventions of the society concerned. It follows that it is necessary to review continually the tolerable level, in particular when developments, both in technology and in knowledge, can lead to economically feasible improvements to attain the minimum risk compatible with the use of the product, process or service.

Where this International Standard states that the risk of a potential hazard shall be reduced to a tolerable level, and that hazard is associated with a safety related control function in conjunction with the associated system components (as mentioned in [5.20.1](#)), a qualitative or quantitative risk assessment method shall be applied for the events to define the corresponding safety requirements and/or safety integrity level (SIL) of the protection system.

Where the reduction of potential hazards to a tolerable level of risk for components and/or equipment not associated with SILs is required, an appropriate quantitative or qualitative risk assessment or a mixture of both methods shall be used, where applicable, to ensure that a tolerable level of risk is achieved. Information on risk assessment, tolerable levels of risk and references for the determination of SIL levels are given at informative [Annex C](#).

The general principles used for risk assessment shall comply with ISO 12100.

The level of risk obtained shall assume that the requirements of this International Standard are being considered and that the operation and maintenance procedures ensure that the obtained levels of risk are maintained.

If new information that significantly affects a risk assessment becomes available, operators of affected equipment shall be advised.

5.3 Modifications and replacement parts

All modifications and updates/upgrades to protection systems and safety relevant components shall be implemented to achieve the required tolerable level of risk. Replacements of components beyond the requirements of normal maintenance as well as modifications and upgrades of equipment to newer technology require that a risk assessment be performed to ensure that the resulting level of risk remains tolerable.

5.4 Foreseeable misuse

Equipment and protective systems shall be designed and integrated into the end product after due analysis of possible operating faults to preclude dangerous situations due to the consequences of reasonably foreseeable misuse. Examples are as follows:

- a) tool required to gain entry to the enclosure;
- b) pass word protected controls;

c) locking devices.

5.5 Lifetime

Life predictions for safety related systems/components, including safety protection systems and components, shall be performed to establish that the microturbine can be operated with a tolerable level of risk throughout its foreseeable service life of the product.

A periodic maintenance schedule shall be provided by the OEM to reduce risk to a safe level for the product protection systems and safety relevant components. The redundancy of protection systems as designed shall be inspected and maintained during the service lifetime of the product by the purchaser.

5.6 Hazard combinations

Where the potential exists for gases, vapours, mists, and liquids to mix and cause a hazardous situation or affect the operation of a safety device, appropriate measures shall be taken to mitigate the risk to a tolerable level.

Where fuel lines are purged or cooled by auxiliary media, the risks associated with reverse flow and the discharges of mixtures shall be assessed and appropriate mitigation measures taken to reduce the risk to a tolerable level.

Where additives are used to enhance the properties of a given medium, a check shall be undertaken to ensure an unsafe situation is not created in the microturbine or any associated equipment.

5.7 Noise

Where the noise levels in work areas exceed 85 dB (A), warning signs shall be displayed at the entry to an area, building or enclosure indicating that personal ear protectors shall be used. Personal access to work areas with foreseeable, unweighted, instantaneous sound levels exceeding 140 dB (200 Pa) shall not be allowed.

Where high pressure/flow vents, bleeds or air/gas motor exhausts are utilized the design shall limit the velocity at the outlet, and silencers shall be fitted or outlets shall be located such that when the outlets discharge the limit to personal noise exposure of a worker specified above shall not be exceeded, or appropriate warning signs shall be located at a safe distance from the noise source.

NOTE 95 dB sound power levels are the limits for the European Union for non-stationary engine generator assemblies. A sound power level test report should be available for stationary engine generators upon request. Local regulations might require additional sound attenuation for the installation site.

5.8 Mechanical

5.8.1 Guarding

5.8.1.1 General

Guards shall be provided in accordance with ISO 14120 or EN 953, against the mechanical hazards described in ISO 12100:2010, 6.3.

Where an enclosure with controlled access acts as a guard against moving mechanisms and hot surfaces, the entry points shall have signs warning against the potential hazards.

5.8.1.2 Hot and cold surfaces

Equipment shall be designed so as to minimize the risk of burn injury caused by contact with or proximity to surfaces at high and low temperatures.

This can be achieved when the surface temperatures for incidental contact for a given material/finish do not exceed the burn threshold for a minimum contact period of 1 s. Where the threshold temperature is exceeded on normally accessible surfaces, appropriate guarding, barriers, or other suitable measures shall be implemented to remove the potential for burns. On surfaces not normally accessed, warning sign(s) shall be posted at a clearly visible location in the vicinity.

Typical 1 s burn threshold levels are 70 °C for uncoated metal, 80 °C for coated metal and 85 °C for glass. ISO 13732-1 and ISO 13732-3 shall be used to determine if a potential risk of a burn is present.

For deliberate contact surfaces (e.g. manual valves and door handles), means shall be provided to ensure that the surface temperatures do not exceed the burn threshold for a contact time of 10 s.

5.8.2 Accessibility for maintenance

Where applicable, measures for safe access shall comply with ISO 12100:2010, 6.3.5.6.

Where access provisions are not available for non-operational maintenance, temporary access provisions shall be used.

Positioning of safety components and danger, warning, and caution labels shall be considered in the design phase to reduce the chance of injury during maintenance activities.

All safety and instruction labels shall comply with ISO 12100, ISO 3864-3, ISO 7000, and IEC 60417.

Where practicable, structural members, or permanently installed equipment, shall not visually or physically obstruct adjustment, servicing, removal of replaceable equipment, or other required maintenance tasks.

5.8.3 Casing design

Casings shall be designed to withstand the maximum reasonably foreseeable loads including transient and abnormal operating conditions (e.g. microturbine compressor surge) without leading to a failure of the casing itself or its flanges. Hot air leakage that can cause damage or potential injuries shall be prevented.

Casings shall be designed or suitable guarding shall be provided to contain a blade-off event and the subsequent consequential damage, but not for a disc burst or overhang failure (see [5.8.15](#)).

Non-destructive testing, non-destructive examination, or pressure testing techniques shall be used to ensure the integrity of the casing under the relevant and reasonably foreseeable operating conditions and a containment report shall be available upon request.

5.8.4 Microturbine compressor surge

In the event of a surge, the forces, deflections, and consequences of flame reversal shall be mitigated to a tolerable level of risk during shut-down.

5.8.5 Stability and handling

Engine supports, casings, and, if used, base frames shall be mounted in their environment in a manner such that they remain in their intended position during all reasonably foreseeable events.

Where equipment is not suitable for manual handling, lifting arrangements shall be designed to transfer the load of the microturbines or components smoothly from the normal supports to a resting place in a safe and controlled manner, taking account of dynamic and overturning loadings.

Where machinery is being moved that could, due to its own weight, lack of stability or the conditions under which the operation is being undertaken, create a crushing force causing injury, maintenance equipment shall be supplied that applies restraints to ensure that the potential for crushing is mitigated.

Where machinery or one of its component parts is to be moved by hand, it shall be easily movable, or be equipped for picking up and moving safely. Special arrangements shall be made for the handling of tools and/or machinery parts which, even if lightweight, could be hazardous.

Fixed lifting attachments shall be designed in accordance with ISO 13628-1, Annex K to withstand at least 1,5 times the mass lifted, unless otherwise specified in ISO 13628-1 and shall include consideration of any dynamic loads applied during use or testing to ensure an adequate level of safety taking into account failure from fatigue, wear, corrosion, and environmental conditions where the equipment could be used. Lift fittings/lugs on a complete microturbine unit enclosure are to be subjected to a two times load test for 1 min and then examined. The unit shall show no evidence of permanent deformation. Lifting equipment shall comply with a recognized standard applicable to the equipment and its use and shall be appropriately tested, marked and where applicable certificated.

5.8.6 Overload of rotating shafts due to torque

Where there is the potential for faults in the driven machinery (e.g. short circuits) that under reasonably foreseeable circumstances can cause an overtorque greater than the specified design limits in the equipment drive shafts or the associated microturbine rotor, a torque-limiting device or other appropriate measures shall be provided to prevent a dangerous failure.

If torque limiting devices are used for controlling this risk, the activation of such devices shall not change the bearing support condition of the shafts into a situation where overhanging rotors rotate above their critical speed.

5.8.7 Vibration

Where vibration levels in the drive shaft line/train can escalate to excessive levels resulting in the potential for dangerous situations, vibration monitoring equipment shall be installed to continuously monitor and detect any escalation and initiate appropriate action (e.g. shut-down) to bring the microturbine to a safe condition if vibration levels exceed a preset limit.

5.8.8 Mechanical failure caused by corrosion

Mechanical properties of stressed or vibrating materials (e.g. rotors and piping) can be significantly affected by corrosion caused by the environment. Possible effects are reduction of the fatigue limit, stress corrosion cracking (SCC), and stress accelerated grain boundary oxidation (SAGBO). The supplier shall make sure that all necessary steps are taken to address hazards caused by these effects.

5.8.9 Design methods and materials

Microturbines shall be designed so that, when correctly operated and maintained, the risks of failures that result in the release of high-energy debris, rupture of pressure casings or the release of hot, flammable or toxic gases are reduced to tolerable levels of risk for the lifetime of the machinery.

The selection and use of materials for the safety related parts of the microturbine and its related systems shall be based on validated material data and validated design techniques. The selection shall consider the effects of material property deterioration due to manufacturing processes, environmental, or operational causes. See also [5.23.12](#) and [5.23.13](#).

Where the use of titanium or magnesium based alloys creates a fire risk, measures to prevent a dangerous situation or extinguish such a fire shall be taken. See also [5.23.11](#).

Components that are highly stressed (e.g. by aerodynamic or rotational loads and/or high temperature conditions) and that can fail and cause personal injury shall be identified and made traceable for quality control purposes.

The soundness of critical rotating components shall be confirmed by non-destructive testing combined with a fracture mechanics assessment, to indicate that the flaws present no risk at the acceptance limit. Analysis based on material tests shall be used to confirm that a tolerable level of risk is achieved over the

range of operating speeds of the parts during their foreseeable lifetime. The analysis shall at least take into account the risks of crack growth, elastoplastic deformation, creep, corrosion, and fatigue failure.

If the failure of a driven equipment rotor has a direct effect on the safety of the microturbine, the soundness of rotor materials shall be confirmed.

Materials of construction and methods of use shall be such as not to cause unacceptable effects on human health or the environment over the life cycle of the microturbine system and its components.

5.8.10 Microturbine temperatures

Protective measures (e.g. direct or indirect temperature monitoring, cooling air flow, and calculation) shall be taken to prevent failures due to over temperature where the release of high-energy debris, rupture of pressure casings, or the release of hot, flammable or toxic gases is likely to give rise to a hazard. If temperatures exceed the tolerated level, then microturbine unloading to a safe condition or shut-down shall be initiated automatically.

5.8.11 Environmental loads

Machinery, support and enclosure structures, and associated auxiliary piping and ducting shall be designed to withstand a reasonably foreseeable combination of loads caused by site winds, snow fall, ice, low ambient temperatures, and seismic activity without causing structural collapse or other dangerous situations. Local codes and standards normally govern the design, but where such local codes or standards do not exist, the purchaser shall specify the wind speed, snowfall and ice accumulation rates, seismic accelerations, and temperature conditions to be used.

For floating production storage and offloading vessels (FPSO) and floating production units (FPU) applications account shall be taken of the pitch and roll angles and acceleration forces generated by the vessel during operation and maintenance.

5.8.12 Assembly features

Microturbine components whose correct assembly is safety related shall be protected from incorrect assembly in the field or during repair. These components shall undergo a review to determine if assembly features shall be designed into the components and/or distinctive markings shall be used and appropriately documented to minimize the risk of incorrect assembly.

5.8.13 Couplings

Flexible couplings external to the microturbine core used to transmit the microturbine output power shall take account of the design requirements of ISO 14691 for speeds up to 4 000 r/min and ISO 10441 for speeds exceeding 4 000 r/min. Further, for critical service, ISO 10441 should be used irrespective of speed. If rigid couplings are used, the supplier shall ensure that the coupling can transmit the torque.

5.8.14 Rotor bearings

Bearing design shall take into account the resulting effects and risks of the off balance of a spinning rotor due to the reasonably foreseeable loss of microturbine compressor blades and/or turbine blades to ensure that unsafe conditions (uncontained failure, breached pressure casing, fire) do not result. Protective measures shall be taken to prevent the hazards of lube oil loss, fire, and explosion of lube oil vapour or mist (within and around the bearing compartment). Fire protection shall be considered if high temperature surfaces that can ignite the lube oil exist in proximity to the bearing and lubricating oil.

NOTE This clause is not applicable for air lubricated bearing designs.

5.8.15 Rotating part failure

5.8.15.1 General

All microturbine compressor, directly driven generator, and turbine rotating parts that are relevant for safety shall be designed for the conditions and stresses that they encounter during start-up, running, transient, shut-down, or trip conditions.

5.8.15.2 Rotor and disc failure

Due to the large amount of energy contained in the rotating components of a microturbine, rotor or disc failure shall be contained or the risk of overspeed shall be reduced to a tolerable level with passive and/or active measures.

Passive measures include a limitation of the speed to values below rotor failure speed by one or a combination of the following measures:

- a) prevention of further rotor acceleration by loss of blades due to centrifugal load, burning out or other effects;
- b) limitation of the speed at highest fuel flow due to aerodynamic effects in the blading of microturbine compressor and turbine;
- c) manufacturers blade/disk containment test conducted and containment test report published and be made available upon request.

Active measures include overspeed protection and the automatic drain of liquid fuel out of the casing before ignition, according to [5.10.9](#).

5.8.15.3 Overhanging rotor parts

Overhanging rotor parts shall not operate above or within an intolerable margin of their critical speed related to the first bending mode.

If overhanging rotor parts operate above their critical speed related to the first bending mode, calculations and test running on a prototype shall demonstrate that no unsafe vibration levels are reached.

5.8.16 Foreign object damage (FOD) screen

If there is a possibility of foreign objects entering the microturbine and causing loss of containment of rotating parts, a FOD screen/filter shall be installed at the machine inlet to reduce the size of objects that can enter to that which is unlikely to cause such a failure. The location of the screen/filter shall be sufficiently upstream to avoid the potential for large objects to cause significant localized flow blockage that can induce blade failure.

5.8.17 Gearbox

Gear wheels are loaded with a superposition of residual stress, thermal stress, and centrifugal stress, which are dependent on size and speed. This creates a risk of brittle fracture especially in the centre of the wheel body, which increases with size. This risk shall be addressed during production with non destructive testing of pinions and wheels combined with a fracture mechanics assessment, which indicates no risk emerging from flaws at the acceptance limit. Pinions or wheels, for which the acceptance limit of flaws cannot be achieved, shall undergo an appropriate overspeed proof test. This test shall be arranged such that the wheel is rotated up to a speed level that causes a tensile stress inside the disc exceeding the maximum operating stress level with the margin required to ensure the safety of any potential undetected internal flaw with respect to sub-critical crack growth and crack stability during the whole design life of the rotor.

Where the type or design of the gearbox is such that other components are loaded in the same manner as above and assessment indicates that an acceptance limit of flaws cannot be achieved, the gear shall be subjected to the same overspeed proof test described for the gear wheels to achieve the equivalent safety criterion. The oil inlet and drain temperatures shall be recorded during the overspeed test.

Appropriate service factors shall be applied to the gearbox design commensurate with the equipment to be driven and duty range in accordance with a recognized international or national standard.

NOTE 1 See ISO 13691, API 613, or AGMA 6011 for high speed gears.

NOTE 2 For epicyclic gears, reference can be made to the general guidelines in AGMA 6023.

Oil retention in gearbox casings, from gear transmissions with high pitchline velocities can lead to overheating of the oil resulting in oil fires or explosions. The gearcase design shall be such that sufficient free oil volume exists and adequate free drainage facilities are provided to avoid these hazards. Where such hazards cannot be eliminated by design, additional precautions shall be taken.

The oil supply conditions to the gearbox shall be monitored to ensure that the viscosity conditions used as the design basis are achieved to preclude premature wear and failure.

The gearbox design shall prevent failure under the overload conditions described in [5.8.6](#).

5.8.18 Starting systems

The starting system shall be suitable for the acceleration of the microturbine and, where appropriate, driven equipment and for extended operation during purge and microturbine compressor cleaning cycles. Where failure to accelerate at the correct rate can lead to hazardous situations not covered by other controls, for example flame or temperature monitoring, the speed shall be monitored and hazardous deviations shall automatically trip the microturbine.

Starter systems (including gas pressurized or internal combustion engine driven systems) shall be protected by design or by the use of additional controls against overspeed conditions.

Where electric starter motors are intended to operate above their continuous rating, suitable controls shall be provided to ensure that hazardous over-temperatures do not arise.

If a separate, dedicated, starting driver that does not run continually with the driven microturbine rotor is installed, it shall disengage and shut-down automatically before reaching its maximum tolerable speed. Failure to disengage shall automatically trip the microturbine.

Starting systems using pressurized flammable gas as the source of power shall be designed to prevent associated fire and explosion hazards. The gas supply shall be isolated effectively when the starter is not in use, to the same degree of isolation as a gas fuel supply (see [5.10.5](#)). Means shall be provided to enable gas to be purged from the starter system for maintenance purposes. Where a gas starter is used and vented to atmosphere, it shall be vented in accordance with [5.22.2](#).

NOTE For safety and environmental reasons, the use of pressurized flammable gas starting systems is not recommended.

A filter/strainer shall be fitted in the supply to gas driven starter systems. It shall prevent any contaminants that can cause damage to the motor, leading to premature failure with the potential for loss of containment and/or ignition, from entering the motor or system components. The dew point of any gas supply shall be such that the formation of liquid hydrocarbons which can cause a motor malfunction or a hazardous situation at the vent discharge are eliminated.

In the event of a starter motor rotor failure, the starter motor casing shall be capable of containing the release of high-energy debris. If this capability does not exist, then other safeguards shall be provided to protect personnel from injury (e.g. enclosure access prevented during starter operation).

For starting systems having common starting capabilities for multiple units, proper electrical and mechanical interlocks shall be provided and tested during production or prior to commissioning in order to avoid starting the wrong microturbine.

5.8.19 Storage and operating ambient temperature conditions

Where low or high ambient temperatures can exist during storage, transportation, handling, start-up and/or running conditions, which have the potential for causing premature failure of equipment and/or brittle fracture of structures, appropriate materials shall be used or protective measures shall be taken to prevent a hazardous situation within the manufactures stated temperature ranges. The microturbine system shall be clearly marked with its operational temperature ranges and documentation shall state the storage temperature ranges for the microturbine electronics system.

Precautions shall be taken to prevent premature failure of the microturbine compressor components that can be subject to malfunction caused by low inlet air temperature conditions.

The manufacturer shall provide technical specifications for proper ambient storage and operating conditions/limits. The manufacturer shall take appropriate measures to protect the equipment for reasonably foreseeable conditions that can exist within a proper storage environment. See the requirements of IEC 60204-1:2009, 4.4

NOTE The microturbine engine power output rating ambient conditions are established in ISO 3977-2.

5.9 Microturbine air inlet system

5.9.1 General

The microturbine air inlet system conditions and directs the air into the microturbine compressor and where applicable power electronics.

The microturbine systems equipped with purge pressurization enclosures placed in Group II Zone 2 locations shall comply with the requirements of IEC 60079-2.

5.9.2 Inlet air contamination

Air inlet filtration shall be provided that minimizes the entry of atmospheric contaminants, airborne contaminants from adjacent plant and saliferous atmospheres, where necessary, that can lead to premature failure of microturbine components, creating a hazardous situation.

The air inlet filtration system shall be capable of experiencing pressure changes due to credible turbine compressor surge events to ensure that a tolerable level of risk is maintained.

Where applicable, cooling air inlet filtration for electronics shall be provided that minimizes the entry of atmospheric contaminants, airborne contaminants from environmental conditions and saliferous atmospheres, where necessary, that can lead to premature failure of microturbine power electronics and safety components, creating a hazardous situation.

5.9.3 Icing monitoring and prevention

Where site conditions of temperature and humidity can be reasonably foreseen to cause icing at the microturbine compressor inlet system, which can cause a dangerous situation, appropriate measures shall be taken to prevent the accumulation of hazardous quantities of ice, or controls utilized that initiate a trip before a hazardous situation is created. Where the measures for preventing inlet icing can become inoperable and while the microturbine system is operating in the range of temperature and humidity where ice in the compressor inlet can form, the microturbine should be shut-down automatically on a fault indication when a hazardous situation is reasonably foreseeable.

Where compressor bleed anti-icing systems distribute hot air over the inlet openings or in the inlet duct, access shall be restricted in the vicinity of the hot air outlets during operation of the system.

If site monitoring instrumentation is to be installed, it shall be installed in such a manner that icing conditions shall not adversely affect the accuracy of the monitoring method. Instrumentation piping shall be routed so that inclusion of atmospheric condensates is prevented.

Where an evaporative cooling system or a direct water mist system is used at the microturbine compressor inlet, the water supply shall be shut-off when air temperature monitoring at the microturbine compressor inlet indicates that conditions exist for ice formation, which can lead to microturbine compressor damage, resulting in a hazardous condition.

Where either on or offline water wash is installed, appropriate precautions shall be taken to prevent the formation of ice. Such precautions can include the use of a suitable anti-freeze agent (see [7.5.2](#) and [5.24.2](#)).

5.9.4 Implosion protection

Where an implosion flap door is provided in the inlet system to open at a specific pressure drop to prevent implosion of the inlet ducting with the potential for the ingestion of dangerous foreign objects if an upstream blockage occurs, suitable measures shall be taken to prevent foreign object ingress at the bypass door, which, due to the size of the object, could cause a dangerous situation. Measures shall be installed to ensure that the implosion flap door, where provided, cannot become frozen shut where its failure to operate can cause a dangerous situation.

5.9.5 Inlet explosion protection

The combustion air intake shall not be located in a zone 0 or zone 1 area (see [5.16.2](#)). Location in a zone 2 area shall be considered acceptable only where the largest credible leak from a secondary source would be diluted to such an extent by the surrounding air that a hazardous situation would not arise in the combustion air supply.

Gas detector(s) to initiate a microturbine trip shall be located at the gas turbine compressor air inlet where a zone 2 area exists from a credible leak, as described above, or where there is still the potential for flammable gases or vapours to enter the microturbine compressor air inlet from either

- a) adjacent plant, should there be an uncontrolled event or major incident,
- b) the atmosphere, due to excessive venting or similar uncontrolled conditions [e.g. in natural gas or liquefied petroleum gas (LPG) plants or offshore platforms], or
- c) ingestion of unburnt flue gas.

Where such risks exist gas detector(s) and any other equipment located in the combustion air stream shall be suitably certified for use in the zoned area.

Gas detectors and associated alarm systems shall comply with [5.19](#) and be selected taking into account the speed of escalation of any reasonably foreseeable leak source, the response rate of the detector(s), the system time constants and any other relevant factors.

5.9.6 Waste disposal through combustion

In some applications the combustion inlet air can be deliberately mixed with waste flammable gases, vapours, or aerosols to eliminate such substances from the environment. The supply of the waste products shall be controlled and shut-off during the microturbine start-up cycle and prior to shut-down. The allowable flow rate and concentration of the waste flammable gases, vapours or aerosols prior to mixing with the combustion air flow, and the temperature and pressure of combustion shall be monitored and controlled within limits verified as tolerable by detailed analysis and tests. If the flow rate or concentrations exceed the defined levels, the supply shall be terminated.

Where this disposal process is adopted, suitable gas detector(s) shall be installed at the microturbine compressor air inlet as an additional precaution to trip the microturbine in the event of an excess waste flow. Gas detector(s) shall comply with [5.19](#) and be selected taking into account the speed of escalation

of the flammable content of the waste stream, the detector response rate, the system time constants, and any other relevant factors.

5.9.7 Recirculation

If ventilation outlet air from the microturbine enclosure is used for anti-icing at the microturbine compressor air inlet, there is the risk that a potentially explosive mixture of fuel and air can be ingested into the microturbine if there is a fuel leak within the microturbine enclosure.

Where this risk exists, the following safety precautions shall be taken or the air shall be heated by other means (e.g. indirectly).

- a) Gas detector(s) shall be located in the microturbine compressor air inlet plenum and in the microturbine enclosure ventilation-air outlet.
- b) All equipment within the ventilation air and combustion inlet air flows shall comply with [5.16](#) for use in zone 2.
- c) All surface temperatures within the ventilation and combustion inlet air flows shall not exceed the AIT of any flammable substances that can be present (see [5.16.4.4](#)).
- d) The gas detector(s) and associated safety systems response times shall prevent a potentially dangerous explosive mixture from reaching the anti-icing outlet within the microturbine compressor air-inlet plenum based on a sudden fuel leak within the enclosure at the minimum ventilation flow rate.

Where microturbine compressor delivery air is piped to the microturbine compressor inlet system to control exhaust emissions during operation under partial load, the take-off point, controls and piping design shall prevent excess flow occurring, the accumulation of unburnt hydrocarbons and the potential for burnt/unburnt products of combustion entering the inlet and causing a hazardous situation on flameout or microturbine compressor surge.

5.9.8 Microturbine compressor air inlet ducting

The microturbine compressor air inlet ducting shall normally be routed to avoid hazardous areas. Where this is not possible, the ducting integrity shall prevent unacceptable leakage paths.

The air inlet ducting system shall be capable of experiencing pressure changes due to credible turbine compressor surge events to ensure a tolerable level of risk is not exceeded.

5.10 Fuel systems

5.10.1 General

The microturbine fuel system shall be considered to include all components within the production enclosure from the point of entry to enclosure, including any internal automatic shut-off valves, up to and including the burners/combustion injectors. The site fuel system shall be considered to include all components outside the enclosure including the external manually operable shut-off valve up to microturbine enclosure. The most common fuels used by microturbine applications within the scope of this International Standard are natural gas and liquid fuels. However, a wide range of alternative fuels can be used and others are under consideration or trial. Design and construction shall take the relevant properties of the fuel into account including AIT, viscosity, lubricity, vapour pressure, toxicity, pour point, and any other reasonably foreseeable properties that could create a hazardous situation.

The microturbine enclosure shall have a fuel system label at the fuel connection point and shall clearly display the following information: the type of fuel to be used, maximum and minimum fuel inlet pressure in kPa, and optionally - the thermal energy value of the fuel to be used in MJ/m³.

NOTE 1 The fuel label can be incorporated within the name data plate as long as the fuel connection and electrical connection point are in close proximity of one another and the name data plate is located between the connections.

NOTE 2 The external fuel valve train shall comply with the national standards of the country of installation and the manufacturers installation requirements.

NOTE 3 Some countries can require maximum and minimum fuel inlet pressure in psig and optionally thermal energy value of the fuel to be used in Btu/scf.

5.10.2 Fuel supply quality and supply conditions

Manufacturers shall provide detailed fuel specifications (including dew point margins for gaseous fuels and potential for wax formation) and condition ranges required for safe, reliable operation of their machines to the operator and to the designer of the fuel supply system. When the fuel does not comply with the detailed fuel specification the operator shall provide a fuel analysis (including up to C12 for gas fuels) so that the manufacturer can specify the specific fuel treatment necessary to mitigate any associated risks to a tolerable level. Treatment can include varying degrees of pressure and flow control, filtration, condensate removal or heating of the fuel supply. The operator has the responsibility to ensure that the supplied fuel composition remains within the range of the agreed fuel specification throughout the lifetime of the plant, unless a deviation is formally agreed with the manufacturer.

Particular attention shall be given to the dew points and release of liquid hydrocarbons or water for gas fuels, and to wax formation at low temperatures for liquid fuels.

Attention should also be given to any trace element content likely to lead to an unacceptable reduction of metallurgical properties.

Materials that provide a tolerable level of resistance to cracking, corrosion or other contaminant-related failure modes shall be selected with alternative fuels, such as bio-gas (landfill and digester) and raw gas (oil-field/well-head) that can contain contaminants or properties with the potential for causing embrittlement/corrosion of fuel system components. Attention shall also be given to any trace element likely to lead to an unacceptable reduction of elastomeric material properties (e.g. gasket seals), see ISO 16010.

Measures shall be taken to ensure temperatures and pressures are within the ranges that are acceptable for use with the selection of a given material.

NOTE ISO 15156-1 and ISO 15156-2 provides guidance on the selection of materials resistant to stress corrosion cracking in the presence of hydrogen sulfide at different levels of contamination, pressures, and temperatures.

5.10.3 Pressure testing

The microturbine (pre-production) fuel system design shall be validated for its integrity by pressure testing for 2 min at 1.5 times the maximum system design pressure with a calibrated pressure gauge verified by a volume metric flow meter and shall show no evidence of leaking.

- a) Pressure testing shall be conducted on all final production fuel system assemblies. A pneumatic or hydrostatic pressure test on the piping/tubing shall be conducted on the assembly line of all production units at maximum system design pressure for 1 min and show no evidence of leaks.
- b) A site pressure test shall be conducted as part of a safe commissioning procedure which shall be adopted to check for leaks on the running microturbine system. The field test procedure adopted with the technical guidance of the OEM shall be shown to achieve a tolerable level of risk and shall be appropriately documented.

NOTE Where it is not practical to conduct a final assembly pneumatic or hydrostatic pressure test on the piping connected to the combustion system, a safe commissioning procedure shall be adopted to check for leaks on the running microturbine. The procedure adopted shall be shown to achieve a tolerable level of risk and shall be appropriately documented.

5.10.4 Fuel supply heating

Electrically powered heaters or any alternative means shall be assessed for safety for use with the proposed fuel specification. Reliable overheat protection shall be provided to ensure that excessive heat input to the fuel or its associated piping cannot occur.

Where heat exchangers use fluid media as the heat input and fuel leakage followed by entrainment into the media can cause a dangerous situation, protective measures shall be taken. The potential for such leakage shall be minimized by detailed design.

Flame fired direct heating shall not be used. Where trace heating or comparable means are used, the design shall self-limit the temperature, or control thermostats shall be used, and be of an explosion proof design with evidence of a competent body certification.

5.10.5 Gas fuel systems

5.10.5.1 General

As a minimum, each gas fuel supply shall include the following functions:

- a) site installation manual isolation (see [5.10.5.2](#));
- b) leak tight shut-off (see [5.10.5.4](#));
- c) automatic fast acting shut-off (see [5.10.5.4](#));
- d) flow control (see [5.10.5.3](#));
- e) venting for depressurization between leak tight and automatic fast acting shut-off valves (see [5.10.5.4](#));
- f) venting for pipework depressurization (see [5.10.5.4](#) or [5.10.5.5](#));
- g) site installed valve and piping connections to allow for the addition of pressure gauges and test points to monitor during maintenance.

Additional equipment shall be provided where a system risk assessment of all reasonably foreseeable conditions and the reliability of the equipment used indicates that additional control is required.

Where the gas fuel supply system comprises more than one supply or a single supply is divided for multiple use, equipment in each supply shall be duplicated such that the individual supplies comply with [5.10.5](#).


A strainer shall be fitted in accordance with [5.10.5.6](#) where necessary for safe operation.

Suitable and sufficient means for assessing the gas tightness of safety shut off systems as well as the pressure and flow throughout a gas valve train during commissioning and maintenance shall be provided.


NOTE This can be provided by the functions of the control system (see [7.7.7](#)), physical means such as test points or a combination of both.

[Figure 1](#) a) shows the minimum arrangement and indicates the operation of the valves. [Figure 1](#) b) and c) show typical alternative arrangements.


NOTE National regulations can require (100 k cycles of operation) certification of safety shut-off valves, flow control valves serving as safety shut-off valves and vent valves. Examples of equivalent valve safety standards are: ANSI Z21.21/CSA 6.5-2005, UL429, IEC 60730-2-17, EN 161.

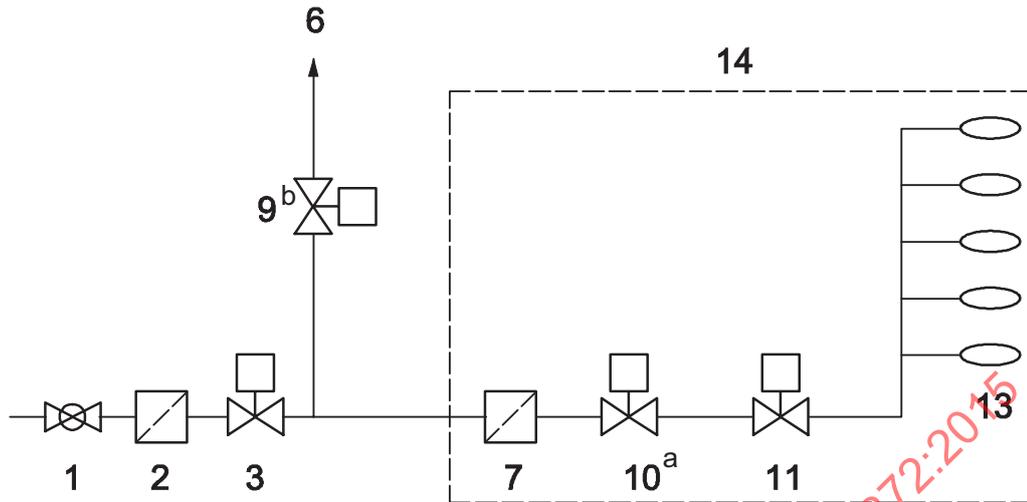


a) Minimum arrangement

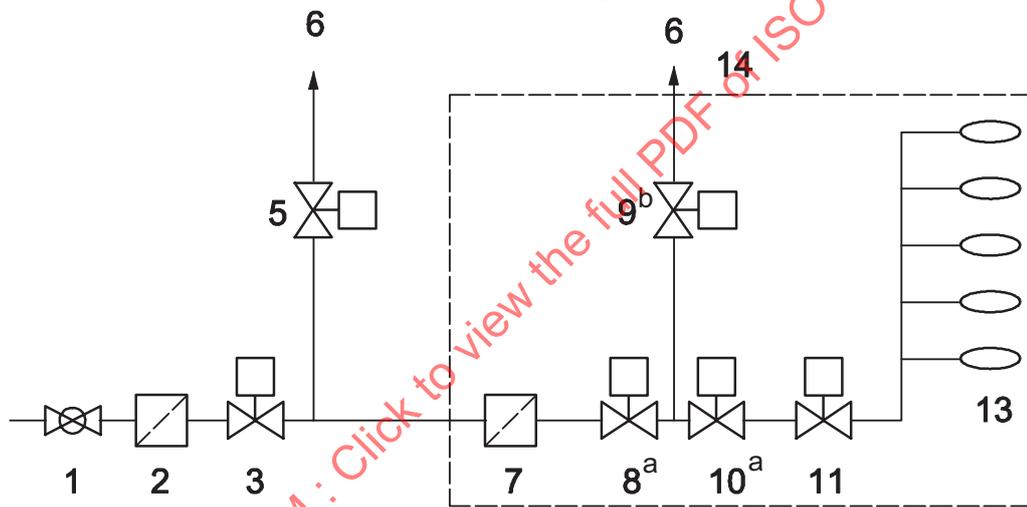

b) Typical alternative arrangement

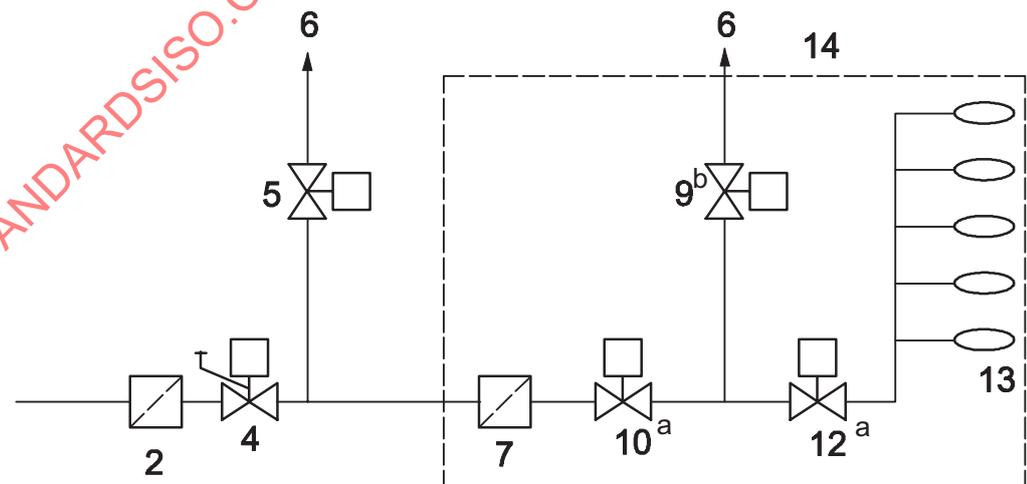

c) Typical alternative arrangement

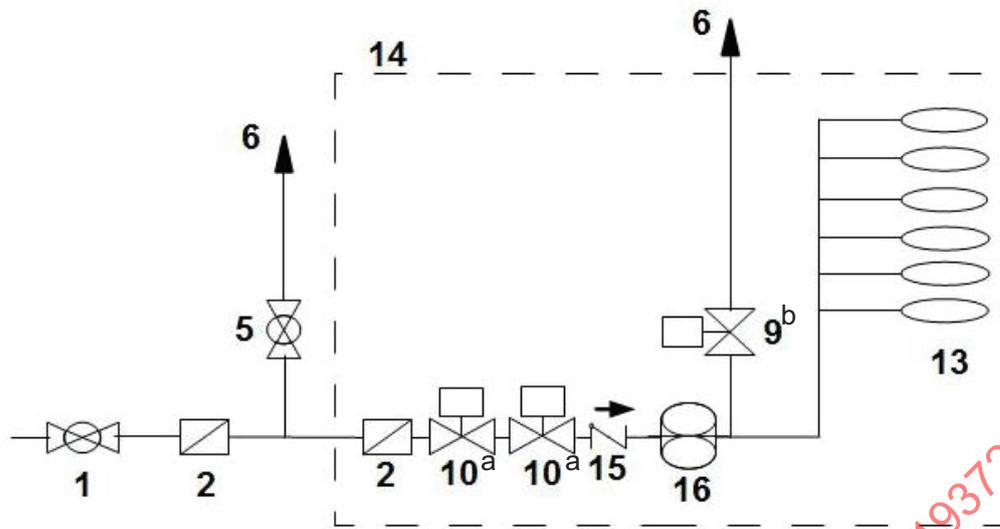

d) Typical alternative arrangement

Key

- | | | | |
|---|---|----|---------------------------------------|
| 1 | manual isolation valve | 9 | vent valve |
| 2 | strainer, optional | 10 | automatic fast acting shut-off valve |
| 3 | shut-off valve | 11 | flow control valve |
| 4 | shut-off valve and manual isolation valve | 12 | flow control and shut-off valve |
| 5 | vent valve | 13 | combustion system |
| 6 | Vent | 14 | typical microturbine enclosure limits |
| 7 | strainer, optional position | 15 | check valve |
| 8 | shut-off valve | 16 | fuel gas booster pump |
| a | Close on every shut-down. | b | Vent on every shut-down. |

Figure 1 — Gas fuel system

Leak tight and automatic fast acting shut-off valves shall fail closed by permanent available energy, e.g. spring force. The fail-safe status of vent valves shall minimize any risks. All valves shall be specified such that a tolerable level of risk and reliable operation will be achieved under all reasonably foreseeable operating conditions.

Normally, automatic shut-off valves shall not be energized to open until the associated downstream vent valve has been proved closed.

Optional site fuel supply vent valves and associated pipework shall be sized to ensure that the depressurized pipe remains at atmospheric pressure taking into account the potential for leakage in upstream valves.

Integral valve combinations can be used providing the necessary functional safety is achieved without introducing additional risk.

See [5.11.2](#) relating to fuel control during ignition.

5.10.5.2 Isolation

For operation during maintenance activity or by fire service personnel, a valve, which can be manually operated, shall be fitted to the inlet of each microturbine unit installation upstream of the automatic

valves. This valve shall be clearly marked, located in an accessible position and shall be capable of being operated by an acceptable level of physical force.

NOTE Guidance on the physical strength for the hand-operation of equipment is given in ISO 9241-400:2007 or EN 614-1:2006.

5.10.5.3 Flow control valve

The fuel flow control valve shall be specified and positioned to control the fuel flow to the microturbine under all reasonably foreseeable operating conditions and shall fail in the closed position if used as the second safety shut-off valve or be accompanied upstream by an automatic safety shut-off valve.

Where failure of fuel flow control equipment can lead to excess fuel flow or other dangerous conditions, an additional independent device or devices shall ensure tolerable fuel flow to the microturbine. Alternatively, the position of the control valve shall be monitored and if an “out of position to demand” is detected, a shut-down shall be initiated.

If an alternative fuel flow control device is provided such as a variable speed gas booster, it shall be specified, located, and governed to control the fuel flow to the microturbine under all reasonably foreseeable operating conditions.

For fuel control provided by alternative devices, two automatic safety shut-off valves shall be provided upstream of the device. The performance of the control device shall be monitored and if an “out of parameter to demand” is detected, a shut-down shall be initiated.

5.10.5.4 Shut-off valves and associated vent valve

Shut-off of the gas fuel supply shall be performed by two independently operated automatic shut-off valves; for a gas rate exceeding 5 GJ/h (1,4 MW) the piping between the valves shall be vented. At least one of the two shut-off valves shall be an automatic fast acting shut-off valve and one shall be a leak tight valve, both of which shall be specified and positioned so that the fuel supply to the microturbine will be shut-off in the event of a dangerous situation at a rate that will prevent dangerous failure of the microturbine. Shut-off valves shall fail closed by permanent available energy, e.g. spring force. One of the two shut-off valves can serve as a flow control valve. This shall not be the automatic fast acting shut-off valve, which shall be provided as an independent function.

Upon shut-down, both shut-off valves — [Figure 1 a\)](#), key items 3 and 10; [Figure 1 b\)](#): key items 8 and 10, and [Figure 1 c\)](#): key items 10 and 12 — shall be closed and where applicable the automatic vent valve opened — [Figure 1 a\)](#), b) and c): key item 9 — to create atmospheric pressure in the supply line to eliminate the possibility of fuel entering the microturbine in its shut-down condition.

Where the design of the fuel system is such that the flow of fuel to the microturbine requires further reduction, due to the stored energy in the piping system downstream of the automatic fast acting shut-off valve, an appropriately sized and positioned fast acting vent valve or alternative equipment shall be used to safely dissipate the stored energy.

Systems that incorporate multiple engines and electronics within a single unified enclosure shall meet this International Standard for double valve requirements at each individual engine.

For a lighter-than-air gas where the gas rate exceeds 5 GJ/h (1,4 MW) local regulations can require the site valve arrangement to be double block (site shut-off valve and the first automatic valve) configuration with the possible additional requirements of an intermediate vent valve.

NOTE National regulations can require the piping between the shut-off valves be vented on all fuel systems.

5.10.5.5 Shut-off valve — Outside the microturbine package

A shut-off valve shall be located outside the microturbine enclosure or building limits, or in a separately enclosed gas fuel package at the interface of the enclosure or building, to automatically isolate the fuel supply to the microturbine in the event of a dangerous situation. The associated vent valve can be located

either inside or outside the microturbine or gas fuel package to vent the section of the pipe between the shut-off valve and the automatic fast acting shut-off valve.

Where the potential exists for the loss of containment from high speed rotating equipment which can cause damage to the valves or rupture of the fuel supply pipe to the microturbine, the shut-off valve(s) outside the microturbine package and the supply pipe to the valves shall be located outside the zone where hazardous projectiles can occur from a potential failure of rotating equipment to ensure fuel shut-off can be achieved. Where the microturbine package is located in a building, the valves shall be located outside the building if further mitigation is required to provide additional isolation.

The fuel shut-off and the vent valve(s) shall be operated automatically on a microturbine trip

- a) if a fire has been detected within the microturbine fire protection area, or
- b) where the cause of the trip can cause damage to or failure of the pipe between the valves and the micro turbine package, or damage to the equipment on the microturbine package, either leading to the uncontrolled leakage of fuel.

5.10.5.6 Strainer

A strainer shall be installed upstream of any automatic fast acting shut-off valve at a suitable location to prevent valve malfunction due to debris entering the valve.

5.10.5.7 Valve proving and position monitoring

At start-up, the position of valves necessary for shut-down shall be confirmed.

At shut-down, the correct functioning of the automatic fast acting shut-off valve, the automatic leak tight shut-off valve and the automatic vent valve shall be automatically monitored to ensure that correct operation of the valves has been achieved.

Monitoring the correct function of the valves shall be done by either supervision of the valve stroke or valve proving of process pressure. Where valve pressure proving is used additional equipment as appropriate can be installed to facilitate pressurization and pressure monitoring. Any additional valves shall be pressure proved as part of the proving sequence.

Monitoring the closed position of the vent valve shall be one by either supervision of the value stroke or valve proving of process pressure taking into account the location of the vent outlet and the hazardous area created should the vent valve fail to close.

NOTE See ISO 12100, ISO 13849-1, ISO 13849-2, IEC 61508, IEC 60730-1, and, additionally when applicable, IEC 61784-3 for guidance on proving of process pressure and supervisory controls.

5.10.5.8 Venting — Not to atmosphere

Where, due to the toxicity of the gas, or where adequate dispersion cannot be ensured, or where environmental considerations prohibit venting to atmosphere, the gas vents can be piped to a low pressure [<50 kPa (0,5 bar)] flare stack, and additional precautions to prevent gas from entering the microturbine shall be implemented. As a minimum this shall consist of a double block and vent in the supply line prior to the microturbine, the valves of which shall be proved and monitored for leak tightness. The vent valve shall be closed after venting to form a double block between the vent line and the microturbine and the pressure in the vented section of the line monitored for any pressure increase. If an increase in pressure is detected this shall be annunciated at the control system to enable rectification action to be taken.

5.10.5.9 Fuel gas booster (internal)

Fuel gas boosters used with in the microturbine enclosure shall be hermetically or semi hermetically sealed and shall be evaluated/certified by a competent regulatory body for electrically safe construction. Fuel gas boosters shall incorporate a pressure limiting device independent of the microturbine controls

to prevent over pressurization of the system. A low pressure switch shall be installed in the fuel system inlet to prevent a vacuum condition in the fuel supply line (see 5.23). A low pressure switch shall be installed in the fuel system inlet to prevent a vacuum condition in the fuel supply line.

NOTE A check valve shall be incorporated upstream of the fuel gas booster to comply some national and local regulations.

5.10.6 Liquid fuel systems

5.10.6.1 Fuel control

As a minimum, each liquid fuel supply shall include the following functions:

- a) manual isolation (see 5.10.6.2);
- b) flow control (see 5.10.6.3);
- c) automatic fast acting shut-off (see 5.10.6.4);
- d) leak tight shut-off (see 5.10.6.5);
- e) spill and/or drain (see 5.10.6.4 and 5.10.6.6);
- f) fuel pump (see 5.23.8.7).


Additional equipment shall be provided where a system risk assessment of all reasonably foreseeable conditions and the reliability of the equipment used indicates that additional control is required.

Different arrangements and combinations of devices can be utilized to fulfil the above functions provided the concepts described in 5.10.6 are achieved and the fuel can be shut-off at a rate that prevents dangerous failure of the microturbine, and the possibility of fuel entering the microturbine in its shut-down condition is eliminated.

Figure 2 shows a typical arrangement. Other arrangements or configurations are permitted.

Shut-off valves shall fail closed by permanent available energy, e.g. spring force. The fail-safe status of drain valves shall minimize any risks. All valves shall be specified such that a tolerable level of risk and reliable operation are achieved under all reasonably foreseeable operating conditions.

NOTE National regulations can require (100 k cycles of operation) certification of safety shut-off valves, flow control valves serving as safety shut-off valves and vent valves. Examples of equivalent valve safety standards are: UL429, IEC 60730-2-19.

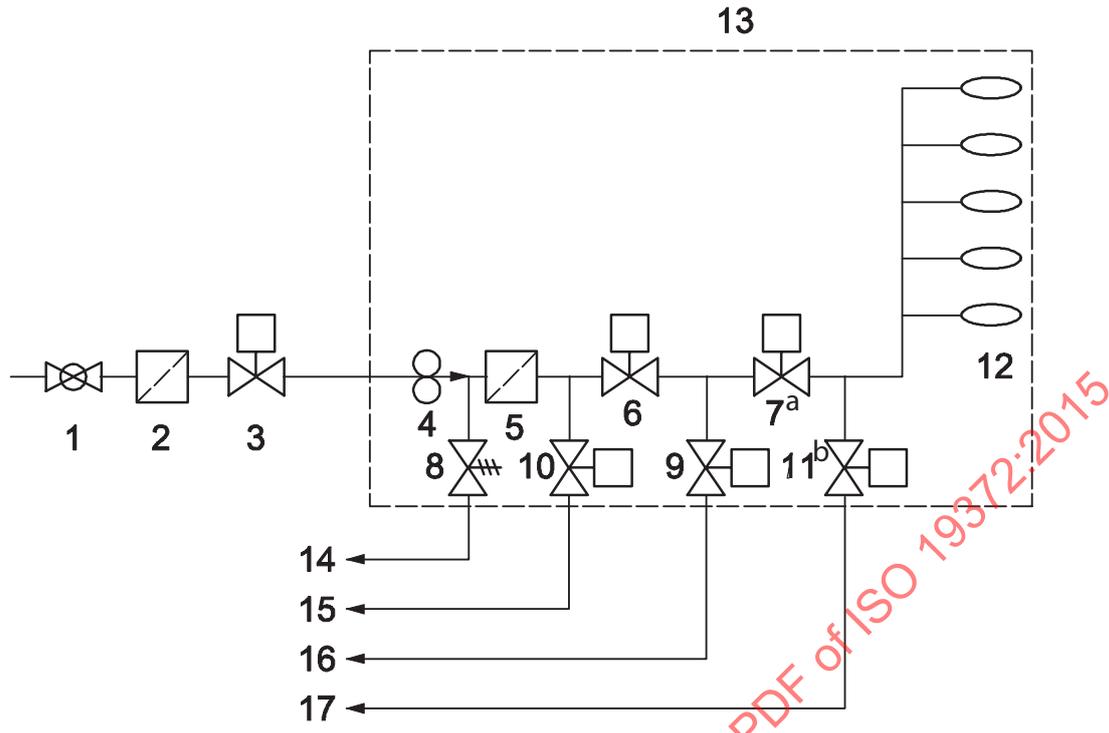

Key

- | | | | |
|---|--|----|---|
| 1 | manual isolation valve | 10 | spill valve — alternative location |
| 2 | filter or strainer, optional position | 11 | drain valve |
| 3 | filter or strainer, optional position | 12 | combustion system |
| 4 | fuel pump, can be located outside microturbine enclosure | 13 | typical microturbine enclosure or building limits |
| 5 | filter or strainer, optional position | 14 | relief |
| 6 | flow control device | 15 | return to supply — alternative location with 10 |
| 7 | automatic fast acting shut-off valve | 16 | return to supply |
| 8 | automatic fast acting shut-off valve | 17 | drain |
| 9 | spill valve | b | Controlled operation on shut-down. |
| a | Close on every shut-down. | | |

Figure 2 — Typical liquid fuel system arrangement

5.10.6.2 Isolation

For operation during maintenance activity or by fire service personnel, a valve, that is capable of manual operation, shall be fitted to the inlet of each microturbine installation upstream of the automatic valves. This valve shall be clearly marked, located in an accessible position and shall be capable of being operated by an acceptable level of physical force.

NOTE Guidance on the physical strength for the hand-operation of equipment is given in ISO 9241-400:2007 or EN 614-1:2006.

5.10.6.3 Flow control device

The fuel flow control device shall be specified, located, and governed to control the fuel flow to the microturbine under all reasonably foreseeable operating conditions.

Where failure of fuel flow control equipment can lead to excess fuel flow or other dangerous conditions, an additional independent device or devices shall ensure tolerable fuel flow to the microturbine.

Alternatively, the position of the control valve shall be monitored and if an “out of position to demand” is detected, a shut-down shall be initiated.

5.10.6.4 Automatic fast acting shut-off valve and spill valve

Shut-off of the liquid fuel supply shall be performed by two independently operated automatic shut-off devices. At least one valve shall be an automatic fast acting shut-off valve.

After operation of the shut-off devices and after any fuel purging, a valve shall drain a section of the supply line to eliminate the possibility of fuel entering the microturbine in its shut-down condition. This valve shall be sized to ensure the drained pipe volume remains near atmospheric pressure taking into account the potential for leakage in upstream valves. Where a spill valve does not spill to atmospheric pressure, a drain valve shall be supplied in accordance with 5.10.6.6. Operational requirements can require the liquid fuel system to remain pressurized when liquid fuel is not being furnished to the engine in order to minimize either starting time or fuel transfer. In these situations, any necessary design steps and additional equipment, including but not limited to

- pressure monitoring,
- valve position monitoring,
- valve proving,
- sequencing valves, and
- drain valves

shall be introduced which is necessary to mitigate risks to a tolerable level.

Where spill flow is returned to the pump suction sufficient cooling and/or make-up flow shall exist to prevent overheating and the potential for vapour lock, or the fuel supply temperature before the pump suction shall be monitored and a shut-down initiated if overheating occurs.

5.10.6.5 Leak tight shut-off valve — Outside the microturbine package

An automatic shut-off valve shall be located outside the microturbine package to automatically isolate the fuel supply to the microturbine in the event of a dangerous situation (see [Figure 2](#), key item 3).

Where the potential exists for the loss of containment from high speed rotating equipment that can cause damage to the valves or rupture of the fuel supply pipe to the microturbine, the shut-off valve(s) outside the microturbine package and the supply pipe to the valves shall be located outside the zone where hazardous projectiles can occur from a potential failure of rotating equipment, to ensure that fuel shut-off can be achieved. Where the microturbine package is located in a building the valve shall be located outside the building if further mitigation is required.

The valve shall be operated automatically on a microturbine trip

- a) if a fire has been detected within the microturbine fire protection area, or
- b) where the cause of the trip can cause damage to or failure of the pipe between the valves and the microturbine package, or damage to the equipment on the microturbine package, with either leading to the uncontrolled leakage of fuel.

5.10.6.6 Drain valve

Where required to achieve a tolerable level of risk during shut-down and where the spill valve does not spill to atmospheric pressure, an automatic drain valve shall be installed to drain fuel downstream of the automatic fast acting shut-off valve which shall operate on every shut-down to drain liquid. The valve can be closed during periods of shut-down where other risks are mitigated.

Where a drain valve is used to drain a part of the system which on shut-down is subject to the reverse flow of high pressure and temperature microturbine compressor delivery air capable of causing the ignition of any hydrocarbons in the drain or purge lines, the drain sequence shall be controlled to prevent this condition. Alternatively, cooling and/or a flame arrester shall be used to prevent any ignition escalating outside the microturbine package or a separator mechanism shall be used to vent any hot gases to atmosphere while draining fluids to a waste liquids tank.

If there is the potential for reverse flow from the tank, appropriate devices and/or instrumentation shall be installed to provide protection against reverse flow into the microturbine under all reasonably foreseeable conditions.

5.10.6.7 Filter/strainer

A filter/strainer shall be fitted upstream of the fuel flow control device and automatic fast acting shut-off valve at a suitable location to prevent device or valve malfunction due to debris entering the device or valve.

5.10.6.8 Valve proving and position monitoring

At start-up, the position of the valves necessary for shut-down shall be confirmed.

At shut-down, the correct function of the automatic fast acting shut-off valve, the automatic leak tight shut-off valve and the automatic drain valve shall be automatically monitored to ensure that correct operation of the valves has been achieved.

Monitoring the correct functioning of the valves shall be done by either supervision of the valve stroke or valve proving of process pressure. The requirement to monitor the position of the drain valve, where supplied, shall be done by either supervision of the valve stroke or valve proving of process pressure taking into account the location of the drain outlet and the hazard that can be created should the valve malfunction.

NOTE See ISO 12100, ISO 13849-1, ISO 13849-2, IEC 61508, IEC 60730-1, and additionally when applicable IEC 61784-3 for guidance on proving of process pressure and supervisory controls.

5.10.6.9 Thermal relief

Where the potential exists for a liquid to be trapped between closed leak tight valves, a suitably located thermal relief shall be provided in accordance with [5.23.9.3](#).

5.10.7 Multi-fuel systems

It shall not be possible under any condition for the reverse flow of fuel into any other system to occur, where this can lead to danger. Appropriate precautions shall be taken to ensure that liquid fuels cannot enter the gas-fuel system where gas fuel is used to purge the liquid fuel burners.

Where only a single fuel can be fired at any one time, interlocks shall be provided to ensure that the standby fuel system cannot operate or is isolated.

Where more than one fuel can be fired at any one time, it shall be ensured that excess energy input due to over-fuelling cannot occur in the microturbine.

5.10.8 Fuel purging

Where forward and reverse purge/drain sequences are used during start-up, operation, or shut-down, risk assessment shall be carried out taking into account all reasonably foreseeable risks including but not limited to the following:

- a) failure of reverse purge sequence during shut-down, which can leave low auto-ignition temperature fuels in the feed lines with the potential for uncontrolled ignition on a restart;

- b) inadequate draining of liquid fuel after a false start, which can leave liquid fuel in the drain lines with the potential for uncontrolled ignition on restart;
- c) uncontrolled shut-down while running on low auto-ignition temperature fuel, causing purge sequences to fail;
- d) potential for ignition of vapours in the purge drain lines/vent tank(s) due to the temperature of the reverse-purge combustion air;
- e) contamination of liquid fuel storage with alternative low auto-ignition fuels if a purge/drain sequence fails, with the potential for uncontrolled ignition on restart due to contamination of the fuel used for starting;
- f) potential for vapour lock (change of state resulting in increased volume and pressure);
- g) uncontrolled supply, venting or draining of dangerous media;
- h) presence of condensates at low points.

Risk mitigation measures such as the use of appropriate instrumentation, double block, and vent valves, valve position monitoring, prevention of reverse flow, separation of media, flame arresters, etc., shall be considered.

5.10.9 Fuel drainage

Where liquid fuel is used, suitable drain points shall be incorporated to drain off unburnt fuel from the pressure section of the casing and/or exhaust system (e.g. in the event of a flame failure on start-up). The drain points shall have valves, automatically operated, that open on shut-down and close as part of the start sequence. The start cycle shall provide a sufficient period to allow draining of this unburnt fuel prior to initiating a restart by the use of automatic drain valves. Automatic or manual operation of the valves as well as their operating schedule, their fail-safe position, the monitoring of the effectiveness of the drain or of the valve position and the requirement of a pre-start purge shall be determined on the basis of risk assessment, taking into account the risk of uncontrollable overspeed caused by burning undrained fuel during start-up, hot gas entering the drain system during operation and unburnt gaseous fuel and air mixtures entering the drain system.

5.11 Combustion supervision

5.11.1 General

Monitoring functions shall be provided for the purposes of detecting that combustion is established at start-up and that a failure of combustion is detected during operation. Both direct and indirect flame sensing systems shall ensure that flame is not sensed prior to the burner ignition sequences.

Where indirect flame monitoring is used, derived from the microturbine exit temperature, pressure, speed parameters or reverse load, these values shall be verified by operational testing of the pre-production product to correctly detect both combustion and loss of combustion under all reasonably foreseeable operating conditions.

Both direct and indirect flame monitoring systems shall either have the ability to be periodically tested, e.g. at start-up and shut-down, or to be self diagnosing or proven automatically during operation.

If air and gas fuel is mixed upstream of the combustor, the risk of unintended ignition in the system causing a dangerous failure shall be assessed and reduced to a tolerable level.

5.11.2 Requirements for ignition

Microturbine combustors, except reheat combustors based on auto-ignition, shall have at least one igniter and one main burner. The igniter can consist of a simple electrical (spark) igniter or of an igniter

and ignition system (ignition flame), or of an ignition system with cross-fire tubes. The main burner can contain a pilot burner (pilot flame) as part of the main burner (main flame).

The energy released during the ignition safety time shall be limited and the maximum pressure rise from a delayed ignition shall not cause unacceptable damage to the plant. The ignition safety time shall be determined by risk assessment. Failed starts with liquid fuels shall be followed by a drain cycle. Failed starts with gaseous fuels where not followed by a re-start attempt require an exhaust purge unless it is indicated as unnecessary by risk assessment. See also [5.12.4](#).

The requirements for enclosure purging in [5.13.6](#) and microturbine and exhaust purging in [5.12.4](#) shall be satisfied prior to ignition (characterized by the occurrence of the first ignition spark). Igniters shall be energized prior to fuel being admitted to the combustion system.

Overfueling during ignition shall be prevented (e.g. by control valve position, pressure or exhaust temperature monitoring, or fuel flow monitoring).

5.11.3 Extinction safety time

On loss of flame, the flame detection and fuel shut-down system shall have a combined maximum response time less than the extinction safety time to limit the release of unburned fuel to an amount that prevents dangerous consequences.

5.11.4 System status indication

The microturbine shall provide a status indication showing what operational mode the system is in at any given time, i.e. remote operating status light or power output display indication.

5.12 Exhaust system

5.12.1 Damper controls

If exhaust dampers are fitted, controls shall be provided to detect uncontrolled damper closure and to shut-down the microturbine before an overpressure condition can arise. Where rapid closing of dampers can create excessive exhaust pressures leading to a hazardous situation, the closing speed of the dampers shall be limited unless other suitable methods are applied that achieve a tolerable level of risk.

5.12.2 Flexible joint location

Where possible, flexible exhaust joints shall not be situated close to walkways or to any electrical or instrument cable or hydrocarbon pipework where leakage or radiation or the potential temperature increase can lead to a hazardous situation. Where the above is not possible, the flexible joints shall be shielded and have gaskets suitable for the thermal environment.

5.12.3 Exhaust stack

The height of exhaust outlets shall be sufficient to provide adequate dispersion of all emissions and the design shall take into account the potential, under reasonably foreseeable operating conditions, for large amounts of oxygen depleted air, carbon monoxide or other hazardous air pollutants being emitted that can cause the asphyxiation of personnel in the area of an inadequately dispersed exhaust. The emissions shall not cause a nuisance or danger to nearby persons or property.

NOTE National or local regulations can govern stack heights.

The package and or installation site exhaust design and location shall take into account wind, seismic hazards, hazardous areas, vent outlets, and other site environmental criteria, and shall accommodate the location of adjacent equipment or structures that can be adversely affected by high exhaust gas temperatures. The design shall consider internal pressure levels that can occur as a result of improper engine operation.

In areas where personnel can be in proximity to the exhaust ducting/stack, thermal protection shall be provided as an integral part of the design of the package and or installation site.

Safe access shall be provided by the installer so that regular checks for leaks can be undertaken on exhaust ducting and exhaust flexibles where these are routed through a building where leakage, due to the above, can lead to asphyxiation or poisoning of personnel in or passing through the building. See [7.5.2](#).

5.12.4 Explosion protection

Where the potential exists for the exhaust system to contain an explosive atmosphere, or gases or vapours that can create an explosive atmosphere, the exhaust system shall be purged before microturbine start-up. The purge flow rate shall be sufficient to minimize unpurged voids. At least three complete volume changes of the microturbine and downstream exhaust system equipment shall be undertaken. The volume is measured up to the base of any main chimney or to that point where, under all load conditions, the exhaust gas temperature of any flammable gases or vapours that can be present is below 80 % of the AIT, measured in degrees Celsius (see [5.16.4.4](#)). Attention shall be given to the potential for entrainment/re-entry/collection of heavier-than-air gases.

Exhaust purging shall be achieved by rotating the microturbine compressor, by the use of separate, suitably controlled fans or by a combination of both to achieve the required volume changes in the total system that can be subject to exhaust gas temperature above the AIT (see [5.16.4.4](#)) of any flammable gases or vapours that can be present. The microturbine exhaust gases can be used for purging provided that they are proven and controlled to be less than 80 % of the AIT measured in degrees Celsius of any flammable gases or vapours that can be present. Additional requirements can be necessary for purging the downstream plant and any associated firing equipment.

The required air purge volume shall be proven by the use of appropriate instrumentation interlocked to the start-up sequence. Where the microturbine air compressor itself is used to provide the purge flow, proof of adequate microturbine compressor rotation speed and proof of correct variable guide vane and/or compressor bleed valve positions shall be used to verify the flow rate.

In the case of a normal controlled shut-down where a shut-off valve operating check has been undertaken and a subsequent start-up takes place, start-up without a full purge can be undertaken, subject to risk assessment to ensure that no fuel can enter the microturbine or exhaust system. A method of mitigating risks to a tolerable level can be achieved by the application of NFPA 85:2011, 8.8.4.6.1 provided that vent outlets are to atmospheric pressure and routed to a safe area or NFPA 85:2011, 8.8.4.6.2. for gaseous fuels and NFPA 85:2011, 8.8.4.6.3 for liquid fuels.

The fuel used for start-up shall be such that auto-ignition on hot internal surfaces does not lead to dangerous overpressure conditions or uncontained component failure. This typically applies to fuels such as naphtha where significant potential exists for the formation of large potentially explosive vapour clouds.

Where more than one microturbine supplies a heat recovery system, precautions shall be taken to ensure that reverse exhaust gas flows cannot pass back into another microturbine under any purge, start-up or other flow condition.

5.13 Enclosures

5.13.1 General

Outdoor enclosures shall be constructed so that the level of weather protection achieved ensures that the correct operation of safety equipment is not impaired by environmental conditions or influences. The microturbine system enclosure shall be tested and evaluated to IEC 60529 for the minimum IP54 code rating and additionally to IEC 60068-2-18 where required, to ensure the safe correct operation of the microturbine and power electronics systems. The testing of the product shall be conducted during

full power operation and in standby to demonstrate safe operation of the microturbine system for adverse weather conditions.

NOTE National or local regulations can require IEC 60068-2-18 or ANSI/UL 2200:2012 rain test for 3R 'rain proof' code enclosure rating. Test shall be conducted during full power operation and in standby to demonstrate safe operation of the microturbine system for adverse weather conditions, followed by a dielectric withstanding test of the power electronics per IEC 60204-1 or equivalent IEC 62109-1 voltage test method.

See [5.25](#) for installation of enclosures in hazardous areas.

Where the enclosure is protected by a gaseous fire extinguishant, the seals at retained panels, doors, and other closure points shall withstand any increase in pressure caused during the release of the extinguishant and maintain the concentration of the extinguishant in accordance with the fire extinguishing code or standard that has been adopted (see [5.15.6](#)).

Non-metallic materials used for flexible connections and seals shall be selected to withstand the loading and environmental conditions to which they are subjected, without impairing the effectiveness of gaseous extinguishant and cooling or dilution ventilation and shall be evaluated for their fire retardant characteristics. See ISO 9772, ISO 9773, IEC 60695-11-10, and IEC 60695-11-20.

Where there is the potential for leakage from driven machinery, of gases of subgroup IIC of IEC/TR 60079-20 (e.g. hydrogen cooled generators) or vapours or mists where the AIT (see [5.16.4.4](#)) is less than the microturbine surface temperature, the machinery shall not be installed in the same enclosure as the microturbine unless the area can be compliant with the hazardous area requirements of [5.13.4](#) and [5.13.5](#) or a gas tight dividing wall or an air gap between two dividing walls is provided or other equally effective means shall be provided to prevent such gas or vapours from entering the microturbine enclosure.

5.13.2 Enclosure structure

The structure of enclosures, attached panels, doors, and their latches shall be designed to withstand the following:

- a) reasonably foreseeable environmental loading associated with the location;
- b) pressure loads caused by the operation of the ventilation system, gaseous extinguishant systems and machinery vents/bleed valves and blockage of ventilation outlets;
- c) overpressures caused by any reasonably foreseeable rupture or leaks from pressure casings and pressurized ducting;
- d) overpressure prior to pressure relief where the requirements of [5.16.5.2](#) are being implemented or overpressure up to 1 000 Pa (10 mbar), unless extrapolated to 1 500 Pa (15 mbar), where the overpressure is being limited in accordance with [5.16.5.3](#).

5.13.3 Enclosure fire precautions

5.13.3.1 General

The risk of fire shall be assessed in all enclosures and, where necessary, fire precautions shall be implemented in accordance with [5.15](#).

5.13.3.2 Microturbine enclosure

When applicable, an integrated fire protection system, including fire detection and suppression equipment, together with the necessary controls and instrumentation shall be provided in the microturbine enclosure in accordance with [5.15](#). The system shall be able to detect fire automatically, directly or indirectly, and extinguish it reliably.

5.13.4 Explosion prevention and protection — Area classification — Ventilation

Hazardous areas within the enclosure shall be classified and explosion prevention and protection measures shall be implemented in accordance with [5.16](#). Where flammable gases, vapours or mists that have an AIT below the temperature of any exposed hot surface can be present or where risk assessment indicates a residual risk of ignition, the additional measures described in [5.16.5.2](#) (explosion relief) and/or [5.16.5.3](#) (pressure resistant design) and/or [5.16.5.4](#) (suppression) shall be implemented.

5.13.5 Gas detection

Where an enclosure contains hazardous zones due to flammable gas or vapour, gas detection shall be implemented in accordance with [5.19](#).


5.13.6 Enclosure purging

Where an enclosure contains equipment that can release gases and liquids capable of producing flammable vapours and mists, the enclosure and associated upstream and downstream ducting volume shall be subject to a purge cycle prior to start-up unless the ventilation has run continually since previous operation of the microturbine.

The purge cycle shall be sufficient to displace three times the volume of the ventilated system.

To shorten the duration of fire or explosion risk in comparison to a natural cooling cycle, the ventilation system shall normally continue to operate at shut-down to reduce the surface temperature of any surface to less than 80 % of the AIT, measured in degrees Celsius (see [5.16.4.4](#)), of any combustible fluids and gases. A margin shall be made, where applicable, for the effects of heat soak from hot masses internal to the surfaces.

In the case of loss of ventilation during the cool-down cycle the actions related to the loss of ventilation shall occur. See [5.16.2](#) and [5.21.9](#).

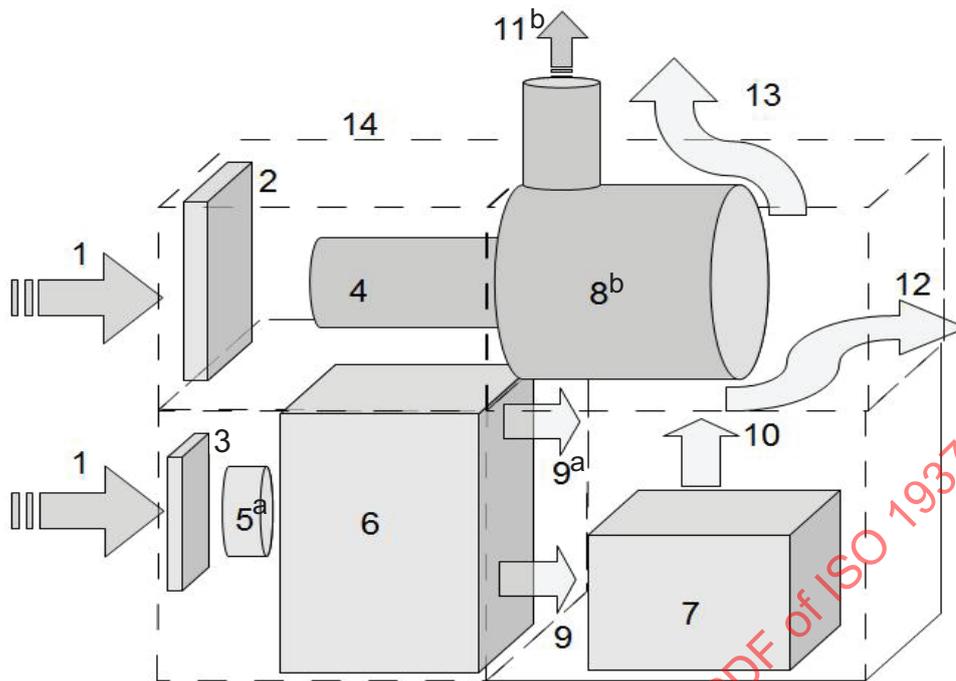

Key

- | | |
|--|---|
| 1 inlet air | 8 microturbine engine ^b |
| 2 microturbine compressor air filter | 9 electronics cool air outlet ^a |
| 3 power electronics air filter | 10 dilution/cooling air |
| 4 generator/microturbine compressor | 11 microturbine exhaust air and ducting ^b |
| 5 power electronics cooling fan ^a | 12 typical dilution exhaust cooling air flow path |
| 6 power electronics modules | 13 typical alternate dilution exhaust cooling air flow path |
| 7 fuel systems area/module | 14 typical microturbine enclosure limits |
| ^a Started first to purge enclosure. | ^b Purged on start-up and shut-down. |

Figure 3 — Enclosure cooling system — Typical arrangement

5.13.7 Mist detection

Flammable mist can be formed from pressurized fluid leakage at a temperature below the flash point of the fluid (see 5.16.2). If risk assessment indicates that the conditions exist for an explosion in an enclosure from the ignition of an explosive mist/air mixture, such that additional risk reduction measures are necessary, suitable protective measures including but not limited to positive locking of fitting, spray retainers, suitable fitting/flange guards, at potential leak points and/or a liquid mist detection system shall be installed. Detectors shall be located taking into account their suitability for operation under local conditions of temperature and air velocity. Alarm settings shall be set as low as possible, commensurate with the avoidance of spurious detection.

5.13.8 Access and doors

To prevent operator entrapment, if it is physically possible for operators to gain entry, each access door shall be fitted with an internal release mechanism that overrides any locking mechanism and is capable

of being opened against negative pressure ventilation forces. See [7.6](#) for information to be supplied in relation to access.

NOTE Similar considerations can apply to hatches.

Enclosure doors shall be fitted with devices when required to prevent unexpected movement due to wind or other actions that can lead to impact or crushing hazards. Where high positive or negative pressure exists in artificially ventilated enclosures which can lead to uncontrolled movement, the manual instructions shall contain procedures for safe opening and closing (see [7.6.1](#)).

For fire extinguishant isolation refer to [7.6.1](#) for isolation details prior to personnel entry.

5.13.9 Entrapment

The arrangement of equipment within enclosures shall be such that access for reasonably foreseeable purposes is available without the risk of entrapment.

Where applicable, account shall be taken of the need for emergency escape routes inside the enclosure to avoid trapping personnel in the event of a hazard.

5.14 Lighting

An appropriate level of local lighting shall be provided in areas where visibility is required for safe execution of inspection and operational activities. Emergency lighting shall be provided where illumination is required for safe operation (stand-by lighting) and escape (escape route lighting).

Assemblies shall be designed and constructed so that there is no area of shadow likely to cause nuisance, that there is no irritating dazzle and that there are no dangerous stroboscopic effects on moving parts due to the lighting.

NOTE Guidance on emergency lighting can be found in EN 1838:1999 and NFPA 101:2003.

5.15 Fire precautions

5.15.1 General

A risk based approach to the requirement for fire risk reduction, protection, detection and suppression measures shall be taken based on the requirements of ISO 19353 or EN 13478, or an equivalent national standard providing equivalent requirements, taking into account the existence of a fire hazard, the probability of its occurrence and the degree of possible harm. The fire protection system shall be based on an integrated set of standards and the guidance described in [5.15.2](#) to [5.15.13](#) inclusive.

5.15.2 Structural fire risk reduction

The materials of construction of enclosed spaces where a fire risk exists, their associated structural members and any acoustic and thermal insulation shall be of non-combustible fire resisting materials to reduce fire loads and inhibit the spread of a fire. The use of small parts that are not connected, such as gaskets made out of combustible materials, is acceptable.

Materials used within evaporative inlet air coolers shall be non-combustible.

Fire hazards of electrotechnical products shall be assessed in accordance with IEC 60695-1-1.

Where risk assessment indicates that a fire extinguishant system shall be provided, the enclosed space shall be designed with the objectives of containing the fire for the maximum period before detection can be ensured, overcoming extinguishant delays and achieving a concentration of extinguishant to extinguish the fire.

5.15.3 Hydrocarbon fire risk reduction

5.15.3.1 General

Tanks containing hydrocarbons shall be equipped with level monitoring equipment for leak detection and, where applicable, detection of over filling.

When defining the fire protection measures for gas fuel areas and other areas containing pressurized hydrocarbons, the actuation of the extinguishing measures (manual or automatic) shall initiate the automatic shut-off of the fuel supply (see also [5.13.3.2](#)). Where manual actuation of the emergency release is required at the extinguishant containers, the operation/installation manual shall advise that the emergency stop button shall be activated to cut off the fuel supply.

Pressurized equipment containing gas fuel, liquid fuel, or other flammable hydrocarbons with the potential for forming flammable mists due to high pressure leaks, shall, in addition to the requirements of [5.23](#), be designed with the minimum number of connections required for correct assembly and maintenance. Where a leak can impinge on electrical equipment which can be a source of ignition, or a hot surface with a temperature above the AIT (see [5.16.4.4](#)) of the potential leak source, additional precautions shall be taken to mitigate the potential for leakage and guard against impingement.

So far as possible, joints shall be positioned so that leaks do not drip or spray onto electrical equipment or hot surfaces.

Where appropriate insulation materials shall be protected against the penetration of hydrocarbons.

The flammability properties of any fluids shall be taken into account during risk assessment. For liquid fuels of low AIT, such as naphtha, segregation of risk areas and the use of explosion relief or other effective measures such as coalescers, spray retainers, etc. shall be considered during risk assessment where additional mitigation is required due to the presence of hot surfaces.

5.15.3.2 Lubrication and hydraulic systems

Where risk reduction measures against flammable oil mists in the presence of hot surfaces do not provide an adequate level of safety, further mitigation shall be undertaken, e.g. by the use of fire resistant or non-flammable fluids. Oil system vents where oil mist can appear shall be fitted with a mist eliminator and routed away from hot surfaces. If vent line outlets are located near a potential ignition source they shall be provided with flame arresters.

5.15.3.3 Post-shut-down lubrication

Where it is necessary to protect the microturbine from damage after a fire shut-down, emergency lubricating oil systems should remain in operation to those areas requiring protection provided risk assessment indicates a tolerable level of risk.

5.15.4 Fire protection

Where indicated by [5.13.3](#) or [5.2](#), an automatic integrated fire protection system shall be provided, together with the necessary controls and instrumentation.

The design shall ensure the integrity and functionality of the fire protection system in the context of fast and reliable detection of fire, fast and reliable discharge after detection, fast and reliable extinguishing and suppression of fire with regard to personnel safety.

5.15.5 Fire detection

To ensure that fires are detected at an early stage, areas at risk shall be monitored with automatic fire detectors. Detectors shall be selected from the following types:

- a) smoke detectors;

- b) flame detectors;
- c) heat detectors.

Heat detectors shall always be present, in the event that flame detectors are blinded by smoke or mist. Other detectors shall be used in conjunction with heat detectors where necessary to mitigate hazardous situations or prevent damage.

The fire detection principles described in ISO/TR 13387-7 or a national standard providing equivalent guidance shall be applied.

Manual push-button fire alarms shall be installed near the main escape routes from any enclosed spaces and at exits from buildings within which a fire protection system is installed. The alarm function can be integrated with the extinguishant release manual push-button at the enclosure.

The definition of areas that are equipped with fire detection or a fire detection and extinguishing system shall be based on risk assessment. At least the minimum number of detectors required for the area being protected shall be installed to provide a fire alarm signal and minimize false alarms to an acceptable level.

Where the location of a fire detector is such that the accuracy of detection could be affected by contamination of the sensing components due to pollutants or substances in the local air stream or atmosphere, the detector type selected shall produce a fault signal if contamination is detected.

5.15.6 Fire extinguishing systems

Fire extinguishing systems shall be designed, installed and tested to the relevant standard as follows:

- a) ISO 6183 or NFPA 12 for CO₂ systems;
- b) ISO 14520-1 or NFPA 2001 for other gaseous systems;
- c) NFPA 750 for water mist systems;
- d) NFPA 13 or EN 12845 for sprinkler systems and NFPA 15 or CEN/TS 14816 for water spray systems.

The extinguishing media shall be selected so as not to cause any damage to the safety related equipment within the enclosed space.

Risk of exposure of personnel to asphyxiants and other extinguishants that are potentially hazardous shall be minimized.

A suitable alarm shall be incorporated into the fire protection control system to provide sufficient warning to people within an enclosed space to make their escape before the discharge of a hazardous extinguishant. The pre-discharge alarms shall provide a time delay of sufficient duration to allow for evacuation under "worst case" conditions.

Where the attempted entry of personnel into an enclosed space protected by a potentially hazardous extinguishant might occur, an entry alarm indication should sound an alarm locally and at the control panel.

Extinguishing systems capable of asphyxiation shall not be installed in or used to protect normally occupied spaces.

Means for mechanical isolation of extinguishing systems shall be provided. The isolation device shall be fitted with position monitoring interfaced to the turbine control system. Isolation shall be repeatedly annunciated at the control system.

Electrical isolation of the extinguishment release can be permitted for short-term entry in large spaces with easy means of egress. Isolation shall be repeatedly annunciated at the turbine control system.

Any air exhausts or air inlet openings into the enclosure shall normally be fitted with an automatic closing damper. If openings are kept open during extinguishant release, this shall be taken into account in the extinguishant quantity calculation. When calculating the quantities of extinguishant for discharge,

due consideration shall be given to unavoidable leakage from the enclosed space. Where dampers are utilized the closing force shall be such to ensure closure of the damper under all reasonably foreseeable environmental and operating conditions. Where required to achieve a tolerable level of risk, damper position shall be monitored.

The extinguishant concentration shall persist effectively to prevent re-ignition by hot surfaces until other safety measures are available (e.g. local fire service). Where re-ignition or lack of site replenishment of extinguishant is a high risk, consideration shall be given to a multi-shot system or providing reserve extinguishant capability.

There shall be two independent discharge release methods:

- a) one automatic, after a signal from the detection system;
- b) one manual, by push button(s) at predefined points near to the enclosed space. Manual release can use electrical assistance to initiate the discharge.

NOTE 1 Some national standards require additional methods for manual release.

Each different design of enclosure shall be subjected to a one-time full extinguishant discharge release type test, or a door fan retention test in conjunction with a functional test on the extinguishment system to ensure the applicable integrity/sealing is achieved.

Proper functioning of all related systems and the sealing of the enclosed space shall be checked on each installation. See also [5.23.13](#) in relation to the suitability of pipework.

NOTE 2 For an example of door fan retention test procedures, see ISO 9972.

5.15.7 Water mist extinguishant

Where a water mist extinguishant system is used and where a continual discharge system can cause damage to the microturbine and power electronics leading to premature failure, a pulsed release system that has been proven not to cause such damage can be used. The interval of pulsing shall be such as to extinguish the maximum credible fire and maintain continual protection against re-ignition.

The numbers and positions of the water mist nozzles shall be selected to provide an adequate effect of the extinguishing spray taking into account the actual geometry and access of the parts.

Suitable measures shall be taken to prevent icing of the system.

The water mist system shall be suitably type tested and validated.

Water mist nozzles shall be fitted with a suitable filter/strainer such that any reasonably foreseeable blockage of the discharge orifices by particulates is prevented. System materials shall be chosen to reduce the potential for blockage of orifices by corrosion deposits. Water quality shall comply with the manufacturer's specification.

NOTE Building machinery room water mist and water spray systems are not acceptable for use with power electronics integrated microturbine configurations unless the microturbine package enclosure is suitable for outdoor use.

5.15.8 Extinguishing system controls

Where risk assessment has determined it applicable, each fire protection and extinguishing system shall be equipped with a fire protection control system. This can be a local panel, can be integrated with the microturbine control system or can be installed in the main control panel area.

The system shall be capable of the functions specified in [Table 1](#).

Table 1 — System functions

Function	Implementation
Manual push-button release	Installed at predefined points outside an enclosed space/machinery room. Use of this release shall not override the required pre-discharge alarm sequences.
Automatic release	Automatic release on fire detection.
Selector switch	The extinguishing system shall be able to be inhibited when a hazardous extinguishant media is used. The use of electrical selector switches to isolate extinguishant release can give rise to a false sense of security when the manual release is still available and shall not be used as an alternative to mechanical isolation.
Acoustic alarm	At enclosed spaces by horn or alarm sirens.
Visual alarm	At enclosed spaces with a high noise level (e.g. microturbine enclosure/machinery room) by red flashing lights.
Interface to microturbine controls	Suitable contacts and associated logic.

In the event of a loss of the primary electrical power supply to the fire protection system, it shall be protected by an independent back-up/emergency system capable of maintaining the electrical supply for a period sufficient to achieve a tolerable level of risk.

The fire protection system shall, where specified, transmit a specific alarm signal to any associated Central Control Panel to provide comprehensive information for operational personnel.

Activation of a single fire detector shall initiate an alarm signal.

Activation of a second detector or second detector type shall initiate appropriate actions that might include but are not limited to the following:

- a) transfer a signal to the microturbine control system for initiating microturbine trip;
- b) close the applicable fuel safety shut-off valve(s) (see [5.10.5.5](#) and [5.10.6.5](#));
- c) actuate related warning devices;
- d) trip the ventilation system of the enclosure/machinery room;
- e) close ventilation inlet and exhaust dampers;

NOTE In some cases, this can be achieved by the extinguishant action.

- f) actuate the automatic fire extinguishing system, after the time delay necessary for personnel protection, where applicable.

Activation of a single fire detector, where applicable, can be used to initiate the appropriate actions above.

The sound level of an acoustic alarm shall be audible above the noise level of the building/area in normal operation, except that red (or another nationally required colour) flashing lights shall be provided in areas with an average sound level greater than 105 dB(A) at 1 m in addition to the acoustic alarm.

Where a serious fault alarm signal is received from the fire protection system, an alarm, which can only be manually reset, shall be initiated. Equipment start-up shall be interlocked or the operation manual shall indicate that start-up is not permitted before the failure is identified and solved. Equipment shall be monitored for open and short circuit conditions or other appropriate measures shall be implemented to achieve a tolerable level of risk.

NOTE A serious fault alarm is an alarmed fault that, if not rectified, affects the ability of the system to operate correctly.

5.15.9 Escape

Suitable safeguards shall be provided to allow prompt evacuation of machinery room, to restrict entry to dangerous areas and to provide means for prompt rescue of any trapped personnel.

There shall be adequate escape routes from the structures to the outdoors. Exit doors shall open in the direction of exit. Where appropriate escape routes shall be marked and provided with emergency escape-route lighting.

5.15.10 Uncontrolled release of media and loss of propellant pressure

A method of monitoring and/or weighing the fire extinguishant vessels' contents that does not require disconnection of the vessel shall be provided so that, if the vessel contents escape or leak, appropriate action can be taken. Where manual checks are used they shall be conducted at intervals that ensure that unacceptable leakage is detected.

Where a nitrogen gas supply is used to actuate the extinguishant release mechanism or as a propellant to eject water in a water mist system, the pressure in the nitrogen vessel(s) shall be monitored so that, if the vessel(s) contents escape or leak, an appropriate alarm shall be provided.

Where low temperature conditions can cause a drop in the pressure of propellant gas vessels, suitable heating shall be provided to maintain the vessel(s) at a temperature such that an acceptable pressure is achieved.

Where the potential exists for external influences to activate fire detection equipment, appropriate precautions shall be taken, e.g. covers at enclosure windows to prevent activation of detectors by local radiation, such as welding arcs.

5.15.11 Vessel thermal relief (burst disc)

Protection shall be provided against overheating when fire extinguishant or nitrogen propellant vessel(s) are located in areas subject to strong sunlight or other heating effects that can cause an uncontrolled pressure increase and operation of the vessel valve burst disc. Propellant or extinguishant vessels shall not be installed inside a microturbine enclosure/machinery room.

Methods of protection might include but are not limited to

- a) vessels mounted in a suitably ventilated cabinet,
- b) vessels located in natural shade, and
- c) provision of canopies or similar protection against surface heating.

The vessel valve burst disc shall be orientated or otherwise guarded so that if the burst disc operates personnel in the immediate area cannot be harmed.

5.15.12 Vessel and/or pipe failure

Fire extinguishant and nitrogen propellant vessels shall be suitably mounted and protected from damage.

Where potentially damaging exposure or unauthorized interference is likely, suitable enclosures or guards shall be provided.

Piping shall be routed so that the potential for damage due to mechanical or other causes is minimized.

5.15.13 Release of extinguishant into microturbine mechanical rooms, control rooms, etc.

If vessels and the associated pipework for fire extinguishant systems are located in microturbine mechanical rooms, control rooms, or similar areas where personnel access is required and there is the potential for asphyxiation due to the extinguishant used and the potential concentrations that could be achieved on release, the precautions in [5.15](#) and [5.13.9](#) shall be applied where relevant.

5.16 Hazardous area classification and explosion prevention and protection

5.16.1 General

Where the potential exists for flammable gases, vapours or mists to arise, the areas shall be classified and appropriate precautions shall be taken against explosions in accordance with IEC 60079-0, IEC 60079-10, IEC 60079-14, EN 1127-1, and EN 13463-1.

Where local legislation recognizes other established standards, such as NFPA 70 and NFPA 497, that achieve an equivalent level of safety and certification of equipment, these documents can be used as alternatives.

5.16.2 Area classification

Hazardous area classification shall be carried out for all microturbine plant items where flammable gas, vapour or mist risks can arise. Areas shall be classified into zones (as defined in IEC 60079-10) and the extent of the zone determined in accordance with IEC 60079-10. The extent of the zone adjacent to any ventilation inlet shall take account the increased airflow in the area and the potential for flammable gases, vapours or mists to be drawn into the inlets.

NOTE Flammable mist can be formed from pressurized fluid leakage at a temperature below the flash point of the fluid. IEC 60079-10 excludes areas where the presence of flammable mist can give rise to an unpredictable risk, which require special consideration, but advises that mists can form or be present at the same time as flammable vapours which can affect the way the flammable material disperses and the extent of any hazardous areas. The strict application of area classification for gases and vapours might not be appropriate because the flammability characteristics of mists are not always predictable. While it can be difficult to decide upon the type and extent of zones, the criteria applicable to gases and vapours will, in most cases, give a safe result. However, special consideration should always be given to the danger of ignition of flammable mists in the presence of hot surfaces. See [5.13.7](#).

Where equipment is located in an enclosure and ventilation is used to control the hazardous areas per IEC 60079-2, the area classification shall take into account the conditions when the ventilation is not present. Actions such as but not limited to de-energizing the electrical supplies or isolation and venting/de-pressurization of fuel and high pressure hydrocarbon systems or a higher level of equipment classification shall be initiated where necessary to remove the potential for a hazardous situation. The specific requirements from the classification of zones to the equipment of the different categories to avoid the applicable ignition sources described in EN 1127-1:2011, 6.4.

EN 1127-1:2011, Annex B, describes the relationships between categories and zones.

Hazardous area classification drawings shall be prepared in accordance with IEC 60079-10, 6.2.

5.16.3 Explosion prevention

The methods described in EN 1127-1 shall be used for the identification and assessment of the hazardous situations and the concepts and methodology for explosion prevention therein shall be applied. Remaining risks shall be assessed in accordance with ISO 12100, taking into account EN 1127-1:2011, Clause 5, and the methods described in EN 1127-1:2011, Clause 6, to eliminate or minimize risks and also all of EN IEC 60079-2 when using purge pressurization methods to eliminate or minimize risks in zone 2 areas and within the microturbine enclosure.

Where there is the potential for any significant quantity of hot gas or air to leak from the equipment casings and cause damage to ancillaries, controls, certified equipment, or safety devices, means shall be provided to prevent such an occurrence leading to a hazard.

5.16.4 Ignition source control

5.16.4.1 General

All equipment shall be designed and constructed so far as possible to prevent ignition sources that can occur during normal operation and reasonably foreseeable machinery fault conditions.

5.16.4.2 Electrical ignition sources

Electrical apparatus for explosive gas atmospheres, for the identified zone and category, shall comply with IEC 60079-0 and IEC 60079-14.

5.16.4.3 Non-electrical ignition sources

5.16.4.3.1 General

Non-electrical equipment used in potentially explosive atmospheres shall comply with the requirements of EN 13463-1 or shall be located in an area that meets the dilution ventilation requirements in [5.16.5.3](#).

5.16.4.3.2 Hot surface temperatures

Where the surface temperature exceeds the AIT (see [5.16.4.4](#)) of any flammable gas, vapour or mist leak that can impinge on the surface, additional measures shall be taken to prevent such leaks, not readily dispersible by any dilution ventilation airflow (see [5.17.5](#)), from contact with the surface.

5.16.4.4 Auto-ignition temperature data

Values of AIT from IEC/TR 60079-20, or otherwise from a verified source, shall be used. For mixtures, unless test data are available, the AIT of the component having the lowest AIT and present at a concentration of over 3 % (by volume) shall be used. If no relevant data are available, the AIT of relevant substances shall be measured in accordance with IEC 60079-4 as amended by IEC 60079-4-am:1995, or by another equivalent method.

An appropriate safety margin shall be applied to the value of the AIT where uncertainty exists due to the constituents of the gas, hot surface size and conditions, contact time, the potential for stagnant conditions, and any other foreseeable circumstances.

NOTE The capability of a heated surface to cause ignition of a potentially explosive atmosphere depends on the type and concentration of the particular substance in the mixture with air. This capability becomes greater with increasing temperature and increasing surface area. The temperature that triggers ignition depends on the size and shape of the heated body, on the concentration gradient in the vicinity of the surface, the contact time of the explosive atmosphere with the heated body and, to a certain extent, also on the surface material and the potential for catalytic reactions. Thus, for example, an explosive atmosphere can be ignited by surface temperatures lower than the AIT measured in accordance with IEC 60079-4 as amended by IEC 60079-4-am:1995, or by other equivalent methods. On the other hand, in the case of heated bodies with convex rather than concave surfaces, a higher surface temperature is necessary for ignition; the minimum ignition temperature increases, for example, with spheres or pipes as the diameter decreases. Likewise when an explosive atmosphere flows past heated surfaces, a higher surface temperature is normally necessary for ignition owing to the brief contact time.

5.16.5 Reduction of explosion effects in an enclosed space

5.16.5.1 General

If the measures described in [5.16.1](#) and [5.16.2](#) (area classification), [5.16.3](#) (explosion prevention), [5.16.4](#) (ignition source control), [5.13.4](#) (ventilation), [5.13.5](#) (gas detection), and [5.13.7](#) (mist detection) do not provide a sufficient level of safety for enclosed spaces, the additional measures described in [5.16.5.2](#) (explosion relief) and/or [5.16.5.3](#) (pressure resistant design) and/or [5.16.5.4](#) (suppression) shall be implemented.

5.16.5.2 Explosion relief

Where necessary in accordance with [5.16.5.1](#), explosion relief in accordance with EN 1127-1:2011 6.5.3, shall be implemented for an enclosed space. Relief panels shall be sized in accordance with NFPA 68.

The set point for the operation of relief panels shall be less than the internal overpressure that can cause any personnel access doors or maintenance panels to be forced open. Relief panels (if fitted) shall be retained by hinges or other mechanical means to prevent them from becoming loose missiles and so as to prevent injury to personnel during opening.

In the event of relief panel operation appropriate action shall be initiated. A microturbine trip shall occur when the relief panel is associated with the microturbine enclosure.

5.16.5.3 Explosion pressure resistant design

5.16.5.3.1 General

Where necessary in accordance with [5.16.5.1](#), an explosion pressure resistant design in accordance with EN 1127-1:2011, 6.5.2.2 shall be implemented for enclosed spaces based on the use of dilution ventilation and its validation in accordance with [5.16.5.3.2](#) and [5.16.5.3.3](#) to limit the overpressure from an explosion event such that the pressure is reduced to a level that is unlikely to cause personnel injury and is contained within the enclosed space.

5.16.5.3.2 Dilution ventilation

Dilution ventilation shall be applied to ensure that areas of stagnant or inadequate ventilation are minimized so that, in the event of a leak, the potentially explosive cloud is diluted by jet mixing with the surrounding air and the mixture is immediately and effectively removed by the ventilation. Explosive concentrations are therefore restricted to the mixing zone and its immediate vicinity, and shall be sufficiently small, as given in [5.16.5.3.3](#), relative to the size of the enclosure space that, in the event of ignition, the maximum overpressure from an explosion event is limited such that the pressure rise consequences are insignificant and safely contained. Thus, the effective distribution of ventilation is more important than its quantity, since high ventilation rates can preclude the detection of small leaks by detectors in the outlet ducts and can result in larger explosive clouds with significant consequences in the event of ignition. Dilution ventilation shall always be associated with the use of gas detectors since it is designed to dilute reasonably foreseeable leaks within a defined range.

Where necessary to achieve effective dilution ventilation, a combination of additional inlet positions, distribution ducts and distribution baffles can be used to direct the ventilation air flow to points of stagnation and re-circulation. Account shall be taken of the flow patterns at cold start-up and running when different thermal conditions exist.

5.16.5.3.3 Ventilation validation

Computational fluid dynamics (CFD) modelling or other quantifiable techniques shall be used to validate microturbine enclosure dilution ventilation in accordance with [5.16.5.3.2](#) to ensure adequate dilution of a limited release leak in an abnormal condition is achieved. The modelling shall show that the leak cloud volume at the 100 % LEL contour arising from the leak that can cause a microturbine trip based on gas detection trip settings in the ventilation outlet ducts, converted to an equivalent volume at stoichiometric concentration, shall be no larger than 0,1 % of the net volume of the enclosure. In all cases, the gas leak rate for the purposes of CFD shall show that in the unlikely event that a limited release leak in an abnormal condition should occur, the enclosure ventilation system is capable of diluting the limited release below the lower explosive limits within the enclosure.

The microturbine fuel system within the enclosure shall be evaluated for its limited release leak in an abnormal condition and the leak rate shall be used to establish the ventilation dilution safety factor which shall be applied to the system design which takes into account the following additional criteria; volume of the enclosure, the flow rate of the enclosure ventilation fan. The limited release leak rate for

the purposes of CFD or risk assessment shall be based on the criteria for reliable fuel system construction and limited release evaluation found in [5.23.8.1](#) and IEC 60079-2.

Where applicable computational fluid dynamics (CFD) modelling or other quantifiable techniques shall be used to validate the installation site/microturbine mechanical room dilution ventilation in accordance with [5.16.5.3.2](#) to ensure adequate dilution of a leak is achieved. The modelling shall show that the leak cloud volume at the 100 % LEL contour arising from the leak that can cause a microturbine trip based on gas detection trip settings in the ventilation outlet ducts, converted to an equivalent volume at stoichiometric concentration, shall be no larger than 0,1 % of the net volume of the enclosure. In all cases, the gas leak rate for the purposes of CFD shall be based on a hole size no smaller than 0,25 mm² and no larger than 25 mm² and the equivalent volume at stoichiometric concentration shall not exceed 1 m³. This criterion has been validated to show that, in the event of ignition, the overpressure created will not exceed 1 000 Pa (10 mbar). If the enclosure strength can be assessed to withstand an overpressure of up to 1 500 Pa (15 mbar), the criterion can be extrapolated to an envelope not exceeding 0,15 % of net volume and an overpressure of 1 500 Pa (15 mbar).

Prior to the completion of commissioning of each initial design, ventilation validation *in situ* measurements shall be undertaken to ensure that areas of stagnant or inadequate ventilation are minimized.

Where analysis shows that unacceptable gas clouds or concentrations that cannot be removed by other means can occur, additional appropriately located gas detectors shall be installed.

Measurements shall verify that the CFD model provides an acceptable representation of the air velocities and heat balance. Where necessary the CFD geometry and parameters shall be adjusted to obtain an acceptable match between the measurements taken and the CFD model output.

NOTE Additional guidance is given in HSL ECO/03/06, HSL CM/04/09, and HSL CM/03/12.

5.16.5.4 Explosion suppression

Explosion suppression systems prevent an explosion from attaining its maximum explosion pressure by rapidly injecting extinguishing agents into the equipment in the event of an explosion. Where necessary in accordance with [5.16.5.1](#), explosion suppression in accordance with EN 1127-1:2011, 6.5.4 shall be implemented for an enclosed space. In the event of activation, appropriate action including a microturbine trip shall be initiated.

5.17 Ventilation

5.17.1 General

Ventilation of enclosed spaces shall be provided to

- a) provide temperature control to ensure the intended operation of equipment is achieved, and
- b) control hazardous zones and promote the dilution of flammable gas, vapour, and mist leaks.

5.17.2 Cooling

Where the functionality of critical components and safety relevant equipment is dependant upon its use within its designed temperature range and alternative systems that are capable of keeping the equipment temperatures within the range, under all reasonably foreseeable operating conditions, are not installed, enclosure/installation site ventilation shall be used to provide an appropriate level of cooling or heating. See [5.17.3](#).

The effectiveness of the chosen solution to provide temperature control of equipment within its designed temperature range, under any reasonably foreseeable operating or fault condition, shall be validated.

5.17.3 Heating

Where ventilation air is heated to prevent icing conditions or heated where the functionality of critical components and safety relevant equipment is designed only for a specific temperature range and alternative systems that are capable of keeping the equipment temperatures above its minimum operating limit are not installed, the heating shall be by

- a) an electrical heater, appropriately certified as necessary, e.g. for use in a hazardous area, or
- b) an indirect heat source, the design of which ensures that flammable gases and vapour or any other substance that can create a hazardous situation do not enter the air stream.

Microturbine compressor delivery air can be used directly to provide heating when stable running conditions are achieved. The take-off point, controls and piping design shall prevent the occurrence of excess flow and the accumulation of unburnt hydrocarbons and shall reduce the potential for burnt/unburnt products of combustion to enter the inlet and cause a hazardous situation on flameout or microturbine compressor surge.

5.17.4 Hazardous area control

Where a hazardous area exists in an enclosed space, a partially enclosed space or an enclosure, ventilation shall be used to dilute potential leaks of flammable gases and vapours by dispersion into the air until their concentration is below the lower explosive limit. The degree (high, medium, low) and availability (good, fair, poor) of ventilation shall be assessed in accordance with IEC 60079-10 for the purpose of area classification. See also [5.16.2](#) and [5.16.5.3](#).

Areas of stagnant or poor ventilation, where recirculation and re-entrainment can arise, shall be minimized by ensuring that the ventilation is effectively distributed.

Where heavier-than-air flammable gases or vapours can be present in enclosures, artificial ventilation shall be used to ensure that any gas or vapour concentrations are effectively dispersed from low levels and shall be assessed in accordance with IEC 60079-2. Where there is the potential for vapours to migrate and accumulate in adjacent low level areas and trenches, precautions shall be taken (e.g. filling or sealing of trenches, additional gas detectors). The permit to work system shall include testing of the atmosphere prior to accessing any trench or low-level area.

5.17.5 Hot surfaces

Where hot surfaces exist or can exist under any reasonably foreseeable normal operating conditions in the hazardous zone that are above the AIT (see [5.16.4.4](#)) of a flammable gas, vapour or mist that can be present due to a leak, or where any other reasonably foreseeable conditions exist that indicates a residual risk of ignition, additional measures in accordance with [5.16.5](#) shall be implemented. The potential for hazardous leaks in enclosures containing hot surfaces shall be limited to secondary grades of release as defined in IEC 60079-10.

Where practical, the ventilation airflow direction shall be arranged so that any flammable leaks are directed away from hot surfaces.

5.17.6 Ventilation inlet location

The ventilation air should preferably be drawn from a non-hazardous area taking into account the suction effects on the surrounding area. Location in a zone 2 area shall be considered acceptable only where the largest credible leak is capable of being diluted by the ventilation air stream, during running conditions or natural ventilation when shutdown and reverse flow can occur, to such an extent that a hazardous situation cannot arise.

Where a zone 2 area exists, as described above, or the potential still exists for a potentially explosive atmosphere to enter the ventilation air inlet as described in [5.9.5](#) for the microturbine compressor air inlet, the actions described therein shall be taken for the ventilation inlet.

5.17.7 Ventilation inlet filtration

Where the potential exists for dusts or other forms of contaminant to enter the ventilation air inlet that can build up to form combustible deposits, especially on hot surfaces, or prevent the correct operation of safety equipment, suitable filtration shall be installed to prevent this build-up.

Where, due to the type of filtration used or environmental conditions, the potential exists for icing, suitable precautions shall be taken.

Where atmospheric pollution or environmental conditions exist (e.g. build-up of salt spray) that can affect the operation of safety devices within enclosures, appropriate filtration shall be supplied.

5.17.8 Ventilation inlet ducting

The ventilation inlet ducting shall normally be routed to avoid hazardous areas. Where this is not possible, the ducting integrity shall prevent unacceptable leaks.

5.17.9 Ventilation outlet location

The ventilation air outlet shall not be located in a zone 0 or 1 area. Location in a zone 2 area shall be considered acceptable only where the largest credible outdoor leak is capable of being diluted to such an extent by natural ventilation that the risk from reverse flow when the ventilation system is not operating is mitigated.

Account shall be taken of any hazardous area created by the ventilation outlet.

5.17.10 Flow monitoring — Artificial ventilation

Ventilation flow shall be monitored and interlocked to the start sequences of equipment so that the start-up is inhibited without sufficient ventilation and enclosure purging.

Means shall be provided to prevent a start-up with defective ventilation monitoring equipment.

During operation, if inadequate ventilation is detected, a shut-down shall be initiated within a safe period of time unless the supply is automatically restored from alternative fans or any alternative power supply. The shut-down period shall be as short as practicable and determined based on plant and application conditions and the presence of an existing alarm condition such that a hazardous situation is prevented. Where the concept of 5.16.5.3 has been applied, flow monitoring shall detect inadequate and excessive flow rates if excessive flow rates are possible due to design or installed equipment and are deemed necessary to ensure safe conditions.

If a gas leak that leads to a dangerous concentration is detected during the period before adequate levels of ventilation are reinstated, the microturbine shall be shut-down and the pressurized parts of the gas system within the enclosure vented.

Where a method is implemented to inhibit the ventilation flow monitoring to allow the opening of enclosure doors (e.g. for inspection), a suitable warning shall be repeated at the microturbine control panel until the monitoring has been restored.

5.18 Fans

5.18.1 Fan guards and structural failure

Guarding for fans shall be provided to eliminate the risk of entrapment or contact with moving parts. Guards shall comply with ISO 12499 and retain the fan blades in the event of failure. The design of the fan housing shall contain any failure of fan components.

NOTE Guidance is given in prEN 14461.

5.18.2 Air blast oil coolers

The design of the cooler shall include protection against foreseeable foreign objects impacting the fan blades and causing damage to the cooler with the potential for process fluid leakage and possible fire causing a hazardous situation. The design of the fan plenum shall contain any failure of fan components.

The location of the air blast cooler assembly shall be such that if leakage of the matrix occurs due to fan debris or other foreign matter, the potential for ignition is minimized.

5.19 Flammable gas detection

5.19.1 General

Detectors shall comply with IEC 60079-29-1.

5.19.2 Type/selection principles

Gas detector measuring principles and selection shall be based on the relevant requirements of IEC 60079-29-2, taking into account the potential for malfunction of the detector(s) due to pollutants/substances in the air stream.

5.19.3 Location principles

The location of fixed gas detectors shall be based on the criteria in IEC 60079-29-2:2007, Clause 8. Enclosed ventilated spaces containing gas fuel or liquid fuel with a flash point less than 55 °C shall be equipped with at least one gas detector located in the ventilation outlet. The location of the detector(s) in the outlet shall take account of the mixture concentration contours within the air stream to ensure detection is achieved.

NOTE The Institute of Petroleum Model Code of Safe Practice, Part 15, [Annex A](#), provides further guidance on vapours produced by liquid fuels at flash point temperatures.

When heavier-than-air gases are used as the main or alternative fuel, extra gas detectors shall be fitted at a low level in the enclosed space to detect any gas or fuel vapours that can have accumulated.

5.19.4 Settings

The lowest practical level shall be used for the gas detector settings for both alarm and trip, taking into account the need to avoid spurious signals. Adjustments shall be carried out in accordance with the manufacturer's manual. Settings shall be chosen in conjunction with the ability of the ventilation system to dilute potentially flammable gas and vapour leaks and shall be the subject of risk assessment.

The gas detector(s) in ventilation outlets shall be set to alarm at not more than 10 % LEL and trip at not more than 25 % LEL. Where gas is detected at the trip setting, the control system shall give an appropriate audible and visual warning and initiate a microturbine shut-down, and potential sources of leaks shall be isolated and vented. Gas detectors can also be installed at other locations; their alarm and trip settings shall be subject to risk assessment.

5.19.5 Enclosures containing hot surfaces — Screening tool

Where hot surfaces exist in an enclosure, as described in [5.17.5](#), a one dimensional jet model can be used as a preliminary screening tool to determine if the % LEL setting of a gas detector at an enclosure vent outlet, in conjunction with dilution ventilation, is likely to control the size of the explosive cloud arising from a detectable leak, the size of the leak cloud being compared with the enclosure size, such that in the event of ignition, the consequences of the pressure rise are insignificant and safely contained.

The screening calculation should be undertaken by comparing the volume of the cloud at the envelope defined by the 100 % LEL contour, and converted to an equivalent volume at stoichiometric concentration, with 0,1 % of the enclosure volume. Where the defined cloud volume is less than this proportion of the

enclosure volume, well distributed dilution ventilation is likely to ensure that the gas detector setting and design ventilation rate can allow the cloud volume to be controlled. However, such a method cannot take account of turbulence, ventilation direction, recirculation or the effect of obstacles, and should be used with caution. Jet leak impingement on a flat surface adjacent to the leak source might not be adequately diluted by normal ventilation velocities, while ventilation direction can reduce the cloud size by a large factor.

The effects of the dilution ventilation air flow on the size of the jet leak cloud shall always be validated in accordance with [5.16.5.3.3](#).

5.19.6 Maintenance and calibration

Maintenance and calibration procedures shall comply with [7.7.6](#) of this International Standard. The test gas used for calibration shall comply with the general requirements of IEC 60079-29-1:2007, 5.3.

The LEL levels shown in IEC/TR 60079-20 shall be used as datum values except where the major constituent is less than 90 % by volume, in which case specialist advice shall be obtained from the detector manufacturer with respect to an appropriate LEL value.

5.20 Control and automatic protection systems

5.20.1 General

Safety related control functions and the associated sensors, control logic and actuated devices (e.g. those for fuel isolation, fire detection, fire suppression, combustion supervision, gas detection, ventilation detection, overspeed detection and emergency stop) shall be identified and designed, tested, installed, commissioned and validated.

It is recommended to apply relevant standards such as IEC 61508-1, IEC 60730-1, and/or IEC 61511-1 and the appropriate normative references therein.

5.20.2 Environmental suitability

Protective systems shall be designed, selected and constructed such that they are capable of performing their intended function under all reasonably foreseeable environmental/operating conditions (e.g. voltages, humidity, vibration, contamination, UV exposure, pollution, climatic, and other external effects), taking into account the operating condition limits specified by component/equipment manufacturers.

Equipment parts used shall be appropriate to the intended mechanical and thermal stresses and capable of withstanding attack by existing or reasonably foreseeable aggressive substances.

Special consideration shall be given to the temperature capabilities of control devices, taking into account the effects of thermal radiation. This shall involve the completion of temperature surveys where any uncertainty exists.

Where a heating or air conditioning system is required to control the environment for the microturbine control module to ensure that the required level of functional safety is achieved, if power is lost to this system, automatic actions shall be taken to safeguard the microturbine control module.

5.20.3 Ergonomics

Ergonomic principles shall comply with ISO 12100:2010, 6.2.8.

The human-machine interface shall be easily read and interpreted by the operator from the control position and designed to rapidly display abnormal behaviour of the equipment.

5.20.4 Failure

The probability of failure of safety functions shall be minimized in accordance with the requirements of ISO 12100:2010, 6.2.12.

When the control signal is removed from a valve or control device that is essential for shut-down or continued operation with tolerable risk, the valve or device shall automatically move to its fail-safe position.

Where indicated by risk assessment, component redundancy or the fail-safe principle for electrical circuits shall be used to perform a safety function and provide the necessary SIL. See [5.2](#).

Measures shall be taken to ensure that errors in the control system logic do not lead to failure and create a hazardous situation. Control parameters shall not change in an uncontrolled way, where such change can lead to hazardous situations.

Reasonably foreseeable human error during operation shall not lead to failure and create a hazardous situation.

5.20.5 Calibration

Control systems shall be designed to allow calibration of safety related functions where applicable. If calibration is required to be performed while the engine is running it shall not lead to an interruption of operation or compromise the safety of the machine. See also [7.7.7](#).

5.20.6 Testing

As far as practicable control systems shall be designed to allow testing of safety functions with the engine stopped, and fuel isolated.

Where necessary to achieve the required level of integrity, the control system shall allow the in-service testing of functions during microturbine operation without allowing unprotected operation.

The safety functions shall be listed in the operation manual and the procedures for such testing shall be suitably described unless fully automated by the control system. See [7.7.7](#).

Safety related control systems shall be self-monitoring and self-diagnostic, where necessary, to achieve an acceptable level of reliability. Errors discovered shall be annunciated to the operator. Where operator action is required, it shall be clearly indicated on the control panel, and the action required shall be similarly indicated or described in the operation manual.

Functional tests shall be made during commissioning, after any intrusive maintenance or automatically before starting. The manufacturer shall recommend the frequency and extent. See [7.7.7](#).

5.20.7 Speed control

To provide protection against failure of the speed measurement or of the speed controller, an independent or fail-safe overspeed protection system shall be provided to limit the overspeed of each shaft by immediately tripping the fuel supply to the microturbine. The measurement range of the speed sensors shall be selected such that the measurement at the trip limit is still reliable and accurate.

Overspeed settings shall be determined by the microturbine and driven-unit suppliers. The setting shall exceed the speed resulting from sudden loss of maximum potential power with a margin that avoids spurious trips but does not result in overstressing of the rotating parts.

The overspeed protection system shall have in-built testing functionality, or provisions shall be made for the testing of all overspeed protection devices at intervals specified by the microturbine manufacturer.

Microturbines with separate power turbines or with heat exchangers can require additional protection against overspeed because of the stored heat, and/or large stored volumes of high pressure air. Protection measures such as but not limited to aerodynamic braking, air release valve(s) shall, where necessary by analysis, be utilized to prevent a hazardous situation.

For multiple rotor shaft engines, if it can be shown that it is not possible for a rotor to overspeed due to aerodynamic forces, an overspeed protection system is not required on that rotor.

5.20.8 Microturbine emergency shut-down system

A site emergency shut-down system shall be provided for the site installation. It shall be externally separate from the main microturbine control system, shall be capable of manual operation and shall be a back-up and not a substitute for other safeguarding measures. It shall also be operated automatically by safety related microturbine protection devices and any safety related process plant protection devices that affect the safe operation of the microturbine.

The control system shall be designed so that the external emergency shut-down system including the emergency stop buttons, trip not only the microturbine by acting on the site fuel shut-off valves to immediately cut off the fuel supply but also all associated equipment upstream and/or downstream if its continued operation can produce a hazard. Shut-down shall not be preventable after the command has been initiated.

The microturbine package or enclosure, as applicable, and the control panel shall be equipped with emergency stop buttons or an emergency stop button interface shall be provided for an installation site or machinery room within a building, appropriately located, clearly marked and directly accessible, which shall be active during normal and maintenance operations.

These buttons shall

- a) have clearly identifiable, clearly visible, and quickly accessible controls and require manual reset after operation,
- b) stop the microturbine and any associated equipment at risk as quickly as possible, without creating additional hazards, and
- c) not be part of a human-machine interface (HMI) (e.g. touch screen) display.

The action of the emergency stop shall set the driven equipment to a safety state commensurate with shut-down of the microturbine and shall override any other functions of the driven equipment and be available and operational at all times, regardless of the operating mode.

An audible warning shall be set off by any emergency stop. If an HMI is used, a message shall be displayed to indicate that the emergency stop has occurred.

Risk assessment shall determine the functions to be maintained in each case of emergency stop to minimize the consequences (e.g. in case of gas leakage detection, the ventilation system is maintained in action to purge the enclosure; in the event of fire the ventilation shall be shut-down and the fire dampers shall close to enable the fire to be extinguished).

An automatic re-start shall not be possible after an emergency stop without a manual intervention. Prior to a re-start a check by operating personnel shall be undertaken to ensure that the fault that initiated the shut-down has been resolved such that operation with a tolerable risk can proceed.

5.20.9 Interlocks

The control system shall provide interlocks that prevent engine start or ignition if this can result in unsafe conditions based on the current status of the systems. Interlocks shall be reset only after correction of the cause. The control system shall indicate which system has initiated the operation of an interlock.

5.21 Electrical

5.21.1 Design/Installation

Electrical components of system, drives, control systems, measuring and control devices, lighting and heating shall, where relevant, comply with IEC 60204-1, IEC 60364-1 and where applicable IEC 60079-14.

Hybrid power inverter system based microturbines shall comply with the relevant parts of IEC 62109-1, IEC 62109-2, and EN 50178.

NOTE National or local regulations can require different standards such as VDE-AR-N-4105, EN 50438, CEI-021, UL1741, and IEEE 1547, 1547.1 as requirements for the connection of micro-generators in parallel with public low-voltage distribution networks.

5.21.2 Isolation and stored energy

5.21.2.1 General

For maintenance and inspection purposes and in an emergency, means for energy isolation for electrical supplies ≤ 1 kV shall comply with IEC 60204-1:2009, 5.3. Isolating devices for supplies > 1 kV shall provide all-pole load disconnection and contact clearances shall be appropriate to ensure isolation.

Devices for the prevention of unexpected start-up shall comply with ISO 14118. Where necessary, local stop buttons shall be provided in accordance with IEC 60204-1:2009, 5.4. Where a hazardous situation cannot be created and where necessary, local stop buttons shall be provided in accordance with IEC 60204-1.

Where electrical isolation by a plug/socket combination under the immediate supervision of the person present in the danger zone is not possible, the isolation devices shall be capable of being locked or otherwise secured in the "isolated" position.

5.21.2.2 Isolation of electrical equipment in potentially hazardous areas

Isolation of other than intrinsically safe circuits shall comply with IEC 60079-17:2007, 4.8.1. Isolation of intrinsically safe circuits shall comply with IEC 60079-17:2007, 4.8.2.

5.21.2.3 Stored energy

Dissipation of stored energy for maintenance and inspection for supplies ≤ 1 kV shall comply with IEC 60204-1:2009, 6.2.4. Supplies greater than 1 kV shall have suitable earthing, bleed resistors or short circuit arrangements. Large capacitors for variable speed drives or other similar equipment shall have warning labels detailing instructions/times for safe discharge.

5.21.3 Electrostatic energy and bonding

5.21.3.1 Non-conducting parts

Non-conductive mechanical equipment parts exposed to the explosive atmosphere and susceptible to electrostatic charging shall comply with IEC/TR 61340-2-2 and IEC/TR 61340-2-3 and where applicable IEC 13463-1, EN 13463-1:2009, 7.4.

5.21.3.2 Conducting parts

Equipment shall be arranged so that dangerous electrical potential differences cannot exist. Bonding shall comply with the requirements in IEC 60204-1.

If there is a possibility of isolated metal parts becoming charged and acting as an ignition source or a risk to persons, then bonded terminals shall be provided and used to continuously dissipate the charge.

Where conductive parts are used for the conveyance of non-conductive fluids and gases and the continuity of conductivity is broken by the use of non-conducting flexible connection or by other means, terminals shall be provided at each side of the break and the parts bonded together, unless there is a valid need for the insulating section, such as to prevent circulating currents in generator bearings.

Shielded cables shall be used where necessary to prevent interference and signal degradation. Continuity of shields shall be ensured. At least one end of each shield shall be earthed.

NOTE For hazards associated with lube oil conductivity, see [5.24.1](#).

5.21.3.3 Stray electric currents

Activities (e.g. local arc welding) within the proximity of the equipment that can induce stray electrical currents leading to the potential for electrical discharge shall be restricted during operation. Where it is necessary to carry out essential arc welding work close to any zoned area, appropriate safeguards shall be taken (e.g. local earthing to ground).

5.21.4 Water ingress

Electrical enclosures shall be rated in accordance with IEC 60529 and be suitable for the environmental conditions in which they are operated. Ingress protection IP 54 shall be used as a minimum for outdoor conditions. In cases where water jets or compressed air are used for cleaning, a suitable higher category shall be used. Where applicable the enclosure shall also be rain tested for water intrusion in accordance with IEC 60068-2-18 during full power operation and in a standby state, after which a voltage test shall be conducted per IEC 62109-1 for inverters systems or IEC 60204-1 for synchronous generators. In cases where water jets or compressed air are used for cleaning, a suitable higher category shall be used. The means of introduction of a cable with its glands, bushings, etc., into an enclosure shall ensure that the degree of protection of the enclosure is not reduced. Cable connectors/glands, flexible conduits and fittings shall offer at least the same level of protection as defined for associated enclosures in accordance with IEC 60204-1 and where applicable IEC 62109-1.

5.21.5 Lightning

If risks due to lightning have been identified, risks shall be minimized in accordance with EN 1127-1:2011, 6.4.8. Over voltage protection shall comply with IEC 60204-1:2009, 7.9, and IEC 60204-11:2000, 7.4, if danger to electrical equipment caused by over voltage can be foreseen.

If the risks due to mains power line low level surge due to lightning has been identified, the system shall comply with IEC 61000-6-2 and IEC 61000-4-5. Where applicable the withstand verified per IEC 62109-1: 2010, 7.5.1

NOTE Further information on the design, installation, inspection, and maintenance of lightning protection systems (LPS) can be found in IEC 62305-1 The effects of lightning can be particularly hazardous to computer systems, regulation, or control systems, and power supplies and can lead to explosions, fire, or injury to persons.

5.21.6 Electromagnetic compatibility (EMC)

The equipment shall not generate electromagnetic disturbances above levels that are appropriate for its intended place of use. In addition, the equipment shall have an adequate level of immunity to electromagnetic disturbances so that it can operate correctly in its intended environment.

Electromagnetic emissions and immunity shall comply with IEC 61000-6-4 and IEC 61000-6-2 respectively.

Current Harmonics shall comply with IEC 61000-3-4 for systems greater than 75A or IEC 61000-3-12 for systems less than 75A if the system is connected to a public low voltage grid.

Voltage Harmonics in stand-alone inverter systems or synchronous generator systems shall comply with IEC 61000-3-6, IEC 60034-22.

Cables shall be installed with sufficient separation to avoid electromagnetic interference. This is normally provided by routing signal cables separately from power cables, and terminating them in separate junction boxes, where applicable.

Installations and earthing and cabling shall comply with the requirements of IEC/TR 61000-5-1 and IEC/TR 61000-5-2 respectively.

General disturbances can be limited by applying the measures in IEC 60204-1:2009, 4.4.2.

5.21.7 Battery installations

Battery room installations shall comply with IEC 62485-2:2010/EN 50272-2, Microturbine package installed battery packs shall comply with IEC 61982-2 if used for transient load power operations.

5.21.8 Electrical overload

Dangerous overloading of electrical equipment shall be prevented at the design stage by means of integrated measurement, regulation and control devices, such as over-current cut-off switches, temperature limiters, time-lag relays, overspeed monitors and/or similar monitoring devices.

Where, under reasonably foreseeable circumstances, there is the potential for circuit overloads in the equipment greater than the design limits, appropriate protection devices shall be installed in accordance with IEC 60204-1:2009, Clause 7.

5.21.9 Electrical power failure

5.21.9.1 System failures

Risk assessment shall be carried out to determine the consequences of power failure to the control system and safety devices and to identify the need for the provision of alternative power supplies such as independent feeds, standby generators or batteries.

If no alternative supply is provided, or if the alternative fails to become available, shut-down shall be achieved with a tolerable level of risk.

If a limited alternative supply is provided, the systems that it is to feed shall be identified so as to minimize the risks and avoid hazardous situations.

In the case of battery back-up systems, a shut-down shall be initiated before the remaining battery power becomes insufficient for a safe shut-down of the equipment.

5.21.9.2 Electrical power restoration

Following power failure, those systems that are automatically restored to operation shall be identified, and shall be designed so as to avoid hazardous situations.

5.22 Drains, vents, and bleeds

5.22.1 General

The hazards associated with drains and vents shall be determined and shall be specified for each interface point, together with the details of the type(s) of media, the mode of operation, and the flow rate and temperature. The details of any hazards shall include, but are not limited to, heavy metals, recycling, corrosion, fire and explosion risks, contact and/or inhalation of harmful fluids, gases, mists, fumes, and dust.

The base plate or foundation shall be designed to ease the collection of liquid and to retain the quantity of leaked liquids collected before the detection of the leak. The location of the drain point of the baseplate shall minimize the quantity of liquid retained after the drain operation.

All manual drain valves shall be easily accessible.

Microturbine package drains and vents shall terminate in safe locations.

The noise generated from vents shall be considered (see [5.7](#)).

5.22.2 Vents for flammable gases

Breathers from regulators or vents from vent valves and relief valves shall be terminated to atmosphere in an area without an ignition source. Protection against lightning shall be in accordance with 5.21.5. Special attention shall be given to ensuring that during running or shut-down gas cannot re-circulate into the microturbine compressor air inlet, the microturbine enclosure ventilation air inlet or outlet and at exhaust locations.

The hazardous area at the outlet point shall be suitably zoned in accordance with IEC 60079-10.

The design of the outlet shall be such that debris and any other potential foreign matter are prevented from entering the vent and arranged to achieve good dispersion taking into account the properties of the gas and anticipating any possible problems when venting from high pressures. The location of vent outlets shall not lead to hazardous areas impinging on other properties, i.e. those belonging to the public or a third party.

Vents shall be independently installed unless it can be shown that there is no potential for unsafe interaction between connected vents.

Where practical, the requirement for venting shall be minimized.

Manual valves shall not be used operationally on vent lines. Where used for maintenance purposes they shall be secured open in a tamper proof manner during operation. Welded pipes are recommended to avoid additional hazardous area classification around mechanical joints on vent lines.

5.22.3 Toxic and hazardous emissions

Means shall be provided to prevent the emission of hazardous substances from the machine in accordance with ISO 14123-1 or EN 626-1. Where the measures described in ISO 14123-1 or EN 626-1 cannot reduce the risk of toxic and hazardous emissions from vents or drains, additional precautions shall be taken to ensure that such emissions cannot reach a toxic or hazardous level that can cause unacceptable exposure levels.

Such measures might include, but are not limited to the following:

- a) increasing the height of vent outlets to provide dispersion to a tolerable level of risk;
- b) locating vent outlets in suitable areas where personnel access is normally prohibited;
- c) continually monitoring for toxic emissions at outlets in conjunction with the associated shut-downs and evacuation acoustic alarm and associated procedures;
- d) the use of coalescers for the removal of mist from vents.

5.22.4 Microturbine compressor bleeds

If local discharge of the bleeds can create a potentially hazardous situation they shall be piped/ducted to discharge to a safe location.

5.23 Pressure equipment

5.23.1 General

Pressure equipment (e.g. piping, vessels, integrated heat recovery pressure vessels, associated assemblies, and incorporated safety and pressure accessories) shall be designed and manufactured to comply with the applicable requirements in this International Standard and shall be tested and inspected

to remain leak tight and withstand the pressure and vibration that can be reasonably expected during its foreseeable lifetime.

NOTE Where temperature, temperature differences, thermal loads, containment, structural strength, stiffness or dynamic loads are the overriding design issues, microturbine equipment under pressure, such as casings, are excluded from the scope of the European Directive 97/23/EC, the Pressure Equipment Directive.

5.23.2 Design

The pressure equipment shall be designed taking into account all relevant factors to ensure that the equipment is safe throughout its intended life and shall incorporate appropriate safety factors to ensure that an adequate safety margin exists to guard against all relevant failure modes in a consistent manner.

Account shall be taken of the full range of reasonably foreseeable loadings, internal and/or external pressure, ambient and operating temperatures, mass of piping/vessel and contents, climate loads, dynamic effects of the fluid, potential movements of structures, vibrations, earthquakes, transportation, handling, fatigue, reaction forces, and applicable combinations of these loadings occurring simultaneously. The material, wall thickness, tensile strength, ductility, forming, joining, and test methods shall be suitable for the specific media and withstand the reasonably foreseeable loadings that can occur. Where necessary, adequate allowance or protection against wear, erosion, corrosion, chemical attack, and decomposition of unstable fluids shall be provided, taking due account of the intended and reasonably foreseeable use.

Adequate provisions shall be provided for inspection and testing, where appropriate.

5.23.3 Hazards

The pressure equipment selected shall

- a) eliminate or reduce hazards as far as is reasonably practical,
- b) apply appropriate protective measures to mitigate hazards that cannot be eliminated, or
- c) where appropriate, inform users of residual hazards and indicate whether it is necessary to take appropriate special measures to reduce the risks at the time of installation and/or use.

5.23.4 Misuse

Consideration shall be given to the potential misuse of the pressure equipment (e.g. use as a means of access, climbing on it, standing on it or for storage).

5.23.5 Safe handling and operation

Reasonably foreseeable risks associated with handling and operation shall be analysed and provision for appropriate precautions shall be made (e.g. fitting padlocks at manual valves that, if incorrectly operated, can cause a hazard, fitting blanking plugs or flanges at manual valves opened to vent or drain and monitoring the pressure and/or the temperature in the equipment prior to disassembly).

Devices containing loaded springs that can cause injury if accidentally released shall be designed such that the spring load can be reduced to below 110 N before the spring is disassembled. Otherwise they shall be suitably guarded.

5.23.6 Isolation, draining, and venting

Where applicable, adequate means shall be provided for draining and venting of the pressure equipment to permit cleaning, inspection, and maintenance with tolerable risk.

To avoid potential harmful effects (e.g. water hammer and vacuum collapse) all stages of operation and testing shall be considered.

Where required for safe maintenance and inspection purposes, devices shall be provided for isolation and the dissipation of fluid pressure.

5.23.7 Fluid injection

The hazard of fluid injection into the human body shall be minimized by

- a) ensuring that all high pressure piping in a position where it is likely to be damaged is protected, robust, and sufficiently supported,
- b) providing shielding (e.g. screens) to flexible piping installed adjacent to an operator's assigned working position to reduce the risk resulting from a failure in the flexible piping system where failure could cause harm to persons.

5.23.8 Assemblies

5.23.8.1 General

Assemblies shall be so designed that the components to be assembled together are suitable and reliable for their duty and are properly integrated and assembled in an appropriate manner.

Assemblies shall be designed to prevent velocity and pressure fluctuations causing harmful oscillations in the system (e.g. by pressure regulation, correct pipe sizing, firm supporting, and/or flexible couplings).

Piping, valves, pumps, etc. shall be arranged to minimize the number of vent connections required to prevent the formation of air or gas pockets in liquids that can cause unsafe operating conditions.

All piping, pipe fittings, passages, surge or storage tanks and cored or drilled holes shall be free from burrs or foreign matter that can cause damage to a system or lead to a dangerous situation.

Control valves and other control components requiring inspection or maintenance shall be mounted in positions that provide accessibility and avoid damage.

Where proprietary tube fittings are used, component parts from different manufacturers shall not be intermixed within a single fitting. Counter rotating (left hand and right hand) threads shall not be used on the same assembly where there is the potential for uncontrolled pressure release.

Tube fittings from different manufactures shall not be mixed on an assembly.

The fuel system design shall be evaluated by the following methods.

- a) Inspection of fuel system design for - No normal release, limited abnormal release

A fuel system design which meets the requirements for "No normal release, limited abnormal release" containment and comprises metallic pipes, tubes or elements such as Bourdon tubes, bellows or spirals, with joints not subject to disconnection during routine maintenance and made with pipe threads, welding, eutectic methods, or metallic compression fittings shall be considered to have no normal release but limited abnormal release.

NOTE Rotating or sliding joints, flanged joints, elastomeric seals not evaluated for the intended fuel application and non-metallic flexible tubing do not satisfy this criterion.

- b) Pressure testing of prototype (pre-production) fuel system design shall be conducted per [5.10.3](#) as evidence of a reliable fuel system design for production.

- c) The application of national and international pressure piping standards

NOTE It is recommended to apply relevant standards such as ISO 15469, EN 13480, ASME B31.1, and ASME B31.3 and the appropriate normative references therein.

5.23.8.2 Pressure control and overpressure protection

Where there is the potential for exceeding the allowable pressure limits, the equipment shall be protected by instrumentation, pressure limiting devices, and control or relief valves.

Adjustment of over-pressure protection devices shall be possible only with the use of an appropriate tool.

Safety devices shall be monitored as necessary and safe shut-down shall occur where abnormal deviations are detected.

5.23.8.3 Particulate contamination

The ingress of particles that can be detrimental to the safety of the equipment shall be prevented (e.g. by the incorporation of a suitable filter or strainer).

Filters and strainers shall be positioned in such a way that periodic servicing remains easy.

Transparent bowls for filters or strainers (e.g. glass, plastic) shall be protected to prevent injury from flying particles if failure occurs.

5.23.8.4 Filling and drainage

A safe means of filling or draining systems or parts of systems during commissioning, maintenance and de-commissioning shall be provided.

5.23.8.5 Accumulators

The release of stored energy shall not lead to dangerous situations. Preferably, accumulators shall be automatically and completely discharged when the respective system is shut-down. Where this is not possible or practical, a tolerable level of risk shall be achieved by other means.

5.23.8.6 Quick release connections

Where quick release connectors are used, they shall be of the self-sealing type to prevent leakage and ingress of foreign particles and shall be of the type that prevents opening while under pressure. Consideration shall be given to the risk of incorrect reconnection if flexible lines are used; quick connects shall not be the same on different services.

5.23.8.7 Pumps

The system downstream of a positive displacement pump shall be equipped with a relief device if the system can be blocked or closed. The relief fluid shall be piped to a suitable location where the backpressure does not allow the system design pressure to be exceeded under reasonably foreseeable conditions.

Where centrifugal pumps are used as a pressure source, relief devices need not be supplied provided the design of the associated piping and flanges is based on the maximum supply pressure and providing that excessive overheating cannot occur.

If there is the potential for leakage at a pump drive shaft seal that can cause contamination of other media and lead to a hazardous situation, the pump shall be fitted with double seals with the space between the seals suitably drained or vented or be fitted with other suitable measures.

Where relief or spill valve flow is returned to the pump suction, the design shall be such that the credible flow shall not be capable of causing overheating with the potential for cavitation and vapour lock.

The relief device shall be adjusted in accordance with the supplier's instructions to prevent bursting of the pump casing or downstream piping if a malfunction occurs that prevents pump flow.

5.23.9 Safety accessories

5.23.9.1 General

Safety accessories are devices designed to protect pressure equipment against exceeding the allowable limits. Safety accessories shall

- a) be designed and constructed so as to be reliable and suitable for their intended duty and take into account the maintenance and testing requirements of the devices, where applicable,
- b) be independent of other functions, unless their safety function cannot be affected by such other functions, and
- c) comply with appropriate design principles to obtain suitable and reliable protection and shall be designed so that, in the case of failure, a tolerable risk level is maintained until shut-down is achieved.

5.23.9.2 Pressure limiting devices

Pressurized systems, if the risk of over-pressure exists, shall be fitted with pressure limiting devices designed to provide pressure release or to otherwise limit pressure if the system's design maximum working pressure is exceeded. A momentary pressure surge is allowed if this does not result in a dangerous condition.

5.23.9.3 Thermal safety

Where hazardous excess pressure can occur in the pipework system due to thermal expansion of the liquid or gas, means of pressure relief shall be provided.

Where thermal pressure relief valves are used on pressure equipment, the outlet from the thermal relief valve shall be piped to a suitable drain where the backpressure does not allow the system design pressure to be exceeded under reasonably foreseeable conditions.

Where a high or low temperature of the liquid or gas can occur and cause a hazard, the temperature shall be monitored and, if the design limits are exceeded, the microturbine shall be shut-down with a tolerable level of risk.

5.23.10 Flexible piping (and metal hoses)

Flexible piping shall

- a) be as short as practicable consistent with proper bend radii and routing and without being distorted to a deformed shape or stretched in a manner that causes inappropriate permanent tension,
- b) be mounted in such a way as to avoid distortion, uncontrolled movement and damage during pressurization,
- c) withstand the maximum vibration levels that can be imposed by the equipment,
- d) have integral end fittings that allow replacement or maintenance and that enable the connections to be held in position and tightened without the risk of torsional stress being applied to the flexible section, and
- e) be routed and retained so that it is unlikely that they can be used as handholds or footsteps.

Where there is a possibility of unacceptable hazards arising from leakage onto hot surfaces from flexible pipes, additional precautions shall be taken (e.g. by appropriate higher specification, guarding or routing the pipe away from the hot surface).

Flexible pipes for gas systems shall be of corrugated stainless steel or be of a non-metallic construction having a fire-resistant surface.

Corrugated stainless steel hoses shall not be used where there is the potential for the entrapment of liquids and contaminants, e.g. within the corrugations or within any inner liner, if unacceptable risk exists.

A maintenance schedule and end of service life recommendation for flexible piping shall be included in the microturbine maintenance instructions (see 7.7.4).

NOTE It is recommended to apply relevant standards such as ISO 10280, EN 982, EN 983, or ASTM F1120 and the appropriate normative references therein.

5.23.11 External fire

Where the potential exists for pressure equipment to be subjected to external fire, appropriate protective measures shall be taken to minimize risks in the event of leakage.

5.23.12 Material embrittlement and corrosion

Where, under reasonably foreseeable circumstances, equipment can contain gas or other media under pressure that can be contaminated, with the potential for causing embrittlement of the pressure containing parts, materials that provide a tolerable level of resistance to cracking shall be selected.

Attention shall be given to the potential for accelerated embrittlement where contaminants can interact to accelerate the corrosion process (e.g. the presence of hydrogen sulfide with trace contaminants of mercury).

NOTE ISO 15156-1:2001 provides guidance on the selection of materials resistant to stress corrosion cracking in the presence of hydrogen sulfide at different levels of contamination, pressures, and temperatures.

Measures shall be taken to monitor temperatures and pressures to ensure that they are within the ranges that were used for the selection of a given material.

Consideration shall be given to drying and heating gases to reduce the potential for the presence of liquids with the potential to cause corrosion and thereby mitigate the potential for material failure.

5.23.13 Ultraviolet (UV) resistant pipework

Non-metallic hoses and pipework shall not be used where strong concentrations of UV light can occur, with the potential for premature degradation of the material.

5.24 Auxiliary systems

5.24.1 Lubrication systems

The lubrication oil system shall fulfil the requirements for oil flow, pressure and temperature required by the microturbine. Loss of pressure and temperature control functions that can lead to a dangerous situation shall be detected so that shut-down with a tolerable risk can be achieved.

If an external seal air supply is necessary, on microturbine shut-down, to prevent the internal leakage of oil from the microturbine bearings to areas of high temperature within the microturbine section core which could create a fire risk, the specification of the seal air supply shall be such that the supply is maintained under all reasonably foreseeable circumstances for a period that allows the internal microturbine section surfaces likely to be in contact with the oil to cool below a temperature at which ignition can take place.

Where a fan assisted coalescer is used for mist removal, and a hazardous situation can arise from an increase in back pressure, a bypass or other measures shall be taken to reduce the back pressure to the design limit.

Electrostatic charging and the formation of sparks in the lube oil system which can lead to a dangerous condition shall be prevented by sufficient electrical conductivity of the oil or by appropriate system parts, in particular, in relation to isolated conductors and non-conductive parts, such as filter elements.

5.24.2 Water systems

Where water systems (e.g. wash, injection, evaporative cooling, air inlet direct water mist spray, and fire protection) are located where there is the risk of freezing, measures shall be taken to avoid equipment failure. Such measures can include

- a) the use of an appropriate anti-freeze additive,
- b) trace heating of exposed equipment and pipe work with associated thermal insulation, and
- c) the use of suitable methods to prevent freezing of fluids in drain tanks where the lack of drainage can induce a hazard.

Solvents used to enhance the properties of the wash fluid during online microturbine compressor cleaning and anti-freeze additives shall be selected so that a mixture capable of ignition or of producing a rapid increase in microturbine combustion temperatures is not used. Off-line microturbine compressor washing utilizing solvents and anti-freeze shall be followed by a flushing, drying, and purging cycle to ensure that no harmful or combustible deposits remain.

The quality of water used for microturbine compressor air inlet evaporation cooling or direct water mist injection, microturbine compressor water wash, primary or secondary water injection and the source for steam injection shall be controlled such that the total contaminants entering the microturbine shall not impair the life of components, leading to premature failure and a potentially hazardous situation.

5.24.3 Hydraulic and pneumatic systems

Hydraulic and pneumatic systems shall comply with the safety requirements of ISO 4413:1998, 4.3, and ISO 4414:1998, 4.3, respectively.

5.24.4 Utility supplies

Utility supplies shall be filtered and have any undesirable condensate removed to avoid causing malfunction of the supplied equipment.

Instrument utility supply pressure shall be monitored at a point close to the service. The effects of changes in the condition of the utility supply to equipment shall be subject to risk assessment. On the loss of a utility supply, safety equipment shall either permit continued safe operation or shall fail to a safe condition.

Undesirable changes in the pressure of a utility supply shall cause an alarm condition. If the pressure change can cause a potential hazard, the safety devices shall cause shut-down of the equipment. Where it is necessary to maintain pressure to achieve shut-down with a tolerable risk accumulators shall be included in the system.

5.25 Installation in a hazardous area

Hazardous areas shall be classified in zones in accordance with [5.16.2](#).

Microturbine installations in zones 0 and 1 areas shall be prohibited. Where the microturbine is arranged in a ventilated enclosure within a zone 2 area, risk assessment shall take into account the reasonably foreseeable risk. See IEC 60079-2 for purge pressurization for additional requirements of zone 2 area ventilated enclosures.

Installations in zone 2 areas shall comply with the following.

- a) Hazardous area equipment within the zone shall comply with [5.16.4](#). The equipment shall comply with the requirements of the more hazardous substance inside or outside the enclosure.

NOTE Guidance is given in IEC 60079-10, 4.3, Note 2.

- b) The requirements of IEC 60079-10, 4.4, with respect to extent of zone shall be taken into account.

- c) If within the zone 2 area, the microturbine compressor air inlet shall comply with [5.9.5](#) and the ventilation air inlet shall comply with [5.17.6](#).
- d) Access within the microturbine enclosure shall be in accordance with the requirements of [7.6.6](#).
- e) The measures for the prevention of the ignition of flammable gas, vapour or mist on hot surfaces external to the microturbine enclosure within the zone 2 area, as well as in the enclosure, shall comply with [5.16.4.3.2](#).
- f) Where the microturbine exhaust temperature exceeds 80 % of the AIT, in degrees Celsius, of any flammable gas, vapour or mist that can be present, it shall discharge to a safe area taking wind effects into account.

NOTE Based on a site risk assessment, gas detectors can be required at the perimeter of external zoned areas to initiate a microturbine shut-down if an unacceptable detection level occurs. This might not be part of the packagers supply.

5.26 Unenclosed microturbines in a mechanical room

Hazardous area classification shall be in accordance with [5.16](#). Zone 0 areas and continuous grades of release in accordance with IEC 60079-10 shall not be permitted in the microturbine mechanical room.

Any surface temperatures exceeding the AIT of the hazardous gas, vapour or mist that can be present in a zoned area shall be reviewed by risk assessment and suitable mitigation shall be applied. Risk assessment shall take into account the size of the mechanical room and the areas of occupancy with respect to the potential for the ignition of a flammable mixture from a leak source and the possible harm to personnel in the vicinity of the explosion. Where appropriate the techniques described in [5.16.5.3.2](#) and [5.16.5.3.3](#) shall be employed in conjunction with appropriate access restrictions.

Any zone 1 areas in the hall shall be limited to the extent arising from reasonably foreseeable release rates that will be diluted by the ventilation to a defined zone that shall not encroach on any equipment not suitably certified or on any surface temperatures that exceed 80 % of the AIT, in degrees Celsius, of any flammable gas, vapour, or mist that can be present in the zoned area.

The microturbine mechanical room shall be fitted with

- a) a fire detection and extinguishant system in accordance with [5.15](#),
- b) a non-asphyxiant based extinguishant system, or entry to the mechanical room shall be interlocked with isolation of the extinguishant, where personnel access to the hall is required during operation, and
- c) a ventilation system assessed in accordance with IEC 60079-10.

Where the potential for an explosive atmosphere exists due to a leak of a flammable gas or vapour, the mechanical room shall be fitted with a gas detection system in accordance with [5.19](#), but taking into account the need to locate detectors in the vicinity of potential leak sources, credible leak sizes, and the effect of ventilation, and the different conditions when starting cold and running hot. Open path detectors shall be considered for this application.

NOTE See HSL report CM/03/12 for further information.

5.27 Decommissioning and disposal

Microturbine installations being decommissioned shall be rendered unable to start by at least two methods, such as, for example, removal of starter motive power, removal of control circuit fuses, blinding fuel supply, removal of fuel control valve or, disabling the control program.

All systems shall be isolated, tagged, and logged. Preservation methods consistent with the future expected use of the engine and systems should be implemented. Noxious or toxic fluids and materials shall be disposed of in a manner approved by the local authority.

6 Compliance verification

6.1 Quality assurance

Quality assurance shall be achieved by the manufacturer using a recognized quality standard (e.g. ISO 9001:2000).

Design and construction data (e.g. design calculations, engineering drawings), test data, quality control records and records of hazard and operability studies (HAZOPS) and risk assessments shall be kept by the OEM for the equipment life, where there is a legal duty, or otherwise for at least 10 years from the date of supply.

6.2 Verification of safety requirements

Compliance with safety requirements shall be verified in accordance with [Annex B](#).

6.3 Certification markings

CE declaration mark shall be provided for products sold in the European Union or countries that have adopted the EU directives. The declaration of conformity should be written in accordance with ISO 17050-1.

A certification listing mark to a national safety standard from a Nationally Recognized Test Laboratory (NRTL) can be required for North America or countries that have adopted the North American safety standards.

6.4 Electrical output ratings verification

6.4.1 Voltage and frequency

- a) The output voltage shall comply with IEC 60204-1 4.3.2 and 4.3.3 or 4.3.4.
- b) AC output frequency shall comply with IEC 60204-1 4.3.2.

NOTE Synchronise generators are subject to the same tolerances as hybrid inverter based systems for output ratings.

6.4.2 Harmonic Distortion Requirements

Current Harmonics shall comply with the requirements of IEC 61000-3-4:1998 for systems greater than 75A or IEC 61000-3-12:2004 for systems less than 75A if the system is connected to a public low voltage grid.

Voltage Harmonics in stand-alone inverter systems or synchronous generator systems shall comply with the requirements of IEC 61000-3-6.

NOTE National or local regulations can require different standards such as UL1741, UL2200, and IEEE 1547, 1547.1.

6.5 Electrical ratings for microturbine system

Details of the ac output of a unit shall have the following ratings:

- a) Voltage;
- b) Frequency;
- c) Number of phases except for a unit intended for single-phase only;
- d) Amperes volt-amperes, or watts;

- e) Power factor, when less than unity unless the rating is expressed in:
 - 1) Watts and volt-amperes, or
 - 2) Watts and amperes;
- f) RPM;
- g) Insulation system class;
- h) Rated ambient temperature or rated temperature rise.

The electrical rating of a unit shall include the following:

- a) the electrical rating for a 3-phase generator that is limited to either a delta or wye connection shall indicate the phase configuration;
- b) the electrical rating for a generator having a 3-phase output or a single-phase output with a neutral conductor shall indicate the unbalanced load capability of the generator.

6.6 Marking of microturbine system

All markings shall be permanent, that is, either by being moulded, die-stamped, paint-stenciled; stamped or etched metal that is permanently secured; or indelibly stamped on a pressure-sensitive label secured by adhesive that is suitable for the application. A nameplate giving the following information shall be attached to the enclosure adjacent to each incoming supply/output.

Contents of the marking shall be plainly and permanently marked where it is readily visible, after installation, with the following:

- a) the manufacturer's name, trademark, or other descriptive marking by which the organization responsible for the generator is identified;
- b) a distinctive catalogue number or the equivalent and serial number when required;
- c) the electrical ratings specified in 6.5;
- d) the date or other dating period of manufacture not exceeding any three consecutive months;
- e) the enclosure ingress and weather protection code per [5.13.1](#) and [5.21.4](#);
- f) the equipment's minimum and maximum thermal operating range.

NOTE 1 Exception: The manufacturer's identification is not prohibited from being in a traceable code when the unit is identified by the brand or trademark owned by a private labelling reseller.

NOTE 2 Exception: The date of manufacture is not prohibited from being abbreviated, or being in a nationally accepted conventional code, or in a code affirmed by the manufacturer, when the code

- a) does not repeat in less than 20 years;
- b) does not require reference to the production records of the manufacturer to determine when the unit was manufactured.

7 Information for use

7.1 General

Final suppliers shall be responsible for the assembly of safety documentation within their scope of supply, including manuals, drawings, and diagrams that shall be passed to the user before responsibility for their respective installations is passed to the user. Suppliers shall supply the information and recommendations for the transportation, storage, installation, maintenance, operation, and training

necessary to reduce the health and safety risks and the environmental risks in accordance with ISO 14001 or equivalent to a tolerable level.

Manuals and documentation can be provided in whole or part in electronic format.

Sales literature describing the machinery shall be consistent with the information for use with regards to health and safety. Sales literature describing the performance characteristics of machinery shall contain the same information on emissions as is contained in the information for use.

7.2 Language

Safety related documentation shall be drawn up in the base language selected by the OEM from which any translations are developed and comply with ISO 12100.

Safety related documentation shall be issued in the language agreed with the purchaser and/or other languages demanded by local legislation. By way of derogation from this requirement, the maintenance manuals and commissioning documentation for use by specialist personnel need only be available in a single language understood by those personnel.

7.3 Packaging

Where the microturbine engine and electronics are being integrated and packaged by a third party, or other combinations are adopted for the supply of the finished product, the appropriate safety related documentation and manuals shall be supplied along the supply chain to ensure that a tolerable level of safety is achieved. This shall be achieved by the supply of technical documentation and manuals that define the interfaces, their functions and the actions being taken with respect to safety for the engine and electronics modules as the design and assembly progresses through the supply train. Where applicable, documentation shall also include information relating to residual risks necessary for risk assessments undertaken by the product integrator or by the operator.

7.4 Commissioning

Commissioning documentation, which supplements other manuals where additional information is necessary for the commissioning of safety devices and their associated functions, shall be available. The documentation shall include details of checks that shall be undertaken on the equipment, safety devices and associated control system functions prior to first microturbine start-up, including checks that the control-system parameters applicable to safety functions are correctly adjusted/set. Changes made during commissioning shall be within criteria that have been validated to allow non-hazardous operation.

Loop checks, including resistance to earth and continuity, shall be carried out for each applicable safety device including, where applicable, calibration of the device. Where a device is still within its calibration period, this can be carried out by simulation of the device output. Where use is made of distributed networked controls and the loops have been validated at the manufacturer's works for both the devices and the controls and the equipment is within calibration, the loop check can be replaced by a communications check. Power supplies for safety devices, including those supplied and installed by the operator, shall be checked to ensure that the voltage and current supplied and protection and isolation of the circuit are in accordance with the documentation.

The documentation shall include details of bonding, earthing, and shielding checks that shall be undertaken with respect to safety devices and associated wiring where the devices are susceptible to static electricity or electrical interference. The documentation shall include details of bonding and earthing checks that shall be undertaken on mechanical equipment with flowing media or that is otherwise subject to the build up of static electricity that can affect the operation of safety devices, lead to ignition in a hazardous area or cause static shocks to personnel.

The documentation shall designate the piping connections to all safety related supply, vent, and drain lines and tanks and shall state that during the commissioning process, these shall be checked for proper function and, where necessary, that the associated flow rates, pressures and temperatures are within limits and that associated safety devices, pressure equipment assemblies and locking devices are

correctly installed and calibrated and function correctly. Checks shall include verification that each gas vent has the opening required by the design (this can include a restriction orifice), that it has been correctly connected to the relief system or atmosphere and has been terminated in a safe location with respect to any hazardous zones.

The documentation shall state that hazardous areas shall be reviewed by the operator to ensure that, where applicable, equipment is correctly certified for the zone and that zones are not compromised by such hazards as gas vents, other sources of potentially explosive leakage or hot surfaces.

The documentation shall include the necessary checks to verify that site installed fire protection equipment has been assembled and located correctly. This shall include checks that pressurized extinguishant and propellant bottles are located such that overheating will not occur and burst disc debris and discharges are directed to a safe location. Where an extinguishant discharge test is required after installation, the documentation shall include the procedure to be adopted and the safety precautions to be taken, including those where the test is undertaken from running conditions and any post-test inspections that can be required.

Pre-start checks (cold commissioning) shall include exercising of valves and other devices that are part of a safety function and checking that the equipment is correctly mounted and aligned. Where applicable, running tests shall be undertaken to verify that the safety devices are operating correctly.

Where X-rays or gamma rays are used for inspection, diagnostics, or calibration, the documentation shall include precautions to be taken to protect personnel and sensitive equipment from harm.

The documentation shall state that for starting systems having common starting capabilities for multiple units, proper electrical and mechanical interlocks shall be tested prior to commissioning in order to avoid starting the wrong microturbine.

7.5 Operation

7.5.1 General

A manual shall be provided to enable the equipment to be operated with tolerable risk. This shall identify any conditions that impose limitations on the usage of the equipment and any procedures required before and after defined periods of shut-down.

The manual shall contain a description of each section of the equipment, its function and safe operating criteria, the associated safety devices and interlocks, and safety check procedures and any limitations on use. The description shall include, where applicable, the operating sequences of equipment during start-up, changes in operation and shut-down, the locations of emergency stop devices, and methods for tracing and eliminating minor faults.

The manual shall contain instructions for the checking of safety related devices and inspections and setting checks that shall be undertaken while the equipment is in use.

The manual shall identify any site specific reasonably foreseeable environmental conditions that can effect the safe operation of the equipment and the associated corrective actions.

The control system section of the manual shall describe the function of the control system, the equipment operating concept and modes, and how the annunciation of start, operation, and shut-down sequences, the machine status and fault conditions are arranged and displayed. The manual shall include a description of any start-up warning devices, hold-to-run devices and how the machine will react after the actuation of safety devices. Where a message requires operator intervention, the actions required shall be clearly indicated or described in the manual. The manual shall describe any actions that shall be taken before accepting an alarm condition and before resetting after a trip.

Where manual intervention is required for testing of the safety functions and devices during normal operation the periodicity and the actions required shall be described in the manual.

7.5.2 Safety instructions and emergency procedures

The manual shall contain safety instructions required to ensure that the machinery is operated safely under reasonably foreseeable operating conditions and actions to be taken in the event of a reasonably foreseeable emergency and warning against any potential misuse of the equipment.

Where required by local legislation, a declaration shall be provided detailing the airborne noise emission based upon measurements made using the method defined in ISO 10494. The declaration shall comply with ISO 4871.

The manual shall contain warnings and refer to material safety data sheets (MSDS) for all hazardous substances/additives approved for normal use during operation of the machine and shall clearly specify any particular working practices and personal protective equipment (PPE) that are necessary to ensure their safe use, including details of acceptable cleaning solutions and of safe working practices during their handling and use. Additionally, the manual shall contain information detailing the correct use of the machine to prevent exposure of the operator to harmful substances and any biological hazards. The manual shall provide limitations on the use of flammable anti-freeze agents during microturbine compressor washing.

NOTE The operator is responsible for keeping the MSDS updated.

The manual shall instruct that regular checks for leaks are undertaken during scheduled and unscheduled maintenance on exhaust ducting and exhaust flexibles where these are routed through a building where leakage can lead to asphyxiation of personnel in or passing through the building (see 5.12.3). A description of the characteristics of any vents, exhausts or drains for hazardous and noxious substances shall be included. Where the potential exists for contact with or inhalation of toxic gases, the manual shall contain information on the use of portable gas detectors in conjunction with site procedures to cope with any leakage.

The manual shall include instructions on the actions taken by the operators in the event of a gas or mist detector alarm where fitted. Where automatic or manual processes exist to change the ventilation rate on the detection of a leak, the process shall be described in the manual together with details of the effects of its use on the gas or mist detection equipment. If more than one detector is provided, the manual shall include instructions on the interpretation of each detector reading. The manual shall also include the actions and precautions to be taken to locate and eliminate the source of a leak, including details of the equipment to be used, and limitations on access when a leak is known to be present. Where the incorrect operation of manual drain or vent valves can cause a hazardous situation, the manual shall contain clear instructions on their operation.

Hot surfaces in hazardous areas shall be maintained free of contaminants that can ignite or contaminants that can affect the ignition characteristics of the surface.

The manual shall include instructions on the action taken by the operators in the event of fire detection, for both fire detected automatically and fire detected by the operators, and details of any additional actions associated with manual release of the fire extinguishant at the extinguishant containers. Where manual actuation of the emergency release is required at the extinguishant containers, the operating manual shall advise that the emergency stop button shall be activated to cut off the fuel supply. The manual shall also take account of the risks in the opening of enclosure doors after extinguishant discharge, including those associated with the inrush of air and the potential for re-ignition or explosion.

The manual shall include details of all actions required for system replenishment after extinguishant release, including any inspection and maintenance procedures that shall be followed to ensure that subsequent operation is achieved successfully.

The manual shall contain warnings and precautions that shall be taken where there is the potential for discharge of extinguishant from inadvertent operation of UV or other similar detectors from external interference.

The manual shall include instructions on how to confirm the integrity of the equipment for subsequent operation with tolerable risk after any emergency shut-down.

The manual shall include instructions covering any necessary inspection, stabilization, and re-setting actions that shall be taken prior to a microturbine restart in the event that a turbine compressor surge event has occurred.

7.6 Enclosure access

7.6.1 General

The manual shall provide instructions covering access to the microturbine and all other enclosures during operation, maintenance, and commissioning based on the requirements shown in [7.6.2](#), [7.6.3](#), [7.6.4](#), and [7.6.5](#), including that prior to entry to any enclosure protected by a fire suppressant system capable of asphyxiation or other hazards, the release of the suppressant shall be mechanically isolated and locked off. Electrical isolation can be permitted for short-term entry in large spaces with easy means of egress where this cannot be overridden by manual release. In confined spaces, mechanical isolation shall be applied.

The manual shall contain instructions for the safe opening of machinery enclosure doors and/or panels ventilated by positive pressure to prevent impact hazards and the safe closure of negatively ventilated machinery enclosure doors to prevent crushing hazards, and shall state that enclosure doors and/or panels shall be correctly closed after maintenance, or any other opening of the doors and/or panels, to obtain the correct integrity of any enclosure protected by an extinguishant gas.

The manual shall contain instructions on the conditions required for access, taking into account the internal conditions such as noise levels, presence of any hazardous gas, electrical hazards, internal temperature levels, and temperature distribution.

The manual shall include guidance, where appropriate, on the use of an additional person who shall be present external to the enclosure to monitor activities and take any emergency action if a hazardous situation arises. Where the enclosure is large enough to allow access of people and the enclosure door is closed, the additional person shall monitor activities from a position local to the door with line of sight to the activity being undertaken. The additional person shall have mechanisms and means to monitor personnel within the enclosure. Where line of sight cannot be achieved, other methods shall be used to enable an alarm to be raised if an incident occurs.

7.6.2 Risk assessment for accessing enclosures

Conditions for opening of the enclosure doors and/or panels and any subsequent entry or access to the enclosure shall be under the control of a written PTW (permit to work) system or procedure provided by the OEM which shall also detail PPE suitable for the given task. This procedure shall include a risk assessment that takes into account at least: changes in the ventilation airflow, the presence of flammable leaks, the risk of ignition, entrapment, slips, trips and falls, thermal and noise hazards, egress restriction in the surrounding area, potential for doors to freeze closed during access, and lighting. An additional person can be required to be present during access in accordance with [7.9](#).

Where access in the enclosure is being undertaken, no egress restrictions shall be in place in the surrounding areas. Where emergency lighting is not provided, entry shall not be undertaken unless natural ambient lighting provides adequate visibility for exit or uninterruptible temporary lighting is installed.

7.6.3 Limitations under operational conditions

Access to the microturbine enclosure followed by door closure shall be prohibited under running conditions, unless access routes are provided for routine maintenance activities and adequate methods of escape exist, with provision for opening enclosure doors against ventilation loads. Access shall be permitted only when steady-state running conditions have been established and no alarm condition exists that can escalate into a hazardous situation or where other reasonably foreseeable or planned changes in operation can occur. The small variations that occur during normal running are not considered to increase risk.

7.6.4 Limitations under non-operational conditions

A section of the manual shall address conditions for access to the microturbine enclosure under non-operational conditions. The microturbine and other machinery appropriate to the task to be undertaken shall be interlocked from starting. Pressurized systems applicable to work to be undertaken shall be depressurized/vented and appropriately isolated.

Where access under non-operational conditions is necessary followed by closure of the enclosure doors, the availability of lighting within the enclosure shall be ensured through the availability of permanent or temporary emergency lighting. Where such access is undertaken with the ventilation system operational and with ventilation loads on enclosure doors, additional precautions shall be taken (e.g. ventilation control from within the enclosure, radio communication) to prevent entrapment of personnel.

7.6.5 Access during commissioning and re-commissioning

Where special access is necessary during initial commissioning or re-commissioning after overhaul or modification, such access shall be undertaken only by appropriately qualified and experienced personnel and shall be detailed in the associated commissioning documentation and for enclosures large enough to contain people, shall be supported by a written procedure provided by the OEM or PTW in accordance with [7.9](#).

7.6.6 Installations in a hazardous area

See [5.25](#). In addition to the requirements of [7.6.1](#) to [7.6.5](#) access to microturbine enclosures within hazardous areas shall be prevented during turbine operation and after shut-down unless at least one of the following conditions is fulfilled:

- a) hot surfaces have cooled to below 80 % of the AIT, in degrees Celsius, of any potentially explosive atmosphere;
- b) gas detectors are in use for checking presence of hazardous atmospheres at the point of entry and procedures are in place should a hazardous atmosphere occur during access.

7.7 Maintenance

7.7.1 General

The manual shall include all of the instructions necessary for maintaining the reliable operation of safety equipment for its intended life. It shall include the replacement of parts whose life is limited by operating hours/cycles. Due consideration shall be taken with regards to the fragility, reliability, and the importance of the device. See also [5.3](#) regarding modifications and replacement parts.

Where applicable to ensure reliable and safe operation, the manual shall contain instructions detailing the sampling of fluids and information on the need for replacement. Lubricating and hydraulic oil analysis shall be undertaken at defined periods to ensure that deterioration in their properties, which could lead to a hazardous situation, has not taken place.

The manual shall identify the appropriate safeguards that shall be taken to enable maintenance activities to be carried out safely including the use of special tooling and fixtures. Safeguards shall cover, where applicable, the hazards arising from microturbine rotating components (e.g. rotor windmilling), variable geometry and similar mechanisms during maintenance, adjustment, and inspection. The use of any devices or lifting equipment to prevent unexpected movement and instability shall be included with recommendations on PTW, isolation and tagging procedures, and the posting of warning signs. Where applicable guidance on the use of method statements shall be given where the potential for crushing, entrapment or other hazards exist while moving equipment.

The manual shall specify all special tools required for the adjustment of safety devices.

7.7.2 General maintenance hazards

The manual shall include the precautions required where there is the potential for spark generation in a hazardous area while maintenance work is being carried out, including the shut-off and venting of supplies and checks for the presence of gases prior to and during any work. The provisions to prevent spark generation in the manual shall comply with EN 13463-1.

Where necessary to avoid specific hazards, the manual shall include instructions for the removal and replacement of any guards without damage to components and the necessary isolation procedures to prevent unexpected movement of the guarded equipment, including instructions that guards shall be replaced and, where applicable, correctly sealed before the machine is re-started.

The manual shall detail the acceptable methods for cleaning equipment and shall clearly state if water jets and/or compressed air can be used for cleaning and detail any applicable safeguards.

Additionally, clear instructions shall be provided in the maintenance manuals to ensure adequate understanding of the criticality of the parts, and the correct installation methods.

7.7.3 Accessibility, isolation, and energy dissipation

The manual shall include guidance on safe access including the requirement for temporary access platforms required to ensure that the maintenance activity can be executed with tolerable risk. Where the activity is at an elevated level the guidance shall include the precautions to be taken against falling objects.

The manual shall describe the safe means provided for the isolation of non-electrical supplies, for the release or depressurization of any stored energy and warning of the risks associated with work on non-purged equipment and the additional safeguards that shall be employed (also see 7.8). Diagrams shall be provided showing all valves and other equipment provided specifically for the purpose of the isolation of fluids.

The manual shall describe the means provided for electrical supply isolation, earthing and short-circuit protection, the method of testing, and their proper use for maintenance and repair. Diagrams shall be provided showing all the devices provided specifically for the isolation of electrical supplies. Where maintenance is necessary on energized devices, the manual shall include guidance on the methods to be used and supervision, and shall state that before action on the ignition system, variable speed drive controls, or other controls that store dangerous levels of electrical energy, there shall be a wait period to allow the discharge resistances to reduce the energy stored to a non-hazardous level.

The manual shall describe the devices to prevent unexpected start-up or movement, those for the isolation and dissipation of stored energy and their use during microturbine maintenance and repair as shown in 5.21.2.

Inspection of the lightning protection system shall be undertaken after a known lightning strike.

7.7.4 Pressure equipment

The manual shall contain instructions for the inspection and maintenance of pressure equipment to maintain integrity including checking/testing the operation of pressure control and relief devices and the periodicity at which the activities shall be undertaken. The instructions shall include checks for wear, erosion, abrasion, corrosion, or material degradation where required for continued use with tolerable risk. The manual shall include inspection procedures and change-out periods for flexible pipes, diaphragms and other parts subject to deterioration from continued movement where failure can create a hazardous situation.

The manual shall contain instructions to allow the non-hazardous dismantling of pressure equipment and pipework, including but not limited to the venting/drainage of any residual pressure, any purging required to create an inert atmosphere and associated isolation and blanking. It shall also contain instructions on how to verify the leak tightness of equipment including pressure testing after re-assembly and the precautions taken during testing, including the use of PPE and the risks of asphyxiation from leakage of oxygen-depleting gases used for test purposes. Instructions, where necessary, shall be included for safe filling after assembly and verification of leak tightness.

Where pressure testing is not practical (e.g. between the last fuel shut-off valve and the combustion burners), the manual shall contain alternative procedures to verify that all connects are leak tight. Where indicated as necessary by risk assessment this shall include pressure testing with dummy fittings prior to making final connections.

7.7.5 Fire protection systems

The manual shall include inspection programmes and maintenance instructions for the total system and its components. The programme shall include the inspection intervals for the different parts of the system such that faults are detected at an early stage to allow rectification before the system can have to operate. Where the system includes fire dampers and their associated controls these shall be included in the inspection programme. The programme shall include periodic functional checks that the equipment operates correctly. Non-standard tools required for the maintenance of the fire protection system shall be identified and should be offered as an option.

7.7.6 Gas detectors

The manual shall include guidance on the maintenance and calibration details for gas detectors in accordance with IEC 60079-29-2:2007, Clause 11, including normal calibration intervals based on the type of detector and its location/usage. The instructions shall include guidance on the test and neutral gases to be used and, where applicable, the required flow rate, the LEL settings used and their relevance to the associated hazard.

The manual shall specify actions taken where calibration checks show changes in reading accuracy that can allow an unacceptable gas concentration to arise. Such action can include shortening of the calibration interval or replacement of the sensor or sensing element. The maintenance procedures shall include verification that the signal from the gas detector gives the correct measurement at the control equipment and that the correct actions are initiated at the set alarm and trip levels.

The use of aerosols, and especially the use of silicone oil mists, shall not be permitted within, and in the vicinity of, the enclosures as they lead to an undetected poisoning of the catalysts such that the safety function of the detection system is ruined without the operators being aware. Maintenance instructions shall include this prohibition.

7.7.7 Control systems: maintenance, calibration, and testing

The manual shall include details of the safety related controls and associated equipment that require functional checks, maintenance, calibration, or testing at specified intervals so that the safety integrity level of the safety functions are ensured, including those functions that can be calibrated or tested when the engine is running, together with details of any precautions necessary to avoid any hazard arising from the operation of the controls during maintenance. Where applicable the checks shall include a functional test of the safety systems, including safety devices and sensors that verify that the control system reacts correctly to the input signals. Calibration shall be completed during commissioning, after any relevant intrusive maintenance, and at intervals specified by the manufacturer based on the usage of the relevant equipment that ensures the said equipment shall remain within its specified working tolerance.

The manual shall instruct that overspeed protection device(s) shall be subjected to a manual or automatically simulated test/software selfcheck test, that can possibly interrupt the normal operation in a safe manner, at an interval that validates its functional safety.

Where trend monitoring techniques are utilized to alleviate the need for maintenance activities, these shall be subject to etailed review to ensure that a tolerable level of risk is achieved throughout the foreseeable lifetime of the equipment. The criteria for the safe use of the trend data shall be included in the manual.

7.7.8 Hazardous materials

The manual shall contain warnings and details by referring to material safety data sheets (MSDS) for all hazardous substances approved for use during maintenance of the machine and identify any hazardous materials, biological hazards or hazards generated by materials and substances (and their constituents)

used or exhausted by the machinery that can be encountered during maintenance and shall clearly specify any particular working practices and PPE that are necessary during all maintenance operations.

Where toxic fuels are used which can leave harmful residues after purging or drainage the manual shall contain instructions for the non-hazardous handling and maintenance of equipment that can become contaminated. The manual shall identify any devices or instruments that need to be provided by the operator, which are considered necessary to detect any hazardous substances or environmental conditions.

7.8 Warning signs and notices

Machines shall be provided with markings in accordance with ISO 12100:2010, 6.4.4. Visual danger signs, nameplates, markings, and identification plates shall be of sufficient durability to withstand the physical environment involved.

Where access is required to a space when there is the potential for entrapment or where other hazards can exist a warning sign supplemented, if necessary, with text and/or an information sign shall be placed at the point of entry or, if not enclosed, shall be appropriately marked with colour or with fences. Where the space is protected by a fire extinguishant gas that can cause asphyxiation if released the warning sign, supplemented with advisory text, shall be placed in a prominent position covering each point of entry. The text shall advise of the risk of automatic extinguishant release, the need for isolation prior to entry and any safety instructions following a fire shut-down where an inrush of air can create the conditions for re-ignition of an extinguished fire. A warning sign shall be placed at each point of manual release indicating that extinguishant release will occur on activation.

Where additional risk mitigation is required with respect to the opening doors and/or panels in enclosures with positive or negative pressure artificial ventilation, warning signs shall be positioned at the point of entry.

A warning sign shall be placed at the entry to all areas containing potentially explosive atmospheres. This can be in the form of a hazard warning sign with the letters "Ex" in the triangle or a standard hazard warning sign supplemented by the appropriate text. The solution chosen shall comply with local legislation in the country where the product is put to use.

Where parts or assemblies have to be handled with the aid of lifting equipment during operation and maintenance, the mass shall be marked on the part or assembly to be lifted or referenced on documents included in/with the manuals.

Where appropriate, warning signs used as protection against hot surfaces shall include a warning against high temperature and the emission of radiated heat by combining the pictograms for temperature and for the emission of heat by radiation.

Where the considerations in [5.7](#) or any other requirements show a need for personal ear protection, a mandatory warning sign shall be posted at the entries to the area.

Where detailed documentation is not included in the manuals to allow the identification of piping or a piping section and the associated system to which it belongs, the piping as installed shall be marked by painting, lettering, tagging, etc. From the markings, it shall be possible to identify the system to which the piping belongs.

Warning signs shall be placed at points where toxic emissions can occur.

The location of warning/safety signs and notices shall be documented.

7.9 Permit to work (PTW)

The operation and/or maintenance manual shall contain guidance on the use of a written PTW system and that such a system is used for activities carried out in hazardous areas, confined spaces, on pressurized equipment, and where supply isolation is required to allow safe working. The manual shall state that it is the responsibility of the operator to issue a written procedure provided by the OEM or PTW system and that such work be undertaken by competent and trained persons who fully understand

the risks involved and, where necessary, the requirement for a second person to be present who shall maintain close communication during the operation concerned.

7.10 Training

Details of the training necessary for personnel involved in the operation, maintenance, and commissioning of safety equipment covered by this International Standard shall be available. This shall include the use of PPE, the functioning of safety devices, their interaction with the controls, the actions that follow an alarm and trip level being activated, and any subsequent actions that shall be taken.

IEC 60079-17 and IEC 60079-19:1993 shall be used for guidance on the inspection, maintenance, and repair requirements for equipment in hazardous areas.

7.11 Decommissioning and disposal

Where required by the end operator, documentation shall include guidance to render the equipment inoperative and guidance on safe decommissioning and disposal of hazardous substances based on the instructions contained in ISO 14123-1 or EN 626-1:1996.

STANDARDSISO.COM : Click to view the full PDF of ISO 19372:2015