
**Guidelines for in-service inspections
for primary coolant circuit
components of light water reactors —**

**Part 5:
Eddy current testing of steam
generator heating tubes**

*Lignes directrices pour les contrôles périodiques des composants du
circuit primaire des réacteurs à eau légère —*

*Partie 5: Essai de tuyaux de chauffage pour générateurs de vapeur
par courant de Foucault*

STANDARDSISO.COM : Click to view the full PDF of ISO 20890-5:2020



STANDARDSISO.COM : Click to view the full PDF of ISO 20890-5:2020



COPYRIGHT PROTECTED DOCUMENT

© ISO 2020

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	iv
1 Scope	1
2 Normative references	1
3 Terms and definitions	2
4 Inspection technique	3
4.1 Preliminary remark	3
4.2 General	4
4.3 Standard technique	4
4.3.1 Multiple frequency technique with internal bobbin probe in differential arrangement	4
4.3.2 Linking the signals of multiple frequencies with internal bobbin probe in differential arrangement (mixed technique)	5
4.3.3 Multifrequency system with internal bobbin probe in absolute arrangement	5
4.4 Inspection techniques for more extensive analyses	5
5 Requirements	6
5.1 Test personnel	6
5.1.1 Task of NDT personnel	6
5.1.2 Personnel requirements	6
5.2 Steam generator heating tubes	7
5.3 Eddy current test equipment	8
5.3.1 General	8
5.3.2 Test robot	8
5.3.3 Eddy current test system	9
5.3.4 Assistant analysis system	10
5.4 Data storage medium	11
6 Testing	11
6.1 General	11
6.2 Preparations	11
6.3 Implementation	11
6.3.1 General	11
6.3.2 Data acquisition	12
6.3.3 Data analysis	13
6.4 Final measures	15
7 Recording	15
7.1 Test record and test report	15
7.2 Indication list	15
7.3 Findings record	15
Annex A (informative) General test procedure	17
Bibliography	19

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see the following URL: www.iso.org/iso/foreword.html.

This document was prepared by ISO/TC 85, *Nuclear energy, nuclear technologies, and radiological protection*, Subcommittee SC 6, *Reactor technology*.

A list of all parts in the ISO 20890 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Guidelines for in-service inspections for primary coolant circuit components of light water reactors —

Part 5: Eddy current testing of steam generator heating tubes

1 Scope

This document gives guidelines for pre-service inspection (PSI) and in-service inspections (ISI) by eddy current tests on non-ferromagnetic steam generator heating tubes of light water reactors, whereby the test is carried out using mechanised test equipment outwards from the tube inner side.

An in-service eddy current test of steam generator heating tube plugs as a component of the primary circuit is not an object of this document. Owing to the different embodiments of steam generator heating tube plugs, the use of specially adapted test systems to be qualified is necessary.

Test systems for the localisation of inhomogeneities (surface) and requirements for test personnel, test devices, the preparation of test and device systems, the implementation of the testing as well as the recording are defined.

NOTE Data concerning the test section, test extent, inspection period, inspection interval and evaluation of indications is defined in the nuclear safety standards.

It is recommended that the technical specifications are based on experience on U-tube bends with even bend radius (similar to the S/KWU design). To test other kind of tube bends (e.g. U-tube bends with two 90° bends) further qualifications will be provided.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 8596, *Ophthalmic optics — Visual acuity testing — Standard and clinical optotypes and their presentation*

ISO 9712:2012, *Non-destructive testing — Qualification and certification of NDT personnel*

ISO 12718, *Non-destructive testing — Eddy current testing — Vocabulary*

ISO 15548-1, *Non-destructive testing — Equipment for eddy current examination — Part 1: Instrument characteristics and verification*

ISO 15548-2, *Non-destructive testing — Equipment for eddy current examination — Part 2: Probe characteristics and verification*

ISO 15548-3, *Non-destructive testing — Equipment for eddy current examination — Part 3: System characteristics and verification*

ISO 15549, *Non-destructive testing — Eddy current testing — General principles*

ISO 18490, *Non-destructive testing — Evaluation of vision acuity of NDT personnel*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 12718 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

3.1 analysis system
<eddy current testing> test system that is used with scanning sensors or segment sensors at steam generator heating tubes for more precise characterisation of *indications* (3.2)

3.2 indication
representation or signal from a discontinuity in the format allowed by the NDT method used

[SOURCE: ISO/TS 18173:2005, 2.14]

Note 1 to entry: Signal that is initiated by operationally induced damage mechanisms, geometrical as well as material or design induced influences.

3.3 evaluation
assessment (3.5) of *indications* (3.2) revealed by NDT against a predefined level

Note 1 to entry: Inspection of the recorded signals in respect to completeness and analysis capacity, localisation and registration of indications according to defined criteria, representation of the test results.

[SOURCE: EN 1330-2:1998, 2.10]

3.4 basic frequency
test frequency that is used primarily for the localisation and analysis of indications in the standard technique

3.5 assessment
comparison of the analysed measuring data with specified criteria

3.6 form indication
signal that is caused by geometrically induced influences

3.7 calibration
<eddy current testing> determination of the interrelation between the output measured data of the eddy current test device and the associated *indications* (3.2), resulting from definite reference defects at reference specimens

3.8 calibration block
<eddy current testing> piece of material of specified composition, surface finish, heat treatment and geometric form, by means of which *eddy current test equipment* (3.15) can be assessed and calibrated

[SOURCE: ISO 5577:2017, 5.4.1]

3.9**test supervisor**

responsible for application of the test method and for the individual details of the test implementation including monitoring of the activities for preparation and implementation of the test as well as analysis of the test results

3.10**test sensitivity**

change to the initial variable of the *eddy current test system* (3.15) (amplitude/phase), in relation to the change in the underlying input variable (e.g. wall thickness attenuation)

3.11**probe**

body containing exciter elements (e.g. coils) and measuring elements

3.12**standard technique**

<eddy current testing> test system that is carried out with internal coaxial probes (3.11) with coaxial coils at steam generator heating tubes

3.13**interference signals**

signals that impede the detection and analysis of indications

3.14**reference block**

<eddy current testing> block of material representative of the material to be tested with similar electromagnetic properties containing well-defined artificial discontinuities, used to adjust the sensitivity and/or time base of the *eddy current test equipment* (3.15) in order to compare detected discontinuity indications (3.2) with those arising from the known artificial discontinuities

Note 1 to entry: Specified metallurgical, geometrical and dimensional characteristics means for example material, weld seam implementation, form, wall thickness with reference characteristics (e.g. notches, drill holes) that are adapted to the test assignment.

[SOURCE: ISO 5577:2017, 5.4.2]

3.15**eddy current test equipment**

eddy current test system, test robot and its measured data logging as well as the analysis unit including software

4 Inspection technique**4.1 Preliminary remark**

The suitability of the inspection technique and the test device system shall be validated corresponding to the requirements of the applicable regulations of the nuclear safety standard.

NOTE The procedure for the qualification is described in ENIQ report nr. 31^[4].

A general test procedure shall be prepared. [Annex A](#) contains the items of the general test procedure.

A calibration procedure can be agreed between the contract partner and shall be documented.

4.2 General

During the eddy current testing of steam generator heating tubes, it is the task of the evaluation to differentiate the recorded signals according to

- operational indications (location, expansion and possibly their type, e.g. cracks, abrasions, dents),
- geometric indications (e.g. of structural parts such as spacers, tube bottom, rolled-in slugs), and
- other indications (e.g. of local fluctuations in the electrical conductivity and permeability, electrical interference, wobble effect of the probes, impurities on the inside or outside of the tube, production indications as well as any external parts present).

To attain a sufficiently accurate reproduction of the signal sequence, the spatial resolution shall be set so that the required spatial resolution is ensured by the selected sampling rate and the probe speed.

The probe speed shall be dependent on the base frequency and sample rate and shall be no faster than the speed required to obtain a clear signal from the reference standard through-wall hole, within the calibration limitations described in [6.3.3.2](#).

The following inspection technique can be used for the eddy current testing of steam generator heating tubes as part of the standard technique:

- Multiple frequency technique with internal bobbin probe (differential arrangement, see [4.3.1](#); absolute arrangement, see [4.3.3](#));
- Linking of the signals of multiple frequencies with internal bobbin probe in differential arrangement (see [4.3.2](#)).

If the standard technique is inadequate for evaluation of the eddy current signals, eddy current techniques for more extensive evaluation (see [4.4](#) for additional techniques, e.g. rotating scanning probes, matrix probes with T/R technique) or other non-destructive testing methods (e.g. ultrasonic testing, visual inspection) shall be applied.

Supplementary to the standard technique, eddy current techniques for more extensive analyses can also be used as localisation systems in case of specific requirements (e.g. testing in the area of tube bottom/roll-in slugs).

4.3 Standard technique

4.3.1 Multiple frequency technique with internal bobbin probe in differential arrangement

4.3.1.1 Basic frequency

The total tube circumference is recorded integrally when testing with an internal coaxial probe. The extension of indication can therefore only be determined in the axial direction. In the undisturbed area, evaluation of the signals of a frequency for determining location, depth and axial extension of an operational change is sufficient.

If indications overlap (e.g. operational indications and form indications), a statement is generally only possible with restrictions. The multifrequency technique shall then be used in the mix (linking of multiple frequencies) (see [4.3.2](#)).

When testing operationally indications, the test frequencies used are generally in the range from 10 kHz to 1 MHz. The basic frequency shall be selected so that the phase offset angle between a 20 % flat-bottom hole applied on the outside of a reference specimen and a through-wall drilled hole is in the range from 90° to 120°.

4.3.1.2 Comparison between the signals of several individual frequencies with internal bobbin probe

If indications occur, further frequencies can be used for the differentiation of interference signals and operationally indications in addition to the basic frequency. The individual frequencies shall be selected so that a significant phase offset angle is reached between indications and interference signals.

4.3.2 Linking the signals of multiple frequencies with internal bobbin probe in differential arrangement (mixed technique)

4.3.2.1 General

Two to four frequencies are used generally for this inspection technique.

Linking the signals of multiple frequencies (mix) allows a quantitative analysis of operationally indications even when indications with interference signals overlap. However, the test sensitivity (fault detectability) generally declines for areas in which the evaluation is conducted in the mix.

The following two mixes shall be used as a minimum:

- 2-frequency mix for the area of the spacers and the area of the tube bottom;
- 3-frequency mix for the area of tube bottom with tube expansion (roll-in).

4.3.2.2 Two-frequency mix

The frequencies shall be selected so that the interference signals of all structural parts (e.g. spacers, corrugated iron, and oscillation limiters) are suppressed. The phase offset angle between a wall thickness weakening of 20 % applied on the outside of a reference specimen and a wall penetrating reference fault shall be in the range from 80° to 100°.

4.3.2.3 Three-frequency mix

The frequencies shall be selected so that the interference signals of rolling and tube bend upper edges or support plates and “pilger effects” are suppressed simultaneously. In addition, the mix phase offset angle for wall thickness weakening applied to the outside of a reference specimen of 60 % and 20 % shall exhibit a difference of minimum 40°.

4.3.3 Multifrequency system with internal bobbin probe in absolute arrangement

In contrast to the multiple frequency technique in differential arrangement, the absolute arrangement serves for localising and evaluating flat incident indications with large extension in the axial direction (e.g. large area abrasion in the area of tube bends) or for determining the sedimentation level in the area above the tube bottom.

4.4 Inspection techniques for more extensive analyses

To supplement the standard inspection technique, probes are specifically used for the analysis of already localised operational indications. These probes serve for characterisation of the indications in respect to

- circumferential expansion,
- longitudinal expansion,
- determining the number of indications both in the longitudinal and circumferential direction,
- indication orientation, and
- indication type.

Here a detailed determination of the indication position in relation to structural parts can be made. Owing to the smaller coil length of coverage, the smaller zone of interaction or the width of coverage, the test sensitivity is increased in the longitudinal direction and in the circumferential direction (i.e. in the entire range of the tube circumference). The multiple frequency technique is usually used here in the same way as the standard inspection technique. The following are typically used as analysis probes:

- Rotating scanning probes;
- Segmentcoils;
- Matrix probes (array probes).

The following clauses in this document define the requirements for the standard inspection techniques and shall be applied correspondingly to the analysis techniques used. Special requirements for the analysis techniques require separate definition.

5 Requirements

5.1 Test personnel

5.1.1 Task of NDT personnel

NDT personnel^[4] have a great responsibility, not only with respect to their employers or contractors but also under the rules of good workmanship. The NDT personnel may be independent and free from economic influences with regard to his test results, otherwise the results are compromised. The NDT personnel shall be aware of the importance of his signature and the consequences of incorrect test results for safety, health and environment. Under legal aspects, the falsification of certificates is an offence and judged according to the national legal regulations. A tester may find himself in a conflicting situation about his findings with his employer, the responsible authorities or legal requirements.

Finally, the NDT personnel is responsible for all interpretations of test results carrying his signature. NDT personnel should never sign test reports beyond their certification (see [Table 1](#)).

NOTE For reasons of readability, the male form is used with personal names, however the female form is also always intended.

5.1.2 Personnel requirements

The test personnel comprise operating personnel for test robots, operating personnel for eddy current test devices and analysts as well as the test supervisor.

Those personnel, using qualified non-destructive testing (NDT) procedures and equipment, should be qualified through one or any combination of the following:

- certification through a national NDT personnel certification scheme;
- theoretical and/or open trials;
- blind trials.

Any personnel certification requirements invoking relevant national NDT personnel certification schemes (e.g. ISO 9712) should be validated according to [Table 1](#). Any additional personnel training requirements should also be specified in the qualification dossier.

If no relevant scheme exists or if extra personnel qualification is needed, the qualification body should determine the additional practical and theoretical examinations needed beyond those in the national certification scheme, include these in the qualification procedure and ensure that the NDT procedure also includes the necessary requirements. The qualification procedure should describe the proposed system.

The test supervisor is responsible for the application of the NDT qualified system and shall have the knowledge required for his tasks as well as sufficient knowledge of the application options and limits of the test methods and have knowledge about the characteristic appearances of operationally induced defects. Indications beyond the evaluation limit shall be evaluated by the test supervisor, who has the requisite experience in respect to the test object, test assignment, test method and device system.

The operating personnel for test robots and eddy current test devices shall be trained for the special requirements of the work to be performed. In particular, they shall have adequate experience in the implementation of eddy current tests and knowledge about the test object in respect to this testing.

The analysts shall be trained for the special requirements of the work to be performed and have experience in the analysis and evaluation of indications as well as knowledge of the test object and the characteristic appearance of indications.

Test personnel performing NDT and the evaluation of the results shall be qualified in accordance with ISO 9712 or equivalent at an appropriate level in the relevant industrial sector.

Table 1 — Minimum requirements for the test personnel

Test personnel	Qualification
Operating personnel for test robots	Validation by training
Operating personnel for eddy current test devices	Certified with at least level 2 according to ISO 9712 or comparable qualification
Analysts	Certified with at least level 2 according to ISO 9712 or comparable qualification
Test supervisor	Certified with level 3 according to ISO 9712

The test personnel shall fulfil the vision requirements of ISO 9712:2012, 7.4

The test personnel shall provide annual validation of their visual ability, which has been determined by an ophthalmologist, ophthalmic optician or other medically recognised person. The vision requirements of ISO 9712 shall be fulfilled. The following modifications can be used as a substitute to ISO 9712.

- a) The visual acuity testing shall be conducted using standard symbols in accordance with ISO 8596 (Landolt rings) or ISO 18490 (E shaped character). Here a near vision acuity of 1,0 at a test distance of 0,33 m with at least one eye, with or without optical aid shall be validated.
- b) The ability to distinguish between colours and between grey shadowing shall be validated with colour sense test boards. The validation can typically be conducted with the help of Ishihara colour boards as well as the "shades of grey test". In case of anomalies, the employer shall decide whether the ability to see colours is sufficient for the test assignment.

5.2 Steam generator heating tubes

The internal surfaces of the steam generator heating tubes shall be in a state that allows testing. The internal surfaces should be smooth and free of substances that could be affected adversely by performing the test and the quality of the test results.

Tube surface shall be free of paint, loose scale or any other surface deposit or irregularity which may adversely affect the flow of eddy currents or hinder the relative travel of test coil or tube.¹⁾

1) Requirement from RCC-M-2012 MC 6143 Surface preparation.

5.3 Eddy current test equipment

5.3.1 General

The eddy current test equipment comprises

- test robot,
- eddy current test system for measured data logging, and
- analysis unit including software.

All components of the eddy current test equipment that are installed in the steam generator (e.g. sliding hose of the test sensor, sensor bodies, test robot) shall be made from halogen-free material.

5.3.2 Test robot

The test robot consists of the following:

- probe positioning unit;
- probe feeding unit.

The test robot shall be designed so that

- It can be controlled remotely.
- All tubes can be moved to in a definite manner and the required test length is recorded.
- The movement of the probe (sensor and cable assembly) into the tube to be tested can be monitored with a video camera.
- A positioning accuracy of the probe feeding unit between two form structure indications shall be ≤ 10 mm in pull direction.
- The position increment of the probe (sensor) in longitudinal tube direction is displayed in steps of 1 mm.
- The position data of the probe positioning unit are:
 - available;
 - indicated in object-relevant coordinates so that executed test robot movements are comprehensible.
- The test speed (probe drawing speed) can be monitored in an axial direction.
- A reference specimen can be guided as well.
- The interference level arising from the probe positioning and probe sliding units does not affect the test adversely.
- The radiation exposure of the personnel when installing and removing the test robot and also during the test is as low as possible.
- It can be widely decontaminable.

5.3.3 Eddy current test system

5.3.3.1 General

The eddy current test system consists of the following parts:

- remote-controlled eddy current test device with digital output;
- equipment for operating the eddy current test device and the measured data logging;
- probes;
- connecting cable;
- reference specimen.

5.3.3.2 Requirements for the eddy current test device

The device shall be able to support the test systems described at [4.3](#) and [4.4](#). The following technical requirements apply in individual detail:

- adjustable test frequencies;
- at least four test frequencies;
- frequency range: 10 kHz to 1 MHz;
- absolute and differential arrangement in parallel available for all frequencies.

Only devices are approved for test application, which have undergone at least one detailed functional test and calibration (verification level 2 according to ISO 15548-1) each year. This shall be documented and validated.

5.3.3.3 Requirements for the probes

The probes shall fulfil the following requirements:

- Probe fill factor basically $\geq 0,8$.
- If probes with undersize (probe fill factor $< 0,8$) are used for the test in the area of dents and close tube bends or tubes with small radius, the suitability of the probe shall be validated as part of the qualification of the eddy current test system;
- Self-centring guide in the steam generator heating tubes; and
- Differential arrangement with the option of being able to operate it in absolute arrangement. Type relevant data sheets shall be provided for the probes to be used.

5.3.3.4 Requirements for the connecting cables

The connecting cables may not exhibit any damage that impairs their mechanical or electrical properties.

5.3.3.5 Requirements for reference specimens and calibration block

5.3.3.5.1 General

Reference specimens contain definite reference defects (artificial discontinuities e.g. through-bored hole, flat-bottomed hole, notches) and simulated structural parts. These reference specimens assist for qualification of the eddy current test system as well as for calibration of the eddy current test system including generation of the evaluation characteristic curve.

The reference specimens shall

- correspond to the test object in the test system relevant properties (material, geometry — in particular diameter and wall thickness — as well as manufacture) with reference faults that are adapted to the test assignment, and
- be free of non-defined irregularities that affect the signals of the defined reference defects and the simulated structural parts.

The definite reference defects shall

- exhibit distances to one another and from the tube ends that are large enough so that their signals do not mutually influence each other,
- be installed so that the electrical and magnetic properties of the material are not changed and no local deformations result, and
- are measured and recorded (actual dimensions). The actual dimensions shall be used for calibration of the eddy current test system.

If operational defects, structural parts, geometry changes and deposits in the reference specimen are simulated, it shall be ensured that they are representative. In addition, the structural parts present in the steam generator can be used for the calibration, in particular for the mixed system (see [4.3.2](#)).

5.3.3.5.2 Reference specimen for determining the evaluation characteristic curves during calibration of the standard test systems

When determining the evaluation characteristic curves (see [6.3.3.2](#)) of the individual frequencies and their links, reference specimens shall be used, which contain artificial discontinuities in the form of drilled holes or flat-bottomed holes or notches. The dimensions of the artificial discontinuities are specified in the national nuclear standards.

EXAMPLE The following dimensions can be used: diameter of through-walled drilled holes 1,3 mm in case of four drilled holes distributed evenly over the circumference and 1,7 mm in case of only one drilled hole.

The variables of the further reference defects (flat-bottomed holes, notches) shall be selected so that their signal amplitudes are in the same order of magnitude as the through-walled drilled holes for the basic frequency. Reference defects with at least the following wall thickness reduction shall be included:

- 100 %;
- 50 % to 60 % (outer);
- 20 % to 30 % (outer).

5.3.3.5.3 Calibration block for checking the eddy current test system

The calibration block serves for inspecting the settings of the eddy current test system and its function during the testing. Therefore, it may deviate from the test object in the test system relevant properties (material, geometry, manufacture).

The calibration block exhibits definite reference defects. Based on reference measurements between the calibration block and reference specimen used for the calibration, the transferability of the performed settings and the correct function of the test system is ensured.

A reference specimen may also be used as a calibration block.

5.3.4 Assistant analysis system

The assistant analysis system (or digital data analysis system) shall enable an automated and manual evaluation as well as monitoring for completeness of the test.

The evaluation characteristic curves are compiled for the calibration using the assistant analysis system. Phase angle and amplitude are calibrated. The percentage wall thickness reduction is determined using the evaluation characteristic curves. The axial assignment of indications is automated, in relation to the position of known structural parts.

5.4 Data storage medium

Data storage medium shall be designed according to the following principles.

- a) They enable a labelling for identification.
- b) An unintentional overwrite is prevented.
- c) The suitability of storage is ensured.

It shall be ensured that measuring data can be read and processed by the next in-service test.

NOTE The operating system or hardware modifications might render it necessary to transfer original data to other data storage medium types.

6 Testing

6.1 General

The specifications in accordance with ISO 15548-1, ISO 15548-2, ISO 15548-3 and ISO 15549 shall apply in respect to the general preparation for eddy current testing.

6.2 Preparations

The test personnel shall be timely instructed prior to the testing concerning the implementation, extent and target objectives of the testing. All requisite documents, such as test procedures, drawings or tube sheet necessary for conducting the testing shall be made provided.

Before using the eddy current test equipment in areas exposed to radiation, training for rapid assembly and disassembly shall be realised for reducing the time personnel remain in such areas. The training shall be documented and, if necessary, validated by the test service provider.

6.3 Implementation

6.3.1 General

The basic adjustment of the test system shall be set before conducting the test. This includes the following:


- test frequencies;
- scanning rate;
- channel assignment (absolute measurement/difference measurement);
- basic gain (eddy current test device);
- coil assignment.

The actual testing is divided into data acquisition (with storage on a data storage medium) and data evaluation (based on the acquired data).

6.3.2 Data acquisition

At the start of the test, the defined reference defects of the reference specimen are recorded with the basic assignment. The measuring data at the reference specimen shall be collected with the same speed as during the measuring data collection of the heating tubes to be tested.

The phase angle of the signal slope of the through-walled drilled hole (wall thickness reduction of 100 %) shall be set to 40° for the basic setting of the measuring data logging. The run direction of the indication begins when pulling the probe with a downwards movement in the lower right quadrant of the image (see [Figure 1](#), curve section 1).

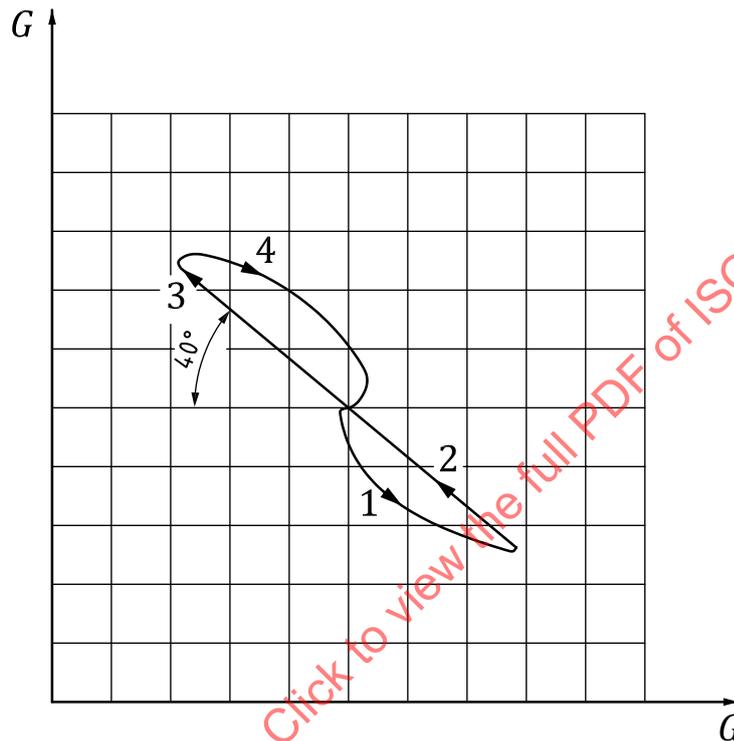

key
 G gain, in V.

Figure 1 — Indication of a wall penetrating reference defect (through-walled drilled holes) when pulling the probe

The indication of the wall penetrating reference defect shall be set to about 80 % FSH.

The test system relevant parameters (e.g. test frequencies, sampling rate, basic amplification) are automatically saved with the raw data. The following shall also be documented:

- identification number of the calibration block;
- eddy current test device and identification number;
- sensor type and identification number;
- date and time.

The data acquisition at the heating tubes is performed with the basic adjustment (see [6.3.1](#)) and the basic settings corresponding to a test plan in which the test extent (number and position of the heating tubes to be tested, test lengths, sensor type) is specified.

The following shall be monitored continuously during the measuring data acquisition:

- Functionality of the test system by visual monitoring of the eddy current data;
- External disturbances by visual monitoring of the interference level;
- Recording of the measuring data;
- The accordance of actual and target coordinates of the relevant test positions.

A data acquisition shall be validated regularly on the reference specimen to monitor the test system, e.g. every 4 h. A calibration block according to [5.3.3.5.3](#) can also be used for this.

A data acquisition on the reference specimen shall also be conducted upon:

- beginning and end of the data acquisition,
- interruption of the data acquisition >4 h,
- every sensor change,
- changes in the analogous part of the equipment, and
- other disturbances.

If disturbances occur, the causes shall be identified and eliminated. After elimination of the disturbances, the data acquisition of inadequately tested areas shall be repeated.

6.3.3 Data analysis


6.3.3.1 General

The aim of the evaluation is to analyse indications with respect to their type, location and extension as well as, if applicable, a quantification of wall thickness reduction. The evaluation is conducted based on the digitally recorded measured data.

6.3.3.2 Calibration

At the beginning of the data evaluation, a calibration (initial calibration) shall be performed based on the eddy current data recorded according to [6.3.2](#) for defined reference defects of the reference specimen. This calibration ensures that the test sensitivity during the evaluation is on the same level as set in the qualification. The calibration includes:

- the required multifrequency combinations;
- the settings of the phase angles and the amplitudes for all test frequencies and multifrequency combinations; and
- the generation of evaluation curves for selected frequencies and multifrequency combinations. An example of an evaluation curve (phase curve) is shown in [Figure 2](#).

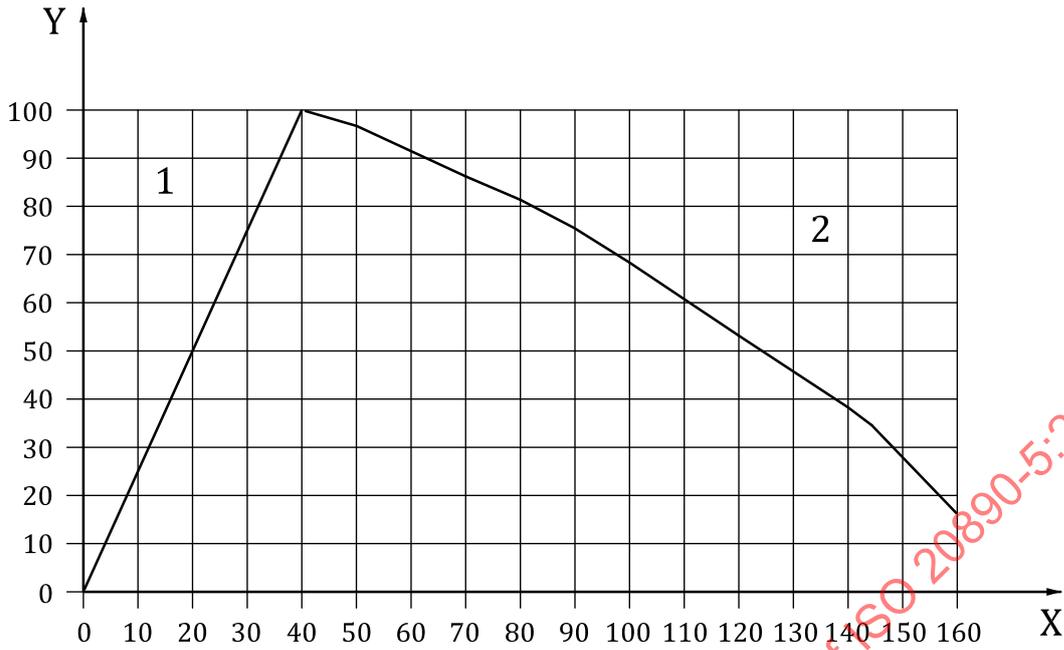

Key
 X phase angle
 Y wall thickness reduction
 1 internal defect
 2 external defect

Figure 2 — Example of an evaluation curve: Wall thickness reduction in % of the wall thickness as a function of the phase angle of the indication at a test frequency

Based on the acquired data at the reference specimen, the calibration shall be checked cyclically. When checking the calibration, the value may deviate from the determined values of the initial calibration by maximum $\pm 3^\circ$ or $\pm 20\%$ in respect to the phase and signal amplitude of the basic frequency.

If these values are exceeded, a new initial calibration shall be performed and the data acquisition shall be repeated for the relevant tube positions.

6.3.3.3 Data evaluation

The data evaluation may be conducted manually as well as automatically or as a combination of both. The first checks are in respect to completeness of extent (e.g. position and test length) and sufficient data quality (e.g. signal/noise ratio).

The search for indications according to 4.2 is performed by evaluating the signals of the basic frequency or a multiple frequency link qualified for this. In general, an indication is described by evaluation of the basic frequency (determination of the wall thickness reduction, type, axial location and length of an indication). If the evaluation of the basic frequency does not supply clear information (e.g. in the area of structural parts), the signals of other frequencies and links of frequencies are also evaluated.

If the standard system is inadequate to describe the test results, test systems for more extensive evaluations according to 4.4 should be applied.

6.3.3.4 Assessment of measuring data

The assessment of indications shall be conducted corresponding to the national safety standards.

6.4 Final measures

Before completing the testing (i.e. disassembly of the test equipment), the following measures shall be performed.

- a) Check the test scope by target-actual comparison of the test plan in respect to completeness.
- b) Check the test results and their documentation in respect to completeness.

Once the checks are passed, the release may be issued to remove or disassemble the test equipment.

7 Recording

7.1 Test record and test report

A test record or test report shall be compiled concerning the testing. The test documentation should also be backed up in digital form in addition to paper form. The following data shall be included:

- date of the testing;
- name of the power plant;
- test principle (test procedure, test specifications);
- test object, test range and test section (tube positions and tube sections);
- test equipment used (test device, test robot);
- calibrations of the eddy current test system;
- result of the test (indication list and possibly findings record) and as well as results comparison with the previous in-service testing;
- deviations from the specifications of the test specifications;
- name of the test organisation;
- place, date, name, signature, certificate number of the test inspectors and test supervisors of the operator or the test company commissioned by him and the third party.

7.2 Indication list

Indications according to 6.3.3.3 and evaluated as not form indications or defect indications are recorded in the indication list. The indication list shall include the following:

- coordinates of the indications (series, column, height coordinates), in relation to the component;
- test system with which the indication was validated (sensor type, test frequency);
- wall thickness reduction, if this can be determined;
- amplitude and signal phase;
- indication type.

7.3 Findings record

The findings record is used to log those indications from the indication list which reach or exceed the assessment limit according to national nuclear safety standards and which are not assessed as