

---

# INTERNATIONAL STANDARD



# 4064 / 1

---

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION • МЕЖДУНАРОДНАЯ ОРГАНИЗАЦИЯ ПО СТАНДАРТИЗАЦИИ • ORGANISATION INTERNATIONALE DE NORMALISATION

---

## Measurement of water flow in closed conduits — Meters for cold potable water — Part I : Specification

*Mesurage de débit d'eau dans les conduites fermées — Compteurs d'eau potable froide —  
Partie I : Spécifications*

First edition — 1977-12-01

STANDARDSISO.COM : Click to view the full PDF of ISO 4064-1:1977

---

UDC 532.575 : 681.121.2/7

Ref. No. ISO 4064/1-1977 (E)

**Descriptors:** flow measurement, water meters, pipe flow, water flow, potable water, cold water, definitions, equipment specifications, dimensions, marking.

Price based on 6 pages

## FOREWORD

ISO (the International Organization for Standardization) is a worldwide federation of national standards institutes (ISO member bodies). The work of developing International Standards is carried out through ISO technical committees. Every member body interested in a subject for which a technical committee has been set up has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work.

Draft International Standards adopted by the technical committees are circulated to the member bodies for approval before their acceptance as International Standards by the ISO Council.

International Standard ISO 4064/1 was developed by Technical Committee ISO/TC 30, *Measurement of fluid flow in closed conduits*, and was circulated to the member bodies in September 1976.

It has been approved by the member bodies of the following countries :

Belgium	India	Turkey
Czechoslovakia	Korea, Rep. of	United Kingdom
Egypt, Arab Rep. of	Mexico	U.S.S.R.
Finland	Netherlands	Yugoslavia
France	Portugal	
Germany	Romania	

The member bodies of the following countries expressed disapproval of the document on technical grounds :

Austria  
Japan  
U.S.A.

# Measurement of water flow in closed conduits — Meters for cold potable water — Part I : Specification

## 1 SCOPE AND FIELD OF APPLICATION

This International Standard is the first part of an International Standard applying to meters for the measurement of cold potable water and which is to comprise three parts.

This first part deals with terminology, technical characteristics, metrological characteristics and pressure loss.

The second part<sup>1)</sup> will deal with installation conditions and the third<sup>2)</sup> with test methods.

This International Standard applies to water meters of various metrological classes (see clause 5) having nominal flow rates which lie in the range 0,6 to 4 000 m<sup>3</sup>/h, with a nominal pressure of 10 bar<sup>3)</sup> and a working temperature up to 30 °C.

The recommendations of this International Standard apply, except for the connecting flange dimensions, to water meters subject to nominal pressures of 10 to 16 bar. The recommendations of this International Standard apply to water meters defined as follows : self-contained integrating measuring instruments continuously determining the volume of water flowing through them, employing a direct mechanical process involving the use of volumetric chambers with mobile walls or the action of the velocity of the water on the rotation rate of a moving part (turbine, impeller).

Legal requirements take precedence over the recommendations of this International Standard.

## 2 REFERENCES

ISO 228, *Pipe threads where pressure-tight joints are not made on the threads — Part I : Designation, dimensions and tolerances.*<sup>4)</sup>

ISO 2084, *Pipeline flanges for general use — Metric series — Mating dimensions.*

ISO 4006, *Measurement of fluid flow in closed conduits — Vocabulary and symbols.*

OIML, *Vocabulary of legal metrology*, 1969.

## 3 DEFINITIONS

For the purpose of this International Standard, the following definitions apply :

**3.1 nominal pressure** : The internal pressure, expressed in bars, corresponding to the maximum permissible working pressure. It is designated by the letters PN followed by the appropriate figure.

**3.2 flow rate** : The quotient of the volume of water passing through the water meter by the time taken for this volume to pass through the meter.

**3.3 volume-flow** : The volume of water passing through the water meter.

**3.4 maximum flow rate,  $q_{max}$**  : The highest flow rate at which the meter is required to operate in a satisfactory manner for a short period of time without deteriorating.

**3.5 nominal flow rate,  $q_n$**  : Half the maximum flow rate,  $q_{max}$ .

Expressed in cubic metres per hour, the nominal flow rate is used for the purpose of designating the water meter.

At the nominal flow rate,  $q_n$ , a water meter is expected to operate in a satisfactory manner under normal conditions of use, i.e. under steady or intermittent flow conditions.

**3.6 minimum flow rate,  $q_{min}$**  : The lowest flow rate at which the meter is required to give indications within the maximum permissible error tolerance. It is determined in terms of  $q_n$ .

**3.7 transitional flow rate,  $q_t$**  : The flow rate at which the maximum permissible error of the water meter changes in value.

1) At present at the stage of draft.

2) In preparation.

3) 1 bar = 10<sup>5</sup> Pa

4) At present at the stage of draft. (Revision of ISO/R 228-1961.)

**3.8 flow-rate range :** The range limited by the maximum and the minimum flow rates ( $q_{max}$  and  $q_{min}$ ).

This range is divided into two zones called upper and lower zones, separated by the transitional flow rate.

**3.9 pressure loss :** The pressure loss caused by the presence of the water meter.

## 4 TECHNICAL CHARACTERISTICS

### 4.1 Meter size and overall dimensions

Meter size is designated either by thread size of the end connections or by the nominal diameter of the flange. For each meter size designation there is a corresponding fixed set of overall dimensions (see figure 1). The dimensions are given in tables 1 and 2.

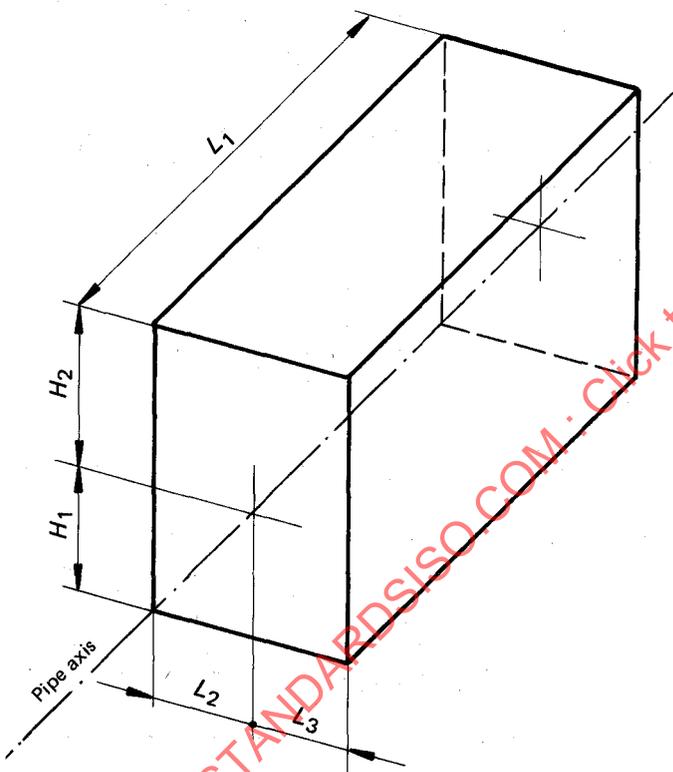


FIGURE 1

$H_1 + H_2$ ;  $L_1$ ;  $L_2 + L_3$  define the height, length and width respectively of a cuboid within which the water meter can be contained (the cover being at right angles to its closed position).

$H_1$ ,  $H_2$ ,  $L_2$ ,  $L_3$  are maximum dimensions.

$L_1$  is a fixed value with specified tolerances.

For threaded end connections, two minimum dimensions,  $a$  and  $b$ , are specified (see 4.1.2).

### 4.1.1 Relationship between meter size and nominal flow rate

Meter size and hence overall dimensions are in principle linked to the nominal flow rate ( $q_n$ ) of the water meter as specified in tables 1 and 2.

It is, however, permitted to adopt a meter size one step smaller or larger than the relationship shown in the tables, provided that the metrological requirements are met. In such a case the meter shall be designated not only by the numerical value of its nominal flow rate but also by the nominal diameter of its end connections. End connections shall be the same at the water meter inlet and outlet.

### 4.1.2 Threaded connection

Values are given in table 1. Threads shall comply with ISO/R 228. Figure 2 defines dimensions  $a$  and  $b$ .

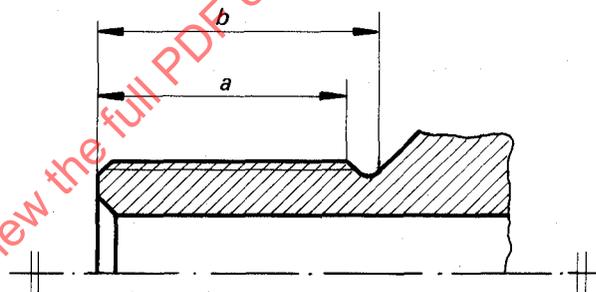


FIGURE 2

### 4.1.3 Flanged connection

Flanged end connections shall comply with ISO 2084 for a nominal pressure corresponding to that of the water meter, i.e. normally 10 bar. Dimensions are given in table 2.

The manufacturer shall provide a reasonable clearance behind the rear face of the flange to allow access for installation and removal.

## 4.2 Indicating device

The indicator must allow, by simple juxtaposition of its various constituent elements, a reliable, easy and unambiguous reading of the volume of water measured, expressed in cubic metres.

The volume is indicated by one of the following systems :

- the position of one or more pointers on circular scales – type 1;
- reading of a row of in-line consecutive digits in one or more apertures – type 2;
- a combination of these two systems – type 3.

The cubic metre and its multiples shall be indicated in black, and sub-multiples of the cubic metre in red. This colour coding applies to the pointers on circular scale type indicating devices and to the drums in in-line digit indicating devices.

The actual or apparent height of the digits on the drums shall not be less than 4 mm.

On digital indicators (types 2 and 3) visible displacement of all digits shall be upwards.

The advance of any given digital unit shall be completed while the digit of the immediately next lower value describes the last tenth of its travel; the drum showing the digits of lowest value may move continuously in the case of type 3.

Indicators with pointers (type 1 and 3) shall rotate in a clockwise direction. The value in cubic metres for each scale division shall be expressed as  $10^n$ , where  $n$  is a positive or negative whole number or zero, thereby establishing a system of consecutive decades. Each scale shall be :

- either graduated in values expressed in cubic metres;
- or accompanied by a multiplying factor ( $\times 0,001 - \times 0,01 - \times 0,1 - \times 1 - \times 10 - \times 100 - \times 1\ 000$ , etc.)

In both cases (dial and digital indicators) :

- the unit symbol  $m^3$  shall appear either on the dial or in the immediate vicinity of the digital indication;
- the fastest-moving visible graduated element, the control element, the scale interval of which is known as the "verification scale interval", shall move continuously.

The length of the verification scale interval shall be not less than 1 mm and not more than 5 mm. The scale shall consist :

- either of lines of equal thickness not exceeding one-quarter of the distance between the axes of two consecutive lines and differing only in length;
- or of contrasting bands of a constant width equal to the length of the scale division.

The width of the pointer index tip shall not exceed one-quarter of the distance between two scale divisions, and in no case shall it be greater than 0,5 mm.

**4.3 Number of decades and value of the verification scale division**

It shall be possible for the indicating device to record volume, expressed in cubic metres, corresponding to at least 1 999 h of operation at the nominal flow rate, without returning to zero.

The value of the verification scale interval, expressed in cubic metres, shall be based on the formula  $1 \times 10^n$  or  $2 \times 10^n$  or  $5 \times 10^n$ .

For type 2, the verification scale interval may be formed from the division into 20, 50 or 100 equal parts of a supplementary scale of markings engraved on the drum bearing the figures of the lowest decade. Numbering shall not be applied to the said divisions.

TABLE 1 - Water meters with threaded end connections - Nominal flow rates, meter sizes and dimensions

Dimensions in millimetres

Nominal flow rate $q_n$ (All types) $m^3/h$	Meter size (Nominal diameter of threaded end connection)
0,6	G 1/2 B
1	G 1/2 B
1,5	G 3/4 B
2,5	G 1 B
3,5	G 1 1/4 B
6,0	G 1 1/2 B
10	G 2 B

Thread	a min.	b min.	Overall dimensions							
			$L_1$ tolerance $\begin{matrix} 0 \\ -2 \end{matrix}$			$L_2$ max.	$L_3$ max.	$H_1$ max.	$H_2$ max.	
			Preferred value	Alternatives						
G 1/2 B	10	12	110	85	130	50	50	50	180	
G 1/2 B	10	12	110	85	130	50	50	55	200	
G 3/4 B	10	12	165	110	130	65	65	60	220	
G 1 B	12	14	190	165		65	65	60	240	
G 1 1/4 B	12	16	260			85	85	65	260	
G 1 1/2 B	13	18	260			85	85	70	280	
G 2 B	13	20	300			105	105	75	300	

TABLE 2 — Water meters with flanged end connections — Nominal flow rates, meter sizes and dimensions

Dimensions in millimetres

Nominal flow rate $q_n$ $m^3/h$	Meter size (Nominal diameter of flange of end connections)	Overall dimensions											
		L <sub>1</sub> tolerances		L <sub>2</sub> max.		L <sub>3</sub> max.		H <sub>1</sub> max.		H <sub>2</sub> max.			
		200 ≤ L <sub>1</sub> ≤ 400 : 0	0 - 3	400 < L <sub>1</sub> ≤ 1 200 : 0		0 - 5		Turbine and removable element Woltman meters		Non-removable element Woltman meters			
Volumetric and turbine meters	Woltman meters	Volume meters	Turbine and removable element Woltman meters	Non-removable element Woltman meters	Volume and turbine meters	Woltman meters	Volume and turbine meters	Woltman meters	Volume and turbine meters	Woltman meters	Volume and turbine meters		
15	50	350	300	200	135	135	135	135	135	115	100	300	390
20	65	450	300	200	135	135	150	135	135	130	110	320	390
30	80	500	350	200 or 225*	135	135	180	135	135	150	120	320	410
50	100	650	350 or 400*	250	135	135	225	135	135	215	140	320	440
100	150	1 000	500	300	175	175	350	175	175	250	180	400	500
	200		500	350	190	190		190	190		200		500
	250		600	450	210	210		210	210		220		500
	300		800	500	240	240		240	240		250		500
	400		800	600	290	290		290	290		320		500
	500		1 000	800	365	365		365	365		380		520
	600		1 200	1 000	390	390		390	390		450		600
	800		1 200	1 200	510	510		510	510		550		700

\* For a transitional period.

STANDARDS5000.COM - Click to view the full PDF of ISO 4064-1:1977