
Lift (Elevator) installation —
Part 1:
Class I, II, III and VI lifts

Installation d'ascenseurs —

Partie 1: Ascenseurs des classes I, II, III et VI

STANDARDSISO.COM : Click to view the full PDF of ISO 4190-1:2010



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

STANDARDSISO.COM : Click to view the full PDF of ISO 4190-1:2010



COPYRIGHT PROTECTED DOCUMENT

© ISO 2010

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword	iv
Introduction.....	v
1 Scope	1
2 Terms and definitions	1
2.1 General	1
2.2 Lift classes	2
2.3 Dimensions	2
2.4 Other characteristics	5
3 Lift characteristics	5
3.1 Renard series	5
3.2 Rated loads	6
3.3 Rated speeds	6
3.4 Selection of class of lift	6
4 Dimensions	6
4.1 Inner dimensions of cars	6
4.2 Inner dimensions of well	8
4.3 Dimensions of landings	11
4.4 Dimensions of machine room for electric lifts	12
4.5 Dimensions of machine room for hydraulic lifts	14
4.6 Arrangement of machine room	14
Bibliography.....	29

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 4190-1 was prepared by Technical Committee ISO/TC 178, *Lifts, escalators and moving walks*.

This fourth edition cancels and replaces the third edition (ISO 4190-1:1999).

This edition reflects the requirements of the global marketplace and includes

- a) harmonization, where possible, of Japanese dimensions of car and door sizes, loads and speeds,
- b) relocation of the 450 kg lift from Figure 8 to Figure 5,
- c) relocation of the 320 kg lift from Figure 4 to Figure 9,
- d) introduction of 1 350 kg lift in Figures 6 and 7, and
- e) introduction of speeds 0,75 m/s, 1,5 m/s and 1,75 m/s.

NOTE 1 In certain instances, harmonization is not possible and these sizes are shown in Figures 9, 10 a), 10 b), and 10 c).

NOTE 2 National regulations can demand greater dimensions in some instances.

ISO 4190 consists of the following parts, under the general title *Lift (Elevator) installation*:

- *Part 1: Classes I, II, III and VI lifts*
- *Part 2: Class IV lifts¹⁾*
- *Part 3: Service lifts class V¹⁾*
- *Part 5: Control devices, signals and additional fittings*
- *Part 6: Passenger lifts to be installed in residential buildings — Planning and selection¹⁾*

1) It is intended that, upon revision, the introductory element of the title of this part will be harmonized with part 1.

Introduction

This part of ISO 4190 reflects the requirements of the global marketplace and includes:

- the special needs, access and full manoeuvrability of people with physical disabilities;
- appropriate use of stretchers, beds and ancillary medical equipment in hospitals and nursing homes;
- a range of intensive-use lifts²⁾ typically used for high-rise buildings for rated speeds of 2,5 m/s to 6,0 m/s; the rated speeds have been mainly based upon the Renard series for speeds of up to 2,5 m/s;
- improved utilization of building space by reducing well (hoistway) sizes where practicable.

STANDARDSISO.COM : Click to view the full PDF of ISO 4190-1:2010

2) Hereinafter, the term “lift” is used instead of the term “elevator”.

STANDARDSISO.COM : Click to view the full PDF of ISO 4190-1:2010

Lift (Elevator) installation —

Part 1: Class I, II, III and VI lifts

1 Scope

This part of ISO 4190 specifies the necessary dimensions to permit the installation of passenger lifts of class I, II, III and VI.

The dimensions given reflect the requirements for the apparatus. This part of ISO 4190 is applicable to all new lift installations, irrespective of drive systems, including a car with one entrance, to be installed in a new building. However, for arrangements with counterweight at the side, a through-entrance configuration is possible. Where relevant, this part of ISO 4190 is also applicable to an installation in an existing building.

This part of ISO 4190 is not applicable to lifts, the speed of which is higher than 6,0 m/s.

NOTE It is the responsibility of the user to consult the manufacturer for such installations.

2 Terms and definitions

For the purposes of this part of ISO 4190, the following terms and definitions apply.

2.1 General

2.1.1

car

part of the lift which carries the passenger and/or other loads

2.1.2

head room

part of the well situated above the highest landing served by the car

2.1.3

landing

area providing access to the car at each level of use

2.1.4

machine room

room in which the machine or machines and/or the associated equipment are placed

2.1.5

lift GB**elevator** US

permanent lifting appliance serving defined landing levels, comprising a car, the dimensions and means of construction of which, clearly permit the access of passengers

2.1.6

pit

part of the well situated below the lowest landing served by the car

2.1.7

through entrance car

car with doors at the front and rear which may or may not be able to open at the same time

2.1.8

well

hoistway

space in which the car, the counterweight(s) and hydraulic jack(s) move

NOTE This space is usually bounded by the bottom of the pit, the walls and the ceiling of the well.

2.2 Lift classes

2.2.1

class I

lift designed for the transport of persons

2.2.2

class II

lift designed mainly for the transport of persons, but in which goods may be carried

NOTE This differs from a class I, III and VI lift, essentially, by the inner fittings of the car.

2.2.3

class III

lift designed for health-care purposes, including hospitals and nursing homes

2.2.4

class IV

lift designed mainly for the transport of goods (freight) which are generally accompanied by persons

2.2.5

class V

service lift GB
dumbwaiter US

2.2.6

class VI

lift especially designed to suit buildings with intensive traffic, i.e. lifts with speeds of 2,5 m/s and above

2.3 Dimensions

See Figure 1.

2.3.1

car width

b_1

horizontal distance between the inner surface of the car walls measured parallel to the front entrance side

NOTE This dimension is measured as indicated in Figure 1, 1 m above the floor. In certain regions, e.g. Asia-Pacific and North American regions, the car width, b_1 , is measured between the finished panels, whereas in Europe, the car width is measured excluding decorative or protective panels.

2.3.2**car depth** d_1

horizontal distance between the internal walls of the car, measured perpendicular to the front entrance side

NOTE This dimension is measured as indicated in Figure 1, 1 m above the floor. In certain regions, e.g. Asia-Pacific and North American regions, the car depth, d_1 , is measured between the finished panels, whereas in Europe, the car depth is measured excluding decorative or protective panels.

2.3.3**car height** h_4

vertical inner distance between the entrance threshold and the constructional roof of the car

NOTE 1 Light fittings and false ceilings should be accommodated within this dimension (see Figure 1).

NOTE 2 In certain regions, e.g. Asia-Pacific and North American regions, the car height, h_4 , is measured between the floor and the underside of the false ceiling, whereas in Europe, the car height is measured to the underside of the structural roof.

2.3.4**entrance width into car** b_2

clear width of the entrance, measured when the landing and car doors are fully open

2.3.5**entrance height** h_3

clear height of the entrance, measured when the landing doors and car doors are fully open

2.3.6**well width GB****hoistway width US** b_3

horizontal distance between the inner surface of the well walls, measured parallel to the car width

2.3.7**well depth GB****hoistway depth US** d_2

horizontal dimension between the inner surface of the well walls, perpendicular to the width

2.3.8**pit depth** d_3

vertical distance between the finished floor of the lowest landing served and the bottom of the well



2.3.9**headroom height** h_1

vertical distance between the finished floor of the highest landing served and the ceiling of the well (not including any pulley over line of car)

2.3.10**machine room width** b_4

horizontal dimension between the inner surface of the walls, measured parallel to the car width

See Figure 3.

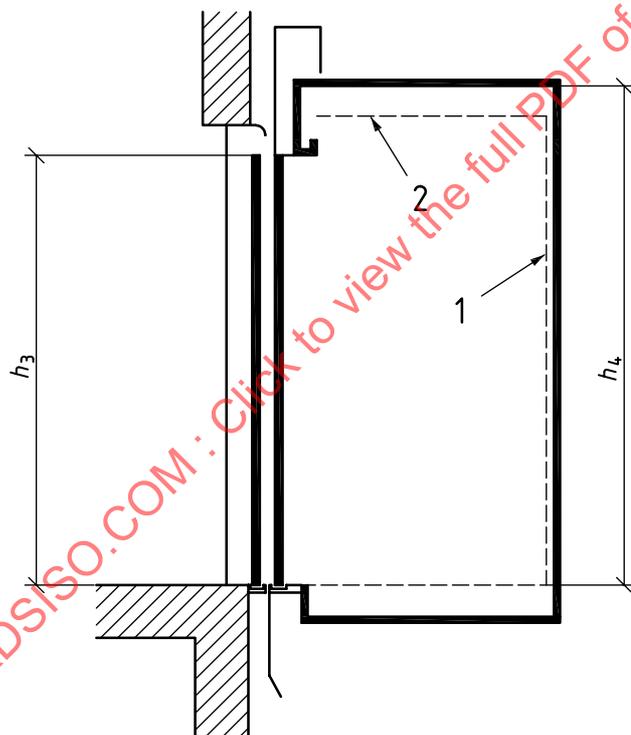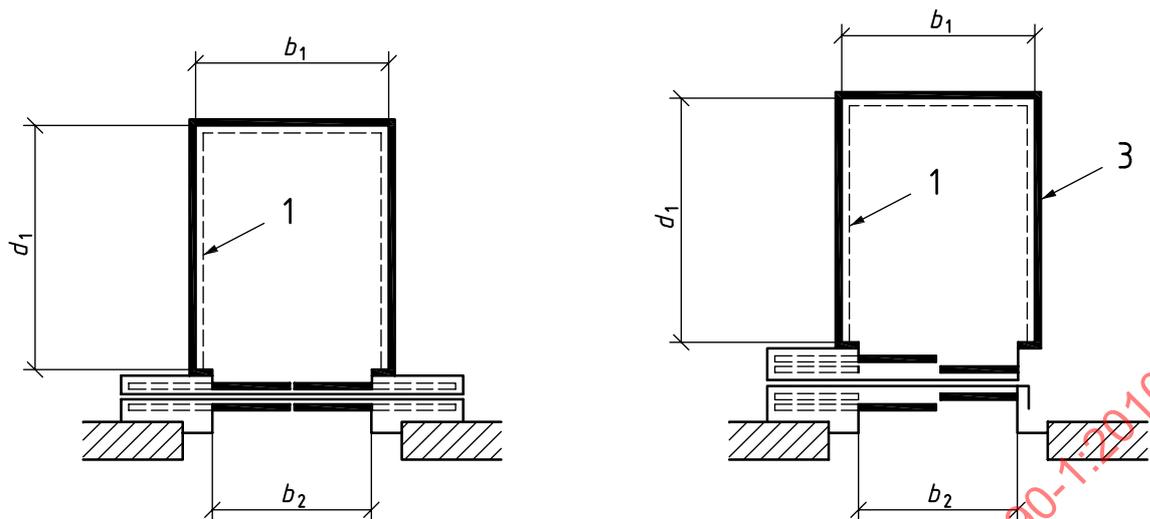

Key

- 1 decorative panels
- 2 false ceiling
- 3 car wall

- b_1 car width
- b_2 entrance width
- d_1 car depth
- h_3 entrance height
- h_4 car height

Figure 1 — Car and entrance dimensions

2.3.11**machine room depth** d_4

horizontal dimension between the inner surface of the walls, perpendicular to the width

2.3.12**machine room height** h_2

smallest vertical distance between the finished floor and the room ceiling, satisfying both the requirements of the national building regulations and lift equipment

2.4 Other characteristics**2.4.1****rated speed** v_n

speed for which the lift has been built and at which it is designed to operate

2.4.2**rated load**

load for which the lift has been built and under which it is designed to operate

2.4.3**group collective lift** GB**group collective elevator** US

group of electrically interconnected lifts for which landing controls are common

3 Lift characteristics**3.1 Renard series**

The dimensions of the car are related to the loads which have been selected to be close to the Renard R10 series of preferred numbers.

The dimensions of the pit, headroom and machine room have been determined in relation to the speeds which, up to 2,5 m/s, are based on the R5 series of preferred numbers.

NOTE The Renard series is a series of preferred numbers adopted at the international level in 1946 (Budapest International Congress).


The Renard series is a geometrical progression and has a multiplier selected on exponents of 10.

For lifts, the multipliers are:

— car load: $R10 = \sqrt[10]{10} = 1,258\ 9$

— car speed: $R5 = \sqrt[5]{10} = 1,584\ 9$

The results are approximate, which give:

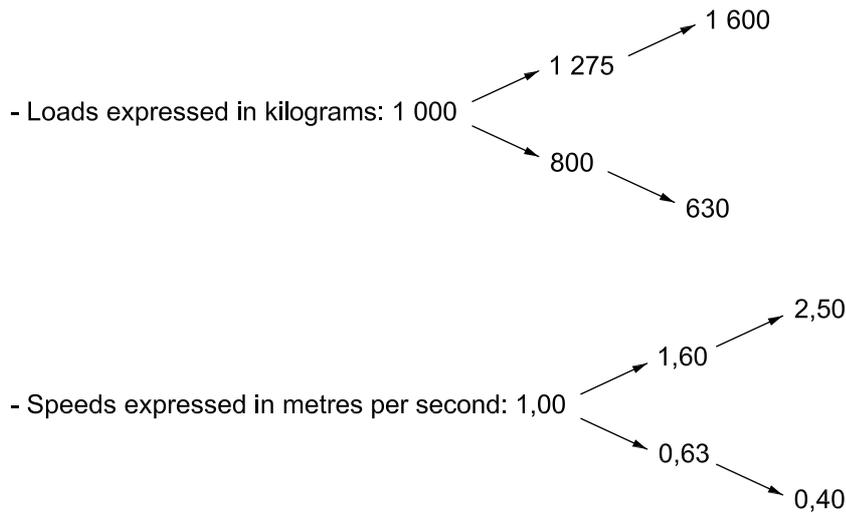

3.2 Rated loads

These shall be, in kilograms:

- 450 - 630 - 800 – 1 000 - 1 275 – 1 350 - 1 600 - 1 800 - 2 000 - 2 500

NOTE 1 350 kg (3 000 lb) and 1 800 kg (4 000 lb) are not Renard numbers, but are popular sizes in the Asia-Pacific and North American regions.

3.3 Rated speeds

These shall be, in metres per second:

- 0,40 - 0,63 - 0,75 - 1,00 - 1,50 - 1,60 – 1,75 - 2,00 - 2,50 - 3,00 - 3,50 - 4,00 - 5,00 - 6,00

NOTE 0,75, 1,50, 1,75, 2,00, 3,00 and 5,00, are not Renard numbers, but are popular speeds in the Asia-Pacific and North American regions.

Speeds from 0,63 m/s to 6,00 m/s apply to electric lifts.

Speeds from 0,40 m/s to 1,00 m/s apply to hydraulic lifts.

3.4 Selection of class of lift

Any type of building may be equipped with lifts of different classes. The lifts are grouped in Figures 5 to 10 a), 10 b) and 10 c).

4 Dimensions

4.1 Inner dimensions of cars

4.1.1 Accessibility

It is recommended that in multi-storey buildings there be at least one lift accessible to transport persons in wheelchairs.

This lift shall meet all conditions required for this application, and shall be indicated by the sign:



Accessible for wheelchairs.

NOTE 1 ISO 4190-5 provides requirements for control devices, signals and additional fittings for such lifts.

NOTE 2 The accessibility requirements are subject to national regulations.

4.1.2 Class I lifts

Class I lifts are passenger lifts (see Figures 5 and 6 and Table 2). Lifts for local markets are shown in Figures 9, 10 a), 10 b) and 10 c).

4.1.2.1 The following lifts for residential buildings are shown in Table 2:

- a) cars for 450 kg rated load lifts allow only the transport of persons or a wheelchair, but without an accompanying person;
- b) cars for 630 kg rated load lifts allow, in addition, the transport of a person in a wheelchair with an accompanying person (but do not allow full manoeuvrability, i.e. turning full-circle);
- c) cars for 1 000 kg rated lifts allow, in addition to a) and b), the transport of stretchers with removable handles and of coffins and furniture.

4.1.2.2 General-purpose lifts shall be used mainly in low- and medium-rise buildings, typically up to 15 floors where lift speeds of up to 2,5 m/s are suitable. The dimensions of these lifts are shown in Table 2.

4.1.3 Class II lifts

Class II lifts are passenger lifts in which goods can be carried (see Figures 5 to 8 and Tables 2 and 3). Lifts for local markets are shown in Figures 9, 10 a), 10 b) and 10 c).

The dimensions of class II lifts shall be selected from those for either class I or class VI lifts. It is particularly recommended that the dimensions for the 1 000 kg lift intended for residential buildings and/or class III lifts be used for this purpose.

4.1.4 Class III lifts

Class III lifts are health-care lifts (see Figure 8 and Table 4).

It should be noted that

- a) cars for 2 500 kg rated load lifts are particularly suitable for carrying persons in hospital beds of dimensions 1 000 mm × 2 300 mm, together with ancillary medical equipment and associated attendants;
- b) cars for 2 000 kg lifts are suitable for carrying beds of dimensions 1 000 mm × 2 300 mm (excluding ancillary medical equipment) but with associated attendants;
- c) cars for 1 600 kg lifts are primarily suitable for moving hospital beds of dimensions 900 mm × 2 000 mm; (excluding ancillary medical equipment) but with associated attendants;
- d) cars for 1 275 kg lifts are suitable for beds of dimensions 900 mm × 2 000 mm in nursing homes (excluding ancillary medical equipment) but with one associated attendant;

4.1.5 Class VI lifts

Class VI lifts are lifts for intensive use (see Figure 7 and Table 2).

Lifts for intensive use shall be used mainly in high-rise buildings, typically above 15 floors, where lift speeds of at least 2,5 m/s are needed. The dimensions of these lifts are shown in Table 2.

The precise load, speed and numbers of lifts should be the subject of a detailed traffic calculation.

4.2 Inner dimensions of well

4.2.1 Plan dimensions

For the lift well plan dimensions include clear plumb tolerances (see Table 1). The dimensions b_3 and d_2 in Figures 1, 2, 3 and 4 represent the minimum plumb requirement.

The architect or any person assuming such functions, in agreement with the builder, shall ensure that these tolerances are adequate for the specified dimensions of the finished work. Otherwise, additional tolerances shall be added to the lift well plan dimensions.

For the incorporation of lifts in the building, the well shall have a certain free volume enclosed by a rectangular parallelepiped inscribed in the well, with vertical edges and bases formed by the bottom of the pit and the ceiling of the well.

When a counterweight safety gear is required, the depths or the widths defined should be increased by up to 200 mm depending on the location of the counterweight.

4.2.1.1 Dimensional tolerances

4.2.1.1.1 General

The architect or any person assuming such functions, in agreement with the builder, should either ensure that the well dimensions are sufficient for the lift to be installed, or add additional tolerances to the nominal size dimensions for the well.

4.2.1.1.2 Well dimensions

Lifts have to move vertically through a building and the car and landing door equipment have to interconnect, therefore the plumbness of the well and the alignment of the landing openings are of paramount importance. The well shall not be built to the usually applied construction industry practices, which allow deviations from the nominal sizes as both increased and decreased dimensions. It is also important to ensure that the well is built to a high degree of verticality, i.e. plumb. Decreased dimensions are thus not acceptable to the lift industry and allowances shall be made by the architect, builder or structural engineer to accommodate the high degree of verticality needed. Failure to do so can result in significant reworking and serious delays.

The purchaser's representative, in conjunction with the builder, should ensure that the minimum clear plumb sizes specified by the lift contractor are included in the building design and are obtained in the finished work.

The purchaser's representative, in conjunction with the builder, should ensure that dimensions in excess of the recommended minimum plumb dimensions for wells and openings do not exceed the maximum values shown in Table 1, beyond which changes in design can be necessary.

The purchaser's representative should take into account the constructional tolerances appropriate to any particular building technique, when specifying the well structural dimensions to meet the lift contractor's dimensional requirements.

Table 1 — Limits of accuracy of well plumb dimensions

Well height (storey)	Dimensional tolerance <i>K</i>
< 20	+50 mm, -0 mm
> 20	+1,0 mm, -0 mm per extra storey up to a maximum of 100 mm

NOTE 1 The dimensional tolerance K is a positive value only. Unlike other building tolerances, K cannot have a negative value.

If the well is built with a negative value of K , this can require reconstruction of the well in the affected areas or extensive modifications to the lift equipment, if this is possible, resulting in delays.

NOTE 2 Figure 2 illustrates the structural limits of accuracy pertaining to single and multiple well arrangements. If the net well dimensions b_3 (well width) and d_2 (well depth) and the nominal structural entrance opening dimensions C and D are defined by plumb lines, it is essential that the actual wall does not encroach upon the space bounded by those dimensions. Dimension K in Figure 2, which is the limit of accuracy of dimensions b_3 and d_2 , should not exceed the value given in Table 1 for the relevant well height.

NOTE 3 In the case of multiple lifts situated side by side, dimension K is not applicable to the space between the plumb wells. This part of ISO 4190 and ISO 4190-2 specify a minimum of 200 mm for this space.

STANDARDSISO.COM : Click to view the full PDF of ISO 4190-1:2010

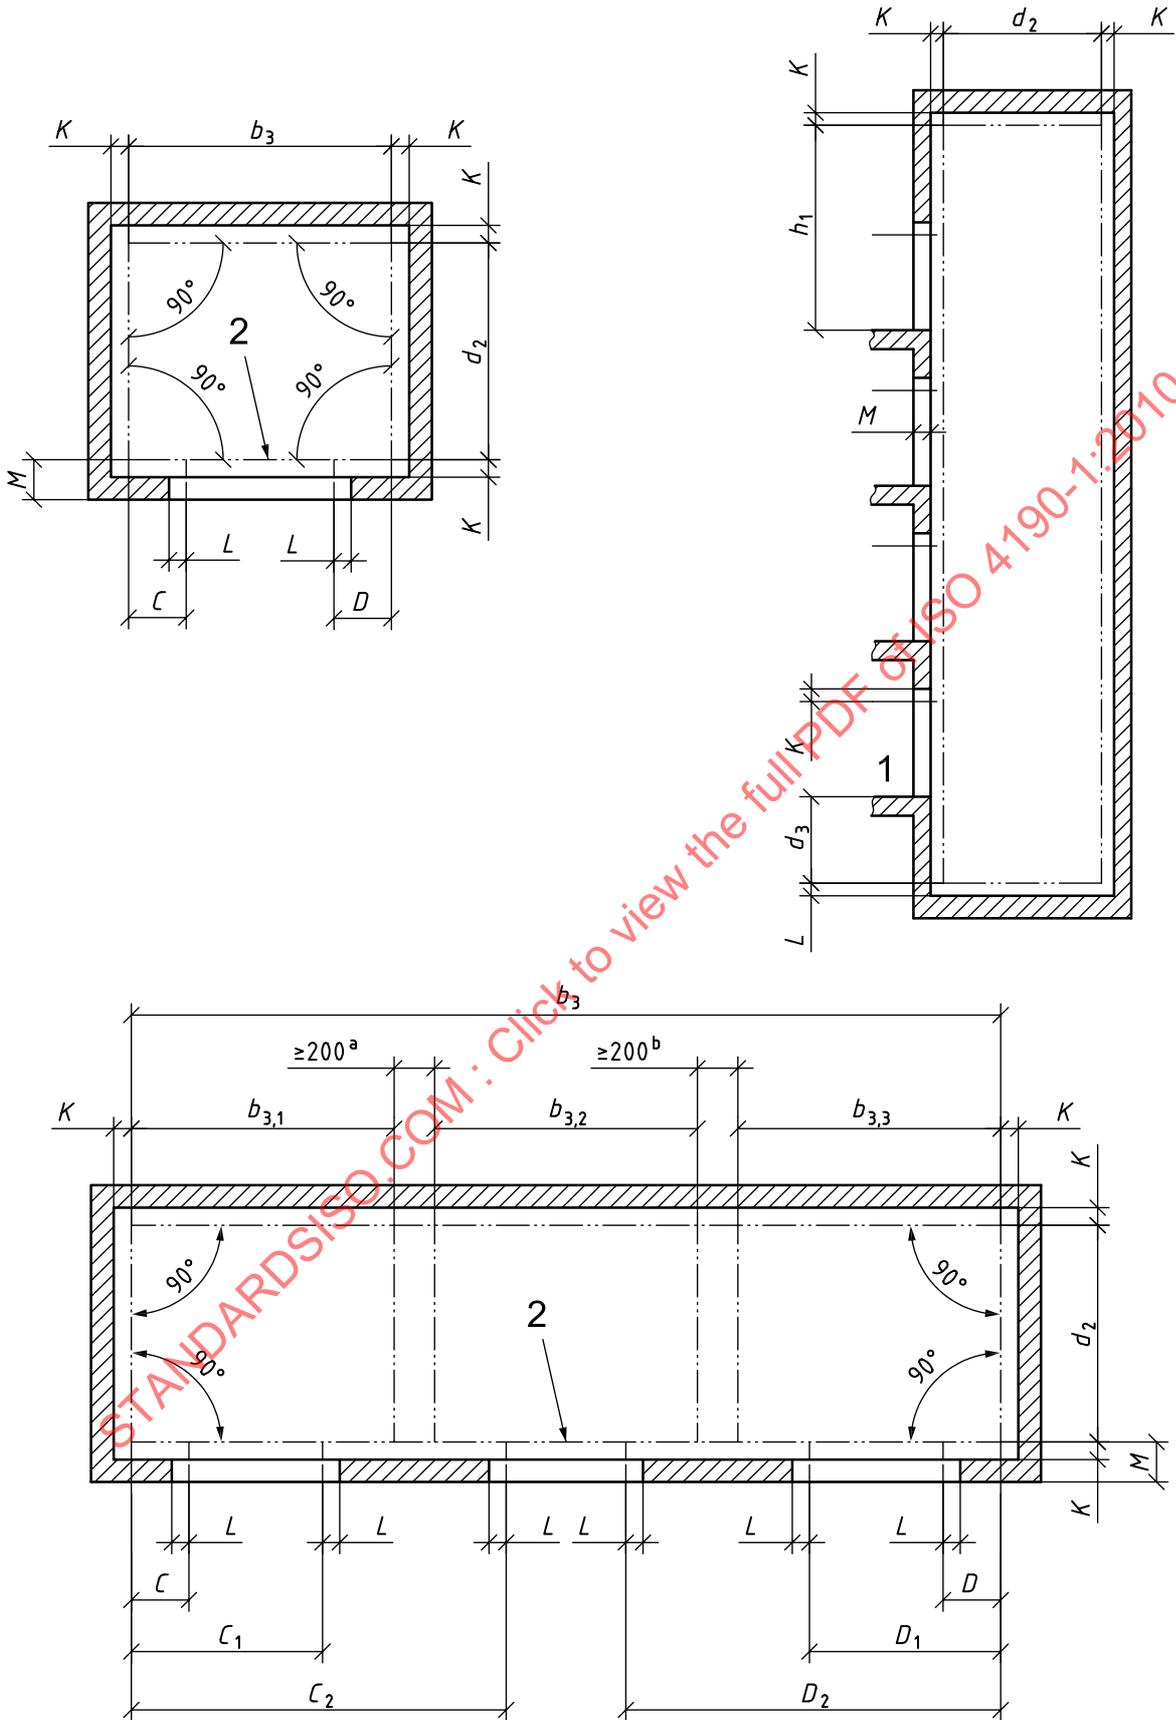


Figure 2 — Structural limits of accuracy (continued)

Key

- 1 finished floor level of landing (FFL)
 2 lift contractor's ref. line (most prominent point of wall)
- b_3 minimum clear well dimensions (well width)
 C distance from the lift contractor's ref. line to the boundary of landing entrance (left side)
 D distance from the lift contractor's ref. line to the boundary of landing entrance (right side)
 d_3 distance from the lowest landing finished floor level to the lift contractor's ref. line at the bottom of the well (pit depth)
 h_1 distance from the top landing finished floor level to the lift contractor's ref. line at the top of the well (headroom height)
 K limit of accuracy of the well construction
 L difference between the rough opening and the finished opening
 M distance from the outside wall of the well to the lift contractor's ref. line
- a If solid dividing wall, refer to single well installation.
 b Minimum shaft trimmer width.

Figure 2 — Structural limits of accuracy**4.2.2 Individual lifts**

The dimensions of the well shall have the values shown in Figures 5 to 10 a), 10 b) and 10 c).

4.2.3 Multiple lifts situated side by side

In the case of a common well, the internal dimensions shall be determined in the following manner:

- a) the total width of the common well shall be equal to the sum of the individual well widths plus the sum of the boundary widths between the wells, each boundary width being at least 200 mm;
- b) the depths of the constituent parts of the common well shall be the same as those laid down for the individual lifts.

4.2.4 Distance between landings

The recommended minimum distance between two successive landings to permit the accommodation of landing doors should be:

- 2 450 mm for a landing door height of 2 000 mm;
- 2 550 mm for a landing door height of 2 100 mm.

4.3 Dimensions of landings**4.3.1 General**

The landing depth specified in subsequent clauses shall at least be maintained over the whole width of the well (individual or common).

These dimensions do not take into account the possibility of through traffic of persons not using the lifts.

4.3.2 Class I lifts particularly intended for residential buildings

These may be individual lifts or multiple lifts situated side by side.

For this category of lifts, a maximum number of four group collective lifts should be placed side by side.

For hydraulic lifts, a maximum of two group collective lifts is generally recommended.

The minimum depth of the landing measured wall to wall and in the same direction as the depth(s) of the car(s) should be equal to the depth of the deepest car. However, the depth of landings served by lifts for persons with disabilities shall be at least 1 500 mm.

The turning space for a wheelchair should be considered.

4.3.3 Class I (other than those particularly intended for residential buildings), II, III and VI lifts

4.3.3.1 Individual lifts or multiple lifts situated side by side

In the case of group collective lifts, the maximum number shall be four.

The minimum depth of the landing measured wall to wall and in the same direction as the depth(s) of the car(s) should be equal to $1,5 d_1$ (where d_1 is the depth of the deepest car). For group collective lifts with four lifts, other than class III, this depth shall be not less than 2 400 mm.

4.3.3.2 Lifts arranged face to face

In the case of group collective lifts, the maximum number shall be eight (2×4).

The distance between facing walls shall be at least equal to the sum of the depths of two facing cars. For group collective lifts, other than class III, this distance shall be not more than 4 500 mm.

4.4 Dimensions of machine room for electric lifts

4.4.1 Individual lifts

The dimensions of the machine room shall be as indicated in Tables 3 and 4. Machine room heights are subject to existing national regulations.

4.4.2 Multiple lifts

4.4.2.1 Class I lifts particularly intended for residential buildings

These shall fulfil the following conditions.

4.4.2.1.1 Floor area

- a) Multiple lifts having the same rated load: the minimum floor area of the common machine room shall be equal to the sum of the minimum areas required for the individual lifts.
- b) Two lifts having different rated loads: the minimum floor area of the common machine room shall be equal to the sum of the minimum areas required for the individual lifts plus the difference between the well areas of the two lifts.
- c) A group of more than two lifts having different rated loads: the minimum floor area of the common machine room shall be equal to the sum of the minimum areas required for the individual lifts, plus the sum of the differences between the well area of the largest lift and the well areas of each of the other lifts.

4.4.2.1.2 Width

The actual dimensions shall provide a floor area at least equal to the one specified for the total area.

The minimum width of the common machine room shall be equal to the total of the common well plus a lateral extension corresponding to that appropriate to the lift with the greatest individual requirement.

4.4.2.1.3 Depth

The actual dimensions shall provide a floor area at least equal to the one specified for the total area.

The minimum depth of the common machine room shall be equal to the depth of the deepest individual well plus 2 100 mm.

4.4.2.1.4 Height

The minimum height of the common machine room shall be equal to the height of the machine room having the greatest height. Machine room heights are subject to existing national regulations.

4.4.2.2 Class I (other than those particularly intended for residential buildings), II, III and VI lifts**4.4.2.2.1 Symbols**

The following symbols are used for the determination of the dimensions:

— b_4 minimum width	}	of the machine room for one single lift
— d_4 minimum depth		
— A floor area		
— b_3 well width for one single lift		
— d_2 well depth for one single lift		
— n total number of lifts		

4.4.2.2.2 Lifts situated side by side

The total area shall be: $A + 0,9A(n - 1)$

The actual dimensions shall provide a floor area at least equal to the one specified for the total area.

Minimum width: $b_4 + (n - 1)(b_3 + 200)$

Minimum depth: d_4

4.4.2.2.3 Lifts arranged face to face

The total area shall be: $A + 0,9A(n - 1)$

The actual dimensions shall provide a floor area at least equal to the one specified for the total area.

Minimum width $b_4 + \frac{(n-1)}{2}(b_3 + 200)$

Minimum depth: $2d_2$ + distance between the wells.

In the case of an odd number of lifts, n is rounded up to the next even number.

4.4.2.2.4 Height

The minimum height of the common machine room shall be equal to the height of the machine room having the greatest height.

Machine room heights are subject to existing national regulations.

4.5 Dimensions of machine room for hydraulic lifts

4.5.1 Individual lifts

The dimensions of the machine room shall be as indicated in Tables 3 and 4. Machine room heights are subject to existing national regulations.

4.5.2 Duplex group lifts

For both lifts, a common machine room is recommended.

The floor area shall be as follows.


- a) Duplex group lifts having the same rated load: the minimum floor area of the common machine room shall be equal to the sum of the minimum area required for machine rooms placed behind the well of individual lifts.
- b) Duplex group lifts having different rated loads: the minimum floor area of the common machine room shall be equal to the sum of the minimum areas required for machine rooms placed behind the well of individual lifts plus the difference between the well area of the two lifts.

4.6 Arrangement of machine room

4.6.1 Individual or common arrangement

4.6.1.1 This part of ISO 4190 is based on a configuration of a machine room above the well. For electric lifts, the lateral extension of the machine room with respect to the well (or common well) can be taken on either the right or the left of the well (see Figure 3).

Dimensions in millimetres

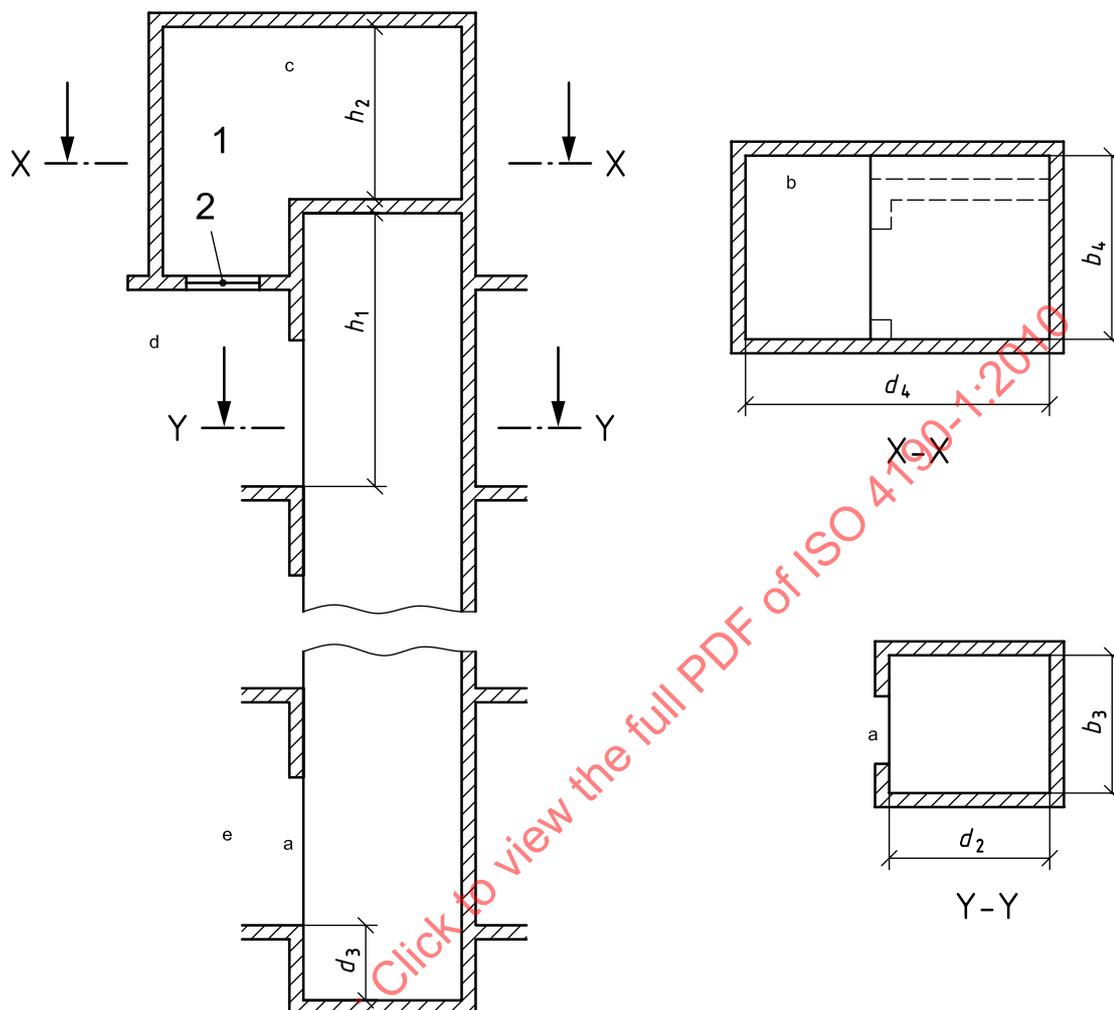

Key


- 1 machine room
- 2 trap door

- b_3 well width
- b_4 machine room width
- d_2 well depth
- d_3 pit depth
- d_4 machine room depth
- h_1 headroom height
- h_2 machine room height

- a For door details, see Figures 5 to 10 a), 10 b) and 10 c).
- b It is necessary to have an access door to the machine room although this is not indicated in the figure.
- c See 2.3.12.
- d Highest level served.
- e Lowest level served.

Figure 3 — Electric lifts with machine room

4.6.1.2 For hydraulic lifts, the machine room is preferably placed beside or behind the well in the lower part of the building (see Figure 4).

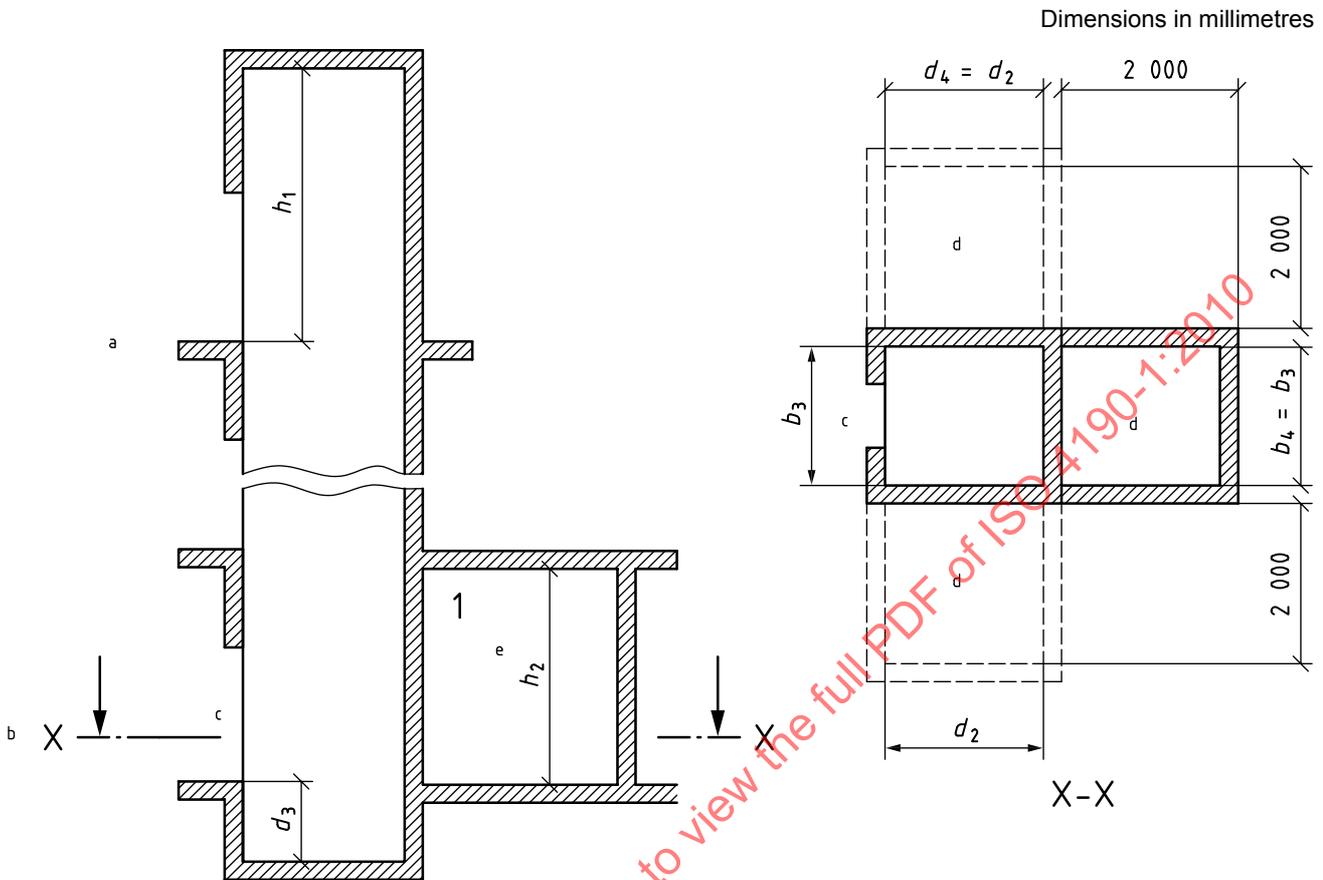

Key

- 1 machine room
- b_3 well width
- b_4 machine room width
- d_2 well depth
- d_3 pit depth
- d_4 machine room depth
- h_1 headroom height
- h_2 machine room height
- a Highest level served.
- b Lowest level served.
- c For door details, see Figures 5 to 10 a), 10 b) and 10 c).
- d It is necessary to have an access door to the machine room although this is not indicated in the Figure.
- e See 2.3.12.

Figure 4 — Hydraulic lifts with machine room

4.6.1.3 The machine room should have adequate ventilation.

4.6.2 Arrangement for individual lifts and multiple lifts side by side with common machine room

4.6.2.1 For electric lifts, the rear wall of the machine room shall be in line with the corresponding well wall (or of the deepest well) and one of the lateral walls shall be in line with the corresponding well wall (or of the common well).

The depth extension of the machine room, with respect to the well, shall be taken on the landing side.

4.6.2.2 For duplex group hydraulic lifts, the common machine room is preferably placed behind the well in the lower part of the building.

4.6.3 Arrangement for lifts face to face with a common machine room (for electric lifts only)

It is recommended that any depth extension not be greater than 0,5 m from the rear walls of the wells and be at the same level as the slab supporting the machinery.

STANDARDSISO.COM : Click to view the full PDF of ISO 4190-1:2010

Table 2 — Classes I, II, and VI lifts — Dimensions of headroom, pit depth, car and door height

Dimensions in millimetres

Parameter	Rated speed V_n	Lifts in residential buildings					General-purpose lifts					Intensive-use lifts							
		Rated load (mass)					Rated load (mass)					Rated load (mass)							
Height of car, h_4		450	630	1 000	630	800	1 000/1 275	1 350	1 275	1 350	1 600	1 800	2 000						
Height of car door and landing doors, h_3		2 200					2 300					2 400							
Pit depth ^{ae} , d_3	0,40 m/s ^b	1 400					c					c							
	0,63 m/s	1 400					c					c							
	0,75 m/s	1 400					c					c							
	1,00 m/s	1 400					c					c							
	1,50 m/s	1 400					c					c							
	1,60 m/s	c					1 600					c							
	1,75 m/s	c					1 600					c							
	2,00 m/s	c					1 750					1 750							
2,50 m/s	c					2 200					2 200								
3,00 m/s	c					c					3 200								
3,50 m/s	c					c					3 400								
4,00 m/s ^d	c					c					3 800								
5,00 m/s ^d	c					c					3 800								
6,00 m/s ^d	c					c					4 000								

STANDARDSISO.COM : Click to view the full PDF of ISO 4190-1:2010

Table 2 (continued)

Parameter	Rated speed V_n	Lifts in residential buildings				General-purpose lifts				Intensive-use lifts			
		450	630	1 000	630	800	1 000/ 1 275	1 350	1 275	1 350	1 600	1 800	2 000
Headroom ^{ae} , h_1	0,40 m/s ^b	3 600											
	0,63 m/s	3 600				3 800				4 200			
	0,75 m/s	3 700				4 000				4 200			
	1,00 m/s	c				4 300				4 400			
	1,50 m/s	c				5 000				5 200			
	1,60 m/s	c				5 000				5 500			
	1,75 m/s	c				5 000				5 500			
	2,00 m/s	c				5 000				5 500			
	2,50 m/s	c				5 000				5 500			
	3,00 m/s	c				5 000				5 500			
	3,50 m/s	c				5 000				5 500			
	4,00 m/s ^d	c				5 000				5 500			
5,00 m/s ^d	c				5 000				5 500				
6,00 m/s ^d	c				5 000				5 500				

a Some countries require additional headroom, h_1 , and pit depth, d_3 .
 b For hydraulic lifts only.
 c Non-standard configuration.
 d Assumes advantages taken of reduced stroke buffering.
 e For pit and headroom sizes for Japan, see national legislation.

Table 3 — Classes I, II and VI lifts — Machine room dimensions

Dimensions in millimetres

	Rated speed V_n m/s	Rated load (mass)			
		320 kg to 630 kg $b_4 \times d_4$	800 kg to 1 000 kg $b_4 \times d_4$	1 275 kg to 1 600 kg $b_4 \times d_4$	1 800 kg to 2 000 kg $b_4 \times d_4$
Machine room (where needed) for electric lifts	0,63 to 1,75	2 500 × 3 700	3 200 × 4 900	3 200 × 4 900	3 000 × 5 000
	2,0 to 3,0		2 700 × 5 100	3 000 × 5 300	3 300 × 5 700
	3,5 to 6,0		3 000 × 5 700	3 000 × 5 700	3 300 × 5 700
Machine room (where needed) for Hydraulic lifts ^a	0,4 to 1,0	Width or depth of well × 2 000 mm for residential buildings			

^a Site conditions and national regulations may require different machine room dimensions (b_4, d_4, h_2).

Table 4 — Class III lifts (Health-care lifts) — Functional dimensions


Parameter	Rated speed V_n m/s		Rated load (mass) kg			
			1 275	1 600	2 000	2 500
Car		Height, h_4 (mm)	2 300			
Car door and landing doors		Height, h_3 (mm)	2 100			
Pit depth, d_3	0,63		1 600		1 800	
	1,00		1 700		1 900	
	1,60		1 900		2 100	
	2,00		2 100		2 300	
	2,50		2 500			
Headroom, h_1	0,63		4 400		4 600	
	1,00		4 400		4 600	
	1,60		4 400		1 600	
	2,00		4 600		4 800	
	2,50		5 400		5 600	
Machine room ^a (where needed)	0,63 m/s to 2,50 m/s	Surface, A (m ²)	25	27	29	
		Width ^b , d_4 (mm)	3 200		3 500	
		Depth ^b , d_4 (mm)	5 500		5 800	

^a Site conditions and national regulations may require different machine room dimensions (b_4, d_4, h_2).

^b b_4 and d_4 are minimum values. The actual dimensions shall provide a floor area at least equal to A .

Non-standard configuration for general-purpose or intensive-use lifts.

Dimensions in millimetres

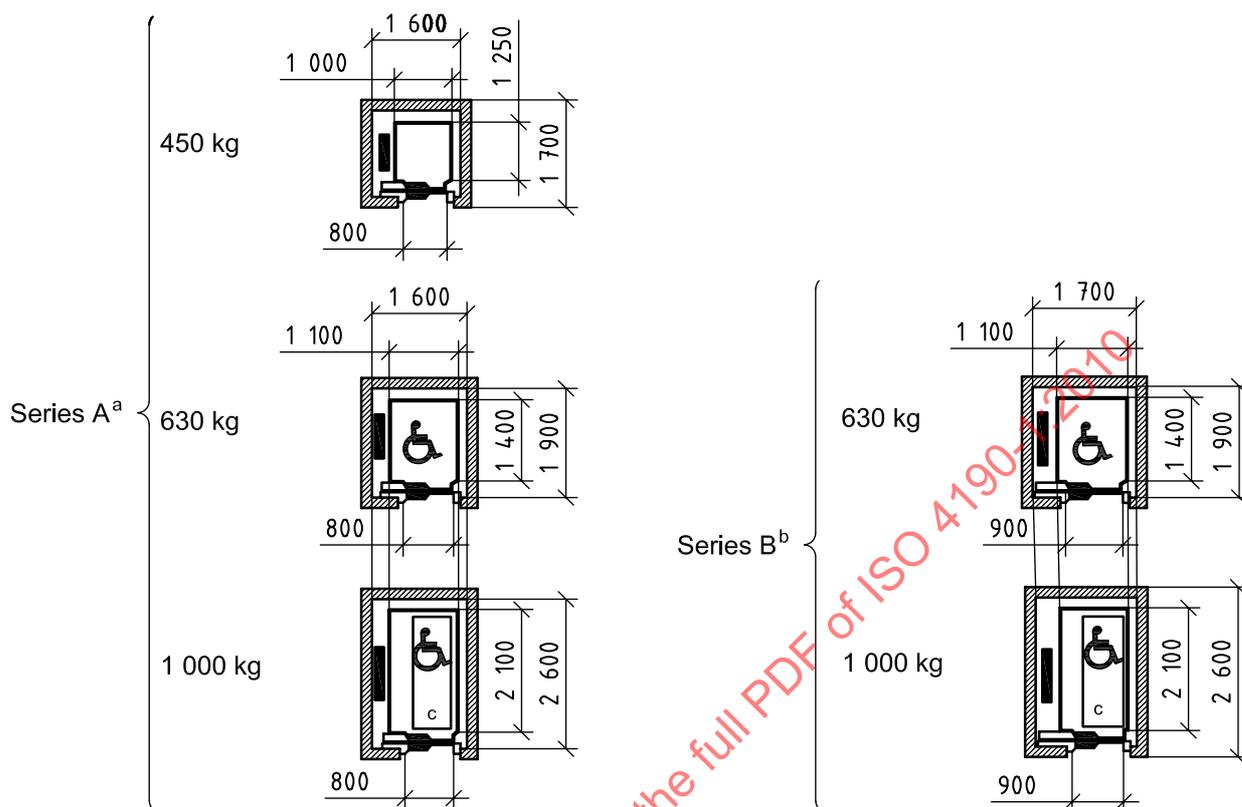

NOTE 1 Lifts suitable for speeds up to and including 2.5 m/s.

NOTE 2 The selection of either series A or B depends on national regulations or market requirements.

NOTE 3 Both series A and B fulfil handicap requirements and carry the symbol: . However, the selection of either an 800 mm or 900 mm door is subject to individual national regulations.

NOTE 4 Even though counterweights are shown in the diagrams, the dimensions apply to all lifts irrespective of the drive system.


NOTE 5 Dimensions of stretcher, reference ^c 600 mm × 2 000 mm.

^a 800 mm entrances, car height 2 200 mm, entrance height 2 100 mm.

^b 900 mm entrances, car height 2 200 mm, entrance height 2 100 mm.

^c Dimensions of stretcher: 600 mm × 2 000 mm.

Figure 5 — Class I — Residential lifts

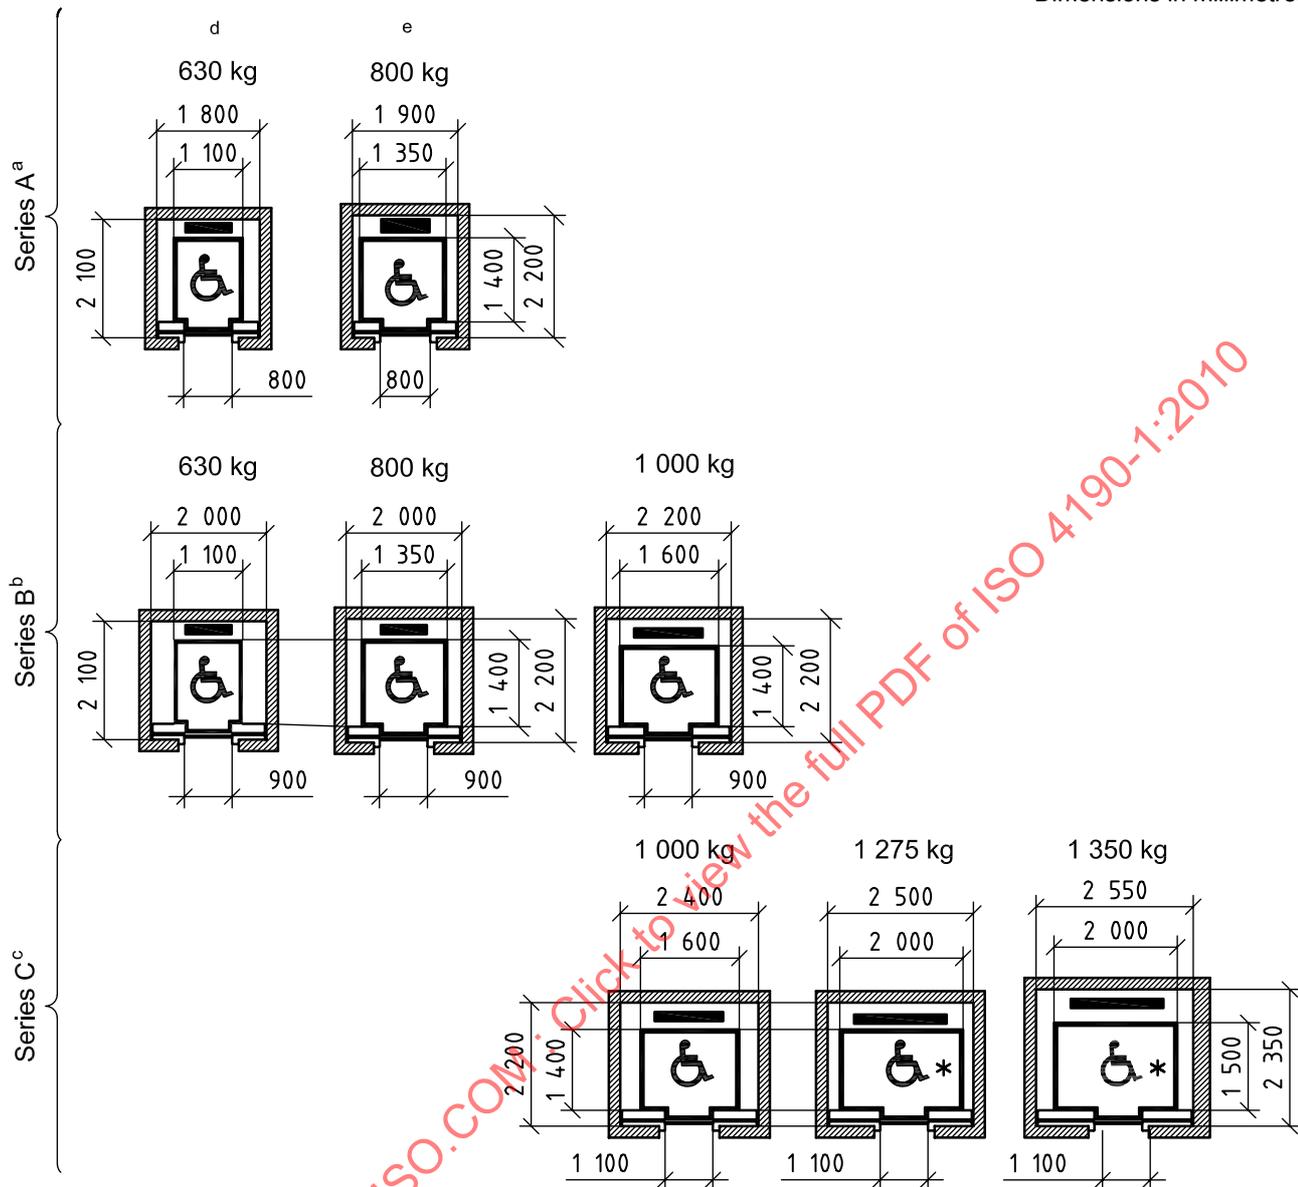

NOTE 1 Lifts suitable for speeds up to and including 2,5 m/s (when higher speeds are used, add 100 mm to the well width and depth).

NOTE 2 The selection of either series A, B or C depends on national regulations or market requirements.

NOTE 3 Series A, B and C fulfil handicap requirements and carry the symbol: . However, the selection of either an 800 mm or 900 mm door is subject to individual national regulations.

NOTE 4 Lifts marked thus:  * allow full manoeuvrability (3-point turn) of a wheelchair.

- a 800 mm entrances.
- b 900 mm entrances.
- c 1 100 mm entrances.
- d Car height 2 200 mm, entrance height 2 100 mm.
- e Car height 2 300 mm, entrance height 2 100 mm.

Figure 6 — Class I — General-purpose lifts