
International Standard



6612

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION • МЕЖДУНАРОДНАЯ ОРГАНИЗАЦИЯ ПО СТАНДАРТИЗАЦИИ • ORGANISATION INTERNATIONALE DE NORMALISATION

Windows and door height windows — Wind resistance tests

Fenêtres et portes-fenêtres — Essais de résistance au vent

First edition — 1980-10-01

STANDARDSISO.COM : Click to view the full PDF of ISO 6612:1980

UDC 69.028.2 : 620.1

Ref. No. ISO 6612-1980 (E)

Descriptors : windows, french windows (french), glazed doors, tests, pressure tests, wind resistance, strain measurement, safety, testing conditions.

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards institutes (ISO member bodies). The work of developing International Standards is carried out through ISO technical committees. Every member body interested in a subject for which a technical committee has been set up has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work.

Draft International Standards adopted by the technical committees are circulated to the member bodies for approval before their acceptance as International Standards by the ISO Council.

International standard ISO 6612 was developed by Technical Committee ISO/TC 162, *Doors and windows*, and was circulated to the member bodies in June 1979.

It has been approved by the member bodies of the following countries :

Australia	Germany, F.R.	Poland
Austria	India	Romania
Belgium	Ireland	South Africa, Rep. of
Bulgaria	Italy	Spain
Canada	Japan	Sweden
Denmark	Libyan Arab Jamahiriya	United Kingdom
Finland	Netherlands	
France	Norway	

The member body of the following country expressed disapproval of the document on technical grounds :

USA

Windows and door height windows — Wind resistance tests

0 Introduction

Wind effects on windows are evidenced, among other reactions, by positive and negative pressures that may be conveniently simulated by the following tests.

These tests allow for the testing of the complete window to check that, under the influence of wind effects, the window :

- has an acceptable deformation;
- maintains its characteristics;
- does not endanger users.

1 Scope

This International Standard defines the method of testing to be used for assessing structural performance, under positive and/or negative static air pressure, of windows to be fitted in exterior walls and supplied in the form of completely assembled and finished units.

2 Field of application

This International Standard applies to all windows, including door height windows, made of any material, in their normal operating condition for which they are designed and installed according to the manufacturer's recommendations as in a

finished building, bearing in mind the conditions of tests as defined below. This International Standard does not apply to the joints between the windows and surrounding components and materials.

3 Definitions

3.1 permanent residual deformation : Change in shape or dimension which does not disappear when pressures are no longer applied.

3.2 frontal displacement : Displacement of a point on a window measured normal to the plane of the window.

3.3 frontal deflection : Maximum difference between the frontal displacements taken along the same window.

3.4 relative frontal deflection : Value of the frontal deflection with respect to the distance between the two ends of the window under examination.

3.5 pressure differential : Difference between the absolute air pressure on the external surface of a window and the absolute air pressure on the internal surface of the same window.

The difference is positive when the external pressure is higher than the internal pressure. In the opposite case, it is negative. This pressure is expressed in Pascals¹⁾.

1) 1 Pa = 1 N/m²

4 Tests

4.1 Frontal deflection test up to a pressure differential of P_1 in both the positive and negative directions, which may be evaluated by the relative frontal deflection.

4.2 Repeated positive and negative application of pressure differentials up to P_2 for n cycles. This test may be evaluated by either operational characteristics or permanent residual deformation or both.

4.3 Safety test under positive and negative application of pressure differentials up to P_3 for one cycle. This test may be evaluated by either operational characteristics or permanent residual deformation or both.

The required values of P_1 , P_2 , P_3 , n and the time exposure shall be defined by authorities having jurisdiction.

5 Apparatus

The basic test apparatus consists of the following :

- a) Chamber with an opening to which the test window is fitted by its surround (see clause 7).
- b) Means of providing a controlled differential air pressure across the window.
- c) Device for rapid controlled changes of the differential air pressure operating between defined limits.
- d) Means for measuring the difference in pressure between the two faces of the window.
- e) Devices for measuring displacements.
- f) Means for positioning the devices for measuring frontal displacements and of ensuring stability during the test.

6 Preparation of the window for testing

A surround for the specimen to be tested shall be prepared. This surround shall be stiff enough to withstand the test pressures without deflecting to an extent likely to impair jointing or to impose bending stresses on the test specimen. When the operating conditions are known, the fixing of the specimen shall simulate these (for example, a window in a curtain walling).

The window shall be fixed vertically, square, and without twists or bends.

The thickness, type of glass and the method of glazing shall comply with the requirements of the manufacturer. When there is no specification or when there is a possibility that the window will be used with different glasses, tests shall be carried out with a glass of minimum thickness with respect to the area.

The hardware fitted to the test window shall be supplied or specified by the manufacturer.

7 Preparation for the tests

The laboratory ambient air temperature and the test chamber air temperature shall be measured and recorded in the report.

Three air pressure pulses shall be applied; the rate of application shall be over a period of not less than 1 s, and the pressure shall be maintained for 3 s. These pulses shall be at the pressure required for the deformation test (P_1), but shall not be less than 500 Pa.

With the pressure reduced to zero, all operating parts of the window shall be opened and closed five times and finally secured in the closed position.

If it is desired to examine the resistance of the window under positive and negative pressure, each of the three tests (see clause 8) shall be carried out first under positive pressure then under negative pressure. A "preparation" as described in the second paragraph of this clause shall be carried out before the measurement of the deformation under negative pressure.

8 Tests

The window shall undergo the following sequence of tests as represented in figures 1 and 2.

8.1 Deformation test

Bring the device for measuring changes in position relative to the plane of the window into its measuring position. Subject the window to pressure, increasing in stages for a minimum period of 10 s at each stage, up to the maximum pressure required (P_1) for this test.

The pressures at these stages shall be 100, 200, 300, 400, 500 Pa and can then be increased in stages of 250 Pa maximum if the pressure required for the test is, exceptionally, higher than 500 Pa.

At each pressure differential, measure the frontal deflection at characteristic points given for the type of specimen to be tested.

If these points are located on the sash-frame or casing, the measurements shall be taken along the longitudinal axis of these window-frame elements. The reference plane for these measurements is a fixed plane which may be that of the window frame.

With the pressure reduced to zero, note the residual permanent frontal displacements at the characteristic points after stabilization.

8.2 Repeated pressure test

The window shall be subjected to n pressure impulses between 0 and P_2 .

The period of transition from one pressure value to another shall not be less than 1 s. The pressure shall be held at their maximum or minimum values for at least 3 s at each impulse.

After completion of the test, open and close the moving parts of the window five times.

Note all damage or functioning defects detected after this test.

8.3 Safety test

The maximum required pressure P_3 shall be reached as quickly as possible, but not in less than 1 s, and held for 3 s.

Note any permanent residual deformations, damage or functioning defects detected after this test.

8.4 Diagrams

Two figures are included below showing diagrams of the sequence of the operation as examples for :

- a positive or negative pressure test only (figure 1);

- a test under positive and negative pressure (figure 2).

Include diagrams showing the sequence of operation in the report.

9 Recording of results

A sketch of the window shall show the points of measurement.

The results of the deformation test (see 8.1) shall be expressed graphically as a function of pressure for each measurement. Deformations are expressed in millimetres and pressures in pascals.

The residual permanent deformation shall be indicated.

Note damage and functioning defects resulting from the tests and show them on the window sketch.

STANDARDSISO.COM : Click to view the full PDF of ISO 6612:1980

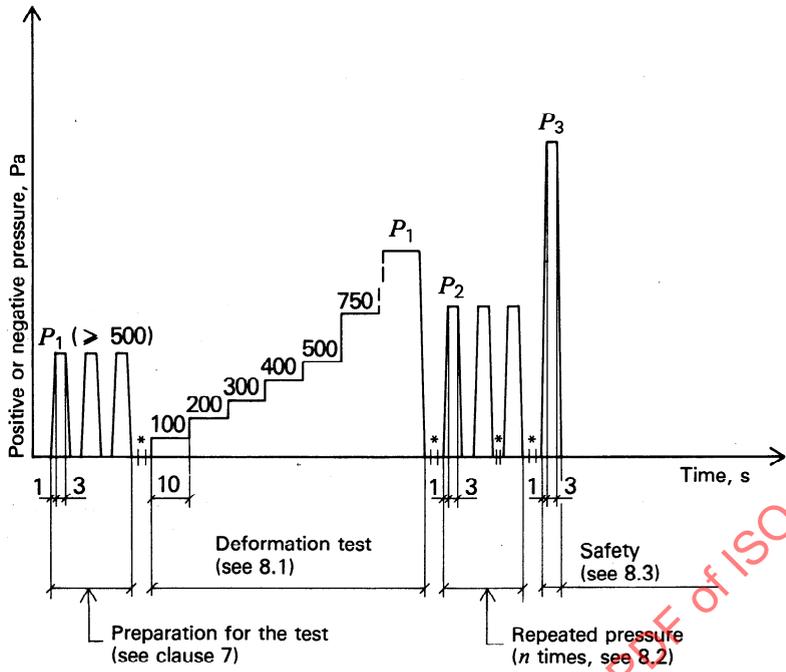


Figure 1 — Example of unidirectional pressure

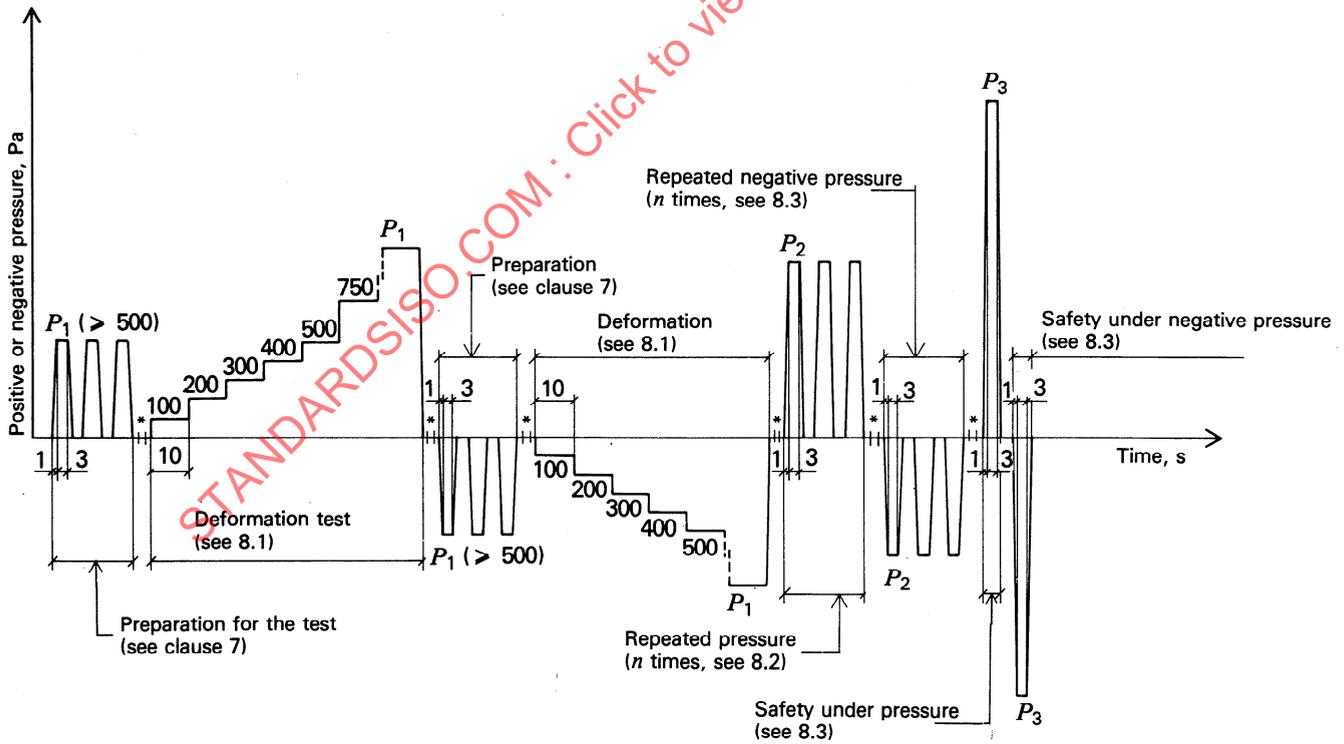


Figure 2 — Example of positive and negative pressure

* Indicates opening and closing

NOTE — The periods indicated are minimum times except for the safety test (P_3) for which the duration of 3 s is compulsory.