

# INTERNATIONAL STANDARD

# ISO 7165

First edition  
1999-12-01

**AMENDMENT 1**  
2004-05-01

---

---

## Fire fighting — Portable fire extinguishers — Performance and construction

### AMENDMENT 1: Class F

*Lutte contre l'incendie — Extincteurs portatifs — Performances et  
construction*

*AMENDEMENT 1: Classe F*

STANDARDSISO.COM : Click to view the full PDF of ISO 7165:1999/Amd 1:2004



Reference number  
ISO 7165:1999/Amd.1:2004(E)

© ISO 2004

**PDF disclaimer**

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

STANDARDSISO.COM : Click to view the full PDF of ISO 7165:1999/Amd 1:2004

© ISO 2004

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
Case postale 56 • CH-1211 Geneva 20  
Tel. + 41 22 749 01 11  
Fax + 41 22 749 09 47  
E-mail [copyright@iso.org](mailto:copyright@iso.org)  
Web [www.iso.org](http://www.iso.org)

Published in Switzerland

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

Amendment 1 to ISO 7165:1999 was prepared by Technical Committee ISO/TC 21, *Equipment for fire protection and fire fighting*, Subcommittee SC 2, *Manually transportable fire extinguishers*.



# Fire fighting — Portable fire extinguishers — Performance and construction

## AMENDMENT 1: Class F

Pages 2 and 3, add the following terms and definitions:

### 3.1.5

#### **Class F**

fires in cooking appliances that involve combustible cooking media (vegetable or animal oils and fats)

### 3.18

#### **wet chemicals**

chemicals including, but not limited to, aqueous solutions of potassium acetate, potassium carbonate, potassium citrate, or combinations of these materials

Page 3, replace Clause 4 by the following:

## **4 Classification of extinguishers**

Extinguishers shall be classified by the type of extinguishing medium that they contain. At present, the main classes of extinguishers are the following:

- a) water-based;
- b) powder;
- c) carbon dioxide;
- d) clean agents

These classes of extinguishers may be further sub-divided, for example water-based extinguishers may contain pure water or water with additives such as wetting agents, viscosity-increasing agents, flame-retardant, foaming agents or wet chemicals, etc.

Page 4, insert the following subclause:

### **5.1.5 Water-based agents**

When the extinguishing agent has a pH exceeding 9.5, a warning statement shall be required for the extinguisher nameplate (see 10.2.2.2) of this Amendment.

Page 17, insert the following subclause:

### **8.1.5 Class F**

Extinguishers recommended as suitable for Class F fires shall extinguish the appropriate test fires as described in 8.7 and pass the splash test requirements as described in 8.8. In addition, wet chemical type extinguishers shall meet the requirements of 8.6.

Page 17, replace 8.2.4 by the following:

#### 8.2.4 Test schedule

The basic schedule of testing is a set of three fires. A Class A, Class B or Class F rating is achieved by extinguishing two out of three fires of the same size. Class D suitability for a particular metal or form of metal is established by extinguishing either the first fire of the set or, if this is not extinguished, extinguishing the second and third test fires.

A set comprises fires consecutively carried out and the result of any particular test fire is not to be disregarded. Each set is to be completed before another is started. For Class A, Class B and Class F fires, a set is completed either

- when all three test fires are carried out, or
- when the first two test fires are both successful or both unsuccessful.

For Class D fires, a set is complete

- when the first test is successful, or
- when the first and second fires are both unsuccessful, or
- when all three are carried out.

Now, on page 17, add the following subclause and renumber the subsequent subclauses:

#### 8.2.2 Class F

All flames are completely extinguished. There shall be no re-ignition of the vegetable oil

- for 20 min after discharge, or
  - until the temperature decreases to at least 35 °C below the auto-ignition temperature,
- whichever is the longer.

Page 26, insert the following subclauses:

### 8.7 Class F test fire

#### 8.7.1 Location

Carry out test fires indoors in a draught-free room of dimensions at least 6 m × 6 m, and 4 m high, and at an ambient temperature of between 10 °C and 30 °C.

#### 8.7.2 Construction

Details of Class F fires are given in Table 10, Figure 4 and Figure 5.


Class F test fires utilize a range of welded sheet metal trays (dimensions are given in Table 11 and Figures 7 and 8). The sides are vertical. The base of the trays are set horizontal and level with the surrounding ground or floor.

Each test fire is designated by a number followed by the letter F.

Table 10 — Fire rating and quantity of agent for Class F extinguishers

| Rating | Volume of cooking oil in test fire<br>litres | Test apparatus<br>mm              | Maximum agent quantity<br>litres or kg |
|--------|--|-----------------------------------|--|
| 5F     | $5^{+1}_0$                                   | Type A<br>diameter = 300          | 2                                      |
| 15F    | $15^{+1}_0$                                  | Type B<br>$X = 448$<br>$Y = 224$  | 3                                      |
| 25F    | $25^{+1}_0$                                  | Type B<br>$X = 578$<br>$Y = 289$  | 6                                      |
| 75F    | $75^{+1}_0$                                  | Type B<br>$X = 1000$<br>$Y = 500$ | 9                                      |


Dimensions in millimetres

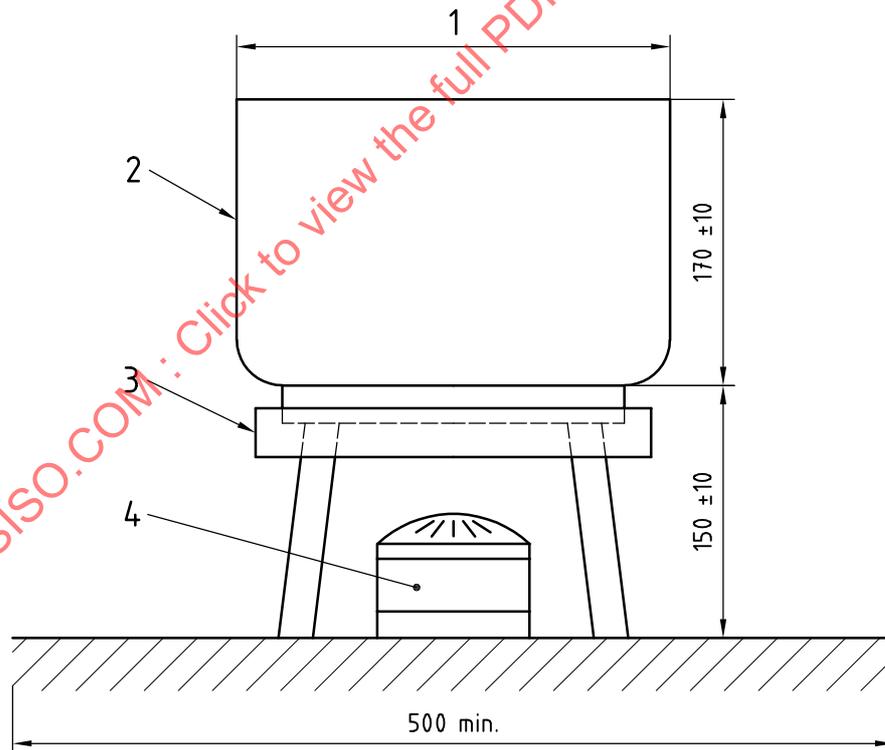

**Key**

- 1 Pan diameter
- 2 Nominal wall thickness: 2 mm
- 3 Skirt to suit burner type
- 4 Burner

Figure 4 — General dimensions for Class F test apparatus — Type A apparatus for Class 5F only

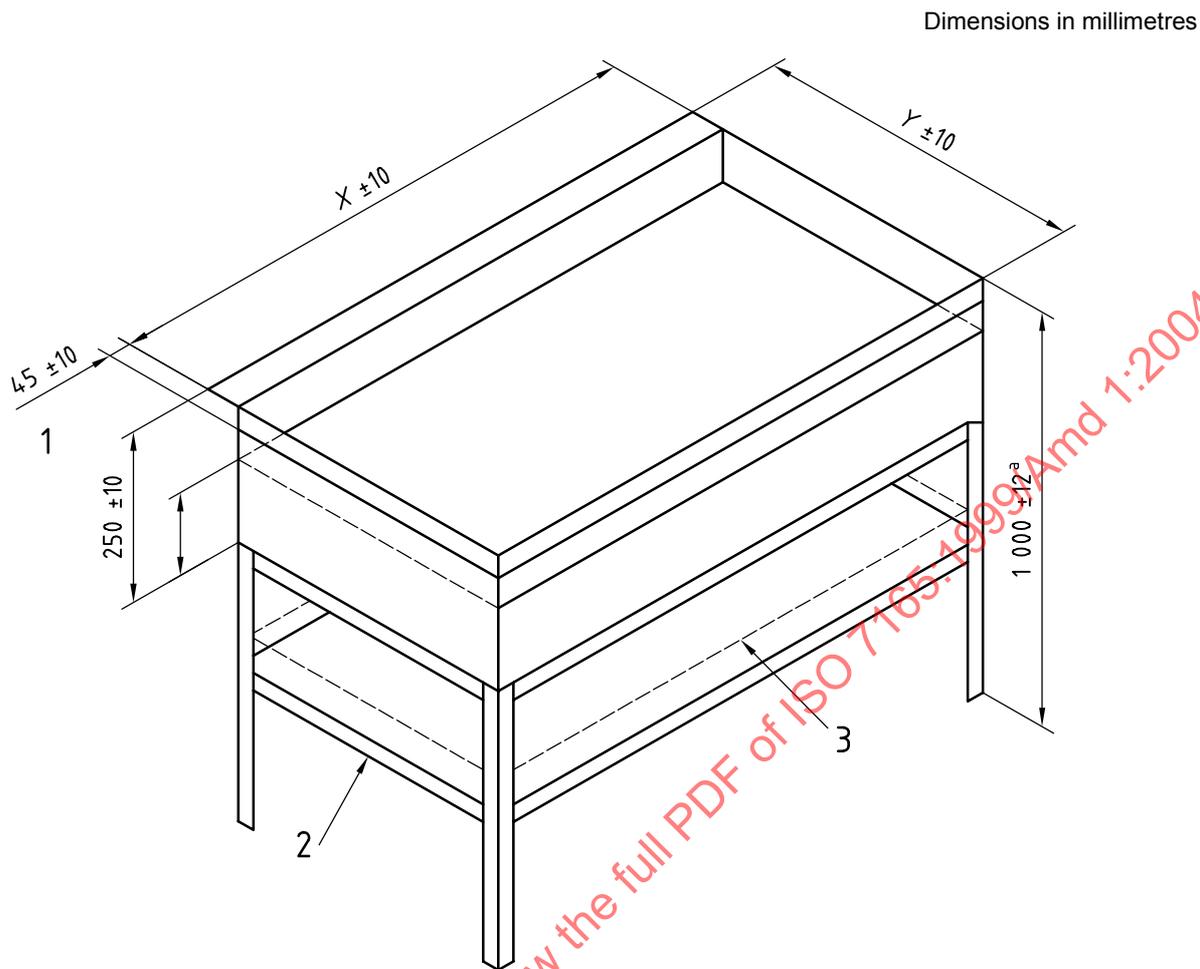

**Key**

- 1 Top edge
- 2 Tray to support gas burners (alternatively electric heating may be used)
- 3 Skirt to contain flames for gas heating (to prevent piloted ignition)

a To floor level.

**Figure 5 — General dimensions for Class F test apparatus —  
Type B apparatus for Class 15F, 25F and 75F**

**8.7.3 Fuel**

Class F fires shall be conducted using a vegetable oil having an auto-ignition temperature of not less than 360 °C.

**8.7.4 Procedure**

**8.7.4.1** Fire tests shall be carried out indoors. Heat the oil in the test tray using a suitable heating arrangement. Measure the oil temperature at a point 25 mm below the fuel surface, and not closer than 75 mm from the walls of the tray.

**8.7.4.2** The tray shall be heated, uncovered, at the maximum input rate of the heating source. The heating arrangement shall increase the temperature of the fuel at a rate of  $(5 \pm 2) \text{ }^\circ\text{C}$  and shall be recorded during the test between the temperature of 260 °C and the end of the test. Heat the oil until auto-ignition occurs.

**8.7.4.3** At auto-ignition, allow the fire to burn freely for 2 min. The energy source shall be turned off at auto-ignition. After the 2-min preburn, discharge the extinguisher onto the tray continuously or intermittently until the extinguisher is fully discharged. The discharge of the extinguisher onto the tray shall be at the distance specified on the extinguisher marking, but in no case shall this be less than 1 m between the nozzle and the tray.

**8.7.4.4** Use fresh fuel for each test.

## **8.8 Class F splash test**

### **8.8.1 Location**

Carry out test fires indoors in a draught-free room of dimensions at least 6 m × 6 m and 4 m high, and at an ambient temperature of between 10 °C and 30 °C.

### **8.8.2 Construction**

Details of Class F fires are given in Table 10, Figure 4 and Figure 5.

Class F test fires utilize a range of welded sheet metal trays. The sides shall be vertical. The base of the trays shall be set horizontal and level with the surrounding ground or floor.

Each test fire is designated by a number followed by the letter F.

### **8.8.3 Fuel**

Class F fires shall be conducted using a vegetable oil having an auto-ignition temperature of not less than 360 °C.

### **8.8.4 Procedure**

**8.8.4.1** The tray shall be heated, uncovered, at the maximum input rate of the heating source. The heating arrangement shall increase the temperature of the fuel at a rate of  $(5 \pm 2)$  °C and shall be recorded during the test between the temperature of 260 °C and the end of the test. Heat the oil until auto-ignition occurs.

**8.8.4.2** At auto-ignition the fire is to be allowed to burn freely for 2 min. The energy source shall be turned off at auto-ignition. After 2 min preburn, the extinguisher is to be discharged onto the tray continuously or intermittently until the extinguisher is fully discharged. The discharge of the extinguisher onto the tray shall be at the distance specified on the extinguisher marking, but in no case shall this be less than one metre between the nozzle and the tray.

**8.8.4.3** Use fresh fuel for each test.

Two tests shall be carried out with the extinguisher conditioned as follows:

- Test 1: condition for at least 18 h at the maximum operating temperature;
- Test 2: condition for at least 18 h at the minimum operating temperature.

### **8.8.5 Determination**

Place around the front and sides of the rectangular fire tray, or completely around the round fire tray, a flat metallic surface at least 750 mm wide with layer of sodium bicarbonate powder, not more than a 2 mm deep, on top of the surface. Heat the liquid oil in the fire tray by its heat source until a temperature of 175 °C to 190 °C is achieved. Each conditioned extinguisher shall be discharged toward the fire tray within 5 min of being conditioned, with the nozzle held at the distance specified by the manufacturer and shown on the nameplate, but not greater than 2 m. Measure the distance from the front edge of the tray to the nozzle.