
International Standard



8339

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION • МЕЖДУНАРОДНАЯ ОРГАНИЗАЦИЯ ПО СТАНДАРТИЗАЦИИ • ORGANISATION INTERNATIONALE DE NORMALISATION

Building construction — Jointing products — Sealants — Determination of tensile properties

Construction immobilière — Produits pour joints — Mastics — Détermination des propriétés de déformation sous traction

First edition — 1984-11-15

STANDARDSISO.COM : Click to view the full PDF of ISO 8339:1984

UDC 624.078.3 : 691.17 : 620.17

Ref. No. ISO 8339-1984 (E)

Descriptors : buildings, joints, sealing materials, putty, tests, determination, tensile properties.

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work.

Draft International Standards adopted by the technical committees are circulated to the member bodies for approval before their acceptance as International Standards by the ISO Council. They are approved in accordance with ISO procedures requiring at least 75 % approval by the member bodies voting.

International Standard ISO 8339 was prepared by Technical Committee ISO/TC 59, *Building construction*.

STANDARDSISO.COM : Click to view the full PDF of ISO 8339:1984

Building construction — Jointing products — Sealants — Determination of tensile properties

1 Scope and field of application

This International Standard specifies a method for the determination of the tensile properties of sealants used in joints in building construction.

NOTE — A method for the determination of tensile properties at maintained extension is specified in ISO 8340.

2 References

ISO 6927, *Building construction — Jointing products — Sealants — Vocabulary*.

ISO 8340, *Building construction — Jointing products — Sealants — Determination of tensile properties at maintained extension*.

3 Definitions

For the purpose of this International Standard, the definitions given in ISO 6927 apply.

4 Principle

Preparation of test specimens in which the sealant to be tested adheres to two parallel contact surfaces. Extension of the test specimens to rupture and recording the tensile properties on a force/strain diagram.

5 Apparatus

5.1 Concrete and/or aluminium and/or flat glass supports, for the preparation of test specimens (two supports are required for each test specimen), of dimensions as shown in figures 1 and 2.

NOTE — For testing sealants of high modulus with flat glass supports, adequate reinforcement of the flat glass supports shall be provided.

5.2 Spacers, of dimensions 12 mm × 12 mm × 12,5 mm, for the preparation of test specimens (see figures 1 and 2).

5.3 Anti-adherent substrate, for the preparation of the test specimens, e.g. polytetrafluoroethylene (PTFE) film or vellum-paper, preferably according to the advice of the sealant manufacturer.

5.4 Tensile test machine, with recording device, capable of extending the test specimens at a rate of 5 to 6 mm/min.

5.5 Refrigerated container, capable of holding the tensile test machine (5.4) and of operating at $(-20 \pm 2) ^\circ\text{C}$.

5.6 Convection-type oven, capable of being controlled at $(70 \pm 2) ^\circ\text{C}$.

5.7 Container, for immersing test specimens in water.

6 Preparation of test specimens

Two supports (5.1) and two spacers (5.2) shall be assembled according to figure 1 or 2 and set up on the anti-adherent substrate (5.3).

The instructions of the sealant manufacturer, for instance whether a primer is to be used, shall be followed.

The volume delimited by supports and spacers shall be filled with sealant, previously conditioned for 24 h at $(23 \pm 2) ^\circ\text{C}$. The following precautions shall be taken :

- avoid the formation of air bubbles;
- press the sealant on the inner surfaces of the supports;
- trim the sealant surface so that it is flush with the faces of the supports and spacers.

Then set the test specimens on edge and remove the anti-adherent substrate within 48 h so as to allow reticulation or complete drying of the sealant joint, with the spacers remaining for 28 days.

7 Conditioning

7.1 General

The test specimens shall be conditioned either in accordance with method A or method B, as agreed between the parties concerned.

After conditioning, the test specimens shall be stored for at least 24 h at $(23 \pm 2) ^\circ\text{C}$ and $(50 \pm 5) \%$ relative humidity before testing.

7.2 Method A

The test specimens shall be conditioned for 28 days at $(23 \pm 2) ^\circ\text{C}$ and $(50 \pm 5) \%$ relative humidity.

7.3 Method B

The test specimens shall be conditioned according to method A and shall then be subjected three times to the following storage cycle :

- a) 3 days in the oven (5.6) at $(70 \pm 2) ^\circ\text{C}$;
- b) 1 day in distilled water at $(23 \pm 1) ^\circ\text{C}$;
- c) 2 days in the oven (5.6) at $(70 \pm 2) ^\circ\text{C}$;
- d) 1 day in distilled water at $(23 \pm 1) ^\circ\text{C}$.

Alternatively, this cycle may be carried out in the order c) — d) — a) — b).

NOTE — Method B is a commonly used conditioning procedure using the influence of heat and water. It is not suitable for giving information on the durability of the sealant.

8 Procedure

The test shall be carried out at temperatures of $(23 \pm 2) ^\circ\text{C}$ and $(-20 \pm 2) ^\circ\text{C}$.

Three test specimens shall be tested at each temperature. When testing at $-20 ^\circ\text{C}$, the test specimens shall be preconditioned at $(-20 \pm 2) ^\circ\text{C}$, for at least 4 h before the start of the test.

Remove the spacers for the preparation of the test specimens, place the test specimen in the tensile test machine (5.4) and extend it at a rate of 5 to 6 mm/min until rupture occurs.

9 Test report

The test report shall make reference to this International Standard and shall include the following information :

- a) name and type of sealant;
- b) batch of sealant from which the test specimens were produced, if possible;
- c) type or types of support material (see 5.1);
- d) the primer used, if applicable;
- e) the method of conditioning used (see clause 7);
- f) force/strain diagrams for the test specimens, indicating the force, in newtons, and the strain as the ratio of the elongation of the test specimen to the original width, as a percentage;
- g) type of rupture (adhesion and/or cohesion break);
- h) any deviations from the specified test conditions.

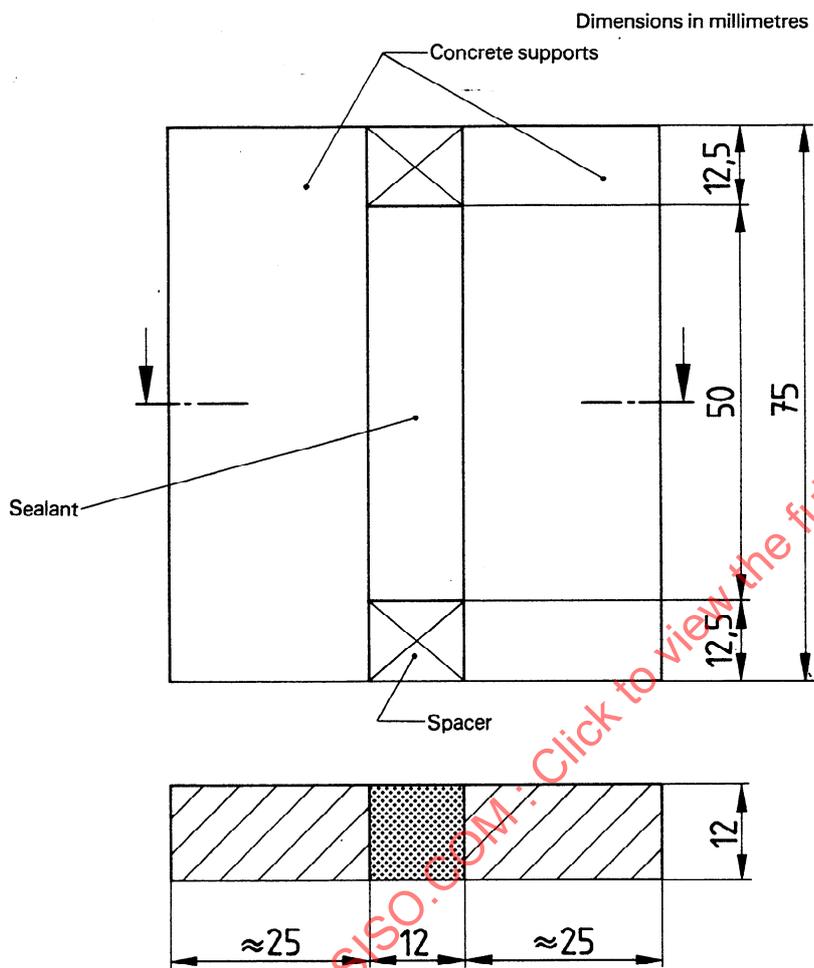


Figure 1 – Test specimen with concrete supports

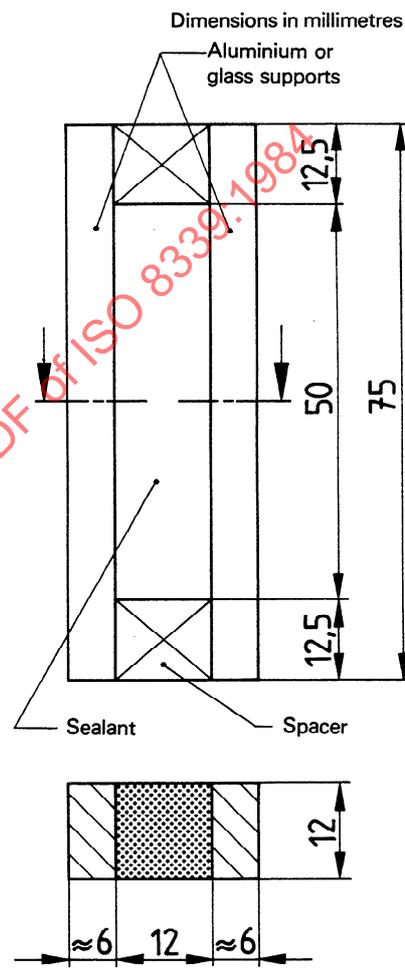


Figure 2 – Test specimen with aluminium or glass supports

This page intentionally left blank

STANDARDSISO.COM : Click to view the full PDF of ISO 8339:1984