
**Fire-resistance tests — Elements
of building construction —**

Part 5:

**Specific requirements for loadbearing
horizontal separating elements**

Essais de résistance au feu — Éléments de construction —

*Partie 5: Exigences spécifiques relatives aux éléments porteurs
horizontaux de séparation*



PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

STANDARDSISO.COM : Click to view the full PDF of ISO 834-5:2000

© ISO 2000

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.ch
Web www.iso.ch

Printed in Switzerland

Contents

Page

Foreword.....	iv
Introduction.....	v
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Symbols and abbreviated terms	2
5 Test equipment	3
6 Test conditions	3
6.1 General.....	3
6.2 Restraint and boundary conditions	3
6.3 Loading.....	3
7 Test specimen preparation.....	4
7.1 Specimen design	4
7.2 Specimen size	4
7.3 Number of test specimens.....	6
7.4 Specimen conditioning	6
7.5 Specimen installation and restraint.....	6
8 Application of instrumentation.....	7
8.1 Furnace thermocouples (plate thermometers)	7
8.2 Unexposed surface thermocouples.....	7
8.3 Deformation measurement	7
9 Test procedure.....	7
9.1 Load application	7
9.2 Furnace control.....	7
9.3 Measurements and observations.....	7
10 Performance criteria.....	7
11 Validity of test	8
12 Expression of results	8
13 Test report.....	8
Annex A (informative) Direct application of results.....	9

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 3.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this part of ISO 834 may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

International Standard ISO 834-5 was prepared by Technical Committee ISO/TC 92, *Fire safety*, Subcommittee SC 2, *Fire containment*.

ISO 834 consists of the following parts, under the general title *Fire-resistance tests — Elements of building construction*:

- *Part 1: General requirements*
- *Part 3: Commentary on test method and test data application*
- *Part 4: Specific requirements for loadbearing vertical separating elements*
- *Part 5: Specific requirements for loadbearing horizontal separating elements*
- *Part 6: Specific requirements for beams*
- *Part 7: Specific requirements for columns*
- *Part 8: Specific requirements for non-loadbearing vertical separating elements*
- *Part 9: Specific requirements for non-loadbearing horizontal separating elements*
- *Part 10: Method to determine the contribution of applied protection materials to structural metallic elements*
- *Part 11: Method to assess the contribution of applied protection materials to structural metallic elements*

Annex A of this part of ISO 834 is for information only.

Introduction

This part of ISO 834 contains specific requirements for fire-resistance testing which are unique to the elements of building construction described as horizontal separating loadbearing elements. The requirements for these loadbearing elements are intended to be applied in appropriate conjunction with the detailed and general requirements contained in ISO 834-1.

STANDARDSISO.COM : Click to view the full PDF of ISO 834-5:2000

Fire-resistance tests — Elements of building construction —

Part 5: Specific requirements for loadbearing horizontal separating elements

1 Scope

This part of ISO 834 specifies the procedures to be followed for determining the fire resistance of loadbearing horizontal separating elements when exposed to heating from the underside.

The test is also appropriate for the evaluation of loadbearing separating elements containing beams when it is not possible to test the floor or roof assembly in a representative manner without them. However, the data cannot be transferred directly one to the other.

The application of this test to other untested forms of construction is acceptable when the construction complies with the direct field of application as given in this part of ISO 834 or when subjected to an extended application analysis in accordance with ISO/TR 12470. Since ISO/TR 12470 gives only general guidelines, specific extended application analyses are to be performed only by persons expert in fire-resistant constructions.

2 Normative references

The following normative documents contain provisions which, through reference in this text, constitute provisions of this part of ISO 834. For dated references, subsequent amendments to, or revisions of, any of these publications do not apply. However, parties to agreements based on this part of ISO 834 are encouraged to investigate the possibility of applying the most recent editions of the normative documents indicated below. For undated references, the latest edition of the normative document referred to applies. Members of ISO and IEC maintain registers of currently valid International Standards.

ISO 834-1:1999, *Fire-resistance tests — Elements of building construction — Part 1: General requirements*.

ISO 834-6, *Fire-resistance tests — Elements of building construction — Part 6: Specific requirements for beams*.

ISO/TR 12470, *Fire resistance tests — Guidance on the application and extension of results*.

ISO/IEC 13943, *Fire safety — Vocabulary*.

3 Terms and definitions

For the purposes of this part of ISO 834, the terms and definitions given in ISO 834-1 and ISO 13943 and the following apply.

3.1

beams

all horizontally oriented structural members employed in building construction and known variously as beams, joists or girders

NOTE They may be integral with or separate from the structure that they support.

3.2

exposed length

length of the specimen exposed to the heating effects of the test furnace

3.3

exposed width

width of the specimen exposed to the heating effects of the test furnace

3.4

floor

horizontal separating element of a building construction which is loadbearing

3.5

horizontal separating element

loadbearing, horizontally oriented floors and roofs which are required to act as fire separations or fire barriers, which divide buildings into fire compartments or fire zones, or which separate a building from adjoining buildings in order to resist the spread of fire to or from compartments or buildings

3.6

plenum

concealed space between a ceiling and a floor or roof, often, but not necessarily designed to accommodate air movement

3.7

roof

horizontal separating element of a building construction which is loadbearing

3.8

span

distance between the centres of support

3.8

specimen length

overall length of the test specimen

3.9

specimen width

overall width of the test specimen

3.10

suspended ceiling

non-loadbearing horizontal protective membrane that is suspended from or fixed directly to a loadbearing horizontal separating element and its supporting framework, including hangers, services (e.g. lighting and ventilation systems), insulating materials, and access and inspection panels

4 Symbols and abbreviated terms

Symbols and designations appropriate to this test are given in ISO 834-1 and as follows:

L_{exp}	Length of test specimen exposed to heating	mm
L_{sup}	Length of test specimen between the centres of supports	mm
L_{spec}	Length of test specimen	mm
W_{exp}	Width of the test specimen exposed to heating	mm
W_{sup}	The transverse span of a two-way spanning test specimen	mm
W_{spec}	Width of the test specimen	mm

5 Test equipment

Equipment employed in the conduct of this test consists of a furnace, loading equipment, restraint and support frames and instrumentation as specified in ISO 834-1.

6 Test conditions

6.1 General

The heating and pressure conditions, the furnace atmosphere and loading conditions shall conform to those specified in ISO 834-1.

6.2 Restraint and boundary conditions

Restraint and boundary conditions shall comply with the requirements given in ISO 834-1 and the requirements of this part of ISO 834.

6.3 Loading

6.3.1 All loadbearing horizontal separating elements shall be tested when subjected to loads calculated in accordance with subclause 6.3 a), b) or c) of ISO 834-1:1999, in consultation with the sponsor to produce the conditions the structure is designed to accommodate. The material properties utilized in the calculation of the load shall be clearly indicated and their source given.

6.3.2 When the proposed test specimen is smaller than the element in practice, it is important that the size of the test specimen, the type and level of loading and the support conditions be selected such that the same type of failure (for instance, a bending failure, a shear failure or a bond or an anchorage failure) will be decisive for the test specimen as for the construction it represents; i.e. the load applied during the test shall provide the same load level as the real construction. For cases in which the decisive type of failure is difficult to predict, two or more tests, individually designed to cover in total all relevant types of failure, shall be required.

6.3.3 The magnitude and the distribution of the load shall be such that the maximum moments and shear forces produced are representative of, or higher than, those expected in practice.

6.3.4 The loading system shall be capable of applying the required load uniformly distributed over the surface by weights or hydraulic jacks such that at any single application point the load is not more than 10 % of the total load. This is permitted to be exceeded when it is necessary to accommodate concentrated loading or additional loading over structural members. The contact area between the load point and the horizontal separating element surface shall be through a pad not smaller than 0,01 m² and no greater than 0,09 m² individually, and shall not exceed 16 % of the total surface area. If the plates are made of steel or of materials with a similar high conductivity, they shall be insulated from the surface of the test specimen. The loading system shall not inhibit the free movement of air above the top surface and, other than at the loading point, no part of the loading apparatus shall be closer than 60 mm from the surface.

6.3.5 The loading system shall be capable of compensating for the maximum allowable deformation of the test specimen.

6.3.6 When the floor or roof contains one or more structural beams, the additional requirements in ISO 834-6 shall apply. When the loading requirements of a horizontal assembly includes the application of an additional point or line load over a beam that is an integral part of the assembly, the loading apparatus shall be capable of applying such loads.

7 Test specimen preparation

7.1 Specimen design

The specimen shall be designed to characterize the many aspects of the construction for which the desired rating is sought. Differently constituted forms of the same detail shall be avoided.


When the test assembly includes a ceiling, the dimensions of the ceiling shall correspond with L_{exp} and W_{exp} and its performance shall be assessed as an integral part of the complete assembly and comply with the following requirements.

- a) The ceiling shall be installed from below in accordance with methods and procedures given in an installation manual or provided by the sponsor and represent conditions of use.
- b) The test specimen shall include the in-practice components for suspension or fixing, expansion and abutting. When ceilings incorporate services (such as lighting or air handling systems) which are an integral part of the design of the ceiling, these shall be included in the test specimen and distributed as in practice.
- c) When the ceiling design includes both longitudinal and transverse joints, the test specimen shall include both. The devices bearing the ceiling components shall be installed against each other without any gaps, unless a gap or gaps are required for design purposes. Such gaps shall be representative of practice and located within the field of the ceiling and not at its perimeter.
- d) Edges between the ceiling and walls and the joints and jointing materials shall be representative of that in practice. The ceiling shall be installed to prohibit thermal elongation, with no allowance for longitudinal movement of the edges or thermal expansion in either direction other than that provided for in the ceiling system. Grid members shall be tightly fitted at the periphery to evaluate the thermal expansion behaviour of grid members and expansion devices.
- e) When the longitudinal and transverse directions of the ceiling are constructed differently, and the performance of the test specimen varies depending upon the direction aligned with the longitudinal axis, the ceiling shall be designed to represent the more onerous condition by arranging the more critical components parallel to the longitudinal axis. When the more onerous orientation cannot be identified, two separate tests shall be required with components arranged both parallel and perpendicular to the longitudinal axis.
- f) When services do not form an integral part of the ceiling but may be fitted subsequently in a manner that may affect the fire resistance of the ceiling, a separate test incorporating these services shall be required.

7.2 Specimen size

7.2.1 Floors supported on rollers

7.2.1.1 Standard conditions (floors supported on rollers) are addressed in 7.2.1.2 and 7.2.1.3. A general arrangement of a simply supported floor in the furnace is shown in Figure 1.

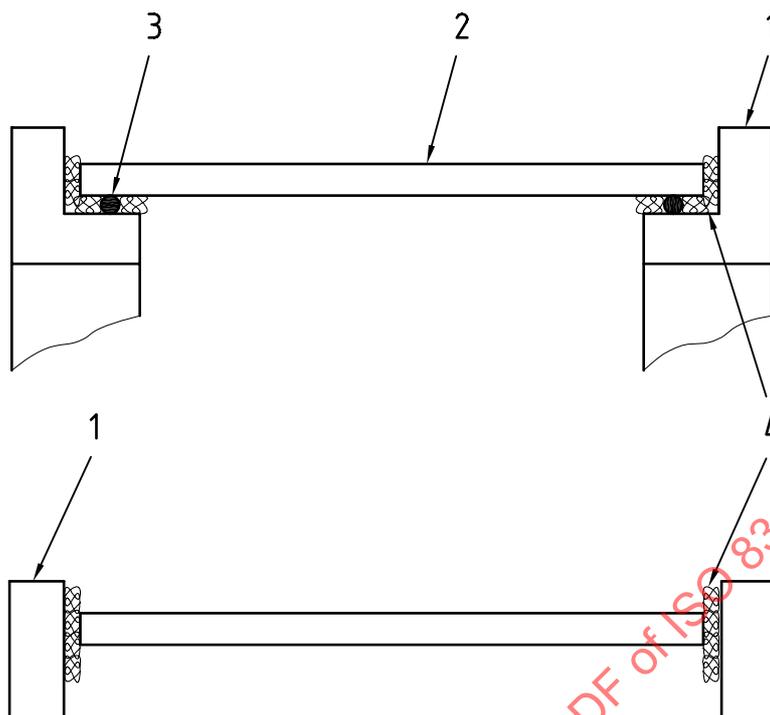

Key

- | | | | |
|---|---------------|---|---------------|
| 1 | Furnace | 3 | Roller or rod |
| 2 | Test assembly | 4 | Insulation |

Figure 1 — Example of a simply supported test specimen

7.2.1.2 The exposed length (L_{exp}) shall not be less than 4 m. The span between supports (L_{sup}) shall be the exposed length (L_{exp}) plus up to a maximum of 100 mm at each end. The specimen length (L_{spec}) shall be the exposed length (L_{exp}) plus up to a maximum of 200 mm at each end.

7.2.1.3 The width of the test specimen (W_{spec}) shall equal the exposed width (W_{exp}) and shall not be less than 3 m. Exception: not less than 2 m for one-way spanning simply supported constructions that do not include a structural member or a ceiling.

7.2.2 Conditions in practice

7.2.2.1 Floors supported representative of conditions in practice are addressed in 7.2.2.2 through 7.2.2.5.

7.2.2.2 The exposed length (L_{exp}) shall not be less than 4 m when the exposed length of the floor in practice is longer than can be accommodated in the furnace. For constructions designed to have an exposed length in practice of less than 4 m, the actual exposed length shall be tested. The length of bearing shall not exceed that in practice. The specimen length (L_{spec}) shall be the exposed length (L_{exp}) plus up to a maximum of 200 mm at each end.

For constructions that include a restrained beam, a 4 m minimum span is inadequate because only a portion of the beam would be expected to be in bending mode, the remainder being partially supported by the restraint mechanism. Therefore, a longer span in which at least 4 m is subjected to positive bending moments shall be selected. If $X\%$ of the beam is expected to be in positive bending mode, the overall length shall be given by $L_{exp} = 4 \times 100/X$ m.

7.2.2.3 The width of the test specimen exposed to heating (W_{exp}) shall not be less than 3 m. For constructions designed to have an exposed width in practice of less than 3 m, the actual exposed width shall be tested.

7.2.2.4 For one-way spanning constructions, the transverse span (W_{sup}) shall equal the exposed width (W_{exp}).

7.2.2.5 For constructions that include structural members that span two ways, the transverse span (W_{sup}) shall be the exposed width (W_{exp}) plus up to half the length of bearing at each transverse end. The length of bearing shall be selected so that the difference between (W_{sup}) and (W_{exp}) does not exceed that in practice. The specimen width (W_{spec}) shall be the exposed width (W_{exp}) plus up to a maximum of 200 mm at each end.

7.3 Number of test specimens

The number of test specimens shall comply with the requirements given herein and in ISO 834-1.

7.4 Specimen conditioning

At the time of the test the strength and moisture content of the test specimens shall approximate the conditions expected in normal service. This includes any in-fills and jointing materials. Guidance on conditioning is given in ISO 834-1. After equilibrium has been achieved the moisture content or state of cure shall be determined and recorded. Any supporting construction, including the lining to the test frame is exempt from this requirement.

7.5 Specimen installation and restraint

7.5.1 Loadbearing horizontal separating elements are either subjected to fire exposure while resting on roller supports (simply supported) or simulating the end conditions as in practice. When support and restraints represent in-practice conditions, those conditions shall be described in the report and the test results shall be reported as restricted.

7.5.2 Test specimens representing floors or roofs shall normally be tested on roller supports. When the end conditions are known, the test construction may be installed as in practice with smooth concrete or steel plate bearing surfaces.

7.5.3 Simply supported specimens shall be positioned to allow freedom for longitudinal movement and vertical deflection and to remove any fixity induced by frictional resistance.

7.5.4 The apparatus utilized for providing restraint to thermal expansion, axially or rotationally, shall be designed or adapted for the forces to be expected as a consequence of thermal expansion and the required restraint.

7.5.5 When a test incorporates more than one beam, each beam shall be exposed to the specified conditions and shall be loaded to act independently.

7.5.6 Any gaps at the boundaries shall be sealed with a non-restraining, non-combustible material.

7.5.7 Resilient material of adequate fire performance shall seal and protect the supports and prevent the leakage of hot gases having any influence on end conditions during the test.

7.5.8 When a specimen is smaller than the test frame opening, a supporting construction shall be used to reduce the opening to the required dimension. Supporting constructions shall not be subject to the specimen conditioning requirements unless there is likely to be a contribution from it to the performance of the test specimen. When a beam is used between the supporting construction and the separating element, the design of the connection between the separating element and the beam, including any fixings and materials to make the junction, shall be as used in practice and shall be regarded as part of the test specimen. The supporting construction is to be considered part of the test frame.

7.5.9 All connections between the test specimen and supporting construction or test frame shall reproduce the normal levels of restraint. The stiffness of the supporting construction shall also sufficiently reproduce normal levels of restraint.