

INTERNATIONAL STANDARD

ISO
8528-1

First edition
1993-04-15

Reciprocating internal combustion engine driven alternating current generating sets —

Part 1:

Application, ratings and performance

*Groupes électrogènes à courant alternatif entraînés par moteurs
alternatifs à combustion interne —*

Partie 1: Application, caractéristiques et performances



Reference number
ISO 8528-1:1993(E)

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

International Standard ISO 8528-1 was prepared by Technical Committee ISO/TC 70, *Internal combustion engines*, Sub-Committee SC 2, *Performance and tests*.

ISO 8528 consists of the following parts, under the general title *Reciprocating internal combustion engine driven alternating current generating sets*:

- *Part 1: Application, ratings and performance*
- *Part 2: Engines*
- *Part 3: Alternating current generators for generating sets*
- *Part 4: Controlgear and switchgear*
- *Part 5: Generating sets*
- *Part 6: Test methods*
- *Part 7: Technical declarations for specification and design*
- *Part 8: Low-power general-purpose generating sets*
- *Part 9: Measurement and evaluation of mechanical vibration*

© ISO 1993

All rights reserved. No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Organization for Standardization
Case Postale 56 • CH-1211 Genève 20 • Switzerland

Printed in Switzerland

- *Part 10: Measurement of airborne noise — Enveloping surface method*
- *Part 11: Security generating sets with uninterruptible power systems*

Parts 7, 8, 9 and 10 are in course of preparation. Part 11 is at an early stage of preparation and may be split into two parts.

STANDARDSISO.COM : Click to view the full PDF of ISO 8528-1:1993

This page intentionally left blank

STANDARDSISO.COM : Click to view the full PDF of ISO 8528-1:1993

Reciprocating internal combustion engine driven alternating current generating sets —

Part 1:

Application, ratings and performance

1 Scope

This part of ISO 8528 defines various classifications for the applications, ratings and performance which arise out of the combination of generating sets consisting of a reciprocating internal combustion (RIC) engine, alternating current (a.c.) generator, controlgear, switchgear and auxiliary equipment.

It applies to a.c. generating sets driven by RIC engines for land and marine use, excluding generating sets used on aircraft or to propel land vehicles and locomotives.

For some specific applications (for example, essential hospital supplies, high-rise buildings, etc.) supplementary requirements may be necessary. The provisions of this part of ISO 8528 should be regarded as a basis.

For other reciprocating-type prime movers (e.g. sewage-gas engines, steam engines), the provisions of this part of ISO 8528 should be used as a basis.

The generating sets according to this International Standard are used to generate electrical power for continuous, peak-load and standby supplies. The classifications laid down in this part of ISO 8528 are intended to help understanding between manufacturer and customer.

2 Normative references

The following standards contain provisions which, through reference in this text, constitute provisions of this part of ISO 8528. At the time of publication, the editions indicated were valid. All standards are subject to revision, and parties to agreements based on this part of ISO 8528 are encouraged to investigate the possibility of applying the most recent edi-

tions of the standards indicated below. Members of IEC and ISO maintain registers of currently valid International Standards.

ISO 3046-1:1986, *Reciprocating internal combustion engines — Performance — Part 1: Standard reference conditions and declarations of power, fuel consumption and lubricating oil consumption.*

ISO 8528-2:1993, *Reciprocating internal combustion engine driven alternating current generating sets — Part 2: Engines.*

ISO 8528-3:1993, *Reciprocating internal combustion engine driven alternating current generating sets — Part 3: Alternating current generators for generating sets.*

ISO 8528-4:1993, *Reciprocating internal combustion engine driven alternating current generating sets — Part 4: Controlgear and switchgear.*

ISO 8528-5:1993, *Reciprocating internal combustion engine driven alternating current generating sets — Part 5: Generating sets.*

IEC 34-1:1983, *Rotating electrical machines — Part 1: Rating and performance.*

IEC 298:1990, *A.C. metal-enclosed switchgear and controlgear for rated voltages above 1 kV and up to and including 52 kV.*

IEC 439-1:1985, *Low-voltage switchgear and controlgear assemblies — Part 1: Requirements for type-tested and partially type-tested assemblies.*

IEC 439-2:1987, *Low-voltage switchgear and controlgear assemblies — Part 2: Particular requirements for busbar trunking systems (busways).*

3 Symbols and abbreviations

P	Power, in kilowatts
p_r	Total barometric pressure, in kilopascals
T_{cr}	Charge air coolant temperature, in kelvins
T_r	Air temperature, in kelvins
t	Time, in seconds
ϕ_r	Relative humidity, as a percentage
a.c.	Alternating current
COP	Continuous power
LTP	Limited-time running power
PRP	Prime power

4 Other regulations and additional requirements

4.1 For a.c. generating sets used on board ships and offshore installations which have to comply with rules of a classification society, the additional requirements of the classification society shall be observed. The classification society shall be stated by the customer prior to placing of the order.

For a.c. generating sets operating in non-classed equipment, such additional requirements are in each case subject to agreement between the manufacturer and customer.

4.2 If special requirements from regulations of any other authority (e.g. inspecting and/or legislative authorities) have to be met, the authority shall be stated by the customer prior to placing of the order.

Any further additional requirements shall be subject to agreement between the manufacturer and customer.

5 General description

5.1 Generating set

A generating set consists of one or more RIC engines to produce mechanical energy and one or more generators to convert the mechanical energy into electrical energy together with components for transmitting the mechanical energy (for example, couplings, gearbox) and, where applicable, bearing and mounting components.

5.1.1 Prime movers

These may be of two types:

- compression-ignition engines, and
- spark-ignition engines.

Depending on the application of the generating set, the following criteria, among others, may be important for the selection of the prime mover to be used:

- quality of fuel and fuel consumption;
- exhaust gas and noise emission;
- speed range;
- mass and dimensions;
- sudden loading and frequency behaviour;
- short-circuit characteristics of the generator;
- cooling systems;
- starting systems;
- maintenance;
- waste heat utilization.

5.1.2 Generators

These may be of two types:

- synchronous generators, and
- asynchronous generators.

Depending on the application of the generating set, the following criteria, among others, may be important for the selection of the generator to be used:

- voltage characteristics during starting, nominal operation and overload operation, as well as after load changes taking into account the power factor;
- short-circuit behaviour (electrical, mechanical);
- efficiency;
- generator design and type of enclosure;
- parallel-operation behaviour;
- maintenance.

5.1.3 Controlgear and switchgear

Equipment for control, switching and monitoring is combined into controlgear and switchgear systems, for the operation of the generating set.

5.1.4 Auxiliaries

Auxiliaries are items of equipment essential for the operation of the generating set, such as

- starting system;
- air intake and exhaust gas systems;
- cooling system;
- lubricating oil system;
- fuel system (including fuel treatment where applicable);
- auxiliary electrical power supply.

5.2 Power station

A power station comprises one or more generating sets and their auxiliary equipment, the associated controlgear and switchgear and, where applicable, the place of installation (e.g. a building, an enclosure or special equipment for protection from the weather).

6 Application criteria

6.1 Modes of operation

The mode of operation of the generating set may affect certain important characteristics (e.g. its economical and reliable operation, the intervals between maintenance and repair), and shall be taken into account by the customer when agreeing the requirements with the manufacturer (see also clause 11).

6.1.1 Continuous operation

Continuous operation is operation of a generating set without a time limit, but considering the maintenance period.

6.1.2 Limited-time operation

Limited-time operation is operation of the generating set for a limited time.

NOTE 1 The demand for electrical power from the connected equipment is supplied from the mains and only in the event of failure of the latter is it supplied by an internal generating set. If there is a failure in the normal power supply, the internal generating set, operating as a back-up or emergency supply, provides a supply temporarily or for a limited time for

- a) safety equipment (e.g. during the evacuation of a building);
- b) connected equipment which is important for the purposes of operation, to maintain emergency operation;
- c) the entire group of connected equipment or part thereof.

The electrical power generated is used to cover a peak demand (peak-load operation).

There is no mains supply and the generating set is only operated from time to time.

6.2 Site criteria

6.2.1 Land use

Land use covers generating sets, either fixed, transportable or mobile, which are used on land.

6.2.2 Marine use

Marine use covers generating sets used on board ships and offshore installations.

6.3 Single and parallel operation

Generating sets may have two types of operation, defined in 6.3.1 and 6.3.2.

6.3.1 Single operation

Single operation refers to a generating set, irrespective of its configuration or modes of start-up and control, which will operate as the sole source of electrical power and without the support of other sources of electrical supply.

6.3.2 Parallel operation

Parallel operation refers to the electrical connection of a generating set to another source of electrical supply with the same voltage, frequency and phase to share the power supply for the connected network. The characteristics of the mains supply, including range and variation of voltage, frequency, impedance of the network, etc., shall be stated by the customer.

6.3.2.1 Parallel operation by generating sets

In this type of operation, two or more generating sets are electrically connected (not mechanically connected) after having been brought into synchronism. Generating sets with different outputs and speeds can be used.

6.3.2.2 Operation in parallel with mains

In this type of operation, one or more parallel-operating generating sets (as described in 6.3.2.1) are electricity connected to a mains supply.

NOTES

2 In the case of a public mains, permission for parallel operation has to be obtained from the public electricity board. Protective equipment has to be harmonized.

3 This also applies to generating sets which, in order to check the start-up, have to run supplying power into the mains for a time period laid down by the generating set manufacturer.

6.4 Modes of start-up and control

The modes of start-up and control involved in the operation of a generating set are normally

- starting,
- monitoring,
- voltage and frequency adjusting and synchronization where applicable,

- switching, and
- stopping.

These can be fully or partly manual or automatic (see also ISO 8528-4).

6.4.1 Manual operation

Manual operation covers generating sets which are started and controlled manually.

6.4.2 Semi-automatic operation

Semi-automatic operation covers generating sets in which some of the functions are started and controlled manually and the remainder automatically.

6.4.3 Automatic operation

Automatic operation covers generating sets which are started and controlled automatically.

6.5 Start-up time

The start-up time is the time from the moment when power is first required to the moment when it is first available. It shall meet the demands of the particular application.

6.5.1 Generating set with no specified start-up time

This is a generating set where, due to the conditions under which it operates, the start-up time is of no importance. Such generating sets are normally started manually.

6.5.2 Generating set with specified start-up time

This is a generating set where the start-up time is specified; starting is normally automatic. Such generating sets may be further classified (see 6.5.2.1 to 6.5.2.3).

6.5.2.1 Long-break set

This is a generating set with a specified start-up time (defined in seconds). The time between a power supply failure and power from the generating set being available is fairly long. In this case the entire set is started from the stationary condition after power is demanded.

6.5.2.2 Short-break set

This is a generating set with running electrical machines where the power supply is interrupted while the necessary switchgear change-over takes place, for a time defined in milliseconds. A source of stored mechanical energy is used to supply power to the

connected equipment for a short period and, where necessary, to start and accelerate the RIC engine.

6.5.2.3 No-break set

This is a generating set with continuously running electrical machines that ensure an uninterrupted supply of power in the event of mains failure. A source of stored mechanical energy is used to supply power to the connected equipment for a short period and, where necessary, to start and accelerate the RIC engine. As the drive is transferred from one power source to another there may be a temporary deviation in frequency.

NOTE 4 It is essential that the size of the permitted deviation in frequency during the change-over is agreed between customer and manufacturer.

7 Performance classes

Four performance classes are specified to cover the various requirements of the supplied electrical systems: see 7.1 to 7.4.

7.1 Performance class G1

This is required for application where the connected loads are such that only basic parameters of voltage and frequency need to be specified.

EXAMPLES

General-purpose applications (lighting and other simple electrical loads).

7.2 Performance class G2

This is required for applications where the demands on voltage characteristics are very much the same as for the commercial power system. When load changes occur, there may be temporary but acceptable deviations of voltage and frequency.

EXAMPLES

Lighting systems; pumps, fans and hoists.

7.3 Performance class G3

This is required for applications where the connected equipment may make severe demands on frequency, voltage and waveform characteristics.

EXAMPLES

Telecommunications and thyristor-controlled loads. It should be especially recognized that both rectifier and thyristor-controlled loads may need special consideration with respect to their effect on generator-voltage waveform.

7.4 Performance class G4

This is required for applications where the demands made on the frequency, voltage and waveform characteristics are exceptionally severe.

EXAMPLES

Data-processing equipment or computer systems.

8 Installation features

Requirements to meet local regulations may affect the design of the generating set. They shall be taken into account by the customer and manufacturer in addition to the installation features given in 8.1 to 8.5.

8.1 Installation configurations

The installation configurations in 8.1.1 to 8.1.3 may or may not have all necessary auxiliary equipment integrally mounted.

8.1.1 Fixed

This configuration includes all generating sets which are permanently installed.

8.1.2 Transportable

This configuration includes all generating sets not permanently installed or mobile.

8.1.3 Mobile

This configuration includes all generating sets having an integral chassis fitted with wheels whereby the generating set is mobile.

8.2 Generating set configurations

In order to simplify contractual information for various RIC engine-driven generating set applications, some typical set configurations are given below:

- A: without baseframe;
- B: with baseframe;
- C: with baseframe, integrally mounted controlgear, switchgear and auxiliaries;
- D: configuration as given in C with enclosure (see also clause 9);
- E: configuration as given in C having an integral set of wheels or mounted on a trailer (see also 8.1.3).

8.3 Types of mounting

The type of mounting (see 8.3.1 to 8.3.3) should be agreed between the customer and the generating set manufacturer.

8.3.1 Rigid mounting

This is mounting the generating set without the use of resilient mountings. If foundations for mounting generating sets are set up on substrates of low elasticity, for example cork tiles, with no resilient layers inserted, the method of mounting is considered to be rigid.

8.3.2 Resilient mounting

This is mounting the generating set with the use of resilient mountings. For special applications (for example, marine or mobile), restrained resilient mountings may be required.

8.3.2.1 Fully resilient mounting

Fully resilient mounting is mounting the RIC engine and the generator resiliently on a baseframe or a foundation with components to provide insulation against vibration.

8.3.2.2 Semi-resilient mounting

Semi-resilient mounting is mounting the RIC engine resiliently with the use of components to provide insulation against vibration and mounting the generator rigidly on a baseframe or a foundation.

8.3.3 Mounting on resilient foundation

This is mounting the generating set on a resilient foundation (damping mass) which is isolated from the load-bearing foundation by, for example, anti-vibration mounts.

8.4 Connection between engine and generator

The connection between the RIC engine and the a.c. generator is determined by the type of components transmitting the power and the assembly between the engine and the generator. It depends on the design of the engine, generator and mounting, the power and the speed.

8.4.1 Coupling arrangements

Typical coupling arrangements are rigid, torsionally rigid, flexible, torsionally flexible or clutch coupling.

8.4.2 Assembly arrangements

The assembly between the RIC engine and the generator may be with or without flange housing.

8.5 Additional installation features — Weather effects

8.5.1 Inside installation

This is installation of the generating set in places where it is not exposed to the direct effects of weather. Consideration shall be given to maximum and minimum room temperatures.

8.5.2 Outside installation with protection from weather

This may be subdivided into

- installation in a protective enclosure;
- installation under a protective roof.

8.5.3 Open-air installation

This is installation in the open, fully exposed to the weather.

9 Emissions

When a generating set operates, it produces emissions including noise, vibration, heat, waste gases and electromagnetic disturbances. Any applicable legislation relating to the protection of the environment and to the health and safety of personnel shall be taken into account by the manufacturer and customer at the time of agreeing a performance specification.

10 Standard reference conditions

In determining the rated power of the generating set, it should be noted that different standard reference conditions apply to the engine, a.c. generator and switchgear.

For conditions on site, see clause 11.

10.1 For the rated power of the RIC engine, the following standard reference conditions apply in accordance with ISO 3046-1:

- total barometric pressure, p_r : 100 kPa (1 000 mbar)
- air temperature, T_r : 298 K (25 °C)
- relative humidity, ϕ_r : 30 %
- charge air coolant temperature, T_{cr} : 298 K (25 °C)

10.2 For the rated power of the a.c. generator, the following standard reference conditions apply in accordance with IEC 34-1 and ISO 8528-3:

- cooling air temperature: below 313 K (40 °C)
- coolant temperature at cooler inlet: below 298 K (25 °C)

- altitude: up to 1 000 m above sea level

10.3 For the ratings of the controlgear and switchgear equipment, the following standard reference conditions apply in accordance with IEC 298, IEC 439-1 and IEC 439-2:

- ambient temperature, temporary maximum: 313 K (40 °C)
- relative humidity: 50 % at 313 K (40 °C)
- altitude: up to 2 000 m above sea level

11 Site conditions

The site conditions under which a generating set is required to operate may affect certain characteristics of the set; they shall be taken into account by the customer and manufacturer.

These conditions shall be clearly defined by the customer and any particular hazardous conditions, such as explosive atmospheres or flammable gases, shall be described. Such characteristics may include but are not limited to those indicated in 11.1 to 11.9.

NOTE 5 In cases where the site conditions are unknown, and if not otherwise specified, the following nominal site conditions should be used:

- total barometric pressure: 89,9 kPa (or altitude above sea level 1 000 m)
- ambient temperature: 313 K (40 °C)
- relative humidity: 60 %

11.1 Ambient temperature

The customer shall inform the manufacturer of the upper and the lower ambient temperature limits at which the generating set will operate.

11.2 Altitude

The customer shall inform the manufacturer of the altitude above sea level at which the generating set will operate. However, it is preferable to have exact values of the barometric pressure on site.

11.3 Humidity

The customer shall inform the manufacturer of the humidity values related to the temperature and pressure on site (see 11.1 and 11.2).

11.4 Sand and dust

The customer shall inform the manufacturer if a generating set is required to operate in a sandy, dusty or other physically polluted atmosphere, as special requirements may be necessary in order to obtain satisfactory performance and operation. Any increased maintenance due to these conditions should be noted by the customer.

11.5 Marine environment

Special consideration is necessary when generating sets are required to operate in a marine environment. This may also apply to generating sets on land but operated at a coastal site. The environment shall be clearly stated by the customer.

11.6 Shock and imposed vibration

If the generating set is required to operate under conditions where shock and/or vibration may occur (for example, earthquake on the one hand and externally imposed vibration from adjacent reciprocating machinery on the other), this shall be clearly stated by the customer.

11.7 Chemical pollution

If the generating set is required to operate under conditions where chemical pollution exists, the nature and extent of this shall be clearly stated by the customer.

11.8 Radiation

Various kinds of radiation may affect some of the components of the generating set, and such components may need special protection and/or a special maintenance programme. Any such condition of operating shall be specified by the customer.

11.9 Cooling water/liquid

If the generating set has water/liquid cooled heat exchangers, the customer shall state the minimum and maximum temperatures (and where necessary, the chemical composition and quantity) of the secondary (external) transfer liquid.

12 Power adjustment for ambient conditions

To determine the appropriate generating set ratings, the customer shall specify the operating conditions prevailing at the site.

- a) site barometric pressure (highest and lowest readings available or, if no pressure data are available, the altitude above sea level);
- b) the monthly mean, minimum and maximum air temperatures during the hottest and coldest months of the year;
- c) the highest and lowest ambient air temperatures around the engine;
- d) the relative humidity (or alternatively the water vapour pressure or the wet and dry bulb tem-

perature) ruling at the maximum temperature conditions;

- e) the maximum and minimum temperatures of the cooling water available.

When the operating conditions differ from the standard reference conditions given in clause 10, any necessary adjustment to the RIC engine, a.c. generator or switchgear rating shall be made in order to determine the rated power of the generating set.

For generating sets to be installed on board ships intended for unrestricted service, according to the International Association of Classification Societies (IACS), the rated power shall be based on the nominal ambient conditions as specified in ISO 3046-1:1986, 7.4.2.

13 Power rating definitions

13.1 General

The power of the generating set is the power output available at the generating set terminals excluding the electrical power absorbed by the essential independent auxiliaries. (See also ISO 8528-2:1993, 5.1 and ISO 8528-3:1993, clause 5.)

13.2 Power ratings

Power ratings of generating sets shall be expressed in kilowatts at rated frequency and a power factor ($\cos \varphi$) of 0,8 lagging unless otherwise stated.

The power rating classifications are necessary for the generating set manufacturer's declaration concerning the power which the generating set will deliver under the stated operating conditions.

13.3 Kinds of power output

The generating set manufacturer shall be responsible for determining the power output according to 13.3.1 to 13.3.3 (see figures 1 to 3) in accordance with the service and maintenance schedule specified by the engine, a.c. generator and controlgear and switchgear manufacturers.

For all kinds of power output, defined in 13.3.1 to 13.3.3, it is necessary to provide additional engine power for governing purpose only (e.g. transient load conditions and suddenly applied load). This additional engine power is usually 10 % of the rated power of the generating set and shall not be used for the supply of electrical consumers.

This additional engine power is not identical to the overload power for RIC engines as defined in ISO 3046-1.

The power limit of a generating set (see figures 1 to 3) depends on the power limit of the RIC engine, e.g. fuel stop power, taking into account the efficiency of the a.c. generator.

13.3.1 Continuous power (COP)

Continuous power is that which a generating set is capable of delivering continuously for an unlimited number of hours per year between the stated maintenance intervals and under stated ambient conditions, the maintenance being carried out as prescribed by the manufacturers. (See figure 1.)

13.3.2 Prime power (PRP)

Prime power is the maximum power available during a variable power sequence, which may be run for an unlimited number of hours per year, between stated maintenance intervals and under the stated ambient conditions, the maintenance being carried out as prescribed by the manufacturers.

The permissible average power output (P_{pp}) (see figure 2) during a 24 h period shall not exceed some percentage of the prime power to be stated by the RIC engine manufacturer. When determining the actual average power output P_{pa} , powers of less than 30 % of the prime power shall be taken as 30 % and time at standstill shall not be counted.

The actual average power, P_{pa} , is calculated as follows:

$$P_{pa} = \frac{P_1t_1 + P_2t_2 + P_3t_3 + \dots + P_nt_n}{t_1 + t_2 + \dots + t_n}$$

$$= \frac{\sum_{i=1}^n P_i t_i}{\sum_{i=1}^n t_i}$$

where $P_1, P_2 \dots P_i$ is the power at time $t_1, t_2 \dots t_i$.

NOTES

6 The customer should be made aware that if any of these conditions are not fulfilled the RIC engine life will be reduced.

7 Time periods at standstill do not enter into the formula.

8 The period of running at prime power is expected to be long enough to enable the generator to reach thermally stable conditions.

13.3.3 Limited-time running power (LTP)

The limited-time running power is the maximum power which a generating set is capable of delivering for up to 500 h per year of which a maximum of 300 h is continuous running, between stated maintenance intervals and under the stated ambient conditions, the maintenance being carried out as prescribed by the RIC engine manufacturers. It is accepted that operation at this rating will affect the life of the set. (See figure 3.)

NOTES

9 The period of running at limited-time running power is expected to be long enough to enable the generator to reach thermally stable conditions.

10 The customer should be made aware that if any of these conditions are not fulfilled the RIC engine life will be reduced.

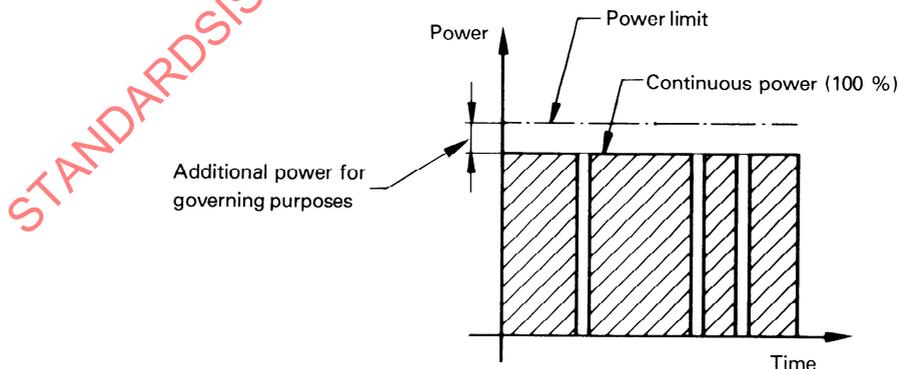


Figure 1 — Illustration of continuous power