
**Building and civil engineering
sealants — Determination of
adhesion/cohesion properties at
constant temperature**

*Mastics pour le bâtiment et le génie civil — Détermination des
propriétés d'adhésivité/cohésion à température constante*

STANDARDSISO.COM : Click to view the full PDF of ISO 9046:2021



STANDARDSISO.COM : Click to view the full PDF of ISO 9046:2021



COPYRIGHT PROTECTED DOCUMENT

© ISO 2021

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

	Page
Foreword	iv
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Principle	1
5 Apparatus	1
5.1 Substrate material	1
5.2 Spacers	1
5.3 Anti-adherent substrate	2
5.4 Ventilated convection-type oven	2
5.5 Container for water immersion	2
5.6 Test machine	2
5.7 Measuring device	2
6 Preparation of test specimens	2
7 Conditioning of test specimens	4
7.1 Preconditioning	4
7.2 Specific conditioning	5
8 Procedure	5
9 Test report	5

STANDARDSISO.COM : Click to view the full PDF of ISO 9046:2021

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 59, *Buildings and civil engineering works*, Subcommittee SC 8, *Sealants*, in collaboration with the European Committee for Standardization (CEN) Technical Committee CEN/SS B02, *Structures*, in accordance with the Agreement on technical cooperation between ISO and CEN (Vienna Agreement).

This third edition cancels and replaces the second edition (ISO 9046:2002), which has been technically revised.

The main changes compared to the previous edition are as follows:

- modified the title;
- modified the rate of test machine;
- modified the requirement of relative humidity;
- modified the anti-adherent substrate.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Building and civil engineering sealants — Determination of adhesion/cohesion properties at constant temperature

1 Scope

The document specifies a method for the determination of the adhesion/cohesion properties of sealants with predominantly plastic behaviour which are used in buildings and civil engineering works.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 6927, *Buildings and civil engineering works — Sealants — Vocabulary*

ISO 13640, *Buildings and civil engineering works — Sealants — Specifications for test substrates*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 6927 apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <http://www.electropedia.org/>

4 Principle

Test specimens are prepared in which the sealant to be tested adheres to two parallel surfaces. After submission to cycles of compression and extension, the test specimens are examined for evidence of loss of adhesion or cohesion.

5 Apparatus

5.1 Substrate material

The mortar or anodized aluminium or glass, used for the preparation of test specimens shall be as defined in ISO 13640. Other substrate materials may be used as agreed by the parties concerned.

For each test specimen, two substrate pieces of the same material are required with dimensions as shown in [Figures 1](#) and [2](#). Test substrates of other dimensions may be used, but the dimensions of the sealant bead and the area of adhesion shall be the same as those shown in [Figures 1](#) and [2](#).

5.2 Spacers

For the preparation of the test specimens, the spacers shall be of dimensions 12 mm × 12 mm × 12,5 mm with anti-adherent surface (see [Figures 1](#) and [2](#)).

5.3 Anti-adherent substrate

For the preparation of test specimens, the anti-adherent substrate can be, for example, polyethylene (PE) film, PTFE or microporous PTFE, preferably according to the advice of the sealant manufacturer.

5.4 Ventilated convection-type oven

The oven shall be capable of being maintained at (70 ± 2) °C.

5.5 Container for water immersion

The container shall be suitable for immersing the specimens according to conditioning method B.

5.6 Test machine

The machine shall be capable of carrying out extension/compression cycles at a rate of $(1 \pm 0,2)$ mm/min.

5.7 Measuring device

The measuring device shall be scaled in 0,5 mm.


6 Preparation of test specimens

The sealant and the substrate shall be brought to (23 ± 2) °C. For each substrate material selected, three test specimens shall be prepared.

For each test specimen, two substrates (5.1) and two spacers (5.2) shall be assembled (see [Figures 1](#) and [2](#)) and set up on the anti-adherent substrate (5.3).

The instructions of the sealant manufacturer concerning, for instance, whether a primer shall be used and the mixing procedure for multi-component sealants shall be followed. The hollow formed by the substrates shall be filled with the sealant.


Dimensions in millimetres

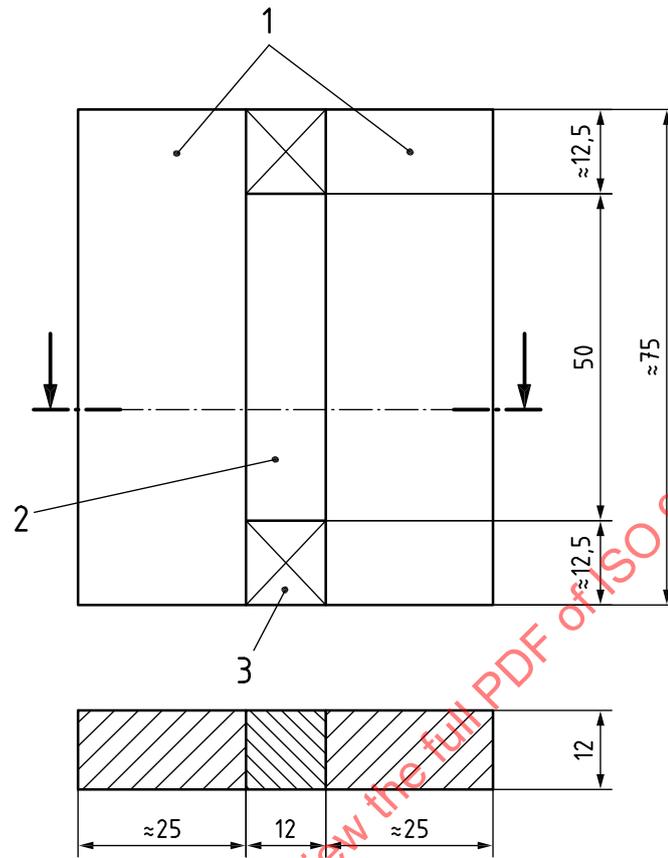

Key

- 1 mortar substrates
- 2 sealant
- 3 spacer

Figure 1 — Test specimen with mortar substrates

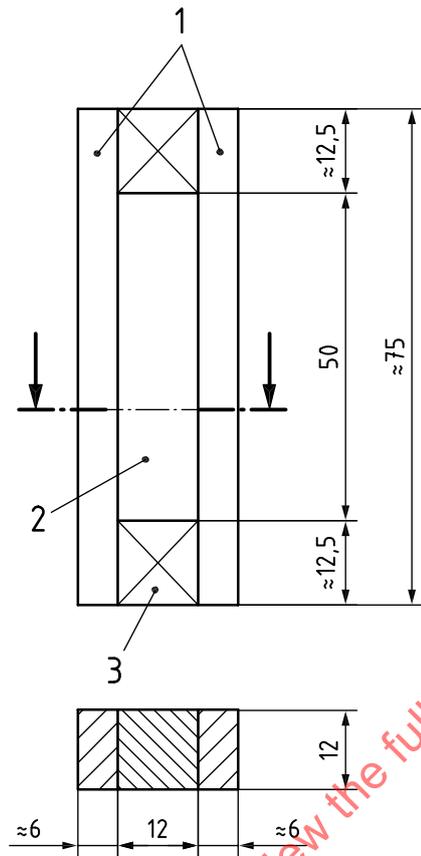

Key

- 1 anodized aluminium or glass substrates
- 2 sealant
- 3 spacer

Figure 2 — Test specimen with anodized aluminium or glass substrate

The following precautions shall be taken:

- a) the formation of air bubbles shall be avoided;
- b) the sealant shall be pressed to the contact surfaces of the substrates;
- c) the sealant surface shall be trimmed so that it is flush with the faces of the substrates and the spacers.

The specimens shall be set on the edge of one of the substrates. The anti-adherent substrate shall be removed as soon as possible. The specimens shall rest in this position to allow curing or optimum drying of the sealant.

The spacers shall be maintained in place during conditioning.

7 Conditioning of test specimens

7.1 Preconditioning

After preparation, the test specimens shall be preconditioned for 28 days at $(23 \pm 2) ^\circ\text{C}$ and $(50 \pm 10) \%$ relative humidity.