

PUBLICLY
AVAILABLE
SPECIFICATION

**ISO/PAS
15594**

First edition
2004-10-01

Airport hydrogen fuelling facility operations

Exploitation d'installation aéroportuaire d'avitaillement en hydrogène

STANDARDSISO.COM : Click to view the full PDF of ISO/PAS 15594:2004



Reference number
ISO/PAS 15594:2004(E)

© ISO 2004

PDF disclaimer

This PDF file may contain embedded typefaces. In accordance with Adobe's licensing policy, this file may be printed or viewed but shall not be edited unless the typefaces which are embedded are licensed to and installed on the computer performing the editing. In downloading this file, parties accept therein the responsibility of not infringing Adobe's licensing policy. The ISO Central Secretariat accepts no liability in this area.

Adobe is a trademark of Adobe Systems Incorporated.

Details of the software products used to create this PDF file can be found in the General Info relative to the file; the PDF-creation parameters were optimized for printing. Every care has been taken to ensure that the file is suitable for use by ISO member bodies. In the unlikely event that a problem relating to it is found, please inform the Central Secretariat at the address given below.

STANDARDSISO.COM : Click to view the full PDF of ISO/PAS 15594:2004

© ISO 2004

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword.....	iv
Introduction	v
1 Scope.....	1
2 Normative references	1
3 Terms and definitions.....	1
4 Symbols and abbreviated terms.....	2
5 Fuelling procedures.....	2
5.1 General requirements	2
5.2 Bonding and grounding procedures.....	2
5.3 Refuelling of a cold system.....	3
5.4 Defuelling	3
5.5 Refuelling of a warm system.....	3
5.6 Monitoring of fuelling parameters.....	4
5.7 Monitoring of the safety parameters.....	4
6 Hydrogen boil-off management.....	5
7 Storage of hydrogen	5
7.1 Storage capacity	5
7.2 Storage means	5
7.3 Properties of hydrogen stored at the airport	6
8 Ground support equipment.....	7
8.1 General requirements	7
8.2 Stationary storage tanks	7
8.3 Portable tank containers	7
8.4 User system for boil-off gas.....	7
8.5 LH ₂ pipelines	8
8.6 Refuelling and boil-off coupling units	8
8.7 Filter on airport side	9
Annex A (informative) Example of a hydrogen aircraft fuel system layout and aircraft refuel/defuel interface point	10
Annex B (informative) LH₂ requirements for different types of aircraft.....	12
Annex C (informative) Hydrogen boil-off in onboard LH₂ tanks.....	13
Annex D (informative) Considerations for the selection of storage means	14
Annex E (informative) Selection of LH₂ refuelling pressure and temperature.....	15
Annex F (informative) User systems for boil-off gas	16
Bibliography	17

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

In other circumstances, particularly when there is an urgent market requirement for such documents, a technical committee may decide to publish other types of normative document:

- an ISO Publicly Available Specification (ISO/PAS) represents an agreement between technical experts in an ISO working group and is accepted for publication if it is approved by more than 50 % of the members of the parent committee casting a vote;
- an ISO Technical Specification (ISO/TS) represents an agreement between the members of a technical committee and is accepted for publication if it is approved by 2/3 of the members of the committee casting a vote.

An ISO/PAS or ISO/TS is reviewed after three years in order to decide whether it will be confirmed for a further three years, revised to become an International Standard, or withdrawn. If the ISO/PAS or ISO/TS is confirmed, it is reviewed again after a further three years, at which time it must either be transformed into an International Standard or be withdrawn.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO/PAS 15594 was prepared by Technical Committee ISO/TC 197, *Hydrogen technologies*.

Introduction

When this document was introduced in the ISO/TC 197 programme of work, all aircraft- and airport-relevant procedures, systems and components concerning hydrogen technologies were in an early development state, and the technical solutions that would enable the future use of hydrogen as a fuel for aviation were not fully developed.

The development of this document within ISO/TC 197 depended on the progress achieved within the European Aeronautic Defence and Space Company (EADS)-Airbus Cryoplane project. However, this project is no longer planned to start in the near future, and there are no other relevant practical projects underway.

ISO/TC 197 experts are convinced that the subject of using liquid hydrogen in commercial aviation is of great importance and will gain new momentum in the next decade. As a result, the latest results are presented in this Publicly Available Specification to make the information available to all interested parties.

This document is not to be regarded as an International Standard. It records the latest results of ISO/TC 197 experts until the subject of using liquid hydrogen in commercial aviation gains interest.

It is understood that this document is far from complete and that it represents the knowledge available at the time of publication. Should work on this subject resume in the next years, the primary objective of the standardization work will be to ensure safety at all phases of handling while taking into account the conditions prevailing at civil airports and the results of risk assessment studies.

Airport hydrogen fuelling facility operations

1 Scope

This Publicly Available Specification specifies the fuelling procedures, hydrogen boil-off management procedures, storage requirements of hydrogen, and characteristics of the ground support equipment required to operate an airport hydrogen fuelling facility.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 14687, *Hydrogen fuel — Product specification*

ISO 20421-1, *Cryogenic vessels — Large transportable vacuum insulated vessels — Part 1: Design, fabrication, inspection and testing*

ASME 1998, *Boiler and Pressure Vessel Code*

KSC¹⁾-STD-Z-0009C, *Cryogenic Ground Support Equipment, Design of, Standard for*

KSC-STD-Z-0005B, *Pneumatic Ground Support Equipment, Design of, Standard for*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1

block fuel

quantity of fuel to be used for refuelling prior to each flight

3.2

refuelling block time

time needed to refuel the aircraft, measured between connection and disconnection of the couplings

3.3

inert gas

nonflammable and nonreactive gas

EXAMPLES Helium, nitrogen, carbon dioxide.

1) Kennedy Space Center.

4 Symbols and abbreviated terms

AP	auxiliary power unit
CO	carbon monoxide
CO ₂	carbon dioxide
C _n H _m	hydrocarbon containing <i>n</i> carbon atoms and <i>m</i> hydrogen atoms
EADS-Airbus	European Aeronautic Defence and Space Company
GH ₂	gaseous hydrogen
LH ₂	liquid hydrogen
N ₂	nitrogen
O ₂	oxygen

5 Fuelling procedures

5.1 General requirements

At the airport, the following situations shall be considered:

- normal refuelling during ground turnaround, with an onboard system in cold condition up to the refuelling/boil-off coupling;
- defuelling of the system on the ground due to planned maintenance activities and applicable troubleshooting cases;
- refuelling of a warm, air-floated onboard system before putting into service and after planned maintenance activities and applicable troubleshooting cases.

The airport infrastructure shall provide the ground support equipment required for performing the above-mentioned refuelling and defuelling operations, including the aircraft tank warm-up and precooling, the necessary purification and purging processes, and the evacuation and GH₂/LH₂ recovery that is required for defuelling operations and refuelling of a warm onboard system. Purge, precooling and warm-up procedures for the onboard fuel system shall be required only for putting into service, maintenance and troubleshooting activities.

The connection point between the aircraft and the ground support equipment shall consist of two couplings (similar but mistake-proof), a refuelling coupling for providing the tanks with LH₂, and a boil-off coupling for the discharge of GH₂. In Annex A, Figure A.1 provides an example of an aircraft refuelling and defuelling interface point and Figure A.2 an example of a hydrogen aircraft-fuel system layout.

5.2 Bonding and grounding procedures

Airport personnel shall apply appropriate bonding and grounding procedures prior to performing any refuelling or defuelling operations on an aircraft.

5.3 Refuelling of a cold system

For normal refuelling during ground turnaround, the airport personnel shall ensure that the tanks are cold and still contain a small quantity of fuel. The time required for the refuelling of a cold system shall be minimized and shall be such that the aircraft-refuel block time requirements can be met (see Annex B). The time required for the refuelling of a cold system shall include an acceptable time for connection and disconnection, including time for cleaning of inner cavities from air at connection and from hydrogen at disconnection, and time for warming before disconnection.

In order to perform the refuelling of a cold system, airport personnel shall use the following refuelling procedure.

- a) Establish the connection of the refuelling and boil-off couplings between the aircraft and ground support equipment. Purging and precooling of the refuelling connecting hose and coupling need not be performed.
- b) After the refuelling system is in "ready" mode, open the tank refuelling and boil-off valves to start the refuelling operation.
- c) Monitor the fuel level of the tanks and control it using the refuelling and boil-off valves.
- d) After filling the tanks, close the refuelling and boil-off valves and separate the couplings and auxiliary connections.

NOTE 1 The renunciation of purge, purification, evacuation and precooling at the coupling can be justified by existing advanced coupling designs.

NOTE 2 During the refuelling of a cold system, no boil-off gas is expected due to recondensation within the onboard tank.

5.4 Defuelling

For yearly maintenance checks or any troubleshooting, airport personnel may need to defuel the aircraft tanks. Defuelling of the aircraft fuel system shall be done using the refuelling and boil-off couplings.

After coupling the aircraft with the refuelling and boil-off connectors of the ground support equipment, an overpressure pipe on the gas side within the onboard tank should deplete the tanks back to the airport stationary storage tank or portable tank container. The onboard pumps could assist the depletion.

If warming up and purging of the aircraft tanks and piping are required, they shall be done using temperature-conditioned inert gases.

5.5 Refuelling of a warm system

Refuelling of a warm, air-floated onboard system shall be carried out before putting an aircraft into service and after planned maintenance activities and applicable troubleshooting cases. Perform the refuelling of a warm system as follows.

- a) Purge the tank and piping system with an inert gas (evacuated, if possible) to remove the air or other foreign gases from the system. Decrease the foreign gas concentration within the system to an acceptable level that is yet to be determined, and measure at the boil-off coupling.
- b) Purge the tank and piping system and precool with conditioned hydrogen to remove the inert gas from the system. Decrease the inert gas concentration within the system to an acceptable level that is yet to be determined, and measure at the boil-off coupling.

NOTE At the time of the publication of this PAS, no detailed procedure for refuelling a warm onboard fuel system could be given, because the initial state of the system before purge could differ and was not really known. The same applied to the required end-state of the system after purge and precooling. The requested procedure may vary due to the design of the onboard tank and piping system. The development task is to define a procedure which is optimized with respect to cost, time required, careful material handling, and safety aspects.

5.6 Monitoring of fuelling parameters

5.6.1 Monitoring during refuelling of a cold system

Control and monitoring during the refuelling of a cold system shall be implemented at one master logic point. A refuelling and monitoring panel shall provide the necessary monitoring indication and enable the selection of all possible automatic/manual procedures, including the preselection of the fuel quantity from the information provided by the aircraft automatic fuel-level control. Shut-off valves in connection with level indication shall execute the refuelling procedure. To avoid tank overfilling, the airport personnel shall monitor onboard-tank liquid level, pressure, temperature and valve positions.

The recommended position for the refuelling control and monitoring-panel is near the refuelling and boil-off couplings integrated in the aircraft structure. The possibility of monitoring the procedure from the aircraft cockpit and ground supply equipment should also be considered.

5.6.2 Monitoring during defuelling and refuelling of a warm system

Airport personnel shall perform control and monitoring during defuelling and refuelling of a warm system. Control and monitoring provisions shall be available from the airport ground infrastructure.

5.7 Monitoring of the safety parameters

5.7.1 General requirements for monitoring devices

Monitoring of the safety parameters is aimed at decreasing the risk associated with handling flammable and cryogenic fuel. Monitoring devices shall not interfere with the refuelling operations, and they shall not be an ignition source.

As much as possible, monitoring devices should be independent of external power supplies, and instead have their own internal power supplies. Devices that take their energy from the fuel (its pressure, flow, or low temperature) or are an integral part of the fuelling system should be given preference.

When a faulty condition is detected, monitoring devices shall trigger an interruption of the fuel flow if the line is already open, or the locking of the main valve if the line is still closed. An audible and/or visible alarm shall be activated indicating the kind of failure and where it occurred.

5.7.2 Monitoring of interface leakage

Interface leakage shall be monitored during the fuelling and defuelling operations. Interface-leakage monitoring shall enable the detection of

- leaks from the lines or the connections,
- open or not fully or faulty closed connections,
- other abnormal conditions that might be dangerous.

The tightness of the connection shall be verified by measuring the pressure decrease or increase in a suitably selected volume or by measuring the pressure difference between such a volume and atmosphere.²⁾

When a leak is detected, personnel shall verify the suspected area with foaming agents, leak detectors or equivalent methods.

2) Measuring pressure decrease or volume increase for tightness of a connection is not very responsive. However, no alternative technology was available at the time of the publication of this PAS. By the time any serious construction of large fuelling facilities for aircraft materializes, the field of hydrogen detection/situational awareness systems should be more mature and could be the preferred method of control and monitoring.

5.7.3 Overpressure

A mechanical contact manometer or an equivalent device shall be used to monitor overpressure in the onboard fuel system and shall be used to stop the fuelling operation immediately when an overpressure condition is detected.

5.7.4 Heat insulation deterioration

Airport personnel shall monitor signs of deterioration of the vacuum insulation. Suitable criteria shall be established to determine the amount of insulation deterioration that is acceptable, and that which requires repair or replacement. Deterioration of insulation can easily be detected in an early stage by observing the outer surface of the vacuum space becoming cold, and water condensing or even freezing on it.

A spot on which such effects can be detected shall be in the view of the airport personnel responsible for the refuelling operations. Means to detect temperatures that are too low can also be used.

In the open air or in a hangar, the air humidity is high enough for water vapour to undergo condensation. In areas where air humidity is too low, means other than visual inspection should be used to detect signs of deterioration of the vacuum insulation.

NOTE A metal rod that contracts when it cools and breaks a contact when its length falls under a certain threshold can be used to monitor deterioration of the insulation.

6 Hydrogen boil-off management

Airports that service hydrogen aircraft shall be equipped with boil-off gas user systems. These systems shall be designed to collect hydrogen boil-off gas generated in the onboard LH₂ tank (see Annex C for a description of the boil-off gas problem) during the following aircraft modes:

- a) ground overnight parking (approximately 12 h);
- b) long-time overhaul with cold tanks;
- c) applicable failure cases.

The connection point between the aircraft and ground support equipment shall be the boil-off coupling, which allows a gas feed to the airport boil-off gas user system for utilization.

7 Storage of hydrogen

7.1 Storage capacity

The storage capacity for LH₂ shall be established based on the demand for hydrogen at the airport. LH₂ requirements for airports range from a few tons per day to 6 000 000 kg per day for a large airport.


7.2 Storage means

LH₂ shall be stored at the airport either in portable tank containers or in stationary storage tanks. Considerations for the selection of storage means are provided in Annex D.

7.3 Properties of hydrogen stored at the airport

7.3.1 LH₂ state condition at aircraft refuelling interface point

LH₂ at the aircraft refuelling interface point shall have a pressure equal to or higher than 700 kPa and a temperature equal to or less than 20 K, as shown in Figure 1. The reasons that lead to the selection of the refuelling pressure and temperature requirements are provided in Annex E.

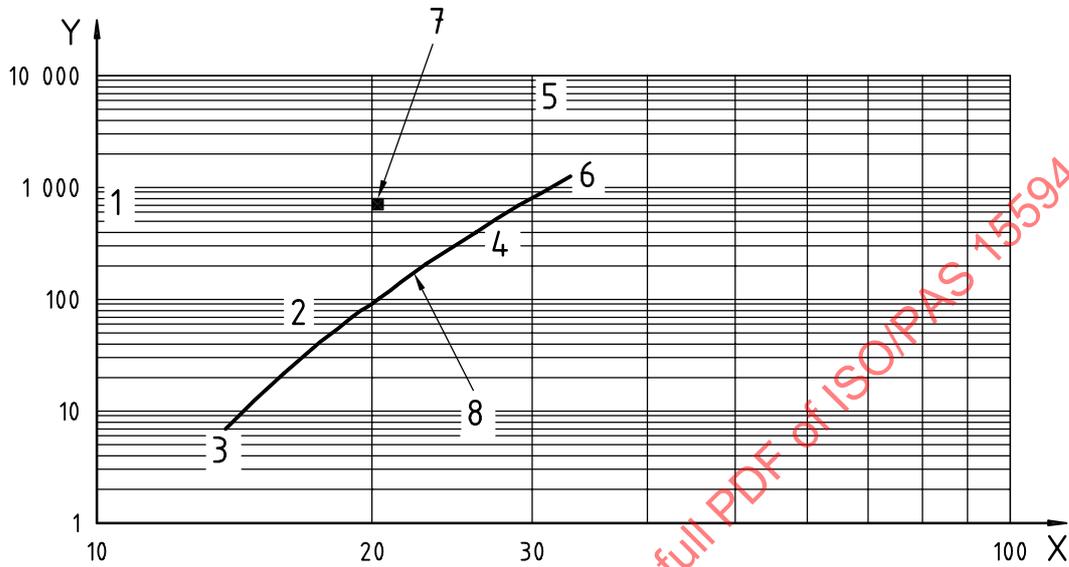

Key

- X fuel temperature, kelvin
- Y fuel pressure, kPa
- 1 solid
- 2 liquid
- 3 triple point
- 4 vapour
- 5 fluid
- 6 critical point
- 7 required fuel condition at aircraft interface
- 8 hydrogen equilibrium state

Figure 1 — Hydrogen refuelling condition

7.3.2 Hydrogen quality

LH₂ at the aircraft interface shall meet the requirements set forth in ISO 14687 for type II hydrogen fuel, with the exceptions stated below:

- LH₂ purity ≥ 99,999 9 % (volume fraction);
- O₂ content ≤ 0,000 02 % (volume fraction);
- N₂ content ≤ 0,000 02 % (volume fraction);
- H₂O content ≤ 0,000 05 % (volume fraction);
- C_nH_m content ≤ 0,000 01 % (volume fraction);
- CO content ≤ 0,000 01 % (volume fraction);

- CO₂ content ≤ 0,000 01 % (volume fraction);
- LH₂ shall not contain particles > 5 µm.

The hydrogen shall not contain impurities in the form of particles large enough to cause component or aircraft fuel system malfunction. The maximum size of 5 µm given above needs to be confirmed, and the requirement specified in 8.7 adjusted accordingly.

In order to define the requirement for hydrogen purity, studies of impurities accumulation in aircraft tanks are needed. These studies should be carried out on tanks with near-real structural dimensions. At the time of publication of this PAS, there was no stable opinion about quantities and composition of dangerous impurities (oxygen, nitrogen, their mixtures).

NOTE It is a design aim for future serial aircraft to keep the onboard fuel system in cold condition for approximately 1,5 years. During this period, hundreds of refuellings will be carried out on a single aircraft, and O₂ and N₂ could accumulate within the aircraft storage system, jeopardizing the safety of the aircraft. In order to prevent such solid nitrogen and oxygen accumulation within the onboard fuel system, a high level of refuelled hydrogen purity and a control device within the aircraft storage system is foreseen. If procedures are developed and are proven efficient in avoiding this accumulation, either at the airport or on the aircraft, the hydrogen purity requirement could be decreased accordingly.

8 Ground support equipment

8.1 General requirements

Ground support equipment shall meet the requirements set forth in KSC-STD-Z-0009C and KSC-STD-Z-0005B and the additional requirements described in the following subclauses. If discrepancies are found between the requirements of KSC-STD-Z-0009C and KSC-STD-Z-0005B and the requirements set forth in the following subclauses, the most recent requirements shall prevail.

8.2 Stationary storage tanks

The storage tank shall consist of a suitably supported inner liquid vessel, enclosed within an outer shell with insulation between the inner liquid vessel and outer shell. The inner liquid vessel shall be made of appropriate stainless steel, and designed and constructed in accordance with, and fulfilling the requirements of, the ASME *Boiler and Pressure Vessel Code* in all respects. The outer shell of the tank shall be made of carbon steel with good weld-ability. Piping between inner and outer shells shall be made of appropriate stainless steel. Appropriate instrumentation for measuring temperature, pressure and fluid level shall be provided.

The boil-off rate of the storage tank shall be designed to match the proposed withdrawal rate of product from the tank, in order to minimize product losses. The annular space between the inner liquid vessel and the outer shell shall be evacuated and include an adequate insulating material. The insulating material shall not be subject to damage by hydrogen, in either its gaseous or liquid state. The insulating material shall not attack the material of the inner liquid vessel or the outer shell. The insulation shall be designed with a vapour-tight seal in the outer covering to prevent the condensation of air and subsequent oxygen enrichment within the insulation. The insulating material and outer shell shall be of adequate design to prevent insulation attrition under normal operating conditions. Means to monitor the vacuum level of the annular space between the inner liquid vessel and the outer shell shall be provided.

8.3 Portable tank containers

Portable tank containers shall be designed and constructed in accordance with and fulfill the requirements of ISO 20421-1 in all respects.

8.4 User system for boil-off gas

Different types of boil-off gas user systems can be used at the airports. Annex F gives an overview of the systems that can be implemented.

8.5 LH₂ pipelines

The inner pipeline shall be made of austenitic stainless steel, Invar or other material, provided it is proven to be equivalent in performance. Axial stresses due to thermal contraction of the inner line shall be analysed. Spacers between inner and outer pipelines shall ensure resistance to axial stresses. Pipeline configuration shall ensure that mechanical stresses are minimized. The choice of material for the outer pipeline will depend on the length of the pipeline.

The annular space between the inner and outer pipelines shall be evacuated and shall include an adequate insulating material. The insulating material shall not be subject to damage by hydrogen, in either its gaseous or liquid state. The insulating material shall not attack the material of the inner or the outer lines. The insulation shall be designed with a vapour-tight seal in the outer covering to prevent the condensation of air and subsequent oxygen enrichment within the insulation. The insulating material and the outer pipeline shall be of adequate design to prevent insulation attrition under normal operating conditions. Means to monitor the vacuum level of the annular space between the inner and outer pipelines shall be provided.

8.6 Refuelling and boil-off coupling units

8.6.1 Classification of refuelling and boil-off coupling units

Refuelling and boil-off coupling units shall be classified according to the following types, depending on the application:

- a) Type I: Manual coupling units used for the refuelling and boil-off management operations of small aircraft;
- b) Type II: Mechanized coupling units used for the refuelling and boil-off management operations of large aircraft.

8.6.2 Refuelling coupling units

Type I refuelling coupling units shall consist of a refuelling hose, a refuelling connector, and safety monitoring devices. The mass of the refuelling connector together with the attached part of the refuelling hose shall not exceed 10 kg (preferably 7 kg).

Type II refuelling coupling units shall consist of a refuelling hose, a refuelling connector, an actuator to provide reliable multiple pressurized sealings, and safety monitoring devices. The mass of the type II refuelling coupling unit is not limited.

NOTE Type I refuelling coupling units need not be equipped with an actuator. The actuator required to provide a reliable multiple pressurized sealing is expected to be installed on the aircraft.

8.6.3 Boil-off coupling units

Type II boil-off coupling units can be integrated in the type II refuelling coupling units.

8.6.4 Refuelling connectors

The refuelling connector of the type I refuelling coupling unit shall be designed and constructed to meet the requirements of the connectors used on road vehicles. The connector shall have a diameter of 30 mm.

The refuelling connector of the type II refuelling coupling unit shall be designed and constructed to meet the requirements of the connectors used on sea ships and liquid hydrogen carriers. The connector shall have a diameter of 140 mm.

NOTE At the time of the publication of this PAS, the requirements applicable to refuelling connectors for both type I and type II refuelling coupling units had yet to be established. Further work is required to define these requirements, including the diameter of the refuelling connectors.

8.6.5 Safety monitoring devices

Safety monitoring devices shall meet the requirements set forth in 5.7.

8.6.6 Refuelling points

The number of refuelling points has a direct effect on the supply method and the flow rates. More information is needed before being able to outline requirements on that subject.

The quantity of LH₂ to be refuelled prior to each flight ranges from 410 kg for a small aircraft, 6 700 kg for a medium aircraft, and up to 33 000 kg for a large aircraft (see Annex B).

8.7 Filter on airport side


A mechanical filter, compatible with LH₂ cyclic transfer temperature and pressure shall be provided at or near the refuelling connector. The filter shall be suitable for removing 5 µm and larger-sized particles. Provisions shall be made to isolate, purge and remove the filter for cleaning. The purge provisions shall be suitable for identifying the cause of the blockage by delta pressure increase.

STANDARDSISO.COM : Click to view the full PDF of ISO/PAS 15594:2004

Annex A (informative)

Example of a hydrogen aircraft fuel system layout and aircraft refuel/defuel interface point


Figures A.1 and A.2 show examples of refuelling and of layout of a hydrogen fuelling system.

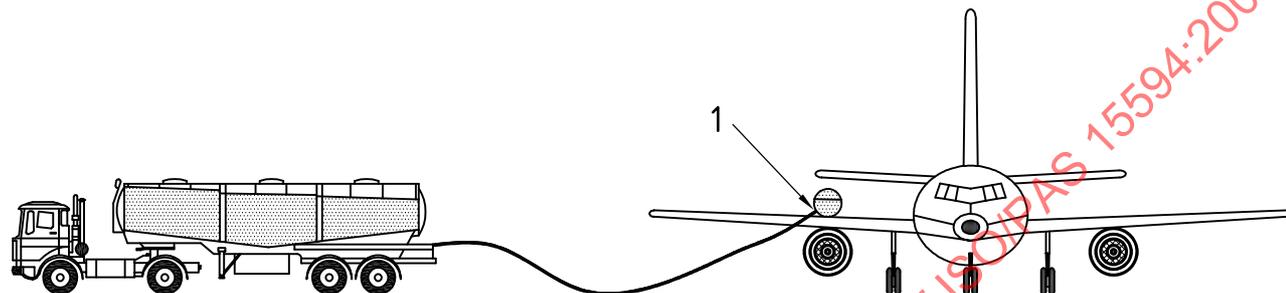

Key

1 aircraft refuel/defuel interface point

**Figure A.1 — Example of refuelling the EADS-Airbus DO 328 LH₂ demonstrator
with a mobile refuelling truck**

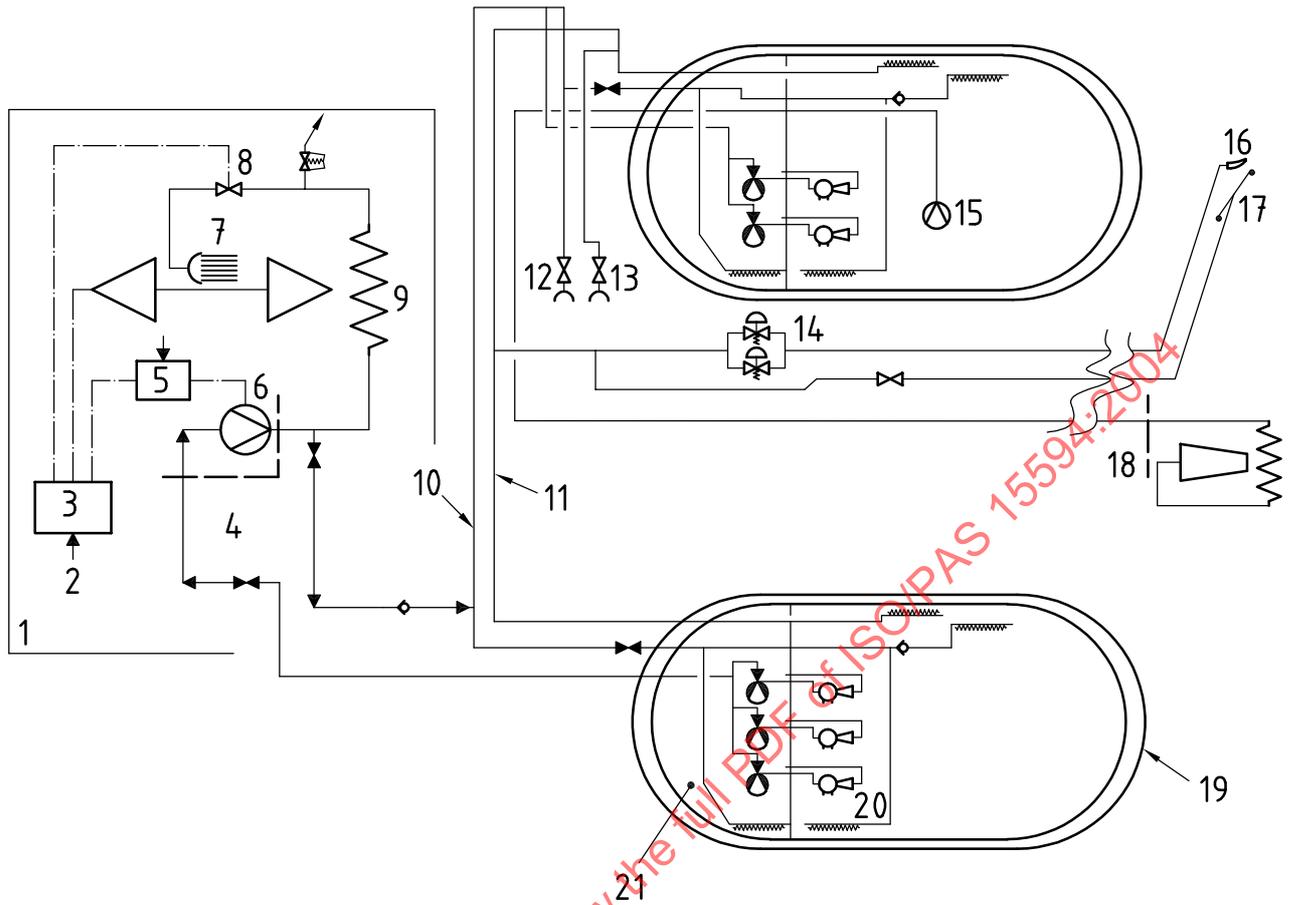

Key

- | | |
|-----------------------------|------------------------------|
| 1 engine periphery (prel.) | 12 refuelling coupling |
| 2 from engine throttle | 13 boil-off coupling |
| 3 control & regulation unit | 14 safety valves |
| 4 interface to engine | 15 HD-pump |
| 5 pump drive | 16 exit for safety valves |
| 6 HP-pump | 17 exits for normal boil-off |
| 7 combustion chamber | 18 interface to APU |
| 8 injection valve | 19 heat insulation |
| 9 heat exchanger | 20 jet pumps |
| 10 crossfeed line | 21 tank pumps |
| 11 gas drainage line | |

Figure A.2 — Example of a hydrogen aircraft fuel system layout, LH₂ DO 328 demonstrator

Annex B
(informative)

LH₂ requirements for different types of aircraft

Type	Total fuel kg	Reserve fuel kg	Block fuel kg	Refuelling block time min	Estimated flow time min	Number of refuelling points	Tank operating pressure range kPa	Tank filling level %
Regional aircraft DO 328 LH ₂ fan version Demonstrator 900 km mission One engine + APU modified	560	150	410	20	15	1	120 to 350	95
Regional aircraft DO 328 LH ₂ fan version Serial aircraft type 900 km mission Two engines + APU modified	950	290	660	10	5	1 To be confirmed (TBC)	120 to 350	95
Medium-range aircraft A 321 LH ₂ version Serial a/c type 4 000 km mission Two engines + APU modified	8 650	1 880	6 770	13	7	To be determined (TBD)	120 to 200	>95
Long-range aircraft A 340 LH ₂ version Serial a/c type 9 300 km mission Four engines + APU modified	37 150	4 500	32 650	40	35	TBD	120 to 200	>95
Medium-range aircraft TU 334 LH ₂ version Demonstrator 1 000 km mission One engine + APU modified	1 100	300	800	20	15	TBD	120 to 200	>95

Annex C (informative)

Hydrogen boil-off in onboard LH₂ tanks

Hydrogen for use in aviation will be stored onboard at cryogenic conditions as a boiling liquid. Thus, the temperature of the hydrogen will be about 20 K. To avoid excessive production of GH₂, with associated tank pressure increase due to the inevitable heat flux into the tanks, a high quality of insulation will be necessary. Other heat leaks should be minimized as well.

The tank insulation-quality requirements are very different for the following applicable aircraft operational modes:

- a) flight operation times;
- b) normal ground service turnaround times;
- c) other ground times:
 - 1) ground overnight parking (approximately 12 h);
 - 2) long-time overhaul with cold tanks;
 - 3) applicable failure cases.

Therefore, a compromise in tank insulation quality should be found to satisfy all of these operating modes, which leads to some unavoidable hydrogen boil-off gas in the onboard LH₂ tank. If it would be possible to consume this gas during all operational modes, the insulation quality of the tanks could be lowered considerably.

During flight operation and normal ground-service turnaround times, possibilities to reduce tank pressures could be found on the aircraft, for example:

- APUs or main engines are running and could be fed by gaseous hydrogen;
- the refuelling procedure could offer the possibility to reduce tank pressures by means of reliquefaction;
- the tank pressure could be allowed to increase to the upper limit, which is defined by the pressure differential at maximum flight altitude.

For the remaining ground cases, technical assistance is required from the airport infrastructure.