

---

---

**Test methods for repair materials for  
water-leakage cracks in underground  
concrete structures —**

Part 1:  
**Test method for thermal stability**

*Méthodes d'essai pour matériaux de réparation pour fissures dues à  
l'eau dans les structures en béton —*

*Partie 1: Méthode d'essai de la stabilité thermique*

STANDARDSISO.COM : Click to view the full PDF of ISO/TS 16774-1:2017



STANDARDSISO.COM : Click to view the full PDF of ISO/TS 16774-1:2017



**COPYRIGHT PROTECTED DOCUMENT**

© ISO 2017, Published in Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office  
Ch. de Blandonnet 8 • CP 401  
CH-1214 Vernier, Geneva, Switzerland  
Tel. +41 22 749 01 11  
Fax +41 22 749 09 47  
copyright@iso.org  
www.iso.org

# Contents

	Page
Foreword.....	iv
Introduction.....	v
<b>1 Scope.....</b>	<b>1</b>
<b>2 Normative references.....</b>	<b>1</b>
<b>3 Terms and definitions.....</b>	<b>1</b>
<b>4 Principle.....</b>	<b>2</b>
<b>5 Apparatus.....</b>	<b>2</b>
<b>6 Preparation of the test specimen and artificial crack conditions.....</b>	<b>2</b>
<b>7 Procedure.....</b>	<b>3</b>
7.1 Thermal stress test.....	3
7.2 Permeability test.....	3
<b>8 Presentation of results.....</b>	<b>4</b>
<b>9 Test report.....</b>	<b>4</b>
9.1 Information on the repair material of the test target.....	4
9.1.1 General.....	4
9.1.2 Other information.....	4
9.2 Information on the test.....	4
<b>Annex A (informative) Example test method.....</b>	<b>6</b>
<b>Bibliography.....</b>	<b>17</b>

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see [www.iso.org/directives](http://www.iso.org/directives)).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see [www.iso.org/patents](http://www.iso.org/patents)).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see the following URL: [www.iso.org/iso/foreword.html](http://www.iso.org/iso/foreword.html)

This document was prepared by ISO/TC 71, *Concrete, reinforced concrete and pre-stressed concrete*, Subcommittee SC 7, *Maintenance and repair of concrete structures*.

A list of parts in the ISO 16774 series, published under the general title *Test methods for repair materials for water-leakage cracks in concrete structures*, can be found on the ISO website.

## Introduction

ISO/TR 16475 outlines six basic properties and the required performance levels of water-leakage repair materials, and ISO/TS 16774-1 through ISO/TS 16774-6 provide test methods designed to evaluate the respective properties of these repair materials.

These test methods are intended to serve as references for nations that have not yet developed a test method on the six proposed required performance properties of water leakage repair materials. If other forms of test methods that are simpler, more accurate or more organized are available, such methods are recommended for use instead.

Many of the dependent variables outlined in the ISO 16774 series of reference test methods are subject to change in accordance with the environmental conditions (temperature; chemical substance and concentration; relative humidity; width of movement activity; water pressure or water flow velocity, etc.) outlined in the standards and testing parameters used in respective countries.

In ISO/TS 16774-1, ISO/TS 16774-5 and ISO/TS 16774-6, for the purpose of objectively comparing the performance of injected repair materials, artificial cracks of same volume were used to control the usage of repair materials for each testing cycle and enable repetition of the same test methods under the same conditions.

[STANDARDSISO.COM](https://standardsiso.com) : Click to view the full PDF of ISO/TS 16774-1:2017

# Test methods for repair materials for water-leakage cracks in underground concrete structures —

## Part 1: Test method for thermal stability

### 1 Scope

This document specifies a laboratory test method for evaluating the thermal stress resistance of water-leakage crack repair materials through permeability testing.

The repair material injected into a test specimen with an artificial crack is thermally stressed under the applied temperature conditions outlined in different national testing parameters that reflect different environmental conditions. As such, the results are only intended to provide a comparative performance evaluation of the waterproofing repair materials between different products of the same type of repair material.

This document outlines general guidelines and procedures for the test method. Specific variables that control the quantifiable parameters of the testing are filled in using relevant national standardizations and/or testing parameters.

NOTE 1 This test method classifies and categorizes materials that are tested into families of similar properties for the purpose of making relative comparisons with the data results.

NOTE 2 Each individual repair material can be further tested in an actual construction site application for a complete assessment.

### 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO/TR 16475, *Guidelines for repair of water-leakage cracks in concrete structures*

### 3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO/TR 16475 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org.obp>

#### 3.1

##### **repair material**

<water-leakage cracks>material used for preventing the escape of water at cracks in concrete

EXAMPLE Injection type grouts, such as synthetic rubberized asphalt, mastic, urethane, poly-urea, etc.

Note 1 to entry: In this document, target ingredients are limited to injection materials outlined in ISO/TR 16475.

## 4 Principle

Resistance to physical change, loss, or disintegration due to thermal stress is one of the fundamental properties that water leakage repair materials should possess. Repair material property changes due to high or low temperature conditions, can potentially cause the repair material's performance to deteriorate. To evaluate the leakage crack repair material's **thermal stability** performance, this test method uses two separate procedures: 1) a thermal stress test method and 2) a permeability test method.

The test specimen with an artificial crack is injected with repair material, and the specimen goes through thermal stress testing for a specified number of cycles, between hot and cold temperature conditions. Test specimens with the repair materials are placed in temperature chambers where the temperature is repeatedly changed from maximum to minimum temperature conditions for a period of time (time and temperature variables are subject to change in accordance to different national test parameters). To evaluate whether the repair material loses its waterproofing property due to thermal stressing, the specimen goes through water permeability testing for the last stage of the test method.

## 5 Apparatus

**5.1 Temperature chamber**, which should be able to handle temperature precision values of 2 °C ranging from  $(-20 \pm 2)$  °C to  $(60 \pm 2)$  °C and maintain a constant temperature in the interior of the chamber apparatus. Apparatus should also be equipped with a compartment dryer and freezers with temperature precision of  $\pm 2$  °C. The chamber should also be able to automatically alternate between high and low temperature conditions.

NOTE Temperature condition values are subject to change in accordance with different national testing parameters and requirements.

**5.2 Air compressor**, which should be able to handle minimum air pressure value of 0,1 N/mm<sup>2</sup> to 0,3 N/mm<sup>2</sup>.

**5.3 Permeability test chamber**, which should be able to handle minimum water pressure value of 0,1 N/mm<sup>2</sup> to 0,3 N/mm<sup>2</sup> (output method).

NOTE Conditions outlined in 5.2 and 5.3 are subject to change in accordance with different national testing parameters and requirements.

## 6 Preparation of the test specimen and artificial crack conditions

1) Two separate concrete or mortar substrate parts should be cured to form a water-leakage crack test specimen. The parts consist of upper and bottom parts, and they should be flat and cylindrical in shape and made using concrete or mortar.

NOTE The mix proportion is (water: cement: fine aggregate = 1: 2: 6, mass ratio). The curing period for the mortar or concrete substrate parts is approximately 72 hours, but subject to change in accordance to different national testing parameters and requirements.

2) The bottom substrate is drilled with evenly spaced holes ( $\varnothing 2,5$  mm) near the centre of the substrate. The pinholes shall be drilled all the way through from one surface of the substrate part to the other.

NOTE The purpose of these pinholes is to check for signs of leakage during repair material injection and during permeability testing.

3) Spacers are placed on one surface of the bottom substrate part without covering the pinholes, and the upper substrate part is placed on top of the spacers. The substrate parts, now having formed the test specimen with the artificial crack, are held together with tape, silicone sealants or other applicable materials along the exterior side. The spacer height represents the width of the crack and can vary depending on the different national testing parameters and requirements.

NOTE Any material can be used to hold the two substrate parts together with a crack space in between, but they should leave an inlet in one side for material injection.

- 4) The injection space should be flushed out with water before injecting the repair material to remove any debris as well as to verify that the interior mortar surface is sufficiently wet for repair material injection. After making sure the substrate parts are held together tightly, place the test specimen under water for a specified amount of time. After taking the specimen out of the water, inject the repair material into the specimen.

The injection method varies according to different national testing parameters and requirements. If manufacturer's instructions are available, this method is recommended instead. If debris and other substances are present they should be removed prior to material application.

NOTE For detailed and clearer explanation, refer to [Annex A](#).

## 7 Procedure

### 7.1 Thermal stress test

- 1) Once the test specimen have been injected with the repair materials and taken out of the water after the specified duration, place the test specimens in the temperature chamber.
- 2) Run the thermal stress testing.

NOTE Thermal stress testing will consist of alternating the interior temperature of the testing chamber between low and high temperature for a set number of cycles within a set period of time. Temperature range, duration, and number of cycles are subject to change in accordance to different national testing parameters and requirements.

- 3) Take the test specimen out of the temperature chamber and record its conditions. Proceed to the permeability test.

NOTE Record sample conditions at different intervals of cycles during thermal cycling for changes on for mass change and visual descriptions of failure like cracking, disintegration, erosion, etc. if such data is required.

### 7.2 Permeability test

- 1) Place the specimen in the permeability test chamber.

NOTE The procedure outlined will follow the steps required for the output method of this permeability test. Other methods, if applicable, can be used for this step.

- 2) Fill the chamber with water. Connect the air compressor valves to the air compression chamber.
- 3) Run the permeability test.

NOTE Water/air pressure values are subject to change in accordance with different national test parameter requirements.

- 4) Observe and record to see if there is leakage or not with the test specimen.

Photos of the specimen and equipment conditions shall be taken at every stage possible during each and every test procedure for recording and information purposes.

NOTE For detailed and clearer explanation, refer to [Annex A](#).

## 8 Presentation of results

The continually induced physical stress of the test cycles can affect the repair material's performance level. This test method evaluates the physical properties of the repair materials under the prescribed conditions of permeability testing through a qualitative evaluation of whether the repair material can maintain adequate waterproofing properties. These results can be used in the future as a data base for a guideline on selecting appropriate repair materials with the required properties of adhesion on leakage crack surfaces of underground concrete structures.

## 9 Test report

### 9.1 Information on the repair material of the test target

#### 9.1.1 General

The test report should record the following information on the repair material of the test target:

- 1) Producer (name, address, phone number).
- 2) Production date, time, place of the repair material.
- 3) Type, storage method and authentication of the repair material.
- 4) Manufacturer's product instructions and relevant repair material guidelines.
- 5) Data on the chemical composition of repair material as indicated in manufacturer's data sheet.

#### 9.1.2 Other information

The following information is recorded on demand, if required:

- 1) Project of the test target.
- 2) Application areas of the test specimen.
- 3) Result of some eco-toxicological performance tests to account for the release of hazardous substances and the subsequent effects on health and safety.

### 9.2 Information on the test

The test report should record the following information on the test:

- 1) Test manager.
- 2) Name/purpose of the test.
- 3) Ambient condition of the laboratory (temperature, relative humidity, safety conditions etc.).
- 4) Production time and place of the specimens.
- 5) Shape and size of the specimens, and the number of replicates of the specimens for repeat test.
- 6) Identification of the specimens (Lot No. etc.).
- 7) Curing and storage conditions.
- 8) Information on the test repair material (name, producer, validity etc.).
- 9) Test data (production, measurement, test period etc.).
- 10) Type of facilities, equipment, tools.

- 11) Status of test equipment, tools.
- 12) Test results.
- 13) Details on other test programmes and procedures.

STANDARDSISO.COM : Click to view the full PDF of ISO/TS 16774-1:2017

## Annex A (informative)

### Example test method

#### A.1 Principle

This example test method evaluates a repair material's resistance to thermal stress using artificially cracked test specimens. The repair material is injected into these specimens and is placed in a temperature chamber where the specimen will undergo specific thermal stressing cycles. Afterwards, a permeability test can be conducted to see if leakages occur to determine whether the thermal stressing changed the repair material's waterproofing properties.

This example test method employs test parameters and environmental conditions outlined in the test standards used in Korea.

NOTE This test method requires the usage of fabricated and simulated artificial cracks as illustrated with the specimen used in this example.


#### A.2 Apparatus

**A.2.1 Temperature chamber**, with automatic temperature control ranging from  $(-20 \pm 1) \text{ }^\circ\text{C}$  to  $(60 \pm 1) \text{ }^\circ\text{C}$ .

**A.2.2 Air compressor**, which should be able to handle minimum air pressure value of  $0,1 \text{ N/mm}^2$  to  $0,3 \text{ N/mm}^2$ .

**A.2.3 Permeability test chamber**, which should be able to handle a minimum water pressure value of  $0,1 \text{ N/mm}^2$  to  $0,3 \text{ N/mm}^2$  (output method).

NOTE Refer to [Figure A.1](#) a) and b)).

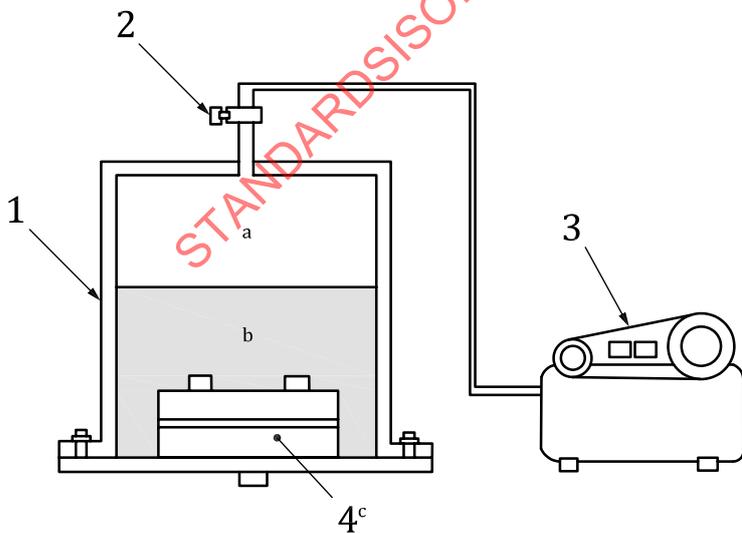

a) Permeability test chamber (output)

b) Compressor and water pressure chamber

**Key**

1	watertightness chamber	a	pressure: 0,3 N/mm <sup>2</sup>
2	pressure regulator	b	water: 1 L
3	air compressor	c	see <a href="#">Figure A.2</a>
4	test specimen		

**Figure A.1 — Apparatus for example test method****A.2.4 Test specimen.**

NOTE Refer to [Figures A.2](#) and [A.3](#).

**A.2.4.1 Fixing bolt** for connecting test specimen to Universal Testing Machine (UTM)( $\varnothing$  6 mm).

**A.2.4.2 Upper substrate part** (acrylic,  $\varnothing$  100 mm  $\times$  30 mm).


**A.2.4.3 Repair material.**

**A.2.4.4 Concrete or mortar substrate part** (water: cement: fine aggregate = 1: 2: 6, mass ratio). Height of the concrete or mortar mould is 15 mm.

**A.2.4.5 Steel plate** for setting the concrete or mortar substrate in place (STS 304,  $\varnothing$  220 mm  $\times$  5 mm).

**A.2.4.6 Non-woven fabric** for filtering repair material particulates when testing cementitious grout material (synthetic fibre,  $\varnothing$  100, 180 g/m<sup>2</sup>).

**A.2.4.7 Acrylic plate** for setting the non-woven fabric in place (acrylic,  $\varnothing$  100 mm  $\times$  5 mm).

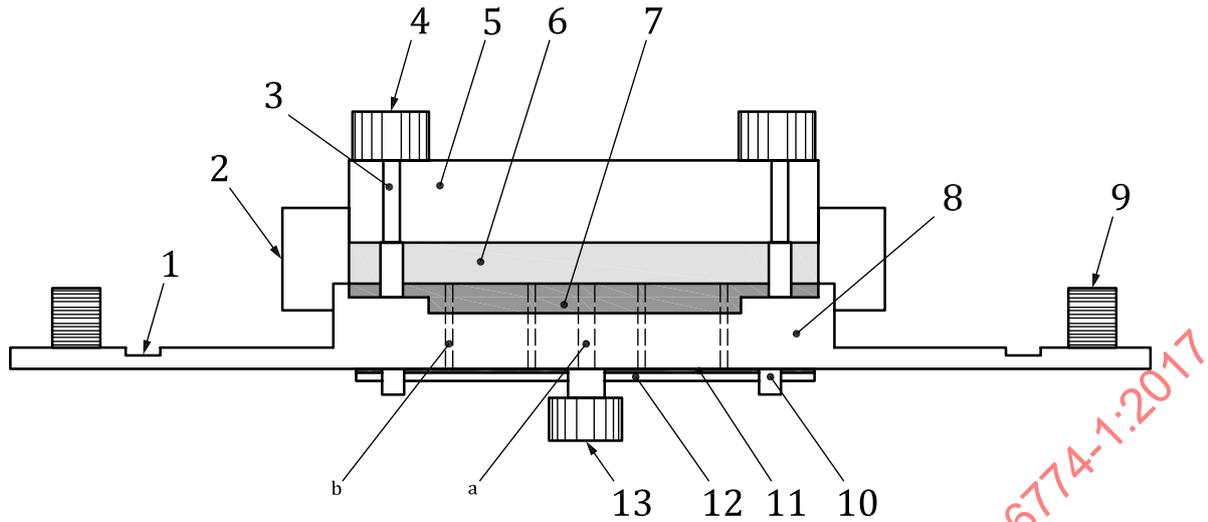


**Key**

- |   |  |    |  |
|---|--|----|--|
| 1 | O-ring (width 5 mm)                                    | 9  | bolt for fixing with chamber (Ø 10 mm)         |
| 2 | acrylic band for seal                                  | 10 | bolt for fixing acrylic plate (Ø 6 mm)         |
| 3 | bolt for connecting upper substrate                    | 11 | non-woven fabric for filtering repair material |
| 4 | fixing nut for connecting mortar substrate (Ø 6 mm)    | 12 | acrylic plate for fixing non-woven fabric      |
| 5 | upper substrate (acrylic, Ø 100 × 30 mm)               | 13 | inlet cover for injecting (Ø 12 mm)            |
| 6 | repair material  | a  | injection hole (Ø 10 mm)                       |
| 7 | mortar substrate                                       | b  | leakage hole (Ø 2,5 mm)                        |
| 8 | steel plate for fixing mortar substrate (Ø 220 × 5 mm) |    |  |

**Figure A.2 — Diagram of the test specimen**

dimensions in millimetres

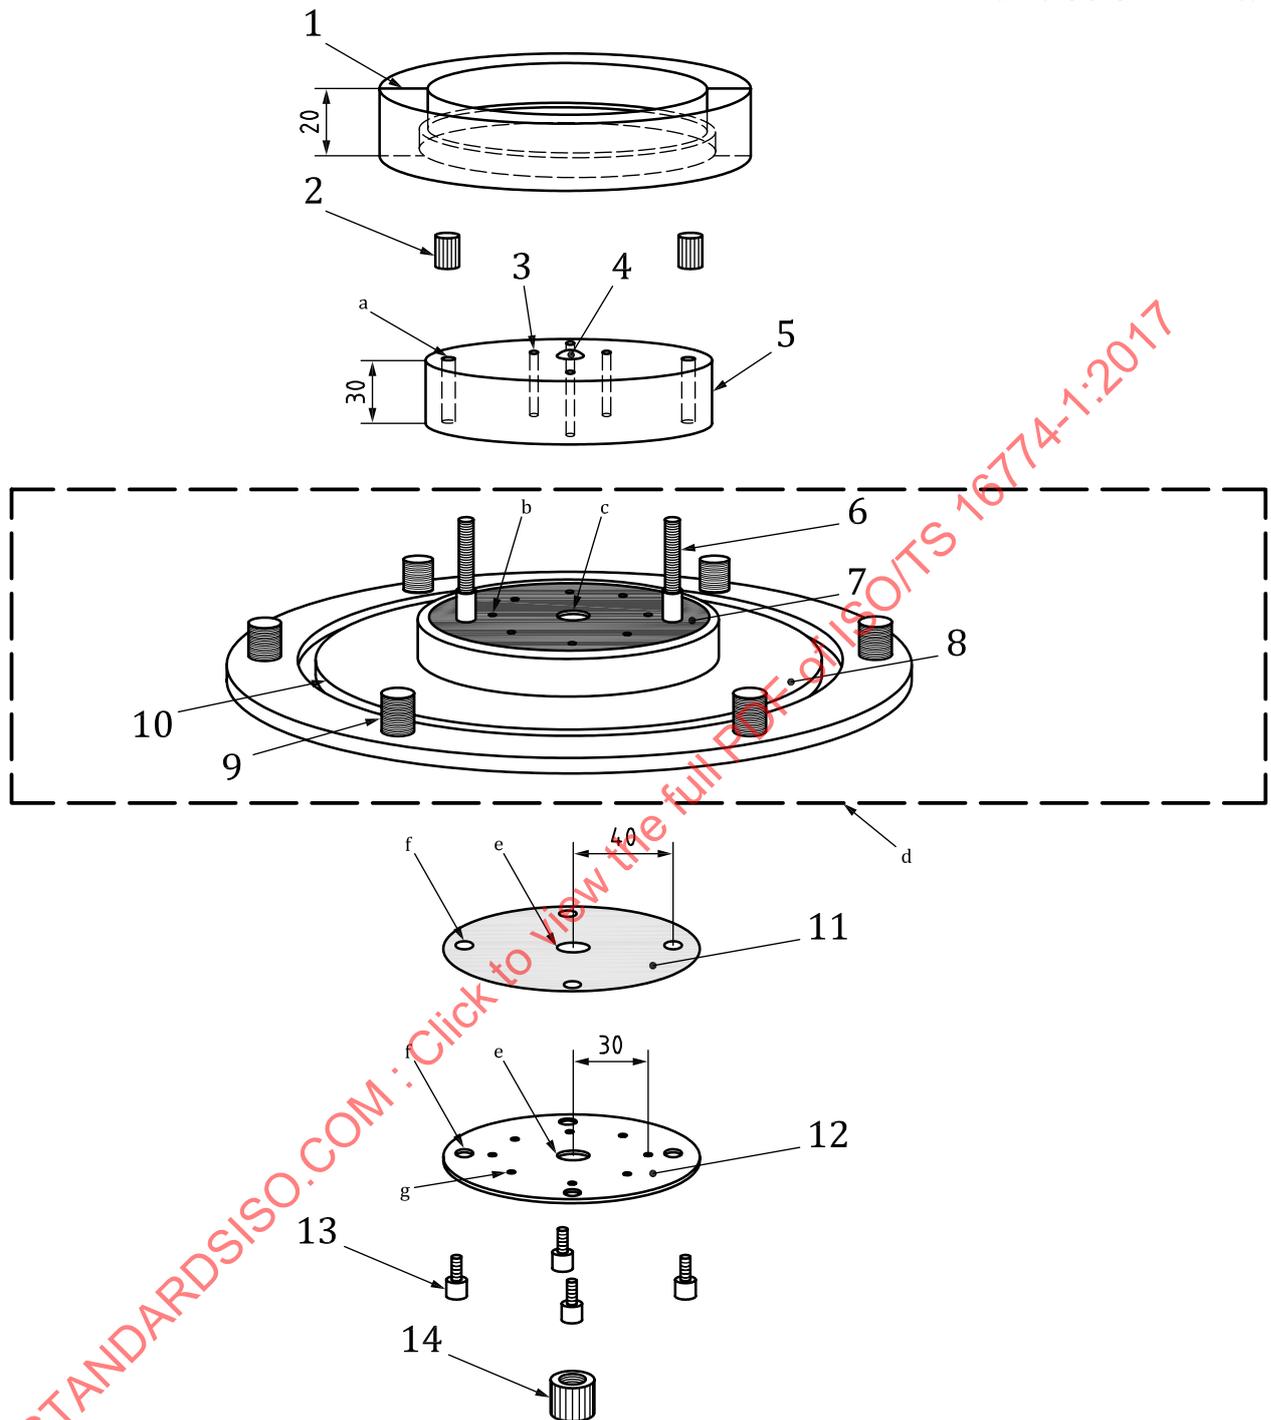

**Key**

- |  |   |
|--|---|
| 1 acrylic band for seal  | 12 acrylic plate for fixing non-woven fabric              |
| 2 fixing nut for fixing mortar substrate ( $\varnothing$ 6 mm) | 13 bolts for fixing acrylic plate ( $\varnothing$ 6 mm)   |
| 3 injection hole ( $\varnothing$ 10 mm)                        | 14 inlet bar for injection ( $\varnothing$ 12 mm)         |
| 4 level instrument   | a hole for connecting bolt ( $\varnothing$ 8 mm)          |
| 5 upper substrate (acrylic)                                    | b leakage hole ( $\varnothing$ 2,5 mm)                    |
| 6 bolt for connecting upper substrate                          | c injection hole ( $\varnothing$ 10 mm)                   |
| 7 mortar substrate   | d see <a href="#">Figures A.4</a> and <a href="#">A.5</a> |
| 8 steel plate for fixing mortar substrate                      | e injection hole ( $\varnothing$ 20 mm)                   |
| 9 bolt for fixing with chamber ( $\varnothing$ 10 mm)          | f hole for fixing ( $\varnothing$ 7 mm)                   |

- 10 O-ring (width: 5 mm) g leakage hole ( $\emptyset$  2,5 mm)
- 11 non-woven fabric for filtering repair material

**Figure A.3 — Basic parts planar of test specimen**

#### **A.2.5 Others.**

**A.2.5.1 Injector** suitable for the application of the tested repair material into the concrete specimen.

**A.2.5.2 Water container.**


**A.2.5.3 Masking tape, silicone sealant and/or additional sealing materials.**

### **A.3 Preparation**

#### **A.3.1 Test specimen assembly part 1**

- 1) Insert the inlet bar and the pin plate on the steel plate. Next, pour the mortar (the mortar substrate part) in the mould inside the steel plate (see steps 1, 2 and 3 in [Figure A.4](#)).
- 2) Cure the mortar substrate part for 72 hours at  $20 \pm 3$  °C and  $>65$  % RH, then remove the hole plate, pin plate and inlet bar (see step 4 in [Figure A.4](#)).
- 3) Place the entire specimen at rest for more than 168 hours at  $20 \pm 3$  °C and  $>65$  % RH (see step 5 in [Figure A.4](#)).

STANDARDSISO.COM : Click to view the full PDF of ISO/TS 16774-1:2017

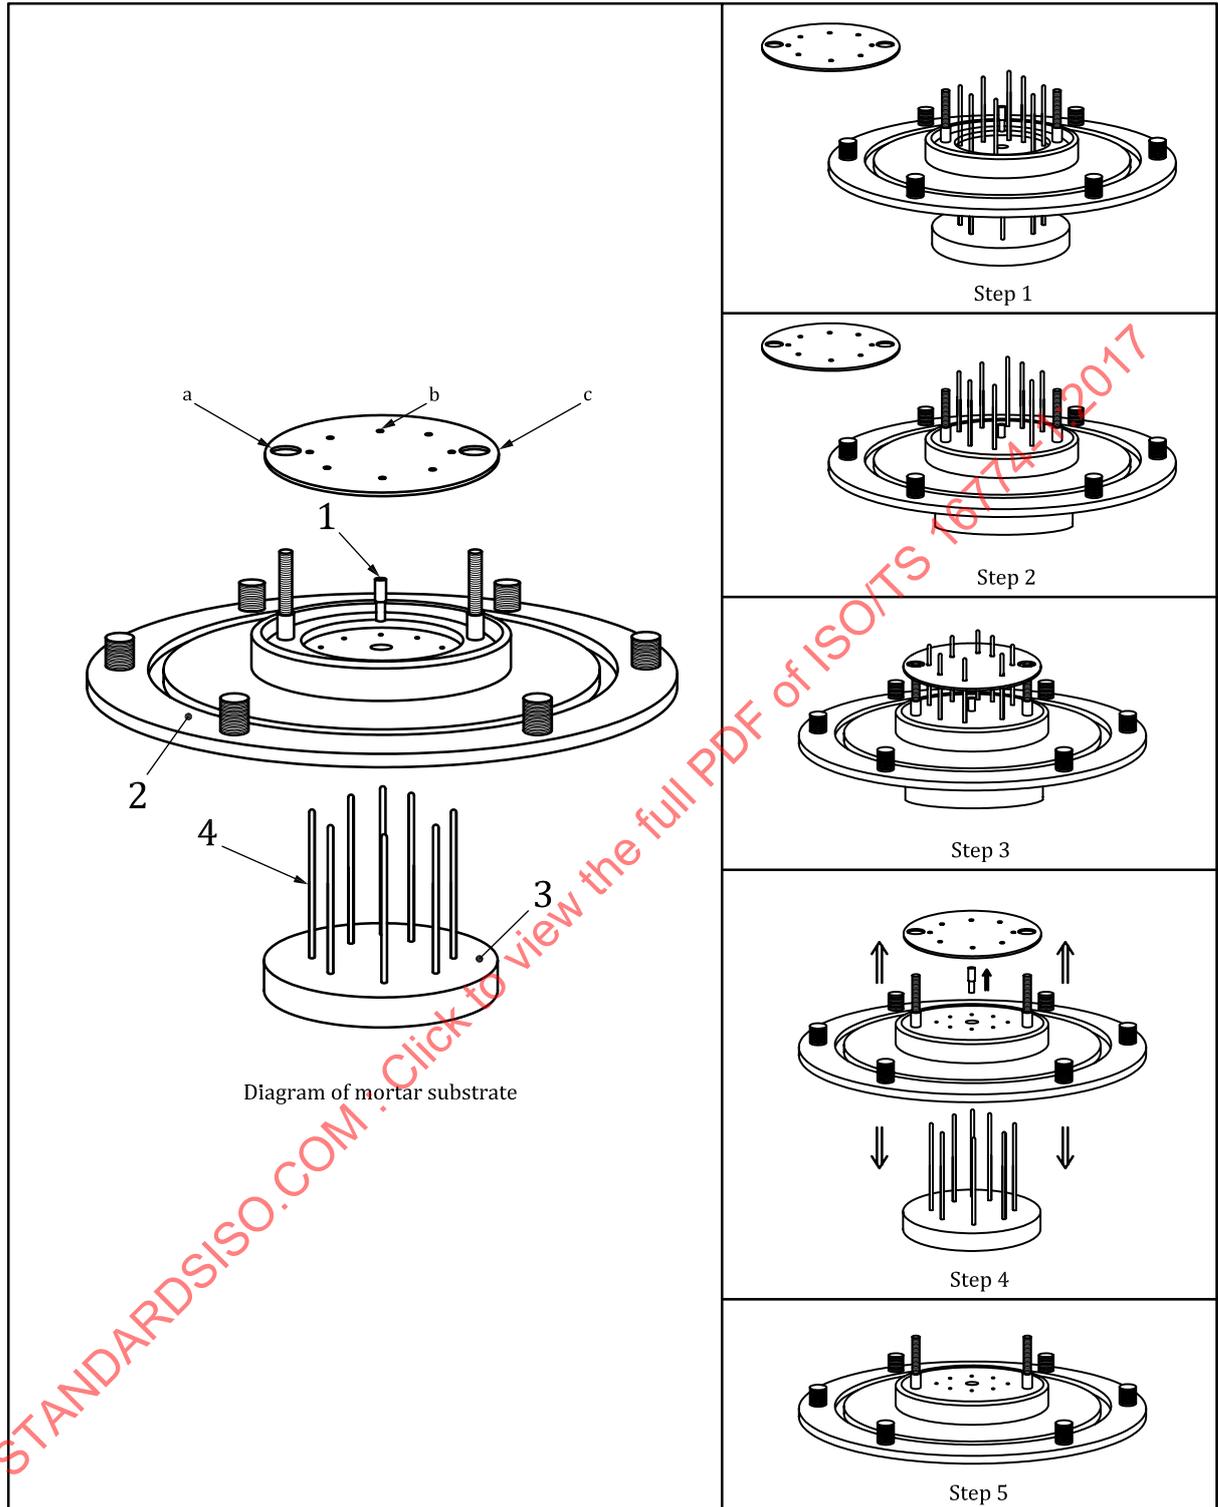

**Key**

- |   |   |   |   |
|---|---|---|---|
| 1 | inlet bar   | a | hole for connecting bolt ( $\varnothing$ 10 mm) |
| 2 | steel plate   | b | hole for fixing pins ( $\varnothing$ 2,5 mm)    |
| 3 | pin plate   | c | hole plate                                      |
| 4 | pins for leakage hole ( $\varnothing$ 2,4 mm $\times$ 100 mm) |   |   |


**Figure A.4 — Test specimen assembly part 1**

### A.3.2 Test specimen assembly part 2

- 1) Attach the non-woven fabric for filtering repair material particulates on the bottom of the steel plate, and fix it in place with the acrylic plate (steps 1, 2 and 3 in [Figure A.5](#)).
- 2) Place the upper acrylic substrate part on the bolts so that it lies horizontally over the steel plate, parallel to the placement of the mortar substrate part (step 4 in [Figure A.5](#)).
- 3) Place the acrylic band around the two substrate parts to cover the space openings on the side to prevent leakage during repair material injection. Apply silicone sealing if needed to close off the seams of the acrylic band for reinforced sealing (step 4 in [Figure A.5](#)).

STANDARDSISO.COM : Click to view the full PDF of ISO/TS 16774-1:2017

Dimensions in millimetres

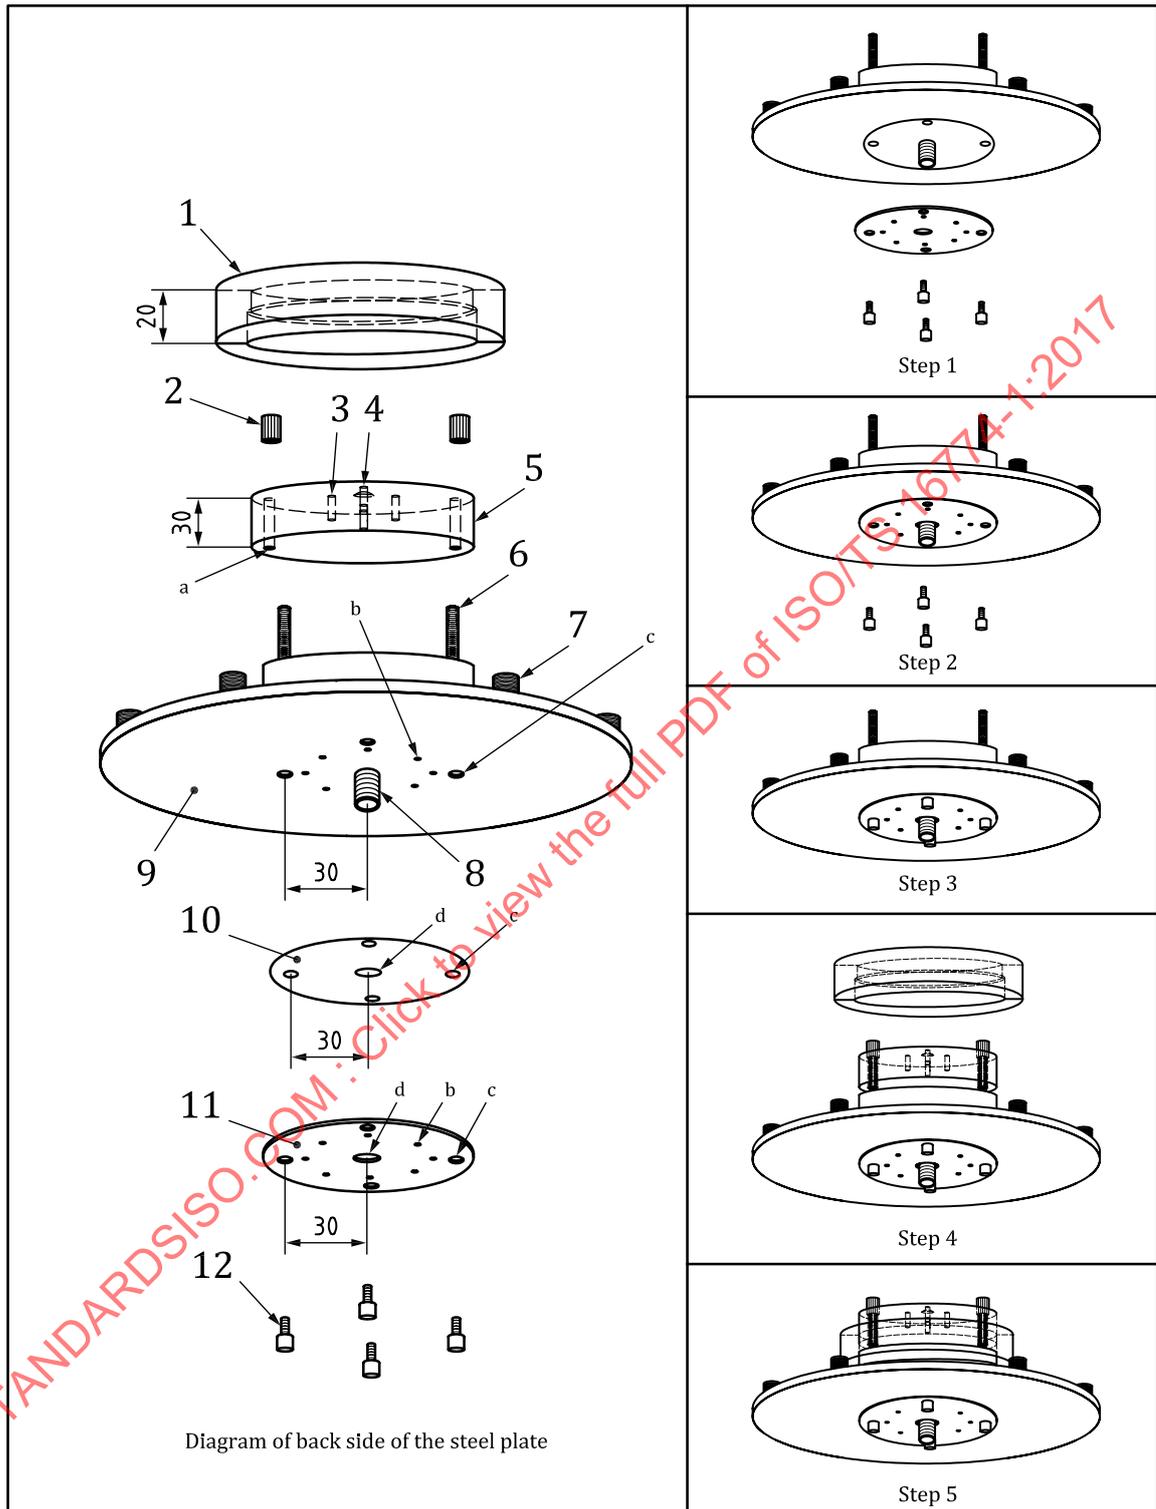

**Key**

- |  |   |
|--|---|
| 1 acrylic band for seal  | 9 steel plate for fixing mortar substrate               |
| 2 fixing nut for fixing mortar substrate ( $\varnothing$ 6 mm) | 10 non-woven fabric for filtering the repair material   |
| 3 nut for fixing ( $\varnothing$ 6 mm)                         | 11 acrylic plate for fixing non-woven fabric            |
| 4 level instrument   | 12 bolts for fixing acrylic plate ( $\varnothing$ 6 mm) |
| 5 upper substrate (acrylic)                                    | a hole for connecting bolt ( $\varnothing$ 8 mm)        |
| 6 bolt for connecting upper substrate specimen                 | b leakage hole ( $\varnothing$ 2,5 mm)                  |